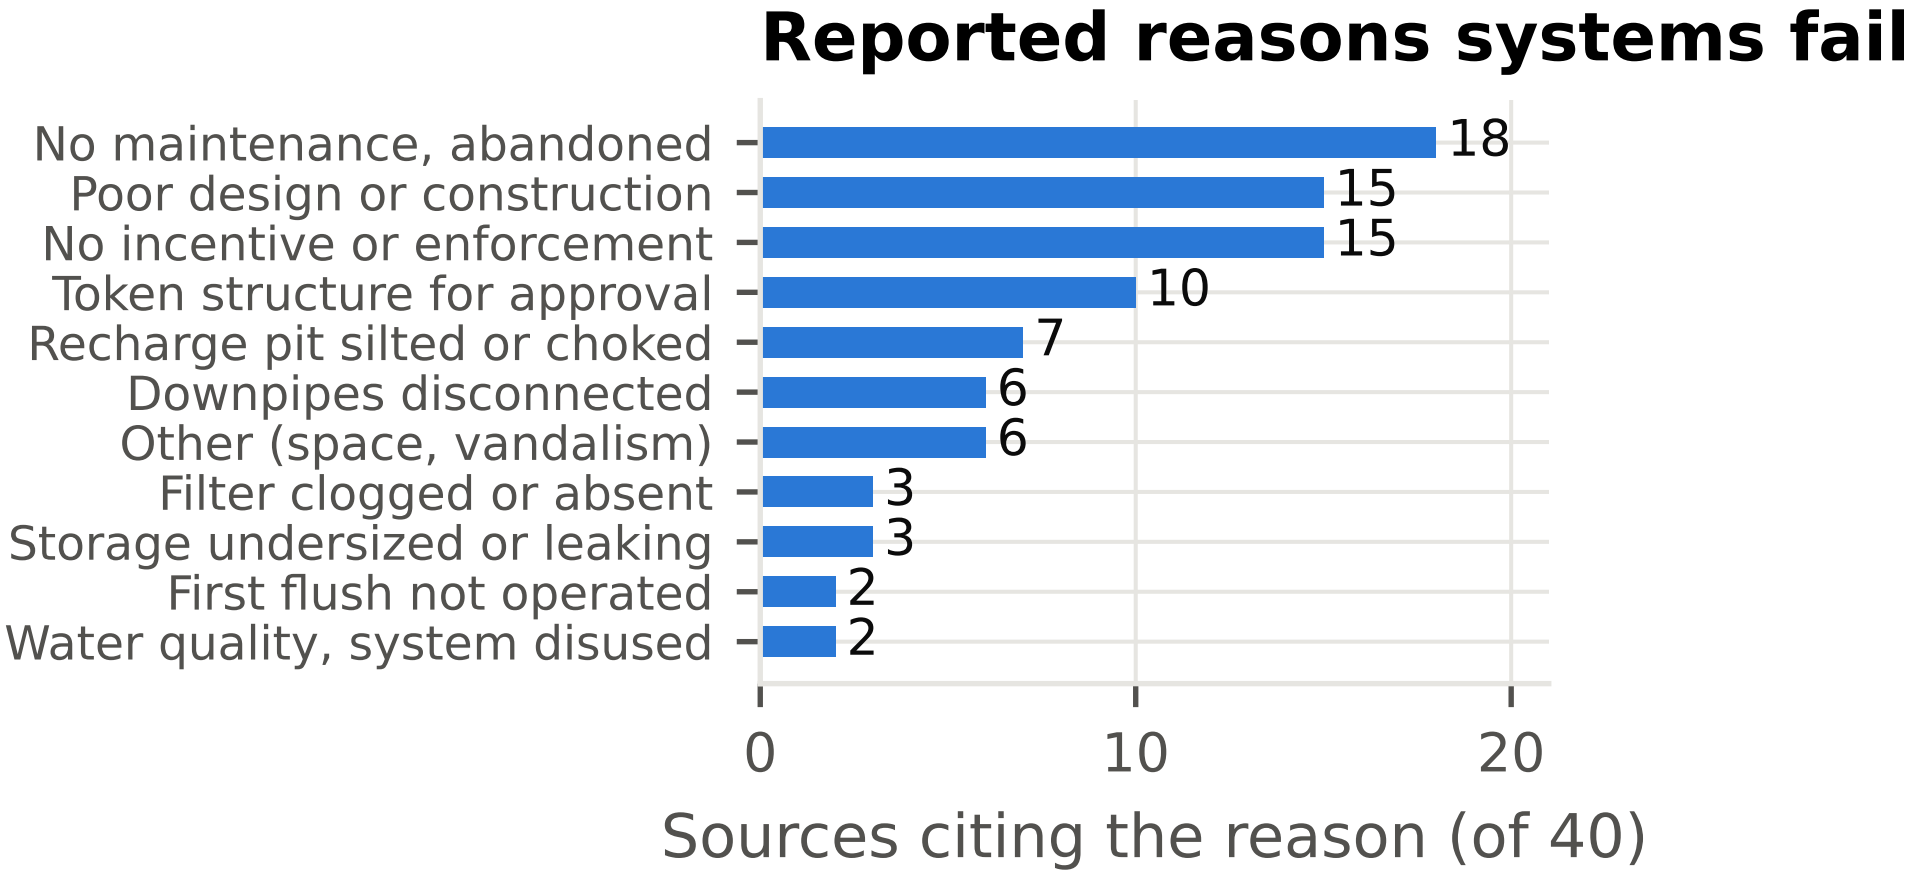
Reported reasons systems fail
No maintenance, abandoned
Poor design or construction
No incentive or enforcement
Token structure for approval
Recharge pit silted or choked
Downpipes disconnected
Other (space, vandalism)
Filter clogged or absent
Storage undersized or leaking
First flush not operated
Water quality, system disused
18
15
15
10
7
6
6
3
3
2
2
0
10
20
Sources citing the reason (of 40)