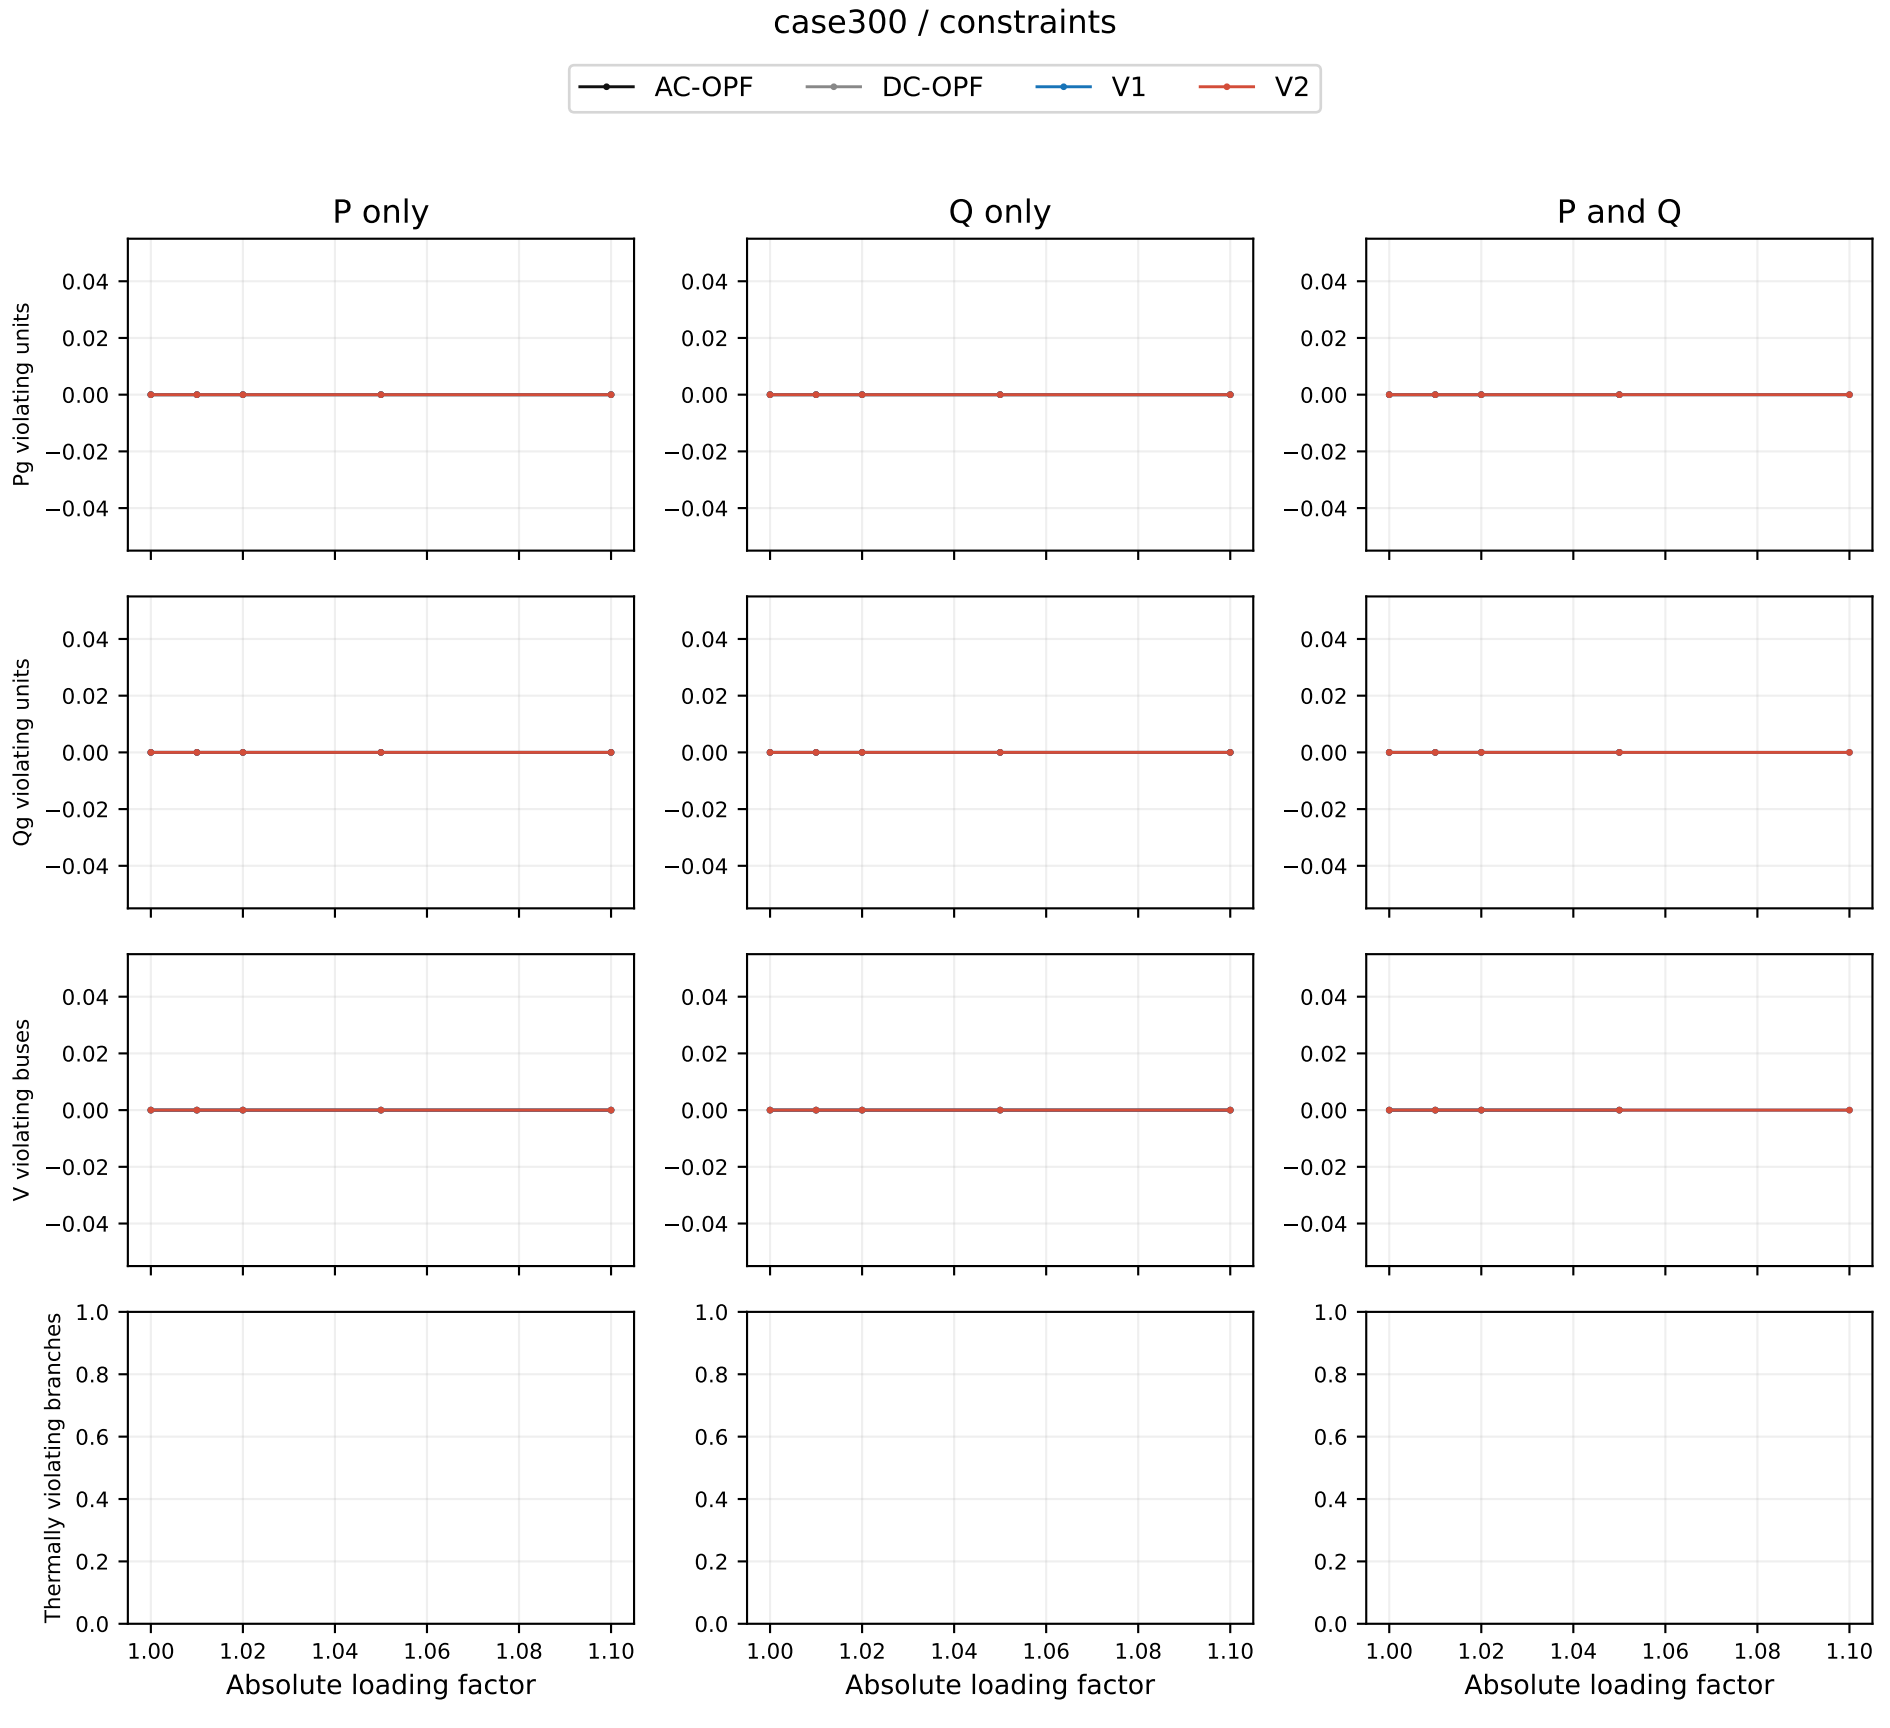
case300 / constraints
AC-OPF
DC-OPF
V1
V2
P only
Q only
P and Q
Pg violating units
Qg violating units
V violating buses
Thermally violating branches
0.04
0.02
0.00
−0.02
−0.04
1.0
0.8
0.6
0.4
0.2
0.0
1.00
1.02
1.04
1.06
1.08
1.10
Absolute loading factor