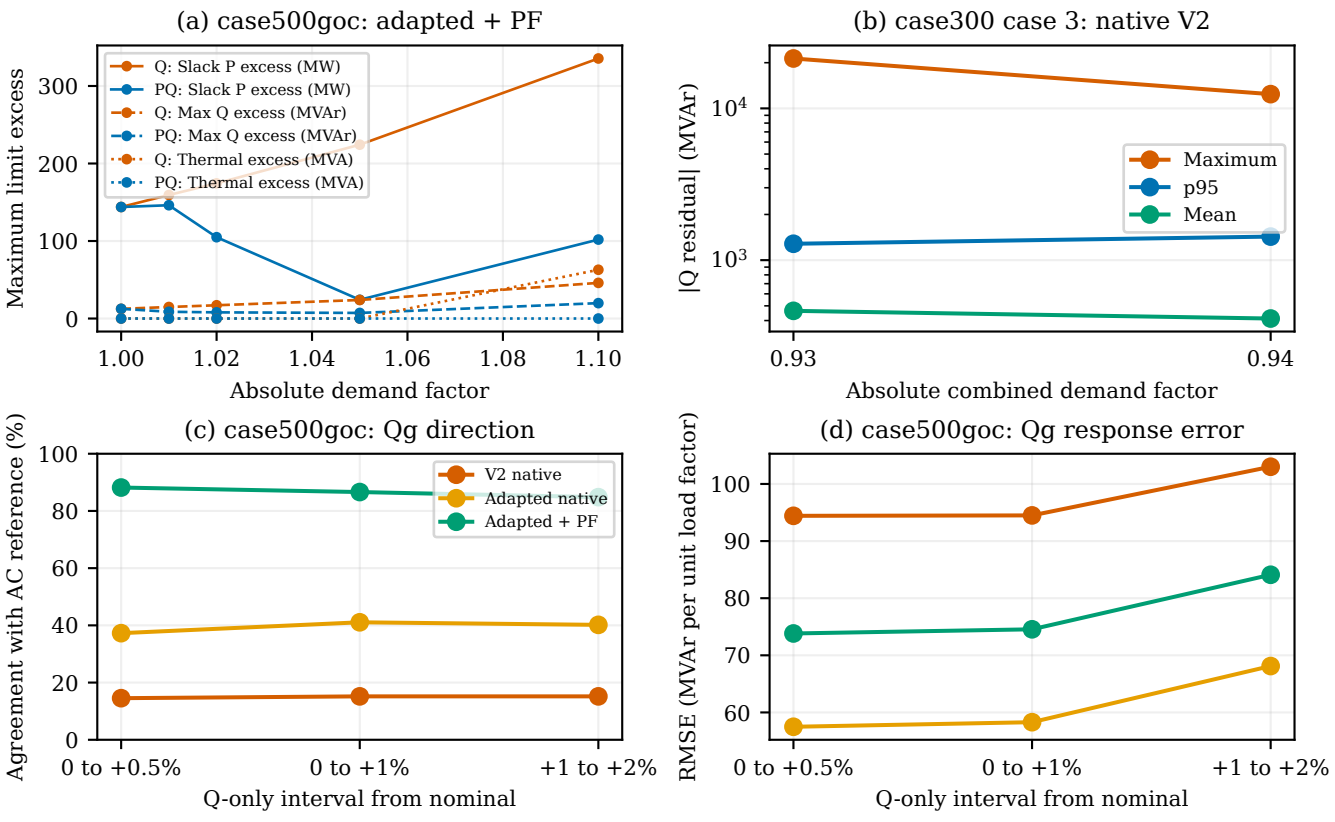
(a) case500goc: adapted + PF
Q: Slack P excess (MW)
PQ: Slack P excess (MW)
Q: Max Q excess (MVAr)
PQ: Max Q excess (MVAr)
Q: Thermal excess (MVA)
PQ: Thermal excess (MVA)
Maximum limit excess
Absolute demand factor
(b) case300 case 3: native V2
Maximum
p95
Mean
|Q residual| (MVAr)
Absolute combined demand factor
(c) case500goc: Qg direction
V2 native
Adapted native
Adapted + PF
Agreement with AC reference (%)
0 to +0.5%
0 to +1%
+1 to +2%
Q-only interval from nominal
(d) case500goc: Qg response error
RMSE (MVAr per unit load factor)
Q-only interval from nominal