Frozen GridSFM: demand location and physical validity

12 completed electrical inputs | verified AC references 10/12 | native joint passes 0/24

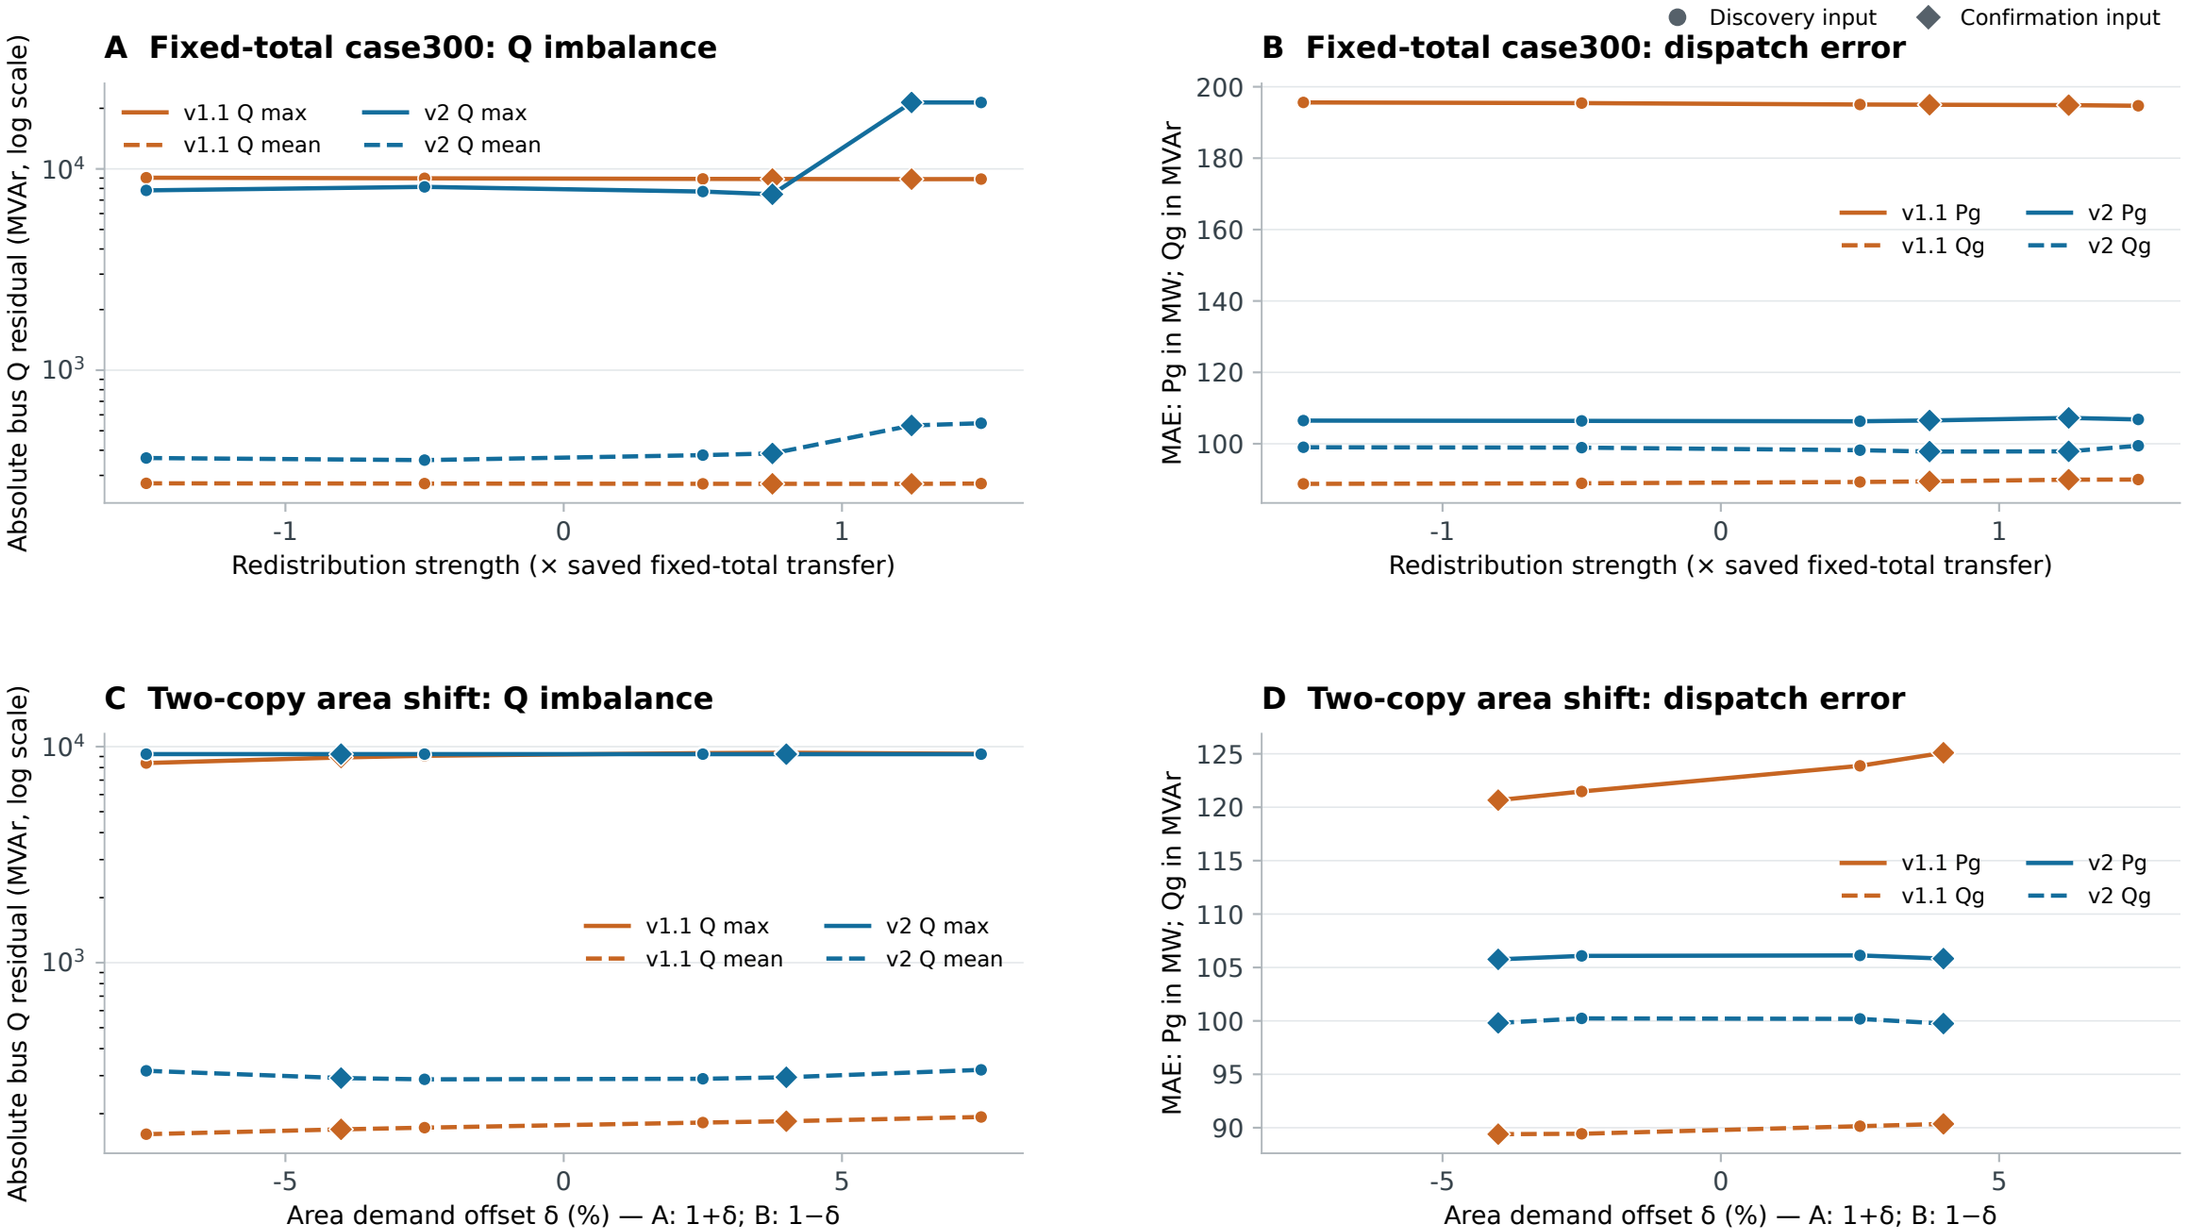

Only completed saved inputs. Accuracy is N/A when the AC reference is UNKNOWN; lines connect sampled settings only.

Original case300 thermal assessment is N/A; connected-system thermal coverage is limited to the existing finite-rated ties.