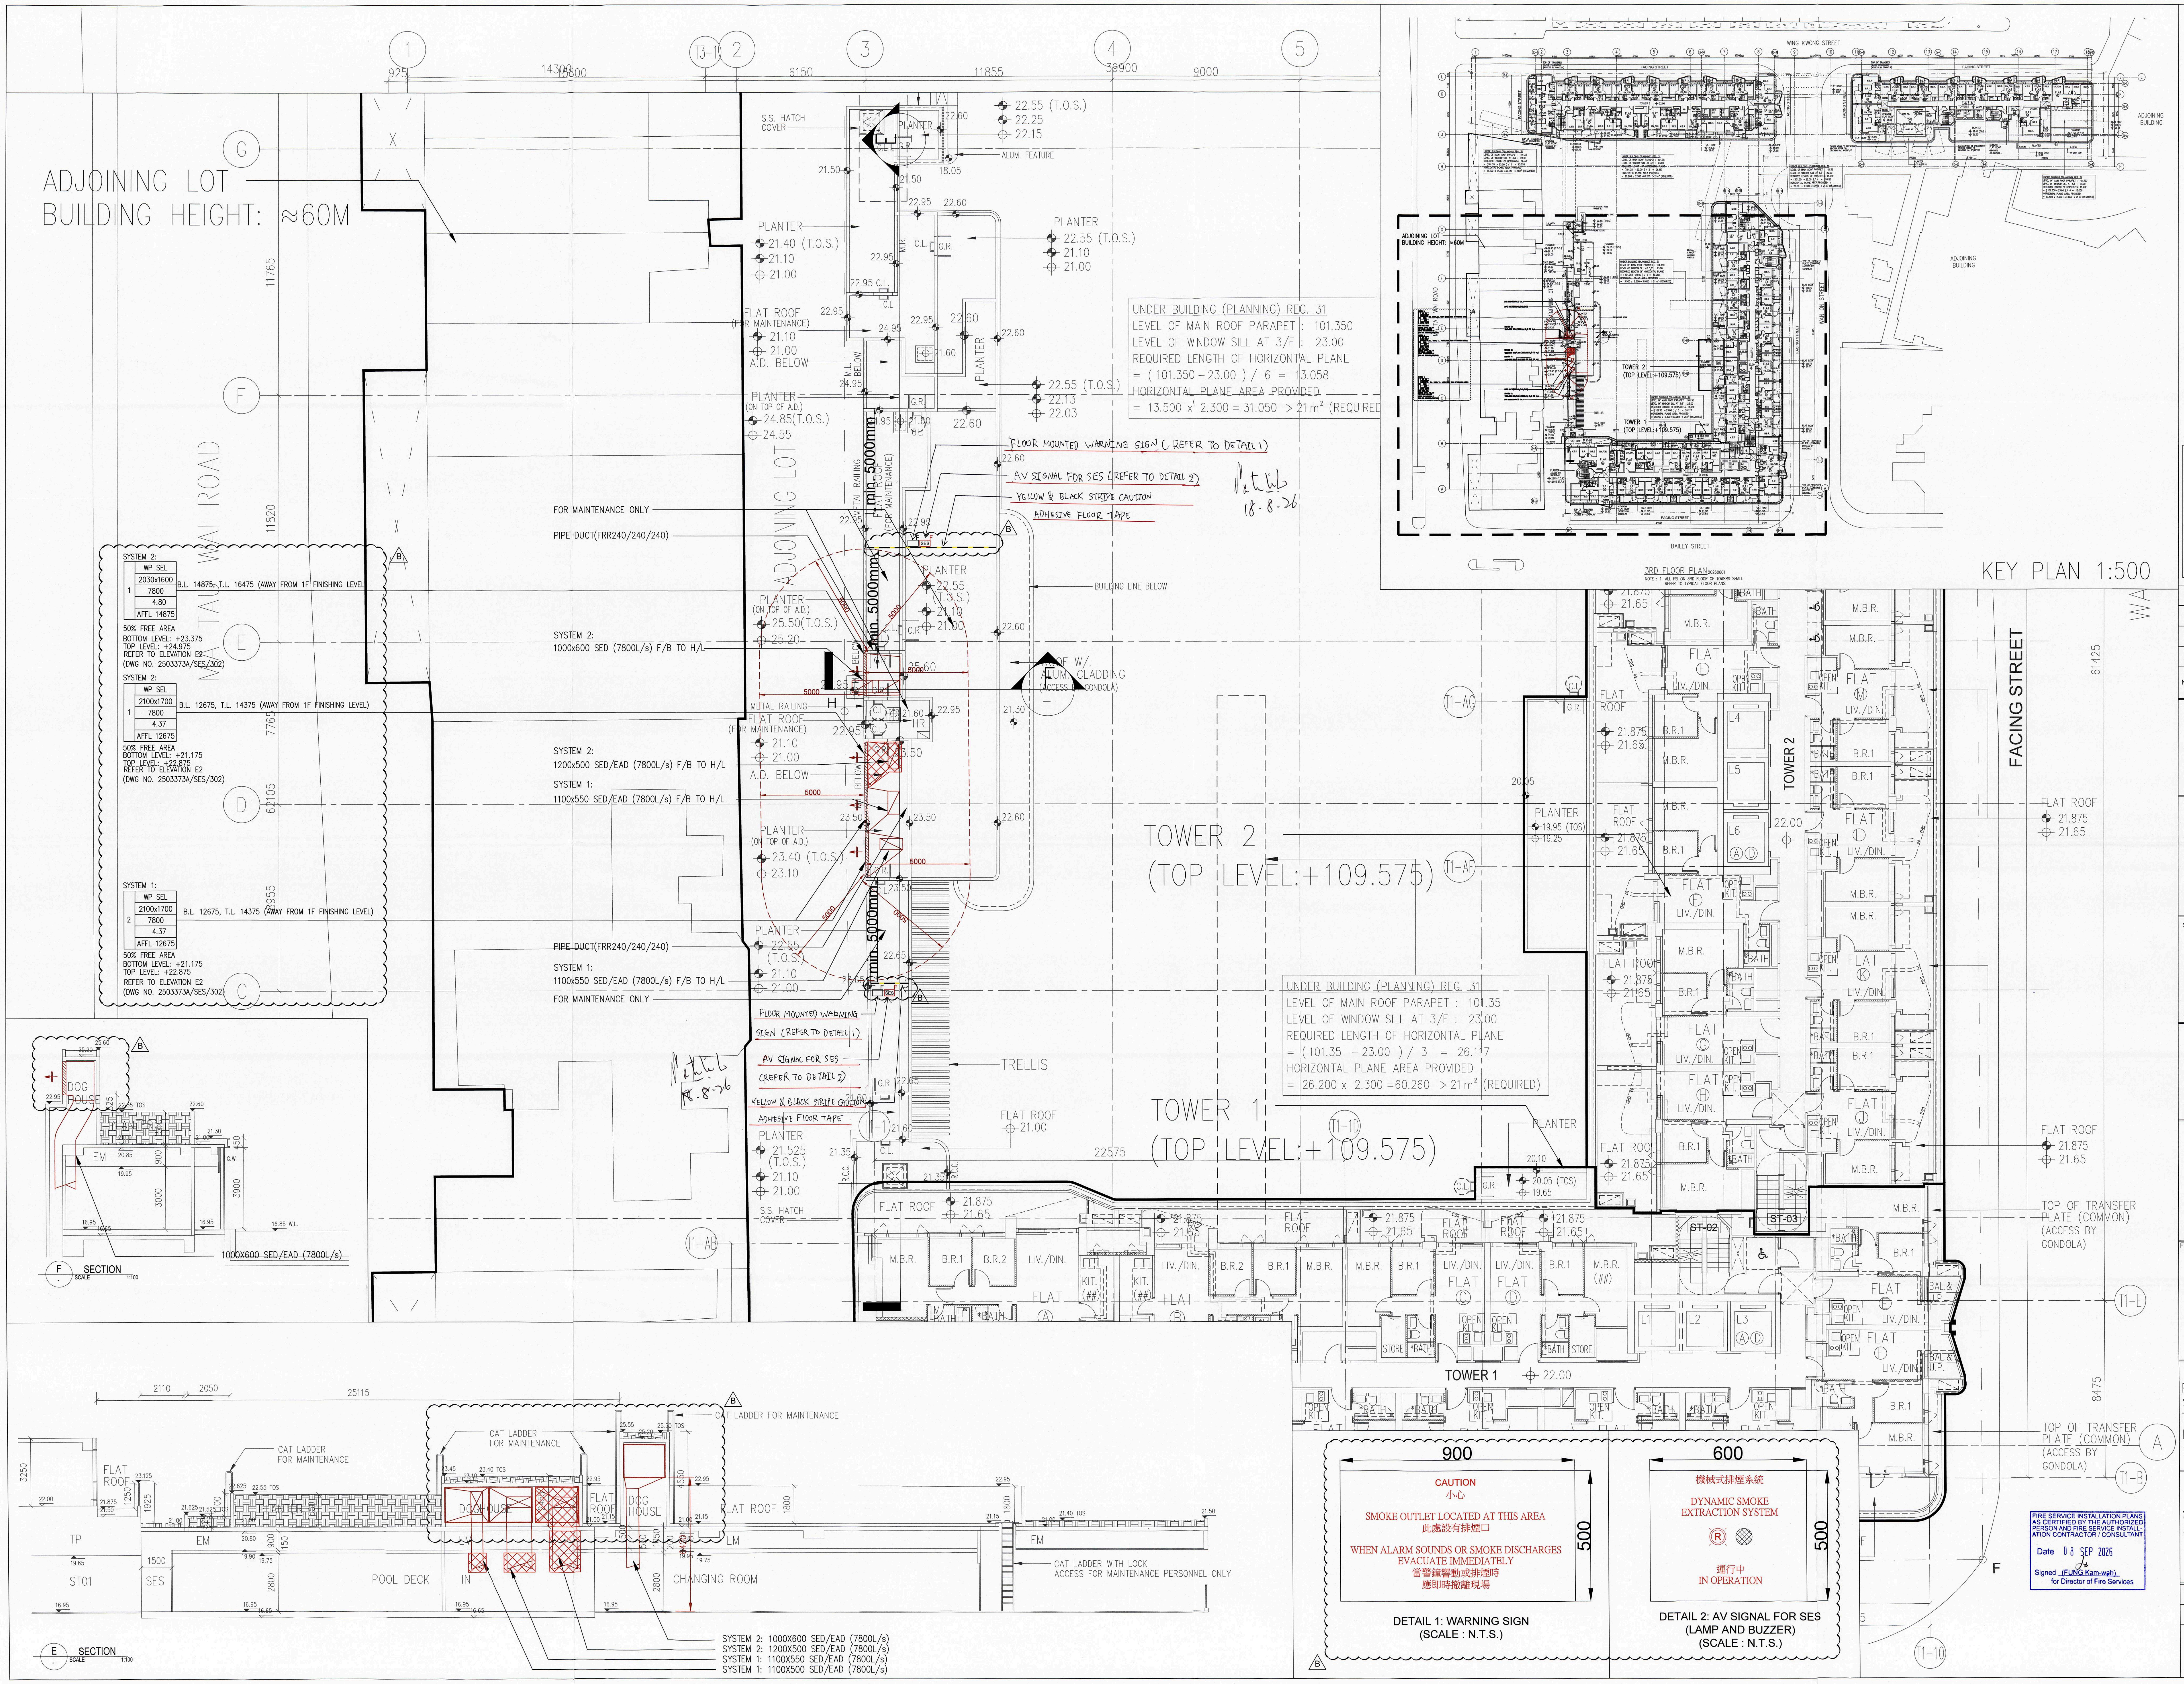
ADJOINING LOT
BUILDING HEIGHT: ≈60M
MA TAU WAI ROAD
ADJOINING LOT
TOWER 2
(TOP LEVEL:+109.575)
TOWER 1
(TOP LEVEL:+109.575)
FACING STREET
KEY PLAN 1:500
3RD FLOOR PLAN
FOR MAINTENANCE ONLY
PIPE DUCT(FRR240/240/240)
SYSTEM 2:
1000x600 SED (7800L/s) F/B TO H/L
SYSTEM 2:
1200x500 SED/EAD (7800L/s) F/B TO H/L
SYSTEM 1:
1100x550 SED/EAD (7800L/s) F/B TO H/L
PIPE DUCT(FRR240/240/240)
SYSTEM 1:
1100x550 SED/EAD (7800L/s) F/B TO H/L
FOR MAINTENANCE ONLY
min. 5000mm
min. 5000mm
min. 5000mm
5000
METAL RAILING
FLAT ROOF (FOR MAINTENANCE)
PLANTER (ON TOP OF A.D.)
A.D. BELOW
S.S. HATCH COVER
ALUM. FEATURE
BUILDING LINE BELOW
TRELLIS
FLAT ROOF
TOP OF TRANSFER PLATE (COMMON) (ACCESS BY GONDOLA)
SECTION E
SECTION F
CAT LADDER FOR MAINTENANCE
CAT LADDER WITH LOCK ACCESS FOR MAINTENANCE PERSONNEL ONLY
DOG HOUSE
POOL DECK
CHANGING ROOM
1000X600 SED/EAD (7800L/s)
SYSTEM 2: 1000X600 SED/EAD (7800L/s)
SYSTEM 2: 1200X500 SED/EAD (7800L/s)
SYSTEM 1: 1100X550 SED/EAD (7800L/s)
SYSTEM 1: 1100X500 SED/EAD (7800L/s)
900
500
600
500

UNDER BUILDING (PLANNING) REG. 31
LEVEL OF MAIN ROOF PARAPET : 101.350
LEVEL OF WINDOW SILL AT 3/F : 23.00
REQUIRED LENGTH OF HORIZONTAL PLANE
= (101.350 – 23.00) / 6 = 13.058
HORIZONTAL PLANE AREA PROVIDED
= 13.500 x 2.300 = 31.050 > 21 m² (REQUIRED

UNDER BUILDING (PLANNING) REG. 31
LEVEL OF MAIN ROOF PARAPET : 101.35
LEVEL OF WINDOW SILL AT 3/F : 23.00
REQUIRED LENGTH OF HORIZONTAL PLANE
= (101.35 – 23.00) / 3 = 26.117
HORIZONTAL PLANE AREA PROVIDED
= 26.200 x 2.300 =60.260 > 21 m² (REQUIRED)

FLOOR MOUNTED WARNING SIGN (REFER TO DETAIL 1)
AV SIGNAL FOR SES (REFER TO DETAIL 2)
YELLOW & BLACK STRIPE CAUTION
ADHESIVE FLOOR TAPE

18-8-26

FLOOR MOUNTED WARNING SIGN (REFER TO DETAIL 1)
AV SIGNAL FOR SES (REFER TO DETAIL 2)
YELLOW & BLACK STRIPE CAUTION
ADHESIVE FLOOR TAPE

18-8-26

SYSTEM 2:
WP SEL
2030x1600
1
7800
4.80
AFFL 14875
B.L. 14875, T.L. 16475 (AWAY FROM 1F FINISHING LEVEL
50% FREE AREA
BOTTOM LEVEL: +23.375
TOP LEVEL: +24.975
REFER TO ELEVATION E2
(DWG NO. 2503373A/SES/302)

SYSTEM 2:
WP SEL
2100x1700
1
7800
4.37
AFFL 12675
B.L. 12675, T.L. 14375 (AWAY FROM 1F FINISHING LEVEL)
50% FREE AREA
BOTTOM LEVEL: +21.175
TOP LEVEL: +22.875
REFER TO ELEVATION E2
(DWG NO. 2503373A/SES/302)

SYSTEM 1:
WP SEL
2100x1700
2
7800
4.37
AFFL 12675
B.L. 12675, T.L. 14375 (AWAY FROM 1F FINISHING LEVEL)
50% FREE AREA
BOTTOM LEVEL: +21.175
TOP LEVEL: +22.875
REFER TO ELEVATION E2
(DWG NO. 2503373A/SES/302)

CAUTION
小心
SMOKE OUTLET LOCATED AT THIS AREA
此處設有排煙口
WHEN ALARM SOUNDS OR SMOKE DISCHARGES
EVACUATE IMMEDIATELY
當警鐘響動或排煙時
應即時撤離現場

DETAIL 1: WARNING SIGN
(SCALE : N.T.S.)

機械式排煙系統
DYNAMIC SMOKE
EXTRACTION SYSTEM
R
運行中
IN OPERATION

DETAIL 2: AV SIGNAL FOR SES
(LAMP AND BUZZER)
(SCALE : N.T.S.)

FIRE SERVICE INSTALLATION PLANS
AS CERTIFIED BY THE AUTHORIZED
PERSON AND FIRE SERVICE INSTALL-
ATION CONTRACTOR / CONSULTANT
Date 08 SEP 2026
Signed (FUNG Kam-wah)
for Director of Fire Services

LOO Kwan Wai
(RPE No.: RP0260258)

NO.	DATE	REVISIONS	DRAFTED	CHECKED	DESIGNED	REVIEWED
B	06/2026	FSD THIRD SUBMISSION	HYH	WWC	HYH	TKL
A	09/2025	FSD SECOND SUBMISSION	HYH	WWC	HYH	TKL
0	05/2025	FSD FIRST SUBMISSION	HYH	WWC	HYH	TKL

CLIENT:
NATION STAR DEVELOPMENT LIMITED
75/F, 8 Finance Street,
Central, Hong Kong

PROJECT ARCHITECT & AUTHORIZED PERSON:
RONALD LU & PARTNERS
呂元祥建築師事務所
33rd Floor, Wu Chung house, 213 Queen's Road East,
Wanchai, Hong Kong

STRUCTURAL/GEOTECHNICAL
wsp
7/F, One Kowloon
1 Wang Yuen Street
Kowloon Bay, Hong Kong

BUILDING SERVICES ENGINEER:
wsp
7/F, One Kowloon
1 Wang Yuen Street
Kowloon Bay, Hong Kong

QUANTITY SURVEYOR:
ARCADIS
17/F, Two Harbour Square, 180 Wai Yip Street,
Kwun Tong, Kowloon
Hong Kong

FIRE SERVICES CONTRACTOR:
開創工程有限公司
GRAND CREATIVE ENGINEERS LIMITED

PROJECT:
PROPOSED DEVELOPMENT AT BAILEY STREET & WING KWONG STREET, TO KWA WAN, KOWLOON
INLAND LOT NO. 11279
(URA PROJECT KC-009)

TITLE:
SMOKE EXTRACTION SYSTEM-
3/F LAYOUT (SHEET 1 OF 1)

DATE: 06/2026		SCALE: 1:100@A0	
DRAFTED: HYH	CHECKED: WWC	DESIGNED: HYH	REVIEWED: TKL
JOB NO. 2503373A	DRAWING NO. 2503373A/SES/201		REV. NO. B

19