
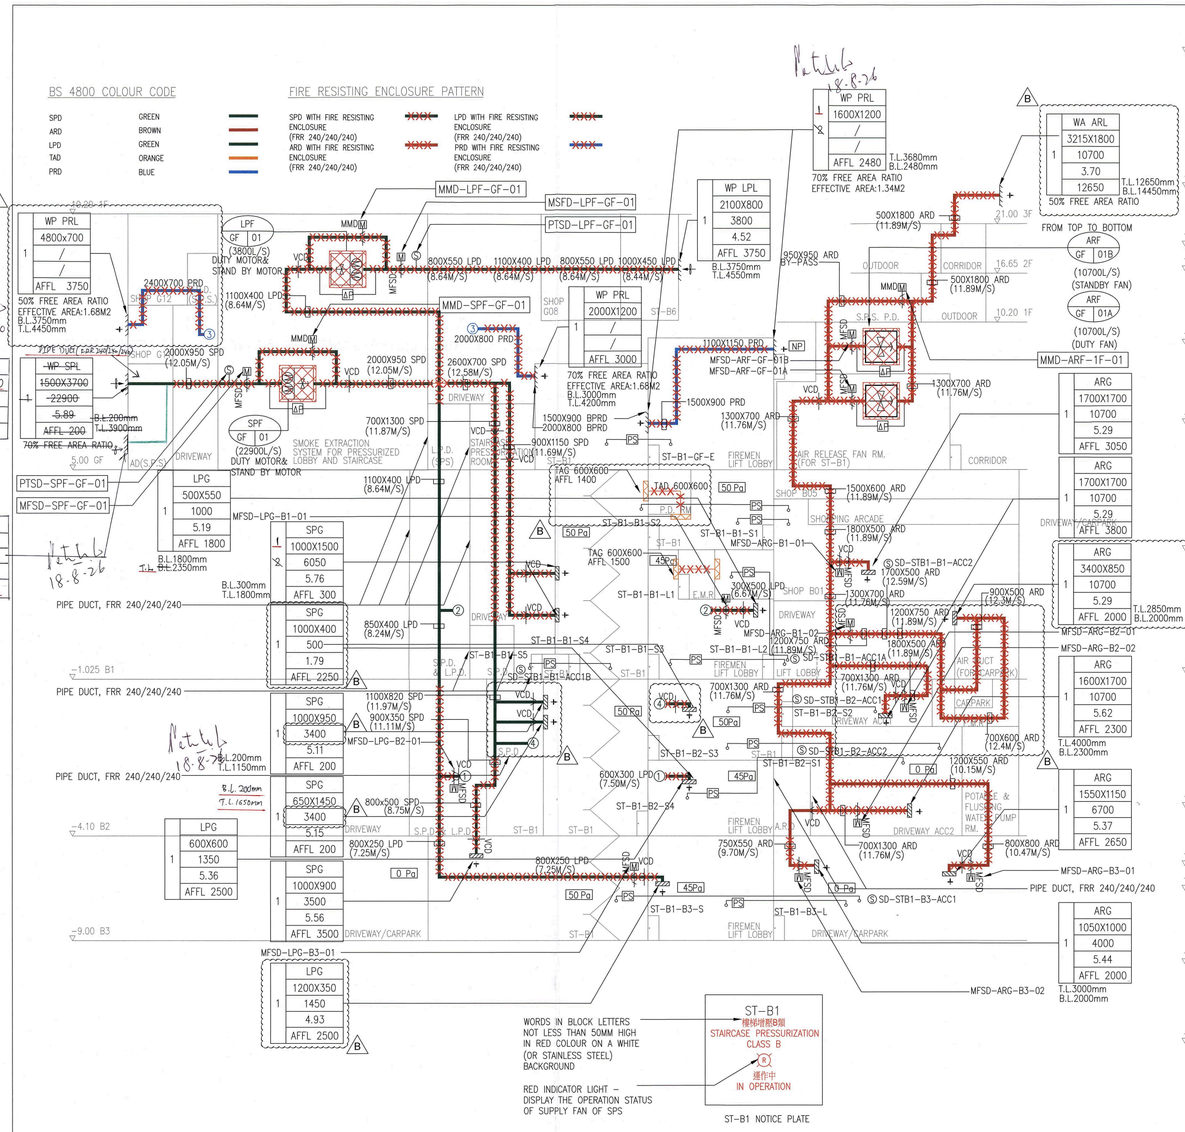


STAIRCASE PRESSURIZATION SYSTEM SCHEMATIC DIAGRAM (ST-B1) (CLASS B)

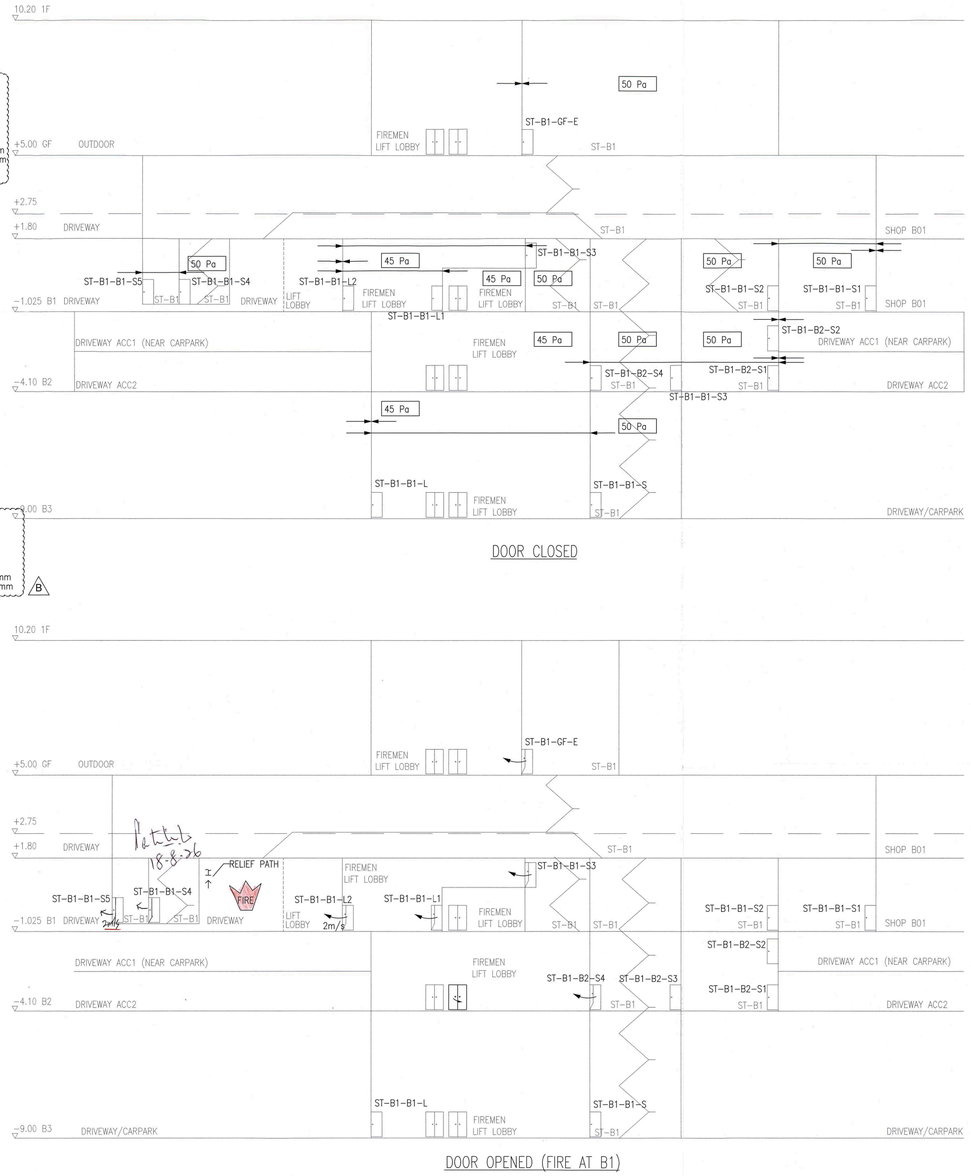

MODE TABLE FOR ST-B1 STAIRCASE PRESSURIZATION SYSTEM

MODE		FAN						MFSD/MMD														
		STAIRCASE PRESSURIZATION FAN		LOBBY PRESSURIZATION FAN		AIR RELEASE FAN		STAIRCASE PRESSURIZATION		LOBBY PRESSURIZATION				AIR RELEASE								
								MFSD AT INTAKE	MMD AT BYPASS	MFSD AT INTAKE	MMD AT BYPASS	MFSD AT FIRE LOBBY			MFSD AT ARF		MFSD AT BYPASS	MFSD AT ACC				
		SPF-GF-01 (DUTY MOTOR)	SPF-GF-01 (STANDBY MOTOR)	LPF-GF-01 (DUTY MOTOR)	LPF-GF-01 (STANDBY MOTOR)	ARF-GF-01A (DUTY FAN)	ARF-GF-01B (STANDBY FAN)	MFSD-SPF-GF-01	MMD-SPF-GF-01	MFSD-LPF-GF-01	MMD-LPF-GF-01	MFSD-LPG-B3-01	MFSD-LPG-B2-01	MFSD-LPG-B1-01	MFSD-ARF-GF-01A	MFSD-ARF-GF-01B	MMD-ARF-1F-01	MFSD-ARG-B3-01	MFSD-ARG-B3-02	MFSD-ARG-B2-01	MFSD-ARG-B2-02	MFSD-ARG-B1-01	MFSD-ARG-B1-02
NORMAL MODE		OFF	OFF	OFF	OFF	OFF	OFF	CLOSE	CLOSE	CLOSE	CLOSE	CLOSE	CLOSE	CLOSE	CLOSE	CLOSE	CLOSE	CLOSE	CLOSE	CLOSE	CLOSE	CLOSE	CLOSE
FIRE MODE	FIRE ON B3 (DRIVEWAY/CARPARK)	ON	STANDBY	ON	STANDBY	ON	STANDBY	OPEN	MODULATING	OPEN	MODULATING	OPEN	OPEN	OPEN	OPEN	STANDBY	MODULATING	OPEN	OPEN	CLOSE	CLOSE	CLOSE	CLOSE
	FIRE ON B2 (DRIVEWAY ACC1) (NEAR CARPARK)	ON	STANDBY	ON	STANDBY	ON	STANDBY	OPEN		OPEN		OPEN	OPEN	OPEN	OPEN	STANDBY		CLOSE	CLOSE	OPEN	CLOSE	CLOSE	CLOSE
	FIRE ON B2 (DRIVEWAY ACC2)	ON	STANDBY	ON	STANDBY	ON	STANDBY	OPEN		OPEN		OPEN	OPEN	OPEN	OPEN	STANDBY		CLOSE	CLOSE	CLOSE	OPEN	CLOSE	CLOSE
	FIRE ON B1 (SHOP B01)	ON	STANDBY	ON	STANDBY	ON	STANDBY	OPEN		OPEN		OPEN	OPEN	OPEN	OPEN	STANDBY		CLOSE	CLOSE	CLOSE	CLOSE	OPEN	CLOSE
	FIRE ON B1 (DRIVEWAY)	ON	STANDBY	ON	STANDBY	ON	STANDBY	OPEN		OPEN		OPEN	OPEN	OPEN	OPEN	STANDBY		CLOSE	CLOSE	CLOSE	CLOSE	CLOSE	OPEN
PROBE TYPE DETECTOR AT INTAKE DUCT	PTSD-SPF-GF-01	OFF	OFF	OFF	OFF	ON	STANDBY	CLOSE	CLOSE	CLOSE	CLOSE	CLOSE	CLOSE	CLOSE	OPEN	CLOSE	ALL DAMPER POSITION SAME AS FIRE MODE						
	PTSD-LPF-GF-01	ON	STANDBY	OFF	OFF	ON	STANDBY	OPEN	MODULATING	CLOSE	CLOSE	CLOSE	CLOSE	CLOSE	OPEN	CLOSE							
NO POWER MODE		OFF	OFF	OFF	OFF	OFF	OFF	CLOSE	OPEN	CLOSE	OPEN	CLOSE	CLOSE	CLOSE	CLOSE	CLOSE	OPEN	CLOSE	CLOSE	CLOSE	CLOSE	CLOSE	CLOSE

LEGEND

- CLOSED DOOR
- OPEN DOOR
- CLOSED FS LIFT DOOR
- OPENED FS LIFT DOOR

SYSTEM ACTUATION AND CONTROL

1. THE STAIRCASE AND LOBBY PRESSURIZATION FANS WILL BE ACTUATED AUTOMATICALLY UNTIL MANUAL RESET UPON THE RECEIPT OF EITHER THE FOLLOWING SIGNAL:
   (A) FIRE SIGNAL TRANSMITTED FROM AUTOMATIC FIRE ALARM PANEL INCLUDING SMOKE DETECTORS, HEAT DETECTORS, SPRINKLER FLOW SWITCH OR MANUAL BREAK GLASS.
   (B) SMOKE DETECTOR INSTALLED AT A DISTANCE NOT EXCEEDING 1M FROM AND OUTSIDE THE ACCESS DOOR TO EITHER THE FIREMAN'S LIFT LOBBY OR THE PRESSURIZED STAIRCASE.
2. THE ACCOMMODATION AIR RELEASE FAN WILL BE ACTUATED AUTOMATICALLY UNTIL MANUAL RESET UPON RECEIPT OF SIGNAL AS MENTIONED IN ITEM 1(A) & 1(B) ABOVE EXCEPT MANUAL BREAK GLASS.
3. WHEN A FIRE SIGNAL AS MENTIONED IN ITEM 1(A) & 1(B) ABOVE IS RECEIVED ON THE FIRE FLOOR, THE RESPECTIVE AIR RELEASE MOTORIZED FIRE AND SMOKE DAMPERS WILL BE OPENED FOR THE RESPECTIVE ACCOMMODATION AIR RELEASE ONLY. ALL OTHER DAMPERS AT OTHER FLOORS FOR THE AIR RELEASE SYSTEM SHALL BE REMAINED CLOSED TO MAINTAIN COMPARTMENTATION.

FIRE SERVICE INSTALLATION PLANS AS CERTIFIED BY THE AUTHORIZED PERSON AND FIRE SERVICE INSTALLATION CONTRACTOR / CONSULTANT
Date 27 AUG 2026
Signed (FUNG Kam-wah)
for Director of Fire Services

LOO Kwan Wai
(RPE No.: RP0260258)

NO.	DATE	REVISIONS	DRAFTED	CHECKED	DESIGNED	REVIEWED
B	06/2026	FSD THIRD SUBMISSION	HYH	WWC	HYH	TKL
A	07/2025	FSD SECOND SUBMISSION	HYH	WWC	HYH	TKL
0	03/2025	FSD FIRST SUBMISSION	HYH	WWC	HYH	TKL

CLIENT:

NATION STAR DEVELOPMENT LIMITED
75/F, 8 Finance Street,
Central, Hong Kong

PROJECT ARCHITECT & AUTHORIZED PERSON:
RONALD LU & PARTNERS 呂元祥建築師事務所
33rd Floor, Wu Chung house, 213 Queen's Road East, Wanchai, Hong Kong

STRUCTURAL/GEOTECHNICAL:
wsp
7/F, One Kowloon
1 Wang Yuen Street
Kowloon Bay, Hong Kong

BUILDING SERVICES ENGINEER:
wsp
7/F, One Kowloon
1 Wang Yuen Street
Kowloon Bay, Hong Kong

QUANTITY SURVEYOR:
ARCADIS
17/F, Two Harbour Square, 180 Wai Yip Street,
Kwun Tong, Kowloon
Hong Kong

FIRE SERVICES CONTRACTOR:
開創工程有限公司
GRAND CREATIVE ENGINEERS LIMITED
CLASS 1 & 2 REGISTERED FIRE SERVICES CONTRACTOR
WSD LICENSED PLUMBER I GRADE 1 I
EMSD REGISTERED ELECTRICAL CONTRACTOR
陳廣開
Chan Kwong Hoi
Director
Unit D, 2/F, Cheong Wah Comm. Bldg., 900-904 Canton Road, Kowloon.
Mobile : 9015 9586 Tel : 3612 5782 Fax : 3612 5785
Email : info@grandcreative.com.hk

PROJECT:
PROPOSED DEVELOPMENT AT BAILEY STREET & WING KWONG STREET, TO KWA WAN, KOWLOON
INLAND LOT NO. 11279
(URA PROJECT KC-009)

TITLE:
STAIRCASE PRESSURIZATION SYSTEM-SCHEMATIC DIAGRAM FOR ST-B1

(2)

DATE: 06/2026	SCALE: NTS@A0		
DRAFTED: HYH	CHECKED: WWC	DESIGNED: HYH	REVIEWED: TKL
JOB NO. 2503373A	DRAWING NO. 2503373A/SPS/STB1/101		REV. NO. B