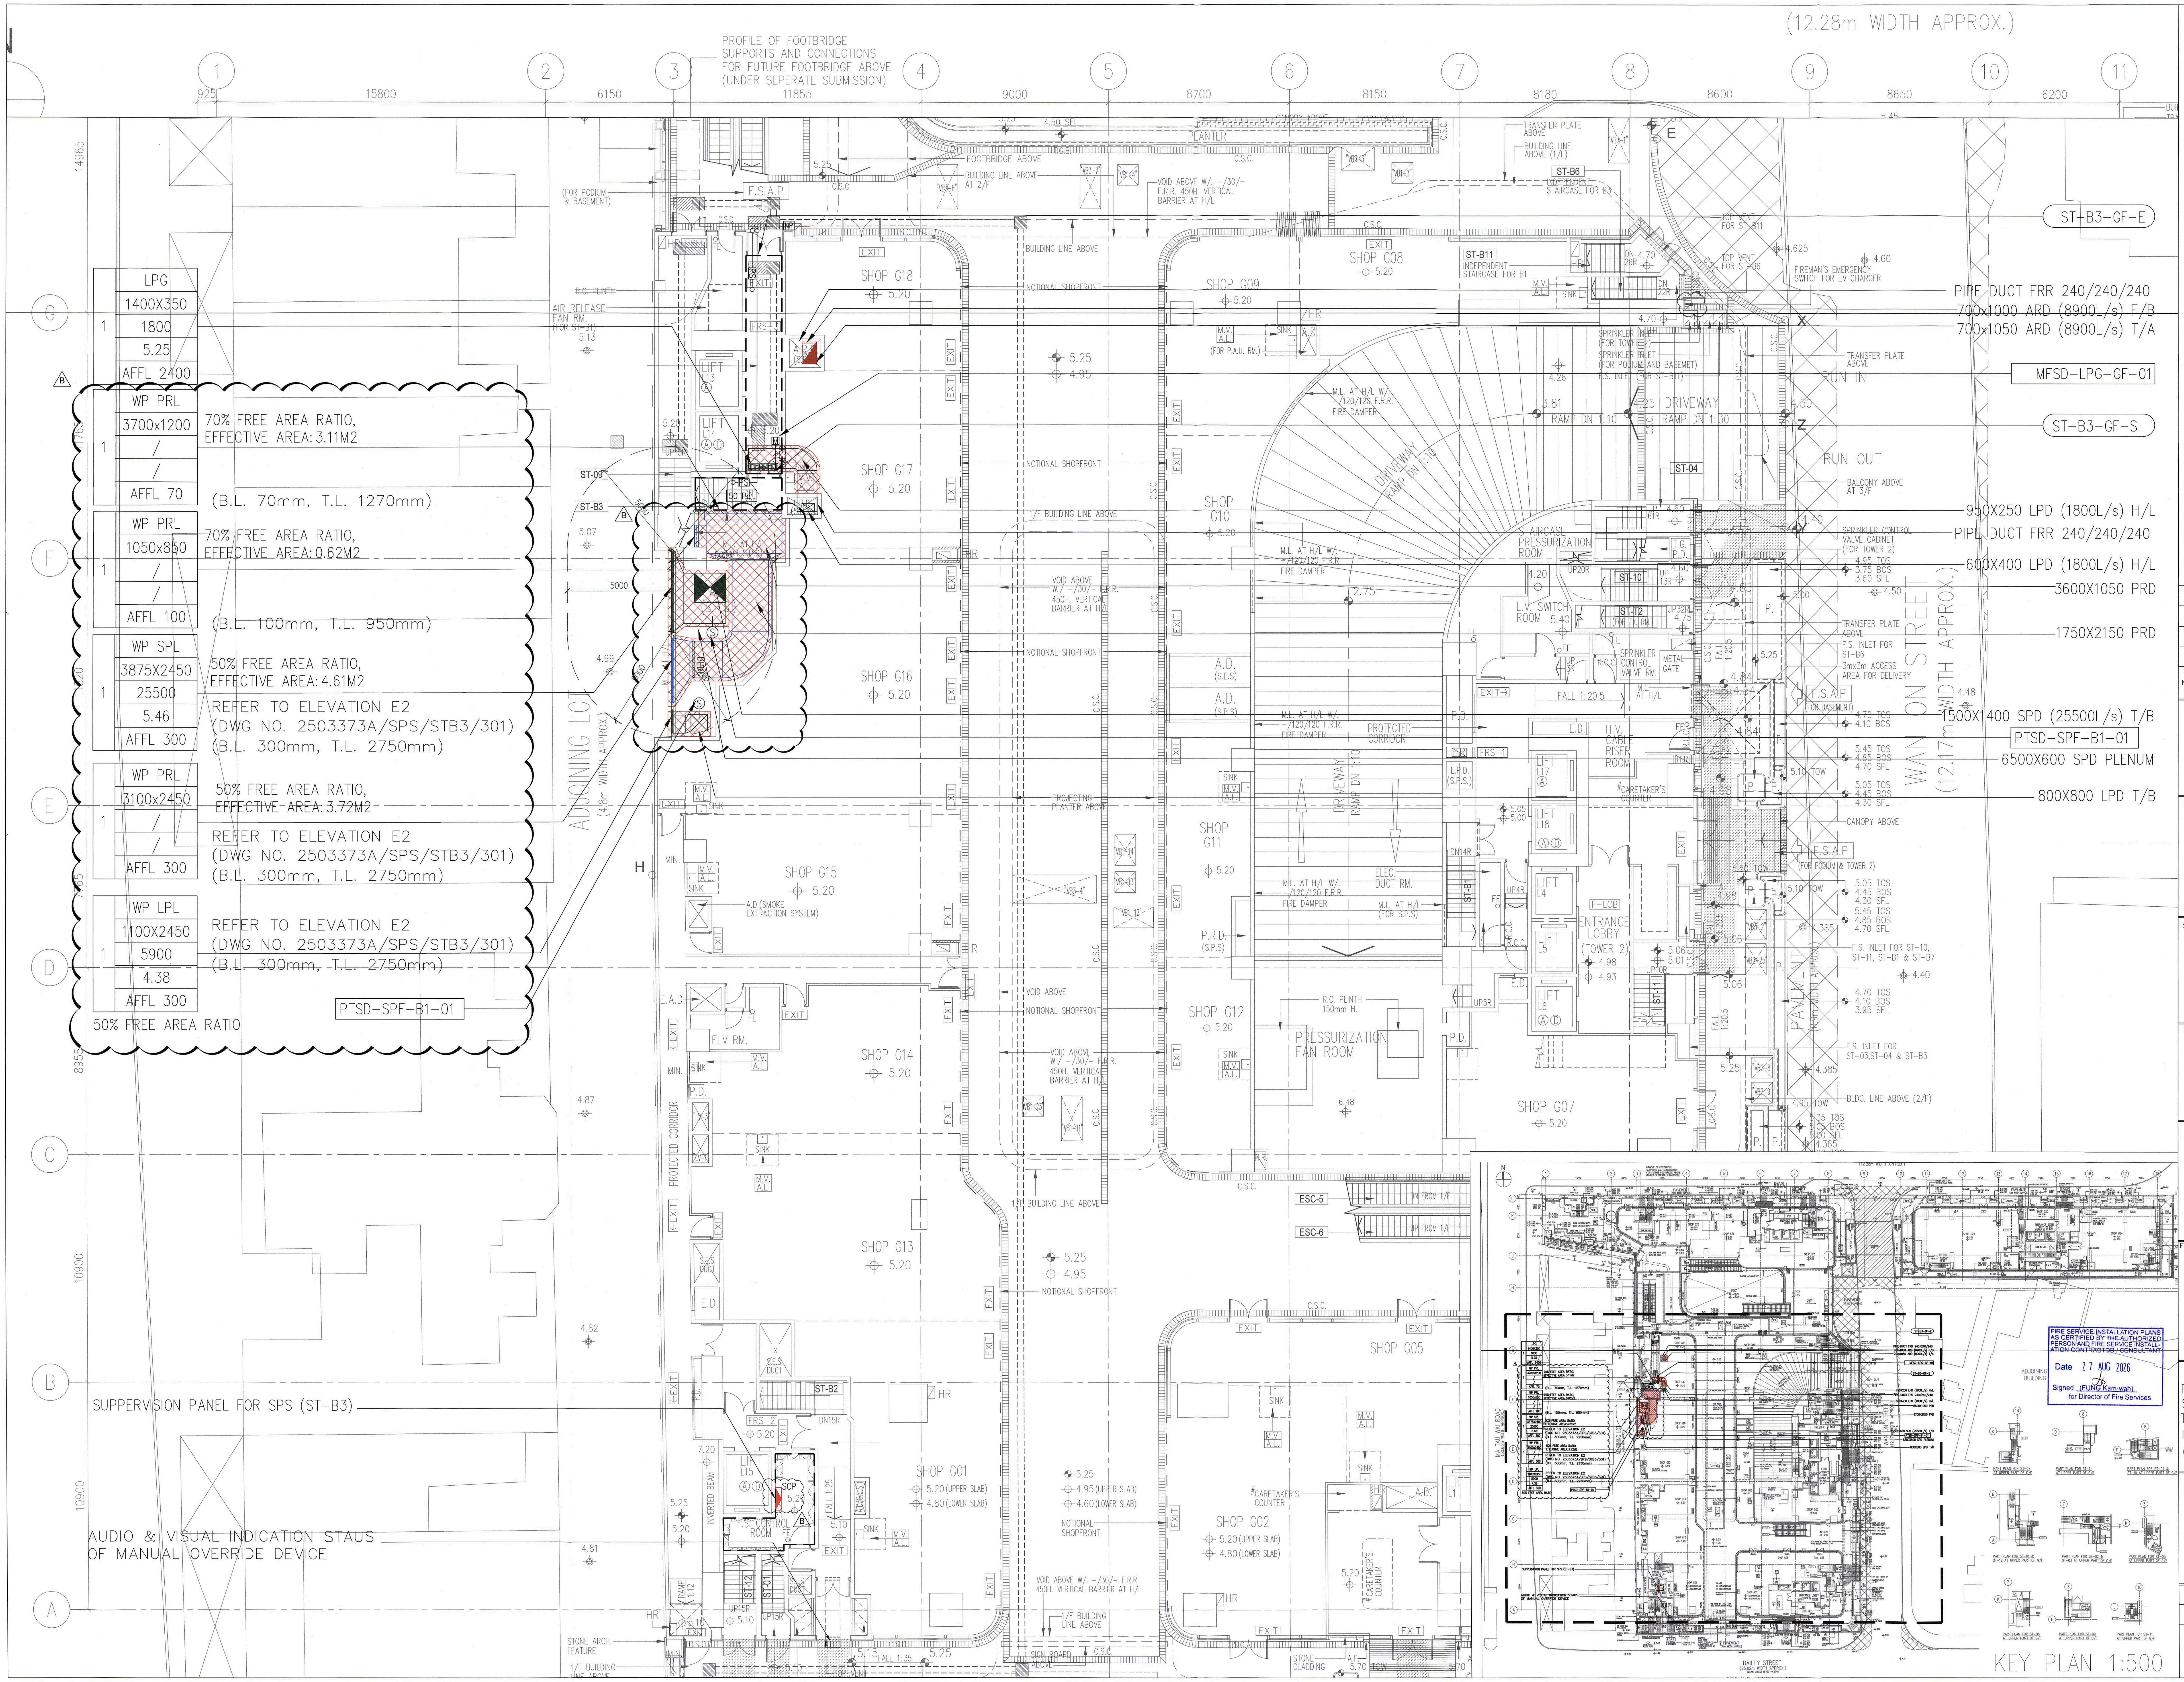
(12.28m WIDTH APPROX.)
PROFILE OF FOOTBRIDGE SUPPORTS AND CONNECTIONS FOR FUTURE FOOTBRIDGE ABOVE (UNDER SEPERATE SUBMISSION)
1
2
3
4
5
6
7
8
9
10
11
925
15800
6150
11855
9000
8700
8150
8180
8600
8650
6200
G
F
E
D
C
B
A
LPG
1400X350
1800
5.25
AFFL 2400
WP PRL
3700x1200
AFFL 70
70% FREE AREA RATIO, EFFECTIVE AREA: 3.11M2
(B.L. 70mm, T.L. 1270mm)
WP PRL
1050x850
AFFL 100
70% FREE AREA RATIO, EFFECTIVE AREA: 0.62M2
(B.L. 100mm, T.L. 950mm)
WP SPL
3875X2450
25500
5.46
AFFL 300
50% FREE AREA RATIO, EFFECTIVE AREA: 4.61M2
REFER TO ELEVATION E2 (DWG NO. 2503373A/SPS/STB3/301) (B.L. 300mm, T.L. 2750mm)
WP PRL
3100x2450
AFFL 300
50% FREE AREA RATIO, EFFECTIVE AREA: 3.72M2
REFER TO ELEVATION E2 (DWG NO. 2503373A/SPS/STB3/301) (B.L. 300mm, T.L. 2750mm)
WP LPL
1100X2450
5900
4.38
AFFL 300
REFER TO ELEVATION E2 (DWG NO. 2503373A/SPS/STB3/301) (B.L. 300mm, T.L. 2750mm)
PTSD-SPF-B1-01
50% FREE AREA RATIO
ST-B3-GF-E
PIPE DUCT FRR 240/240/240
700x1000 ARD (8900L/s) F/B
700x1050 ARD (8900L/s) T/A
MFSD-LPG-GF-01
ST-B3-GF-S
950X250 LPD (1800L/s) H/L
PIPE DUCT FRR 240/240/240
600X400 LPD (1800L/s) H/L
3600X1050 PRD
1750X2150 PRD
1500X1400 SPD (25500L/s) T/B
PTSD-SPF-B1-01
6500X600 SPD PLENUM
800X800 LPD T/B
SUPPERVISION PANEL FOR SPS (ST-B3)
AUDIO & VISUAL INDICATION STAUS OF MANUAL OVERRIDE DEVICE
SHOP G18
SHOP G17
SHOP G16
SHOP G15
SHOP G14
SHOP G13
SHOP G01
SHOP G02
SHOP G05
SHOP G07
SHOP G08
SHOP G09
SHOP G10
SHOP G11
SHOP G12
DRIVEWAY RAMP DN 1:10
STAIRCASE PRESSURIZATION ROOM
PRESSURIZATION FAN ROOM
ADJOINING LOT (4.8m WIDTH APPROX.)
WAN ON STREET (12.17m WIDTH APPROX.)
RUN IN
RUN OUT
KEY PLAN 1:500

FIRE SERVICE INSTALLATION PLANS AS CERTIFIED BY THE AUTHORIZED PERSON AND FIRE SERVICE INSTALLATION CONTRACTOR / CONSULTANT
Date 27 AUG 2026
Signed (FUNG Kam-wah)
for Director of Fire Services

LOO Kwan Wai
(RPE No.: RP0260258)

NO.	DATE	REVISIONS	DRAFTED	CHECKED	DESIGNED	REVIEWED
B	06/2026	FSD THIRD SUBMISSION	HYH	WWC	HYH	TKL
A	07/2025	FSD SECOND SUBMISSION	HYH	WWC	HYH	TKL
0	03/2025	FSD FIRST SUBMISSION	HYH	WWC	HYH	TKL

CLIENT:
NATION STAR DEVELOPMENT LIMITED
75/F, 8 Finance Street,
Central, Hong Kong

PROJECT ARCHITECT & AUTHORIZED PERSON:
RONALD LU & PARTNERS
呂元祥建築師事務所
33rd Floor, Wu Chung house, 213 Queen's Road East,
Wanchai, Hong Kong

STRUCTURAL/GEOTECHNICAL
wsp
7/F, One Kowloon
1 Wang Yuen Street
Kowloon Bay, Hong Kong

BUILDING SERVICES ENGINEER:
wsp
7/F, One Kowloon
1 Wang Yuen Street
Kowloon Bay, Hong Kong

QUANTITY SURVEYOR:
ARCADIS
17/F, Two Harbour Square, 180 Wai Yip Street,
Kwun Tong, Kowloon
Hong Kong

FIRE SERVICES CONTRACTOR:
開創工程有限公司
GRAND CREATIVE ENGINEERS LIMITED
CLASS 1, 2, 3 REGISTERED FIRE SERVICES CONTRACTOR
WSD LICENSED PLUMBER (GRADE 1)
EMSD REGISTERED ELECTRICAL CONTRACTOR
陳廣開
Chan Kwong Hoi
Director
Unit D, 2/F, Cheong Wah Comm. Bldg., 900-904 Canton Road, Kowloon.
Mobile : 9015 9586 Tel : 3612 5782 Fax : 3612 5785
Email : info@grandcreative.com.hk

PROJECT:
PROPOSED DEVELOPMENT AT BAILEY STREET & WING KWONG STREET, TO KWA WAN, KOWLOON
INLAND LOT NO. 11279
(URA PROJECT KC-009)

TITLE:
STAIRCASE PRESSURIZATION SYSTEM – GF LAYOUT (ST-B3)

(8)

DATE: 06/2026		SCALE: 1:100@A0	
DRAFTED: HYH	CHECKED: WWC	DESIGNED: HYH	REVIEWED: TKL
JOB NO.	DRAWING NO.		REV. NO.
2503373A	2503373A/SPS/STB3/204		B