



OCCUPATIONAL HEALTH & SAFETY MANAGEMENT SYSTEM

Document Number:
DIMO-LTD-CL-16


CHECKLIST

Issue:
00

DISTRIBUTION BOARD

Issue Date:
1st January 2021

Project		Date of Inspection	
Contractors Name		Frequency	
Date of first deployment		Checked by	
Type		Serial No	

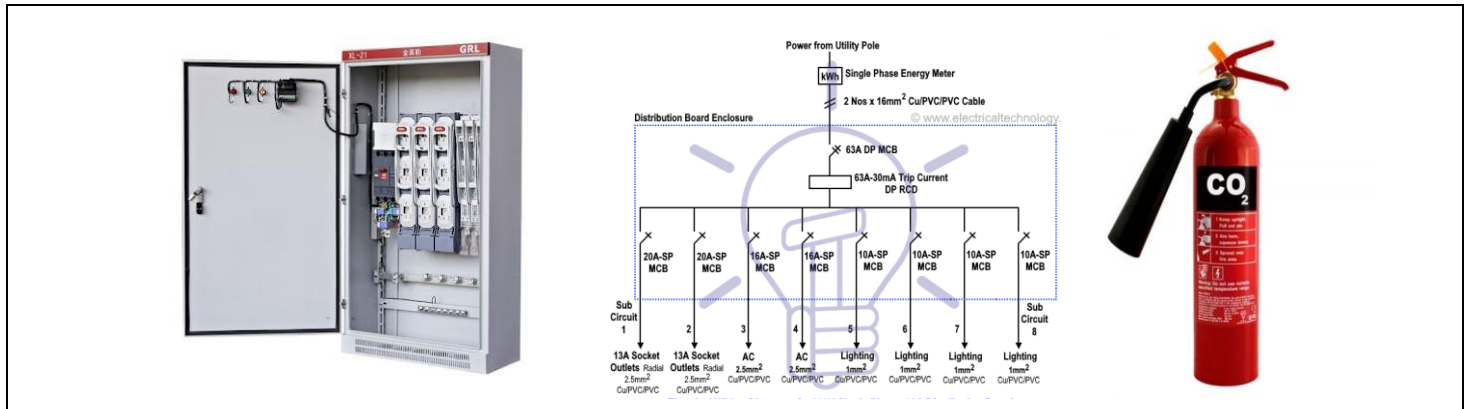

S/N	INSPECTION POINTS	YES	NO	N/A	REMARKS
01	Outdoor Type with minimum IP55 protection and mild steel enclosure with door.				
02	ELCB or RCCB with rating suitable for incoming power supply (30mA sensitivity)				
03	RCCB or ELCB tripped properly by pressing trip test button. ELCB to be tested quarterly for tripping value.				
04	All the connections are through RCCB or ELCB.				
05	Phase Indicating bulbs provided and is working				
06	DB is provided with two distinct robust earth connections.				
07	Plugs and sockets are IP55 and physically in good condition.				
08	SLD (Single line diagram) of DB pasted on DB door				
09	Caution signage and contact number of authorized person details displayed on the DB.				
10	Non-conductive fire extinguisher is available				

Overall Observation	Accepted: Yes No	Remarks:
Removal of Equipment/Machine (If not acceptable)	Date:	Remarks:
If Corrective/Preventive action taken to rectify	Date:	Remarks:

Checked by	Name	Date	Signature
Contractor's Supervisor			
EHS Officer			
Site In charge/Manager			