INITIAL STATIC VERTICAL PILE LOAD TEST

ON 900MM DIA PILE

FOR BDD Chawls Redevelopment Project, Worli, Mumbai
AT Building-3 Wing B

(TEST PILE TP-01)

Client:	Tata Project
Contractor:	NA
Test Date:	08 December 2025
Report No:	IVPLT-001

Test conducted as per IS 2911 (Part 4) - 2013

CONTENTS

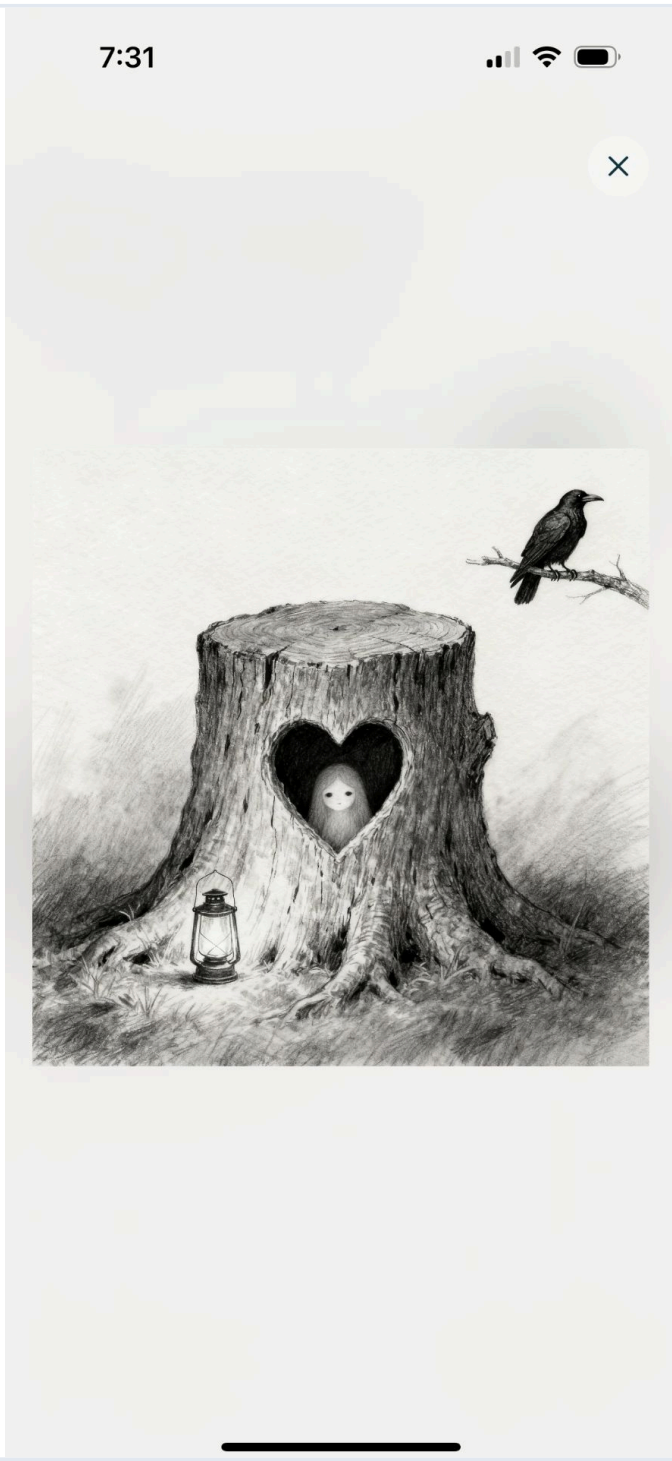

1.0 General

1.1 Tata Project decided to carry out static pile testing work on 900mm diameter pile to estimate load carrying capacity in vertical direction and settlement. This is the Initial Vertical Pile Load Test at Building-3 Wing B.

1.2 This report covers data for one vertical pile load test. This report covers calculation of safe load capacity for pile based on data collected during fieldwork.

1.3 The following codes of practices have been adopted:

- IS 2911 (Part 4) - 2013 "Code of Practice for Design and Construction of Pile Foundations - Load Tests on Piles"
- IS 14593 - 1998 (Reaffirmed 2003) "Design and Construction of Bored Cast-in-Situ Piles Founded on Rocks – Guidelines"

2.0 Scope of Work

Pile details are tabulated as below.

2.1 Pile Details for Initial Pile (Vertical Load Test)

Location	**Building-3 Wing B**
Pile ID	**TP-01**
Pile Diameter	**900 mm**
Pile Depth	**11.51 m**
Concrete Grade	**M40**
Maximum Vertical Safe Capacity	**420 MT**

2.2 Vertical Test Load for Initial Pile

The design vertical load on the pile is **420 MT**.

The pile is required to be tested to a load of **1050 MT** (2.5 × design load).

2.3 Equipment Details

Hydraulic Jack	**As per site specifications**
Ram Area	**2551 cm²**
Dial Gauge Least Count	**0.01 mm**

3.0 Methodology

The Initial Vertical Pile Load Test was conducted in accordance with IS 2911 (Part 4) - 2013 "Code of Practice for Design and Construction of Pile Foundations - Load Test on Piles".

3.1 Test Setup

A hydraulic jack of adequate capacity was used to apply the load, reacting against a sturdy reaction frame. Four dial gauges (0.01 mm least count) were fixed on the pile head to record settlements.

3.2 Test Procedure

1. Load was applied in increments of approximately 20% of design load (84.0 MT) up to the test load of 1050 MT.
2. Each load increment was maintained until the rate of settlement was less than 0.1mm/hour, or for a minimum of 1 hour.
3. Maximum load was maintained for 24 hours as per IS 2911 requirements for initial tests.
4. Load was released in the same increments as the loading phase.
5. Settlement readings were recorded at each load increment using four dial gauges positioned at 90° intervals.

3.3 Acceptance Criteria (IS 2911 Part 4)

As per IS 2911 (Part 4) - 2013, the acceptance criteria for Initial Vertical Pile Load Test are:

1. Net settlement at design load shall not exceed 12mm or 2% of pile diameter (18.0mm), whichever is less.
2. Safe load shall be taken as two-thirds of the load at which total settlement equals 12mm.
3. Safe load shall not exceed half the load at which total settlement equals 10% of pile diameter (90.0mm).

3.4 Load Increment Summary

Jack Ram Area:	**2551 cm²**
Design Load:	**420 MT**
Test Load (2.5× Design):	**1050 MT**
Load Increment (20% of Design):	**84.0 MT**

Note: As the least count of the pressure gauge is limited, exact incremental loads may not be attained. Hence, values close to the incremental load are considered.

Table 1 – Load Sequence

The sequence of loading and unloading shall be as described below for **IVPLT on 900mm Dia Pile (420 MT Design Load)**.

SR. NO.	PRESSURE (KG/CM²)	LOAD (MT)	READING TIME
LOADING PHASE			
1	0	0.00	0
2	33	84.00	1, 15, 30, 45, 60 mins
3	66	168.00	1, 15, 30, 45, 60 mins
4	99	252.00	1, 15, 30, 45, 60 mins
5	132	336.00	1, 15, 30, 45, 60 mins
6	165	420.00	1, 15, 30, 45, 60 mins
7	198	504.00	1, 15, 30, 45, 60 mins
8	230	588.00	1, 15, 30, 45, 60 mins
9	263	672.00	1, 15, 30, 45, 60 mins
10	296	756.00	1, 15, 30, 45, 60 mins
11	329	840.00	1, 15, 30, 45, 60 mins
12	362	924.00	1, 15, 30, 45, 60 mins
13	395	1008.00	1, 15, 30, 45, 60 mins
14	**412**	**1050.00**	**24 hours (1440 mins)**
UNLOADING PHASE			
15	379	966.00	1, 5, 15 mins

SR. NO.	PRESSURE (KG/CM²)	LOAD (MT)	READING TIME
16	346	882.00	1, 5, 15 mins
17	313	798.00	1, 5, 15 mins
18	280	714.00	1, 5, 15 mins
19	247	630.00	1, 5, 15 mins
20	214	546.00	1, 5, 15 mins
21	181	462.00	1, 5, 15 mins
22	148	378.00	1, 5, 15 mins
23	115	294.00	1, 5, 15 mins
24	82	210.00	1, 5, 15 mins
25	49	126.00	1, 5, 15 mins
26	16	42.00	1, 5, 15 mins
27	0	0.00	1, 5, 15 mins

4.0 Results

4.1 Test Results Summary

Maximum Settlement Recorded	**7.22 mm**
Elastic Rebound	**3.08 mm**
Net Settlement (Max - Rebound)	**4.14 mm**
Settlement Limit (IS 2911)	**12 mm**
Safe Load Adopted	**420.0 MT**
Governing Criterion	**DESIGN**
Test Status	**PASSED**

4.2 Assessment

The net settlement of 4.14 mm is within the permissible limit of 12 mm as per IS 2911 (Part 4) - 2013.

The safe load adopted for the pile is **420.0 MT** based on the design criterion.

5.0 Load vs Settlement Curve

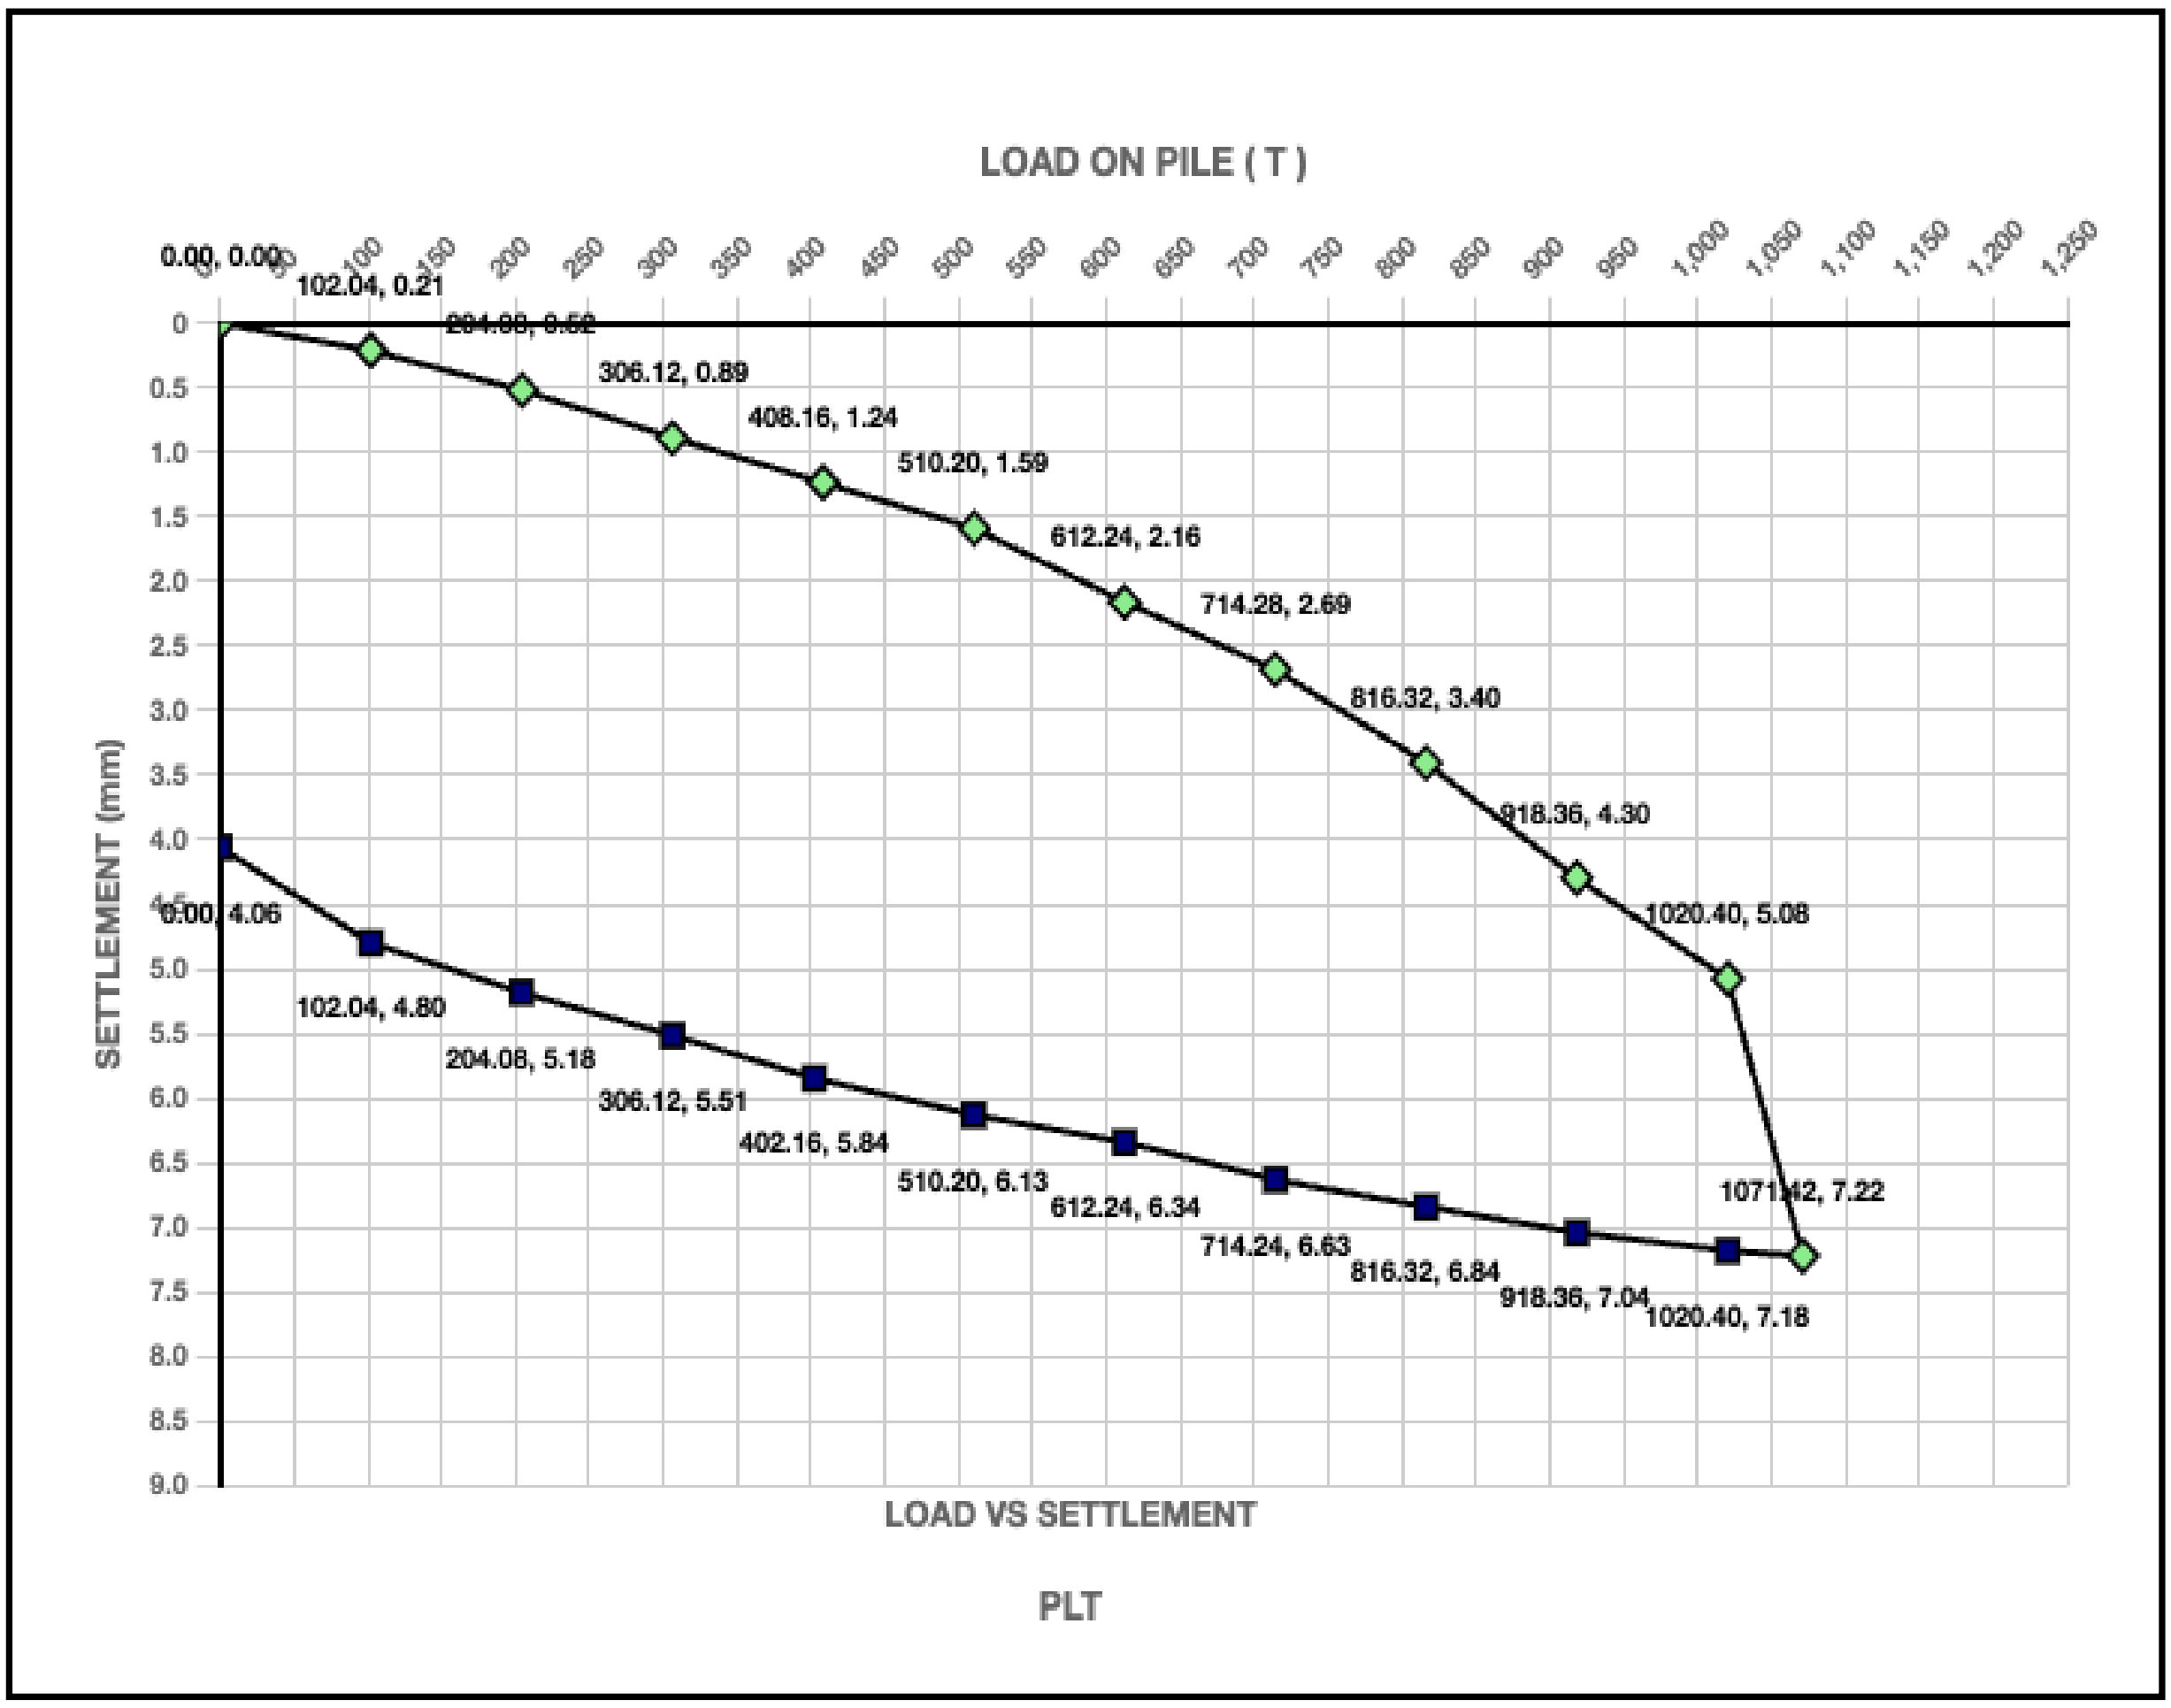

Maximum Settlement at 1071.42 T: 7.22 mm

TEST LOAD	MAX SETTLEMENT	NET SETTLEMENT	TOTAL REBOUND
1050.0	7.22	4.14	3.08
MT	mm	mm	mm

TEST PASSED ✓

Net settlement 4.14mm is within the 12mm limit (IS 2911 Part 4)

5.1 Record of Pile Load Test

LOADING

Load (T)	Average Deflection (mm)
0.00	0.00
102.04	0.21
204.08	0.52
306.12	0.89
408.16	1.24
510.20	1.59
612.24	2.16
714.28	2.69
816.32	3.40
918.36	4.30
1020.40	5.08
1071.42	7.22

UNLOADING

Load (T)	Average Deflection (mm)
1020.40	7.18
918.36	7.04
816.32	6.84
714.24	6.63
612.24	6.34
510.20	6.13
402.16	5.84
306.12	5.51
204.08	5.18
102.04	4.80
0.00	4.06

6.0 Conclusion

Based on the Initial Vertical Pile Load Test conducted on pile TP-01 at Building-3 Wing B, the following observations and conclusions are drawn:

1. The pile was loaded up to 1050.0 MT (2.5 times the design load of 420 MT) as per IS 2911 (Part 4) - 2013.
2. The maximum settlement recorded at test load was 7.22 mm.
3. After complete unloading, the elastic rebound was 3.08 mm.
4. The net settlement (residual) is 4.14 mm, which is within the permissible limit of 12 mm.
5. The safe load adopted for the pile is 420.0 MT based on the design criterion.
6. **The pile HAS PASSED the Initial Vertical Pile Load Test as per IS 2911 (Part 4) - 2013.**

Therefore, the design safe load of 420 MT can be adopted as the working load capacity for this pile.

7.0 Observation Sheet

Load increment readings as per IS 2911 (Part 4)

DATE	TIME (Hrs)	PRESSURE GAUGE READING kg/cm²	LOAD IN MT	Dial Gauge				AVERAGE SETTLEMENT IN MM	REMARK
				Reading 1	Reading 2	Reading 3	Reading 4		
Loading									
09/12/2025	11:29	**0**	**0.00**	0	0	0	0	**0.00**	*Start*
	11:30	**40**	**102.04**	0.12	0.06	0.04	0.02	**0.06**	-
	11:45	**40**		0.19	0.13	0.1	0.1	**0.13**	-
	12:00	**40**		0.22	0.15	0.14	0.15	**0.17**	-
	12:15	**40**		0.24	0.16	0.17	0.18	**0.19**	-
	12:30	**40**		0.26	0.19	0.2	0.21	**0.21**	-
	12:31	**80**	**204.08**	0.45	0.4	0.39	0.38	**0.41**	-
	12:45	**80**		0.4	0.38	0.22	0.17	**0.29**	-
	13:00	**80**		0.47	0.41	0.43	0.41	**0.43**	-
	13:15	**80**		0.51	0.45	0.48	0.46	**0.47**	-
	13:30	**80**		0.55	0.49	0.53	0.51	**0.52**	-
	13:31	**120**	**306.12**	0.81	0.76	0.77	0.75	**0.77**	-
	13:45	**120**		0.84	0.8	0.8	0.79	**0.81**	-
	14:00	**120**		0.86	0.82	0.82	0.81	**0.83**	-
	14:15	**120**		0.89	0.83	0.86	0.85	**0.86**	-
	14:30	**120**		0.91	0.85	0.9	0.89	**0.89**	-
	14:31	**160**	**408.16**	1.32	1.2	1.27	1.21	**1.25**	-
	14:45	**160**		1.34	1.24	1.3	1.24	**1.28**	-
	15:00	**160**		1.35	1.26	1.35	1.27	**1.31**	-
	15:15	**160**		1.24	1.09	1.04	0.97	**1.08**	-
	15:30	**160**		1.34	1.2	1.25	1.16	**1.24**	*overide*
	15:31	**200**	**510.20**	1.56	1.58	1.45	1.44	**1.51**	-
	15:45	**200**		1.57	1.6	1.43	1.42	**1.50**	-

DATE	TIME (Hrs)	PRESSURE GAUGE READING kg/cm²	LOAD IN MT	Dial Gauge				AVERAGE SETTLEMENT IN MM	REMARK
				Reading 1	Reading 2	Reading 3	Reading 4		
	16:00	**200**		1.59	1.62	1.48	1.43	**1.53**	-
	16:15	**200**		1.61	1.65	1.53	1.46	**1.56**	-
	16:30	**200**		1.65	1.67	1.55	1.49	**1.59**	-
	16:31	**240**	**612.24**	2.21	2.12	2.04	1.96	**2.08**	-
	16:45	**240**		2.26	2.15	2.07	1.97	**2.11**	-
	17:00	**240**		2.26	2.17	2.09	1.98	**2.13**	-
	17:15	**240**		2.28	2.19	2.09	1.98	**2.13**	-
	17:30	**240**		2.28	2.24	2.11	2.01	**2.16**	-
	17:31	**280**	**714.28**	2.72	2.75	2.57	2.58	**2.65**	-
	17:45	**280**		2.72	2.75	2.57	2.58	**2.65**	-
	18:00	**280**		2.73	2.76	2.6	2.6	**2.67**	-
	18:15	**280**		2.75	2.77	2.61	2.6	**2.68**	-
	18:30	**280**		2.75	2.78	2.61	2.6	**2.69**	-
	18:31	**320**	**816.32**	3.4	3.43	3.15	3.21	**3.30**	-
	18:45	**320**		3.43	3.45	3.18	3.24	**3.33**	-
	19:00	**320**		3.45	3.48	3.2	3.27	**3.35**	-
	19:15	**320**		3.48	3.5	3.23	3.3	**3.38**	-
	19:30	**320**		3.51	3.53	3.25	3.33	**3.40**	-
	19:31	**360**	**918.36**	4.36	4.39	3.95	4.01	**4.18**	-
	19:45	**360**		4.38	4.4	3.97	4.03	**4.20**	-
	20:00	**360**		4.41	4.43	4.04	4.05	**4.23**	-
	20:15	**360**		4.45	4.47	4.07	4.09	**4.27**	-
	20:30	**360**		4.47	4.49	4.11	4.12	**4.30**	-
	20:31	**400**	**1020.40**	5.09	5.16	4.75	4.78	**4.95**	-
	20:45	**400**		5.14	5.2	4.8	4.86	**5.00**	-
	21:00	**400**		5.17	5.23	4.84	4.88	**5.03**	-
	21:15	**400**		5.19	5.27	4.88	4.91	**5.06**	-
	21:30	**400**		5.2	5.28	4.9	4.92	**5.08**	-

DATE	TIME (Hrs)	PRESSURE GAUGE READING kg/cm²	LOAD IN MT	Dial Gauge				AVERAGE SETTLEMENT IN MM	REMARK
				Reading 1	Reading 2	Reading 3	Reading 4		
	21:31	**420**	**1071.42**	5.52	5.59	5.15	5.2	**5.36**	-
Holding									
	22:30	**420**		5.55	5.63	5.19	5.24	**5.40**	-
	23:30	**420**		5.57	5.67	5.24	5.29	**5.44**	-
10/12/2025	00:30	**420**		5.62	5.71	5.32	5.34	**5.50**	-
	01:30	**420**		5.65	5.74	5.35	5.37	**5.53**	-
	02:30	**420**		5.69	5.79	5.41	5.41	**5.58**	-
	03:30	**420**		5.72	5.81	5.43	5.43	**5.60**	-
	04:30	**420**		5.75	5.84	5.46	5.44	**5.62**	-
	05:30	**420**		5.8	5.87	5.49	5.47	**5.66**	-
	06:30	**420**		5.81	5.88	5.5	5.48	**5.67**	-
	07:30	**420**		5.81	5.89	5.52	5.5	**5.68**	-
	08:30	**420**		5.85	5.92	5.6	5.61	**5.74**	-
	09:30	**420**		5.89	5.95	5.66	5.66	**5.79**	-
	10:30	**420**		6.25	6.27	5.94	6.1	**6.14**	-
	11:30	**420**		6.62	6.66	6.53	6.7	**6.63**	-
	12:30	**420**		6.8	6.88	6.85	6.9	**6.86**	-
	13:30	**420**		6.86	6.94	6.9	7.1	**6.95**	-
	14:30	**420**		6.94	6.95	6.95	7.15	**7.00**	-
	15:30	**420**		7.06	7.09	7.11	7.23	**7.12**	-
	16:30	**420**		7.1	7.14	7.17	7.26	**7.17**	-
	17:30	**420**		7.12	7.18	7.19	7.28	**7.19**	-
	18:30	**420**		7.13	7.2	7.2	7.31	**7.21**	-
	19:30	**420**		7.15	7.21	7.21	7.31	**7.22**	-
	20:30	**420**		7.15	7.22	7.21	7.31	**7.22**	-
	21:30	**420**		7.15	7.22	7.21	7.31	**7.22**	-
Unloading									
	21:31	**400**	**1020.40**	7.11	7.18	7.17	7.26	**7.18**	-

DATE	TIME (Hrs)	PRESSURE GAUGE READING kg/cm²	LOAD IN MT	Dial Gauge				AVERAGE SETTLEMENT IN MM	REMARK
				Reading 1	Reading 2	Reading 3	Reading 4		
	21:35	**400**		7.11	7.18	7.17	7.26	**7.18**	-
	21:45	**400**		7.11	7.18	7.17	7.29	**7.18**	-
	21:46	**360**	**918.36**	7	7.08	7.06	7.26	**7.08**	-
	21:50	**360**		6.98	7.05	7.04	7.17	**7.06**	-
	22:00	**360**		6.97	7.03	7.02	7.14	**7.04**	-
	22:01	**320**	**816.32**	6.82	6.88	6.81	6.97	**6.87**	-
	22:05	**320**		6.81	6.84	6.8	6.94	**6.84**	-
	22:15	**320**		6.81	6.84	6.8	6.94	**6.84**	-
	22:16	**280**	**714.24**	6.63	6.67	6.59	6.76	**6.66**	-
	22:20	**280**		6.6	6.66	6.56	6.74	**6.64**	-
	22:30	**280**		6.59	6.66	6.55	6.73	**6.63**	-
	22:31	**240**	**612.24**	6.38	6.43	6.33	6.53	**6.41**	-
	22:35	**240**		6.33	6.38	6.27	6.5	**6.37**	-
	22:45	**240**		6.3	6.35	6.25	6.49	**6.34**	-
	22:46	**200**	**510.20**	6.11	6.17	6.01	6.28	**6.14**	-
	22:50	**200**		6.1	6.15	6	6.27	**6.13**	-
	23:00	**200**		6.1	6.15	6	6.27	**6.13**	-
	23:01	**160**	**402.16**	5.85	5.9	5.77	6.03	**5.89**	-
	23:05	**160**		5.82	5.88	5.76	6	**5.87**	-
	23:15	**160**		5.81	5.88	5.75	5.94	**5.84**	-
	23:16	**120**	**306.12**	5.53	5.61	5.46	5.71	**5.58**	-
	23:20	**120**		5.49	5.57	5.41	5.67	**5.54**	-
	23:30	**120**		5.48	5.55	5.38	5.64	**5.51**	-
	23:31	**80**	**204.08**	5.2	5.29	5.15	5.36	**5.25**	-
	23:35	**80**		5.17	5.24	5.12	5.31	**5.21**	-
	23:45	**80**		5.15	5.21	5.09	5.28	**5.18**	-
	23:46	**40**	**102.04**	4.89	4.92	4.8	4.97	**4.89**	-
	23:50	**40**		4.83	4.87	4.75	4.81	**4.82**	-

DATE	TIME (Hrs)	PRESSURE GAUGE READING kg/cm²	LOAD IN MT	Dial Gauge				AVERAGE SETTLEMENT IN MM	REMARK
				Reading 1	Reading 2	Reading 3	Reading 4		
11/12/2025	00:00	**40**		4.78	4.84	4.71	4.86	**4.80**	-
	00:01	**0**	**0.00**	4.11	4.23	3.99	4.23	**4.14**	-
	00:05	**0**		4.08	4.21	3.95	4.18	**4.11**	-
	00:15	**0**		4.05	4.17	3.9	4.12	**4.06**	-

8.0 Site Images

Image 1

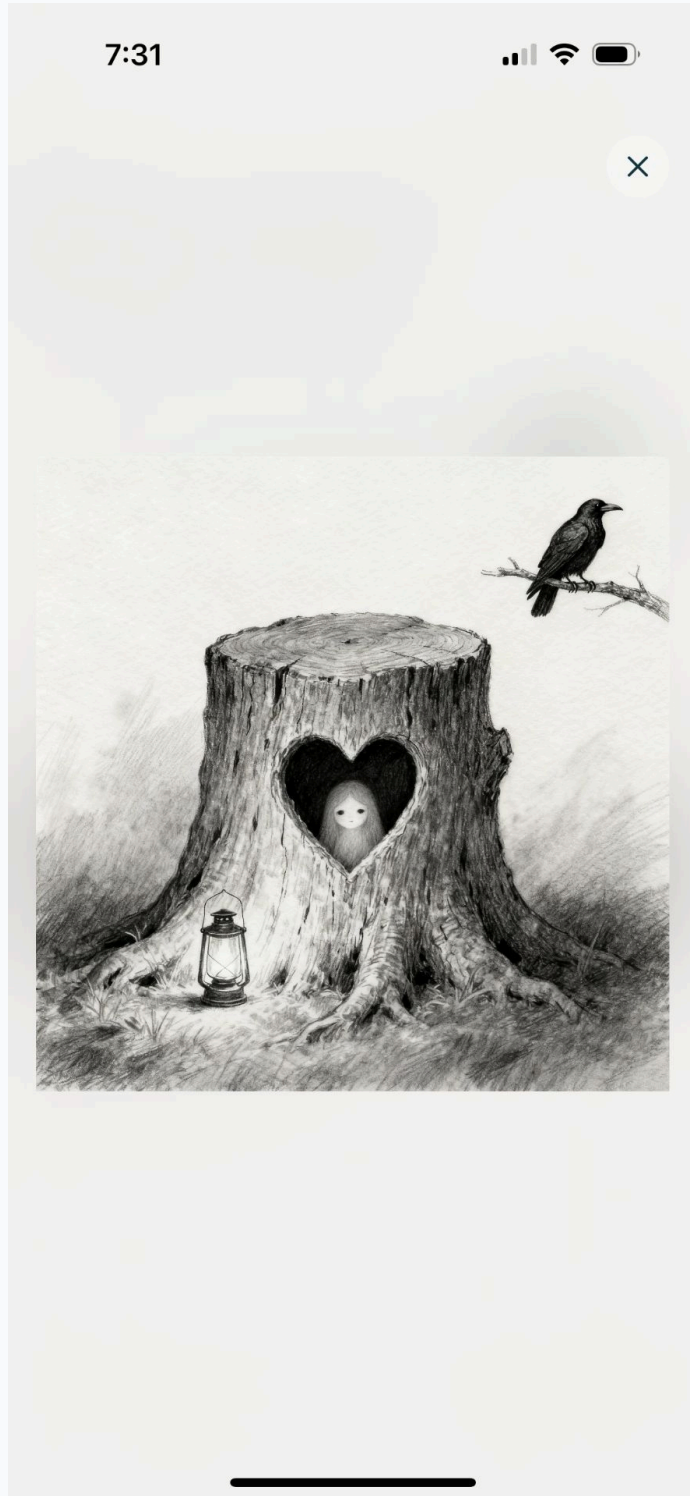

Image 2

Image 3

No Image

9.0 Field Readings

This section contains the original field recording sheets that were used to record the test data during execution. These scanned documents serve as supporting evidence for the test results presented in this report.

10.0 Calibration Certificates

This section contains the calibration certificates for the equipment used during the pile load test. These certificates verify that all measuring instruments were properly calibrated and meet the required standards.

Prepared by:	Checked by:
Site Engineer	Quality Engineer
Reviewed by:	**Approved by:**
Project Manager	Client Representative

ZED

ZedGeo Systems Private Limited., Mumbai

RECORD OF PILE LOAD TEST NO.:- P395 B/01
PROJECT:- CP10-C5-EV03
LOCATION :- Koyambedu
CLIENTS NAME:- CMRL
CONSULTANT:- NKRB
CONTRACTOR:- L&T
PMC:-

L.C OF DIAL GAUGE:- 0.01 mm
TYPE OF TEST:- RVPLT
DESIGN LOAD:- 550 mt
TEST LOAD :- 825 mt
MIXED DESIGN :- M-35
PILE DIAMETER :- 1200 mm

PAGE:- 05
RAM AREA :- 2551 cm2
DATE OF CASTING :- 12/03/23
PILE DEPTH :- 38.893 mtr

INITIAL PILE LOAD TEST

DATE	TIME (Hrs)	PRESSURE GAUGE READING kg/cm2	LOAD IN MT	Reading 1	Reading 2	Reading 3	Reading 4	Average settlement Test Pile	SIGNATURE ZED	SIGNATURE L&T	SIGNATURE NKRB	REMARK
25/9/24	00.41	320	799.99	2.73	3.40	4.58	4.60	3.82	Asahani	C. Pr	[illegible]	
	00.45			2.73	3.40	4.58	4.60	3.82	Asahani	C. Pr	[illegible]	
	00.46	280	699.99	2.72	3.39	4.57	4.60	3.82	Asahani	C. Pr	[illegible]	
	00.50			2.72	3.39	4.57	4.60	3.82	Asahani	C. Pr	[illegible]	
	00.51	240	600	2.70	3.34	4.56	4.59	3.79	Asahani	C. Pr	[illegible]	
	00.55			2.70	3.34	4.56	4.59	3.79	Asahani	C. Pr	[illegible]	
	00.56	200	500	2.47	3.09	4.22	4.28	3.51	Asahani	C. Pr	[illegible]	
	1.00			2.47	3.09	4.22	4.28	3.51	Asahani	C. Pr	[illegible]	
	1.01	160	400	2.29	2.84	3.93	4.03	3.27	Asahani	C. Pr	[illegible]	
	1.05			2.29	2.84	3.93	4.03	3.27	Asahani	C. Pr	[illegible]	
	1.06	120	300	2.05	2.50	3.58	3.71	2.96	Asahani	C. Pr	[illegible]	
	1.10			2.05	2.50	3.58	3.71	2.96	Asahani	C. Pr	[illegible]	
	1.11	80	200	1.81	2.20	3.23	3.39	2.65	Asahani	C. Pr	[illegible]	
	1.15			1.81	2.20	3.23	3.39	2.65	Asahani	C. Pr	[illegible]	
	1.16	40	100	1.30	1.84	2.88	2.97	2.24	Asahani	C. Pr	[illegible]	
	1.20			1.30	1.84	2.88	2.97	2.24	Asahani	C. Pr	[illegible]	
	1.21	0	0.0	0.98	1.41	2.25	2.49	1.78	Asahani	C. Pr	[illegible]	
	1.25			0.98	1.41	2.25	2.45	1.78	Asahani	C. Pr	[illegible]	

- Total Setelment = 3.83 mm
Net Setelment = 1.78 mm

Rebound 2.25 mm

C. Pr
Pradeep C
Sr. Office Engg
20/09/24

ZED
Asahani
25/09/24

[illegible] L&T(EU)

ZED

ZedGeo Systems Private Limited., Mumbai

RECORD OF PILE LOAD TEST NO.:- P395 B/01
PROJECT:- CP10-C5-EV03
LOCATION :- koyambedu
CLIENTS NAME:- CMRL
CONSULTANT:- NKAB
CONTRACTOR:- L&T
PMC:-

L.C OF DIAL GAUGE:- 0.01 mm
TYPE OF TEST:- RVPLT
DESIGN LOAD:- 550 MT
TEST LOAD :- 825 MT
MIXED DESIGN :- m-35
PILE DIAMETER :- 1200 mm

PAGE:- 04
RAM AREA :- 2551 cm2
DATE OF CASTING :- 12/03/23
PILE DEPTH :- 38.893 mtr

INITIAL PILE LOAD TEST

DATE	TIME (Hrs)	PRESSURE GAUGE READING kg/cm2	LOAD IN MT	Reading 1	Reading 2	Reading 3	Reading 4	Average settlement Test Pile	SIGNATURE ZED	SIGNATURE L&T	SIGNATURE NKAB	REMARK
24/9/24	20.40	330	894.99	2.79	3.45	4.61	4.61	3.86	Asahani	[signature]	[signature]	
	21.40			2.83	3.49	4.65	4.65	3.90	Asahani	C.Pr.	[signature]	
	22.40			2.82	3.49	4.66	4.68	3.91	Asahani	C.Pr.	[signature]	
	23.40			2.78	3.45	4.62	4.64	3.87	Asahani	C.Pr	[signature]	
	00.40			2.74	3.40	4.59	4.61	3.83	Asahani		[signature]	

Scanned with ACE Scanner

ZED

ZedGeo Systems Private Limited., Mumbai

RECORD OF PILE LOAD TEST NO:-
PROJECT:-
LOCATION :-
CLIENTS NAME:- CMRL
CONSULTANT:- NKAB
CONTRACTOR:- L&T
PMC:-

L.C OF DIAL GAUGE:- 0.01mm
TYPE OF TEST:- RVPLT
DESIGN LOAD:- 550 MT
TEST LOAD :- 825 MT
MIXED DESIGN :- M-35
PILE DIAMETER :- 1200mm

PAGE:- 03
RAM AREA :- 2551 cm2
DATE OF CASTING :- 12/03/24
PILE DEPTH :- 38.89 mtr

INITIAL PILE LOAD TEST

DATE	TIME (Hrs)	PRESSURE GAUGE READING kg/cm2	LOAD IN MT	Reading 1	Reading 2	Reading 3	Reading 4	Average settlement Test Pile	SIGNATURE ZED	SIGNATURE L&T	SIGNATURE NKAB	REMARK
	00:41	330	894.99	1.81	2.50	3.35	3.50	2.79	AK	[illegible]	[illegible]	(Holding for 24 Hours)
	00:55			1.90	2.52	3.40	3.59	2.83	AK.	[illegible]	[illegible]	
	01:10			1.91	2.59	3.41	3.53	2.84	AK.	[illegible]	[illegible]	
	01:25			1.91	2.52	3.41	3.53	2.84	AK.	[illegible]	[illegible]	
	01:40			1.91	2.59	3.41	3.53	2.84	AK.	[illegible]	[illegible]	
	02:40	–		1.91	2.59	3.41	3.53	2.84	AK.	[illegible]	[illegible]	
	03:40			2.01	2.65	3.58	3.69	2.98	AK.	C. [illegible]	[illegible]	
	04:40			2.22	2.74	3.73	3.89	3.12	AK.	C. [illegible]	[illegible]	
	05:40			2.34	2.94	3.91	3.95	3.28	ASahani	C. [illegible]	[illegible]	
	06:40			2.43	3.03	4.01	4.05	3.38	ASahani	C. [illegible]	[illegible]	
	7:40			2.81	3.44	4.60	4.62	3.86	ASahani	C. [illegible]	[illegible]	
	8:40			2.86	3.50	4.71	4.73	3.95	ASahani	[illegible]	[illegible]	(Karthick [illegible]
	9:40			3.32	3.97	5.16	5.15	4.4	ASahani	[illegible]	[illegible]	
	10:40			3.50	4.14	5.26	5.27	4.54	ASahani	[illegible]	[illegible]	
	11:40			3.70	4.36	5.43	5.43	4.73	ASahani	[illegible]	[illegible]	
	12:40			3.64	4.31	5.32	5.34	4.65	ASahani	[illegible]	[illegible]	[illegible] (L&T m - L&T)
	13:40			3.68	4.35	5.34	5.37	4.68	ASahani	[illegible]	[illegible]	
	14:40			3.64	4.31	5.29	5.29	4.63	ASahani	[illegible]	[illegible]	
	15:40			3.27	3.94	5.00	5.02	4.30	ASahani	[illegible]	[illegible]	
	16:40			2.84	3.49	4.65	4.68	3.91	ASahani	[illegible]	[illegible]	
	17:40			2.68	3.33	4.51	4.53	3.76	ASahani	[illegible]	[illegible]	
	18:40			2.75	3.41	4.57	4.58	3.82	ASahani	[illegible]	[illegible]	
	19:40			2.78	3.44	4.59	4.59	3.85	ASahani	[illegible]	[illegible]	[illegible] (L&T m - L&T)

ZED

ZedGeo Systems Private Limited., Mumbai

RECORD OF PILE LOAD TEST NO.:- P39SB/01
PROJECT:- CP10-CS - EV03
LOCATION :-
CLIENTS NAME:- CMRL
CONSULTANT:- NKAB
CONTRACTOR:- L&T
PMC:-

L.C OF DIAL GAUGE:- 0.01 mm
TYPE OF TEST:- RVPLT
DESIGN LOAD:- 550 MT
TEST LOAD :- 825 MT
MIXED DESIGN :- M-35
PILE DIAMETER :- 1200 mm

PAGE:- 02
RAM AREA :- 2551 cm²
DATE OF CASTING :- 12/03/23
PILE DEPTH :- 38.093 mtr

INITIAL PILE LOAD TEST

DATE	TIME (Hrs)	PRESSURE GAUGE READING kg/cm2	LOAD IN MT	Reading 1	Reading 2	Reading 3	Reading 4	Average settlement Test Pile	SIGNATURE ZED	SIGNATURE L&T	SIGNATURE NKAB	REMARK
28/03/23	20:41	200	500	0.87	1.20	1.66	2.10	1.46	DK			
	20:55			0.87	1.20	1.66	2.10	1.46	DK			
	21:10			0.90	1.22	1.68	2.12	1.48	DK			
	21:25			0.90	1.23	1.70	2.15	1.49	DK			
	21:40			0.90	1.23	1.70	2.15	1.49	DK			
	21:41	240	600	1.22	1.65	2.22	2.70	1.95	DK			
	21:55			1.22	1.62	2.23	2.71	1.95	DK			
	22:10			1.24	1.64	2.25	2.72	1.97	DK			
	22:25			1.25	1.66	2.27	2.74	1.99	DK			
	22:40			1.27	1.69	2.30	2.76	2.00	DK			
	22:41	280	699.99	1.50	1.96	2.75	3.10	2.33	DK			
	22:55			1.50	1.96	2.75	3.10	2.33	DK			
	23:10			1.50	1.96	2.75	3.10	2.33	DK			
	23:25			1.51	1.97	2.76	3.11	2.34	DK			
	23:40			1.51	1.97	2.76	3.11	2.34	DK			
	23:41	320	799.99	1.70	2.35	3.25	3.40	2.67	DK			
	23:55			1.71	2.36	3.26	3.41	2.68	DK			
	00:10			1.71	2.36	3.26	3.41	2.68	DK			
	00:25			1.71	2.36	3.26	3.41	2.68	DK			
	00:40			1.71	2.36	3.26	3.41	2.68	DK			

ZedGeo Systems Private Limited., Mumbai

RECORD OF PILE LOAD TEST NO:- P395, B/01
L.C OF DIAL GAUGE:- 0.01mm
Page:- 01
Ram Area.:- 2351 cm2

PROJECT:- CP10 - C5 - EV03
Type of Test:- RVPLT
Date of Casting :- 12/03/2023
Design load on pile:- 550MT
Pile Depth :- 38.293 mtr

LOCATION :- KOYAMBEDU
Test Load :- 825 MT
Mixed Design :- M-35

CONTRACTOR:- L&T
Pile Diameter :- 1200mm

CLIENTS NAME:- NKAB (CMRL)

ROUTINE ~~INITIAL~~ PILE LOAD TEST

DATE	TIME	PRESSURE	LOAD IN MT	Reading				Average settlement	SIGNATURE			REMARK
	(Hrs)	GAUGE READING kg/cm2		Reading 1	Reading 2	Reading 3	Reading 4	Test Pile	ZED	L&T	NKAB	
23/09/24	16:39	0	0	0	0	0	0	0	DK.			
	16:40	40	100	.20	0.25	0.30	0.75	0.37	DK.			Maheen OCC-NKAB
	16:55			0.17	0.21	0.26	0.74	0.34	DK.			AM CMRL
	17:10			0.15	0.18	0.23	0.71	0.32	DK.			
	17:25			0.12	0.15	0.20	0.70	0.29	DK.			
	17:40			0.10	0.12	0.17	0.67	0.26	DK.			
	17:41	80	200	0.27	0.42	0.52	1.09	0.57	DK.			
	17:55			0.25	0.40	0.50	1.07	0.55	DK.			
	18:10			0.25	0.40	0.52	1.07	0.56	DK.			
	18:25			0.24	0.39	0.51	1.06	0.55	DK.			
	18:40			0.24	0.39	0.51	1.06	0.55	DK.			
	18:41	120	300	0.44	0.69	0.89	1.44	0.86	DK.			
	18:55			0.43	0.69	0.89	1.44	0.86	DK.			
	19:10			0.44	0.70	0.90	1.45	0.87	DK.			
	19:25			0.44	0.70	0.91	1.47	0.88	DK.			
	19:40			0.44	0.70	0.91	1.47	0.88	DK.			
	19:41	160	400	0.66	0.99	1.26	1.90	1.18	DK.			
	19:55			0.66	0.99	1.26	1.90	1.18	DK.			
	20:10			0.66	0.94	1.28	1.90	1.19	DK.			
	20:25			0.68	0.94	1.30	1.90	1.20	DK.			
	20:40			0.68	0.94	1.30	1.90	1.20	DK.			

Appointment Scheduler

Back to Appointment Scheduler (/appointmentscheduler-appointment/ca/en)

Appointment Confirmation

Click here to print your appointment details

Appointment Scheduler Details

USCIS HOUSTON SOUTHWEST (ASC):
Houston, TX

9440 Highway 6 South
Houston, TX 77083

Date: 07/01/2025
Time: 01:00 PM
IRCC number:
1000025611458

What you need to bring:

- **Biometrics letter -** Your Canadian biometrics instruction letter
- **Your passport or travel document -** The document used in your application

Additional information:

- Print a copy of your appointment details if you want to bring it to your appointment
- All USCIS Application Support Centers are handicap accessible
- Bring a translator if you need help reading, speaking, or

understanding English

USCIS HOUSTON SOUTHWEST (ASC):

Houston, TX

9440 Highway 6 South
Houston, TX 77083

Date: 07/01/2025
Heure: 01:00 PM
Numéro IRCC:
1000025611458

Ce que vous devez apporter:

- **Lettre d'instructions pour la collecte de données biométriques - ** Votre lettre d'instructions du Canada
- **Votre passeport ou document de voyage - ** Le document utilisé dans votre demande

Informations supplémentaires:

- Imprimez une copie des détails de votre rendez-vous si vous souhaitez l'apporter à votre rendez-vous
- Tous les centres d'aide a la demande sont accessibles aux personnes handicapées.
- Soyez accompagné(e) d'un(e) interprète si vous avez besoin d'aide pour lire, parler ou comprendre l'anglais

BDD Chawls Redevelopment Project, Worli, Mumbai

Details | Data Entry | Report

Initial Vertical Load Test Report

Pile ID: TP-01 | Location: Building-3 Wing B
Test Date: 08 December 2025 | Test Method: IS 2911 (Part 4) - 2013

Test Result: PASSED
Net Settlement: 4.14mm (Limit: 12mm)

PASSED

TEST LOAD
1050.0 MT
2.5× Design Load

MAX SETTLEMENT
7.22 mm
At test load

ELASTIC REBOUND
3.08 mm
Recovery after unloading

NET SETTLEMENT
4.14 mm
Limit: 12mm (IS 2911)

SAFE LOAD ADOPTED
420.0 MT
Per design criterion

DESIGN LOAD
420.0 MT
Working load capacity

Pile Specifications

Pile ID **TP-01**	Diameter **900 mm**
Depth **11.51 m**	Concrete Grade **M40**
Ram Area **2551 cm²**	Jack Name **-**
Dial Gauge LC **0.01 mm**	Method **IS 2911 (Part 4)**

Load vs Settlement Curve

Loading | Hold | Unloading

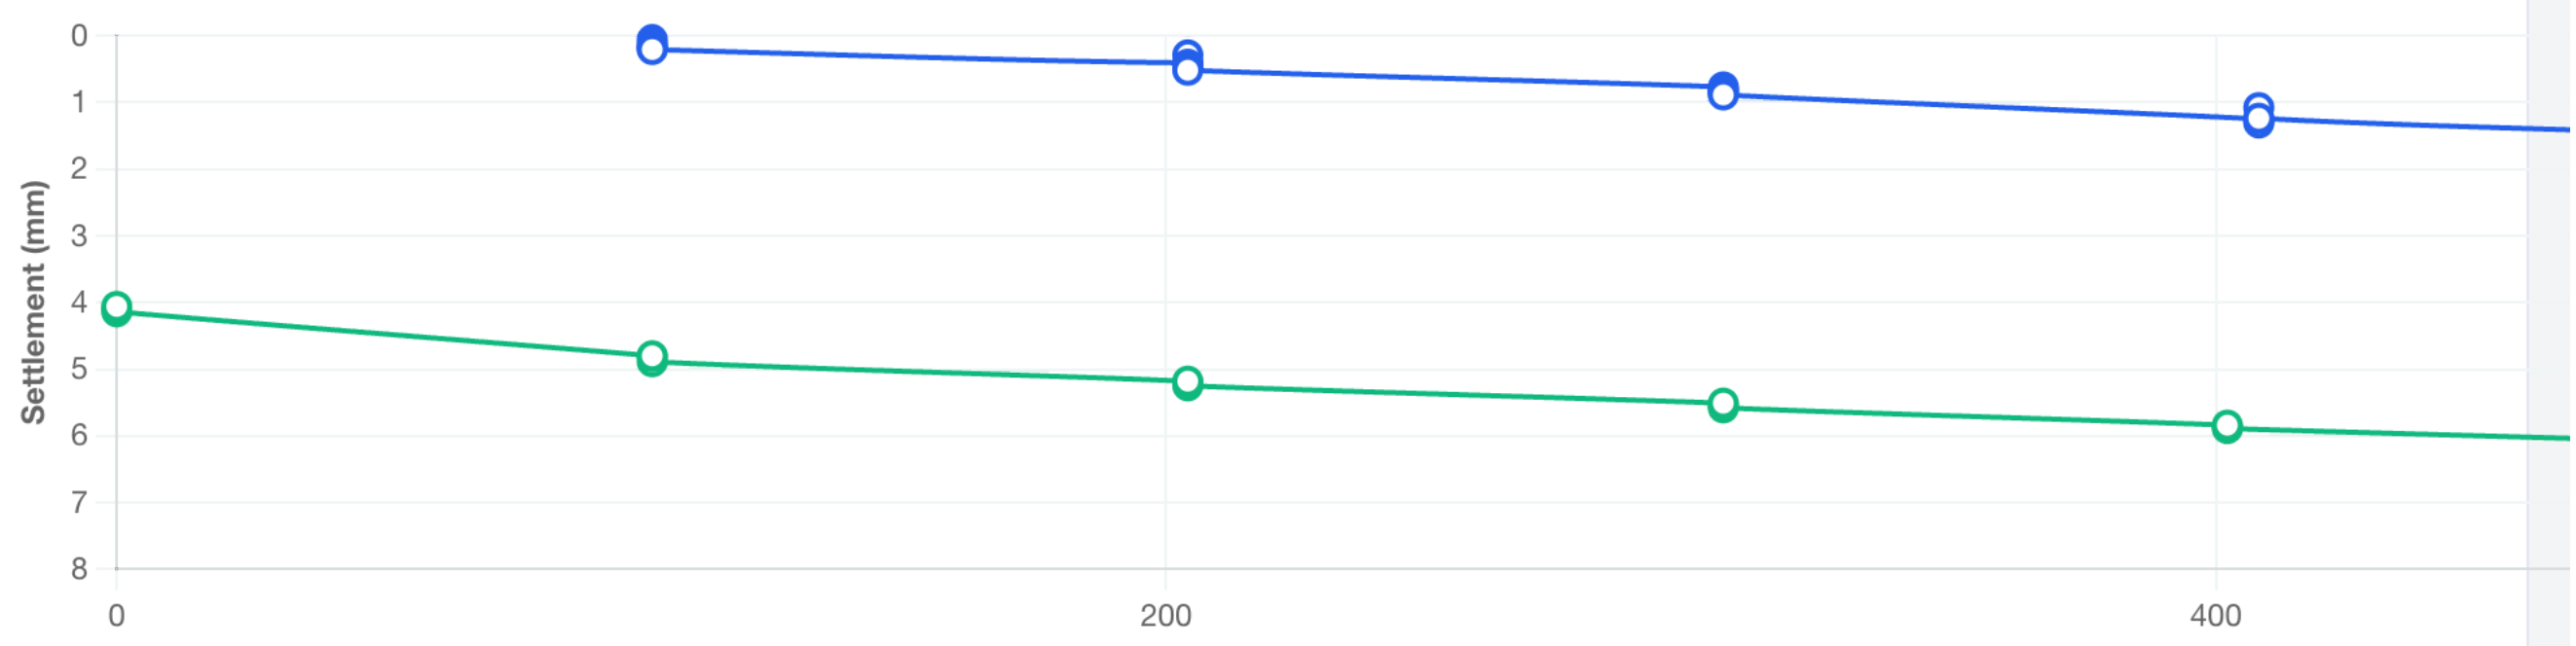

4.0 Results & Conclusion

Generate Conclusion

No conclusion generated yet

Click "Generate Conclusion" to create an IS 2911-compliant conclusion using AI

Load Increment Summary

Phase	Date	Time	Load (MT)	Pressure	Avg Settlement	Remarks
LOADING	08/12/2025	11:59 PM	0.00	0 kg/cm²	- mm	*Start*
LOADING	09/12/2025	12:00 AM	102.04	40 kg/cm²	0.06 mm	-
LOADING	09/12/2025	12:15 AM	102.04	40 kg/cm²	0.13 mm	-
LOADING	09/12/2025	12:30 AM	102.04	40 kg/cm²	0.17 mm	-
LOADING	09/12/2025	12:45 AM	102.04	40 kg/cm²	0.19 mm	-
LOADING	09/12/2025	01:00 AM	102.04	40 kg/cm²	0.21 mm	-
LOADING	09/12/2025	01:01 AM	204.08	80 kg/cm²	0.41 mm	-
LOADING	09/12/2025	01:15 AM	204.08	80 kg/cm²	0.29 mm	-
LOADING	09/12/2025	01:30 AM	204.08	80 kg/cm²	0.43 mm	-
LOADING	09/12/2025	01:45 AM	204.08	80 kg/cm²	0.47 mm	-
LOADING	09/12/2025	02:00 AM	204.08	80 kg/cm²	0.52 mm	-
LOADING	09/12/2025	02:01 AM	306.12	120 kg/cm²	0.77 mm	-
LOADING	09/12/2025	02:15 AM	306.12	120 kg/cm²	0.81 mm	-
LOADING	09/12/2025	02:30 AM	306.12	120 kg/cm²	0.83 mm	-
LOADING	09/12/2025	02:45 AM	306.12	120 kg/cm²	0.86 mm	-
LOADING	09/12/2025	03:00 AM	306.12	120 kg/cm²	0.89 mm	-
LOADING	09/12/2025	03:01 AM	408.16	160 kg/cm²	1.25 mm	-
LOADING	09/12/2025	03:15 AM	408.16	160 kg/cm²	1.28 mm	-
LOADING	09/12/2025	03:30 AM	408.16	160 kg/cm²	1.31 mm	-
LOADING	09/12/2025	03:45 AM	408.16	160 kg/cm²	1.08 mm	-
LOADING	09/12/2025	04:00 AM	408.16	160 kg/cm²	1.24 mm	*overide*
LOADING	09/12/2025	04:01 AM	510.20	200 kg/cm²	1.51 mm	-
LOADING	09/12/2025	04:15 AM	510.20	200 kg/cm²	1.50 mm	-
LOADING	09/12/2025	04:30 AM	510.20	200 kg/cm²	1.53 mm	-
LOADING	09/12/2025	04:45 AM	510.20	200 kg/cm²	1.56 mm	-

Phase	Date	Time	Load (MT)	Pressure	Avg Settlement	Remarks
LOADING	09/12/2025	05:00 AM	510.20	200 kg/cm²	1.59 mm	-
LOADING	09/12/2025	05:01 AM	612.24	240 kg/cm²	2.08 mm	-
LOADING	09/12/2025	05:15 AM	612.24	240 kg/cm²	2.11 mm	-
LOADING	09/12/2025	05:30 AM	612.24	240 kg/cm²	2.13 mm	-
LOADING	09/12/2025	05:45 AM	612.24	240 kg/cm²	2.13 mm	-
LOADING	09/12/2025	06:00 AM	612.24	240 kg/cm²	2.16 mm	-
LOADING	09/12/2025	06:01 AM	714.28	280 kg/cm²	2.66 mm	-
LOADING	09/12/2025	06:15 AM	714.28	280 kg/cm²	2.66 mm	-
LOADING	09/12/2025	06:30 AM	714.28	280 kg/cm²	2.67 mm	-
LOADING	09/12/2025	06:45 AM	714.28	280 kg/cm²	2.68 mm	-
LOADING	09/12/2025	07:00 AM	714.28	280 kg/cm²	2.68 mm	-
LOADING	09/12/2025	07:01 AM	816.32	320 kg/cm²	3.30 mm	-
LOADING	09/12/2025	07:15 AM	816.32	320 kg/cm²	3.33 mm	-
LOADING	09/12/2025	07:30 AM	816.32	320 kg/cm²	3.35 mm	-
LOADING	09/12/2025	07:45 AM	816.32	320 kg/cm²	3.38 mm	-
LOADING	09/12/2025	08:00 AM	816.32	320 kg/cm²	3.40 mm	-
LOADING	09/12/2025	08:01 AM	918.36	360 kg/cm²	4.18 mm	-
LOADING	09/12/2025	08:15 AM	918.36	360 kg/cm²	4.20 mm	-
LOADING	09/12/2025	08:30 AM	918.36	360 kg/cm²	4.23 mm	-
LOADING	09/12/2025	08:45 AM	918.36	360 kg/cm²	4.27 mm	-
LOADING	09/12/2025	09:00 AM	918.36	360 kg/cm²	4.30 mm	-
LOADING	09/12/2025	09:01 AM	1020.40	400 kg/cm²	4.95 mm	-
LOADING	09/12/2025	09:15 AM	1020.40	400 kg/cm²	5.00 mm	-
LOADING	09/12/2025	09:30 AM	1020.40	400 kg/cm²	5.03 mm	-
LOADING	09/12/2025	09:45 AM	1020.40	400 kg/cm²	5.06 mm	-
LOADING	09/12/2025	10:00 AM	1020.40	400 kg/cm²	5.08 mm	-
LOADING	09/12/2025	10:01 AM	1071.42	420 kg/cm²	5.36 mm	-
HOLDING	09/12/2025	11:00 AM	1071.42	420 kg/cm²	5.40 mm	-
HOLDING	09/12/2025	12:00 PM	1071.42	420 kg/cm²	5.44 mm	-
HOLDING	09/12/2025	01:00 PM	1071.42	420 kg/cm²	5.50 mm	-
HOLDING	09/12/2025	02:00 PM	1071.42	420 kg/cm²	5.53 mm	-
HOLDING	09/12/2025	03:00 PM	1071.42	420 kg/cm²	5.58 mm	-

Phase	Date	Time	Load (MT)	Pressure	Avg Settlement	Remarks
HOLDING	09/12/2025	04:00 PM	1071.42	420 kg/cm²	5.60 mm	-
HOLDING	09/12/2025	05:00 PM	1071.42	420 kg/cm²	5.62 mm	-
HOLDING	09/12/2025	06:00 PM	1071.42	420 kg/cm²	5.66 mm	-
HOLDING	09/12/2025	07:00 PM	1071.42	420 kg/cm²	5.67 mm	-
HOLDING	09/12/2025	08:00 PM	1071.42	420 kg/cm²	5.68 mm	-
HOLDING	09/12/2025	09:00 PM	1071.42	420 kg/cm²	5.74 mm	-
HOLDING	09/12/2025	10:00 PM	1071.42	420 kg/cm²	5.79 mm	-
HOLDING	09/12/2025	11:00 PM	1071.42	420 kg/cm²	6.14 mm	-
HOLDING	10/12/2025	12:00 AM	1071.42	420 kg/cm²	6.63 mm	-
HOLDING	10/12/2025	01:00 AM	1071.42	420 kg/cm²	6.86 mm	-
HOLDING	10/12/2025	02:00 AM	1071.42	420 kg/cm²	6.95 mm	-
HOLDING	10/12/2025	03:00 AM	1071.42	420 kg/cm²	7.00 mm	-
HOLDING	10/12/2025	04:00 AM	1071.42	420 kg/cm²	7.12 mm	-
HOLDING	10/12/2025	05:00 AM	1071.42	420 kg/cm²	7.17 mm	-
HOLDING	10/12/2025	06:00 AM	1071.42	420 kg/cm²	7.19 mm	-
HOLDING	10/12/2025	07:00 AM	1071.42	420 kg/cm²	7.21 mm	-
HOLDING	10/12/2025	08:00 AM	1071.42	420 kg/cm²	7.22 mm	-
HOLDING	10/12/2025	09:00 AM	1071.42	420 kg/cm²	7.22 mm	-
HOLDING	10/12/2025	10:00 AM	1071.42	420 kg/cm²	7.22 mm	-
UNLOADING	10/12/2025	10:01 AM	1020.40	400 kg/cm²	7.18 mm	-
UNLOADING	10/12/2025	10:05 AM	1020.40	400 kg/cm²	7.18 mm	-
UNLOADING	10/12/2025	10:15 AM	1020.40	400 kg/cm²	7.19 mm	-
UNLOADING	10/12/2025	10:16 AM	918.36	360 kg/cm²	7.10 mm	-
UNLOADING	10/12/2025	10:20 AM	918.36	360 kg/cm²	7.06 mm	-
UNLOADING	10/12/2025	10:30 AM	918.36	360 kg/cm²	7.04 mm	-
UNLOADING	10/12/2025	10:31 AM	816.32	320 kg/cm²	6.87 mm	-
UNLOADING	10/12/2025	10:35 AM	816.32	320 kg/cm²	6.85 mm	-
UNLOADING	10/12/2025	10:45 AM	816.32	320 kg/cm²	6.85 mm	-
UNLOADING	10/12/2025	10:46 AM	714.24	280 kg/cm²	6.66 mm	-
UNLOADING	10/12/2025	10:50 AM	714.24	280 kg/cm²	6.64 mm	-
UNLOADING	10/12/2025	11:00 AM	714.24	280 kg/cm²	6.63 mm	-
UNLOADING	10/12/2025	11:01 AM	612.24	240 kg/cm²	6.42 mm	-

Phase	Date	Time	Load (MT)	Pressure	Avg Settlement	Remarks
UNLOADING	10/12/2025	11:05 AM	612.24	240 kg/cm²	6.37 mm	-
UNLOADING	10/12/2025	11:15 AM	612.24	240 kg/cm²	6.35 mm	-
UNLOADING	10/12/2025	11:16 AM	510.20	200 kg/cm²	6.14 mm	-
UNLOADING	10/12/2025	11:20 AM	510.20	200 kg/cm²	6.13 mm	-
UNLOADING	10/12/2025	11:30 AM	510.20	200 kg/cm²	6.13 mm	-
UNLOADING	10/12/2025	11:31 AM	402.16	160 kg/cm²	5.89 mm	-
UNLOADING	10/12/2025	11:35 AM	402.16	160 kg/cm²	5.87 mm	-
UNLOADING	10/12/2025	11:45 AM	402.16	160 kg/cm²	5.84 mm	-
UNLOADING	10/12/2025	11:46 AM	306.12	120 kg/cm²	5.58 mm	-
UNLOADING	10/12/2025	11:50 AM	306.12	120 kg/cm²	5.54 mm	-
UNLOADING	10/12/2025	12:00 PM	306.12	120 kg/cm²	5.51 mm	-
UNLOADING	10/12/2025	12:01 PM	204.08	80 kg/cm²	5.25 mm	-
UNLOADING	10/12/2025	12:05 PM	204.08	80 kg/cm²	5.21 mm	-
UNLOADING	10/12/2025	12:15 PM	204.08	80 kg/cm²	5.18 mm	-
UNLOADING	10/12/2025	12:16 PM	102.04	40 kg/cm²	4.89 mm	-
UNLOADING	10/12/2025	12:20 PM	102.04	40 kg/cm²	4.81 mm	-
UNLOADING	10/12/2025	12:30 PM	102.04	40 kg/cm²	4.80 mm	-
UNLOADING	10/12/2025	12:31 PM	0.00	0 kg/cm²	4.14 mm	-
UNLOADING	10/12/2025	12:35 PM	0.00	0 kg/cm²	4.10 mm	-
UNLOADING	10/12/2025	12:45 PM	0.00	0 kg/cm²	4.06 mm	-