

INITIAL STATIC VERTICAL PILE LOAD TEST ON 900MM DIA PILE

FOR BDD Chawls Redevelopment Project, Worli, Mumbai
AT Building-3 Wing B

(TEST PILE TP-01)



Client: Tata Project
Contractor: NA
Test Date: 08 December 2025
Report No: IVPLT-001

Test conducted as per IS 2911 (Part 4) - 2013

CONTENTS

1.0 General

2.0 Scope of Work

3.0 Methodology

4.0 Results

5.0 Readings and Graph

6.0 Conclusion

7.0 Load Test Data

8.0 Site Images

9.0 Field Readings

10.0 Calibration Certificates



1.0 General

1.1 Tata Project decided to carry out static pile testing work on 900mm diameter pile to estimate load carrying capacity in vertical direction and settlement. This is the Initial Vertical Pile Load Test at Building-3 Wing B.

1.2 This report covers data for one vertical pile load test. This report covers calculation of safe load capacity for pile based on data collected during fieldwork.

1.3 The following codes of practices have been adopted:

- IS 2911 (Part 4) - 2013 "Code of Practice for Design and Construction of Pile Foundations - Load Tests on Piles"
- IS 14593 - 1998 (Reaffirmed 2003) "Design and Construction of Bored Cast-in-Situ Piles Founded on Rocks – Guidelines"

08 December 2025

IVPLT Report - TP-01

2.0 Scope of Work

Pile details are tabulated as below.

2.1 Pile Details for Initial Pile (Vertical Load Test)

Location	Building-3 Wing B
Pile ID	TP-01
Pile Diameter	900 mm
Pile Depth	11.51 m
Concrete Grade	M40
Maximum Vertical Safe Capacity	420 MT

2.2 Vertical Test Load for Initial Pile

The design vertical load on the pile is **420 MT**.

The pile is required to be tested to a load of **1050 MT** ($2.5 \times$ design load).

2.3 Equipment Details

Hydraulic Jack	As per site specifications
Ram Area	2551 cm²
Dial Gauge Least Count	0.01 mm

3.0 Methodology

The Initial Vertical Pile Load Test was conducted in accordance with IS 2911 (Part 4) - 2013 "Code of Practice for Design and Construction of Pile Foundations - Load Test on Piles".

3.1 Test Setup

A hydraulic jack of adequate capacity was used to apply the load, reacting against a sturdy reaction frame. Four dial gauges (0.01 mm least count) were fixed on the pile head to record settlements.

3.2 Test Procedure

1. Load was applied in increments of approximately 20% of design load (84.0 MT) up to the test load of 1050 MT.
2. Each load increment was maintained until the rate of settlement was less than 0.1mm/hour, or for a minimum of 1 hour.
3. Maximum load was maintained for 24 hours as per IS 2911 requirements for initial tests.
4. Load was released in the same increments as the loading phase.
5. Settlement readings were recorded at each load increment using four dial gauges positioned at 90° intervals.

3.3 Acceptance Criteria (IS 2911 Part 4)

As per IS 2911 (Part 4) - 2013, the acceptance criteria for Initial Vertical Pile Load Test are:

1. Net settlement at design load shall not exceed 12mm or 2% of pile diameter (18.0mm), whichever is less.
2. Safe load shall be taken as two-thirds of the load at which total settlement equals 12mm.
3. Safe load shall not exceed half the load at which total settlement equals 10% of pile diameter (90.0mm).

08 December 2025

IVPLT Report - TP-01

3.4 Load Increment Summary

Jack Ram Area: **2551 cm²**

Design Load: **420 MT**

Test Load (2.5× Design): **1050 MT**

Load Increment (20% of Design): **84.0 MT**

Note: As the least count of the pressure gauge is limited, exact incremental loads may not be attained. Hence, values close to the incremental load are considered.

Table 1 – Load Sequence

The sequence of loading and unloading shall be as described below for **IVPLT on 900mm Dia Pile (420 MT Design Load)**.

SR. NO.	PRESSURE (KG/CM ²)	LOAD (MT)	READING TIME
LOADING PHASE			
1	0	0.00	0
2	33	84.00	1, 15, 30, 45, 60 mins
3	66	168.00	1, 15, 30, 45, 60 mins
4	99	252.00	1, 15, 30, 45, 60 mins
5	132	336.00	1, 15, 30, 45, 60 mins
6	165	420.00	1, 15, 30, 45, 60 mins
7	198	504.00	1, 15, 30, 45, 60 mins
8	230	588.00	1, 15, 30, 45, 60 mins
9	263	672.00	1, 15, 30, 45, 60 mins
10	296	756.00	1, 15, 30, 45, 60 mins
11	329	840.00	1, 15, 30, 45, 60 mins
12	362	924.00	1, 15, 30, 45, 60 mins
13	395	1008.00	1, 15, 30, 45, 60 mins

SR. NO.	PRESSURE (KG/CM ²)	LOAD (MT)	READING TIME
14	412	1050.00	24 hours (1440 mins)
UNLOADING PHASE			
15	379	966.00	1, 5, 15 mins
16	346	882.00	1, 5, 15 mins
17	313	798.00	1, 5, 15 mins
18	280	714.00	1, 5, 15 mins
19	247	630.00	1, 5, 15 mins
20	214	546.00	1, 5, 15 mins
21	181	462.00	1, 5, 15 mins
22	148	378.00	1, 5, 15 mins
23	115	294.00	1, 5, 15 mins
24	82	210.00	1, 5, 15 mins
25	49	126.00	1, 5, 15 mins
26	16	42.00	1, 5, 15 mins
27	0	0.00	1, 5, 15 mins

08 December 2025

IVPLT Report - TP-01

4.0 Results

4.1 Test Results Summary

Maximum Settlement Recorded	7.22 mm
Elastic Rebound	3.08 mm
Net Settlement (Max - Rebound)	4.14 mm
Settlement Limit (IS 2911)	12 mm
Safe Load Adopted	420.0 MT
Governing Criterion	DESIGN
Test Status	PASSED

4.2 Assessment


The net settlement of 4.14 mm is within the permissible limit of 12 mm as per IS 2911 (Part 4) - 2013.

The safe load adopted for the pile is **420.0 MT** based on the design criterion.

08 December 2025

IVPLT Report - TP-01

5.0 Load vs Settlement Curve

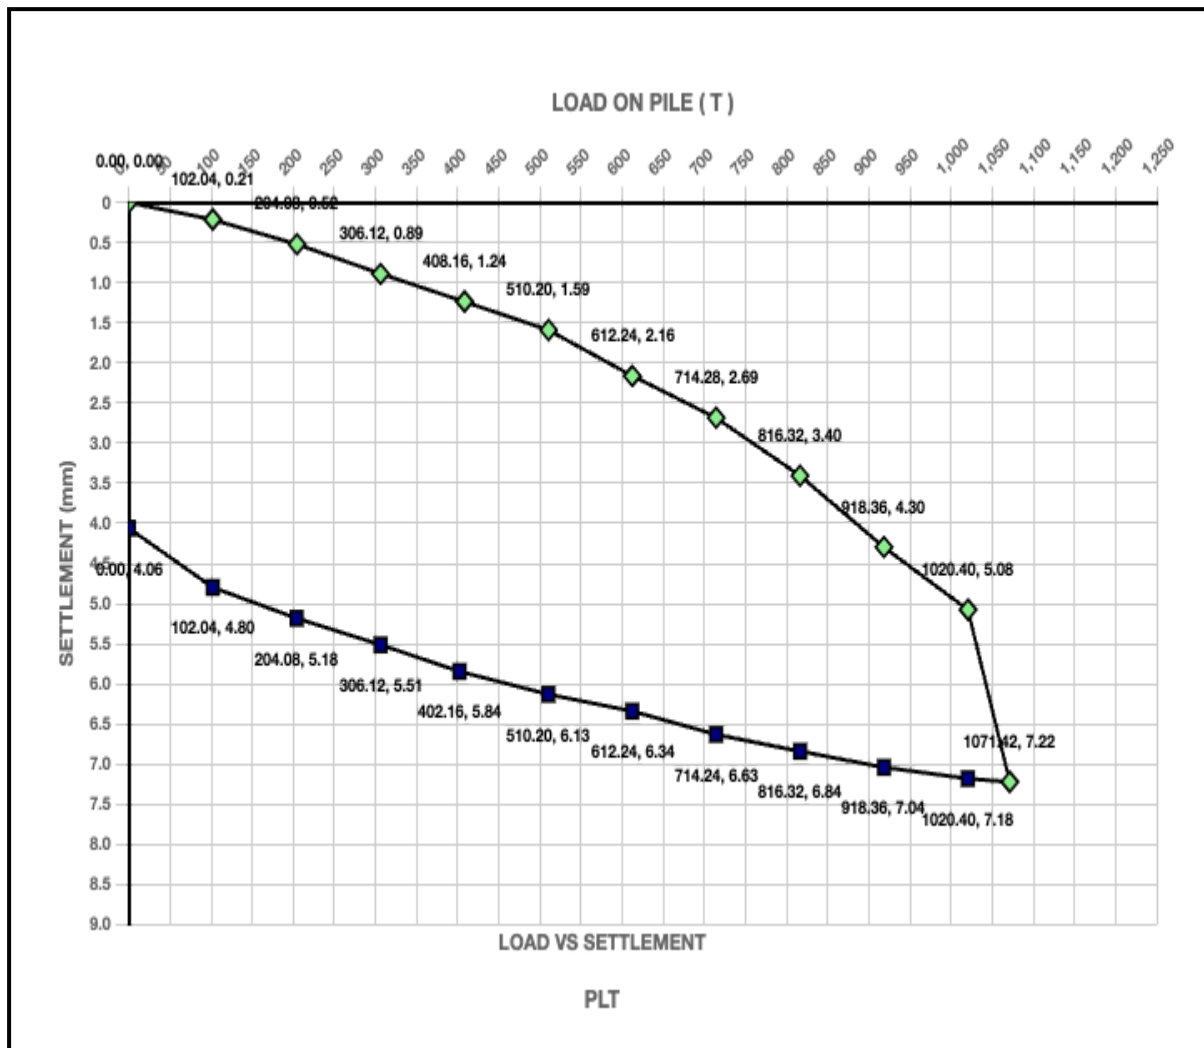

Maximum Settlement at 1071.42 T: 7.22 mm

TEST LOAD
1050.0
MT

MAX SETTLEMENT
7.22
mm

NET SETTLEMENT
4.14
mm

TOTAL REBOUND
3.08
mm

TEST PASSED ✓

Net settlement 4.14mm is within the 12mm limit (IS 2911 Part 4)

08 December 2025

IVPLT Report - TP-01

6.0 Conclusion

Based on the Initial Vertical Pile Load Test conducted on pile TP-01 at Building-3 Wing B, the following observations and conclusions are drawn:

1. The pile was loaded up to 1050.0 MT (2.5 times the design load of 420 MT) as per IS 2911 (Part 4) - 2013.
2. The maximum settlement recorded at test load was 7.22 mm.
3. After complete unloading, the elastic rebound was 3.08 mm.
4. The net settlement (residual) is 4.14 mm, which is within the permissible limit of 12 mm.
5. The safe load adopted for the pile is 420.0 MT based on the design criterion.
6. **The pile HAS PASSED the Initial Vertical Pile Load Test as per IS 2911 (Part 4) - 2013.**

Therefore, the design safe load of 420 MT can be adopted as the working load capacity for this pile.

08 December 2025

IVPLT Report - TP-01

7.0 Load Test Data

S.NO	PHASE	LOAD (MT)	SETTLEMENT (MM)	SIGNATURE
1	LOADING	0.00	0.00	
2	LOADING	102.04	0.06	
3	LOADING	102.04	0.13	
4	LOADING	102.04	0.17	
5	LOADING	102.04	0.19	
6	LOADING	102.04	0.21	
7	LOADING	204.08	0.41	
8	LOADING	204.08	0.29	
9	LOADING	204.08	0.43	
10	LOADING	204.08	0.47	
11	LOADING	204.08	0.52	
12	LOADING	306.12	0.77	
13	LOADING	306.12	0.81	
14	LOADING	306.12	0.83	
15	LOADING	306.12	0.86	
16	LOADING	306.12	0.89	
17	LOADING	408.16	1.25	
18	LOADING	408.16	1.28	
19	LOADING	408.16	1.31	
20	LOADING	408.16	1.08	
21	LOADING	408.16	1.24	
22	LOADING	510.20	1.51	
23	LOADING	510.20	1.50	
24	LOADING	510.20	1.53	
25	LOADING	510.20	1.56	

S.NO	PHASE	LOAD (MT)	SETTLEMENT (MM)	SIGNATURE
26	LOADING	510.20	1.59	
27	LOADING	612.24	2.08	
28	LOADING	612.24	2.11	
29	LOADING	612.24	2.13	
30	LOADING	612.24	2.13	
31	LOADING	612.24	2.16	
32	LOADING	714.28	2.65	
33	LOADING	714.28	2.65	
34	LOADING	714.28	2.67	
35	LOADING	714.28	2.68	
36	LOADING	714.28	2.69	
37	LOADING	816.32	3.30	
38	LOADING	816.32	3.33	
39	LOADING	816.32	3.35	
40	LOADING	816.32	3.38	
41	LOADING	816.32	3.40	
42	LOADING	918.36	4.18	
43	LOADING	918.36	4.20	
44	LOADING	918.36	4.23	
45	LOADING	918.36	4.27	
46	LOADING	918.36	4.30	
47	LOADING	1020.40	4.95	
48	LOADING	1020.40	5.00	
49	LOADING	1020.40	5.03	
50	LOADING	1020.40	5.06	
51	LOADING	1020.40	5.08	
52	LOADING	1071.42	5.36	
53	HOLD	1071.42	5.40	

S.NO	PHASE	LOAD (MT)	SETTLEMENT (MM)	SIGNATURE
54	HOLD	1071.42	5.44	
55	HOLD	1071.42	5.50	
56	HOLD	1071.42	5.53	
57	HOLD	1071.42	5.58	
58	HOLD	1071.42	5.60	
59	HOLD	1071.42	5.62	
60	HOLD	1071.42	5.66	
61	HOLD	1071.42	5.67	
62	HOLD	1071.42	5.68	
63	HOLD	1071.42	5.74	
64	HOLD	1071.42	5.79	
65	HOLD	1071.42	6.14	
66	HOLD	1071.42	6.63	
67	HOLD	1071.42	6.86	
68	HOLD	1071.42	6.95	
69	HOLD	1071.42	7.00	
70	HOLD	1071.42	7.12	
71	HOLD	1071.42	7.17	
72	HOLD	1071.42	7.19	
73	HOLD	1071.42	7.21	
74	HOLD	1071.42	7.22	
75	HOLD	1071.42	7.22	
76	HOLD	1071.42	7.22	
77	UNLOADING	1020.40	7.18	
78	UNLOADING	1020.40	7.18	
79	UNLOADING	1020.40	7.18	
80	UNLOADING	918.36	7.08	
81	UNLOADING	918.36	7.06	

S.NO	PHASE	LOAD (MT)	SETTLEMENT (MM)	SIGNATURE
82	UNLOADING	918.36	7.04	
83	UNLOADING	816.32	6.87	
84	UNLOADING	816.32	6.84	
85	UNLOADING	816.32	6.84	
86	UNLOADING	714.24	6.66	
87	UNLOADING	714.24	6.64	
88	UNLOADING	714.24	6.63	
89	UNLOADING	612.24	6.41	
90	UNLOADING	612.24	6.37	
91	UNLOADING	612.24	6.34	
92	UNLOADING	510.20	6.14	
93	UNLOADING	510.20	6.13	
94	UNLOADING	510.20	6.13	
95	UNLOADING	402.16	5.89	
96	UNLOADING	402.16	5.87	
97	UNLOADING	402.16	5.84	
98	UNLOADING	306.12	5.58	
99	UNLOADING	306.12	5.54	
100	UNLOADING	306.12	5.51	
101	UNLOADING	204.08	5.25	
102	UNLOADING	204.08	5.21	
103	UNLOADING	204.08	5.18	
104	UNLOADING	102.04	4.89	
105	UNLOADING	102.04	4.82	
106	UNLOADING	102.04	4.80	
107	UNLOADING	0.00	4.14	
108	UNLOADING	0.00	4.11	
109	UNLOADING	0.00	4.06	

08 December 2025

IVPLT Report - TP-01

8.0 Site Images



08 December 2025

IVPLT Report - TP-01

9.0 Field Readings

This section contains the original field recording sheets that were used to record the test data during execution. These scanned documents serve as supporting evidence for the test results presented in this report.

08 December 2025

IVPLT Report - TP-01

10.0 Calibration Certificates

This section contains the calibration certificates for the equipment used during the pile load test. These certificates verify that all measuring instruments were properly calibrated and meet the required standards.

08 December 2025

IVPLT Report - TP-01

Prepared by:

Checked by:

Site Engineer


Quality Engineer

Reviewed by:

Approved by:

Project Manager

Client Representative

**ZedGeo Systems Private Limited., Mumbai**RECORD OF PILE LOAD TEST NO. **P395 8/01**PROJECT:- **CP10-C5-EV03**LOCATION:- **Kalyambedu**CLIENTS NAME:- **CMRL**CONSULTANT:- **NKRB**CONTRACTOR:- **LST**

PMC:-

L.C OF DIAL GAUGE:- **0.01 mm**TYPE OF TEST:- **RVPLT**DESIGN LOAD:- **550 mt**TEST LOAD:- **825 mt**MIXED DESIGN:- **m-35**PILE DIAMETER:- **1200 mm**PAGE:- **05**RAM AREA:- **2551 cm²**DATE OF CASTING:- **12/03/23**PILE DEPTH:- **38.893 mtr****INITIAL PILE LOAD TEST**

DATE	TIME	PRESSURE	LOAD IN MT	Reading				Average settlement	SIGNATURE			REMARK
	(Hrs)	GAUGE READING kg/cm ²		Reading 1	Reading 2	Reading 3	Reading 4	Test Pile	ZED	LST	NKRB	
25/09/24	00.41	320	799.99	2.73	3.40	4.58	4.60	3.82	Asahani	C. Pr	Asahani	
	00.45			2.73	3.40	4.58	4.60	3.82	Asahani	C. Pr	Asahani	
	00.46	280	699.99	2.72	3.39	4.57	4.60	3.82	Asahani	C. Pr	Asahani	
	00.50			2.72	3.39	4.57	4.60	3.82	Asahani	C. Pr	Asahani	
	00.51	240	600	2.70	3.34	4.56	4.59	3.79	Asahani	C. Pr	Asahani	
	00.55			2.70	3.34	4.56	4.59	3.79	Asahani	C. Pr	Asahani	
	00.56	200	500	2.47	3.09	4.22	4.28	3.51	Asahani	C. Pr	Asahani	
	1.00			2.47	3.09	4.22	4.28	3.51	Asahani	C. Pr	Asahani	
	1.01	160	400	2.29	2.84	3.93	4.03	3.27	Asahani	C. Pr	Asahani	
	1.05			2.29	2.84	3.93	4.03	3.27	Asahani	C. Pr	Asahani	
	1.06	120	300	2.05	2.50	3.58	3.71	2.96	Asahani	C. Pr	Asahani	
	1.10			2.05	2.50	3.58	3.71	2.96	Asahani	C. Pr	Asahani	
	1.11	80	200	1.81	2.20	3.23	3.39	2.65	Asahani	C. Pr	Asahani	
	1.15			1.81	2.20	3.23	3.39	2.65	Asahani	C. Pr	Asahani	
	1.16	40	100	1.30	1.84	2.88	2.97	2.24	Asahani	C. Pr	Asahani	
	1.20			1.30	1.84	2.88	2.97	2.24	Asahani	C. Pr	Asahani	
	2.21	0	0.0	0.98	1.41	2.25	2.49	1.78	Asahani	C. Pr	Asahani	
	2.25			0.98	1.41	2.25	2.45	1.78	Asahani	C. Pr	Asahani	
				Total Settlement = 3.83 mm								
				Net Settlement = 1.78 mm								

Rebound 2.25 mm

ZED
Asahani
25/09/24

Asahani
25/09/24

**ZedGeo Systems Private Limited., Mumbai**

RECORD OF PILE LOAD TEST NO.:

PROJECT:-

LOCATION:-

CLIENTS NAME:- CMRL

CONSULTANT:- NKA/B

CONTRACTOR:- LBT

PMC:-

LC OF DIAL GAUGE:- 0.01mm

TYPE OF TEST:- RVPLT

DESIGN LOAD:- 550 MT

TEST LOAD:- 825 MT

MIXED DESIGN:-

PILE DIAMETER:- M-35

1250mm

RAM AREA:-

DATE OF CASTING:-

PILE DEPTH:-

PAGE:- 03

2551 cm²

12/03/24

38.89 m

INITIAL PILE LOAD TEST

DATE	TIME	PRESSURE	LOAD IN MT	Reading				Average settlement	SIGNATURE			REMARK
	(Hrs)	GAUGE READING kg/cm ²		Reading 1	Reading 2	Reading 3	Reading 4	Test Pile	ZED	LBT	NKA/B	
	00:41	330	894.99	1.81	2.50	3.35	3.50	2.79	AK	AK	AK	(Holding for 24 Hrs)
	00:55			1.90	2.59	3.40	3.59	2.83	AK	AK	AK	
	01:10			1.91	2.59	3.41	3.53	2.84	AK	AK	AK	
	01:15			1.91	2.52	3.41	3.53	2.84	AK	AK	AK	
	01:40			1.91	2.59	3.41	3.53	2.84	AK	AK	AK	
	02:40			1.91	2.59	3.41	3.53	2.84	AK	AK	AK	
	03:40			2.01	2.65	3.50	3.69	2.98	AK	C. P.	AK	
	04:40			2.22	2.74	3.73	3.89	3.19	AK	C. P.	AK	
	05:40			2.34	2.94	3.91	3.95	3.28	Asghari	C. P.	AK	
	06:40			2.43	3.03	4.01	4.05	3.38	Asghari	C. P.	AK	
	07:40			2.81	3.44	4.60	4.62	3.86	Asghari	C. P.	AK	
	08:40			2.86	3.50	4.71	4.73	3.95	Asghari	S. J.	AK	(Kaithik on K)
	09:40			3.32	3.97	5.16	5.15	4.4	Asghari	S. J.	AK	
	10:40			3.50	4.14	5.26	5.27	4.54	Asghari	S. J.	AK	
	11:40			3.70	4.36	5.43	5.43	4.73	Asghari	S. J.	AK	
	12:40			3.64	4.31	5.32	5.34	4.65	Asghari	S. J.	AK	(W/S - 105)
	13:40			3.68	4.35	5.34	5.37	4.68	Asghari	S. J.	AK	
	14:40			3.64	4.31	5.29	5.29	4.63	Asghari	S. J.	AK	
	15:40			3.27	3.94	5.00	5.02	4.30	Asghari	S. J.	AK	
	16:40			2.84	3.49	4.65	4.68	3.91	Asghari	S. J.	AK	
	17:40			2.68	3.33	4.51	4.53	3.76	Asghari	S. J.	AK	
	18:40			2.75	3.41	4.57	4.58	3.82	Asghari	S. J.	AK	
	19:40			2.78	3.44	4.59	4.59	3.85	Asghari	S. J.	AK	(W/S - 105)

**ZedGeo Systems Private Limited., Mumbai**

RECORD OF PILE LOAD TEST NO.- P39SB/01
PROJECT:- CPOCS - EV03
LOCATION:-
CLIENTS NAME:- CMRL
CONSULTANT:- NKAB
CONTRACTOR:- L&T
PMC:-

LC OF DIAL GAUGE:- 0.01 mm
TYPE OF TEST:- RVPLT
DESIGN LOAD:- 550 MT
TEST LOAD:- 825 MT
MIXED DESIGN:-
PILE DIAMETER:- M-35
1200 mm

PAGE:- 02
RAM AREA:- 2551 cm²
DATE OF CASTING:- 12/03/23
PILE DEPTH:- 38.093 m

INITIAL PILE LOAD TEST

DATE	TIME	PRESSURE	LOAD IN MT	Reading				Average settlement	SIGNATURE			REMARK
	(Hrs)	kg/cm ²		Reading 1	Reading 2	Reading 3	Reading 4	Test Pile	ZED	L&T	NKAB	
20/09/23												
	20:4	200	500	0.87	1.20	1.66	2.10	1.46	OK	Dr	OK	
	20:55			0.87	1.20	1.66	2.10	1.46	OK	Dr	OK	
	21:10			0.90	1.22	1.68	2.12	1.48	OK	Dr	OK	
	21:25			0.90	1.23	1.70	2.15	1.49	OK	Dr	OK	
	21:40			0.90	1.23	1.70	2.15	1.49	OK	Dr	OK	
	21:4	240	600	1.22	1.65	2.22	2.70	1.95	OK	Dr	OK	
	21:55			1.22	1.62	2.23	2.71	1.95	OK	Dr	OK	
	22:10			1.24	1.64	2.25	2.72	1.97	OK	Dr	OK	
	22:25			1.25	1.66	2.27	2.74	1.99	OK	Dr	OK	
	22:40			1.27	1.69	2.30	2.76	2.00	OK	Dr	OK	
	22:4	280	699.99	1.50	1.96	2.75	3.10	2.33	OK	Dr	OK	
	22:55			1.50	1.96	2.75	3.10	2.33	OK	Dr	OK	
	23:10			1.50	1.96	2.75	3.10	2.33	OK	Dr	OK	
	23:25			1.51	1.97	2.76	3.11	2.34	OK	Dr	OK	
	23:40			1.51	1.97	2.76	3.11	2.34	OK	Dr	OK	
	23:4	320	799.99	1.70	2.35	3.25	3.40	2.67	OK	Dr	OK	
	23:55			1.71	2.36	3.26	3.41	2.68	OK	Dr	OK	
	00:10			1.71	2.36	3.26	3.41	2.68	OK	Dr	OK	
	00:25			1.71	2.36	3.26	3.41	2.68	OK	Dr	OK	
	00:40			1.71	2.36	3.26	3.41	2.68	OK	Dr	OK	

**ZedGeo Systems Private Limited., Mumbai**

RECORD OF PILE LOAD TEST NO:- P395, B/01

PROJECT:- CP10 - C5 - EV03

LOCATION:- KOYAMBEDU

CONTRACTOR:- L&T

CLIENTS NAME:- NKAB (CMRL)

L.C OF DIAL GAUGE:- 0.01mm

Type of Test:- RUPLT

Design load on pile:- 550MT

Test Load:- 025 MT

Mixed Design:- m-35

Pile Diameter:- 1200mm

Page:- 01
Ram Area:- 2931cm²
Date of Casting:- 12/03/2023
Pile Depth:- 38.293 mtr

ROUTINE INITIAL PILE LOAD TEST											REMARK
DATE	TIME	PRESSURE	LOAD IN MT	Reading				Average settlement	SIGNATURE		
	(Hrs)	GAUGE READING kg/cm2		Reading 1	Reading 2	Reading 3	Reading 4	Test Pile	ZED	LBT	NKAR
23/09/24	16:39	0	0	0	0	0	0	0	DK	DK	DK
	16:40	40	100	0.20	0.25	0.30	0.75	0.37	DK	DK	DK
	16:55			0.17	0.21	0.26	0.74	0.34	DK	DK	DK
	17:10			0.15	0.18	0.23	0.71	0.32	DK	DK	DK
	17:25			0.12	0.15	0.20	0.70	0.29	DK	DK	DK
	17:40			0.10	0.12	0.17	0.67	0.26	DK	DK	DK
	17:41	80	200	0.27	0.42	0.52	1.09	0.57	DK	DK	DK
	17:55			0.25	0.40	0.50	1.07	0.55	DK	DK	DK
	18:10			0.25	0.40	0.52	1.07	0.56	DK	DK	DK
	18:25			0.24	0.39	0.51	1.06	0.55	DK	DK	DK
	18:40			0.24	0.39	0.51	1.06	0.55	DK	DK	DK
	18:41	120	300	0.44	0.69	0.89	1.44	0.86	DK	DK	DK
	18:55			0.43	0.69	0.89	1.44	0.86	DK	DK	DK
	19:10			0.44	0.70	0.90	1.45	0.87	DK	DK	DK
	19:25			0.44	0.70	0.91	1.47	0.88	DK	DK	DK
	19:40			0.44	0.70	0.91	1.47	0.88	DK	DK	DK
	19:41	160	400	0.66	0.99	1.26	1.90	1.18	DK	DK	DK
	19:55			0.66	0.99	1.26	1.90	1.18	DK	DK	DK
	20:10			0.66	0.94	1.28	1.90	1.19	DK	DK	DK
	20:25			0.68	0.94	1.30	1.90	1.20	DK	DK	DK
	20:40			0.68	0.94	1.30	1.90	1.20	DK	DK	DK

Appointment Scheduler

[← Back to Appointment Scheduler \(/appointmentscheduler-appointment/ca/en\)](/appointmentscheduler-appointment/ca/en)

✓ Appointment Confirmation



Click here to print your appointment details

Appointment Scheduler Details

USCIS HOUSTON SOUTHWEST (ASC):
Houston, TX

9440 Highway 6 South
Houston, TX 77083

Date: 07/01/2025

Time: 01:00 PM

IRCC number:
1000025611458

What you need to bring:

- ▶ **Biometrics letter** - Your Canadian biometrics instruction letter
- ▶ **Your passport or travel document** - The document used in your application

Additional information:

- ▶ Print a copy of your appointment details if you want to bring it to your appointment
- ▶ All USCIS Application Support Centers are handicap accessible
- ▶ Bring a translator if you need help reading, speaking, or

USCIS HOUSTON SOUTHWEST (ASC): Houston, TX

9440 Highway 6 South
Houston, TX 77083

Date: 07/01/2025
Heure: 01:00 PM
Numéro IRCC:
1000025611458

Ce que vous devez apporter:

- ▶ **Lettre d'instructions pour la collecte de données biométriques**
- Votre lettre d'instructions du Canada
- ▶ **Votre passeport ou document de voyage** - Le document utilisé dans votre demande

Informations supplémentaires:

- ▶ Imprimez une copie des détails de votre rendez-vous si vous souhaitez l'apporter à votre rendez-vous
- ▶ Tous les centres d'aide à la demande sont accessibles aux personnes handicapées.
- ▶ Soyez accompagné(e) d'un(e) interprète si vous avez besoin d'aide pour lire, parler ou comprendre l'anglais

Pile ID: TP-01 | Location: Building-3 Wing B
Test Date: 08 December 2025 | Test Method: IS 2911 (Part 4) - 2013

PASSED

Working load capacity

IS 2911 (Part 4)

Time (min)	Specimen 1 Settlement (mm)	Specimen 2 Settlement (mm)
0	-	4.0
100	0.2	4.8
200	0.5	5.1
300	0.8	5.5
400	1.2	5.8
500	1.5	6.0

4.0 Results & Conclusion

 Generate Conclusion



No conclusion generated yet

Click "Generate Conclusion" to create an IS 2911-compliant conclusion using AI

Load Increment Summary

Phase	Date	Time	Load (MT)	Pressure	Avg Settlement	Remarks
LOADING	08/12/2025	11:59 PM	0.00	0 kg/cm ²	- mm	Start
LOADING	09/12/2025	12:00 AM	102.04	40 kg/cm ²	0.06 mm	-
LOADING	09/12/2025	12:15 AM	102.04	40 kg/cm ²	0.13 mm	-
LOADING	09/12/2025	12:30 AM	102.04	40 kg/cm ²	0.17 mm	-
LOADING	09/12/2025	12:45 AM	102.04	40 kg/cm ²	0.19 mm	-
LOADING	09/12/2025	01:00 AM	102.04	40 kg/cm ²	0.21 mm	-
LOADING	09/12/2025	01:01 AM	204.08	80 kg/cm ²	0.41 mm	-
LOADING	09/12/2025	01:15 AM	204.08	80 kg/cm ²	0.29 mm	-
LOADING	09/12/2025	01:30 AM	204.08	80 kg/cm ²	0.43 mm	-
LOADING	09/12/2025	01:45 AM	204.08	80 kg/cm ²	0.47 mm	-
LOADING	09/12/2025	02:00 AM	204.08	80 kg/cm ²	0.52 mm	-
LOADING	09/12/2025	02:01 AM	306.12	120 kg/cm ²	0.77 mm	-
LOADING	09/12/2025	02:15 AM	306.12	120 kg/cm ²	0.81 mm	-
LOADING	09/12/2025	02:30 AM	306.12	120 kg/cm ²	0.83 mm	-
LOADING	09/12/2025	02:45 AM	306.12	120 kg/cm ²	0.86 mm	-
LOADING	09/12/2025	03:00 AM	306.12	120 kg/cm ²	0.89 mm	-
LOADING	09/12/2025	03:01 AM	408.16	160 kg/cm ²	1.25 mm	-
LOADING	09/12/2025	03:15 AM	408.16	160 kg/cm ²	1.28 mm	-
LOADING	09/12/2025	03:30 AM	408.16	160 kg/cm ²	1.31 mm	-
LOADING	09/12/2025	03:45 AM	408.16	160 kg/cm ²	1.08 mm	-
LOADING	09/12/2025	04:00 AM	408.16	160 kg/cm ²	1.24 mm	override
LOADING	09/12/2025	04:01 AM	510.20	200 kg/cm ²	1.51 mm	-
LOADING	09/12/2025	04:15 AM	510.20	200 kg/cm ²	1.50 mm	-
LOADING	09/12/2025	04:30 AM	510.20	200 kg/cm ²	1.53 mm	-
LOADING	09/12/2025	04:45 AM	510.20	200 kg/cm ²	1.56 mm	-

Phase	Date	Time	Load (MT)	Pressure	Avg Settlement	Remarks
LOADING	09/12/2025	05:00 AM	510.20	200 kg/cm ²	1.59 mm	-
LOADING	09/12/2025	05:01 AM	612.24	240 kg/cm ²	2.08 mm	-
LOADING	09/12/2025	05:15 AM	612.24	240 kg/cm ²	2.11 mm	-
LOADING	09/12/2025	05:30 AM	612.24	240 kg/cm ²	2.13 mm	-
LOADING	09/12/2025	05:45 AM	612.24	240 kg/cm ²	2.13 mm	-
LOADING	09/12/2025	06:00 AM	612.24	240 kg/cm ²	2.16 mm	-
LOADING	09/12/2025	06:01 AM	714.28	280 kg/cm ²	2.66 mm	-
LOADING	09/12/2025	06:15 AM	714.28	280 kg/cm ²	2.66 mm	-
LOADING	09/12/2025	06:30 AM	714.28	280 kg/cm ²	2.67 mm	-
LOADING	09/12/2025	06:45 AM	714.28	280 kg/cm ²	2.68 mm	-
LOADING	09/12/2025	07:00 AM	714.28	280 kg/cm ²	2.68 mm	-
LOADING	09/12/2025	07:01 AM	816.32	320 kg/cm ²	3.30 mm	-
LOADING	09/12/2025	07:15 AM	816.32	320 kg/cm ²	3.33 mm	-
LOADING	09/12/2025	07:30 AM	816.32	320 kg/cm ²	3.35 mm	-
LOADING	09/12/2025	07:45 AM	816.32	320 kg/cm ²	3.38 mm	-
LOADING	09/12/2025	08:00 AM	816.32	320 kg/cm ²	3.40 mm	-
LOADING	09/12/2025	08:01 AM	918.36	360 kg/cm ²	4.18 mm	-
LOADING	09/12/2025	08:15 AM	918.36	360 kg/cm ²	4.20 mm	-
LOADING	09/12/2025	08:30 AM	918.36	360 kg/cm ²	4.23 mm	-
LOADING	09/12/2025	08:45 AM	918.36	360 kg/cm ²	4.27 mm	-
LOADING	09/12/2025	09:00 AM	918.36	360 kg/cm ²	4.30 mm	-
LOADING	09/12/2025	09:01 AM	1020.40	400 kg/cm ²	4.95 mm	-
LOADING	09/12/2025	09:15 AM	1020.40	400 kg/cm ²	5.00 mm	-
LOADING	09/12/2025	09:30 AM	1020.40	400 kg/cm ²	5.03 mm	-
LOADING	09/12/2025	09:45 AM	1020.40	400 kg/cm ²	5.06 mm	-
LOADING	09/12/2025	10:00 AM	1020.40	400 kg/cm ²	5.08 mm	-
LOADING	09/12/2025	10:01 AM	1071.42	420 kg/cm ²	5.36 mm	-
HOLDING	09/12/2025	11:00 AM	1071.42	420 kg/cm ²	5.40 mm	-
HOLDING	09/12/2025	12:00 PM	1071.42	420 kg/cm ²	5.44 mm	-
HOLDING	09/12/2025	01:00 PM	1071.42	420 kg/cm ²	5.50 mm	-
HOLDING	09/12/2025	02:00 PM	1071.42	420 kg/cm ²	5.53 mm	-
HOLDING	09/12/2025	03:00 PM	1071.42	420 kg/cm ²	5.58 mm	-

Phase	Date	Time	Load (MT)	Pressure	Avg Settlement	Remarks
HOLDING	09/12/2025	04:00 PM	1071.42	420 kg/cm ²	5.60 mm	-
HOLDING	09/12/2025	05:00 PM	1071.42	420 kg/cm ²	5.62 mm	-
HOLDING	09/12/2025	06:00 PM	1071.42	420 kg/cm ²	5.66 mm	-
HOLDING	09/12/2025	07:00 PM	1071.42	420 kg/cm ²	5.67 mm	-
HOLDING	09/12/2025	08:00 PM	1071.42	420 kg/cm ²	5.68 mm	-
HOLDING	09/12/2025	09:00 PM	1071.42	420 kg/cm ²	5.74 mm	-
HOLDING	09/12/2025	10:00 PM	1071.42	420 kg/cm ²	5.79 mm	-
HOLDING	09/12/2025	11:00 PM	1071.42	420 kg/cm ²	6.14 mm	-
HOLDING	10/12/2025	12:00 AM	1071.42	420 kg/cm ²	6.63 mm	-
HOLDING	10/12/2025	01:00 AM	1071.42	420 kg/cm ²	6.86 mm	-
HOLDING	10/12/2025	02:00 AM	1071.42	420 kg/cm ²	6.95 mm	-
HOLDING	10/12/2025	03:00 AM	1071.42	420 kg/cm ²	7.00 mm	-
HOLDING	10/12/2025	04:00 AM	1071.42	420 kg/cm ²	7.12 mm	-
HOLDING	10/12/2025	05:00 AM	1071.42	420 kg/cm ²	7.17 mm	-
HOLDING	10/12/2025	06:00 AM	1071.42	420 kg/cm ²	7.19 mm	-
HOLDING	10/12/2025	07:00 AM	1071.42	420 kg/cm ²	7.21 mm	-
HOLDING	10/12/2025	08:00 AM	1071.42	420 kg/cm ²	7.22 mm	-
HOLDING	10/12/2025	09:00 AM	1071.42	420 kg/cm ²	7.22 mm	-
HOLDING	10/12/2025	10:00 AM	1071.42	420 kg/cm ²	7.22 mm	-
UNLOADING	10/12/2025	10:01 AM	1020.40	400 kg/cm ²	7.18 mm	-
UNLOADING	10/12/2025	10:05 AM	1020.40	400 kg/cm ²	7.18 mm	-
UNLOADING	10/12/2025	10:15 AM	1020.40	400 kg/cm ²	7.19 mm	-
UNLOADING	10/12/2025	10:16 AM	918.36	360 kg/cm ²	7.10 mm	-
UNLOADING	10/12/2025	10:20 AM	918.36	360 kg/cm ²	7.06 mm	-
UNLOADING	10/12/2025	10:30 AM	918.36	360 kg/cm ²	7.04 mm	-
UNLOADING	10/12/2025	10:31 AM	816.32	320 kg/cm ²	6.87 mm	-
UNLOADING	10/12/2025	10:35 AM	816.32	320 kg/cm ²	6.85 mm	-
UNLOADING	10/12/2025	10:45 AM	816.32	320 kg/cm ²	6.85 mm	-
UNLOADING	10/12/2025	10:46 AM	714.24	280 kg/cm ²	6.66 mm	-
UNLOADING	10/12/2025	10:50 AM	714.24	280 kg/cm ²	6.64 mm	-
UNLOADING	10/12/2025	11:00 AM	714.24	280 kg/cm ²	6.63 mm	-
UNLOADING	10/12/2025	11:01 AM	612.24	240 kg/cm ²	6.42 mm	-

Phase	Date	Time	Load (MT)	Pressure	Avg Settlement	Remarks
UNLOADING	10/12/2025	11:05 AM	612.24	240 kg/cm ²	6.37 mm	-
UNLOADING	10/12/2025	11:15 AM	612.24	240 kg/cm ²	6.35 mm	-
UNLOADING	10/12/2025	11:16 AM	510.20	200 kg/cm ²	6.14 mm	-
UNLOADING	10/12/2025	11:20 AM	510.20	200 kg/cm ²	6.13 mm	-
UNLOADING	10/12/2025	11:30 AM	510.20	200 kg/cm ²	6.13 mm	-
UNLOADING	10/12/2025	11:31 AM	402.16	160 kg/cm ²	5.89 mm	-
UNLOADING	10/12/2025	11:35 AM	402.16	160 kg/cm ²	5.87 mm	-
UNLOADING	10/12/2025	11:45 AM	402.16	160 kg/cm ²	5.84 mm	-
UNLOADING	10/12/2025	11:46 AM	306.12	120 kg/cm ²	5.58 mm	-
UNLOADING	10/12/2025	11:50 AM	306.12	120 kg/cm ²	5.54 mm	-
UNLOADING	10/12/2025	12:00 PM	306.12	120 kg/cm ²	5.51 mm	-
UNLOADING	10/12/2025	12:01 PM	204.08	80 kg/cm ²	5.25 mm	-
UNLOADING	10/12/2025	12:05 PM	204.08	80 kg/cm ²	5.21 mm	-
UNLOADING	10/12/2025	12:15 PM	204.08	80 kg/cm ²	5.18 mm	-
UNLOADING	10/12/2025	12:16 PM	102.04	40 kg/cm ²	4.89 mm	-
UNLOADING	10/12/2025	12:20 PM	102.04	40 kg/cm ²	4.81 mm	-
UNLOADING	10/12/2025	12:30 PM	102.04	40 kg/cm ²	4.80 mm	-
UNLOADING	10/12/2025	12:31 PM	0.00	0 kg/cm ²	4.14 mm	-
UNLOADING	10/12/2025	12:35 PM	0.00	0 kg/cm ²	4.10 mm	-
UNLOADING	10/12/2025	12:45 PM	0.00	0 kg/cm ²	4.06 mm	-