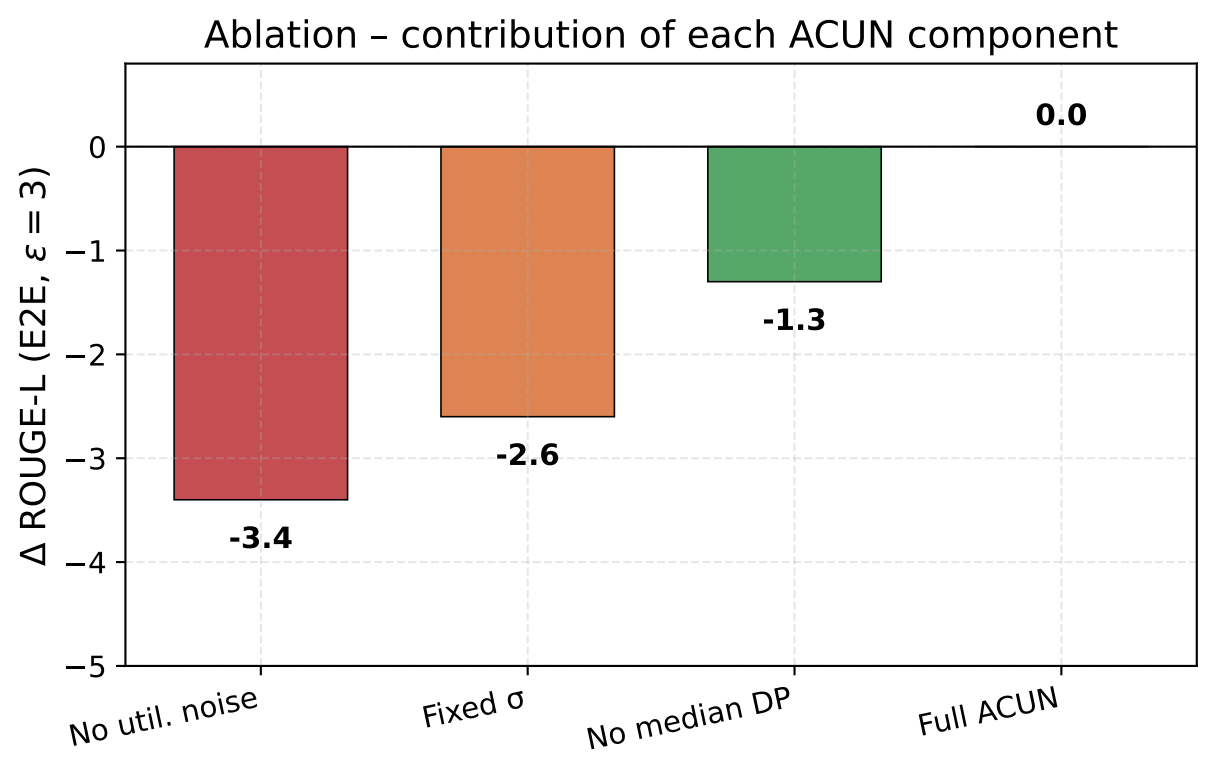
Ablation – contribution of each ACUN component
Δ ROUGE-L (E2E, ε = 3)
0
−1
−2
−3
−4
−5
-3.4
-2.6
-1.3
0.0
No util. noise
Fixed σ
No median DP
Full ACUN