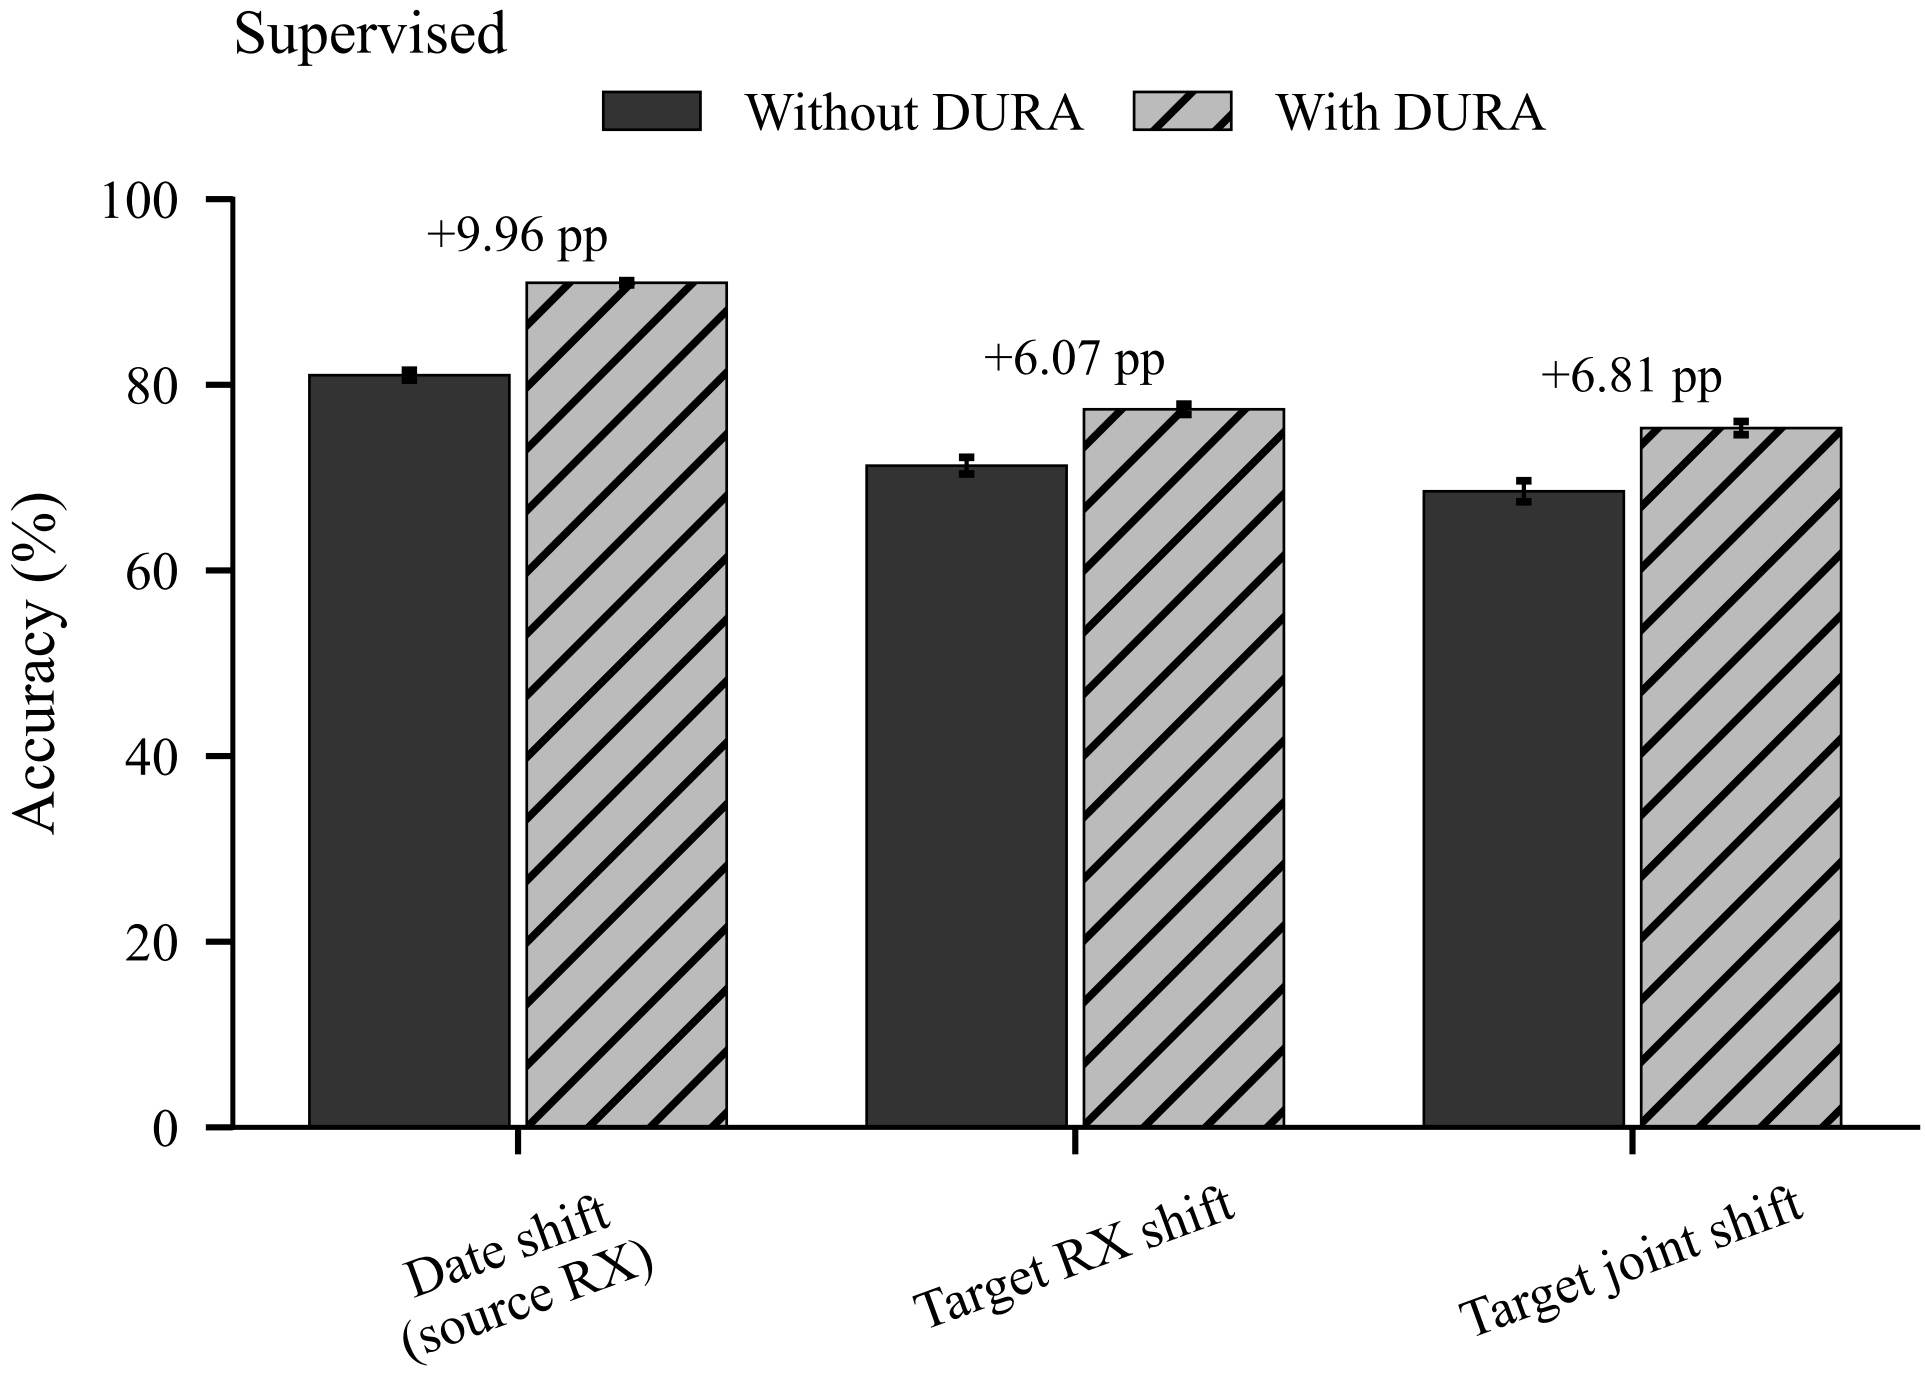
Supervised
Without DURA
With DURA
100
80
60
40
20
0
Accuracy (%)
+9.96 pp
+6.07 pp
+6.81 pp
Date shift
(source RX)
Target RX shift
Target joint shift