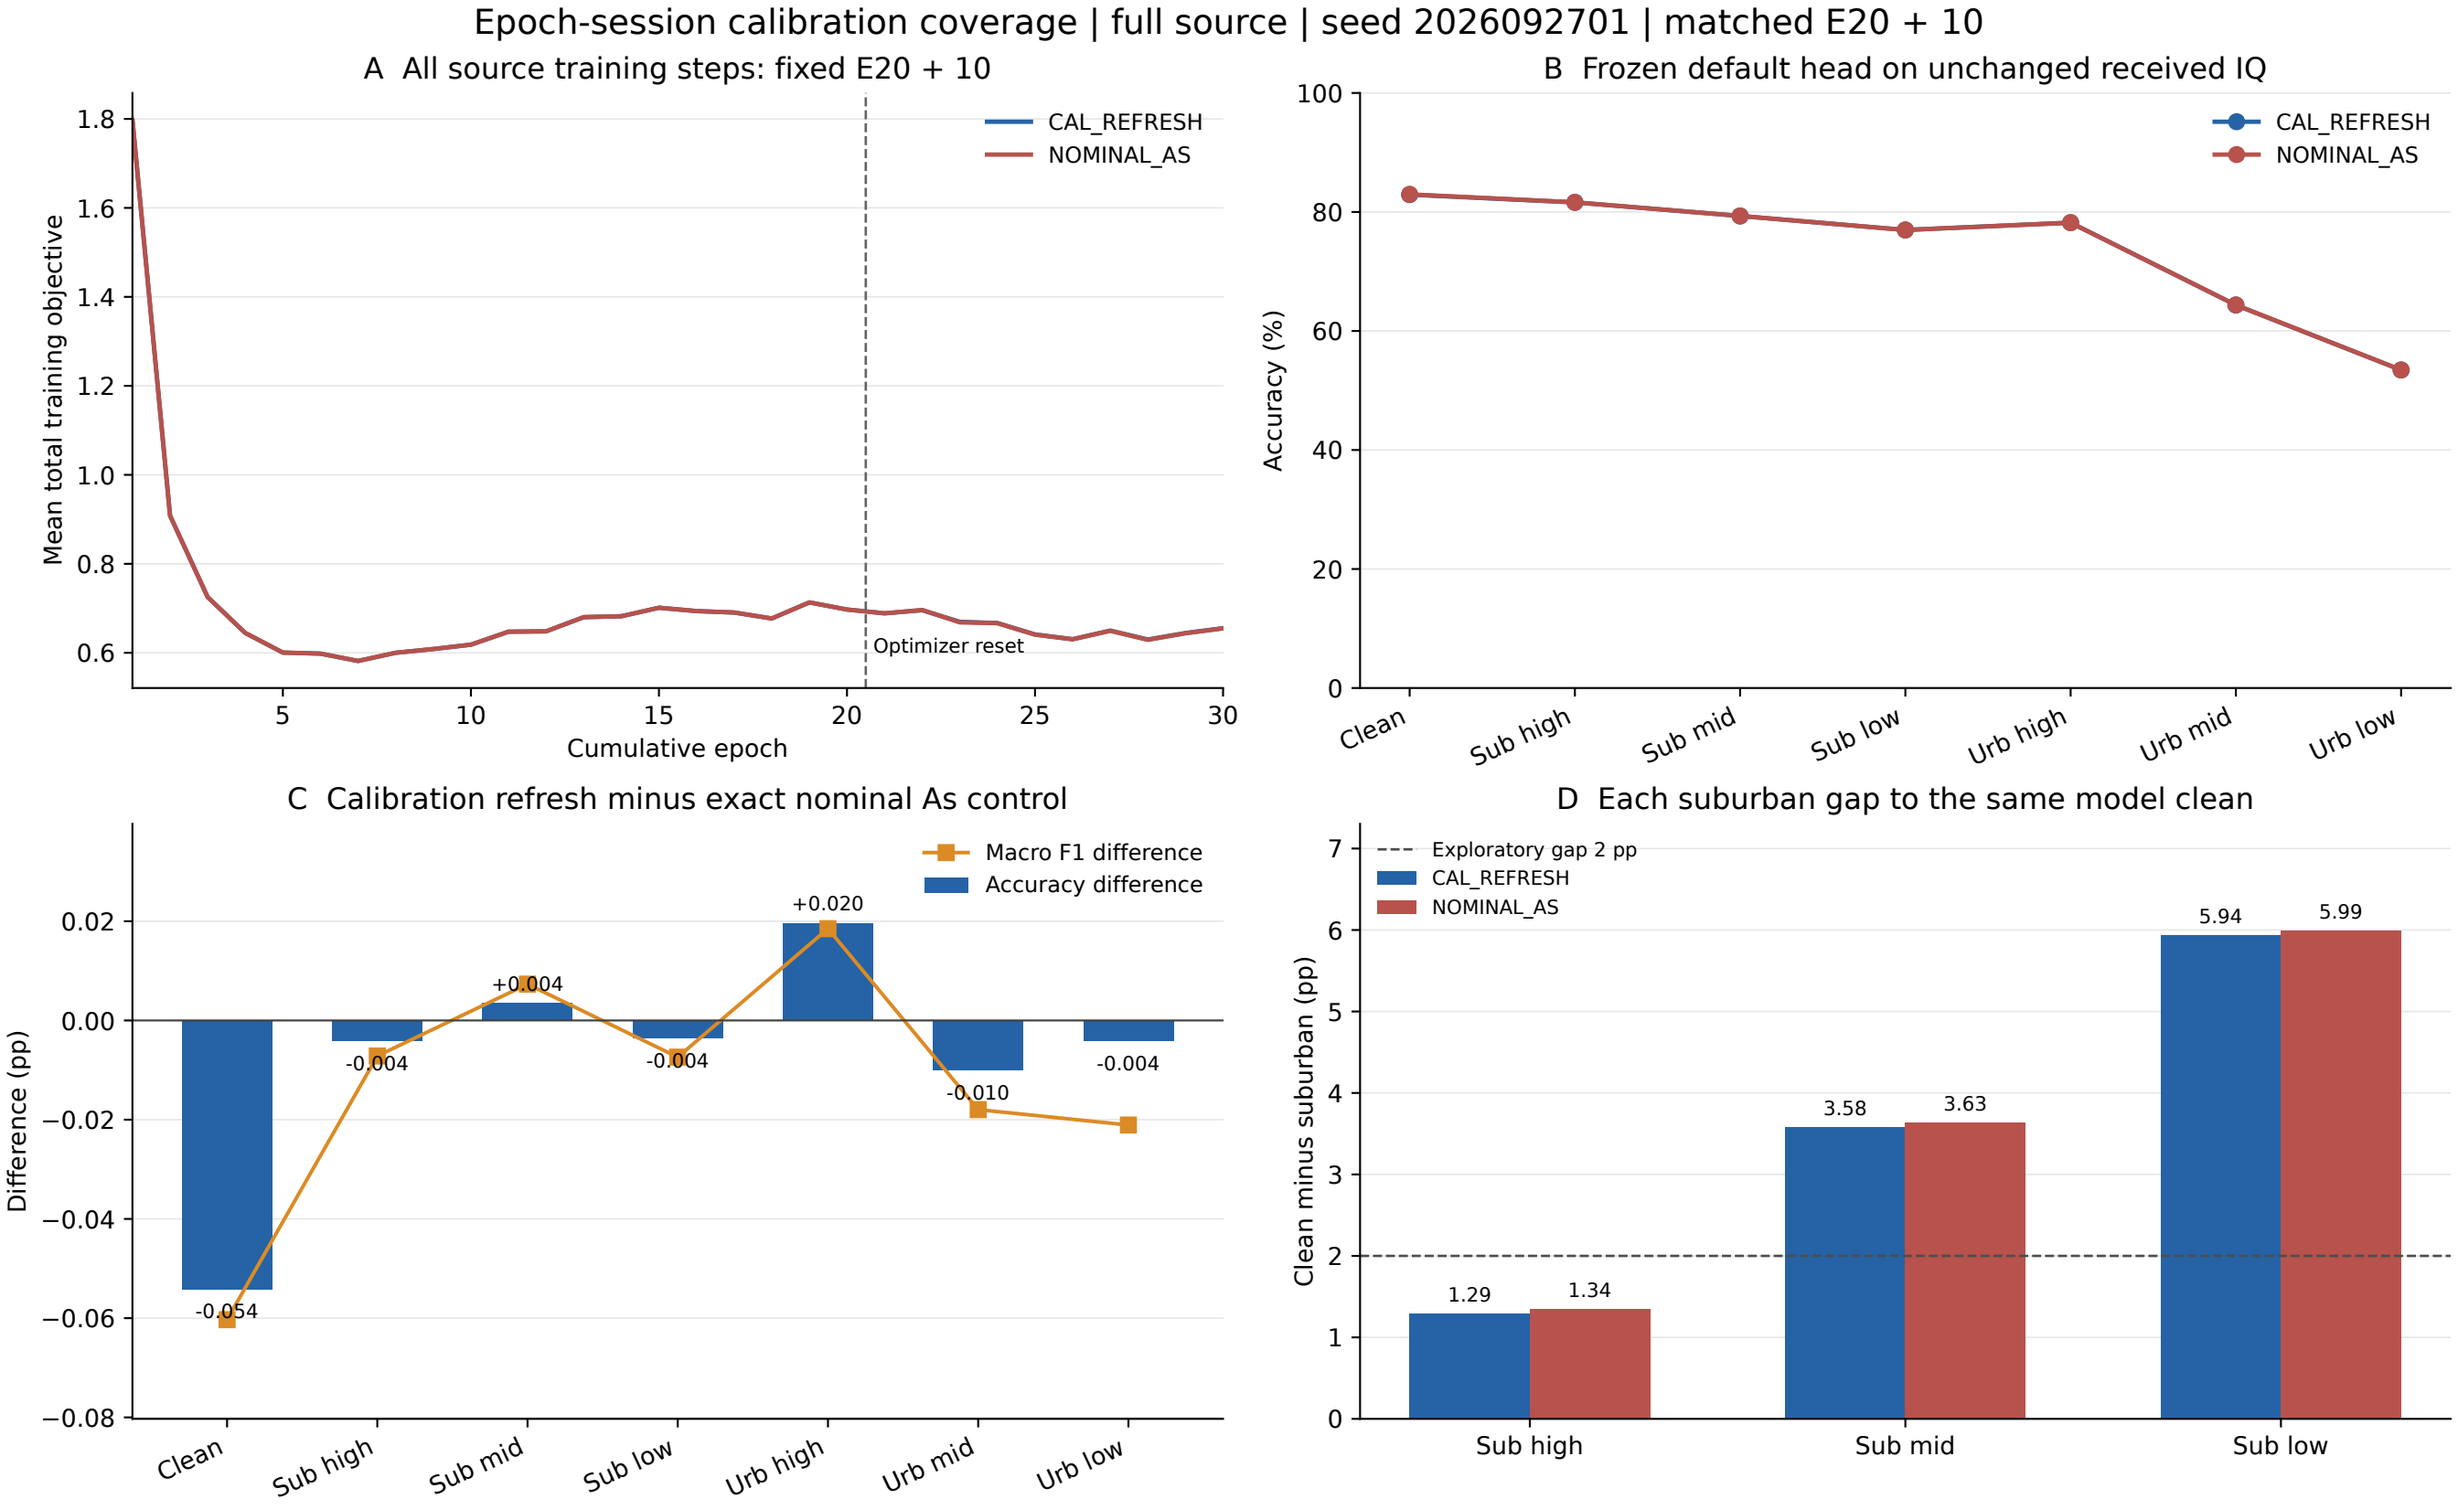
Epoch-session calibration coverage | full source | seed 2026092701 | matched E20 + 10
A All source training steps: fixed E20 + 10
Mean total training objective
Cumulative epoch
CAL_REFRESH
NOMINAL_AS
Optimizer reset
B Frozen default head on unchanged received IQ
Accuracy (%)
CAL_REFRESH
NOMINAL_AS
Clean
Sub high
Sub mid
Sub low
Urb high
Urb mid
Urb low
C Calibration refresh minus exact nominal As control
Difference (pp)
Macro F1 difference
Accuracy difference
-0.054
-0.004
+0.004
-0.004
+0.020
-0.010
-0.004
D Each suburban gap to the same model clean
Clean minus suburban (pp)
Exploratory gap 2 pp
CAL_REFRESH
NOMINAL_AS
1.29
1.34
3.58
3.63
5.94
5.99
Sub high
Sub mid
Sub low