



Front panels for the CO2 Calibration System Reference Select box using MKS 640 pressure controllers. Viewed from outside.
Panel: Lansing 3U x Full width x 18"
2015-05-28

1U panel (1.72" x 16.5")

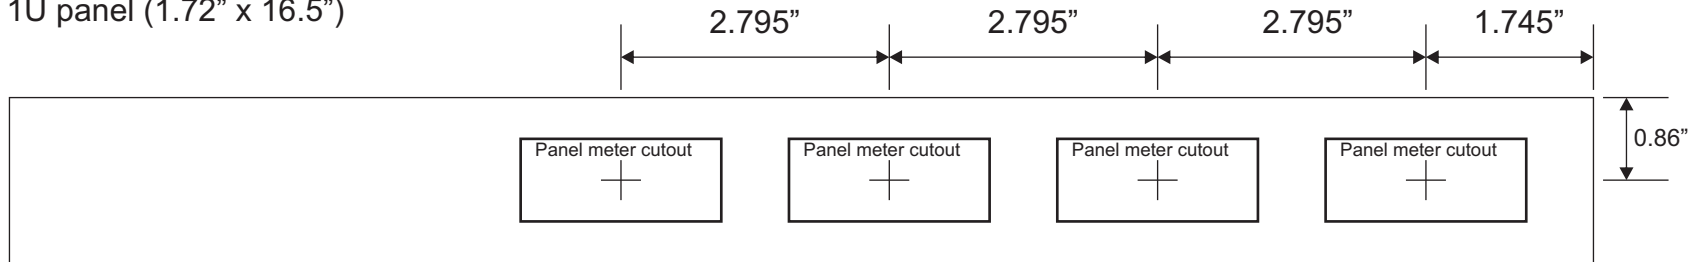

3U panel (5.25" x 16.5")

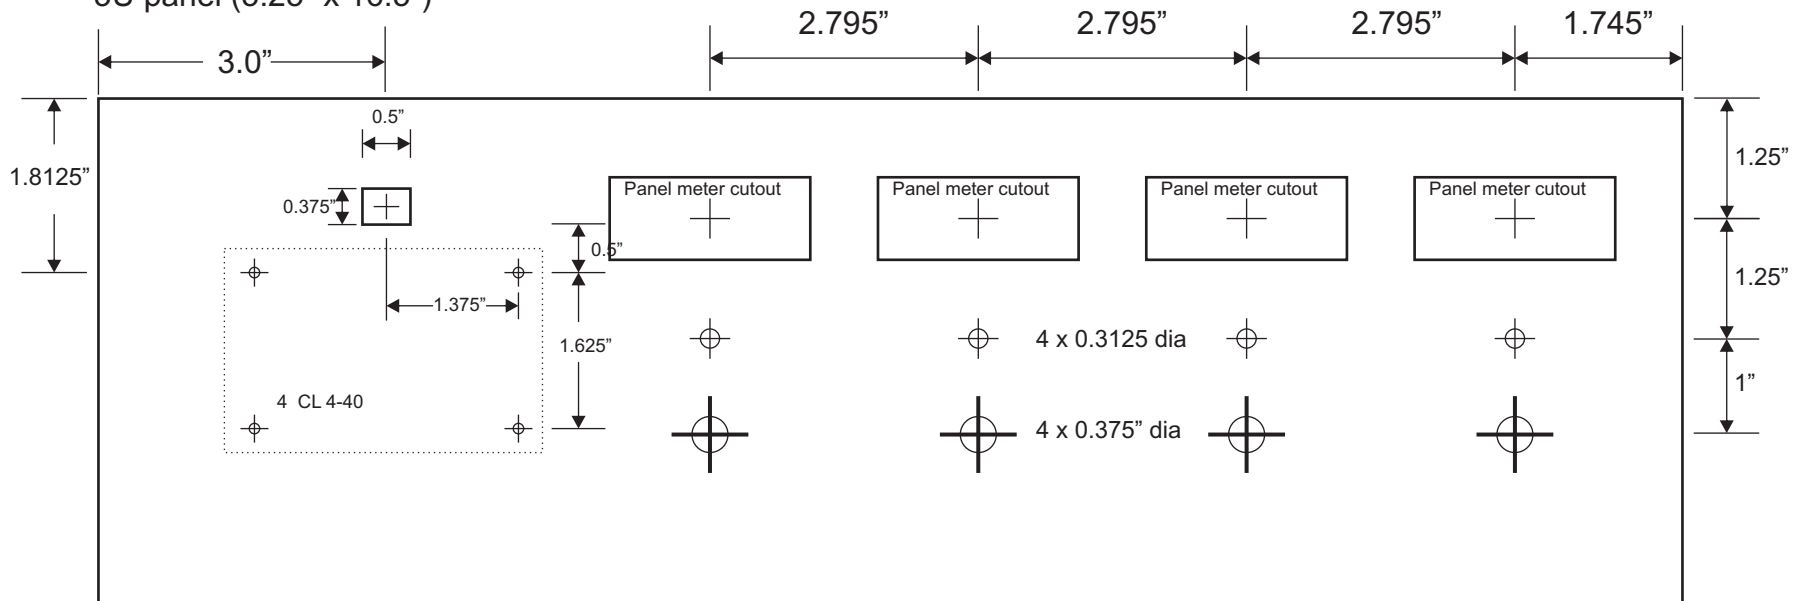


Panel Meter Cutouts
MIN: 2.09" x 0.84"
MAX: 2.17" x 0.92"

Back panels for the CO2 Calibration System Reference Select Box using MKS pressure controllers. Viewed from outside.

Back panel: Lansing 3U x Full width x 18"


2015-05-28

1U panel (1.72" x 16.5")

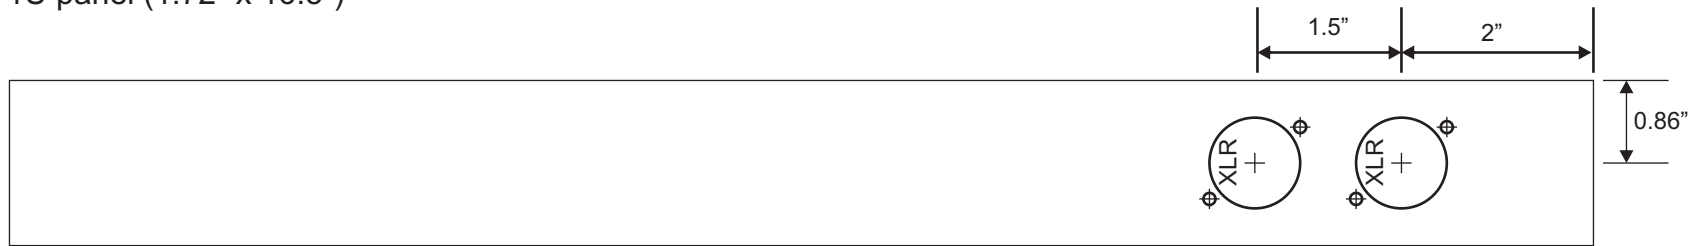


XLR cutouts rotated 90 degrees from cutout diagram on last page


3U panel (5.25" x 16.5")

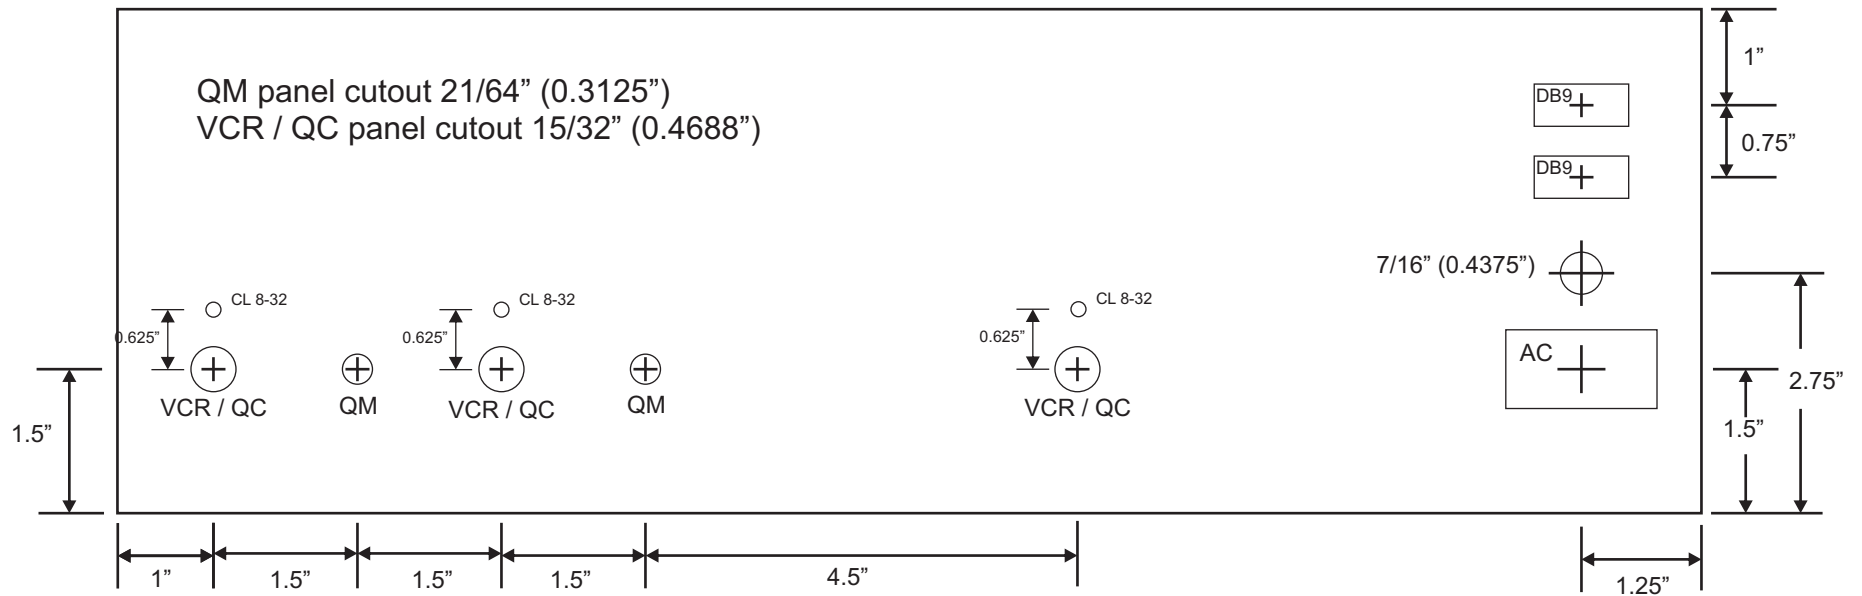

Mounting plate
approximately 1/8" x 16 1/2" x 17 5/8"

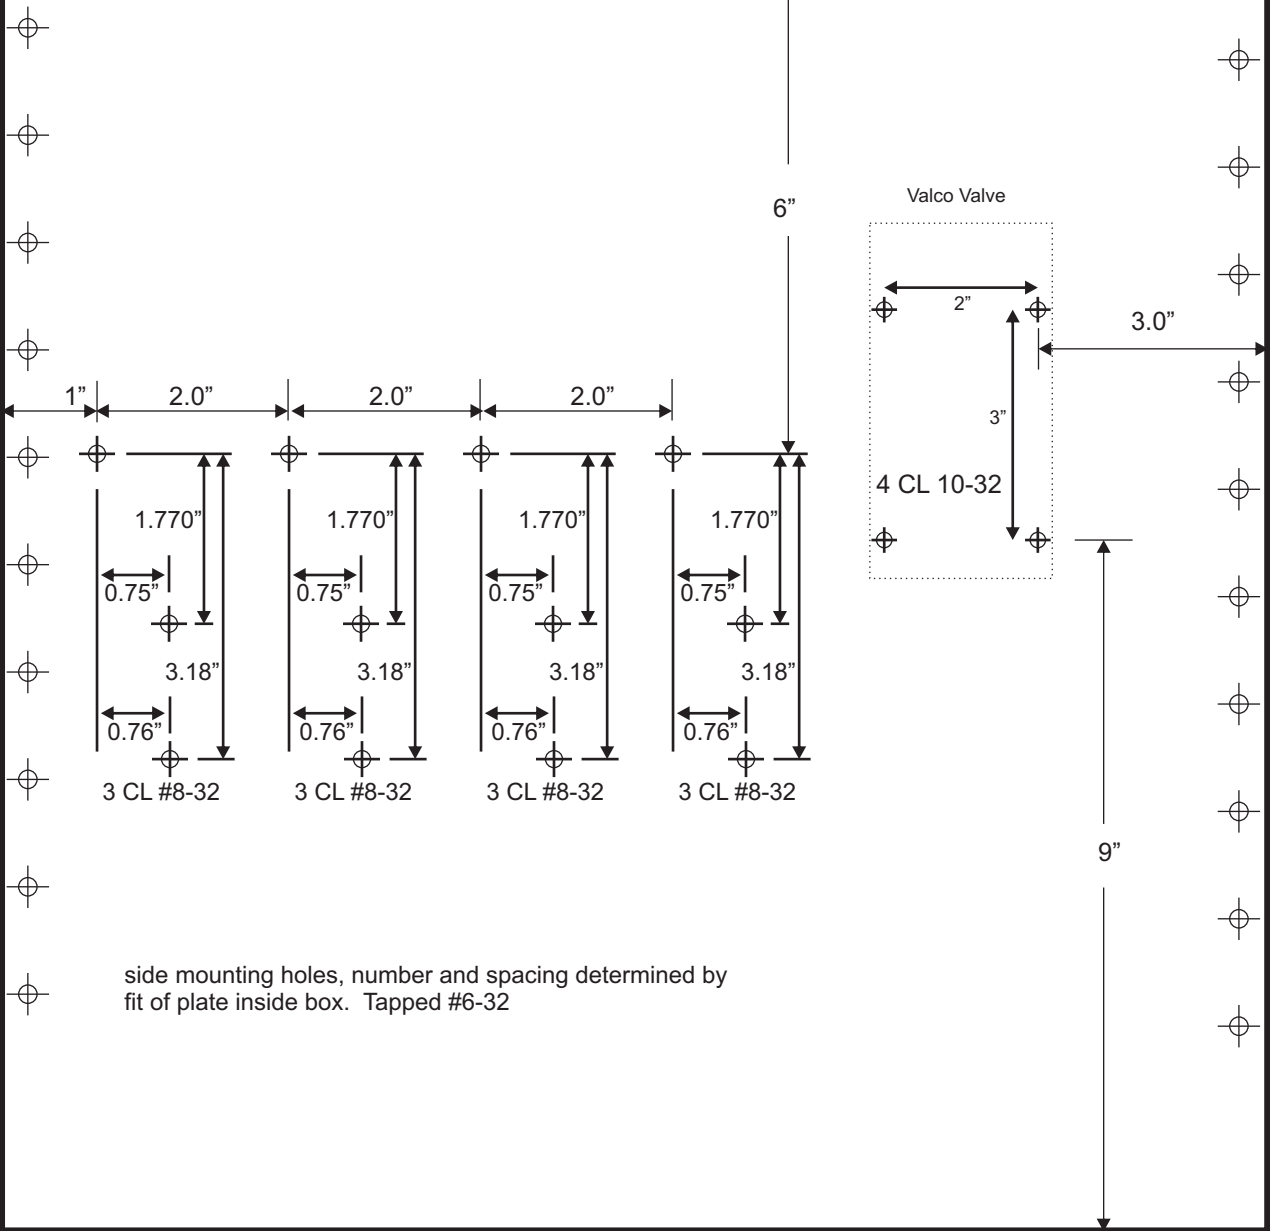

side mounting holes, number and spacing determined by
fit of plate inside box. Tapped #6-32

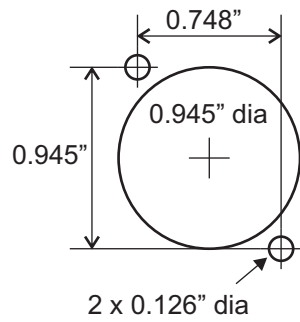

XLR panel connector

