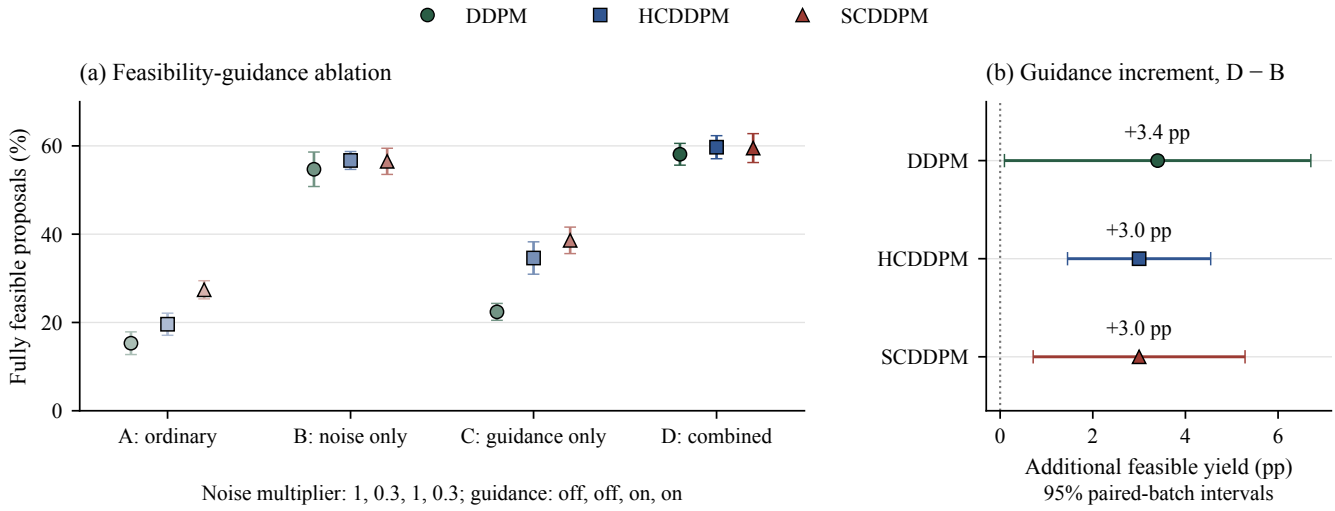
DDPM
HCDDPM
SCDDPM
(a) Feasibility-guidance ablation
Fully feasible proposals (%)
0
20
40
60
A: ordinary
B: noise only
C: guidance only
D: combined
Noise multiplier: 1, 0.3, 1, 0.3; guidance: off, off, on, on
(b) Guidance increment, D − B
+3.4 pp
+3.0 pp
+3.0 pp
DDPM
HCDDPM
SCDDPM
0
2
4
6
Additional feasible yield (pp)
95% paired-batch intervals