Q-PALL PLASTIC PALLETS

Technical specifications
Datasheet, edition October 2026

1200 x 800 mm · EURO PALLET

Plastic pallet 1200 x 800 x 160 open deck 3 runners light – 2.QP1208LB3RR

LIGHT | Open deck | 3 runners | Nestable

TOP



BOTTOM



2,500 kg	1,000 kg	–
Static load on a flat floor	Dynamic load by forklift or pallet truck	Racking load Not for racking

DIMENSIONS AND WEIGHT

Item number	2.QP1208LB3RR
Length	1200 mm
Width	800 mm
Height	160 mm
Weight	7 kg

CONSTRUCTION AND MATERIAL

Top deck	Open deck
Bottom	3 runners
Load class	Light
Nestable	Yes
Material	Nearly 100% recycled plastic (HDPE/PP/LDPE)
Colour	Black (standard), other colours on request
ISPM 15	Exempt (no treatment needed)

DELIVERY AND DOCUMENTATION

Production location	On request
Ordering in stacks	45 pallets per stack (stack dimensions approx. 1200 x 800 x 2360 mm)
Delivery	Nested, runners supplied loose
PPWR (EU 2025/40)	Declaration of conformity available

SIMILAR VERSIONS AND PRODUCTION LOCATIONS


ITEM NUMBER	PRODUCTION LOCATION	DIMENSIONS (MM)	WEIGHT	STATIC	DYNAMIC	RACKING
2.QP1208LB3RR This datasheet	On request	1200 x 800 x 160	7 kg	2,500 kg	1,000 kg	–
3.QP1208LB3RR	On request	1200 x 800 x 160	7.2 kg	2,500 kg	1,000 kg	–
QP1208LB3RR	Ribe (DK)	1200 x 800 x 150	7.3 kg	2,500 kg	1,000 kg	–

Click an item number for the page and datasheet of that version. We deliver from a factory where your pallet is available, as close to you as possible. Small differences in height, weight and load capacity between the versions are possible.

1200 x 800 mm · EURO PALLET

Plastic pallet 1200 x 800 x 160 open deck 3 runners light – 2.QP1208LB3RR

TECHNICAL DRAWING

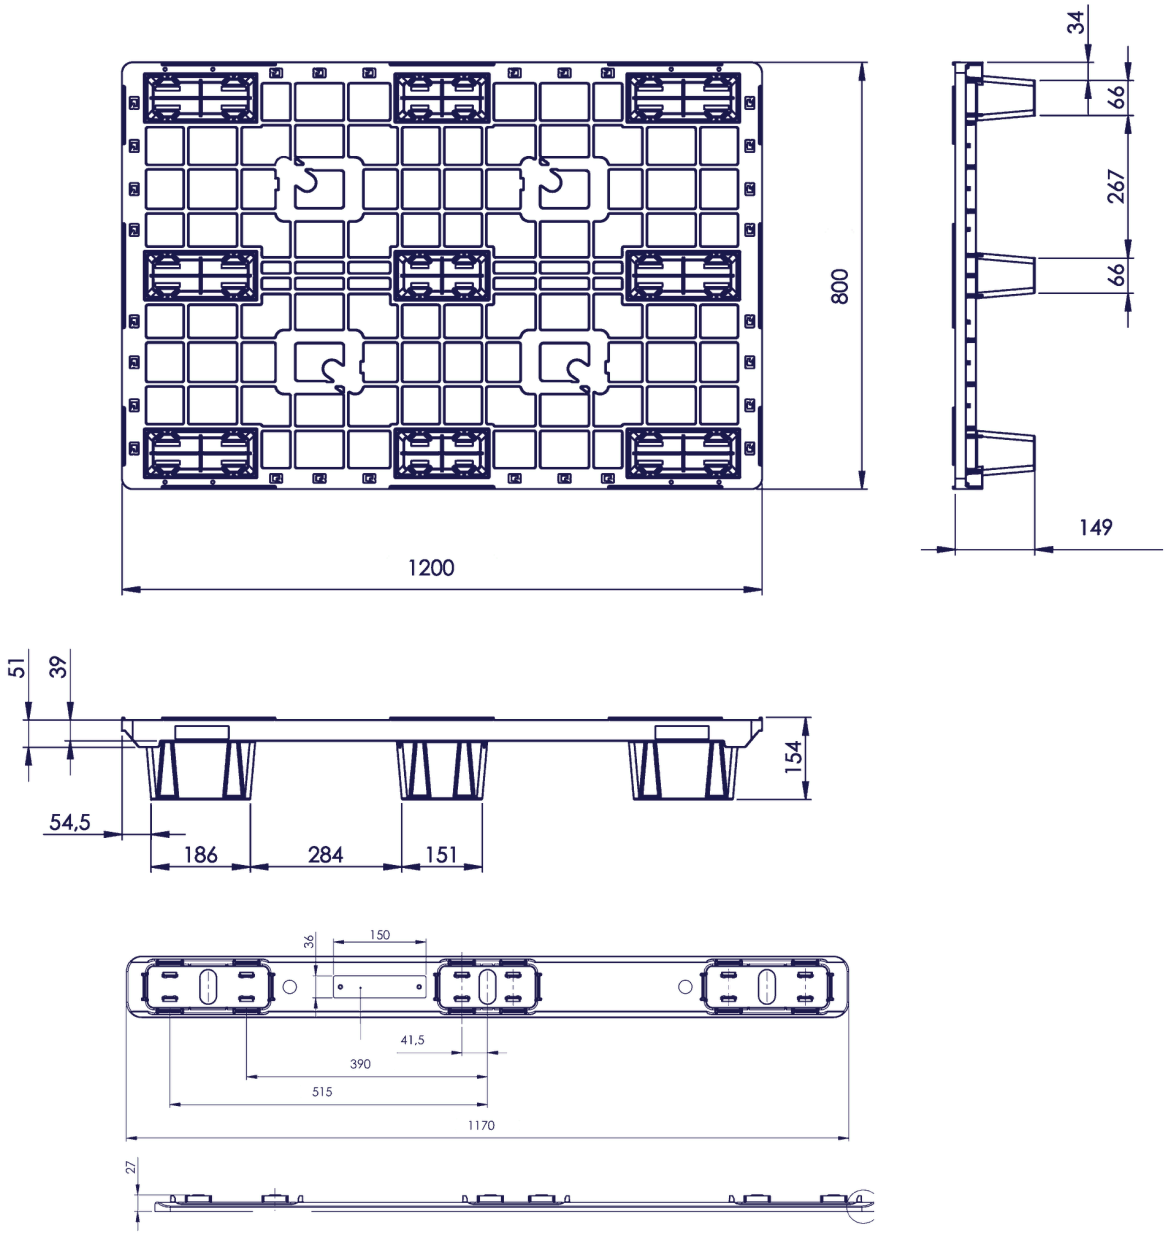

Top view and side views of the pallet; below, the click-on runner (3 per pallet). Dimensions in mm.

TEST CONDITIONS AND TOLERANCES

- Dimensional tolerance of the pallet: +5 / -5 mm. Weight tolerance: +5 / -5 %.
- We test our pallets with an evenly distributed, stable and homogeneous load of bagged goods, for a predetermined period at an ambient temperature of 20 °C. Different load conditions may lead to different results and must be assessed separately.