Q-PALL PLASTIC PALLETS

Technical specifications
Datasheet, edition October 2026

1200 x 800 mm · EURO PALLET

Plastic pallet 1200 x 800 x 145 closed deck 3 runners medium

MEDIUM | Closed deck | 3 runners



5,000 kg	1,250 kg	650 kg
Static load on a flat floor	Dynamic load by forklift or pallet truck	Racking load in pallet racking

DIMENSIONS AND WEIGHT

Article number	2.QP1208MB3RR-CD
Length	1200 mm
Width	800 mm
Height	145 mm
Weight	13.8 kg

CONSTRUCTION AND MATERIAL

Top deck	Closed deck
Bottom	3 runners
Load class	Medium
Nestable	No
Material	Mix HDPE / PP
Colour	Black (standard), other colours on request
ISPM 15	Exempt (no treatment needed)

DELIVERY AND DOCUMENTATION

Production location	Ribe (DK)
Ordering in stacks	17 pallets per stack (stack dimensions approx. 1,200 x 800 x 2,465 mm)
PPWR (EU 2025/40)	Declaration of conformity available

SIMILAR VERSIONS AND PRODUCTION LOCATIONS


ARTICLE NUMBER	PRODUCTION LOCATION	DIMENSIONS (MM)	WEIGHT	STATIC	DYNAMIC	RACKING
2.QP1208MB3RR-CD This datasheet	Ribe (DK)	1200 x 800 x 145	13.8 kg	5,000 kg	1,250 kg	650 kg
3.QP1208MB3RR-CD	Lleida (ES)	1200 x 800 x 145	14 kg	5,000 kg	1,500 kg	650 kg
5.QP1208MB3RR-CD	Balk (NL)	1200 x 800 x 145	13.8 kg	5,000 kg	1,500 kg	750 kg
4.QP1208MB3RR-CD	On request	1200 x 800 x 145	13.8 kg	5,000 kg	1,500 kg	750 kg

Click an article number for the page and datasheet of that version. We deliver from the factory closest to you. Small differences in height, weight and load capacity between the versions are possible.

1200 x 800 mm · EURO PALLET

Plastic pallet 1200 x 800 x 145 closed deck 3 runners medium

TECHNICAL DRAWING

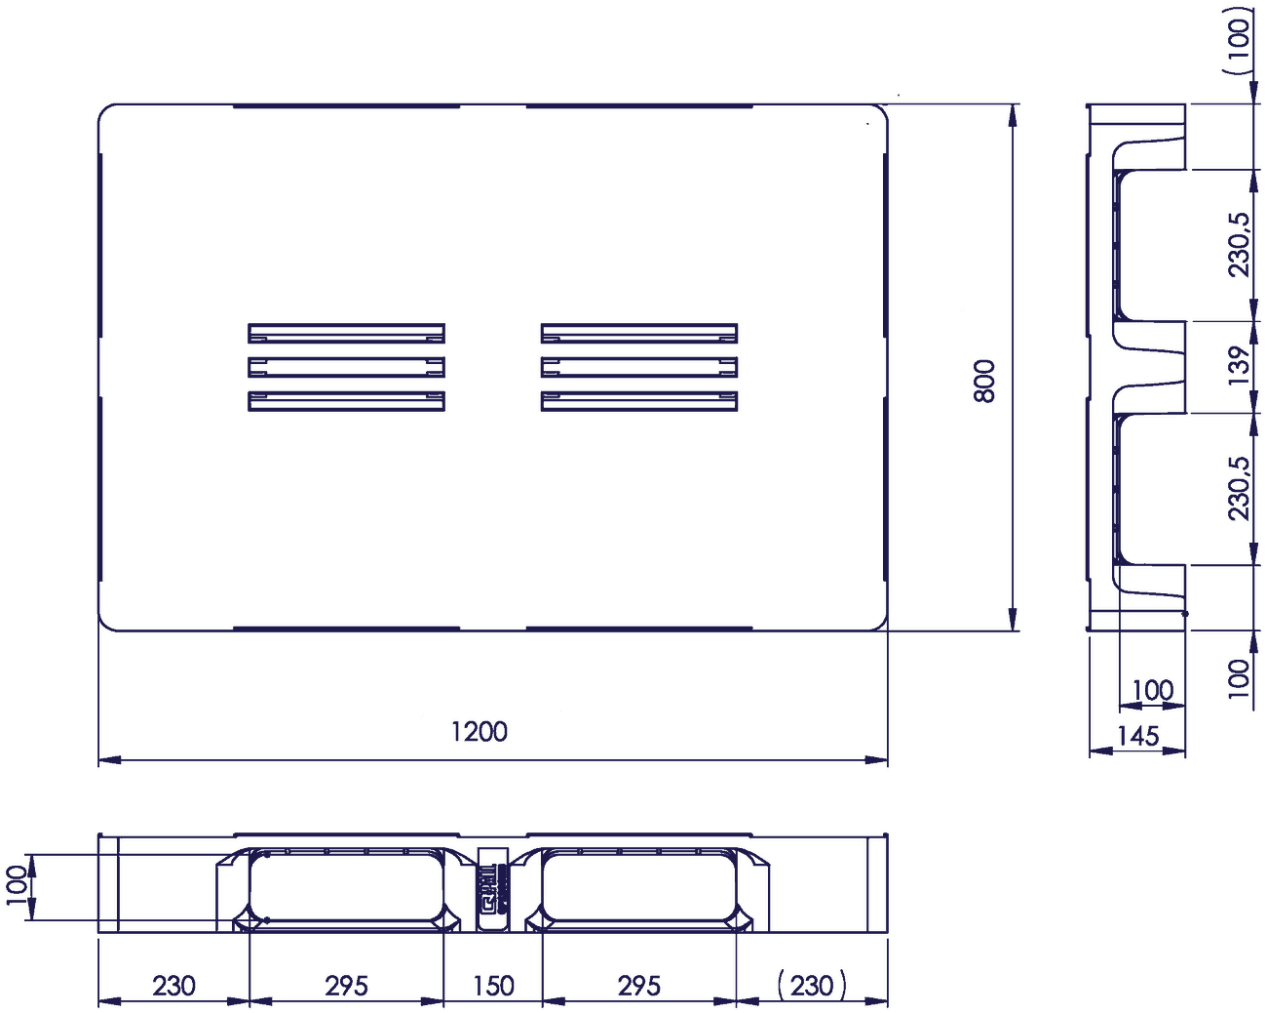

Top view and side views, dimensions in mm.

TEST CONDITIONS AND TOLERANCES

- The racking load is determined in a test with 25 kg bags on a conventional pallet racking system.
- Dimensional tolerance of the pallet: +5 / -5 mm. Weight tolerance: +5 / -5 %.
- We test our pallets with an evenly distributed, stable and homogeneous load of bagged goods, for a predetermined period at an ambient temperature of 20 °C. Different load conditions may lead to different results and must be assessed separately.