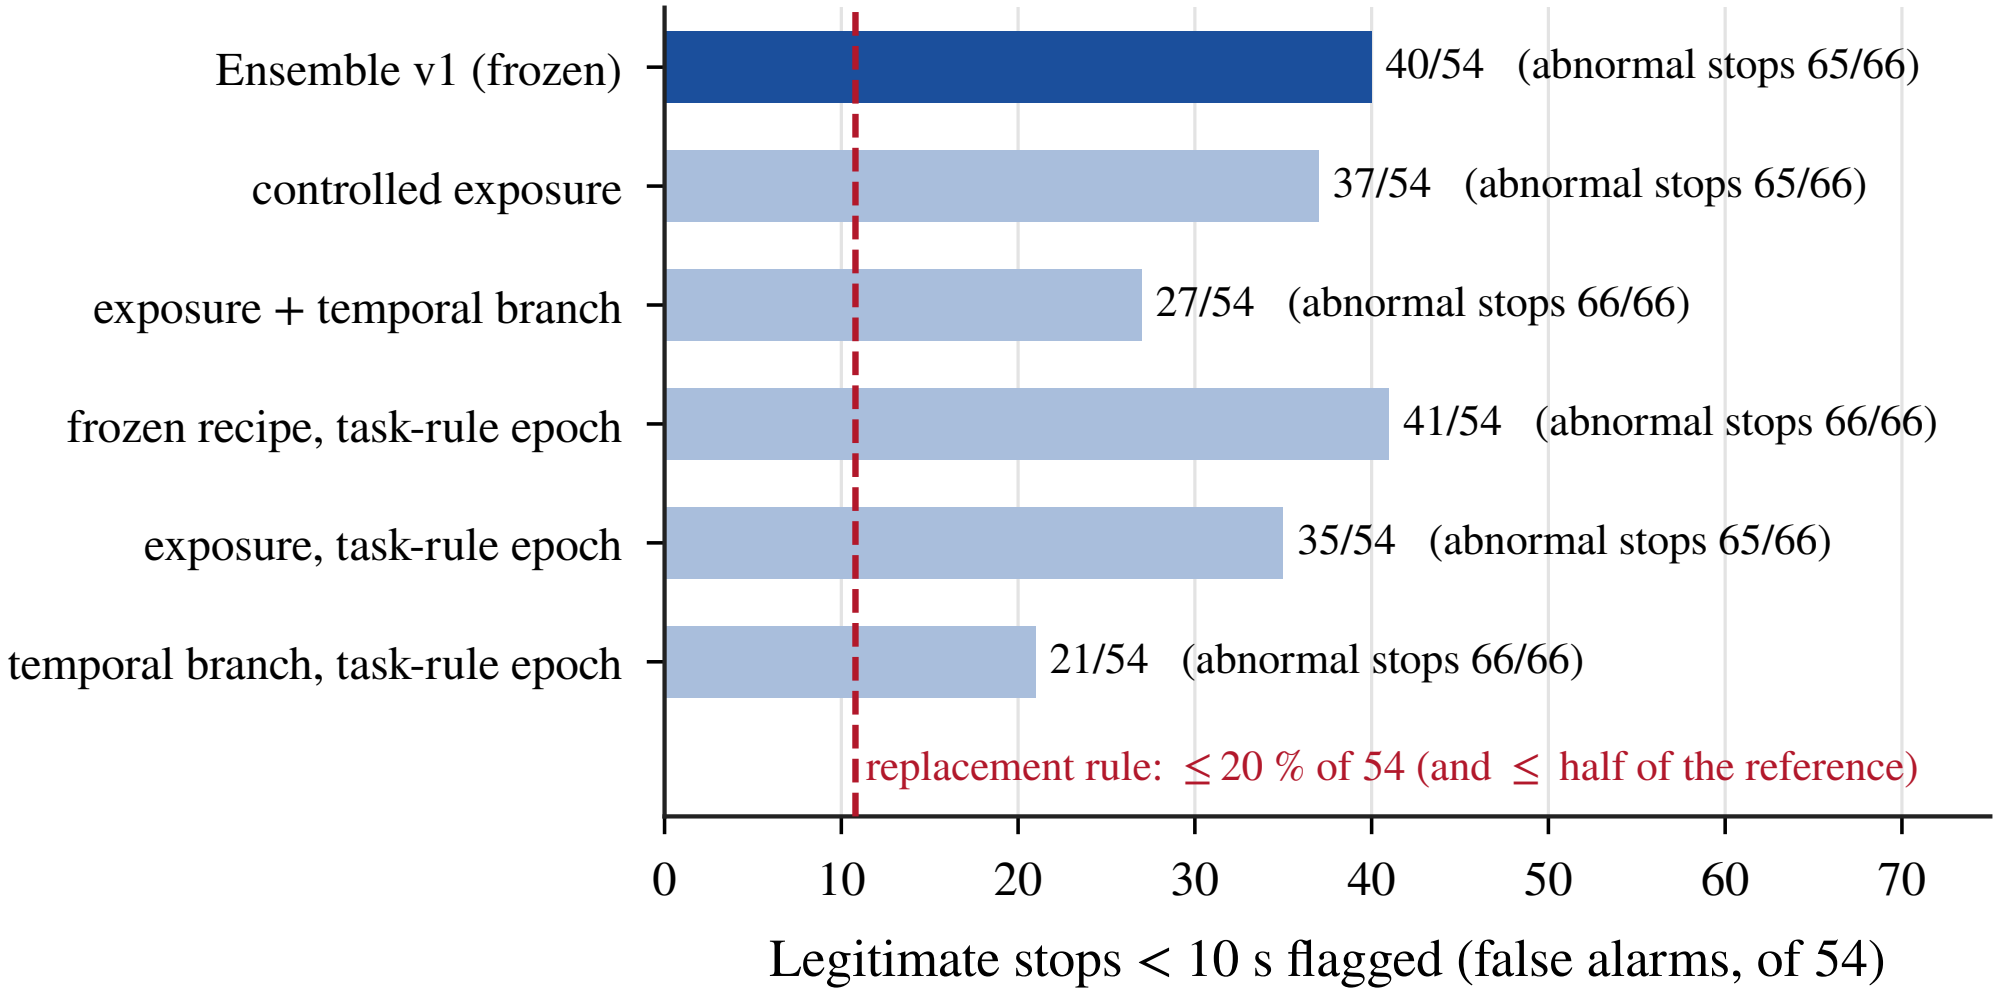
Ensemble v1 (frozen)
40/54 (abnormal stops 65/66)
controlled exposure
37/54 (abnormal stops 65/66)
exposure + temporal branch
27/54 (abnormal stops 66/66)
frozen recipe, task-rule epoch
41/54 (abnormal stops 66/66)
exposure, task-rule epoch
35/54 (abnormal stops 65/66)
temporal branch, task-rule epoch
21/54 (abnormal stops 66/66)
replacement rule: ≤ 20 % of 54 (and ≤ half of the reference)
0
10
20
30
40
50
60
70
Legitimate stops < 10 s flagged (false alarms, of 54)