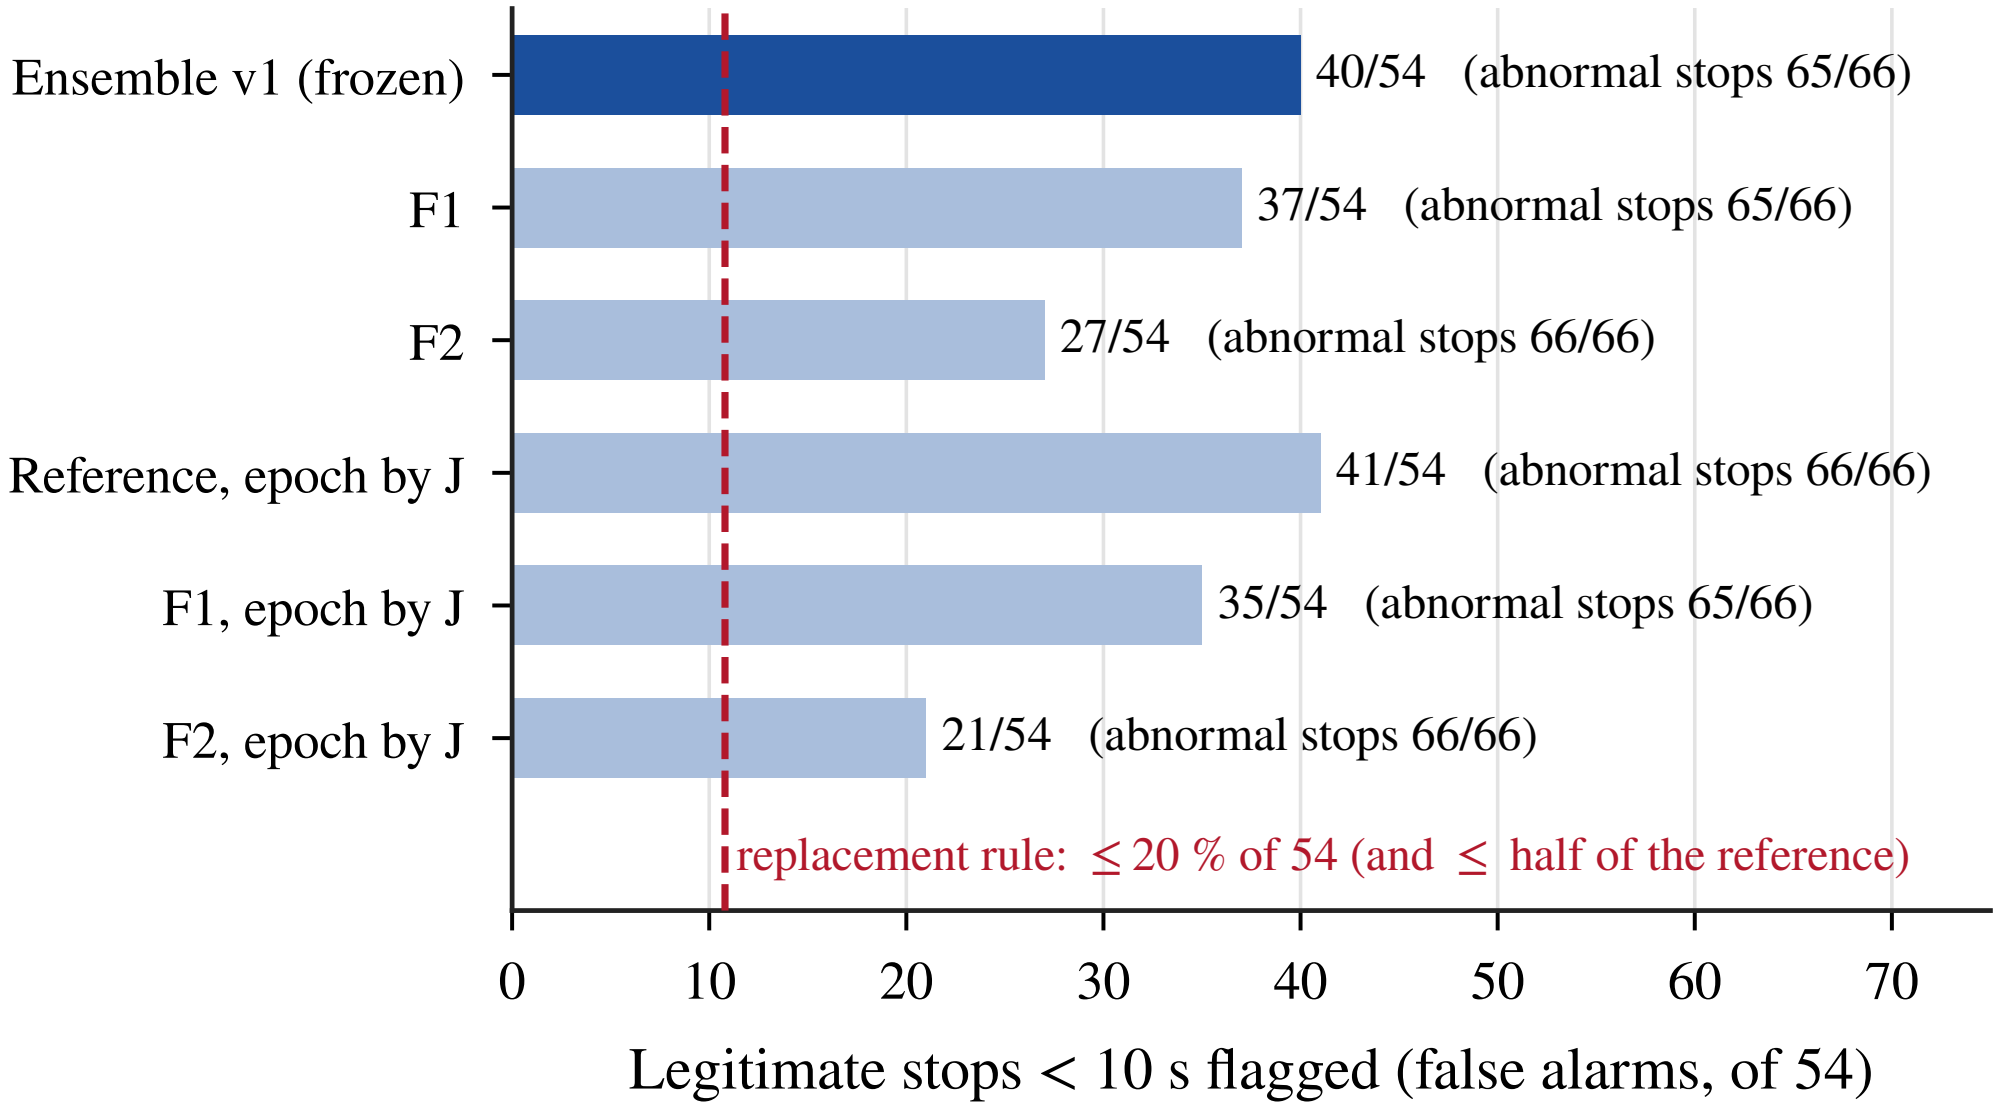
Ensemble v1 (frozen)
40/54 (abnormal stops 65/66)
F1
37/54 (abnormal stops 65/66)
F2
27/54 (abnormal stops 66/66)
Reference, epoch by J
41/54 (abnormal stops 66/66)
F1, epoch by J
35/54 (abnormal stops 65/66)
F2, epoch by J
21/54 (abnormal stops 66/66)
replacement rule: ≤ 20 % of 54 (and ≤ half of the reference)
0
10
20
30
40
50
60
70
Legitimate stops < 10 s flagged (false alarms, of 54)