PDU QUALITY ASSURANCE REPORT
PDU 入厂检验报告

E120 (10/23 REV 01)

NAME: PDU 产品名称：电源分配单元	MODEL: 3s125Xd1-24G 型　号：3s125Xd1-24G	QUANTITY: 15pcs 数　量：15pcs
CUSTOMER: TON 客　户：TON	LOT NO: 20240701030015 批次号：20240701030015	P.O. NO: 合 同 号:
TEST STANDARD: YDT 2063-2009 符合标准：YDT 2063-2009	REFERENCE: GB/T2828.1-2012, Normal once 检验依据：GB/T2828.1-2012,正常一次	/

REFERENCE: GB/T2828.1-2012, Normal once
抽样方案依据**(REFERENCE): GB/T2828.1-2012**，正常一次
IL: appearance = II; Function = S-4; AQL: Cr (fatal defect) = 0; MA (serious defect) = 0.65; Mi (general defect) = 2.5;
IL: 外观 = II ； 功能 = **S-4** ； **AQL: CR**（致命缺陷） = **0** ； **MA**（严重缺陷） = **0.65** ； **MI**（一般缺陷） = **2.5**;

标准要求	**N/A** 不适用	**YES** 是
Installation size and wire length: 1951*80*82mm. 安装尺寸、线长：1951*80*82mm。 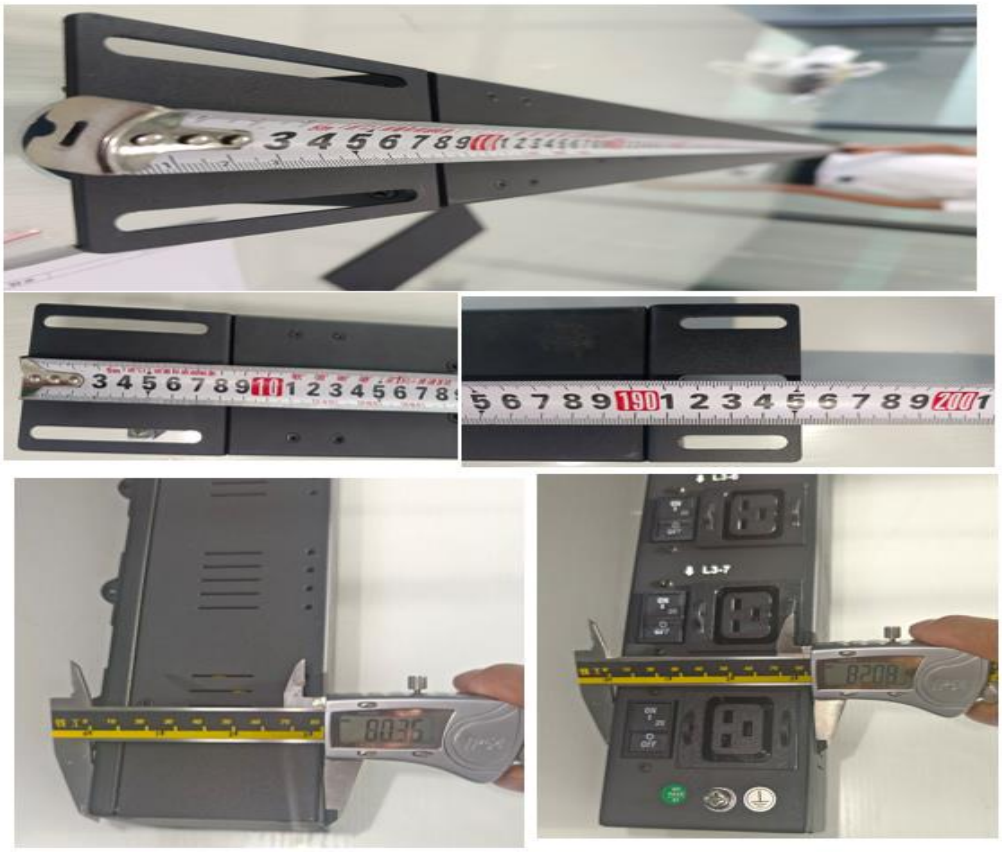	☐	☑
Input connector system: ☑Without joint; ☐ With joint_____; 输入接头制式：☑不带接头；☐带接头_____;	☐	☑

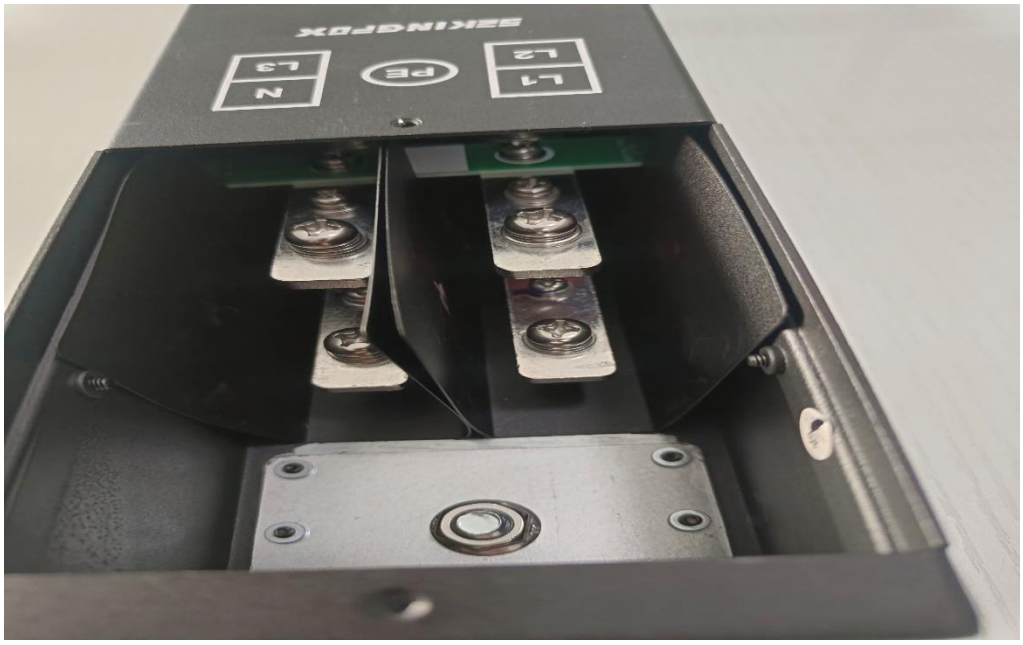		
Appearance structure, screen printing, Label and identification: Consistent with the technical drawings or samples, the paste is good, no warping, horizontal tilt, and the font is clear. 外观结构、丝印、标签、标识：与技术图纸或样品一致,粘贴良好，无翘边角、水平倾斜，字体清晰。 	☐	☑
Color of spray: Color: Black . 喷涂颜色：颜色： 黑色 。	☐	☑

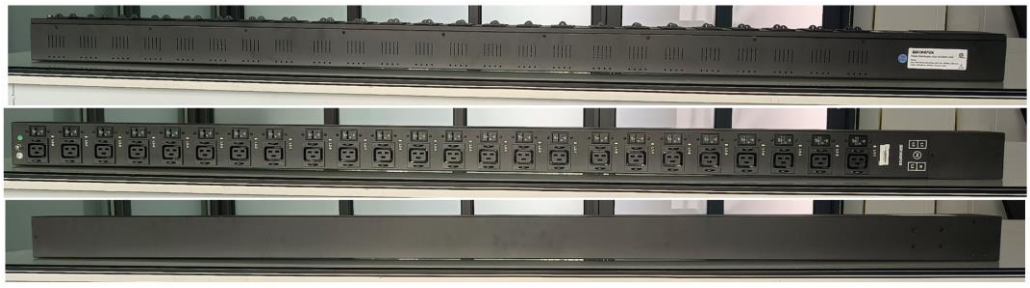		
Appearance quality：No obvious color difference, paint peeling, rust, stain, defect 外观质量：无明显色差、脱漆、生锈、污渍、缺损。 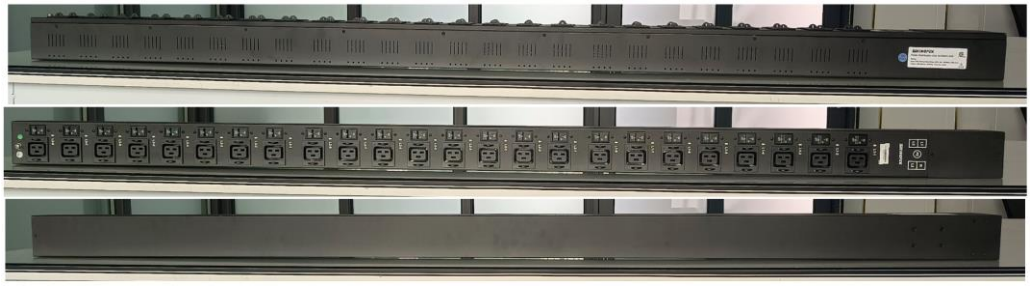	☐	☑
Wire connection test：The wires are connected and have no short circuit. 通路测试：线线通路,无短路。	☐	☑

PDU QUALITY ASSURANCE REPORT
PDU 入厂检验报告

E120 (10/23 REV 01)

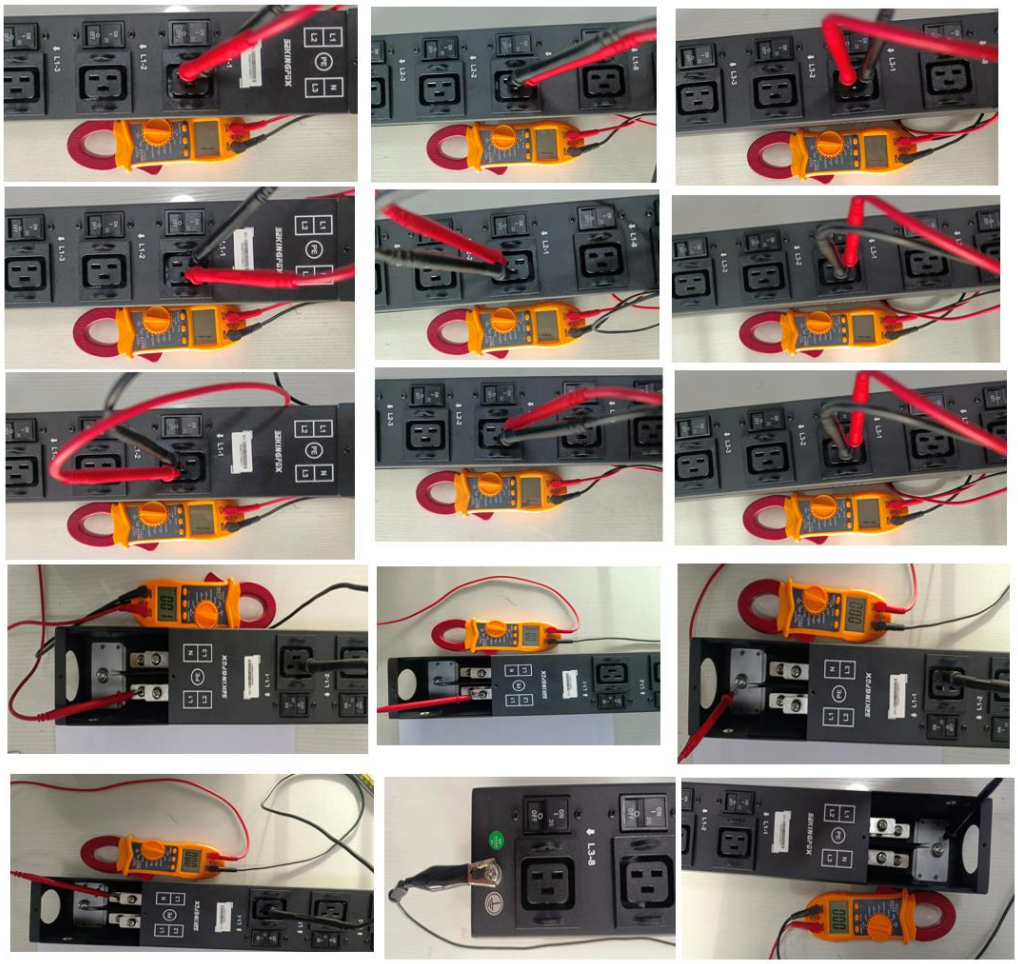		
Insulation resistance: Phase line and PE line or shell,Test conditions: 500V, ⩾ 5MΩ , no discharge alarm. 绝缘电阻：相线与 PE 线或外壳， 测试条件：500V，⩾5MΩ，无放电告警。	☐	☑
High voltage test: Phase line and PE line or shellTest conditions: 2000Vac/10mA/60s; no discharge alarm. 高压测试：相线与 PE 线或外壳 测试条件：2000V/10mA/60S;无放电告警。	☐	☑
Grounding resistance: Input PE end and shell PE end (or PE line end); test condition: 25A; index: ⩽ 50mΩ （0.05Ω）. 接地电阻：输入 PE 端与外壳 PE 端（或 PE 线末端）；测试条件：25A；指标：⩽50mΩ （0.05Ω）。	☐	☑

PDU QUALITY ASSURANCE REPORT
PDU 入厂检验报告

E120 (10/23 REV 01)

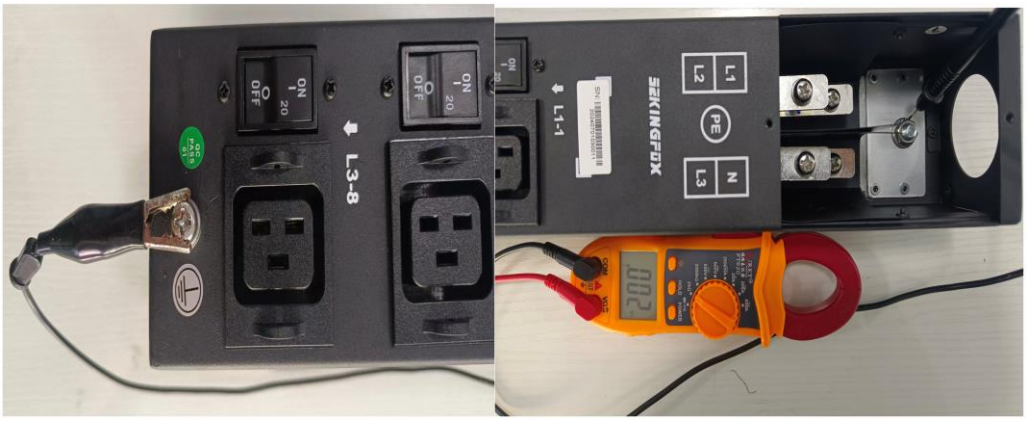		
Electric-shock safeguard, Grounding contact: After the PDU is assembled, its live parts shall be untouchable. The pressure of grounding contact is normal. 防触电保护、接地触头：PDU 组装完成后其带电零件均应不可触及；接地触头接触压力正常。	☐	☑
Creepage distance, electrical clearance: Internal polarity spacing ⩾3mm. Distance between internal polarity and metal shell ⩾ 4.5mm. 爬电距离、电气间隙：内部极性间距⩾3mm；内部极性与金属外壳间距⩾4.5mm；	☐	☑
Load：Test current: 3* 125A Detect the outlets one by one, the load current is stable (5S), and there is no abnormal ignition. 负载：测试电流：3*125A 逐位检测，负载电流稳定(5S)，无异常跳火。	☐	☑
Overvoltage and overload detection: Overvoltage and overload alarm monitoring is normal. 过压、过流检测：过压、过载告警监测正常。	☑	☐
Working condition: The working indicator light indicates correctly. 工作状态：工作指示灯指示正确。	☑	☐
Over / under voltage switching detection: If the input voltage of A/B exceeds or is less than the set value, the product must respond to the switch correctly. 过/欠压切换检测：A 路/B 路输入电压超过或小于设定值,产品须正确响应切换。	☑	☐
Input power off: Power off when input A or B the product must respond correctly. 断电切换：A 路/B 路输入断开，产品必须正确相应。	☑	☐
Address code check: The label address code is consistent with the product address code. 地址码检查：标签地址码与产品地址码相符。	☑	☐
Sensor detection: monitoring is normal. 传感器检测：监测正常。	☑	☐
Overvoltage and overload control: Overvoltage and overload control are normal. 过压、过流控制：过压、过流控制正常。	☑	☐
Switch detection: Each socket switch is normal. 驱动检测：位数控制检测正常。	☑	☐
Cascade communication: Cascade communication is normal. 级联正常：级联显示正常	☑	☐
Software and hardware versions: Software:_____ ； Hardware:_____.	☑	☐

PDU QUALITY ASSURANCE REPORT
PDU 入厂检验报告

E120 (10/23 REV 01)

软、硬件版本：软件：_____；　硬件：___；		
Nail hole spacing / actual matching 1924mm . 挂钉孔距/实配 1924mm 。	☐	☑
Cable specification / . 线缆规格： / 。	☑	☐
Customer model verification: Label, system model. 客户型号核查： 3s125xd1-24G 。 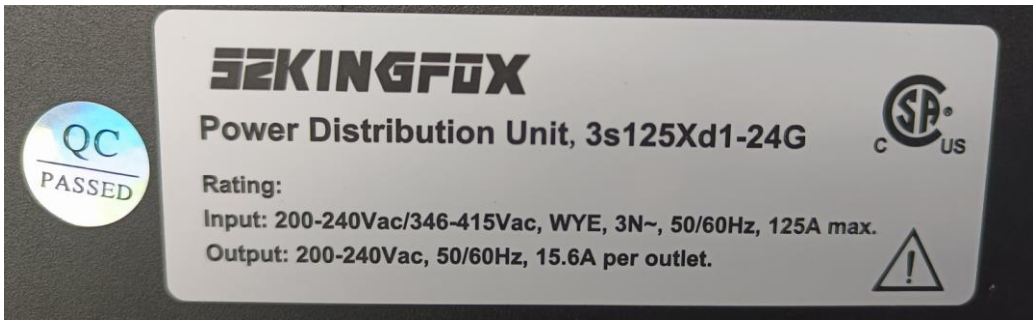 	☐	☑
Factory Reset: Clean Alarm Log. 出厂复位：清除告警记录。	☑	☐
Single phase line color check: L(red), N(blue), PE(yellow green). 单相线颜色检查：L（红）、N（蓝）、PE（黄绿滚）	☑	☐
Three phase line color check: L1(red), L2(black), L3（grey), N(blue), PE(yellow gree). 三相线颜色检查：L1(红)L2(黑)L3(灰)N(蓝)PE(黄绿滚) 	☐	☑
Packaging accessories: Consistent with the technical specification drawing or sample.	☐	☑

PDU QUALITY ASSURANCE REPORT
PDU 入厂检验报告

E120 (10/23 REV 01)

包装附件：与技术规格图纸或样品是否一致。		
Packing method: ☐SET(Kit label), ☑PCS(General label). 包装方式：☐SET(套件标签)，☑PCS(常规标签)。	☐	☑
Weight indication:Net weight(N.W.): 11.8kg ;Gross weight(G.W.): 12.8kg . 重量标示：净重： 11.8kg ；毛重： 12.8kg 。	☐	☑
Outer box volume indication: Length, width, height:(L、W、H): 2010*130*135mm 。 外箱体积标示：长*宽*高： 2010*130*135mm 。	☐	☑

QA:Yangzhibo 质检员：杨志波	DATE (MM/DD/YY): 2024.07.23 日期（月/日/年）：2024.07.23	CONFIRMATION:Chenzhongquan 审核：陈忠权