




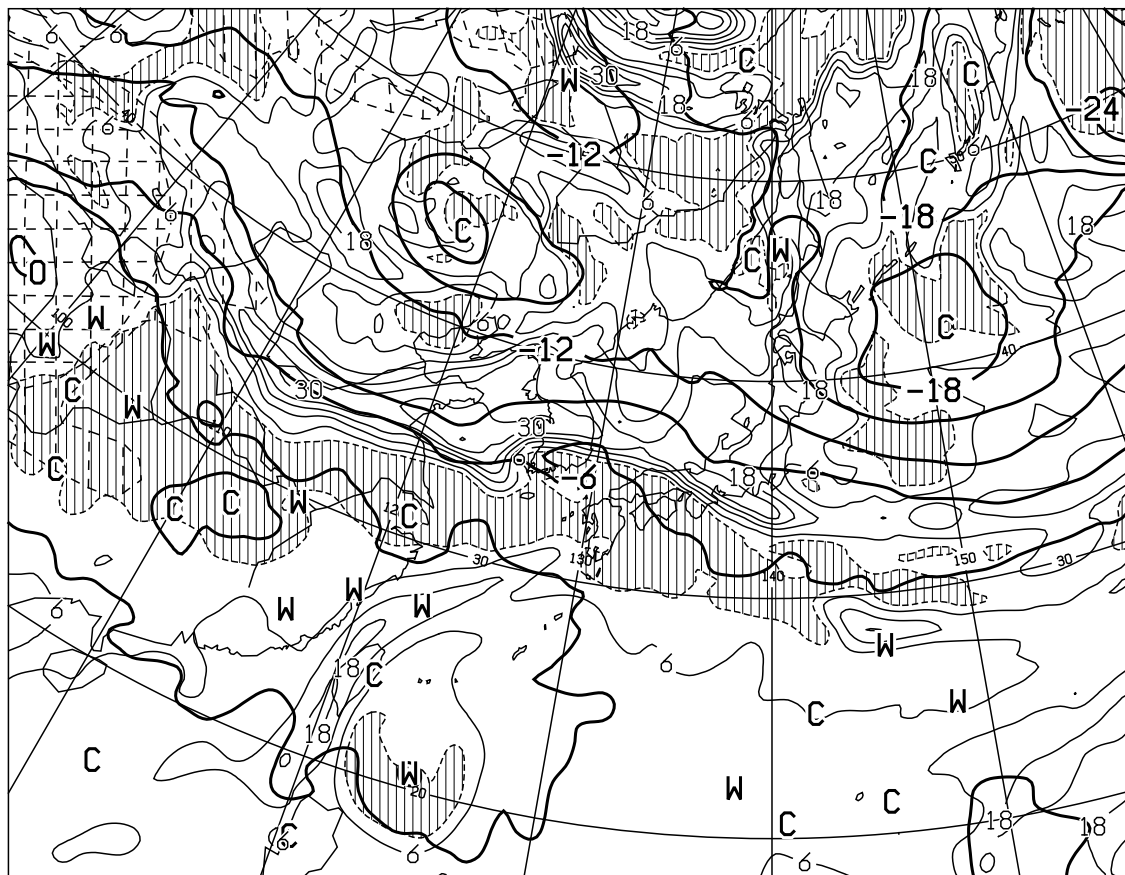


T=12 VALID 240000UTC TEMP(C) AT 500hPa
T-TD(C) AT 700hPa

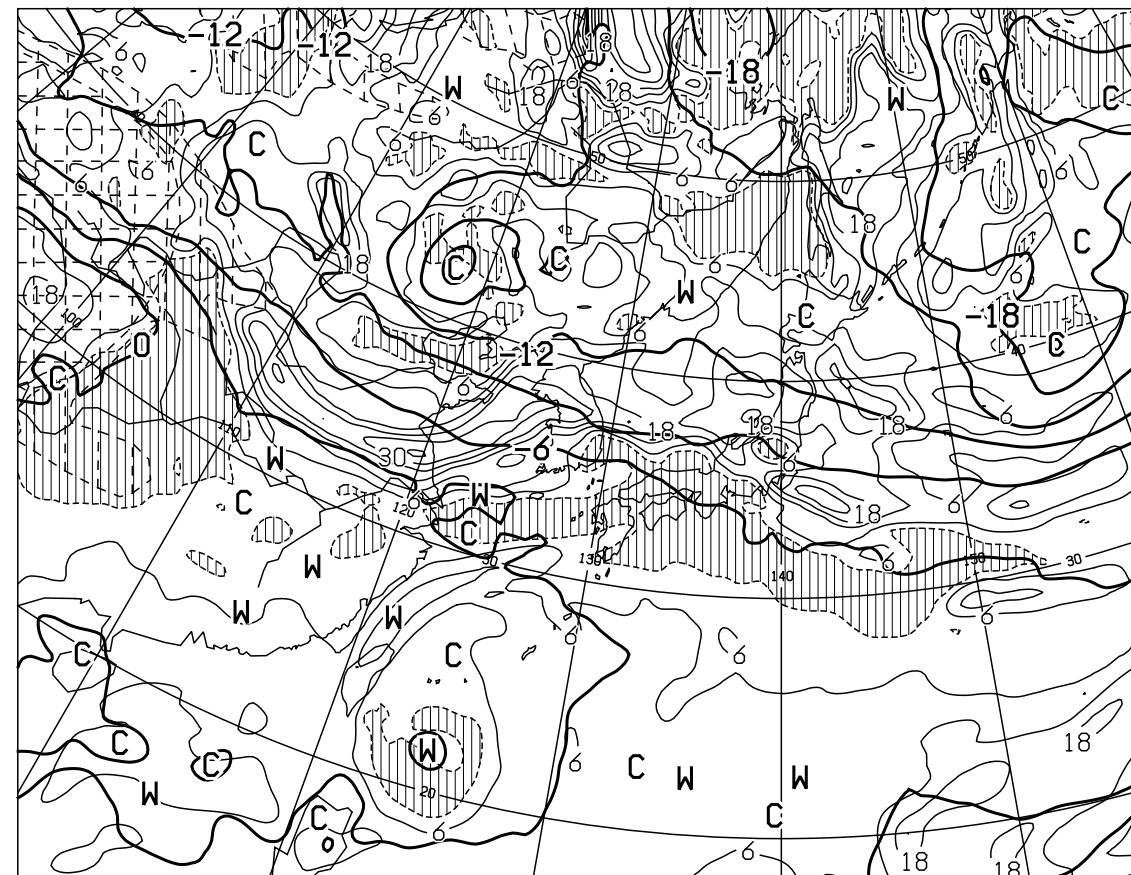

T=24 VALID 241200UTC TEMP(C) AT 500hPa
T-TD(C) AT 700hPa

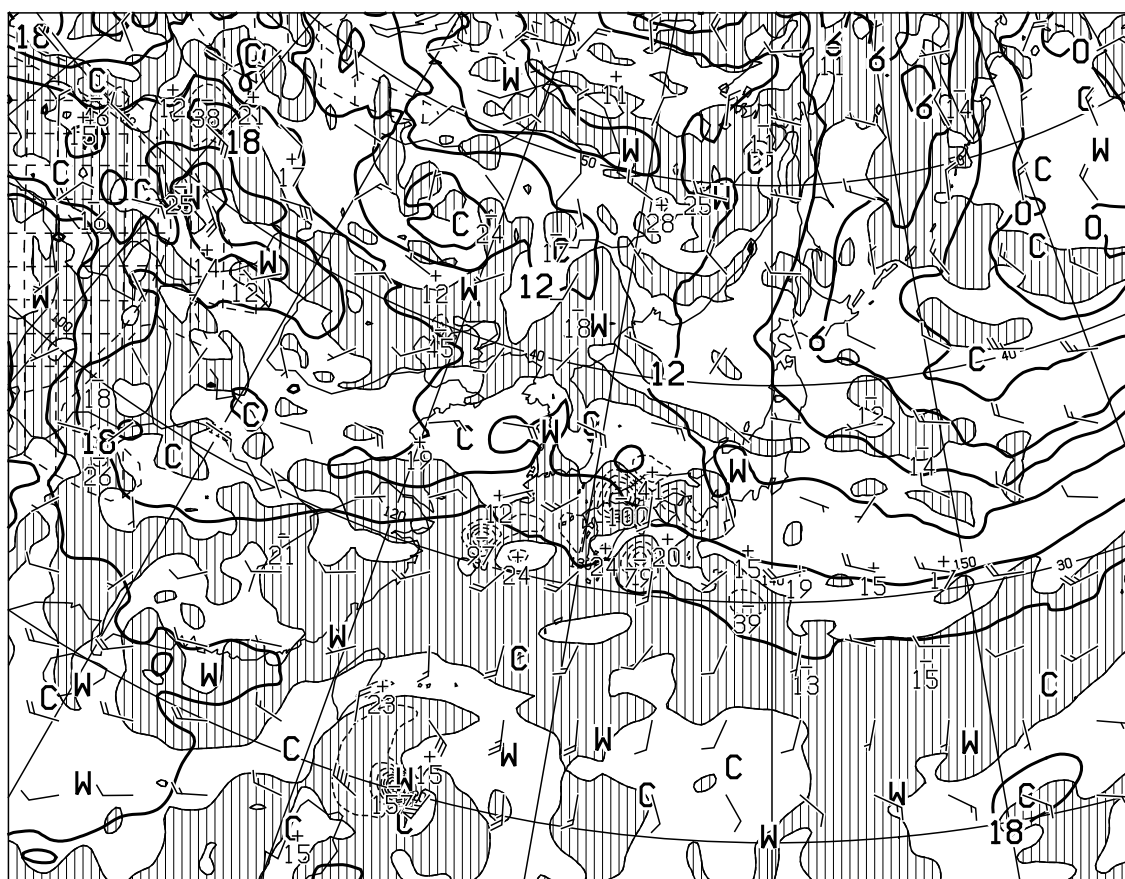

T=12 VALID 240000UTC TEMP(C), WIND ARROW AT 850hPa
P-VEL(hPa/H) AT 700hPa

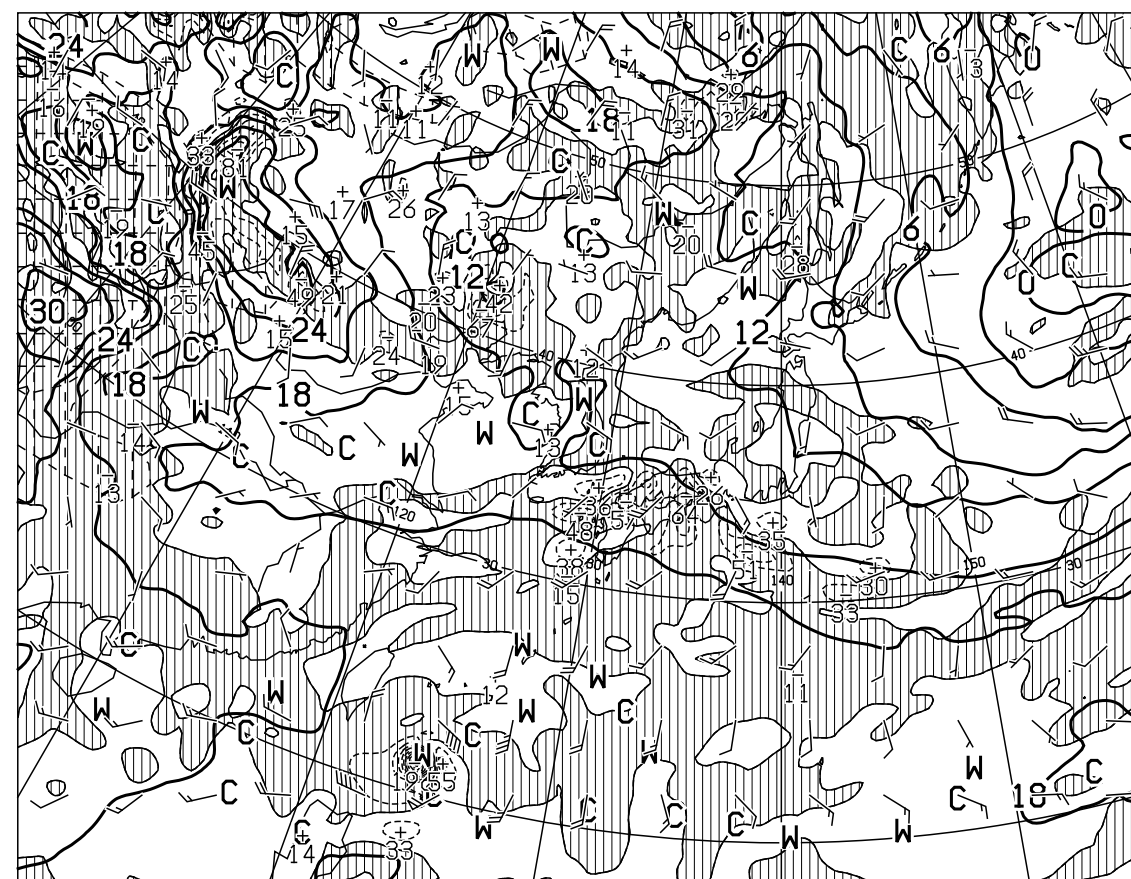

T=24 VALID 241200UTC TEMP(C), WIND ARROW AT 850hPa
P-VEL(hPa/H) AT 700hPa

FXFE5782 231200UTC JUN 2026