ENVIROCON
Recognised By
PCB, Assam & MSPCB, Meghalaya

Digboi Stores Building, New Market
Digboi, Assam – 786 171
Ph: 03751-264414, 9435008657, 8876028672
E-mail: envirocon@rediffmail.com
Website: www.envirocon.net.in

ISO 9001 DNV Certified
OHSAS 18001 DNV Certified

Report No.: ENV/ARL&NERPL/GHY/20-21/WW-01
Date : 26/11/2020


Order No.: Verbal
Date :

Report Issued To : **ASSAM ROOFING LIMITED/NORTH EAST ROOFING LIMITED**
Bonda, Narengi, Guwahati – 26 (Assam)

WASTE WATER ANALYSIS RESULTS

Sample Ref. No. : ARL&NERPL/2020/WW-2111/01
Sample Type/Source : STP Treated Water/Outlet of common STP of Assam Roofing Ltd. & North East Roofing Ltd.
Sample Collected By : Jointly by Representative of ENVIROCON & Client
Sample Collected On : 21.11.2020
Sample Received On : 23.11.2020
Analysis Protocol : IS 3025

S. No.	Parameters	Results	Units	Limits (IS:2490)
1.	pH	7.21	--	5.5 – 9.0
2.	Temperature	23.4	^{0}C	shall not exceed 5^{0}C above the receiving water temperature
3.	Bio-chemical Oxygen Demand (as BOD) (3 days @27 ^{0}C)	21	mg/l	30
4.	Chemical Oxygen Demand (as COD)	78	mg/l	250
5.	Total Suspended Solids (as TSS)	21	mg/l	100
6.	Oil & Grease	1.6	mg/l	10
7.	Total Residual Chlorine	<0.01	mg/l	1.0
8..	Ammonical Nitrogen (as N)	2.1	mg/l	50
9.	Total Kjeldahl Nitrogen (as NH_3)	4.2	mg/l	100
10.	Free Ammonia (as NH_3)	<0.01	mg/l	5.0

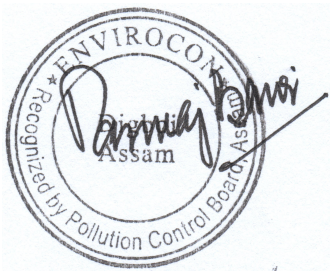

Checked By: Mr. Pankaj Baroi, **ENVIROCON**

NOTE:
1. Results reported are valid at the time of and under the prevailing conditions of measurement.
2. Results refer only to the particular parameters tested.
3. This test report shall not be reproduced except in full, without the written permission of ENVIROCON, Digboi Stores Building, New Market, Digboi – 786171, Assam.