FIRE DETECTION AND ALARM

⊗E	LED EMERGENCY LIGHT 5W (SELF CONTAINED TYPE) ,SURFACE OR SUSPENDED MOUNTED ,WITH 2-HOURS BACK UP TIME,BUILT-IN ADDRESSABLE MODULE	→ ←	LED DIRECTIONAL SIGN LUMINAIRE (SELF CONTAINED TYPE) , SUSPENDED MOUNTED (SINGLE SIDE),WITH 2-HOURS BACK UP TIME BUILT-IN ADDRESSABLE MODULE
⊗EWP	WEATHERPROOF TYPE LED EMERGENCY LIGHT 5W (SELF CONTAINED TYPE) ,SURFACE OR SUSPENDED MOUNTED ,WITH 2-HOURS BACK UP TIME,BUILT-IN ADDRESSABLE MODULE	→wp ←wp	WEATHERPROOF TYPE LED DIRECTIONAL SIGN LUMINAIRE (SELF CONTAINED TYPE) , SUSPENDED MOUNTED (SINGLE SIDE),WITH 2-HOURS BACK UP TIME BUILT-IN ADDRESSABLE MODULE
⊠	LED EMERGENCY LIGHT 2x9W(SELF CONTAINED TYPE) , WALL MOUNTED, WITH 2-HOURS BACK UP TIME,BUILT-IN ADDRESSABLE MODULE	⇉	LED DIRECTIONAL SIGN LUMINAIRE (SELF CONTAINED TYPE) , SUSPENDED MOUNTED (DOUBLE SIDE) ,WITH 2-HOURS BACK UP TIME,BUILT-IN ADDRESSABLE MODULE
⊠wp	WEATHERPROOF TYPE LED EMERGENCY LIGHT 2x9W(SELF CONTAINED TYPE) , WALL MOUNTED, WITH 2-HOURS BACK UP TIME,BUILT-IN ADDRESSABLE MODULE	⇉wp	WEATHERPROOF TYPE LED DIRECTIONAL SIGN LUMINAIRE (SELF CONTAINED TYPE) , SUSPENDED MOUNTED (DOUBLE SIDE) ,WITH 2-HOURS BACK UP TIME,BUILT-IN ADDRESSABLE MODULE
E	LED EXIT SIGN LUMINAIRE (SELF CONTAINED TYPE) , WALL OR SUSPENDED MOUNTED, WITH 2-HOURS BACK UP TIME,BUILT-IN ADDRESSABLE MODULE	FW↑	LED DIRECTIONAL SIGN LUMINAIRE (SELF CONTAINED TYPE) ,SURFACE OR SUSPENDED MOUNTED(SINGLE SIDE),WITH 2-HOURS BACK UP TIME BUILT-IN ADDRESSABLE MODULE
E wp	WEATHERPROOF TYPE LED EXIT SIGN LUMINAIRE (SELF CONTAINED TYPE) , WALL OR SUSPENDED MOUNTED, WITH 2-HOURS BACK UP TIME,BUILT-IN ADDRESSABLE MODULE	FW↑wp	WEATHERPROOF TYPE LED DIRECTIONAL SIGN LUMINAIRE (SELF CONTAINED TYPE) ,SURFACE OR SUSPENDED MOUNTED(SINGLE SIDE),WITH 2-HOURS BACK UP TIME BUILT-IN ADDRESSABLE MODULE

SYMBOLS

FCP	FIRE ALARM CONTROL PANEL	CM	CONTROL MODULE
ANN	GRAPHIC ANNUNCIATOR BOARD	IM	FAULT ISOLATOR MODULE
RANN	REMOTE GRAPHIC ANNUNCIATOR BOARD	F◁	FIRE ALARM SPEAKER WALL MOUNTED
FATB	FIRE ALARM TERMINAL BOX	F◀	FIRE ALARM SPEAKER W/STORBE LIGHT, WALL MOUNTED
ASD	ASPIRATED SMOKE DETECTION CONTROL PANEL	FS	FLOW SWITCH (BY OTHER)
Ⓗ	SURFACE MOUNTED HEAT DETECTOR,COMBINATION TYPE	SV	SUPERVISORY SWITCH (BY OTHER)
Ⓗ 135°F	SURFACE MOUNTED HEAT DETECTOR FIXED TEMPERATURE AT 135°F	T→	PHOTO ELECTRIC BEAM SMOKE DETECTOR, TRANSMITTER
SD	SURFACE MOUNTED SMOKE DETECTOR, PHOTOELECTRIC TYPE	R←	PHOTO ELECTRIC BEAM SMOKE DETECTOR, RECEIVER
SD V	SMOKE DETECTOR INSIDE COLD CONTENTMENT	E——×	ASPIRATED SMOKE DETECTION AND END CAP
DS	DUCT SMOKE DETECTOR	EOL	END OF LINE
M	MANUAL CALL POINT / BREAK GLASS ALARM WITH KEY SWITCH ZONE	△L	FIRE CONDITION ACTIVATED LIFT HOMING.
	AD ADDRESSABLE TYPE U UNDERNEATH RAISE FLOOR C ABOVE CEILING V LASER SMOKE DETECTOR TYPE	PA	FIRE CONDITION ACTIVATED BACKGROUND MUSIC SYSTEM SHUT-OFF
		A/C	FIRE CONDITION ACTIVATED AIR-CONDITIONING SHUT-OFF.
		NOV	FIRE CONDITION MONITORED NOVEC
Ⓑ	FIRE ALARM BELL 6"	FP	FIRE CONDITION MONITORED FIRE PUMP
⊗	FLASHSTROBE LIGHT 110 Cd	P	PULL BOX
¤	ASD SAMPLING POINT	■	MAN HOLE
F▽	FIRE MAN TELEPHONE OUTLET	FSS	FIRE SUPPRESSION SYSTEM
MM	MONITOR MODULE	K	KEY SWITCH

FIRE EVACUATION ROUTE

🟩	33.90M
🟪	55.20M
🟦	55.55M
🟫	29.40M
🟦	53.40M
🟩	28.50M
🟨	57.12M
🟥	40.50M
🟦	58.82M
- - -	INTERNAL WALL, TWO-HOUR FIRE RESISTANCE RATING
- - -	EXTERIOR WALL, TWO-HOUR FIRE RESISTANCE RATING

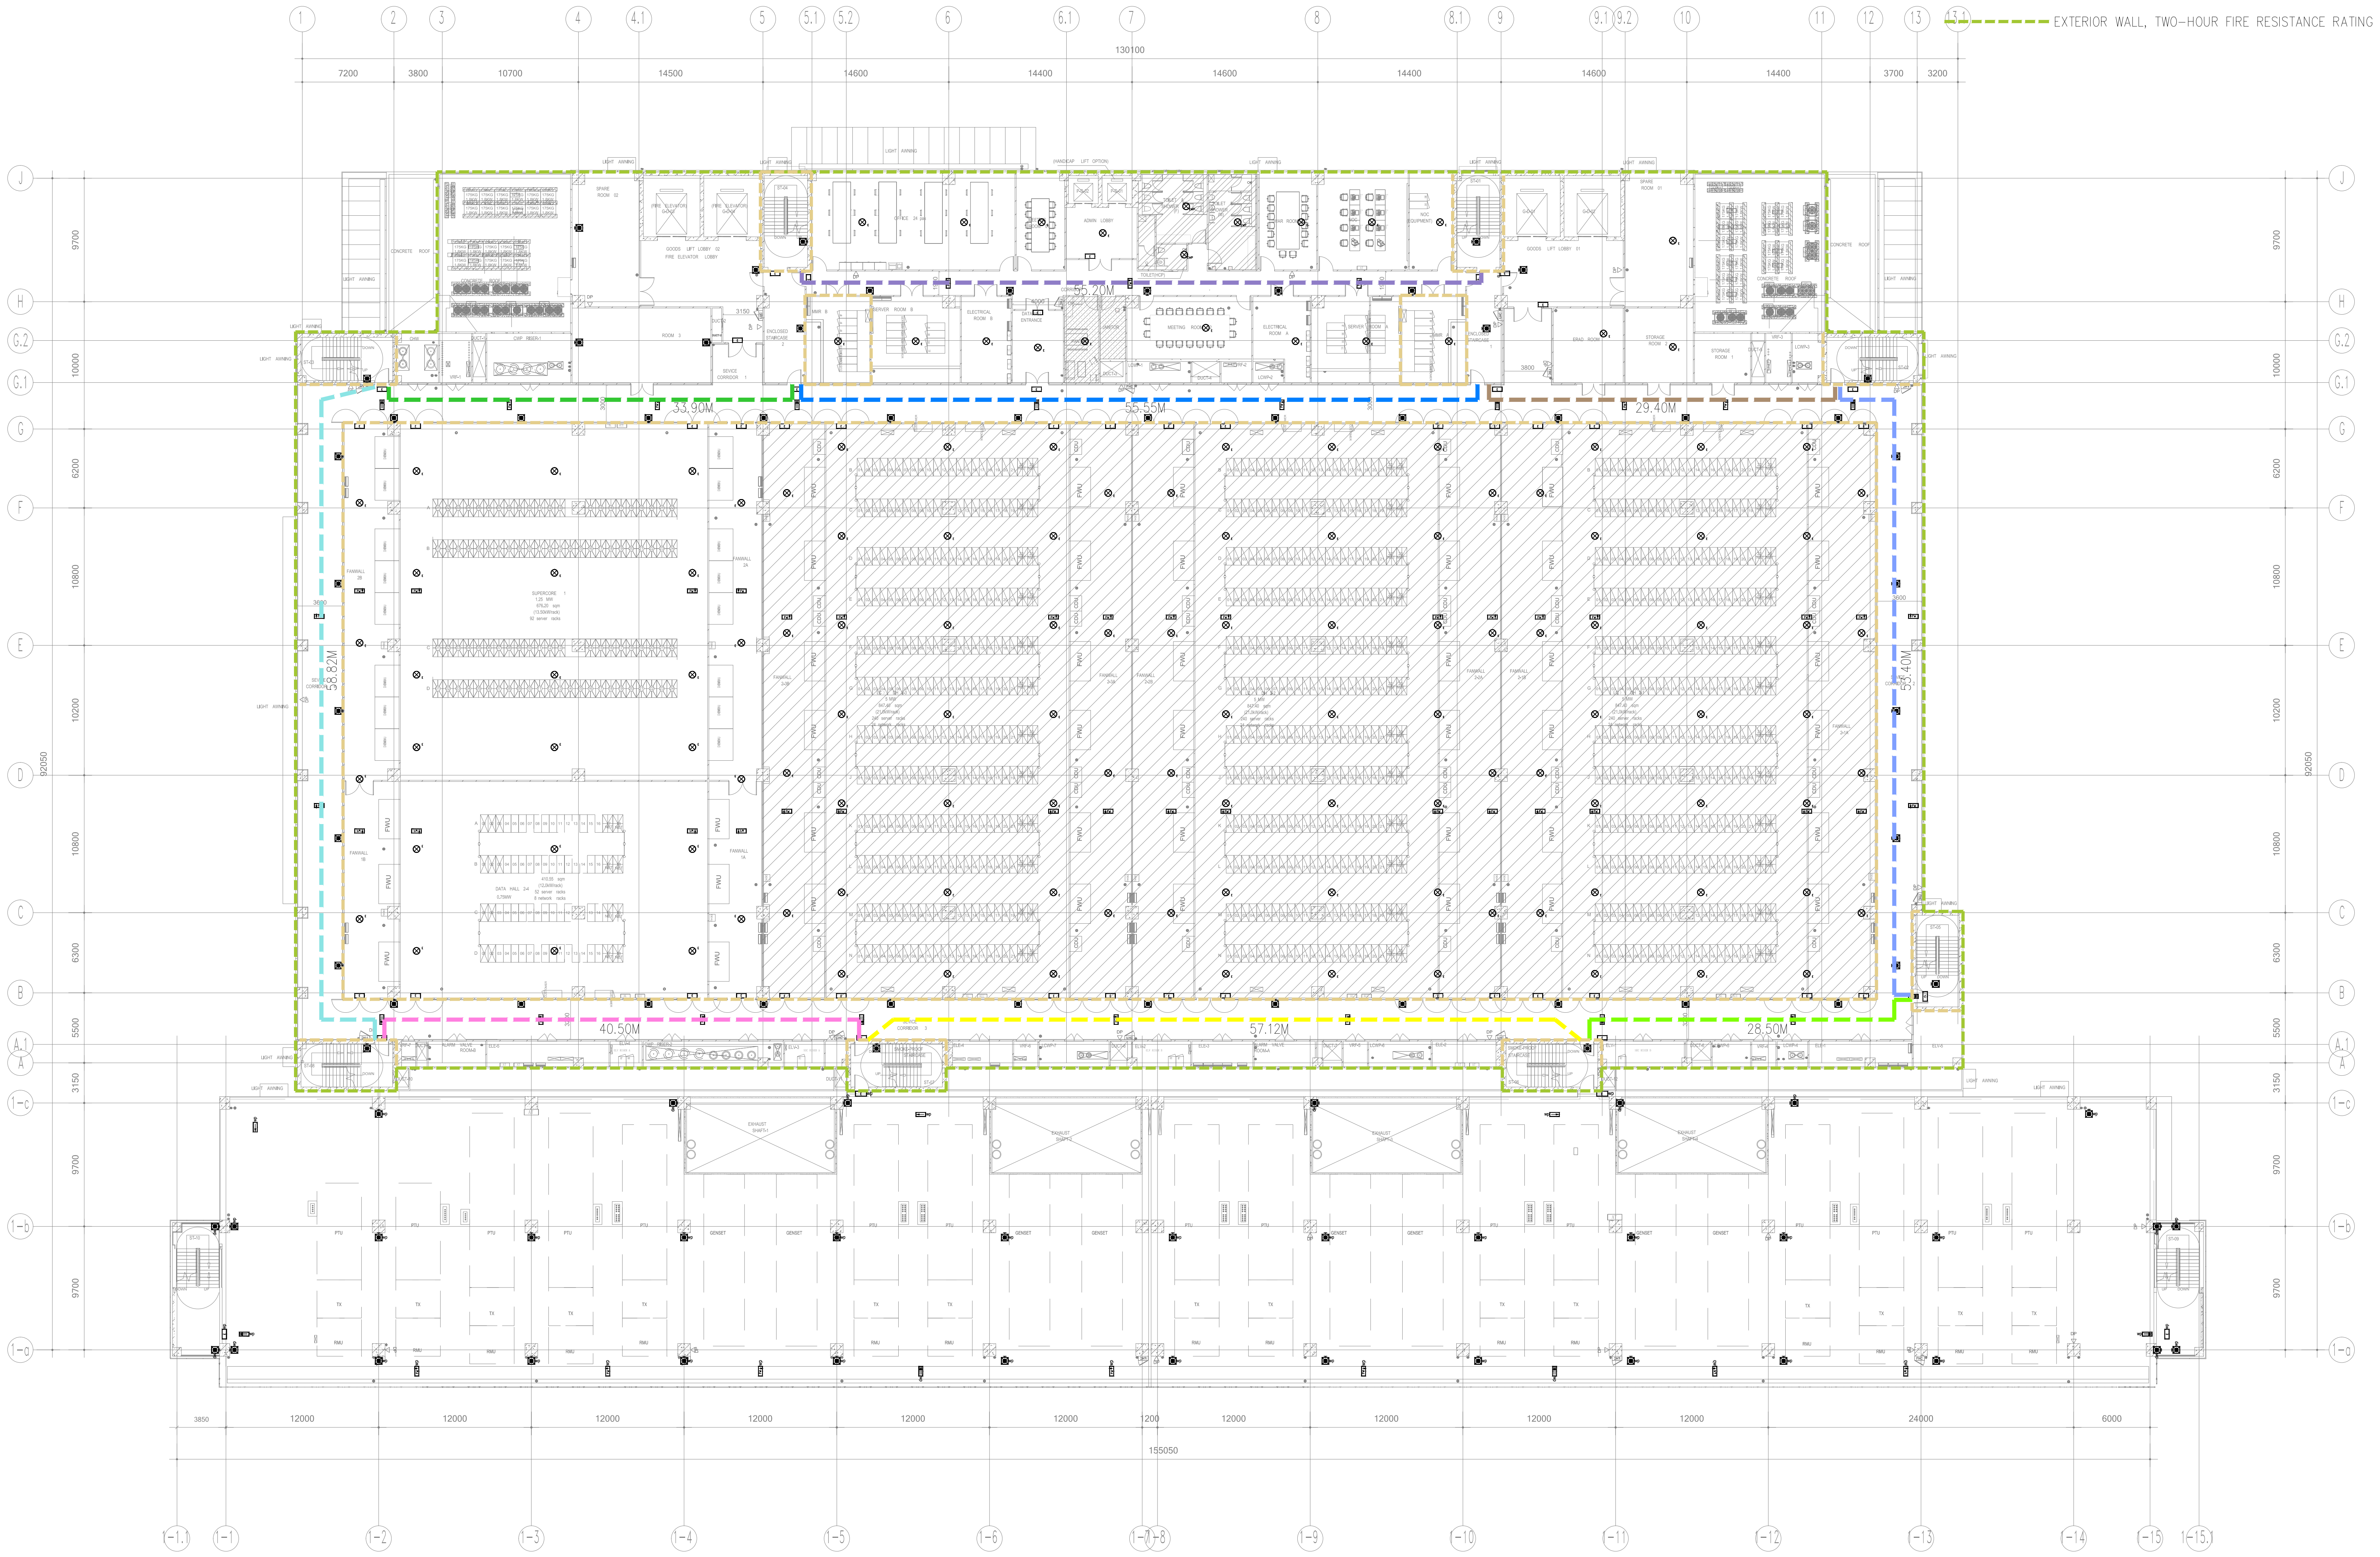

2ND FLOOR PLAN(DC BUILDING A)

SCALE 1:250

FLOOR AREA:12238.10 sqm
OVERALL GROSS FLOOR AREA:40900.20 sqm

COMPARTMENT AND EVACUATION ANALYSIS – 2F

NOTE : THIS PRINT IS OF A CONFIDENTIAL NATURE, IT SHALL NOT BE TRACED,PHOTOGRAPHED,PHOTOSTATED OR REPRODUCED IN ANY MANER,NOR USED FOR ANY PURPOSE WHATSOEVER EXCEPT BY WRITTEN PERMISSION

CLIENT :

GULF EDGE DC 01

87 Wireless Road, M Thai Tower 11th. Floor, All Seasons Place, Lumpini,
Pathumwan, Bangkok 10330, Thailand

CONTRACTOR :

华西发展(泰国)有限公司
บริษัท หัวซือ ดีเวลลอปเม้นต์ (ประเทศไทย) จำกัด
HUASHI DEVELOPMENT CO.,LTD
No. 202, Room No. 1403, 14/F, Le Concorde Building,
Ratchadapisek Road, Huaykhwang Sub-District,
Huaykhwang District, Bangkok Metropolitan 10310.

CONSULTANT :

ARbay
บริษัท เอ อาร์ เบย์ จำกัด
ARbay Company Limited
31 st Floor Bangkok Insurance Building
25 South Sathorn road Thungmahamek
Sathorn Bangkok 10120 THAILAND
T +66 (0) 2286 8199
F +66 (0) 2286 2863
info@arbay.co.th

CONSULTANT :

Qbic Engineers & Architects Co.,Ltd.
8 Soi KALONG 4 SANAMBINNAM ROAD,
THASAI SUB-DISTRICT, MUANG NONTHABURI DISTRICT
, NONTHABURI.
Tel 662-950-4374
Fax 662-580-3231
E-Mail : qbic@qbic.co.th, www.qbic.co.th
QBIC ENGINEERS AND ARCHITECTS CO.,LTD.

CONSULTANT :

MITR
MITR TECHNICAL CONSULTANT CO.,LTD.
1168/8 12th FLOOR, LUMPINI TOWER BUILDING,
RAMA IV RD., THUNGMAHAMEK, SATHORN, BANGKOK 10120, THAILAND
TEL : 0-2679-9079-84
FAX : 0-2679-9085 E-mail: mitr_dd@mitr.com

Architect :	SIGNATURE
ประกิต พนานุรัตน์ วสถ. 580 ที่อยู่ 251/1 ถ.จารุเมือง แขวงรองเมือง เขตปทุมวัน กรุงเทพมหานคร โทรศัพท์ 02-286-8199	

Structural Engineer :	SIGNATURE
วิศวกรผู้ออกแบบโครงสร้าง	
ณัฐสม สงวนวงษ์ วย 1423 ที่อยู่ 2/1 ซ.รามคำแหง 150 ถ.รามคำแหง แขวง สะพานสูง เขต สะพานสูง กทม. 10240	ณัฐสม สงวนวงษ์

Structural Inspector :	SIGNATURE
วิศวกรผู้ตรวจสอบโครงสร้าง	
โกมล จุฑาภัทร วย 964 ที่อยู่ 24/18 ซ.นวมินทร์ 129 ถ. นวมินทร์ แขวง นวลจันทร์ เขต บึงกุ่ม กทม. 10230	

Electrical Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบไฟฟ้ากำลัง	
นายสุภัทร บูรณวิทย์ วฟก.1265 ที่อยู่ 21 ซอยทานสัมฤทธิ์ 13 ตำบลท่าทราย อ.เมืองนนทบุรี จ.นนทบุรี 11000	

Mechanical Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบเครื่องกลและปรับอากาศ	
นายประสิทธิ์ เกียวสุนทร วก.1221 ที่อยู่ 44/372 ซอยบางกระดี่ 35/1 แขวงแสมดำ เขตบางขุนเทียน กทม. 10150	ประสิทธิ์

Sanitary Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบสุขาภิบาล และดับเพลิง	
นายทศวรรษ สนันฤทธิ์ วส. 215 ที่อยู่ บ้านเลขที่ 99/107 หมู่ที่ 3 ต.ศีรษะจรเข้น้อย อ.บางเสาธง จ.สมุทรปราการ 10540	ทศวรรษ

ISSUE/REVISION

REV.	DESCRIPTION	DATE
A	90% DEVELOPED	09/05/2026

PROJECT NAME :

GEDC 01

LOCATION:
Nikhom Phattana district, Rayong ,industrial estate,CPGC

BUILDING :

90% DEVELOPED

TITLE :

COMPARTMENT AND EVACUATION ANALYSIS–2F

JOB NO.	SCALE 1:250
DRAWN LW	REF.
CHECKED LJC	DWG.NO. MPK01A–90–A–CACE–201
APPROVED LXD	
DATE 2026.05.09	