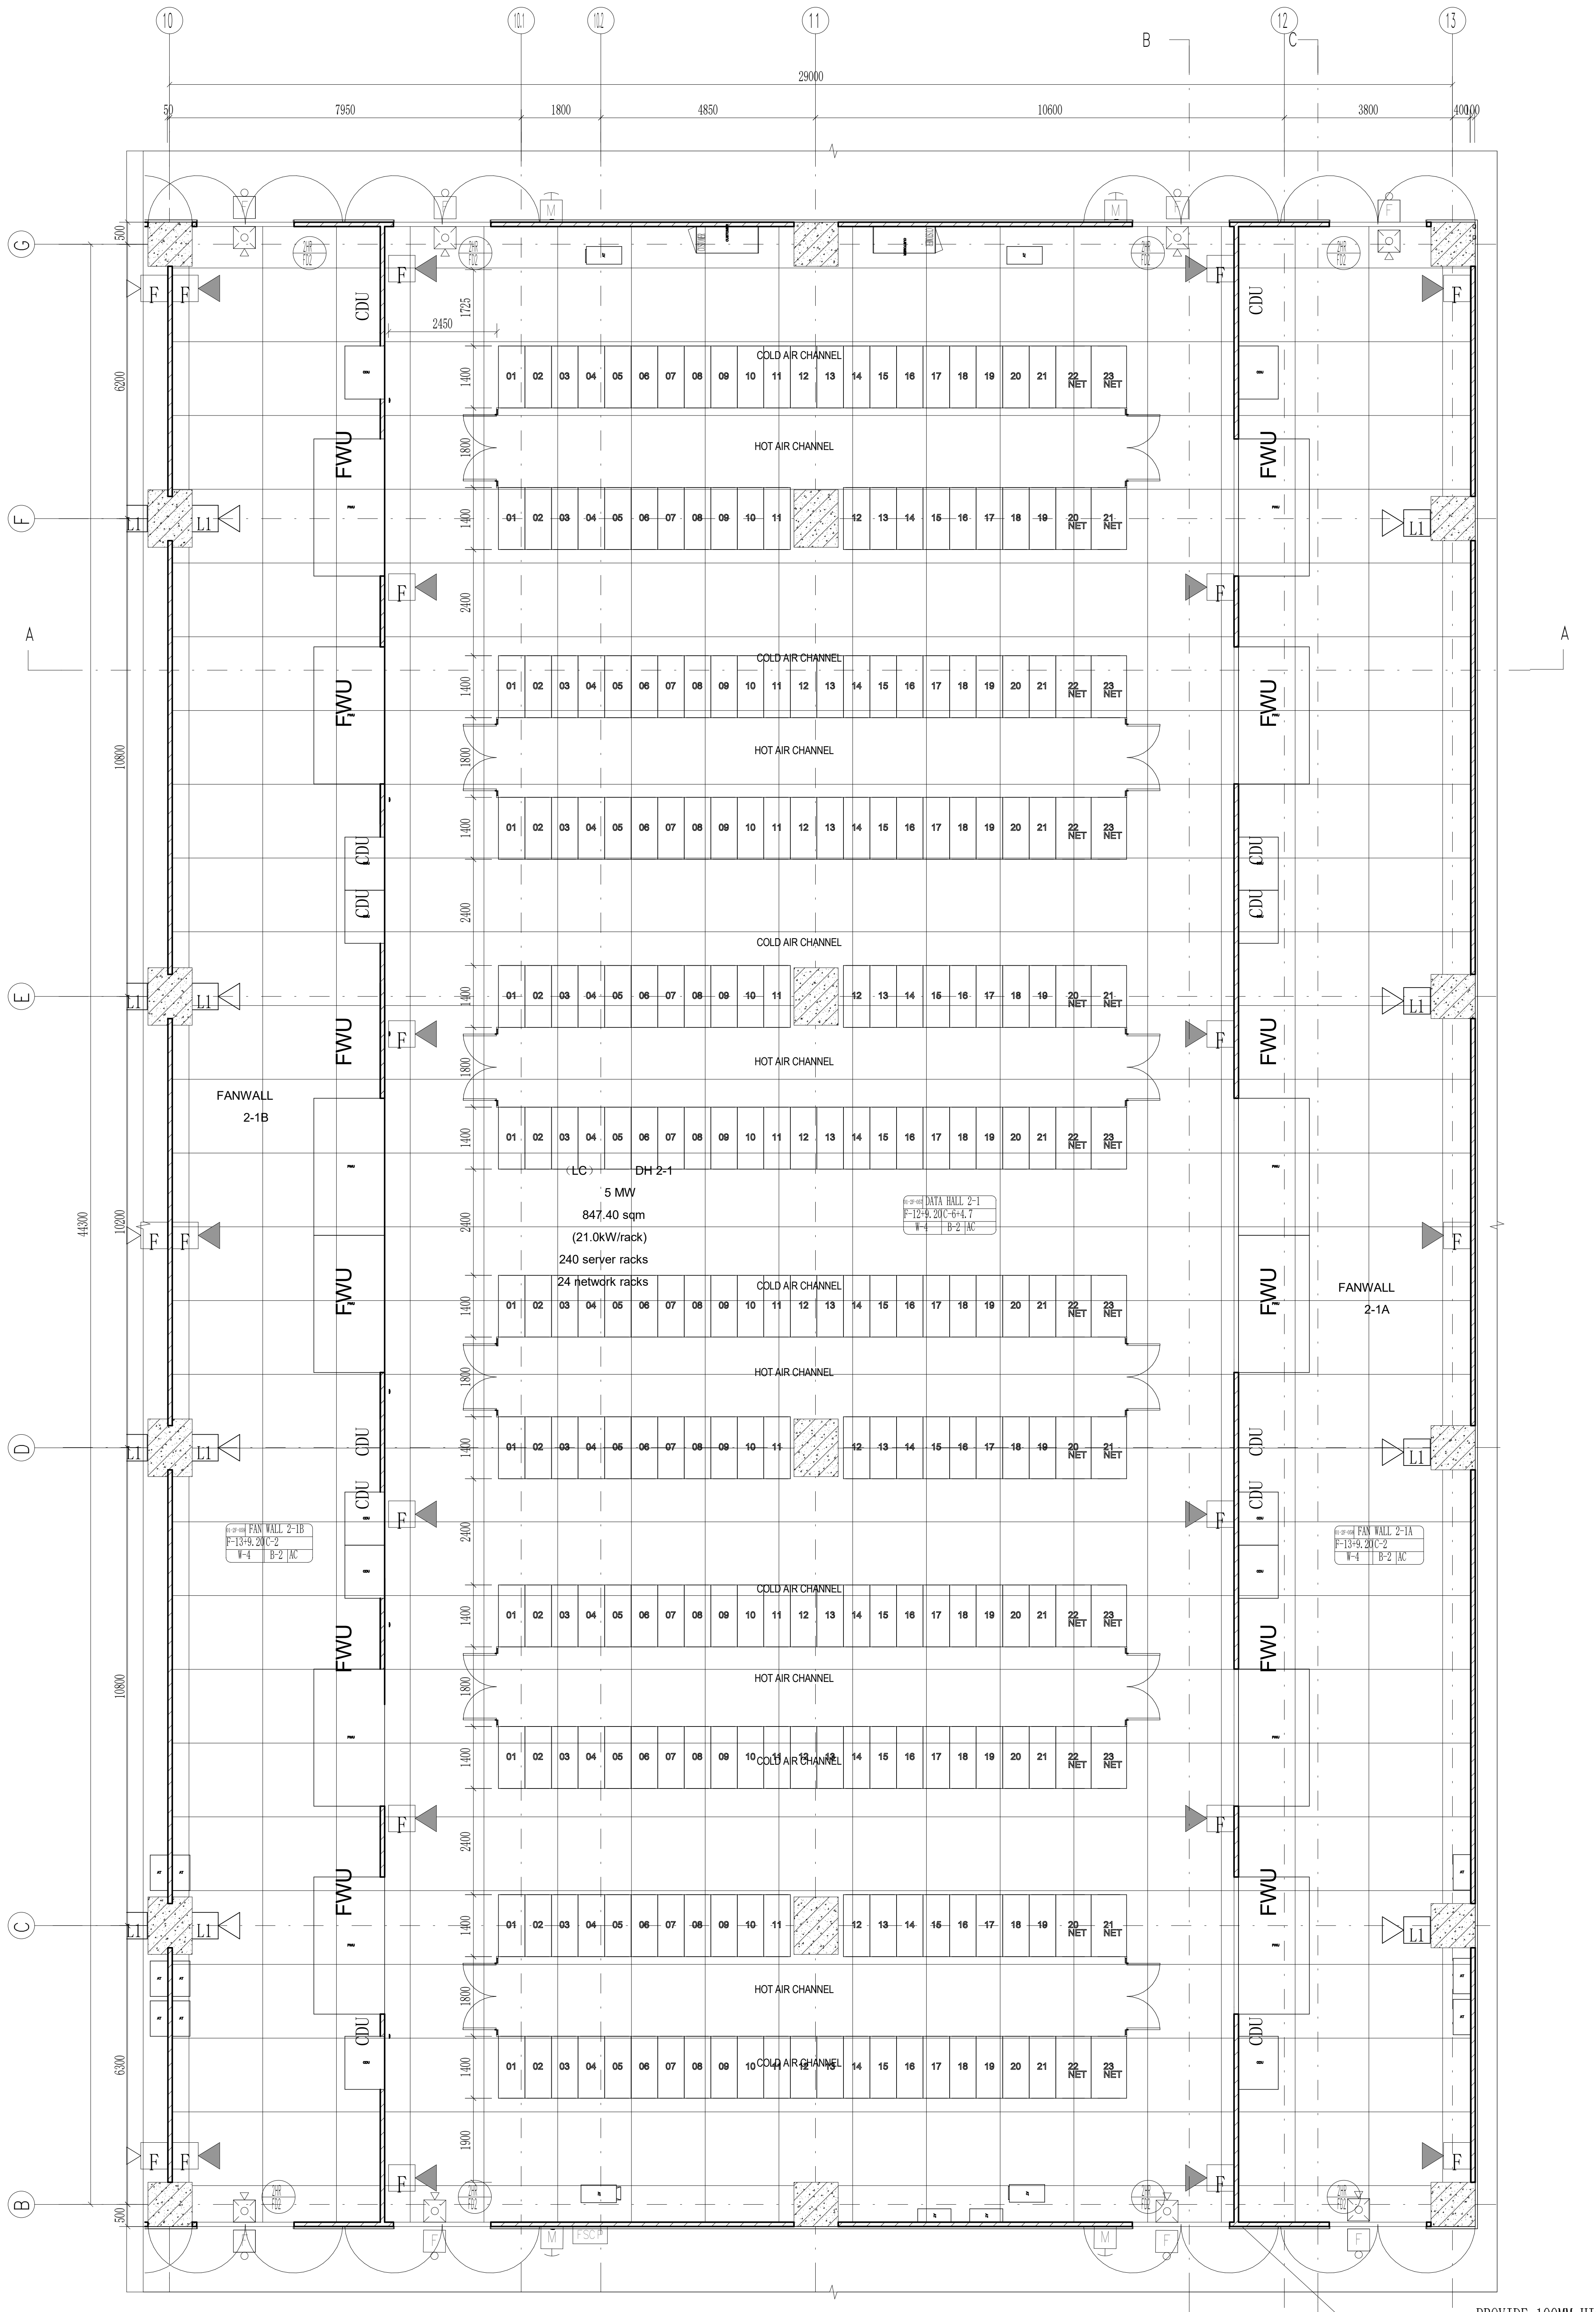

PROVIDE 100MM HIGH
CONCRETE UPSTAND AT THE
LOWER PART

DH2-1、FAN WALL 2-1A 2-1B FLOOR PLAN

Scale 1:75

THE "SFL" MARKED IN THE DRAWING REFERS TO THE STRUCTURAL FLOOR LEVEL, WHILE THE FINISHED FLOOR LEVEL (FFL) IS DETERMINED BASED ON FLOOR FINISHES.

Room Number	Room Name	Room Type	0kW/RACK	12kW/RACK	16kW/RACK	21kW/RACK	Rack Count	Design IT Load（Mw）
01-2F-050	Data Hall2-1	Liquid-cooled	0	0	24	240	264	5

Note On Levels- All Levels Shown Are Absolute Elevation	
☒	0kW/RACK
▯	12kW/RACK
⊠	16kW/RACK
▯	21kW/RACK

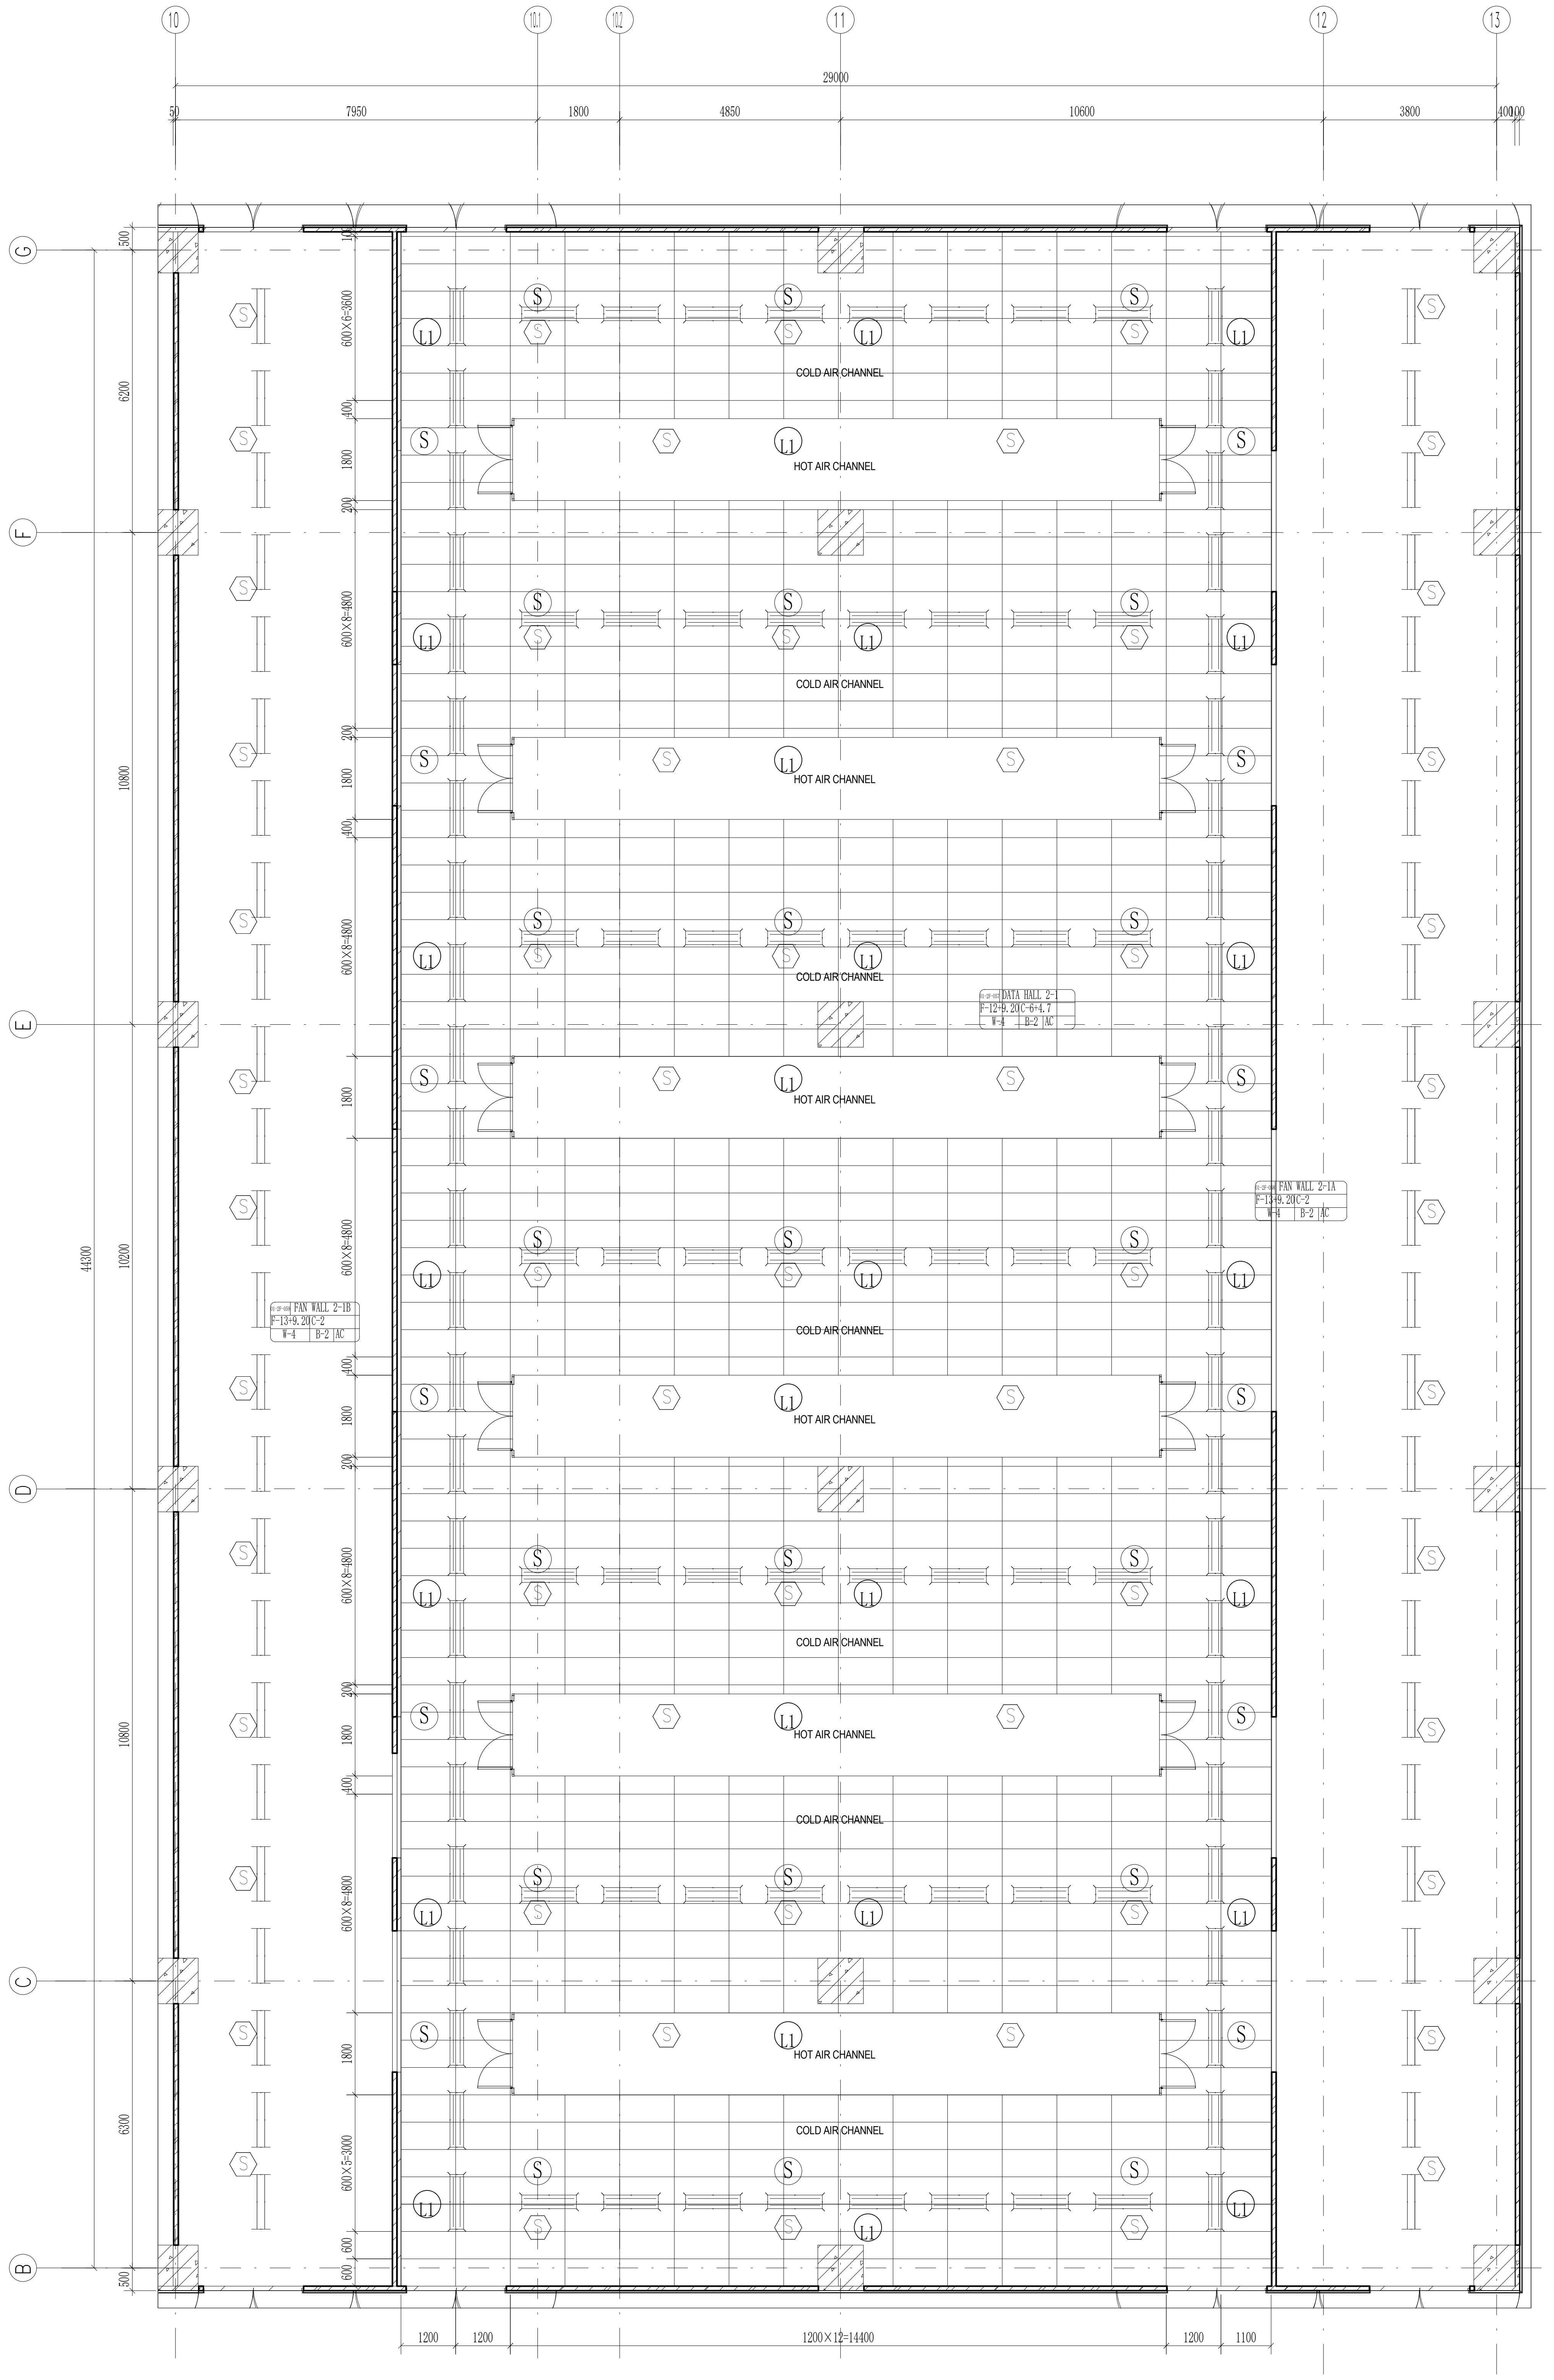

DH2-1 CEILING LAYOUT

Scale 1:75

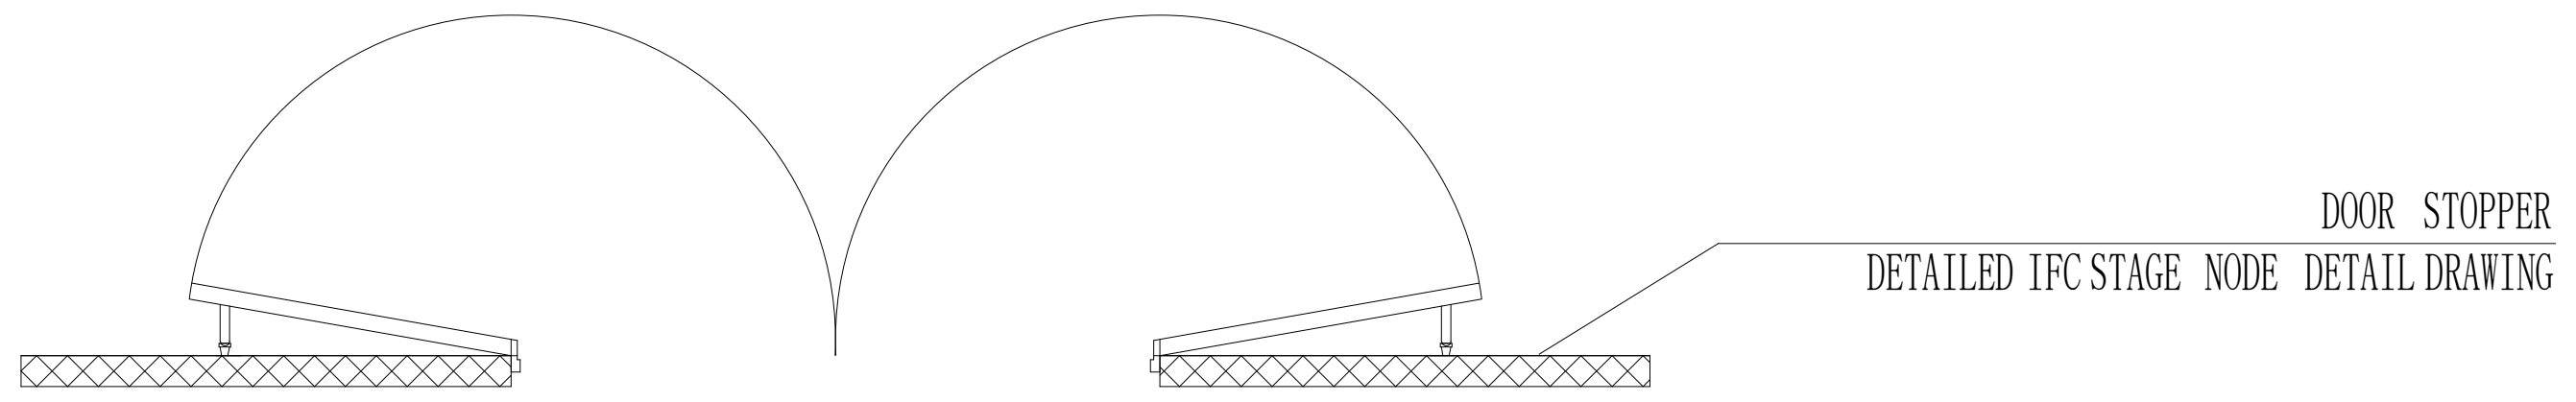

DOOR STOPPER DETAIL

Scale 1:25

— — 2MM THICK STAINLESS STEEL PROTECTIVE PLATE IS INSTALLED FROM THE GROUND UP TO A HEIGHT OF 1.5 METERS. DETAILED IFC STAGE NODE DETAIL DRAWING

FIRE ALARM SPEAKER WALL MOUNTED

COMBINATION HORN/VISIBLE

○ SURFACE MOUNTED SMOKE DETECTOR, PHOTOELECTRIC TYPE

⬡ PHOTOELECTRIC SMOKE DETECTOR

LED double tube lamp; Ceiling Mounted; System Power 2x20W (+/- 10% In Tolerance); System Lumens >2x2000lm (+/- 10% In Tolerance); Luminaire Efficacy >100lm/w; CCT 5000K; CRI>80; CPF>0.9; Input Voltage 220V-240V 50/60Hz (Mounting height 3.0m)

LED double tube lamp; Ceiling Mounted; System Power 2x20W (+/- 10% In Tolerance); System Lumens >2x2000lm (+/- 10% In Tolerance); Luminaire Efficacy >100lm/w; CCT 5000K; CRI>80; CPF>0.9; Input Voltage 220V-240V 50/60Hz (Mounting height 3.0m)

F ALARM BELL

○ CEILING SPEAKER

CLIENT :

GULF EDGE DC 01

87 Wireless Road, M Thai Tower 11th. Floor, All Seasons Place, Lumpini, Pathumwan, Bangkok 10330, Thailand

CONTRACTOR :

华西发展(泰国)有限公司
บริษัท หัวซือ ดีเวลลอปเม้นต์ (ประเทศไทย) จำกัด
HUASHI DEVELOPMENT CO.,LTD
No. 202, Room No. 1403, 14/F, Le Concorde Building,
Ratchadapisek Road, Huaykhwang Sub-District,
Huaykhwang District, Bangkok Metropolitan 10310.

CONSULTANT :

ARbay
บริษัท เอ อาร์ เบย์ จำกัด
ARbay Company Limited
31 st Floor Bangkok Insurance Building
25 South Sathorn road Thungmahamek
Sathorn Bangkok 10120 THAILAND
T +66 (0) 2286 8199
F +66 (0) 2286 2863
info@arbay.co.th

CONSULTANT :

Qbic Engineers & Architects Co.,Ltd.
8 Soi KALONG 4 SANAMBINNAM ROAD,
THASAI SUB-DISTRICT, MUANG NONTHABURI DISTRICT
, NONTHABURI.
Tel 662-950-4374
Fax 662-580-3231
E-Mail : qbic@qbic.co.th, www.qbic.co.th
QBIC ENGINEERS AND ARCHITECTS CO.,LTD.

CONSULTANT :

MITR
MITR TECHNICAL CONSULTANT CO.,LTD.
1168/8 12th FLOOR, LUMPINI TOWER BUILDING,
RAMA IV RD., THUNGMAHAMEK, SATHORN, BANGKOK 10120, THAILAND
TEL : 0-2679-9079-84
FAX : 0-2679-9085 E-mail: mitr_dd@mitr.com

Architect :	SIGNATURE
ประกิต พนานุรัตน์ วสถ. 580 ที่อยู่ 251/1 ถ.จารุเมือง แขวงรองเมือง เขตปทุมวัน กรุงเทพมหานคร โทรศัพท์ 02-286-8199	

Structural Engineer :	SIGNATURE
วิศวกรผู้ออกแบบโครงสร้าง	
ณัฐสม สงวนวงษ์ วย 1423 ที่อยู่ 2/1 ซ.รามคำแหง 150 ถ.รามคำแหง แขวง สะพานสูง เขต สะพานสูง กทม. 10240	ณัฐสม สงวนวงษ์

Structural Inspector :	SIGNATURE
วิศวกรผู้ตรวจสอบโครงสร้าง	
โกมล จุฑาภัทร วย 964 ที่อยู่ 24/18 ซ.นวมินทร์ 129 ถ. นวมินทร์ แขวง นวลจันทร์ เขต บึงกุ่ม กทม. 10230	

Electrical Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบไฟฟ้ากำลัง	
นายสุภัทร บูรณวิทย์ วฟก.1265 ที่อยู่ 21 ซอยทานสัมฤทธิ์ 13 ตำบลท่าทราย อ.เมืองนนทบุรี จ.นนทบุรี 11000	สุภัทร บูรณวิทย์

Mechanical Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบเครื่องกลและปรับอากาศ	
นายประสิทธิ์ เกี้ยวสุนทร วก.1221 ที่อยู่ 44/372 ซอยบางกระดี่ 35/1 แขวงแสมดำ เขตบางขุนเทียน กทม. 10150	ประสิทธิ์

Sanitary Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบสุขาภิบาล และดับเพลิง	
นายทศวรรษ สนั่นฤทธิ์ วส. 215 ที่อยู่ บ้านเลขที่ 99/107 หมู่ที่ 3 ต.ศีรษะจรเข้น้อย อ.บางเสาธง จ.สมุทรปราการ 10540	ทศวรรษ

ISSUE/REVISION

REV.	DESCRIPTION	DATE
A	90% DEVELOPED	09/05/2026

PROJECT NAME :

GEDC 01

LOCATION:
Nikhom Phattana district, Rayong ,industrial estate,CPGC

BUILDING :
MAIN BUILDING

90% DEVELOPED

TITLE :

ROOM DETAIL-2F-DATAHALL2-1(LC)
FANWALL ROOM 2-1A,2-1B PLAN

JOB NO.	SCALE 作为说明
DRAWN 作者	REF.
CHECKED 审图员	DWG.NO. MPK01A-90-A-RD-201
APPROVED 审核者	
DATE 2026.05.09	

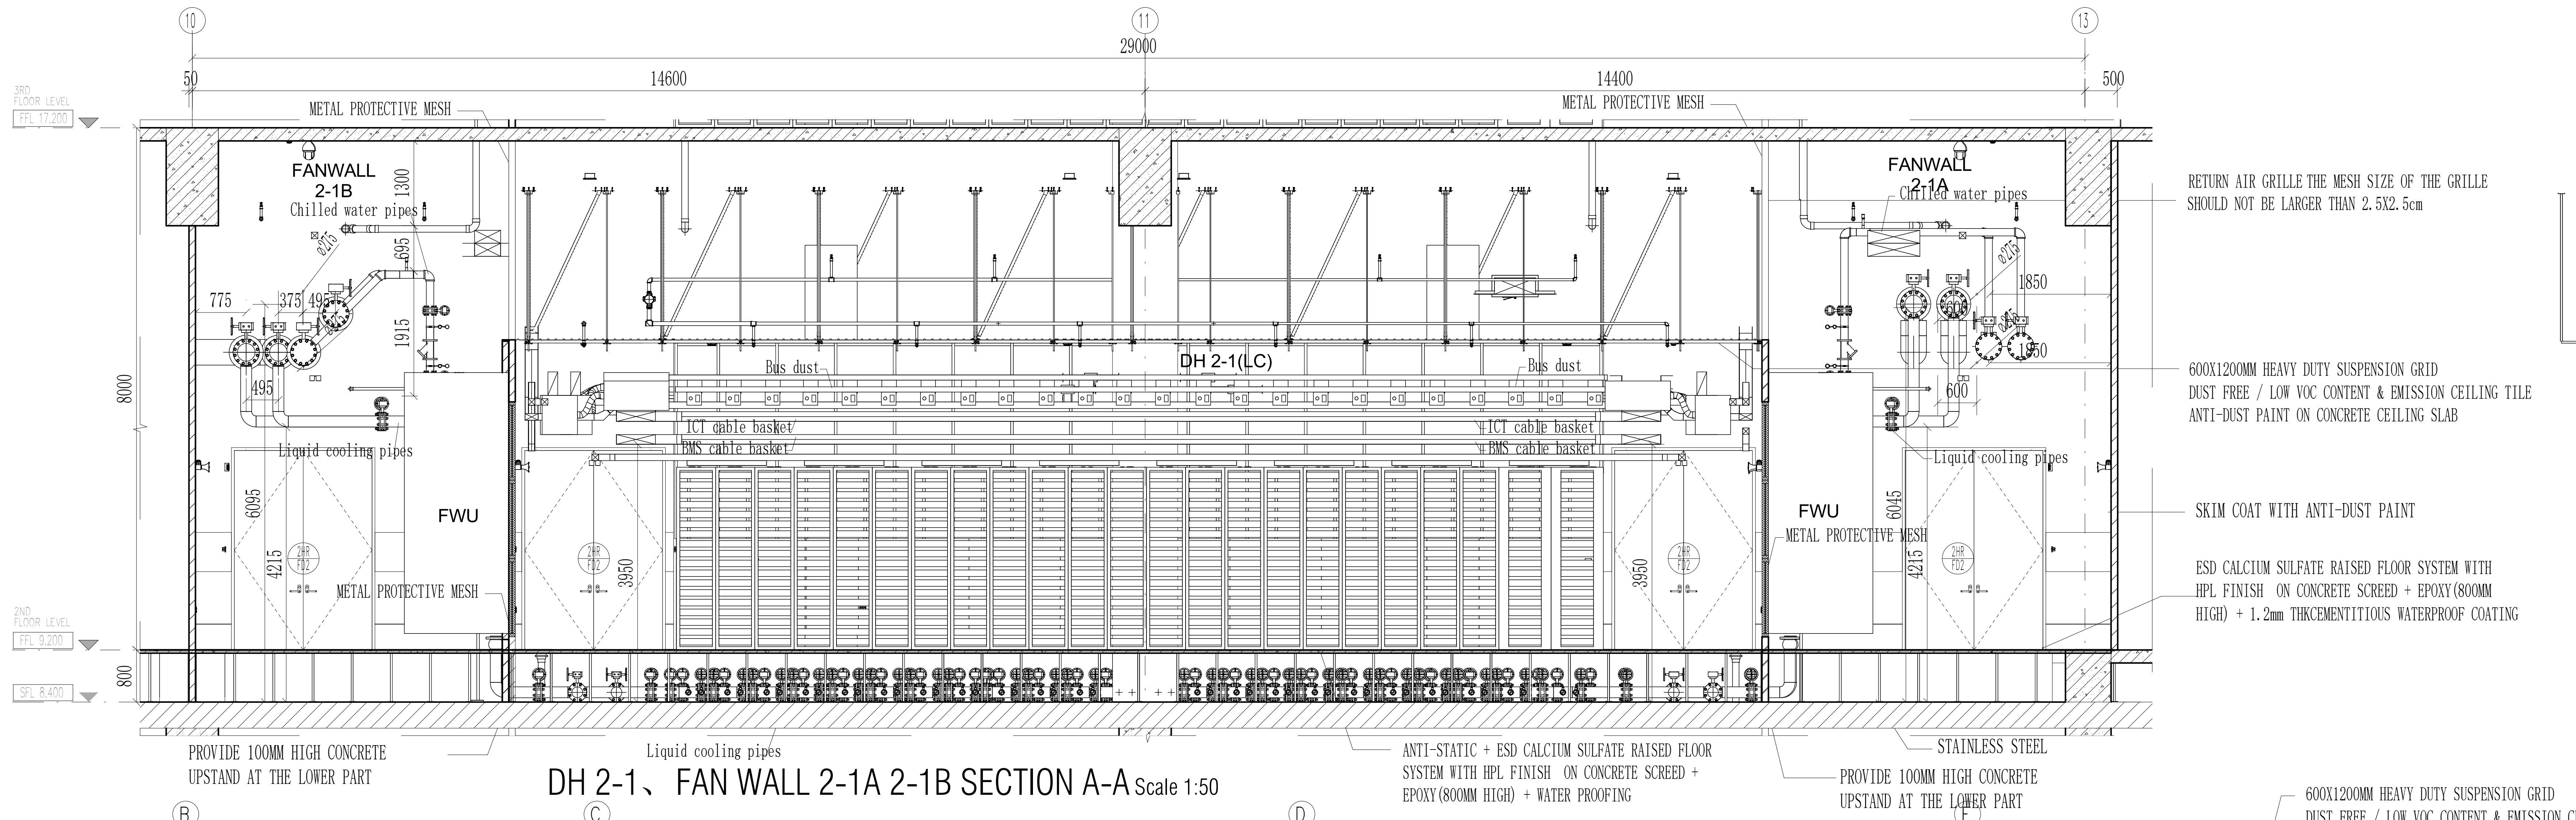
10
11
13
29000
50
14600
14400
500
3RD FLOOR LEVEL
FFL 17.200
2ND FLOOR LEVEL
FFL 9.200
SFL 8.400
8000
800
METAL PROTECTIVE MESH
FANWALL 2-1B
Chilled water pipes
1300
ø275
695
775
375
495
495
1915
Liquid cooling pipes
6095
4215
2HR FD2
FWU
METAL PROTECTIVE MESH
3950
Bus dust
DH 2-1(LC)
ICT cable basket
BMS cable basket
FANWALL 2-1A
Chilled water pipes
1850
600
FWU
METAL PROTECTIVE MESH
6045
4215
Liquid cooling pipes
PROVIDE 100MM HIGH CONCRETE UPSTAND AT THE LOWER PART
Liquid cooling pipes
ANTI-STATIC + ESD CALCIUM SULFATE RAISED FLOOR SYSTEM WITH HPL FINISH ON CONCRETE SCREED + EPOXY(800MM HIGH) + WATER PROOFING
PROVIDE 100MM HIGH CONCRETE UPSTAND AT THE LOWER PART
STAINLESS STEEL
RETURN AIR GRILLE THE MESH SIZE OF THE GRILLE SHOULD NOT BE LARGER THAN 2.5X2.5cm
600X1200MM HEAVY DUTY SUSPENSION GRID
DUST FREE / LOW VOC CONTENT & EMISSION CEILING TILE
ANTI-DUST PAINT ON CONCRETE CEILING SLAB
SKIM COAT WITH ANTI-DUST PAINT
ESD CALCIUM SULFATE RAISED FLOOR SYSTEM WITH HPL FINISH ON CONCRETE SCREED + EPOXY(800MM HIGH) + 1.2mm THKCEMENTITIOUS WATERPROOF COATING

DH 2-1、 FAN WALL 2-1A 2-1B SECTION A-A Scale 1:50

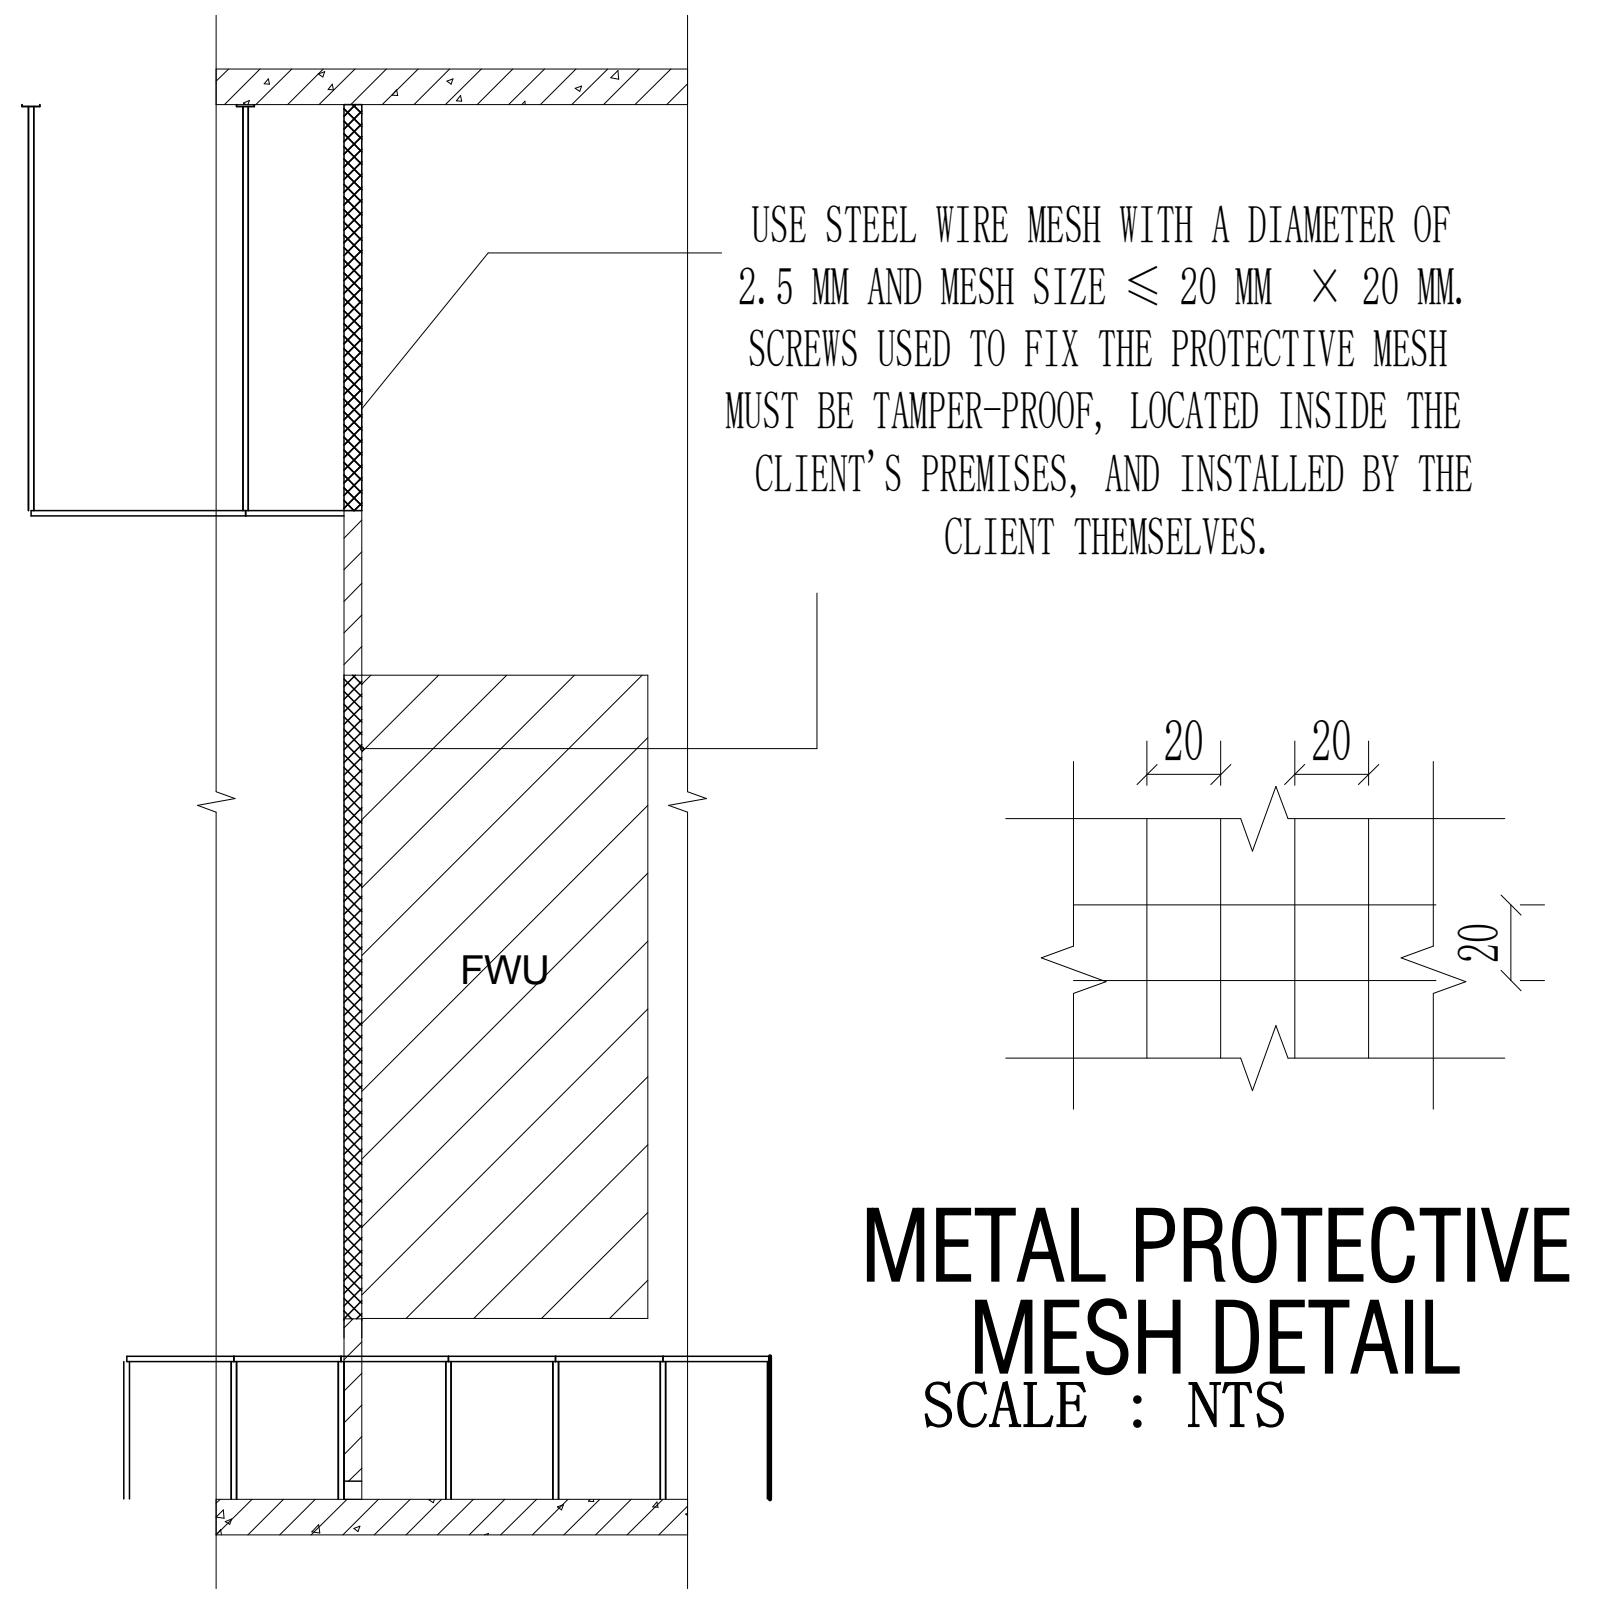
USE STEEL WIRE MESH WITH A DIAMETER OF 2.5 MM AND MESH SIZE ≤ 20 MM × 20 MM. SCREWS USED TO FIX THE PROTECTIVE MESH MUST BE TAMPER-PROOF, LOCATED INSIDE THE CLIENT'S PREMISES, AND INSTALLED BY THE CLIENT THEMSELVES.
FWU
20
20
20

METAL PROTECTIVE MESH DETAIL
SCALE : NTS

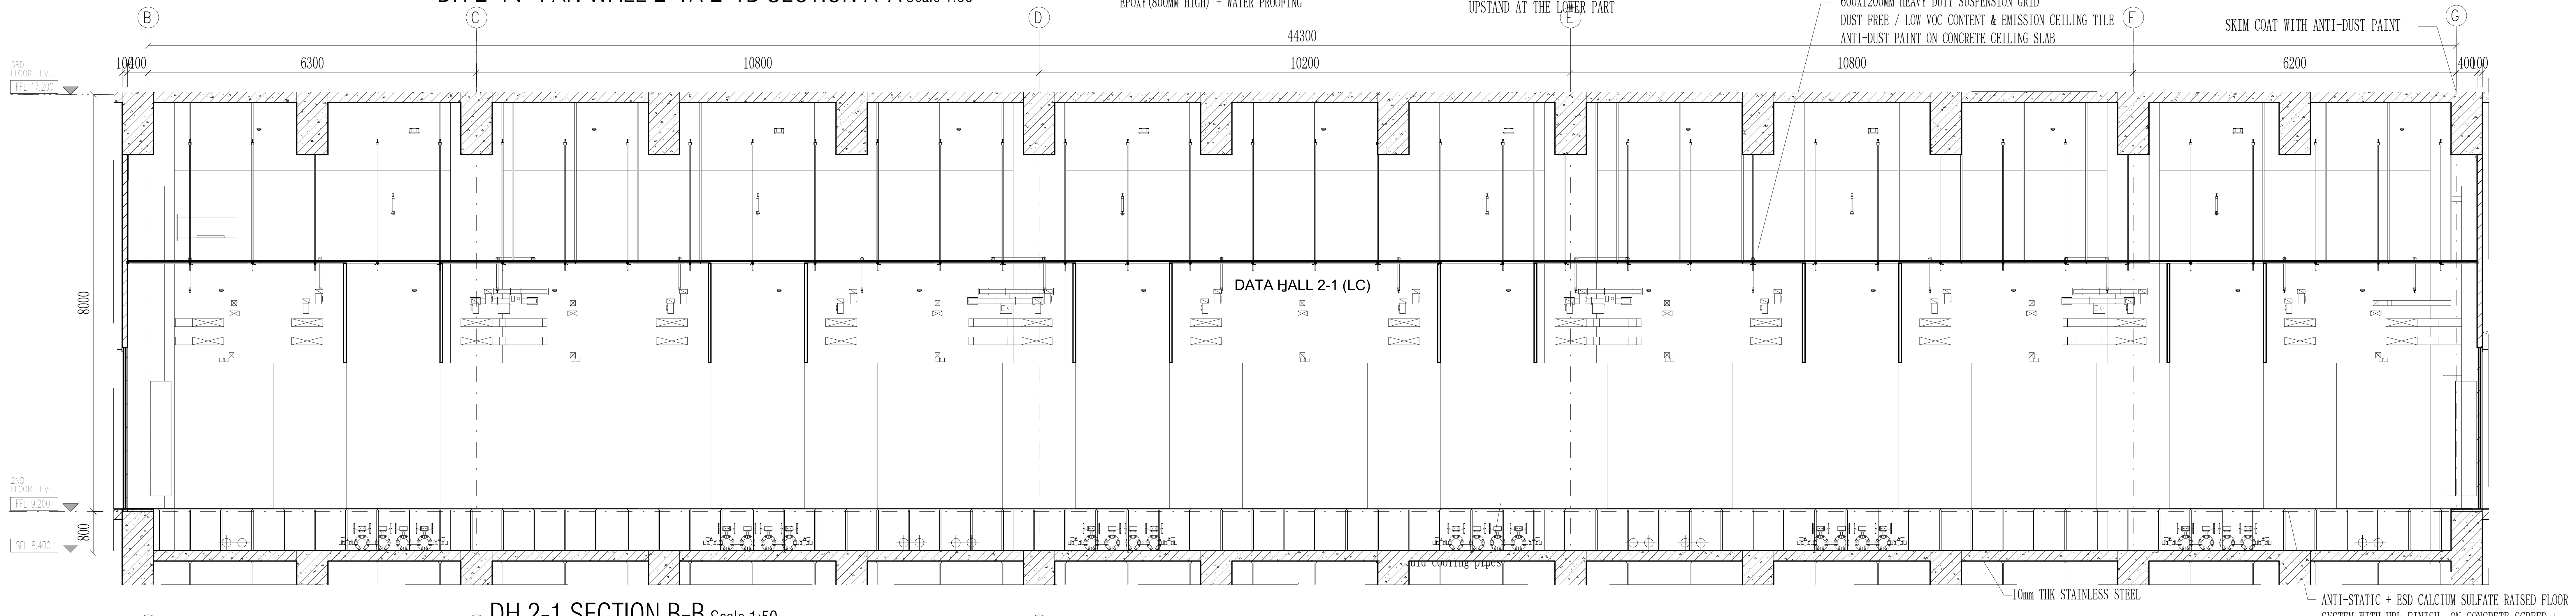
B
C
D
E
F
G
44300
100
400
6300
10800
10200
10800
6200
400
100
3RD FLOOR LEVEL
FFL 17.200
2ND FLOOR LEVEL
FFL 9.200
SFL 8.400
8000
800
600X1200MM HEAVY DUTY SUSPENSION GRID
DUST FREE / LOW VOC CONTENT & EMISSION CEILING TILE
ANTI-DUST PAINT ON CONCRETE CEILING SLAB
SKIM COAT WITH ANTI-DUST PAINT
DATA HALL 2-1 (LC)
Liquid cooling pipes
10mm THK STAINLESS STEEL
ANTI-STATIC + ESD CALCIUM SULFATE RAISED FLOOR SYSTEM WITH HPL FINISH ON CONCRETE SCREED + EPOXY(800MM HIGH) + WATER PROOFING

DH 2-1 SECTION B-B Scale 1:50

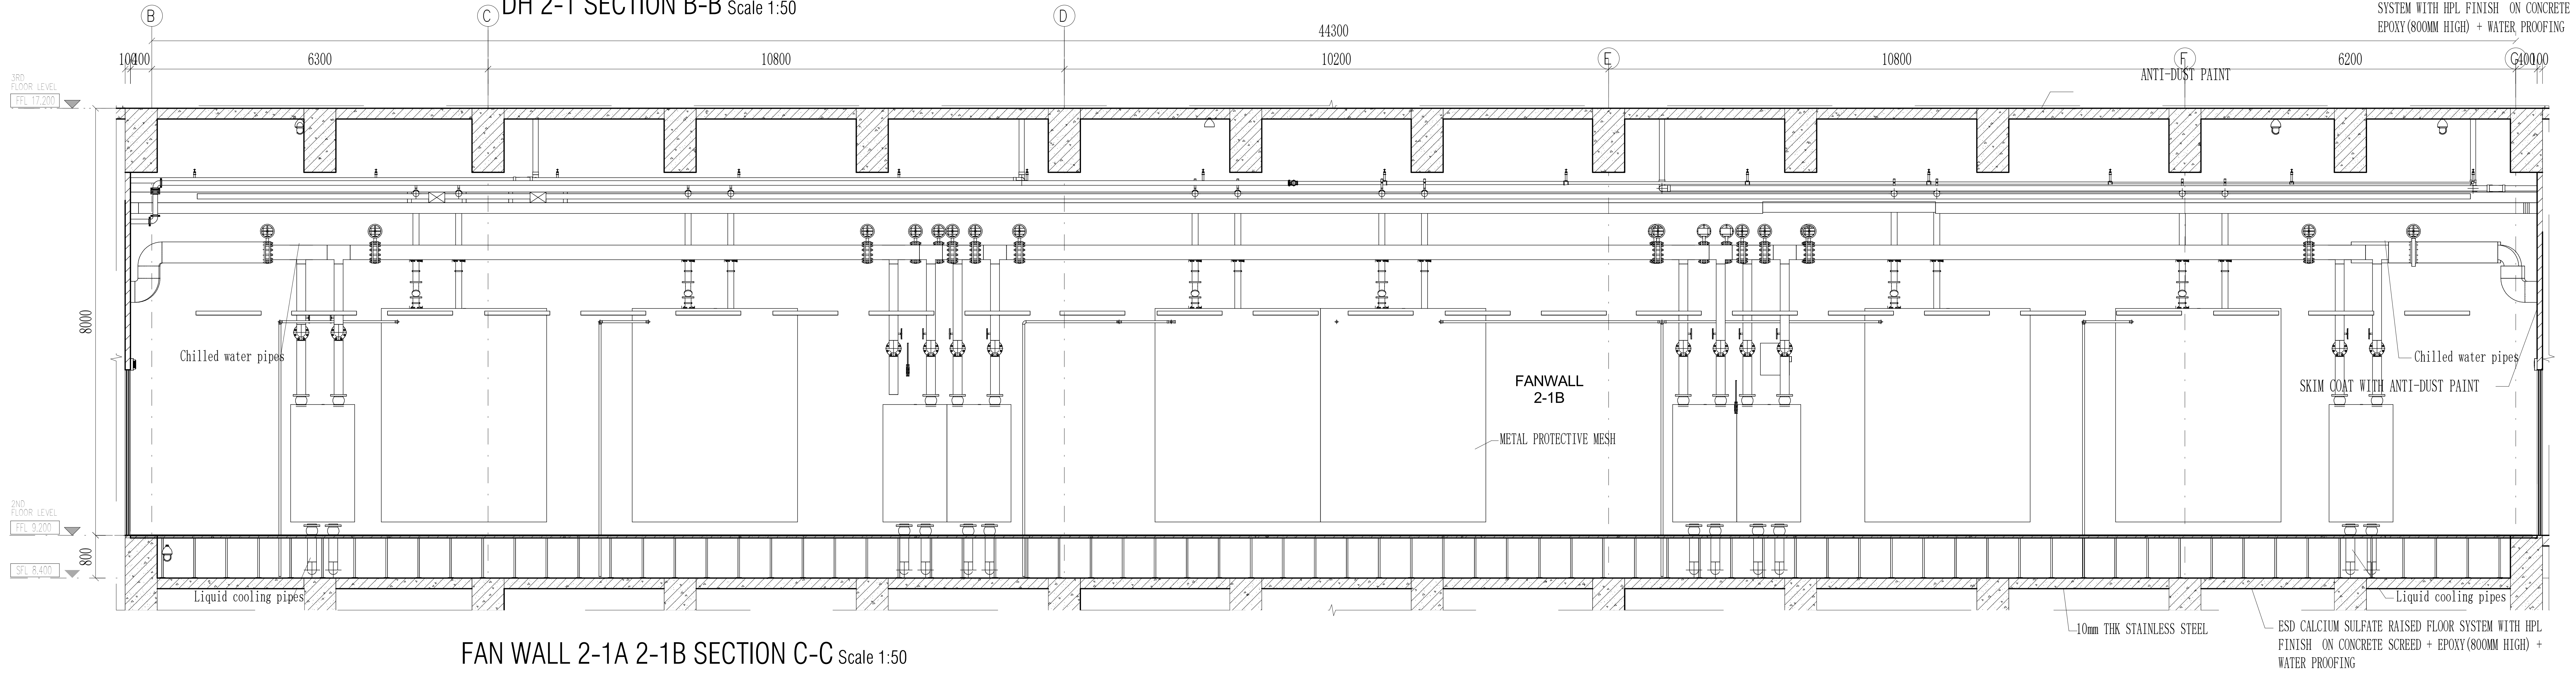

FAN WALL 2-1A 2-1B SECTION C-C Scale 1:50

CLIENT :

GULF EDGE DC 01

87 Wireless Road, M Thai Tower 11th. Floor, All Seasons Place, Lumpini,
Pathumwan, Bangkok 10330, Thailand

CONTRACTOR :

华西发展(泰国)有限公司
บริษัท หัวซือ ดีเวลลอปเม้นต์ (ประเทศไทย) จำกัด
HUASHI DEVELOPMENT CO.,LTD
No. 202, Room No. 1403, 14/F, Le Concorde Building,
Ratchadapisek Road, Huaykhwang Sub-District,
Huaykhwang District, Bangkok Metropolitan 10310.

CONSULTANT :

ARbay
บริษัท เอ อาร์ เบย์ จำกัด
ARbay Company Limited
31 st Floor Bangkok Insurance Building
25 South Sathorn road Thungmahamek
Sathorn Bangkok 10120 THAILAND
T +66 (0) 2286 8199
F +66 (0) 2286 2863
info@arbay.co.th

CONSULTANT :

Qbic Engineers & Architects Co.,Ltd.
8 Soi KALONG 4 SANAMBINNAM ROAD,
THASAI SUB-DISTRICT, MUANG NONTHABURI DISTRICT
, NONTHABURI.
Tel 662-950-4374
Fax 662-580-3231
E-Mail : qbic@qbic.co.th, www.qbic.co.th
QBIC ENGINEERS AND ARCHITECTS CO.,LTD.

CONSULTANT :

MITR
MITR TECHNICAL CONSULTANT CO.,LTD.
1168/8 12th FLOOR, LUMPINI TOWER BUILDING,
RAMA IV RD., THUNGMAHAMEK, SATHORN, BANGKOK 10120, THAILAND
TEL : 0-2679-9079-84
FAX : 0-2679-9085 E-mail: mitr_dd@mitr.com

Architect : SIGNATURE
ประกิต พนานุรัตน์ วสถ. 580
ที่อยู่
251/1 ถ.จารุเมือง แขวงรองเมือง เขตปทุมวัน
กรุงเทพมหานคร โทรศัพท์ 02-286-8199

Structural Engineer : SIGNATURE
วิศวกรผู้ออกแบบโครงสร้าง
ณัฐสม สงวนวงษ์ วย 1423
ที่อยู่
2/1 ซ.รามคำแหง 150 ถ.รามคำแหง
แขวง สะพานสูง เขต สะพานสูง กทม. 10240

Structural Inspector : SIGNATURE
วิศวกรผู้ตรวจสอบโครงสร้าง
โกมล จุฑาภัทร วย 964
ที่อยู่
24/18 ซ.นวมินทร์ 129 ถ. นวมินทร์
แขวง นวลจันทร์ เขต บึงกุ่ม กทม. 10230

Electrical Engineer : SIGNATURE
วิศวกรผู้ออกแบบระบบไฟฟ้ากำลัง
นายสุภัทร บูรณวิทย์ วฟก.1265
ที่อยู่
21 ซอยทานสัมฤทธิ์ 13
ตำบลท่าทราย อ.เมืองนนทบุรี จ.นนทบุรี 11000

Mechanical Engineer : SIGNATURE
วิศวกรผู้ออกแบบระบบเครื่องกลและปรับอากาศ
นายประสิทธิ์ เกี้ยวสุนทร วก.1221
ที่อยู่
44/372 ซอยบางกระดี่ 35/1 แขวงแสมดำ
เขตบางขุนเทียน กทม. 10150

ประสิทธิ์

Sanitary Engineer : SIGNATURE
วิศวกรผู้ออกแบบระบบสุขาภิบาล และดับเพลิง
นายทศวรรษ สนั่นฤทธิ์ วส. 215
ที่อยู่
บ้านเลขที่ 99/107 หมู่ที่ 3 ต.ศีรษะจรเข้น้อย
อ.บางเสาธง จ.สมุทรปราการ 10540

ทศวรรษ

ISSUE/REVISION

REV.	DESCRIPTION	DATE
A	90% DEVELOPED	09/05/2026

PROJECT NAME :

GEDC 01

LOCATION:
Nikhom Phattana district, Rayong ,industrial estate,CPGC

BUILDING :
MAIN BUILDING

90% DEVELOPED

TITLE :

ROOM DETAIL-2F-DATAHALL2-1(LC)
FANWALL ROOM 2-1A,2-1BSECTION

JOB NO.	SCALE 1 : 50
DRAWN 作者	REF.
CHECKED 审图员	DWG. NO. MPK01A-90-A-RD-202
APPROVED 审核者	
DATE 2026.05.09	

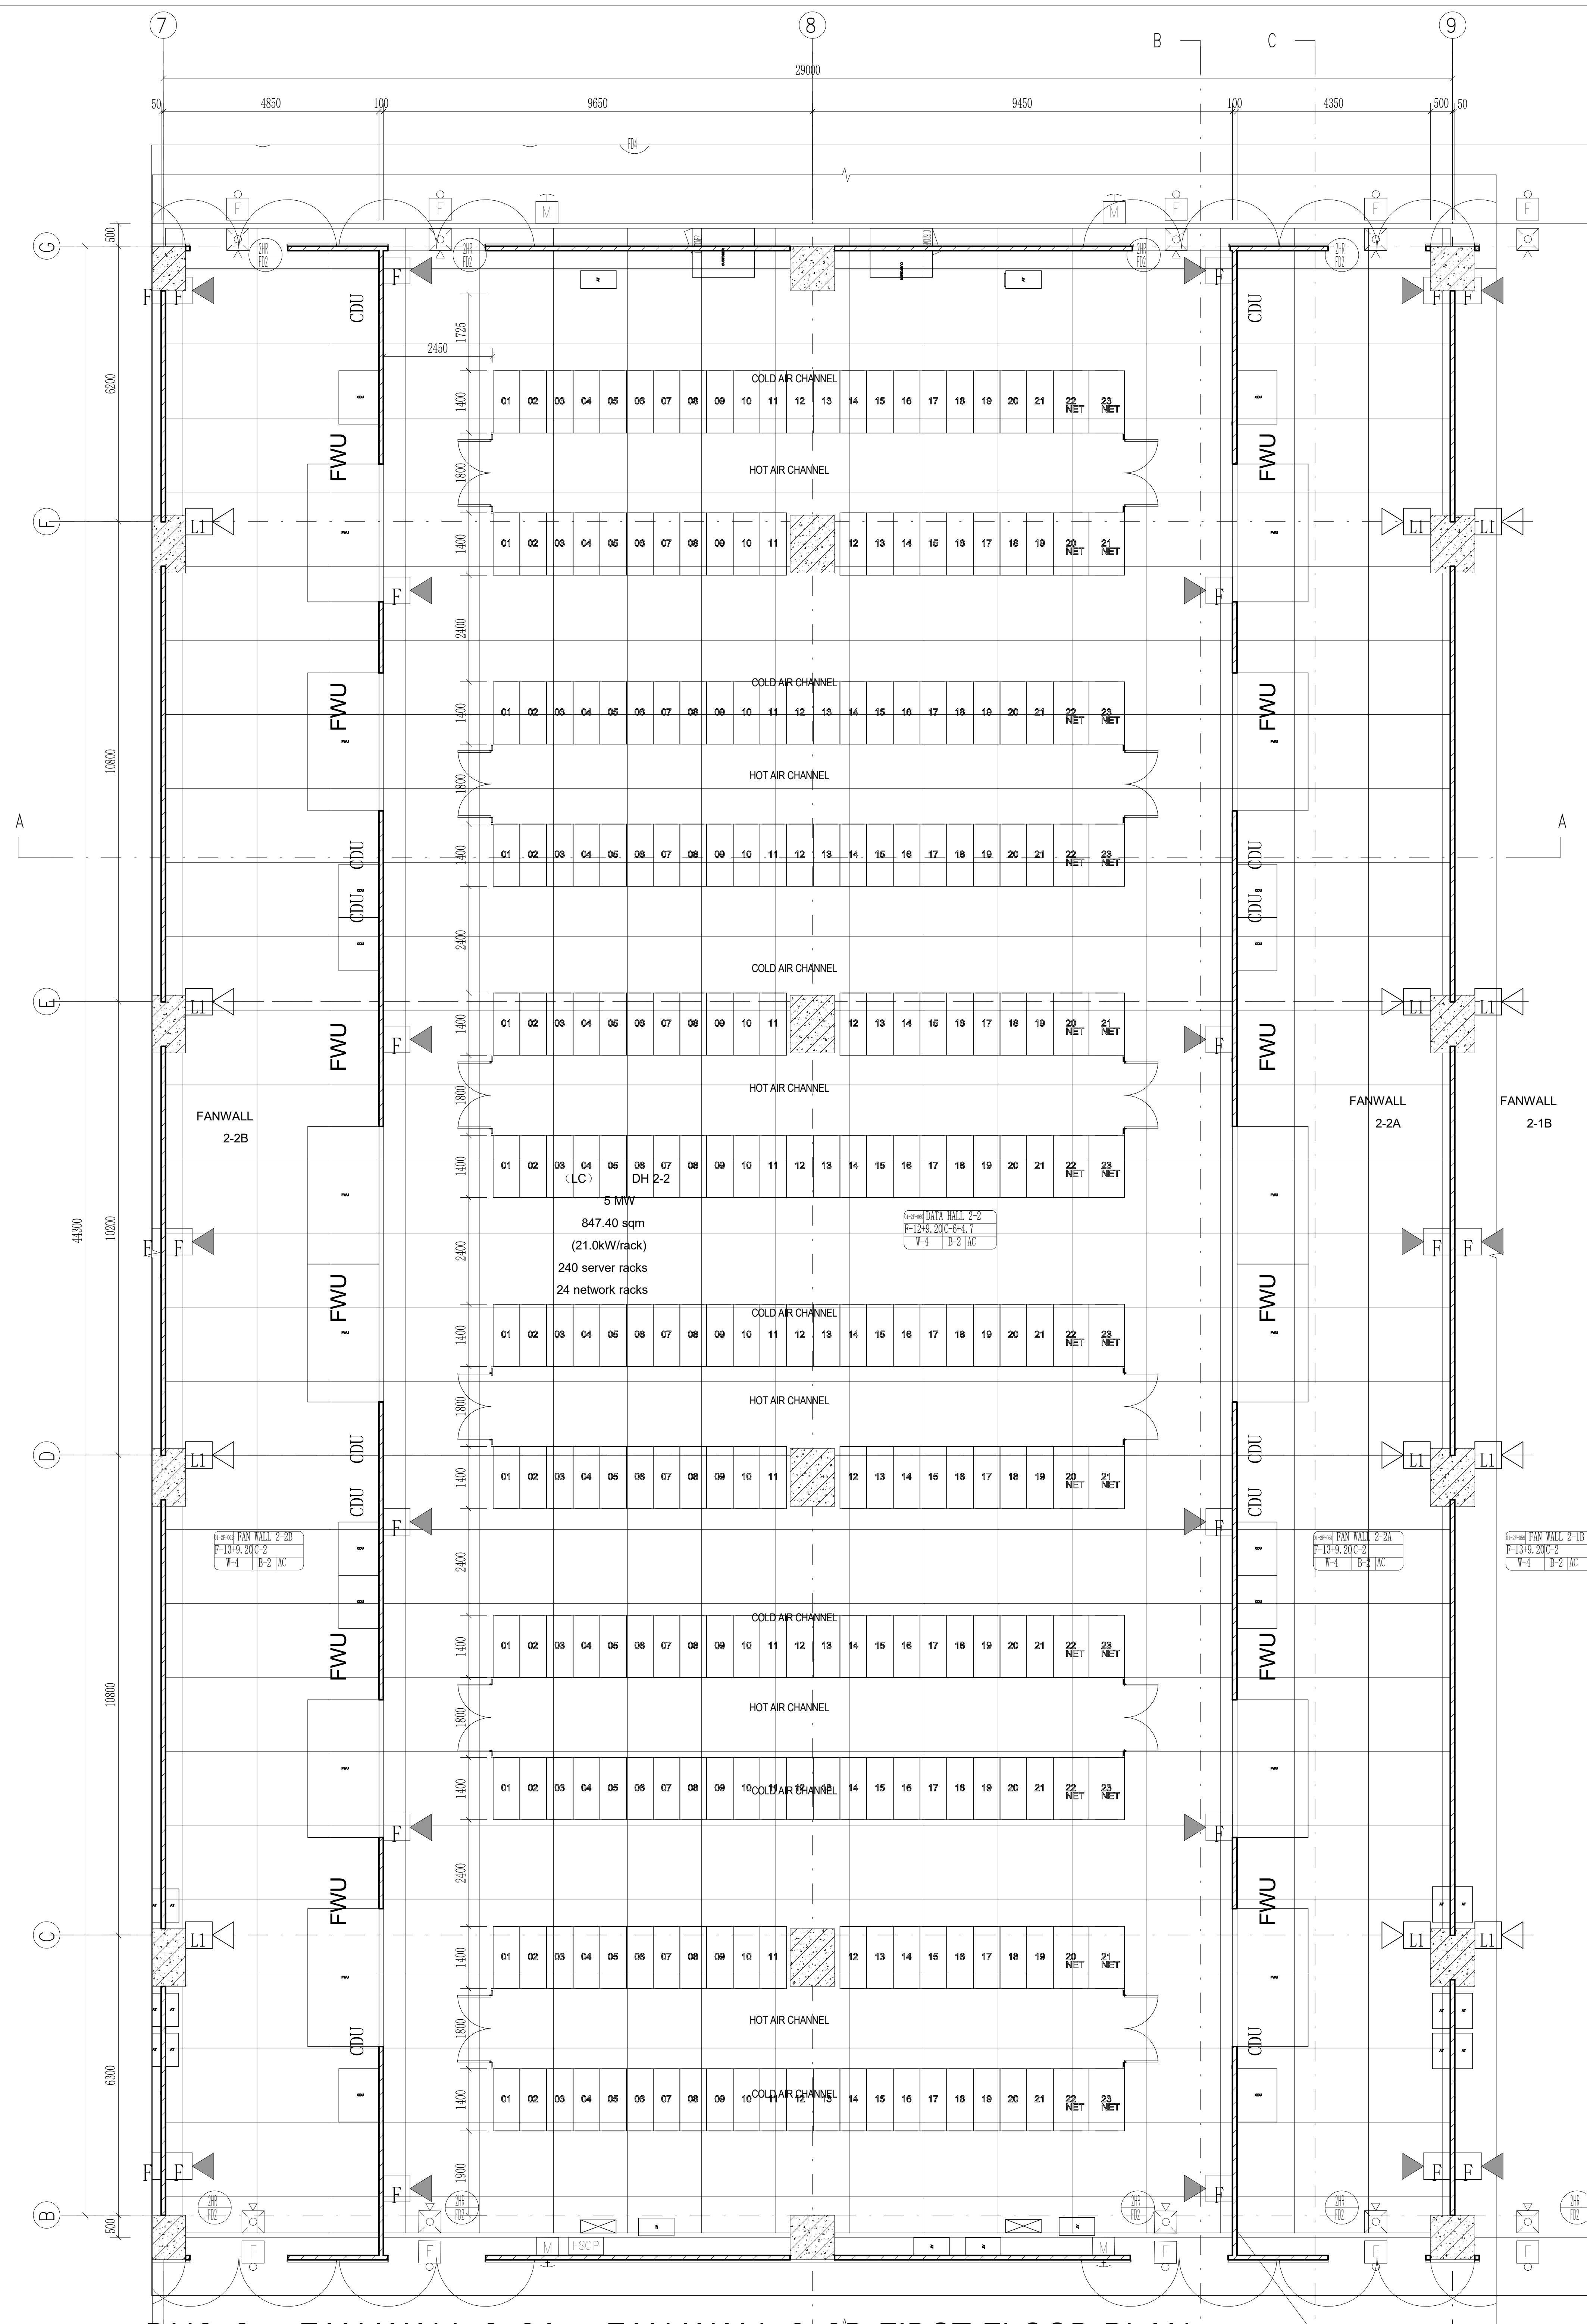

DH2-2、 FAN WALL 2-2A、 FAN WALL 2-2B FIRST FLOOR PLAN

Scale 1:75

PROVIDE 100MM HIGH CONCRETE
UPSTAND AT THE LOWER PART

THE "SFL" MARKED IN THE DRAWING REFERS TO THE STRUCTURAL FLOOR LEVEL, WHILE THE FINISHED FLOOR LEVEL (FFL) IS DETERMINED BASED ON FLOOR FINISHES.

Room Number	Room Name	Room Type	0kW/RACK	12kW/RACK	16kW/RACK	21kW/RACK	Rack Count	Design IT Load (Mw)
01-2F-053	Data Hall2-2	Liquid-cooled	0	0	24	240	264	5

Note On Levels- All Levels Shown Are Absolute Elevation	
☒	0kW/RACK
▯	12kW/RACK
☒	16kW/RACK
▯	21kW/RACK

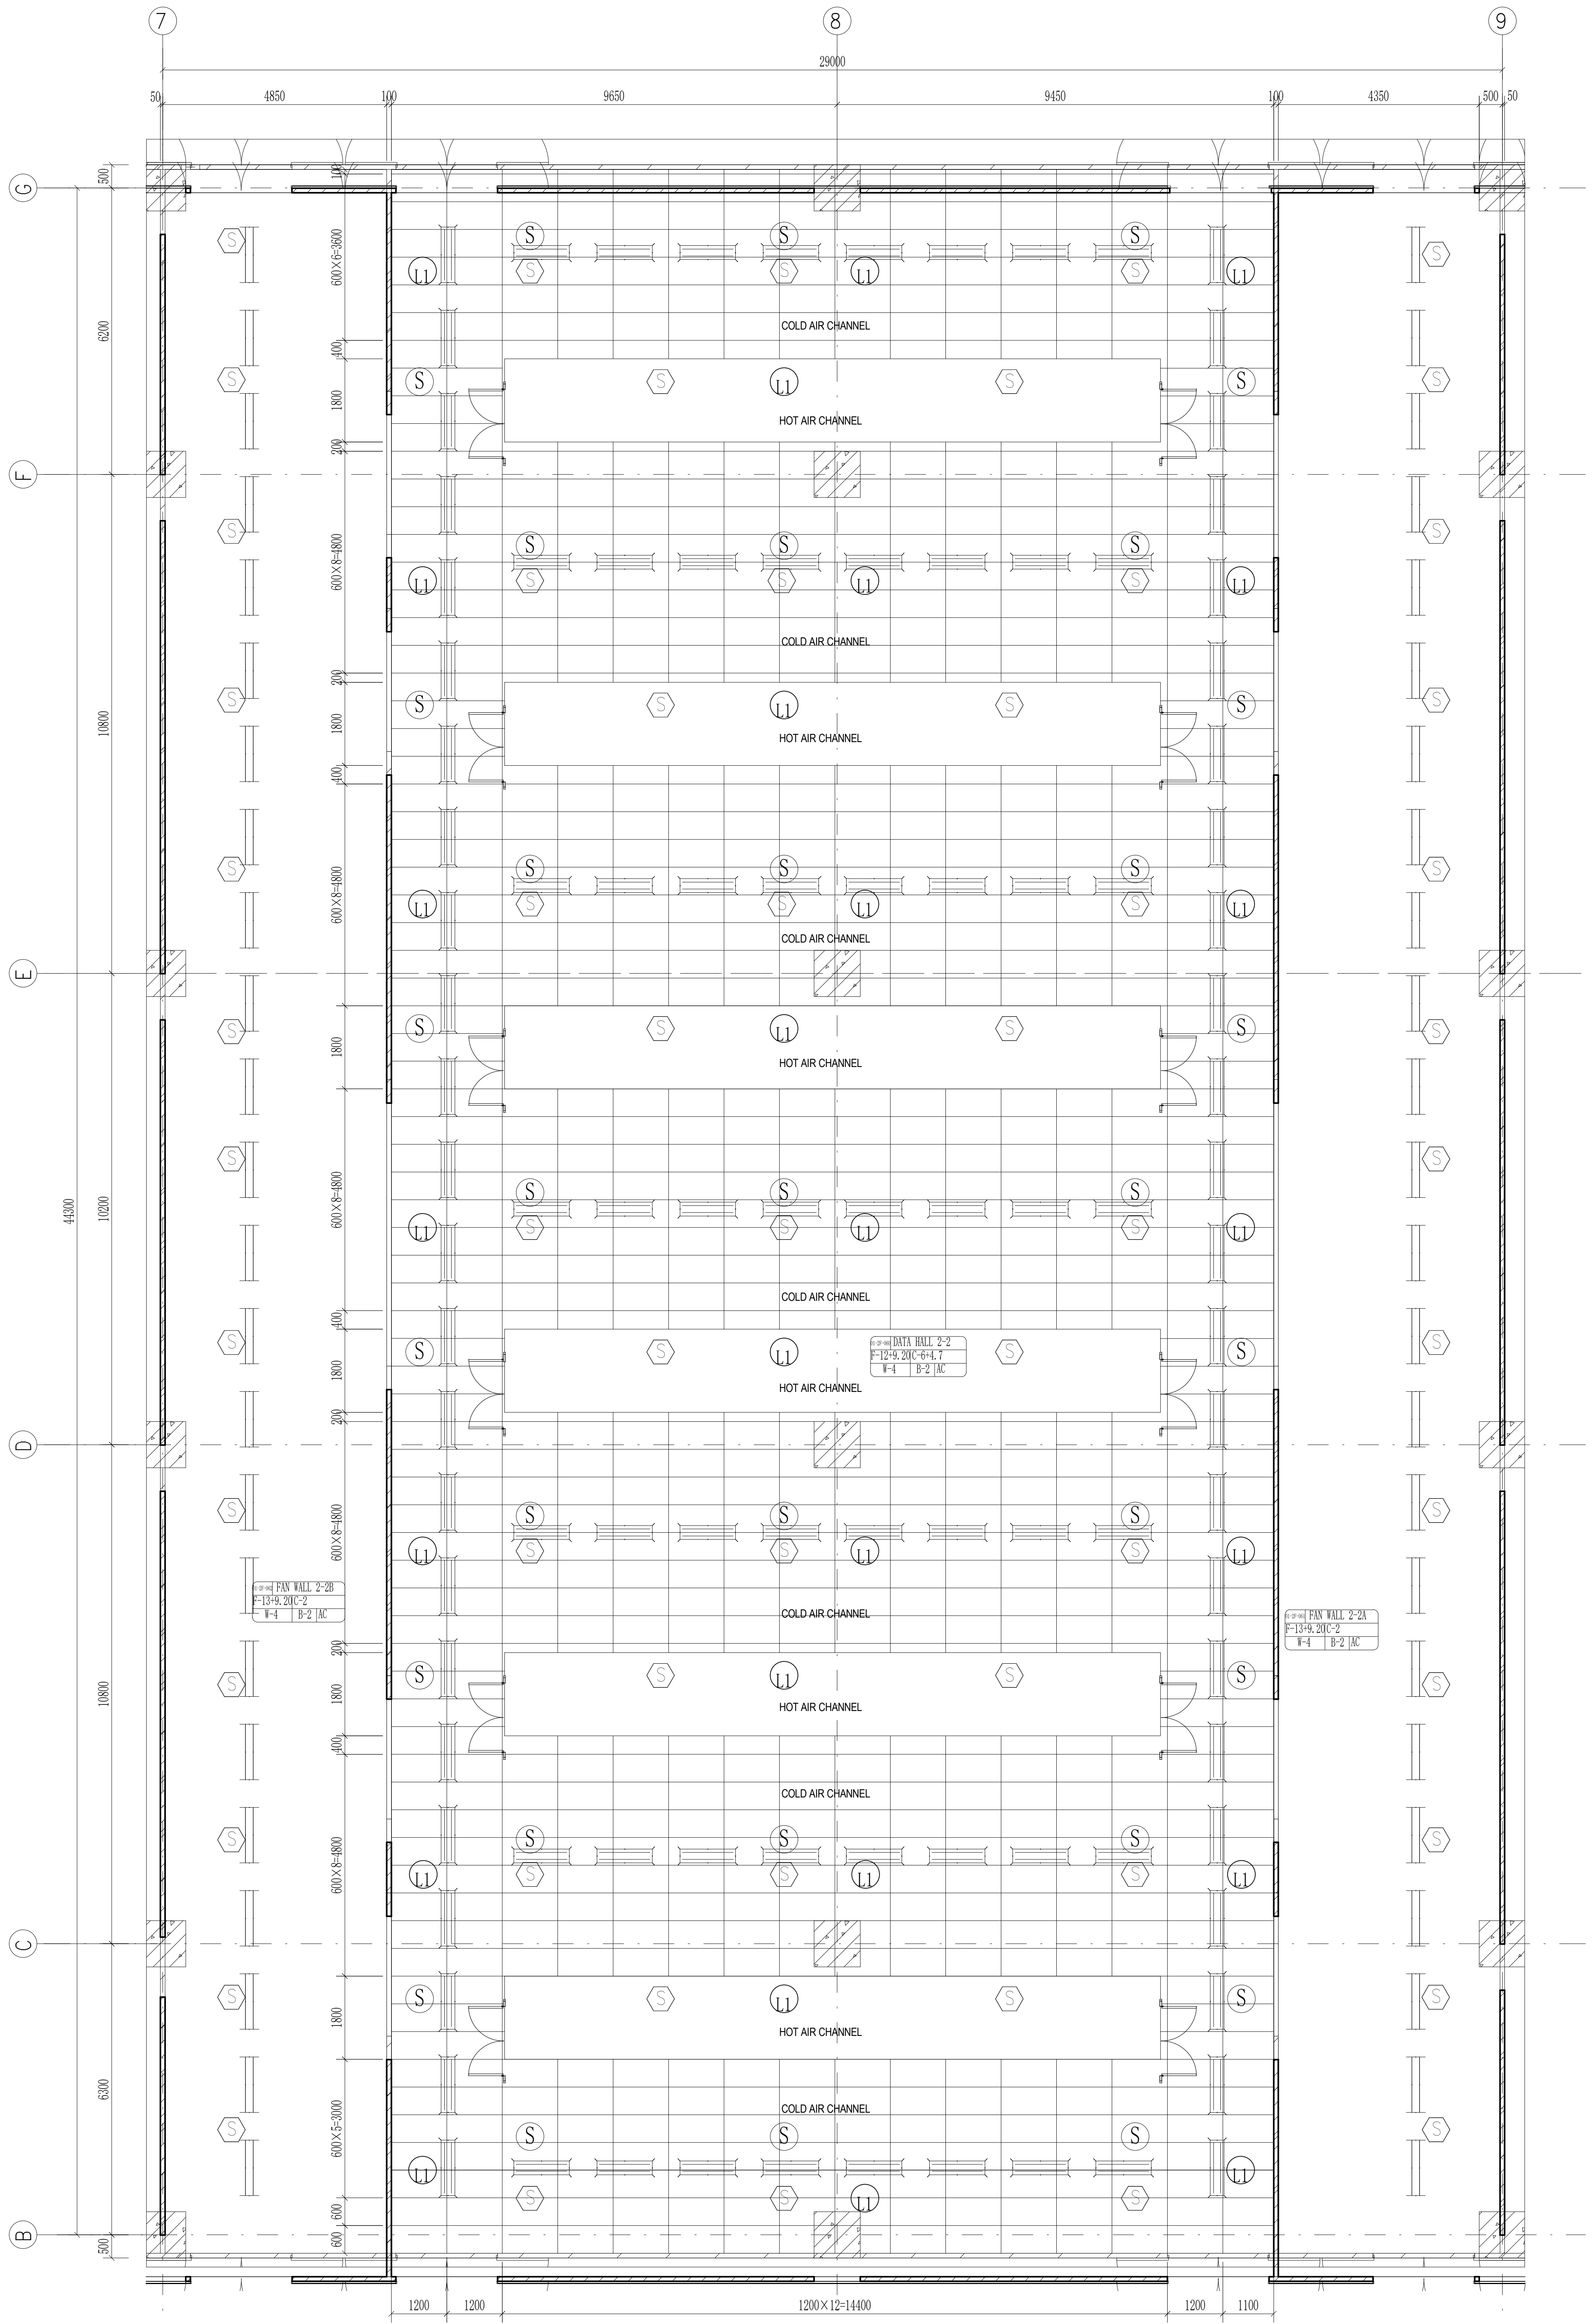

DH2-2 CEILING LAYOUT

Scale 1:75

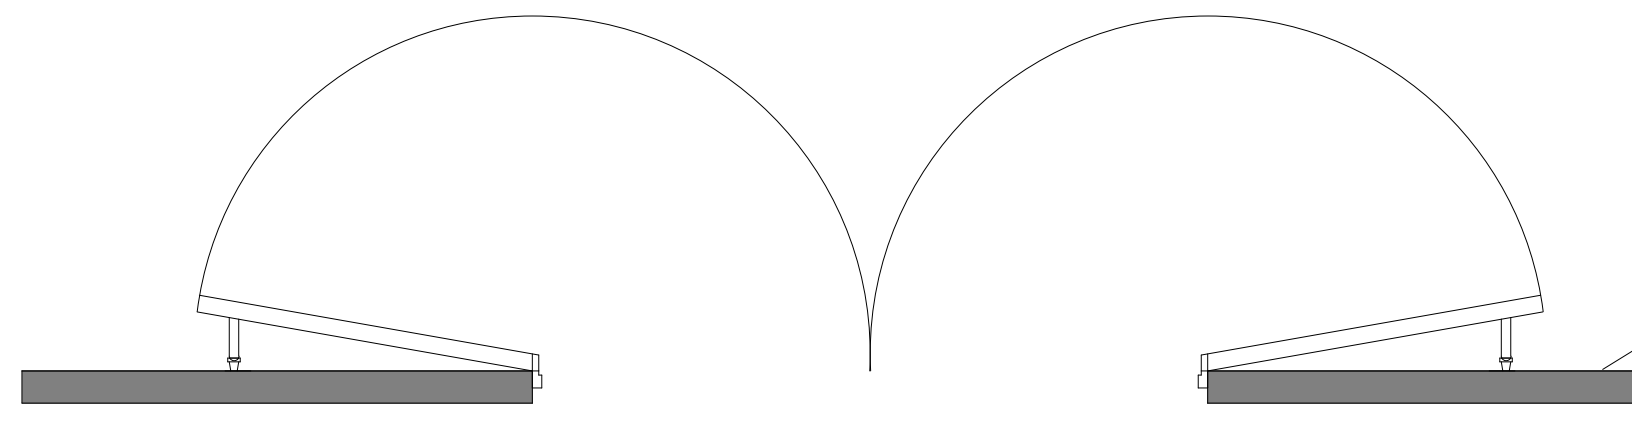

2MM THICK STAINLESS STEEL PROTECTIVE PLATE IS INSTALLED FROM THE GROUND UP TO A HEIGHT OF 1.5 METERS. DETAILED IFC STAGE NODE DETAIL DRAWING

DOOR STOPPER DETAIL

Scale 1:25

◀	FIRE ALARM SPEAKER WALL MOUNTED
☒	COMBINATION HORN/VISIBLE
○	SURFACE MOUNTED SMOKE DETECTOR, PHOTOELECTRIC TYPE
⬡	PHOTOELECTRIC SMOKE DETECTOR
▭	LED double tube lamp; Ceiling Mounted; System Power 2x20W (+/- 10% In Tolerance); System Lumens >2x2000lm (+/- 10% In Tolerance); Luminaire Efficacy >100lm/w; CCT 5000K; CRI>80; CPF>0.9; Input Voltage 220V-240V 50/60Hz (Mounting height 3.0m)
▭	LED double tube lamp; Ceiling Mounted; System Power 2x20W (+/- 10% In Tolerance); System Lumens >2x2000lm (+/- 10% In Tolerance); Luminaire Efficacy >100lm/w; CCT 5000K; CRI>80; CPF>0.9; Input Voltage 220V-240V 50/60Hz (Mounting height 3.0m)
F	ALARM BELL
○	CEILING SPEAKER

CLIENT :

GULF EDGE DC 01

87 Wireless Road, M Thai Tower 11th. Floor, All Seasons Place, Lumpini, Pathumwan, Bangkok 10330, Thailand

CONTRACTOR :

华西发展(泰国)有限公司
บริษัท หัวซือ ดีเวลลอปเม้นต์ (ประเทศไทย) จำกัด
HUASHI DEVELOPMENT CO.,LTD
No. 202, Room No. 1403, 14/F, Le Concorde Building,
Ratchadapisek Road, Huaykhwang Sub-District,
Huaykhwang District, Bangkok Metropolitan 10310.

CONSULTANT :

ARbay
บริษัท เอ อาร์ เบย์ จำกัด
ARbay Company Limited
31 st Floor Bangkok Insurance Building
25 South Sathorn road Thungmahamek
Sathorn Bangkok 10120 THAILAND
T +66 (0) 2286 8199
F +66 (0) 2286 2863
info@arbay.co.th

CONSULTANT :

Qbic Engineers & Architects Co.,Ltd.
8 Soi KALONG 4 SANAMBINNAM ROAD,
THASAI SUB-DISTRICT, MUANG NONTHABURI DISTRICT
, NONTHABURI.
Tel 662-950-4374
Fax 662-580-3231
E-Mail : qbic@qbic.co.th, www.qbic.co.th
QBIC ENGINEERS AND ARCHITECTS CO.,LTD.

CONSULTANT :

MITR
MITR TECHNICAL CONSULTANT CO.,LTD.
1168/8 12th FLOOR, LUMPINI TOWER BUILDING,
RAMA IV RD., THUNGMAHAMEK, SATHORN, BANGKOK 10120, THAILAND
TEL : 0-2679-9079-84
FAX : 0-2679-9085 E-mail: mitr_dd@mitr.com

Architect :	SIGNATURE
ประกิต พนานุรัตน์ วสถ. 580 ที่อยู่ 251/1 ถ.จารุเมือง แขวงรองเมือง เขตปทุมวัน กรุงเทพมหานคร โทรศัพท์ 02-286-8199	
Structural Engineer :	SIGNATURE
วิศวกรผู้ออกแบบโครงสร้าง	
ณัฐสม สงวนวงษ์ วย 1423 ที่อยู่ 2/1 ซ.รามคำแหง 150 ถ.รามคำแหง แขวง สะพานสูง เขต สะพานสูง กทม. 10240	ณัฐสม สงวนวงษ์
Structural Inspector :	SIGNATURE
วิศวกรผู้ตรวจสอบโครงสร้าง	
โกมล จุฑาภัทร วย 964 ที่อยู่ 24/18 ซ.นวมินทร์ 129 ถ. นวมินทร์ แขวง นวลจันทร์ เขต บึงกุ่ม กทม. 10230	
Electrical Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบไฟฟ้ากำลัง	
นายสุภัทร บูรณวิทย์ วฟก.1265 ที่อยู่ 21 ซอยทานสัมฤทธิ์ 13 ตำบลท่าทราย อ.เมืองนนทบุรี จ.นนทบุรี 11000	สุภัทร บูรณวิทย์
Mechanical Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบเครื่องกลและปรับอากาศ	
นายประสิทธิ์ เกี๋ยวสุนทร วก.1221 ที่อยู่ 44/372 ซอยบางกระดี่ 35/1 แขวงแสมดำ เขตบางขุนเทียน กทม. 10150	ประสิทธิ์
Sanitary Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบสุขาภิบาล และดับเพลิง	
นายทศวรรษ สนั่นฤทธิ์ วส. 215 ที่อยู่ บ้านเลขที่ 99/107 หมู่ที่ 3 ต.ศีรษะจรเข้น้อย อ.บางเสาธง จ.สมุทรปราการ 10540	ทศวรรษ

ISSUE/REVISION

REV.	DESCRIPTION	DATE
A	90% DEVELOPED	09/05/2026

PROJECT NAME :
GEDC 01

LOCATION:
Nikhom Phattana district, Rayong ,industrial estate,CPGC

BUILDING :
MAIN BUILDING

90% DEVELOPED

TITLE :
ROOM DETAIL-2F-DATAHALL2-2(LC)
FANWALLROOM 2-2A,2-2B PLAN

JOB NO.		SCALE	1 : 75
DRAWN	作者	REF.	
CHECKED	审图员	DWG. NO.	MPK01A-90-A-RD-203
APPROVED	审核者		
DATE	2026.05.09		

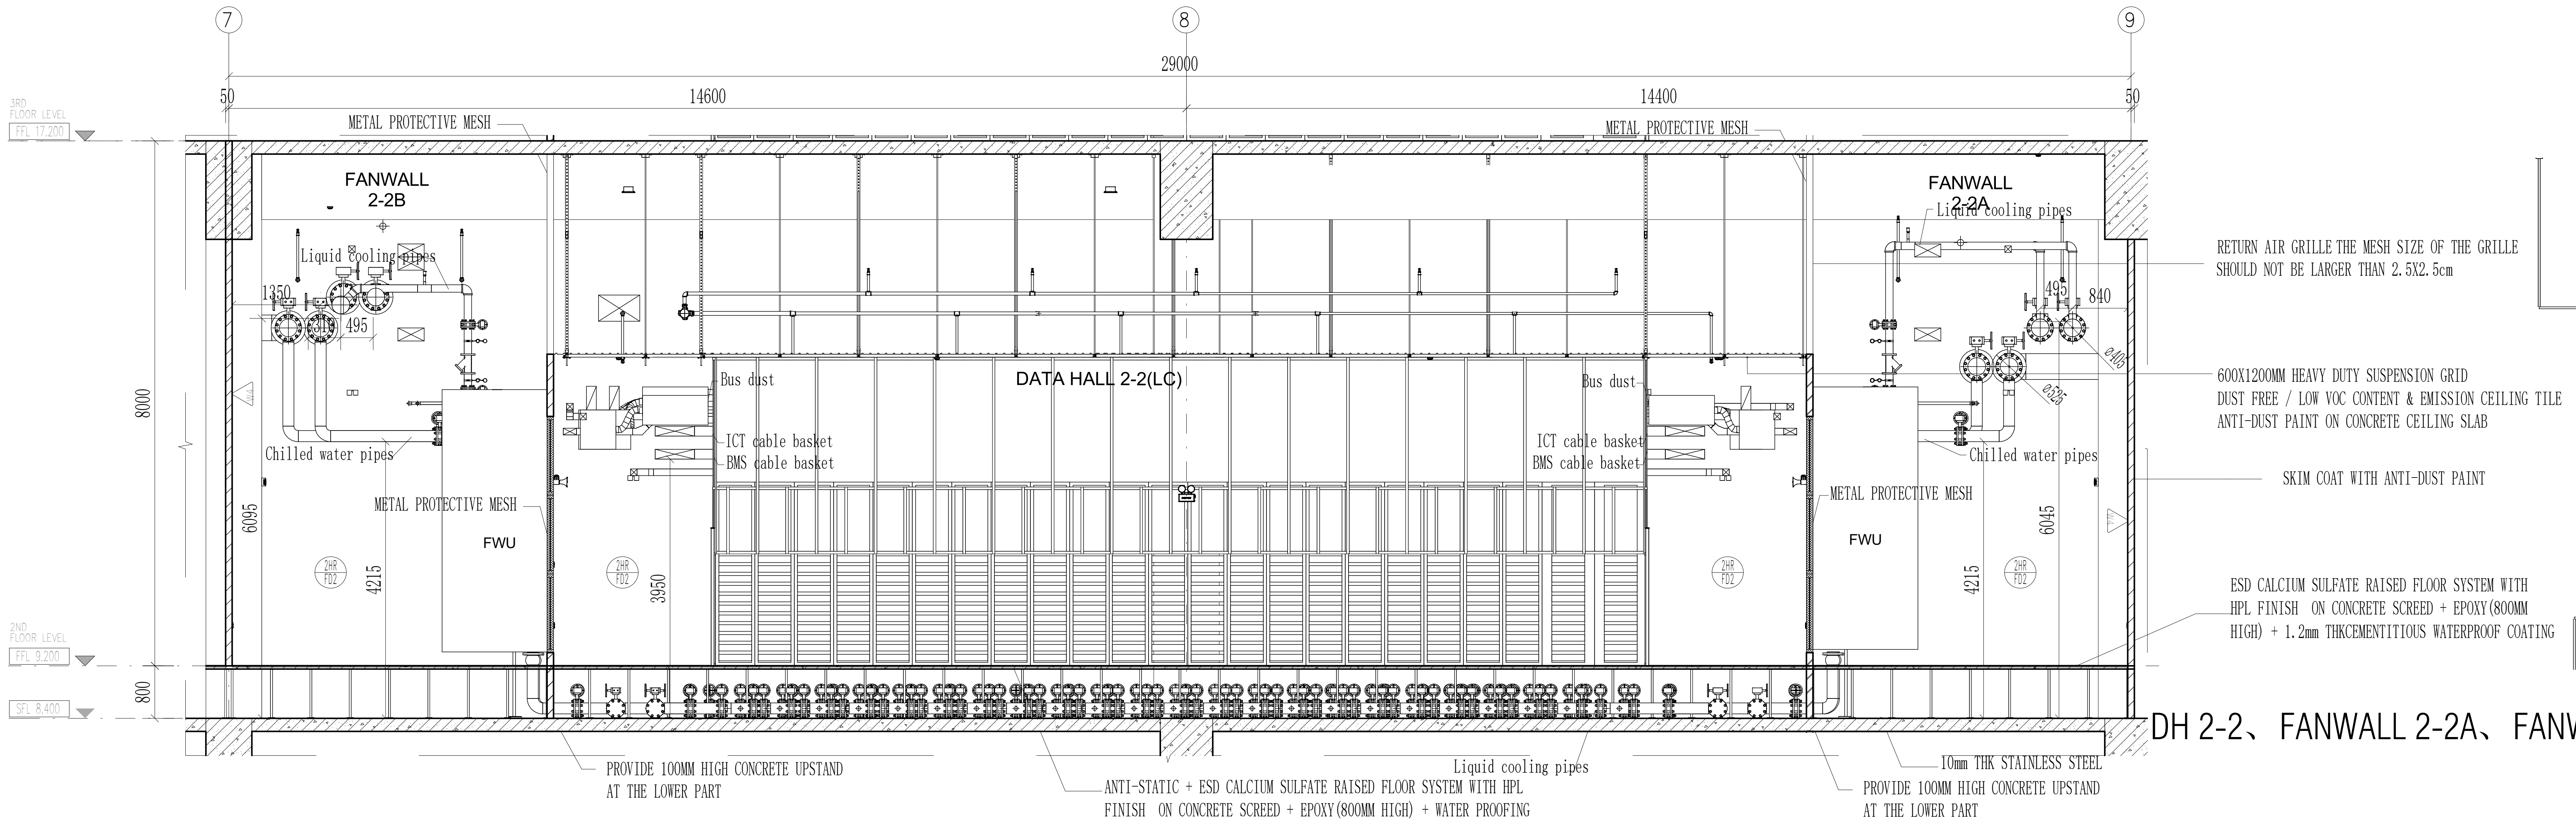
7
8
9
29000
50
14600
14400
50
3RD FLOOR LEVEL
FFL 17.200
2ND FLOOR LEVEL
FFL 9.200
SFL 8.400
METAL PROTECTIVE MESH
METAL PROTECTIVE MESH
FANWALL 2-2B
FANWALL 2-2A
Liquid cooling pipes
Liquid cooling pipes
1350
495
495
840
Ø405
Ø525
Bus dust
Bus dust
DATA HALL 2-2(LC)
ICT cable basket
BMS cable basket
ICT cable basket
BMS cable basket
Chilled water pipes
Chilled water pipes
METAL PROTECTIVE MESH
METAL PROTECTIVE MESH
FWU
FWU
8000
6095
4215
3950
4215
6045
800
2HR FD2
RETURN AIR GRILLE THE MESH SIZE OF THE GRILLE SHOULD NOT BE LARGER THAN 2.5X2.5cm
600X1200MM HEAVY DUTY SUSPENSION GRID DUST FREE / LOW VOC CONTENT & EMISSION CEILING TILE ANTI-DUST PAINT ON CONCRETE CEILING SLAB
SKIM COAT WITH ANTI-DUST PAINT
ESD CALCIUM SULFATE RAISED FLOOR SYSTEM WITH HPL FINISH ON CONCRETE SCREED + EPOXY(800MM HIGH) + 1.2mm THKCEMENTITIOUS WATERPROOF COATING
PROVIDE 100MM HIGH CONCRETE UPSTAND AT THE LOWER PART
ANTI-STATIC + ESD CALCIUM SULFATE RAISED FLOOR SYSTEM WITH HPL FINISH ON CONCRETE SCREED + EPOXY(800MM HIGH) + WATER PROOFING
Liquid cooling pipes
10mm THK STAINLESS STEEL
PROVIDE 100MM HIGH CONCRETE UPSTAND AT THE LOWER PART

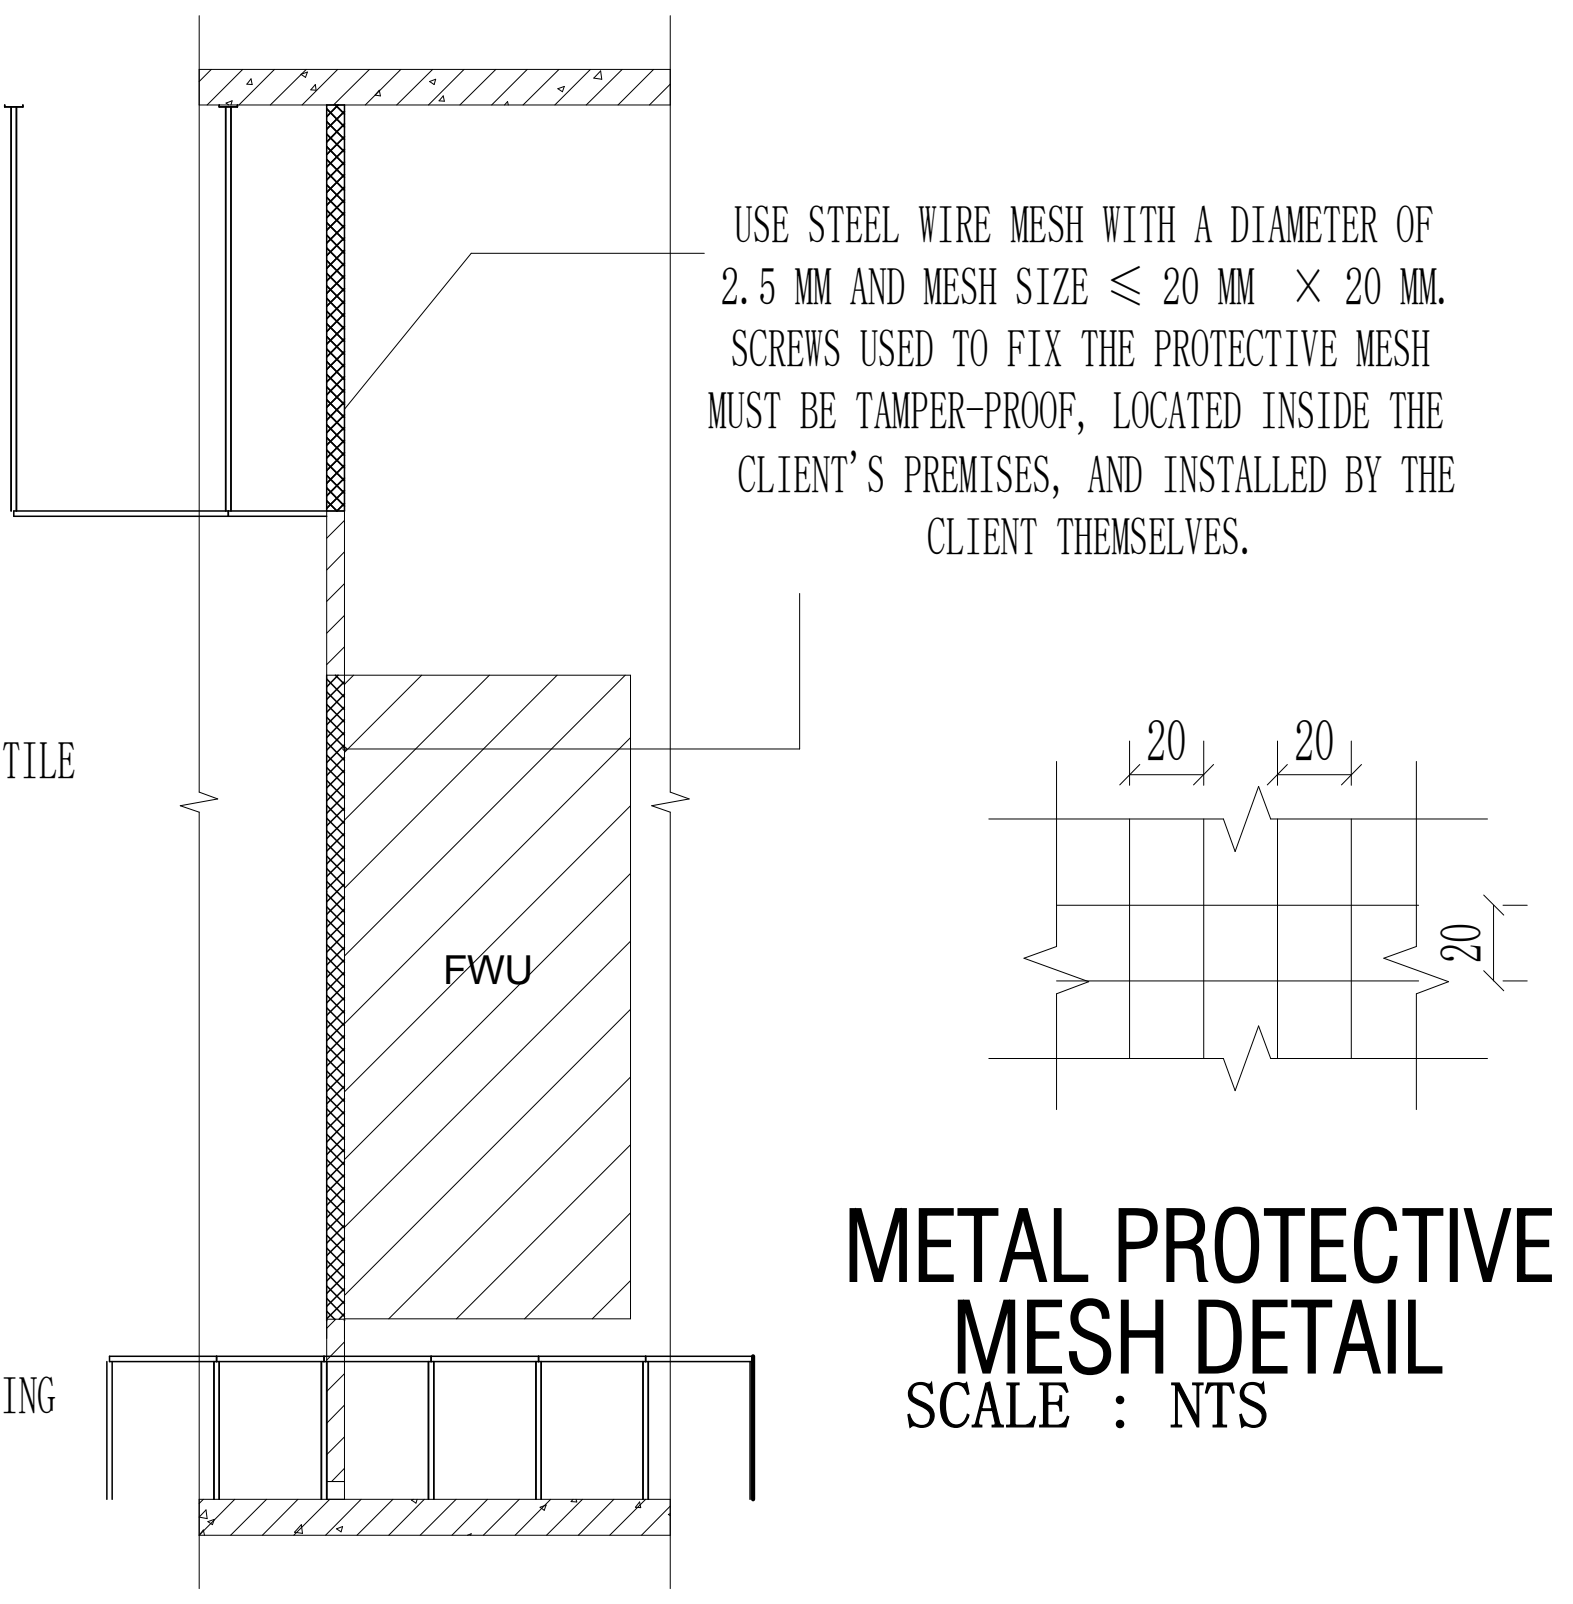
USE STEEL WIRE MESH WITH A DIAMETER OF 2.5 MM AND MESH SIZE ≤ 20 MM × 20 MM. SCREWS USED TO FIX THE PROTECTIVE MESH MUST BE TAMPER-PROOF, LOCATED INSIDE THE CLIENT'S PREMISES, AND INSTALLED BY THE CLIENT THEMSELVES.
FWU
20
20
20

METAL PROTECTIVE MESH DETAIL

SCALE : NTS

DH 2-2、FANWALL 2-2A、FANWALL 2-2B SECTION A-A

Scale 1:50

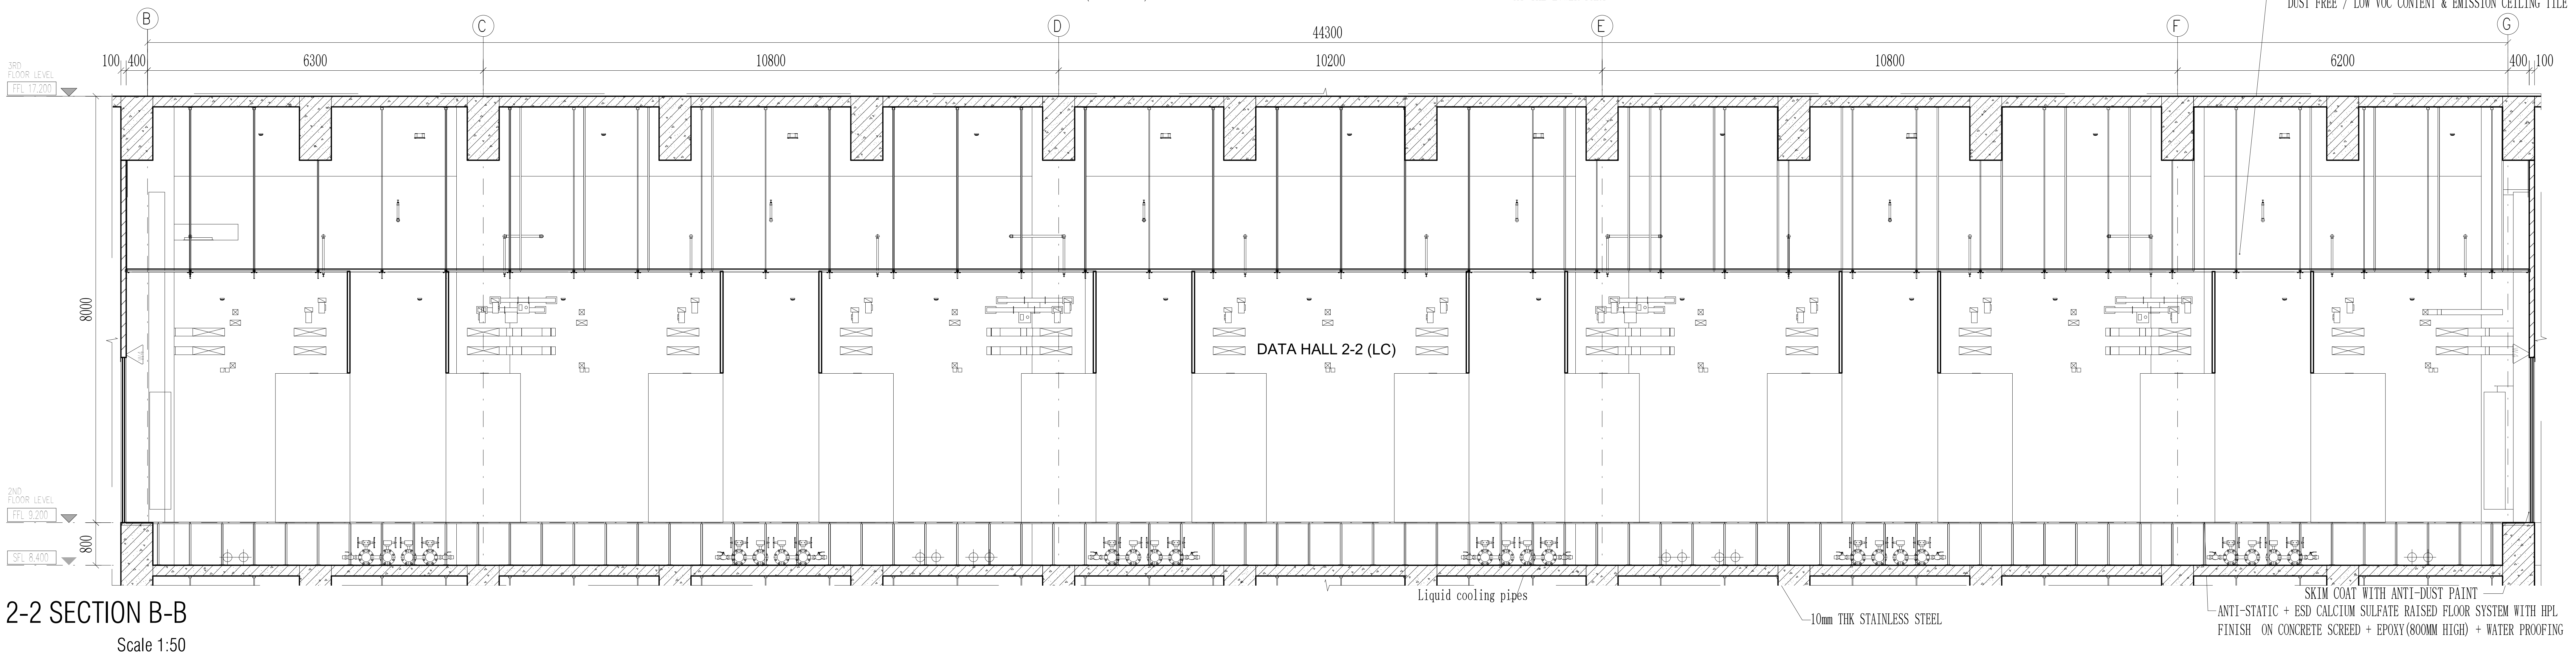
600X1200MM HEAVY DUTY SUSPENSION GRID DUST FREE / LOW VOC CONTENT & EMISSION CEILING TILE
B
C
D
E
F
G
44300
100
400
6300
10800
10200
10800
6200
400
100
3RD FLOOR LEVEL
FFL 17.200
2ND FLOOR LEVEL
FFL 9.200
SFL 8.400
8000
800
DATA HALL 2-2 (LC)
Liquid cooling pipes
10mm THK STAINLESS STEEL
SKIM COAT WITH ANTI-DUST PAINT
ANTI-STATIC + ESD CALCIUM SULFATE RAISED FLOOR SYSTEM WITH HPL FINISH ON CONCRETE SCREED + EPOXY(800MM HIGH) + WATER PROOFING

DH 2-2 SECTION B-B

Scale 1:50

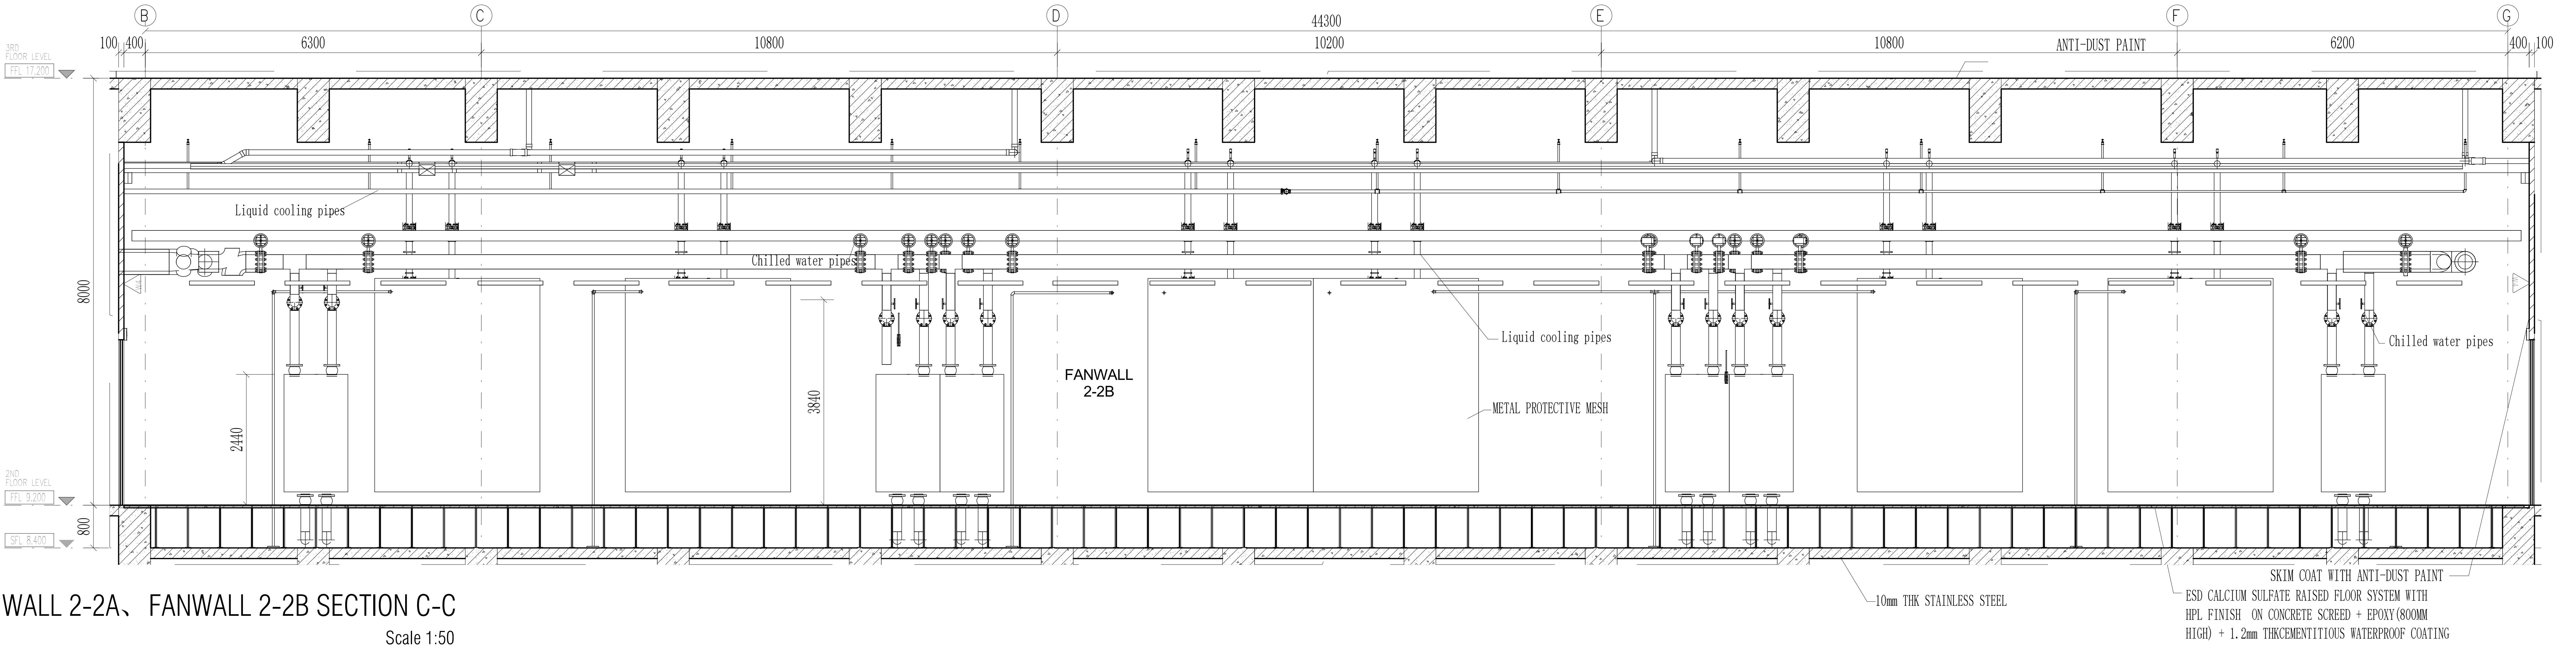

FANWALL 2-2A、FANWALL 2-2B SECTION C-C

Scale 1:50

CLIENT :

GULF EDGE DC 01

87 Wireless Road, M Thai Tower 11th. Floor, All Seasons Place, Lumpini,
Pathumwan, Bangkok 10330, Thailand

CONTRACTOR :

华西发展(泰国)有限公司
บริษัท หัวซือ ดีเวลลอปเม้นต์ (ประเทศไทย) จำกัด
HUASHI DEVELOPMENT CO.,LTD
No. 202, Room No. 1403, 14/F, Le Concorde Building,
Ratchadapisek Road, Huaykhwang Sub-District,
Huaykhwang District, Bangkok Metropolitan 10310.

CONSULTANT :

ARbay
บริษัท เอ อาร์ เบย์ จำกัด
ARbay Company Limited
31 st Floor Bangkok Insurance Building
25 South Sathorn road Thungmahamek
Sathorn Bangkok 10120 THAILAND
T +66 (0) 2286 8199
F +66 (0) 2286 2863
info@arbay.co.th

CONSULTANT :

Qbic Engineers & Architects Co.,Ltd.
8 Soi KALONG 4 SANAMBINNAM ROAD,
THASAI SUB-DISTRICT, MUANG NONTHABURI DISTRICT
, NONTHABURI.
Tel 662-950-4374
Fax 662-580-3231
E-Mail : qbic@qbic.co.th, www.qbic.co.th
QBIC ENGINEERS AND ARCHITECTS CO.,LTD.

CONSULTANT :

MITR
MITR TECHNICAL CONSULTANT CO.,LTD.
1168/8 12th FLOOR, LUMPINI TOWER BUILDING,
RAMA IV RD., THUNGMAHAMEK, SATHORN, BANGKOK 10120, THAILAND
TEL : 0-2679-9079-84
FAX : 0-2679-9085 E-mail: mitr_dd@mitr.com

Architect :	SIGNATURE
ประกิต พนานุรัตน์ วสถ. 580 ที่อยู่ 251/1 ถ.จารุเมือง แขวงรองเมือง เขตปทุมวัน กรุงเทพมหานคร โทรศัพท์ 02-286-8199	
Structural Engineer :	SIGNATURE
วิศวกรผู้ออกแบบโครงสร้าง	
ณัฐสม สงวนวงษ์ วย 1423 ที่อยู่ 2/1 ซ.รามคำแหง 150 ถ.รามคำแหง แขวง สะพานสูง เขต สะพานสูง กทม. 10240	ณัฐสม สงวนวงษ์
Structural Inspector :	SIGNATURE
วิศวกรผู้ตรวจสอบโครงสร้าง	
โกมล จุฑาภัทร วย 964 ที่อยู่ 24/18 ซ.นวมินทร์ 129 ถ. นวมินทร์ แขวง นวลจันทร์ เขต บึงกุ่ม กทม. 10230	
Electrical Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบไฟฟ้ากำลัง	
นายสุภัทร บูรณวิทย์ วฟก.1265 ที่อยู่ 21 ซอยทานสัมฤทธิ์ 13 ตำบลท่าทราย อ.เมืองนนทบุรี จ.นนทบุรี 11000	สุภัทร
Mechanical Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบเครื่องกลและปรับอากาศ	
นายประสิทธิ์ เกี้ยวสุนทร วก.1221 ที่อยู่ 44/372 ซอยบางกระดี่ 35/1 แขวงแสมดำ เขตบางขุนเทียน กทม. 10150	ประสิทธิ์
Sanitary Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบสุขาภิบาล และดับเพลิง	
นายทศวรรษ สนั่นฤทธิ์ วส. 215 ที่อยู่ บ้านเลขที่ 99/107 หมู่ที่ 3 ต.ศีรษะจรเข้น้อย อ.บางเสาธง จ.สมุทรปราการ 10540	ทศวรรษ

ISSUE/REVISION

REV.	DESCRIPTION	DATE
A	90% DEVELOPED	09/05/2026

PROJECT NAME :

GEDC 01

LOCATION:
Nikhom Phattana district, Rayong ,industrial estate,CPGC

BUILDING :
MAIN BUILDING

90% DEVELOPED

TITLE :

ROOM DETAIL-2F-DATAHALL2-2(LC)
FANWALLROOM 2-2A,2-2B SECTION

JOB NO.	SCALE 1 : 50
DRAWN 作者	REF.
CHECKED 审图员	DWG. NO. MPK01A-90-A-RD-204
APPROVED 审核者	
DATE 2026.05.09	

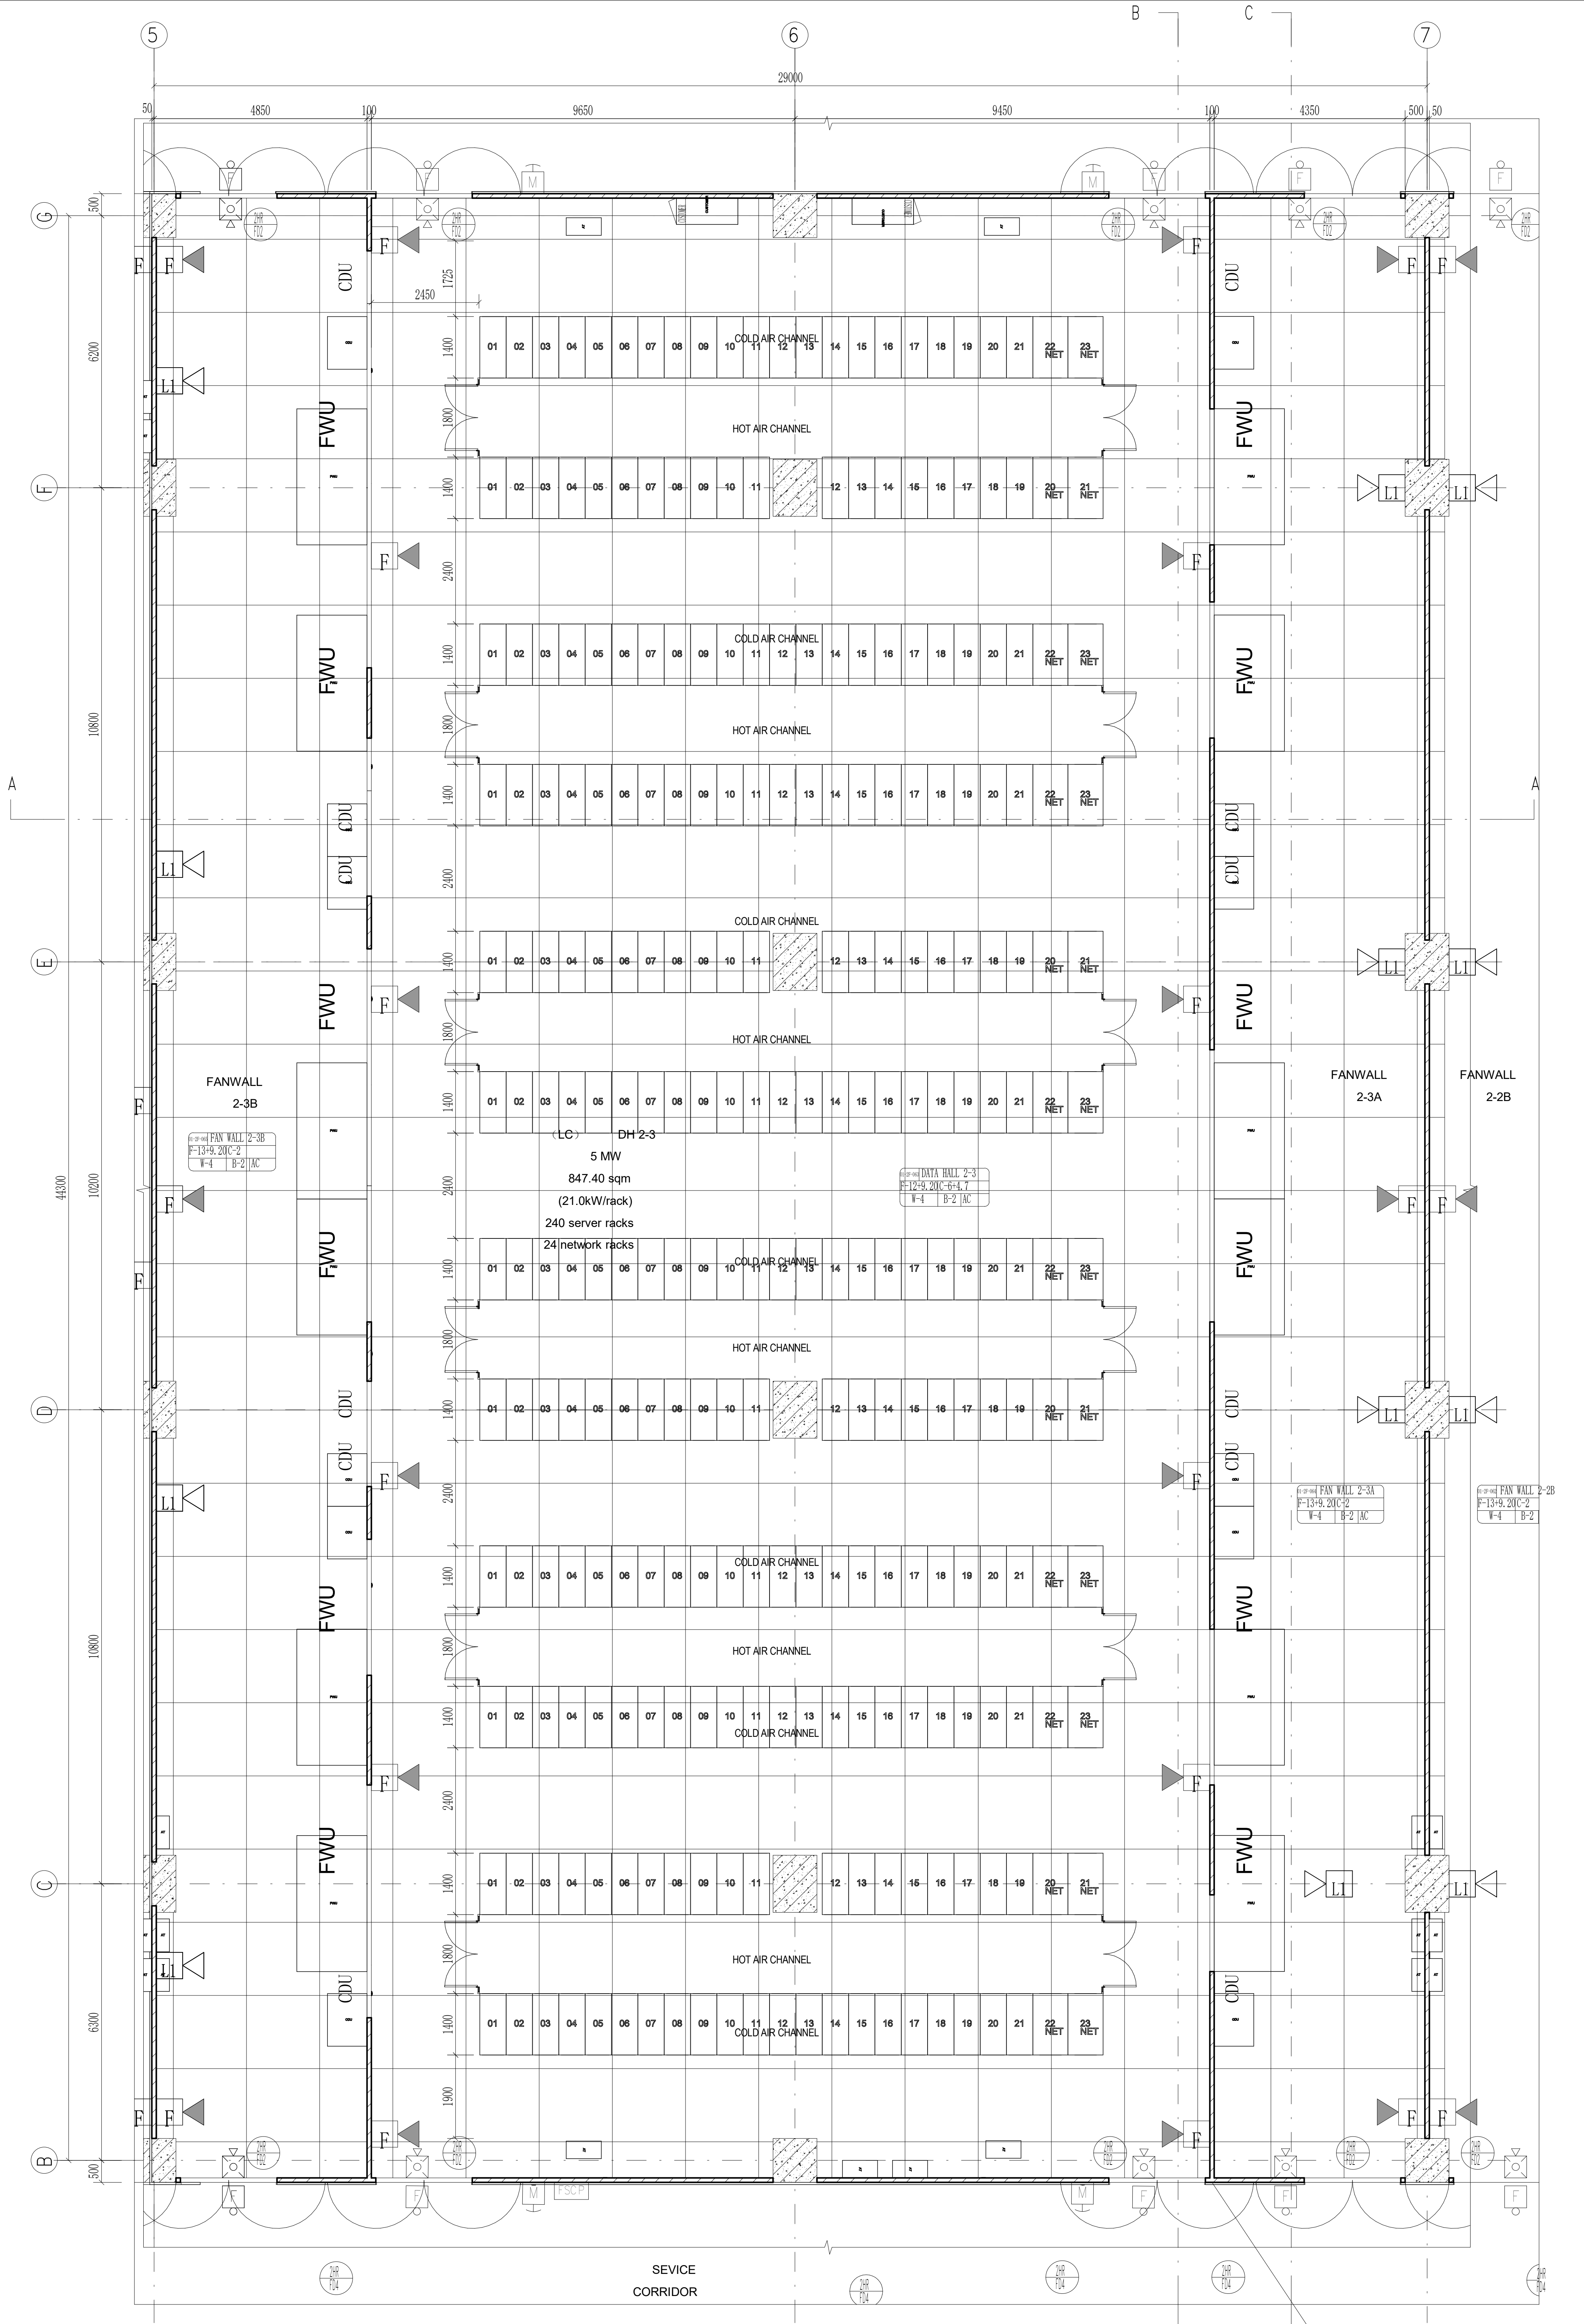

DH2-3、FAN WALL 2-3A、FAN WALL 2-3B FIRST FLOOR PLAN

Scale 1:75

THE "SFL" MARKED IN THE DRAWING REFERS TO THE STRUCTURAL FLOOR LEVEL, WHILE THE FINISHED FLOOR LEVEL (FFL) IS DETERMINED BASED ON FLOOR FINISHES.

PROVIDE 100MM HIGH CONCRETE UPSTAND AT THE LOWER PART

Room Number	Room Name	Room Type	0kW/RACK	12kW/RACK	16kW/RACK	21kW/RACK	Rack Count	Design IT Load（Mw）
01-2F-059	Data Hall2-3	Liquid-cooled	0	0	24	240	264	5

Note On Levels- All Levels Shown Are Absolute Elevation	
☒	0kW/RACK
▯	12kW/RACK
☒	16kW/RACK
▯	21kW/RACK

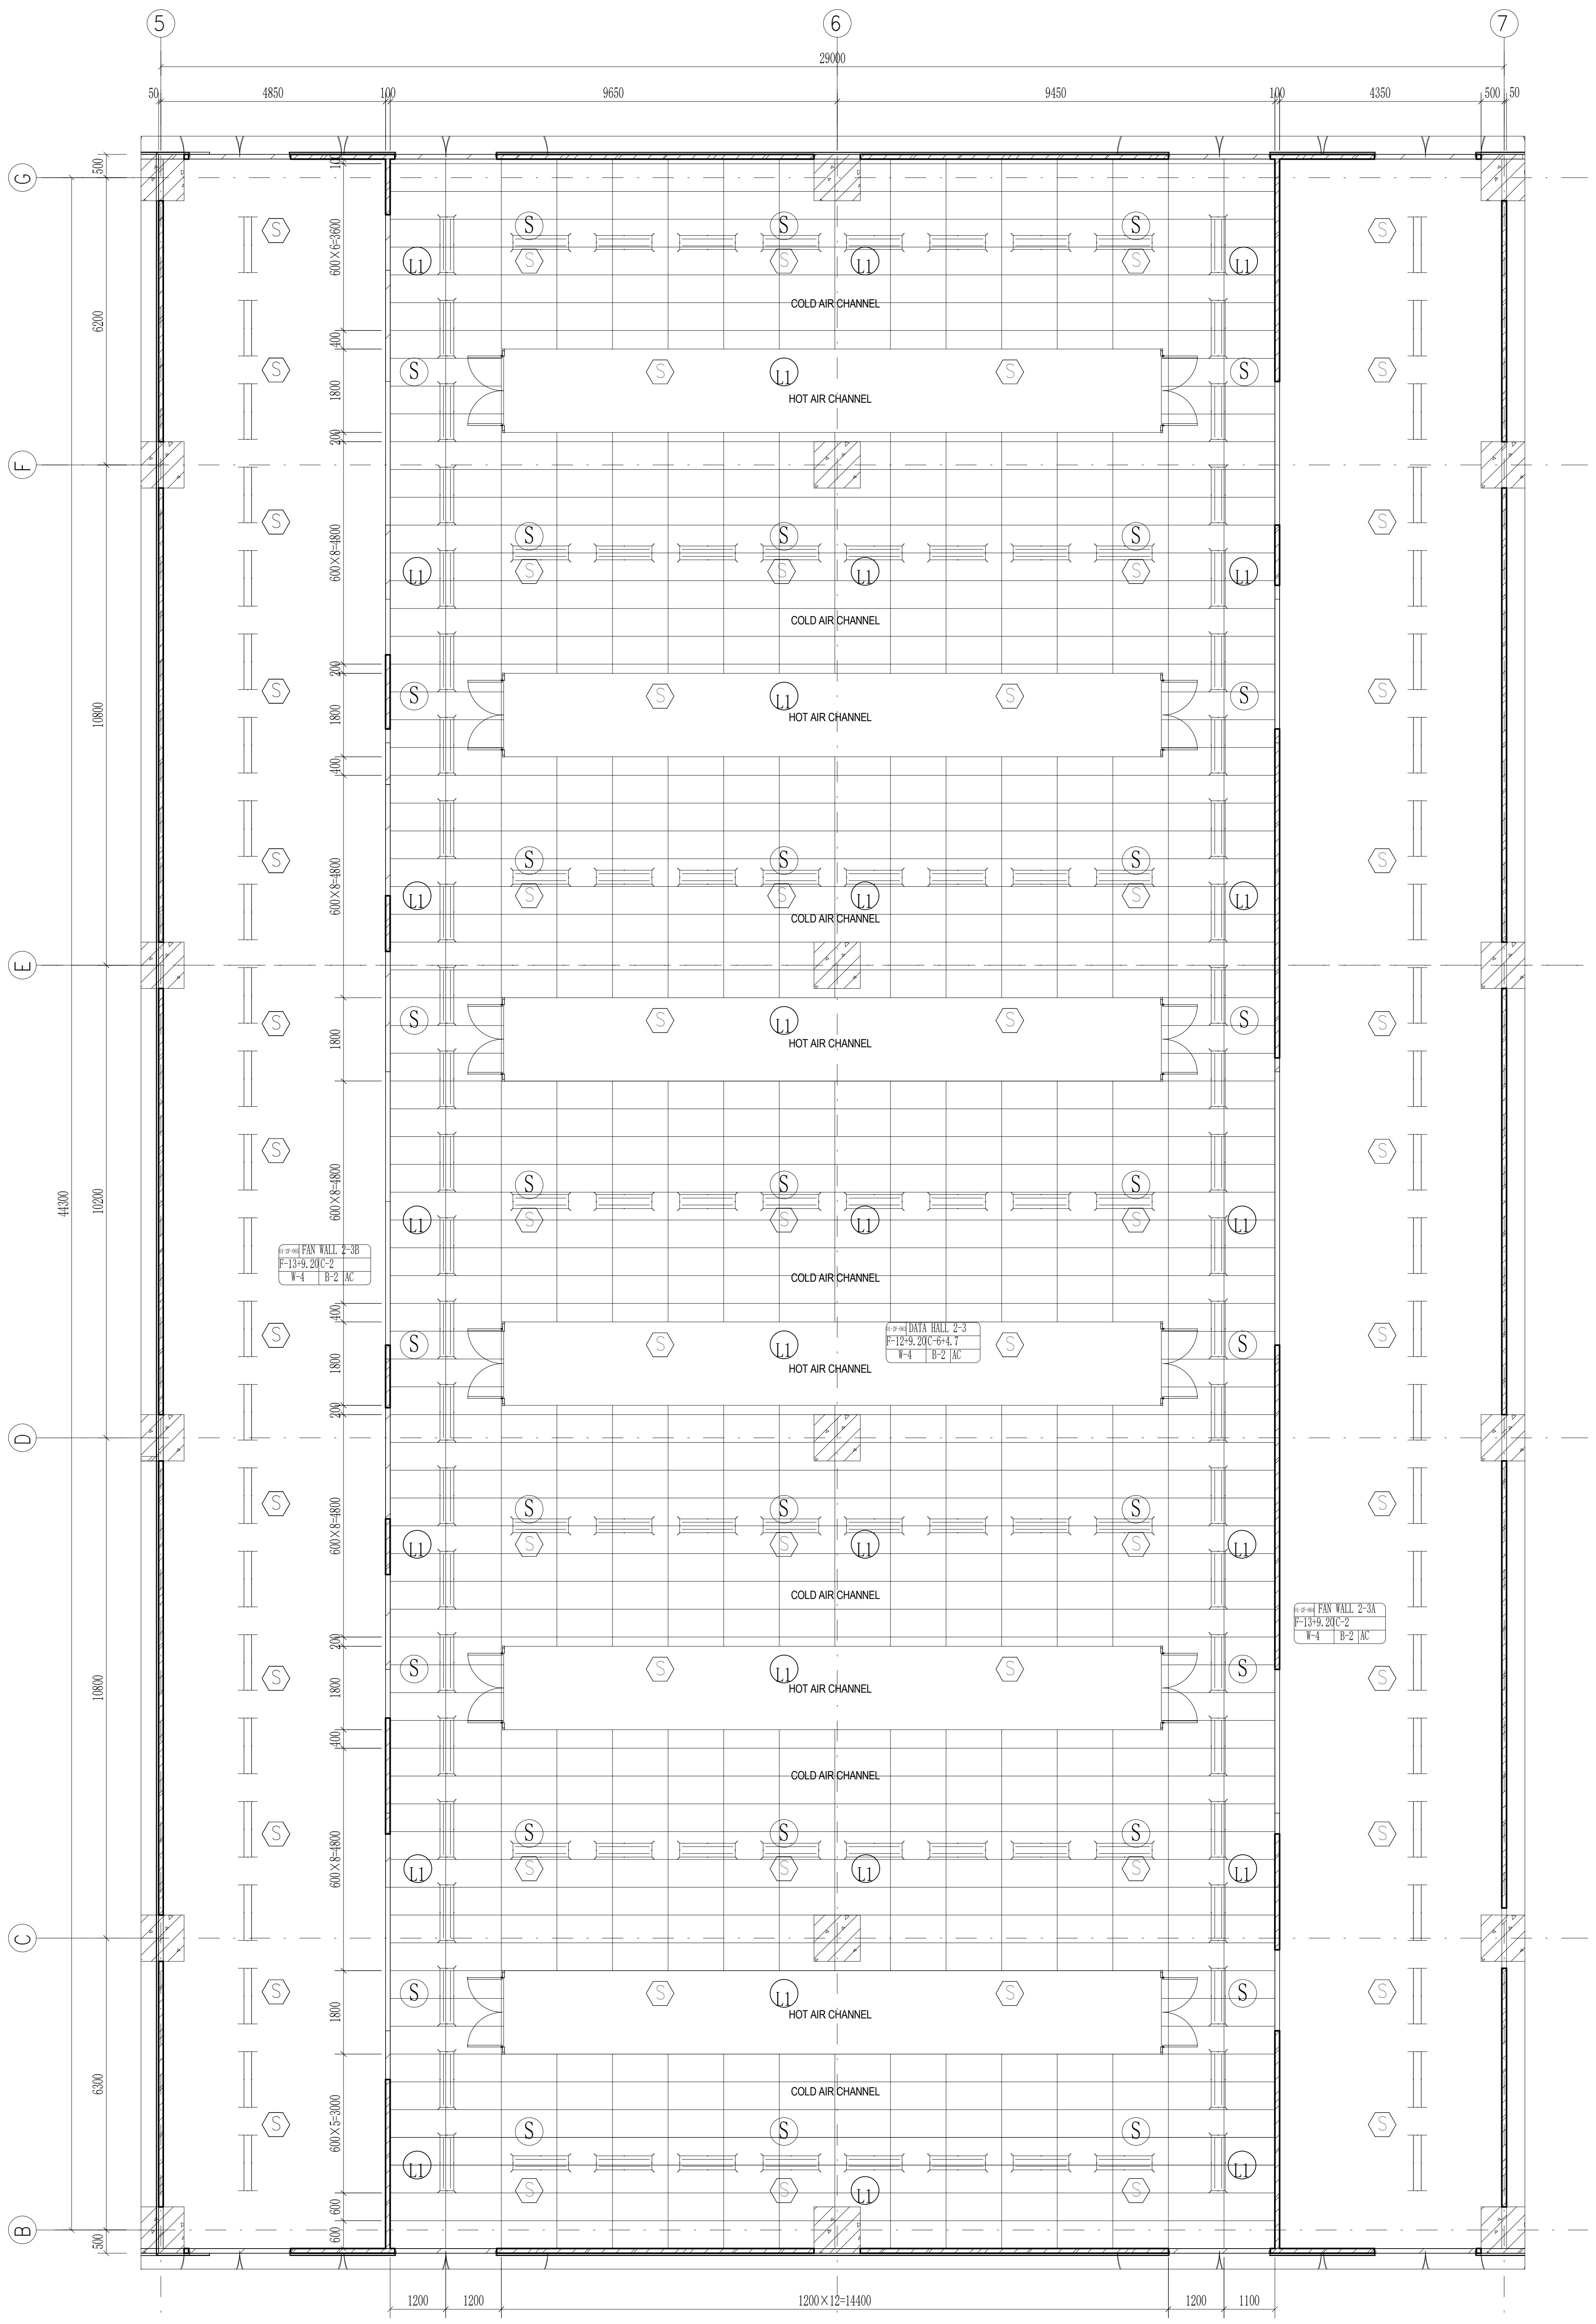

DH2-3 CEILING LAYOUT

Scale 1:75

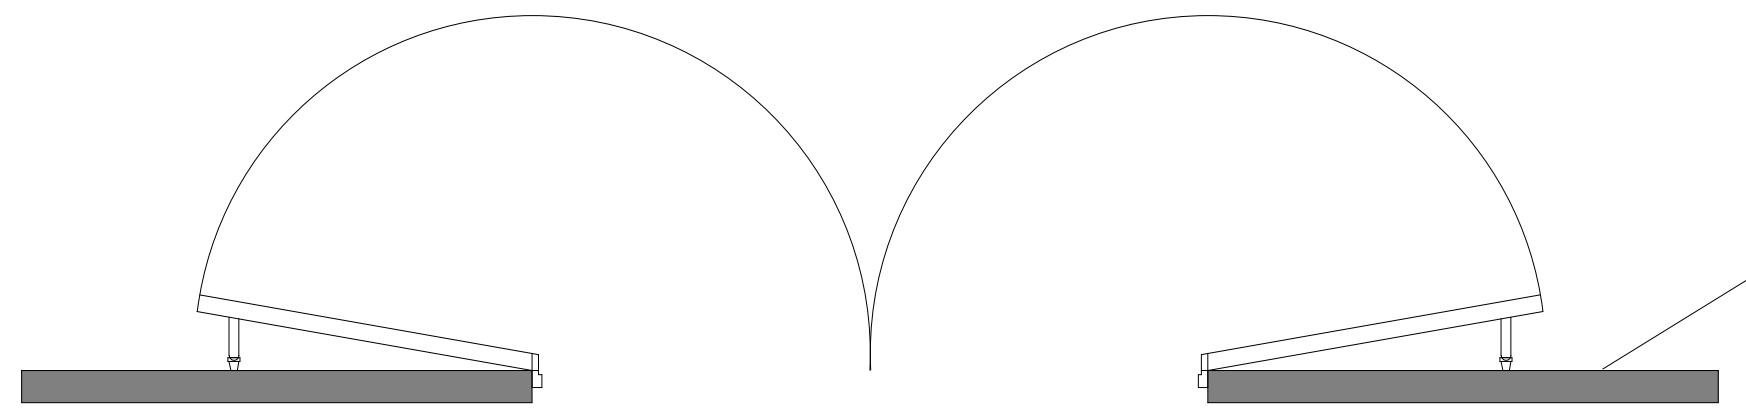

DOOR STOPPER
DETAILED IFC STAGE NODE DETAIL DRAWING

2MM THICK STAINLESS STEEL PROTECTIVE PLATE IS INSTALLED FROM THE GROUND UP TO A HEIGHT OF 1.5 METERS. DETAILED IFC STAGE NODE DETAIL DRAWING

DOOR STOPPER DETAIL

Scale 1:25

FIRE ALARM SPEAKER WALL MOUNTED

COMBINATION HORN/VISIBLE

SURFACE MOUNTED SMOKE DETECTOR, PHOTOELECTRIC TYPE

Ⓢ PHOTOELECTRIC SMOKE DETECTOR

LED double tube lamp; Ceiling Mounted; System Power 2x20W (+/-10% In Tolerance); System Lumens >2x2000lm (+/- 10% In Tolerance); Luminaire Efficacy >100lm/w; CCT 5000K; CRI>80; CPF>0.9; Input Voltage 220V-240V 50/60Hz (Mounting height 3.0m)

LED double tube lamp; Ceiling Mounted; System Power 2x20W (+/-10% In Tolerance); System Lumens >2x2000lm (+/- 10% In Tolerance); Luminaire Efficacy >100lm/w; CCT 5000K; CRI>80; CPF>0.9; Input Voltage 220V-240V 50/60Hz (Mounting height 3.0m)

F ALARM BELL

○ CEILING SPEAKER

CLIENT :

GULF EDGE DC 01

87 Wireless Road, M Thai Tower 11th. Floor, All Seasons Place, Lumpini, Pathumwan, Bangkok 10330, Thailand

CONTRACTOR :

华西发展(泰国)有限公司
บริษัท หัวซือ ดีเวลลอปเม้นต์ (ประเทศไทย) จำกัด
HUASHI DEVELOPMENT CO., LTD
No. 202, Room No. 1403, 14/F, Le Concorde Building,
Ratchadapisek Road, Huaykhwang Sub-District,
Huaykhwang District, Bangkok Metropolitan 10310.

CONSULTANT :

ARbay
บริษัท เอ อาร์ เบย์ จำกัด
ARbay Company Limited
31 st Floor Bangkok Insurance Building
25 South Sathorn road Thungmahamek
Sathorn Bangkok 10120 THAILAND
T +66 (0) 2286 8199
F +66 (0) 2286 2863
info@arbay.co.th

CONSULTANT :

Qbic Engineers & Architects Co.,Ltd.
8 Soi KALONG 4 SANAMBINNAM ROAD,
THASAI SUB-DISTRICT, MUANG NONTHABURI DISTRICT
, NONTHABURI.
Tel 662-950-4374
Fax 662-580-3231
E-Mail : qbic@qbic.co.th, www.qbic.co.th
QBIC ENGINEERS AND ARCHITECTS CO.,LTD.

CONSULTANT :

MITR
MITR TECHNICAL CONSULTANT CO.,LTD.
1168/8 12th FLOOR, LUMPINI TOWER BUILDING,
RAMA IV RD., THUNGMAHAMEK, SATHORN, BANGKOK 10120, THAILAND
TEL : 0-2679-9079-84
FAX : 0-2679-9085 E-mail: mitr_dd@mitr.com

Architect :	SIGNATURE
ประกิด พนานุรัตน์ วสถ. 580 ที่อยู่ 251/1 ถ.จารุเมือง แขวงรองเมือง เขตปทุมวัน กรุงเทพมหานคร โทรศัพท์ 02-286-8199	
Structural Engineer :	SIGNATURE
วิศวกรผู้ออกแบบโครงสร้าง	
ณัฐสม สงวนวงษ์ วย 1423 ที่อยู่ 2/1 ซ.รามคำแหง 150 ถ.รามคำแหง แขวง สะพานสูง เขต สะพานสูง กทม. 10240	ณัฐสม สงวนวงษ์
Structural Inspector :	SIGNATURE
วิศวกรผู้ตรวจสอบโครงสร้าง	
โกมล จุฑาภัทร วย 964 ที่อยู่ 24/18 ซ.นวมินทร์ 129 ถ. นวมินทร์ แขวง นวลจันทร์ เขต บึงกุ่ม กทม. 10230	
Electrical Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบไฟฟ้ากำลัง	
นายสุภัทร บูรณวิทย์ วฟก.1265 ที่อยู่ 21 ซอยทานสัมฤทธิ์ 13 ตำบลท่าทราย อ.เมืองนนทบุรี จ.นนทบุรี 11000	
Mechanical Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบเครื่องกลและปรับอากาศ	
นายประสิทธิ์ เกี้ยวสุนทร วก.1221 ที่อยู่ 44/372 ซอยบางกระดี่ 35/1 แขวงแสมดำ เขตบางขุนเทียน กทม. 10150	ประสิทธิ์
Sanitary Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบสุขาภิบาล และดับเพลิง	
นายทศวรรษ สนั่นฤทธิ์ วส. 215 ที่อยู่ บ้านเลขที่ 99/107 หมู่ที่ 3 ต.ศีรษะจรเข้น้อย อ.บางเสาธง จ.สมุทรปราการ 10540	ทศวรรษ

ISSUE/REVISION

REV.	DESCRIPTION	DATE
A	90% DEVELOPED	09/05/2026

PROJECT NAME :

GEDC 01

LOCATION:
Nikhom Phattana district, Rayong , industrial estate,CPGC

BUILDING :
MAIN BUILDING

90% DEVELOPED

TITLE :

ROOM DETAIL-2F-DATAHALL2-3(LC) ,
FAN WALLROOM 2-3A,2-3B PLAN

JOB NO.		SCALE	1 : 75
DRAWN	作者	REF.	
CHECKED	审图员	DWG. NO.	MPK01A-90-A-RD-205
APPROVED	审核者		
DATE	2026.05.09		

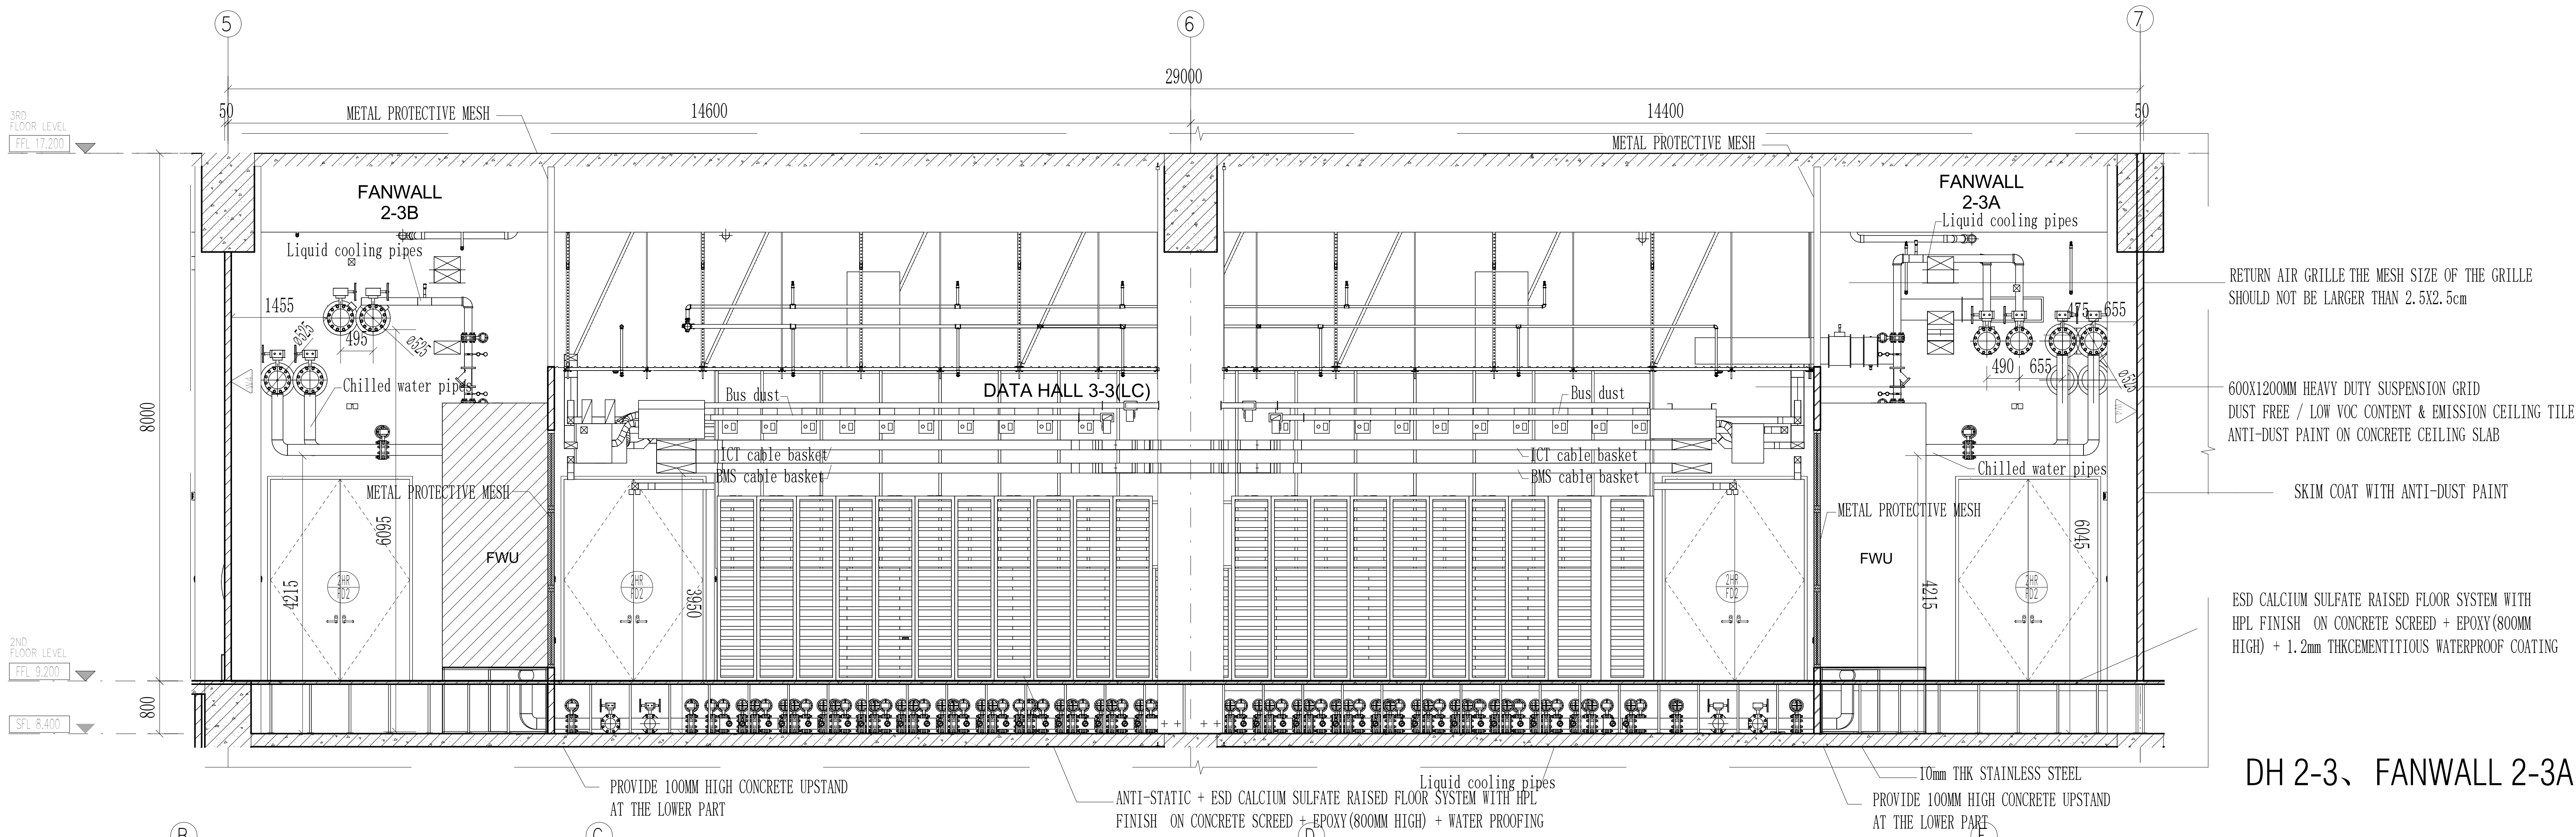
5
6
7
29000
50
14600
14400
50
METAL PROTECTIVE MESH
METAL PROTECTIVE MESH
3RD FLOOR LEVEL
FFL 17.200
2ND FLOOR LEVEL
FFL 9.200
SFL 8.400
8000
800
FANWALL 2-3B
Liquid cooling pipes
1455
495
Ø525
Chilled water pipes
METAL PROTECTIVE MESH
6095
4215
FWU
2HR FD2
3950
DATA HALL 3-3(LC)
Bus dust
ICT cable basket
BMS cable basket
FANWALL 2-3A
Liquid cooling pipes
475
655
490
655
Chilled water pipes
METAL PROTECTIVE MESH
FWU
4215
6045
RETURN AIR GRILLE THE MESH SIZE OF THE GRILLE SHOULD NOT BE LARGER THAN 2.5X2.5cm
600X1200MM HEAVY DUTY SUSPENSION GRID
DUST FREE / LOW VOC CONTENT & EMISSION CEILING TILE
ANTI-DUST PAINT ON CONCRETE CEILING SLAB
SKIM COAT WITH ANTI-DUST PAINT
ESD CALCIUM SULFATE RAISED FLOOR SYSTEM WITH HPL FINISH ON CONCRETE SCREED + EPOXY(800MM HIGH) + 1.2mm THKCEMENTITIOUS WATERPROOF COATING
PROVIDE 100MM HIGH CONCRETE UPSTAND AT THE LOWER PART
ANTI-STATIC + ESD CALCIUM SULFATE RAISED FLOOR SYSTEM WITH HPL FINISH ON CONCRETE SCREED + EPOXY(800MM HIGH) + WATER PROOFING
Liquid cooling pipes
10mm THK STAINLESS STEEL
PROVIDE 100MM HIGH CONCRETE UPSTAND AT THE LOWER PART

DH 2-3、FANWALL 2-3A、FANWALL 2-3B SECTION A-A

Scale 1:50

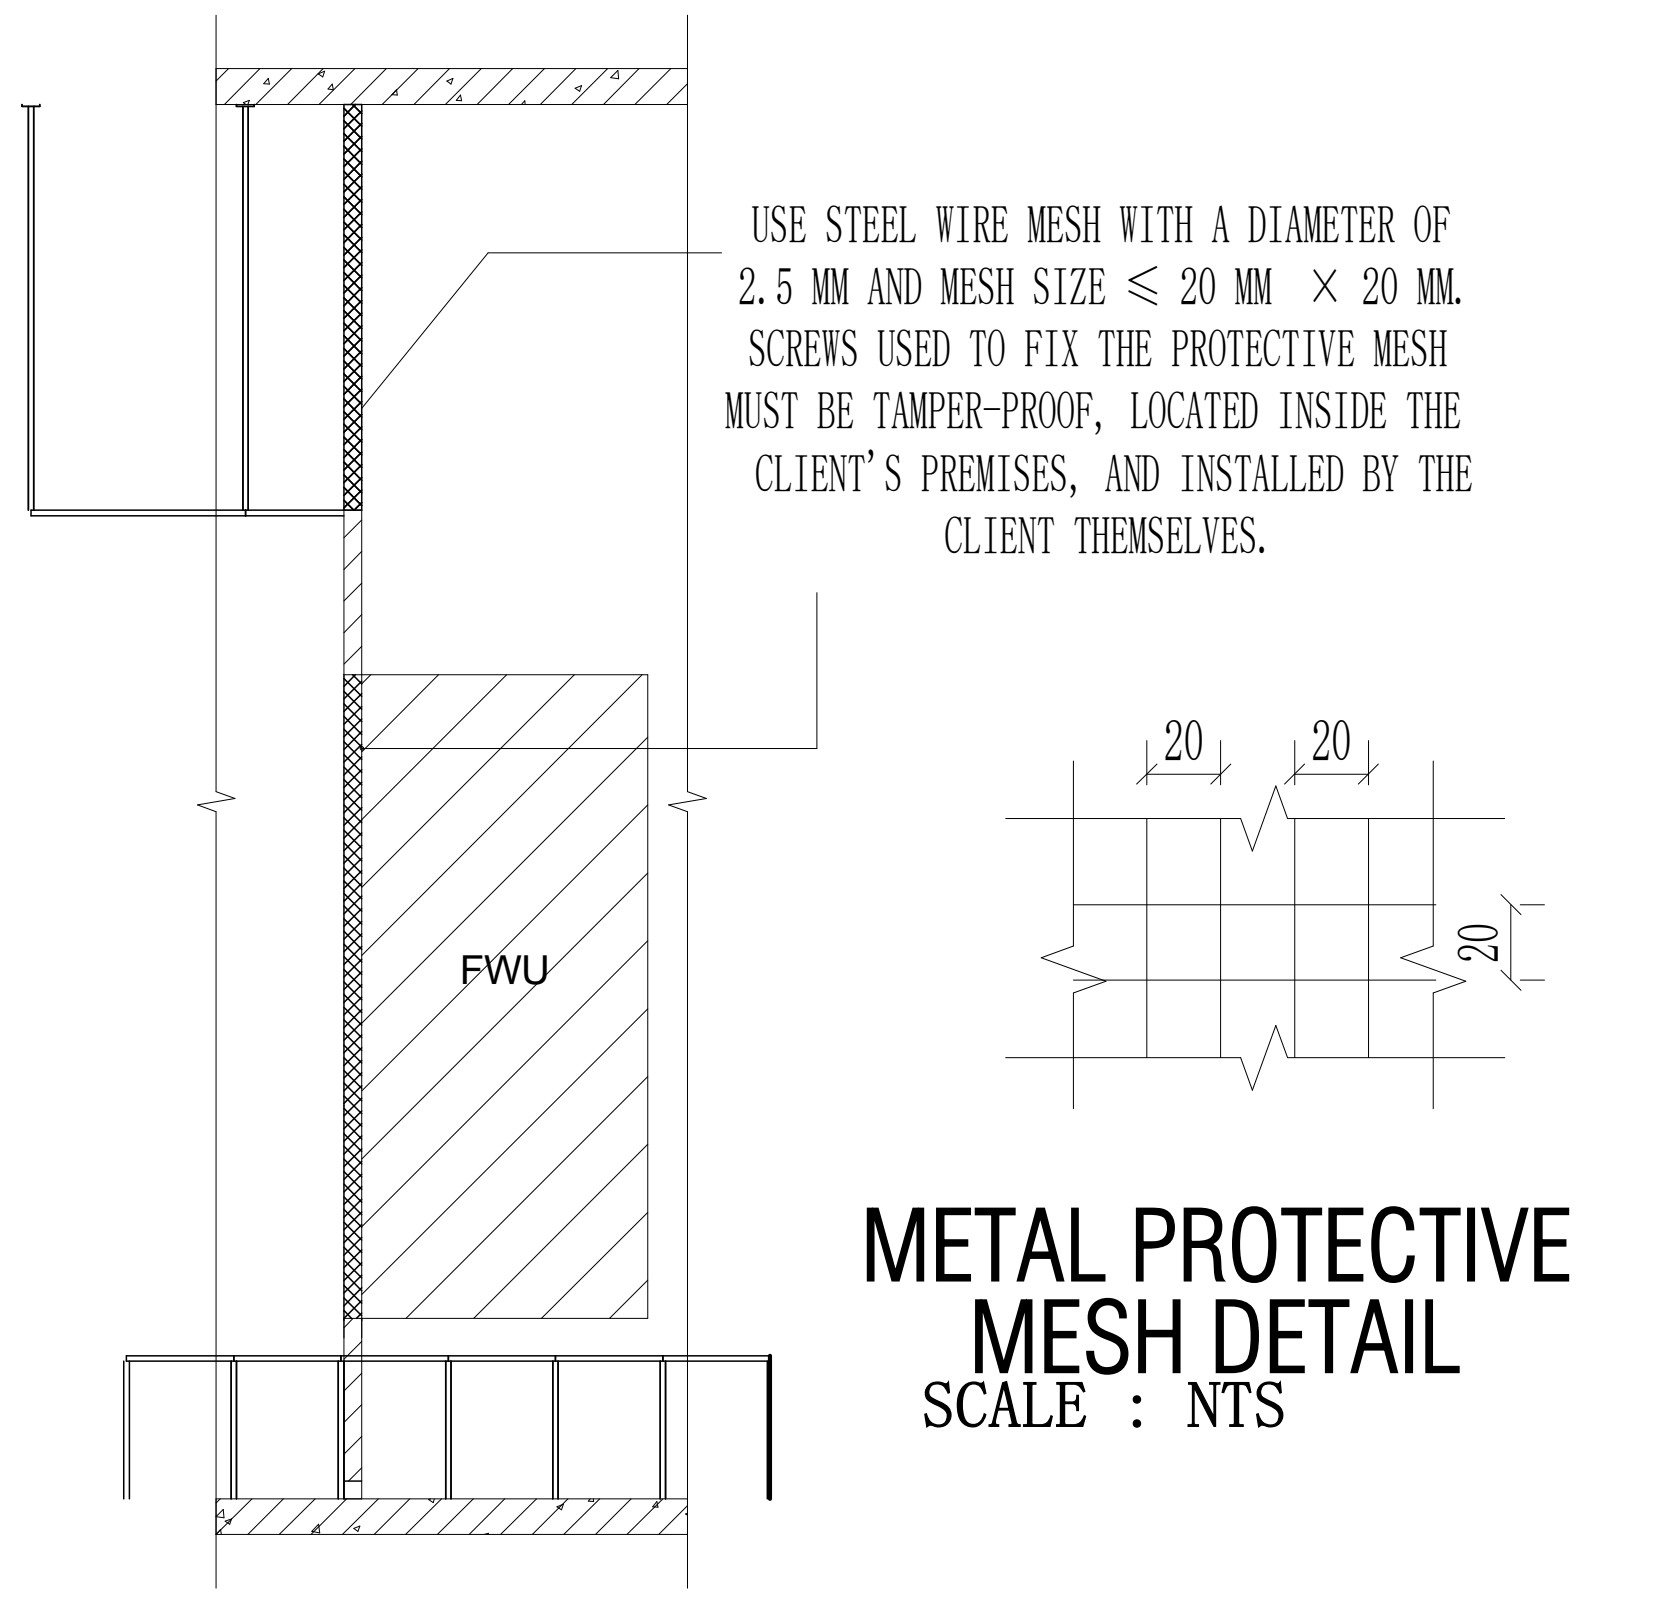
USE STEEL WIRE MESH WITH A DIAMETER OF 2.5 MM AND MESH SIZE ≤ 20 MM × 20 MM. SCREWS USED TO FIX THE PROTECTIVE MESH MUST BE TAMPER-PROOF, LOCATED INSIDE THE CLIENT'S PREMISES, AND INSTALLED BY THE CLIENT THEMSELVES.
FWU
20
20
20

METAL PROTECTIVE MESH DETAIL

SCALE : NTS

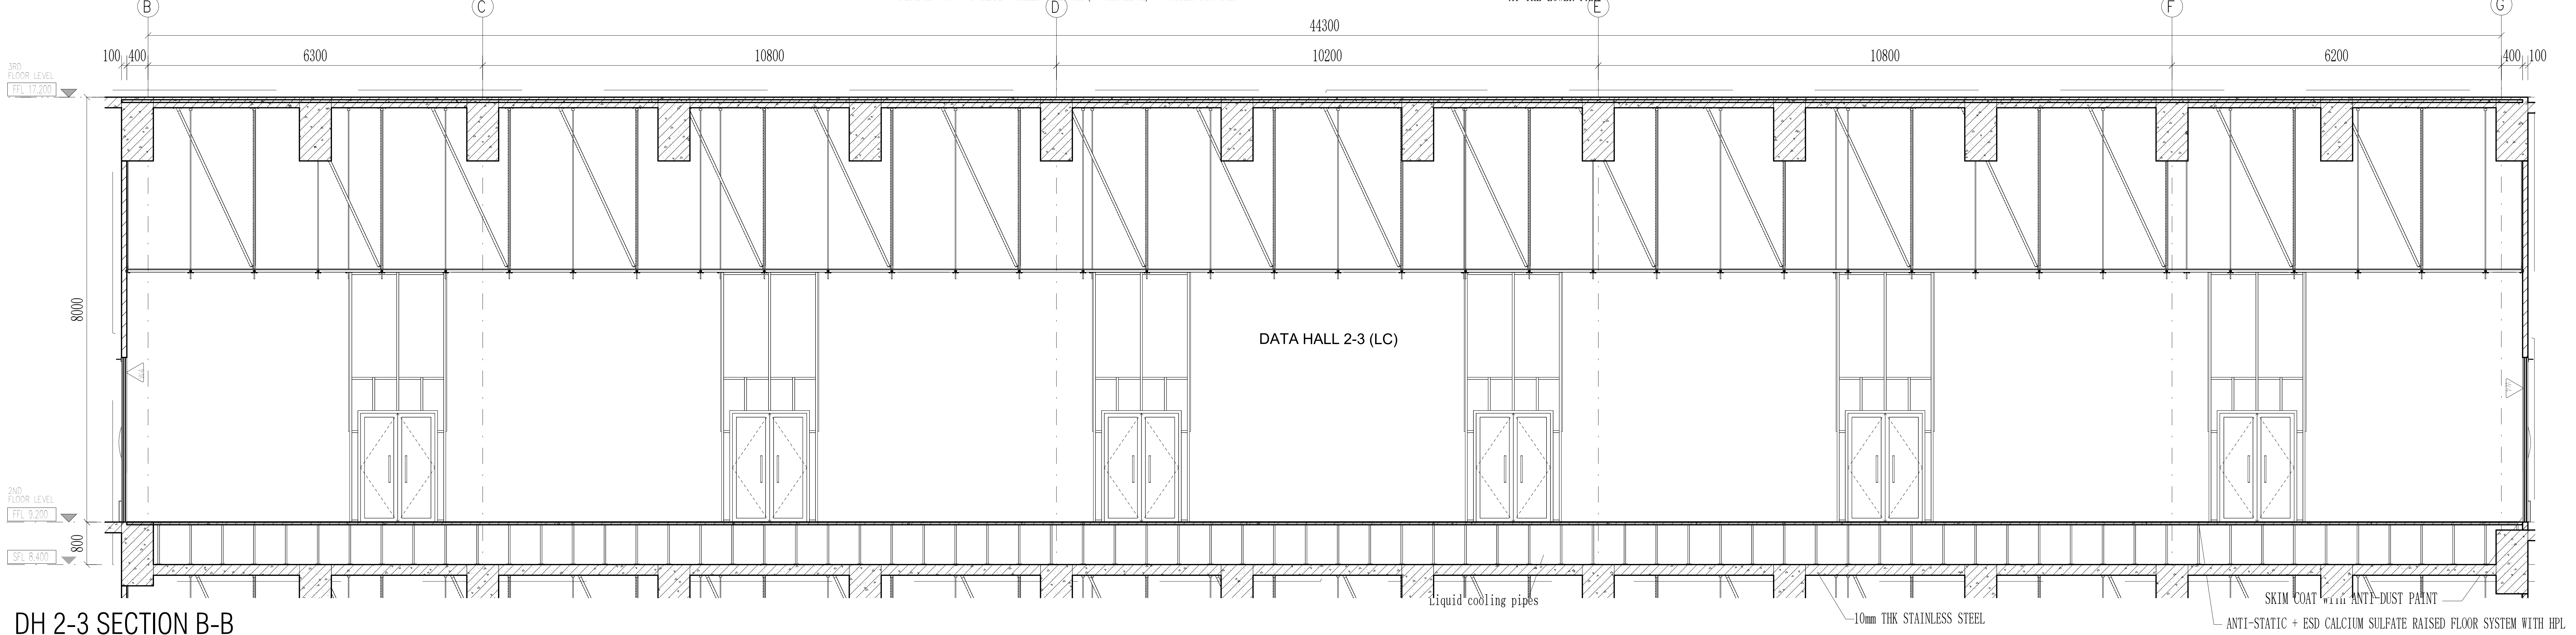

DH 2-3 SECTION B-B

Scale 1:50

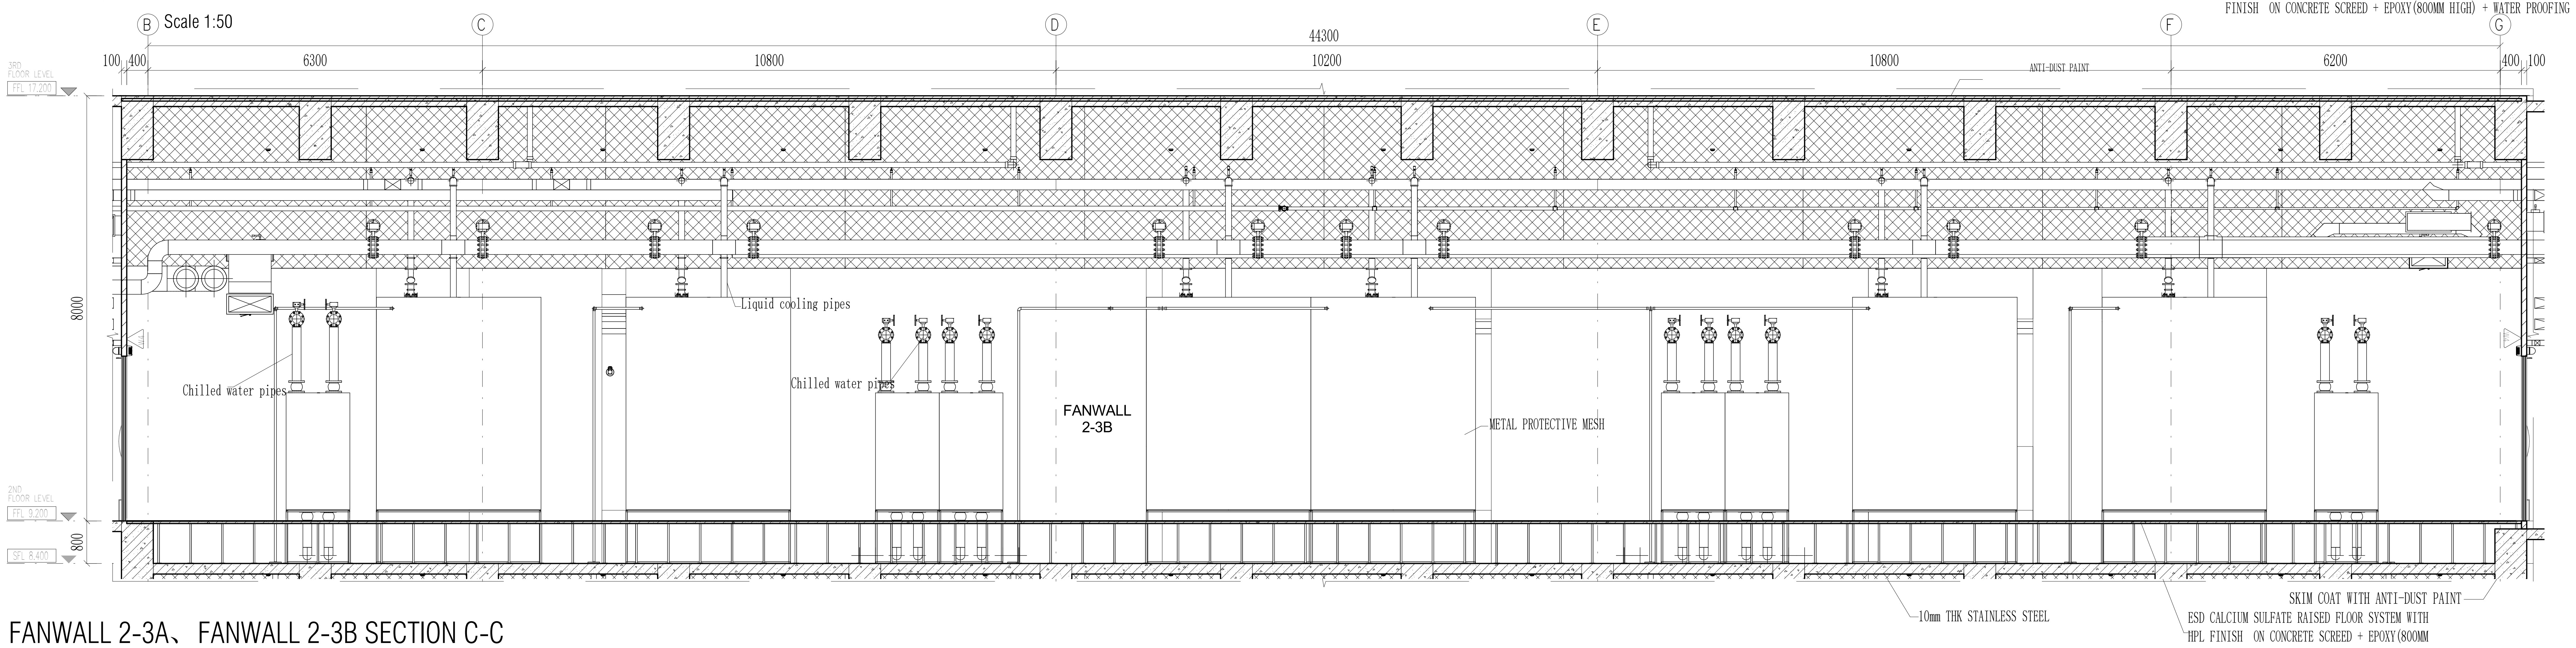

FANWALL 2-3A、FANWALL 2-3B SECTION C-C

Scale 1:50

CLIENT :

GULF EDGE DC 01

87 Wireless Road, M Thai Tower 11th. Floor, All Seasons Place, Lumpini,
Pathumwan, Bangkok 10330, Thailand

CONTRACTOR :

华西发展(泰国)有限公司
บริษัท หัวซือ ดีเวลลอปเม้นต์ (ประเทศไทย) จำกัด
HUASHI DEVELOPMENT CO.,LTD
No. 202, Room No. 1403, 14/F, Le Concorde Building,
Ratchadapisek Road, Huaykhwang Sub-District,
Huaykhwang District, Bangkok Metropolitan 10310.

CONSULTANT :

ARbay
บริษัท เอ อาร์ เบย์ จำกัด
ARbay Company Limited
31 st Floor Bangkok Insurance Building
25 South Sathorn road Thungmahamek
Sathorn Bangkok 10120 THAILAND
T +66 (0) 2286 8199
F +66 (0) 2286 2863
info@arbay.co.th

CONSULTANT :

Qbic Engineers & Architects Co.,Ltd.
8 Soi KALONG 4 SANAMBINNAM ROAD,
THASAI SUB-DISTRICT, MUANG NONTHABURI DISTRICT
, NONTHABURI.
Tel 662-950-4374
Fax 662-580-3231
E-Mail : qbic@qbic.co.th, www.qbic.co.th
QBIC ENGINEERS AND ARCHITECTS CO.,LTD.

CONSULTANT :

MITR
MITR TECHNICAL CONSULTANT CO.,LTD.
1168/8 12th FLOOR, LUMPINI TOWER BUILDING,
RAMA IV RD., THUNGMAHAMEK, SATHORN, BANGKOK 10120, THAILAND
TEL : 0-2679-9079-84
FAX : 0-2679-9085 E-mail: mitr_dd@mitr.com

Architect :	SIGNATURE
ประกิต พนานุรัตน์ วสถ. 580 ที่อยู่ 251/1 ถ.จารุเมือง แขวงรองเมือง เขตปทุมวัน กรุงเทพมหานคร โทรศัพท์ 02-286-8199	
Structural Engineer :	SIGNATURE
วิศวกรผู้ออกแบบโครงสร้าง	
ณัฐสม สงวนวงษ์ วย 1423 ที่อยู่ 2/1 ซ.รามคำแหง 150 ถ.รามคำแหง แขวง สะพานสูง เขต สะพานสูง กทม. 10240	ณัฐสม สงวนวงษ์
Structural Inspector :	SIGNATURE
วิศวกรผู้ตรวจสอบโครงสร้าง	
โกมล จุฑาภัทร วย 964 ที่อยู่ 24/18 ซ.นวมินทร์ 129 ถ. นวมินทร์ แขวง นวลจันทร์ เขต บึงกุ่ม กทม. 10230	
Electrical Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบไฟฟ้ากำลัง	
นายสุภัทร บูรณวิทย์ วฟก.1265 ที่อยู่ 21 ซอยทานสัมฤทธิ์ 13 ตำบลท่าทราย อ.เมืองนนทบุรี จ.นนทบุรี 11000	
Mechanical Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบเครื่องกลและปรับอากาศ	
นายประสิทธิ์ เกี้ยวสุนทร วก.1221 ที่อยู่ 44/372 ซอยบางกระดี่ 35/1 แขวงแสมดำ เขตบางขุนเทียน กทม. 10150	ประสิทธิ์
Sanitary Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบสุขาภิบาล และดับเพลิง	
นายทศวรรษ สนั่นฤทธิ์ วส. 215 ที่อยู่ บ้านเลขที่ 99/107 หมู่ที่ 3 ต.ศีรษะจรเข้น้อย อ.บางเสาธง จ.สมุทรปราการ 10540	ทศวรรษ

ISSUE/REVISION

REV.	DESCRIPTION	DATE
A	90% DEVELOPED	09/05/2026

PROJECT NAME :

GEDC 01

LOCATION:
Nikhom Phattana district, Rayong ,industrial estate,CPGC

BUILDING :

MAIN BUILDING

90% DEVELOPED

TITLE :

ROOM ETAIL-2F-DATAHALL2-3(LC) FAN
ALL ROOM 2-3A,2-3BSECTION

JOB NO.	SCALE 1 : 50
DRAWN NXR	REF.
CHECKED LJC	DWG. NO. MPK01A-90-A-RD-206
APPROVED LXD	
DATE 2026.05.09	

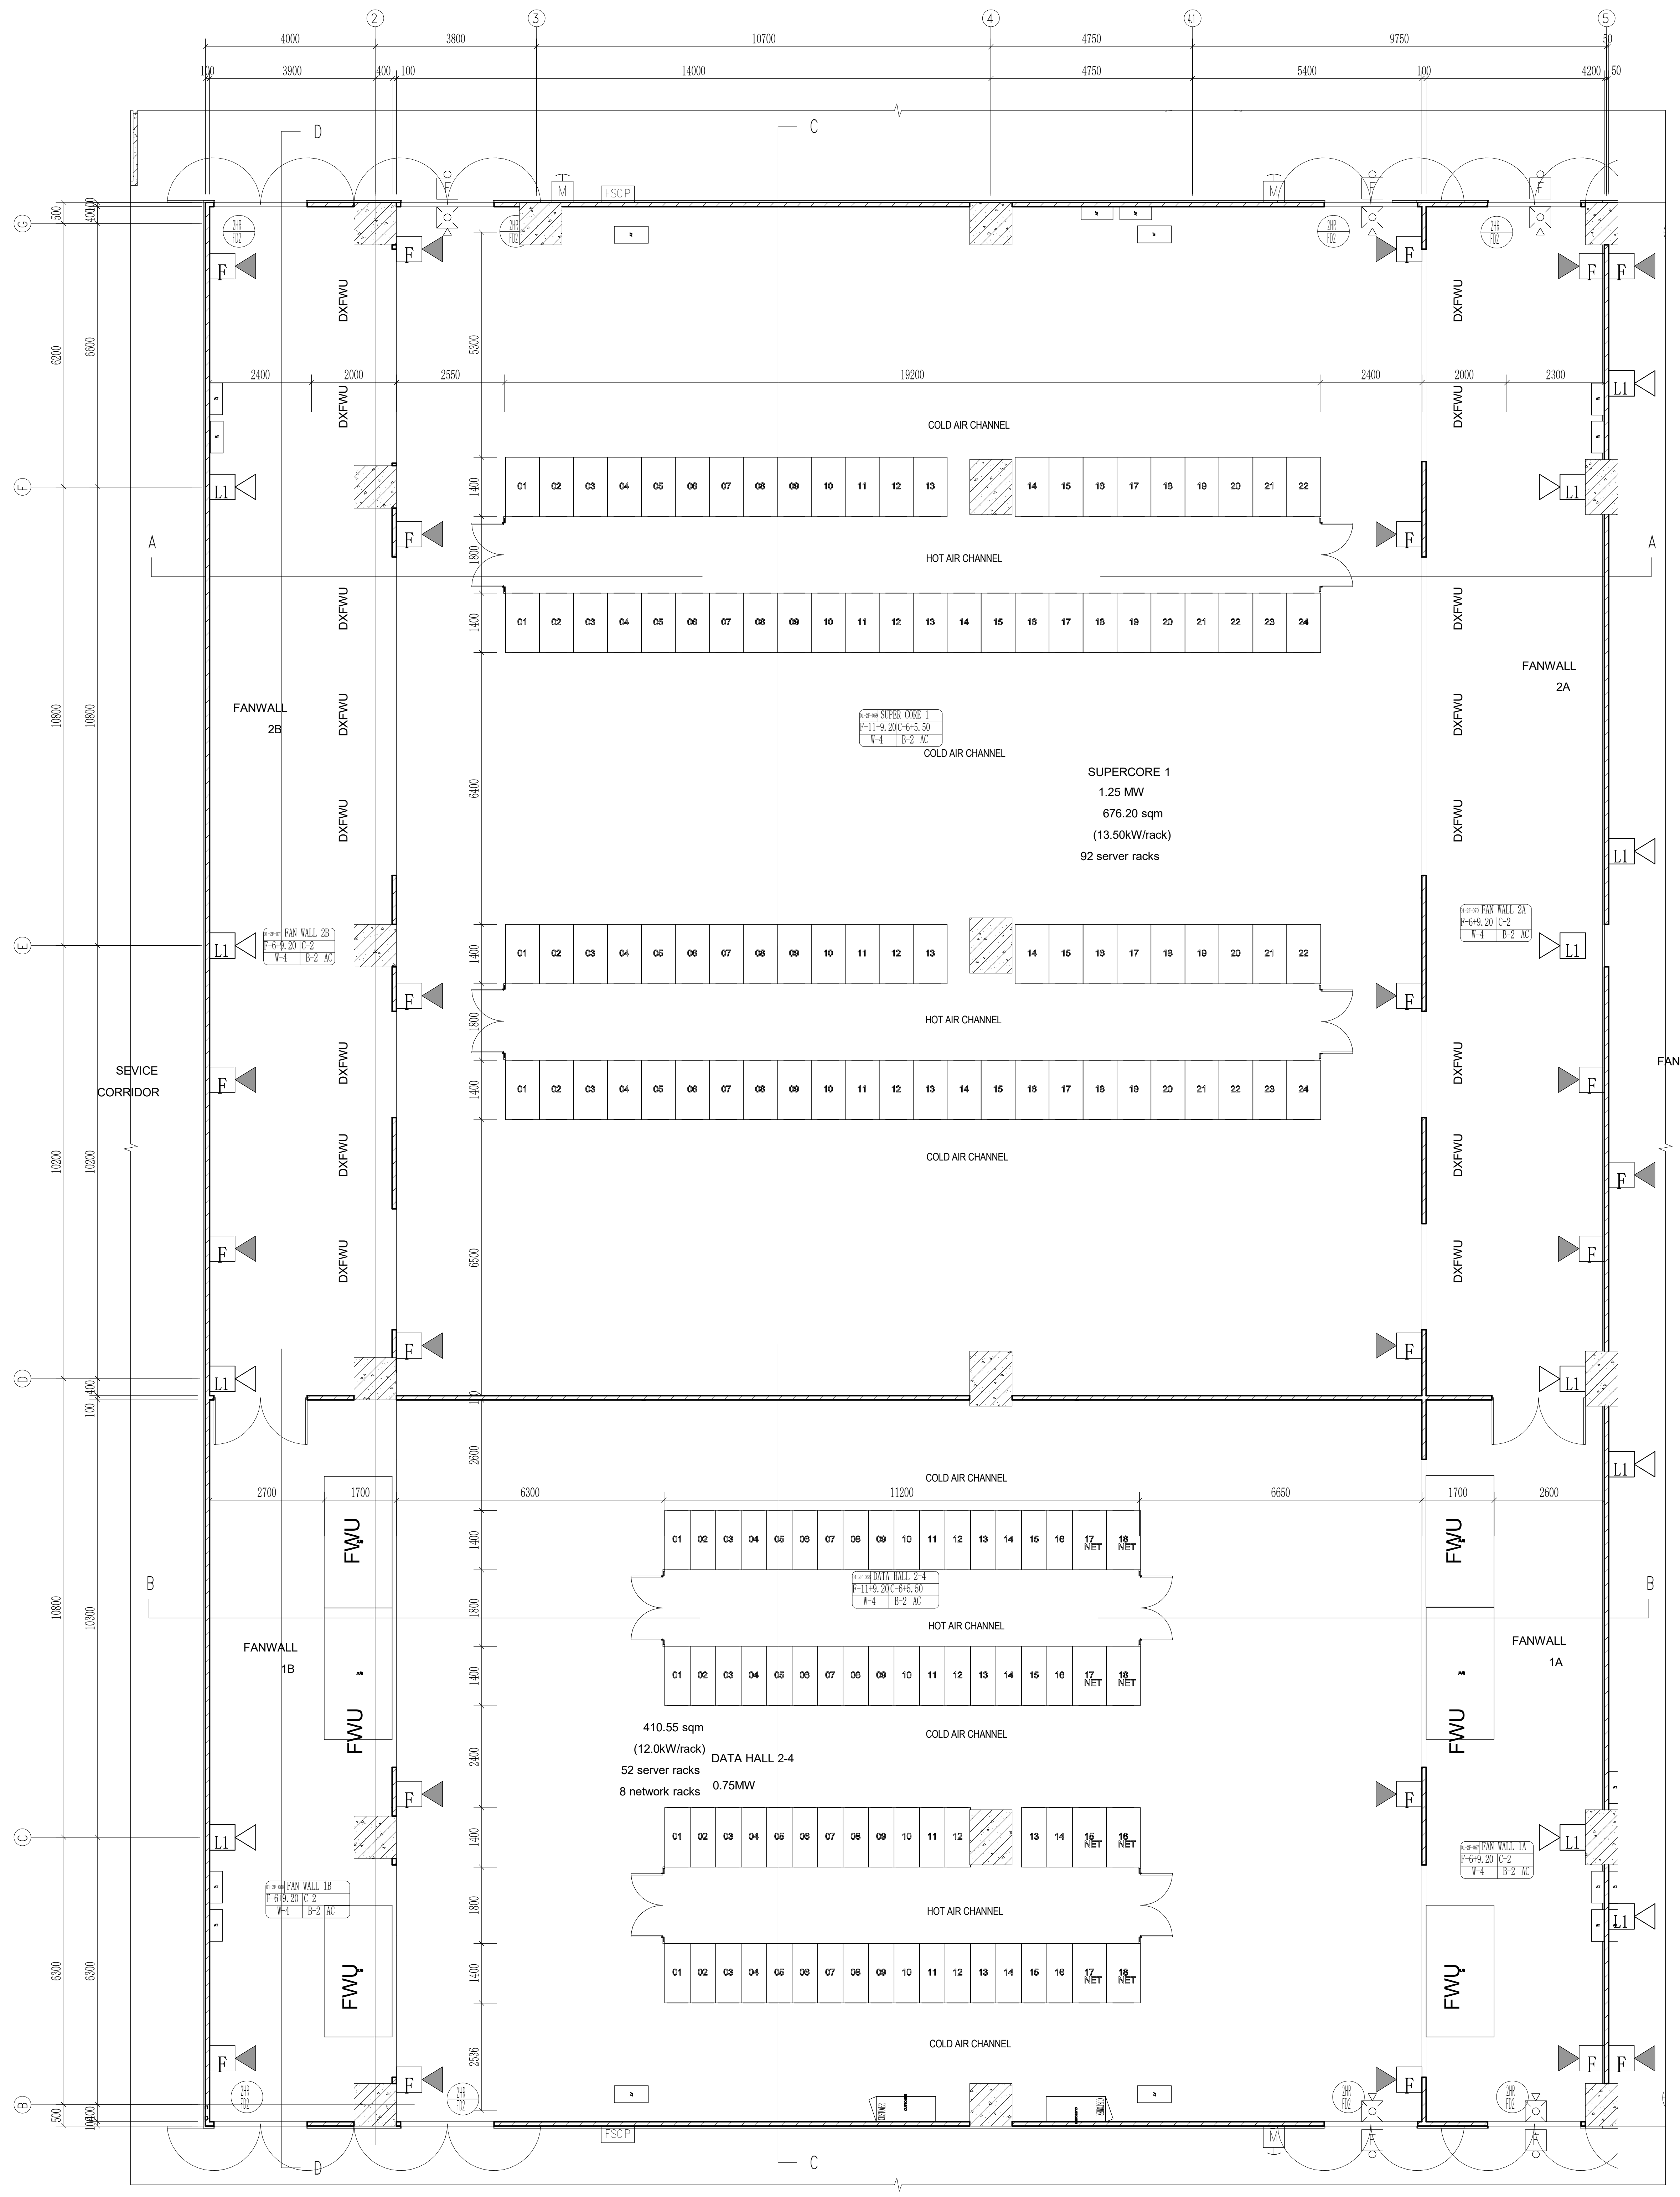

SUPERCORE、DATA HALL 2-4、FANWALL1A~1B、FANWALL2A~2B FLOOR PLAN

Scale 1:75

THE "SFL" MARKED IN THE DRAWING REFERS TO THE STRUCTURAL FLOOR LEVEL, WHILE THE FINISHED FLOOR LEVEL (FFL) IS DETERMINED BASED ON FLOOR FINISHES.

Room Number	Room Name	Room Type	0kW/RACK	12kW/RACK	16kW/RACK	13.5kW/RACK	Rack Count	Design IT Load (Mw)
01-2F-062	SuperCore	Air-cooled	0	0	0	92	92	1.25
01-2F-059	Data Hall2-4	Air-cooled	10	52	8	0	70	0.75

Note On Levels- All Levels Shown Are Absolute Elevation	
☒	0kW/RACK
☐	12kW/RACK
☒	16kW/RACK
☒	13.5kW/RACK

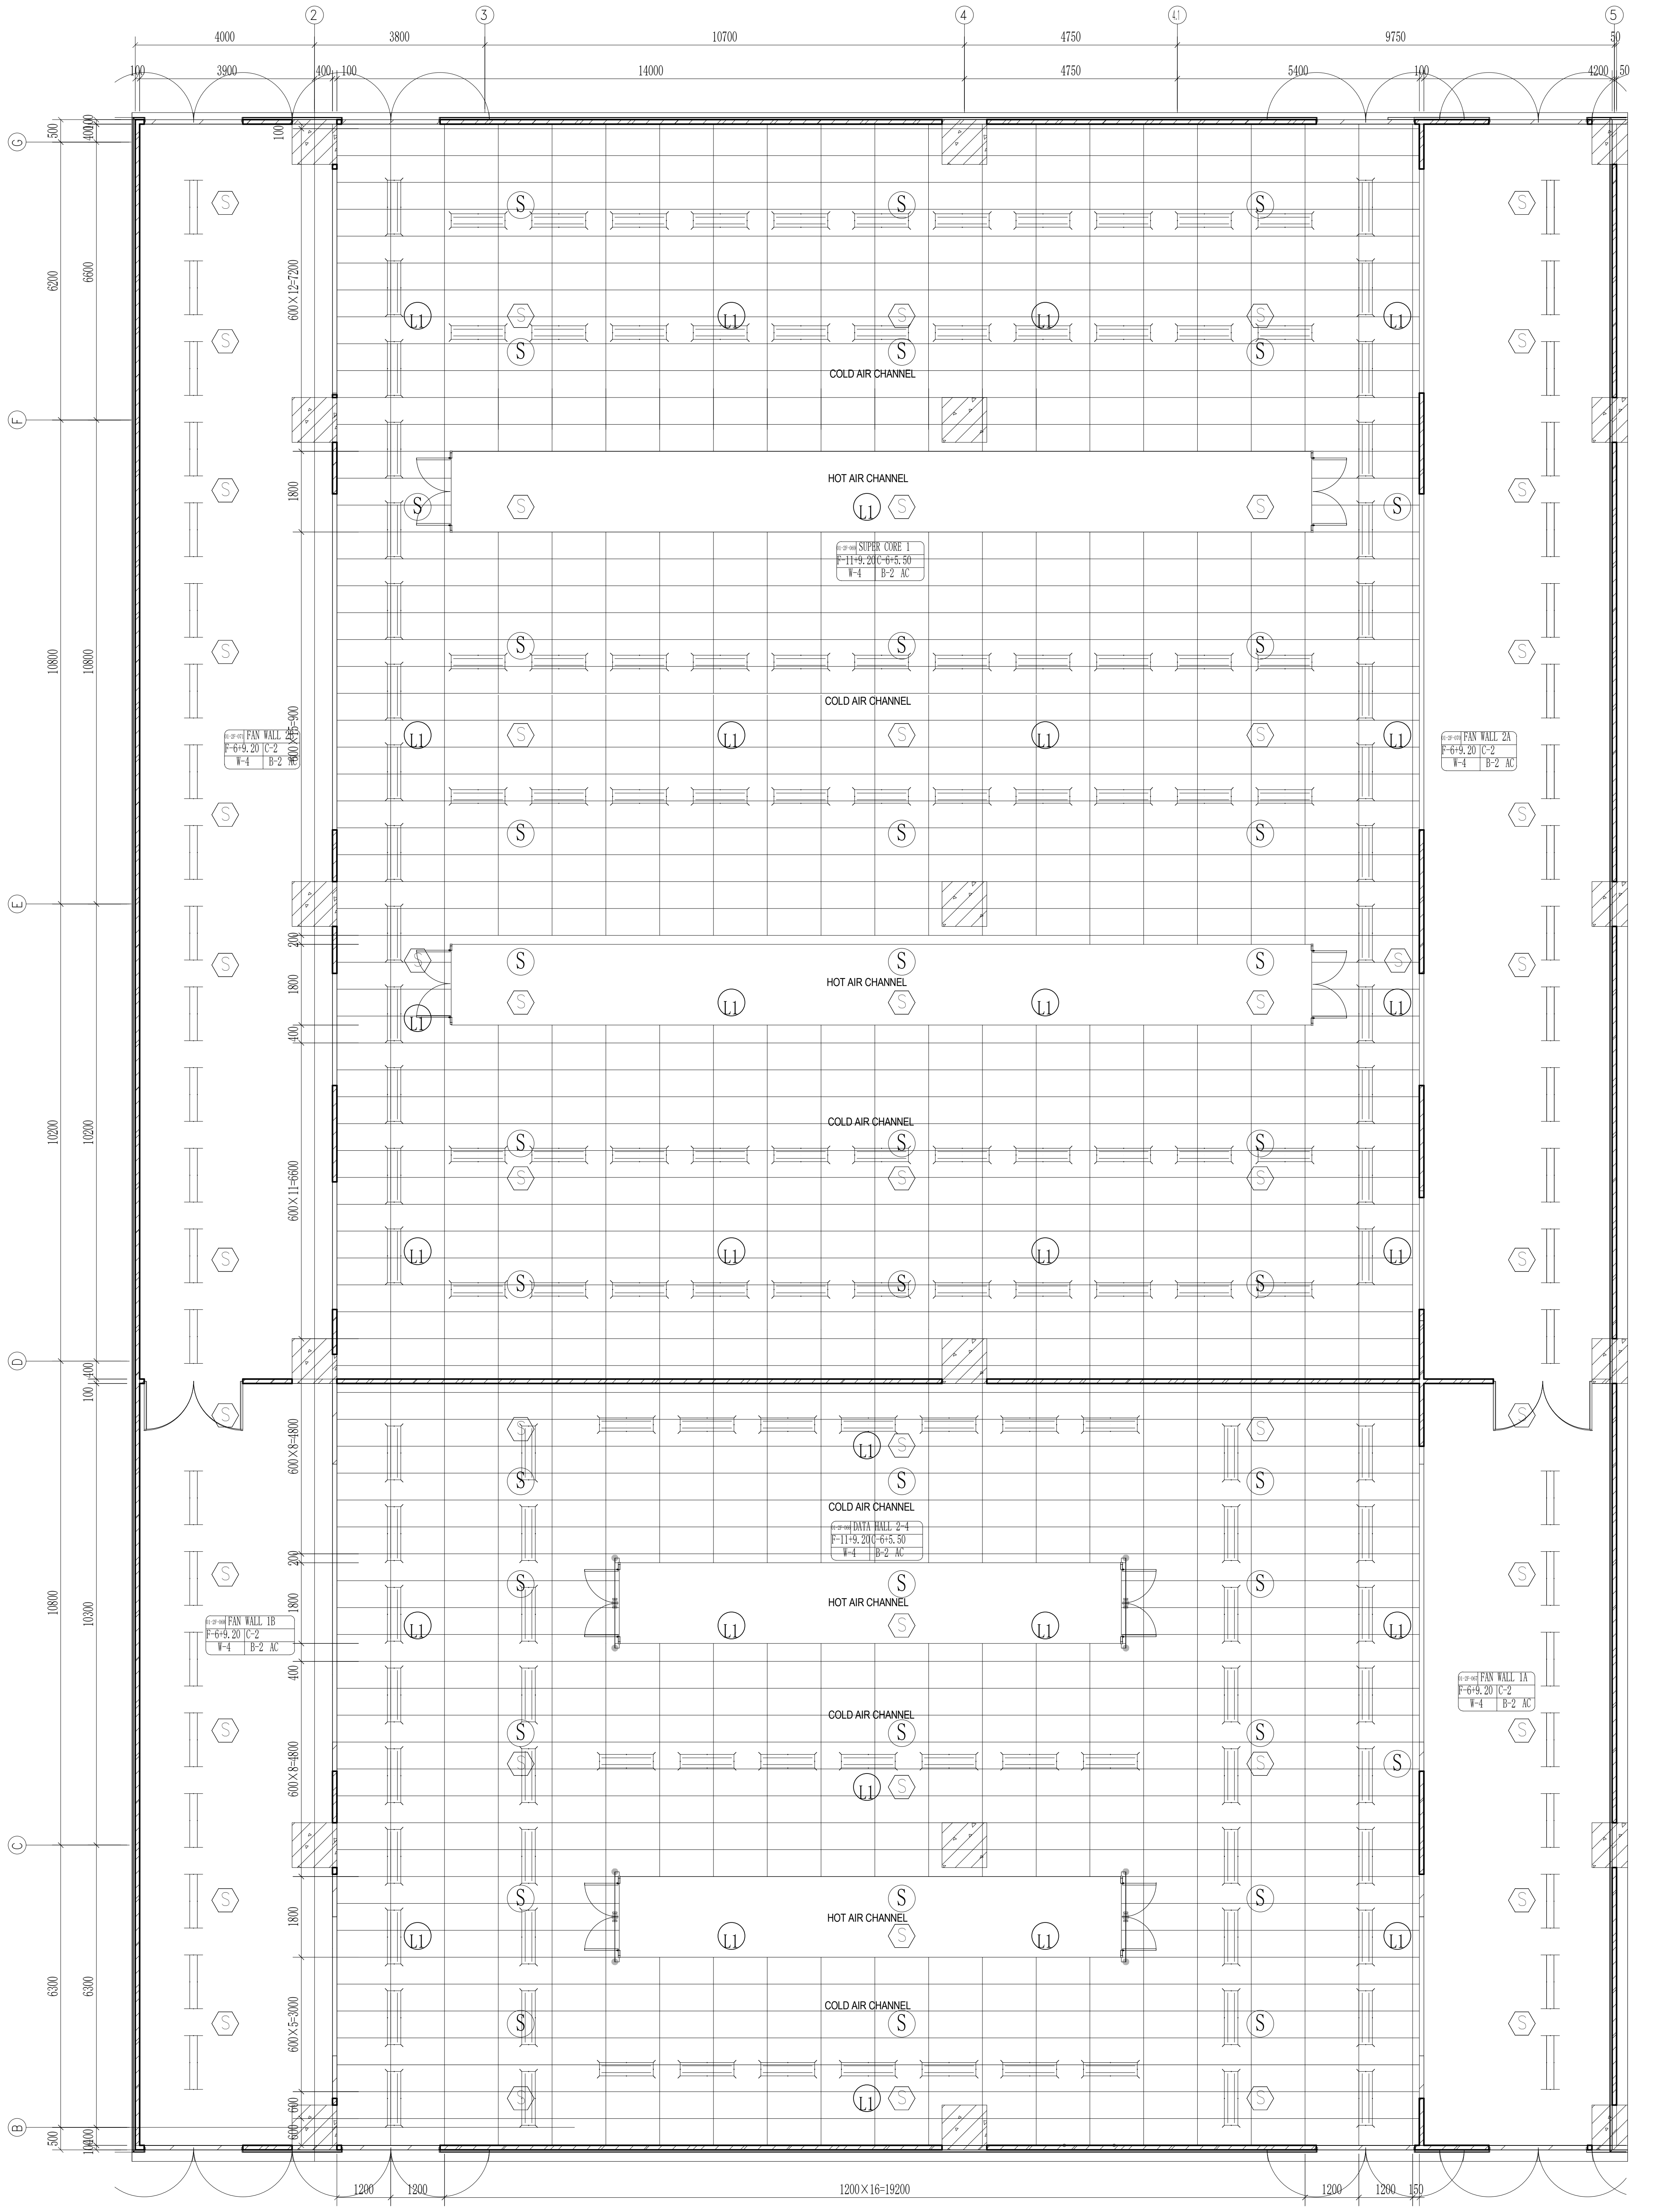

SUPERCORE、DATA HALL 2-4 CEILING LAYOUT

Scale 1:75

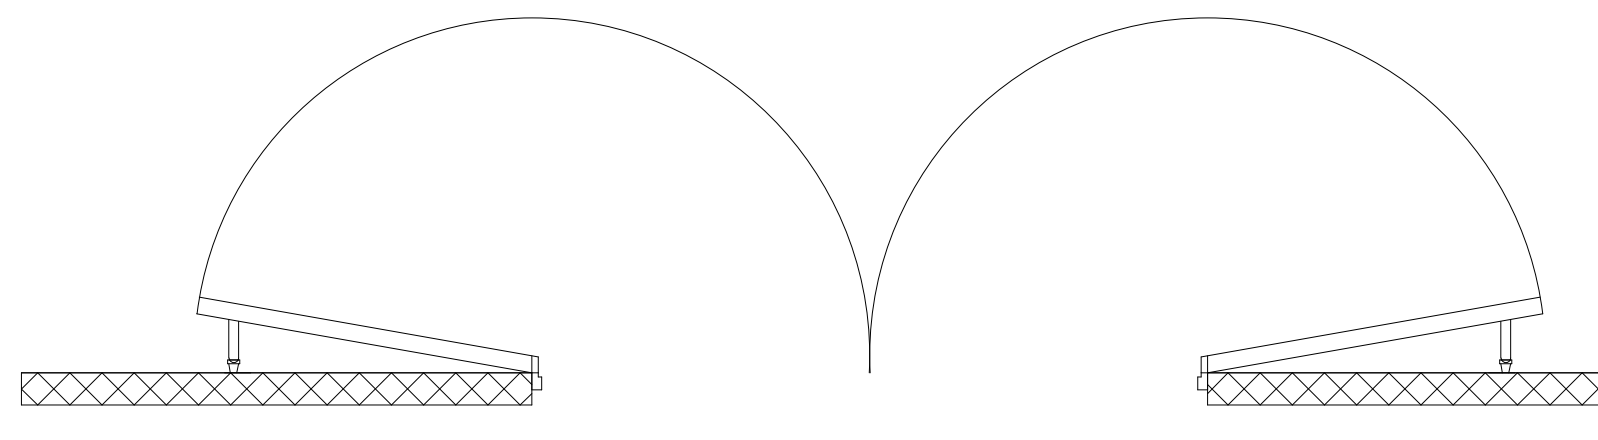

2MM THICK STAINLESS STEEL PROTECTIVE PLATE IS INSTALLED FROM THE GROUND UP TO A HEIGHT OF 1.5 METERS. DETAILED IFC STAGE NODE DETAIL DRAWING

DOOR STOPPER DETAIL

Scale 1:25

FIRE ALARM SPEAKER WALL MOUNTED

COMBINATION HORN/VISIBLE

SURFACE MOUNTED SMOKE DETECTOR, PHOTOELECTRIC TYPE

PHOTOELECTRIC SMOKE DETECTOR

LED double tube lamp; Ceiling Mounted; System Power 2x20W (+/- 10% In Tolerance); System Lumens >2x2000lm (+/- 10% In Tolerance); Luminaire Efficacy >100lm/w; CCT 5000K; CRI>80; CPF>0.9; Input Voltage 220V-240V 50/60Hz (Mounting height 3.0m)

LED double tube lamp; Ceiling Mounted; System Power 2x20W (+/- 10% In Tolerance); System Lumens >2x2000lm (+/- 10% In Tolerance); Luminaire Efficacy >100lm/w; CCT 5000K; CRI>80; CPF>0.9; Input Voltage 220V-240V 50/60Hz (Mounting height 3.0m)

ALARM BELL

CEILING SPEAKER

CLIENT :

GULF EDGE DC 01

87 Wireless Road, M Thai Tower 11th. Floor, All Seasons Place, Lumpini,
Pathumwan, Bangkok 10330, Thailand

CONTRACTOR :

华西发展(泰国)有限公司
บริษัท หัวซือ ดีเวลลอปเม้นต์ (ประเทศไทย) จำกัด
HUASHI DEVELOPMENT CO.,LTD
No. 202, Room No. 1403, 14/F, Le Concorde Building,
Ratchadapisek Road, Huaykhwang Sub-District,
Huaykhwang District, Bangkok Metropolitan 10310.

CONSULTANT :

ARbay
บริษัท เอ อาร์ เบย์ จำกัด
ARbay Company Limited
31 st Floor Bangkok Insurance Building
25 South Sathorn road Thungmahamek
Sathorn Bangkok 10120 THAILAND
T +66 (0) 2286 8199
F +66 (0) 2286 2863
info@arbay.co.th

CONSULTANT :

Qbic Engineers & Architects Co.,Ltd.
8 Soi KALONG 4 SANAMBINNAM ROAD,
THASAI SUB-DISTRICT, MUANG NONTHABURI DISTRICT
, NONTHABURI.
Tel 662-950-4374
Fax 662-580-3231
E-Mail : qbic@qbic.co.th, www.qbic.co.th
QBIC ENGINEERS AND ARCHITECTS CO.,LTD.

CONSULTANT :

MITR
MITR TECHNICAL CONSULTANT CO.,LTD.
1168/8 12th FLOOR, LUMPINI TOWER BUILDING,
RAMA IV RD., THUNGMAHAMEK, SATHORN, BANGKOK 10120, THAILAND
TEL : 0-2679-9079-84
FAX : 0-2679-9085 E-mail: mitr_dd@mitr.com

Architect :	SIGNATURE
ประกิต พนานุรัตน์ วสถ. 580 ที่อยู่ 251/1 ถ.จารุเมือง แขวงรองเมือง เขตปทุมวัน กรุงเทพมหานคร โทรศัพท์ 02-286-8199	

Structural Engineer :	SIGNATURE
วิศวกรผู้ออกแบบโครงสร้าง	
ณัฐสม สงวนวงษ์ วย 1423 ที่อยู่ 2/1 ซ.รามคำแหง 150 ถ.รามคำแหง แขวง สะพานสูง เขต สะพานสูง กทม. 10240	

Structural Inspector :	SIGNATURE
วิศวกรผู้ตรวจสอบโครงสร้าง	
โกมล จุฑาภัทร วย 964 ที่อยู่ 24/18 ซ.นวมินทร์ 129 ถ. นวมินทร์ แขวง นวลจันทร์ เขต บึงกุ่ม กทม. 10230	

Electrical Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบไฟฟ้ากำลัง	
นายสุภัทร บูรณวิทย์ วฟก.1265 ที่อยู่ 21 ซอยทานสัมฤทธิ์ 13 ตำบลท่าทราย อ.เมืองนนทบุรี จ.นนทบุรี 11000	

Mechanical Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบเครื่องกลและปรับอากาศ	
นายประสิทธิ์ เกี้ยวสุนทร วก.1221 ที่อยู่ 44/372 ซอยบางกระดี่ 35/1 แขวงแสมดำ เขตบางขุนเทียน กทม. 10150	ประสิทธิ์

Sanitary Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบสุขาภิบาล และดับเพลิง	
นายทศวรรษ สนั่นฤทธิ์ วส. 215 ที่อยู่ บ้านเลขที่ 99/107 หมู่ที่ 3 ต.ศีรษะจรเข้น้อย อ.บางเสาธง จ.สมุทรปราการ 10540	ทศวรรษ

ISSUE/REVISION

REV.	DESCRIPTION	DATE
A	90% DEVELOPED	09/05/2026

PROJECT NAME :
GEDC 01

LOCATION:
Nikhom Phattana district, Rayong ,industrial estate,CPGC

BUILDING :
MAIN BUILDING

90% DEVELOPED

TITLE :
ROOM DETAIL-2F-SUPERCORE1,DATA HALL2-4 (AC), FANWALL1A-1B,2A-2B PLAN

JOB NO.	SCALE 作为说明
DRAWN 作者	REF.
CHECKED 审图员	DWG. NO. MPK01A-90-A-RD-207
APPROVED 审核者	
DATE 2026.05.09	

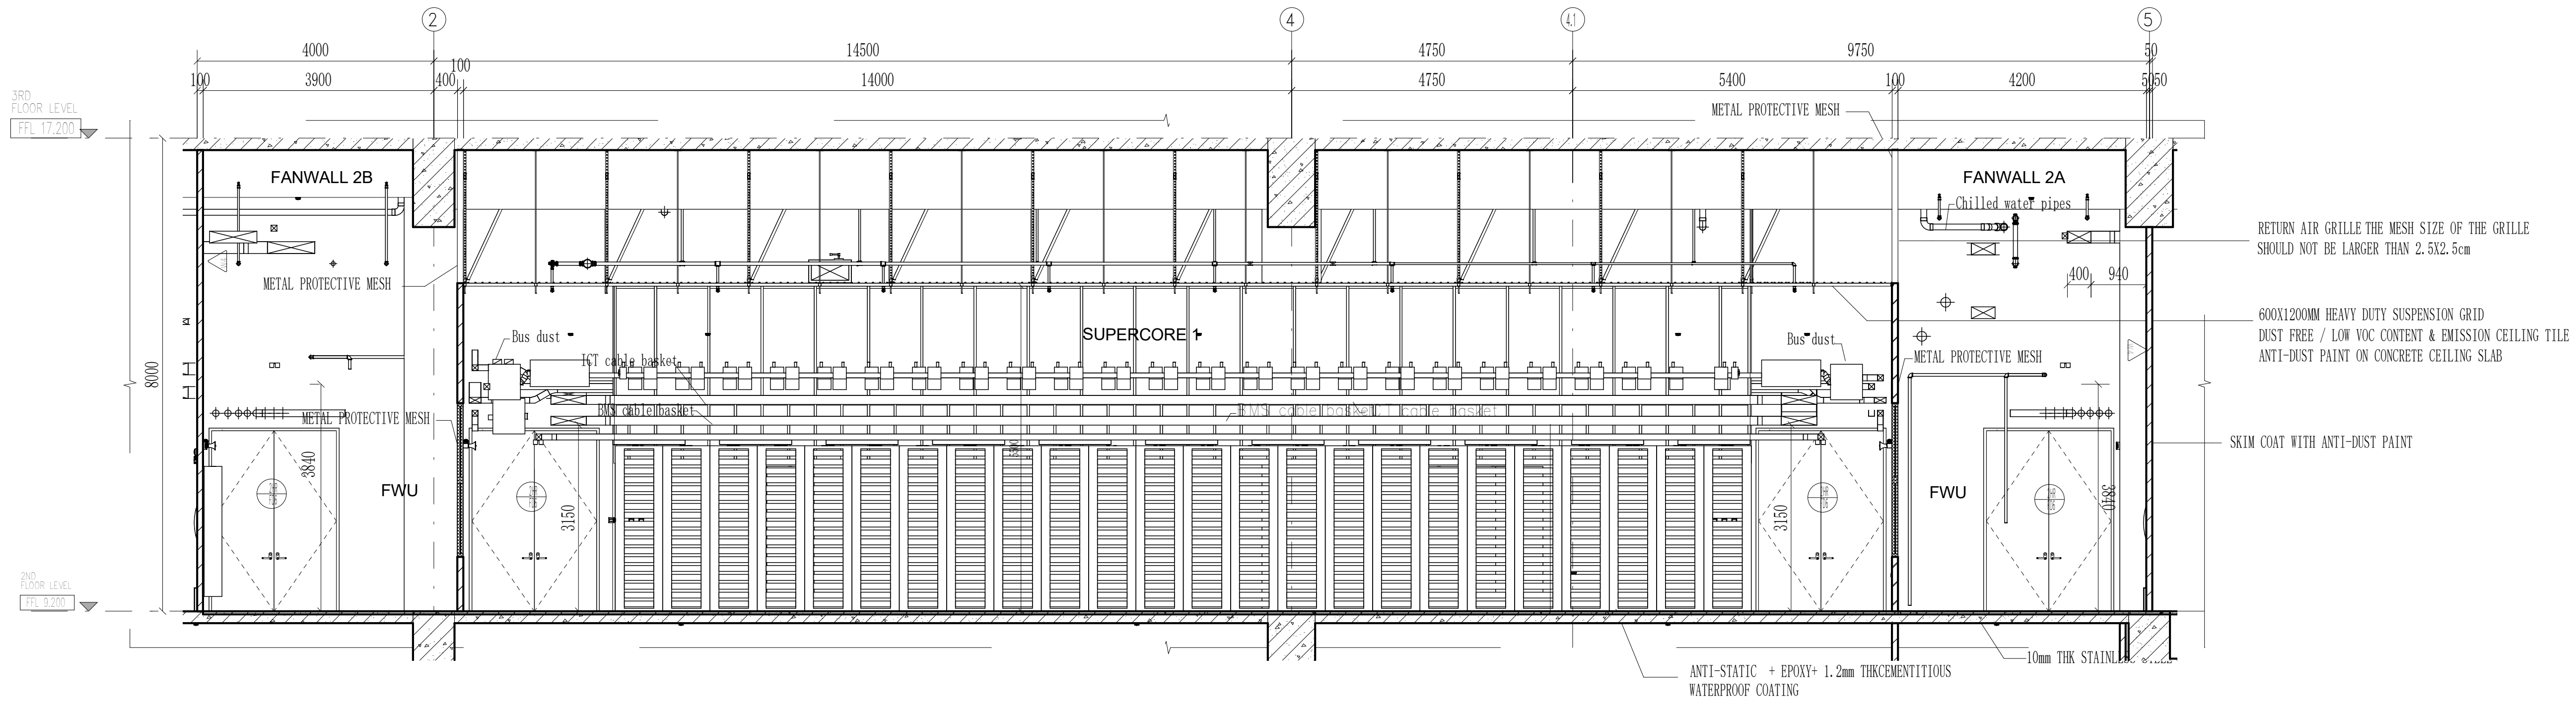

SUPERCORE、FANWALL 2A～2B SECTION A-A Scale 1:75

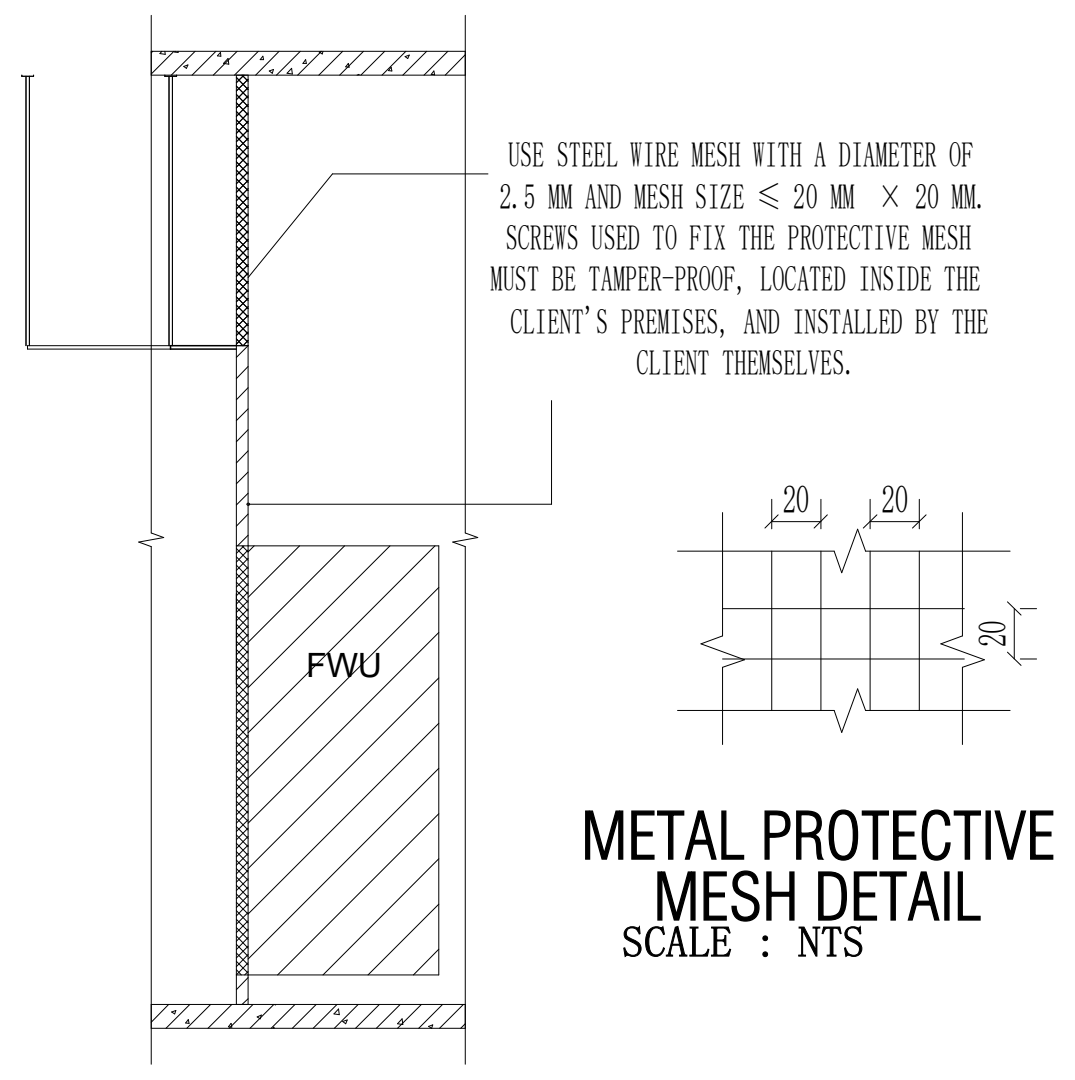
USE STEEL WIRE MESH WITH A DIAMETER OF 2.5 MM AND MESH SIZE ≤ 20 MM × 20 MM. SCREWS USED TO FIX THE PROTECTIVE MESH MUST BE TAMPER-PROOF, LOCATED INSIDE THE CLIENT'S PREMISES, AND INSTALLED BY THE CLIENT THEMSELVES.
FWU
20
20
20

METAL PROTECTIVE MESH DETAIL

SCALE : NTS

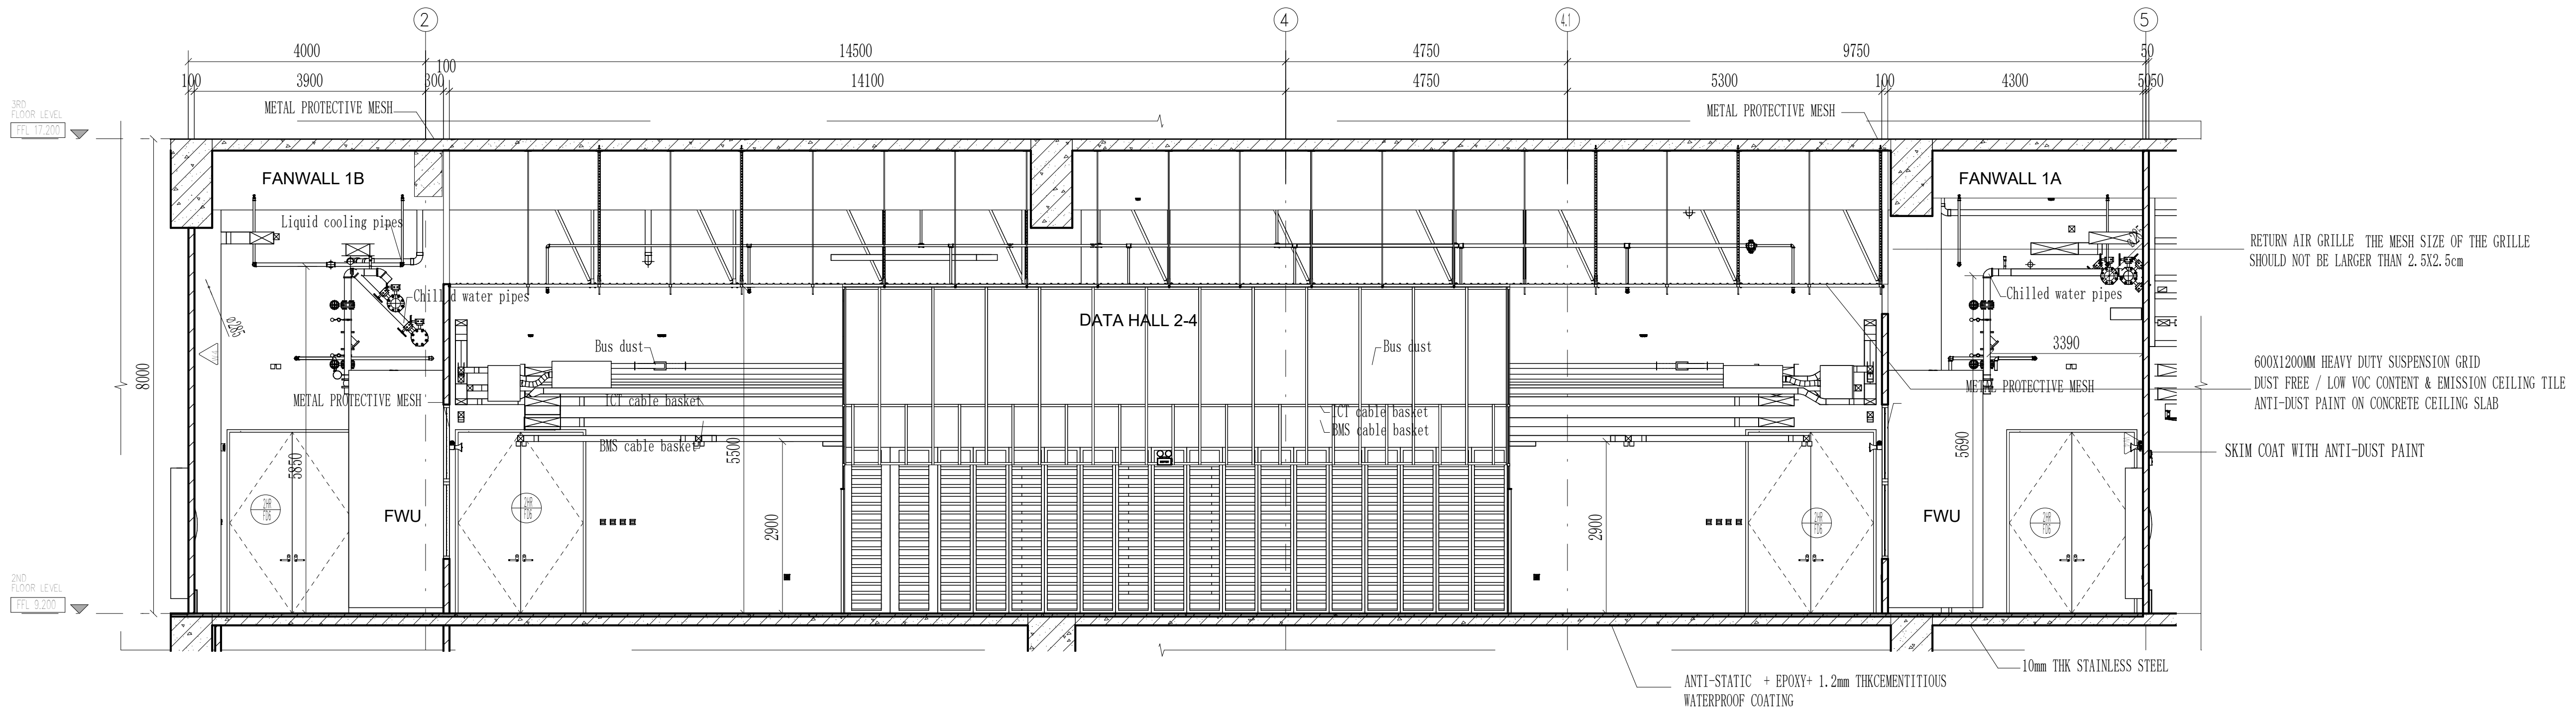

DATA HALL 2-4、FANWALL 1A～1B SECTION A-A Scale 1:75

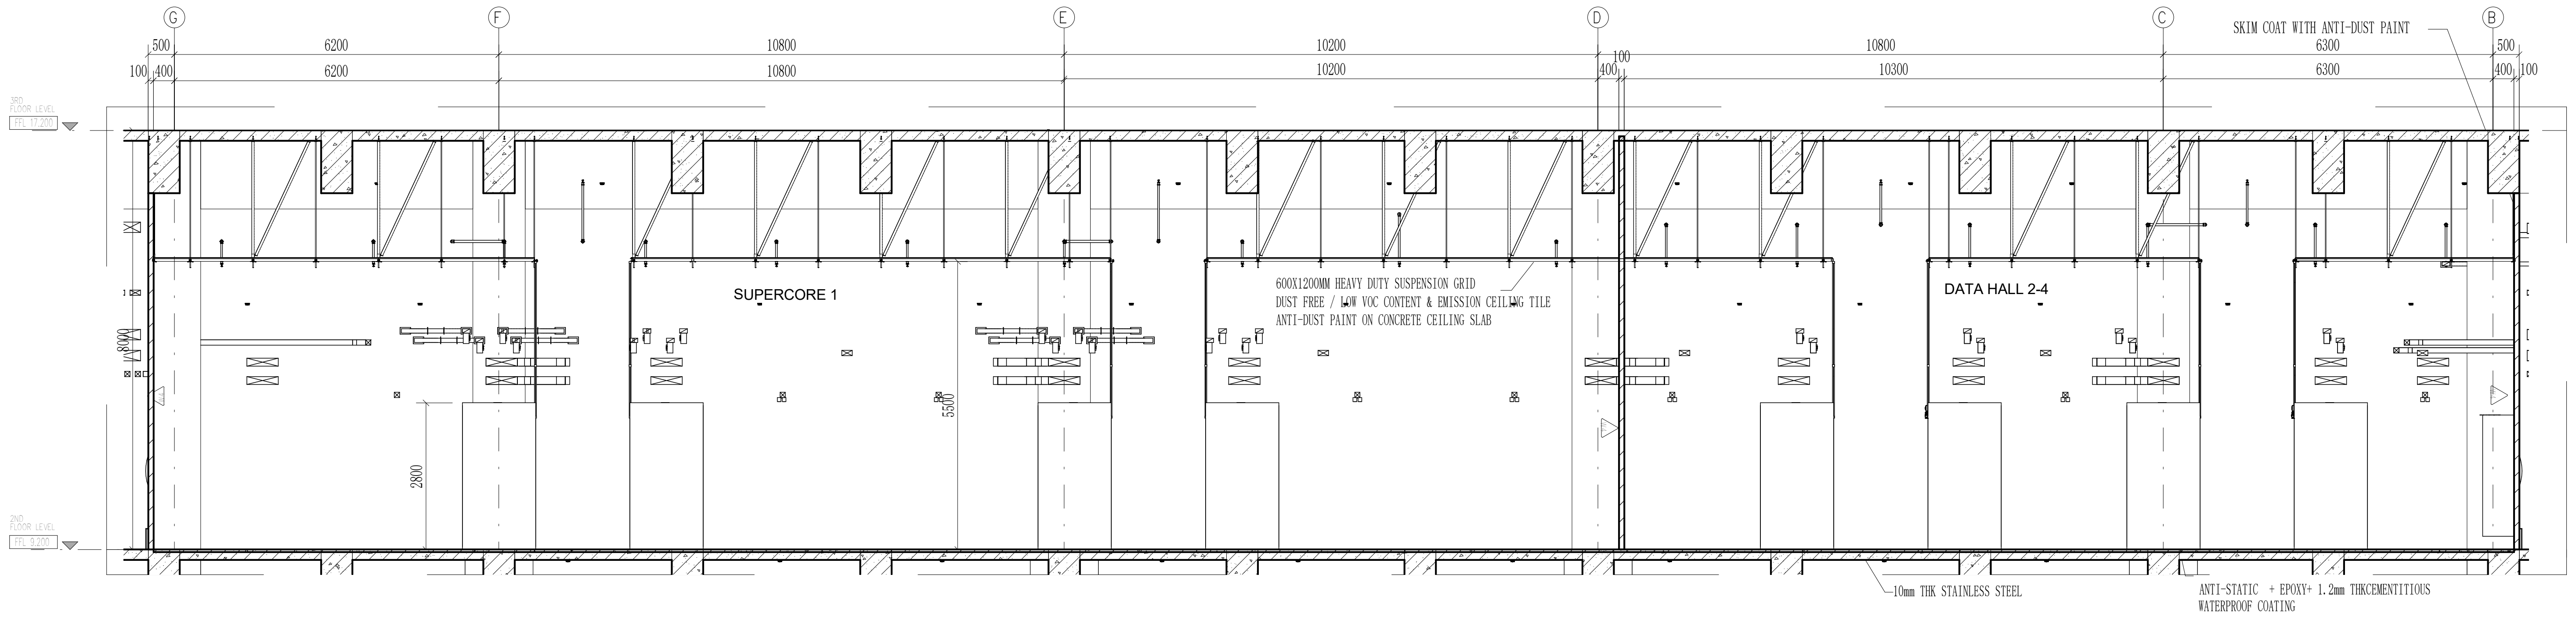
SUPERCORE 1
DATA HALL 2-4
600X1200MM HEAVY DUTY SUSPENSION GRID
DUST FREE / LOW VOC CONTENT & EMISSION CEILING TILE
ANTI-DUST PAINT ON CONCRETE CEILING SLAB
SKIM COAT WITH ANTI-DUST PAINT
10mm THK STAINLESS STEEL
ANTI-STATIC + EPOXY+ 1.2mm THKCEMENTITIOUS WATERPROOF COATING
8000
2800
500
6200
10800
10200
10800
6300
500
100
400
6200
10800
10200
100
400
10300
6300
400
100
G
F
E
D
C
B

SUPERCORE 1、DATA HALL 2-4 SECTION C-C Scale 1:75

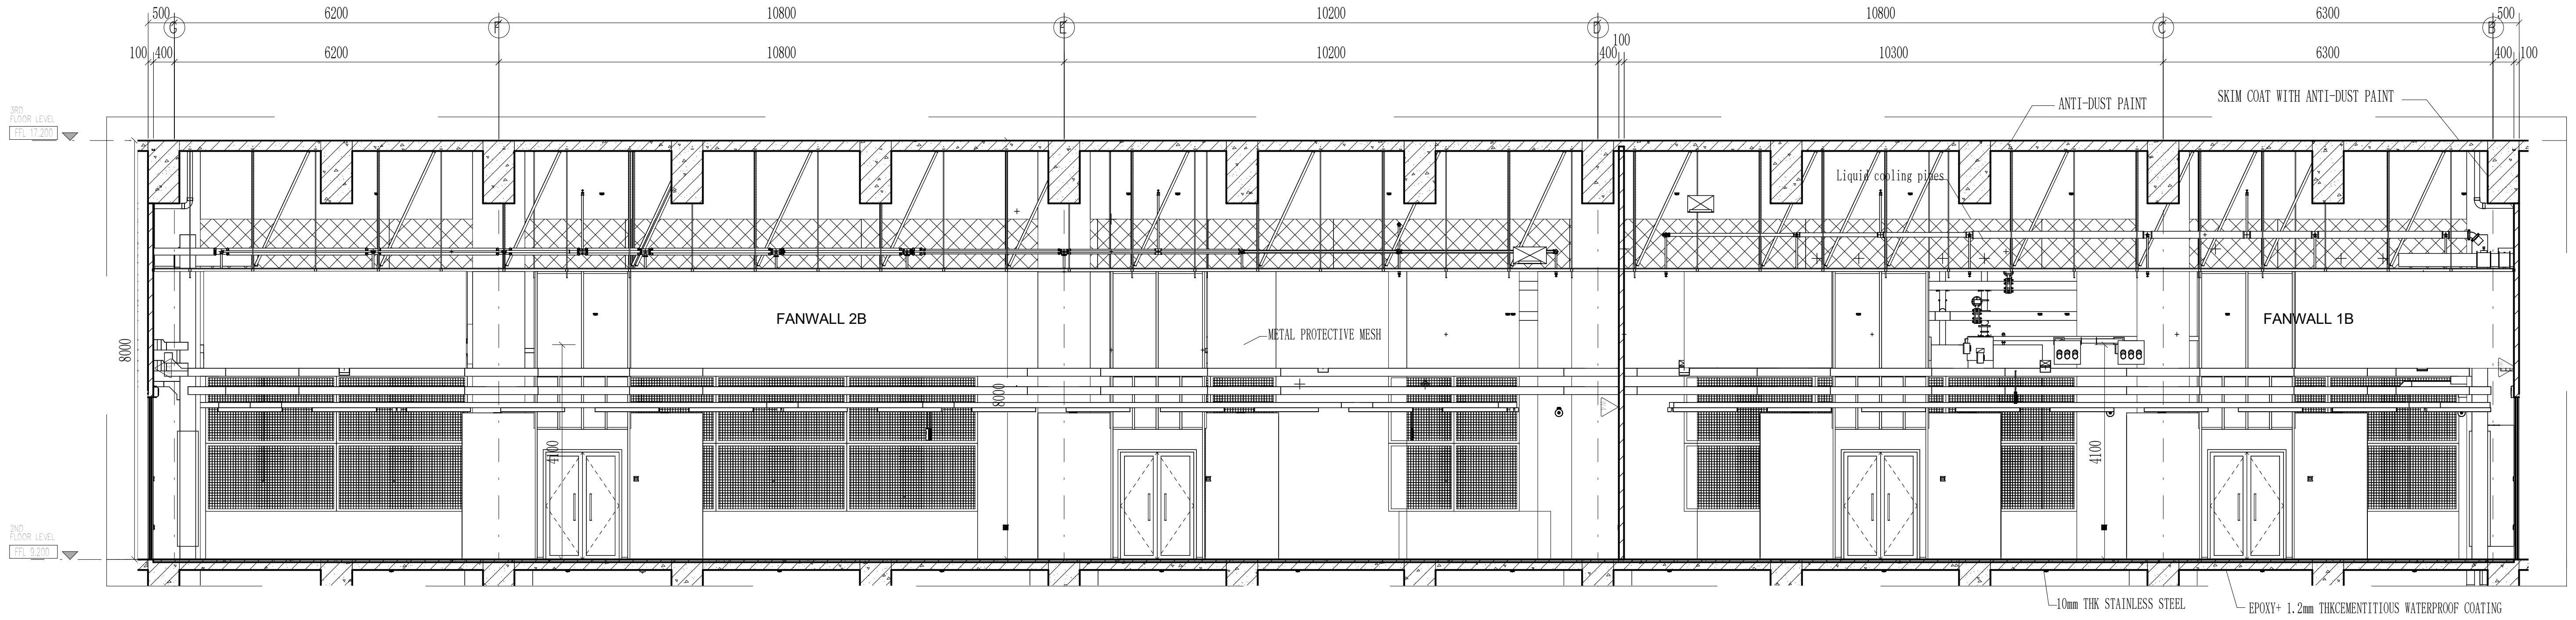

FANWALL 1B～2B SECTION D-D Scale 1:75

CLIENT :

GULF EDGE DC 01
87 Wireless Road, M Thai Tower 11th. Floor, All Seasons Place, Lumpini,
Pathumwan, Bangkok 10330, Thailand

CONTRACTOR :

华西发展(泰国)有限公司
บริษัท หัวซือ ดีเวลลอปเม้นต์ (ประเทศไทย) จำกัด
HUASHI DEVELOPMENT CO.,LTD
No. 202, Room No. 1403, 14/F, Le Concorde Building,
Ratchadapisek Road, Huaykhwang Sub-District,
Huaykhwang District, Bangkok Metropolitan 10310.

CONSULTANT :

ARbay
บริษัท เอ อาร์ เบย์ จำกัด
ARbay Company Limited
31 st Floor Bangkok Insurance Building
25 South Sathorn road Thungmahamek
Sathorn Bangkok 10120 THAILAND
T +66 (0) 2286 8199
F +66 (0) 2286 2863
info@arbay.co.th

CONSULTANT :

Qbic Engineers & Architects Co.,Ltd.
8 Soi KALONG 4 SANAMBINNAM ROAD,
THASAI SUB-DISTRICT, MUANG NONTHABURI DISTRICT
, NONTHABURI.
Tel 662-950-4374
Fax 662-580-3231
E-Mail : qbic@qbic.co.th, www.qbic.co.th
QBIC ENGINEERS AND ARCHITECTS CO.,LTD.

CONSULTANT :

MITR
MITR TECHNICAL CONSULTANT CO.,LTD.
1168/8 12th FLOOR, LUMPINI TOWER BUILDING,
RAMA IV RD., THUNGMAHAMEK, SATHORN, BANGKOK 10120, THAILAND
TEL : 0-2679-9079-84
FAX : 0-2679-9085 E-mail: mitr_dd@mitr.com

Architect :	SIGNATURE
ประกิต พนานุรัตน์ วสถ. 580 ที่อยู่ 251/1 ถ.จารุเมือง แขวงรองเมือง เขตปทุมวัน กรุงเทพมหานคร โทรศัพท์ 02-286-8199	

Structural Engineer :	SIGNATURE
วิศวกรผู้ออกแบบโครงสร้าง	
ณัฐสม สงวนวงษ์ วย 1423 ที่อยู่ 2/1 ซ.รามคำแหง 150 ถ.รามคำแหง แขวง สะพานสูง เขต สะพานสูง กทม. 10240	

Structural Inspector :	SIGNATURE
วิศวกรผู้ตรวจสอบโครงสร้าง	
โกมล จุฑาภัทร วย 964 ที่อยู่ 24/18 ซ.นวมินทร์ 129 ถ. นวมินทร์ แขวง นวลจันทร์ เขต บึงกุ่ม กทม. 10230	

Electrical Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบไฟฟ้ากำลัง	
นายสุภัทร บูรณวิทย์ วฟก.1265 ที่อยู่ 21 ซอยทานสัมฤทธิ์ 13 ตำบลท่าทราย อ.เมืองนนทบุรี จ.นนทบุรี 11000	

Mechanical Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบเครื่องกลและปรับอากาศ	
นายประสิทธิ์ เกี้ยวสุนทร วก.1221 ที่อยู่ 44/372 ซอยบางกระดี่ 35/1 แขวงแสมดำ เขตบางขุนเทียน กทม. 10150	ประสิทธิ์

Sanitary Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบสุขาภิบาล และดับเพลิง	
นายทศวรรษ สนั่นฤทธิ์ วส. 215 ที่อยู่ บ้านเลขที่ 99/107 หมู่ที่ 3 ต.ศีรษะจรเข้น้อย อ.บางเสาธง จ.สมุทรปราการ 10540	ทศวรรษ

ISSUE/REVISION

REV.	DESCRIPTION	DATE
A	90% DEVELOPED	09/05/2026

PROJECT NAME :

GEDC 01

LOCATION:
Nikhom Phattana district, Rayong ,industrial estate,CPGC

BUILDING :
MAIN BUILDING

90% DEVELOPED

TITLE :
ROOM DETAIL-2F-SUPERCORE1,DATA HALL2-4 (AC), FANWALL1A-1B,2A-2B SECTION

JOB NO.		SCALE	1 : 75
DRAWN	LYT	REF.	
CHECKED	LJC	DWG. NO.	MPK01A-90-A-RD-208
APPROVED	LXD		
DATE	2026.05.09		

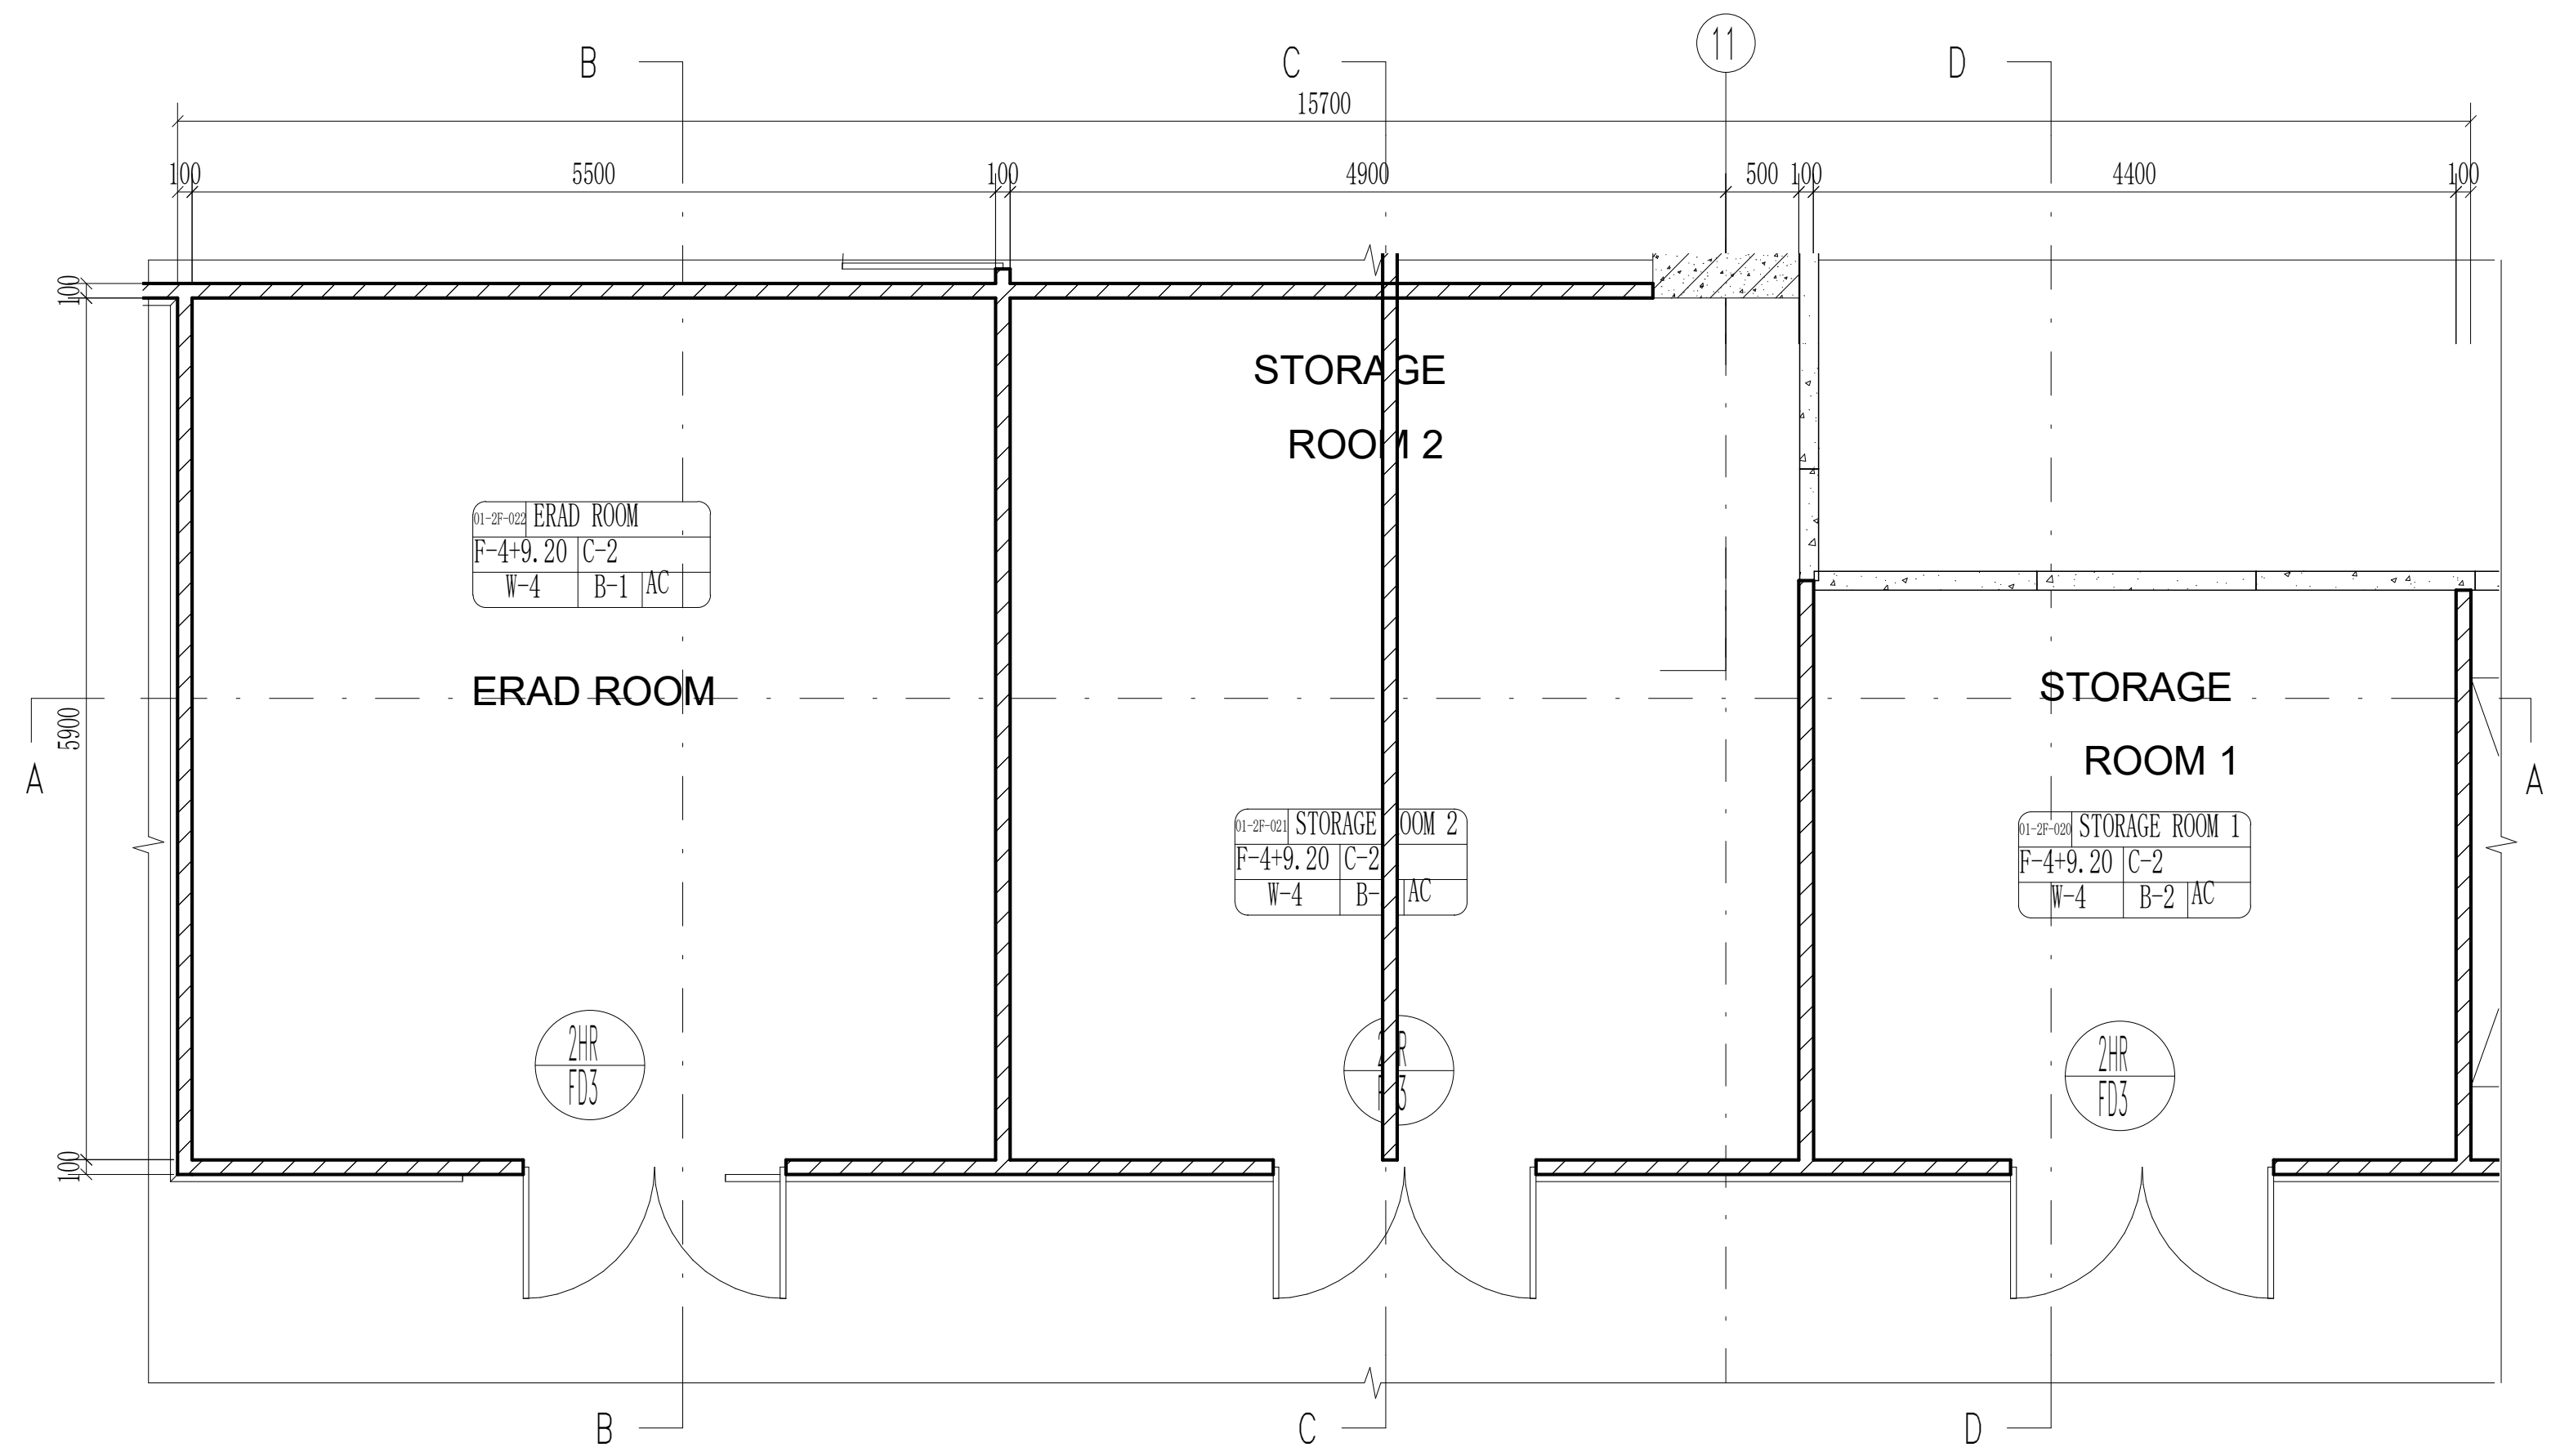

ERAD ROOM、 STORAGE ROOM 2ND FLOOR PLAN

Scale 1:50

THE "SFL" MARKED IN THE DRAWING REFERS TO THE STRUCTURAL FLOOR LEVEL, WHILE THE FINISHED FLOOR LEVEL (FFL) IS DETERMINED BASED ON FLOOR FINISHES.

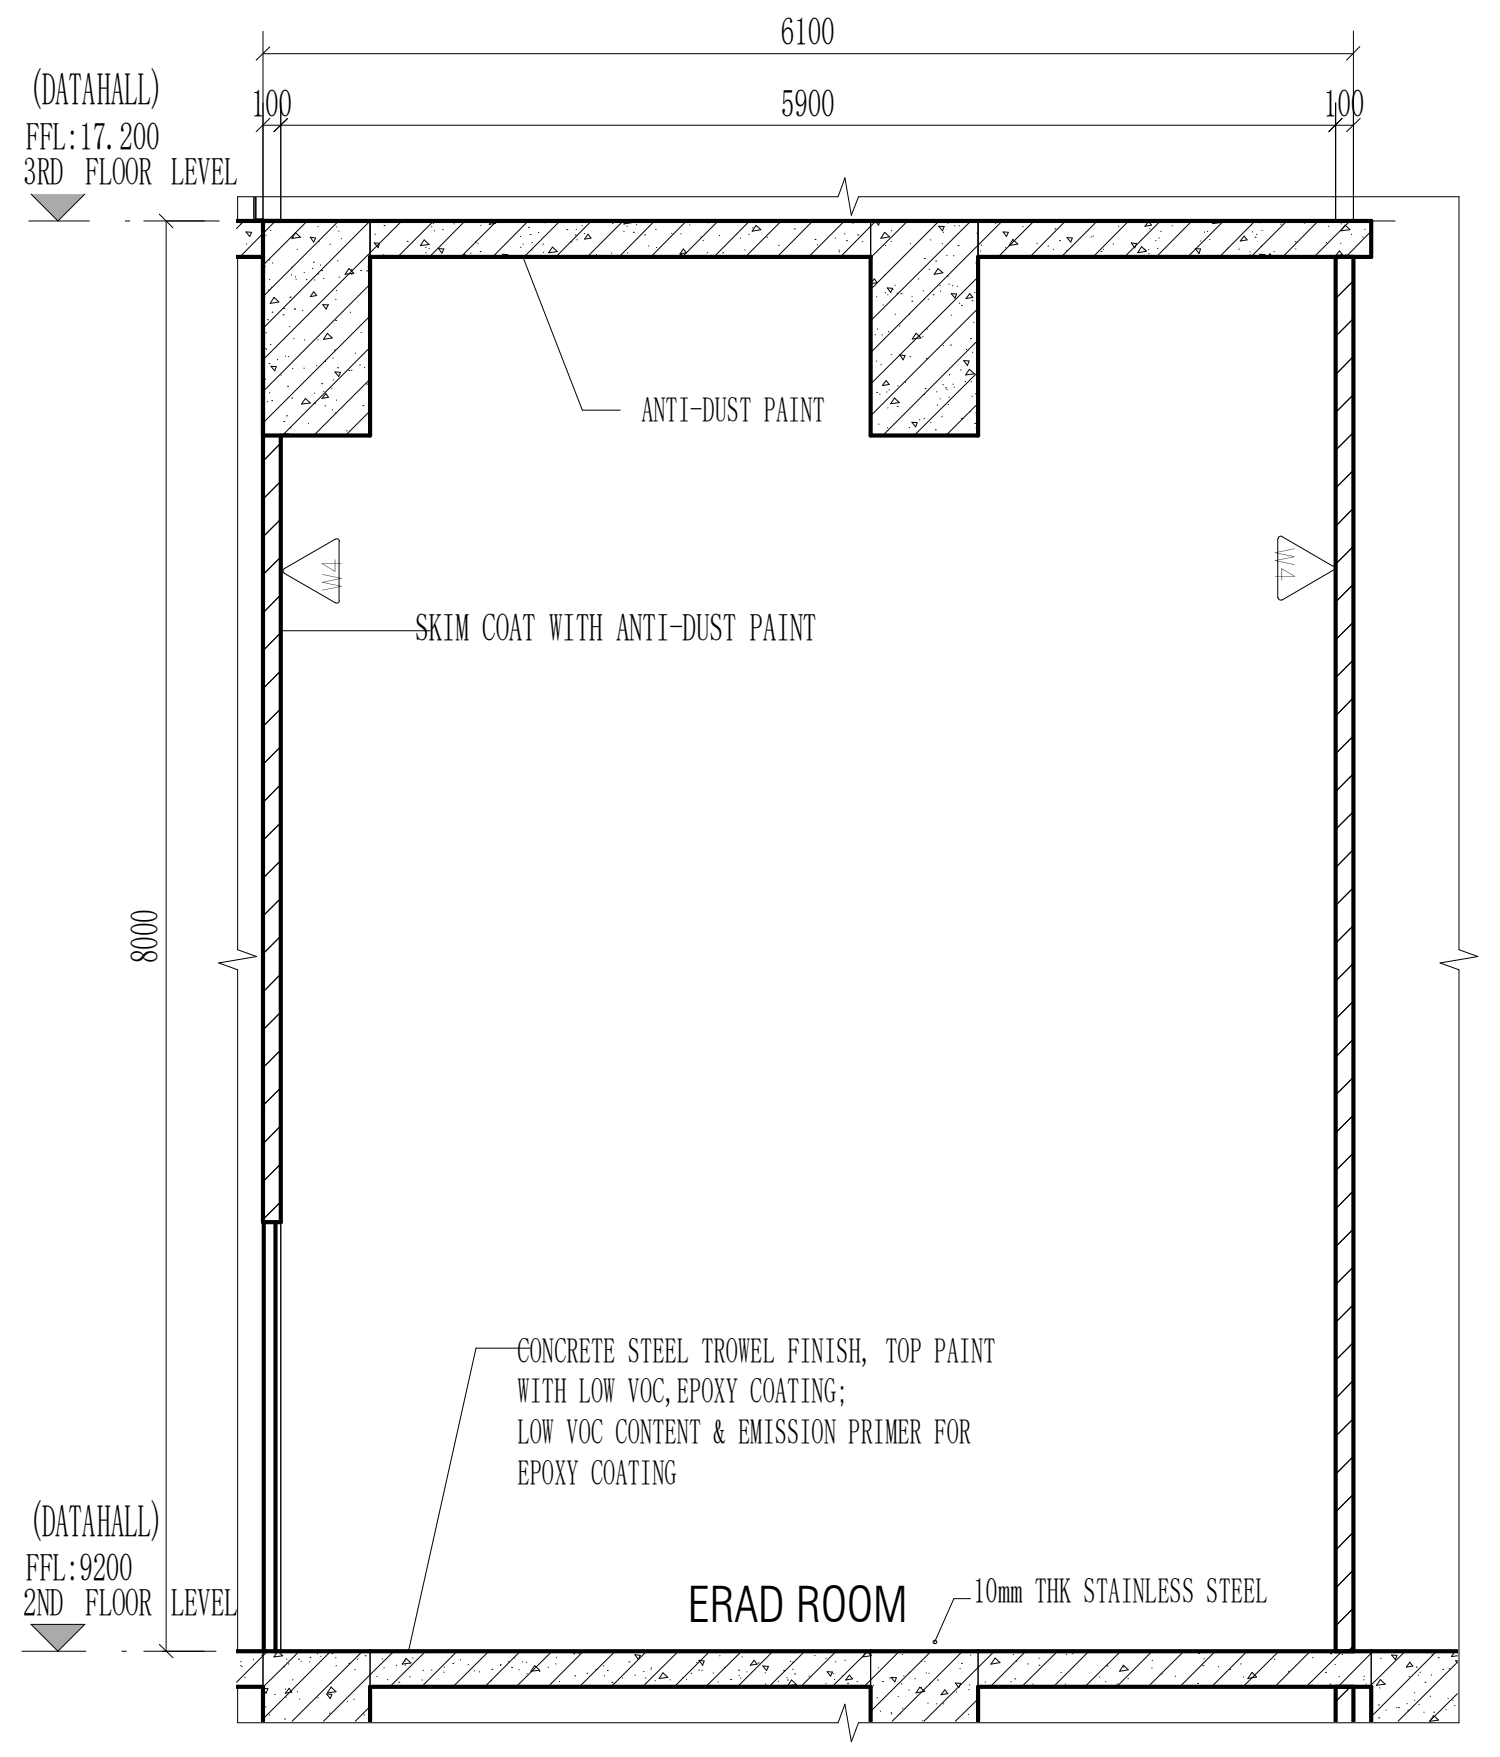
6100
100
5900
100
(DATAHALL)
FFL:17.200
3RD FLOOR LEVEL
ANTI-DUST PAINT
W4
SKIM COAT WITH ANTI-DUST PAINT
8000
CONCRETE STEEL TROWEL FINISH, TOP PAINT WITH LOW VOC,EPOXY COATING; LOW VOC CONTENT & EMISSION PRIMER FOR EPOXY COATING
(DATAHALL)
FFL:9200
2ND FLOOR LEVEL
ERAD ROOM
10mm THK STAINLESS STEEL

ERAD ROOM SECTION B-B

Scale 1:50

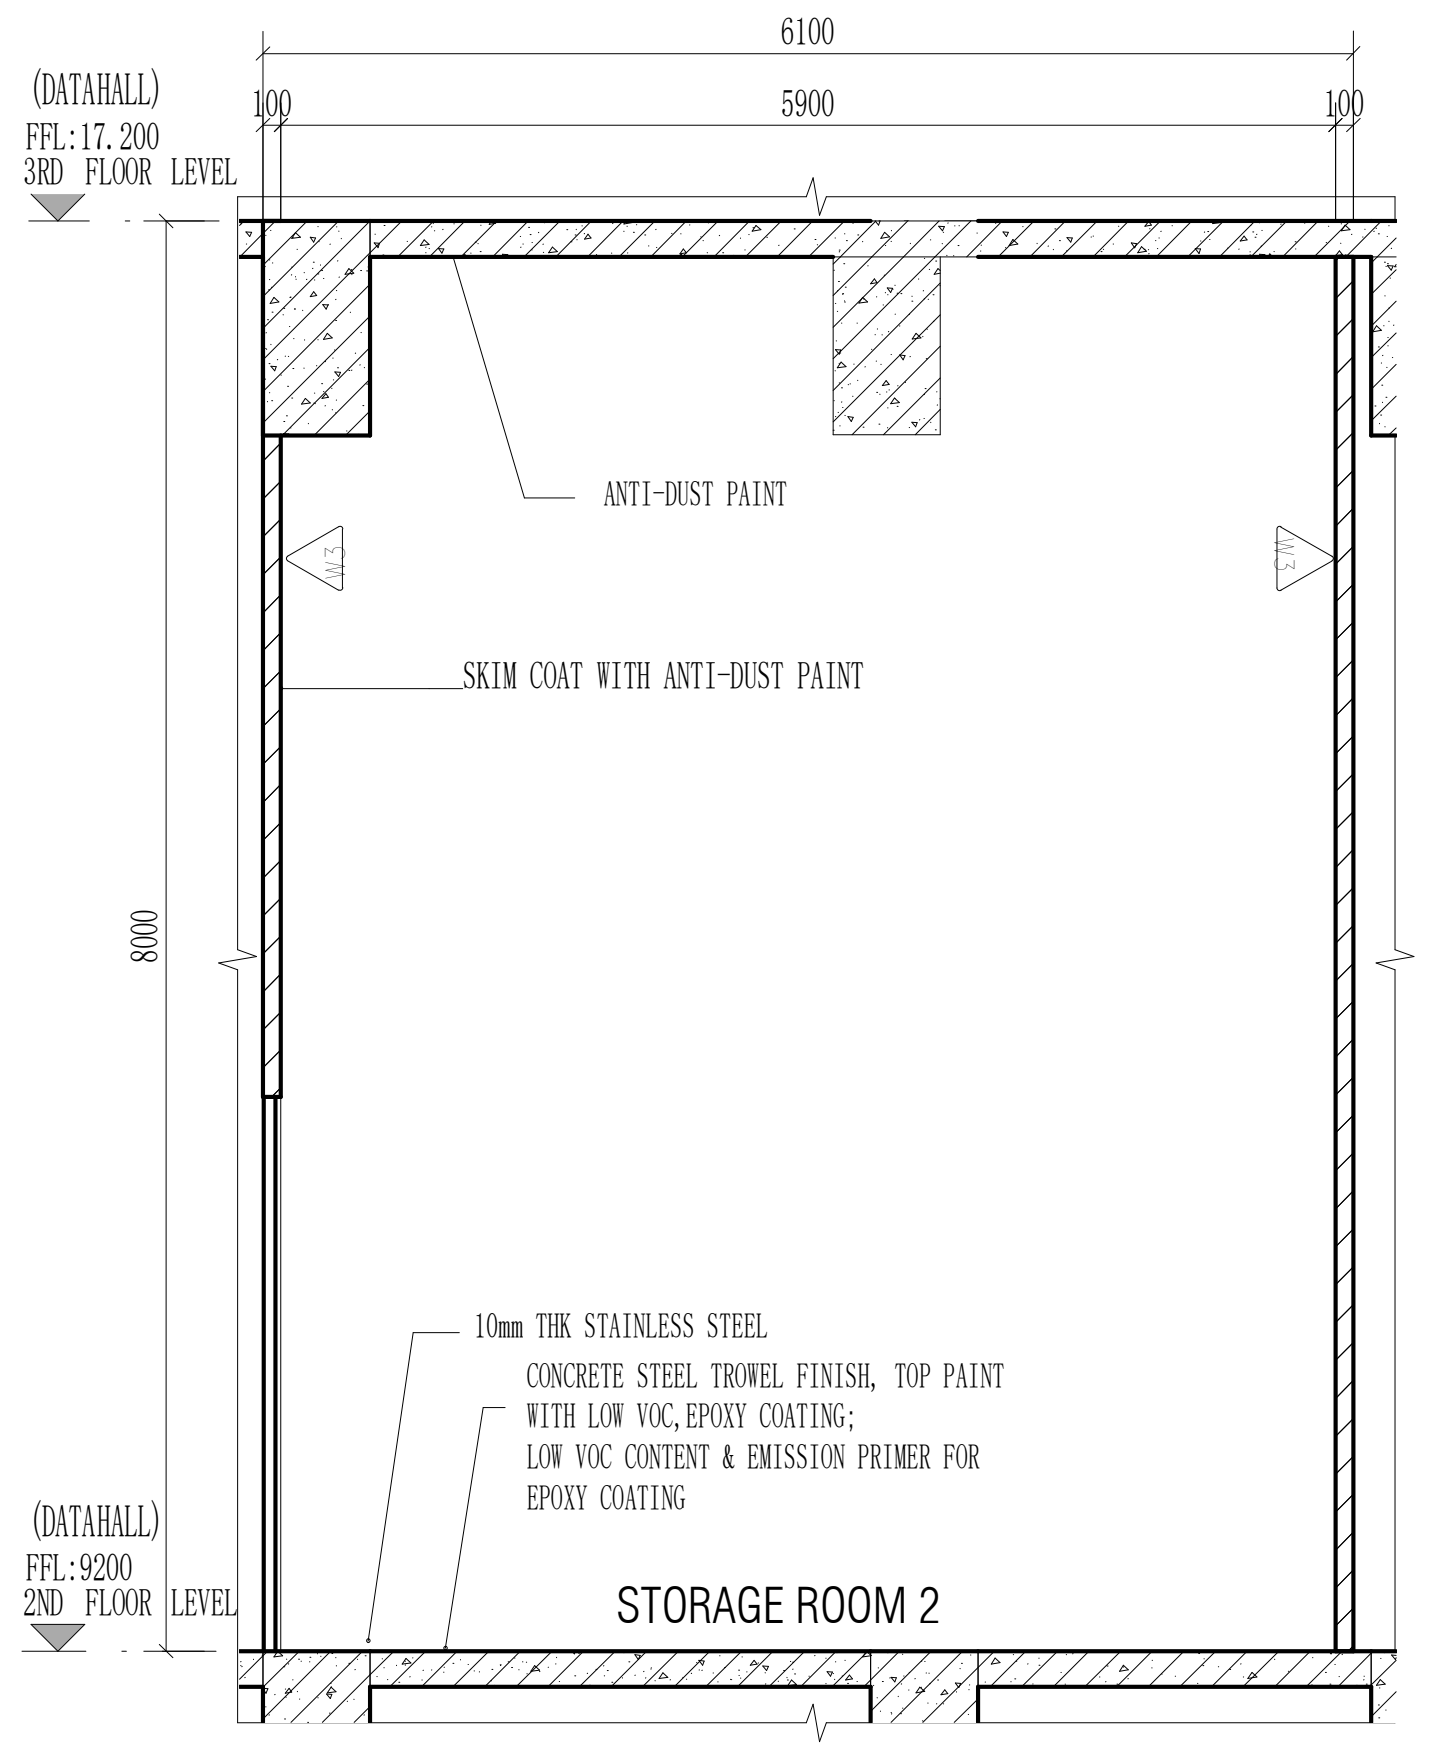
6100
100
5900
100
(DATAHALL)
FFL:17.200
3RD FLOOR LEVEL
ANTI-DUST PAINT
SKIM COAT WITH ANTI-DUST PAINT
8000
10mm THK STAINLESS STEEL
CONCRETE STEEL TROWEL FINISH, TOP PAINT WITH LOW VOC,EPOXY COATING; LOW VOC CONTENT & EMISSION PRIMER FOR EPOXY COATING
(DATAHALL)
FFL:9200
2ND FLOOR LEVEL
STORAGE ROOM 2

STORAGE ROOM 2 SECTION C-C

Scale 1:50

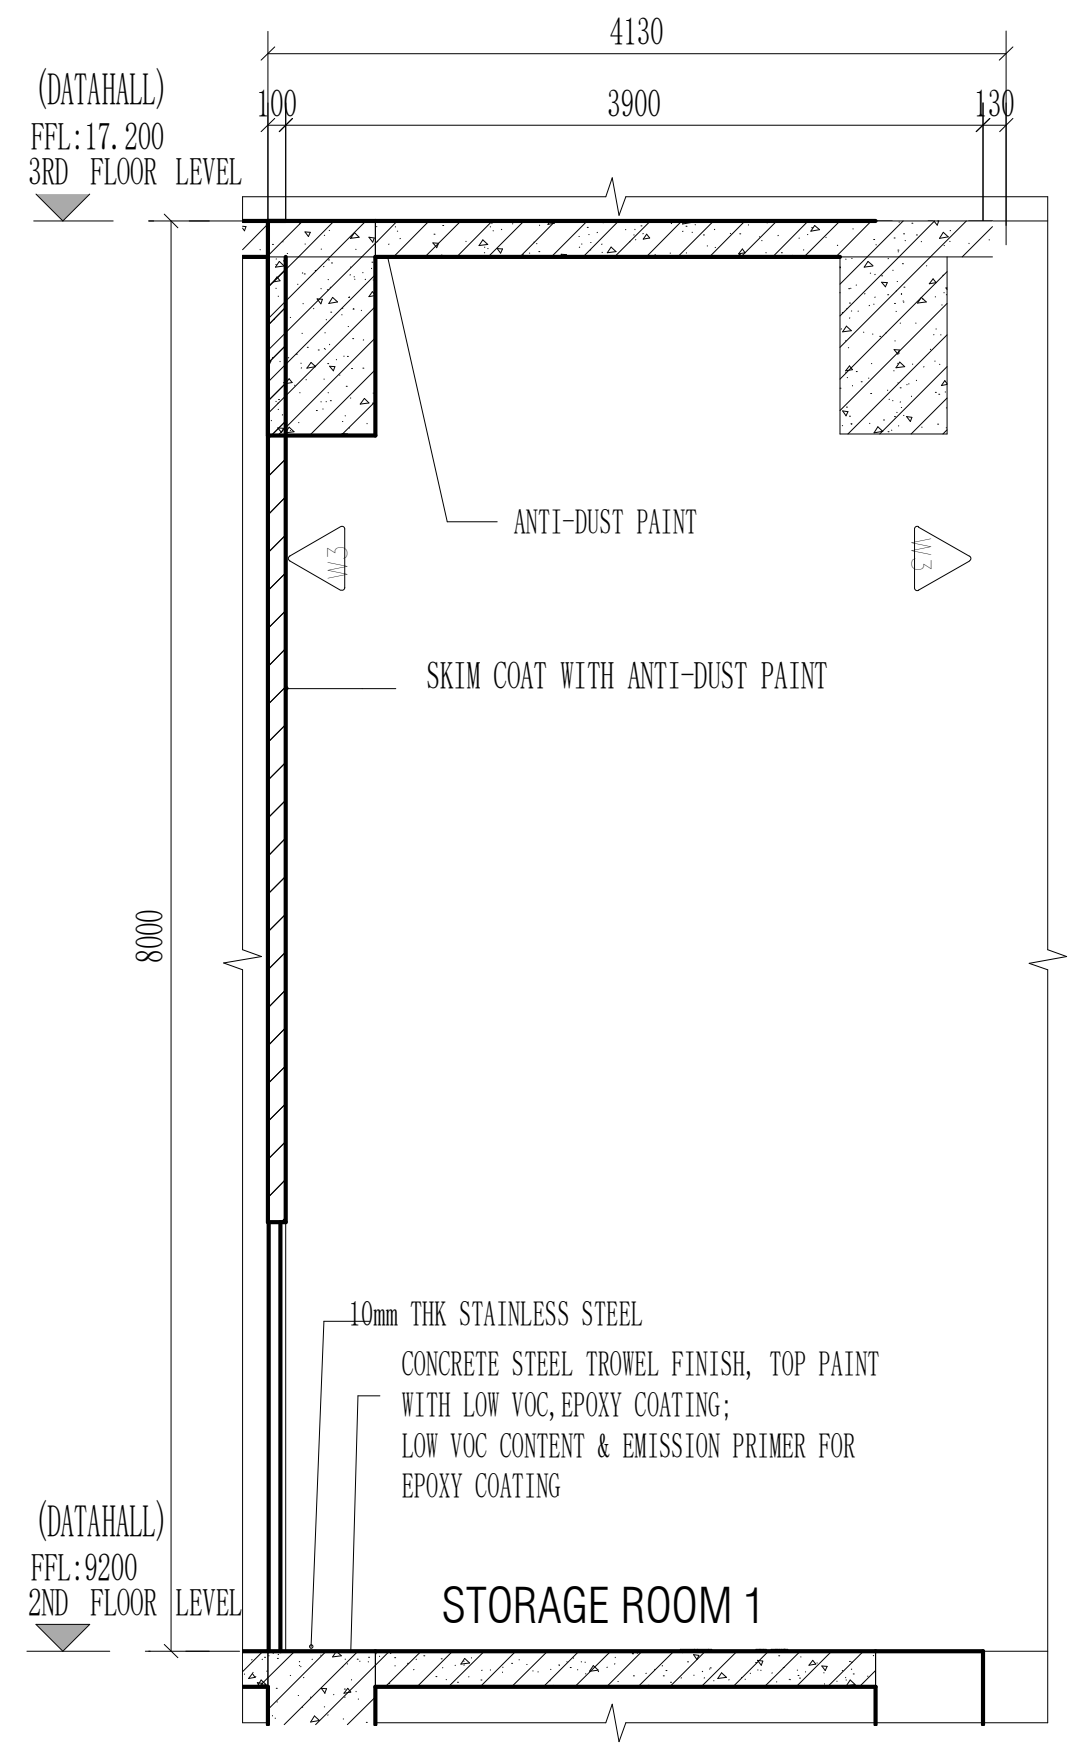
4130
100
3900
130
(DATAHALL)
FFL:17.200
3RD FLOOR LEVEL
ANTI-DUST PAINT
SKIM COAT WITH ANTI-DUST PAINT
8000
10mm THK STAINLESS STEEL
CONCRETE STEEL TROWEL FINISH, TOP PAINT WITH LOW VOC,EPOXY COATING; LOW VOC CONTENT & EMISSION PRIMER FOR EPOXY COATING
(DATAHALL)
FFL:9200
2ND FLOOR LEVEL
STORAGE ROOM 1

STORAGE ROOM 1 SECTION D-D

Scale 1:50

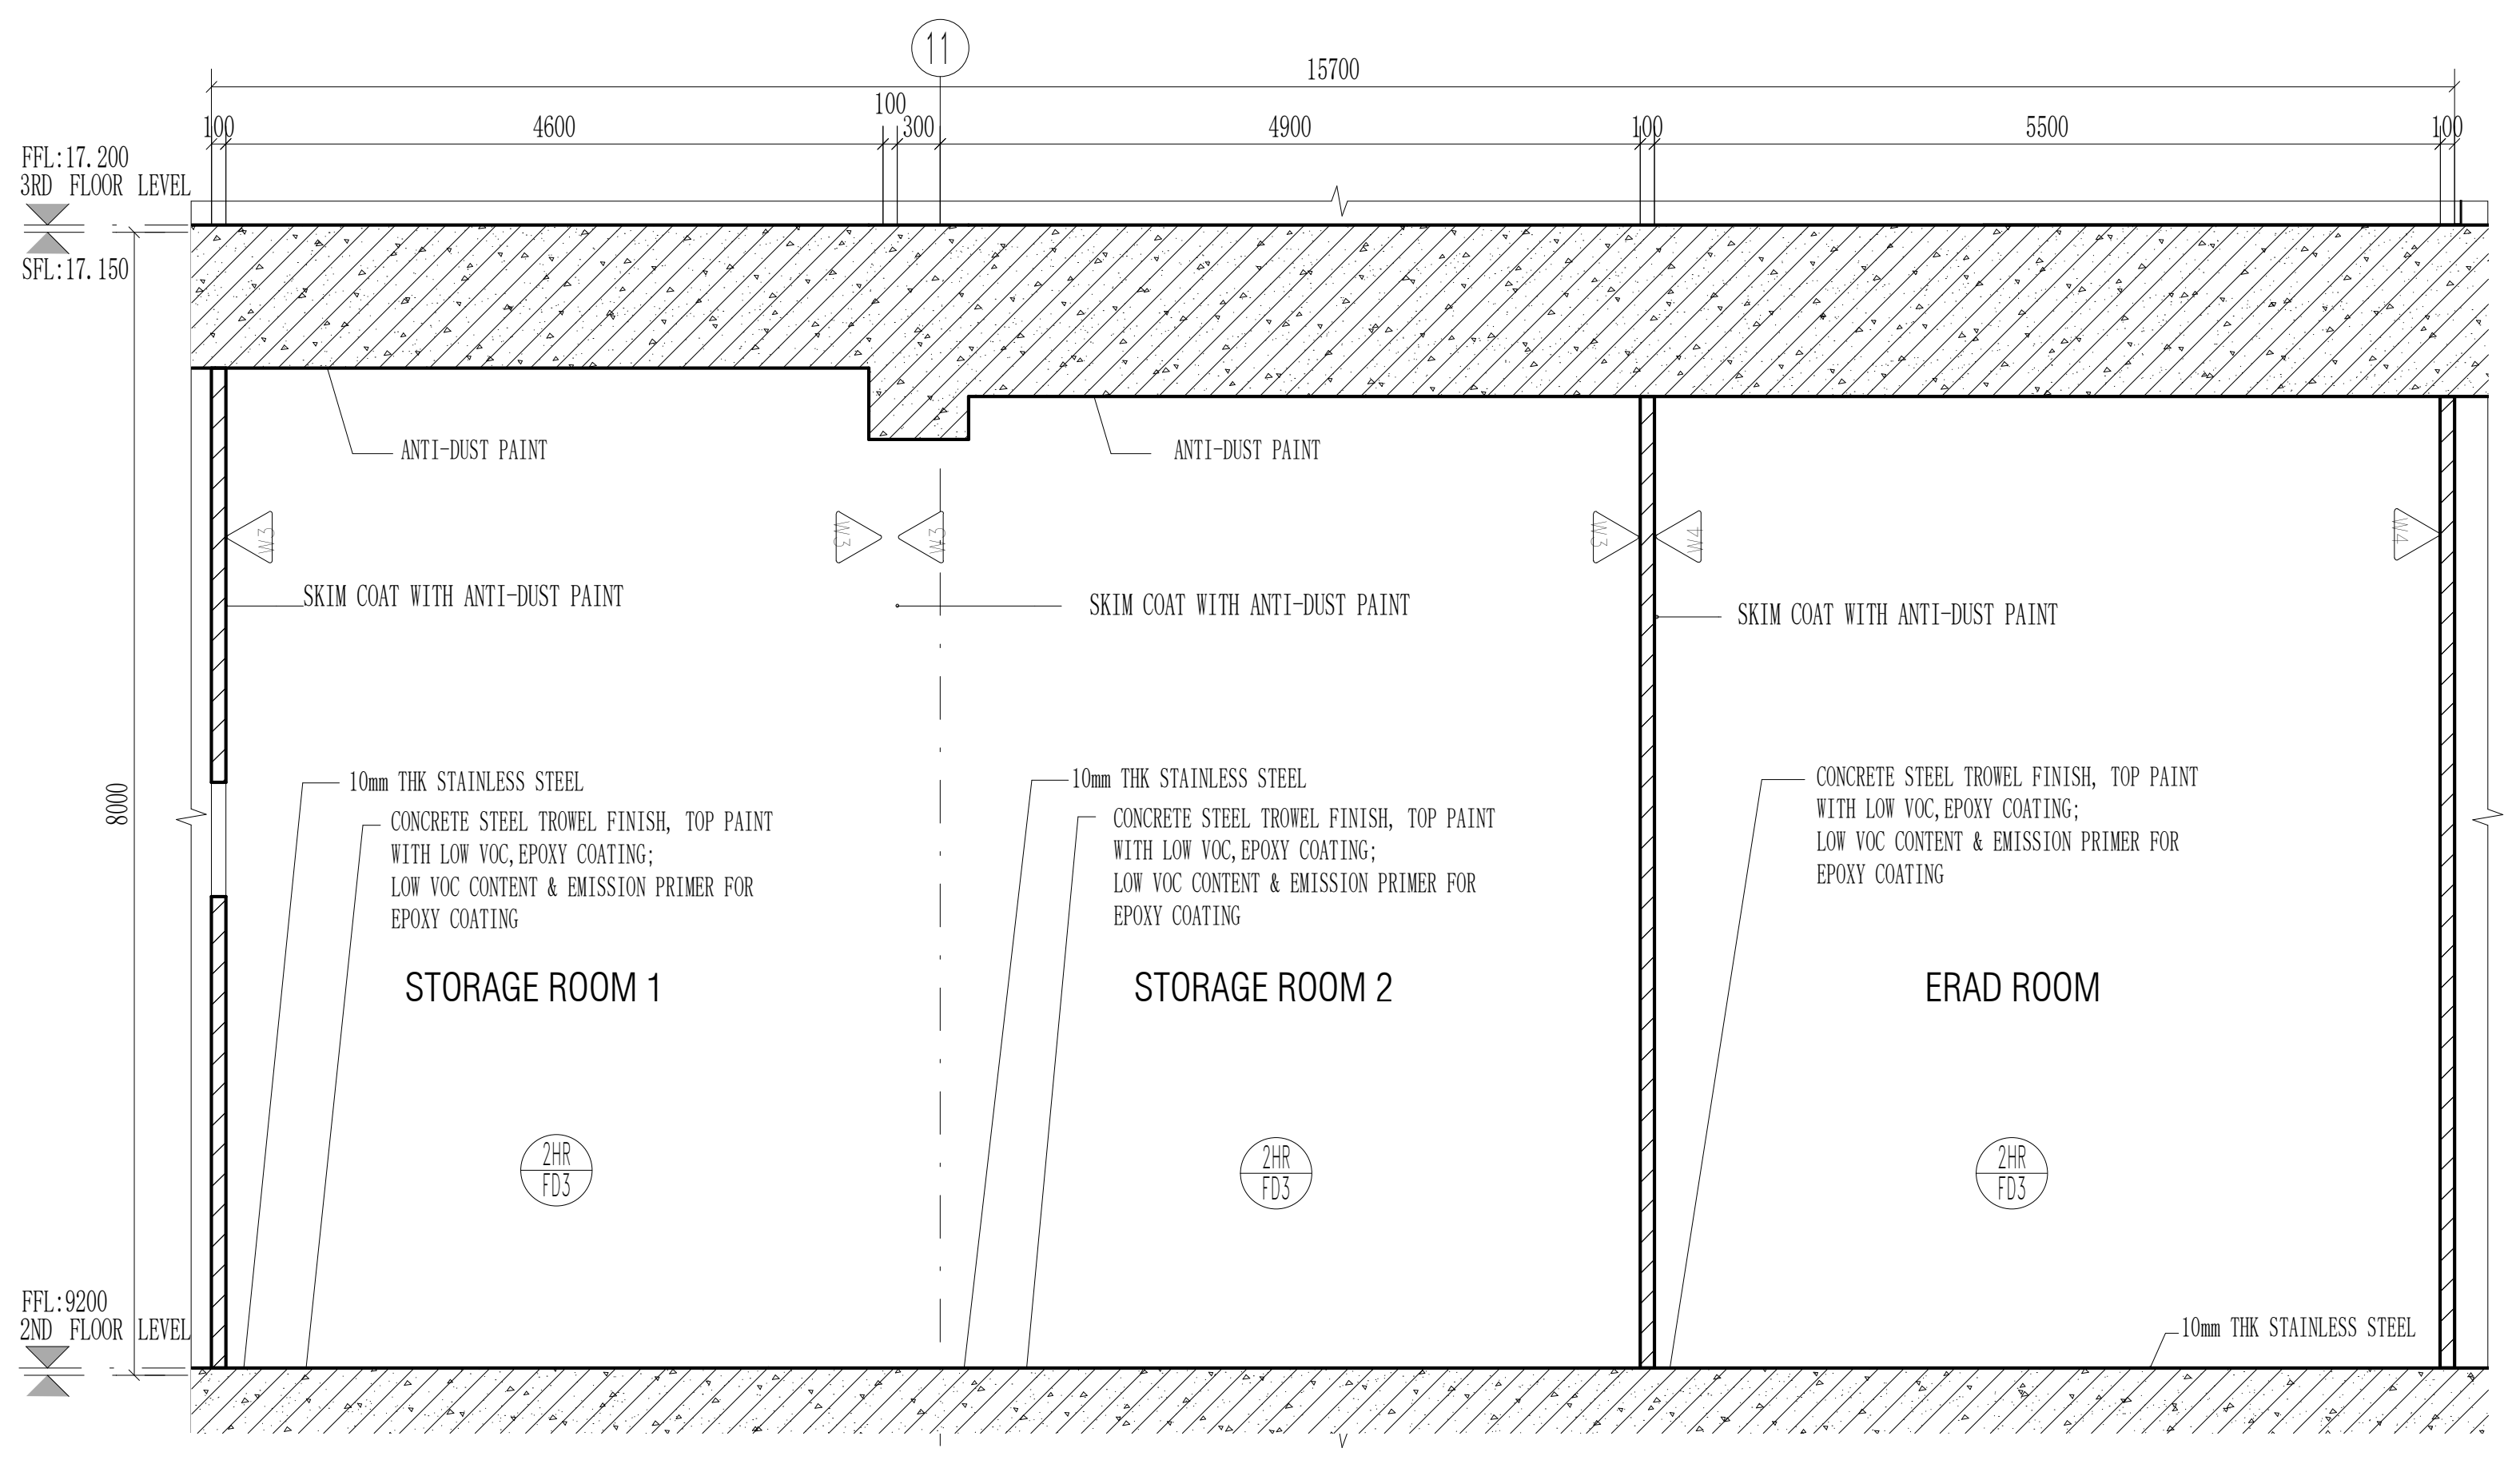

ERAD ROOM、 STORAGE ROOM SECTION A-A

Scale 1:50

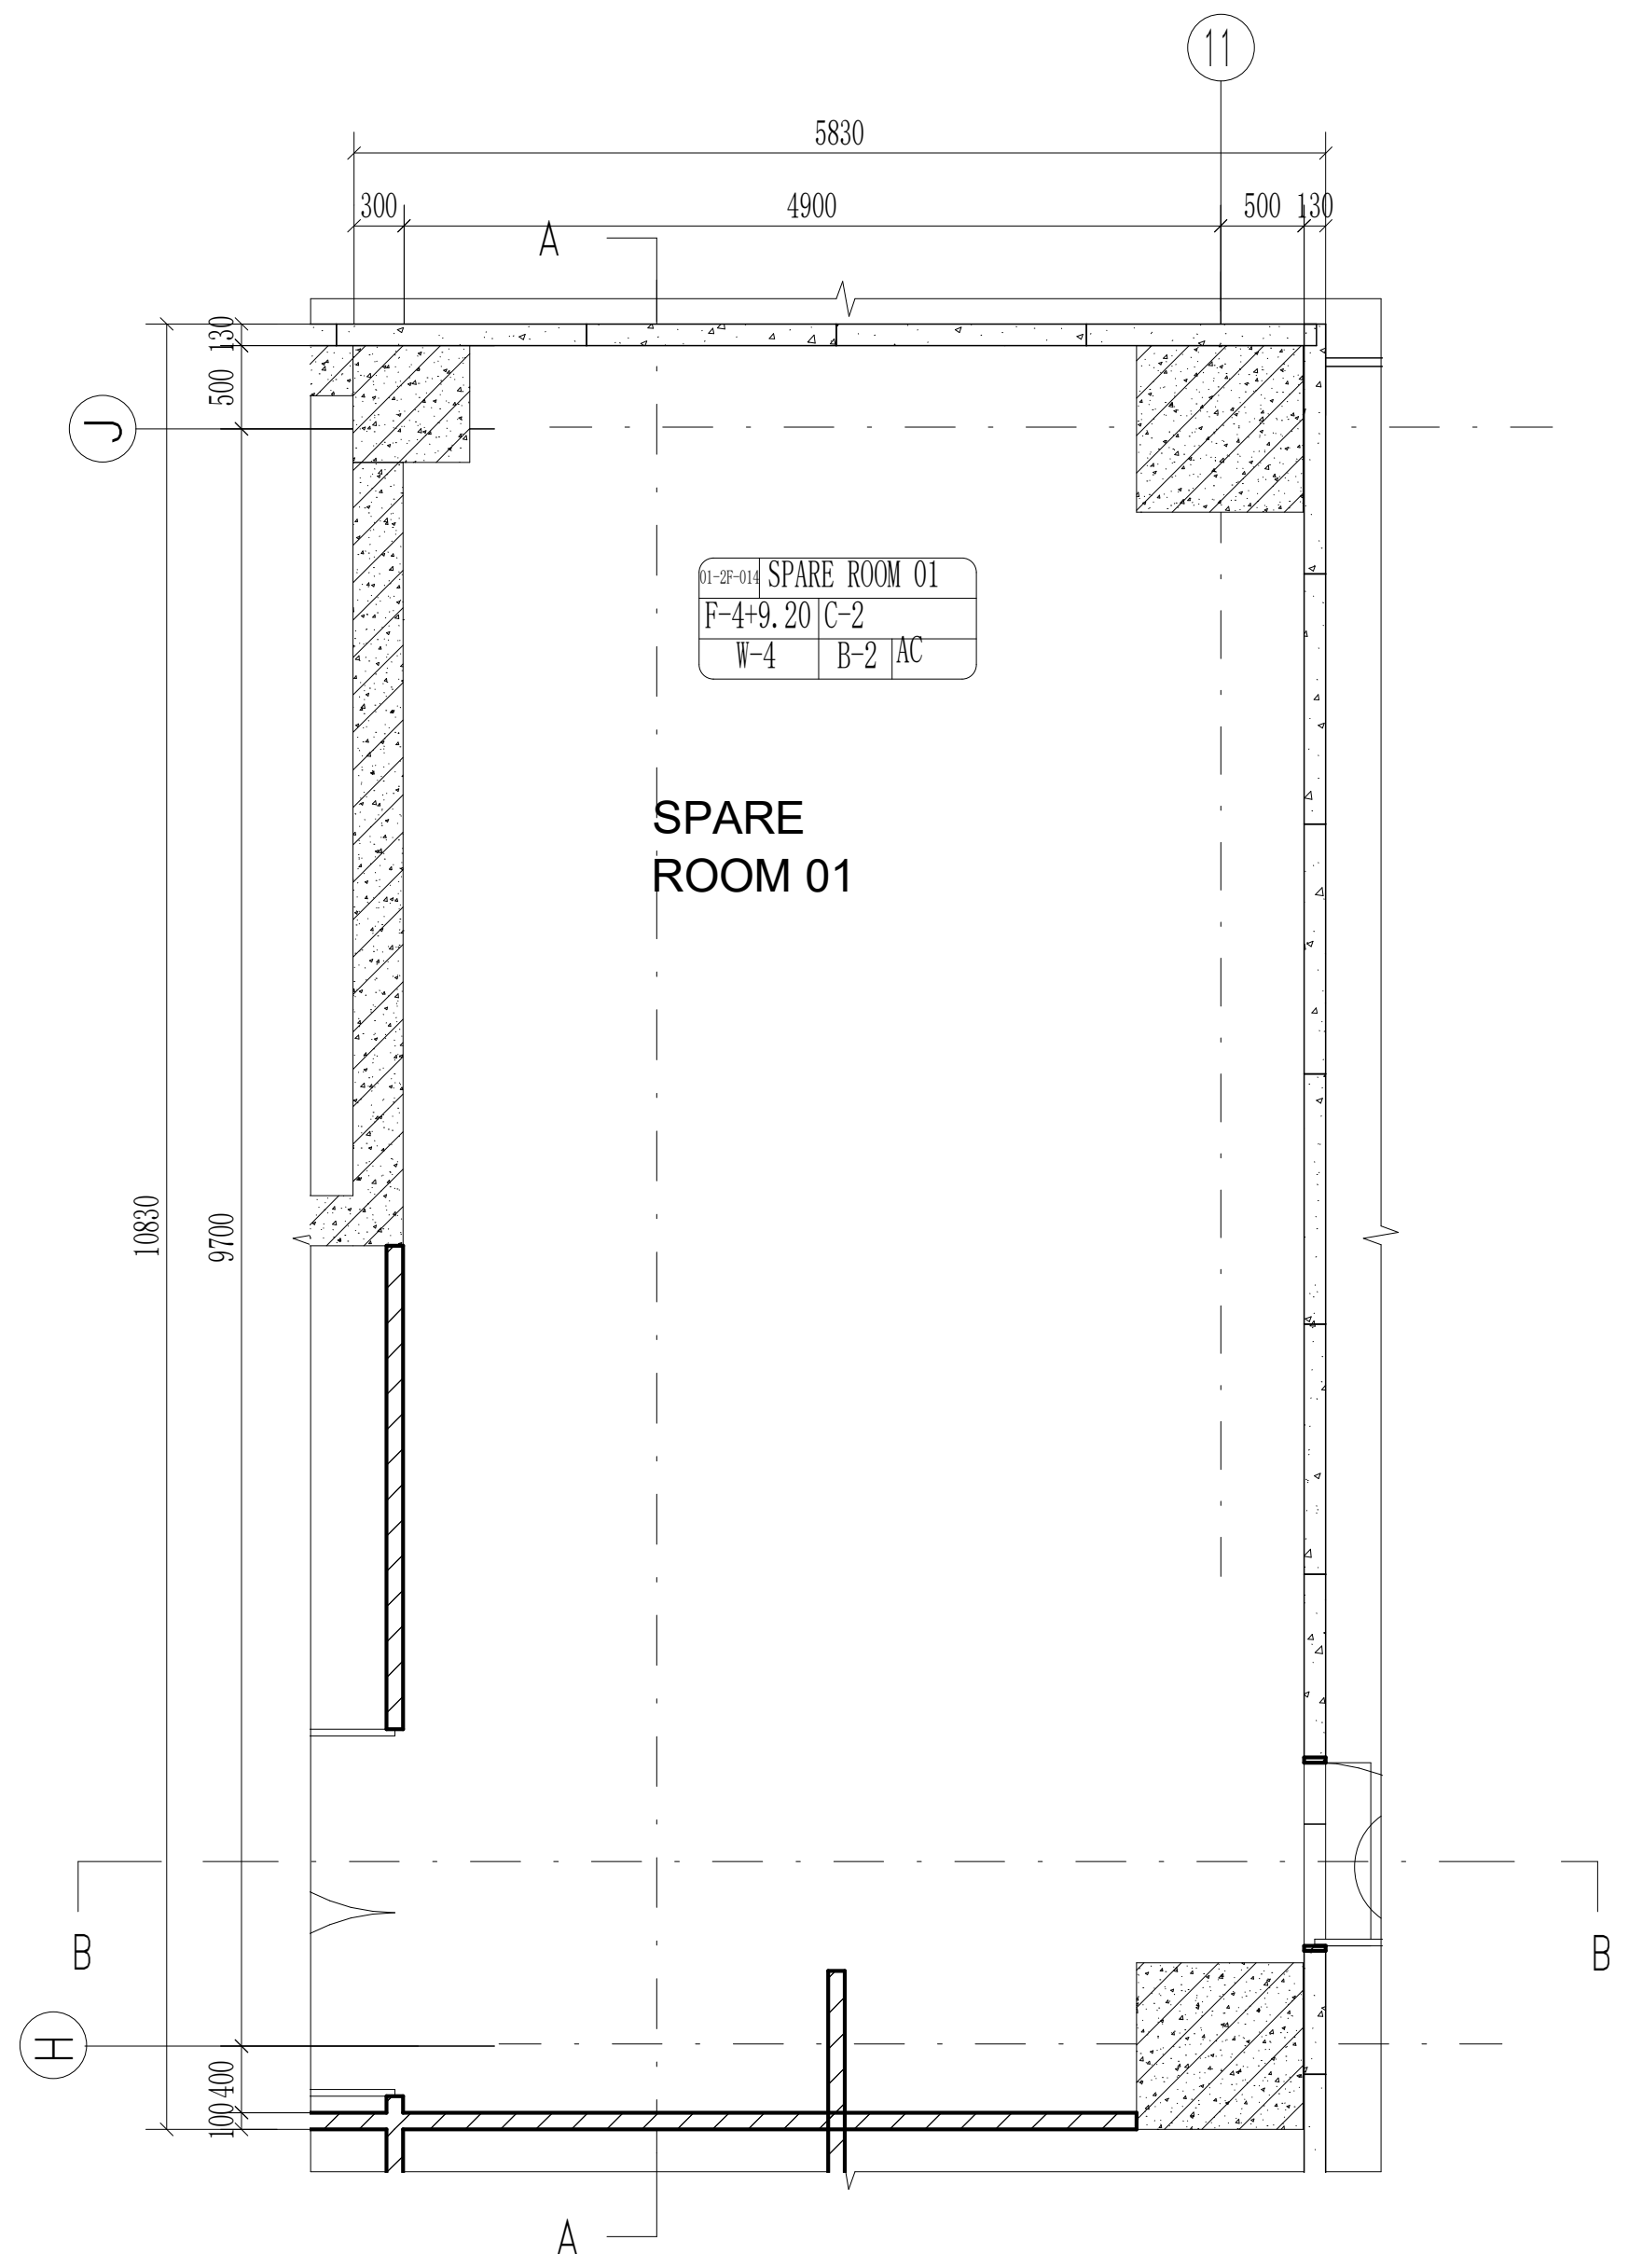

SPARE ROOM 2ND FLOOR PLAN

Scale 1:50

THE "SFL" MARKED IN THE DRAWING REFERS TO THE STRUCTURAL FLOOR LEVEL, WHILE THE FINISHED FLOOR LEVEL (FFL) IS DETERMINED BASED ON FLOOR FINISHES.

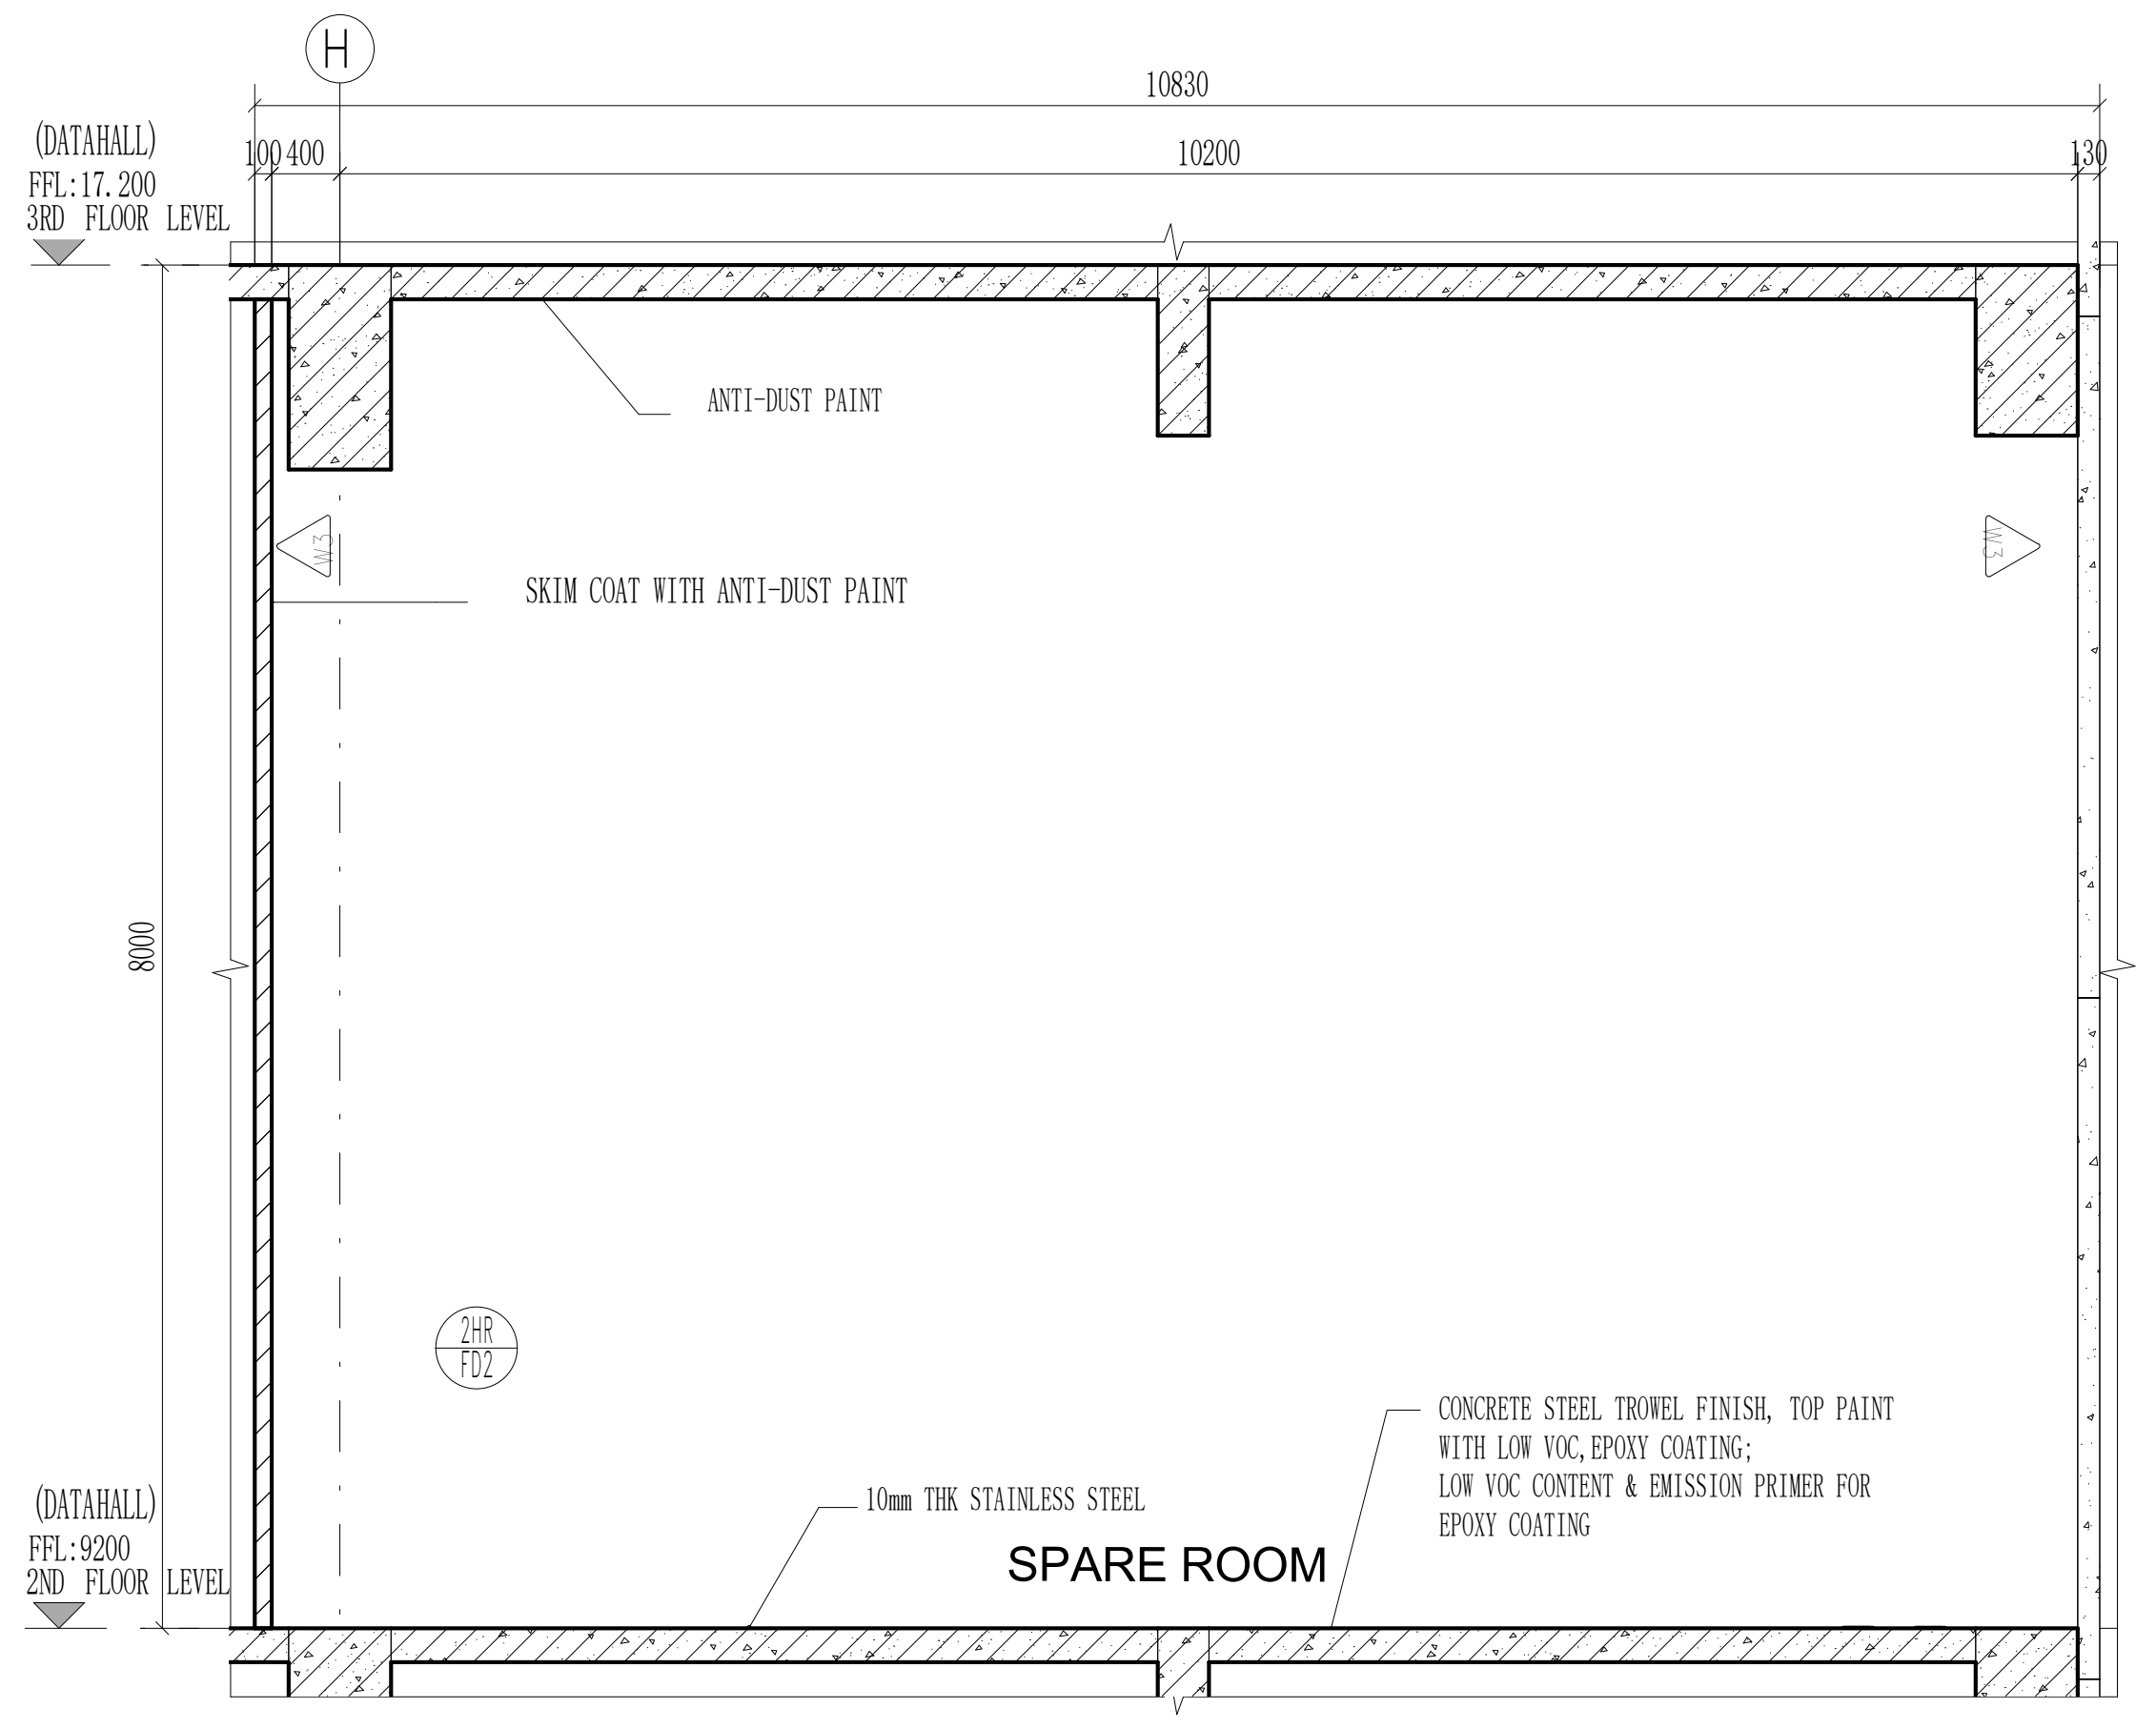
H
10830
100 400
10200
130
(DATAHALL)
FFL:17.200
3RD FLOOR LEVEL
ANTI-DUST PAINT
SKIM COAT WITH ANTI-DUST PAINT
8000
CONCRETE STEEL TROWEL FINISH, TOP PAINT WITH LOW VOC,EPOXY COATING; LOW VOC CONTENT & EMISSION PRIMER FOR EPOXY COATING
10mm THK STAINLESS STEEL
SPARE ROOM
(DATAHALL)
FFL:9200
2ND FLOOR LEVEL

SPARE ROOM SECTION A-A

Scale 1:50

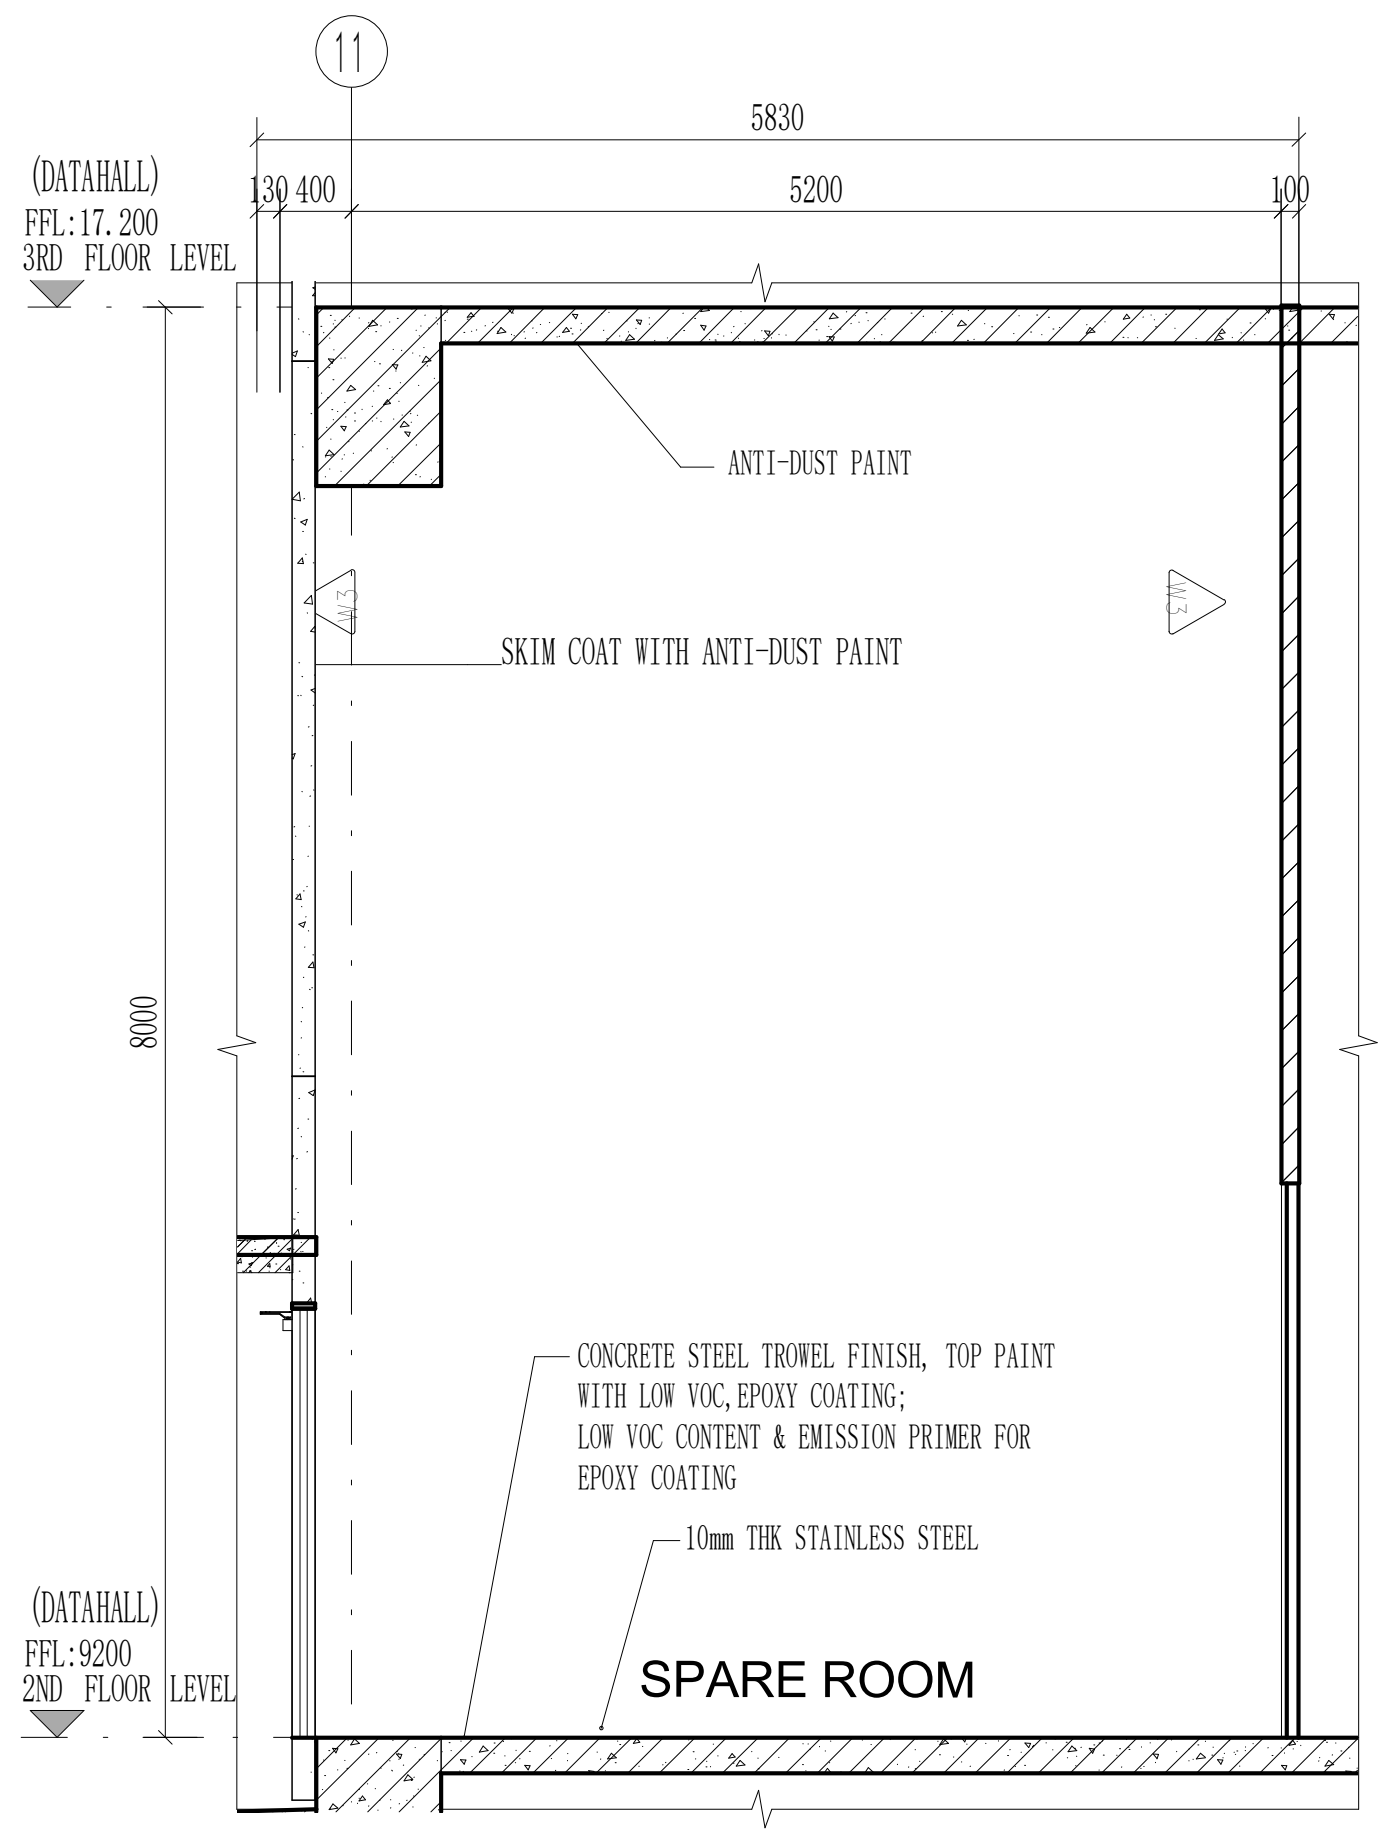
11
5830
130 400
5200
100
(DATAHALL)
FFL:17.200
3RD FLOOR LEVEL
ANTI-DUST PAINT
SKIM COAT WITH ANTI-DUST PAINT
8000
CONCRETE STEEL TROWEL FINISH, TOP PAINT WITH LOW VOC,EPOXY COATING; LOW VOC CONTENT & EMISSION PRIMER FOR EPOXY COATING
10mm THK STAINLESS STEEL
SPARE ROOM
(DATAHALL)
FFL:9200
2ND FLOOR LEVEL

SPARE ROOM SECTION B-B

Scale 1:50

CLIENT :

GULF EDGE DC 01

87 Wireless Road, M Thai Tower 11th. Floor, All Seasons Place, Lumpini,
Pathumwan, Bangkok 10330, Thailand

CONTRACTOR :

华西发展(泰国)有限公司
บริษัท หัวซือ ดีเวลลอปเม้นต์ (ประเทศไทย) จำกัด
HUASHI DEVELOPMENT CO.,LTD
No. 202, Room No. 1403, 14/F, Le Concorde Building,
Ratchadapisek Road, Huaykhwang Sub-District,
Huaykhwang District, Bangkok Metropolitan 10310.

CONSULTANT :

ARbay
บริษัท เอ อาร์ เบย์ จำกัด
ARbay Company Limited
31 st Floor Bangkok Insurance Building
25 South Sathorn road Thungmahamek
Sathorn Bangkok 10120 THAILAND
T +66 (0) 2286 8199
F +66 (0) 2286 2863
info@arbay.co.th

CONSULTANT :

Qbic Engineers & Architects Co.,Ltd.
8 Soi KALONG 4 SANAMBINNAM ROAD,
THASAI SUB-DISTRICT, MUANG NONTHABURI DISTRICT
, NONTHABURI.
Tel 662-950-4374
Fax 662-580-3231
E-Mail : qbic@qbic.co.th, www.qbic.co.th
QBIC ENGINEERS AND ARCHITECTS CO.,LTD.

CONSULTANT :

MITR
MITR TECHNICAL CONSULTANT CO.,LTD.
1168/8 12th FLOOR, LUMPINI TOWER BUILDING,
RAMA IV RD., THUNGMAHAMEK, SATHORN, BANGKOK 10120, THAILAND
TEL : 0-2679-9079-84
FAX : 0-2679-9085 E-mail: mitr_dd@mitr.com

Architect :	SIGNATURE
ประกิต พนานุรัตน์ วสถ. 580 ที่อยู่ 251/1 ถ.จารุเมือง แขวงรองเมือง เขตปทุมวัน กรุงเทพมหานคร โทรศัพท์ 02-286-8199	
Structural Engineer :	SIGNATURE
วิศวกรผู้ออกแบบโครงสร้าง	
ณัฐสม สงวนวงษ์ วย 1423 ที่อยู่ 2/1 ซ.รามคำแหง 150 ถ.รามคำแหง แขวง สะพานสูง เขต สะพานสูง กทม. 10240	
Structural Inspector :	SIGNATURE
วิศวกรผู้ตรวจสอบโครงสร้าง	
โกมล จุฑาภัทร วย 964 ที่อยู่ 24/18 ซ.นวมินทร์ 129 ถ. นวมินทร์ แขวง นวลจันทร์ เขต บึงกุ่ม กทม. 10230	
Electrical Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบไฟฟ้ากำลัง	
นายสุภัทร บูรณวิทย์ วฟก.1265 ที่อยู่ 21 ซอยทานสัมฤทธิ์ 13 ตำบลท่าทราย อ.เมืองนนทบุรี จ.นนทบุรี 11000	
Mechanical Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบเครื่องกลและปรับอากาศ	
นายประสิทธิ์ เกี้ยวสุนทร วก.1221 ที่อยู่ 44/372 ซอยบางกระดี่ 35/1 แขวงแสมดำ เขตบางขุนเทียน กทม. 10150	ประสิทธิ์
Sanitary Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบสุขาภิบาล และดับเพลิง	
นายทศวรรษ สนั่นฤทธิ์ วส. 215 ที่อยู่ บ้านเลขที่ 99/107 หมู่ที่ 3 ต.ศีรษะจรเข้น้อย อ.บางเสาธง จ.สมุทรปราการ 10540	ทศวรรษ

ISSUE/REVISION

REV.	DESCRIPTION	DATE
A	90% DEVELOPED	09/05/2026

PROJECT NAME :

GEDC 01

LOCATION:
Nikhom Phattana district, Rayong ,industrial estate,CPGC

BUILDING :
MAIN BUILDING

90% DEVELOPED

TITLE :

ROOM
TAIL-2F-STORAGEROOM,ADROOM,ARE

JOB NO.	SCALE 1 : 50
DRAWN 作者	REF.
CHECKED 审图员	DWG. NO. MPK01A-90-A-RD-209
APPROVED 审核者	
DATE 2026.05.09	

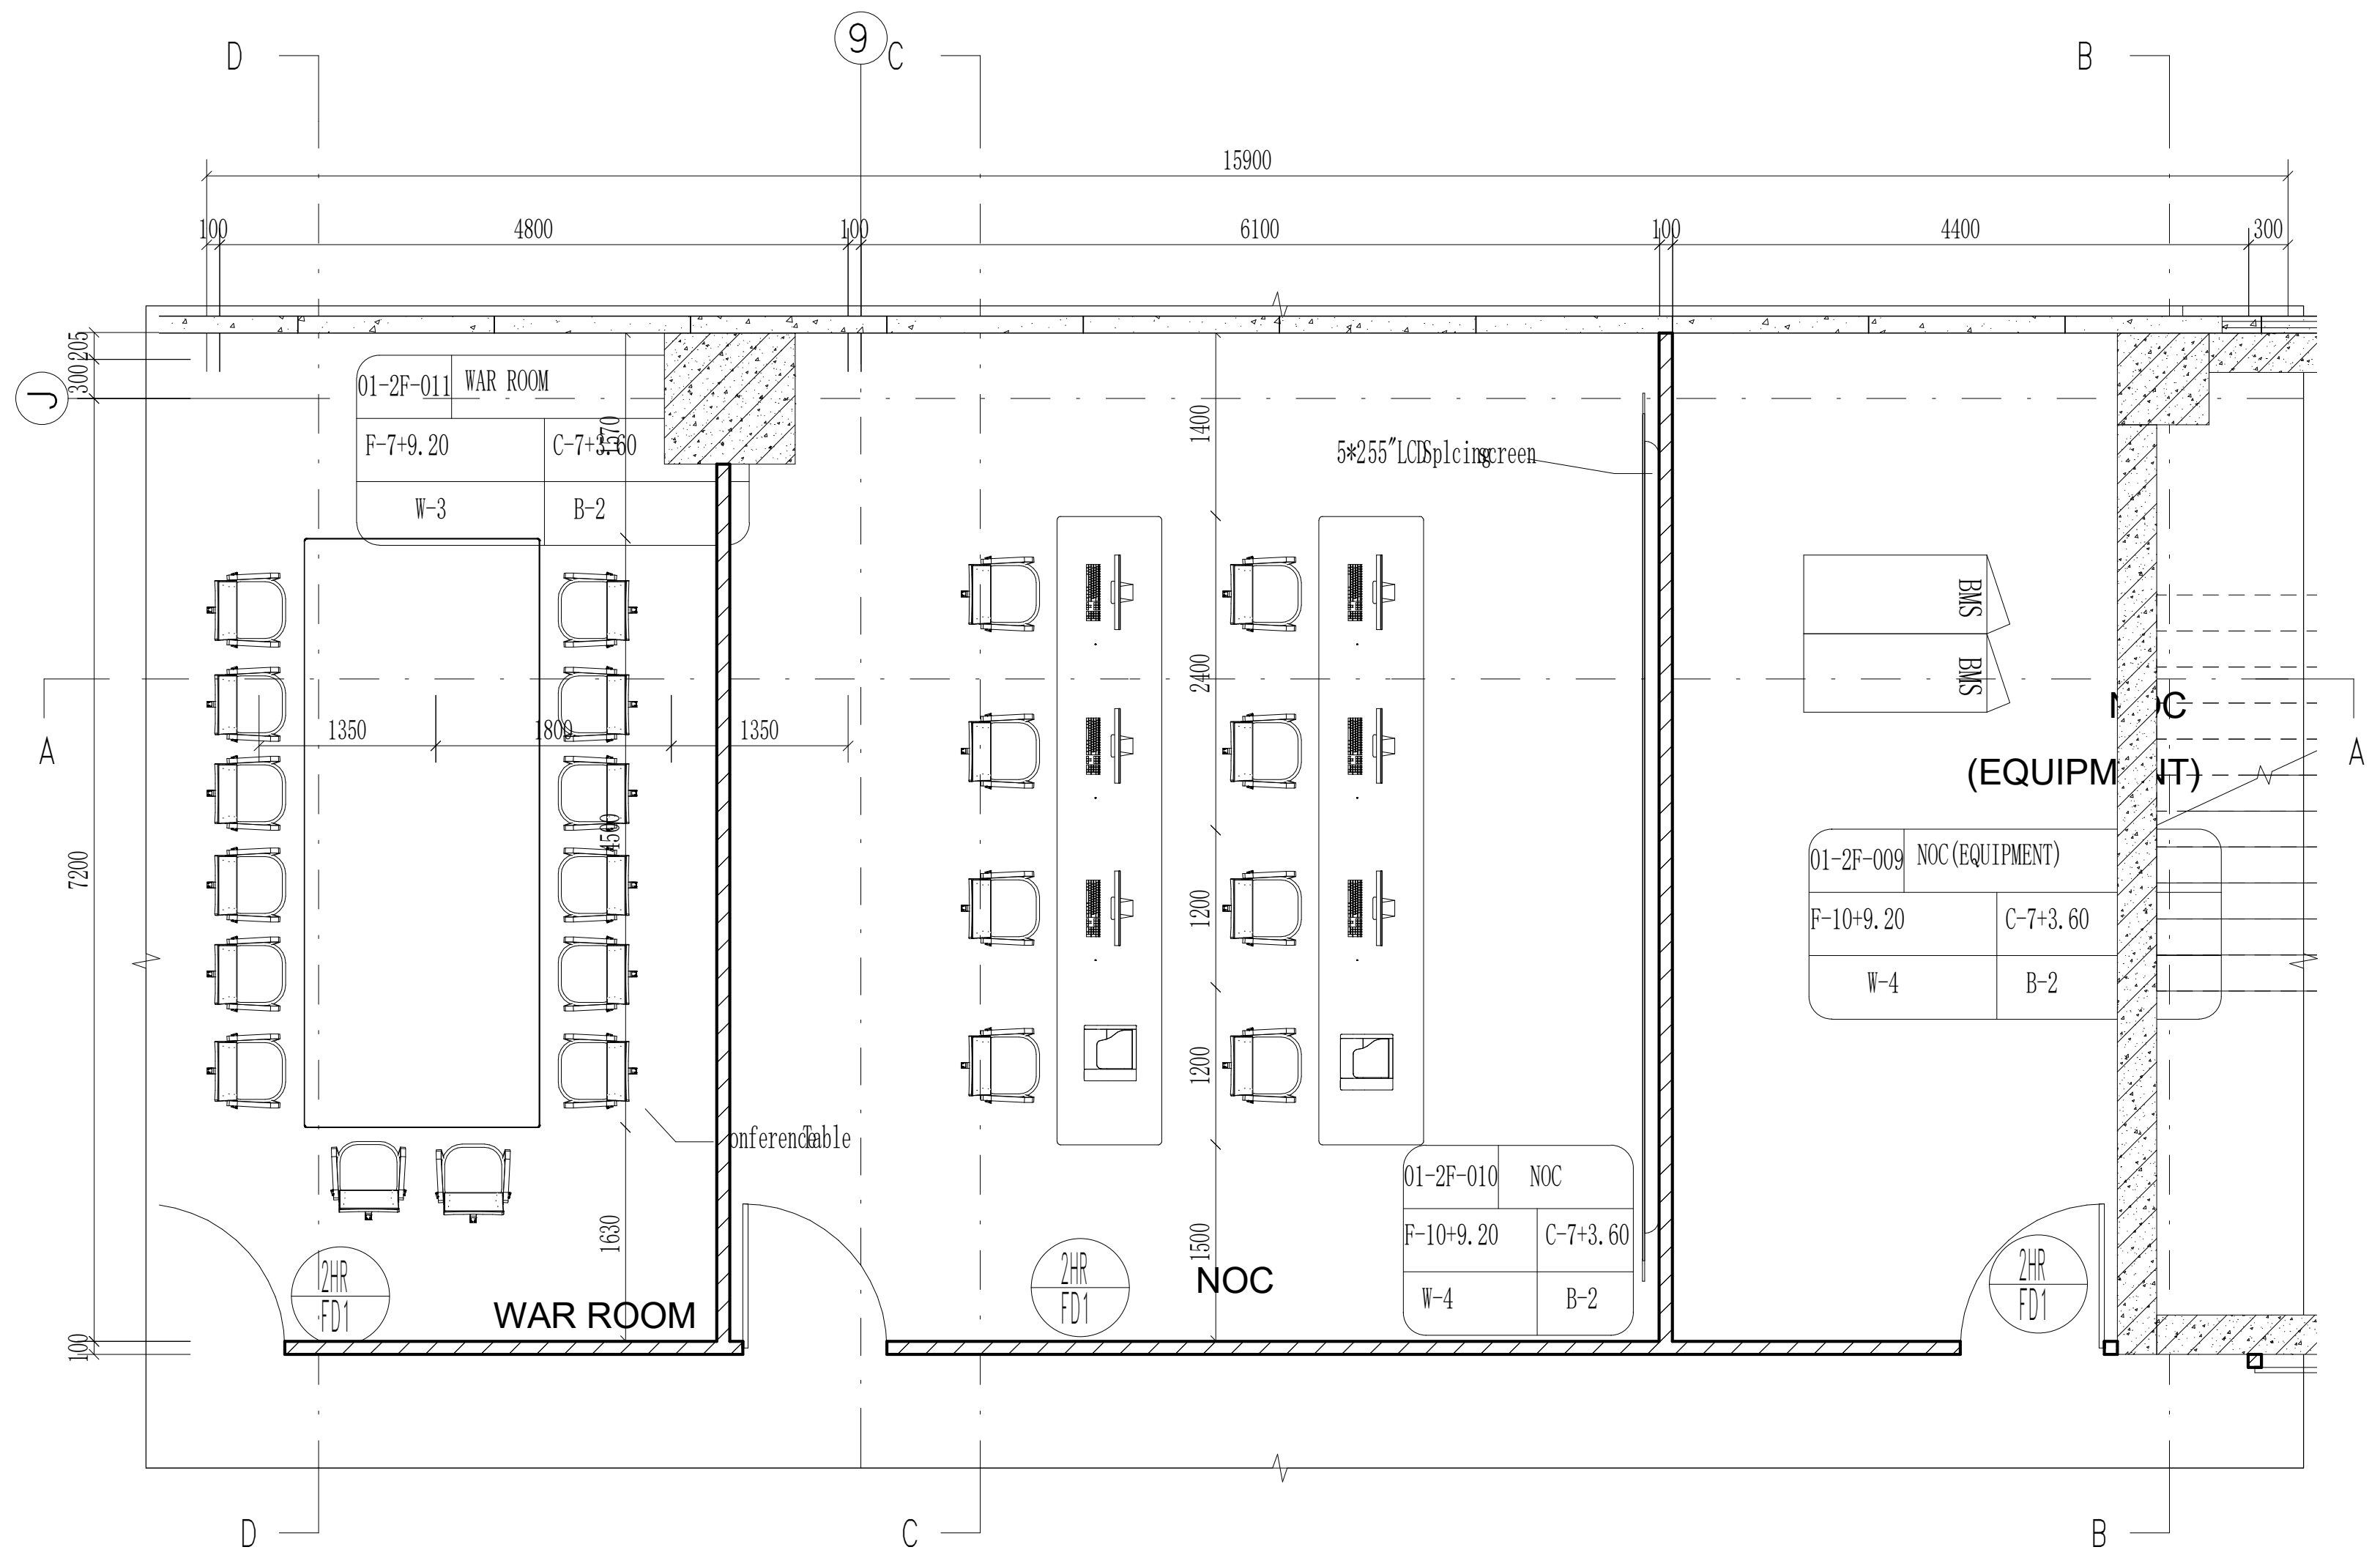

WAR ROOM 、 NOC、 NOC(EQUIPMENT) 2ND FLOOR PLAN

Scale 1:50

THE "SFL" MARKED IN THE DRAWING REFERS TO THE STRUCTURAL FLOOR LEVEL, WHILE THE FINISHED FLOOR LEVEL (FFL) IS DETERMINED BASED ON FLOOR FINISHES.

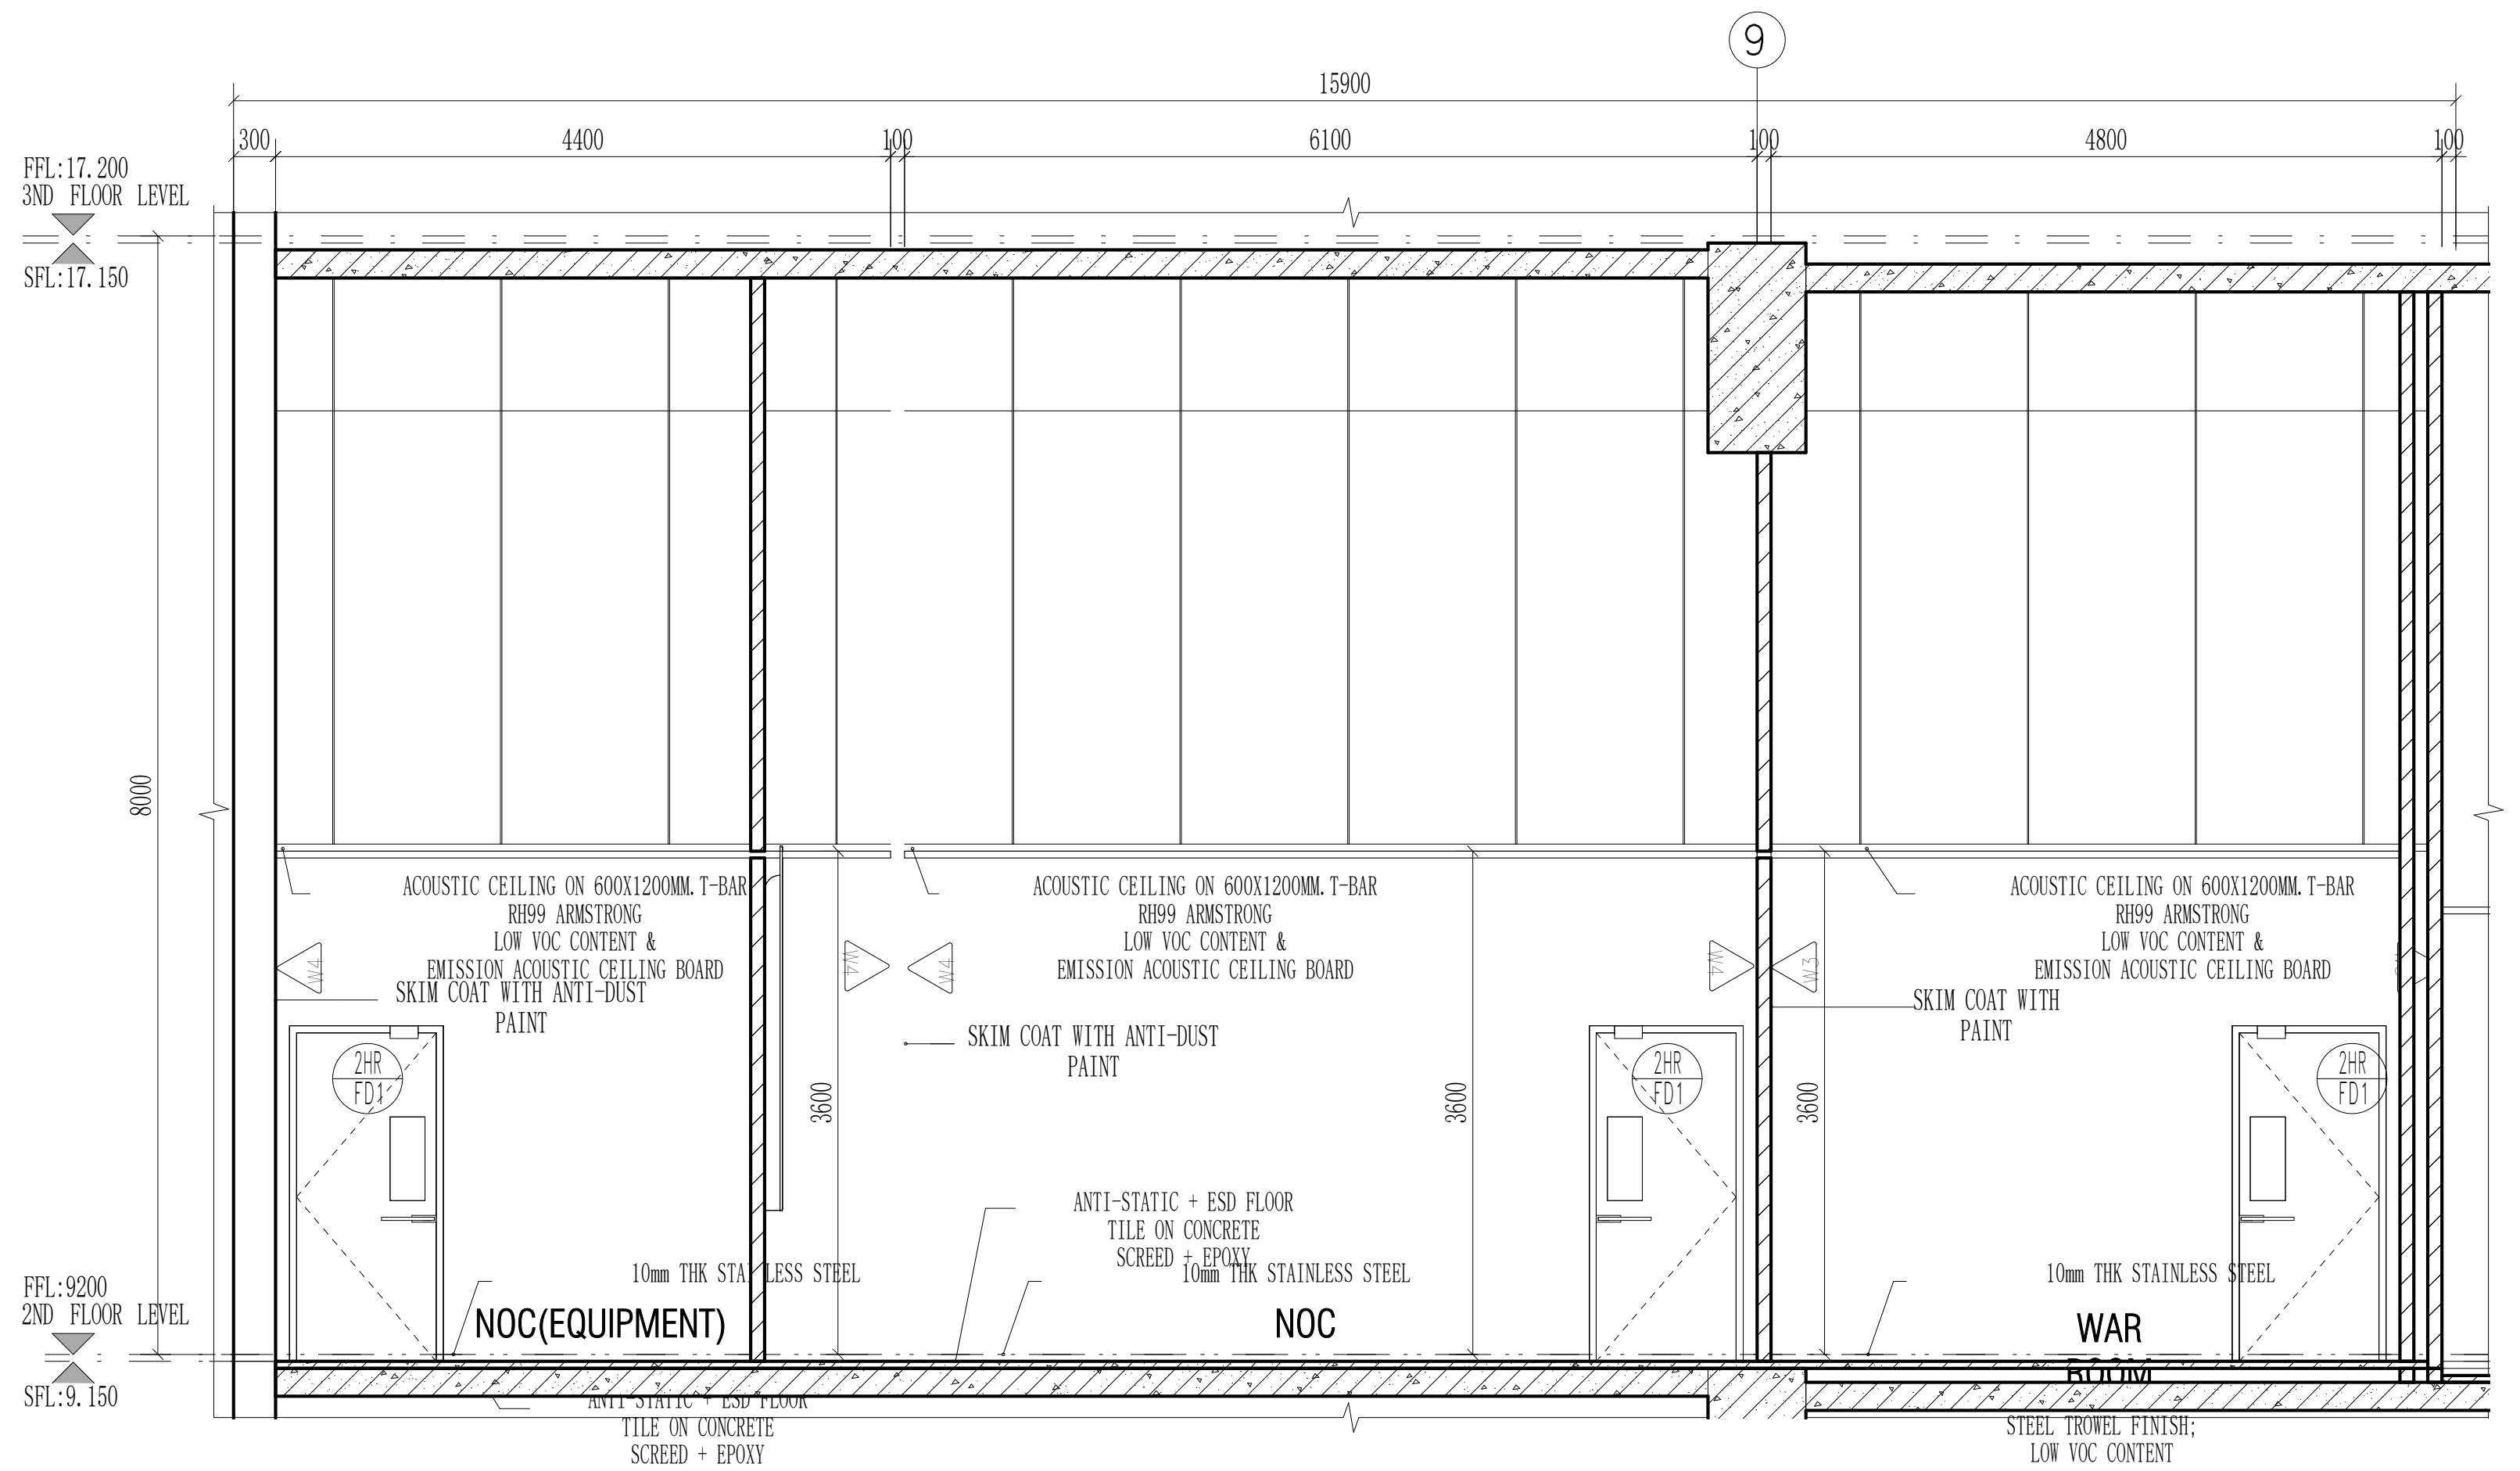

NOC(EQUIPMENT)、 NOC、 WAR ROOM SECTION A-A

Scale 1:50

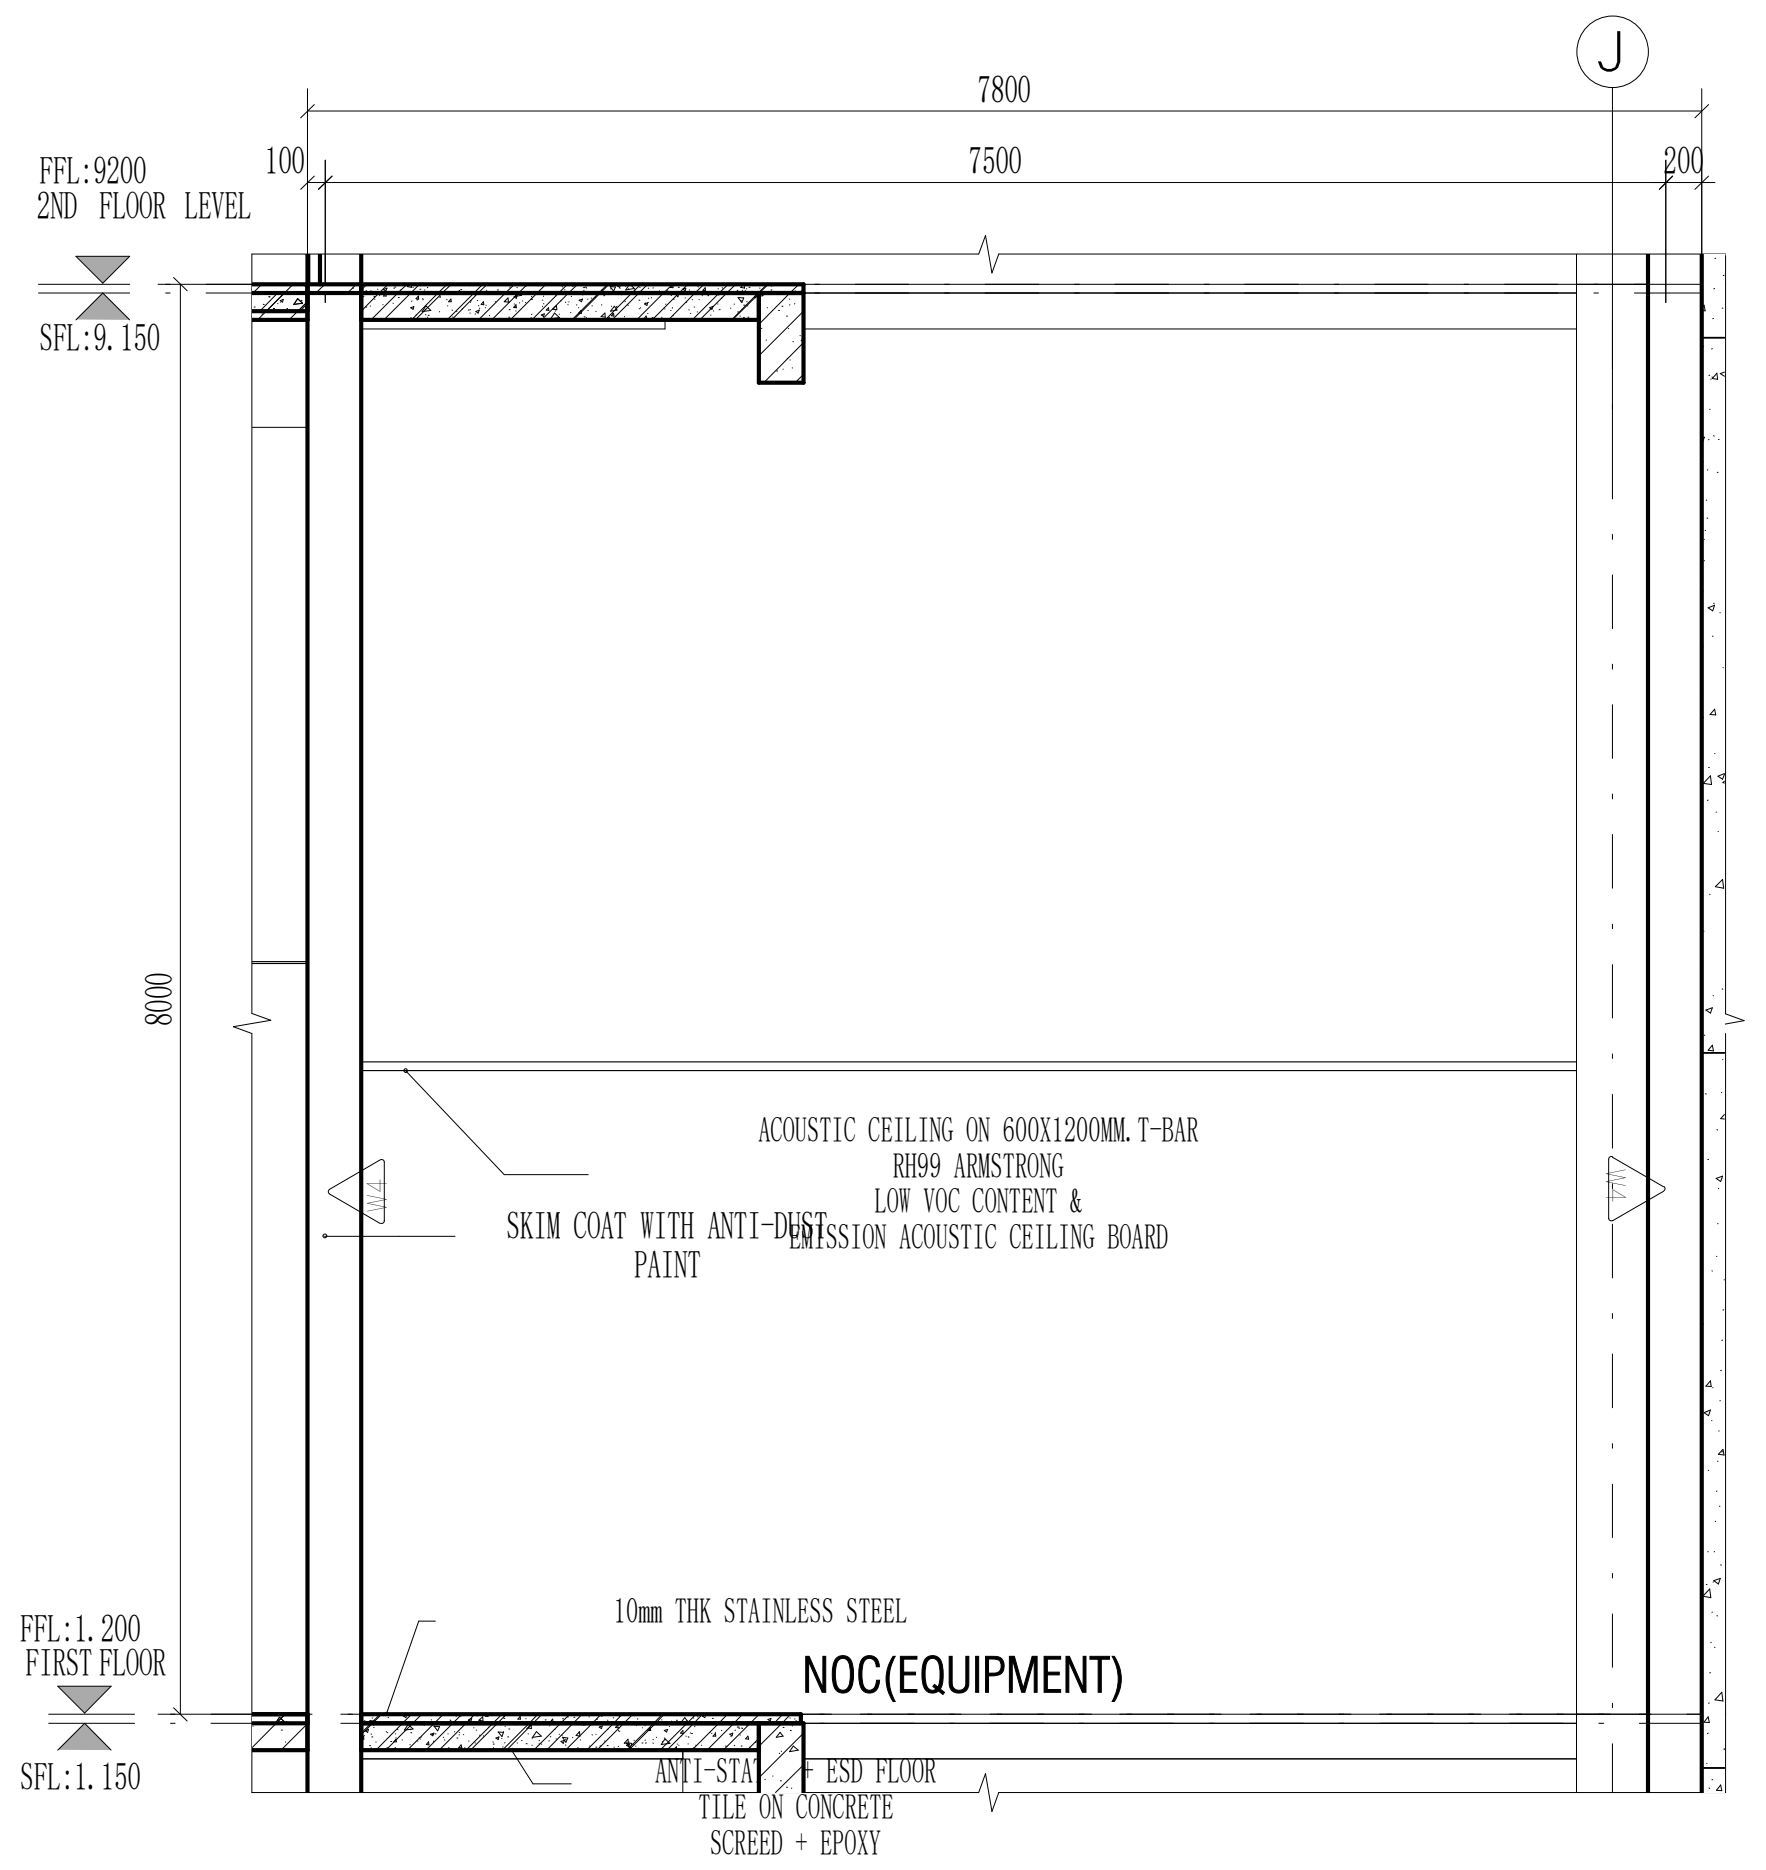

NOC(EQUIPMENT) SECTION B-B

Scale 1:50

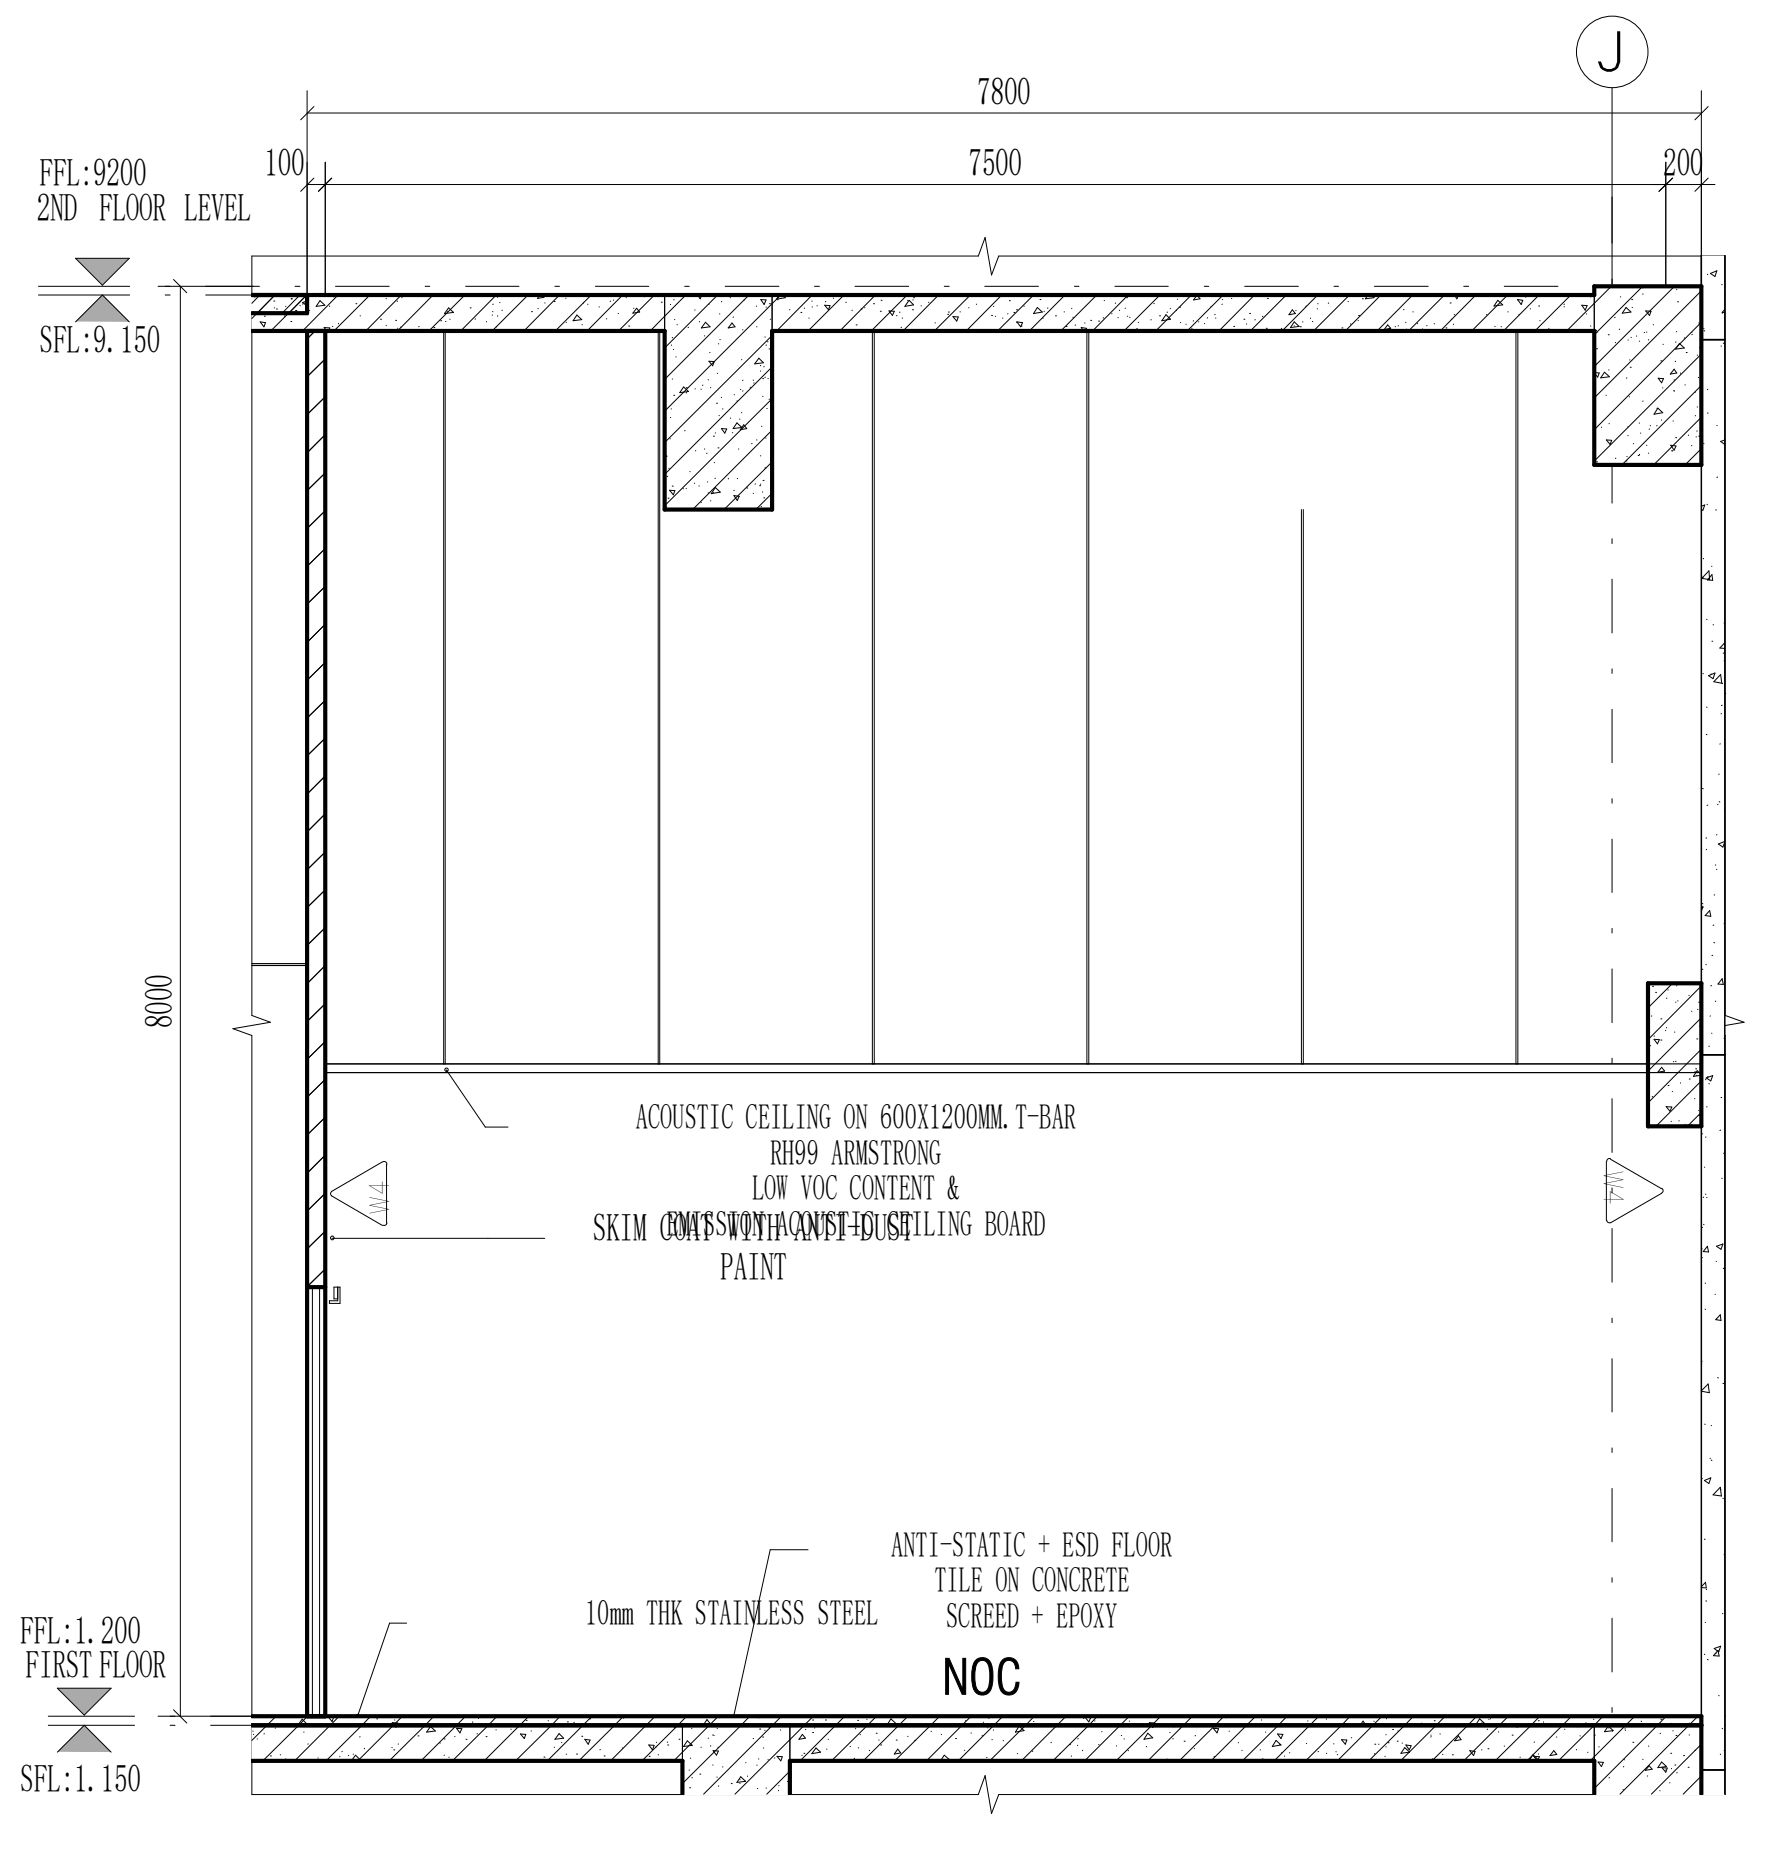

NOC SECTION C-C

Scale 1:50

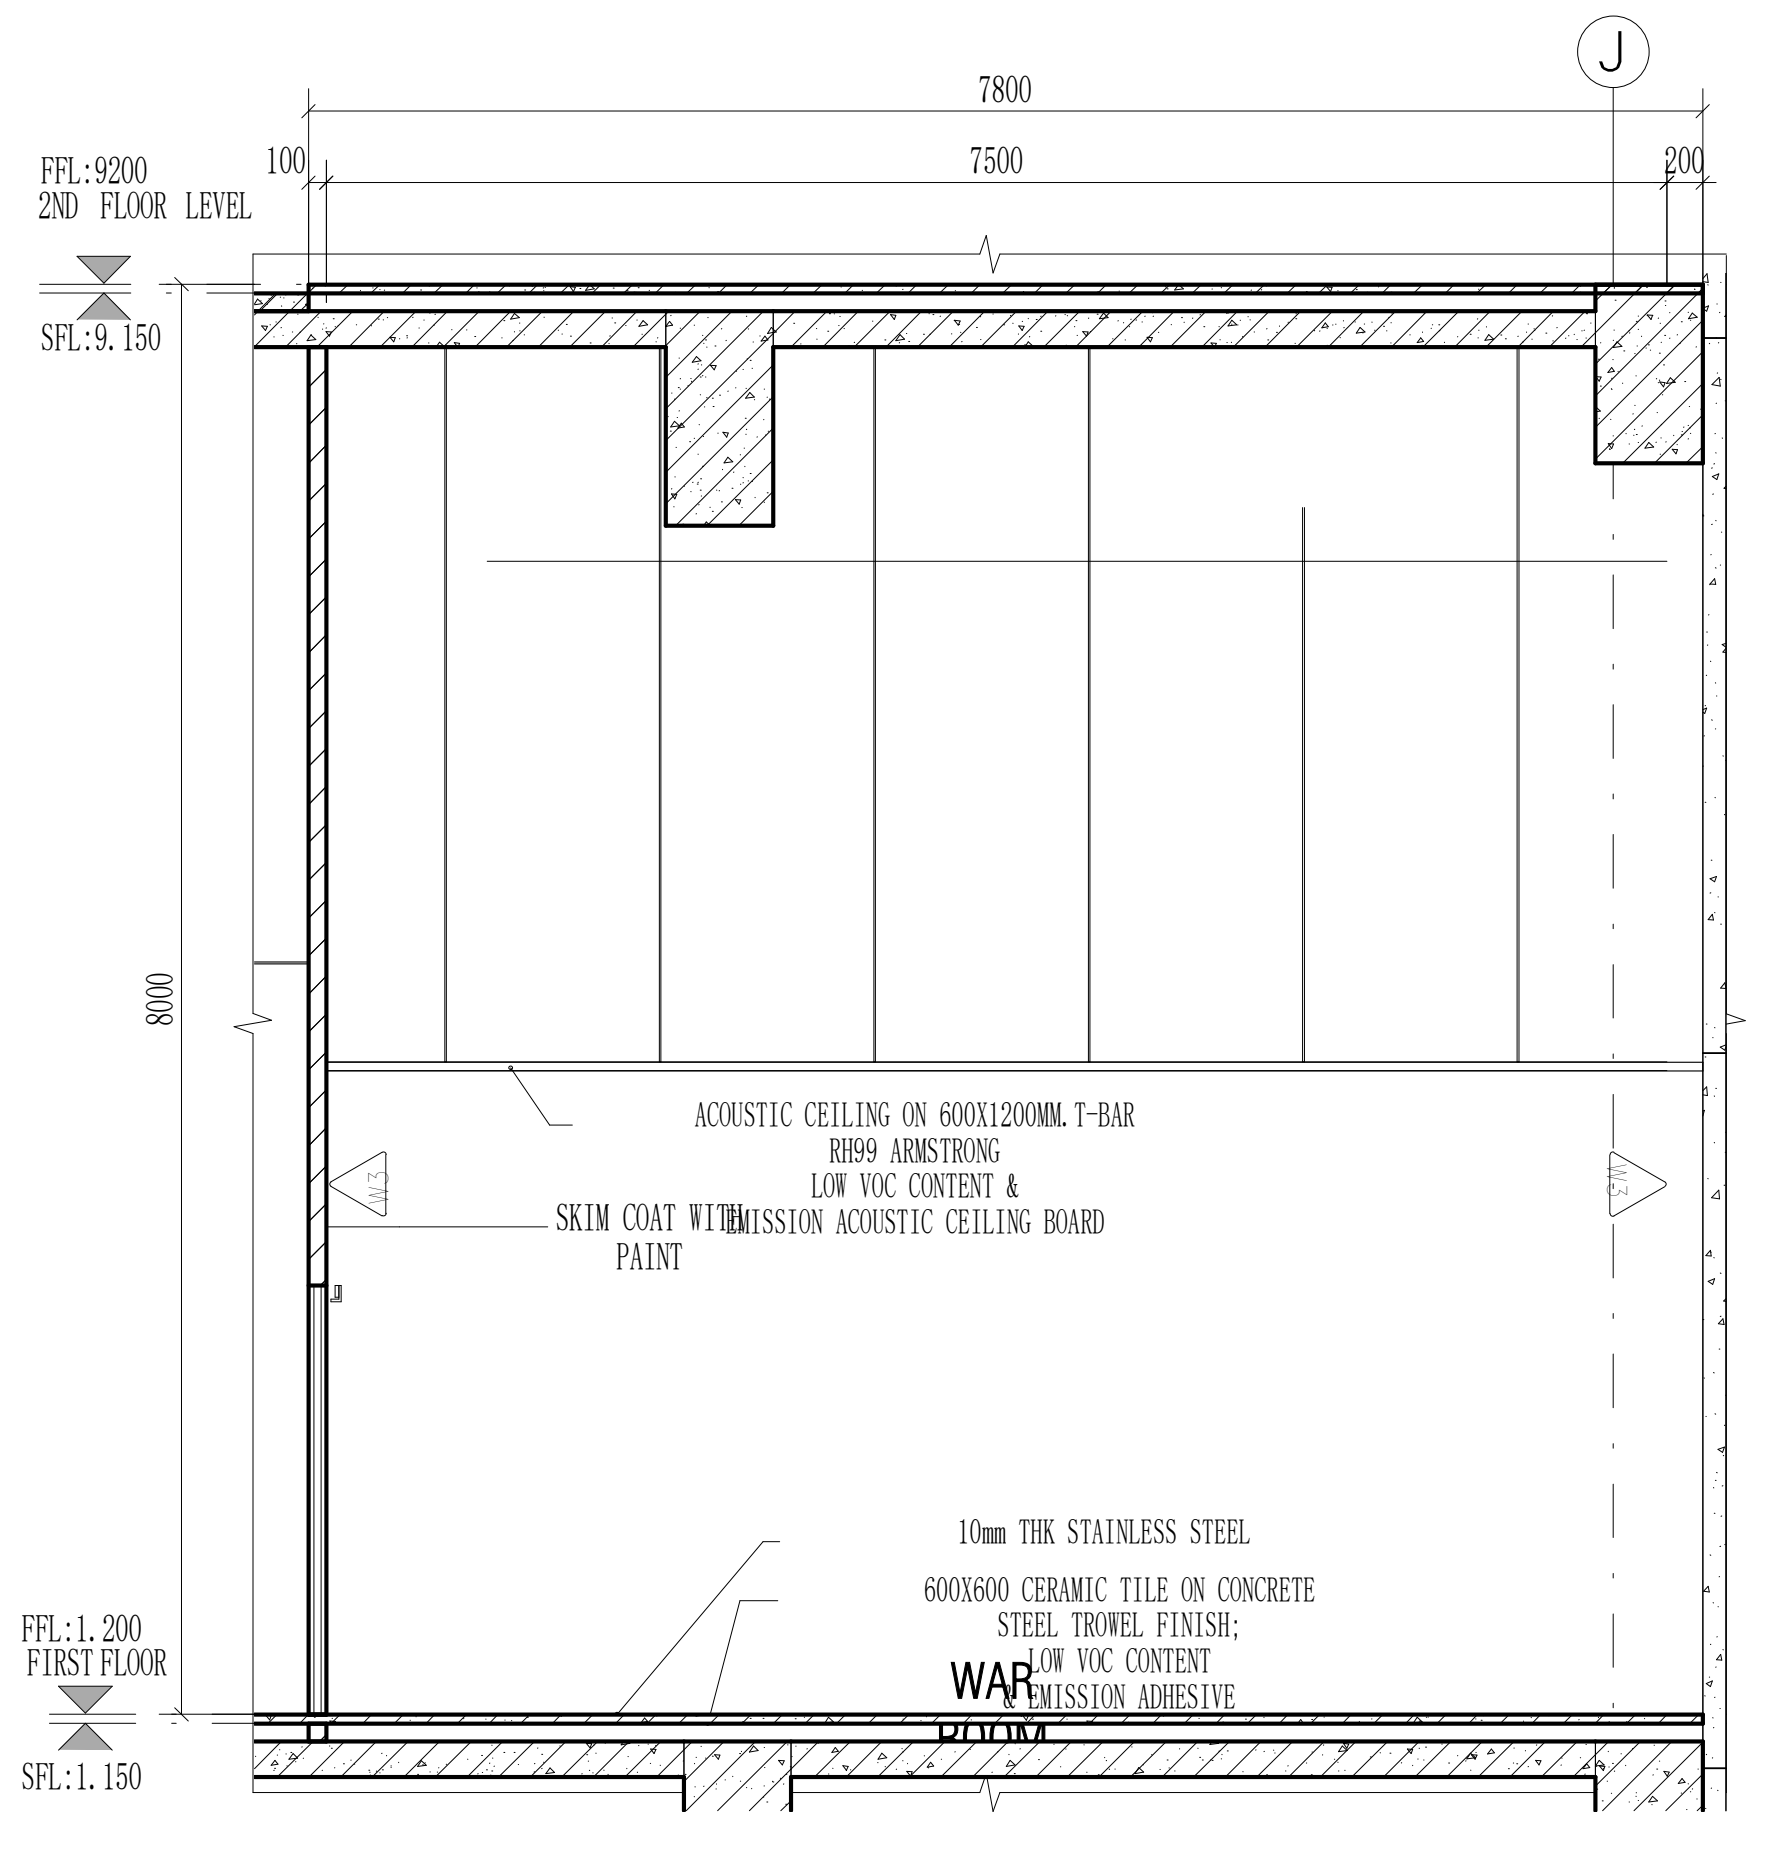

WAR ROOM SECTION D-D

Scale 1:50

CLIENT :

GULF EDGE DC 01

87 Wireless Road, M Thai Tower 11th. Floor, All Seasons Place, Lumpini,
Pathumwan, Bangkok 10330, Thailand

CONTRACTOR :

华西发展(泰国)有限公司
บริษัท หัวซือ ดีเวลลอปเม้นต์ (ประเทศไทย) จำกัด
HUASHI DEVELOPMENT CO.,LTD
No. 202, Room No. 1403, 14/F, Le Concorde Building,
Ratchadapisek Road, Huaykhwang Sub-District,
Huaykhwang District, Bangkok Metropolitan 10310.

CONSULTANT :

ARbay
บริษัท เอ อาร์ เบย์ จำกัด
ARbay Company Limited
31 st Floor Bangkok Insurance Building
25 South Sathorn road Thungmahamek
Sathorn Bangkok 10120 THAILAND
T +66 (0) 2286 8199
F +66 (0) 2286 2863
info@arbay.co.th

CONSULTANT :

Qbic Engineers & Architects Co.,Ltd.
8 Soi KALONG 4 SANAMBINNAM ROAD,
THASAI SUB-DISTRICT, MUANG NONTHABURI DISTRICT
, NONTHABURI.
Tel 662-950-4374
Fax 662-580-3231
E-Mail : qbic@qbic.co.th, www.qbic.co.th
QBIC ENGINEERS AND ARCHITECTS CO.,LTD.

CONSULTANT :

MITR
MITR TECHNICAL CONSULTANT CO.,LTD.
1168/8 12th FLOOR, LUMPINI TOWER BUILDING,
RAMA IV RD., THUNGMAHAMEK, SATHORN, BANGKOK 10120, THAILAND
TEL : 0-2679-9079-84
FAX : 0-2679-9085 E-mail: mitr_dd@mitr.com

Architect :	SIGNATURE
ประกิต พนานุรัตน์ วสถ. 580 ที่อยู่ 251/1 ถ.จารุเมือง แขวงรองเมือง เขตปทุมวัน กรุงเทพมหานคร โทรศัพท์ 02-286-8199	
Structural Engineer :	SIGNATURE
วิศวกรผู้ออกแบบโครงสร้าง	
ณัฐสม สงวนวงษ์ วย 1423 ที่อยู่ 2/1 ซ.รามคำแหง 150 ถ.รามคำแหง แขวง สะพานสูง เขต สะพานสูง กทม. 10240	ณัฐสม สงวนวงษ์
Structural Inspector :	SIGNATURE
วิศวกรผู้ตรวจสอบโครงสร้าง	
โกมล จุฑาภัทร วย 964 ที่อยู่ 24/18 ซ.นวมินทร์ 129 ถ. นวมินทร์ แขวง นวลจันทร์ เขต บึงกุ่ม กทม. 10230	
Electrical Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบไฟฟ้ากำลัง	
นายสุภัทร บูรณวิทย์ วฟก.1265 ที่อยู่ 21 ซอยทานสัมฤทธิ์ 13 ตำบลท่าทราย อ.เมืองนนทบุรี จ.นนทบุรี 11000	สุภัทร บูรณวิทย์
Mechanical Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบเครื่องกลและปรับอากาศ	
นายประสิทธิ์ เกี้ยวสุนทร วก.1221 ที่อยู่ 44/372 ซอยบางกระดี่ 35/1 แขวงแสมดำ เขตบางขุนเทียน กทม. 10150	ประสิทธิ์
Sanitary Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบสุขาภิบาล และดับเพลิง	
นายทศวรรษ สนั่นฤทธิ์ วส. 215 ที่อยู่ บ้านเลขที่ 99/107 หมู่ที่ 3 ต.ศีรษะจรเข้น้อย อ.บางเสาธง จ.สมุทรปราการ 10540	ทศวรรษ

ISSUE/REVISION

REV.	DESCRIPTION	DATE
A	90% DEVELOPED	09/05/2026

PROJECT NAME :

GEDC 01

LOCATION:
Nikhom Phattana district, Rayong ,industrial estate,CPGC

BUILDING :
MAIN BUILDING

90% DEVELOPED

TITLE :

ROOM DETAIL-2F-NOC (EQUIPMENT) 、NOC、WAR ROOM

JOB NO.	SCALE 1 : 50
DRAWN ZYY	REF.
CHECKED LJC	DWG. NO. MPK01A-90-A-RD-210
APPROVED LXD	
DATE 2026.05.09	

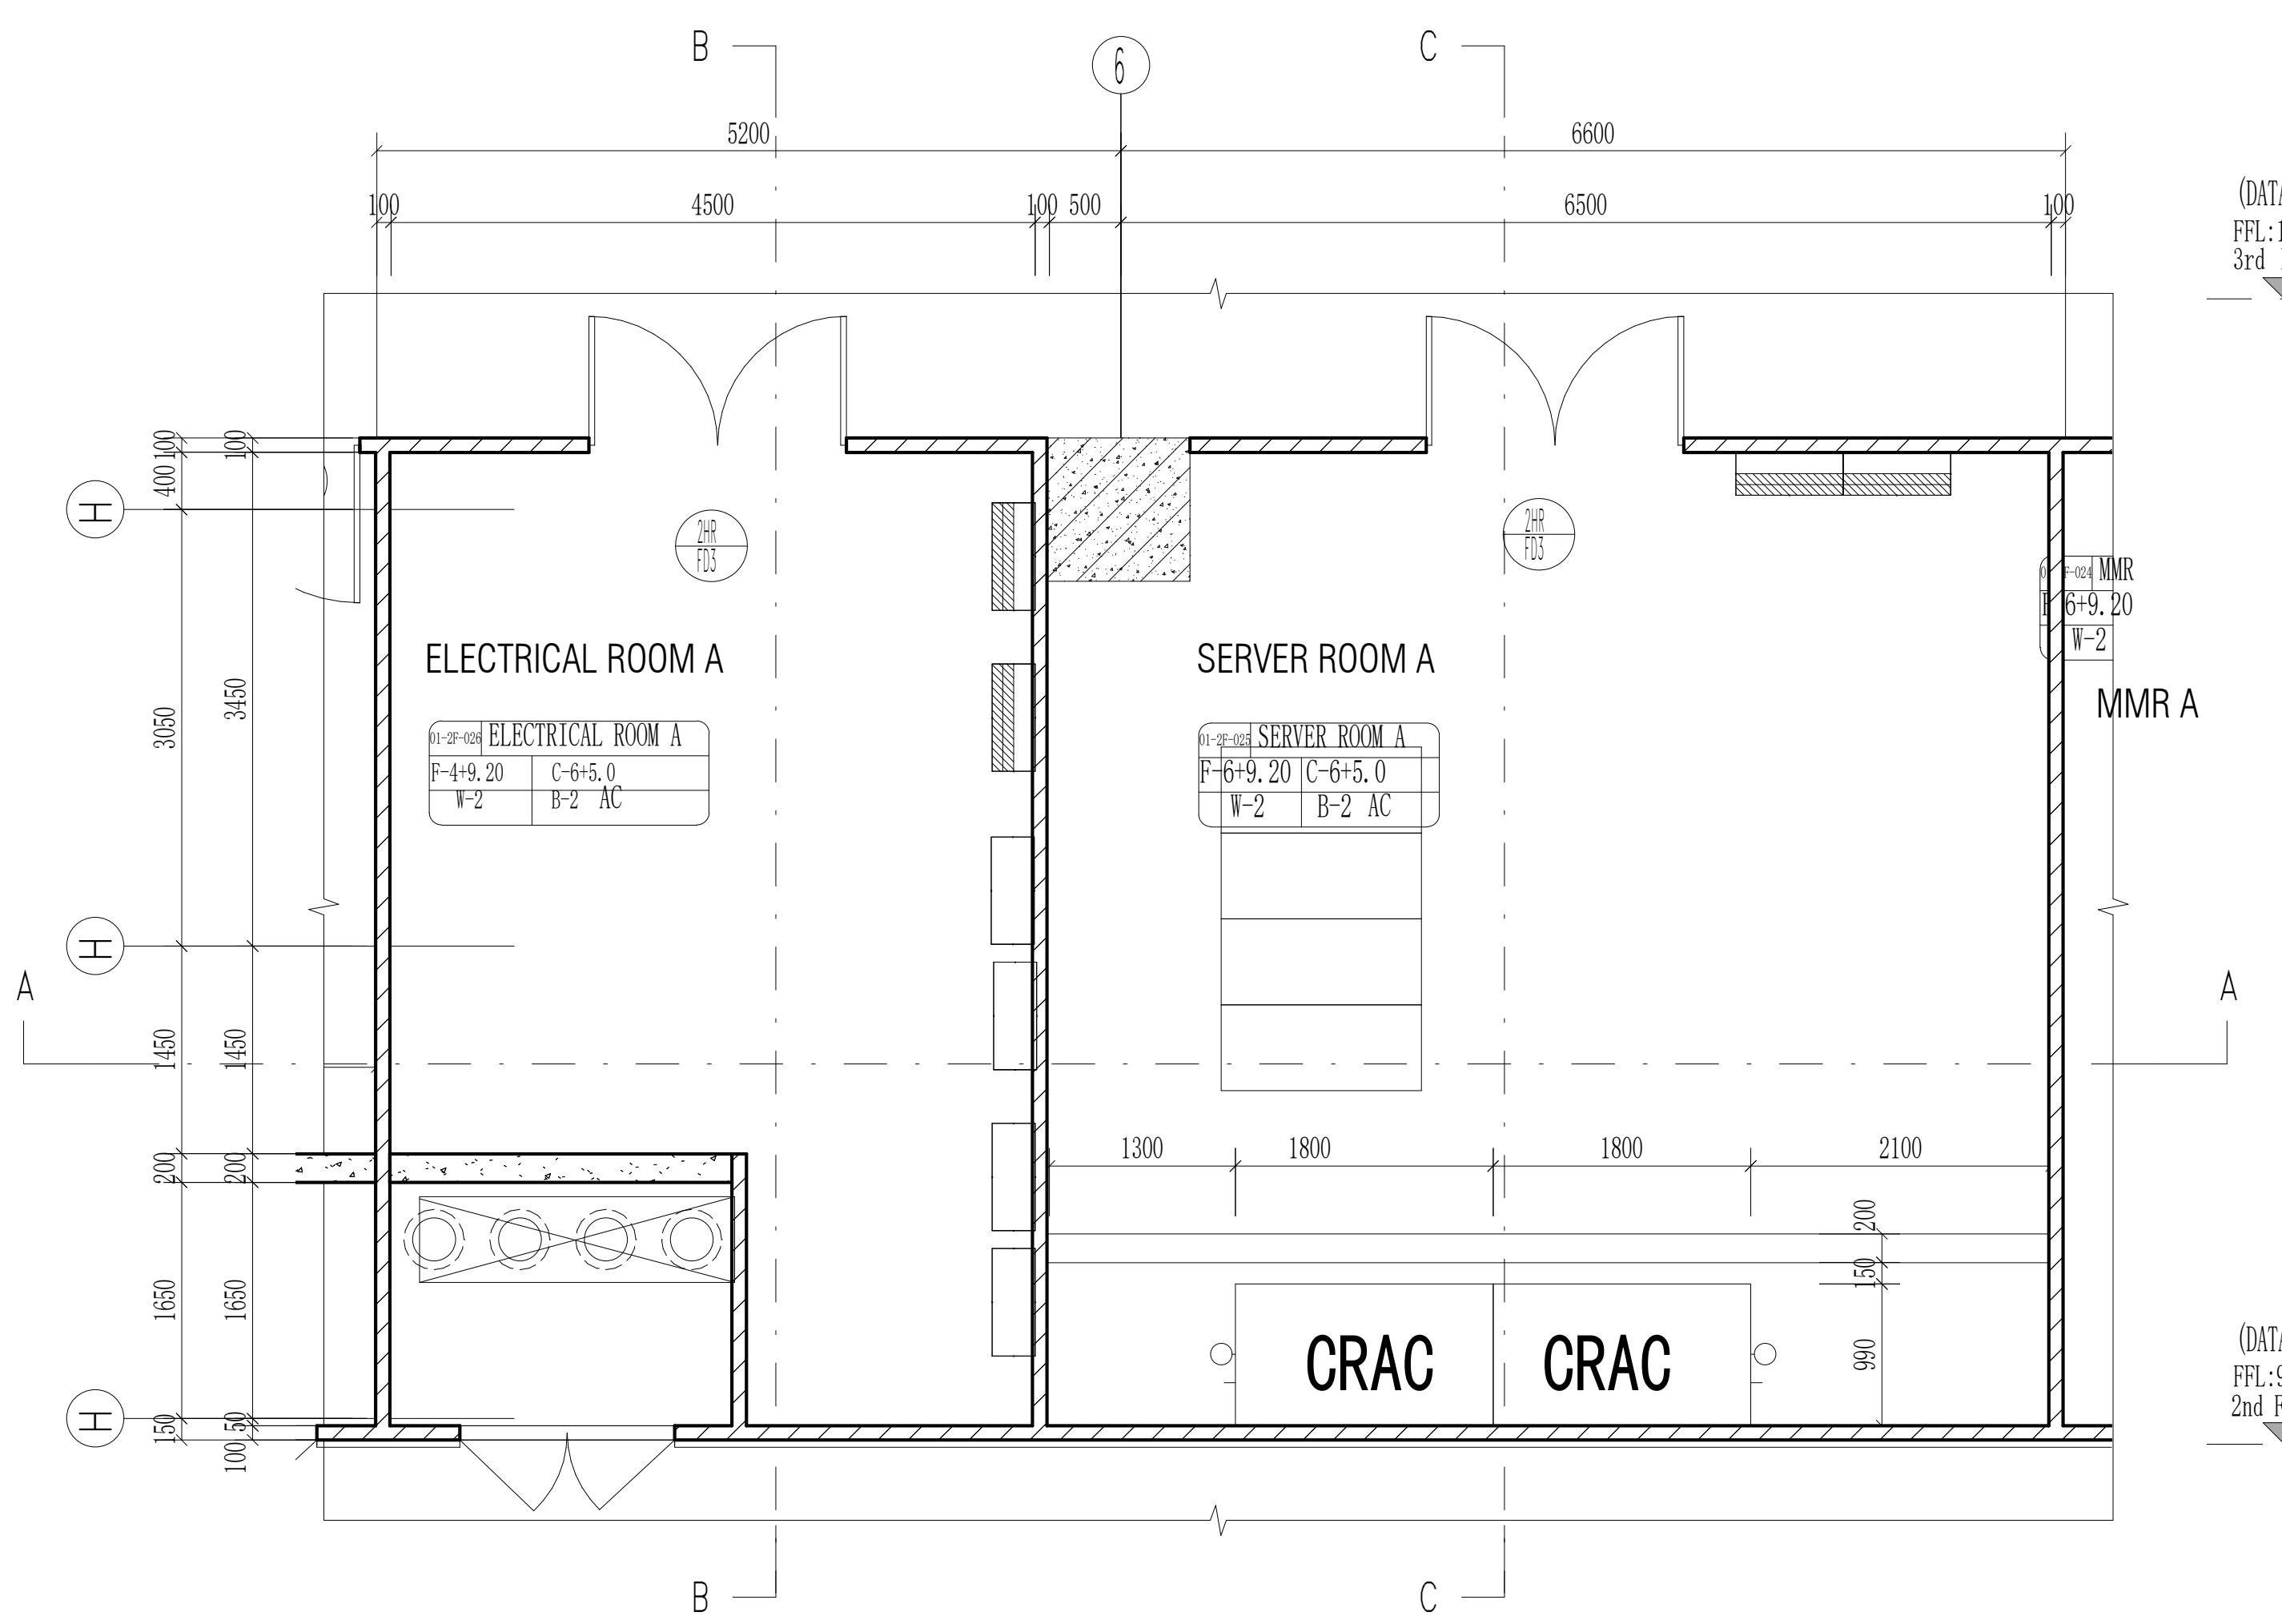

ELECTRICAL ROOM A、SERVER ROOM A PLAN

Scale 1:50

THE "SFL" MARKED IN THE DRAWING REFERS TO THE STRUCTURAL FLOOR LEVEL, WHILE THE FINISHED FLOOR LEVEL (FFL) IS DETERMINED BASED ON FLOOR FINISHES.

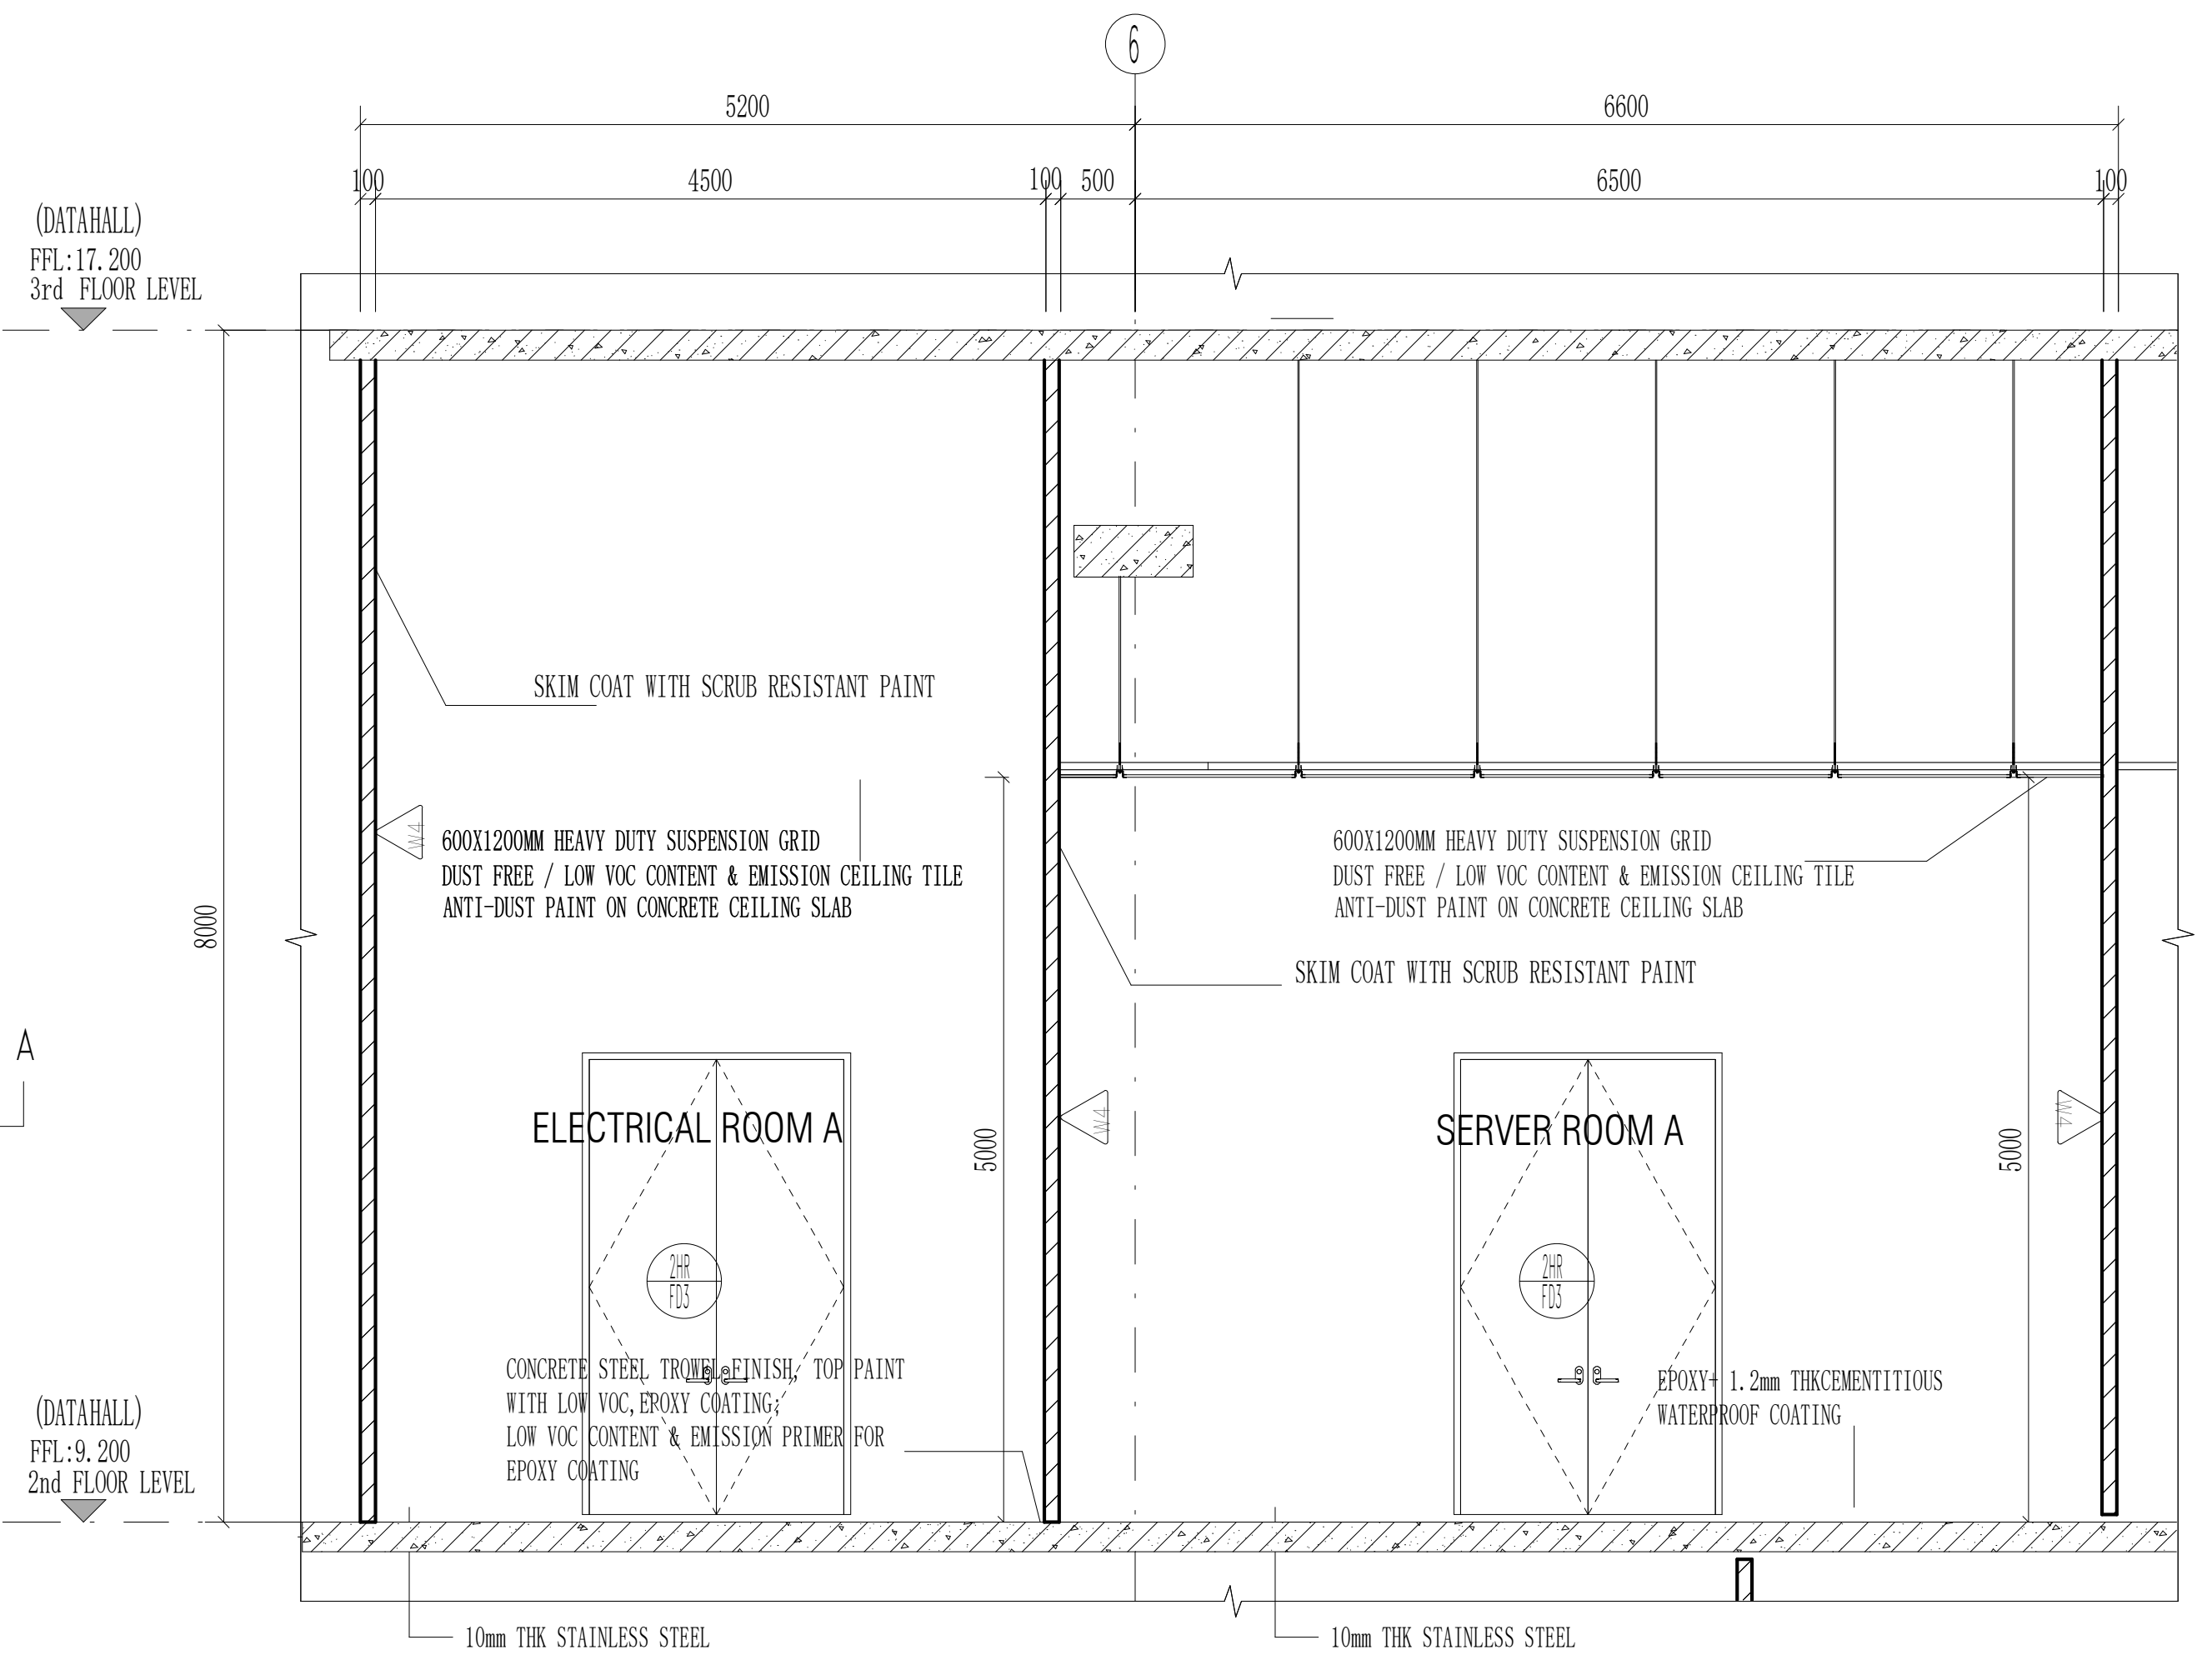
(DATAHALL)
FFL:17.200
3rd FLOOR LEVEL
(DATAHALL)
FFL:9.200
2nd FLOOR LEVEL
SKIM COAT WITH SCRUB RESISTANT PAINT
600X1200MM HEAVY DUTY SUSPENSION GRID
DUST FREE / LOW VOC CONTENT & EMISSION CEILING TILE
ANTI-DUST PAINT ON CONCRETE CEILING SLAB
ELECTRICAL ROOM A
SERVER ROOM A
CONCRETE STEEL TROWEL FINISH, TOP PAINT
WITH LOW VOC,EPOXY COATING;
LOW VOC CONTENT & EMISSION PRIMER FOR
EPOXY COATING
EPOXY+ 1.2mm THKCEMENTITIOUS
WATERPROOF COATING
10mm THK STAINLESS STEEL
8000
5000

ELECTRICAL ROOM A、SERVER ROOM A SECTION A-A

Scale 1:50

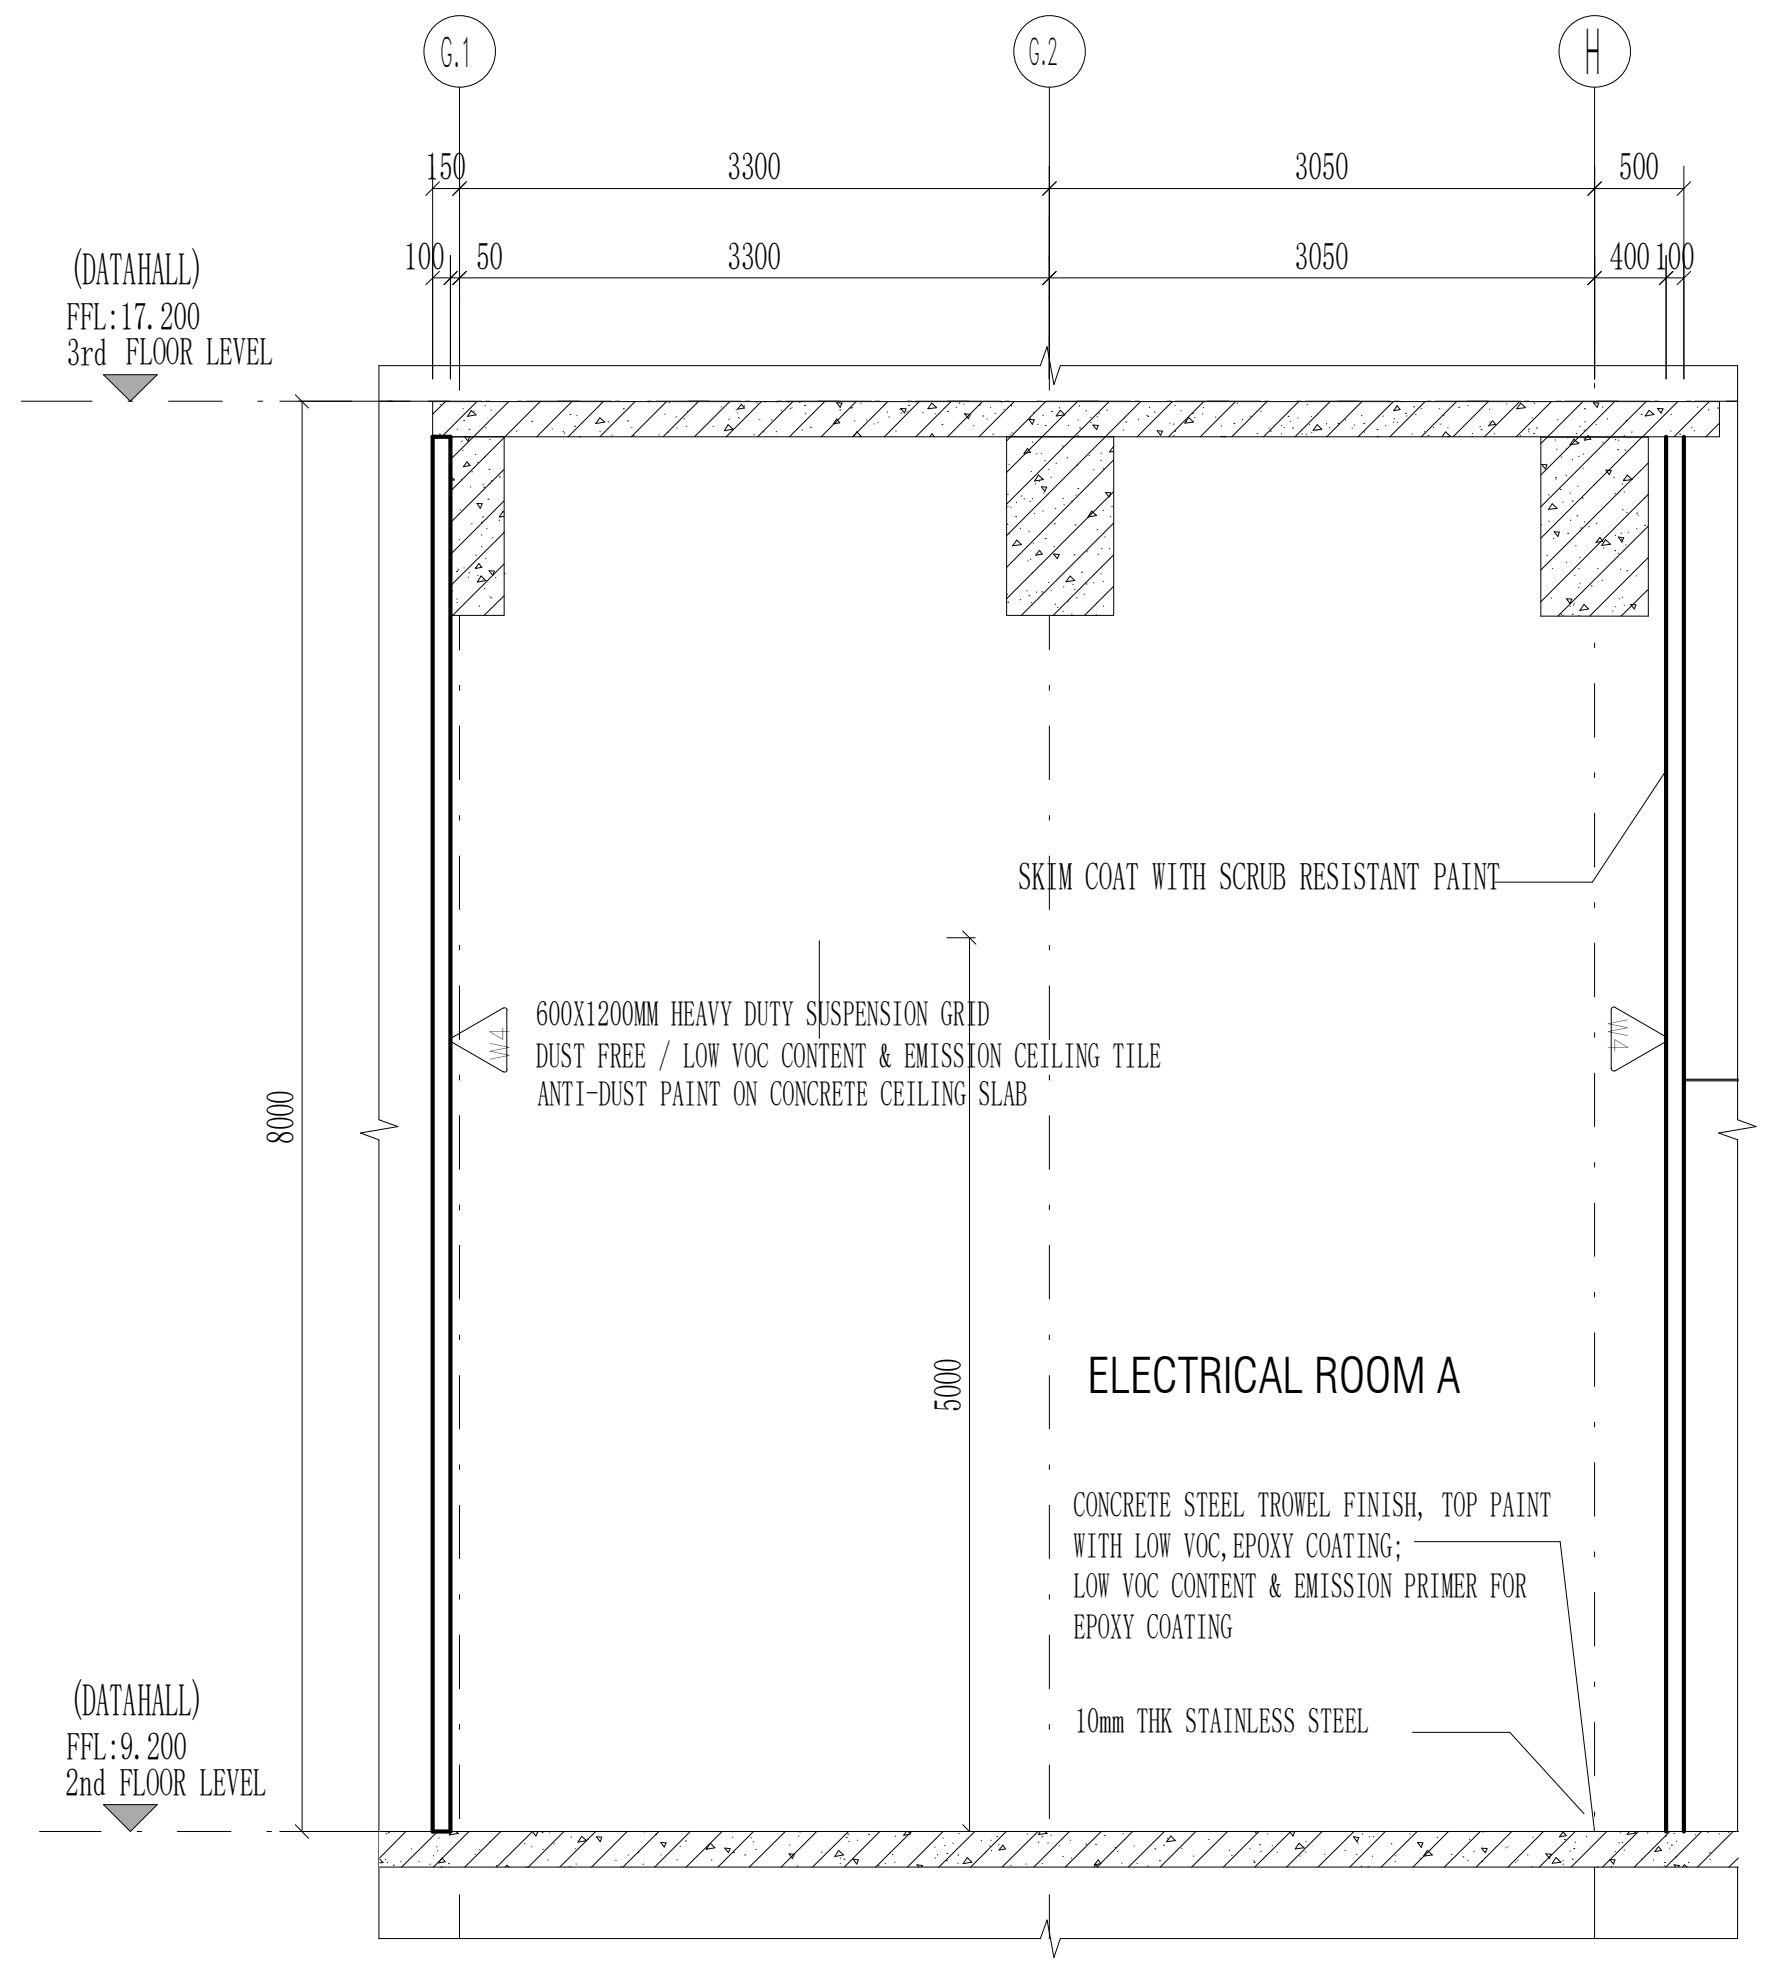
SKIM COAT WITH SCRUB RESISTANT PAINT
600X1200MM HEAVY DUTY SUSPENSION GRID
DUST FREE / LOW VOC CONTENT & EMISSION CEILING TILE
ANTI-DUST PAINT ON CONCRETE CEILING SLAB
ELECTRICAL ROOM A
CONCRETE STEEL TROWEL FINISH, TOP PAINT
WITH LOW VOC,EPOXY COATING;
LOW VOC CONTENT & EMISSION PRIMER FOR
EPOXY COATING
10mm THK STAINLESS STEEL

ELECTRICAL ROOM A SECTION B-B

Scale 1:50

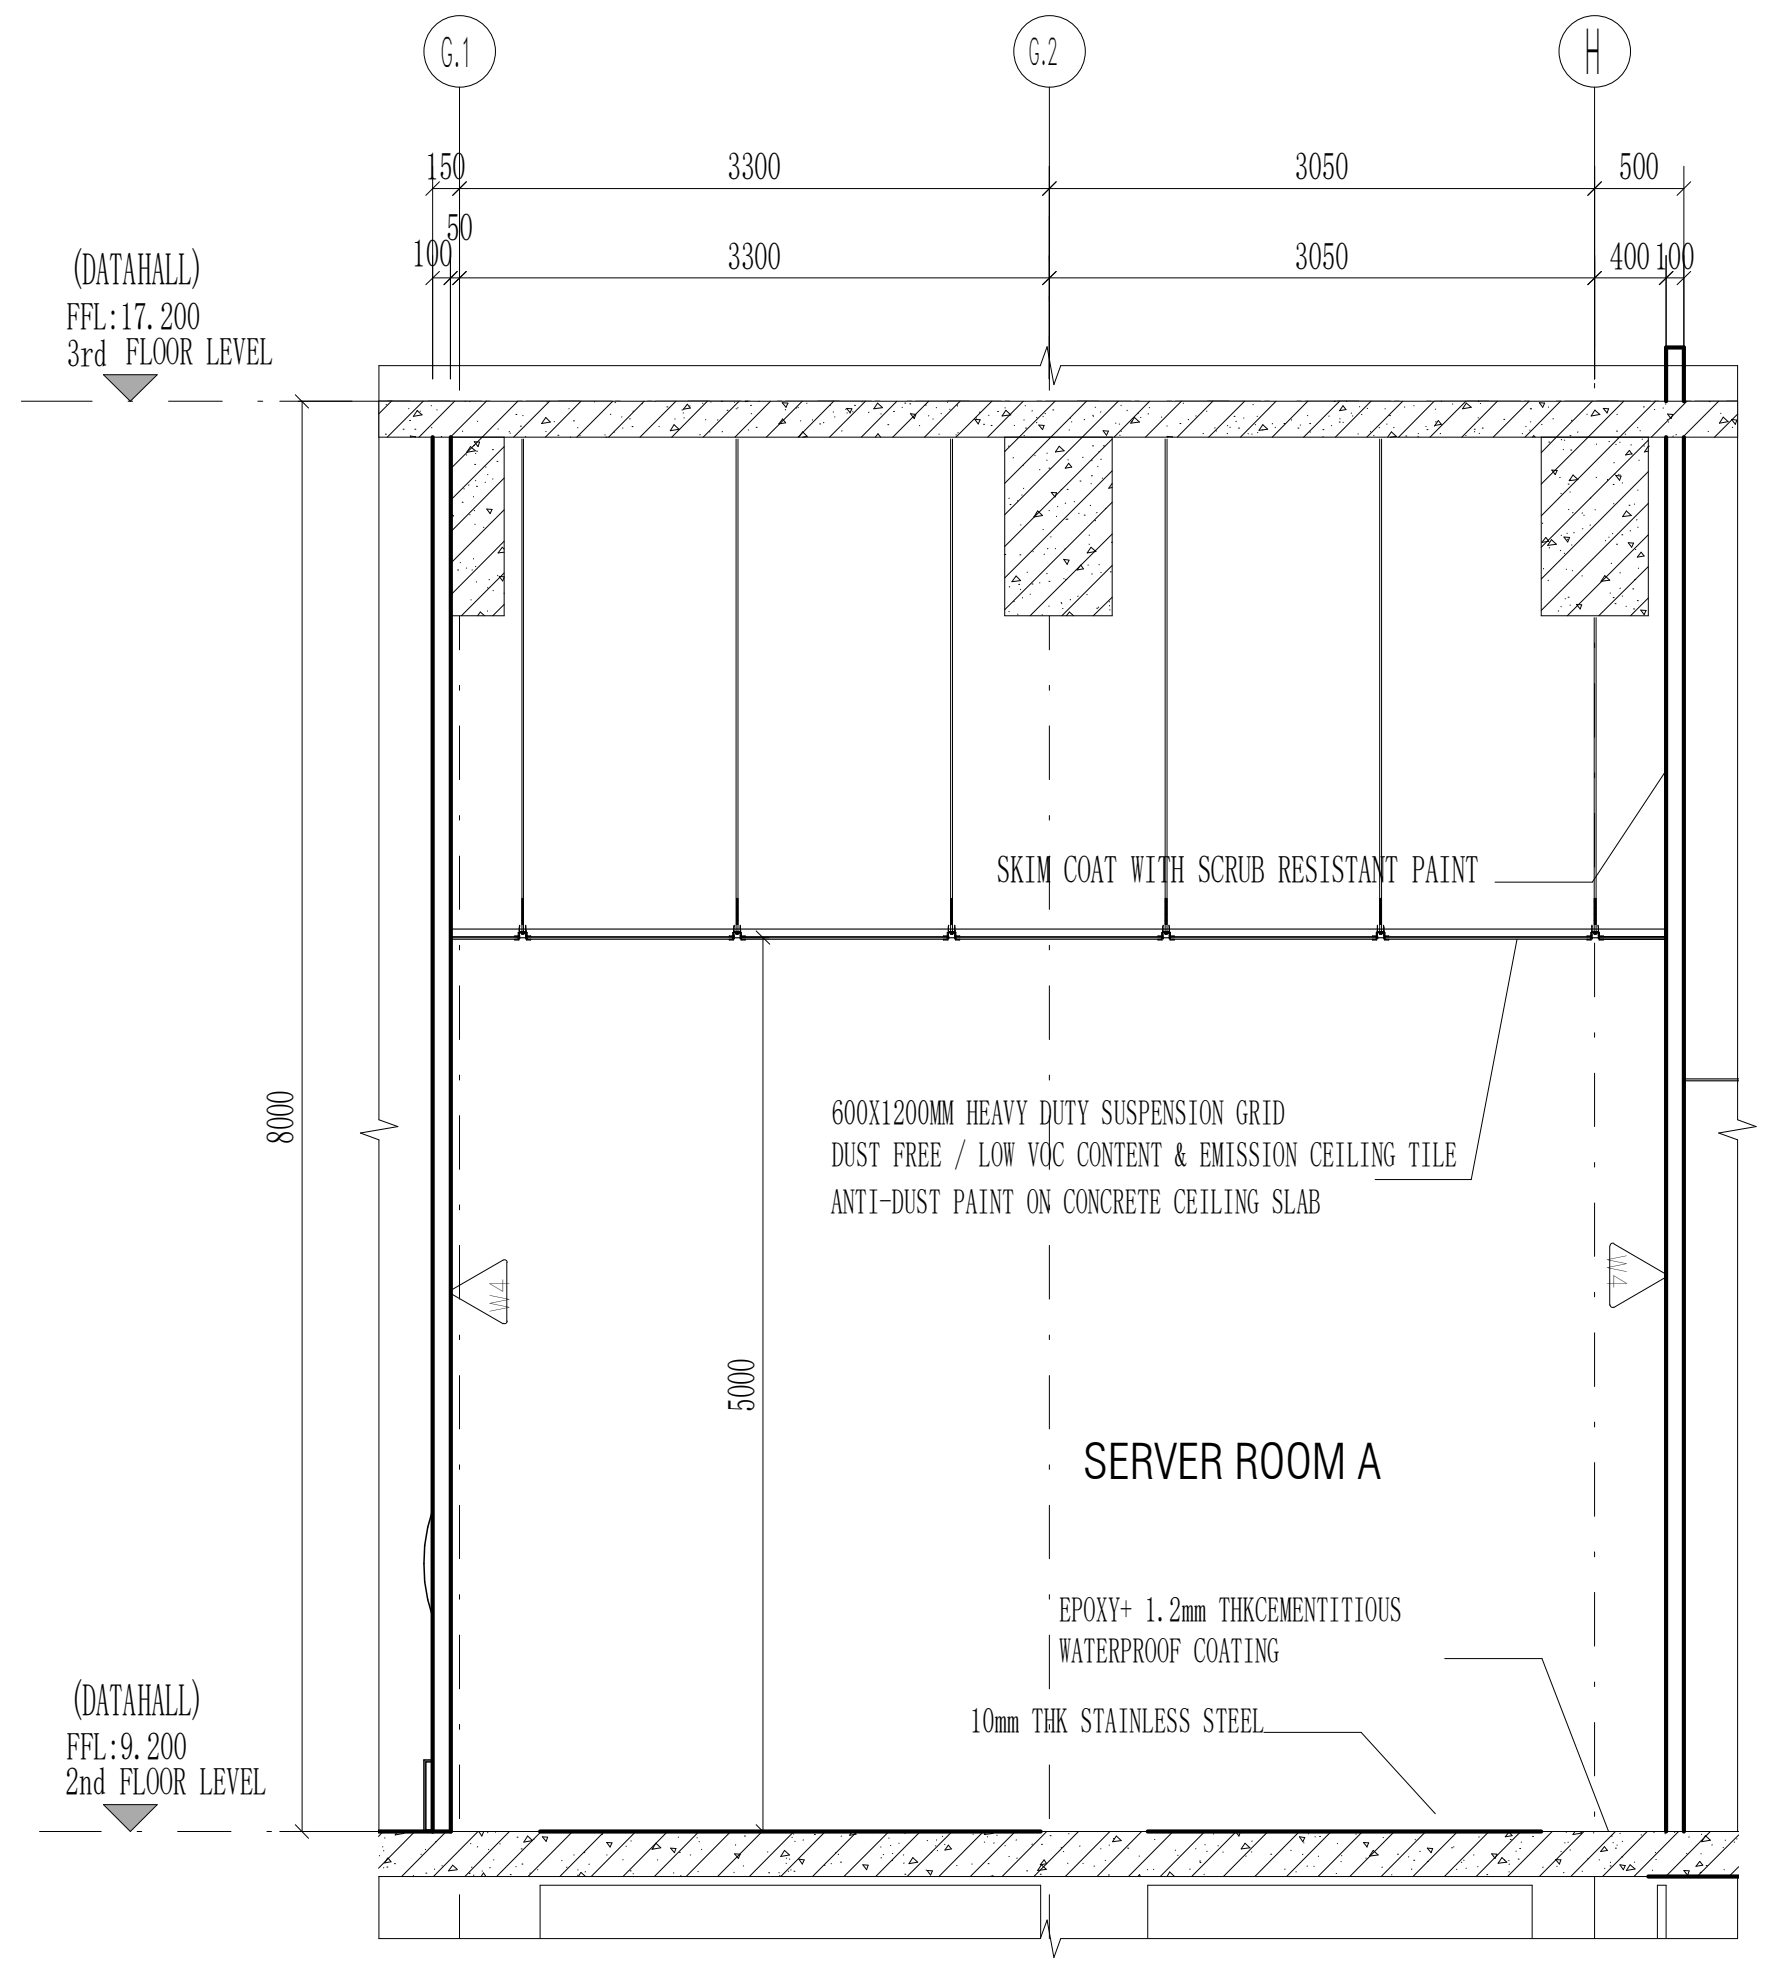
SKIM COAT WITH SCRUB RESISTANT PAINT
600X1200MM HEAVY DUTY SUSPENSION GRID
DUST FREE / LOW VOC CONTENT & EMISSION CEILING TILE
ANTI-DUST PAINT ON CONCRETE CEILING SLAB
SERVER ROOM A
EPOXY+ 1.2mm THKCEMENTITIOUS
WATERPROOF COATING
10mm THK STAINLESS STEEL

SERVER ROOM A SECTION C-C

Scale 1:50

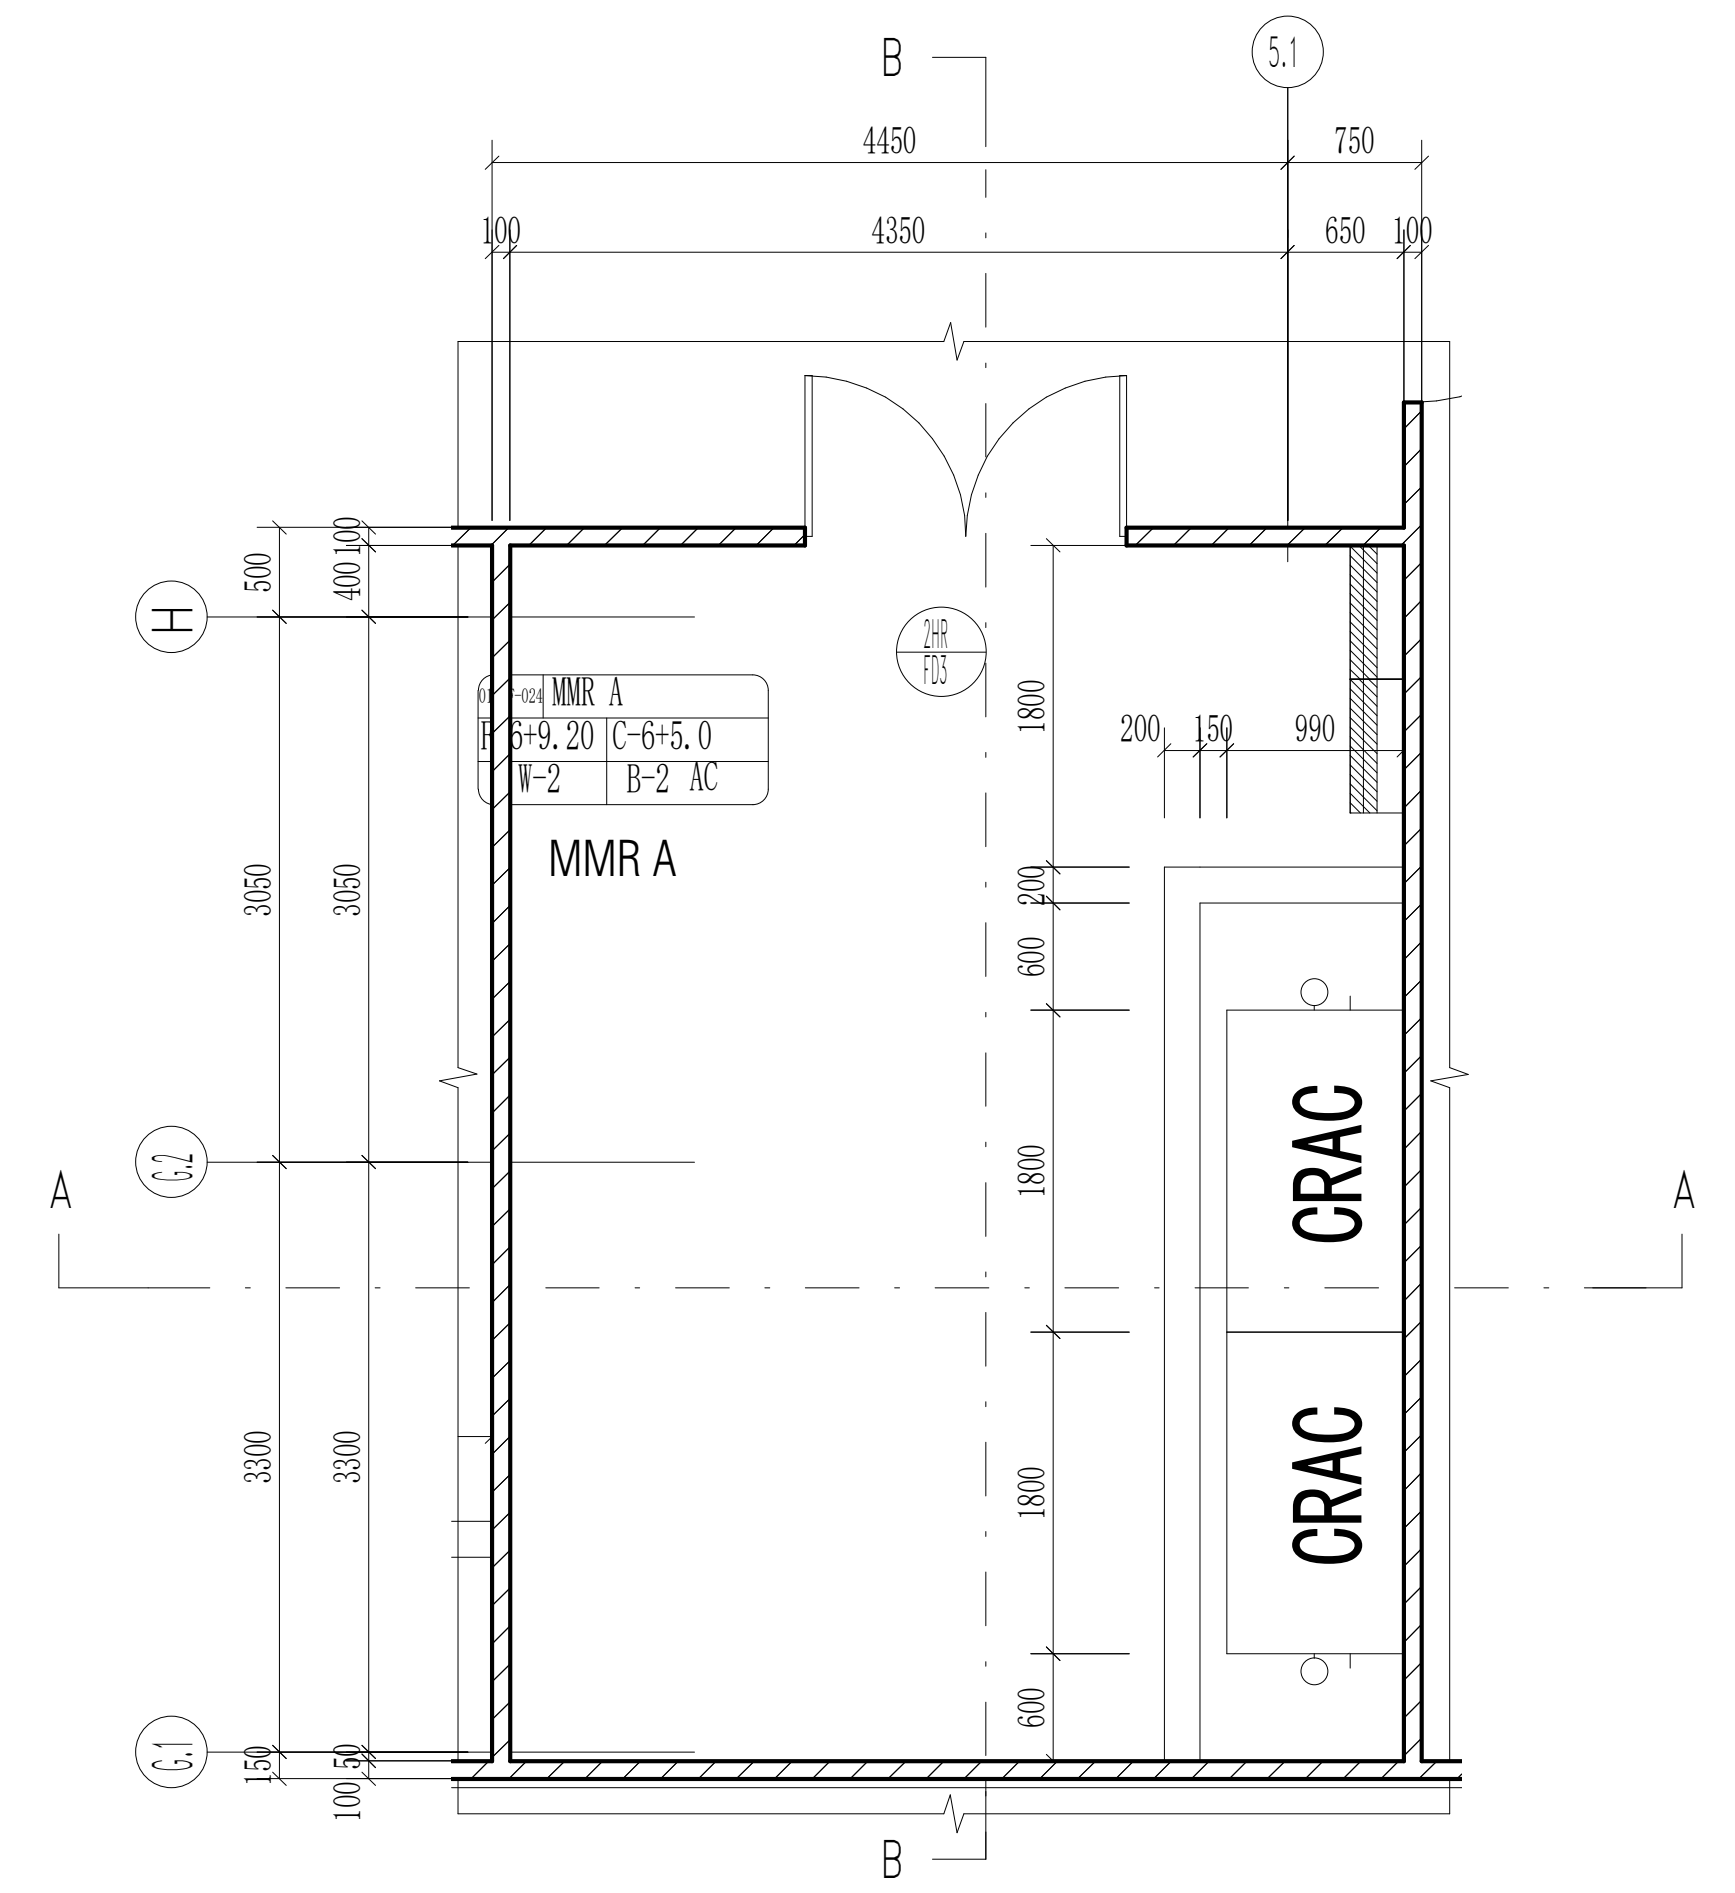

MMR A PLAN

Scale 1:50

THE "SFL" MARKED IN THE DRAWING REFERS TO THE STRUCTURAL FLOOR LEVEL, WHILE THE FINISHED FLOOR LEVEL (FFL) IS DETERMINED BASED ON FLOOR FINISHES.

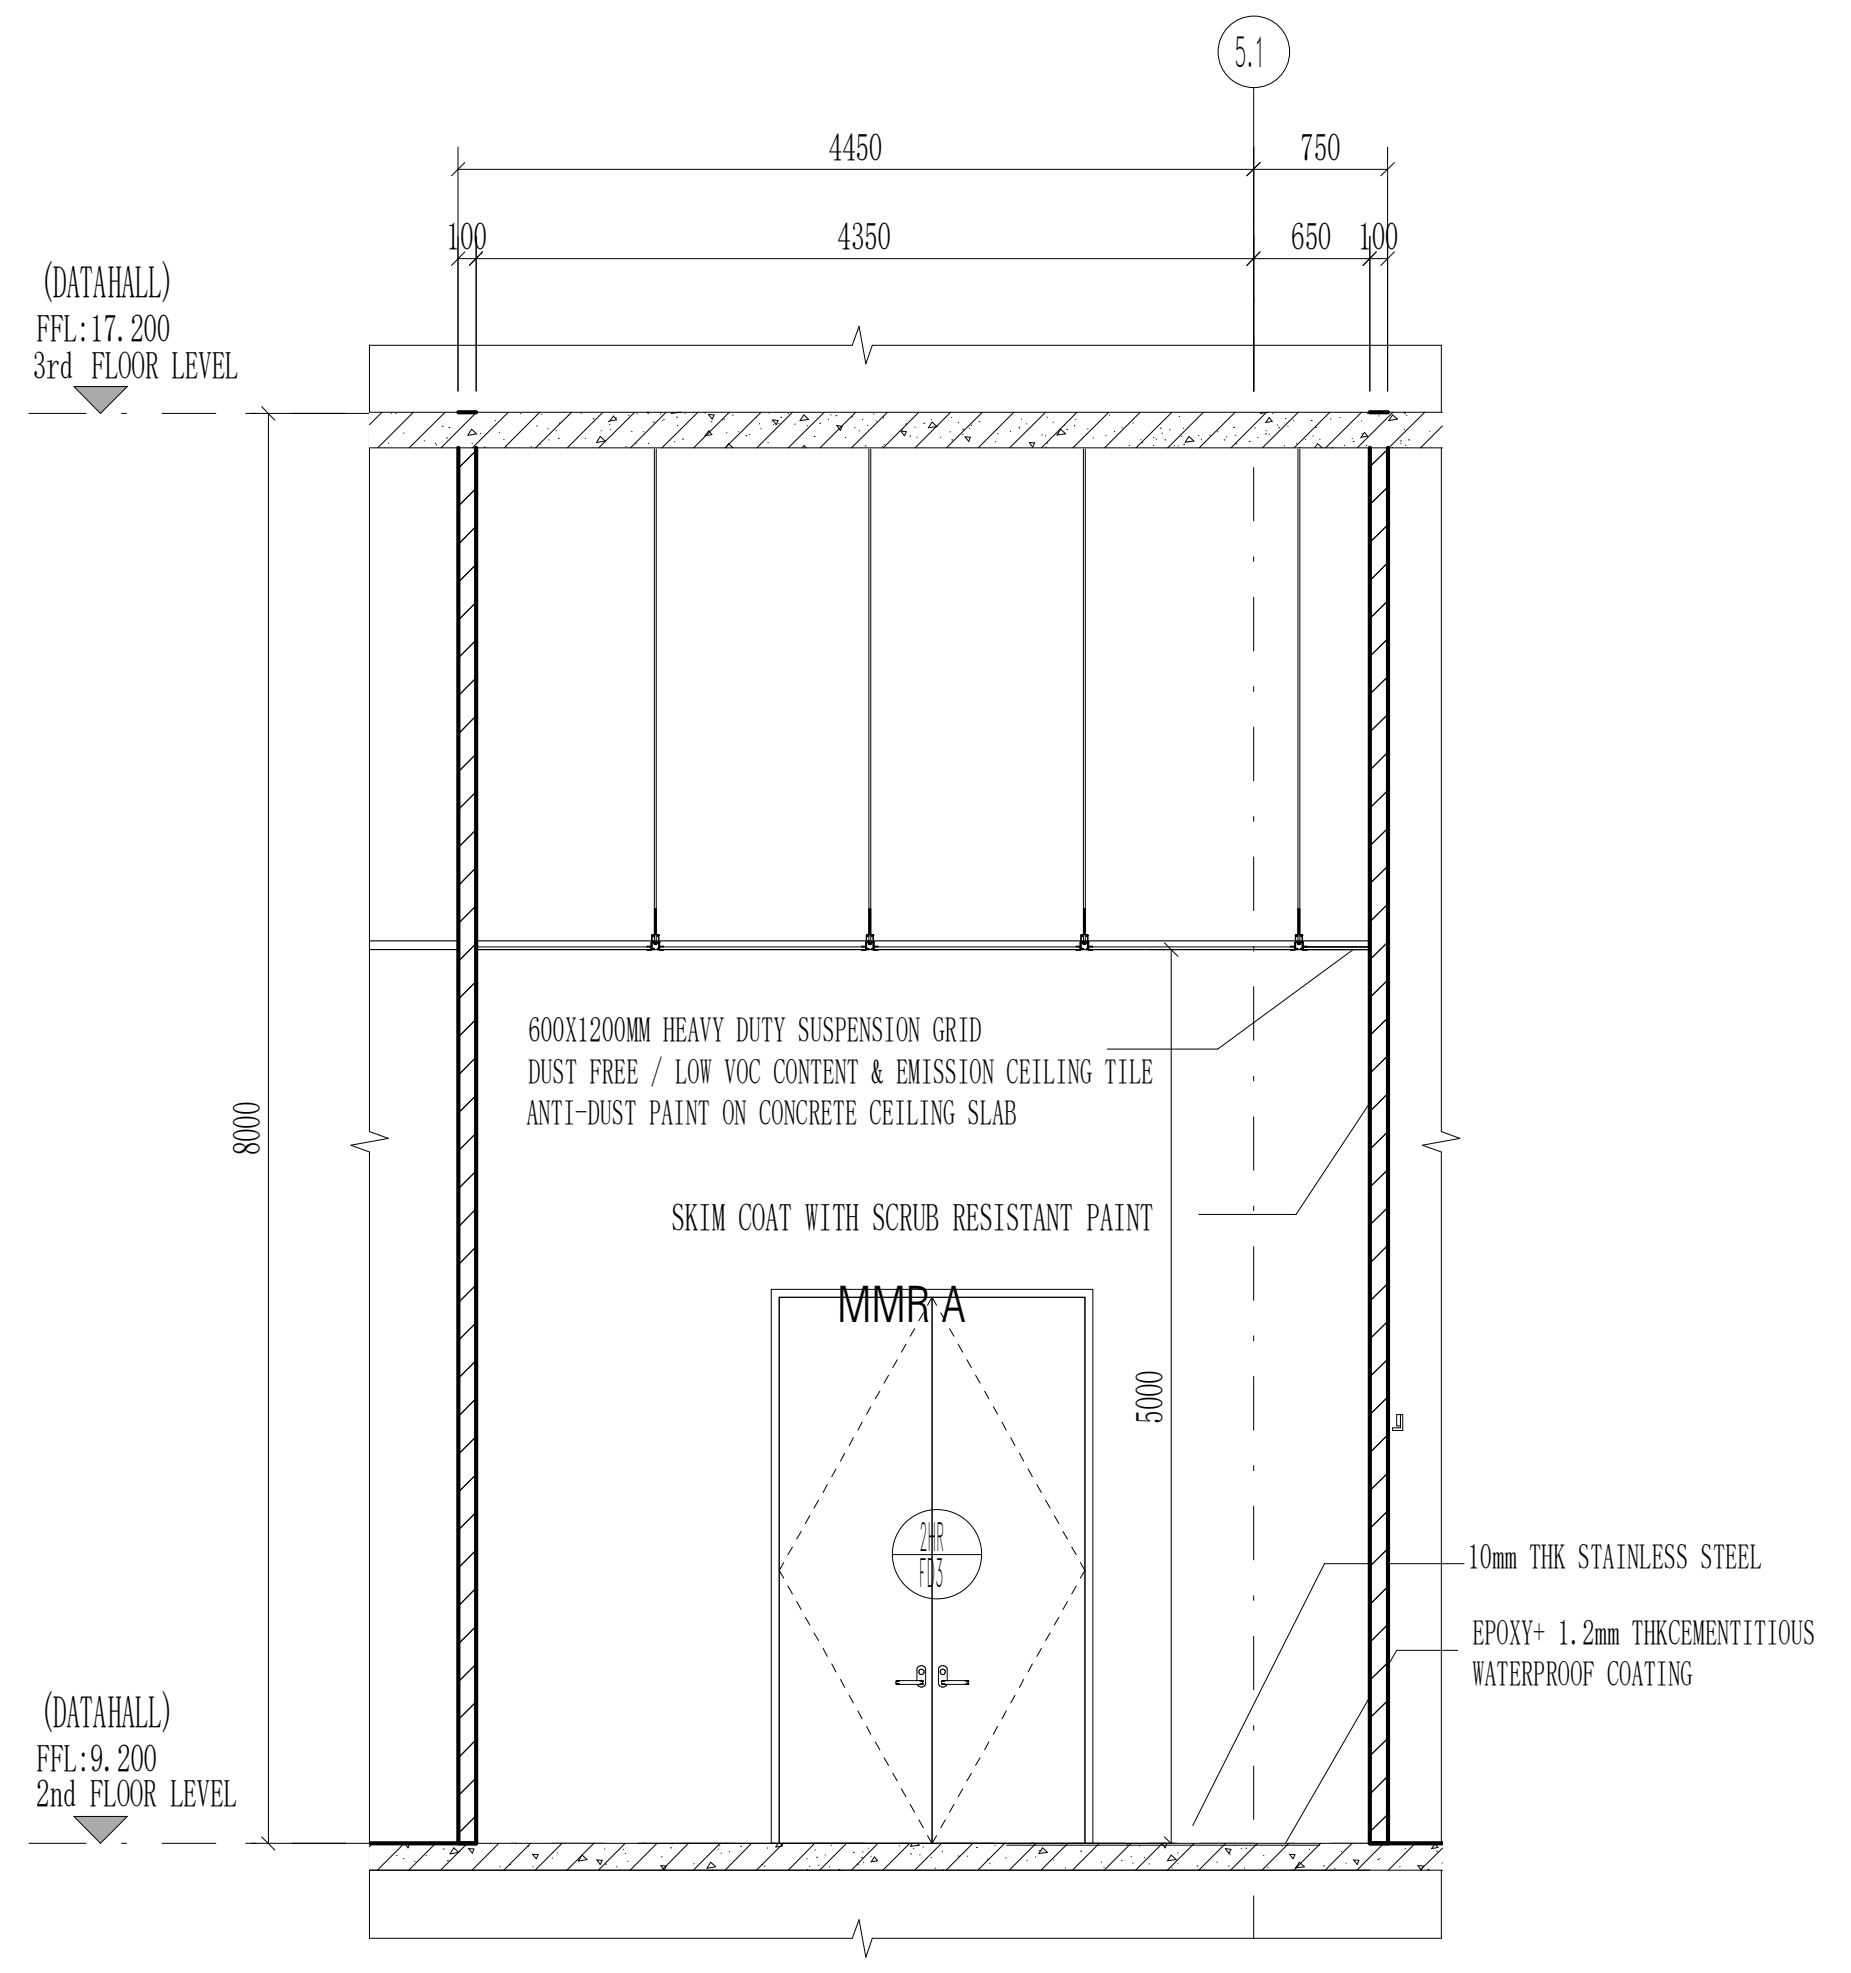
600X1200MM HEAVY DUTY SUSPENSION GRID
DUST FREE / LOW VOC CONTENT & EMISSION CEILING TILE
ANTI-DUST PAINT ON CONCRETE CEILING SLAB
SKIM COAT WITH SCRUB RESISTANT PAINT
MMR A
10mm THK STAINLESS STEEL
EPOXY+ 1.2mm THKCEMENTITIOUS
WATERPROOF COATING

MMR A SECTION A-A

Scale 1:50

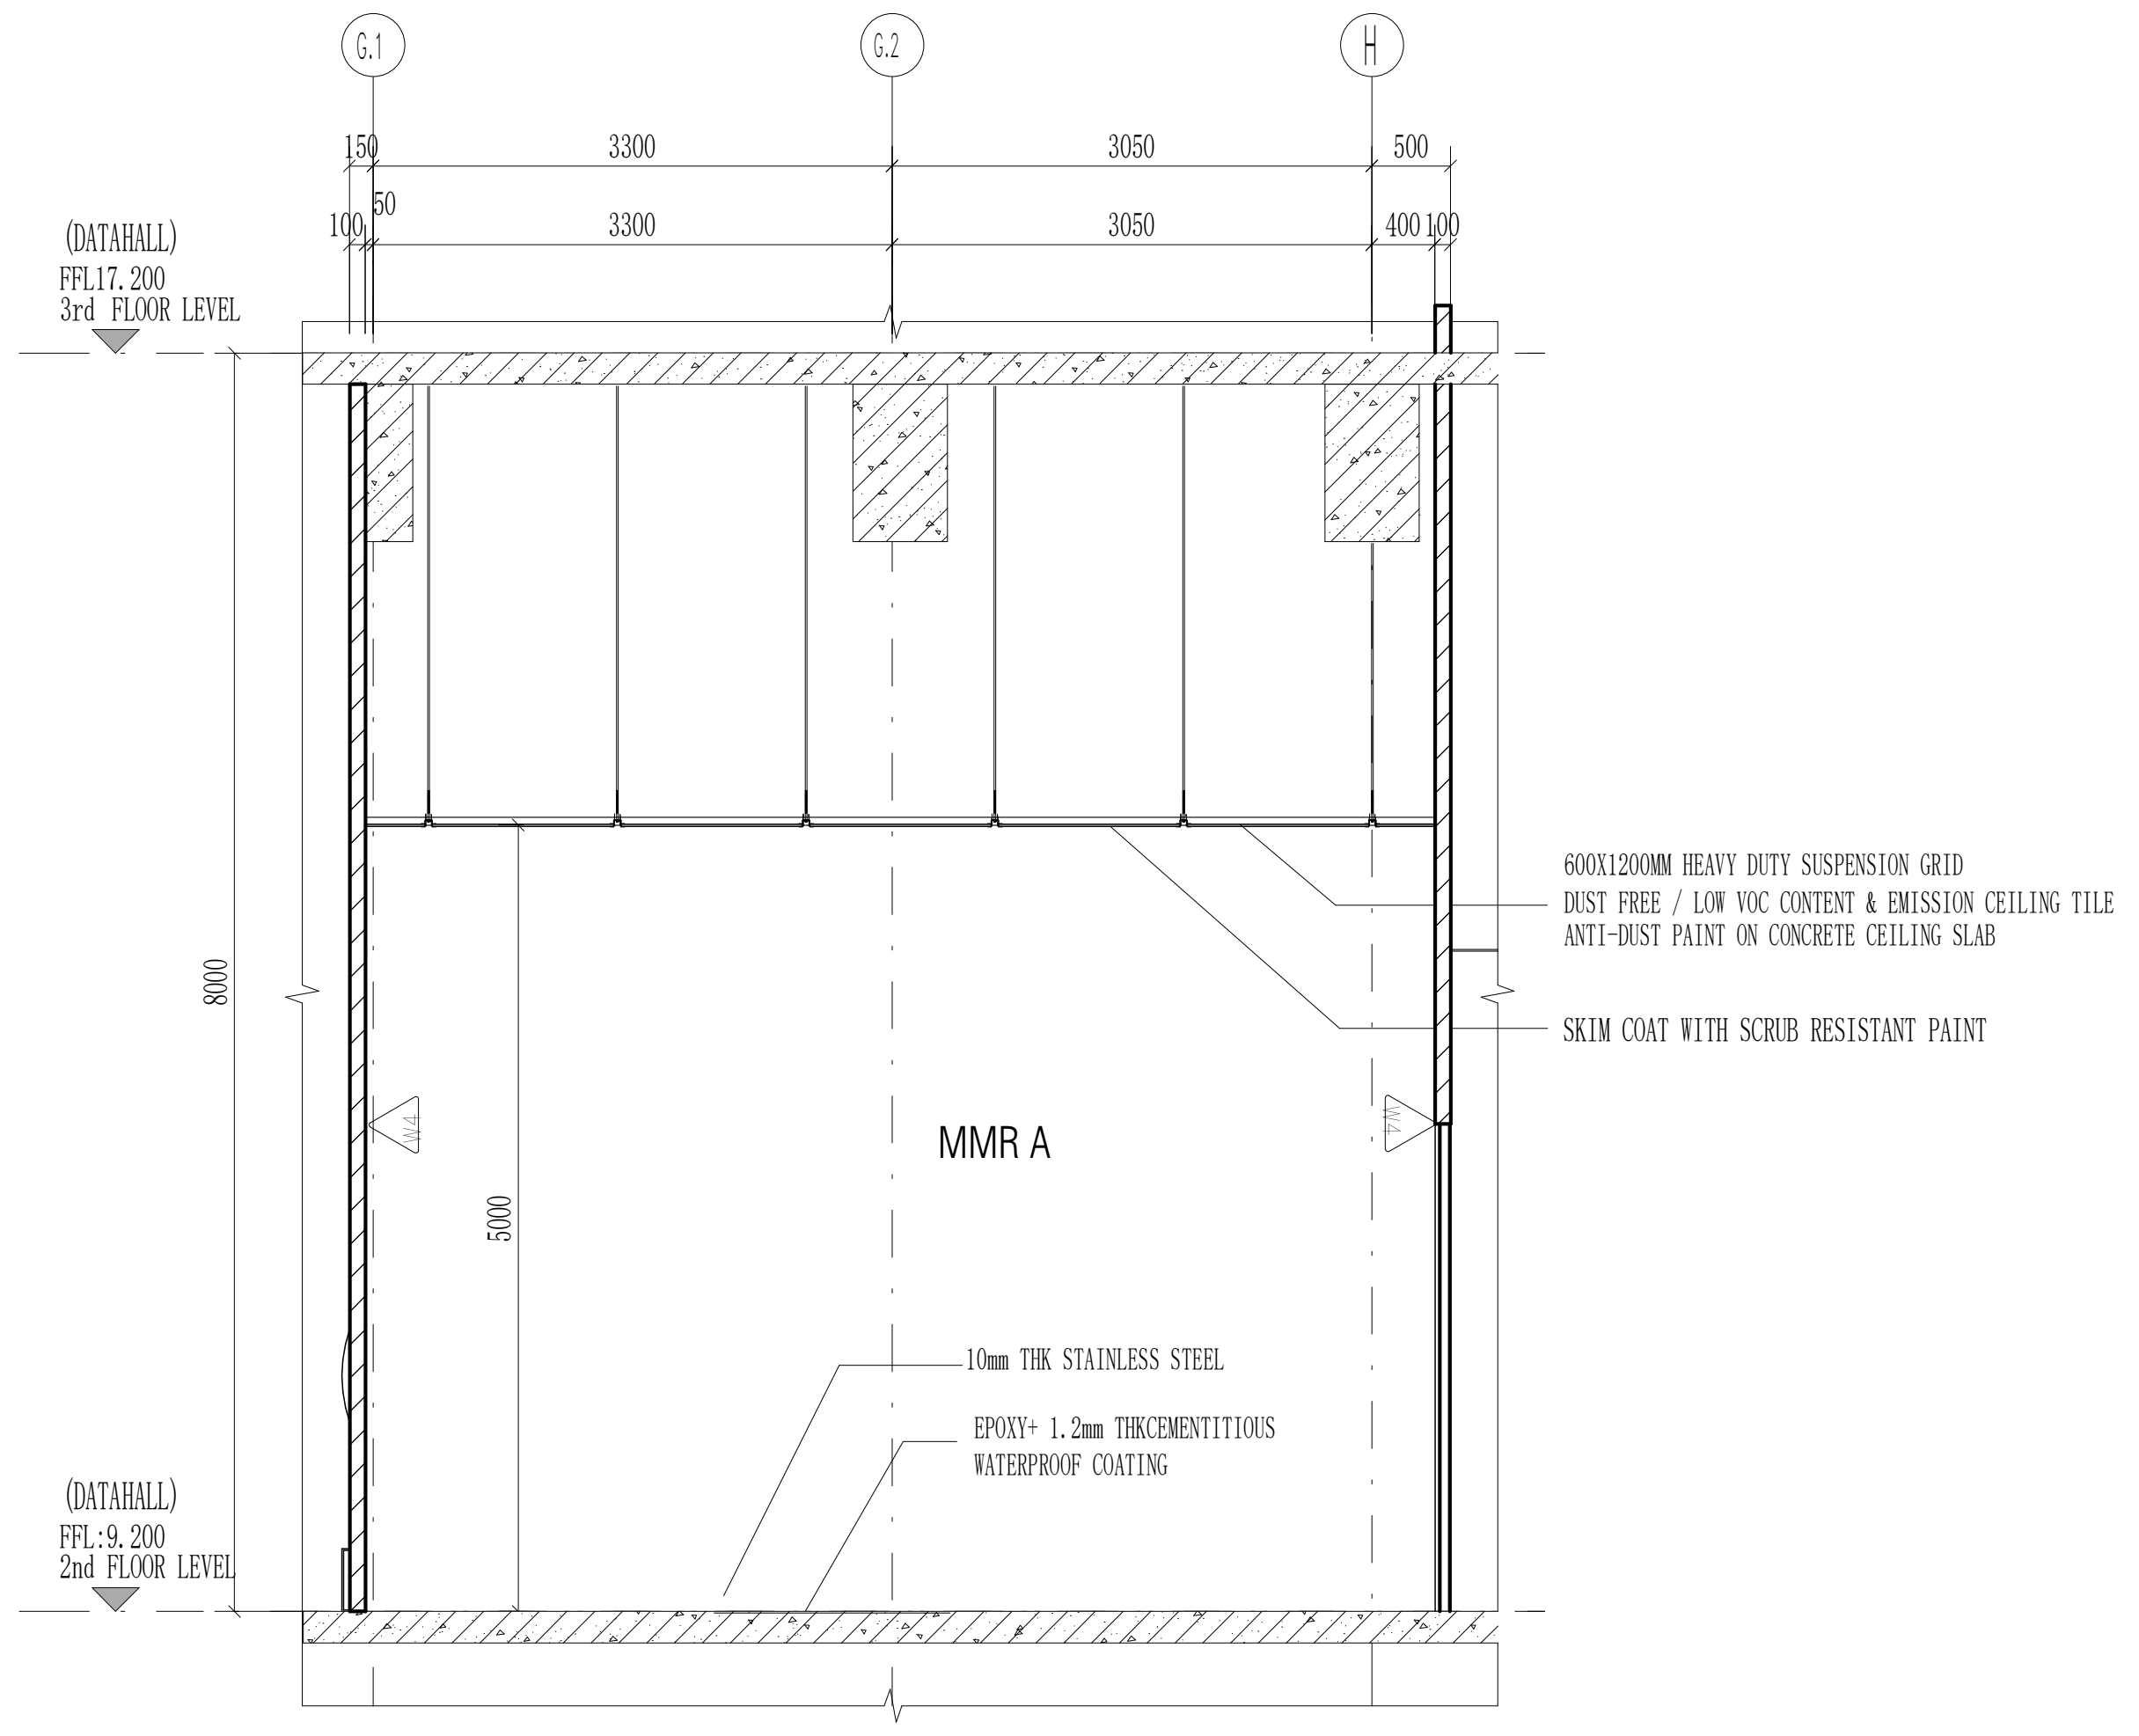
600X1200MM HEAVY DUTY SUSPENSION GRID
DUST FREE / LOW VOC CONTENT & EMISSION CEILING TILE
ANTI-DUST PAINT ON CONCRETE CEILING SLAB
SKIM COAT WITH SCRUB RESISTANT PAINT
MMR A
10mm THK STAINLESS STEEL
EPOXY+ 1.2mm THKCEMENTITIOUS
WATERPROOF COATING

MMR A SECTION B-B

Scale 1:50

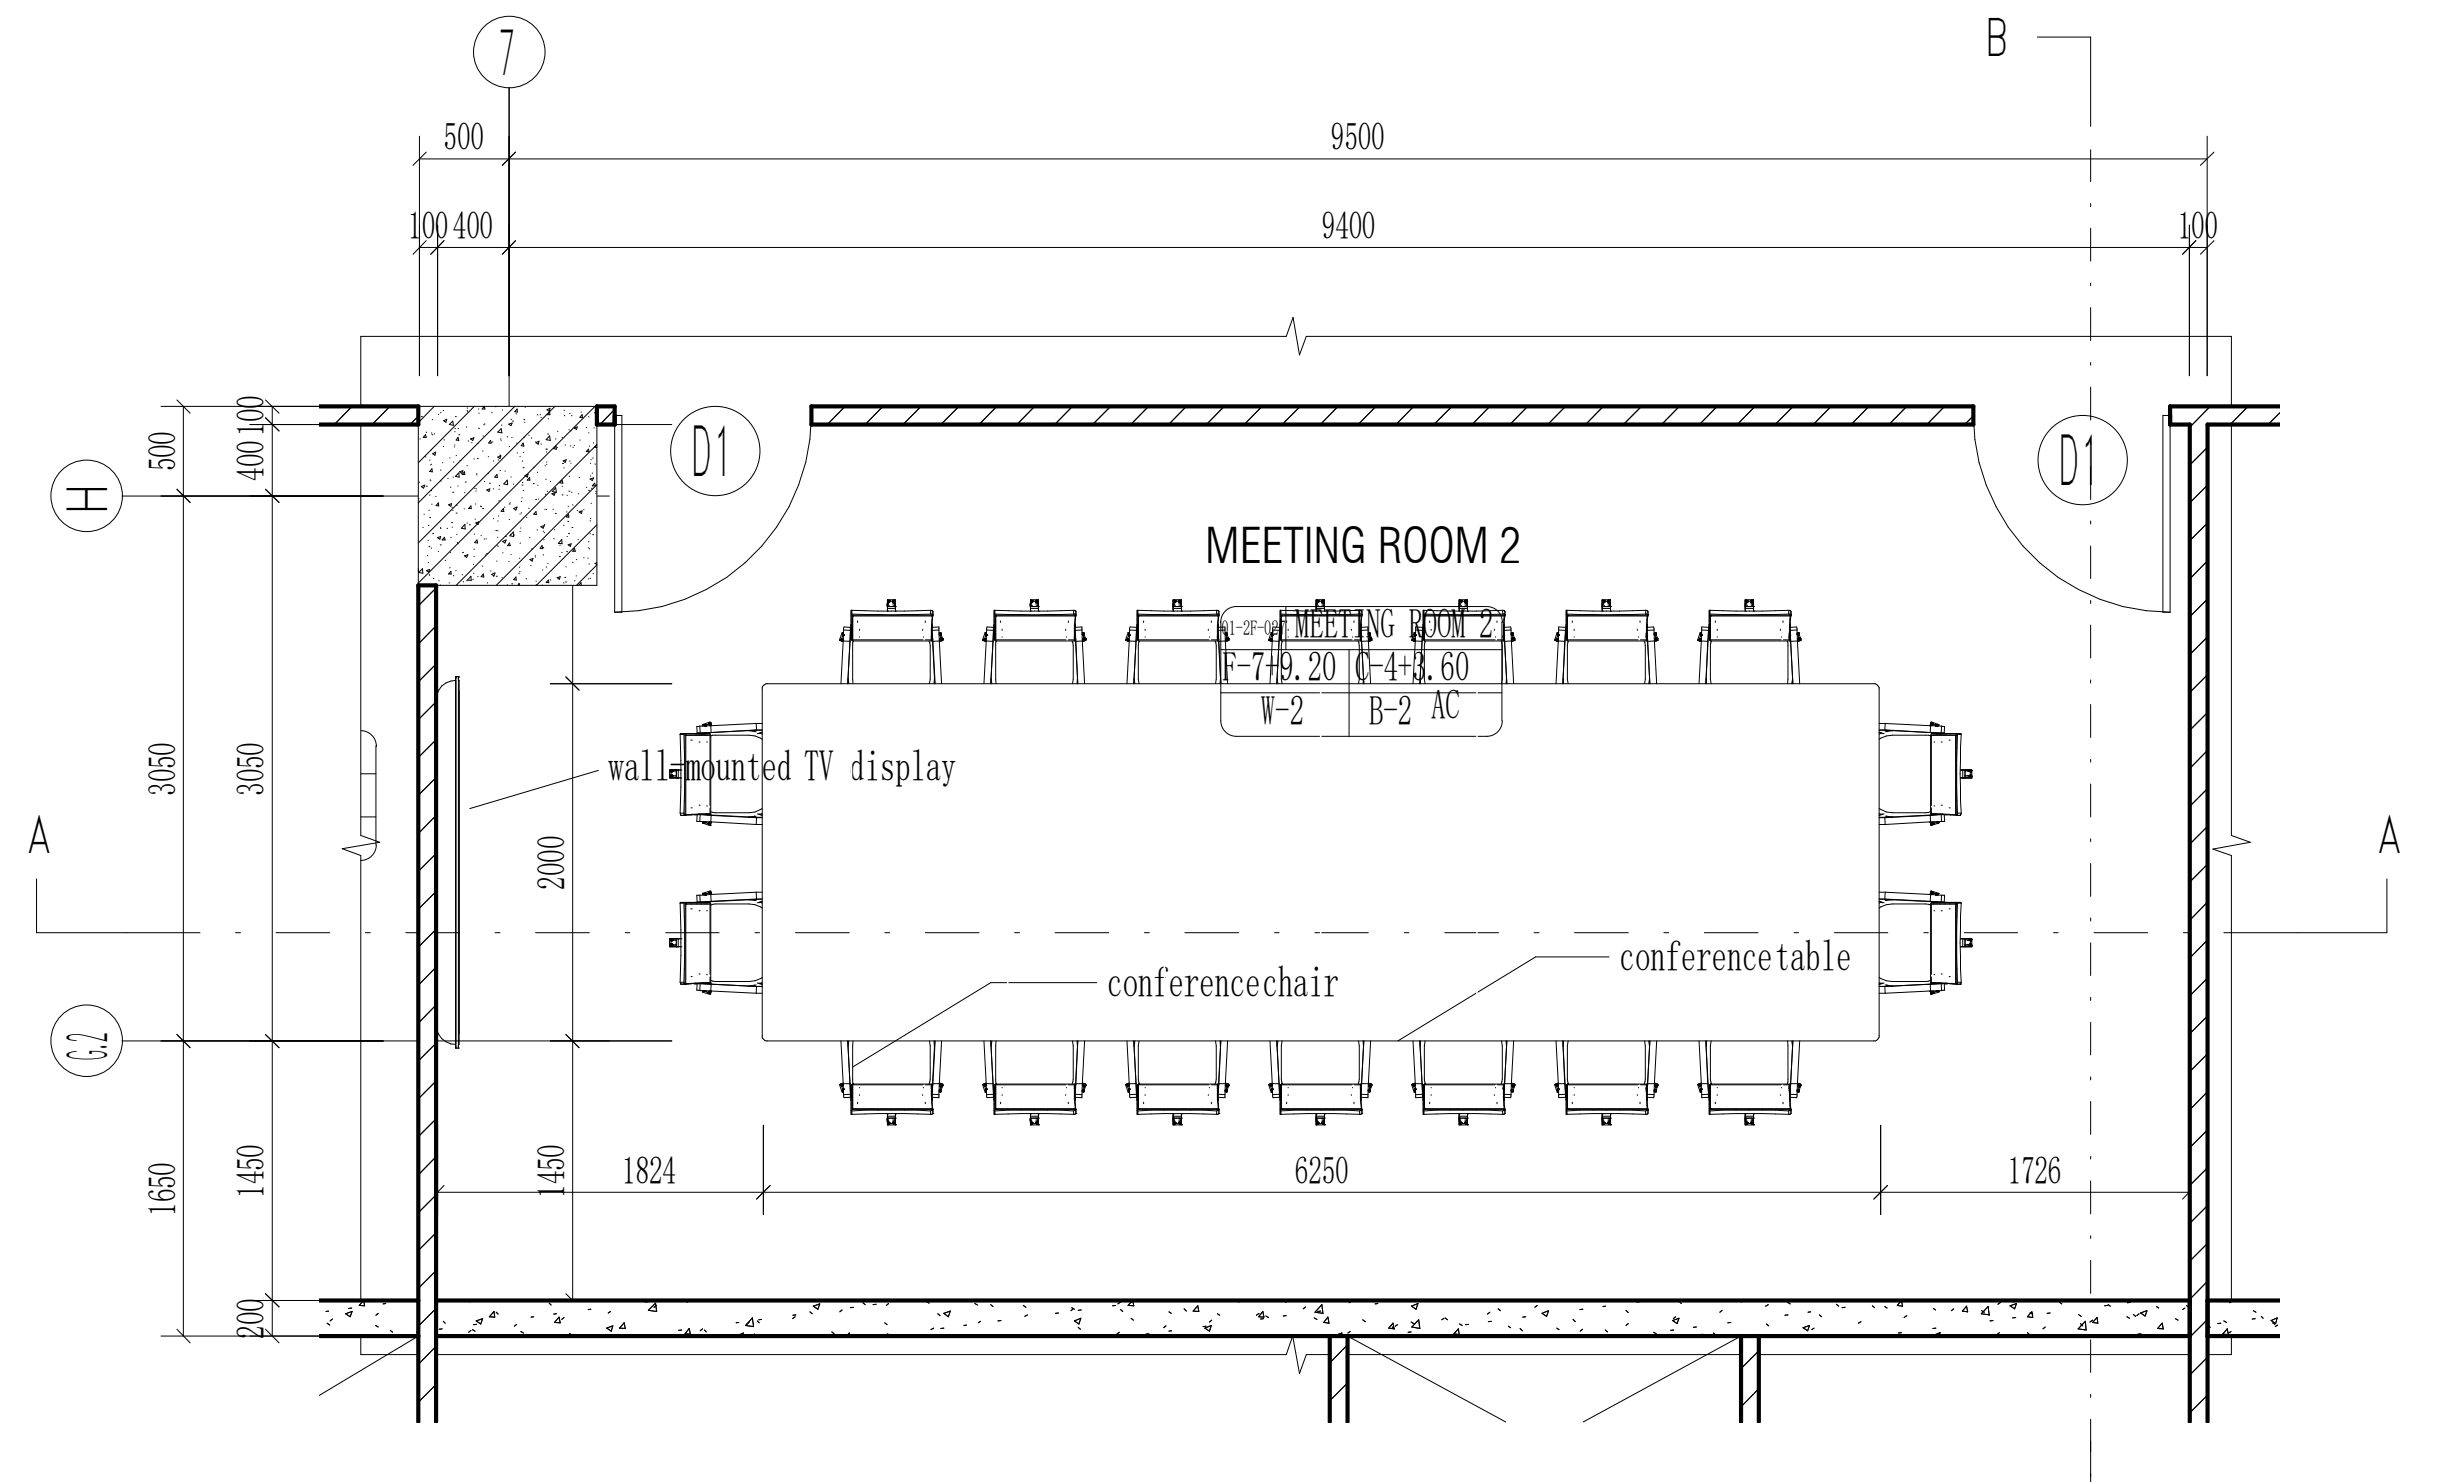

MEETING ROOM PLAN

Scale 1:50

THE "SFL" MARKED IN THE DRAWING REFERS TO THE STRUCTURAL FLOOR LEVEL, WHILE THE FINISHED FLOOR LEVEL (FFL) IS DETERMINED BASED ON FLOOR FINISHES.

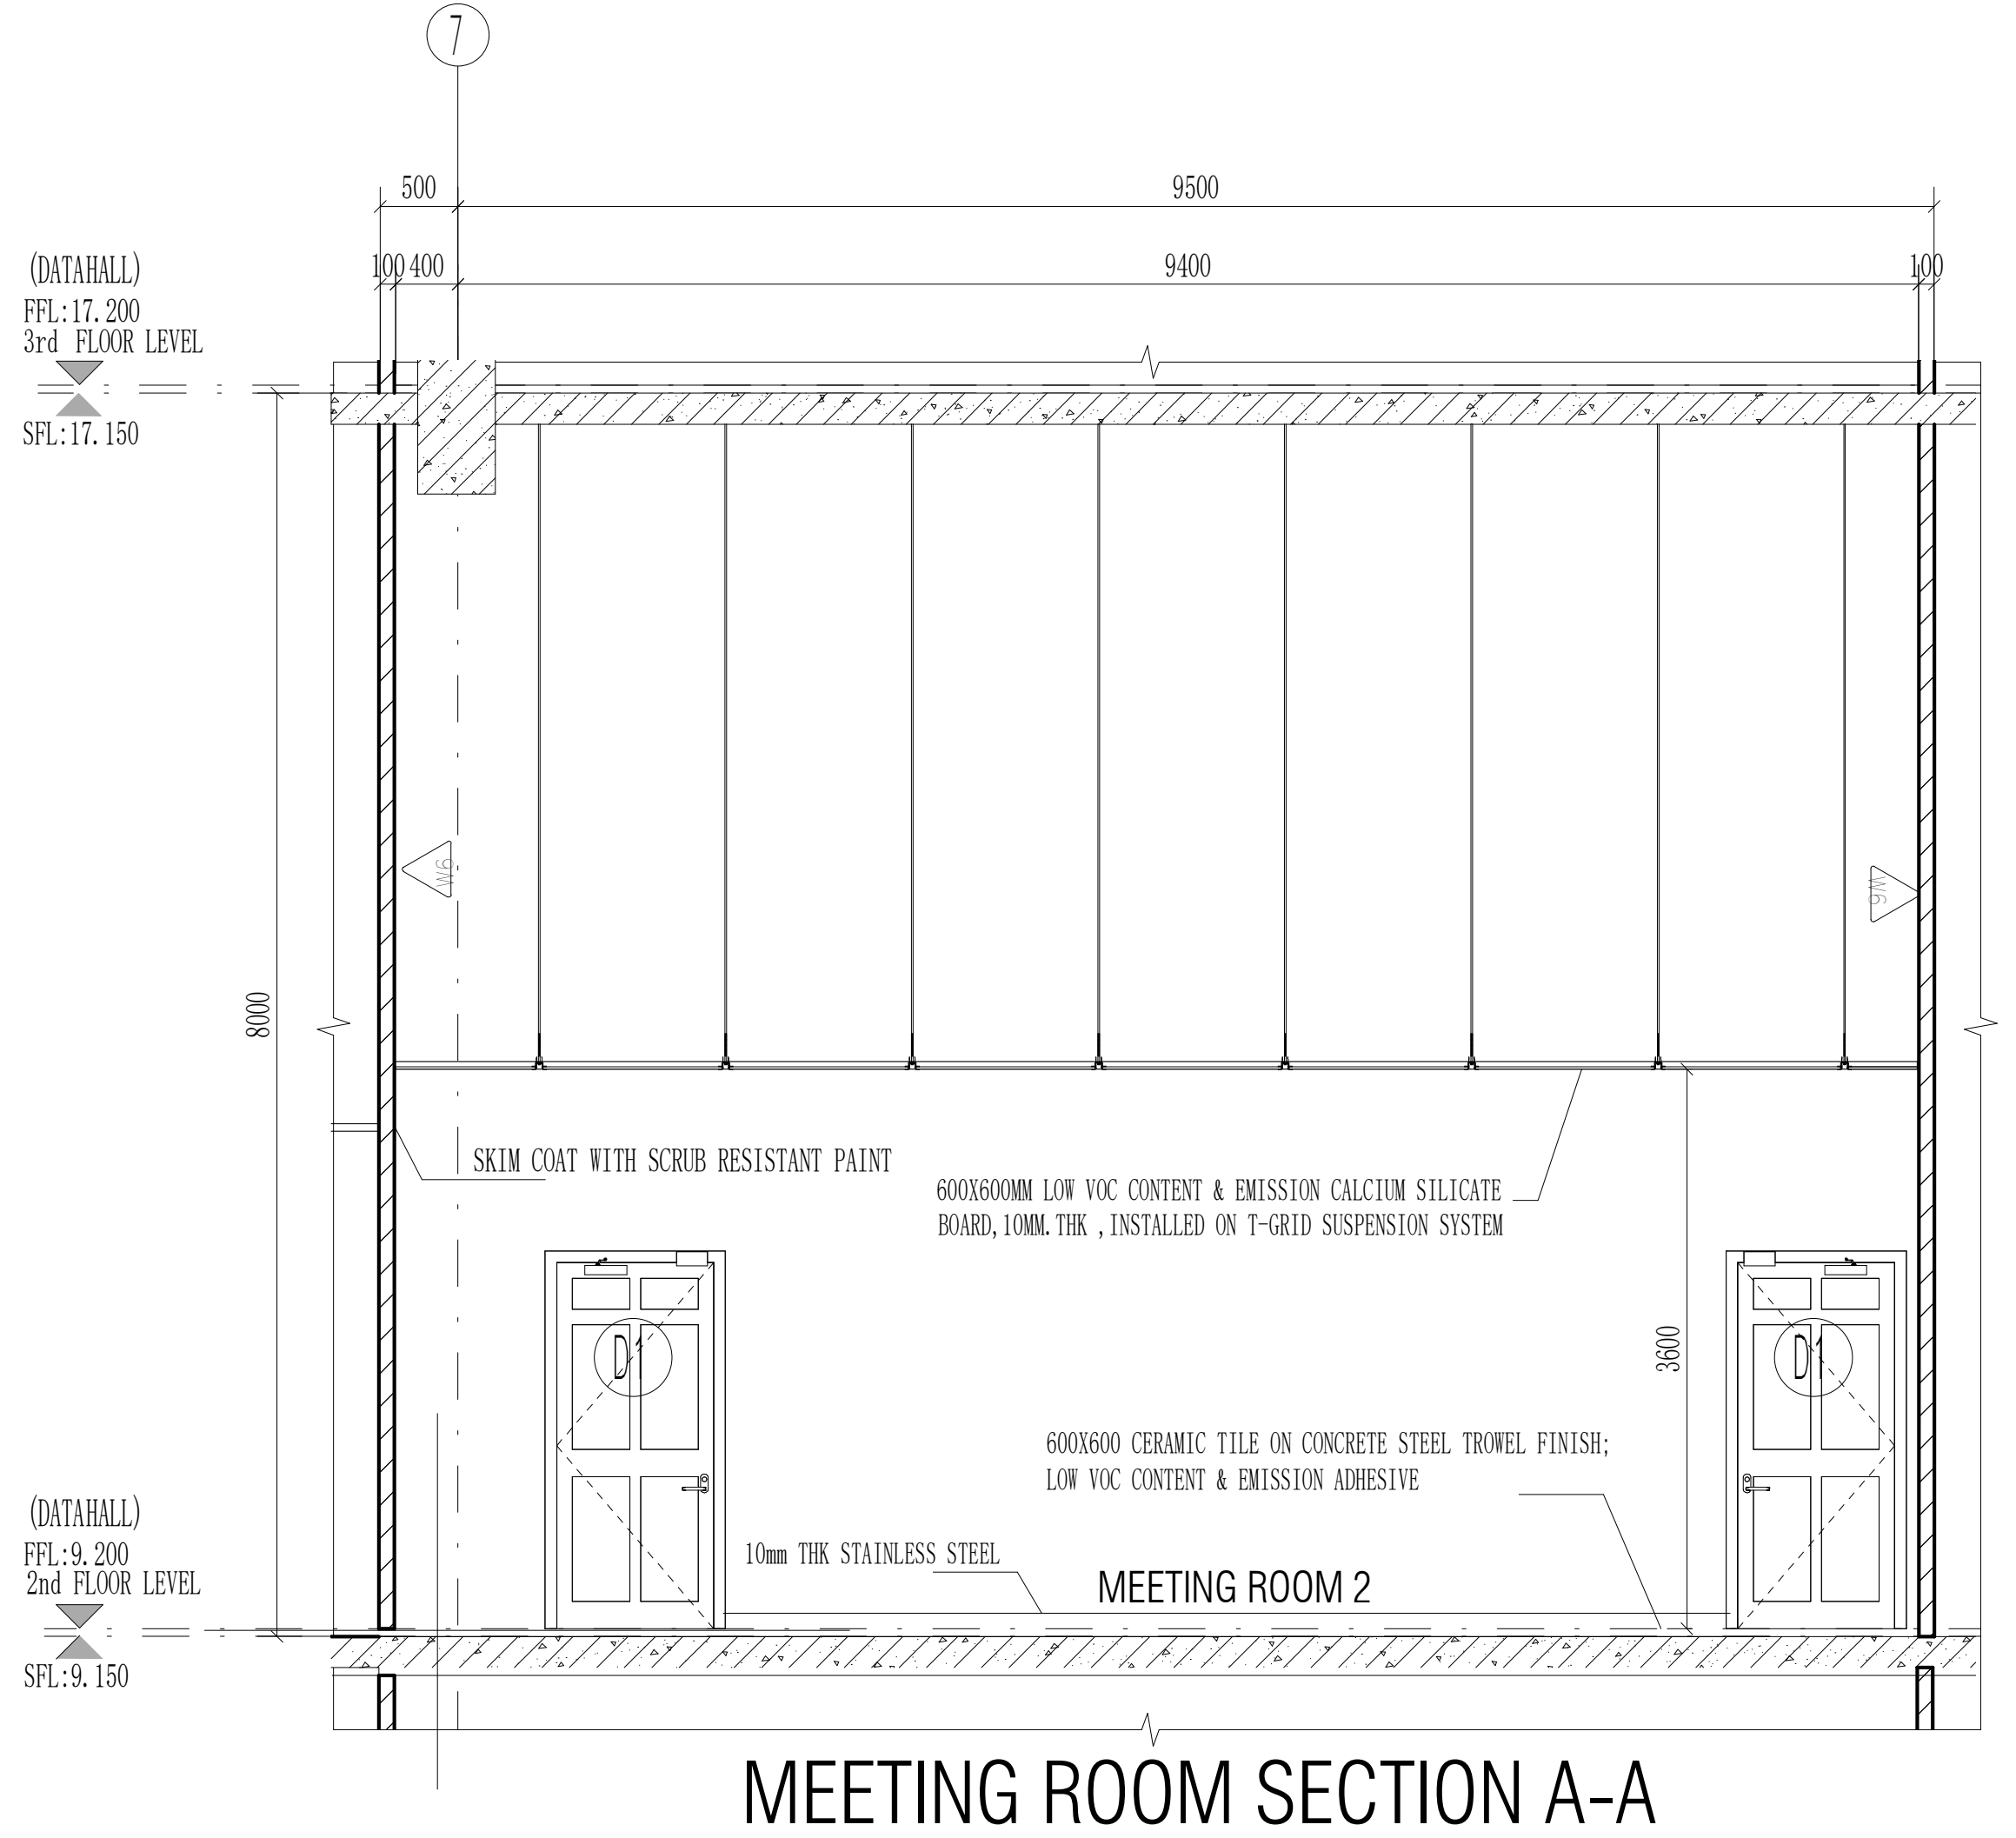
SKIM COAT WITH SCRUB RESISTANT PAINT
600X600MM LOW VOC CONTENT & EMISSION CALCIUM SILICATE
BOARD,10MM.THK , INSTALLED ON T-GRID SUSPENSION SYSTEM
600X600 CERAMIC TILE ON CONCRETE STEEL TROWEL FINISH;
LOW VOC CONTENT & EMISSION ADHESIVE
10mm THK STAINLESS STEEL
MEETING ROOM 2
SFL:17.150
SFL:9.150

MEETING ROOM SECTION A-A

Scale 1:50

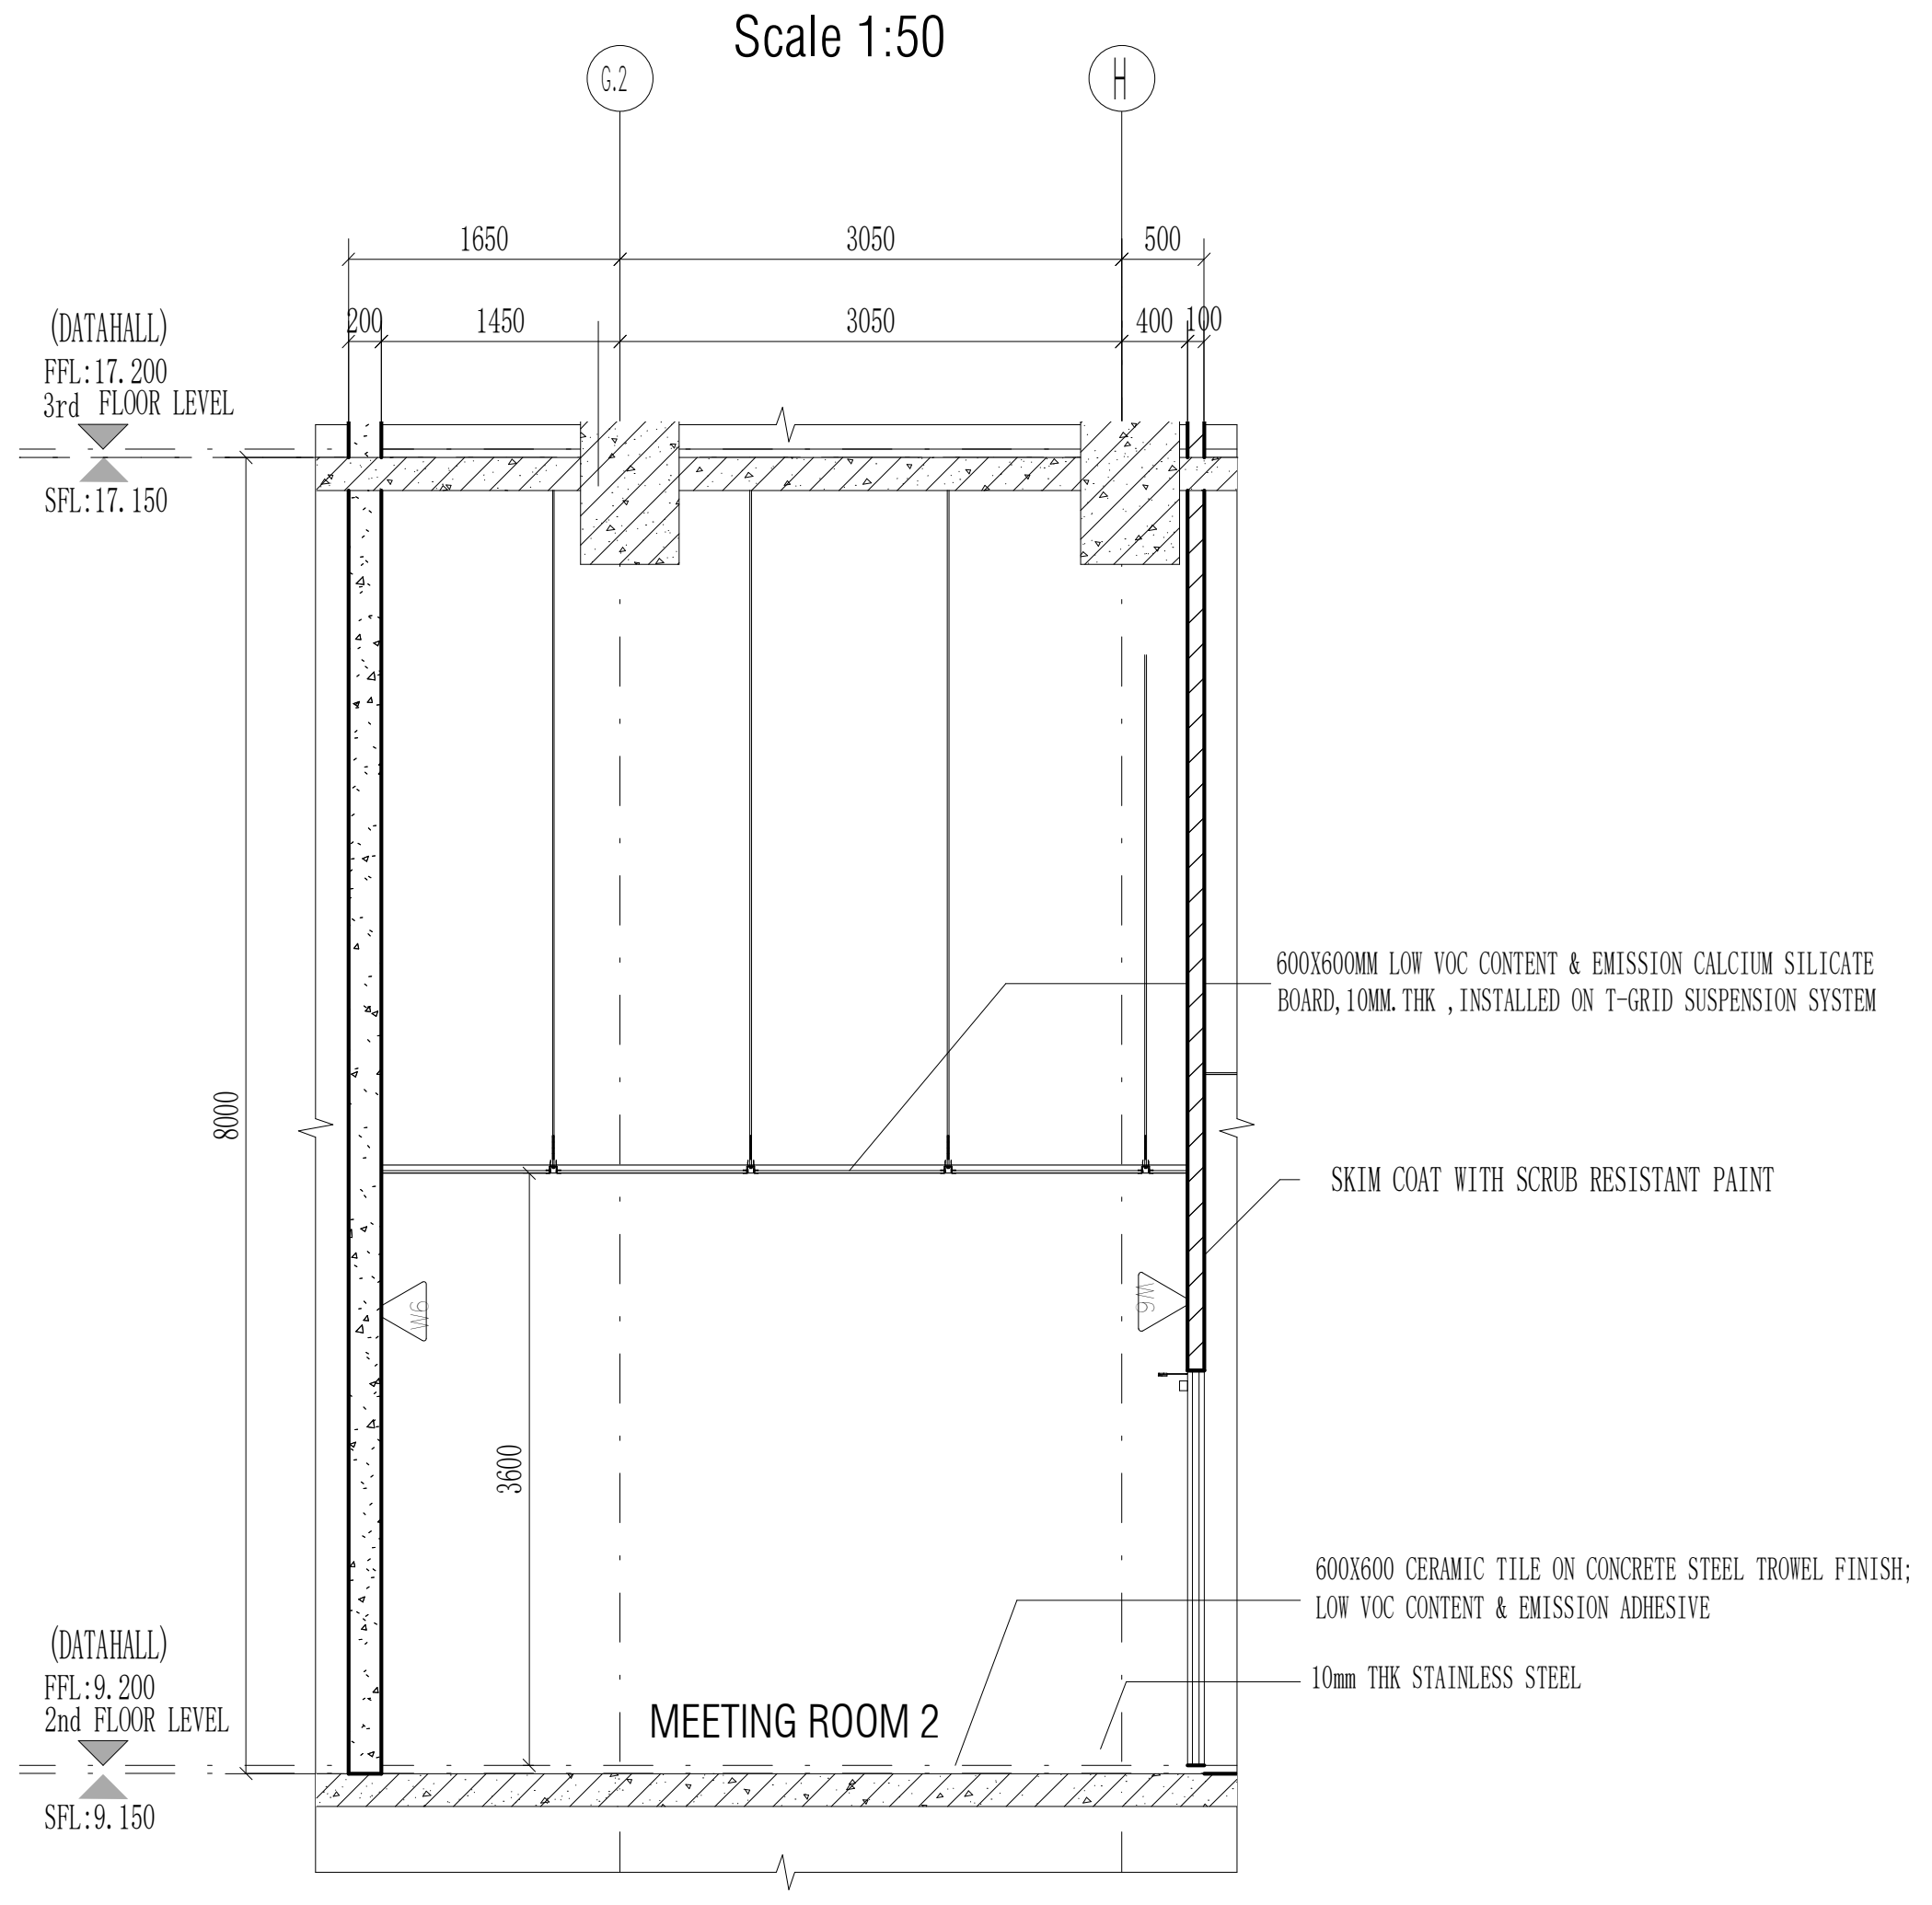
600X600MM LOW VOC CONTENT & EMISSION CALCIUM SILICATE
BOARD,10MM.THK , INSTALLED ON T-GRID SUSPENSION SYSTEM
SKIM COAT WITH SCRUB RESISTANT PAINT
600X600 CERAMIC TILE ON CONCRETE STEEL TROWEL FINISH;
LOW VOC CONTENT & EMISSION ADHESIVE
10mm THK STAINLESS STEEL
MEETING ROOM 2

MEETING ROOM SECTION B-B

Scale 1:50

NOTE :THIS PRINT IS OF A CONFIDENTIAL NATURE, IT SHALL NOT BE TRACED,PHOTOGRAPHED,PHOTOSTATED OR REPRODUCED IN ANY MANER,NOR USED FOR ANY PURPOSE WHATSOEVER EXCEPT BY WRITTEN PERMISSION

CLIENT :

GULF EDGE DC 01

87 Wireless Road, M Thai Tower 11th. Floor, All Seasons Place, Lumpini,
Pathumwan, Bangkok 10330, Thailand

CONTRACTOR :

华西发展(泰国)有限公司
บริษัท หัวซือ ดีเวลลอปเม้นต์ (ประเทศไทย) จำกัด
HUASHI DEVELOPMENT CO.,LTD
No. 202, Room No. 1403, 14/F, Le Concorde Building,
Ratchadapisek Road, Huaykhwang Sub-District,
Huaykhwang District, Bangkok Metropolitan 10310.

CONSULTANT :

ARbay
บริษัท เอ อาร์ เบย์ จำกัด
ARbay Company Limited
31 st Floor Bangkok Insurance Building
25 South Sathorn road Thungmahamek
Sathorn Bangkok 10120 THAILAND
T +66 (0) 2286 8199
F +66 (0) 2286 2863
info@arbay.co.th

CONSULTANT :

Qbic Engineers & Architects Co.,Ltd.
8 Soi KALONG 4 SANAMBINNAM ROAD,
THASAI SUB-DISTRICT, MUANG NONTHABURI DISTRICT
, NONTHABURI.
Tel 662-950-4374
Fax 662-580-3231
E-Mail : qbic@qbic.co.th, www.qbic.co.th
QBIC ENGINEERS AND ARCHITECTS CO.,LTD.

CONSULTANT :

MITR
MITR TECHNICAL CONSULTANT CO.,LTD.
1168/8 12th FLOOR, LUMPINI TOWER BUILDING,
RAMA IV RD., THUNGMAHAMEK, SATHORN, BANGKOK 10120, THAILAND
TEL : 0-2679-9079-84
FAX : 0-2679-9085 E-mail: mitr_dd@mitr.com

Architect : SIGNATURE
ประกิต พนานุรัตน์ วสถ. 580
ที่อยู่
251/1 ถ.จารุเมือง แขวงรองเมือง เขตปทุมวัน
กรุงเทพมหานคร โทรศัพท์ 02-286-8199

Structural Engineer : SIGNATURE
วิศวกรผู้ออกแบบโครงสร้าง
ณัฐสม สงวนวงษ์ วย 1423
ที่อยู่
2/1 ซ.รามคำแหง 150 ถ.รามคำแหง
แขวง สะพานสูง เขต สะพานสูง กทม. 10240

Structural Inspector : SIGNATURE
วิศวกรผู้ตรวจสอบโครงสร้าง
โกมล จุฑาภัทร วย 964
ที่อยู่
24/18 ซ.นวมินทร์ 129 ถ. นวมินทร์
แขวง นวลจันทร์ เขต บึงกุ่ม กทม. 10230

Electrical Engineer : SIGNATURE
วิศวกรผู้ออกแบบระบบไฟฟ้ากำลัง
นายสุภัทร บูรณวิทย์ วฟก.1265
ที่อยู่
21 ซอยทานสัมฤทธิ์ 13
ตำบลท่าทราย อ.เมืองนนทบุรี จ.นนทบุรี 11000

Mechanical Engineer : SIGNATURE
วิศวกรผู้ออกแบบระบบเครื่องกลและปรับอากาศ
นายประสิทธิ์ เกี้ยวสุนทร วก.1221
ที่อยู่
44/372 ซอยบางกระดี่ 35/1 แขวงแสมดำ
เขตบางขุนเทียน กทม. 10150
ประสิทธิ์

Sanitary Engineer : SIGNATURE
วิศวกรผู้ออกแบบระบบสุขาภิบาล และดับเพลิง
นายทศวรรษ สนั่นฤทธิ์ วส. 215
ที่อยู่
บ้านเลขที่ 99/107 หมู่ที่ 3 ต.ศีรษะจรเข้น้อย
อ.บางเสาธง จ.สมุทรปราการ 10540
ทศวรรษ

ISSUE/REVISION

REV.	DESCRIPTION	DATE
A	90% DEVELOPED	09/05/2026

PROJECT NAME :

GEDC 01

LOCATION:
Nikhom Phattana district, Rayong ,industrial estate,CPGC

BUILDING :
MAIN BUILDING

90% DEVELOPED

TITLE :

ROOM DETAIL-2F-SERVER ROOM A、ELECTRICAL ROOM A、MMR A、MEETING ROOM

JOB NO.	SCALE 1 : 50
DRAWN NXR	REF.
CHECKED LJC	DWG. NO. MPK01A-90-A-RD-211
APPROVED LXD	
DATE 2026.05.09	

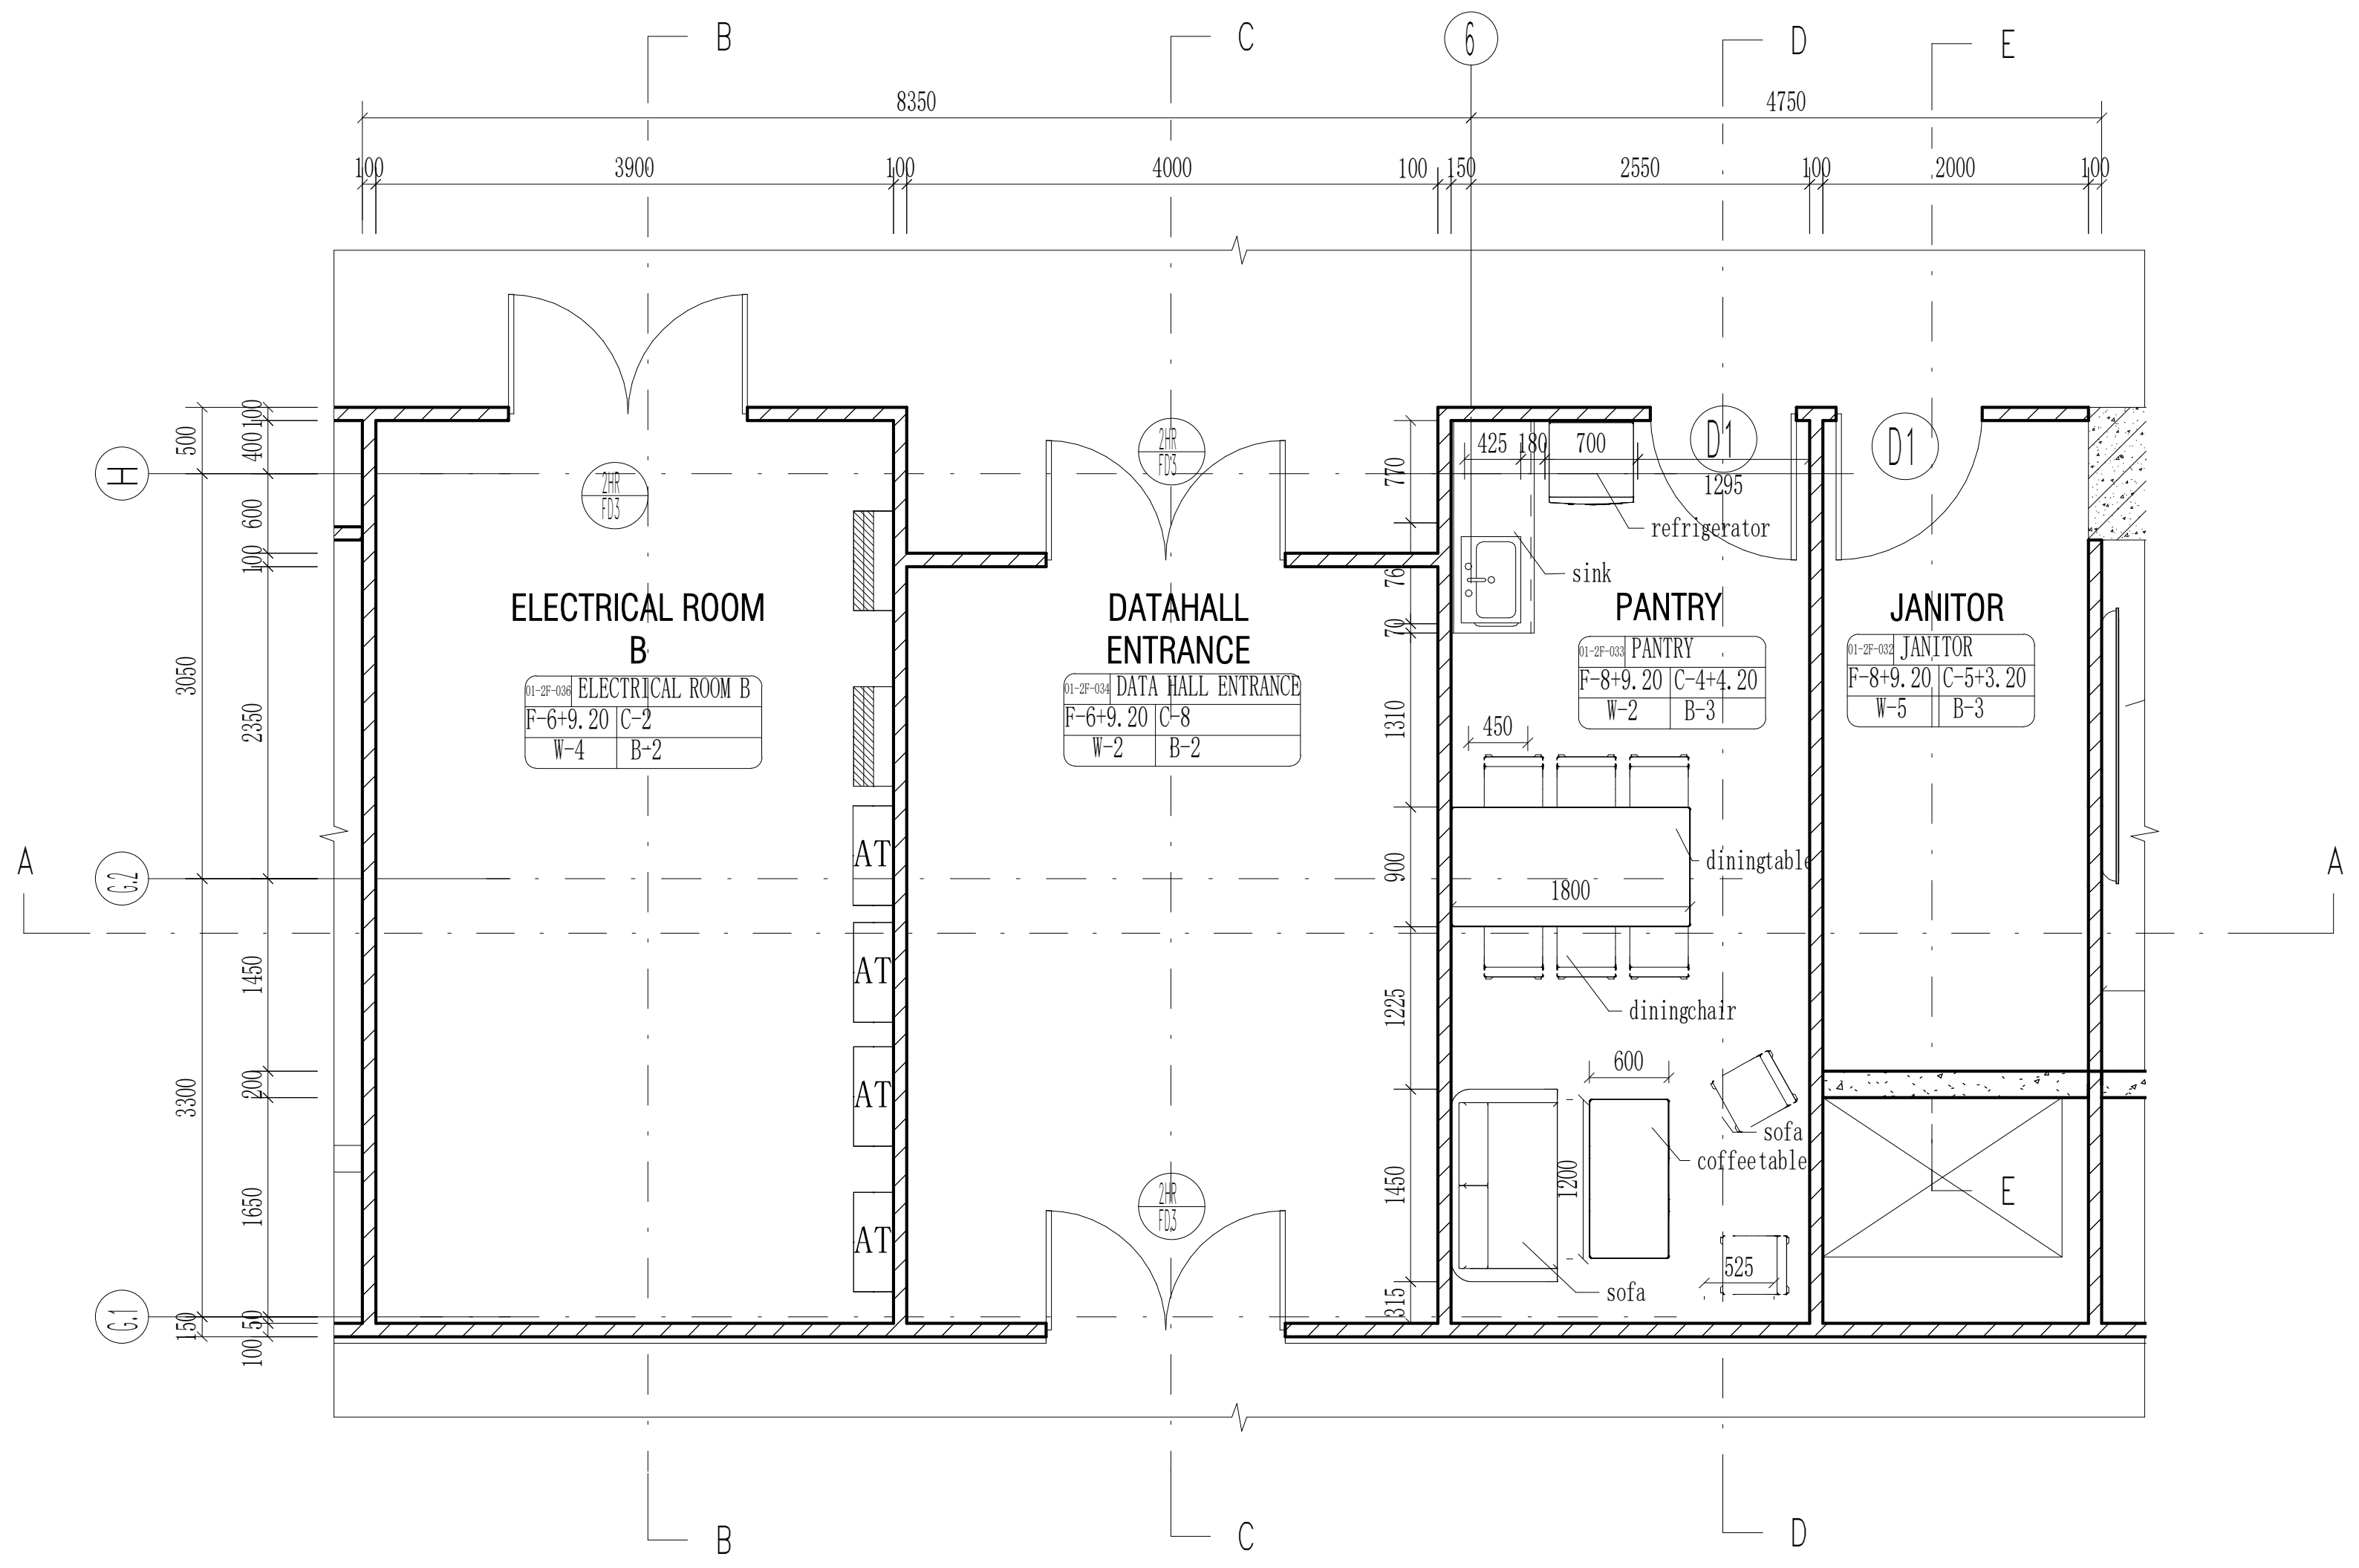

ELECTRICAL ROOM B 、 DATAHALLENTRANGE PANTRY、 JANITOR PLAN

Scale 1:50

THE "SFL" MARKED IN THE DRAWING REFERS TO THE STRUCTURAL FLOOR LEVEL, WHILE THE FINISHED FLOOR LEVEL (FFL) IS DETERMINED BASED ON FLOOR FINISHES.

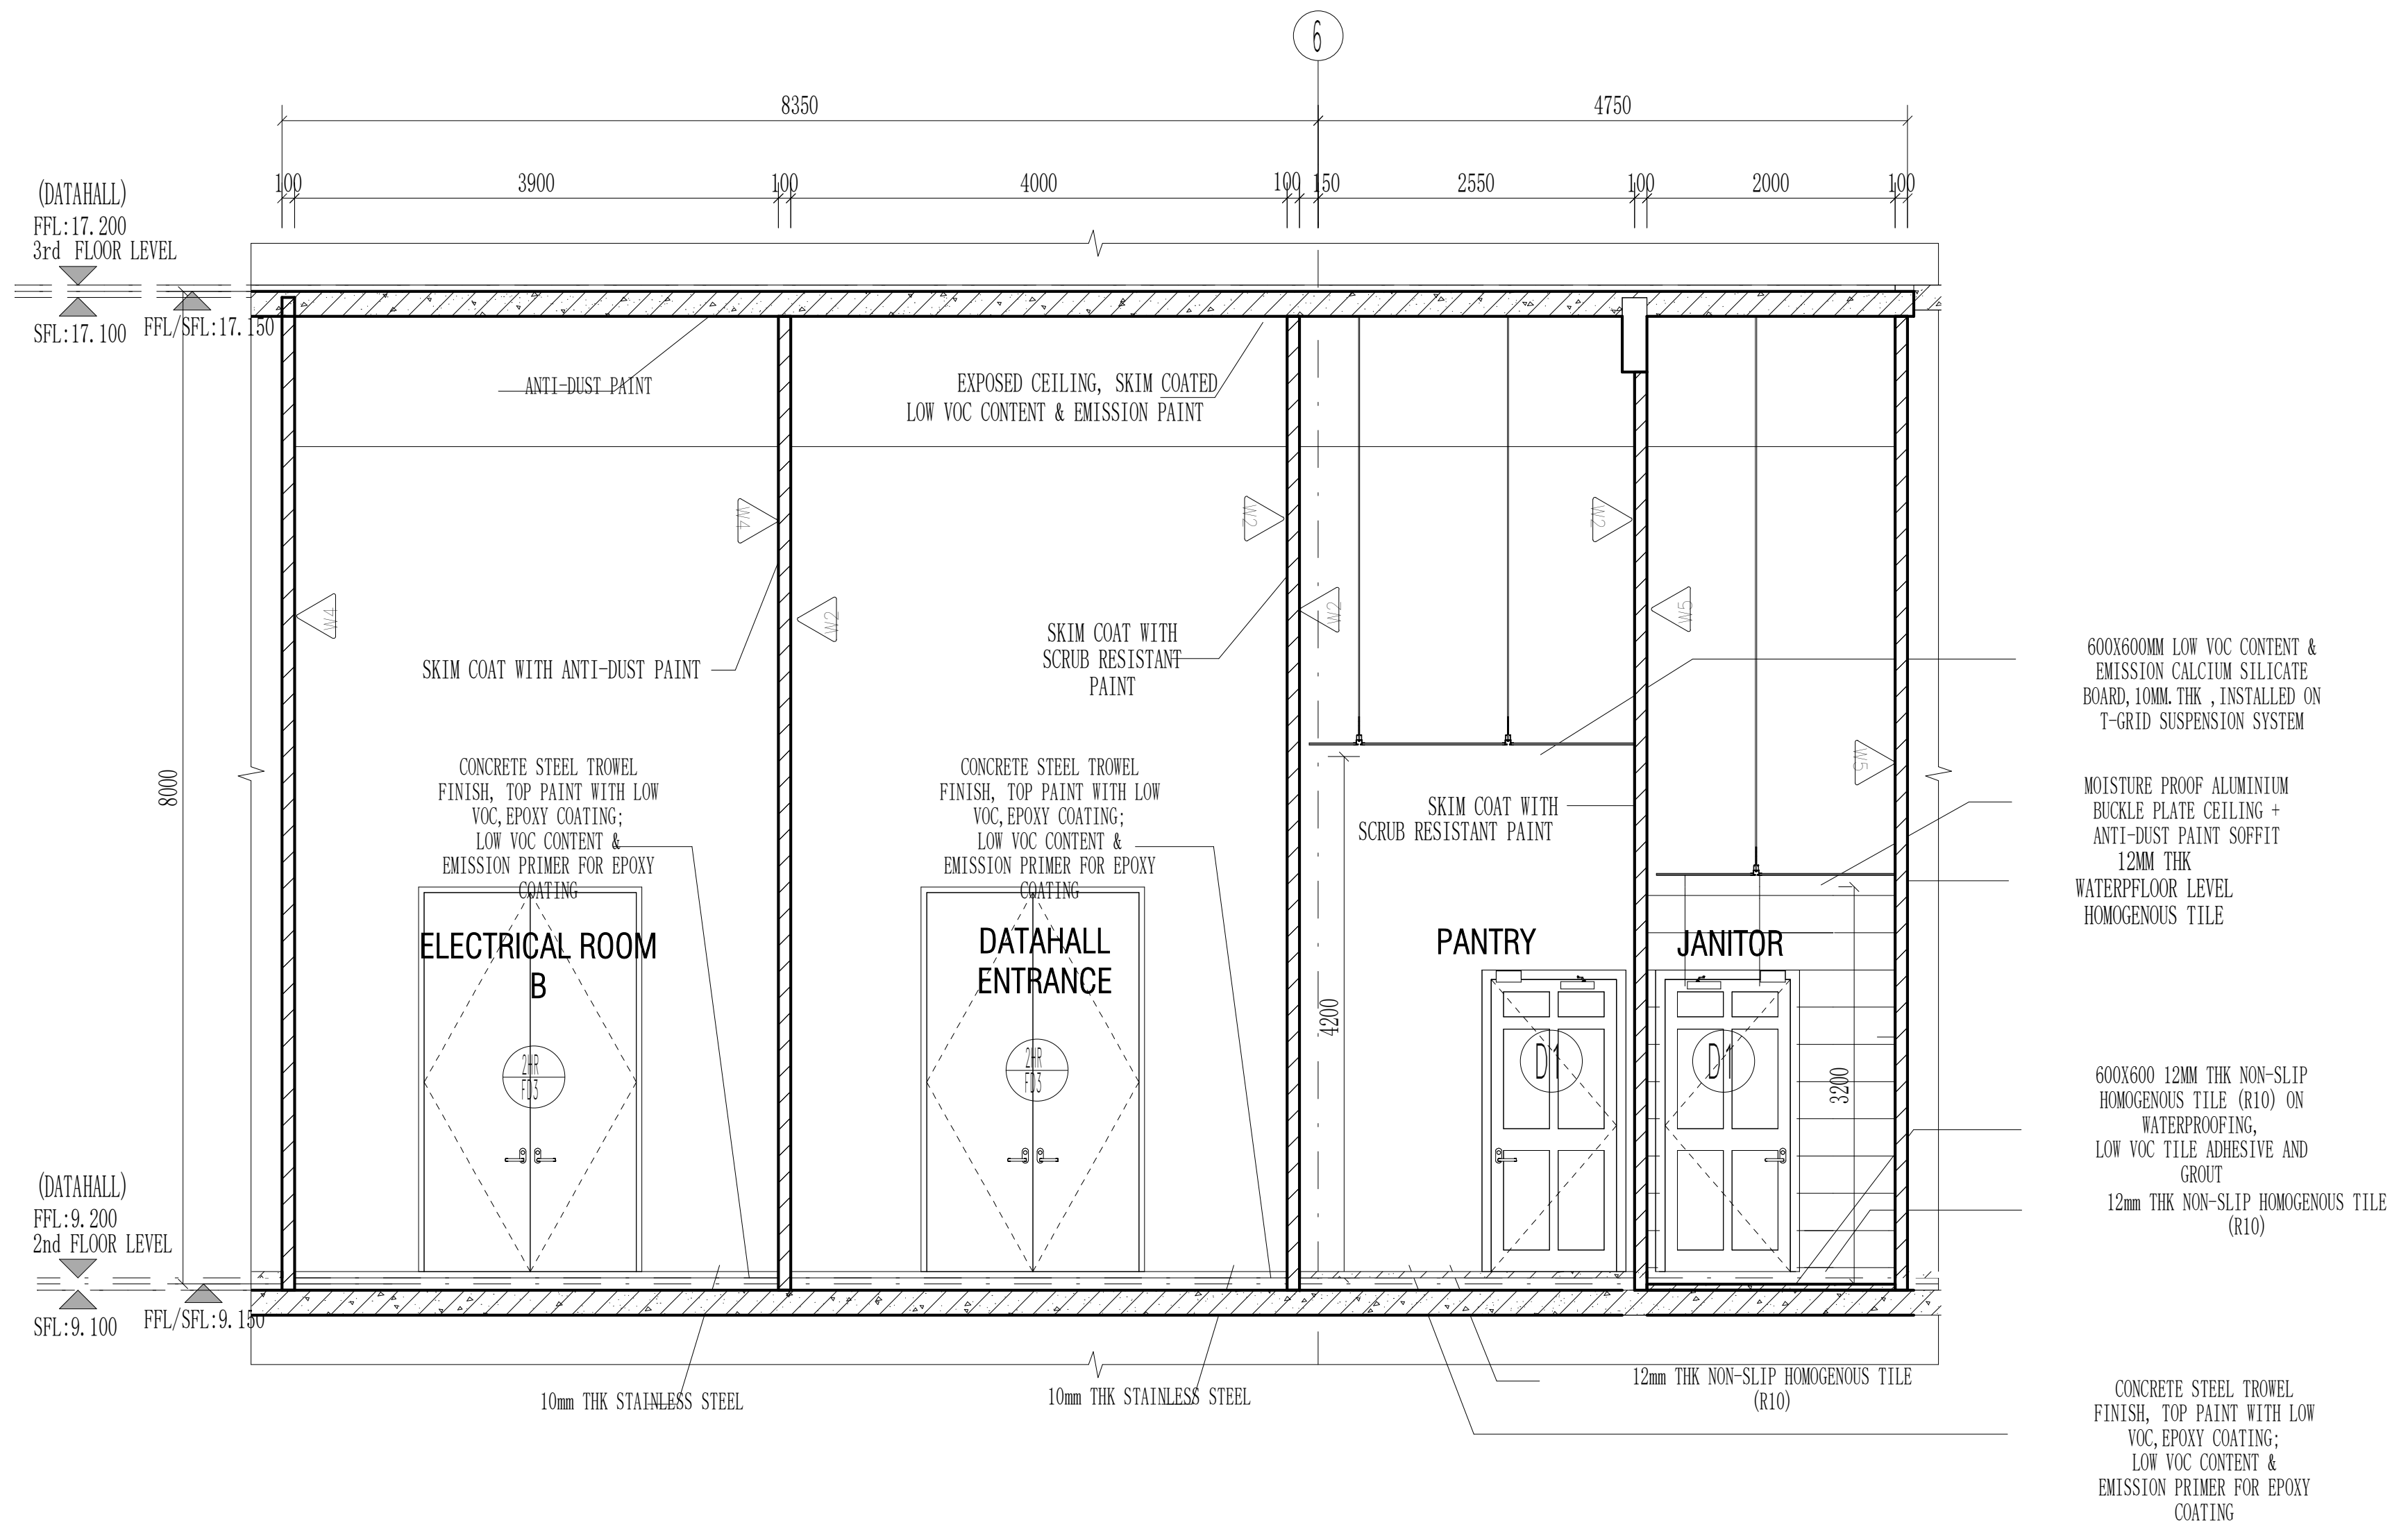
6
8350
4750
100
3900
100
4000
100
150
2550
100
2000
100
(DATAHALL)
FFL:17.200
3rd FLOOR LEVEL
SFL:17.100
FFL/SFL:17.150
ANTI-DUST PAINT
EXPOSED CEILING, SKIM COATED
LOW VOC CONTENT & EMISSION PAINT
SKIM COAT WITH ANTI-DUST PAINT
SKIM COAT WITH SCRUB RESISTANT PAINT
CONCRETE STEEL TROWEL FINISH, TOP PAINT WITH LOW VOC,EPOXY COATING; LOW VOC CONTENT & EMISSION PRIMER FOR EPOXY COATING
CONCRETE STEEL TROWEL FINISH, TOP PAINT WITH LOW VOC,EPOXY COATING; LOW VOC CONTENT & EMISSION PRIMER FOR EPOXY COATING
SKIM COAT WITH SCRUB RESISTANT PAINT
600X600MM LOW VOC CONTENT & EMISSION CALCIUM SILICATE BOARD,10MM.THK ,INSTALLED ON T-GRID SUSPENSION SYSTEM
MOISTURE PROOF ALUMINIUM BUCKLE PLATE CEILING + ANTI-DUST PAINT SOFFIT
12MM THK WATERPFLOOR LEVEL HOMOGENOUS TILE
ELECTRICAL ROOM B
DATAHALL ENTRANCE
PANTRY
JANITOR
2HR FD3
D1
D1
8000
4200
3200
W4
W2
W5
600X600 12MM THK NON-SLIP HOMOGENOUS TILE (R10) ON WATERPROOFING, LOW VOC TILE ADHESIVE AND GROUT
12mm THK NON-SLIP HOMOGENOUS TILE (R10)
(DATAHALL)
FFL:9.200
2nd FLOOR LEVEL
SFL:9.100
FFL/SFL:9.150
10mm THK STAINLESS STEEL
10mm THK STAINLESS STEEL
12mm THK NON-SLIP HOMOGENOUS TILE (R10)
CONCRETE STEEL TROWEL FINISH, TOP PAINT WITH LOW VOC,EPOXY COATING; LOW VOC CONTENT & EMISSION PRIMER FOR EPOXY COATING

ELECTRICAL ROOM B 、 DATAHALLENTRANGE PANTRY、 JANITOR SECTION A-A

Scale 1:50

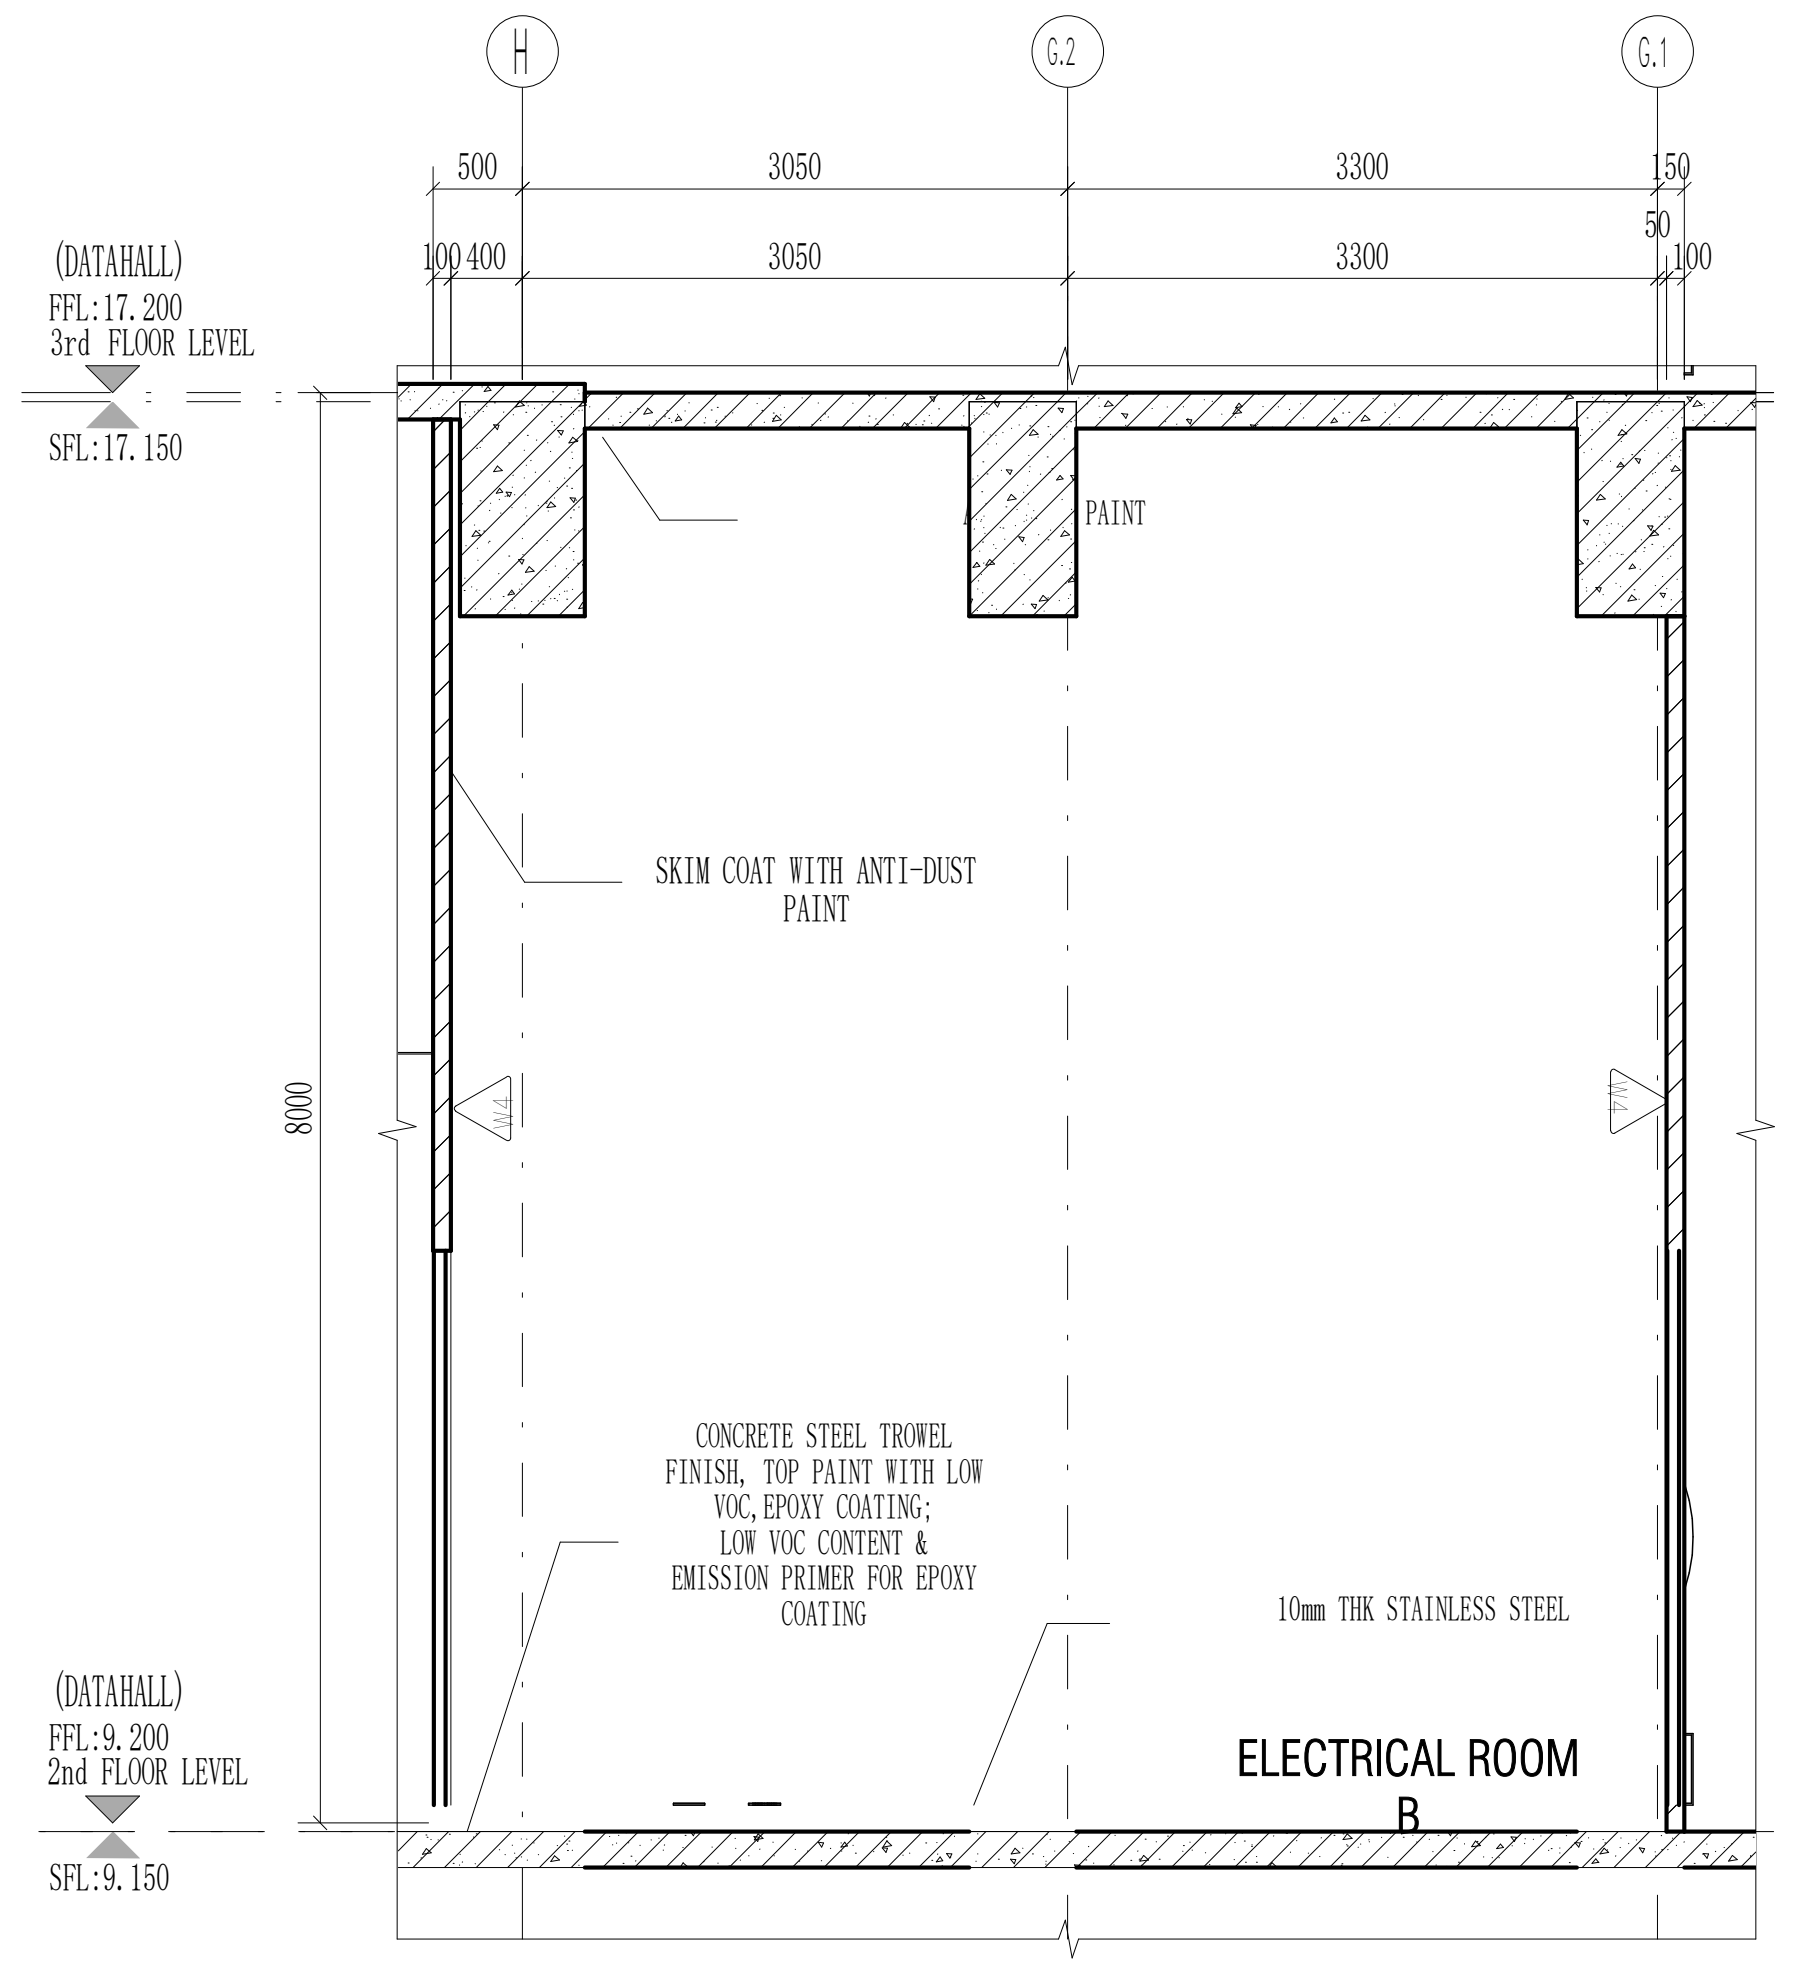

ELECTRICAL ROOM B SECTION B-B

Scale 1:50

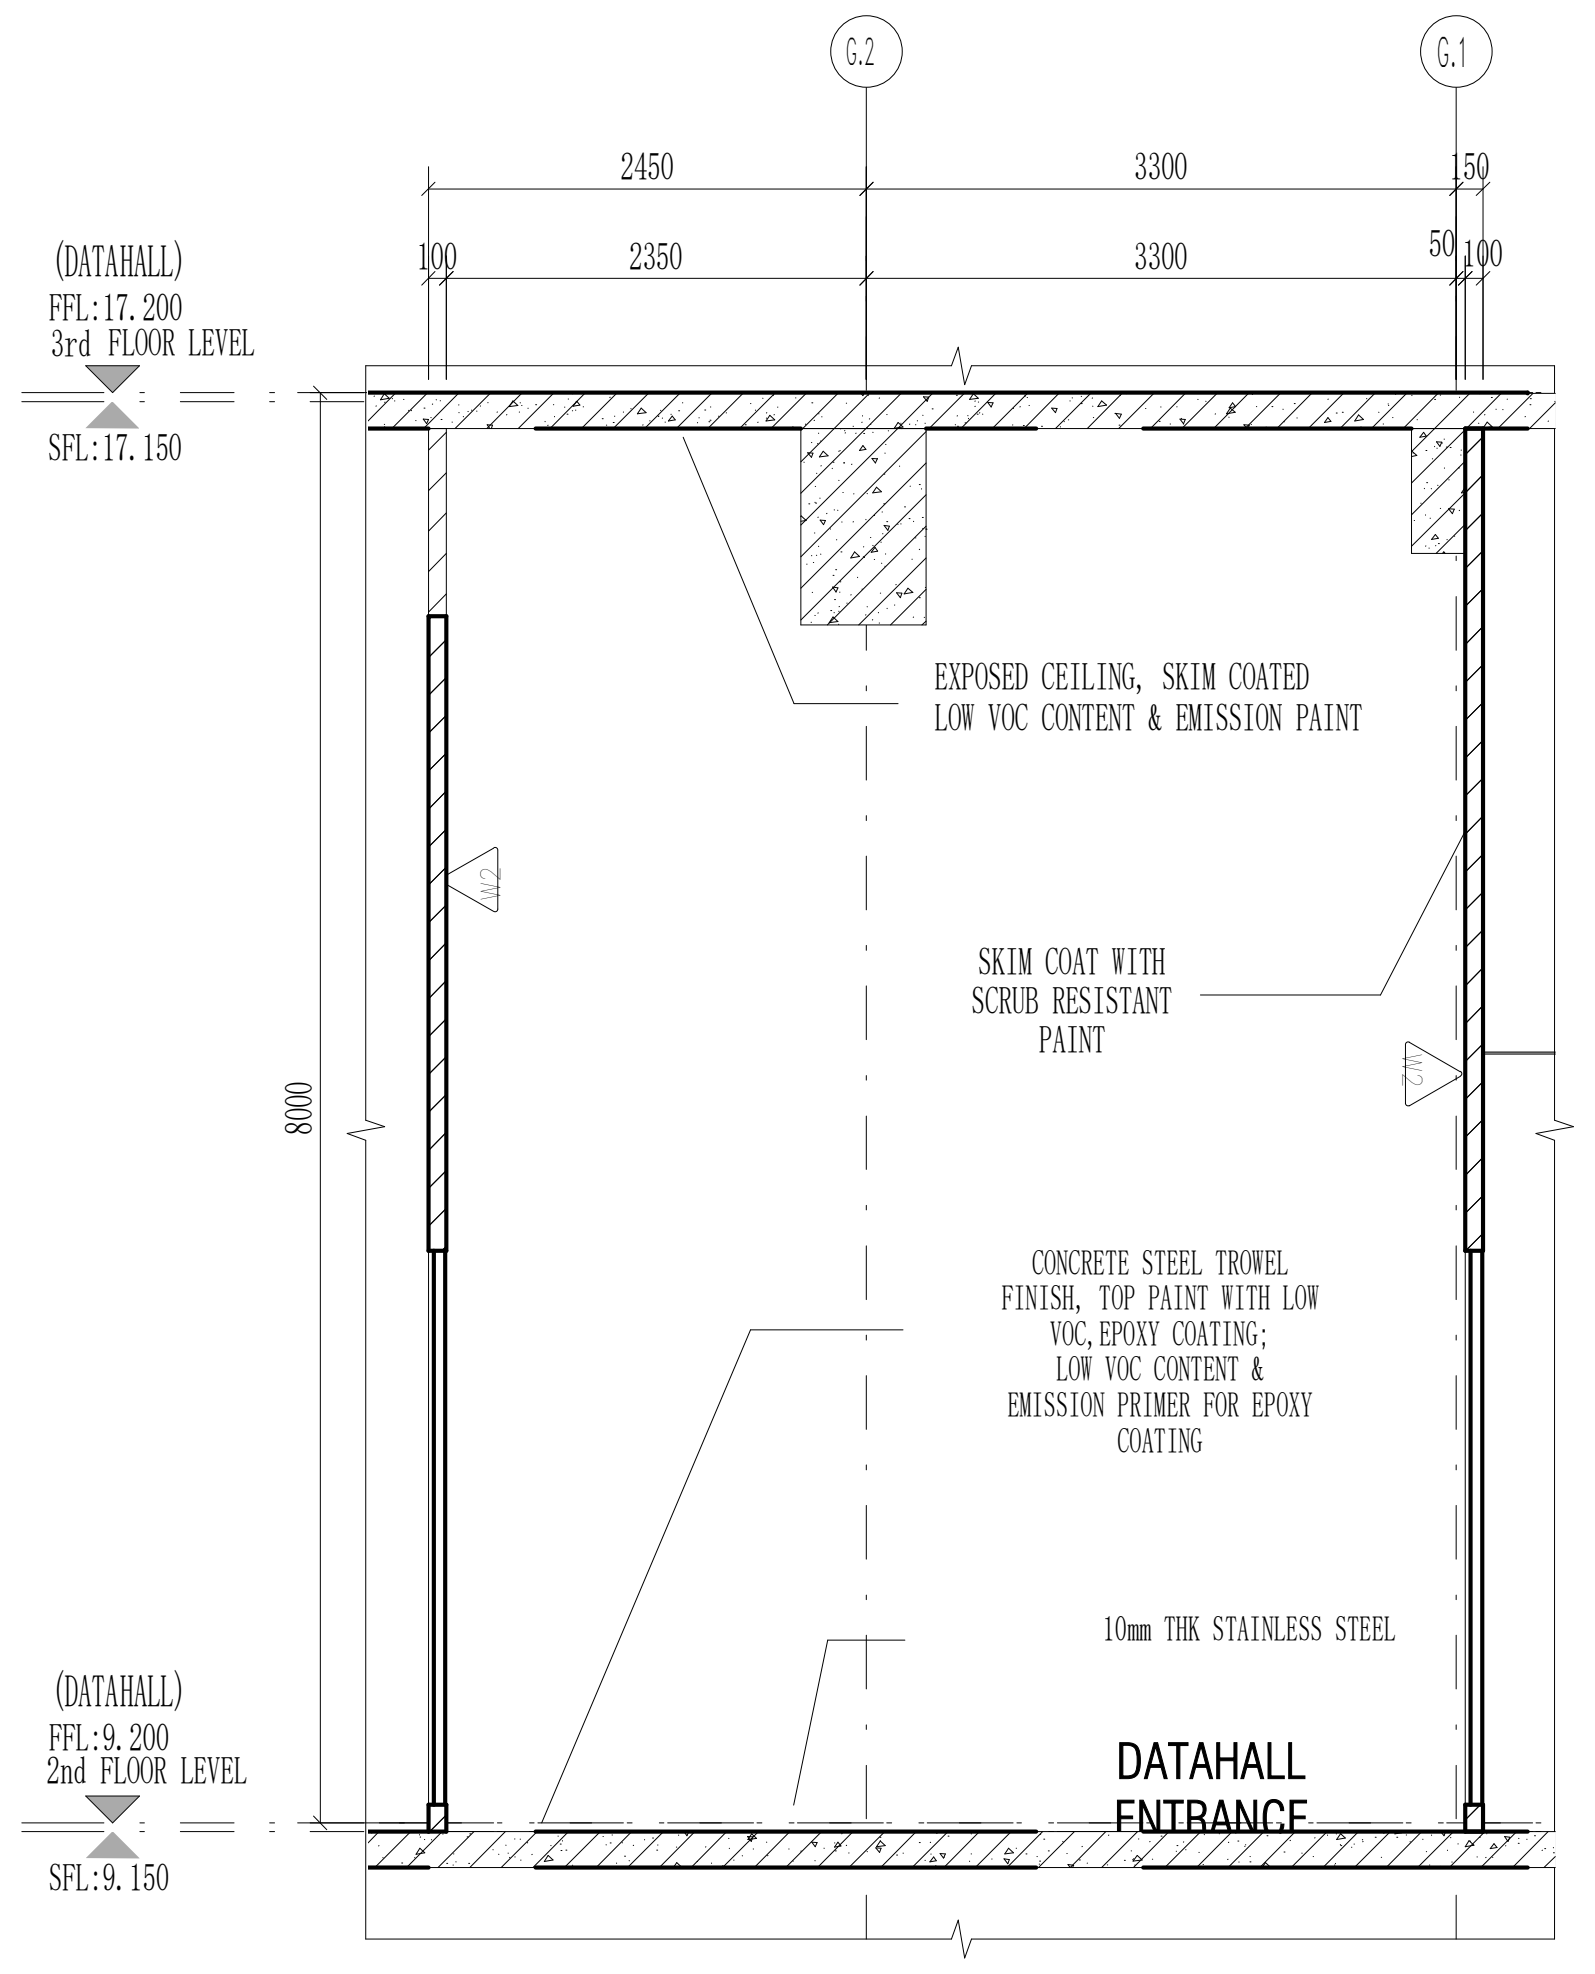
G.2
G.1
2450
3300
150
100
2350
3300
50
100
(DATAHALL)
FFL:17.200
3rd FLOOR LEVEL
SFL:17.150
EXPOSED CEILING, SKIM COATED LOW VOC CONTENT & EMISSION PAINT
SKIM COAT WITH SCRUB RESISTANT PAINT
8000
W2
W2
CONCRETE STEEL TROWEL FINISH, TOP PAINT WITH LOW VOC,EPOXY COATING; LOW VOC CONTENT & EMISSION PRIMER FOR EPOXY COATING
10mm THK STAINLESS STEEL
DATAHALL ENTRANCE
(DATAHALL)
FFL:9.200
2nd FLOOR LEVEL
SFL:9.150

DATAHALLENTRANCE SECTION C-C

Scale 1:50

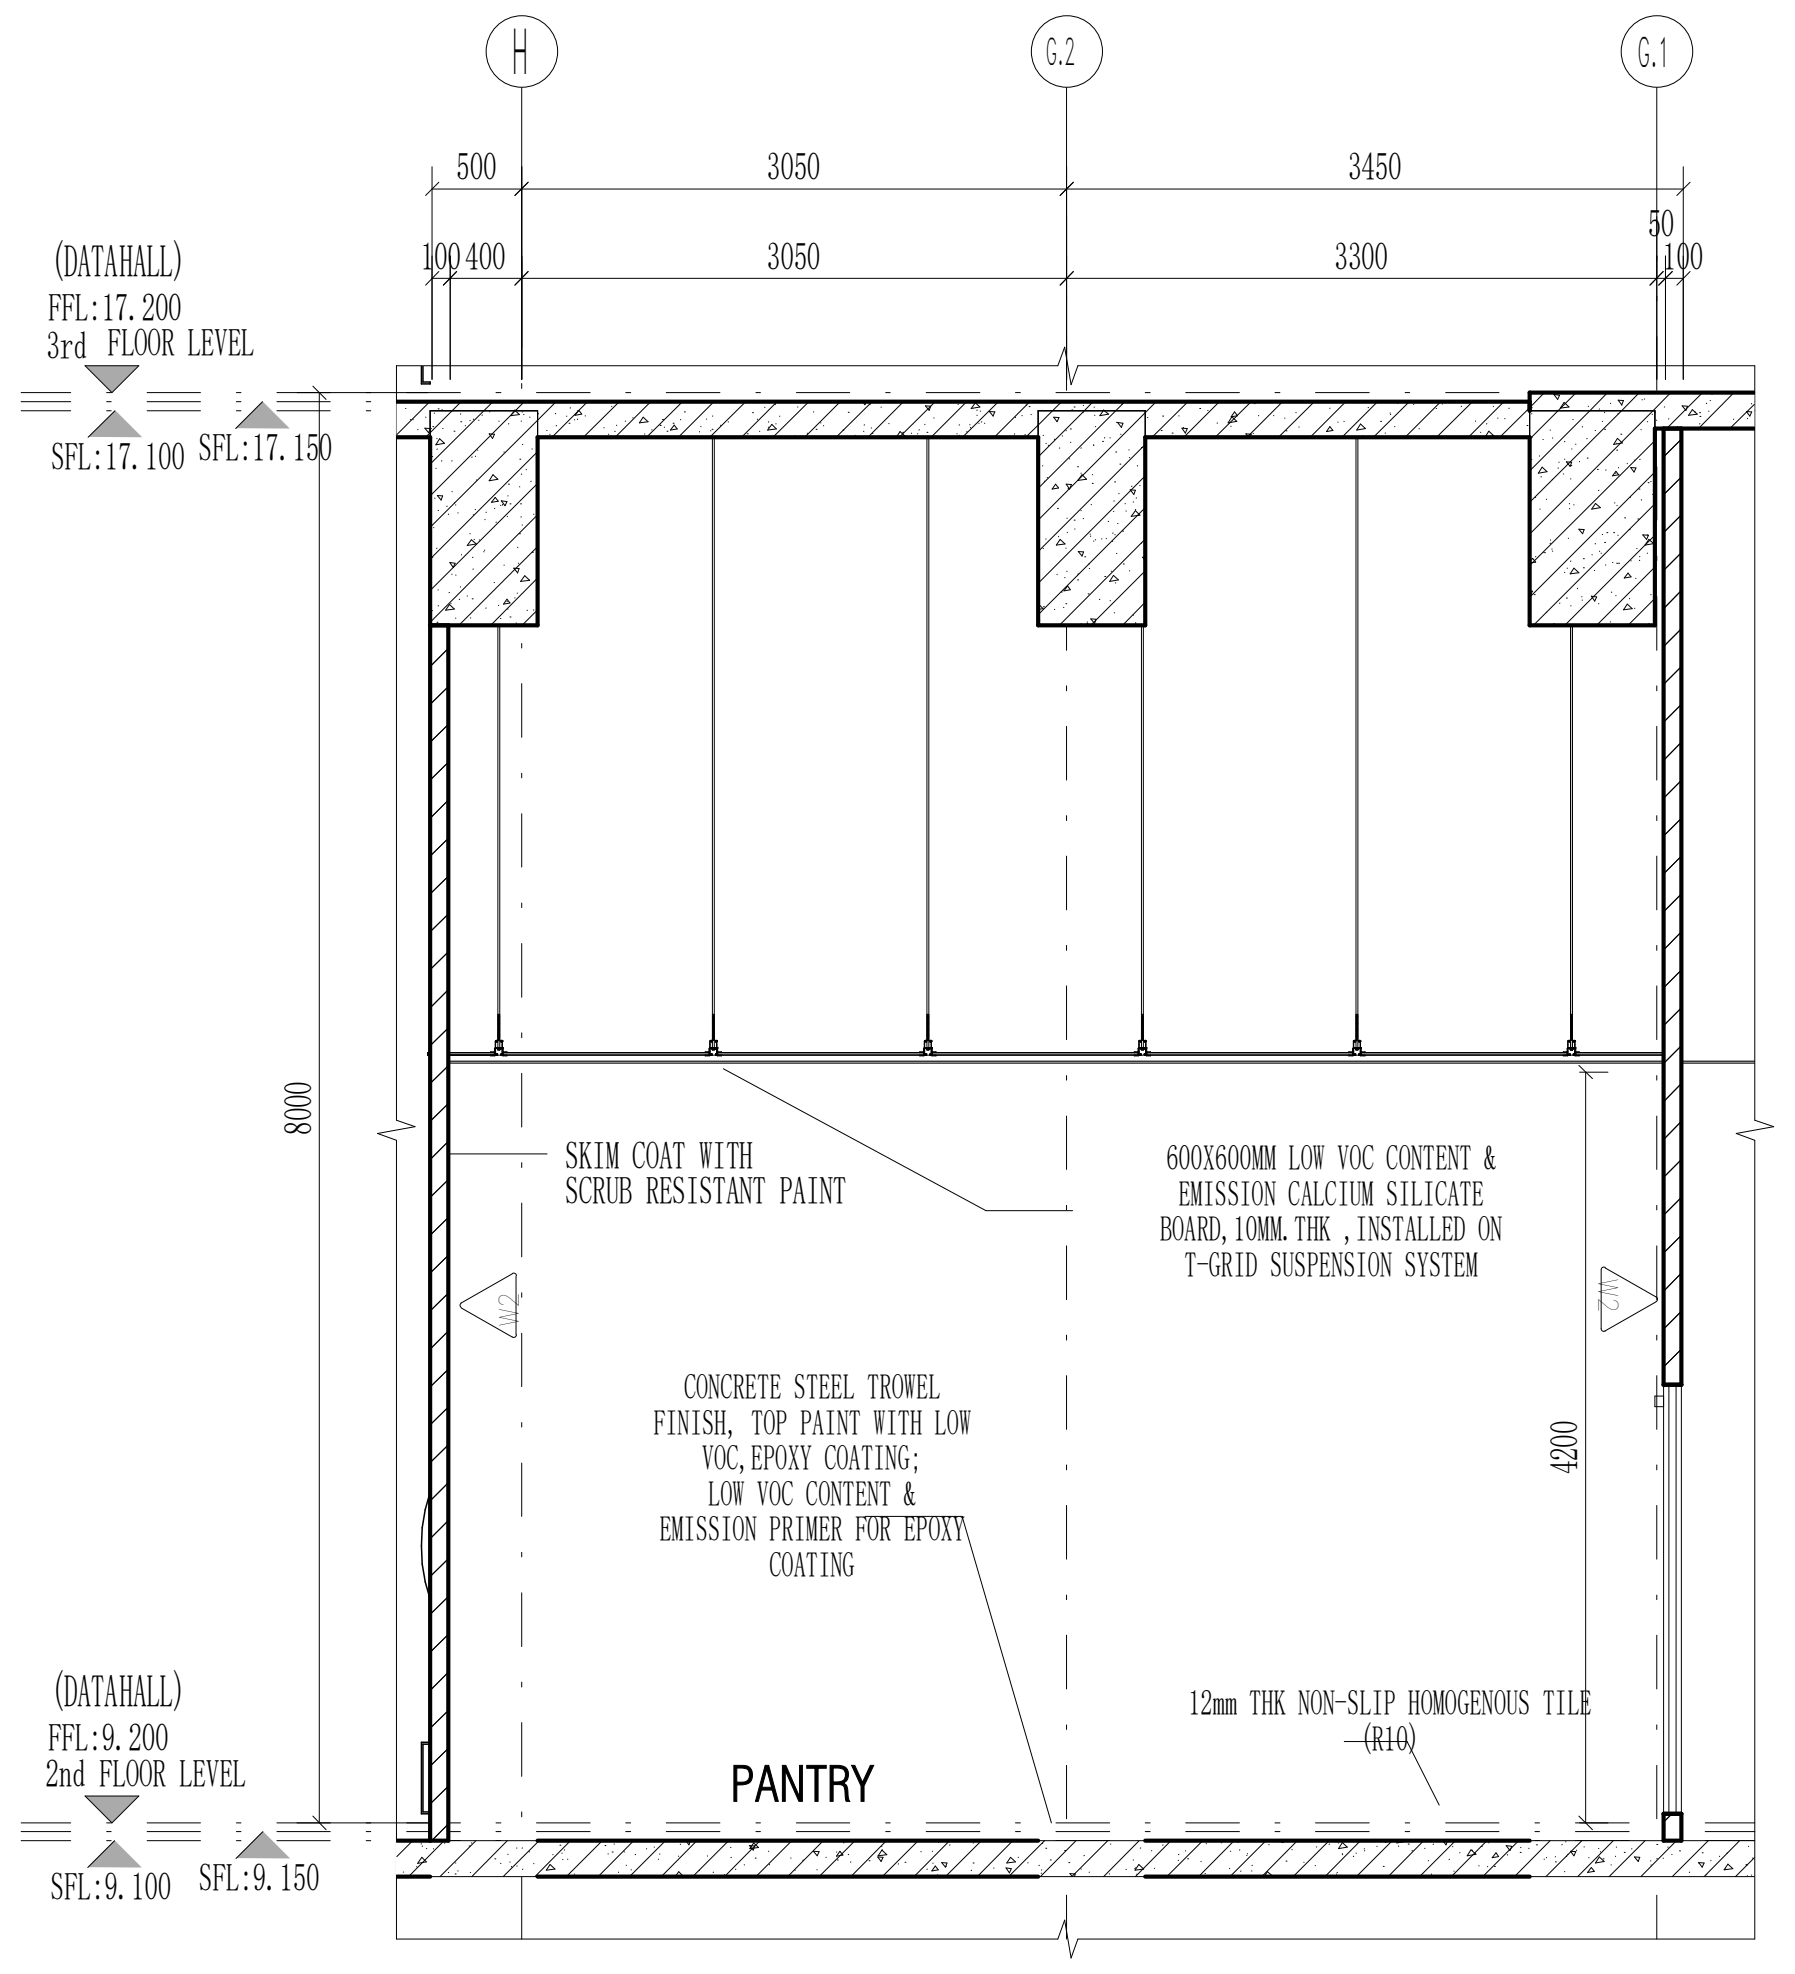
H
G.2
G.1
500
3050
3450
50
100 400
3050
3300
100
(DATAHALL)
FFL:17.200
3rd FLOOR LEVEL
SFL:17.100
SFL:17.150
8000
SKIM COAT WITH SCRUB RESISTANT PAINT
600X600MM LOW VOC CONTENT & EMISSION CALCIUM SILICATE BOARD,10MM.THK ,INSTALLED ON T-GRID SUSPENSION SYSTEM
W2
W2
CONCRETE STEEL TROWEL FINISH, TOP PAINT WITH LOW VOC,EPOXY COATING; LOW VOC CONTENT & EMISSION PRIMER FOR EPOXY COATING
4200
12mm THK NON-SLIP HOMOGENOUS TILE (R10)
PANTRY
(DATAHALL)
FFL:9.200
2nd FLOOR LEVEL
SFL:9.100
SFL:9.150

PANTRY SECTION D-D

Scale 1:50

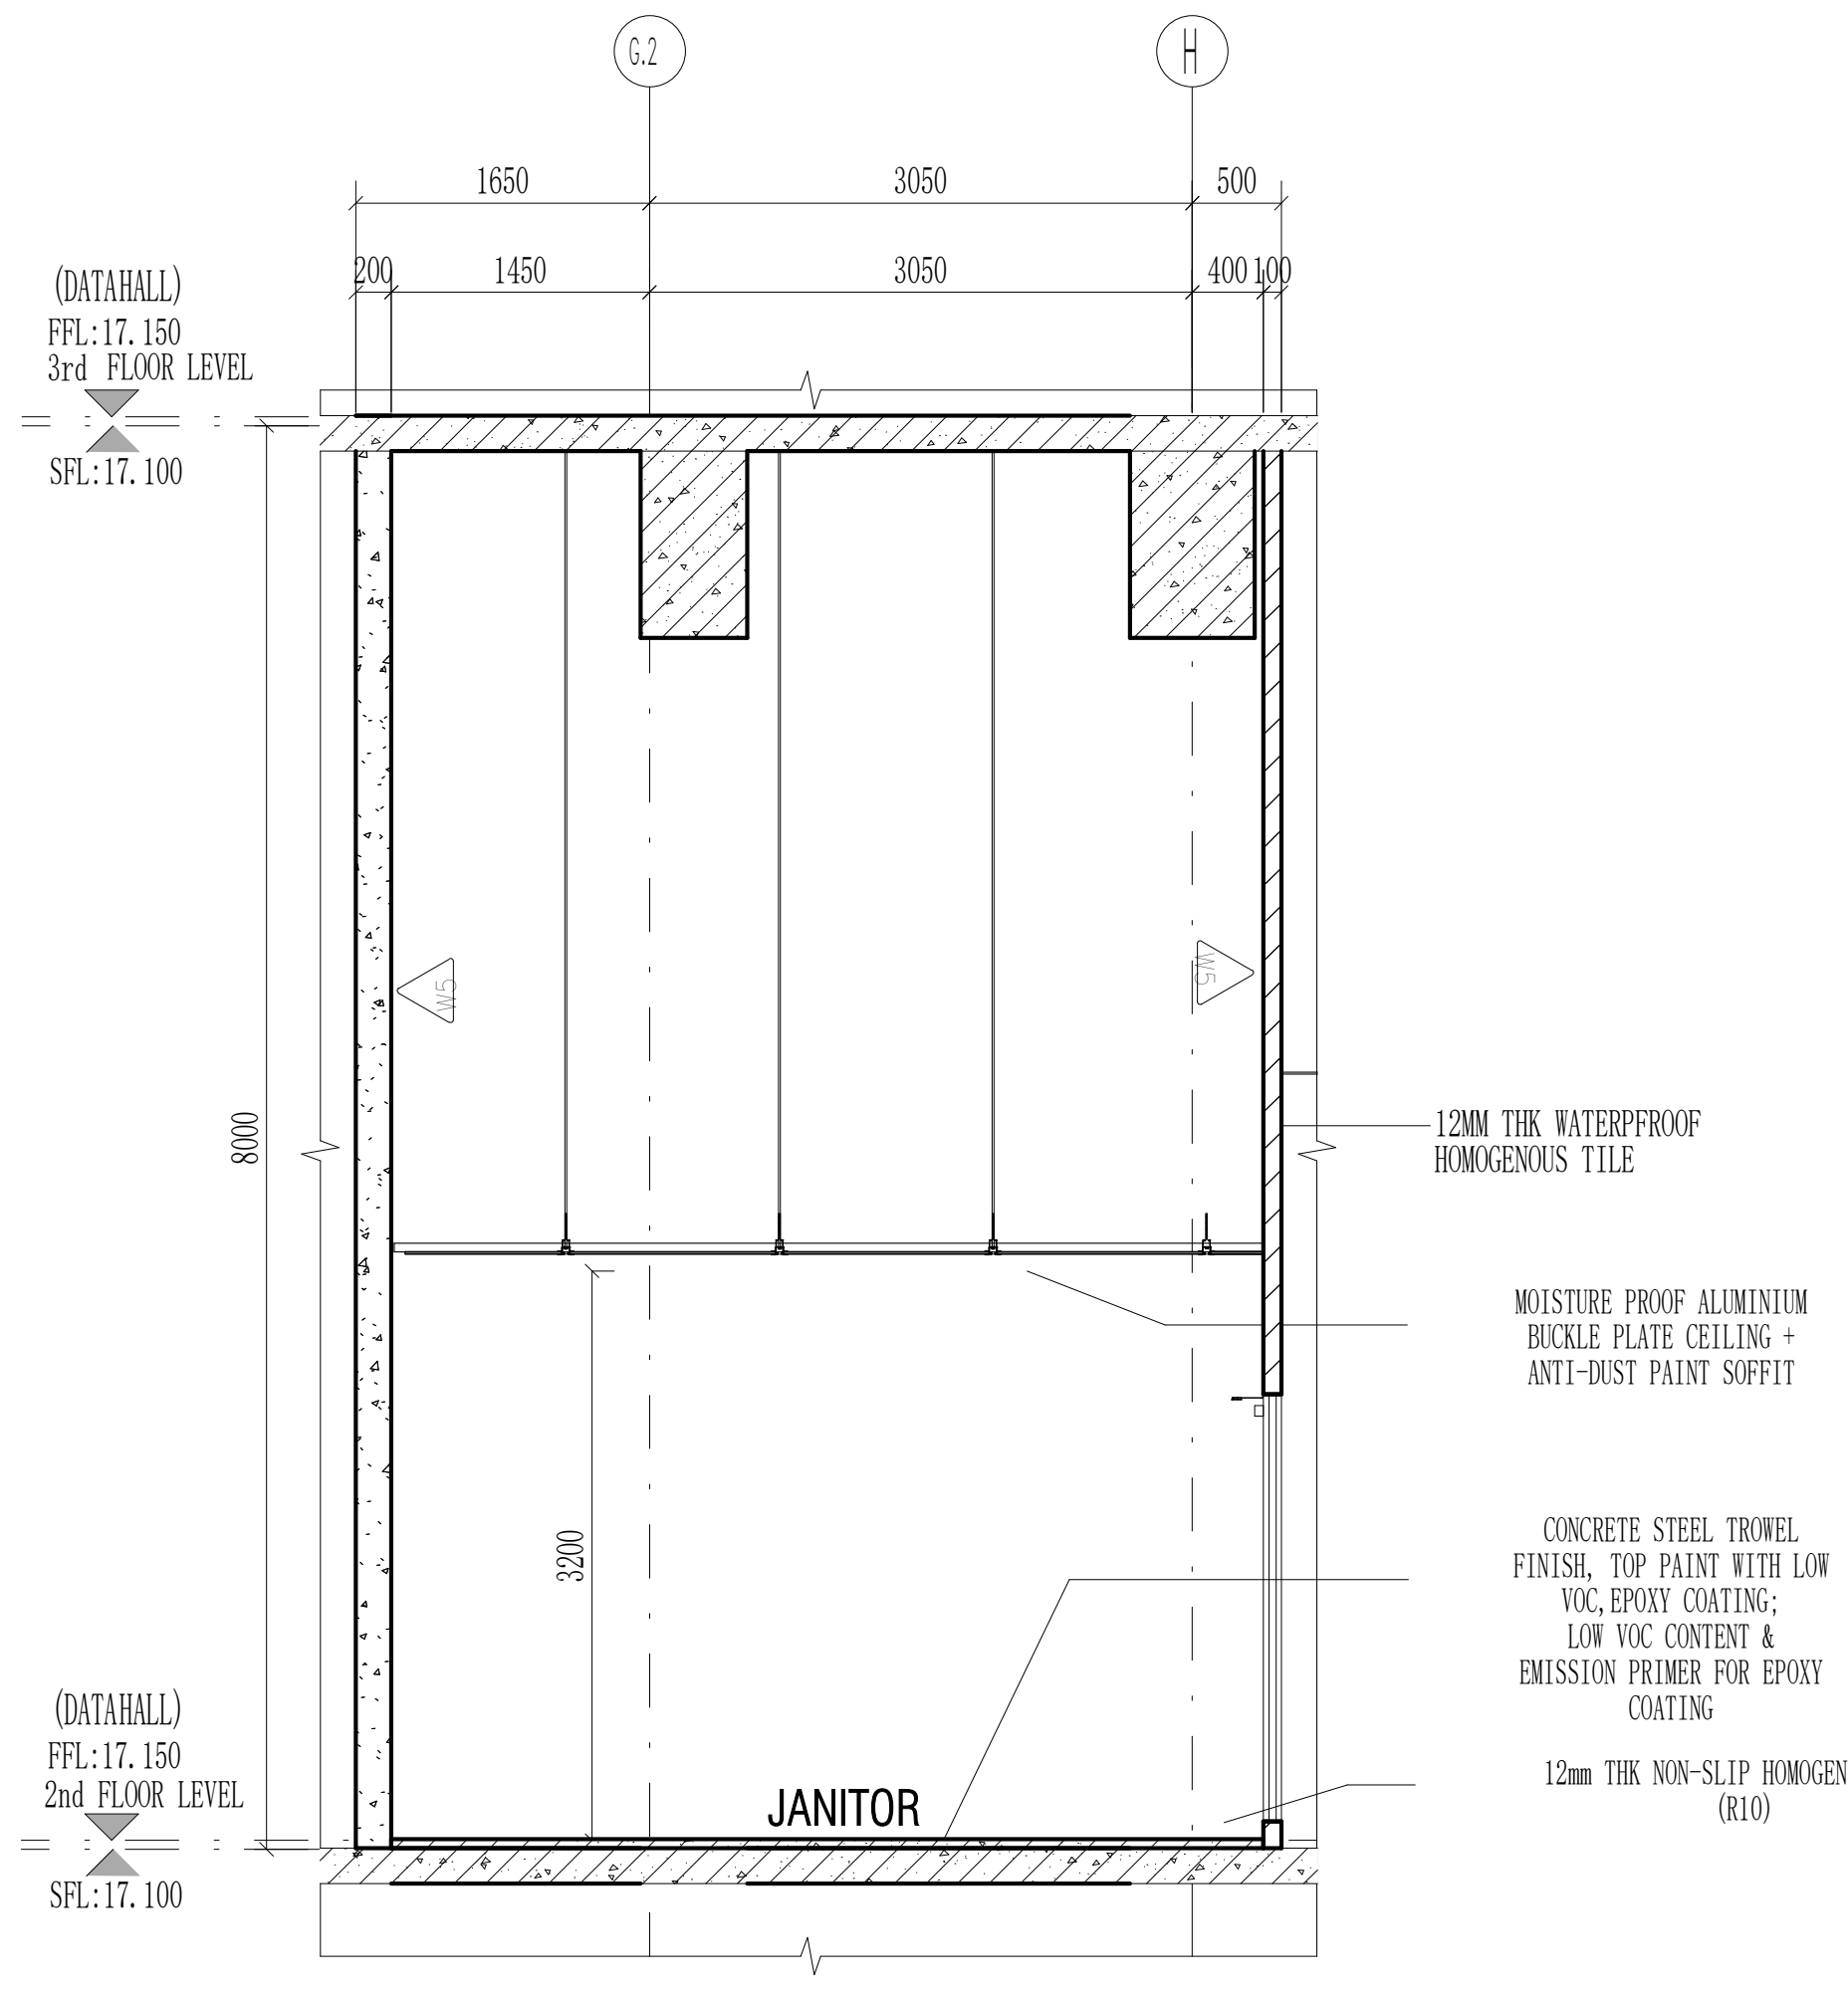
G.2
H
1650
3050
500
200
1450
3050
400 100
(DATAHALL)
FFL:17.150
3rd FLOOR LEVEL
SFL:17.100
8000
W5
W5
12MM THK WATERPFROOF HOMOGENOUS TILE
MOISTURE PROOF ALUMINIUM BUCKLE PLATE CEILING + ANTI-DUST PAINT SOFFIT
3200
CONCRETE STEEL TROWEL FINISH, TOP PAINT WITH LOW VOC,EPOXY COATING; LOW VOC CONTENT & EMISSION PRIMER FOR EPOXY COATING
12mm THK NON-SLIP HOMOGENOUS TILE (R10)
JANITOR
(DATAHALL)
FFL:17.150
2nd FLOOR LEVEL
SFL:17.100

JANITOR SECTION E-E

Scale 1:50

CLIENT :

GULF EDGE DC 01

87 Wireless Road, M Thai Tower 11th. Floor, All Seasons Place, Lumpini,
Pathumwan, Bangkok 10330, Thailand

CONTRACTOR :

华西发展(泰国)有限公司
บริษัท หัวซือ ดีเวลลอปเม้นต์ (ประเทศไทย) จำกัด
HUASHI DEVELOPMENT CO.,LTD
No. 202, Room No. 1403, 14/F, Le Concorde Building,
Ratchadapisek Road, Huaykhwang Sub-District,
Huaykhwang District, Bangkok Metropolitan 10310.

CONSULTANT :

ARbay
บริษัท เอ อาร์ เบย์ จำกัด
ARbay Company Limited
31 st Floor Bangkok Insurance Building
25 South Sathorn road Thungmahamek
Sathorn Bangkok 10120 THAILAND
T +66 (0) 2286 8199
F +66 (0) 2286 2863
info@arbay.co.th

CONSULTANT :

Qbic Engineers & Architects Co.,Ltd.
8 Soi KALONG 4 SANAMBINNAM ROAD,
THASAI SUB-DISTRICT, MUANG NONTHABURI DISTRICT
, NONTHABURI.
Tel 662-950-4374
Fax 662-580-3231
E-Mail : qbic@qbic.co.th, www.qbic.co.th
QBIC ENGINEERS AND ARCHITECTS CO.,LTD.

CONSULTANT :

MITR
MITR TECHNICAL CONSULTANT CO.,LTD.
1168/8 12th FLOOR, LUMPINI TOWER BUILDING,
RAMA IV RD., THUNGMAHAMEK, SATHORN, BANGKOK 10120, THAILAND
TEL : 0-2679-9079-84
FAX : 0-2679-9085 E-mail: mitr_dd@mitr.com

Architect :	SIGNATURE
ประกิต พนานุรัตน์ วสถ. 580 ที่อยู่ 251/1 ถ.จารุเมือง แขวงรองเมือง เขตปทุมวัน กรุงเทพมหานคร โทรศัพท์ 02-286-8199	
Structural Engineer :	SIGNATURE
วิศวกรผู้ออกแบบโครงสร้าง	
ณัฐสม สงวนวงษ์ วย 1423 ที่อยู่ 2/1 ซ.รามคำแหง 150 ถ.รามคำแหง แขวง สะพานสูง เขต สะพานสูง กทม. 10240	
Structural Inspector :	SIGNATURE
วิศวกรผู้ตรวจสอบโครงสร้าง	
โกมล จุฑาภัทร วย 964 ที่อยู่ 24/18 ซ.นวมินทร์ 129 ถ. นวมินทร์ แขวง นวลจันทร์ เขต บึงกุ่ม กทม. 10230	
Electrical Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบไฟฟ้ากำลัง	
นายสุภัทร บูรณวิทย์ วฟก.1265 ที่อยู่ 21 ซอยทานสัมฤทธิ์ 13 ตำบลท่าทราย อ.เมืองนนทบุรี จ.นนทบุรี 11000	
Mechanical Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบเครื่องกลและปรับอากาศ	
นายประสิทธิ์ เกี้ยวสุนทร วก.1221 ที่อยู่ 44/372 ซอยบางกระดี่ 35/1 แขวงแสมดำ เขตบางขุนเทียน กทม. 10150	ประสิทธิ์
Sanitary Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบสุขาภิบาล และดับเพลิง	
นายทศวรรษ สนั่นฤทธิ์ วส. 215 ที่อยู่ บ้านเลขที่ 99/107 หมู่ที่ 3 ต.ศีรษะจรเข้น้อย อ.บางเสาธง จ.สมุทรปราการ 10540	ทศวรรษ

ISSUE/REVISION

REV.	DESCRIPTION	DATE
A	90% DEVELOPED	09/05/2026

PROJECT NAME :

GEDC 01

LOCATION:
Nikhom Phattana district, Rayong ,industrial estate,CPGC

BUILDING :
MAIN BUILDING

90% DEVELOPED

TITLE :

ROOMDETAIL-JANITOR,PANTRY,DATAHALL ENTRANCE,ELECTRICALROOM B

JOB NO.	SCALE 1 : 50
DRAWN NXR	REF.
CHECKED LJC	DWG. NO.
APPROVED LXD	MPK01A-90-A-RD-212
DATE 2026.05.09	

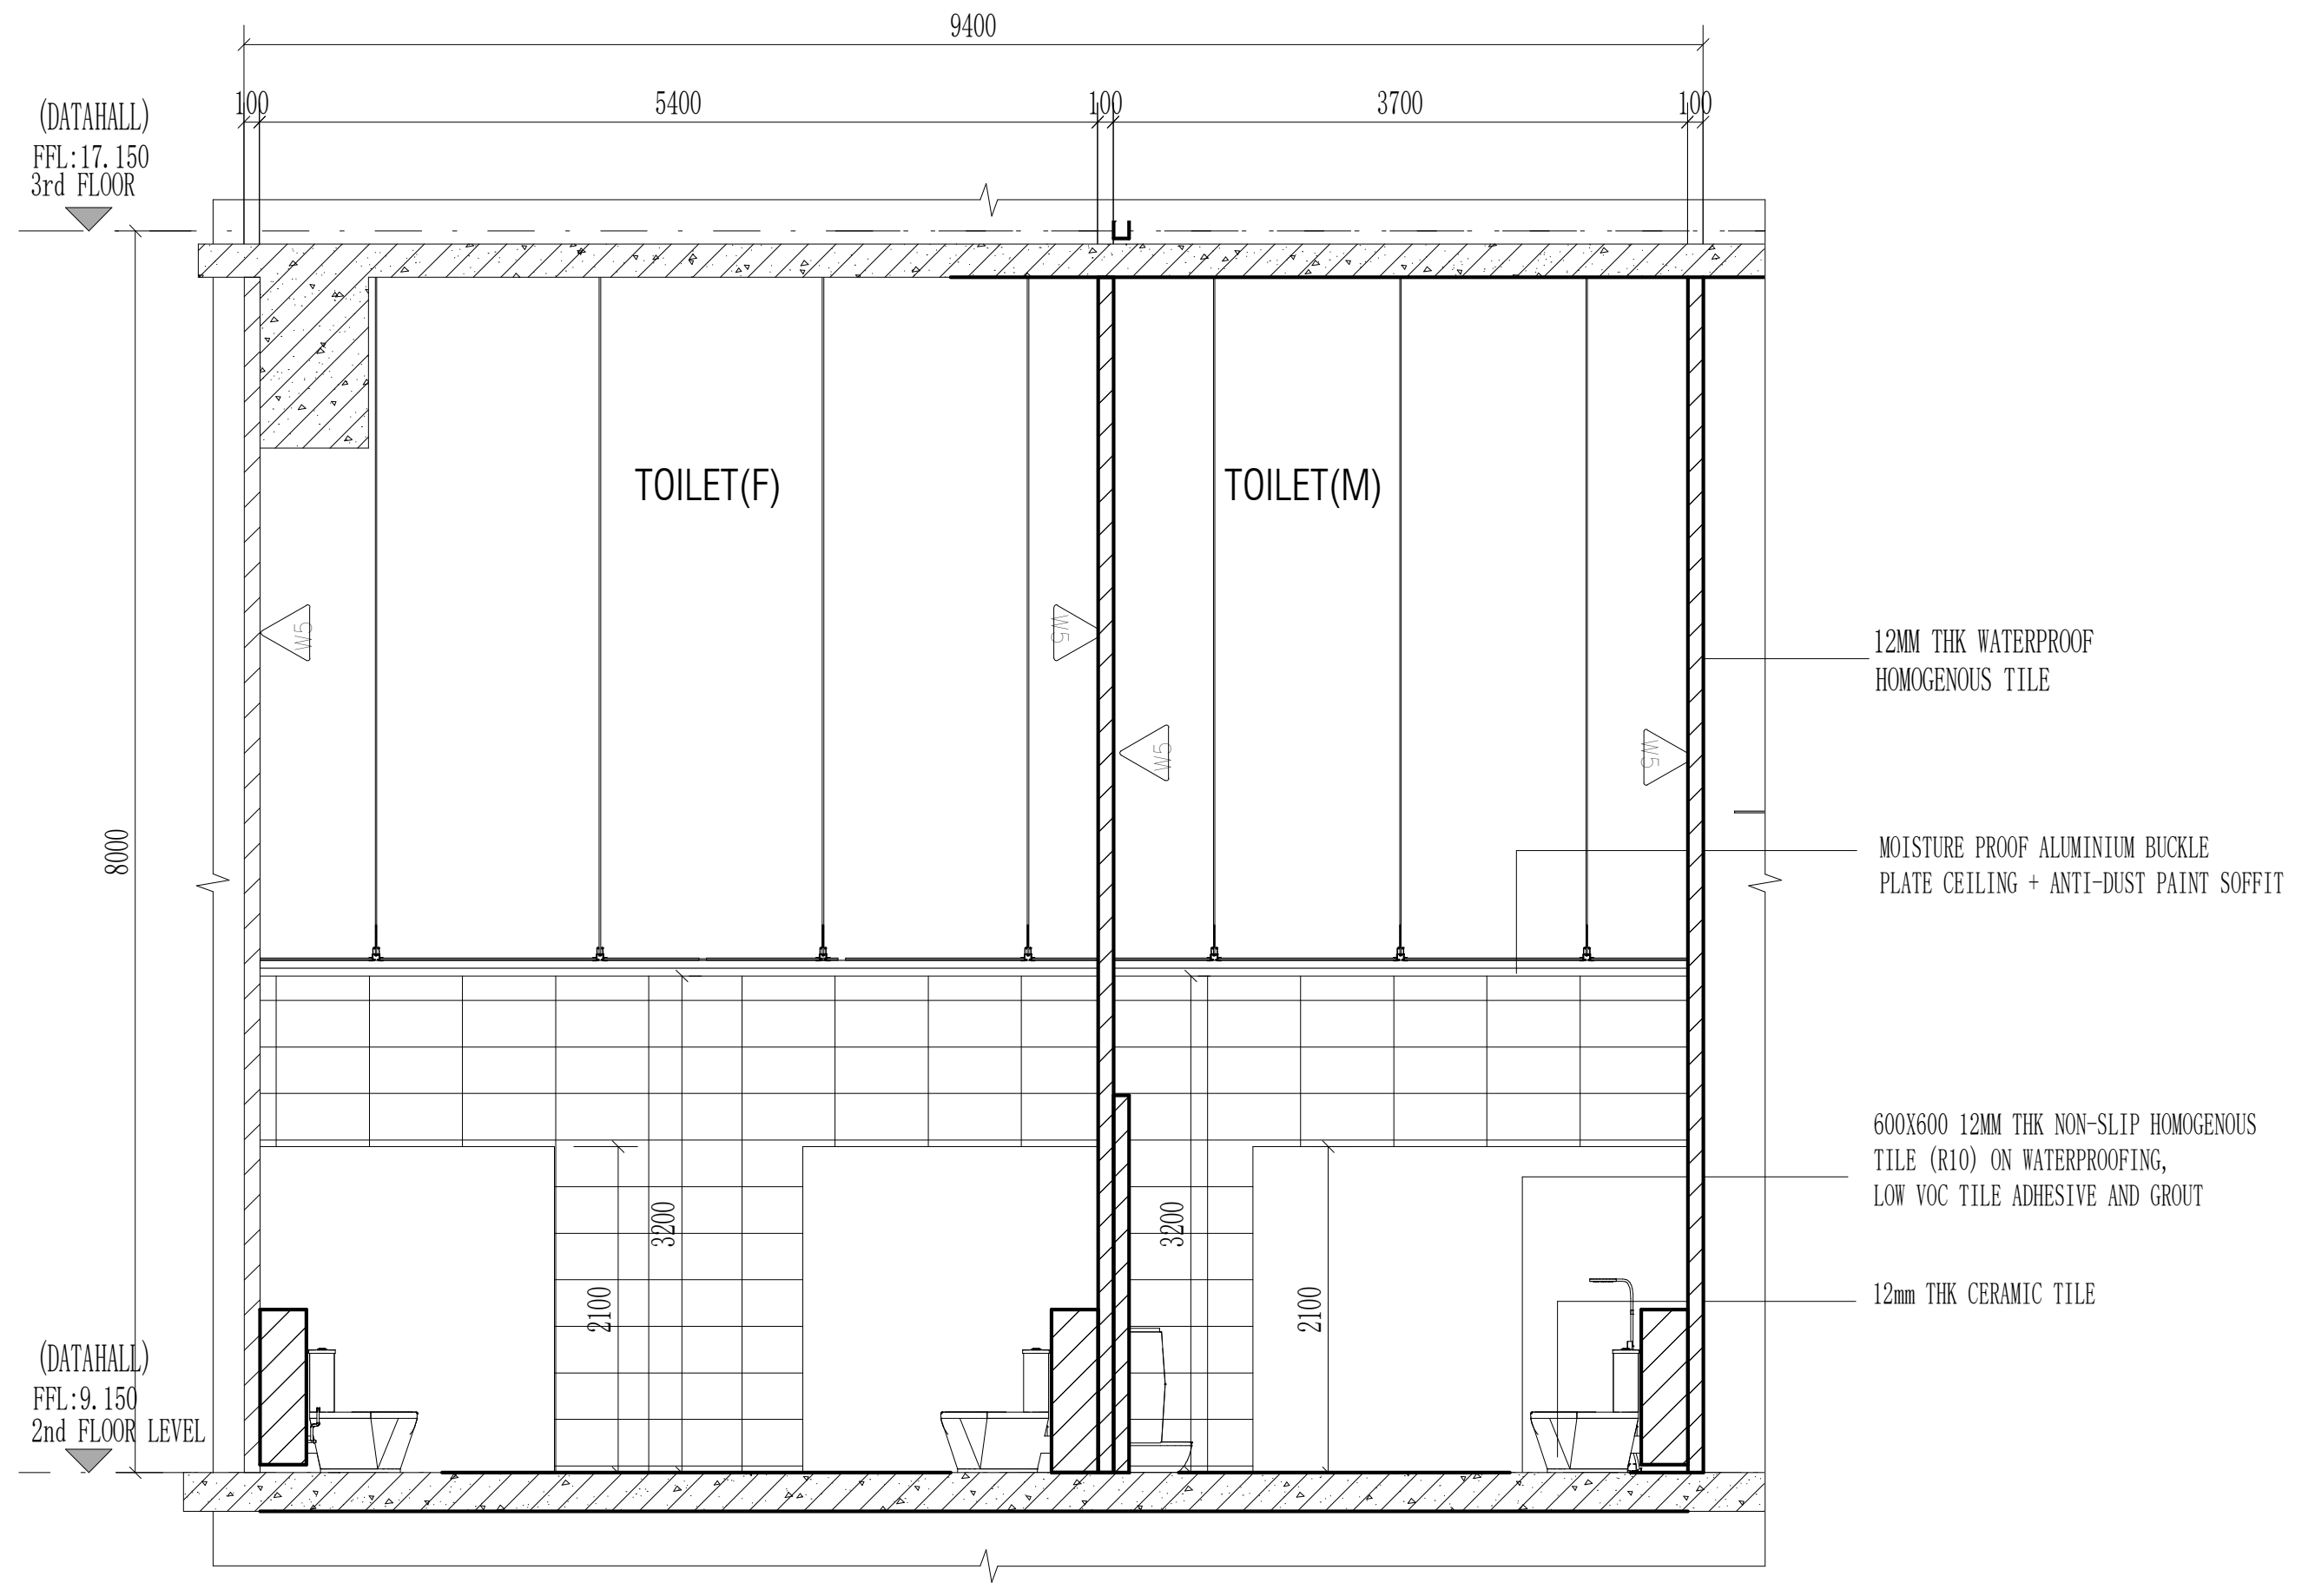

TOILET(F)、 TOILET(M) SECTIONA-A

Scale 1:50

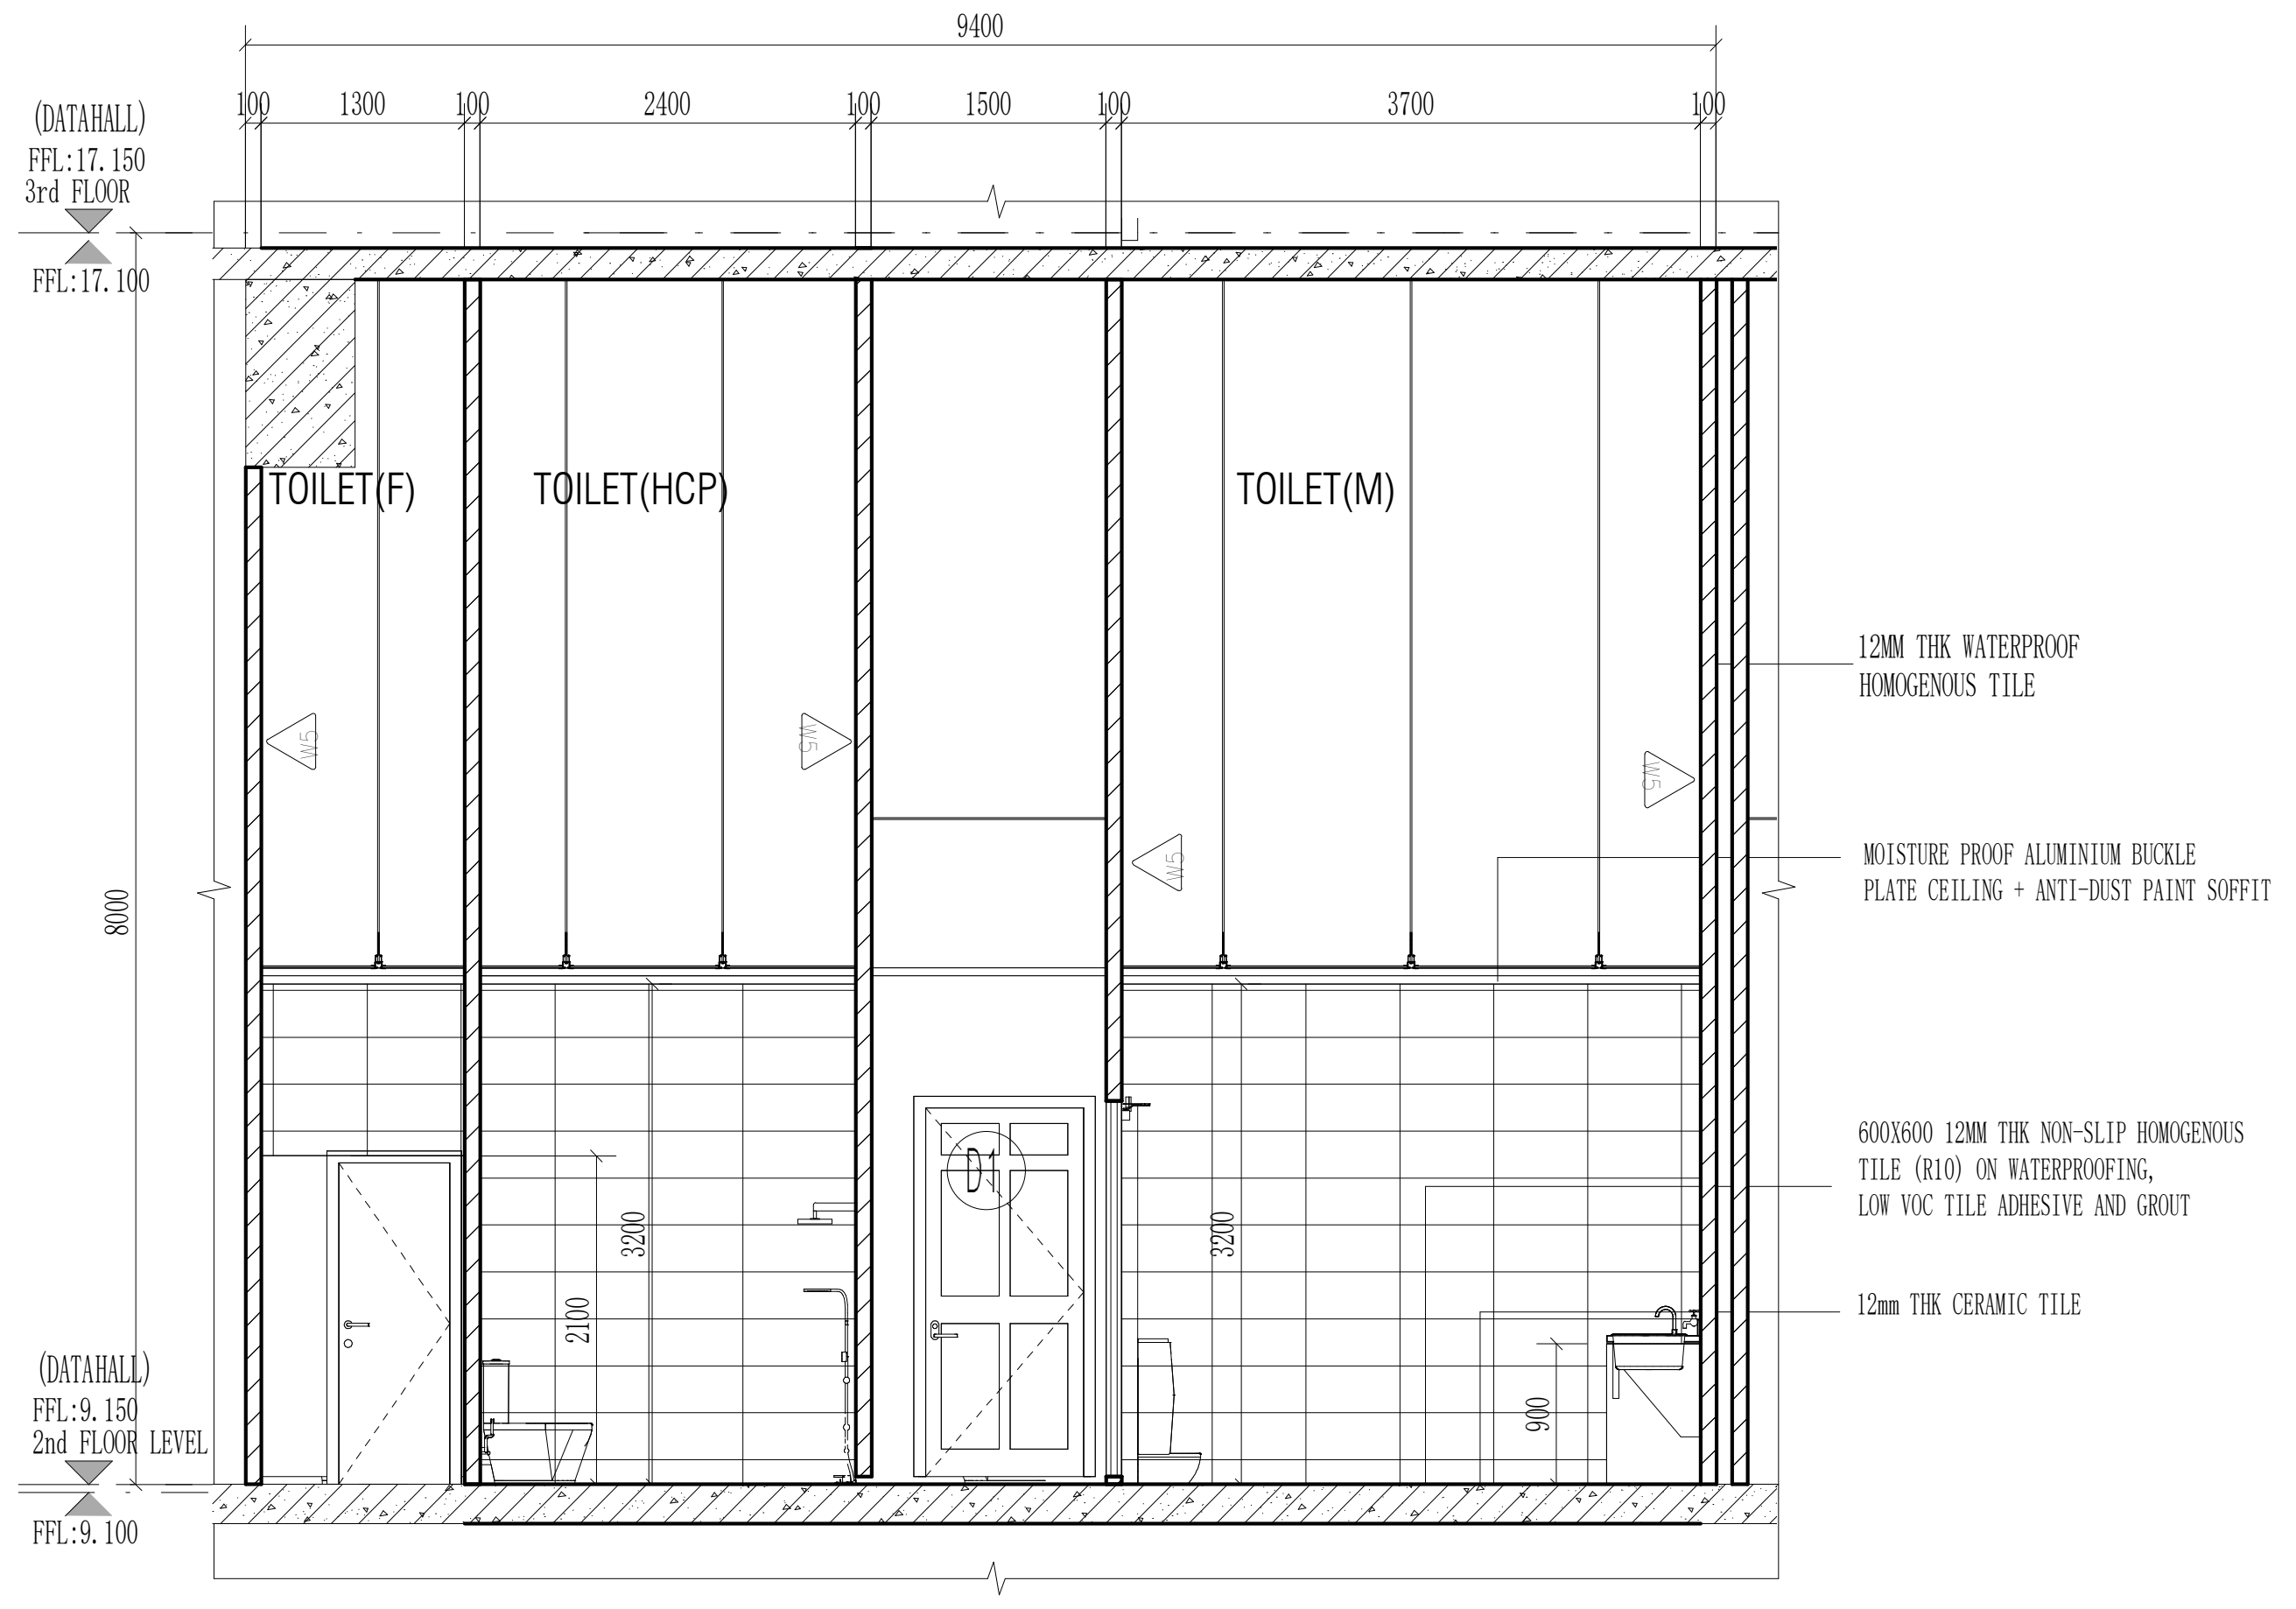

SHOWER(F) TOILET(HCP) TOILET(M) SECTION B-B

Scale 1:50

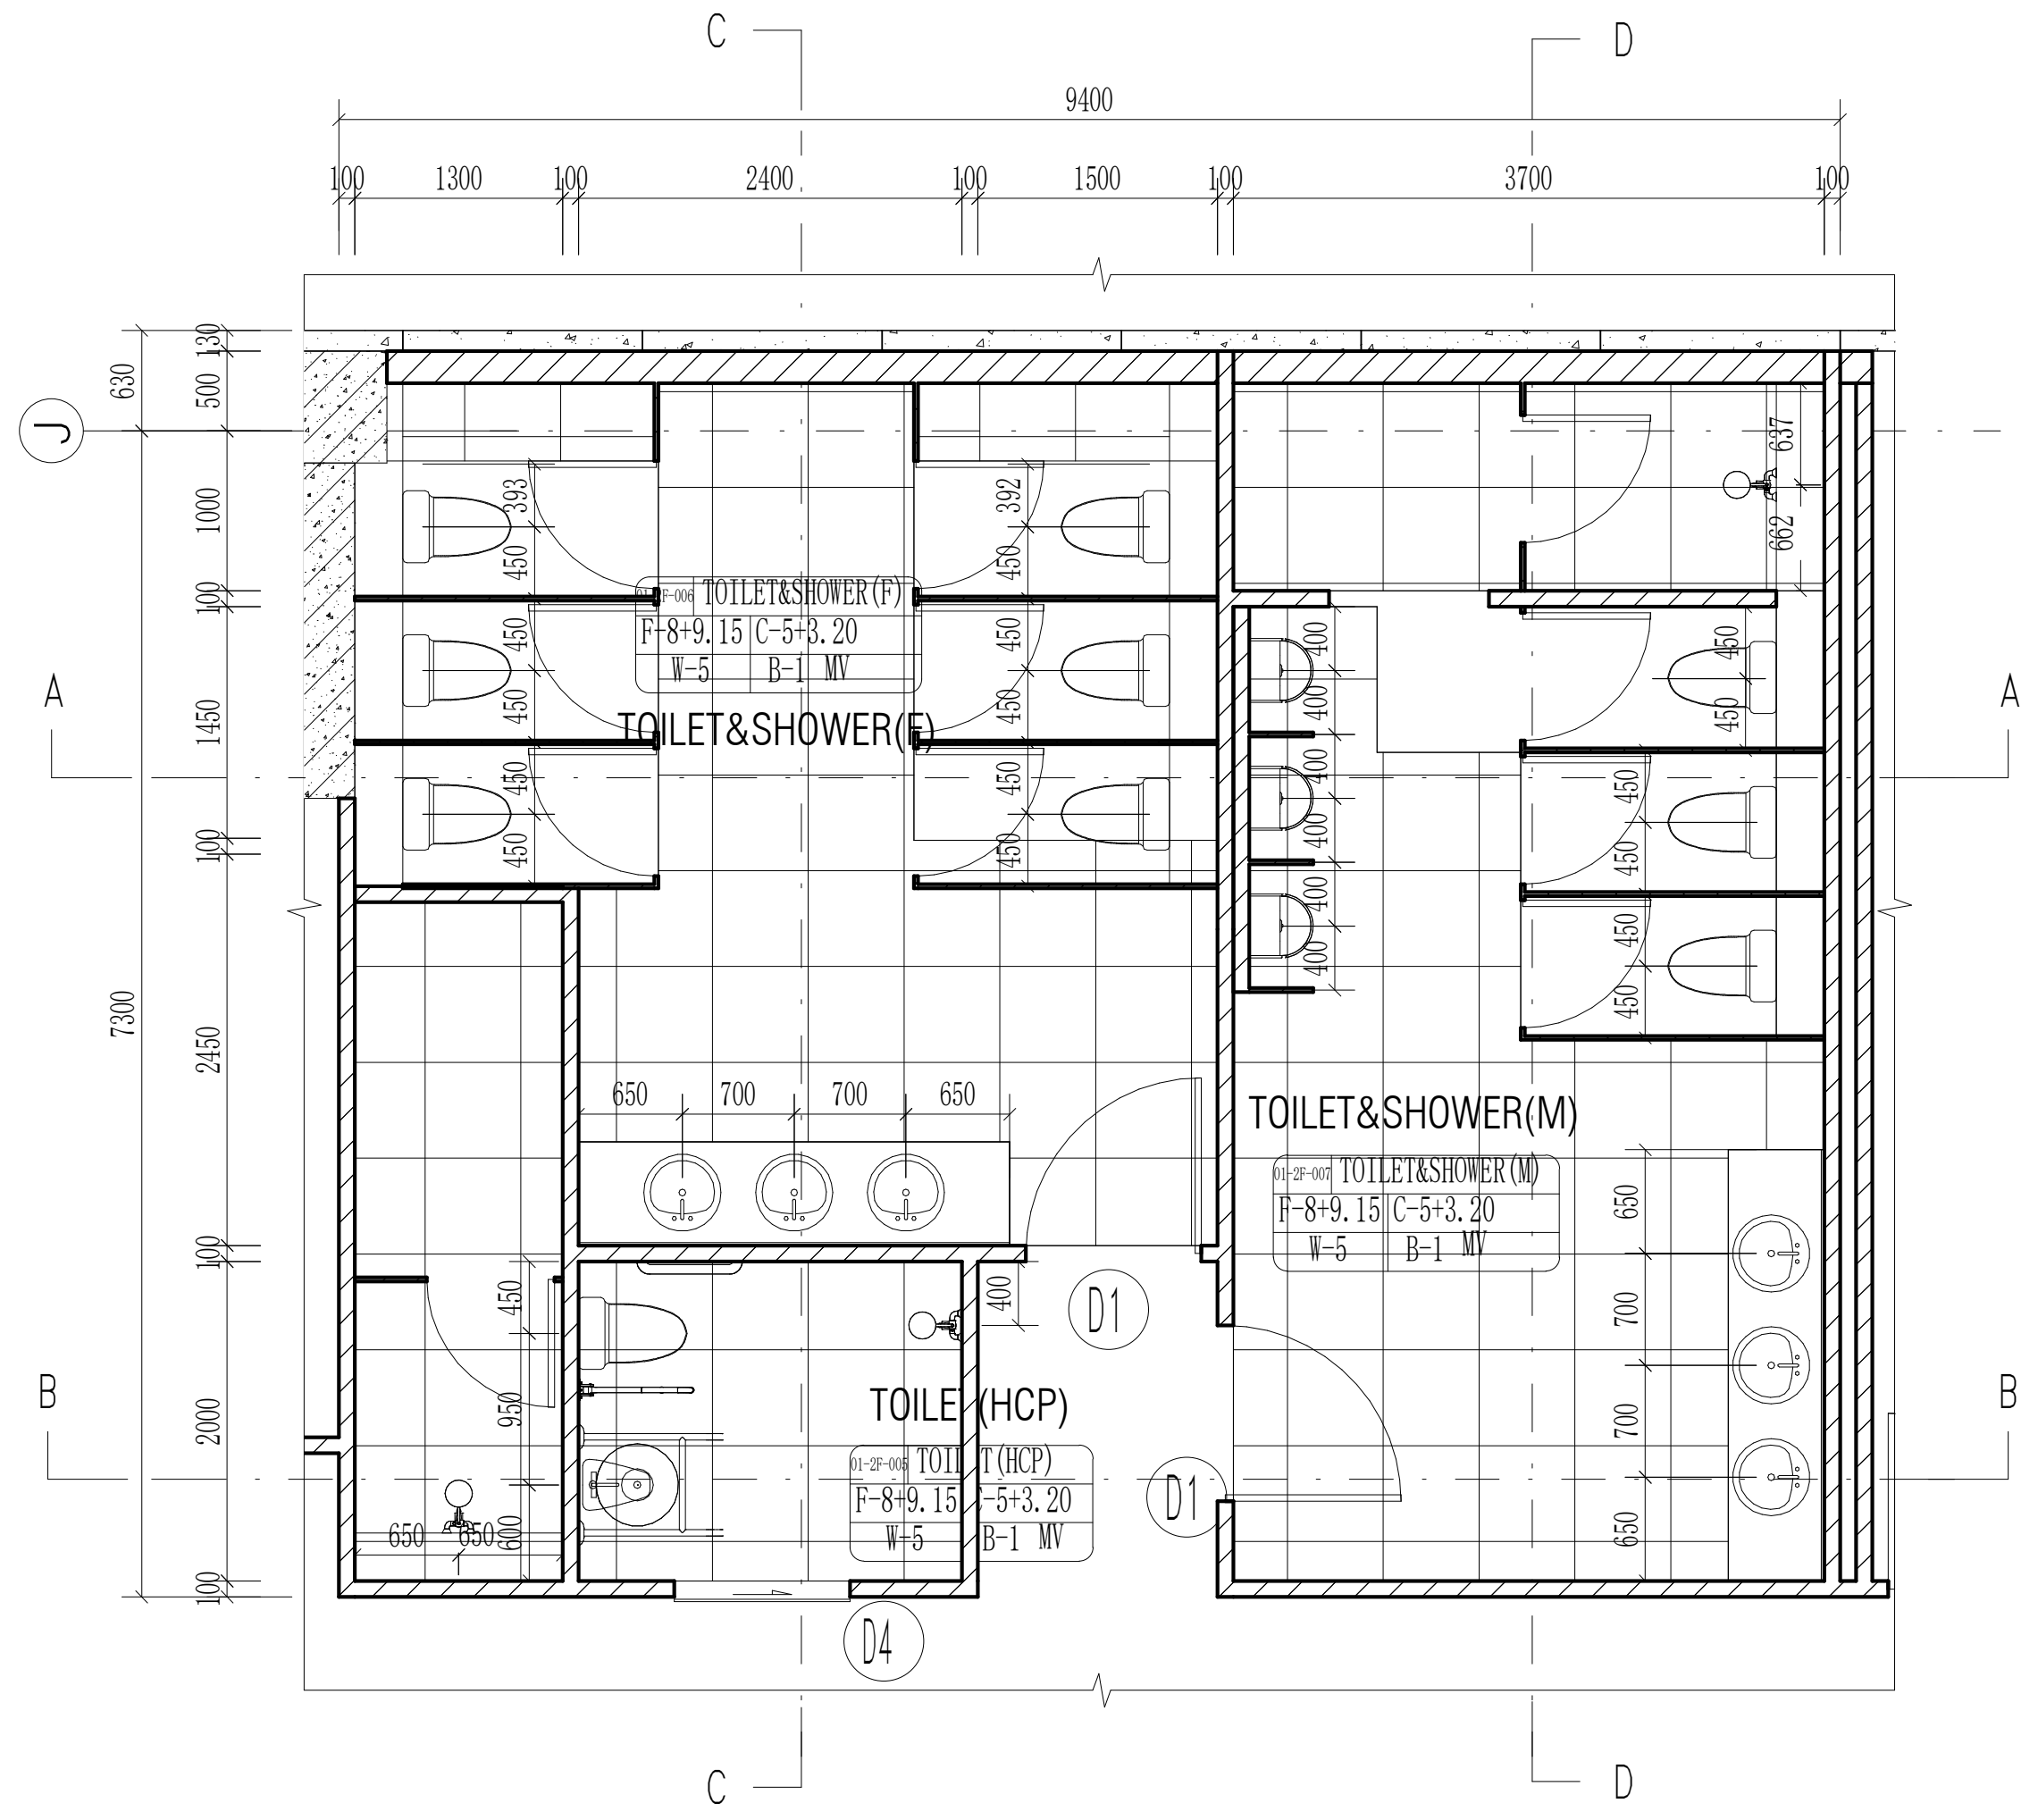

TOILET&SHOWER(F)、 TOILET&SHOWER(M)、 TOILE(HCP) PLAN

Scale 1:50

THE "SFL" MARKED IN THE DRAWING REFERS TO THE STRUCTURAL FLOOR LEVEL, WHILE THE FINISHED FLOOR LEVEL (FFL) IS DETERMINED BASED ON FLOOR FINISHES.

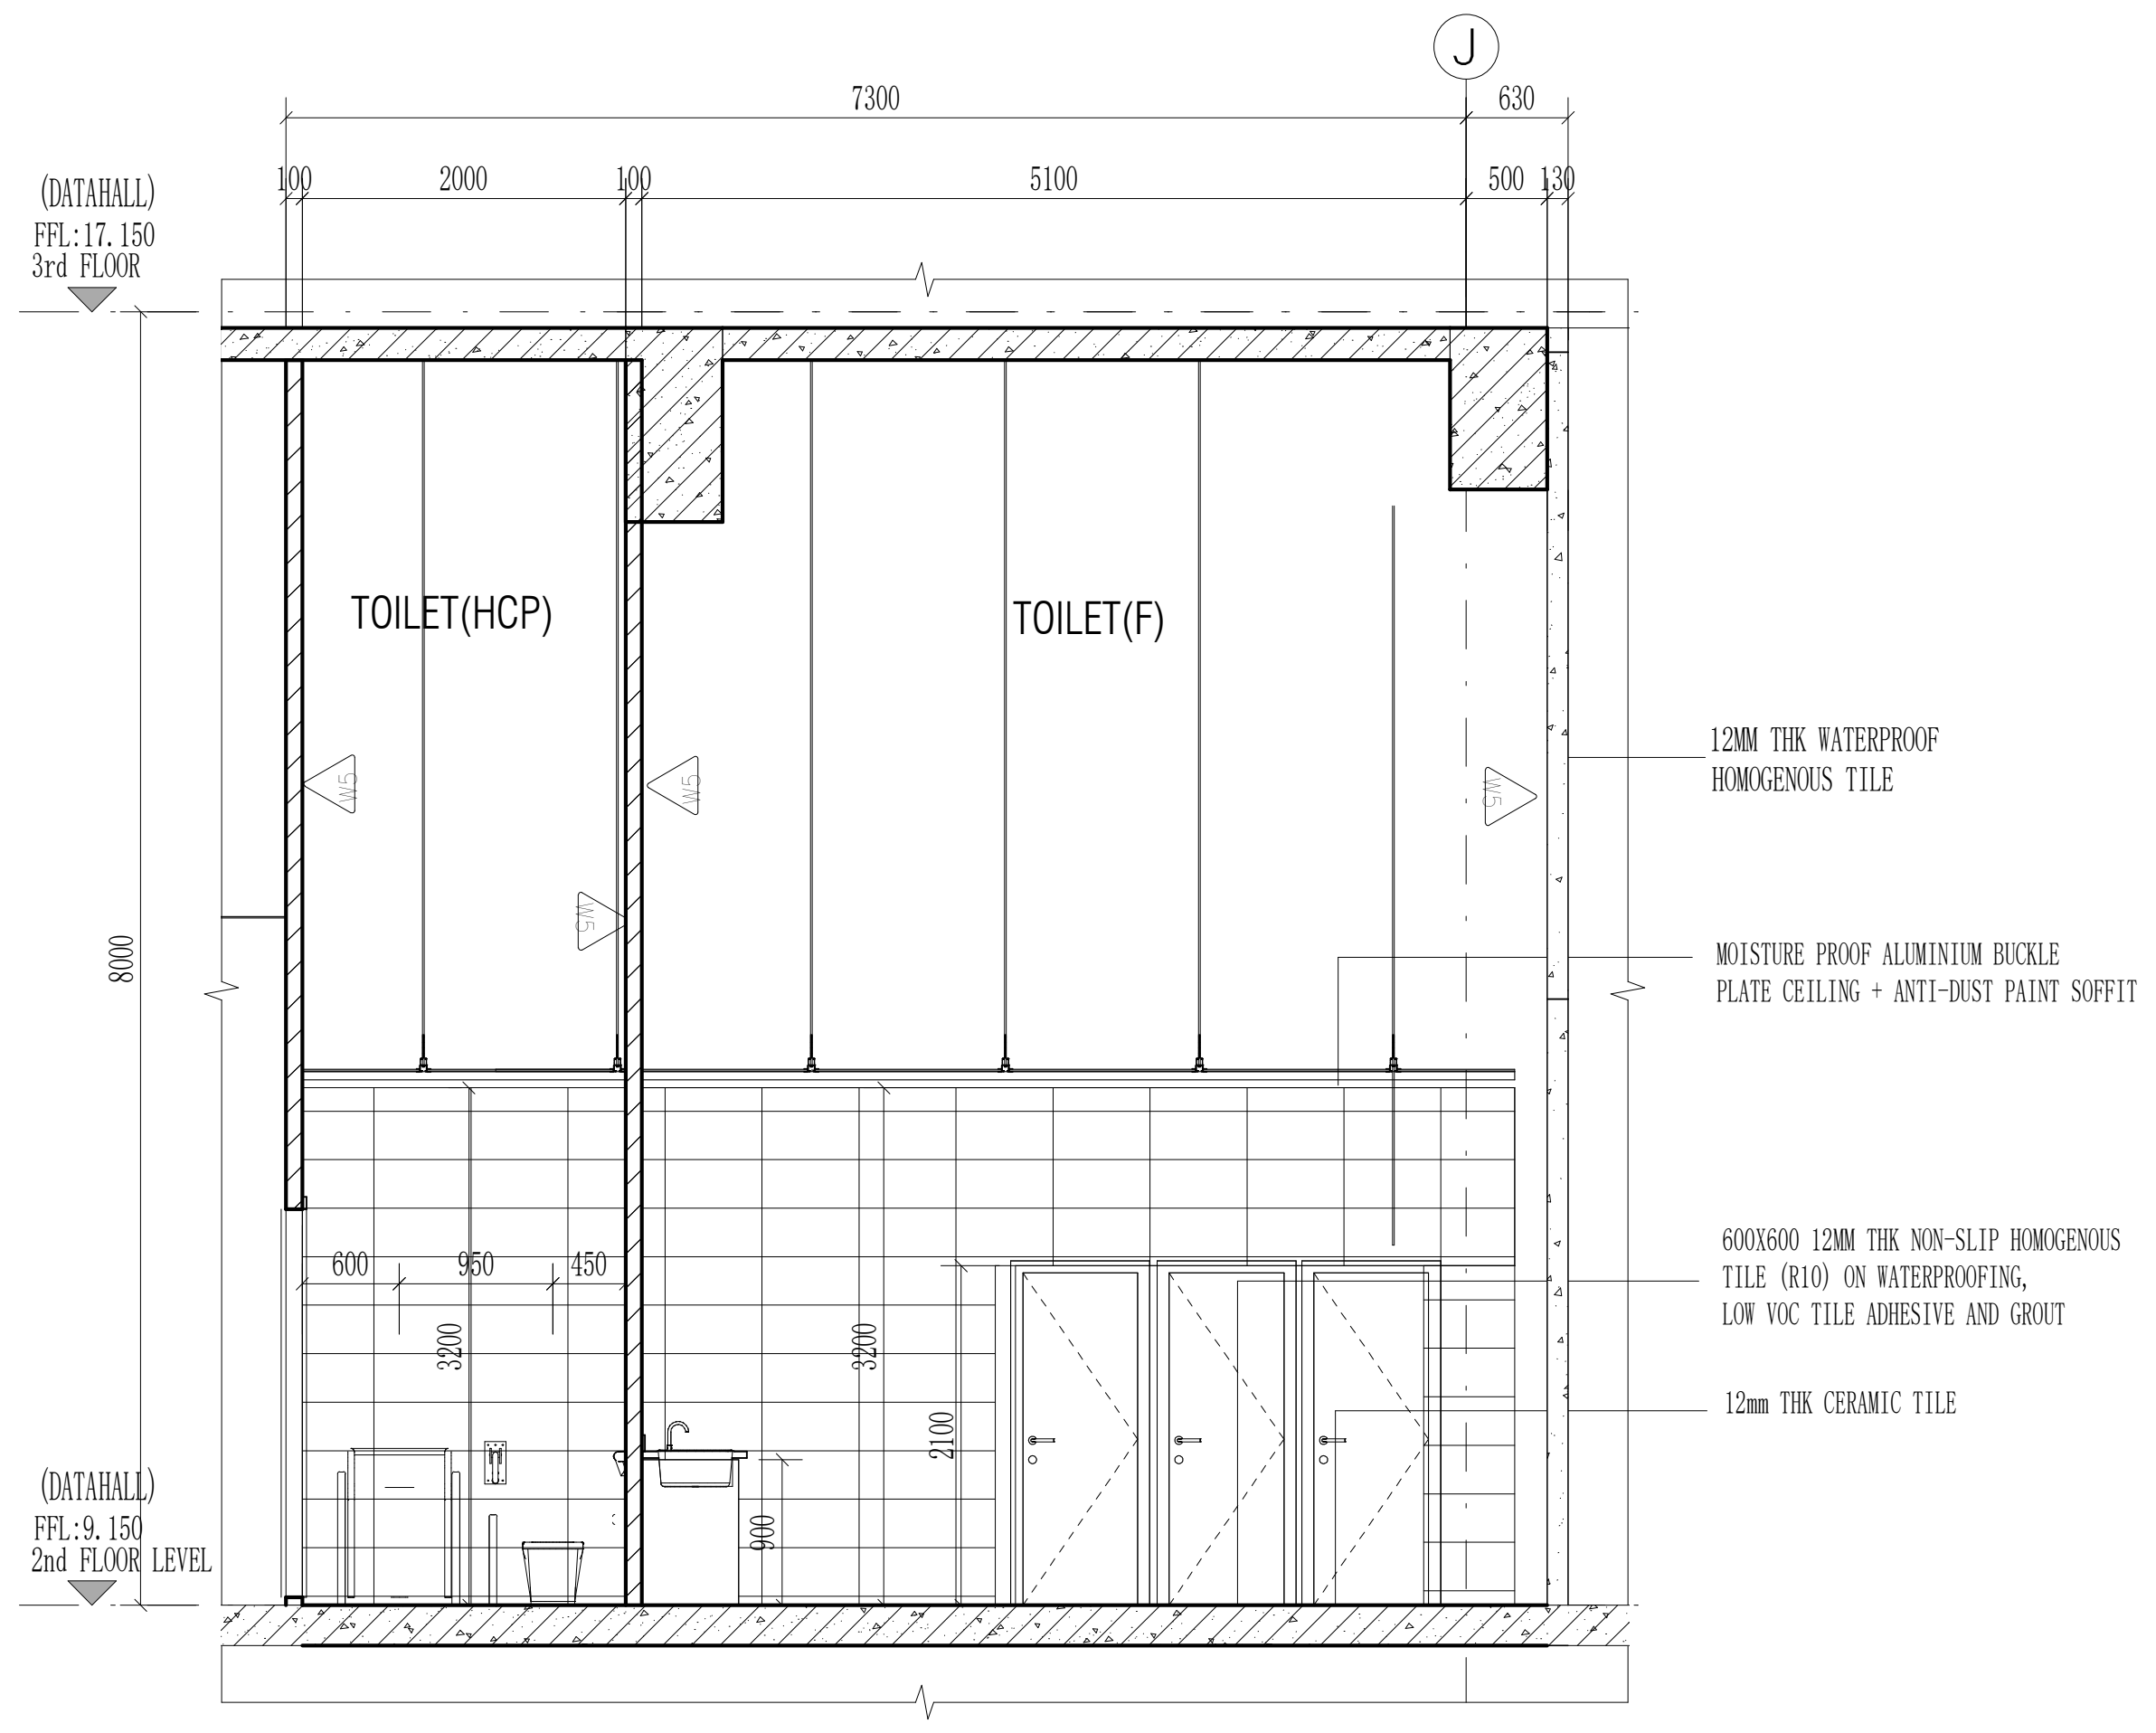

TOILET(F) TOILET(HCP) SECTION C-C

Scale 1:50

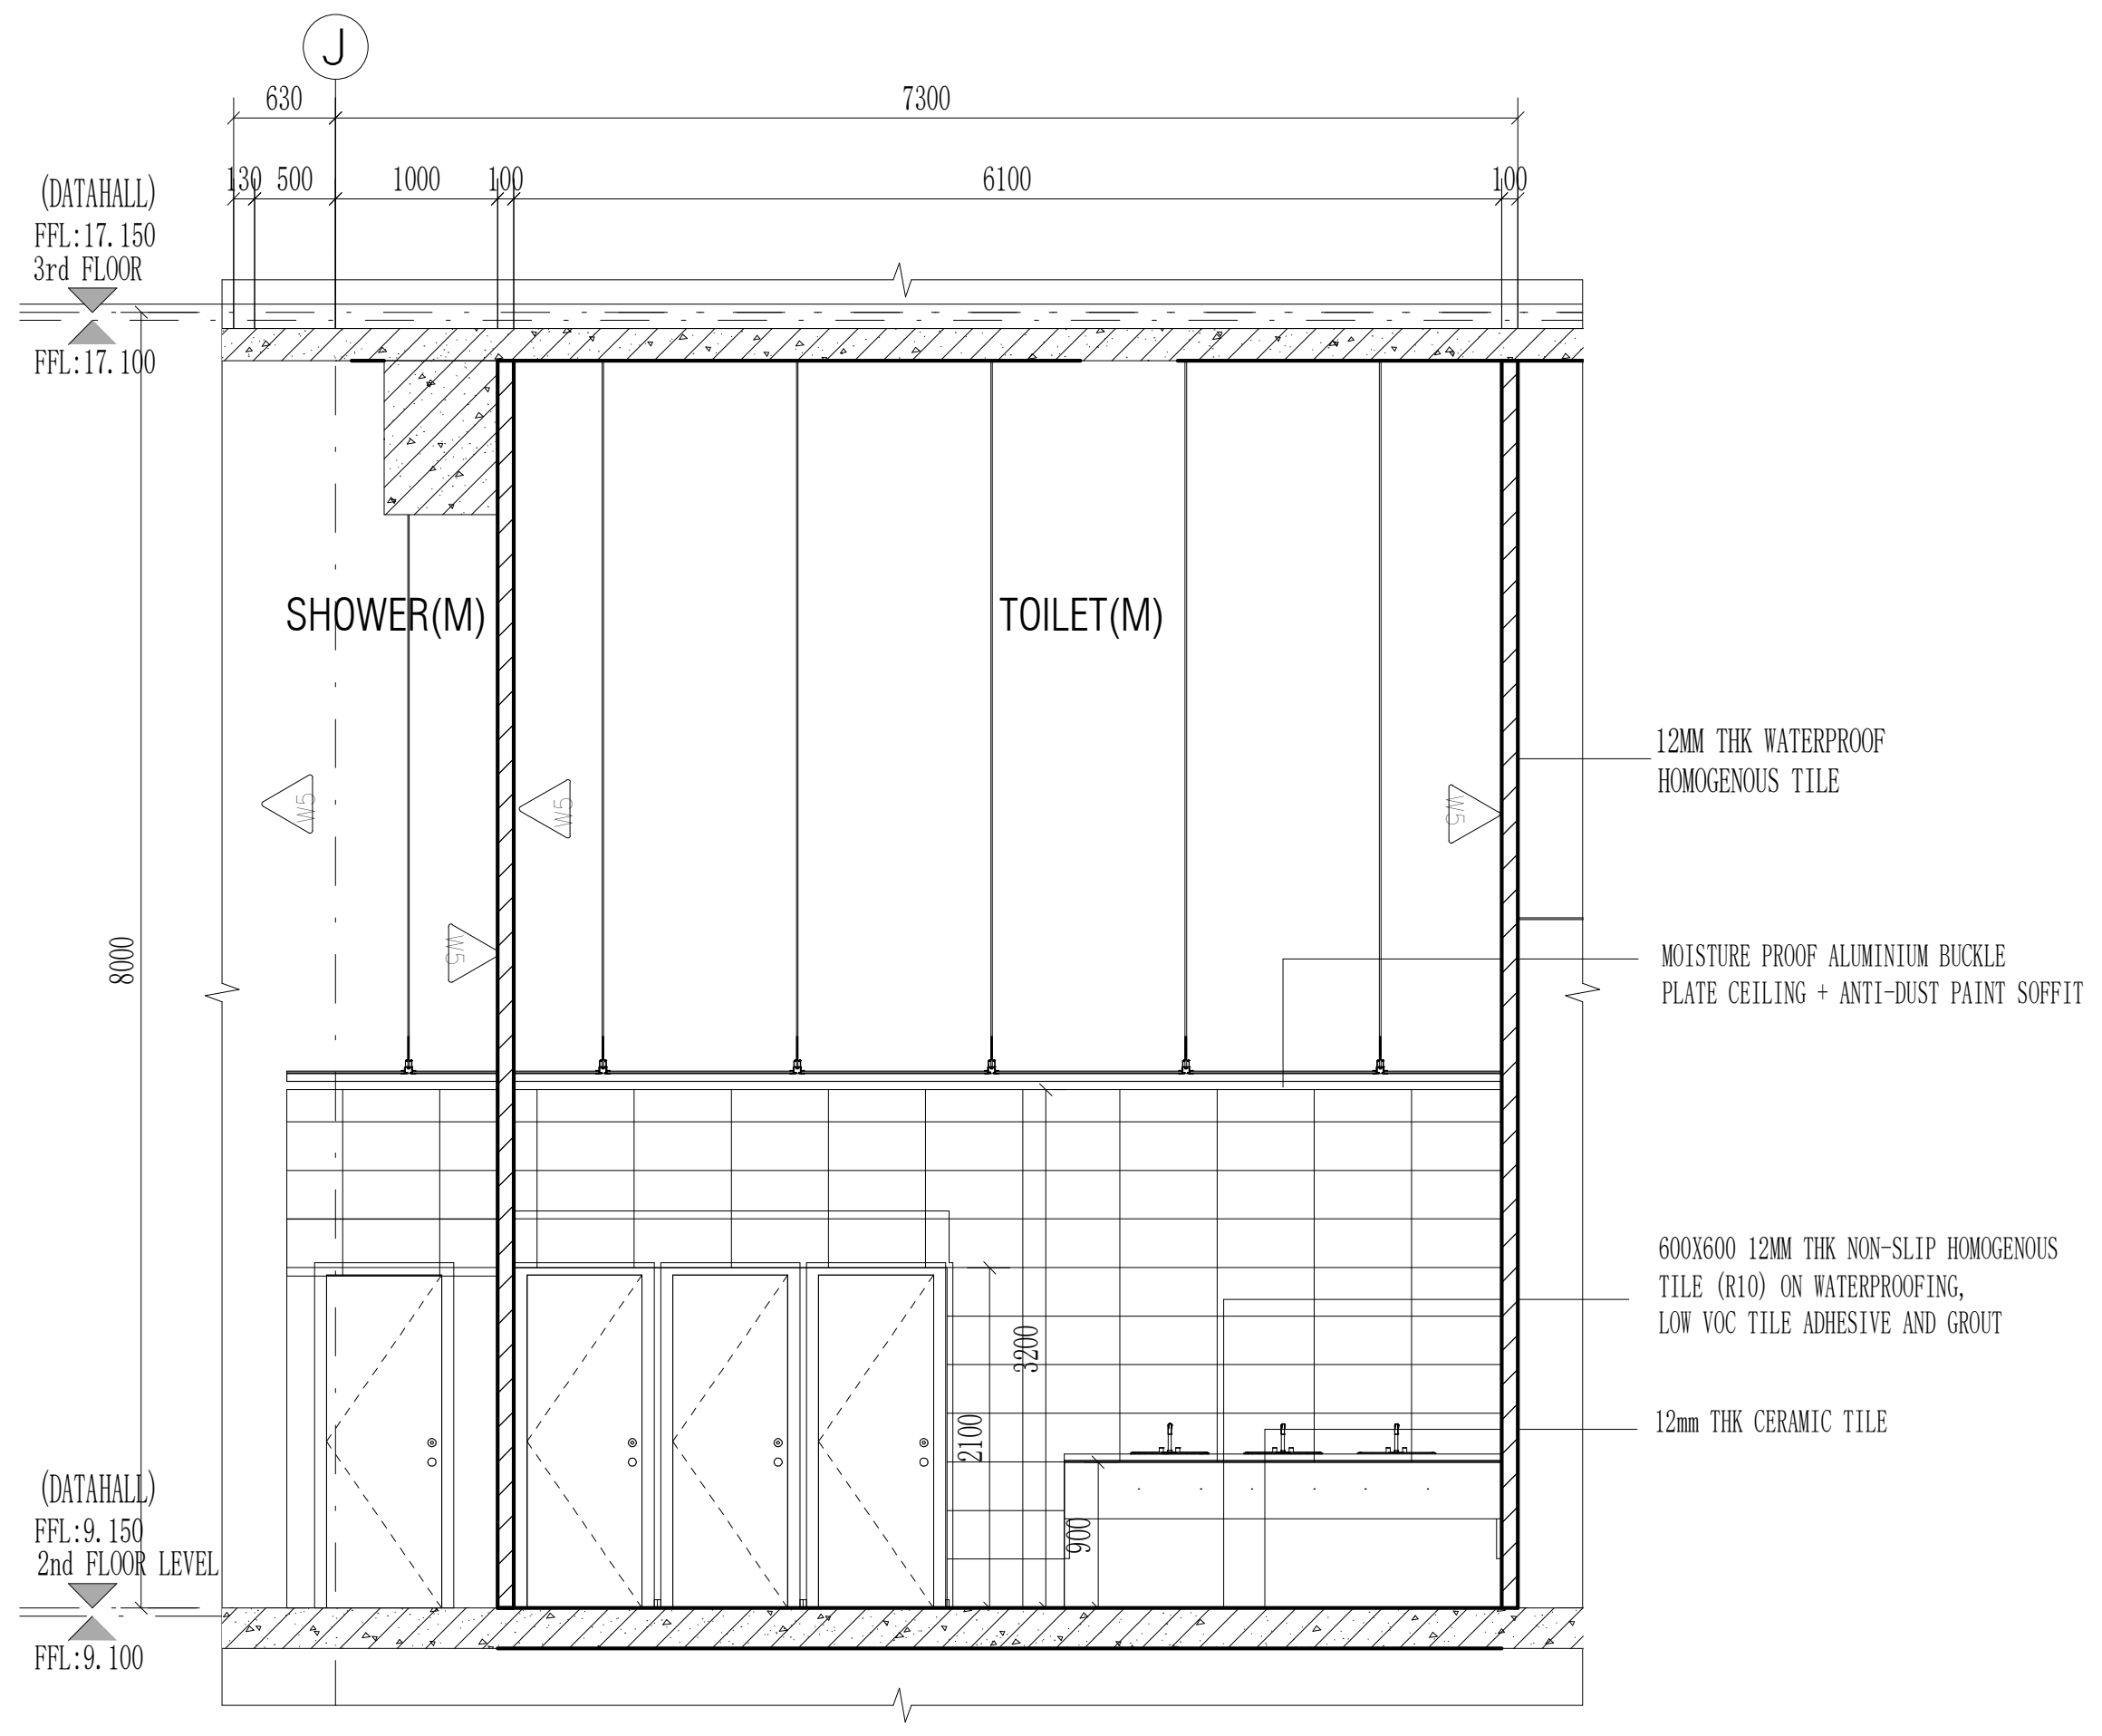

SHOWER(M) TOILET(M) SECTION D-D

Scale 1:50

CLIENT :

GULF EDGE DC 01

87 Wireless Road, M Thai Tower 11th. Floor, All Seasons Place, Lumpini,
Pathumwan, Bangkok 10330, Thailand

CONTRACTOR :

HUASHI
华西发展(泰国)有限公司
บริษัท หัวซือ ดีเวลลอปเม้นต์ (ประเทศไทย) จำกัด
HUASHI DEVELOPMENT CO.,LTD
No. 202, Room No. 1403, 14/F, Le Concorde Building,
Ratchadapisek Road, Huaykhwang Sub-District,
Huaykhwang District, Bangkok Metropolitan 10310.

CONSULTANT :

ARbay
บริษัท เอ อาร์ เบย์ จำกัด
ARbay Company Limited
31 st Floor Bangkok Insurance Building
25 South Sathorn road Thungmahamek
Sathorn Bangkok 10120 THAILAND
T +66 (0) 2286 8199
F +66 (0) 2286 2863
info@arbay.co.th

CONSULTANT :

Qbic Engineers & Architects Co.,Ltd.
8 Soi KALONG 4 SANAMBINNAM ROAD,
THASAI SUB-DISTRICT, MUANG NONTHABURI DISTRICT
, NONTHABURI.
Tel 662-950-4374
Fax 662-580-3231
E-Mail : qbic@qbic.co.th, www.qbic.co.th
QBIC ENGINEERS AND ARCHITECTS CO.,LTD.

CONSULTANT :

MITR
MITR TECHNICAL CONSULTANT CO.,LTD.
1168/8 12th FLOOR, LUMPINI TOWER BUILDING,
RAMA IV RD., THUNGMAHAMEK, SATHORN, BANGKOK 10120, THAILAND
TEL : 0-2679-9079-84
FAX : 0-2679-9085 E-mail: mitr_dd@mitr.com

Architect :	SIGNATURE
ประกิต พนานุรัตน์ วสถ. 580 ที่อยู่ 251/1 ถ.จารุเมือง แขวงรองเมือง เขตปทุมวัน กรุงเทพมหานคร โทรศัพท์ 02-286-8199	
Structural Engineer :	SIGNATURE
วิศวกรผู้ออกแบบโครงสร้าง	
ณัฐสม สงวนวงษ์ วย 1423 ที่อยู่ 2/1 ซ.รามคำแหง 150 ถ.รามคำแหง แขวง สะพานสูง เขต สะพานสูง กทม. 10240	
Structural Inspector :	SIGNATURE
วิศวกรผู้ตรวจสอบโครงสร้าง	
โกมล จุฑาภัทร วย 964 ที่อยู่ 24/18 ซ.นวมินทร์ 129 ถ. นวมินทร์ แขวง นวลจันทร์ เขต บึงกุ่ม กทม. 10230	
Electrical Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบไฟฟ้ากำลัง	
นายสุภัทร บูรณวิทย์ วฟก.1265 ที่อยู่ 21 ซอยทานสัมฤทธิ์ 13 ตำบลท่าทราย อ.เมืองนนทบุรี จ.นนทบุรี 11000	
Mechanical Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบเครื่องกลและปรับอากาศ	
นายประสิทธิ์ เกี่ยวสุนทร วก.1221 ที่อยู่ 44/372 ซอยบางกระดี่ 35/1 แขวงแสมดำ เขตบางขุนเทียน กทม. 10150	ประสิทธิ์
Sanitary Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบสุขาภิบาล และดับเพลิง	
นายทศวรรษ สนั่นฤทธิ์ วส. 215 ที่อยู่ บ้านเลขที่ 99/107 หมู่ที่ 3 ต.ศีรษะจรเข้น้อย อ.บางเสาธง จ.สมุทรปราการ 10540	ทศวรรษ

ISSUE/REVISION

REV.	DESCRIPTION	DATE
A	90% DEVELOPED	09/05/2026

PROJECT NAME :

GEDC 01

LOCATION:
Nikhom Phattana district, Rayong ,industrial estate,CPGC

BUILDING :
MAIN BUILDING

90% DEVELOPED

TITLE :

ROOM DETAIL-TOILET
&SHOWER(F),TOILET&SHOWER(M),TOILET(HCP)

JOB NO.	SCALE 1 : 50
DRAWN NXR	REF.
CHECKED LJC	DWG. NO. MPK01A-90-A-RD-213
APPROVED LXD	
DATE 2026.05.09	

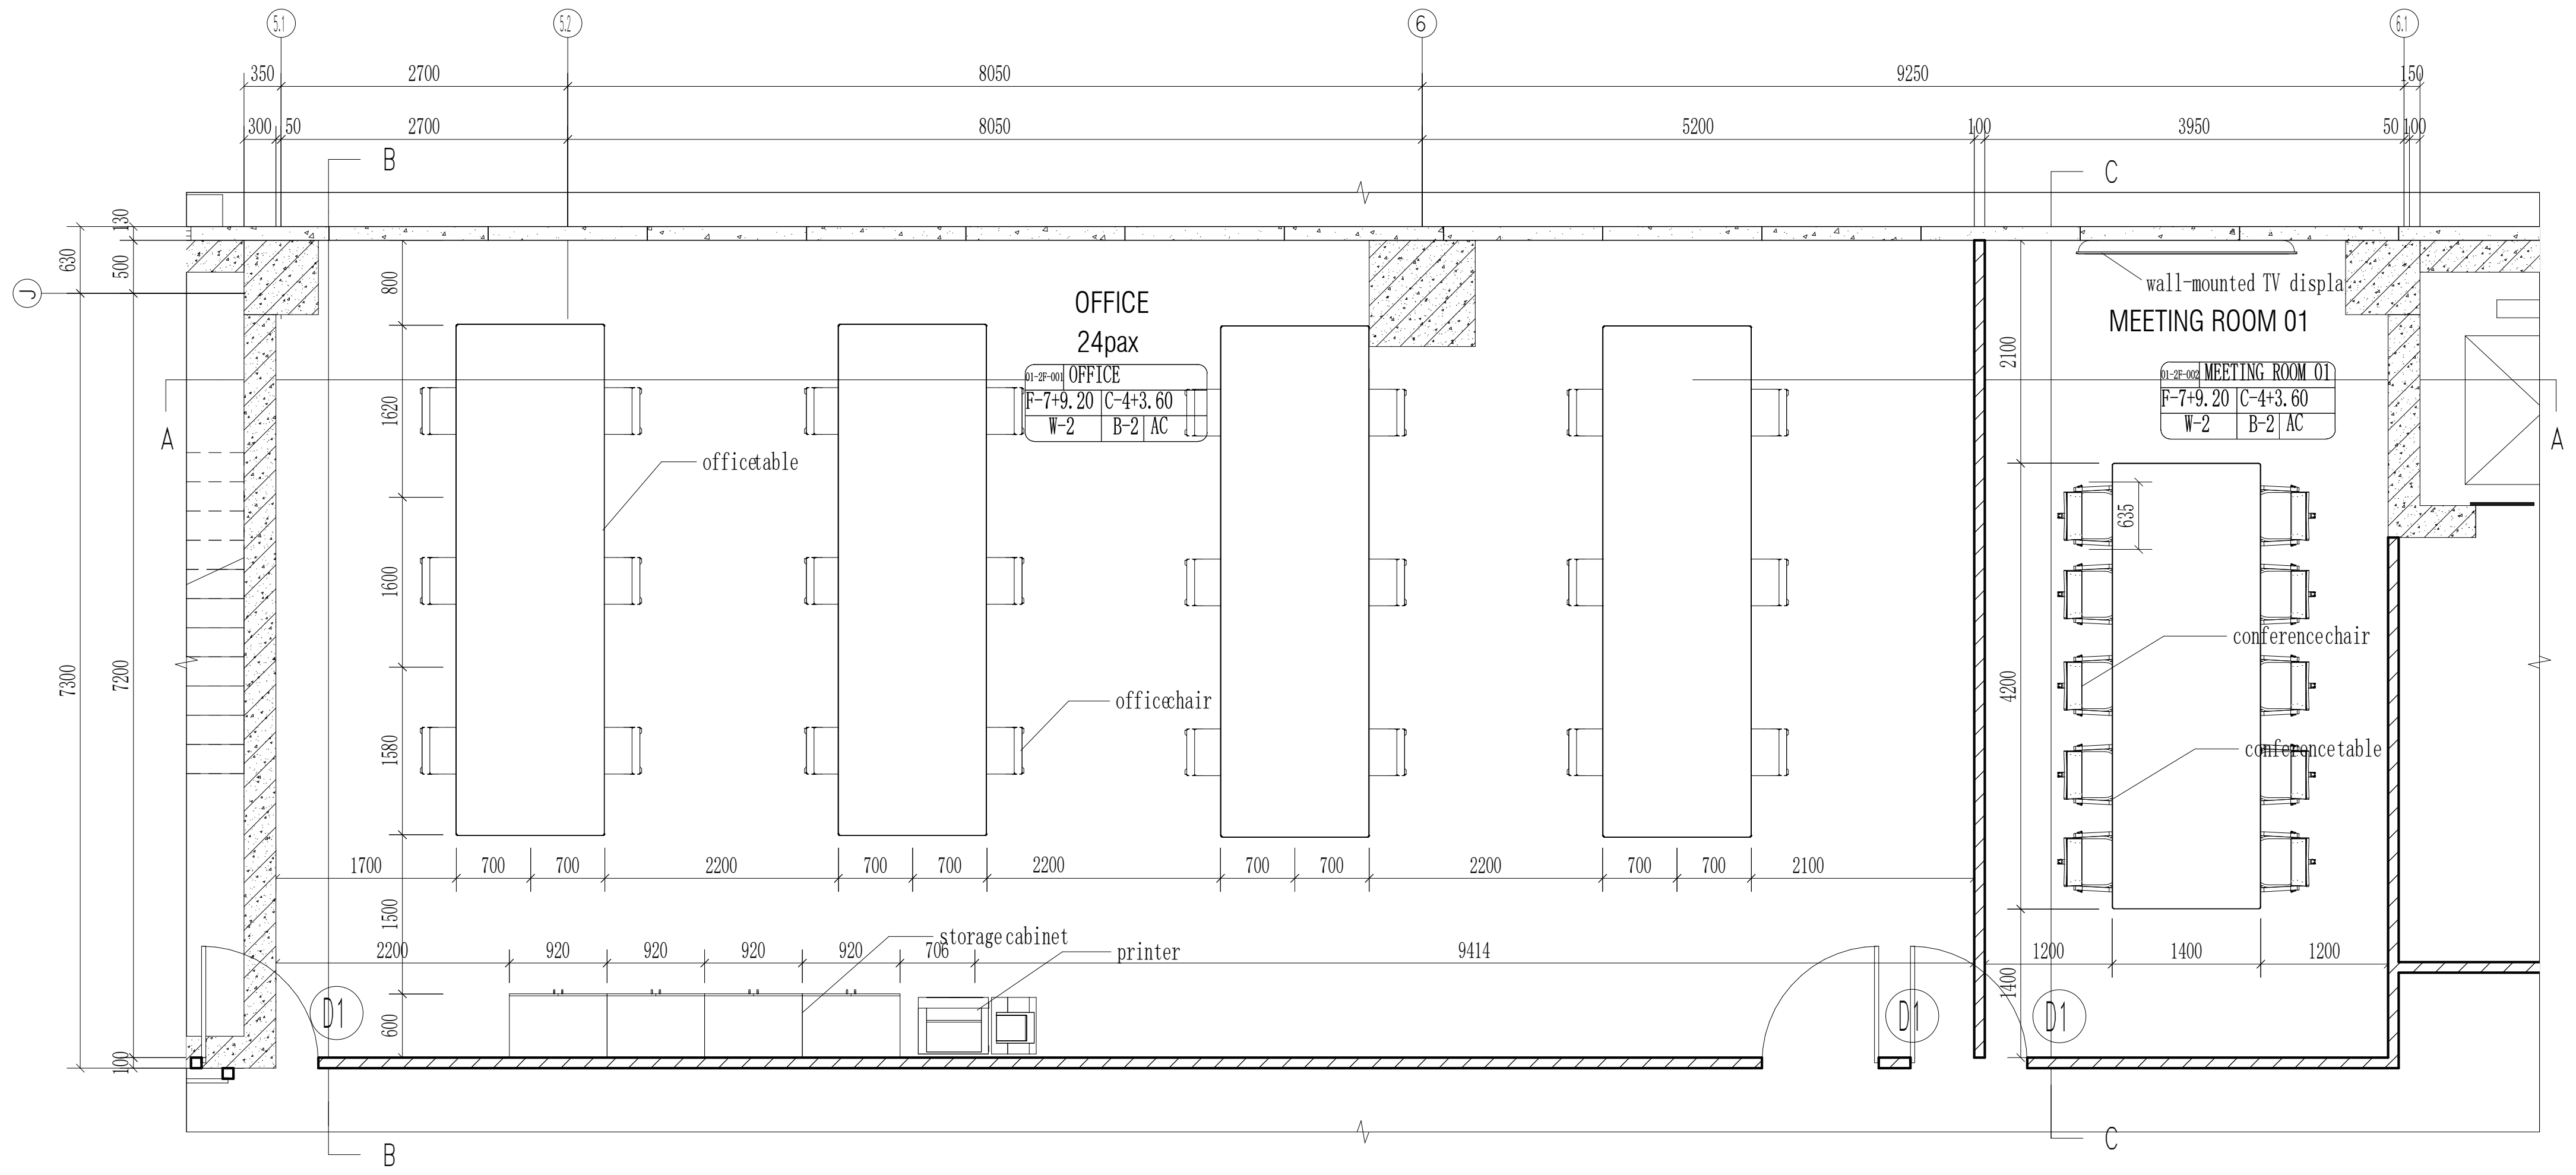

OFFICE、 MEETING ROOM 01 FLOOR PLAN

Scale 1:50

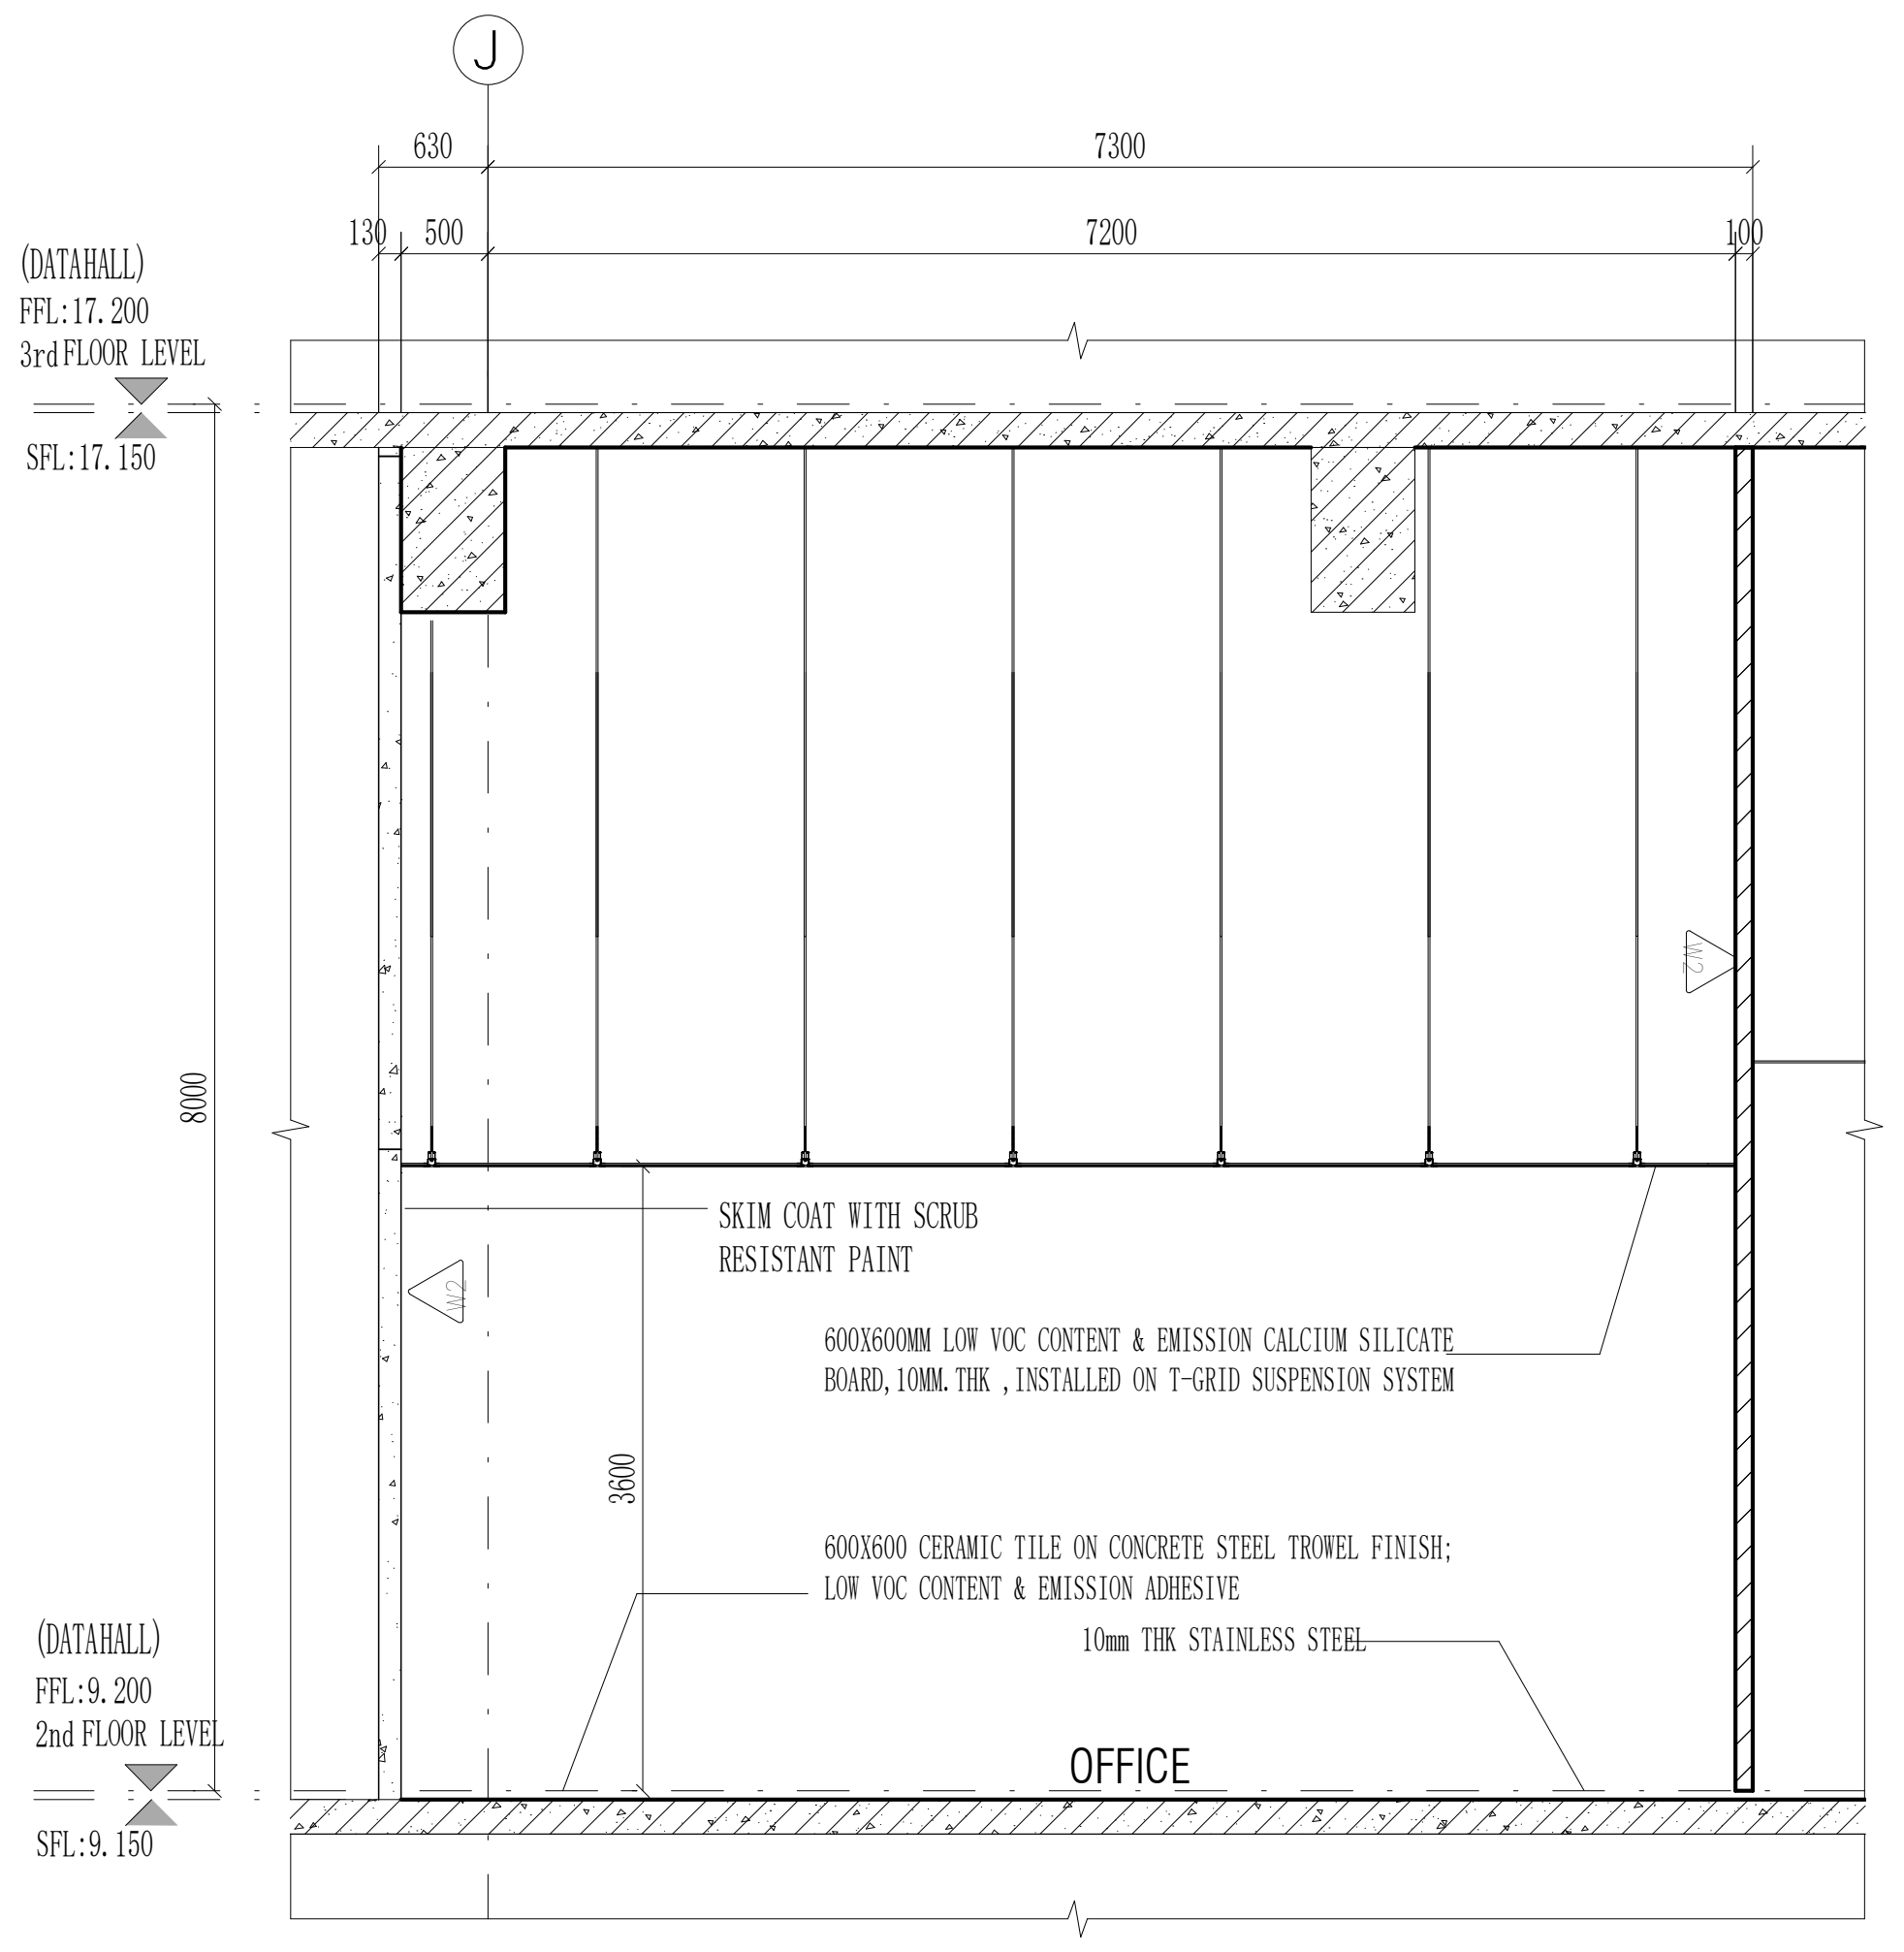
J
630
7300
130
500
7200
100
(DATAHALL)
FFL:17.200
3rd FLOOR LEVEL
SFL:17.150
8000
W2
SKIM COAT WITH SCRUB
RESISTANT PAINT
600X600MM LOW VOC CONTENT & EMISSION CALCIUM SILICATE
BOARD,10MM.THK ,INSTALLED ON T-GRID SUSPENSION SYSTEM
3600
600X600 CERAMIC TILE ON CONCRETE STEEL TROWEL FINISH;
LOW VOC CONTENT & EMISSION ADHESIVE
10mm THK STAINLESS STEEL
(DATAHALL)
FFL:9.200
2nd FLOOR LEVEL
SFL:9.150
OFFICE

OFFICE SECTION B-B

Scale 1:50

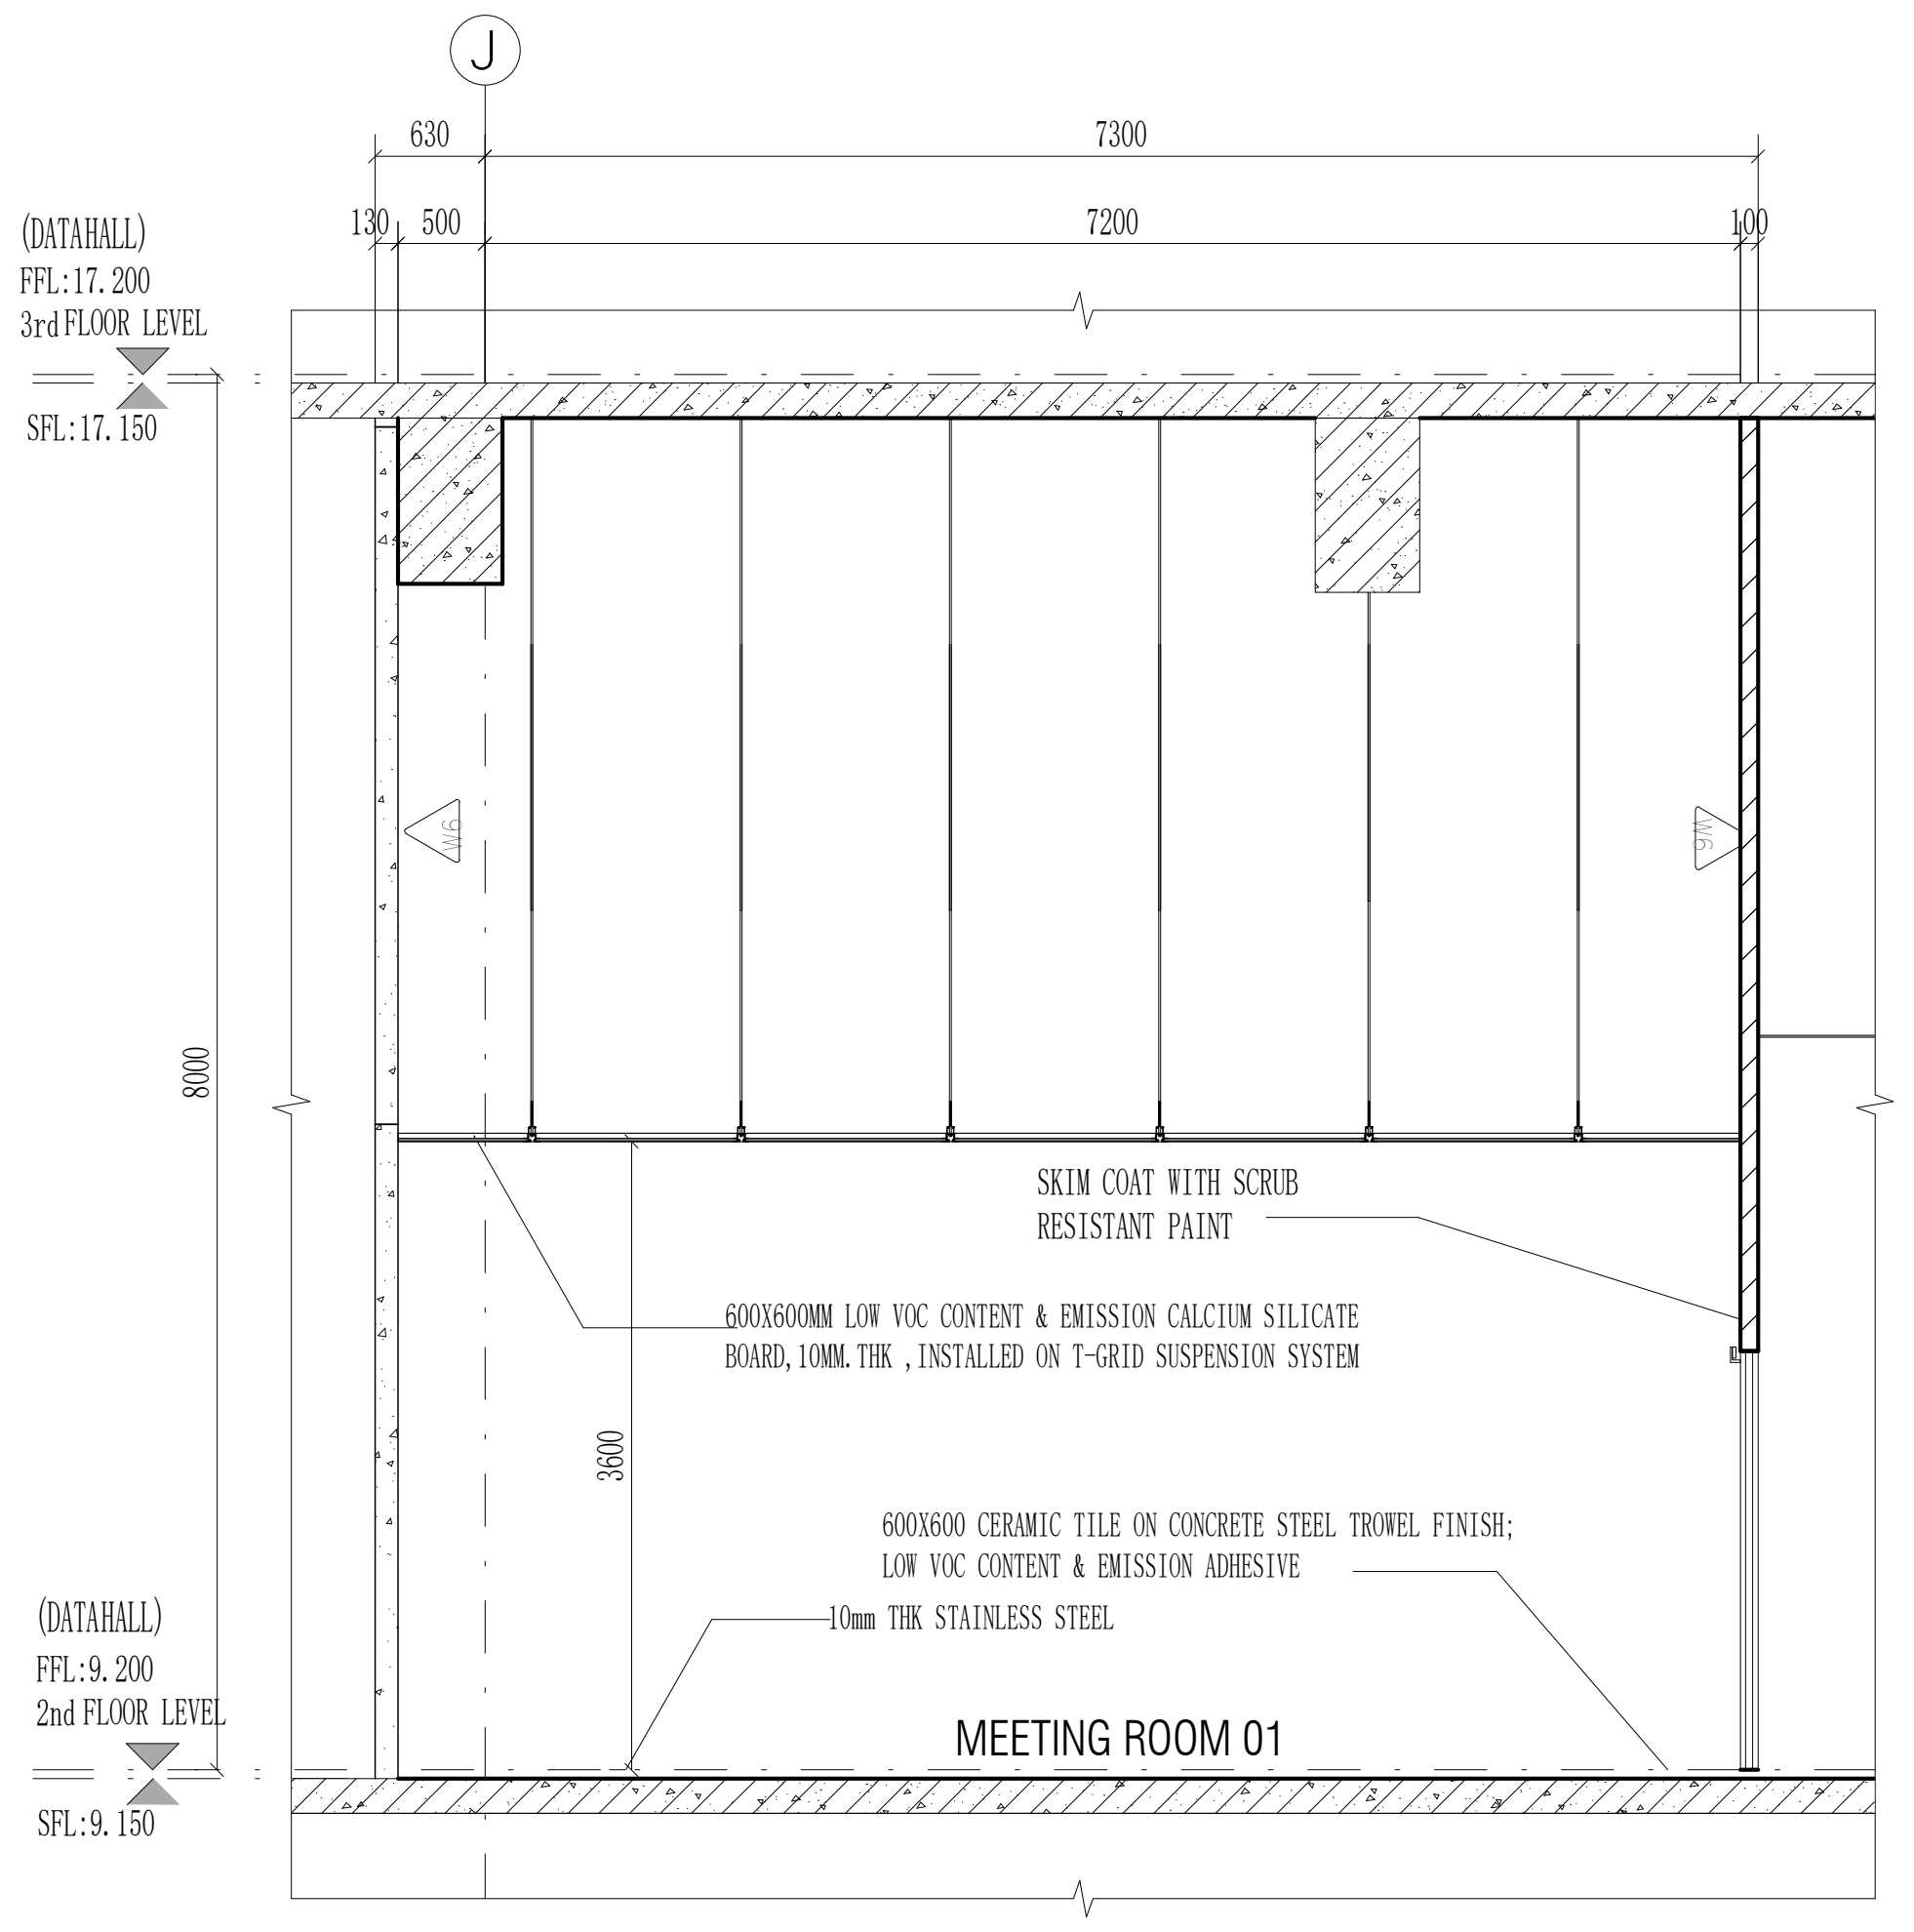
J
630
7300
130
500
7200
100
(DATAHALL)
FFL:17.200
3rd FLOOR LEVEL
SFL:17.150
8000
W6
SKIM COAT WITH SCRUB
RESISTANT PAINT
600X600MM LOW VOC CONTENT & EMISSION CALCIUM SILICATE
BOARD,10MM.THK ,INSTALLED ON T-GRID SUSPENSION SYSTEM
3600
600X600 CERAMIC TILE ON CONCRETE STEEL TROWEL FINISH;
LOW VOC CONTENT & EMISSION ADHESIVE
10mm THK STAINLESS STEEL
(DATAHALL)
FFL:9.200
2nd FLOOR LEVEL
SFL:9.150
MEETING ROOM 01

MEETING ROOM 01 SECTION C-C

Scale 1:50

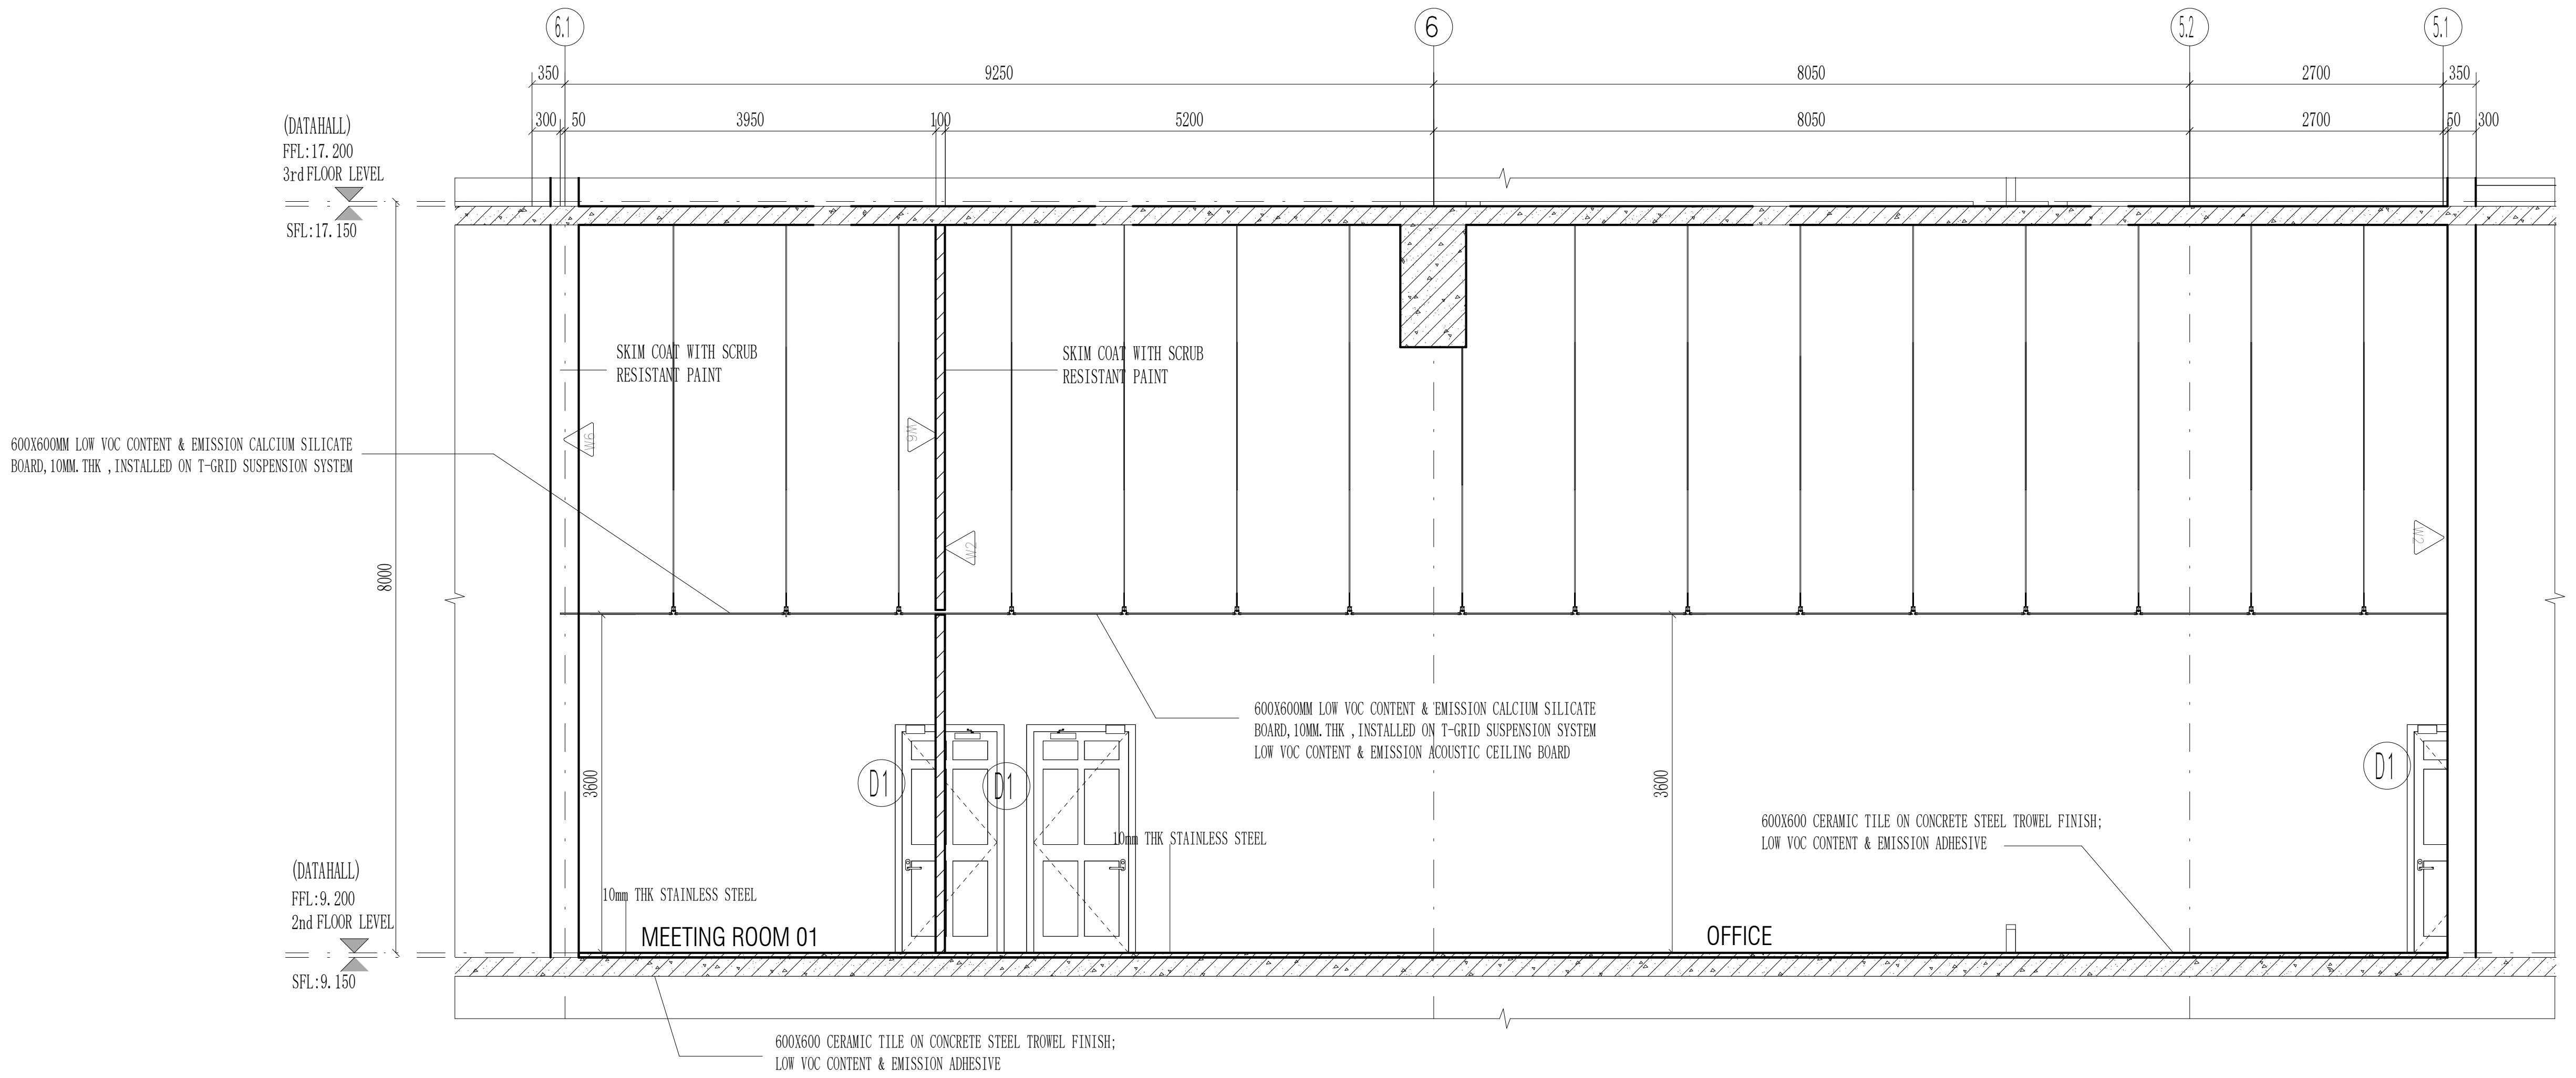
6.1
6
5.2
5.1
350
9250
8050
2700
300
50
3950
100
5200
(DATAHALL)
FFL:17.200
3rd FLOOR LEVEL
SFL:17.150
SKIM COAT WITH SCRUB
RESISTANT PAINT
600X600MM LOW VOC CONTENT & EMISSION CALCIUM SILICATE
BOARD,10MM.THK ,INSTALLED ON T-GRID SUSPENSION SYSTEM
W6
W2
8000
600X600MM LOW VOC CONTENT & EMISSION CALCIUM SILICATE
BOARD,10MM.THK ,INSTALLED ON T-GRID SUSPENSION SYSTEM
LOW VOC CONTENT & EMISSION ACOUSTIC CEILING BOARD
3600
D1
10mm THK STAINLESS STEEL
600X600 CERAMIC TILE ON CONCRETE STEEL TROWEL FINISH;
LOW VOC CONTENT & EMISSION ADHESIVE
(DATAHALL)
FFL:9.200
2nd FLOOR LEVEL
SFL:9.150
MEETING ROOM 01
OFFICE
600X600 CERAMIC TILE ON CONCRETE STEEL TROWEL FINISH;
LOW VOC CONTENT & EMISSION ADHESIVE

OFFICE、 MEETING ROOM 01 SECTION A-A

Scale 1:50

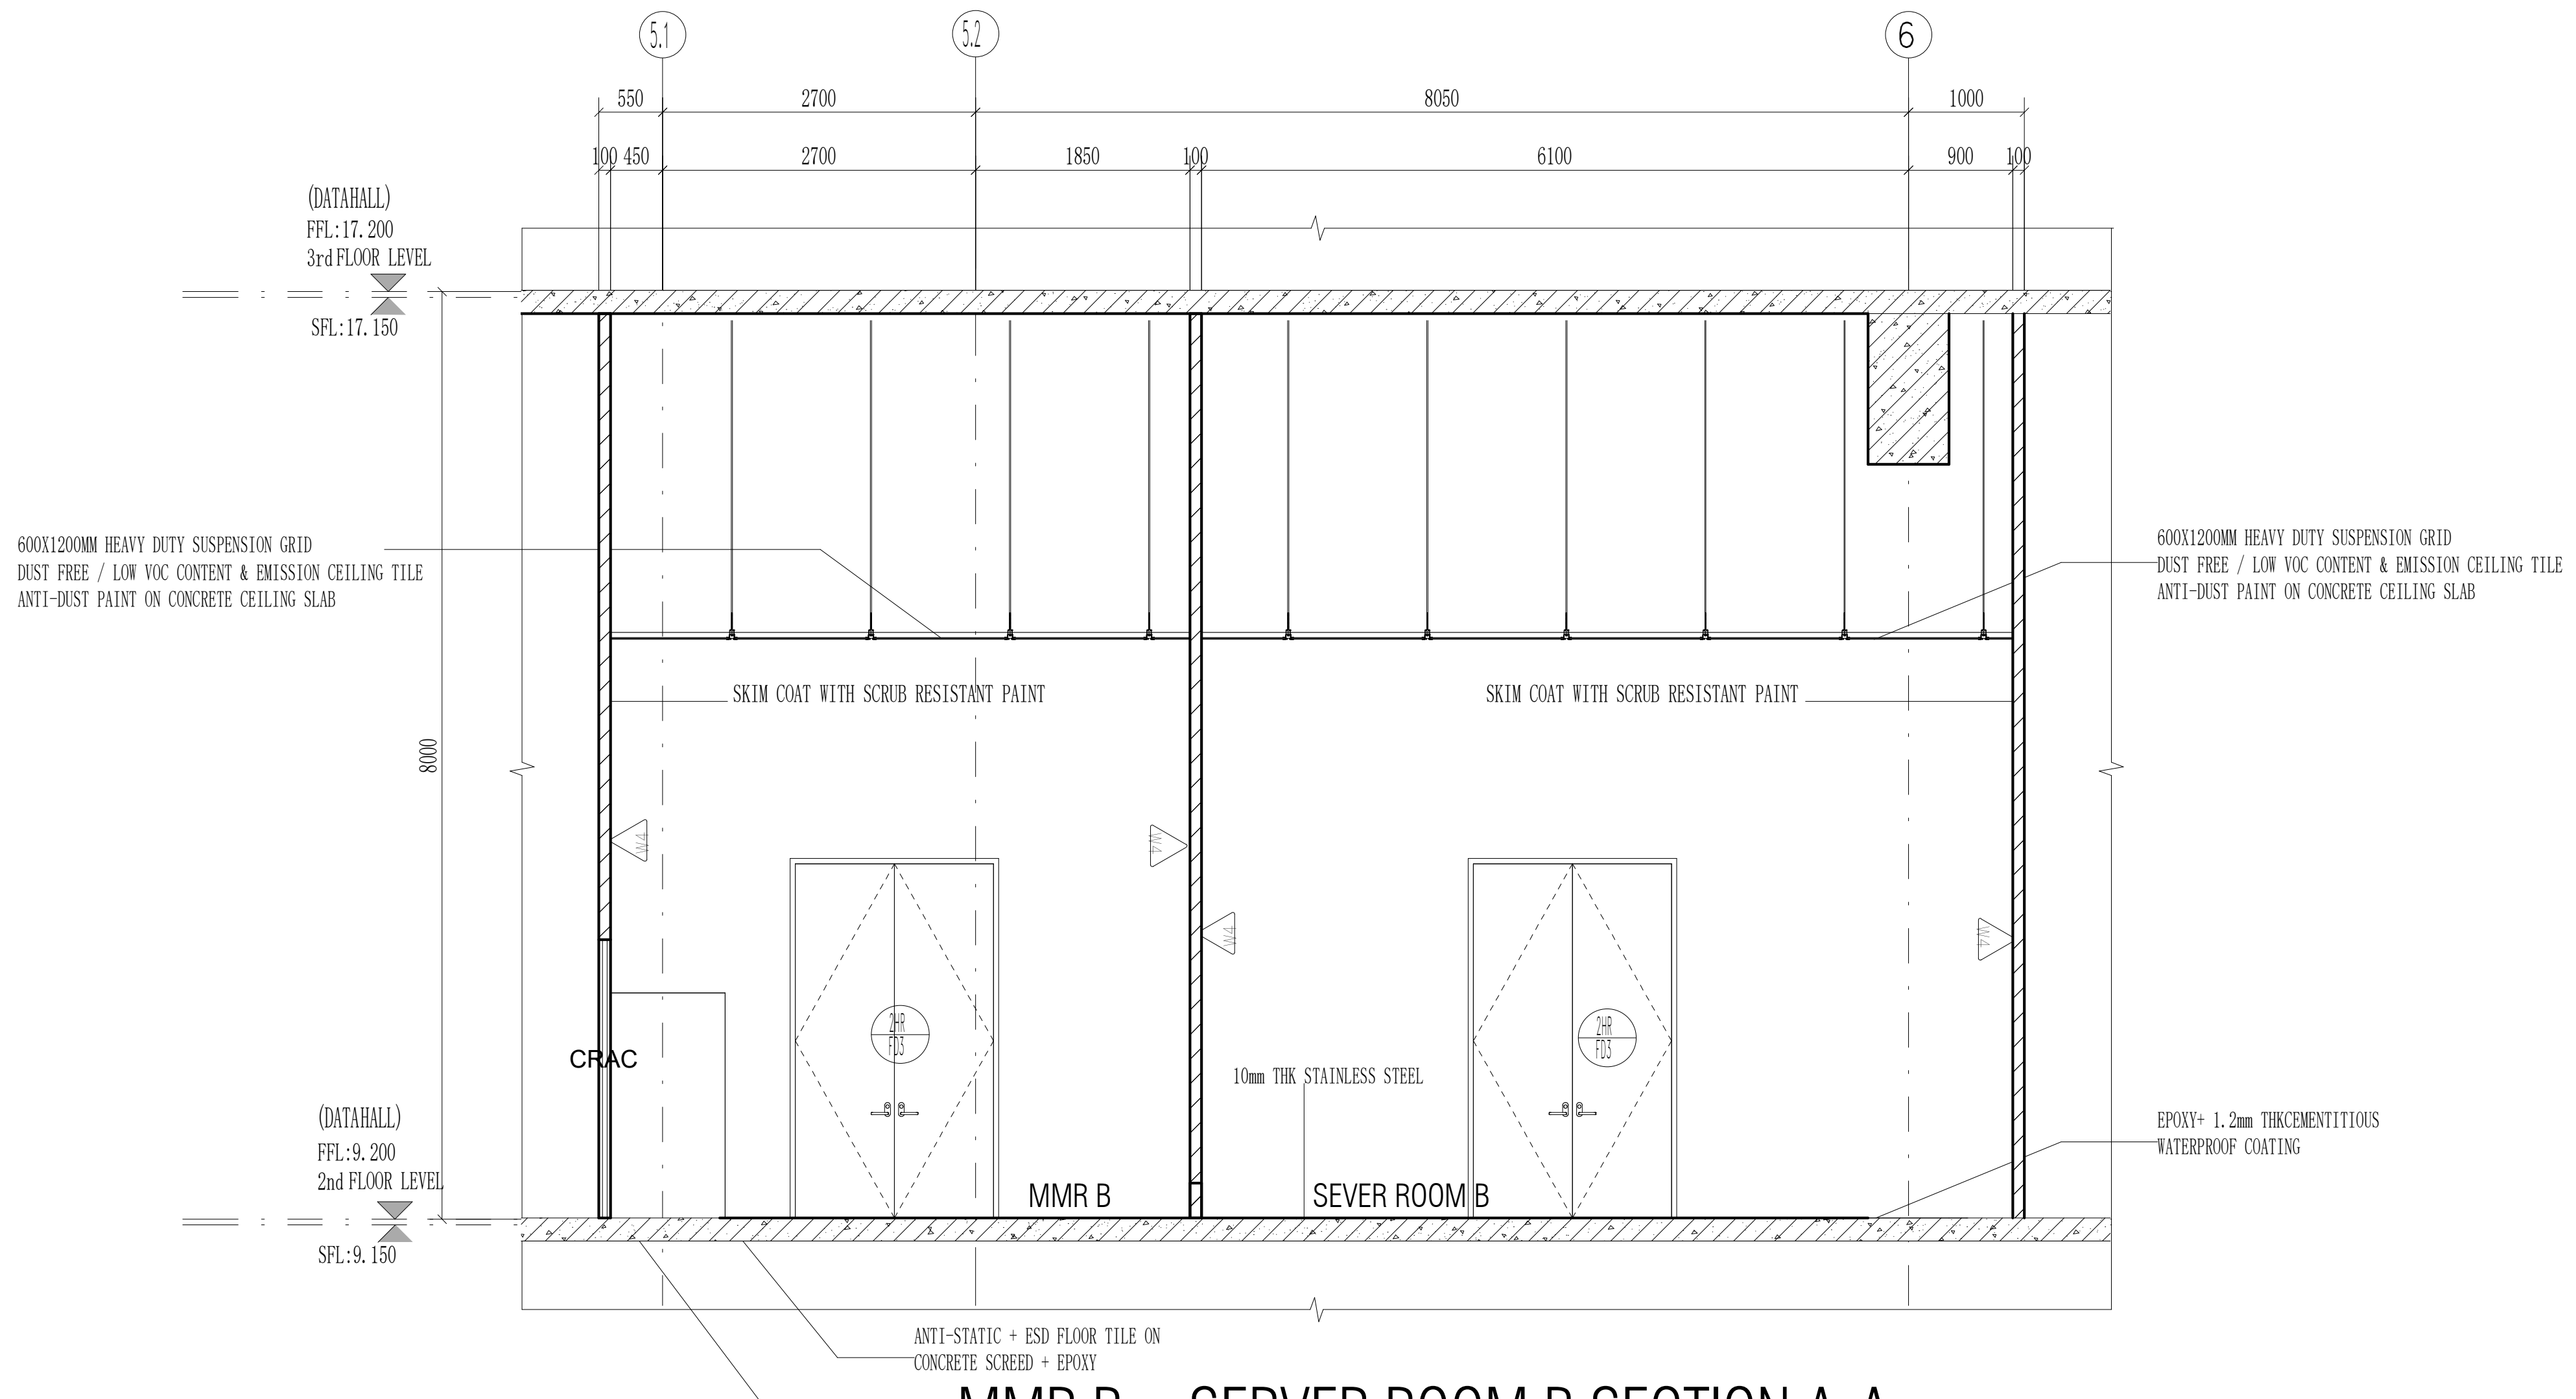

MMR B、 SERVER ROOM B SECTION A-A

Scale 1:50

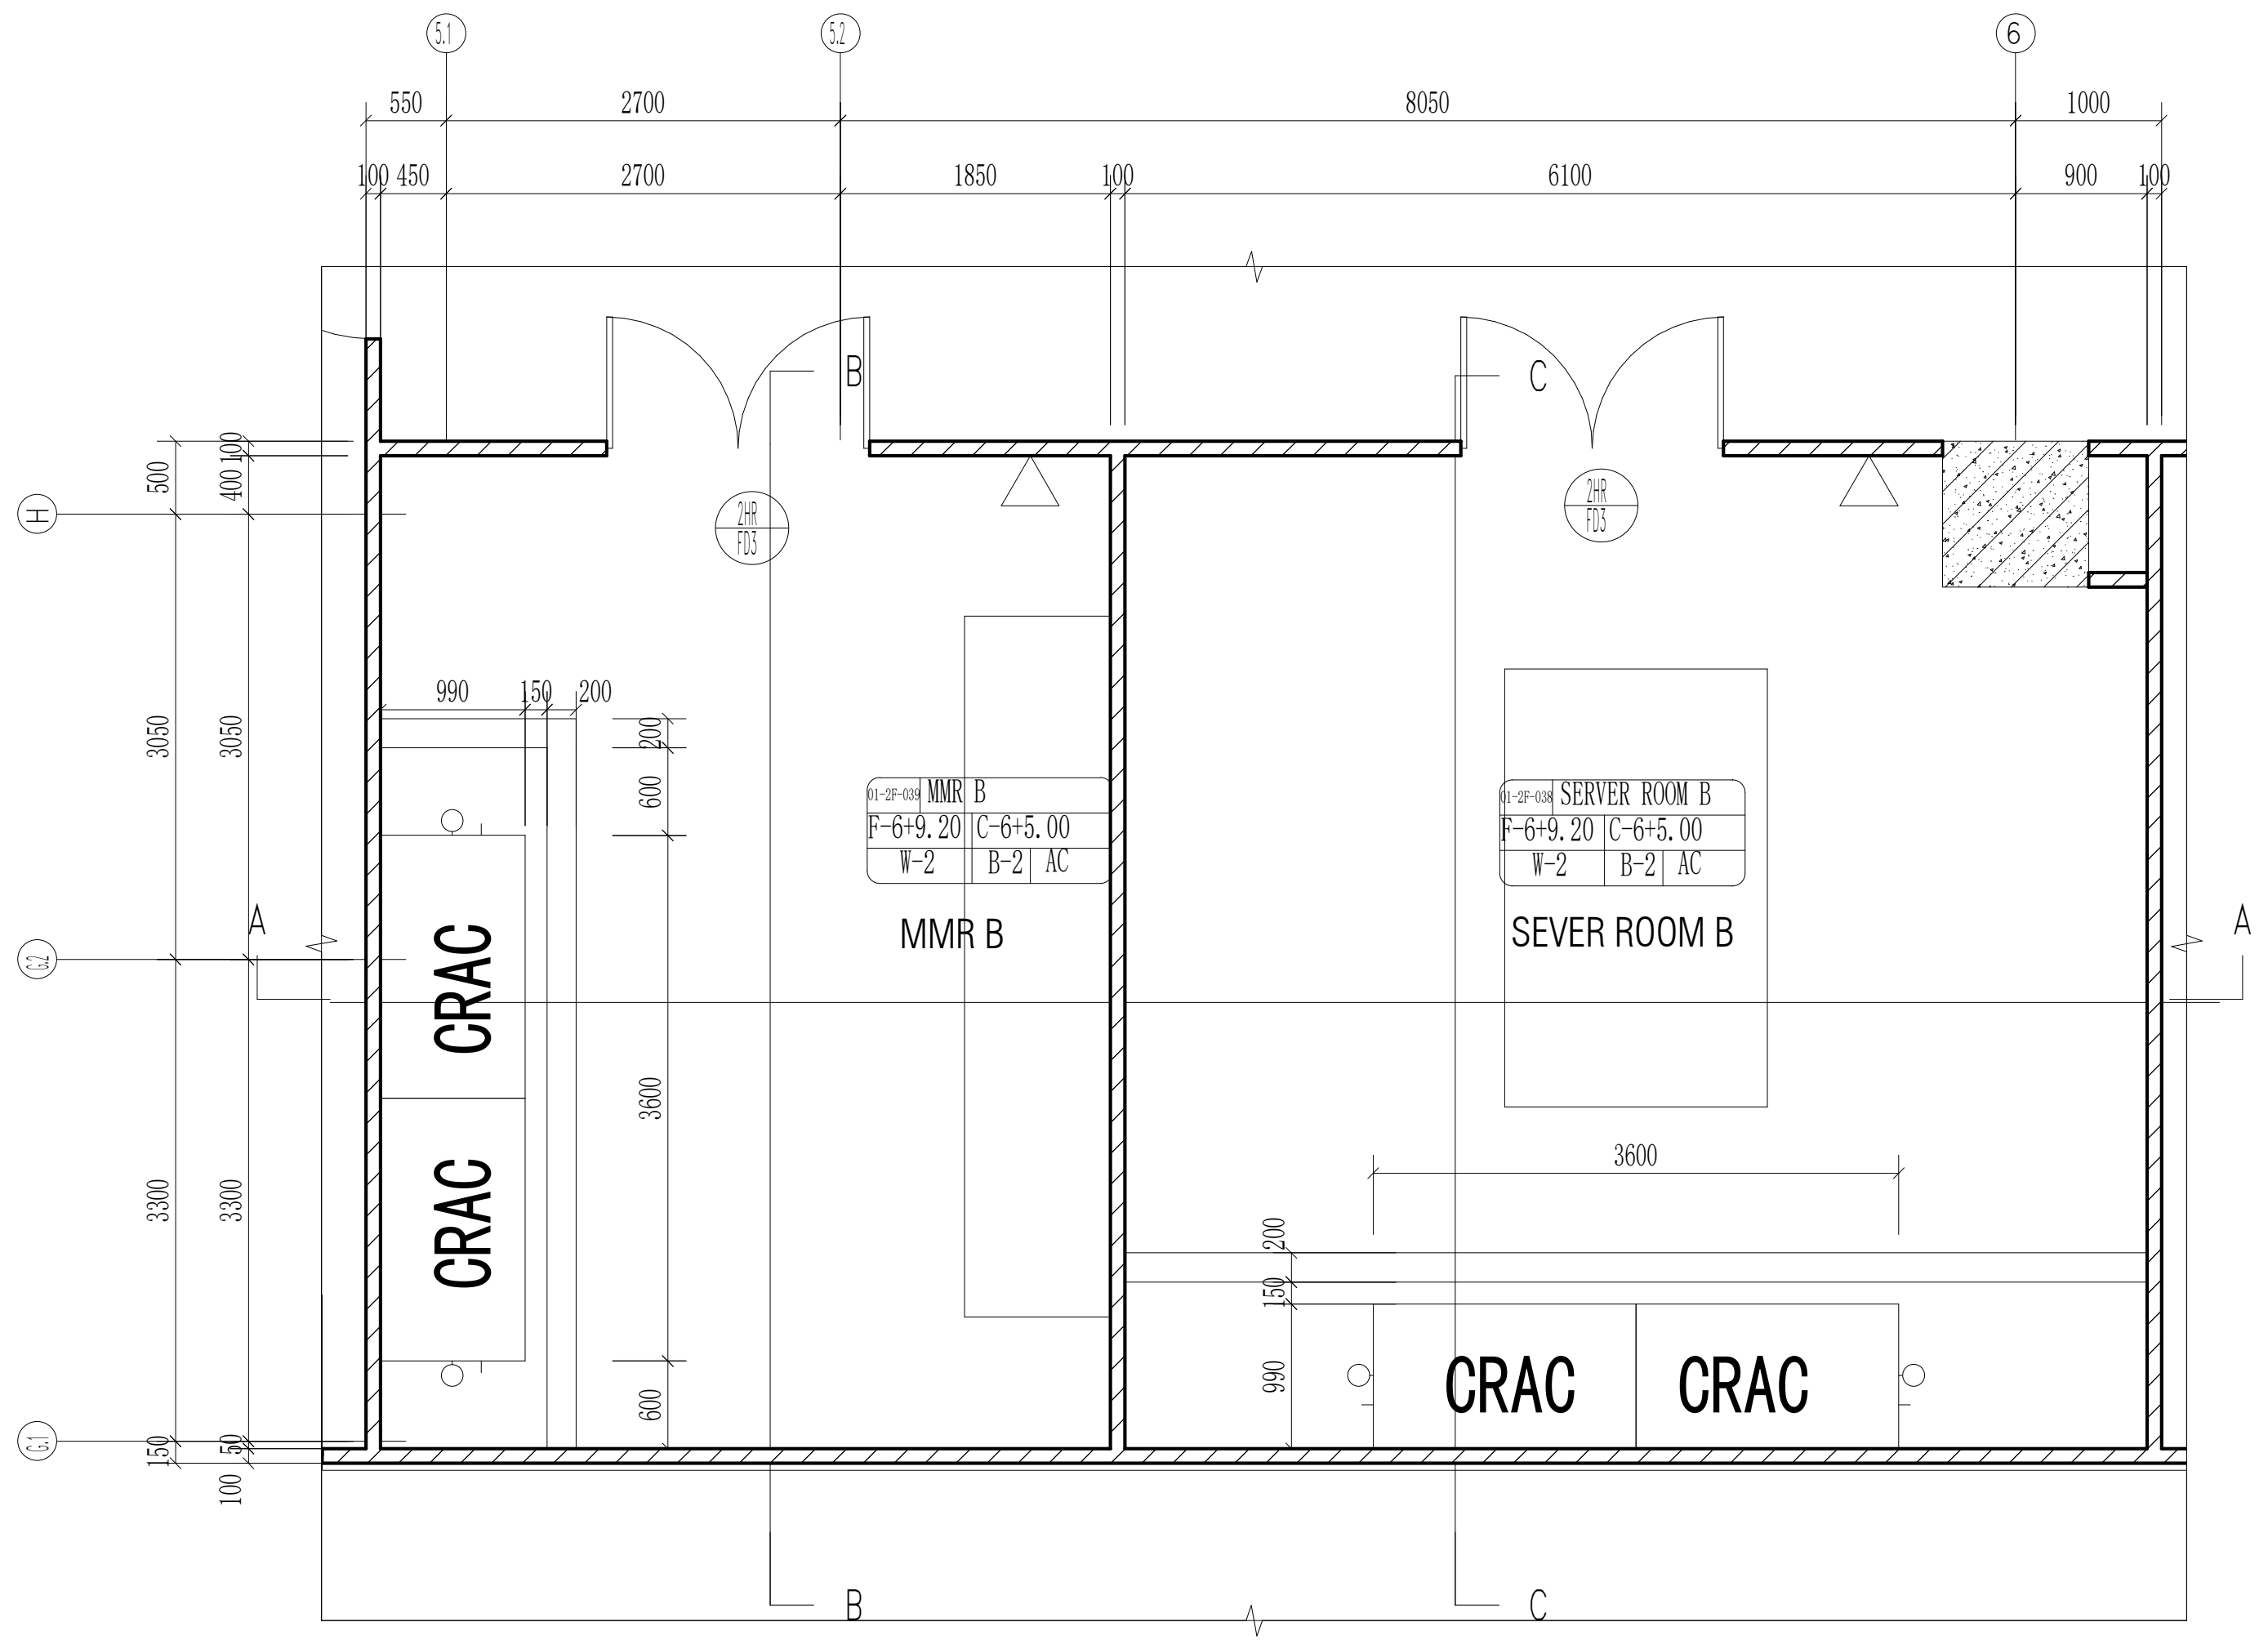

MMR B、 SERVER ROOM B FLOOR PLAN

Scale 1:50

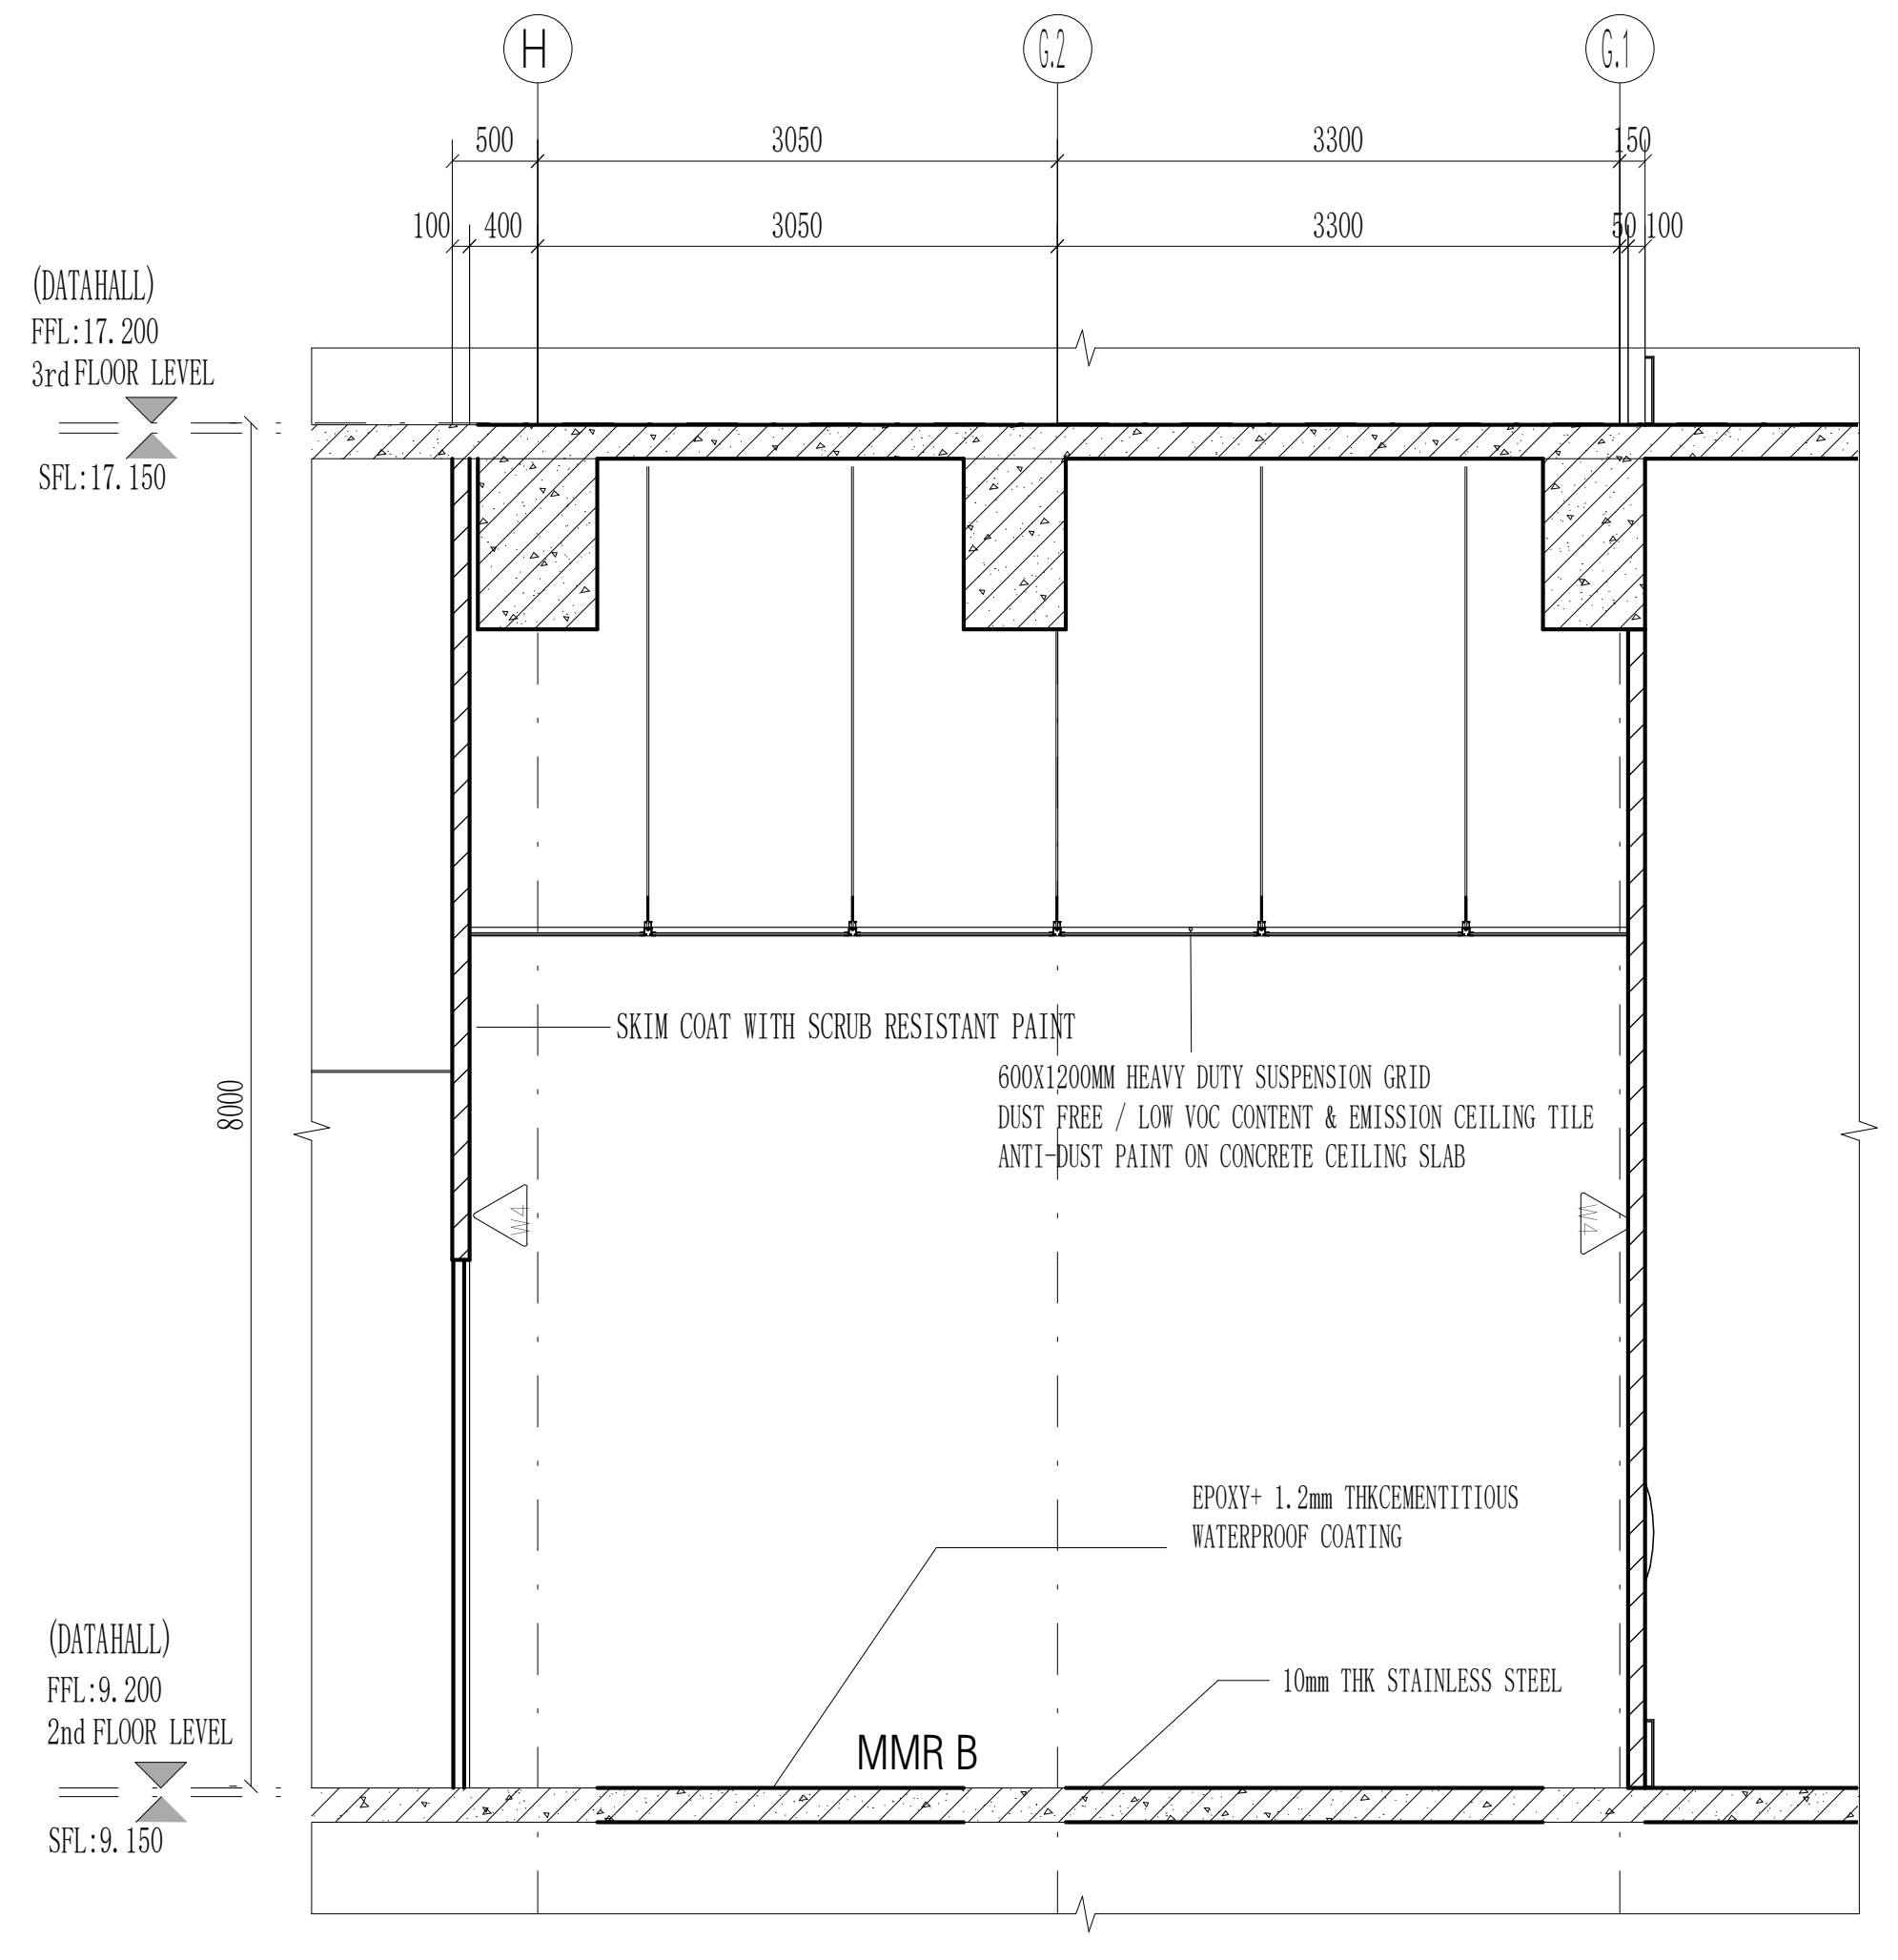
H
G.2
G.1
500
3050
3300
150
100
400
50
(DATAHALL)
FFL:17.200
3rd FLOOR LEVEL
SFL:17.150
8000
SKIM COAT WITH SCRUB RESISTANT PAINT
600X1200MM HEAVY DUTY SUSPENSION GRID
DUST FREE / LOW VOC CONTENT & EMISSION CEILING TILE
ANTI-DUST PAINT ON CONCRETE CEILING SLAB
W4
EPOXY+ 1.2mm THKCEMENTITIOUS
WATERPROOF COATING
10mm THK STAINLESS STEEL
(DATAHALL)
FFL:9.200
2nd FLOOR LEVEL
SFL:9.150
MMR B

MMR B SECTION B-B

Scale 1:50

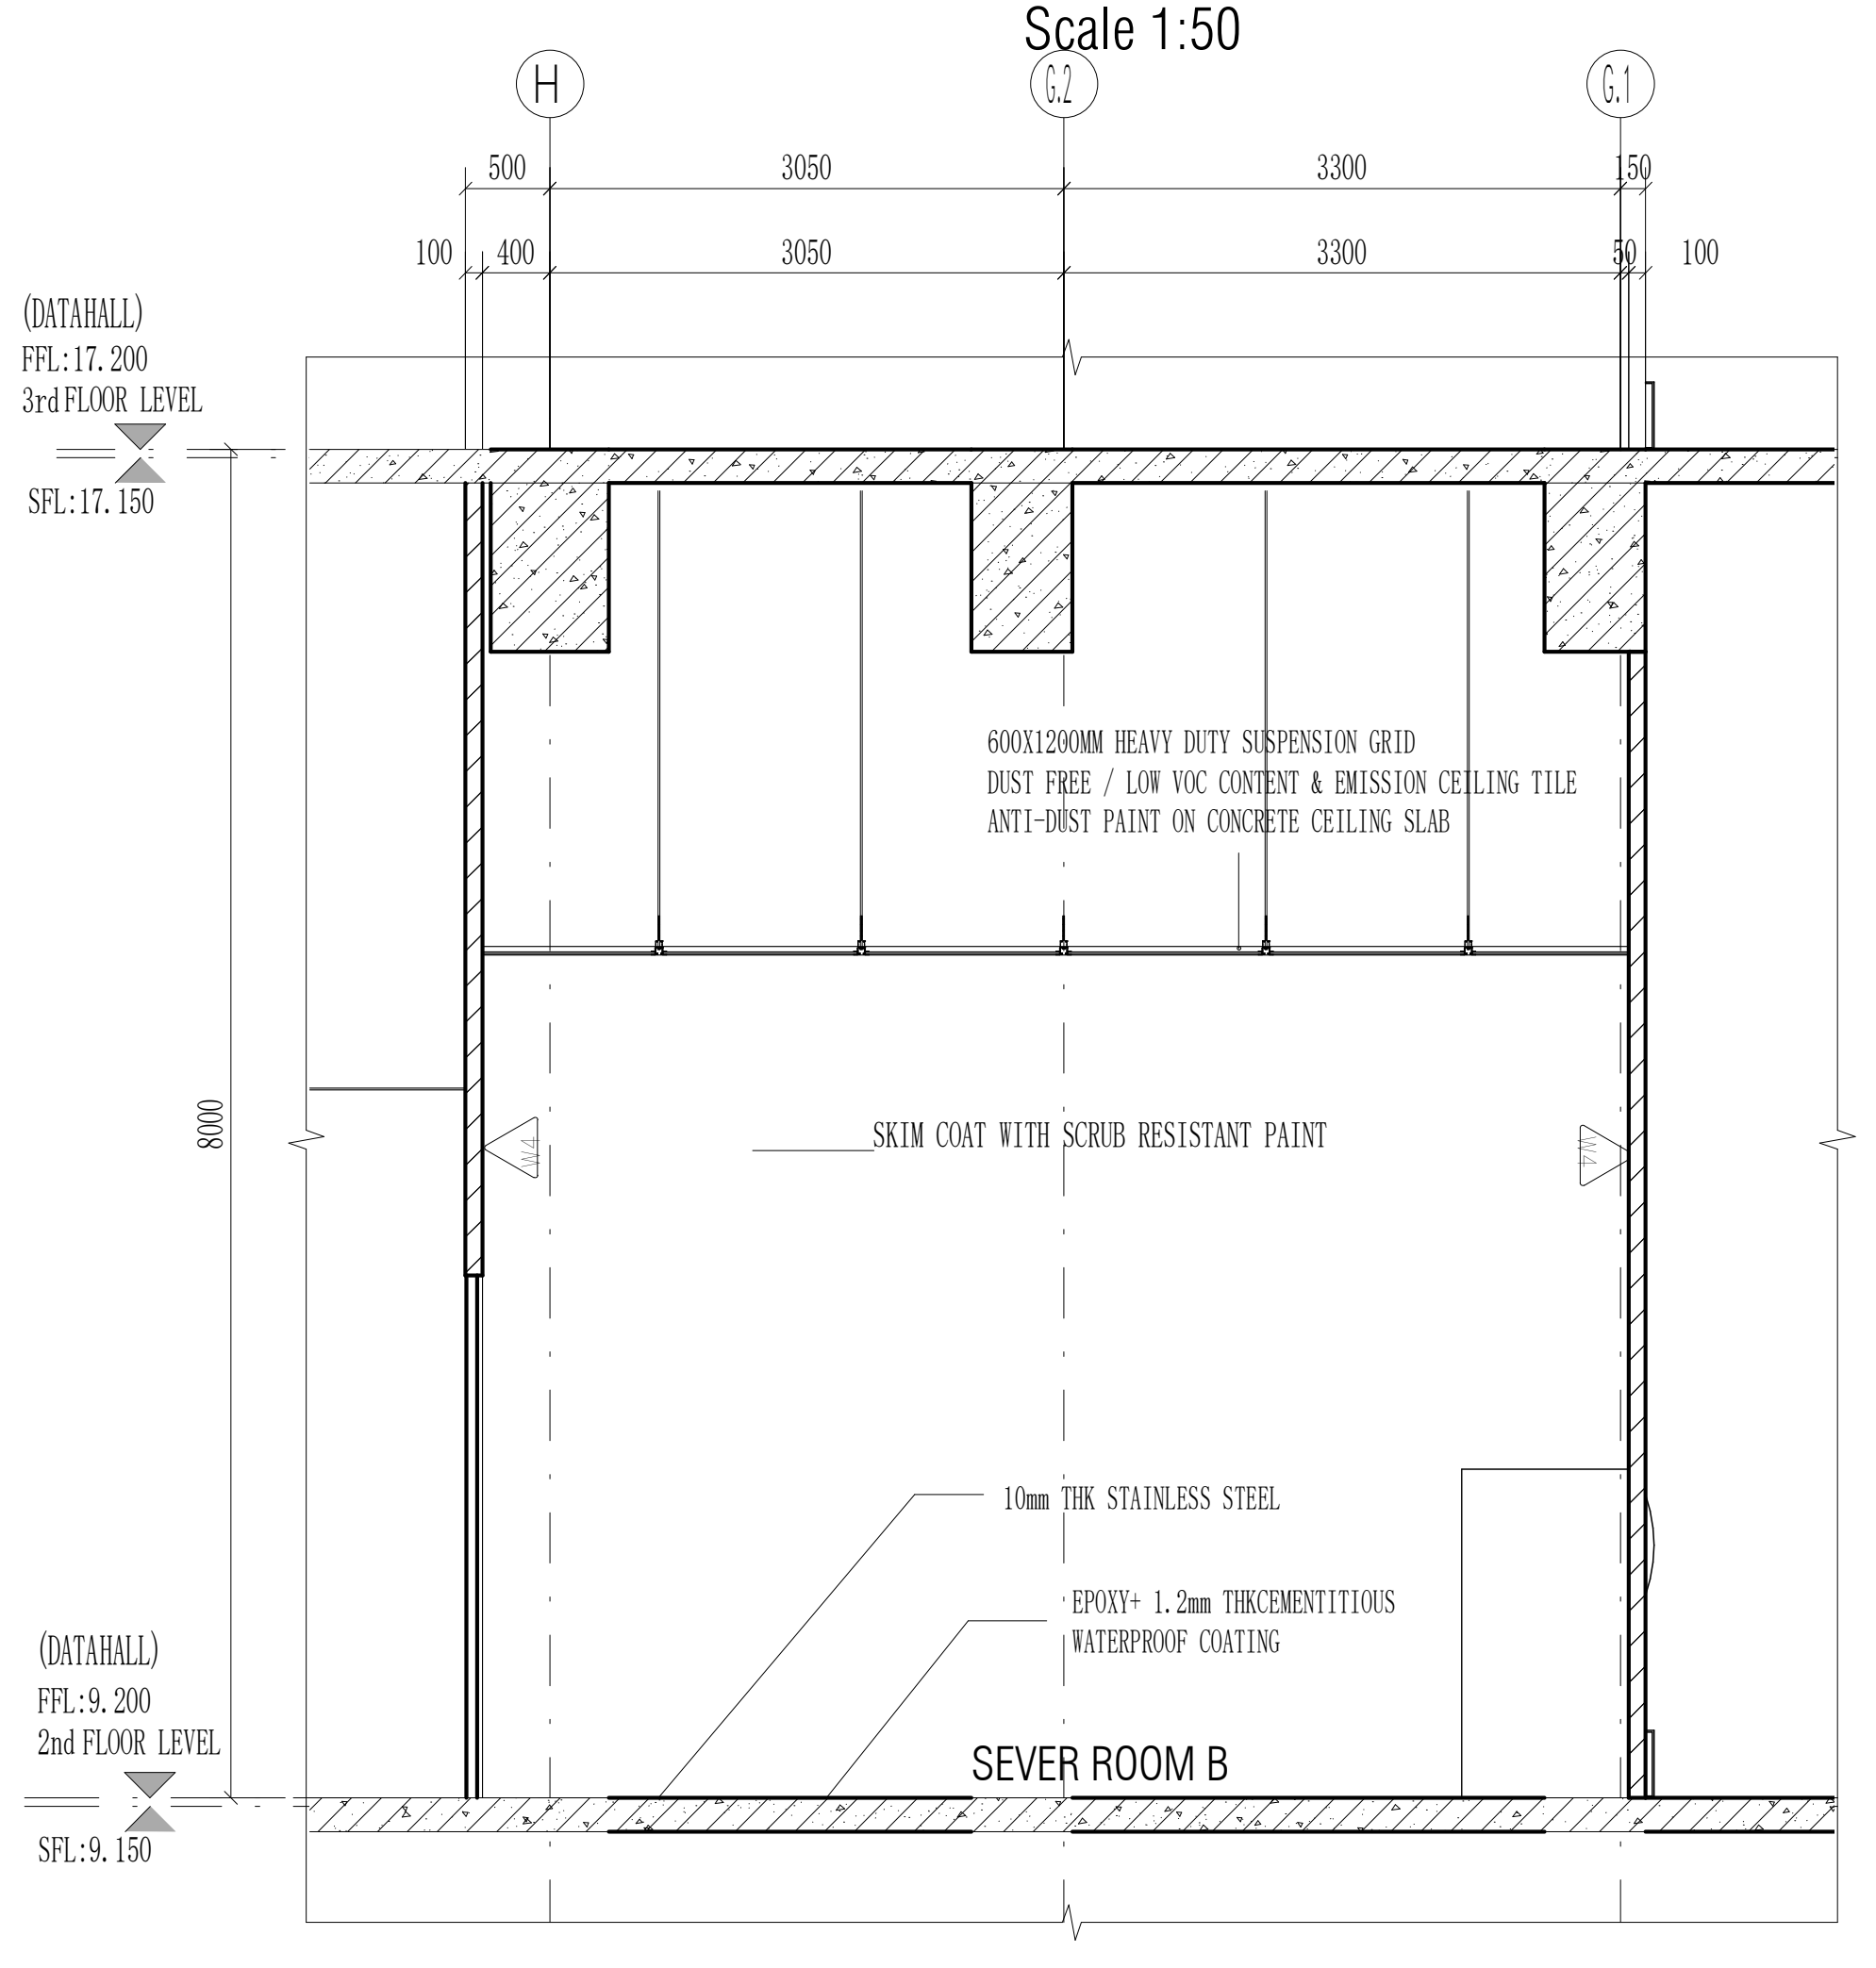
H
G.2
G.1
500
3050
3300
150
100
400
50
(DATAHALL)
FFL:17.200
3rd FLOOR LEVEL
SFL:17.150
600X1200MM HEAVY DUTY SUSPENSION GRID
DUST FREE / LOW VOC CONTENT & EMISSION CEILING TILE
ANTI-DUST PAINT ON CONCRETE CEILING SLAB
8000
W4
SKIM COAT WITH SCRUB RESISTANT PAINT
10mm THK STAINLESS STEEL
EPOXY+ 1.2mm THKCEMENTITIOUS
WATERPROOF COATING
(DATAHALL)
FFL:9.200
2nd FLOOR LEVEL
SFL:9.150
SEVER ROOM B

SERVER ROOM B SECTION C-C

Scale 1:50

CLIENT :

GULF EDGE DC 01

87 Wireless Road, M Thai Tower 11th. Floor, All Seasons Place, Lumpini,
Pathumwan, Bangkok 10330, Thailand

CONTRACTOR :

华西发展(泰国)有限公司
บริษัท หัวซือ ดีเวลลอปเม้นต์ (ประเทศไทย) จำกัด
HUASHI DEVELOPMENT CO.,LTD
No. 202, Room No. 1403, 14/F, Le Concorde Building,
Ratchadapisek Road, Huaykhwang Sub-District,
Huaykhwang District, Bangkok Metropolitan 10310.

CONSULTANT :

ARbay
บริษัท เอ อาร์ เบย์ จำกัด
ARbay Company Limited
31 st Floor Bangkok Insurance Building
25 South Sathorn road Thungmahamek
Sathorn Bangkok 10120 THAILAND
T +66 (0) 2286 8199
F +66 (0) 2286 2863
info@arbay.co.th

CONSULTANT :

Qbic Engineers & Architects Co.,Ltd.
8 Soi KALONG 4 SANAMBINNAM ROAD,
THASAI SUB-DISTRICT, MUANG NONTHABURI DISTRICT
, NONTHABURI.
Tel 662-950-4374
Fax 662-580-3231
E-Mail : qbic@qbic.co.th, www.qbic.co.th
QBIC ENGINEERS AND ARCHITECTS CO.,LTD.

CONSULTANT :

MITR
MITR TECHNICAL CONSULTANT CO.,LTD.
1168/8 12th FLOOR, LUMPINI TOWER BUILDING,
RAMA IV RD., THUNGMAHAMEK, SATHORN, BANGKOK 10120, THAILAND
TEL : 0-2679-9079-84
FAX : 0-2679-9085 E-mail: mitr_dd@mitr.com

Architect :	SIGNATURE
ประกิต พนานุรัตน์ วสถ. 580 ที่อยู่ 251/1 ถ.จารุเมือง แขวงรองเมือง เขตปทุมวัน กรุงเทพมหานคร โทรศัพท์ 02-286-8199	
Structural Engineer :	SIGNATURE
วิศวกรผู้ออกแบบโครงสร้าง	
ณัฐสม สงวนวงษ์ วย 1423 ที่อยู่ 2/1 ซ.รามคำแหง 150 ถ.รามคำแหง แขวง สะพานสูง เขต สะพานสูง กทม. 10240	ณัฐสม สงวนวงษ์
Structural Inspector :	SIGNATURE
วิศวกรผู้ตรวจสอบโครงสร้าง	
โกมล จุฑาภัทร วย 964 ที่อยู่ 24/18 ซ.นวมินทร์ 129 ถ. นวมินทร์ แขวง นวลจันทร์ เขต บึงกุ่ม กทม. 10230	
Electrical Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบไฟฟ้ากำลัง	
นายสุภัทร บูรณวิทย์ วฟก.1265 ที่อยู่ 21 ซอยทานสัมฤทธิ์ 13 ตำบลท่าทราย อ.เมืองนนทบุรี จ.นนทบุรี 11000	
Mechanical Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบเครื่องกลและปรับอากาศ	
นายประสิทธิ์ เกี้ยวสุนทร วก.1221 ที่อยู่ 44/372 ซอยบางกระดี่ 35/1 แขวงแสมดำ เขตบางขุนเทียน กทม. 10150	ประสิทธิ์
Sanitary Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบสุขาภิบาล และดับเพลิง	
นายทศวรรษ สนั่นฤทธิ์ วส. 215 ที่อยู่ บ้านเลขที่ 99/107 หมู่ที่ 3 ต.ศีรษะจรเข้น้อย อ.บางเสาธง จ.สมุทรปราการ 10540	ทศวรรษ

ISSUE/REVISION

REV.	DESCRIPTION	DATE
A	90% DEVELOPED	09/05/2026

PROJECT NAME :

GEDC 01

LOCATION:
Nikhom Phattana district, Rayong ,industrial estate,CPGC

BUILDING :
MAIN BUILDING

90% DEVELOPED

TITLE :

ROOMDETAIL-2F-OFFICE,MEETINGROOM01、MMRB、
SEVER ROOM B

JOB NO.		SCALE	1 : 50
DRAWN	LYT	REF.	
CHECKED	LJC	DWG. NO.	
APPROVED	LXD		MPK01A-90-A-RD-214
DATE	2026.05.09		

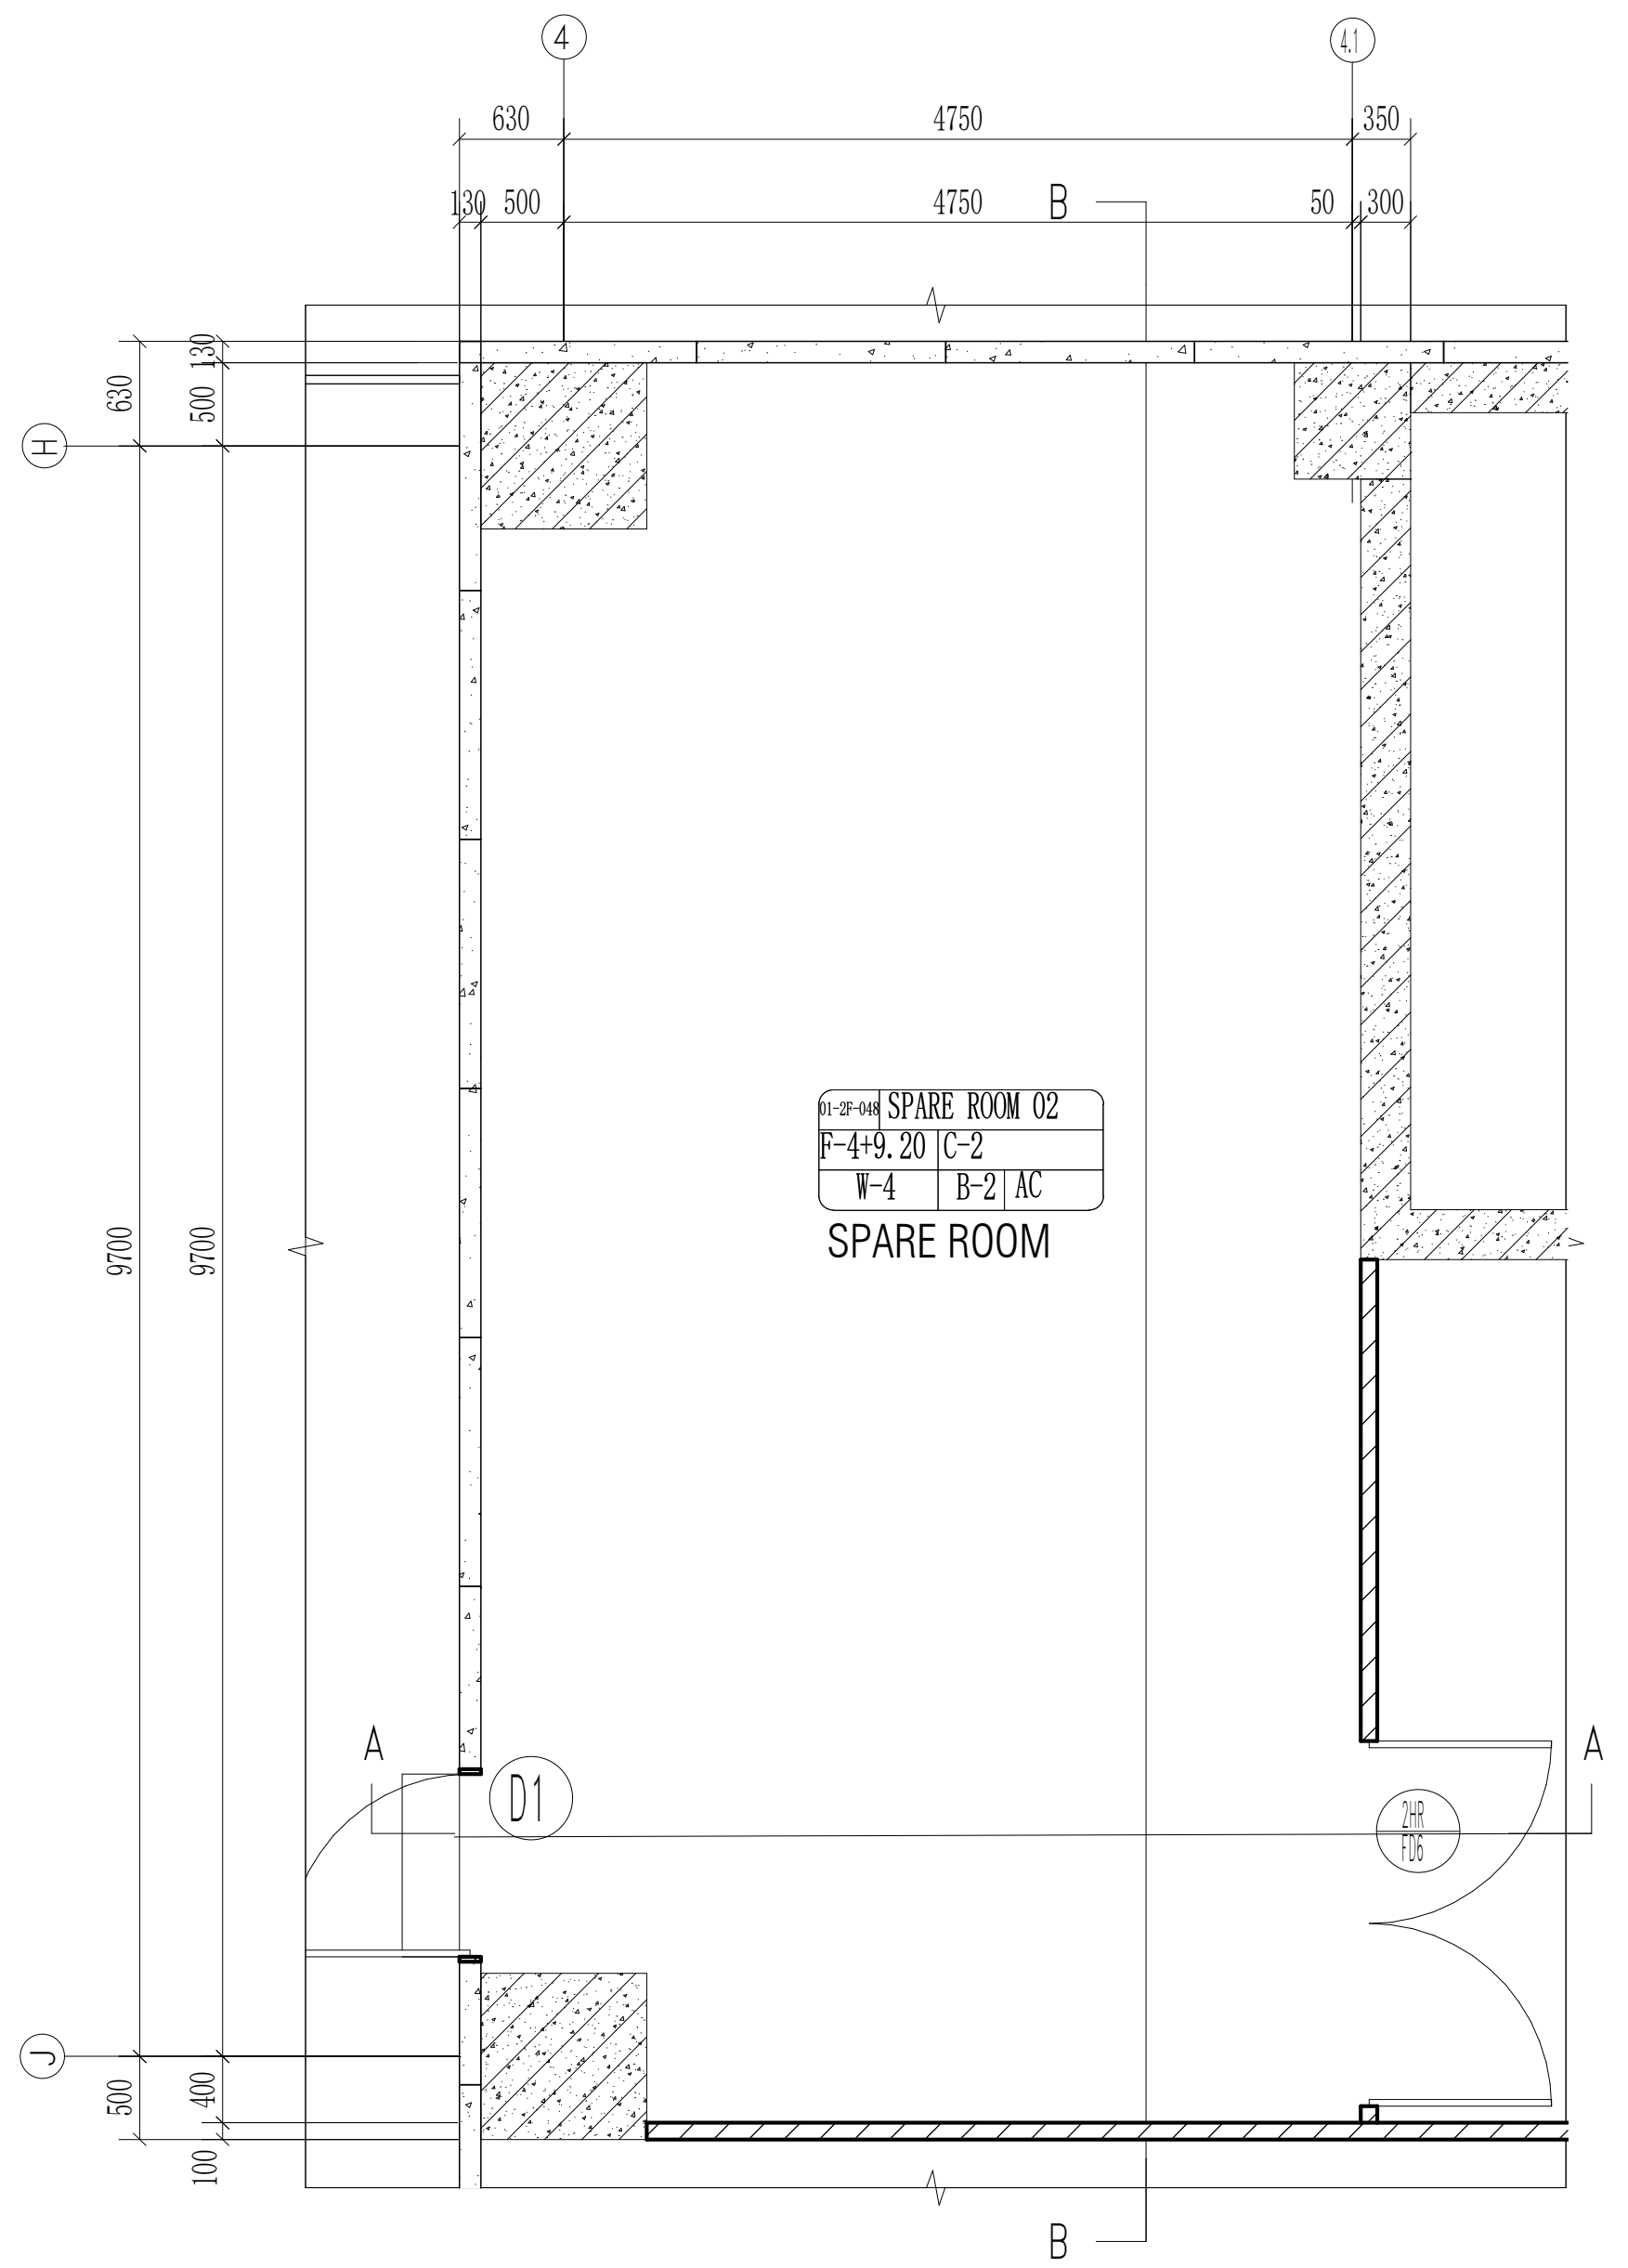

SPARE ROOM 02 FLOOR PLAN

Scale 1:50

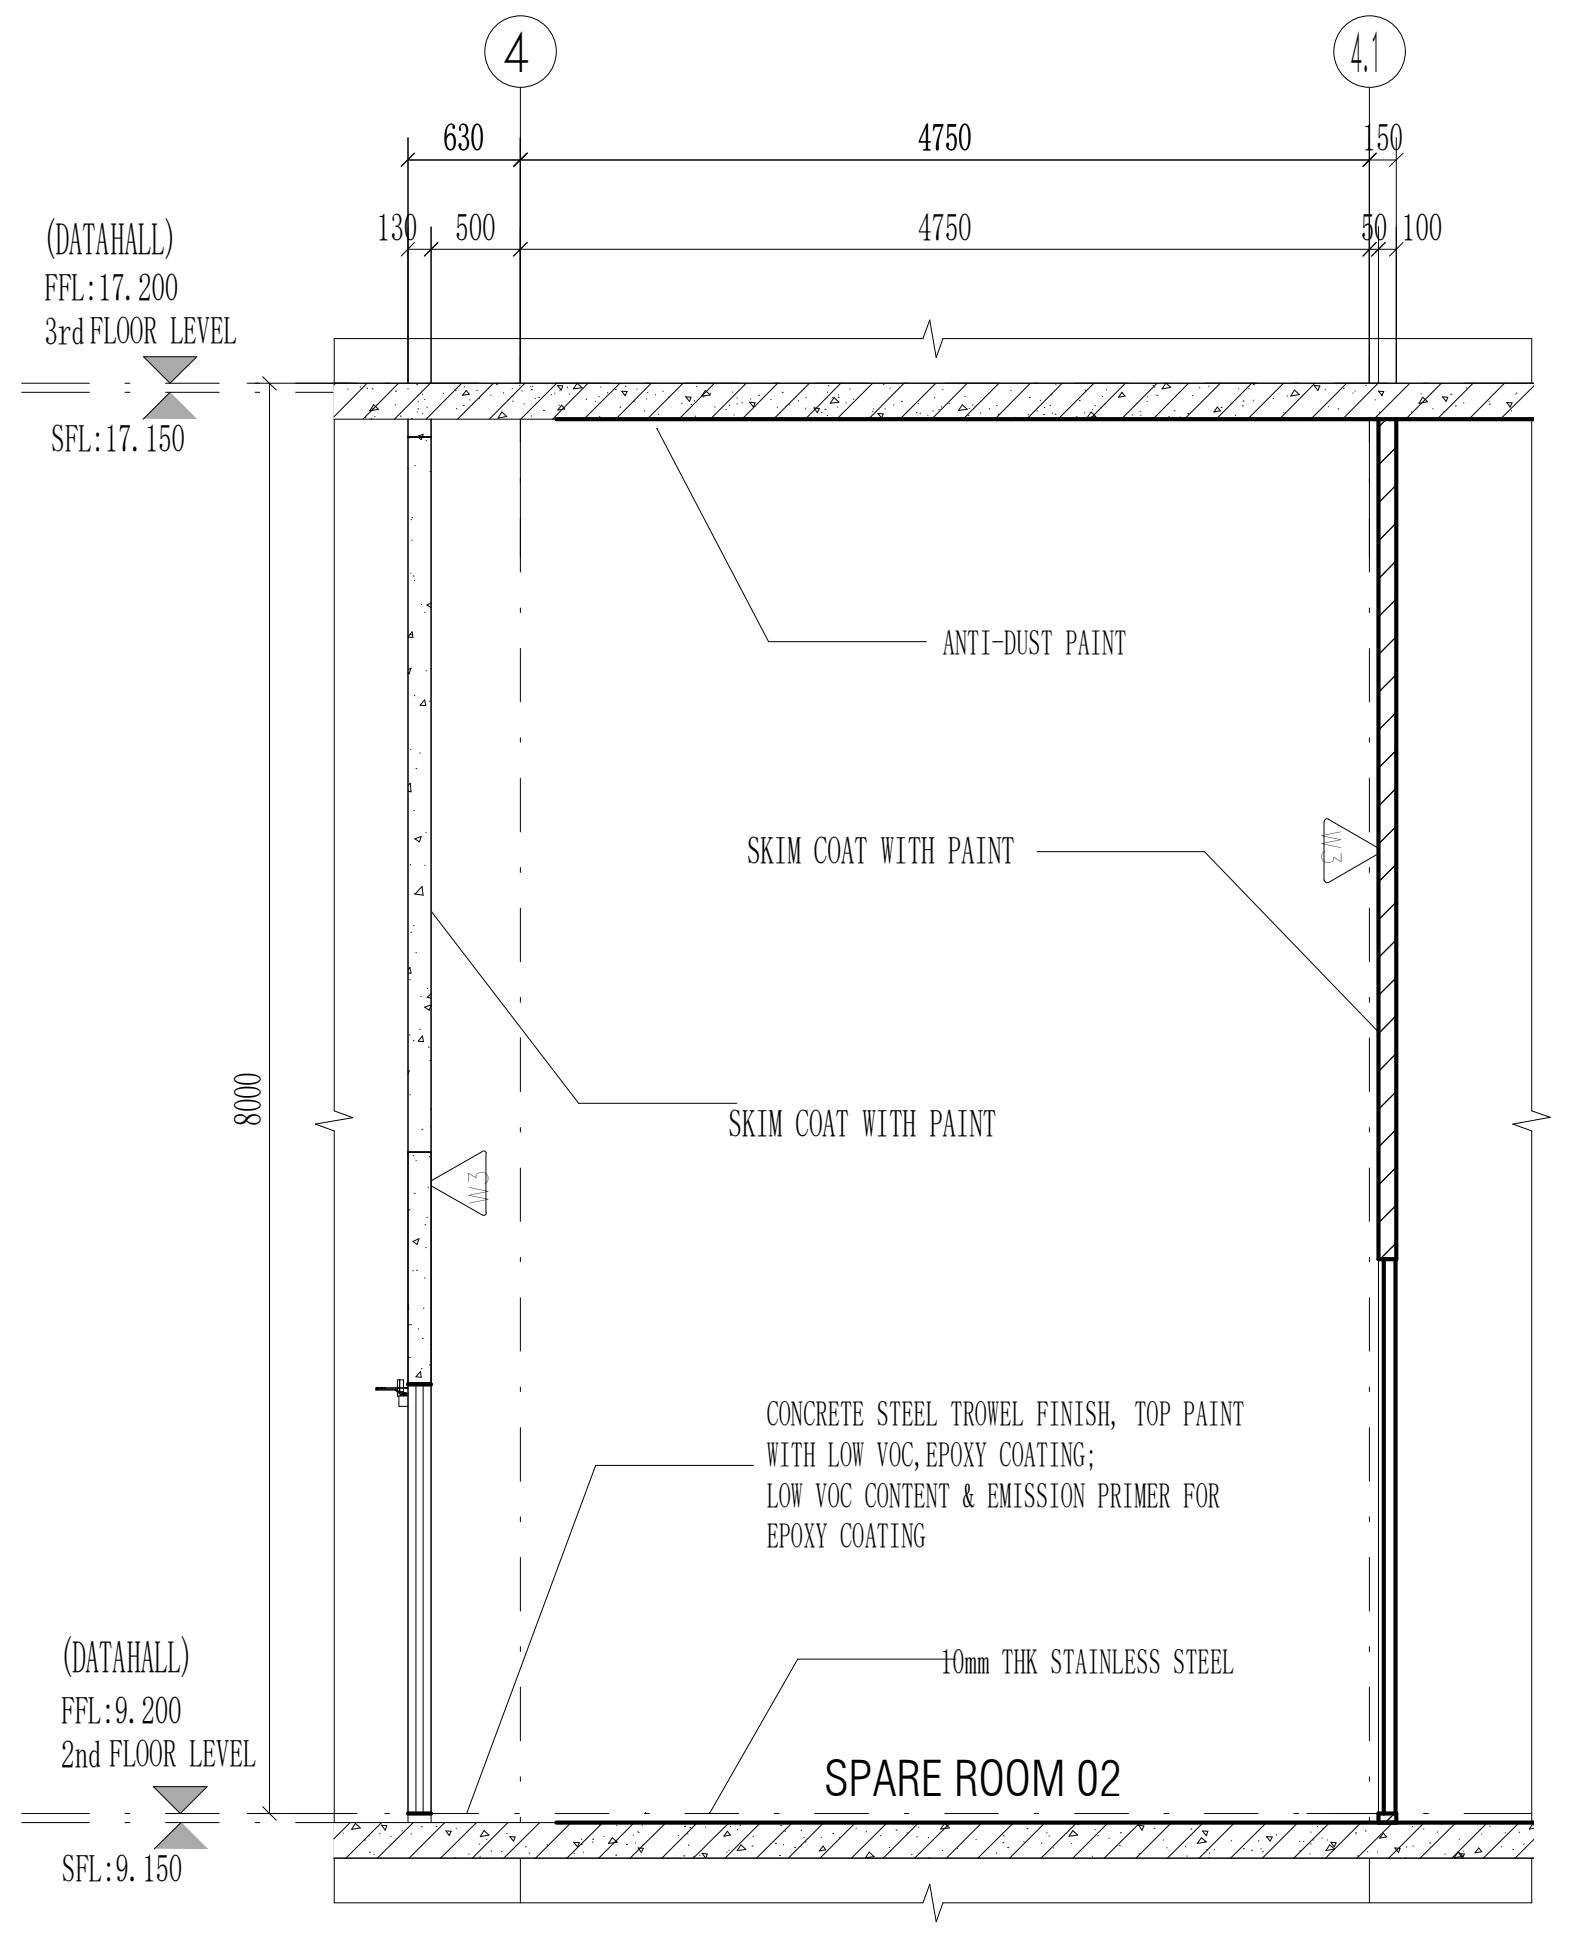

SPARE ROOM 02 SECTION A-A

Scale 1:50

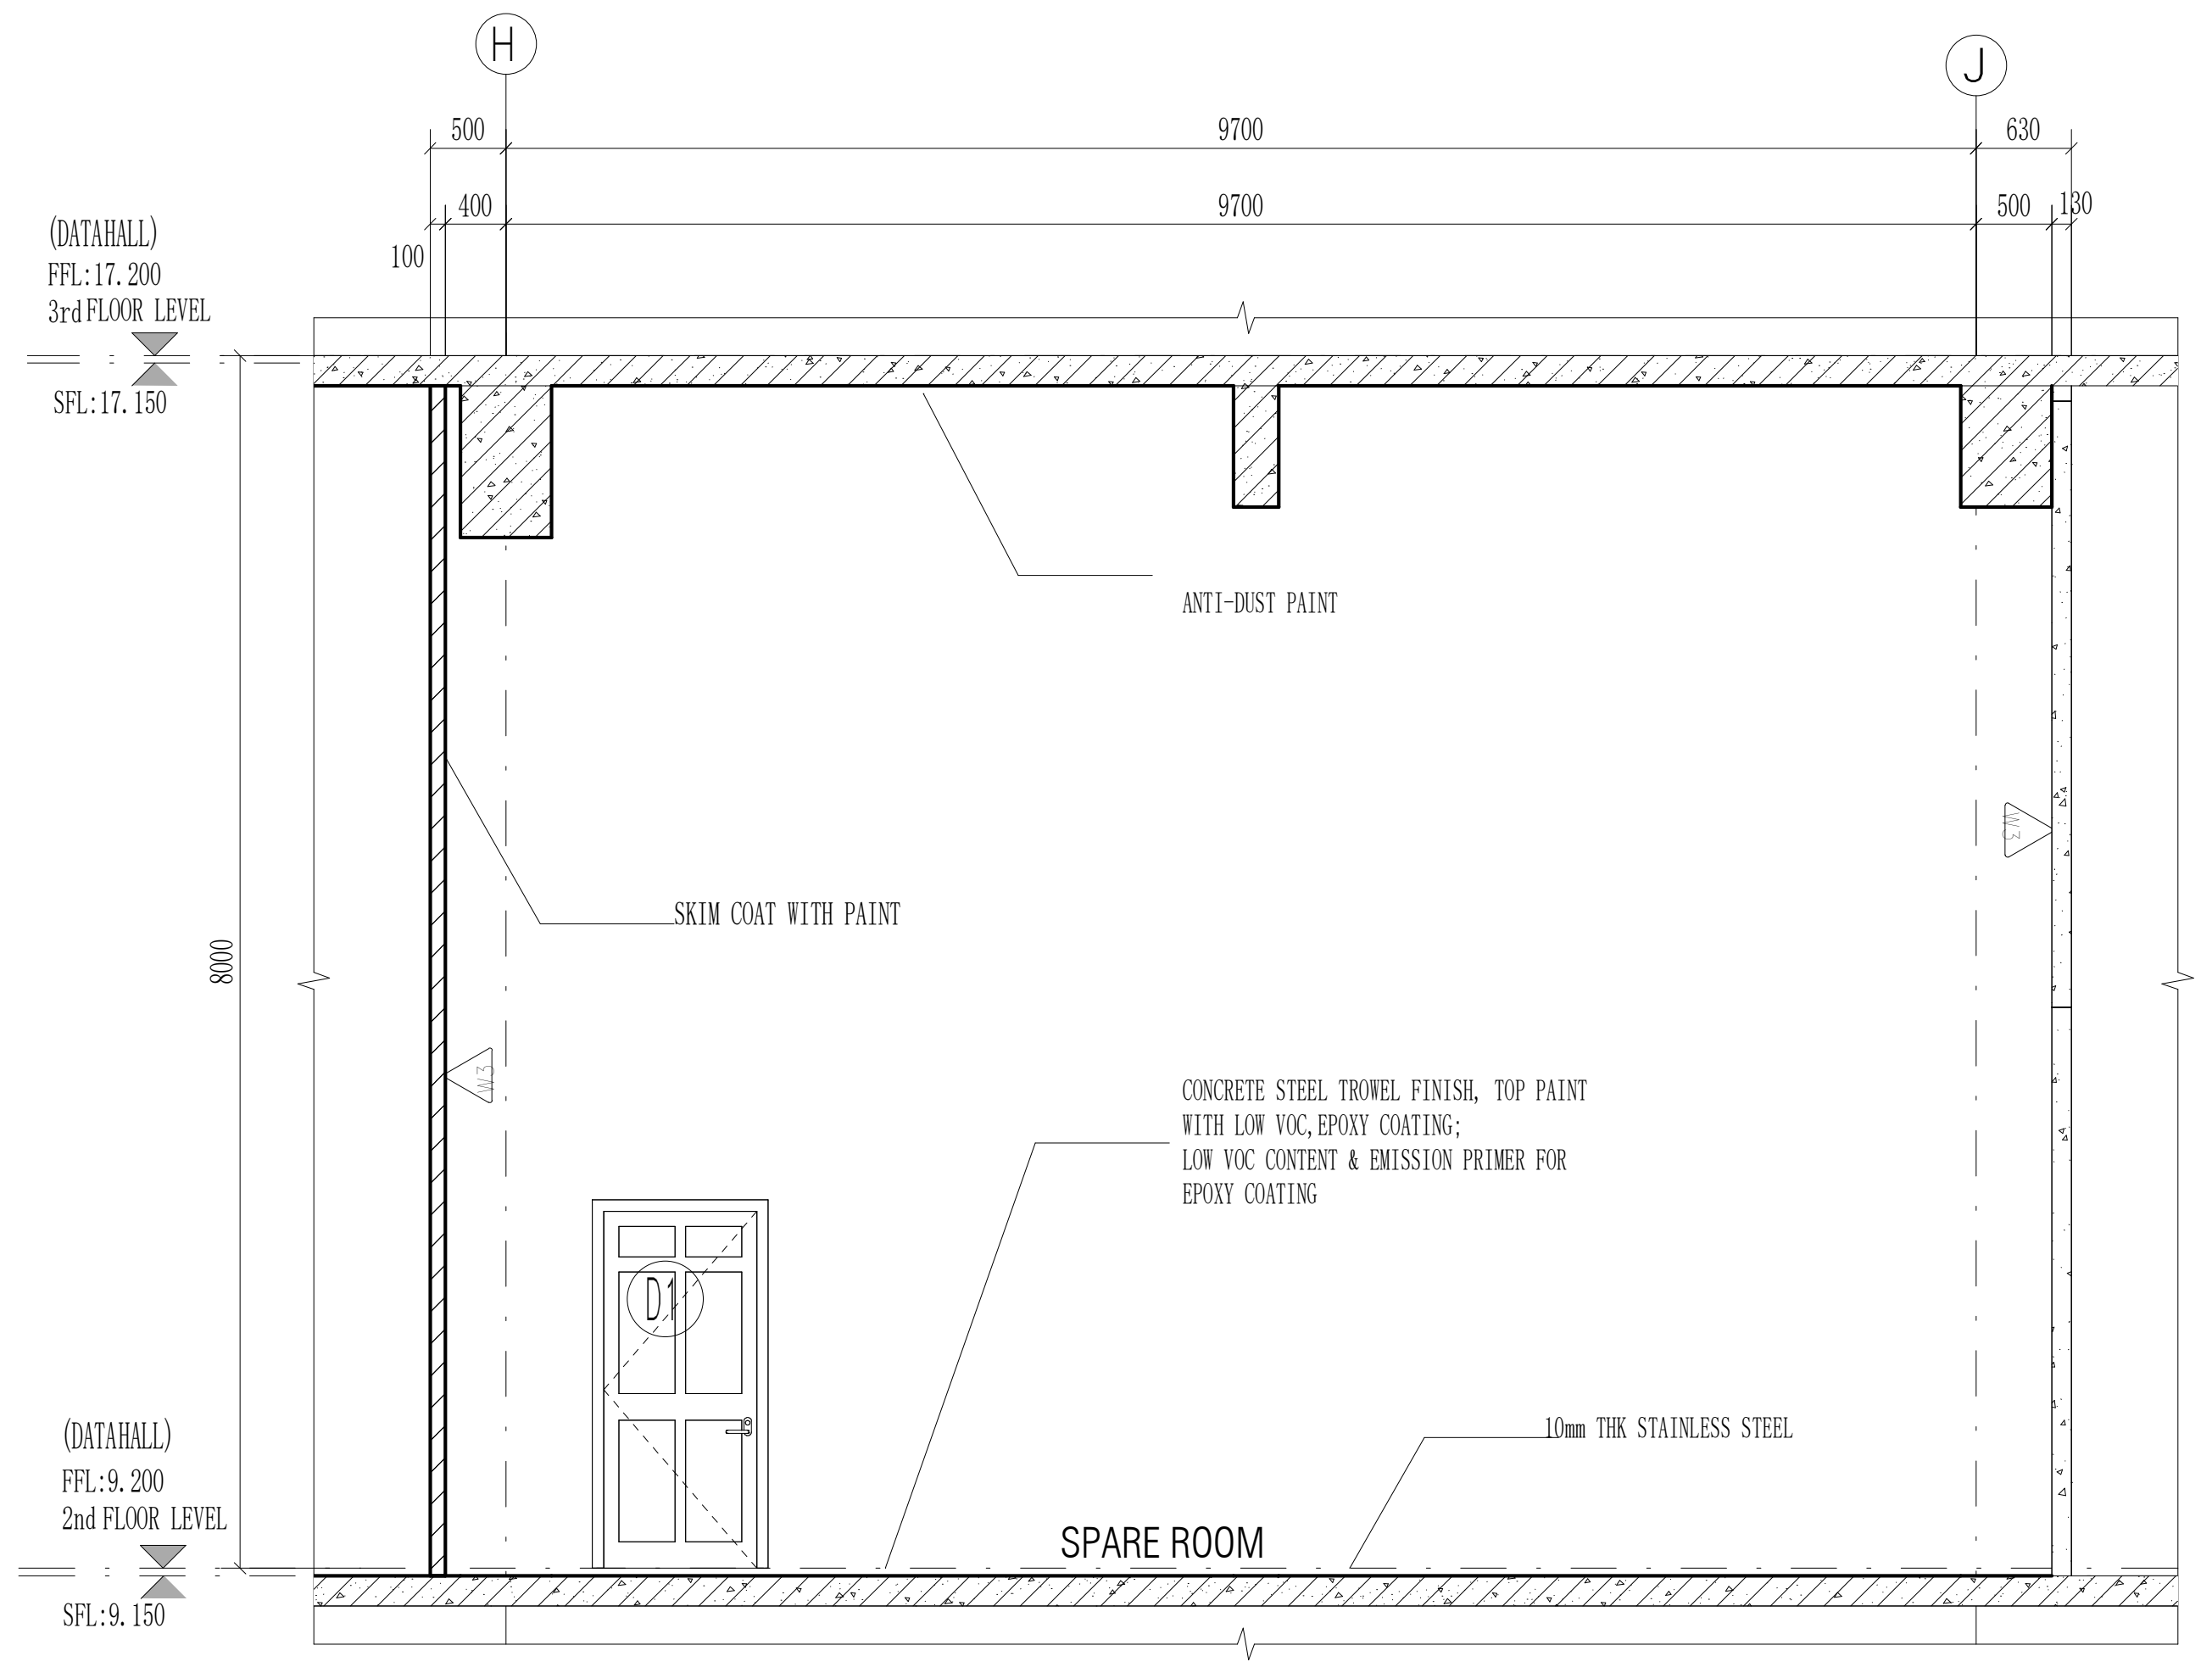

SPARE ROOM 02 SECTION B-B

Scale 1:50

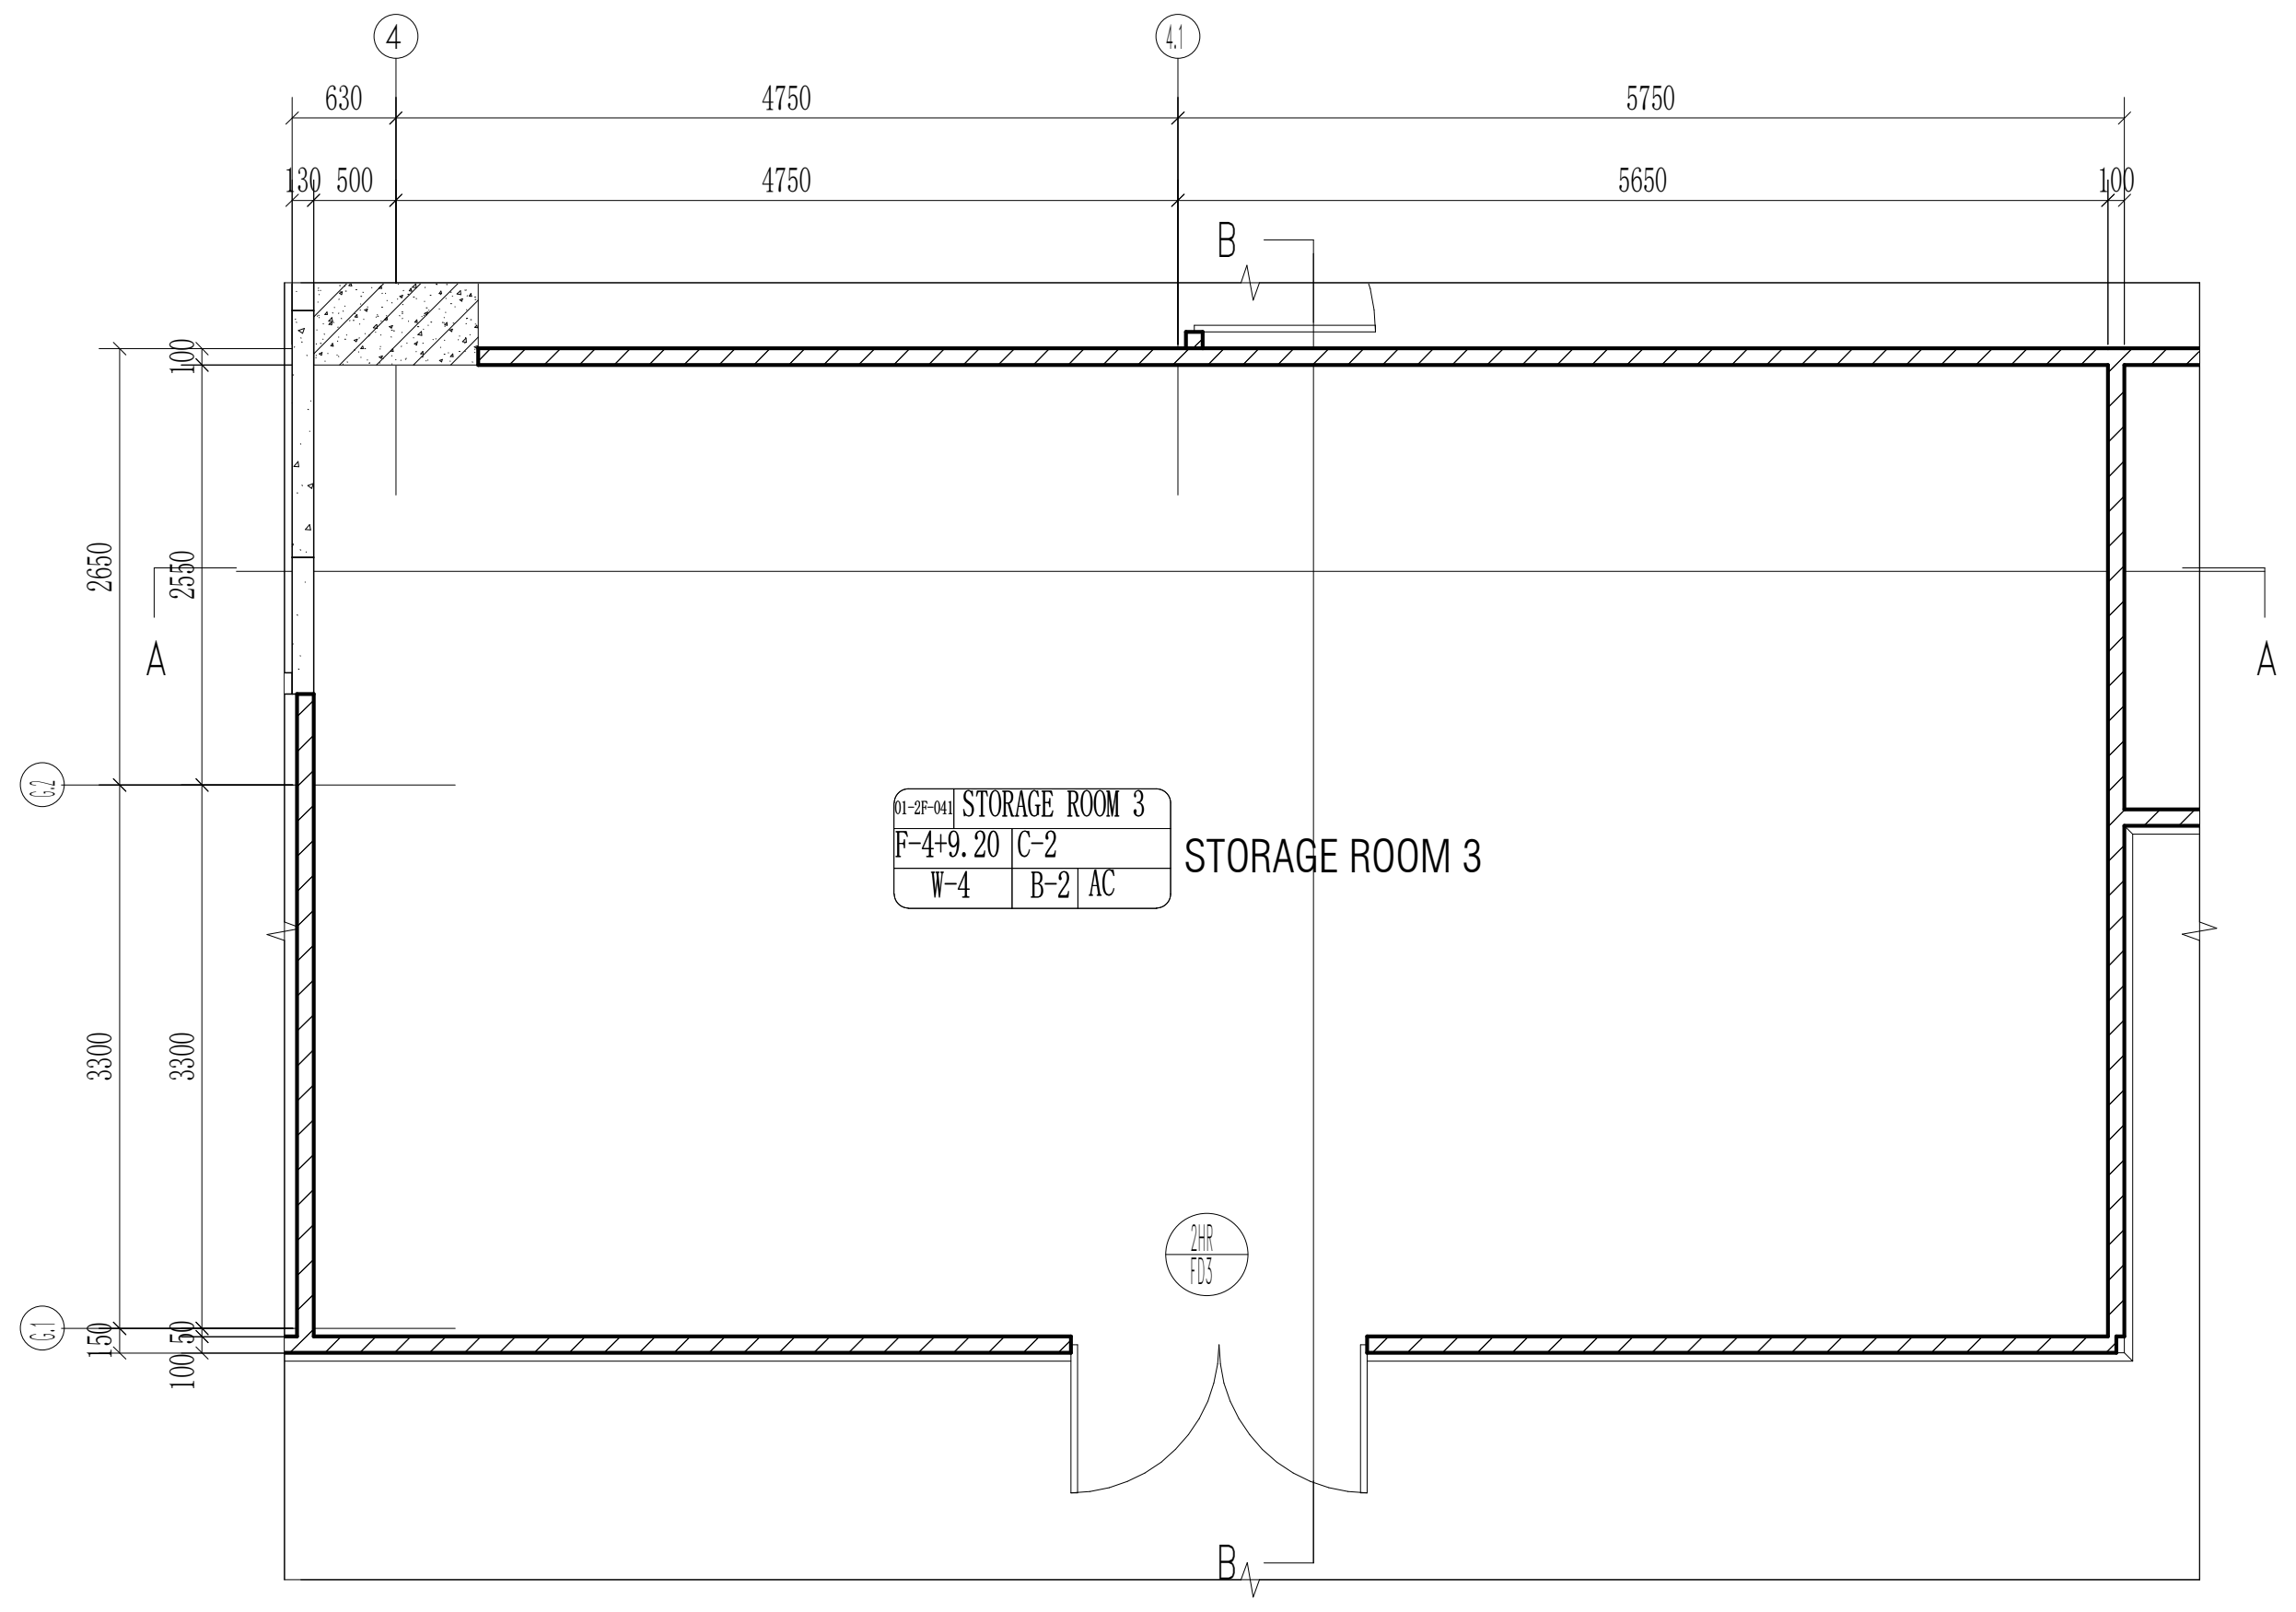

STORAGE ROOM 3 FLOOR PLAN

Scale 1:50

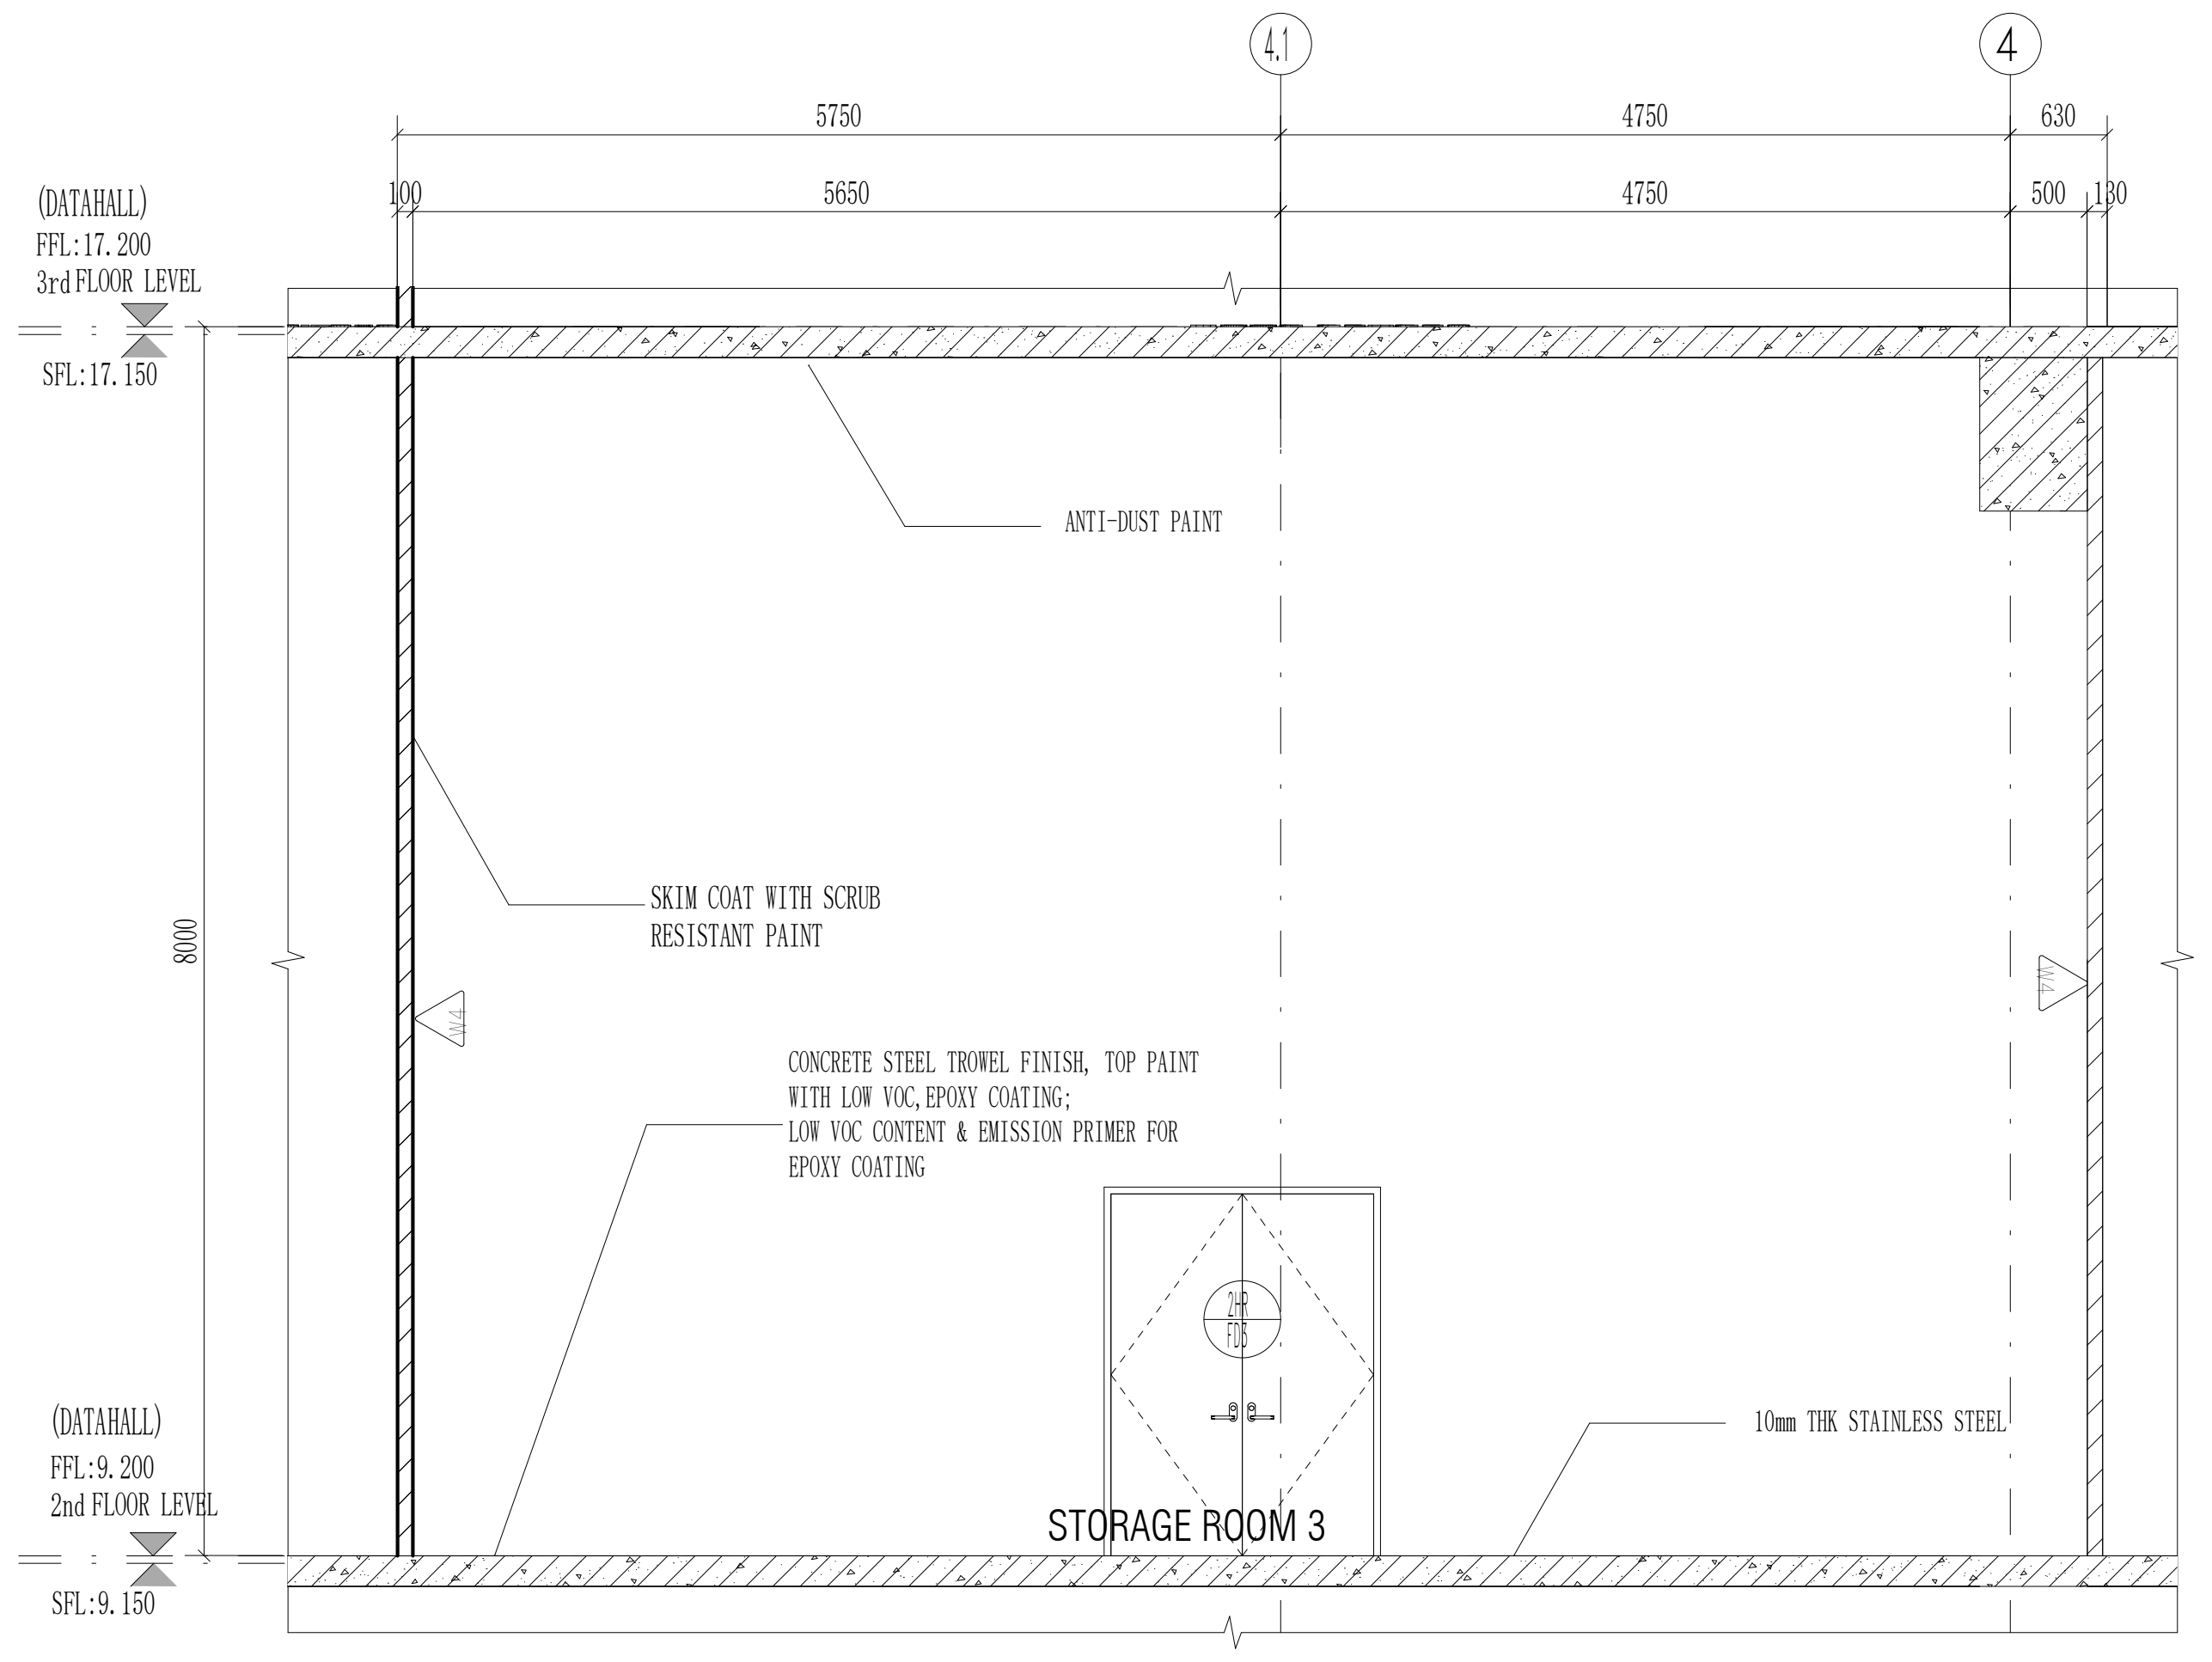

STORAGE ROOM 3 SECTION A-A

Scale 1:50

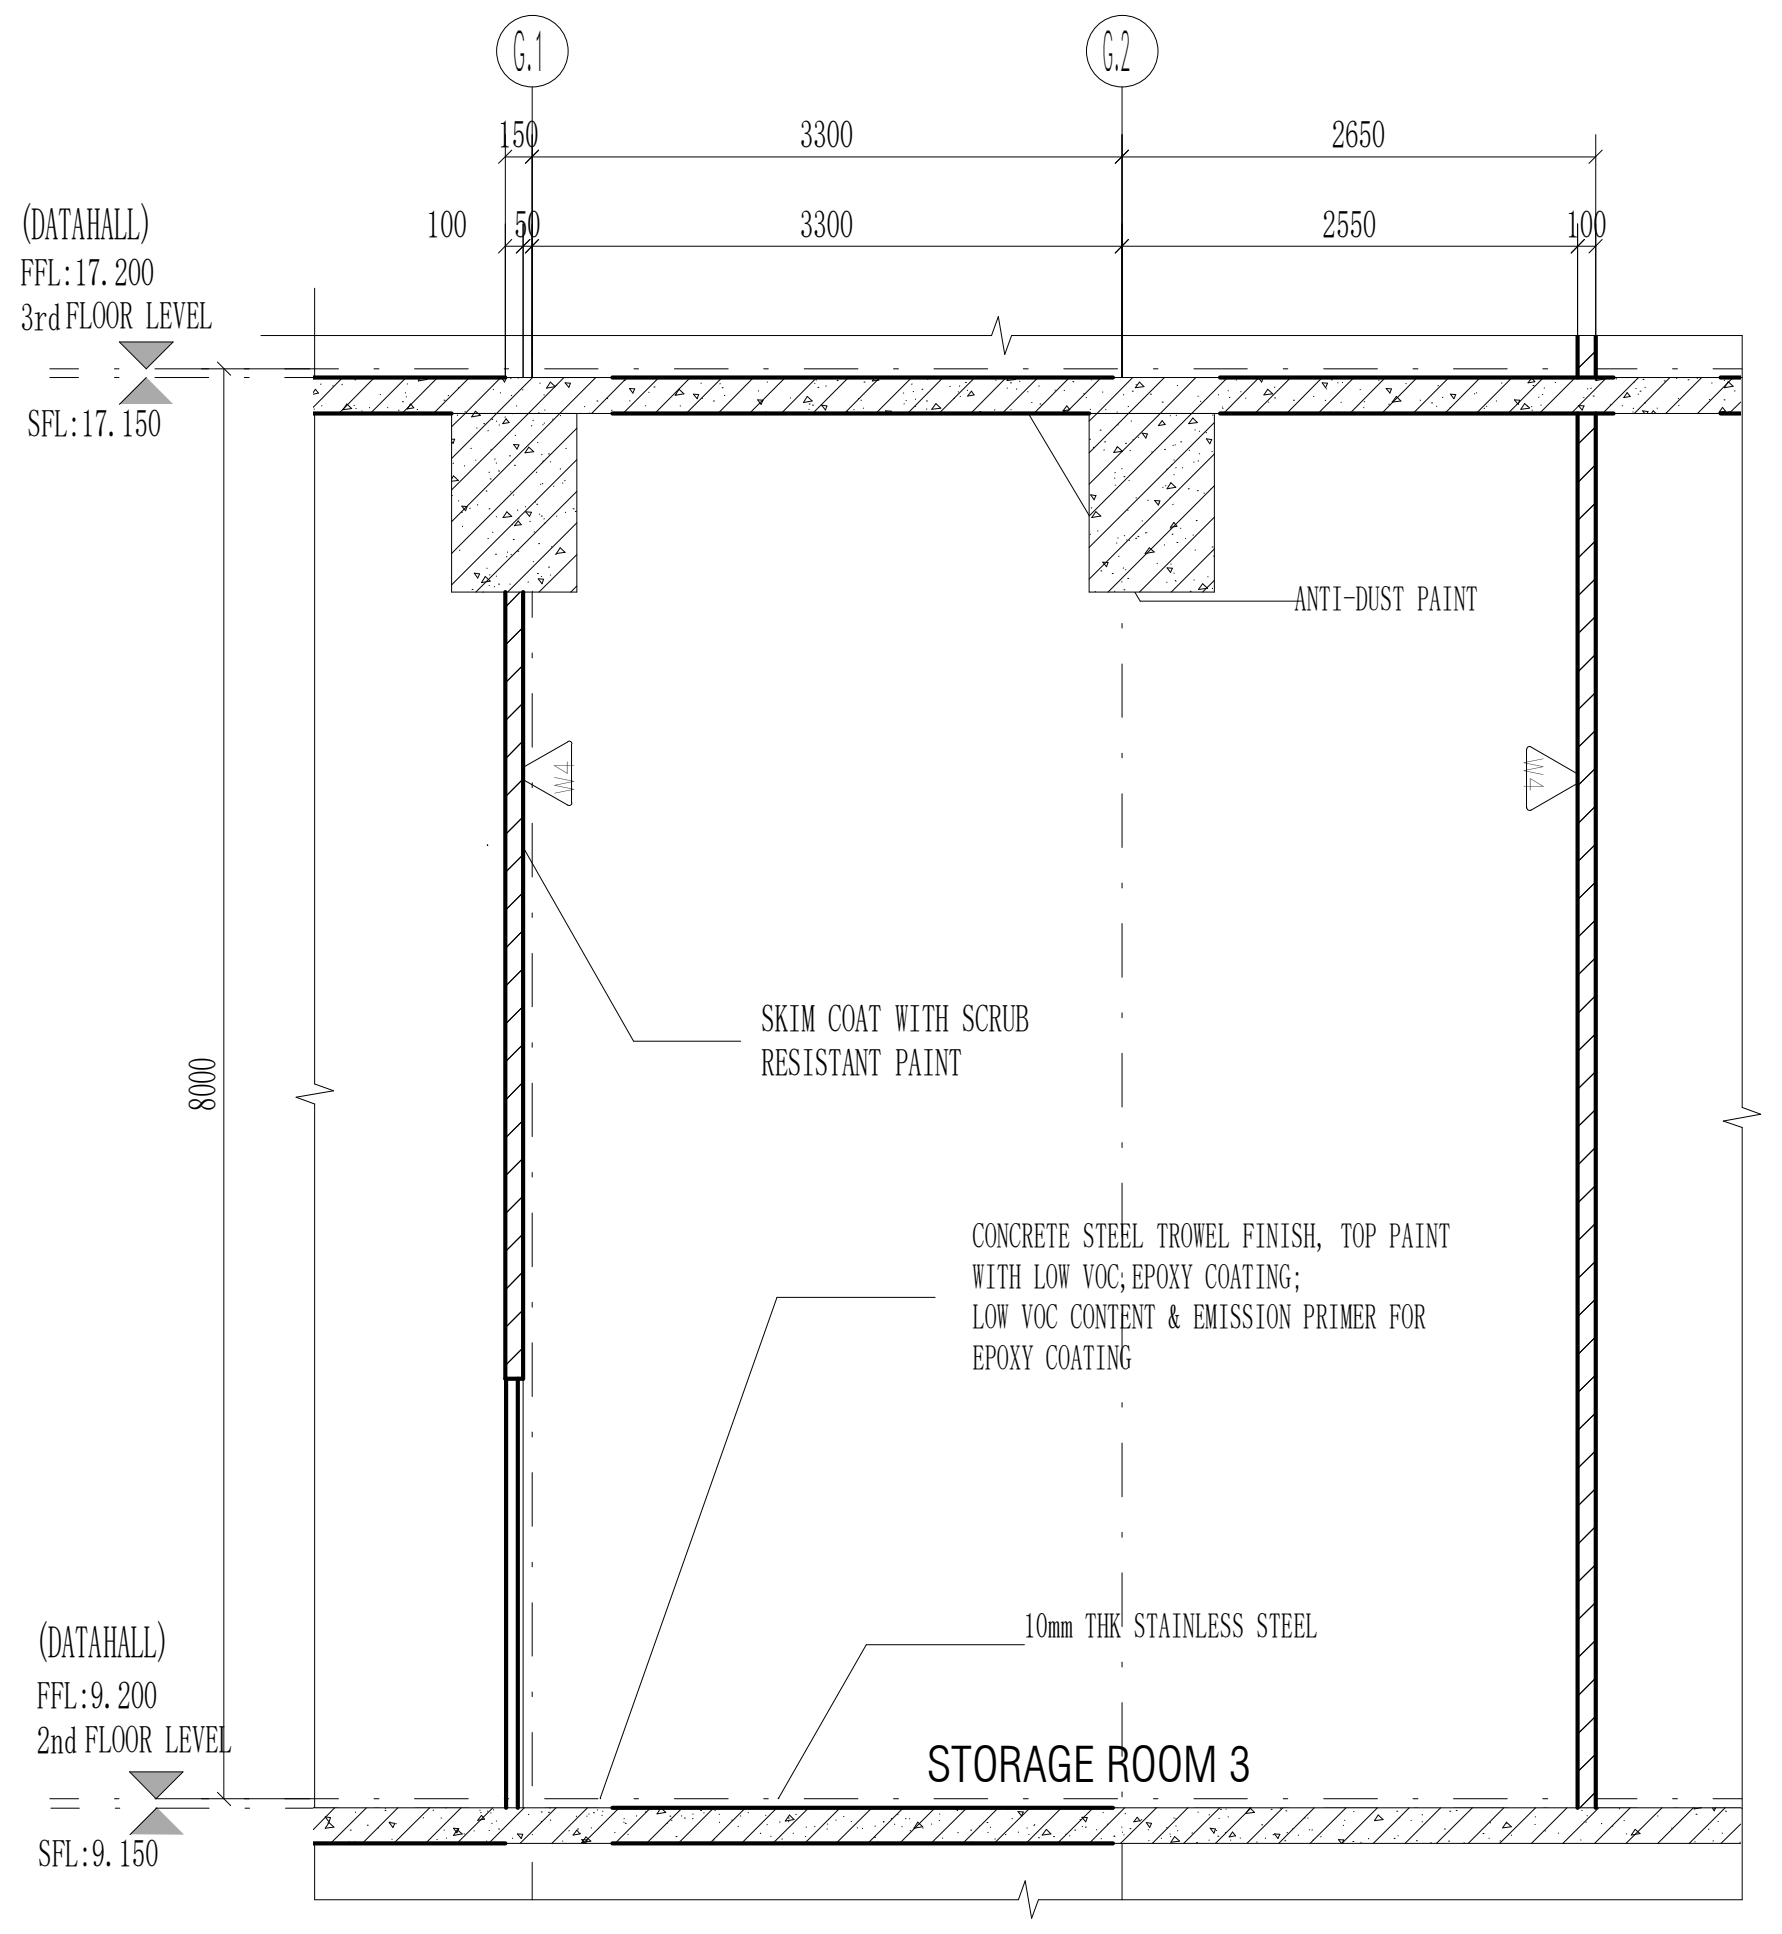

STORAGE ROOM 3 SECTION B-B

Scale 1:50

CLIENT :

GULF EDGE DC 01

87 Wireless Road, M Thai Tower 11th. Floor, All Seasons Place, Lumpini,
Pathumwan, Bangkok 10330, Thailand

CONTRACTOR :

华西发展(泰国)有限公司
บริษัท หัวซือ ดีเวลลอปเม้นต์ (ประเทศไทย) จำกัด
HUASHI DEVELOPMENT CO.,LTD
No. 202, Room No. 1403, 14/F, Le Concorde Building,
Ratchadapisek Road, Huaykhwang Sub-District,
Huaykhwang District, Bangkok Metropolitan 10310.

CONSULTANT :

ARbay
บริษัท เอ อาร์ เบย์ จำกัด
ARbay Company Limited
31 st Floor Bangkok Insurance Building
25 South Sathorn road Thungmahamek
Sathorn Bangkok 10120 THAILAND
T +66 (0) 2286 8199
F +66 (0) 2286 2863
info@arbay.co.th

CONSULTANT :

Qbic Engineers & Architects Co.,Ltd.
8 Soi KALONG 4 SANAMBINNAM ROAD,
THASAI SUB-DISTRICT, MUANG NONTHABURI DISTRICT
, NONTHABURI.
Tel 662-950-4374
Fax 662-580-3231
E-Mail : qbic@qbic.co.th, www.qbic.co.th
QBIC ENGINEERS AND ARCHITECTS CO.,LTD.

CONSULTANT :

MITR
MITR TECHNICAL CONSULTANT CO.,LTD.
1168/8 12th FLOOR, LUMPINI TOWER BUILDING,
RAMA IV RD., THUNGMAHAMEK, SATHORN, BANGKOK 10120, THAILAND
TEL : 0-2679-9079-84
FAX : 0-2679-9085 E-mail: mitr_dd@mitr.com

Architect :	SIGNATURE
ประกิต พนานุรัตน์ วสถ. 580 ที่อยู่ 251/1 ถ.จารุเมือง แขวงรองเมือง เขตปทุมวัน กรุงเทพมหานคร โทรศัพท์ 02-286-8199	

Structural Engineer :	SIGNATURE
วิศวกรผู้ออกแบบโครงสร้าง	
ณัฐสม สงวนวงษ์ วย 1423 ที่อยู่ 2/1 ซ.รามคำแหง 150 ถ.รามคำแหง แขวง สะพานสูง เขต สะพานสูง กทม. 10240	ณัฐสม สงวนวงษ์

Structural Inspector :	SIGNATURE
วิศวกรผู้ตรวจสอบโครงสร้าง	
โกมล จุฑาภัทร วย 964 ที่อยู่ 24/18 ซ.นวมินทร์ 129 ถ. นวมินทร์ แขวง นวลจันทร์ เขต บึงกุ่ม กทม. 10230	

Electrical Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบไฟฟ้ากำลัง	
นายสุภัทร บูรณวิทย์ วฟก.1265 ที่อยู่ 21 ซอยทานสัมฤทธิ์ 13 ตำบลท่าทราย อ.เมืองนนทบุรี จ.นนทบุรี 11000	สุภัทร บูรณวิทย์

Mechanical Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบเครื่องกลและปรับอากาศ	
นายประสิทธิ์ เกี้ยวสุนทร วก.1221 ที่อยู่ 44/372 ซอยบางกระดี่ 35/1 แขวงแสมดำ เขตบางขุนเทียน กทม. 10150	ประสิทธิ์

Sanitary Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบสุขาภิบาล และดับเพลิง	
นายทศวรรษ สนั่นฤทธิ์ วส. 215 ที่อยู่ บ้านเลขที่ 99/107 หมู่ที่ 3 ต.ศีรษะจรเข้น้อย อ.บางเสาธง จ.สมุทรปราการ 10540	ทศวรรษ

ISSUE/REVISION

REV.	DESCRIPTION	DATE
A	90% DEVELOPED	09/05/2026

PROJECT NAME :

GEDC 01

LOCATION:
Nikhom Phattana district, Rayong ,industrial estate,CPGC

BUILDING :
MAIN BUILDING

90% DEVELOPED

TITLE :

ROOM DETAIL-SPAREROOM,STORAGE ROOM3

JOB NO.		SCALE	1 : 50
DRAWN	LYT	REF.	
CHECKED	LJC	DWG. NO.	MPK01A-90-A-RD-215
APPROVED	LXD		
DATE	2026.05.09		