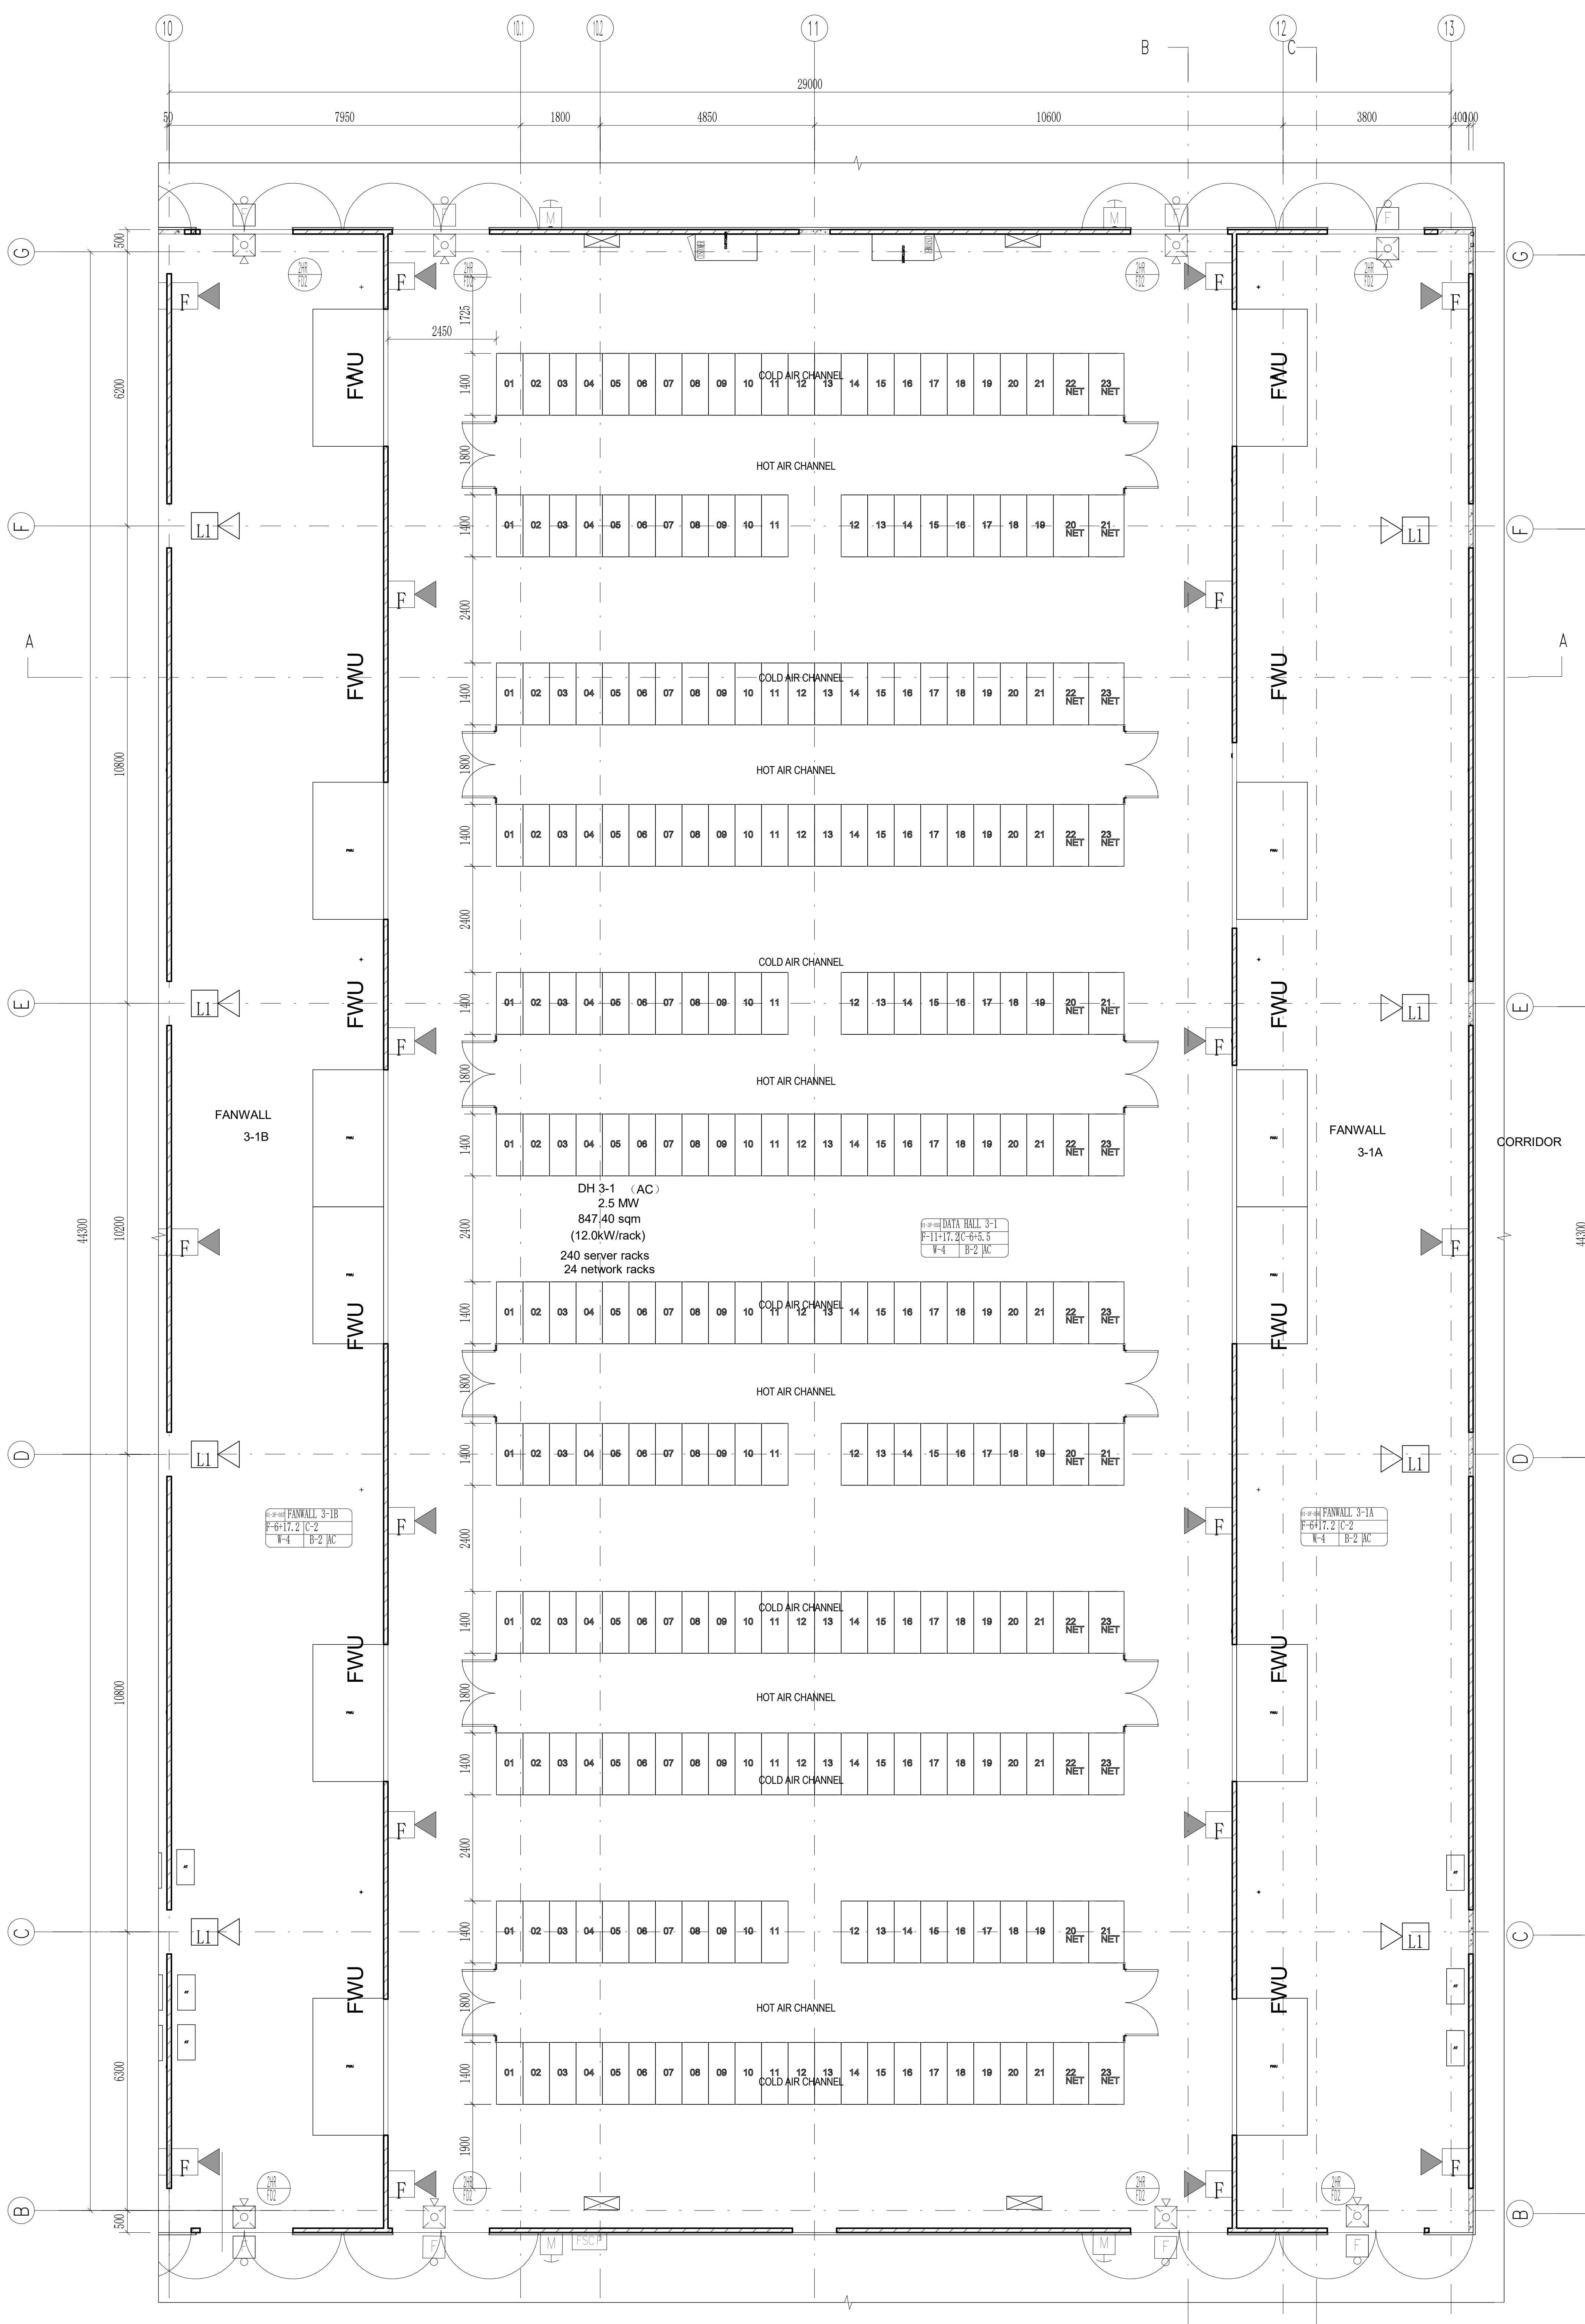

DH3-1、 FAN WALL 3-1A 3-1B FLOOR PLAN

Scale 1:75

THE "SFL" MARKED IN THE DRAWING REFERS TO THE STRUCTURAL FLOOR LEVEL, WHILE THE FINISHED FLOOR LEVEL (FFL) IS DETERMINED BASED ON FLOOR FINISHES.

Room Number	Room Name	Room Type	0kW/RACK	12kW/RACK	16kW/RACK	21kW/RACK	Rack Count	Design IT Load（Mw）
01-3F-050	Data Hall3-1	Air-cooled	0	240	24	0	264	2.5

Note On Levels- All Levels Shown Are Absolute Elevation	
☒	0kW/RACK
☐	12kW/RACK
☒	16kW/RACK
▧	21kW/RACK

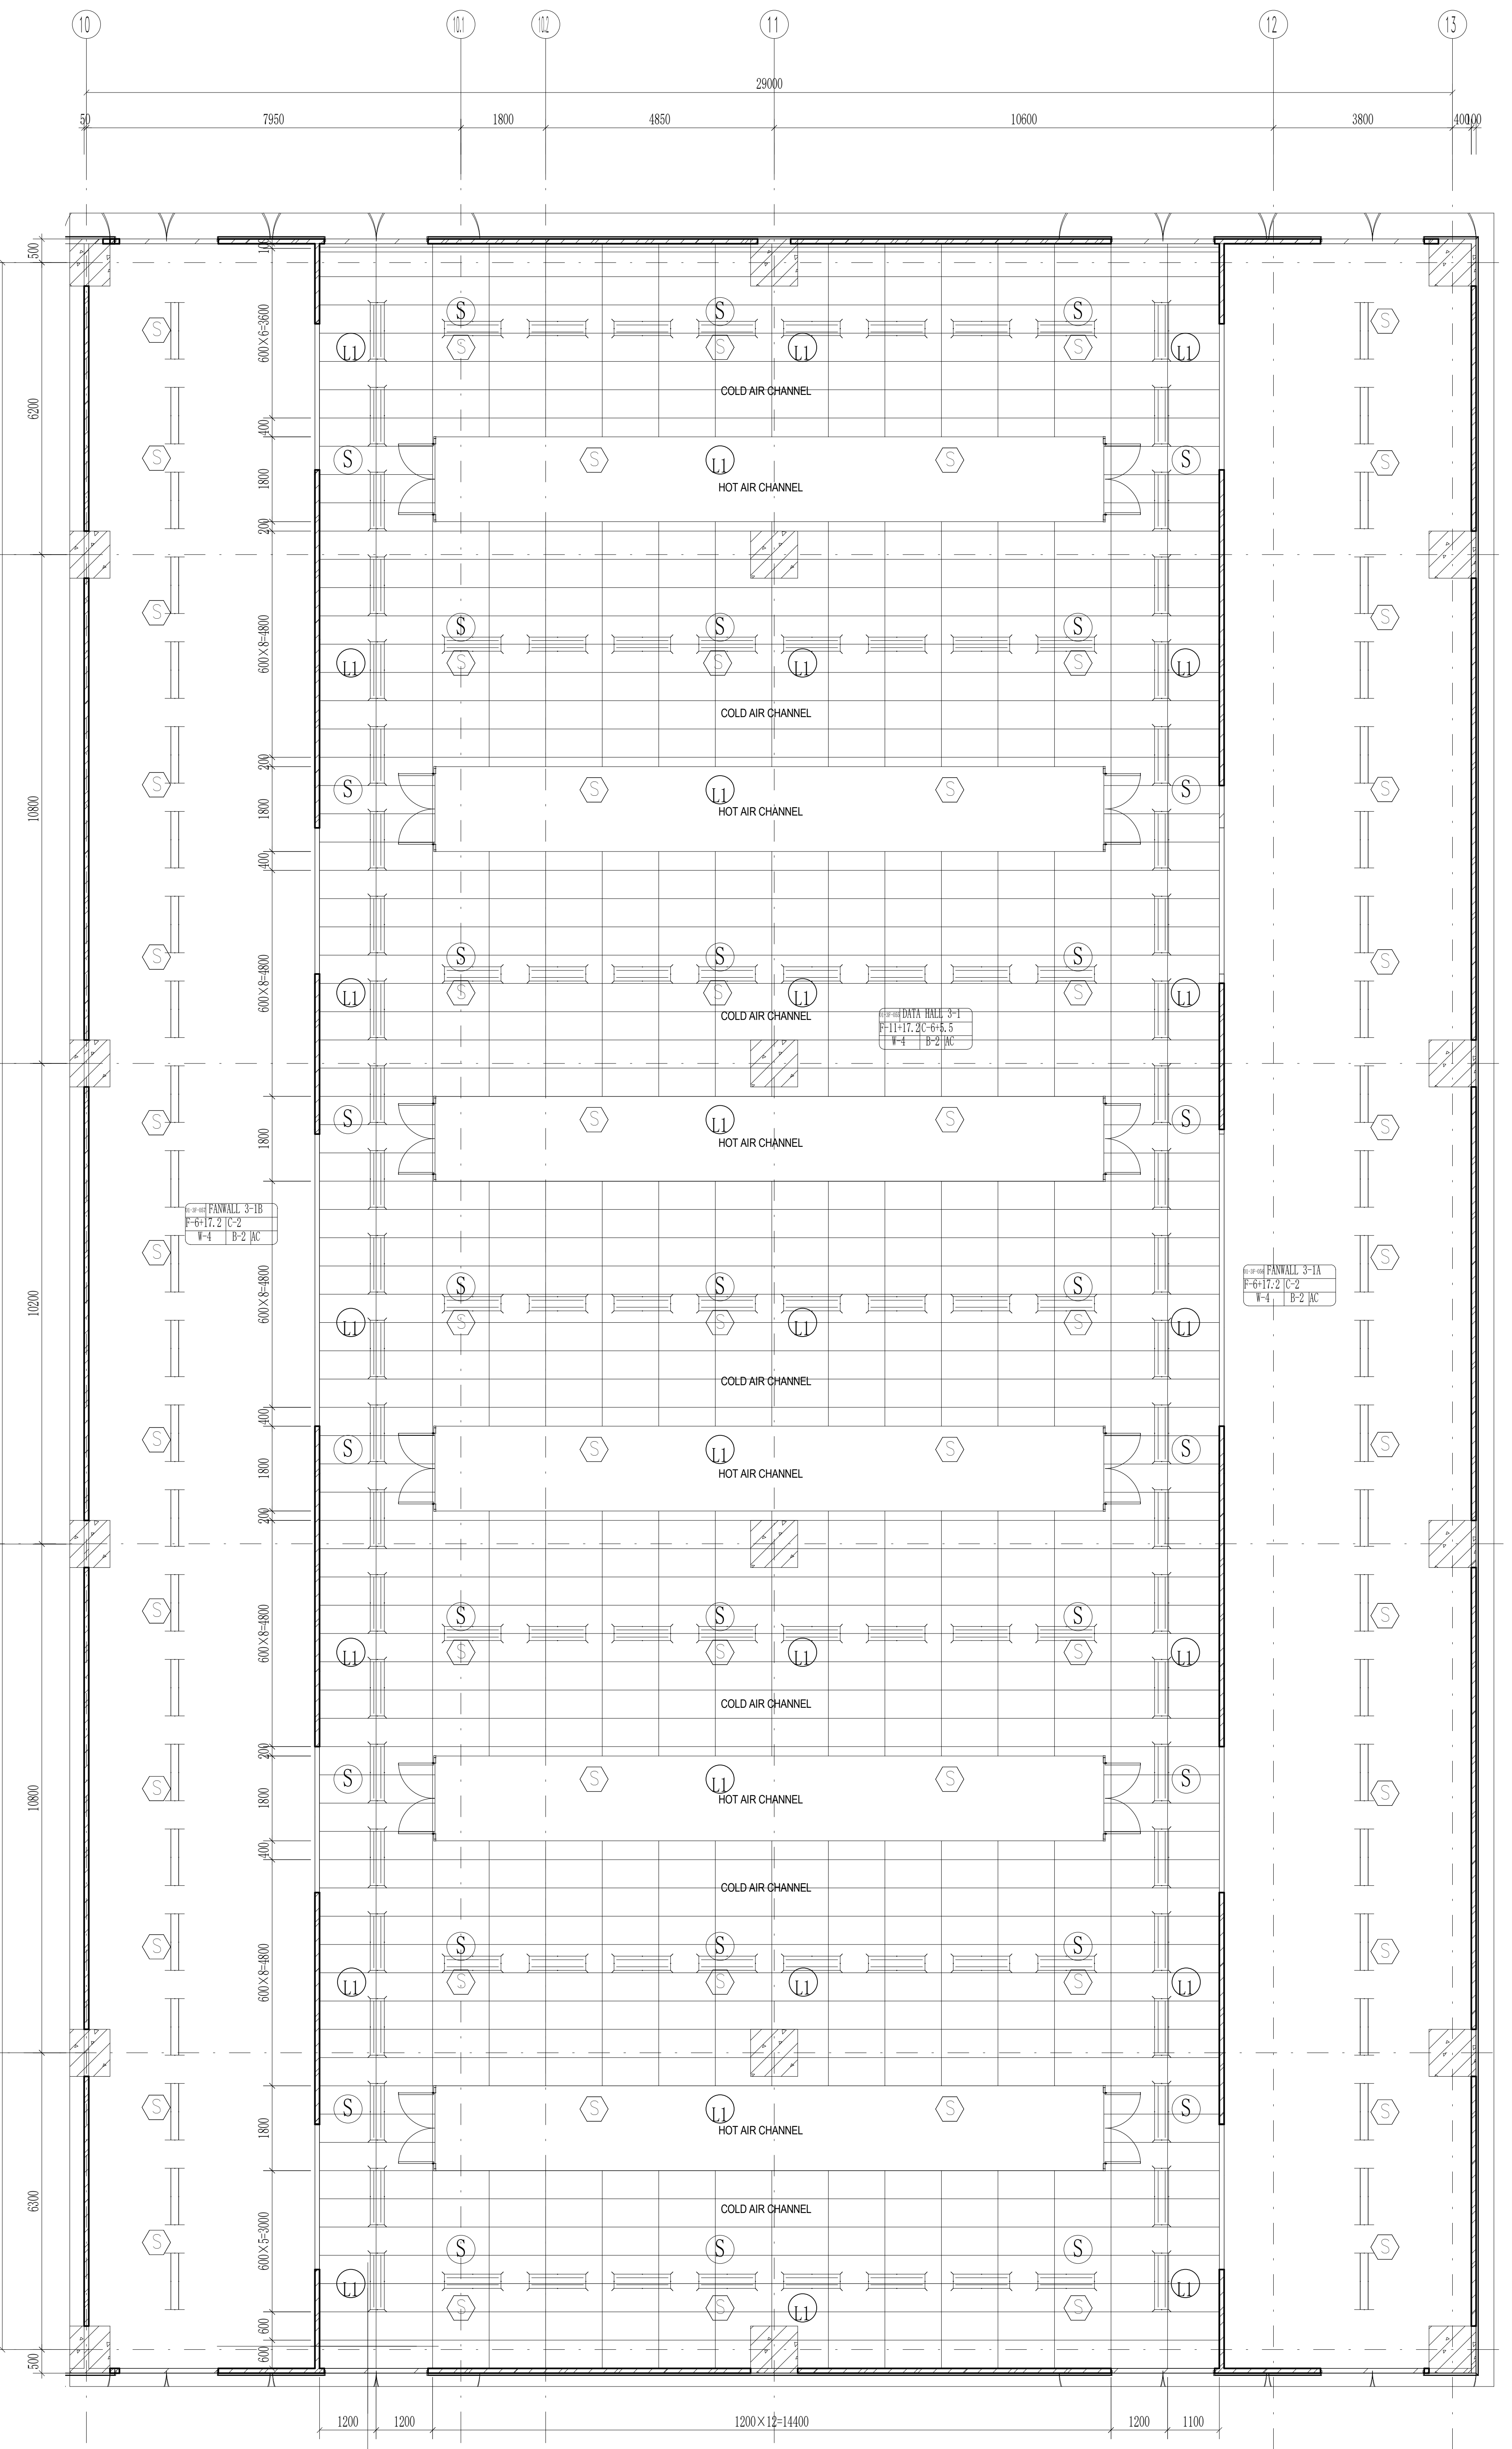

DH3-1 CEILING LAYOUT

Scale 1:75

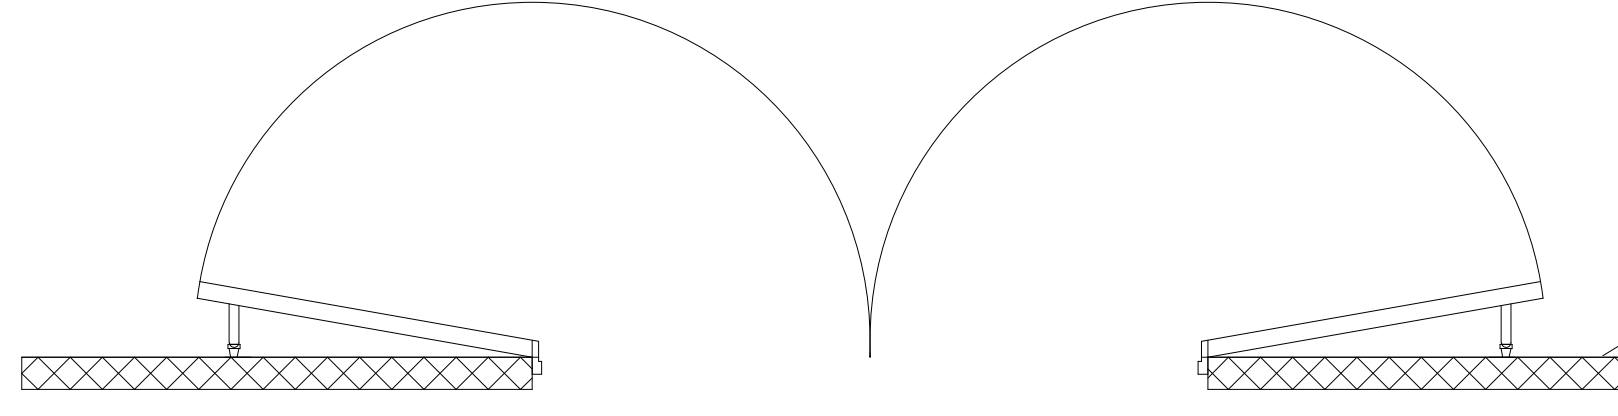

2MM THICK STAINLESS STEEL PROTECTIVE PLATE IS INSTALLED FROM THE GROUND UP TO A HEIGHT OF 1.5 METERS.DETAILED IFC STAGE NODE DETAIL DRAWING

DOOR STOPPER DETAIL

Scale 1:25

FIRE ALARM SPEAKER WALL MOUNTED

COMBINATION HORN/VISIBLE

SURFACE MOUNTED SMOKE DETECTOR, PHOTOELECTRIC TYPE

PHOTOELECTRIC SMOKE DETECTOR

LED double tube lamp; Ceiling Mounted; System Power 2x20W (+/- 10% In Tolerance); System Lumens >2x2000lm (+/- 10% In Tolerance); Luminaire Efficacy >100lm/w; CCT 5000K; CRI>80; CPF>0.9; Input Voltage 220V-240V 50/60Hz (Mounting height 3.0m)

LED double tube lamp; Ceiling Mounted; System Power 2x20W (+/- 10% In Tolerance); System Lumens >2x2000lm (+/- 10% In Tolerance); Luminaire Efficacy >100lm/w; CCT 5000K; CRI>80; CPF>0.9; Input Voltage 220V-240V 50/60Hz (Mounting height 3.0m)

ALARM BELL

CEILING SPEAKER

CLIENT :

GULF EDGE DC 01

87 Wireless Road, M Thai Tower 11th. Floor, All Seasons Place, Lumpini, Pathumwan, Bangkok 10330, Thailand

CONTRACTOR :

华西发展(泰国)有限公司
บริษัท หัวซือ ดีเวลลอปเม้นต์ (ประเทศไทย) จำกัด
HUASHI DEVELOPMENT CO.,LTD
No. 202, Room No. 1403, 14/F, Le Concorde Building,
Ratchadapisek Road, Huaykhwang Sub-District,
Huaykhwang District, Bangkok Metropolitan 10310.

CONSULTANT :

ARbay
บริษัท เอ อาร์ เบย์ จำกัด
ARbay Company Limited
31 st Floor Bangkok Insurance Building
25 South Sathorn road Thungmahamek
Sathorn Bangkok 10120 THAILAND
T +66 (0) 2286 8199
F +66 (0) 2286 2863
info@arbay.co.th

CONSULTANT :

Qbic Engineers & Architects Co.,Ltd.
8 Soi KALONG 4 SANAMBINNAM ROAD,
THASAI SUB-DISTRICT, MUANG NONTHABURI DISTRICT
, NONTHABURI.
Tel 662-950-4374
Fax 662-580-3231
E-Mail : qbic@qbic.co.th, www.qbic.co.th
QBIC ENGINEERS AND ARCHITECTS CO.,LTD.

CONSULTANT :

MITR
MITR TECHNICAL CONSULTANT CO.,LTD.
1168/8 12th FLOOR, LUMPINI TOWER BUILDING,
RAMA IV RD., THUNGMAHAMEK, SATHORN, BANGKOK 10120, THAILAND
TEL : 0-2679-9079-84
FAX : 0-2679-9085 E-mail: mitr_dd@mitr.com

Architect :	SIGNATURE
ประกิต พนานุรัตน์ วสถ. 580 ที่อยู่ 251/1 ถ.จารุเมือง แขวงรองเมือง เขตปทุมวัน กรุงเทพมหานคร โทรศัพท์ 02-286-8199	
Structural Engineer :	SIGNATURE
วิศวกรผู้ออกแบบโครงสร้าง	
ณัฐสม สงวนวงษ์ วย 1423 ที่อยู่ 2/1 ซ.รามคำแหง 150 ถ.รามคำแหง แขวง สะพานสูง เขต สะพานสูง กทม. 10240	
Structural Inspector :	SIGNATURE
วิศวกรผู้ตรวจสอบโครงสร้าง	
โกมล จุฑาภัทร วย 964 ที่อยู่ 24/18 ซ.นวมินทร์ 129 ถ. นวมินทร์ แขวง นวลจันทร์ เขต บึงกุ่ม กทม. 10230	
Electrical Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบไฟฟ้ากำลัง	
นายสุภัทร บูรณวิทย์ วฟก.1265 ที่อยู่ 21 ซอยทานสัมฤทธิ์ 13 ตำบลท่าทราย อ.เมืองนนทบุรี จ.นนทบุรี 11000	
Mechanical Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบเครื่องกลและปรับอากาศ	
นายประสิทธิ์ เกี้ยวสุนทร วก.1221 ที่อยู่ 44/372 ซอยบางกระดี่ 35/1 แขวงแสมดำ เขตบางขุนเทียน กทม. 10150	ประสิทธิ์
Sanitary Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบสุขาภิบาล และดับเพลิง	
นายทศวรรษ สนั่นฤทธิ์ วส. 215 ที่อยู่ บ้านเลขที่ 99/107 หมู่ที่ 3 ต.ศีรษะจรเข้น้อย อ.บางเสาธง จ.สมุทรปราการ 10540	ทศวรรษ

ISSUE/REVISION

REV.	DESCRIPTION	DATE
A	90% DEVELOPED	09/05/2026

PROJECT NAME :

GEDC 01

LOCATION:
Nikhom Phattana district, Rayong ,industrial estate,CPGC

BUILDING :
MAIN BUILDING

90% DEVELOPED

TITLE :

ROOM DETAIL-3F-DATAHALL3-1(AC) .
FANWALLROOM 3-1A,3-1B PLAN

JOB NO.		SCALE	作为说明
DRAWN	ZYY	REF.	
CHECKED	LJC	DWG. NO.	MPK01A-90-A-RD-301
APPROVED	LXD		
DATE	2026.05.09		

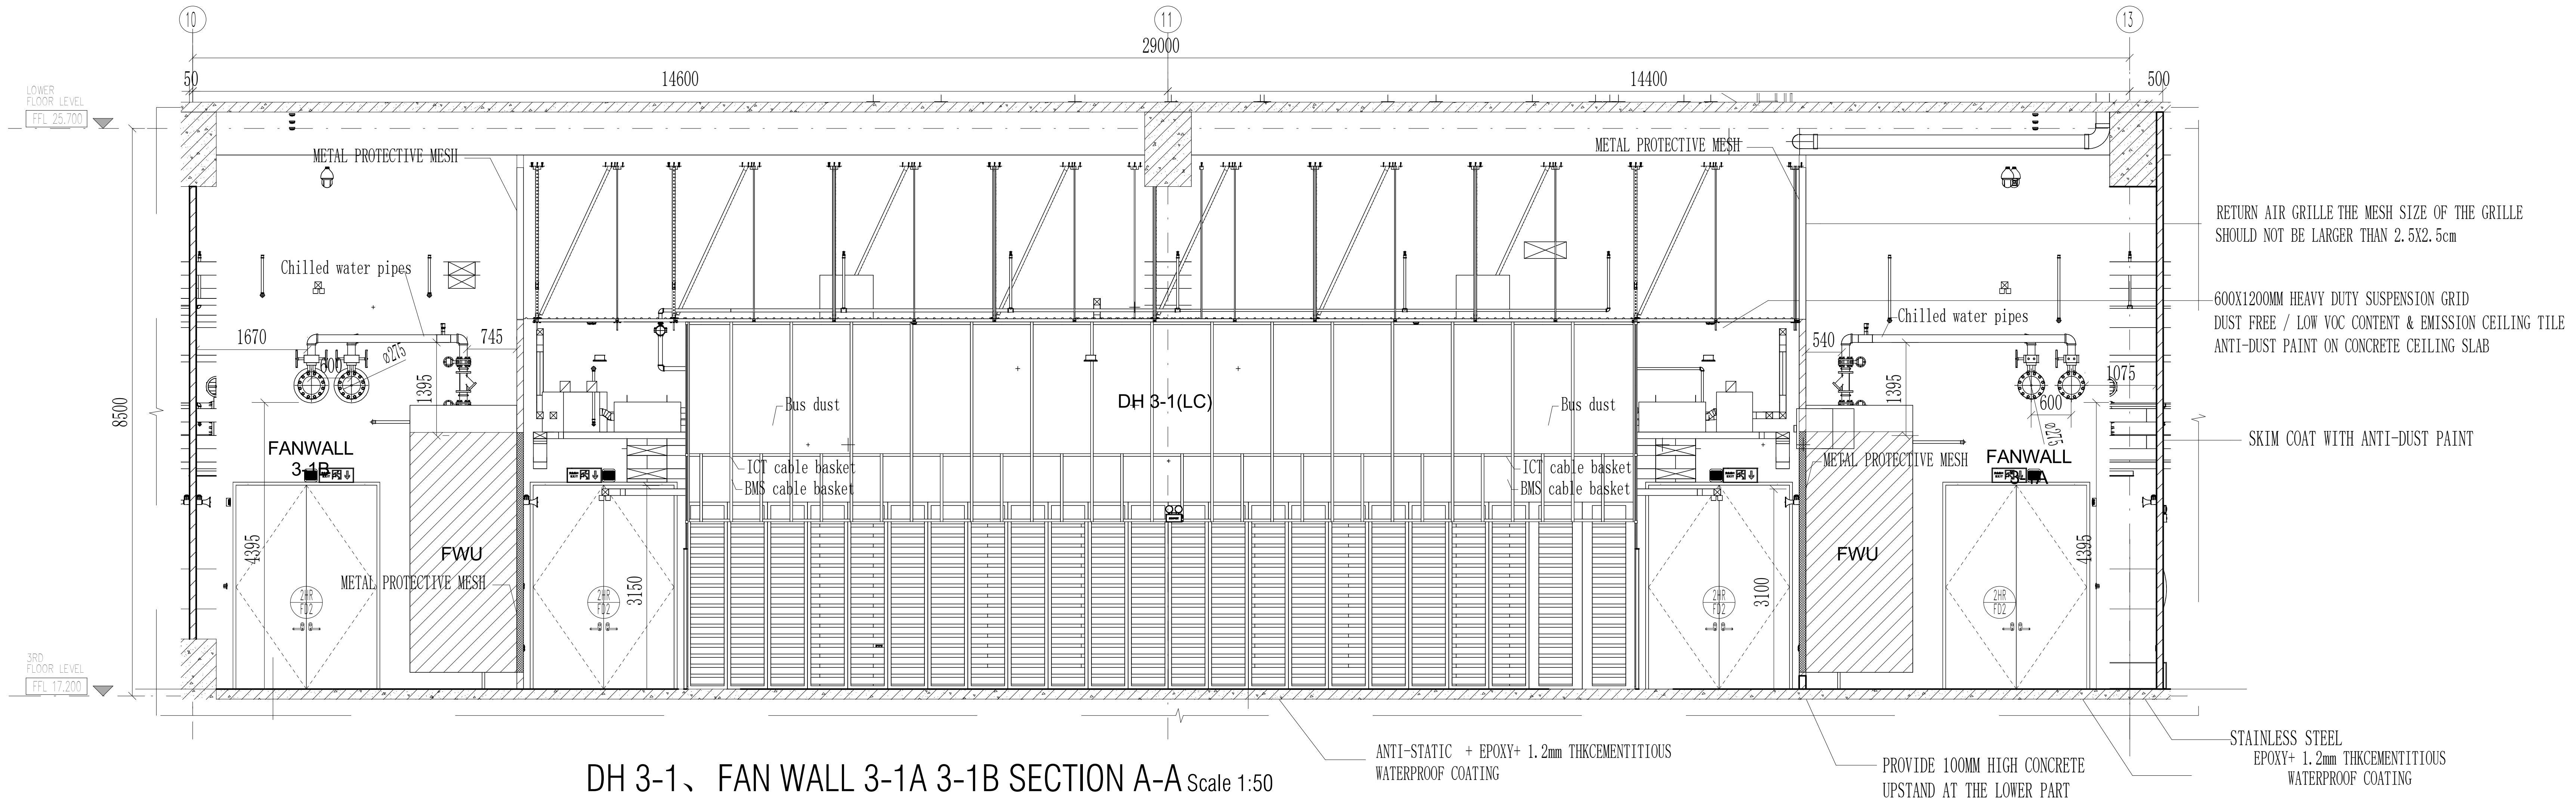
10
11
13
29000
50
14600
14400
500
LOWER FLOOR LEVEL
FFL 25.700
3RD FLOOR LEVEL
FFL 17.200
8500
METAL PROTECTIVE MESH
Chilled water pipes
1670
745
600
ø275
1395
FANWALL 3-1B
4395
FWU
METAL PROTECTIVE MESH
2HR FD2
3150
Bus dust
DH 3-1(LC)
ICT cable basket
BMS cable basket
3100
540
1075
FANWALL 3-1A
RETURN AIR GRILLE THE MESH SIZE OF THE GRILLE SHOULD NOT BE LARGER THAN 2.5X2.5cm
600X1200MM HEAVY DUTY SUSPENSION GRID
DUST FREE / LOW VOC CONTENT & EMISSION CEILING TILE
ANTI-DUST PAINT ON CONCRETE CEILING SLAB
SKIM COAT WITH ANTI-DUST PAINT
ANTI-STATIC + EPOXY+ 1.2mm THKCEMENTITIOUS WATERPROOF COATING
PROVIDE 100MM HIGH CONCRETE UPSTAND AT THE LOWER PART
STAINLESS STEEL
EPOXY+ 1.2mm THKCEMENTITIOUS WATERPROOF COATING

DH 3-1、FAN WALL 3-1A 3-1B SECTION A-A Scale 1:50

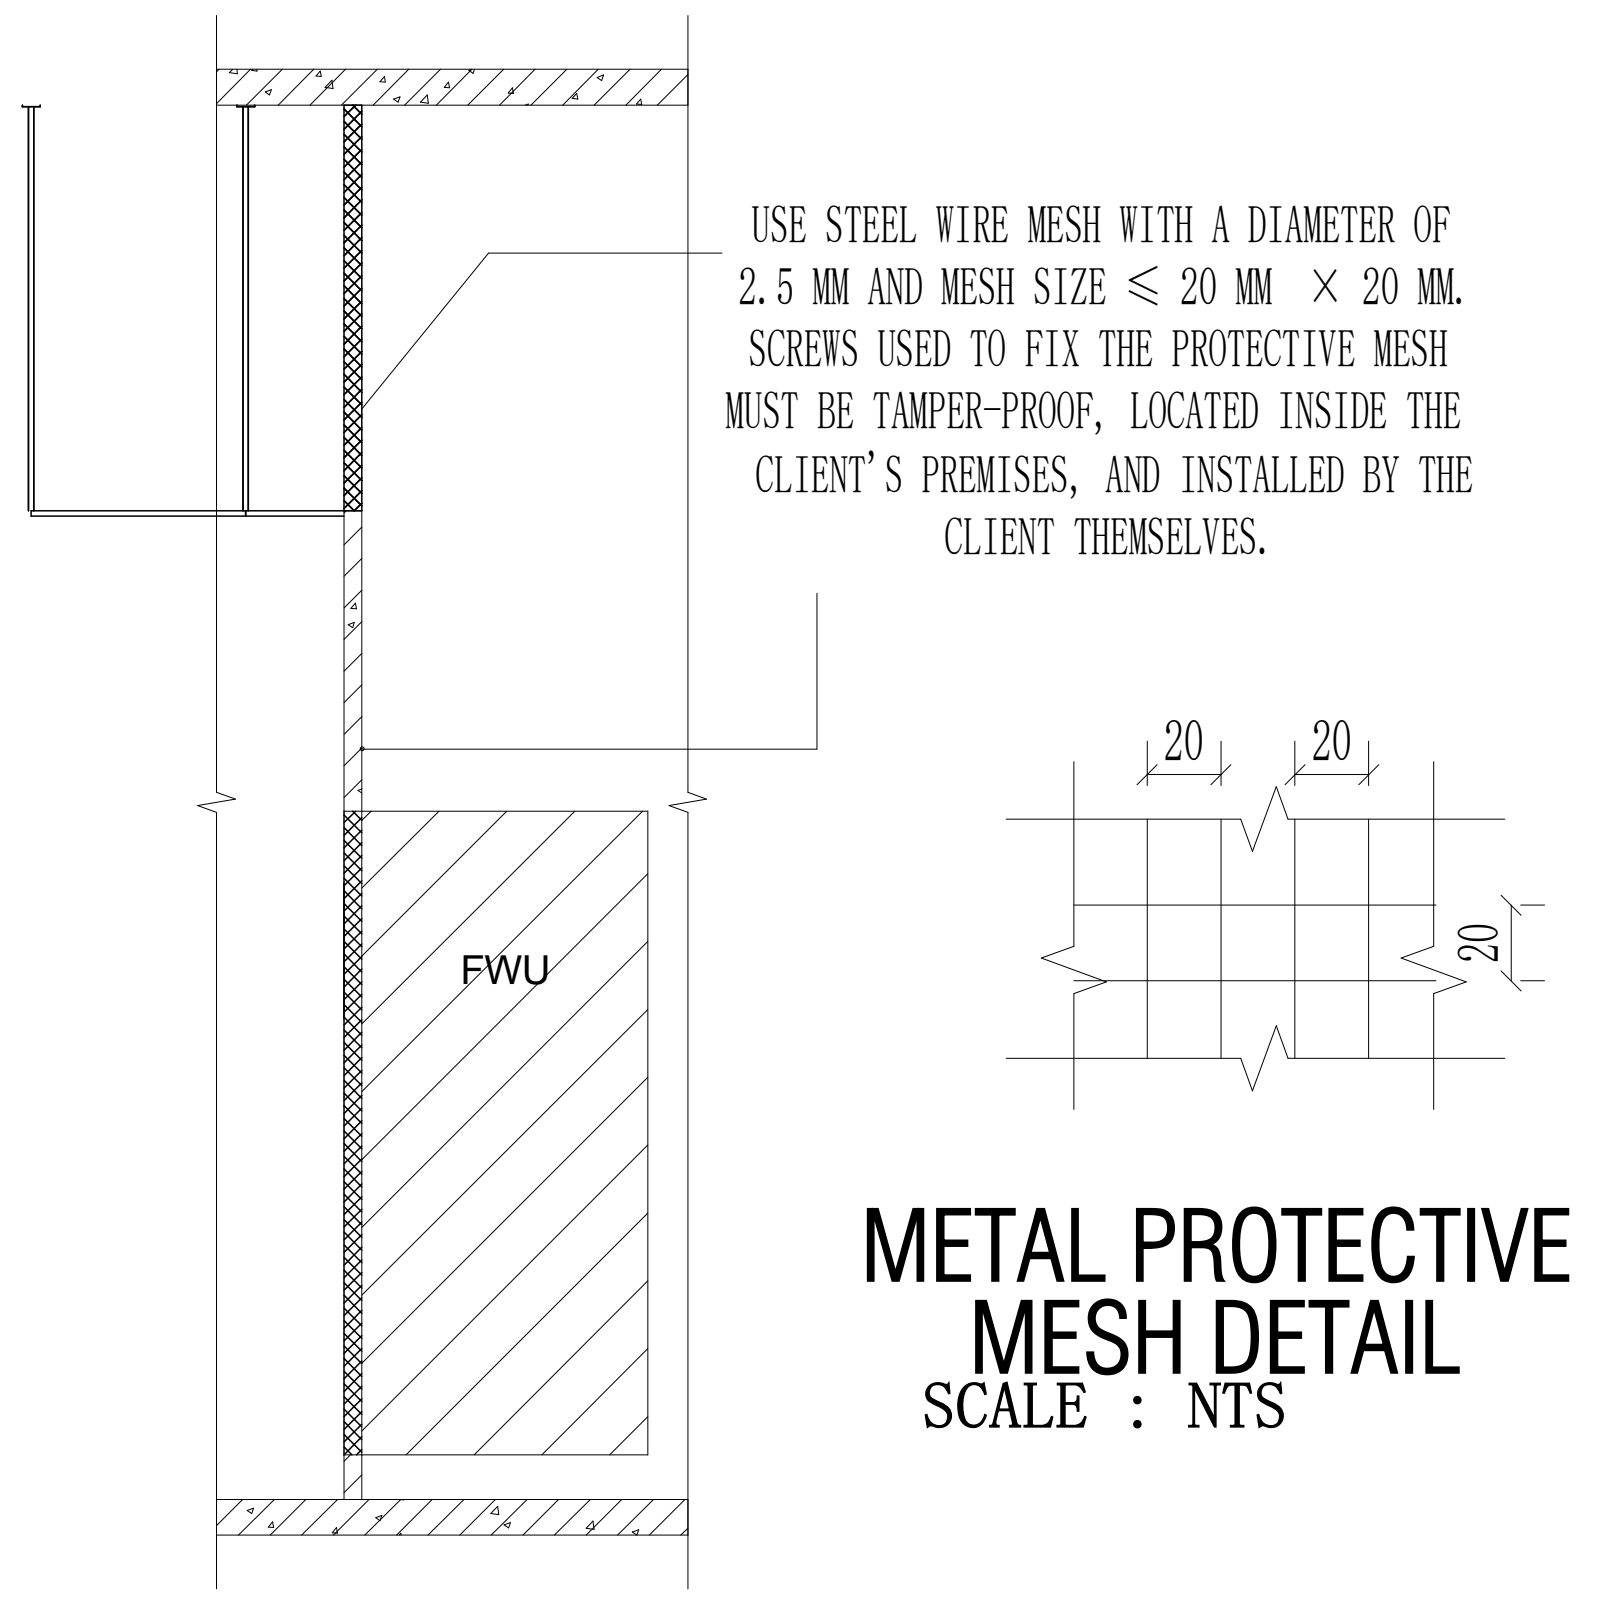
USE STEEL WIRE MESH WITH A DIAMETER OF 2.5 MM AND MESH SIZE ≤ 20 MM × 20 MM. SCREWS USED TO FIX THE PROTECTIVE MESH MUST BE TAMPER-PROOF, LOCATED INSIDE THE CLIENT'S PREMISES, AND INSTALLED BY THE CLIENT THEMSELVES.
FWU
20
20
20

METAL PROTECTIVE MESH DETAIL

SCALE : NTS

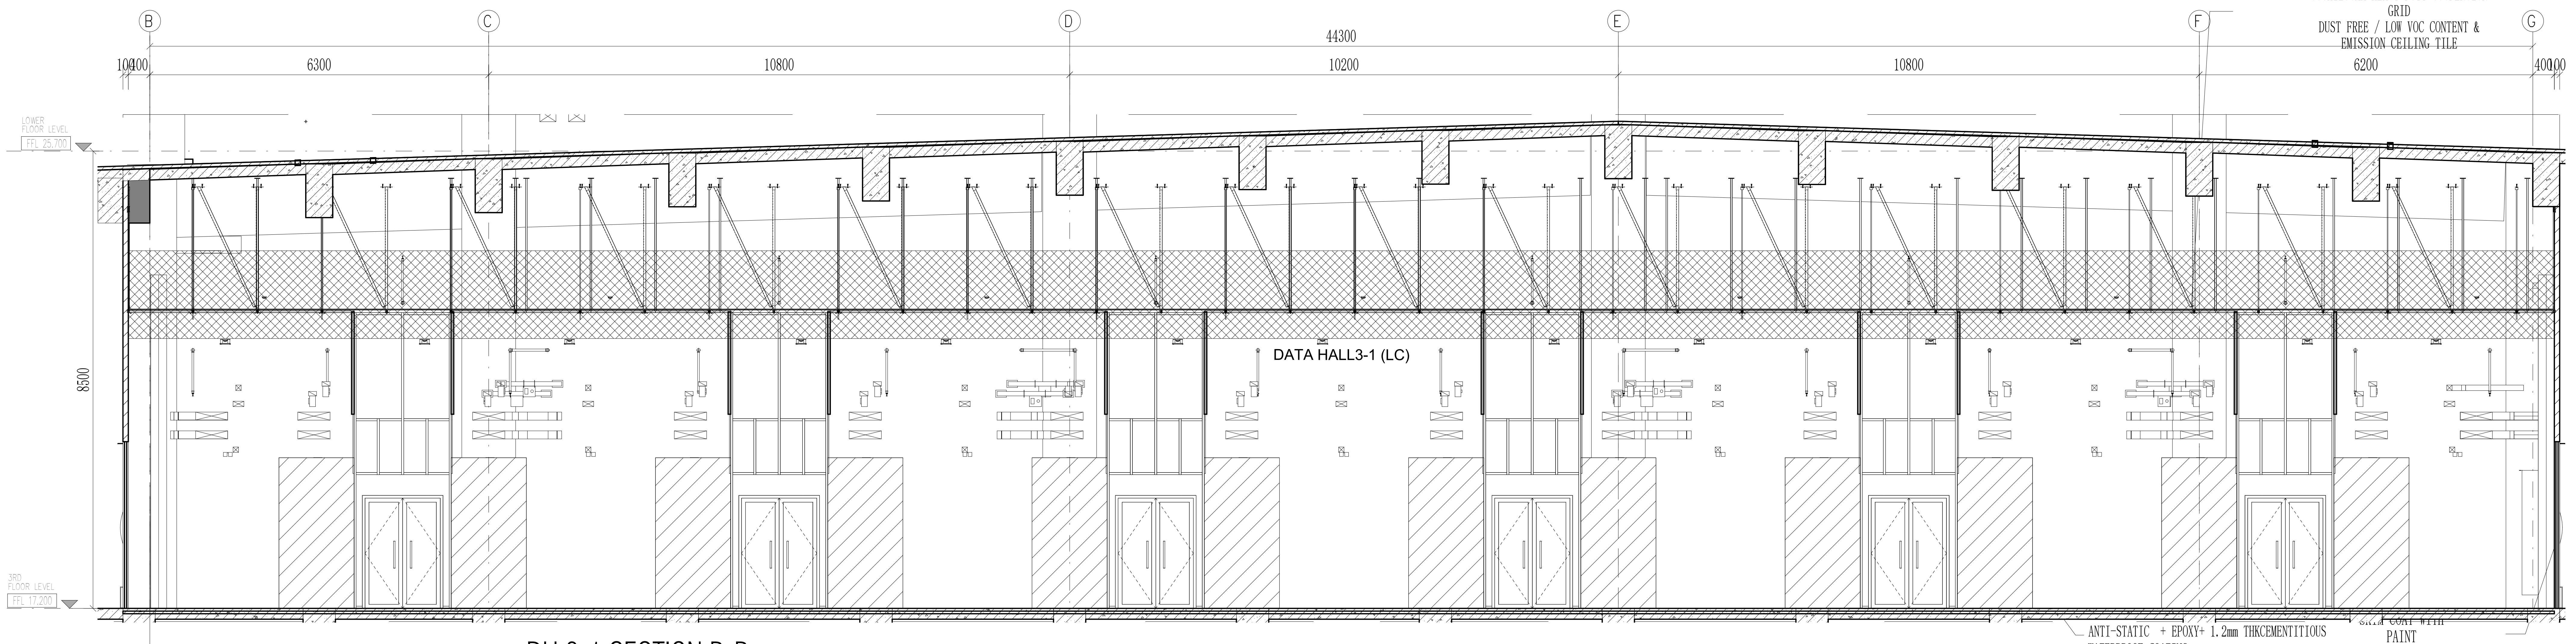
B
C
D
E
F
G
44300
100
400
6300
10800
10200
10800
6200
400
100
600X1200MM HEAVY DUTY SUSPENSION GRID
DUST FREE / LOW VOC CONTENT & EMISSION CEILING TILE
LOWER FLOOR LEVEL
FFL 25.700
3RD FLOOR LEVEL
FFL 17.200
8500
DATA HALL3-1 (LC)
ANTI-STATIC + EPOXY+ 1.2mm THKCEMENTITIOUS WATERPROOF COATING
SKIM COAT WITH PAINT

DH 3-1 SECTION B-B Scale 1:50

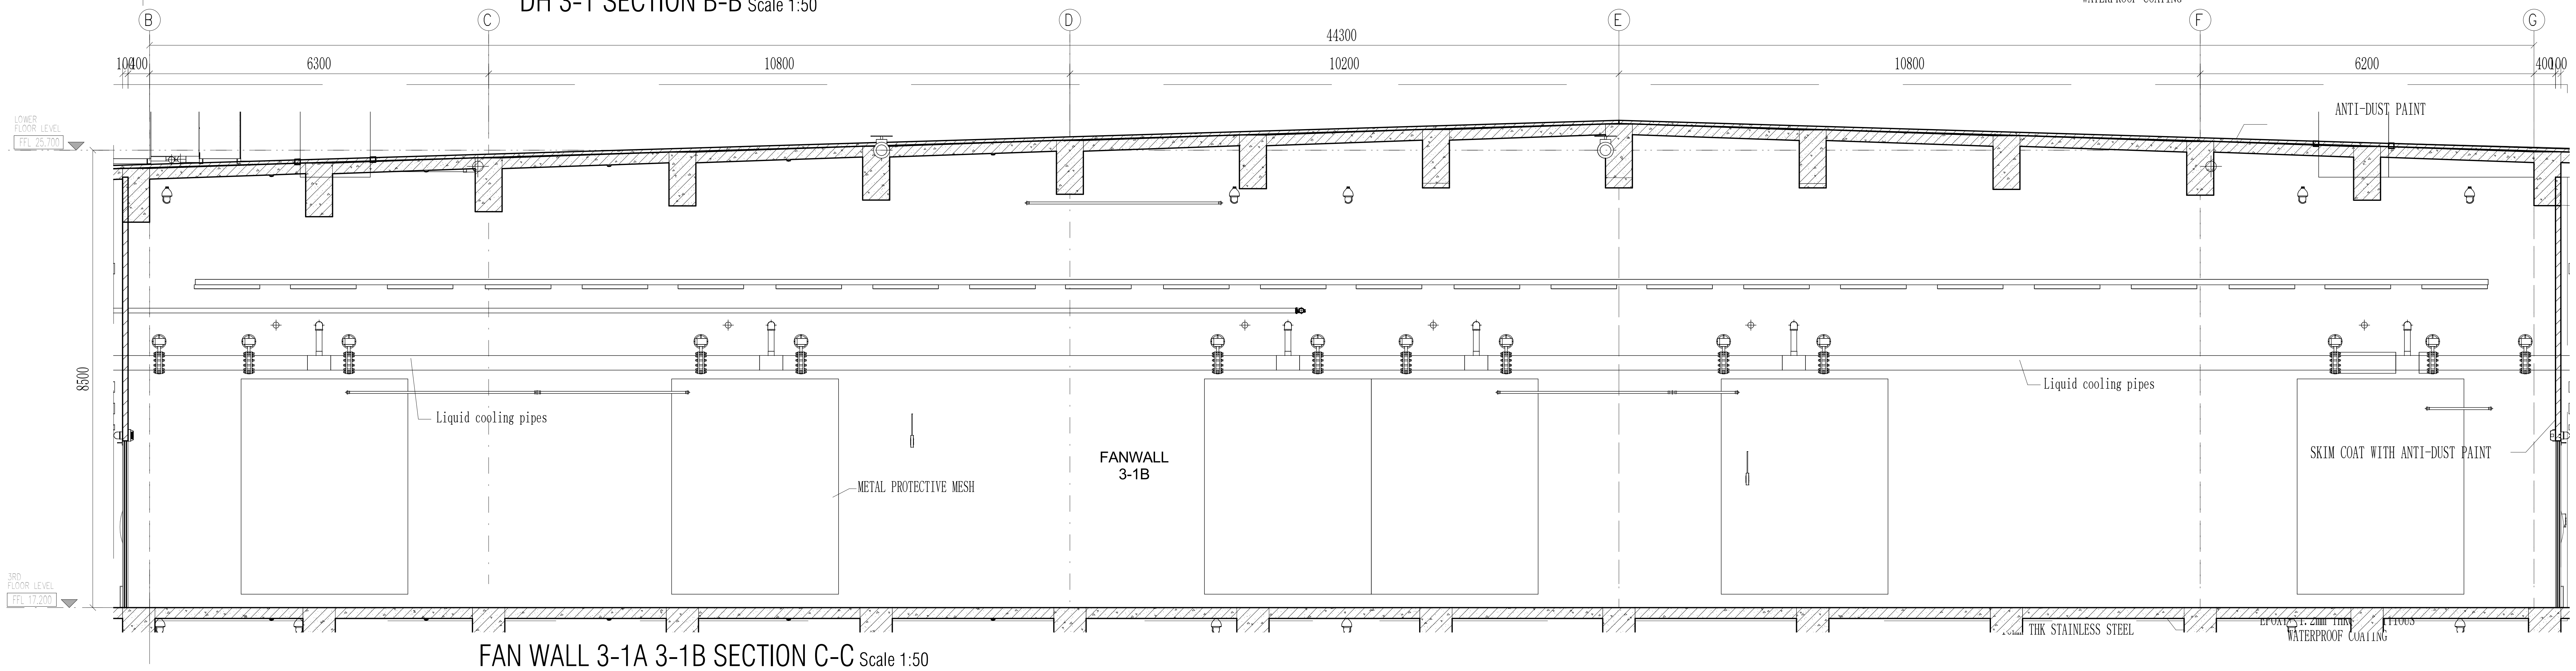
B
C
D
E
F
G
44300
100
400
6300
10800
10200
10800
6200
400
100
ANTI-DUST PAINT
LOWER FLOOR LEVEL
FFL 25.700
3RD FLOOR LEVEL
FFL 17.200
8500
Liquid cooling pipes
Liquid cooling pipes
METAL PROTECTIVE MESH
FANWALL 3-1B
SKIM COAT WITH ANTI-DUST PAINT
THK STAINLESS STEEL
EPOXY+ 1.2mm THK
WATERPROOF COATING

FAN WALL 3-1A 3-1B SECTION C-C Scale 1:50

CLIENT :

GULF EDGE DC 01

87 Wireless Road, M Thai Tower 11th. Floor, All Seasons Place, Lumpini,
Pathumwan, Bangkok 10330, Thailand

CONTRACTOR :

华西发展(泰国)有限公司
บริษัท หัวซือ ดีเวลลอปเม้นต์ (ประเทศไทย) จำกัด
HUASHI DEVELOPMENT CO.,LTD
No. 202, Room No. 1403, 14/F, Le Concorde Building,
Ratchadapisek Road, Huaykhwang Sub-District,
Huaykhwang District, Bangkok Metropolitan 10310.

CONSULTANT :

ARbay
บริษัท เอ อาร์ เบย์ จำกัด
ARbay Company Limited
31 st Floor Bangkok Insurance Building
25 South Sathorn road Thungmahamek
Sathorn Bangkok 10120 THAILAND
T +66 (0) 2286 8199
F +66 (0) 2286 2863
info@arbay.co.th

CONSULTANT :

Qbic Engineers & Architects Co.,Ltd.
8 Soi KALONG 4 SANAMBINNAM ROAD,
THASAI SUB-DISTRICT, MUANG NONTHABURI DISTRICT
, NONTHABURI.
Tel 662-950-4374
Fax 662-580-3231
E-Mail : qbic@qbic.co.th, www.qbic.co.th
QBIC ENGINEERS AND ARCHITECTS CO.,LTD.

CONSULTANT :

MITR
MITR TECHNICAL CONSULTANT CO.,LTD.
1168/8 12th FLOOR, LUMPINI TOWER BUILDING,
RAMA IV RD., THUNGMAHAMEK, SATHORN, BANGKOK 10120, THAILAND
TEL : 0-2679-9079-84
FAX : 0-2679-9085 E-mail: mitr_dd@mitr.com

Architect :	SIGNATURE
ประกิต พนานุรัตน์ วสถ. 580 ที่อยู่ 251/1 ถ.จารุเมือง แขวงรองเมือง เขตปทุมวัน กรุงเทพมหานคร โทรศัพท์ 02-286-8199	
Structural Engineer :	SIGNATURE
วิศวกรผู้ออกแบบโครงสร้าง	
ณัฐสม สงวนวงษ์ วย 1423 ที่อยู่ 2/1 ซ.รามคำแหง 150 ถ.รามคำแหง แขวง สะพานสูง เขต สะพานสูง กทม. 10240	ณัฐสม สงวนวงษ์
Structural Inspector :	SIGNATURE
วิศวกรผู้ตรวจสอบโครงสร้าง	
โกมล จุฑาภัทร วย 964 ที่อยู่ 24/18 ซ.นวมินทร์ 129 ถ. นวมินทร์ แขวง นวลจันทร์ เขต บึงกุ่ม กทม. 10230	
Electrical Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบไฟฟ้ากำลัง	
นายสุภัทร บูรณวิทย์ วฟก.1265 ที่อยู่ 21 ซอยทานสัมฤทธิ์ 13 ตำบลท่าทราย อ.เมืองนนทบุรี จ.นนทบุรี 11000	
Mechanical Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบเครื่องกลและปรับอากาศ	
นายประสิทธิ์ เกี้ยวสุนทร วก.1221 ที่อยู่ 44/372 ซอยบางกระดี่ 35/1 แขวงแสมดำ เขตบางขุนเทียน กทม. 10150	ประสิทธิ์
Sanitary Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบสุขาภิบาล และดับเพลิง	
นายทศวรรษ สนั่นฤทธิ์ วส. 215 ที่อยู่ บ้านเลขที่ 99/107 หมู่ที่ 3 ต.ศีรษะจรเข้น้อย อ.บางเสาธง จ.สมุทรปราการ 10540	ทศวรรษ

ISSUE/REVISION

REV.	DESCRIPTION	DATE
A	90% DEVELOPED	09/05/2026

PROJECT NAME :

GEDC 01

LOCATION:
Nikhom Phattana district, Rayong ,industrial estate,CPGC

BUILDING :
MAIN BUILDING

90% DEVELOPED

TITLE :

ROOM DETAIL-3F-DATAHALL3-1(AC)
FANWALL ROOM 3-1A,3-1BSECTIO,

JOB NO.	SCALE 1 : 50
DRAWN ZYY	REF.
CHECKED LJC	DWG. NO. MPK01A-90-A-RD-302
APPROVED LXD	
DATE 2026.05.09	

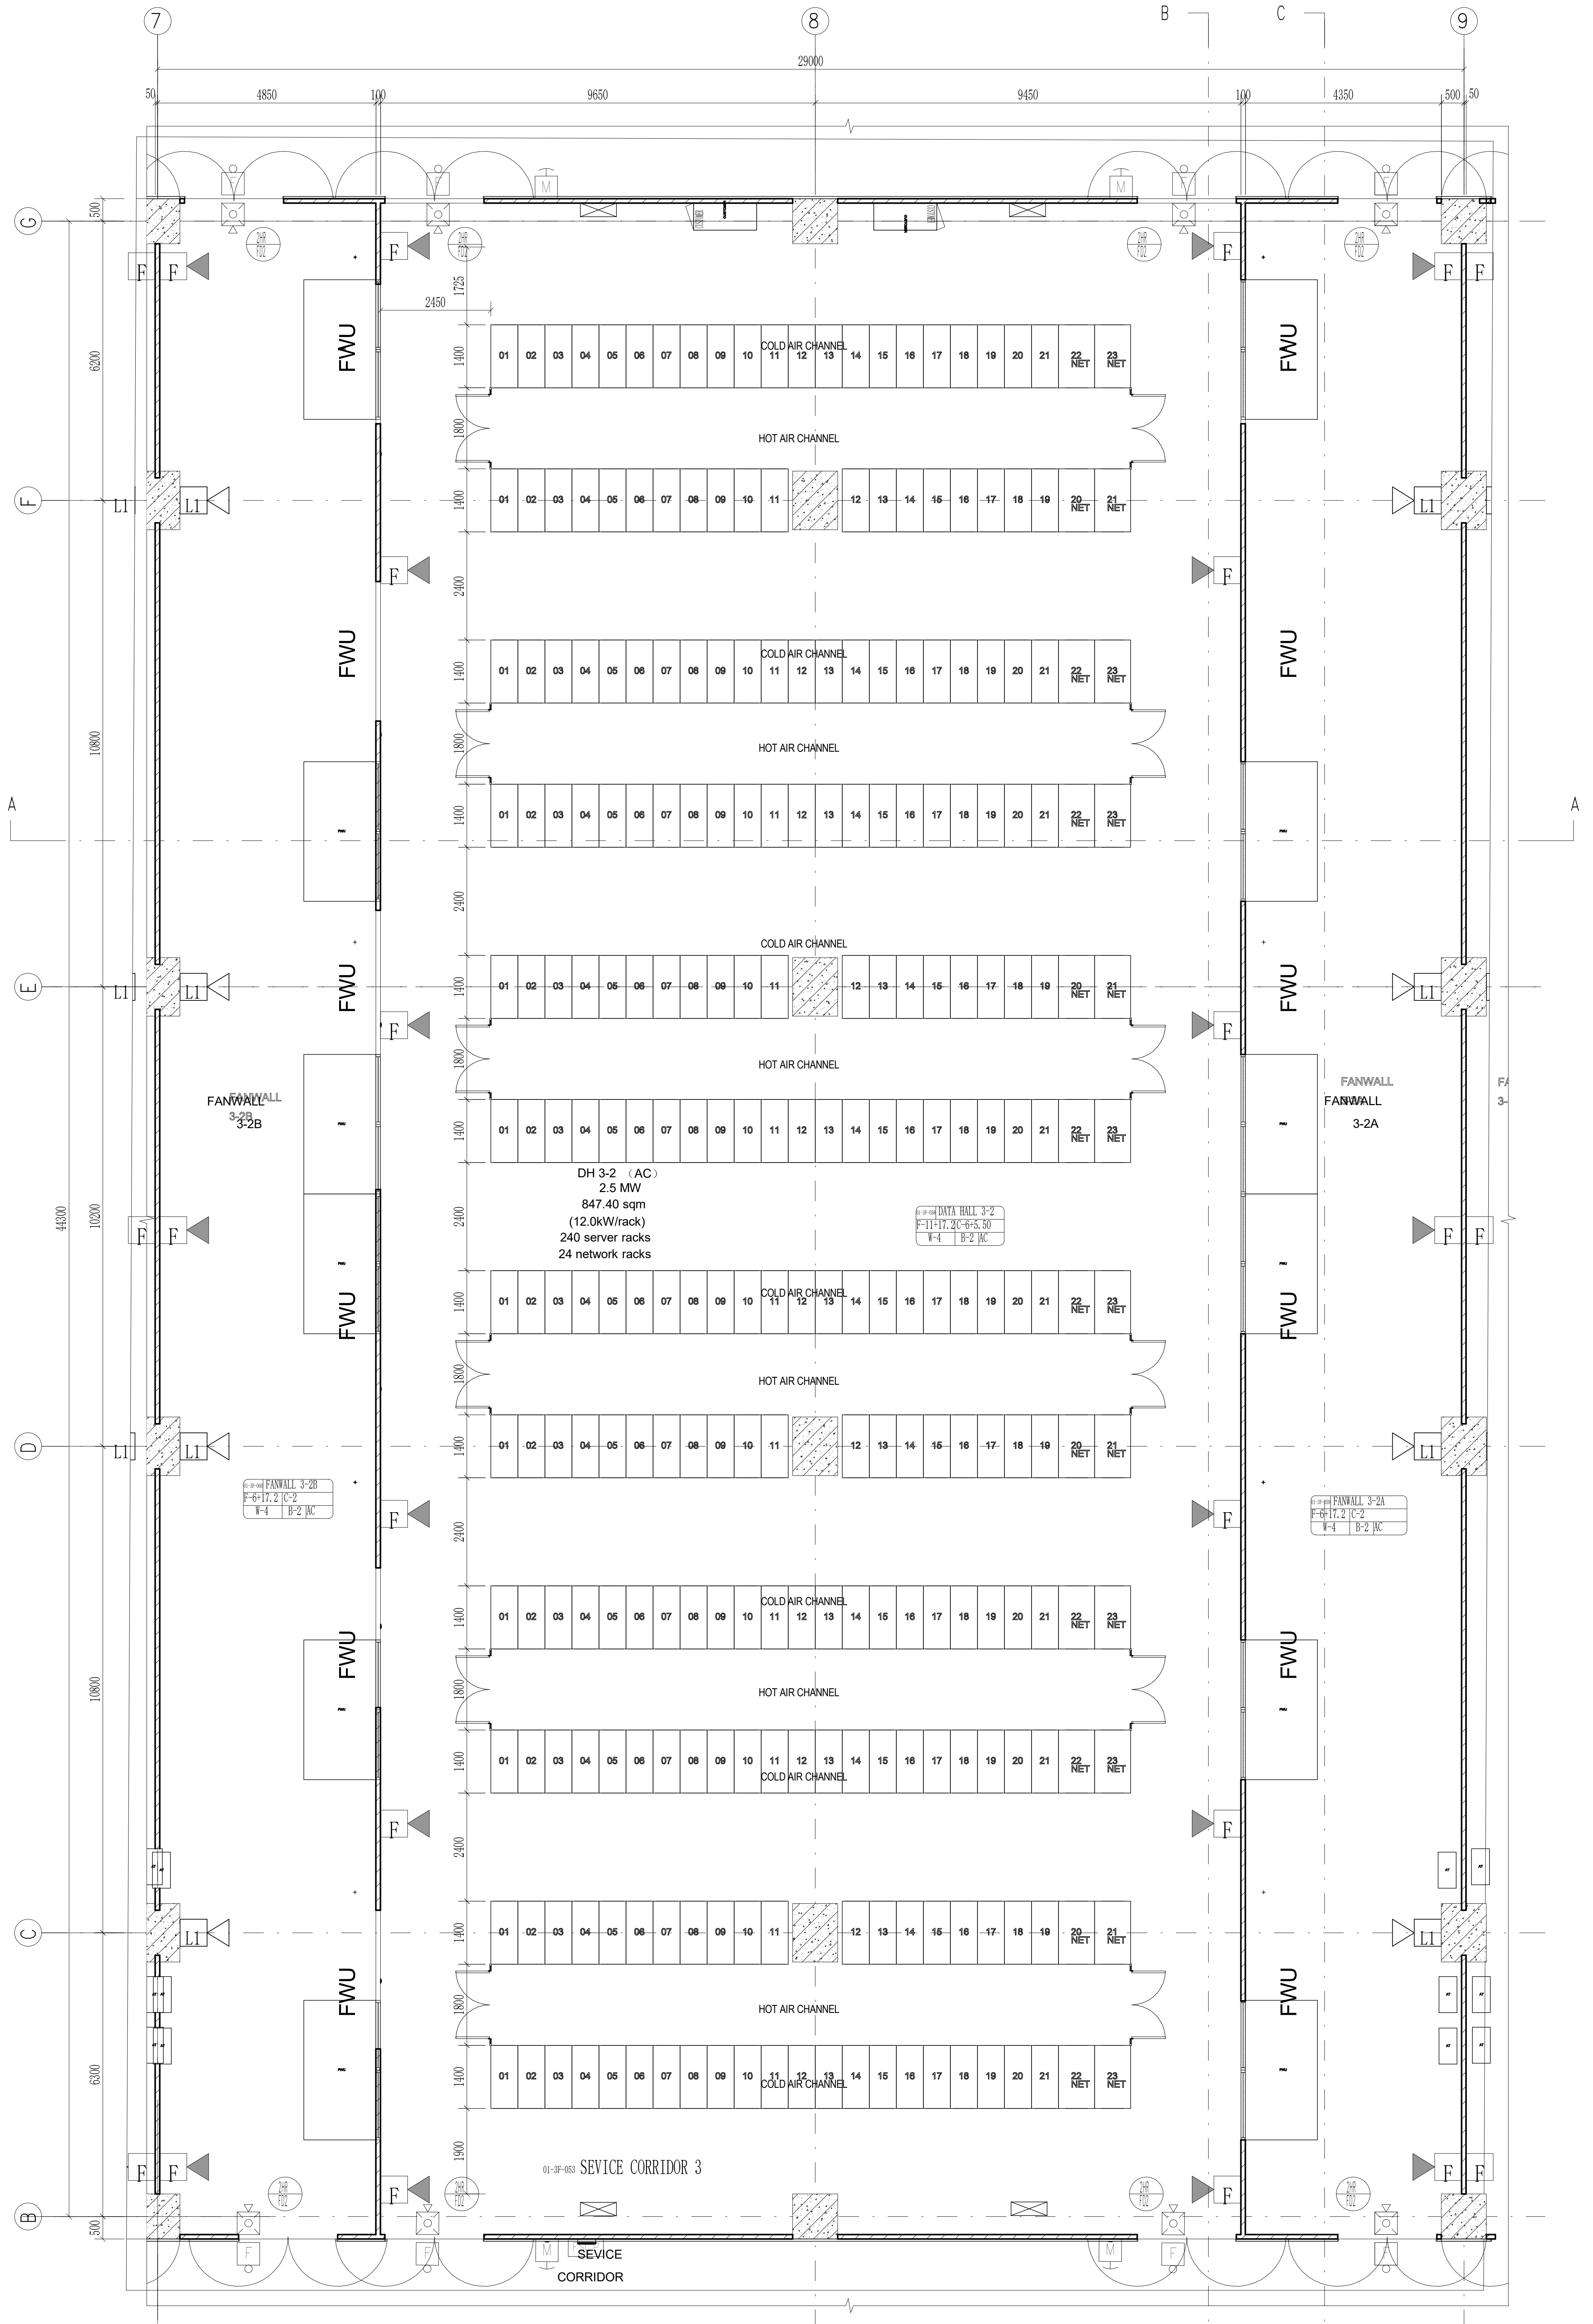
7
8
9
B
C
29000
4850
9650
9450
4350
50
100
500
G
F
E
D
C
B
A
FWU
COLD AIR CHANNEL
HOT AIR CHANNEL
01 02 03 04 05 06 07 08 09 10 11 12 13 14 15 16 17 18 19 20 21 22 NET 23 NET
FANWALL 3-2B
FANWALL 3-2A
01-3F-058 DATA HALL 3-2
F-11+17.2 C-6+5.50
W-4 B-2 AC
01-3F-053 SEVICE CORRIDOR 3
SEVICE CORRIDOR
6300
10800
10200
44300
1800
1400
2400
2450
1725
L1
F

DH 3-2 （AC）
2.5 MW
847.40 sqm
(12.0kW/rack)
240 server racks
24 network racks

DH3-2、FAN WALL 3-2A、FAN WALL 3-2B FIRST FLOOR PLAN

Scale 1:75

THE "SFL" MARKED IN THE DRAWING REFERS TO THE STRUCTURAL FLOOR LEVEL, WHILE THE FINISHED FLOOR LEVEL (FFL) IS DETERMINED BASED ON FLOOR FINISHES.

Room Number	Room Name	Room Type	0kW/RACK	12kW/RACK	16kW/RACK	21kW/RACK	Rack Count	Design IT Load (Mw)
01-3F-053	Data Hall3-2	Air-cooled	0	240	24	0	264	2.5

Note On Levels- All Levels Shown Are Absolute Elevation	
☒	0kW/RACK
☐	12kW/RACK
☒	16kW/RACK
▧	21kW/RACK

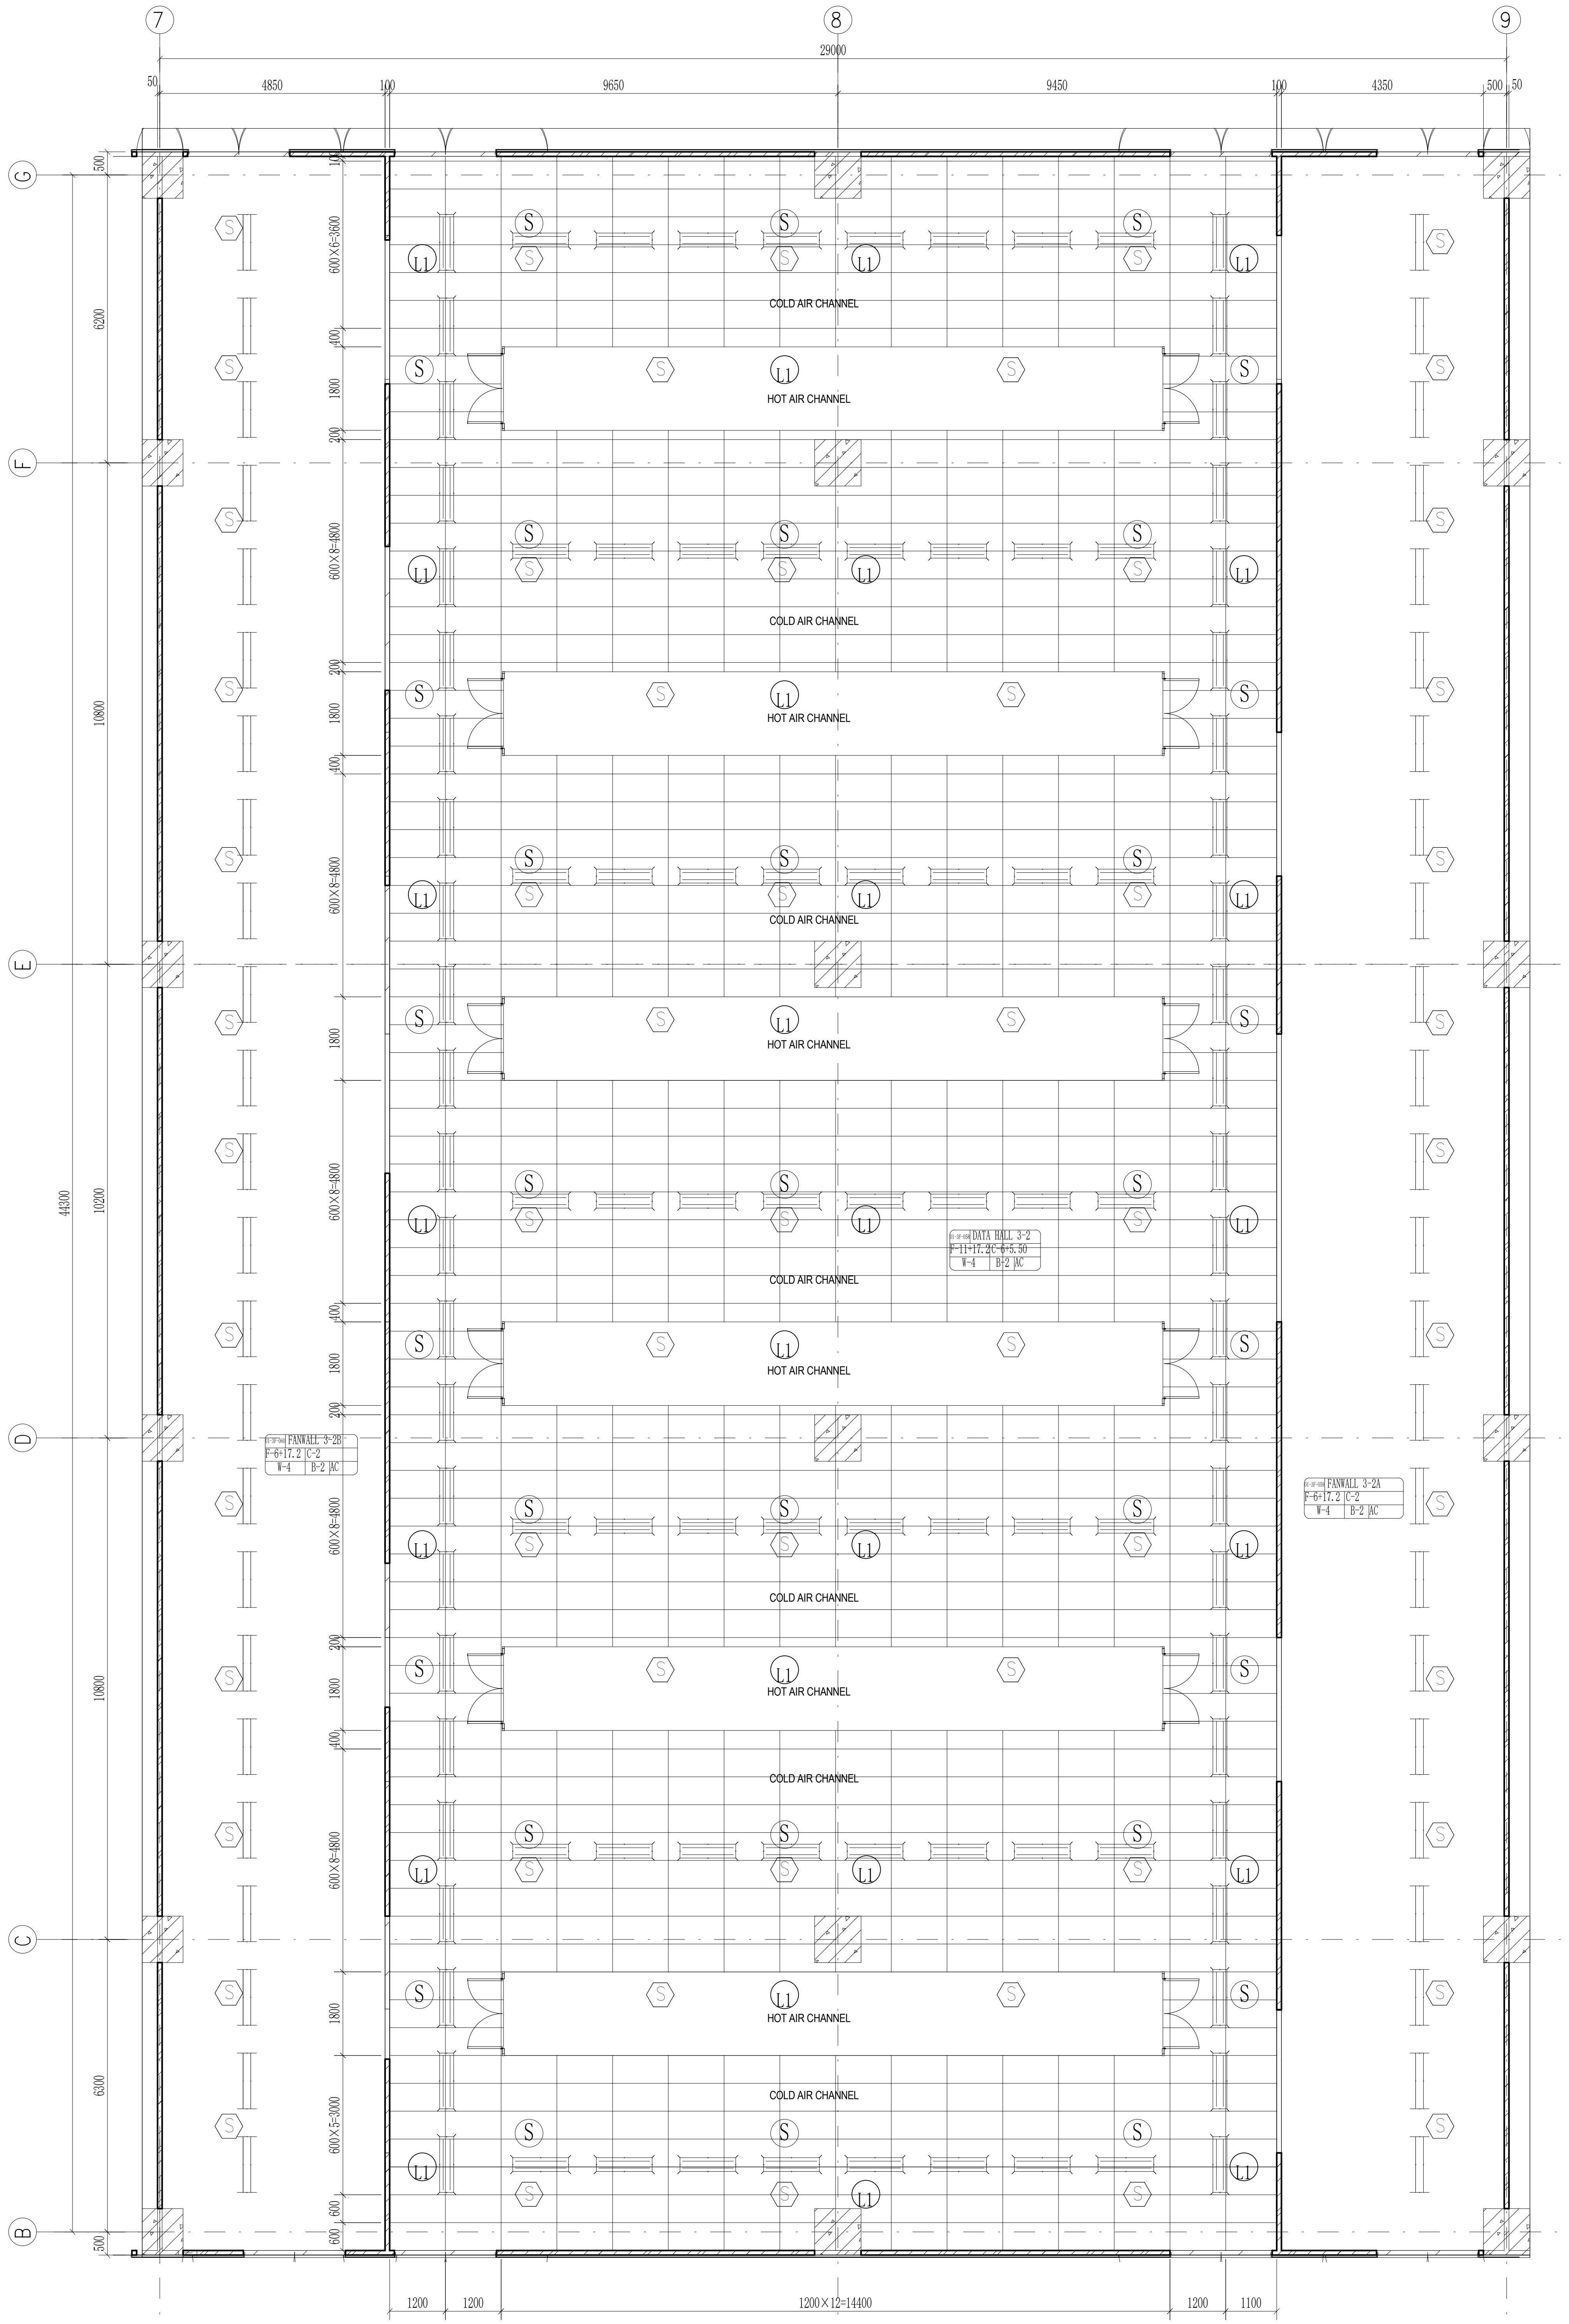
7
8
9
29000
4850
9650
9450
4350
G
F
E
D
C
B
COLD AIR CHANNEL
HOT AIR CHANNEL
S
L1
01-3F-058 DATA HALL 3-2
F-11+17.2 C-6+5.50
W-4 B-2 AC
FANWALL 3-2B
FANWALL 3-2A
600×6=3600
600×8=4800
600×5=3000
1200
1100
1200×12=14400

DH3-2 CEILING LAYOUT

Scale 1:75

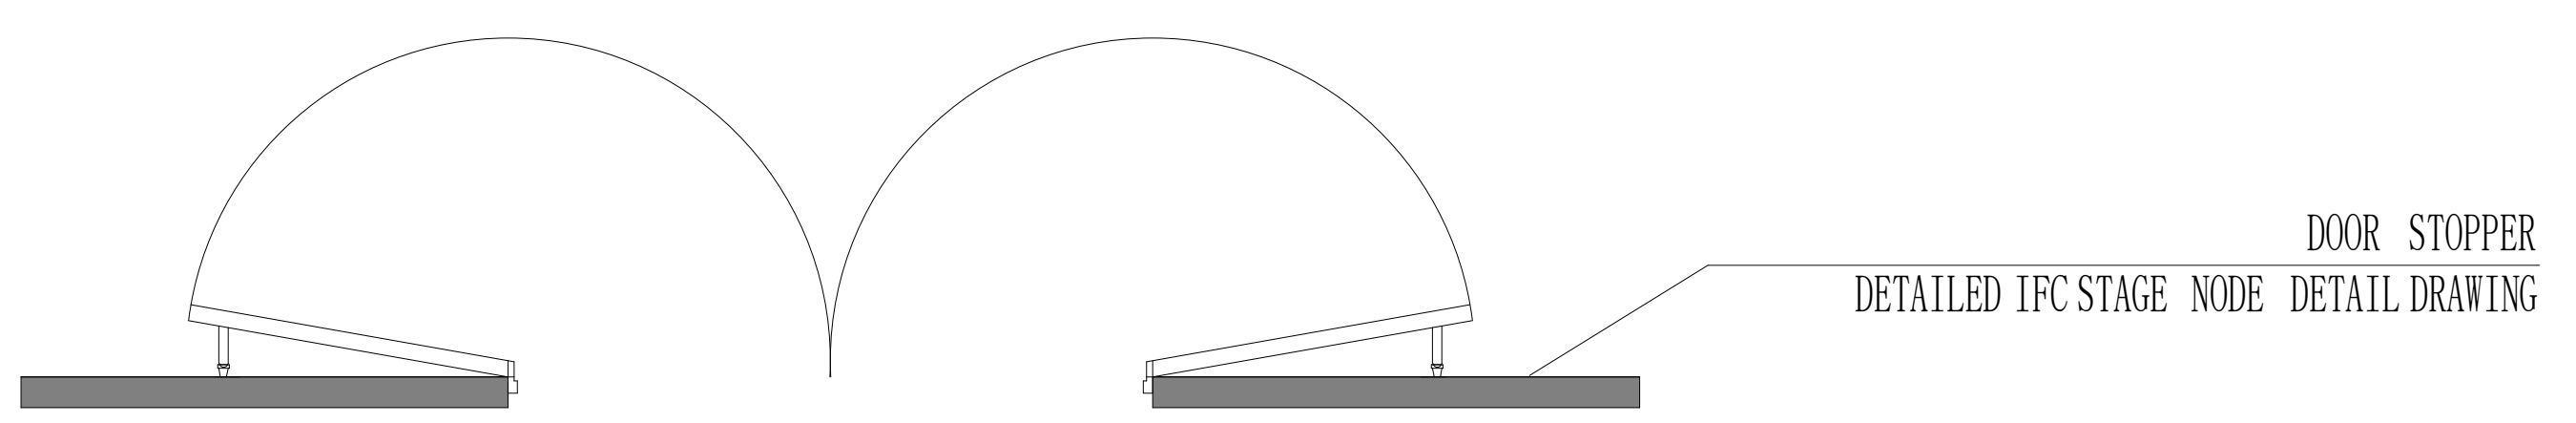
DOOR STOPPER
DETAILED IFC STAGE NODE DETAIL DRAWING

2MM THICK STAINLESS STEEL PROTECTIVE PLATE IS INSTALLED FROM THE GROUND UP TO A HEIGHT OF 1.5 METERS. DETAILED IFC STAGE NODE DETAIL DRAWING

DOOR STOPPER DETAIL

Scale 1:25

FIRE ALARM SPEAKER WALL MOUNTED

COMBINATION HORN/VISIBLE

SURFACE MOUNTED SMOKE DETECTOR, PHOTOELECTRIC TYPE

⬡ PHOTOELECTRIC SMOKE DETECTOR

LED double tube lamp; Ceiling Mounted; System Power 2x20W (+/- 10% In Tolerance); System Lumens >2x2000lm (+/- 10% In Tolerance); Luminaire Efficacy >100lm/w; CCT 5000K; CRI>80; CPF>0.9; Input Voltage 220V-240V 50/60Hz (Mounting height 3.0m)

LED double tube lamp; Ceiling Mounted; System Power 2x20W (+/- 10% In Tolerance); System Lumens >2x2000lm (+/- 10% In Tolerance); Luminaire Efficacy >100lm/w; CCT 5000K; CRI>80; CPF>0.9; Input Voltage 220V-240V 50/60Hz (Mounting height 3.0m)

ALARM BELL

○ CEILING SPEAKER

CLIENT :

GULF EDGE DC 01

87 Wireless Road, M Thai Tower 11th. Floor, All Seasons Place, Lumpini,
Pathumwan, Bangkok 10330, Thailand

CONTRACTOR :

华西发展(泰国)有限公司
บริษัท หัวซือ ดีเวลลอปเม้นต์ (ประเทศไทย) จำกัด
HUASHI DEVELOPMENT CO.,LTD
No. 202, Room No. 1403, 14/F, Le Concorde Building,
Ratchadapisek Road, Huaykhwang Sub-District,
Huaykhwang District, Bangkok Metropolitan 10310.

CONSULTANT :

ARbay
บริษัท เอ อาร์ เบย์ จำกัด
ARbay Company Limited
31 st Floor Bangkok Insurance Building
25 South Sathorn road Thungmahamek
Sathorn Bangkok 10120 THAILAND
T +66 (0) 2286 8199
F +66 (0) 2286 2863
info@arbay.co.th

CONSULTANT :

Qbic Engineers & Architects Co.,Ltd.
8 Soi KALONG 4 SANAMBINNAM ROAD,
THASAI SUB-DISTRICT, MUANG NONTHABURI DISTRICT
, NONTHABURI.
Tel 662-950-4374
Fax 662-580-3231
E-Mail : qbic@qbic.co.th, www.qbic.co.th
QBIC ENGINEERS AND ARCHITECTS CO.,LTD.

CONSULTANT :

MITR
MITR TECHNICAL CONSULTANT CO.,LTD.
1168/8 12th FLOOR, LUMPINI TOWER BUILDING,
RAMA IV RD., THUNGMAHAMEK, SATHORN, BANGKOK 10120, THAILAND
TEL : 0-2679-9079-84
FAX : 0-2679-9085 E-mail: mitr_dd@mitr.com

Architect :	SIGNATURE
ประกิต พนานุรัตน์ วสถ. 580 ที่อยู่ 251/1 ถ.จารุเมือง แขวงรองเมือง เขตปทุมวัน กรุงเทพมหานคร โทรศัพท์ 02-286-8199	
Structural Engineer :	SIGNATURE
วิศวกรผู้ออกแบบโครงสร้าง	
ณัฐสม สงวนวงษ์ วย 1423 ที่อยู่ 2/1 ซ.รามคำแหง 150 ถ.รามคำแหง แขวง สะพานสูง เขต สะพานสูง กทม. 10240	ณัฐสม สงวนวงษ์
Structural Inspector :	SIGNATURE
วิศวกรผู้ตรวจสอบโครงสร้าง	
โกมล จุฑาภัทร วย 964 ที่อยู่ 24/18 ซ.นวมินทร์ 129 ถ. นวมินทร์ แขวง นวลจันทร์ เขต บึงกุ่ม กทม. 10230	
Electrical Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบไฟฟ้ากำลัง	
นายสุภัทร บูรณวิทย์ วฟก.1265 ที่อยู่ 21 ซอยทานสัมฤทธิ์ 13 ตำบลท่าทราย อ.เมืองนนทบุรี จ.นนทบุรี 11000	สุภัทร บูรณวิทย์
Mechanical Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบเครื่องกลและปรับอากาศ	
นายประสิทธิ์ เกี้ยวสุนทร วก.1221 ที่อยู่ 44/372 ซอยบางกระดี่ 35/1 แขวงแสมดำ เขตบางขุนเทียน กทม. 10150	ประสิทธิ์
Sanitary Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบสุขาภิบาล และดับเพลิง	
นายทศวรรษ สนั่นฤทธิ์ วส. 215 ที่อยู่ บ้านเลขที่ 99/107 หมู่ที่ 3 ต.ศีรษะจรเข้น้อย อ.บางเสาธง จ.สมุทรปราการ 10540	ทศวรรษ

ISSUE/REVISION

REV.	DESCRIPTION	DATE
A	90% DEVELOPED	09/05/2026

PROJECT NAME :
GEDC 01

LOCATION:
Nikhom Phattana district, Rayong ,industrial estate,CPGC

BUILDING :
MAIN BUILDING

90% DEVELOPED

TITLE :
DETAIL-3F-DATAHALL3-2(AC),
FANROOMWALLROOM 3-2A,3-2B PLAN

JOB NO.		SCALE	1 : 75
DRAWN	NXR	REF.	
CHECKED	LJC	DWG. NO.	MPK01A-90-A-RD-303
APPROVED	LXD		
DATE	2026.05.09		

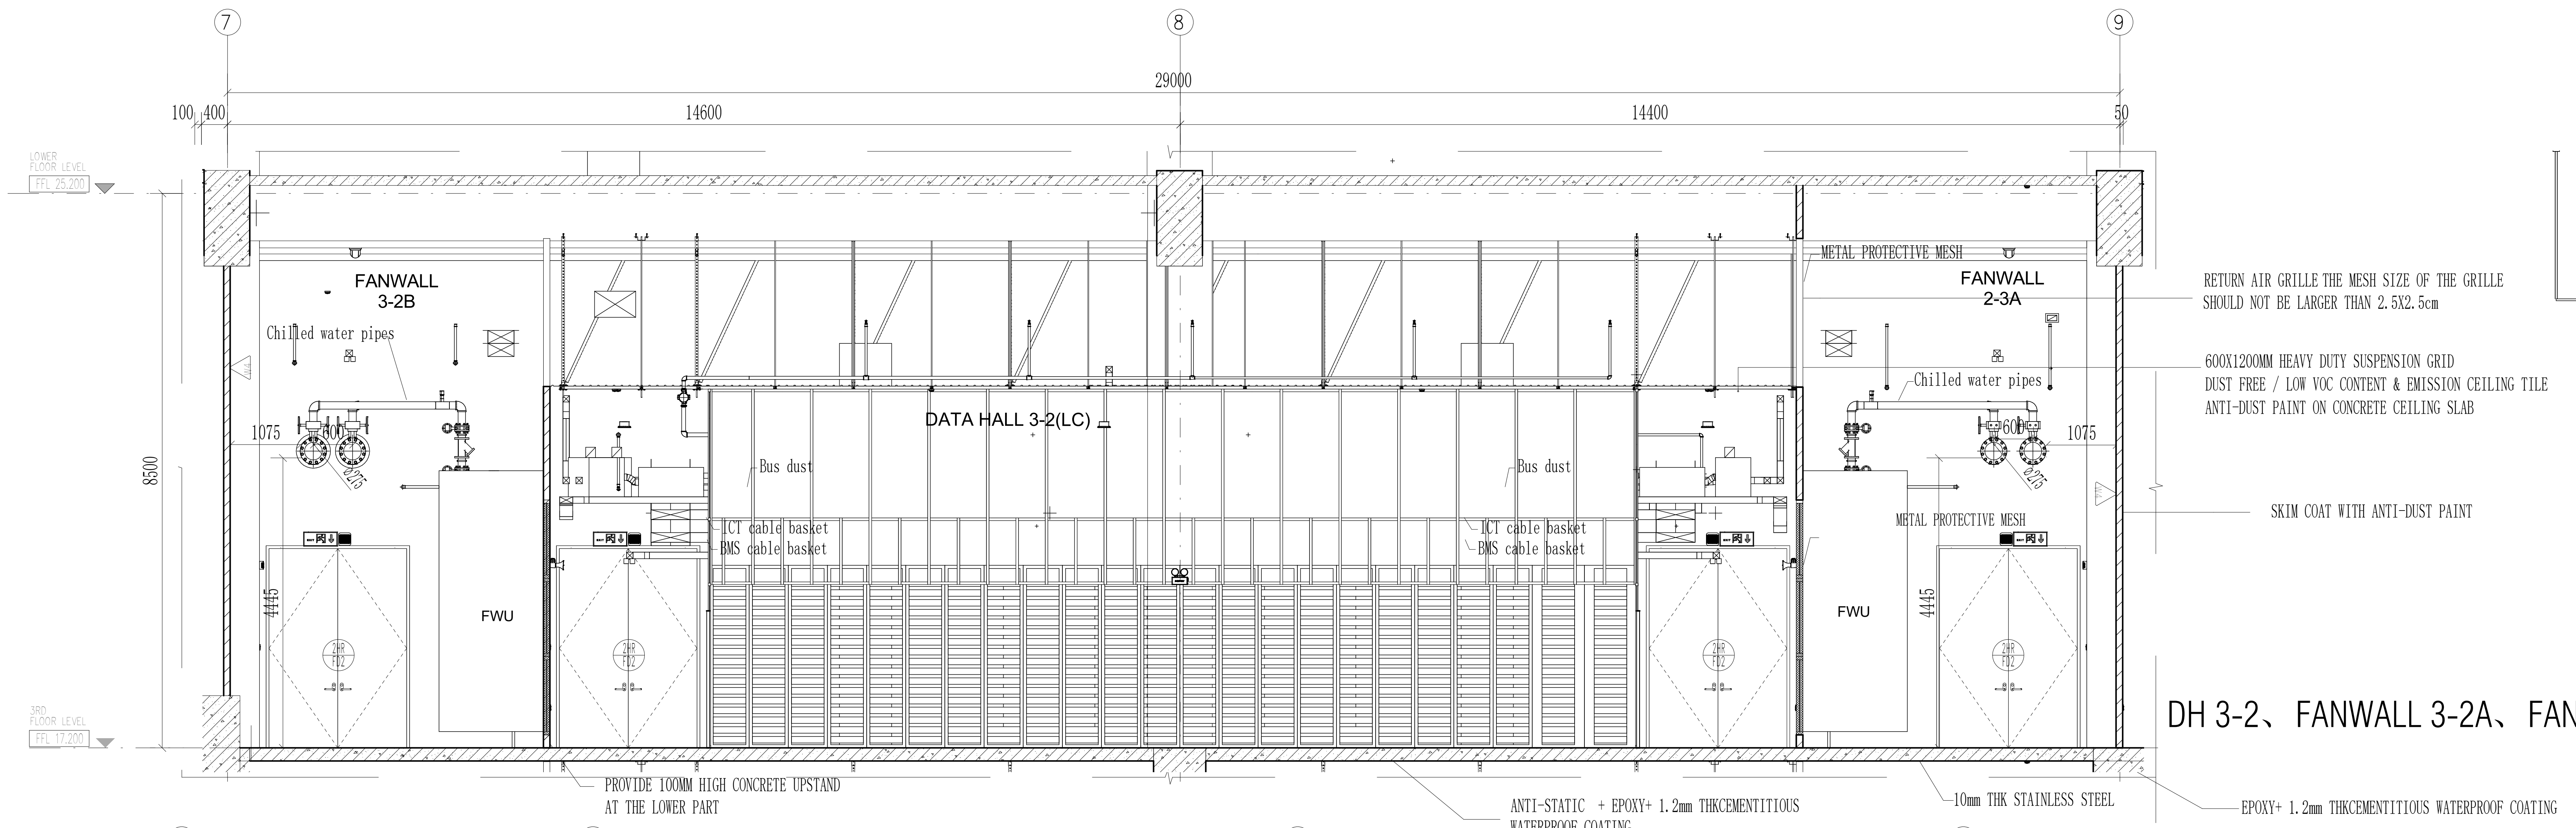
7
8
9
29000
100
400
14600
14400
50
LOWER FLOOR LEVEL
FFL 25.200
3RD FLOOR LEVEL
FFL 17.200
8500
FANWALL 3-2B
Chilled water pipes
1075
600
Ø275
4445
FWU
2HR FD2
DATA HALL 3-2(LC)
Bus dust
ICT cable basket
BMS cable basket
METAL PROTECTIVE MESH
FANWALL 2-3A
Chilled water pipes
600
1075
Ø275
METAL PROTECTIVE MESH
4445
FWU
RETURN AIR GRILLE THE MESH SIZE OF THE GRILLE SHOULD NOT BE LARGER THAN 2.5X2.5cm
600X1200MM HEAVY DUTY SUSPENSION GRID
DUST FREE / LOW VOC CONTENT & EMISSION CEILING TILE
ANTI-DUST PAINT ON CONCRETE CEILING SLAB
SKIM COAT WITH ANTI-DUST PAINT
PROVIDE 100MM HIGH CONCRETE UPSTAND AT THE LOWER PART
ANTI-STATIC + EPOXY+ 1.2mm THKCEMENTITIOUS WATERPROOF COATING
10mm THK STAINLESS STEEL
EPOXY+ 1.2mm THKCEMENTITIOUS WATERPROOF COATING

DH 3-2、FANWALL 3-2A、FANWALL 3-2B SECTION A-A

Scale 1:50

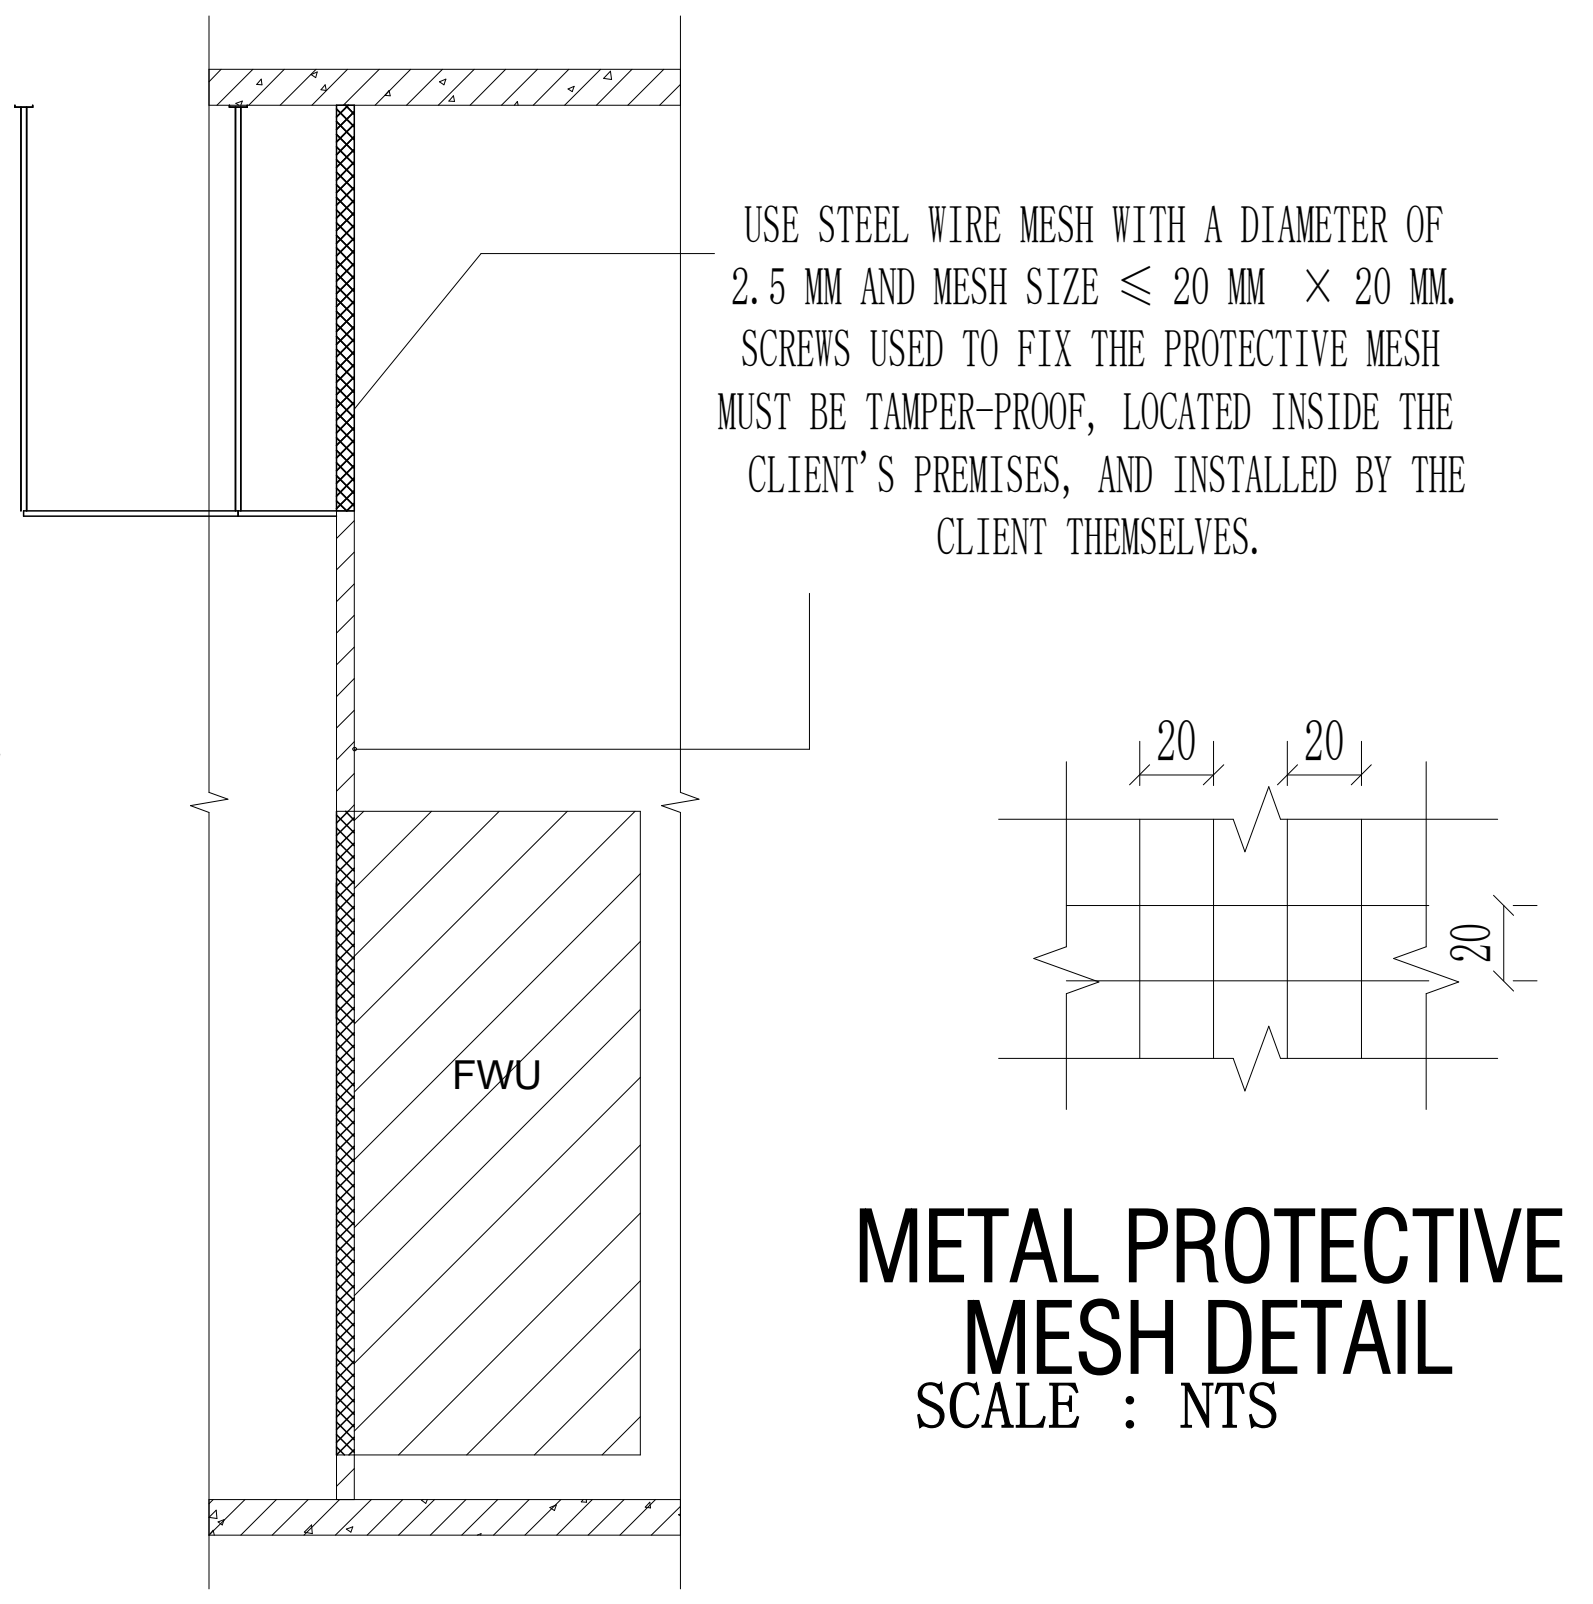
USE STEEL WIRE MESH WITH A DIAMETER OF 2.5 MM AND MESH SIZE ≤ 20 MM × 20 MM. SCREWS USED TO FIX THE PROTECTIVE MESH MUST BE TAMPER-PROOF, LOCATED INSIDE THE CLIENT'S PREMISES, AND INSTALLED BY THE CLIENT THEMSELVES.
FWU
20
20
20

METAL PROTECTIVE MESH DETAIL

SCALE : NTS

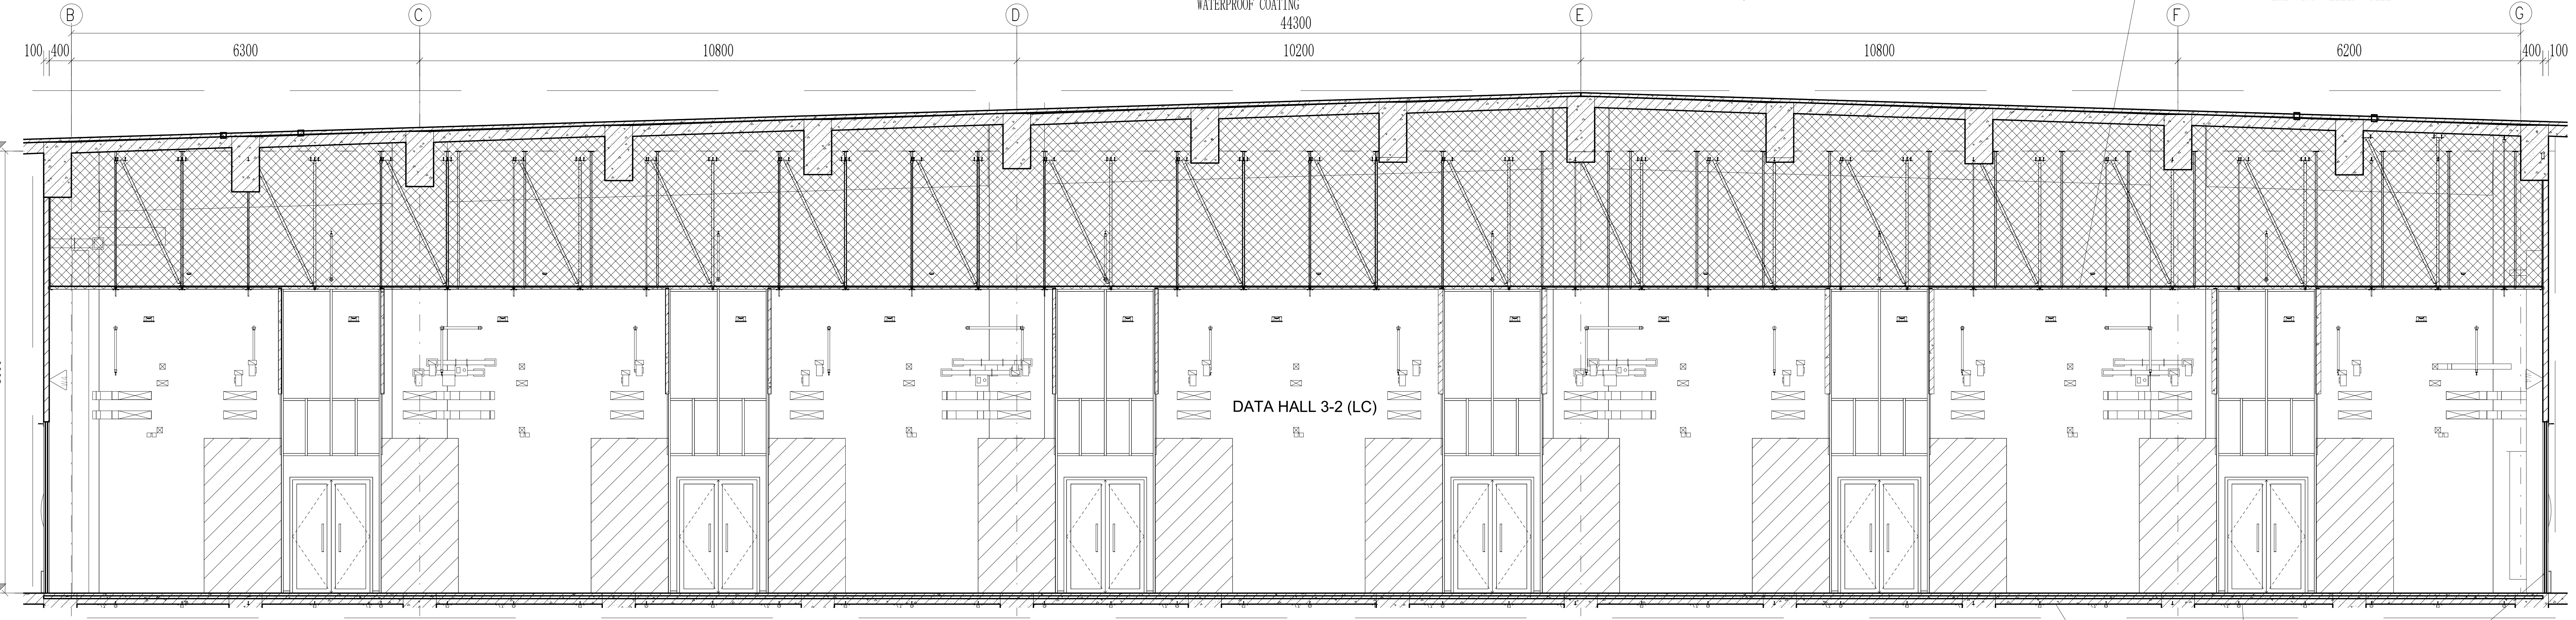
600X1200MM HEAVY DUTY SUSPENSION GRID
DUST FREE / LOW VOC CONTENT & EMISSION CEILING TILE
B
C
D
E
F
G
44300
100
400
6300
10800
10200
10800
6200
400
100
LOWER FLOOR LEVEL
FFL 25.200
3RD FLOOR LEVEL
FFL 17.200
8000
DATA HALL 3-2 (LC)
10mm THK STAINLESS STEEL
SKIM COAT WITH ANTI-DUST PAINT
ANTI-STATIC + EPOXY+ 1.2mm THKCEMENTITIOUS WATERPROOF COATING

DH 3-2 SECTION B-B

Scale 1:50

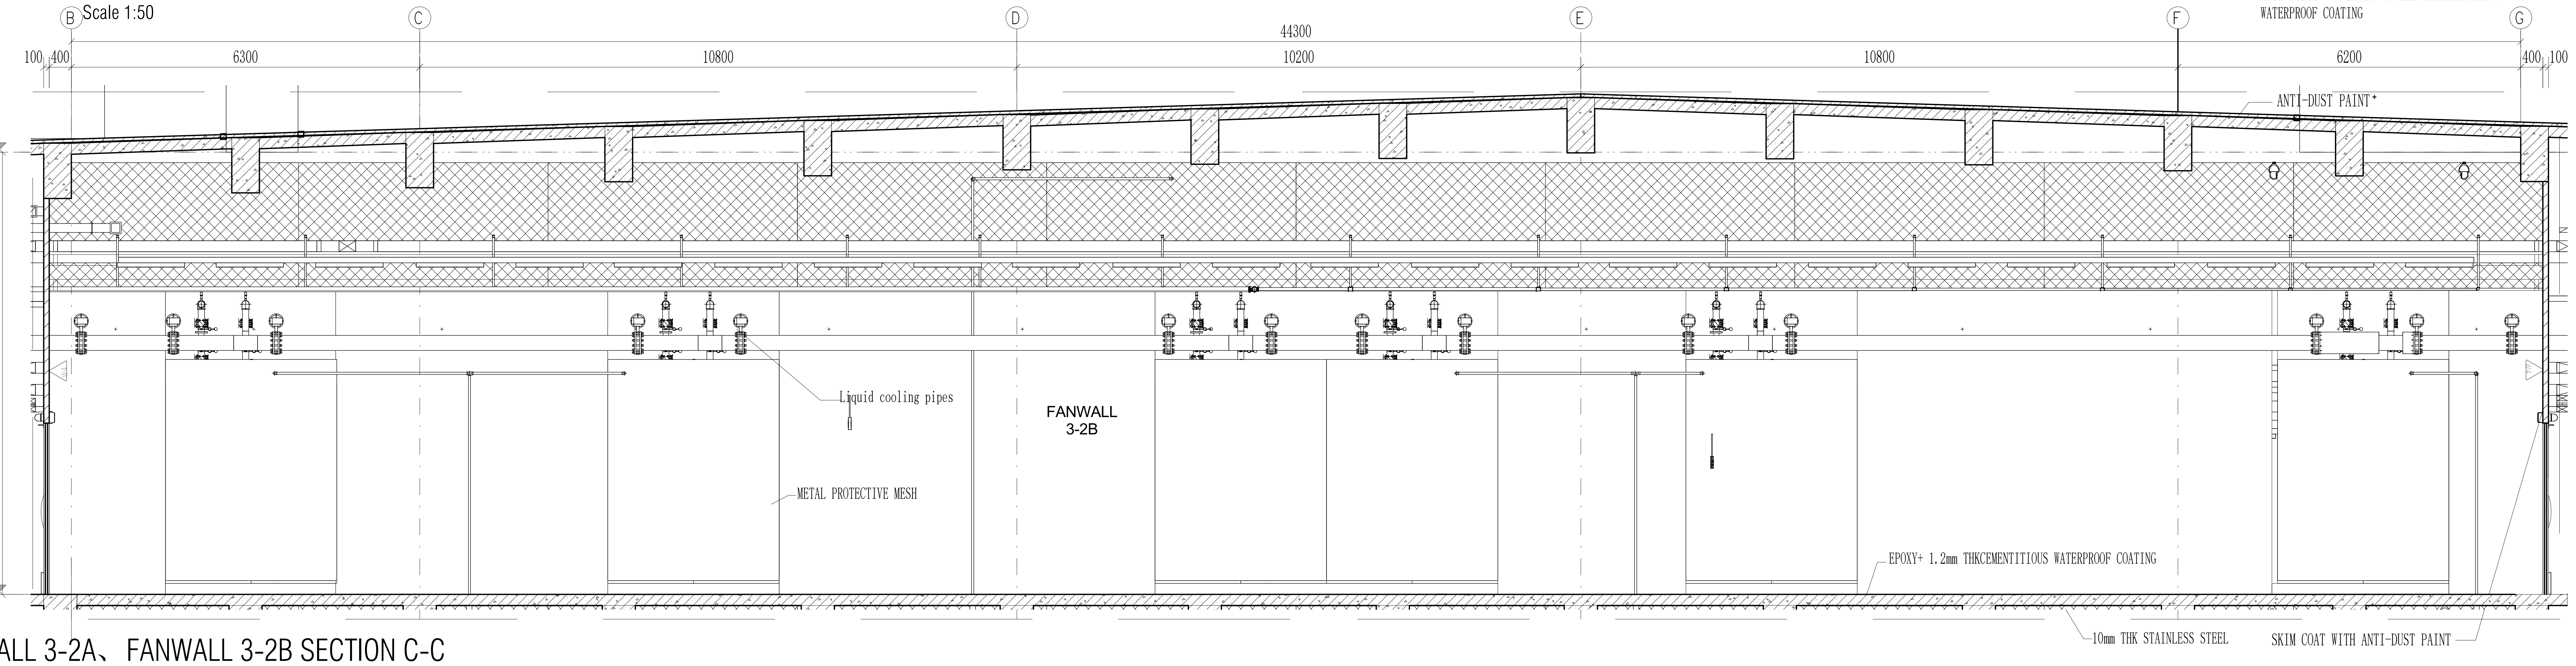
B
C
D
E
F
G
44300
100
400
6300
10800
10200
10800
6200
400
100
ANTI-DUST PAINT
LOWER FLOOR LEVEL
FFL 25.200
3RD FLOOR LEVEL
FFL 17.200
8000
Liquid cooling pipes
FANWALL 3-2B
METAL PROTECTIVE MESH
EPOXY+ 1.2mm THKCEMENTITIOUS WATERPROOF COATING
10mm THK STAINLESS STEEL
SKIM COAT WITH ANTI-DUST PAINT

FANWALL 3-2A、FANWALL 3-2B SECTION C-C

Scale 1:50

CLIENT :

GULF EDGE DC 01

87 Wireless Road, M Thai Tower 11th. Floor, All Seasons Place, Lumpini,
Pathumwan, Bangkok 10330, Thailand

CONTRACTOR :

华西发展(泰国)有限公司
บริษัท หัวซือ ดีเวลลอปเม้นต์ (ประเทศไทย) จำกัด
HUASHI DEVELOPMENT CO.,LTD
No. 202, Room No. 1403, 14/F, Le Concorde Building,
Ratchadapisek Road, Huaykhwang Sub-District,
Huaykhwang District, Bangkok Metropolitan 10310.

CONSULTANT :

ARbay
บริษัท เอ อาร์ เบย์ จำกัด
ARbay Company Limited
31 st Floor Bangkok Insurance Building
25 South Sathorn road Thungmahamek
Sathorn Bangkok 10120 THAILAND
T +66 (0) 2286 8199
F +66 (0) 2286 2863
info@arbay.co.th

CONSULTANT :

Qbic Engineers & Architects Co.,Ltd.
8 Soi KALONG 4 SANAMBINNAM ROAD,
THASAI SUB-DISTRICT, MUANG NONTHABURI DISTRICT
, NONTHABURI.
Tel 662-950-4374
Fax 662-580-3231
E-Mail : qbic@qbic.co.th, www.qbic.co.th
QBIC ENGINEERS AND ARCHITECTS CO.,LTD.

CONSULTANT :

MITR
MITR TECHNICAL CONSULTANT CO.,LTD.
1168/8 12th FLOOR, LUMPINI TOWER BUILDING,
RAMA IV RD., THUNGMAHAMEK, SATHORN, BANGKOK 10120, THAILAND
TEL : 0-2679-9079-84
FAX : 0-2679-9085 E-mail: mitr_dd@mitr.com

Architect :	SIGNATURE
ประกิต พนานุรัตน์ วสถ. 580 ที่อยู่ 251/1 ถ.จารุเมือง แขวงรองเมือง เขตปทุมวัน กรุงเทพมหานคร โทรศัพท์ 02-286-8199	
Structural Engineer :	SIGNATURE
วิศวกรผู้ออกแบบโครงสร้าง	
ณัฐสม สงวนวงษ์ วย 1423 ที่อยู่ 2/1 ซ.รามคำแหง 150 ถ.รามคำแหง แขวง สะพานสูง เขต สะพานสูง กทม. 10240	ณัฐสม สงวนวงษ์
Structural Inspector :	SIGNATURE
วิศวกรผู้ตรวจสอบโครงสร้าง	
โกมล จุฑาภัทร วย 964 ที่อยู่ 24/18 ซ.นวมินทร์ 129 ถ. นวมินทร์ แขวง นวลจันทร์ เขต บึงกุ่ม กทม. 10230	
Electrical Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบไฟฟ้ากำลัง	
นายสุภัทร บูรณวิทย์ วฟก.1265 ที่อยู่ 21 ซอยทานสัมฤทธิ์ 13 ตำบลท่าทราย อ.เมืองนนทบุรี จ.นนทบุรี 11000	สุภัทร บูรณวิทย์
Mechanical Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบเครื่องกลและปรับอากาศ	
นายประสิทธิ์ เกี้ยวสุนทร วก.1221 ที่อยู่ 44/372 ซอยบางกระดี่ 35/1 แขวงแสมดำ เขตบางขุนเทียน กทม. 10150	ประสิทธิ์
Sanitary Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบสุขาภิบาล และดับเพลิง	
นายทศวรรษ สนั่นฤทธิ์ วส. 215 ที่อยู่ บ้านเลขที่ 99/107 หมู่ที่ 3 ต.ศีรษะจรเข้น้อย อ.บางเสาธง จ.สมุทรปราการ 10540	ทศวรรษ

ISSUE/REVISION

REV.	DESCRIPTION	DATE
A	90% DEVELOPED	09/05/2026

PROJECT NAME :

GEDC 01

LOCATION:
Nikhom Phattana district, Rayong ,industrial estate,CPGC

BUILDING :
MAIN BUILDING

90% DEVELOPED

TITLE :

DETAIL-3F-DATAHALL3-2(AC),
FANROOMWALLROOM 3-2A,3-2B
SECTION

JOB NO.		SCALE	1 : 50
DRAWN	NXR	REF.	
CHECKED	LJC	DWG. NO.	MPK01A-90-A-RD-304
APPROVED	LXD		
DATE	2026.05.09		

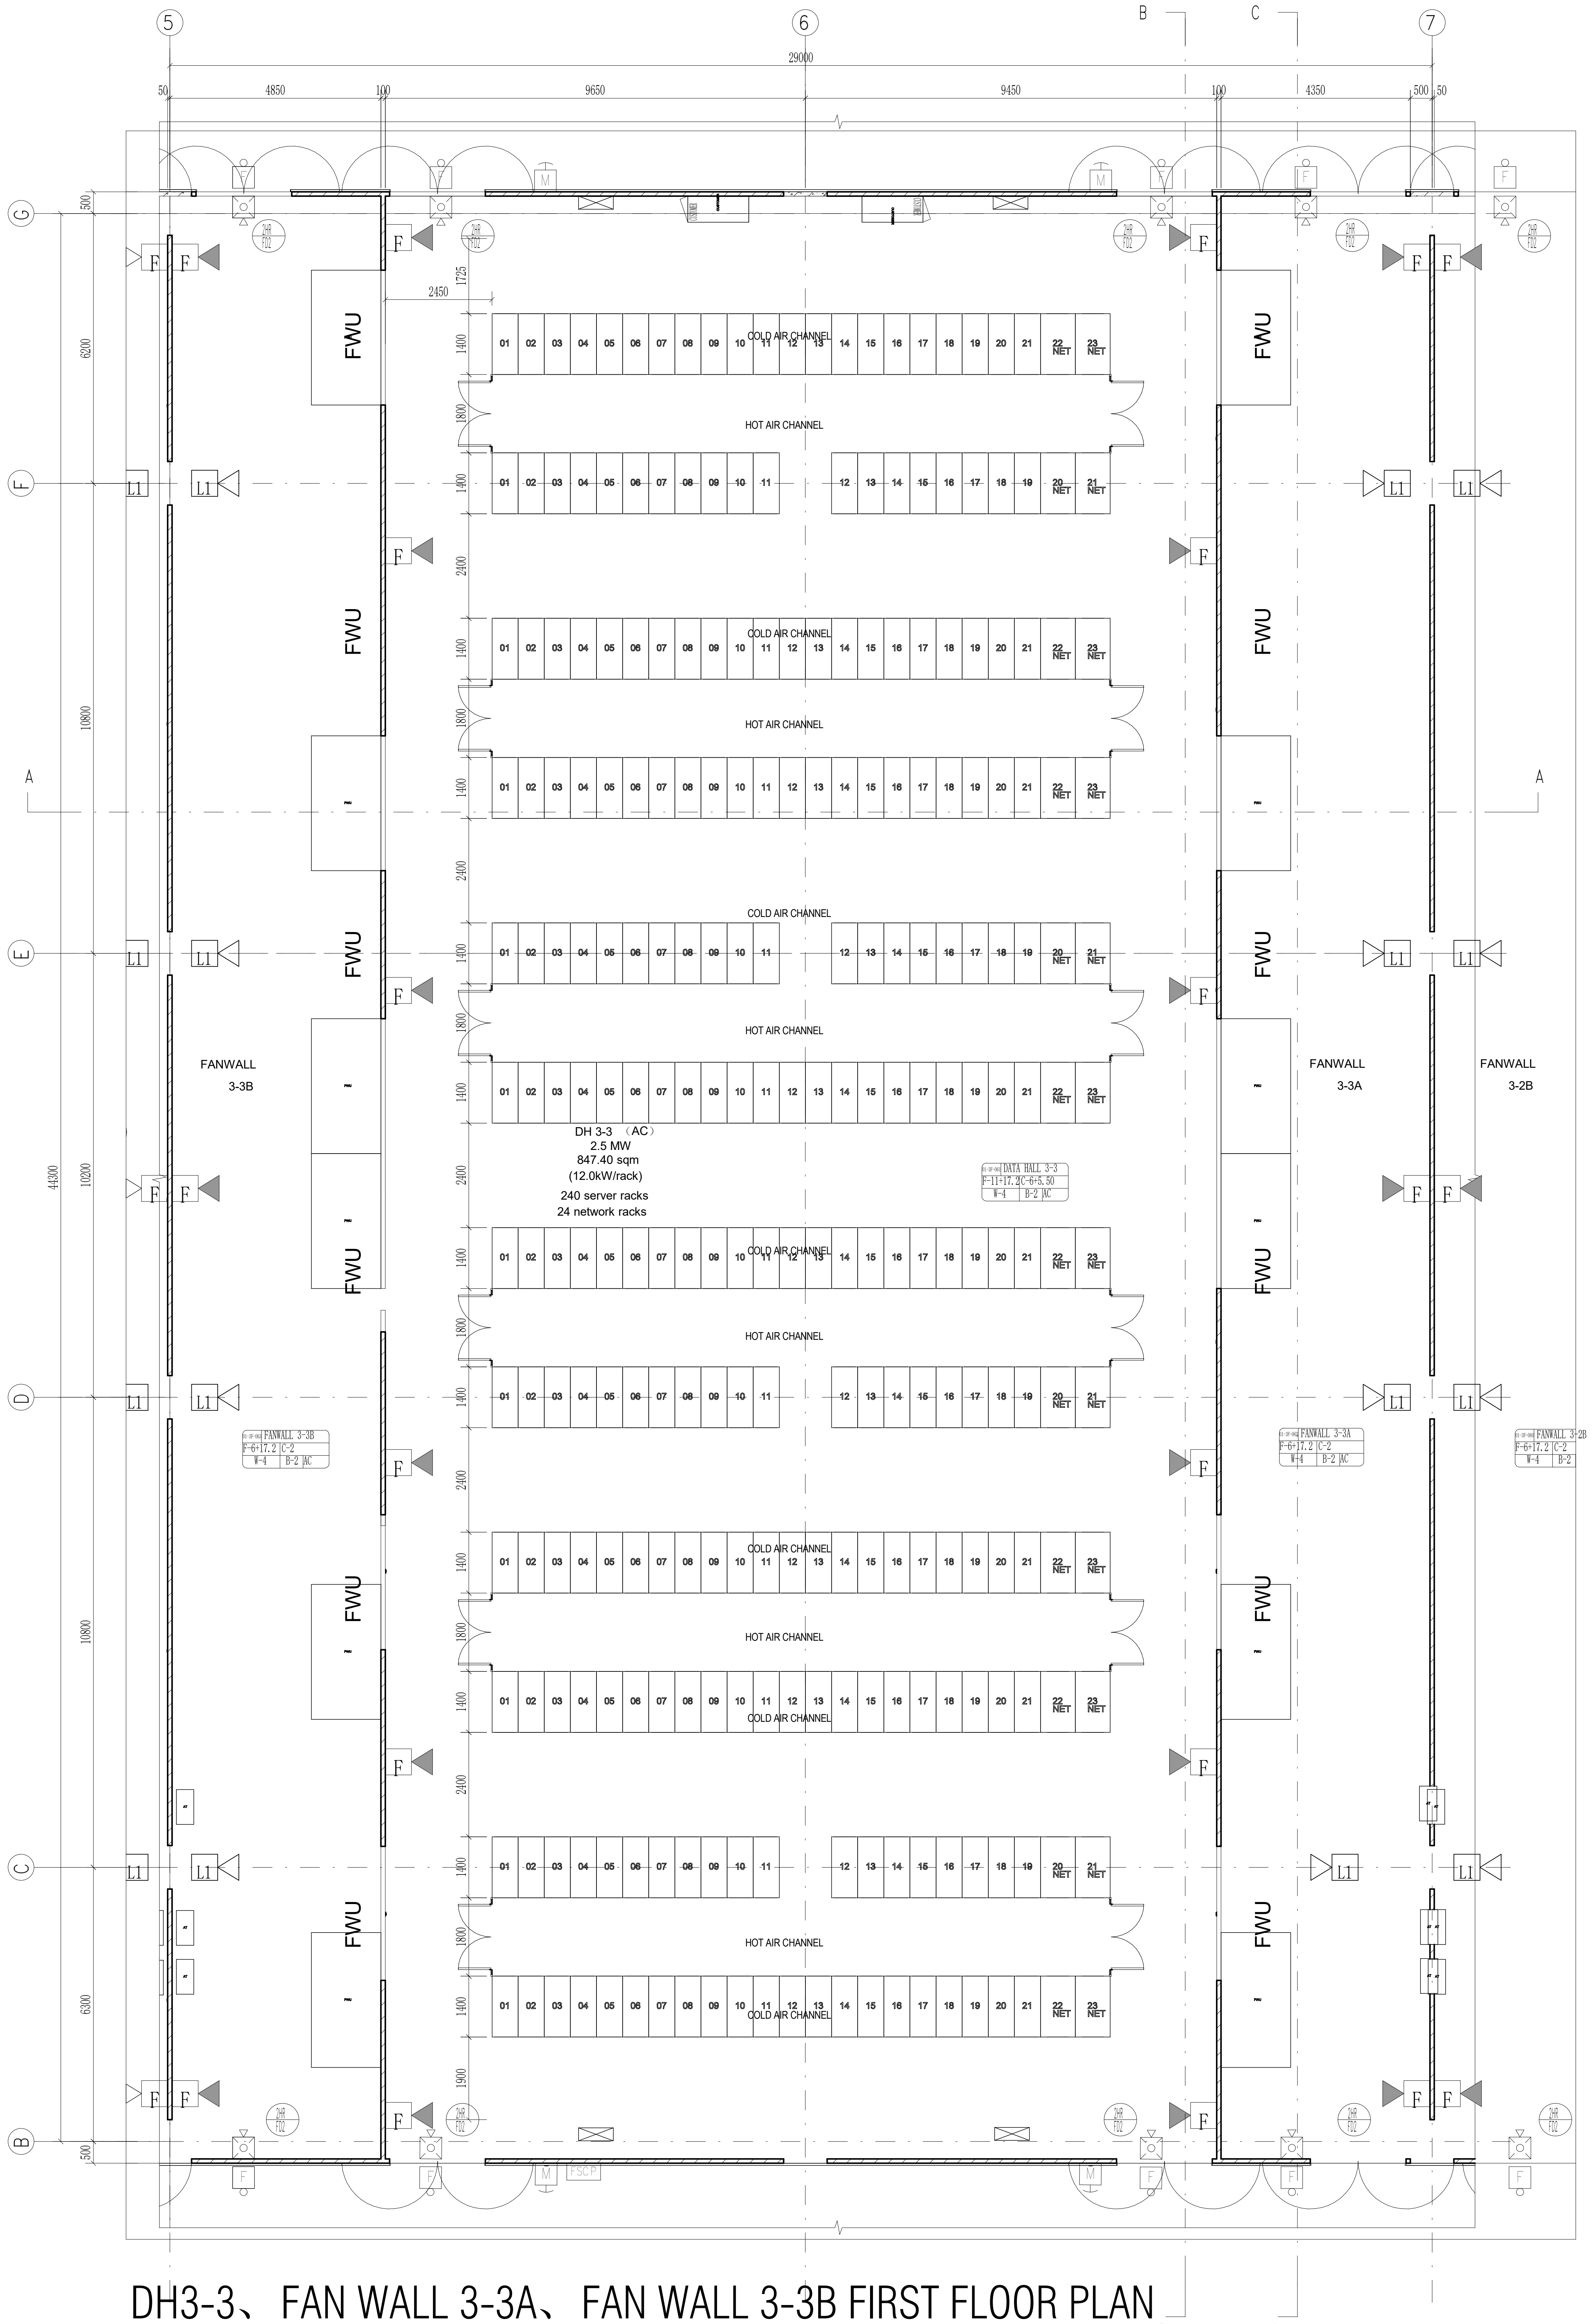

DH3-3、FAN WALL 3-3A、FAN WALL 3-3B FIRST FLOOR PLAN

Scale 1:75

THE "SFL" MARKED IN THE DRAWING REFERS TO THE STRUCTURAL FLOOR LEVEL, WHILE THE FINISHED FLOOR LEVEL (FFL) IS DETERMINED BASED ON FLOOR FINISHES.

Room Number	Room Name	Room Type	0kW/RACK	12kW/RACK	16kW/RACK	21kW/RACK	Rack Count	Design IT Load (Mw)
01-3F-056	Data Hall3-3	Air-cooled	0	240	24	0	264	2.5

Note On Levels- All Levels Shown Are Absolute Elevation	
☒	0kW/RACK
▯	12kW/RACK
☒	16kW/RACK
⧄	21kW/RACK

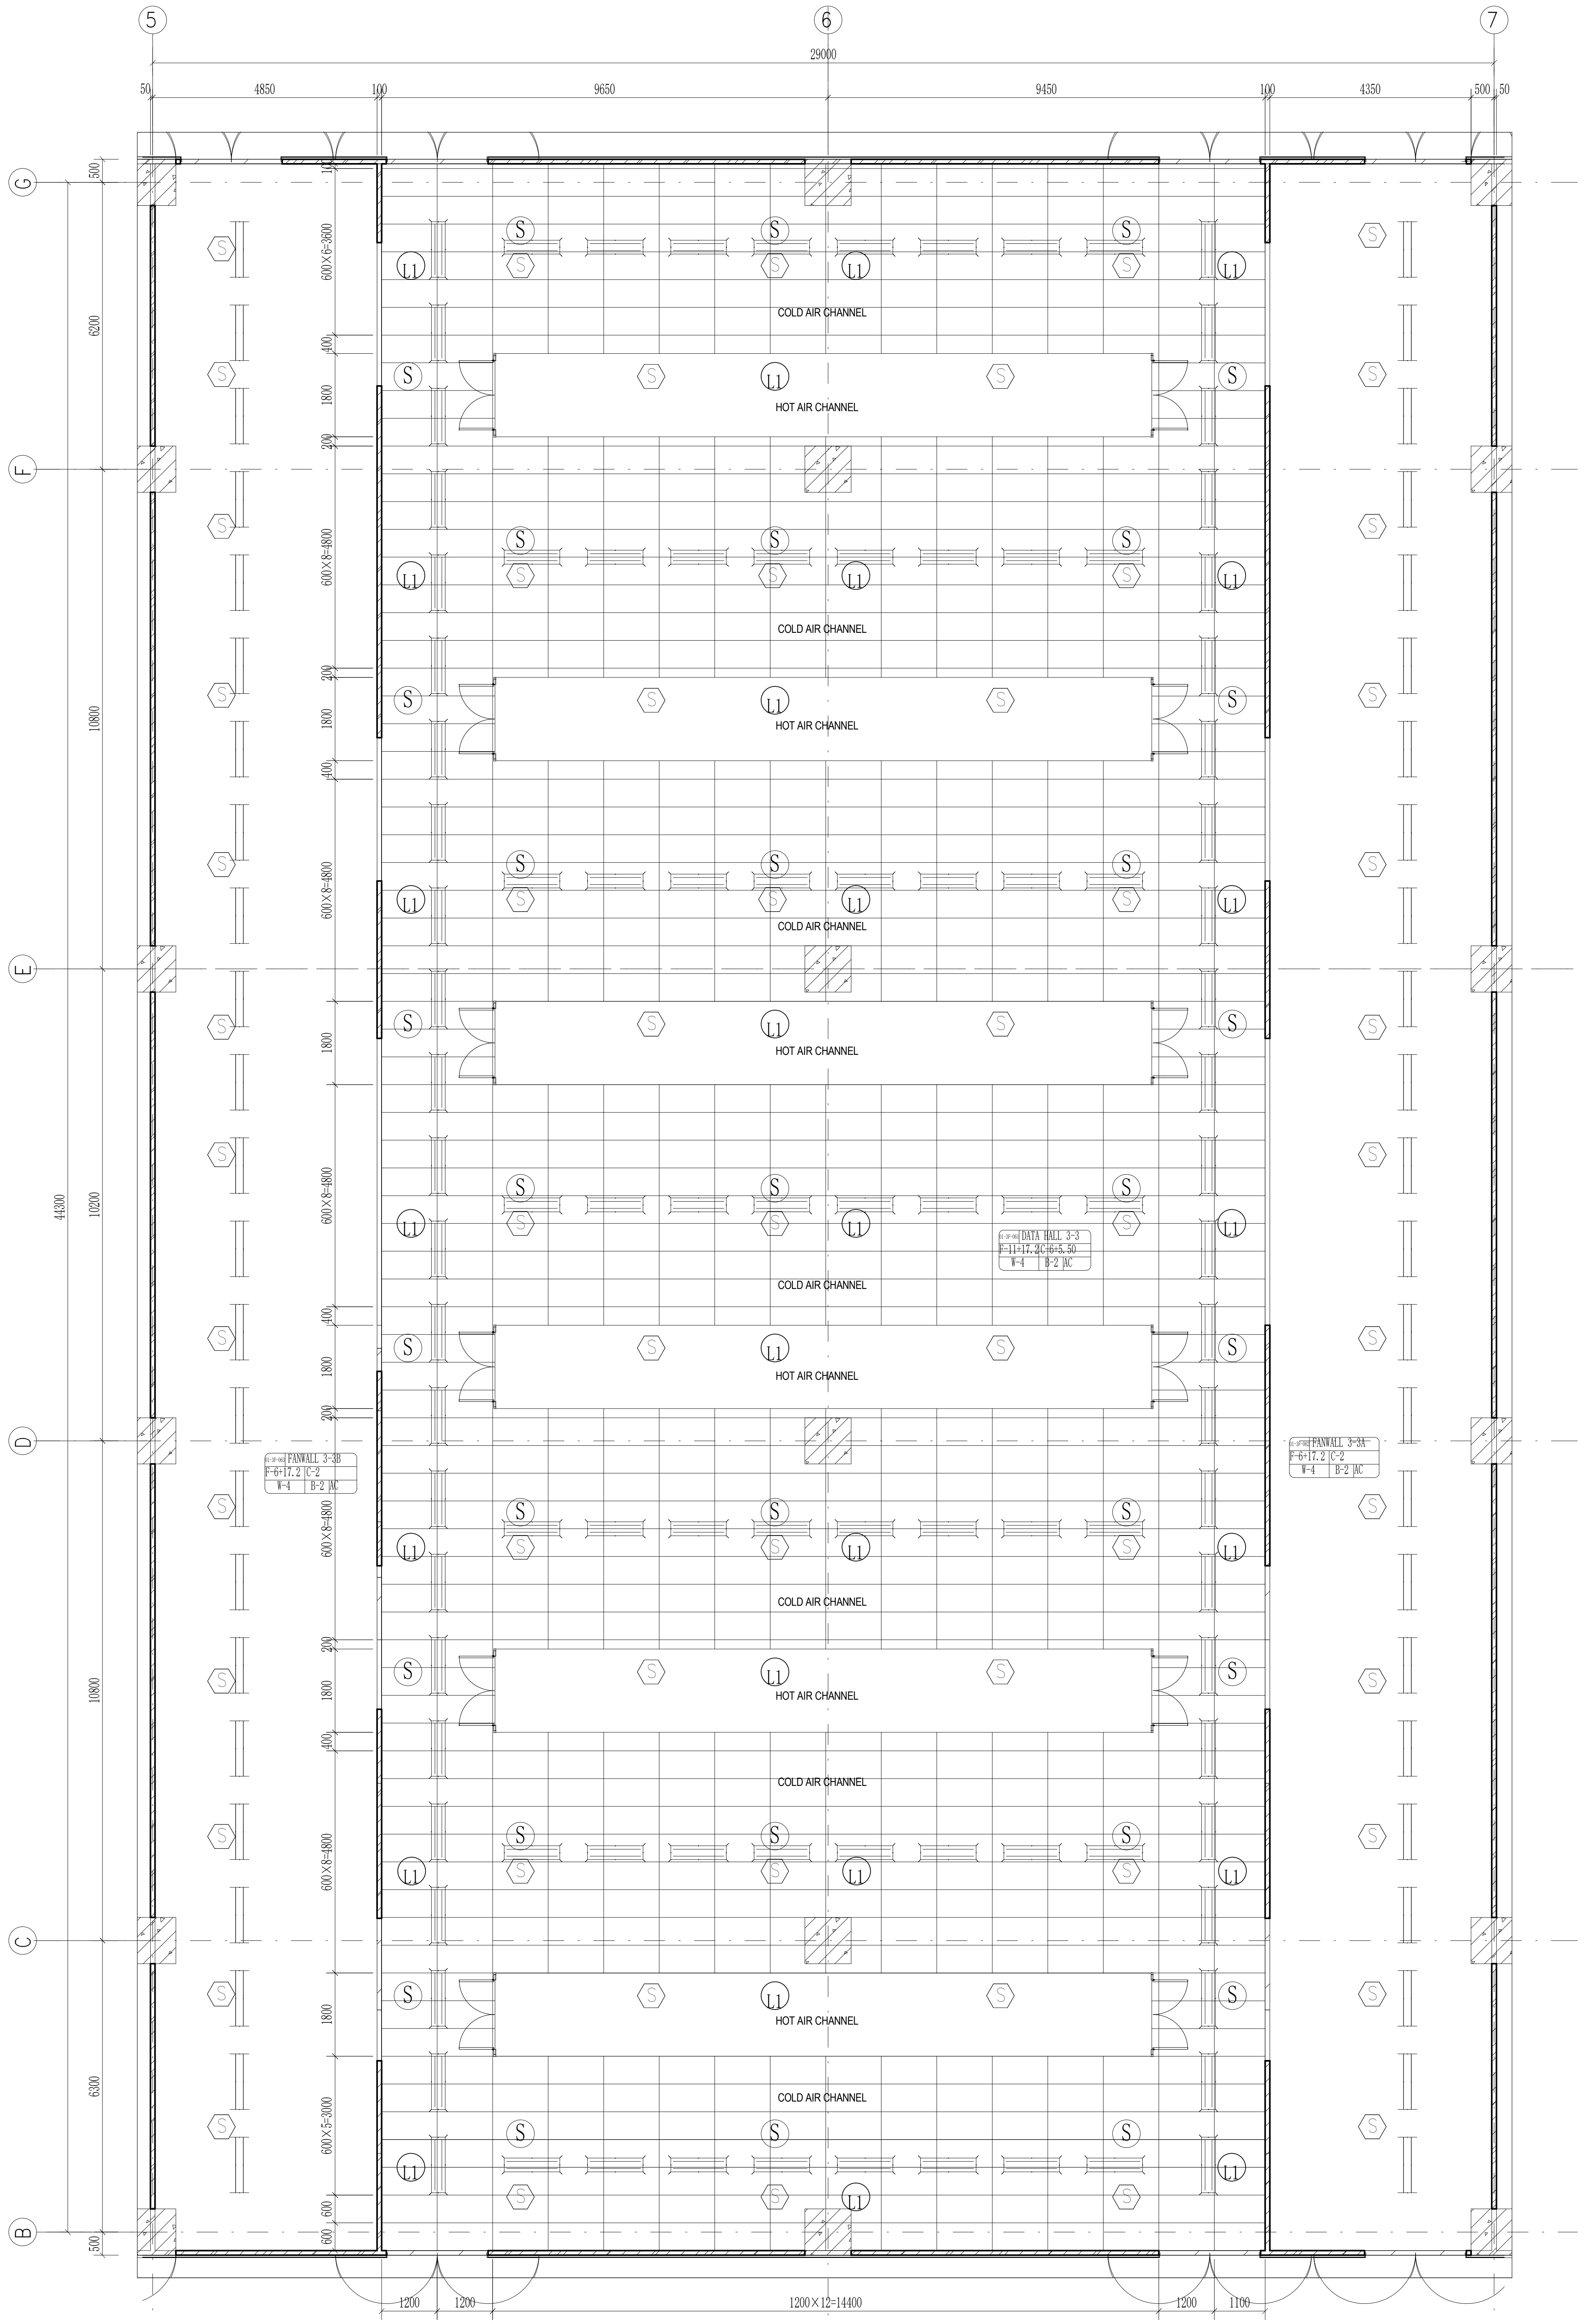

DH3-3 CEILING LAYOUT

Scale 1:75

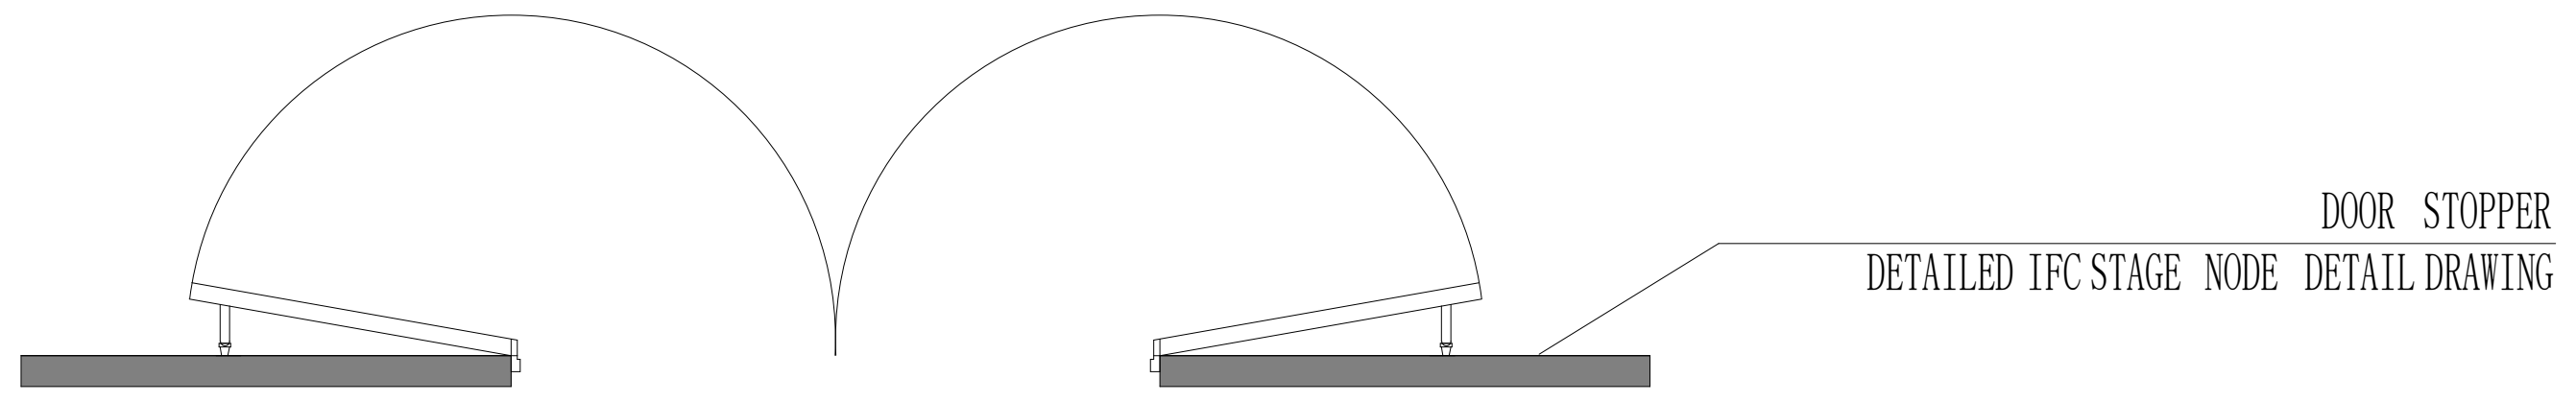

DOOR STOPPER DETAIL

Scale 1:25

2MM THICK STAINLESS STEEL PROTECTIVE PLATE IS INSTALLED FROM THE GROUND UP TO A HEIGHT OF 1.5 METERS. DETAILED IFC STAGE NODE DETAIL DRAWING

◀ FIRE ALARM SPEAKER WALL MOUNTED

☒ COMBINATION HORN/VISIBLE

SURFACE MOUNTED SMOKE DETECTOR, PHOTOELECTRIC TYPE

⬡ PHOTOELECTRIC SMOKE DETECTOR

LED double tube lamp; Ceiling Mounted; System Power 2x20W (+/- 10% In Tolerance); System Lumens >2x2000lm (+/- 10% In Tolerance); Luminaire Efficacy >100lm/w; CCT 5000K; CRI>80; CPF>0.9; Input Voltage 220V-240V 50/60Hz (Mounting height 3.0m)

LED double tube lamp; Ceiling Mounted; System Power 2x20W (+/- 10% In Tolerance); System Lumens >2x2000lm (+/- 10% In Tolerance); Luminaire Efficacy >100lm/w; CCT 5000K; CRI>80; CPF>0.9; Input Voltage 220V-240V 50/60Hz (Mounting height 3.0m)

F ALARM BELL

○ CEILING SPEAKER

CLIENT :

GULF EDGE DC 01

87 Wireless Road, M Thai Tower 11th. Floor, All Seasons Place, Lumpini, Pathumwan, Bangkok 10330, Thailand

CONTRACTOR :

华西发展(泰国)有限公司
บริษัท หัวซือ ดีเวลลอปเม้นต์ (ประเทศไทย) จำกัด
HUASHI DEVELOPMENT CO.,LTD
No. 202, Room No. 1403, 14/F, Le Concorde Building,
Ratchadapisek Road, Huaykhwang Sub-District,
Huaykhwang District, Bangkok Metropolitan 10310.

CONSULTANT :

ARbay
บริษัท เอ อาร์ เบย์ จำกัด
ARbay Company Limited
31 st Floor Bangkok Insurance Building
25 South Sathorn road Thungmahamek
Sathorn Bangkok 10120 THAILAND
T +66 (0) 2286 8199
F +66 (0) 2286 2863
info@arbay.co.th

CONSULTANT :

Qbic Engineers & Architects Co.,Ltd.
8 Soi KALONG 4 SANAMBINNAM ROAD,
THASAI SUB-DISTRICT, MUANG NONTHABURI DISTRICT
, NONTHABURI.
Tel 662-950-4374
Fax 662-580-3231
E-Mail : qbic@qbic.co.th, www.qbic.co.th
QBIC ENGINEERS AND ARCHITECTS CO.,LTD.

CONSULTANT :

MITR
MITR TECHNICAL CONSULTANT CO.,LTD.
1168/8 12th FLOOR, LUMPINI TOWER BUILDING,
RAMA IV RD., THUNGMAHAMEK, SATHORN, BANGKOK 10120, THAILAND
TEL : 0-2679-9079-84
FAX : 0-2679-9085 E-mail: mitr_dd@mitr.com

Architect : SIGNATURE
ประกิต พนานุรัตน์ วสถ. 580
ที่อยู่
251/1 ถ.จารุเมือง แขวงรองเมือง เขตปทุมวัน
กรุงเทพมหานคร โทรศัพท์ 02-286-8199

Structural Engineer : SIGNATURE
วิศวกรผู้ออกแบบโครงสร้าง
ณัฐสม สงวนวงษ์ วย 1423
ที่อยู่
2/1 ซ.รามคำแหง 150 ถ.รามคำแหง
แขวง สะพานสูง เขต สะพานสูง กทม. 10240

Structural Inspector : SIGNATURE
วิศวกรผู้ตรวจสอบโครงสร้าง
โกมล จุฑาภัทร วย 964
ที่อยู่
24/18 ซ.นวมินทร์ 129 ถ. นวมินทร์
แขวง นวลจันทร์ เขต บึงกุ่ม กทม. 10230

Electrical Engineer : SIGNATURE
วิศวกรผู้ออกแบบระบบไฟฟ้ากำลัง
นายสุภัทร บูรณวิทย์ วฟก.1265
ที่อยู่
21 ซอยทานสัมฤทธิ์ 13
ตำบลท่าทราย อ.เมืองนนทบุรี จ.นนทบุรี 11000

Mechanical Engineer : SIGNATURE
วิศวกรผู้ออกแบบระบบเครื่องกลและปรับอากาศ
นายประสิทธิ์ เกี้ยวสุนทร วก.1221
ที่อยู่
44/372 ซอยบางกระดี่ 35/1 แขวงแสมดำ
เขตบางขุนเทียน กทม. 10150
ประสิทธิ์

Sanitary Engineer : SIGNATURE
วิศวกรผู้ออกแบบระบบสุขาภิบาล และดับเพลิง
นายทศวรรษ สนั่นฤทธิ์ วส. 215
ที่อยู่
บ้านเลขที่ 99/107 หมู่ที่ 3 ต.ศีรษะจรเข้น้อย
อ.บางเสาธง จ.สมุทรปราการ 10540
ทศวรรษ

ISSUE/REVISION

REV.	DESCRIPTION	DATE
A	90% DEVELOPED	09/05/2026

PROJECT NAME :
GEDC 01
LOCATION:
Nikhom Phattana district, Rayong ,industrial estate,CPGC

BUILDING :
MAIN BUILDING

90% DEVELOPED

TITLE :
ROOM DETAIL-3F-DATAHALL3-3(AC)
FANWALLROOM 3-3A,3-3B PLAN

JOB NO.	SCALE 1 : 75
DRAWN NXR	REF.
CHECKED LJC	DWG. NO. MPK01A-90-A-RD-305
APPROVED LXD	
DATE 2026.05.09	

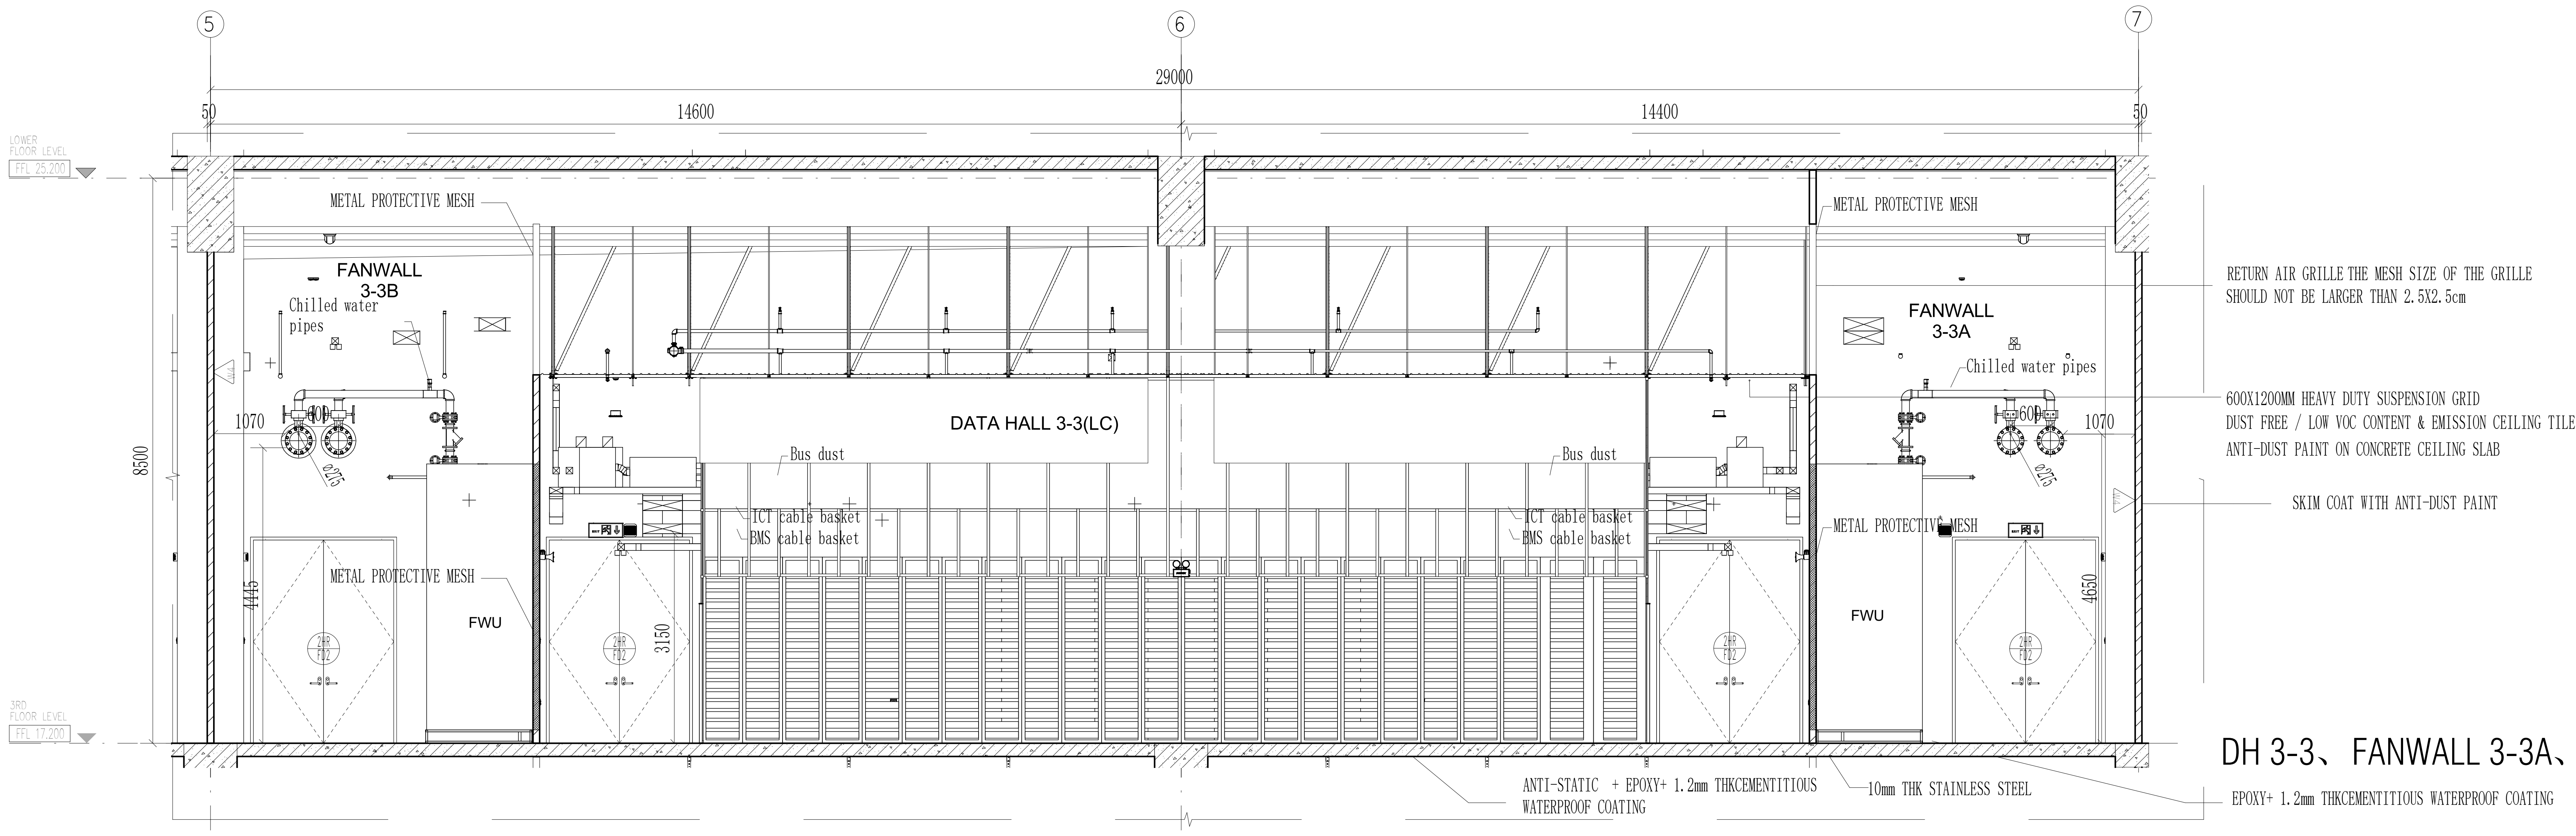
5
6
7
29000
14600
14400
50
50
LOWER FLOOR LEVEL
FFL 25.200
3RD FLOOR LEVEL
FFL 17.200
METAL PROTECTIVE MESH
FANWALL 3-3B
Chilled water pipes
1070
8500
4445
FWU
DATA HALL 3-3(LC)
Bus dust
ICT cable basket
BMS cable basket
3150
FANWALL 3-3A
Chilled water pipes
4650
RETURN AIR GRILLE THE MESH SIZE OF THE GRILLE SHOULD NOT BE LARGER THAN 2.5X2.5cm
600X1200MM HEAVY DUTY SUSPENSION GRID
DUST FREE / LOW VOC CONTENT & EMISSION CEILING TILE
ANTI-DUST PAINT ON CONCRETE CEILING SLAB
SKIM COAT WITH ANTI-DUST PAINT
ANTI-STATIC + EPOXY+ 1.2mm THKCEMENTITIOUS WATERPROOF COATING
10mm THK STAINLESS STEEL
EPOXY+ 1.2mm THKCEMENTITIOUS WATERPROOF COATING

DH 3-3、FANWALL 3-3A、FANWALL 3-3B SECTION A-A

Scale 1:50

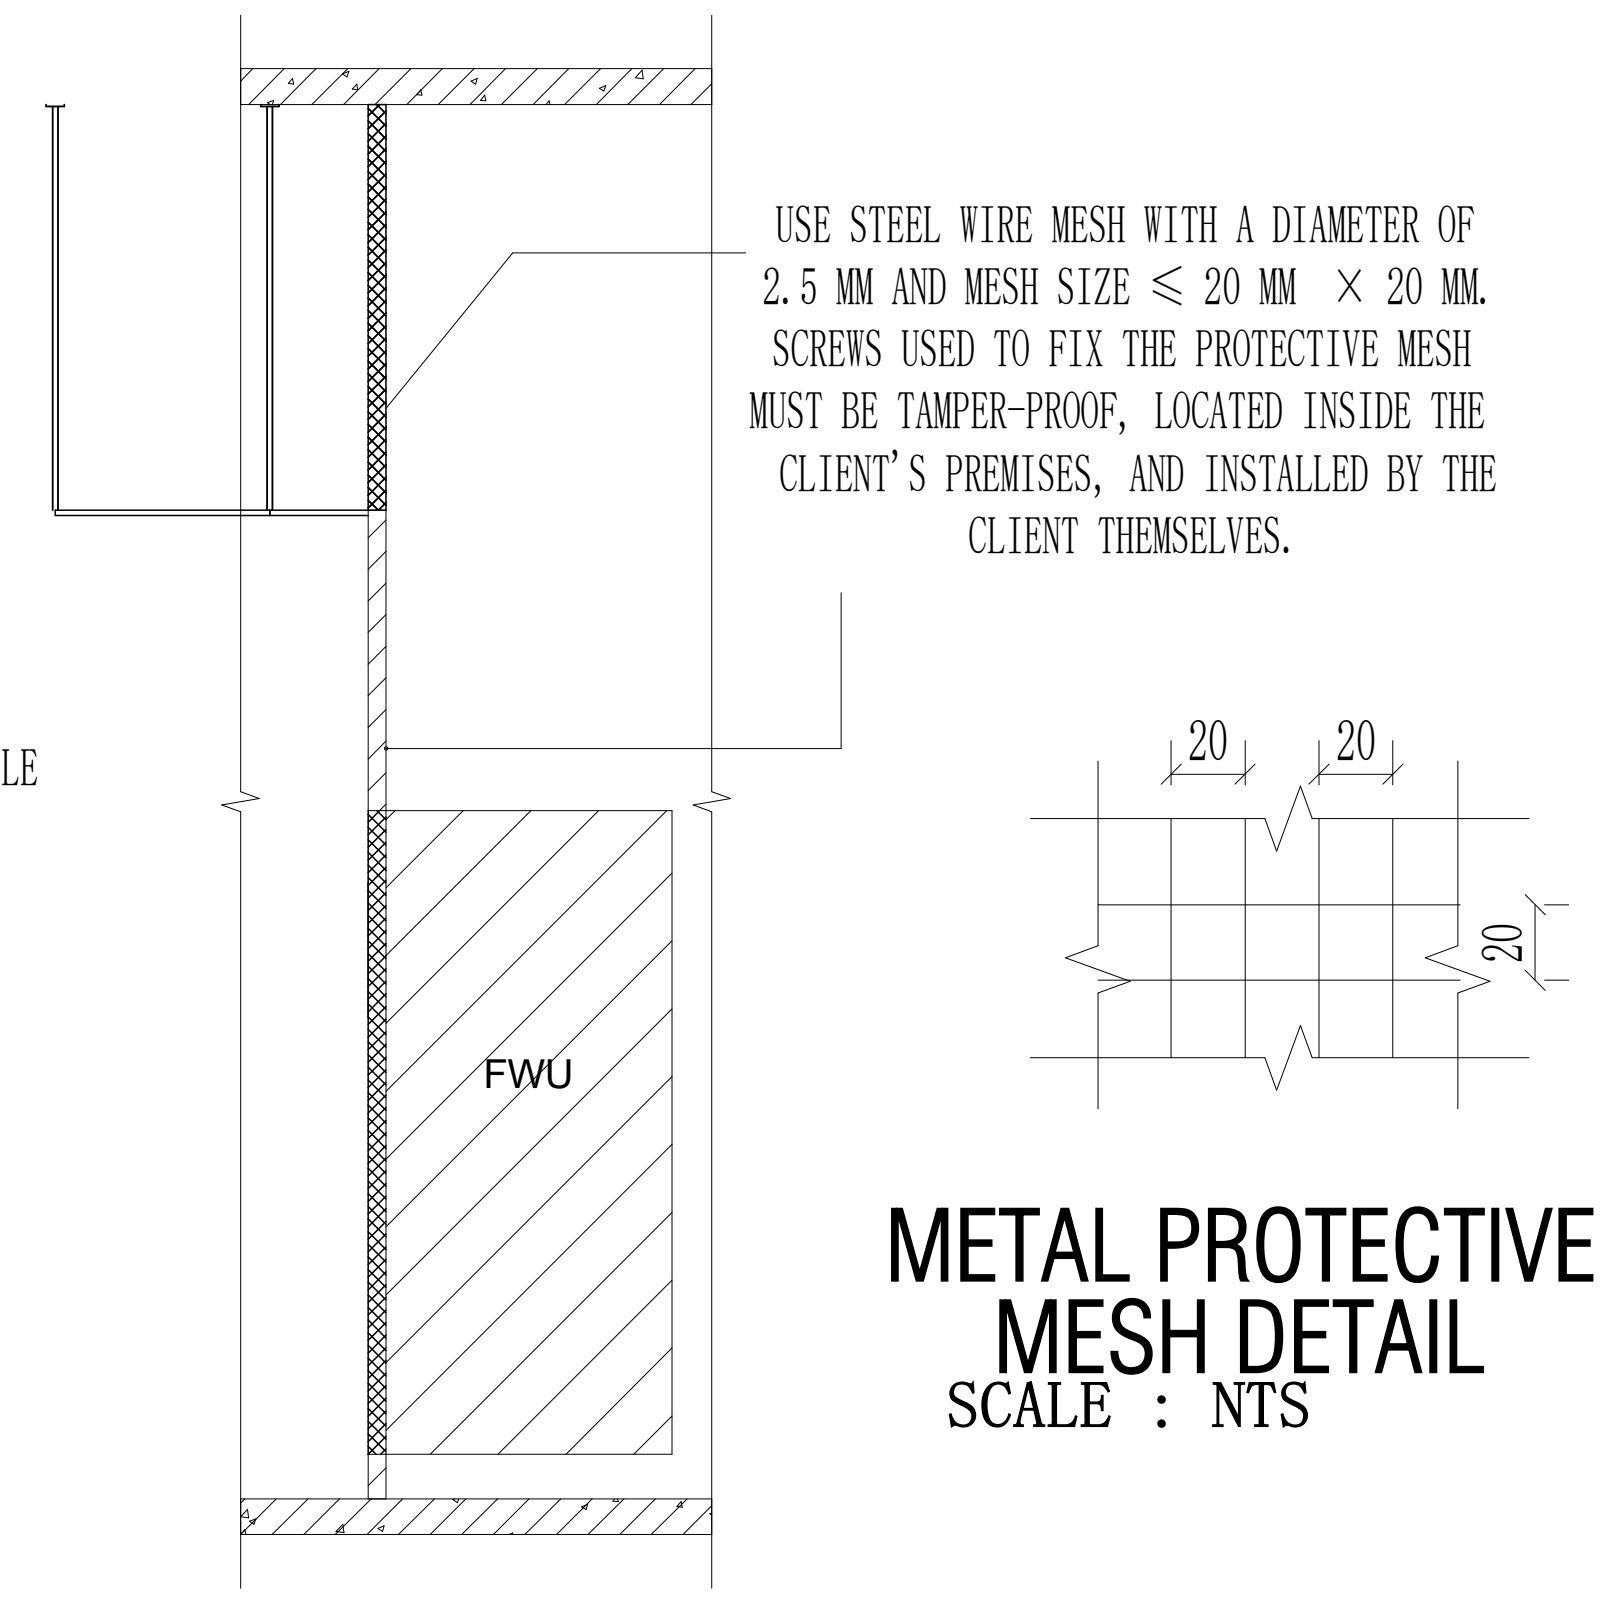
USE STEEL WIRE MESH WITH A DIAMETER OF 2.5 MM AND MESH SIZE ≤ 20 MM × 20 MM. SCREWS USED TO FIX THE PROTECTIVE MESH MUST BE TAMPER-PROOF, LOCATED INSIDE THE CLIENT'S PREMISES, AND INSTALLED BY THE CLIENT THEMSELVES.
20
20
20
FWU

METAL PROTECTIVE MESH DETAIL

SCALE : NTS

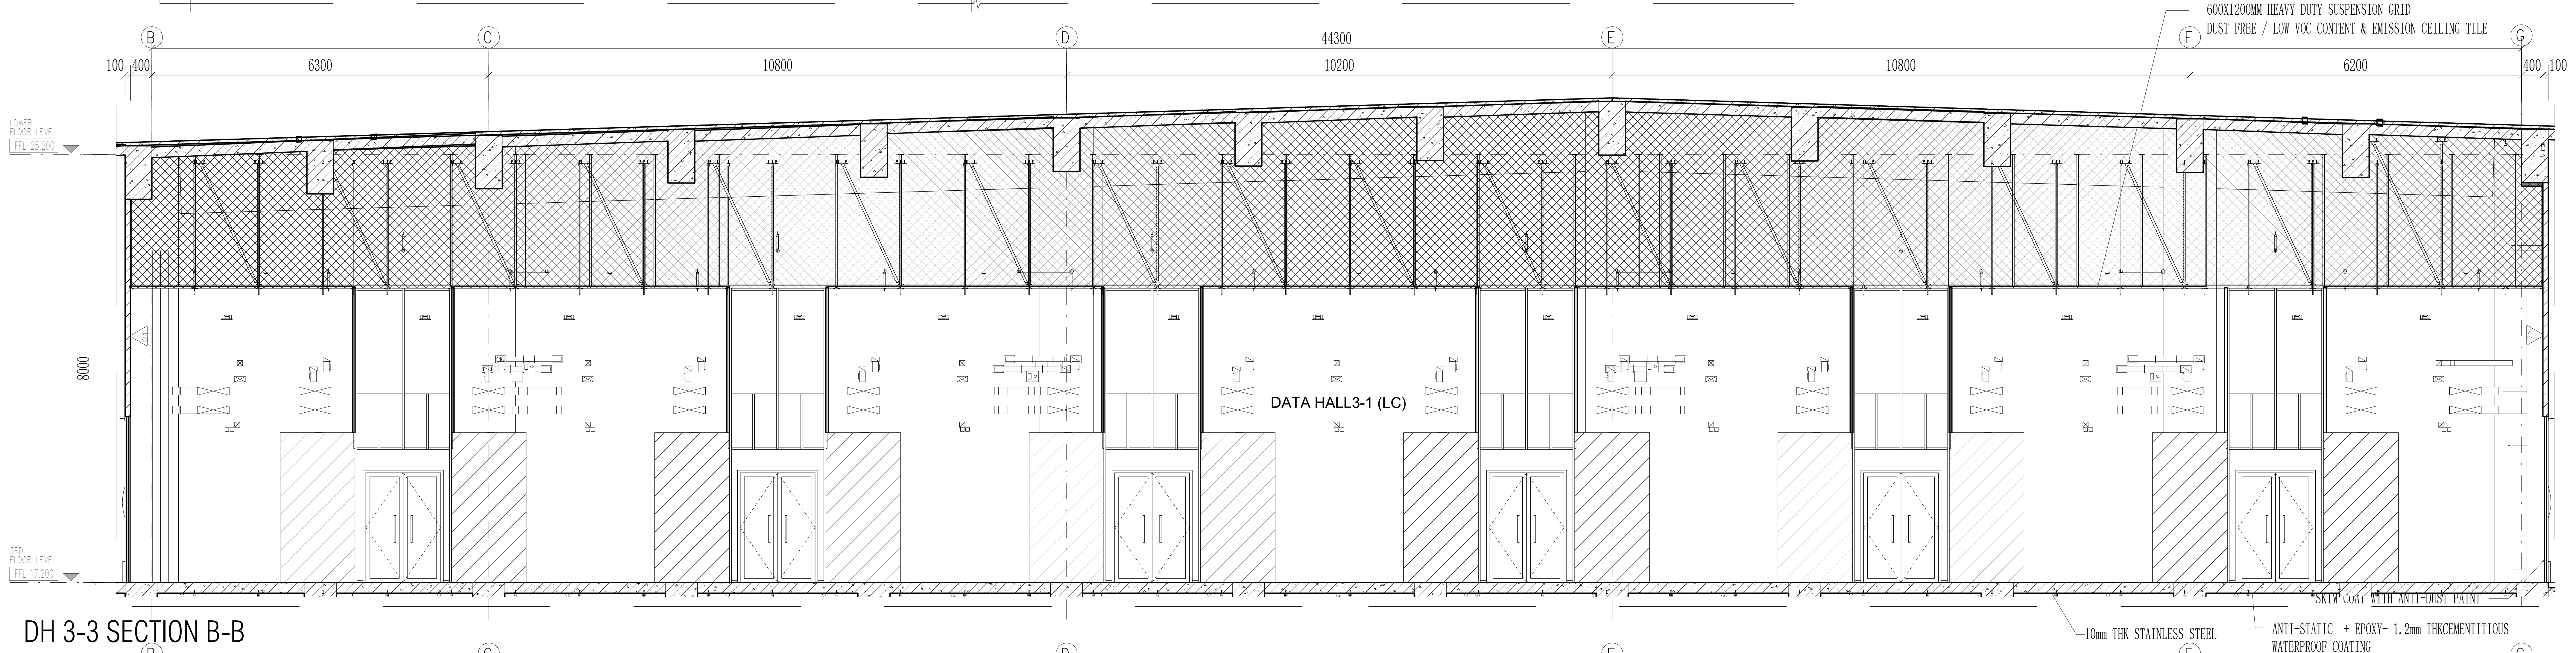
600X1200MM HEAVY DUTY SUSPENSION GRID
DUST FREE / LOW VOC CONTENT & EMISSION CEILING TILE
B
C
D
E
F
G
44300
100
400
6300
10800
10200
10800
6200
400
100
LOWER FLOOR LEVEL
FFL 25.200
3RD FLOOR LEVEL
FFL 17.200
8000
DATA HALL3-1 (LC)
SKIM COAT WITH ANTI-DUST PAINT
10mm THK STAINLESS STEEL
ANTI-STATIC + EPOXY+ 1.2mm THKCEMENTITIOUS WATERPROOF COATING

DH 3-3 SECTION B-B

Scale 1:50

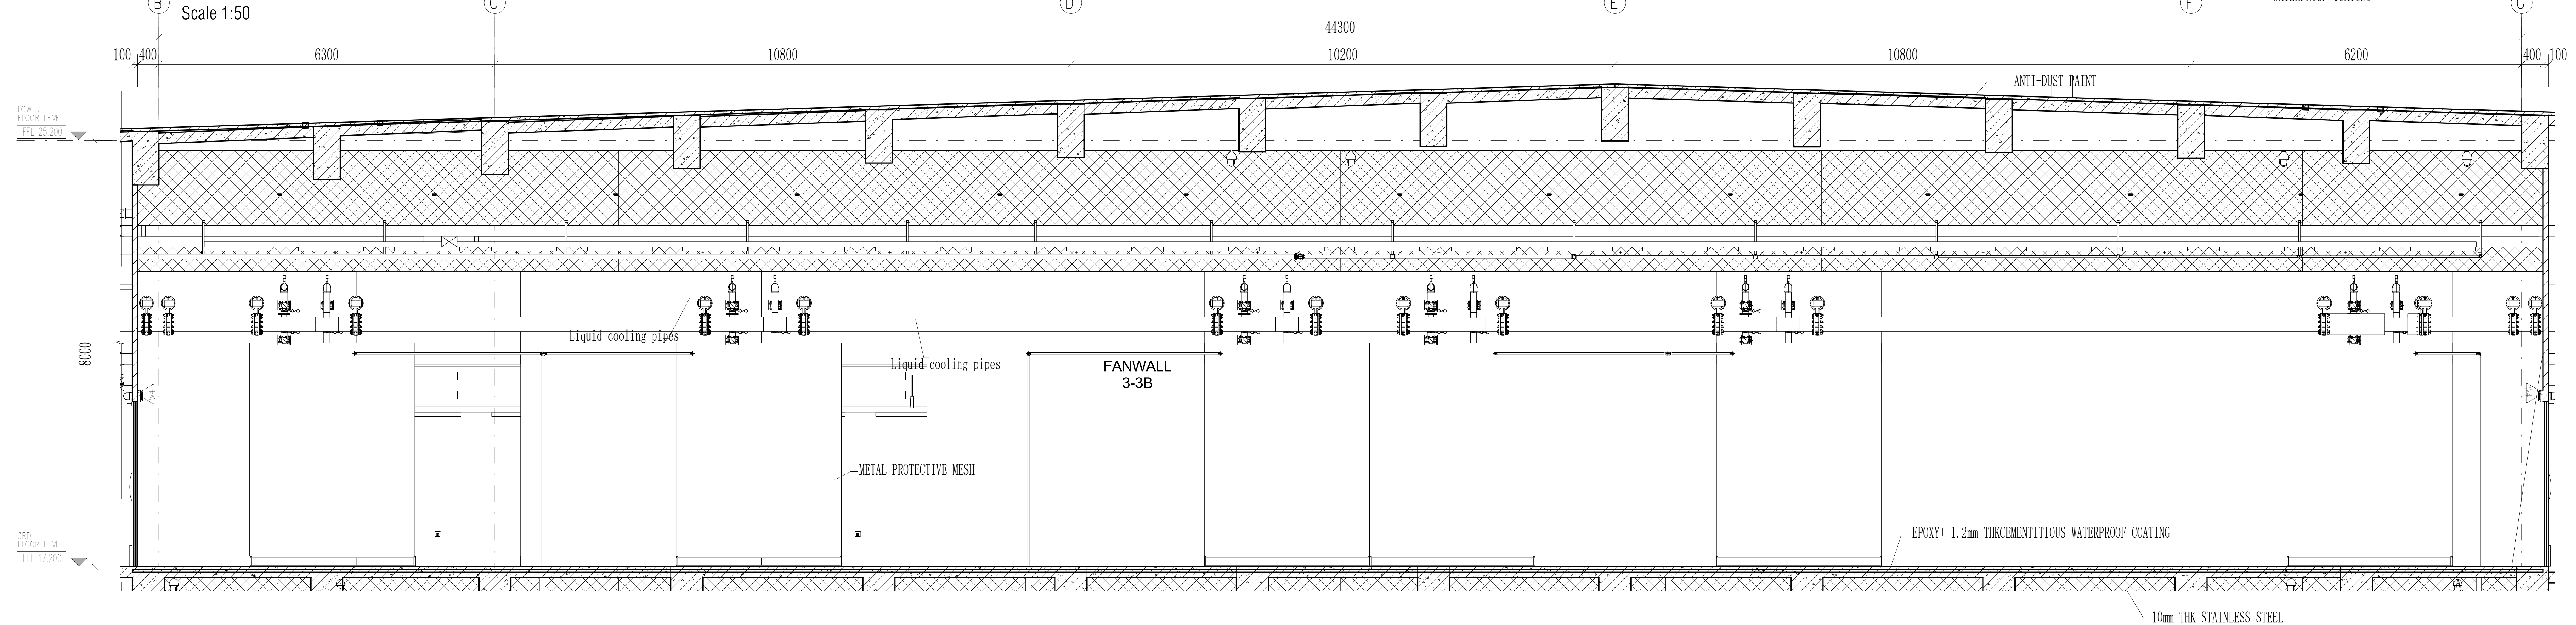
B
C
D
E
F
G
44300
100
400
6300
10800
10200
10800
6200
400
100
ANTI-DUST PAINT
LOWER FLOOR LEVEL
FFL 25.200
3RD FLOOR LEVEL
FFL 17.200
8000
Liquid cooling pipes
Liquid cooling pipes
FANWALL 3-3B
METAL PROTECTIVE MESH
EPOXY+ 1.2mm THKCEMENTITIOUS WATERPROOF COATING
10mm THK STAINLESS STEEL

FANWALL 3-3A、FANWALL 3-3B SECTION C-C

Scale 1:50

CLIENT :

GULF EDGE DC 01

87 Wireless Road, M Thai Tower 11th. Floor, All Seasons Place, Lumpini,
Pathumwan, Bangkok 10330, Thailand

CONTRACTOR :

华西发展(泰国)有限公司
บริษัท หัวซือ ดีเวลลอปเม้นต์ (ประเทศไทย) จำกัด
HUASHI DEVELOPMENT CO.,LTD
No. 202, Room No. 1403, 14/F, Le Concorde Building,
Ratchadapisek Road, Huaykhwang Sub-District,
Huaykhwang District, Bangkok Metropolitan 10310.

CONSULTANT :

ARbay
บริษัท เอ อาร์ เบย์ จำกัด
ARbay Company Limited
31 st Floor Bangkok Insurance Building
25 South Sathorn road Thungmahamek
Sathorn Bangkok 10120 THAILAND
T +66 (0) 2286 8199
F +66 (0) 2286 2863
info@arbay.co.th

CONSULTANT :

Qbic Engineers & Architects Co.,Ltd.
8 Soi KALONG 4 SANAMBINNAM ROAD,
THASAI SUB-DISTRICT, MUANG NONTHABURI DISTRICT
, NONTHABURI.
Tel 662-950-4374
Fax 662-580-3231
E-Mail : qbic@qbic.co.th, www.qbic.co.th
QBIC ENGINEERS AND ARCHITECTS CO.,LTD.

CONSULTANT :

MITR
MITR TECHNICAL CONSULTANT CO.,LTD.
1168/8 12th FLOOR, LUMPINI TOWER BUILDING,
RAMA IV RD., THUNGMAHAMEK, SATHORN, BANGKOK 10120, THAILAND
TEL : 0-2679-9079-84
FAX : 0-2679-9085 E-mail: mitr_dd@mitr.com

Architect :	SIGNATURE
ประกิต พนานุรัตน์ วสถ. 580 ที่อยู่ 251/1 ถ.จารุเมือง แขวงรองเมือง เขตปทุมวัน กรุงเทพมหานคร โทรศัพท์ 02-286-8199	
Structural Engineer :	SIGNATURE
วิศวกรผู้ออกแบบโครงสร้าง	
ณัฐสม สงวนวงษ์ วย 1423 ที่อยู่ 2/1 ซ.รามคำแหง 150 ถ.รามคำแหง แขวง สะพานสูง เขต สะพานสูง กทม. 10240	
Structural Inspector :	SIGNATURE
วิศวกรผู้ตรวจสอบโครงสร้าง	
โกมล จุฑาภัทร วย 964 ที่อยู่ 24/18 ซ.นวมินทร์ 129 ถ. นวมินทร์ แขวง นวลจันทร์ เขต บึงกุ่ม กทม. 10230	
Electrical Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบไฟฟ้ากำลัง	
นายสุภัทร บูรณวิทย์ วฟก.1265 ที่อยู่ 21 ซอยทานสัมฤทธิ์ 13 ตำบลท่าทราย อ.เมืองนนทบุรี จ.นนทบุรี 11000	
Mechanical Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบเครื่องกลและปรับอากาศ	
นายประสิทธิ์ เกี้ยวสุนทร วก.1221 ที่อยู่ 44/372 ซอยบางกระดี่ 35/1 แขวงแสมดำ เขตบางขุนเทียน กทม. 10150	ประสิทธิ์
Sanitary Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบสุขาภิบาล และดับเพลิง	
นายทศวรรษ สนั่นฤทธิ์ วส. 215 ที่อยู่ บ้านเลขที่ 99/107 หมู่ที่ 3 ต.ศีรษะจรเข้น้อย อ.บางเสาธง จ.สมุทรปราการ 10540	ทศวรรษ

ISSUE/REVISION

REV.	DESCRIPTION	DATE
A	90% DEVELOPED	09/05/2026

PROJECT NAME :

GEDC 01

LOCATION:
Nikhom Phattana district, Rayong ,industrial estate,CPGC

BUILDING :
MAIN BUILDING

90% DEVELOPED

TITLE :

ROOM DETAIL-3F-DATAHALL3-3(AC)
FANWALLROOM 3-3A,3-3B SECTION

JOB NO.		SCALE	1 : 50
DRAWN	NXR	REF.	
CHECKED	LJC	DWG. NO.	MPK01A-90-A-RD-306
APPROVED	LXD		
DATE	2026.05.09		

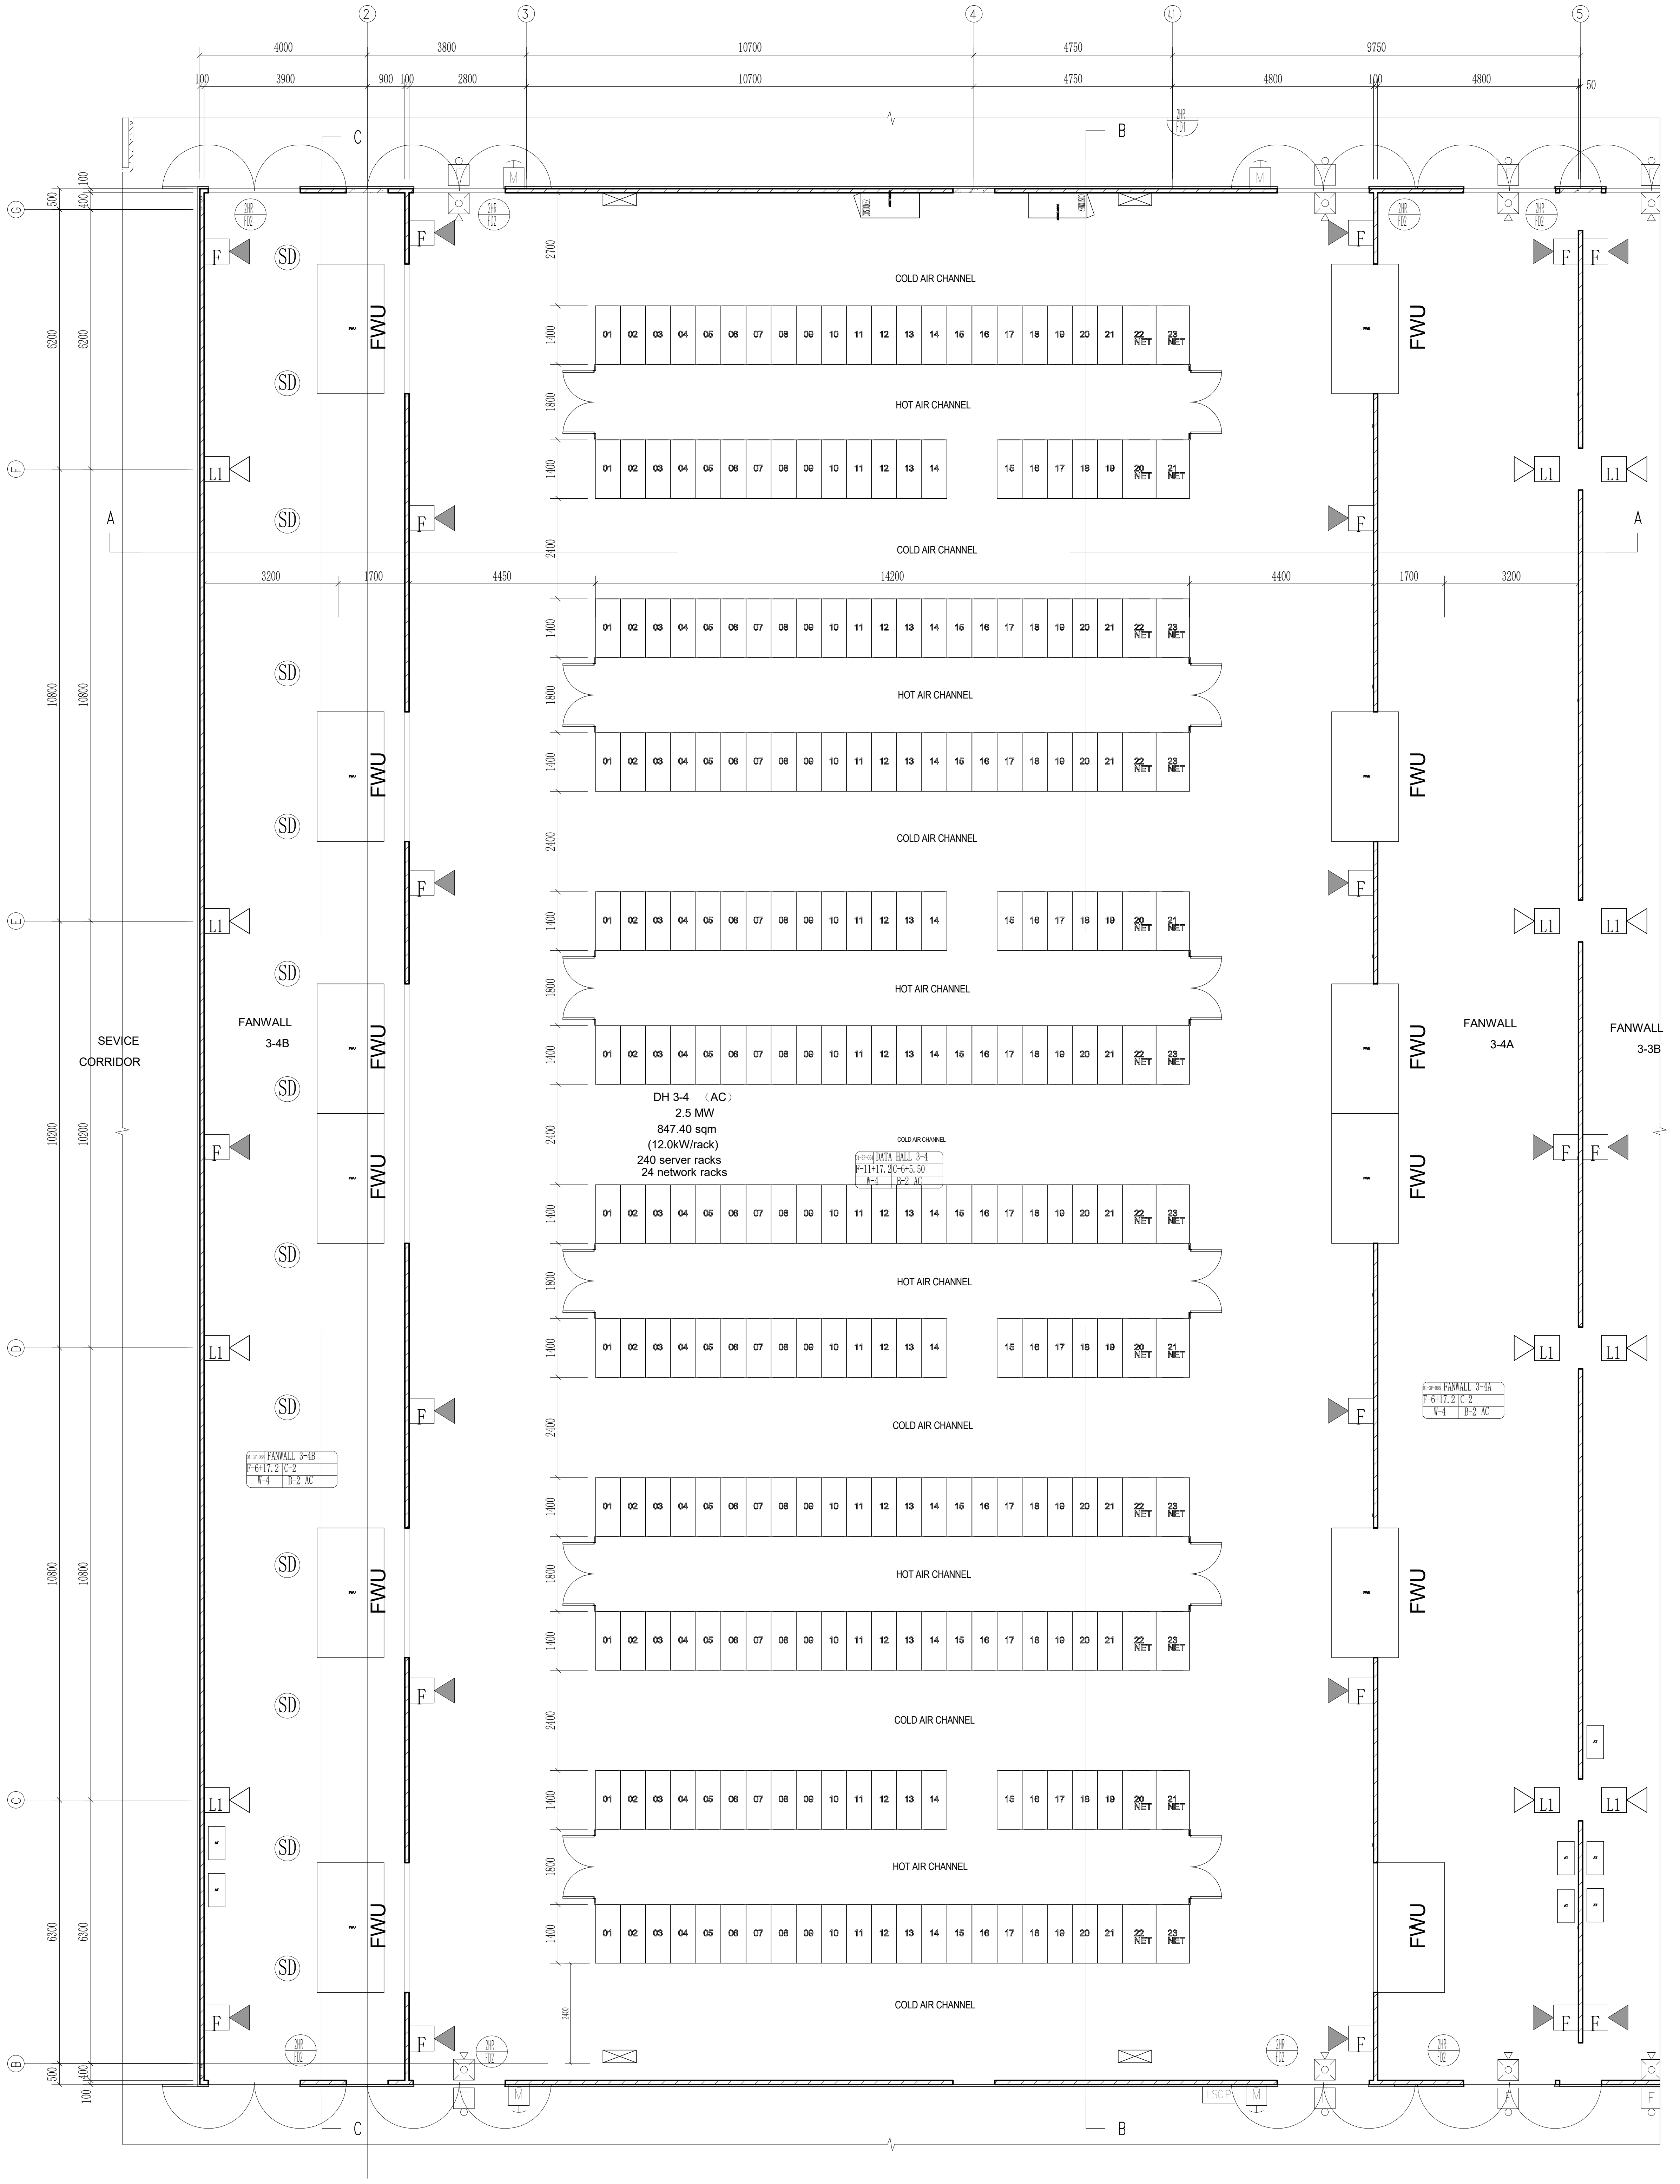

DH 3-4(AC)、 FANWALL3-4A、FANWALL3-4B FLOOR PLAN

Scale 1:75

THE "SFL" MARKED IN THE DRAWING REFERS TO THE STRUCTURAL FLOOR LEVEL, WHILE THE FINISHED FLOOR LEVEL (FFL) IS DETERMINED BASED ON FLOOR FINISHES.

Room Number	Room Name	Room Type	0kW/RACK	12kW/RACK	16kW/RACK	21kW/RACK	Rack Count	Design IT Load（Mw）
01-3F-059	Data Hall3-4	Air-cooled	0	240	24	0	264	2.5

Note On Levels- All Levels Shown Are Absolute Elevation	
☒	0kW/RACK
▯	12kW/RACK
⊠	16kW/RACK
⧄	21kW/RACK

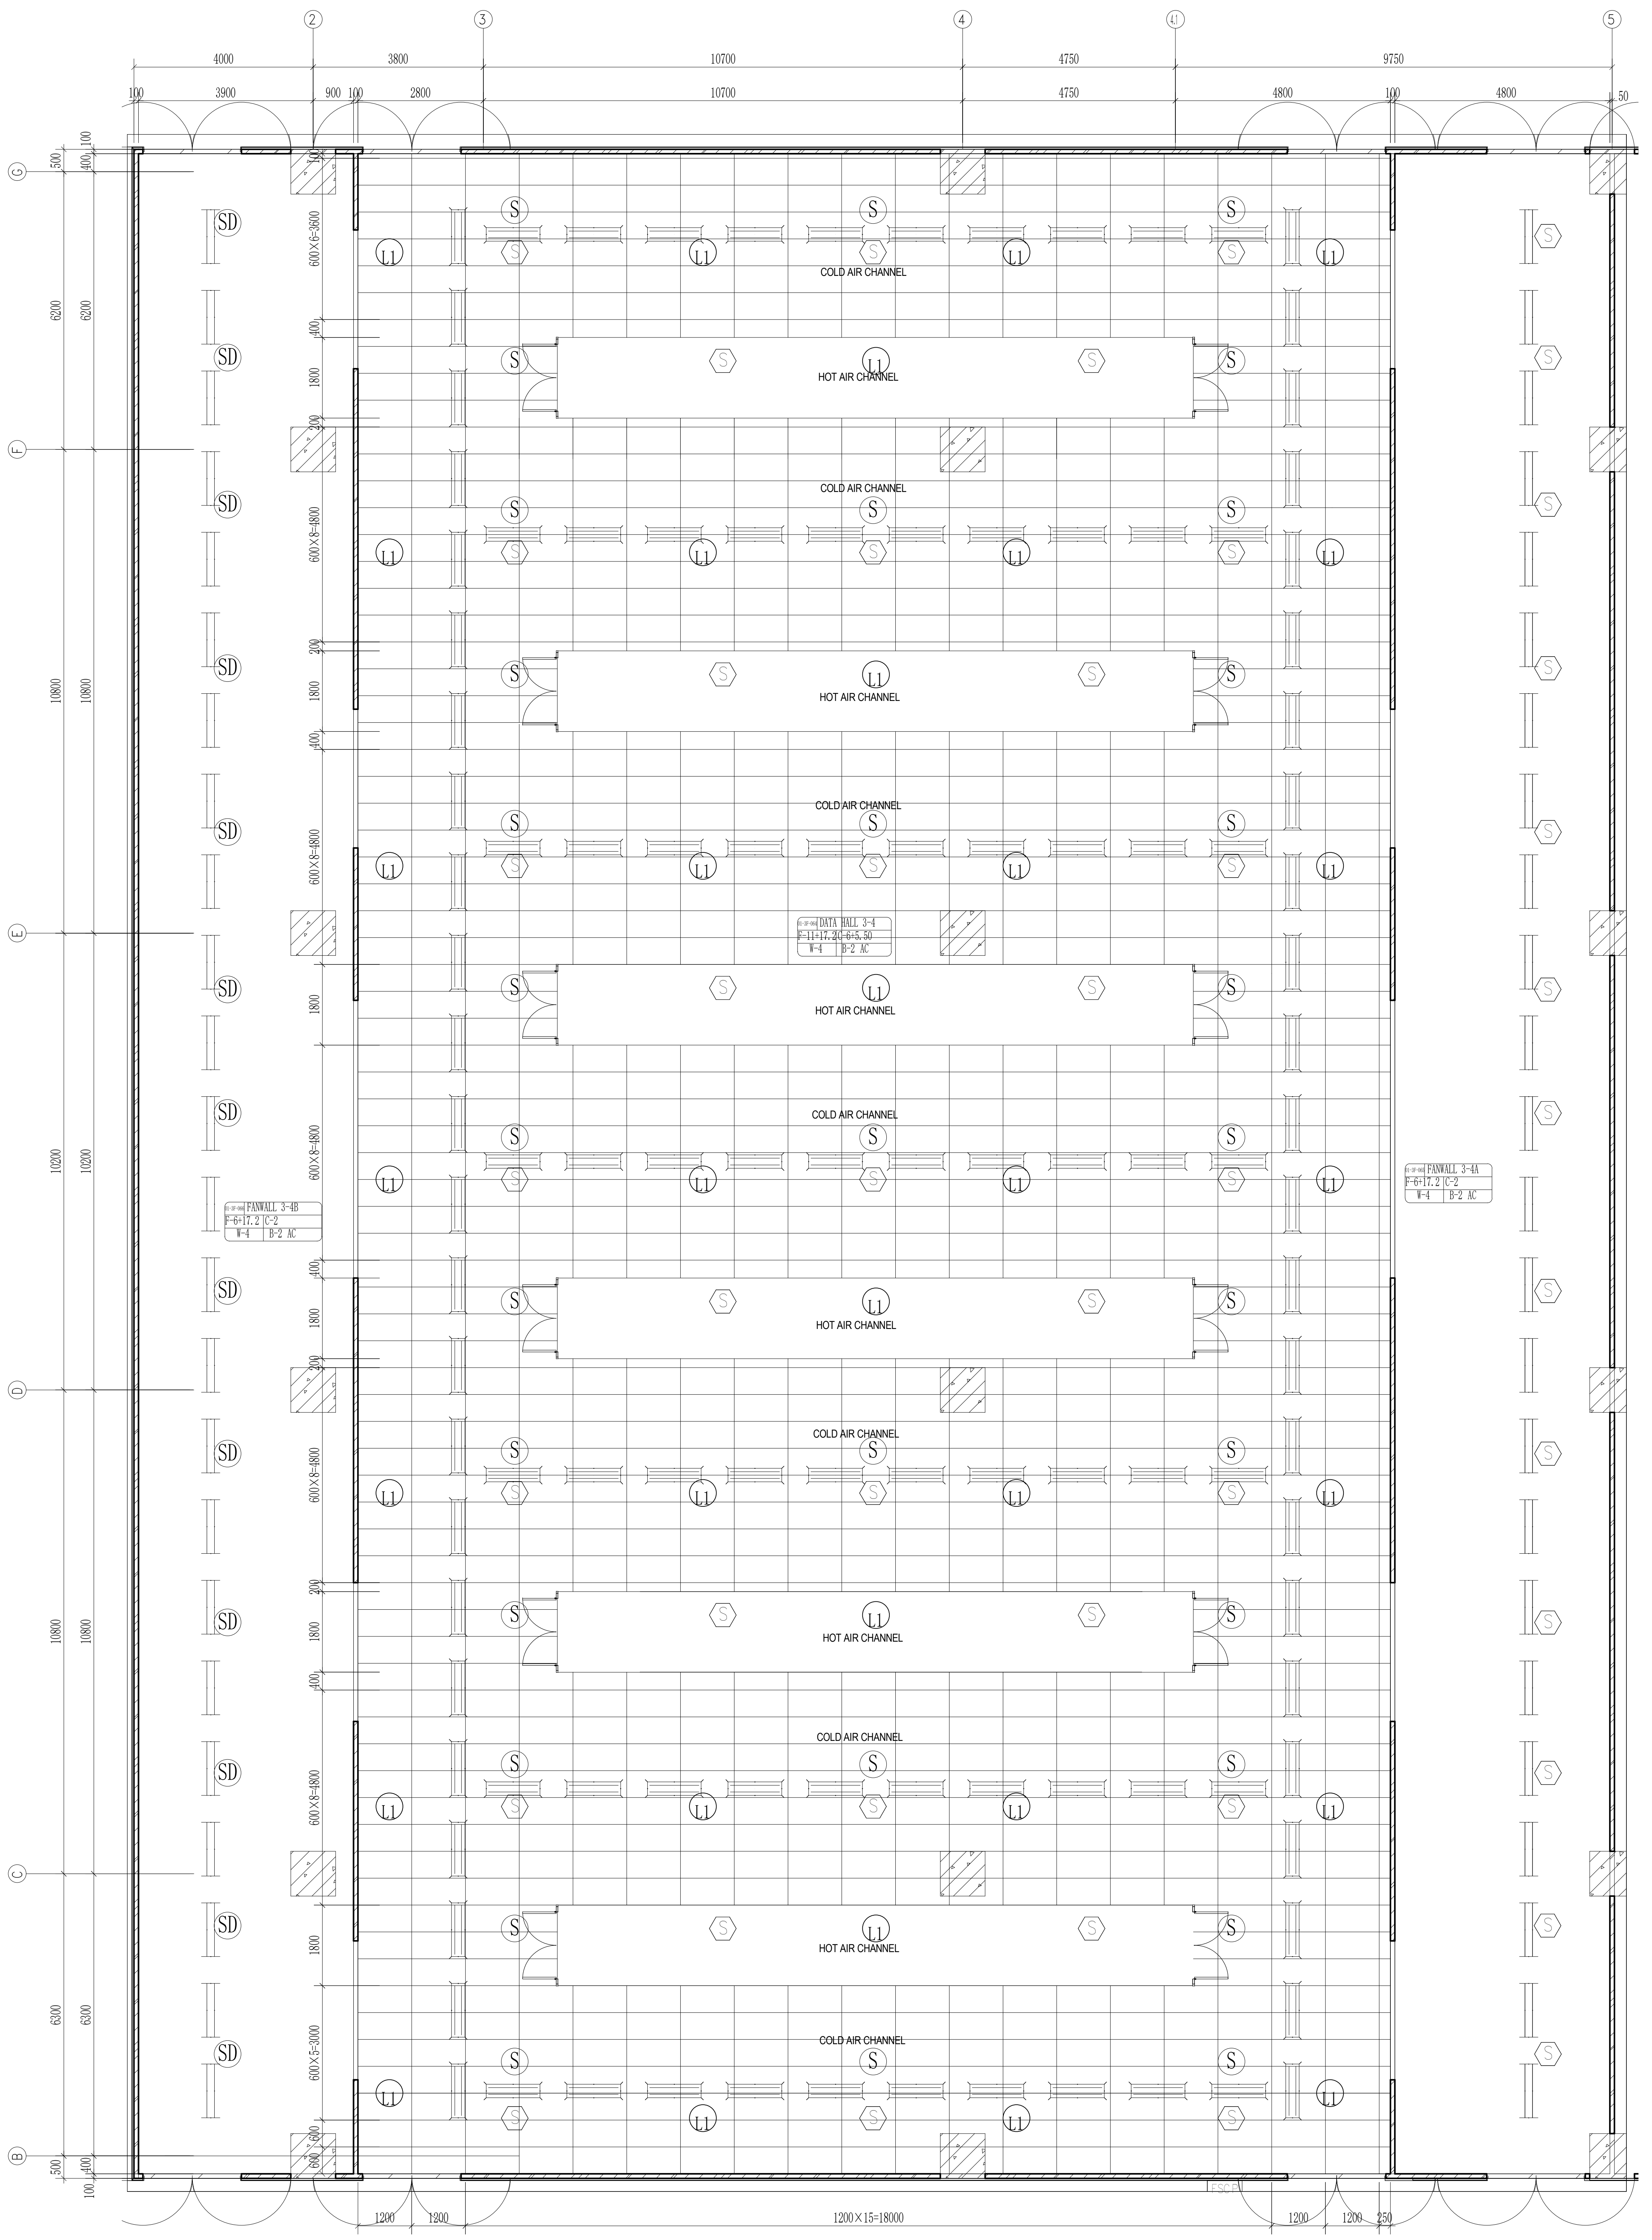

DH 3-4(AC) CEILING LAYOUT

Scale 1:75

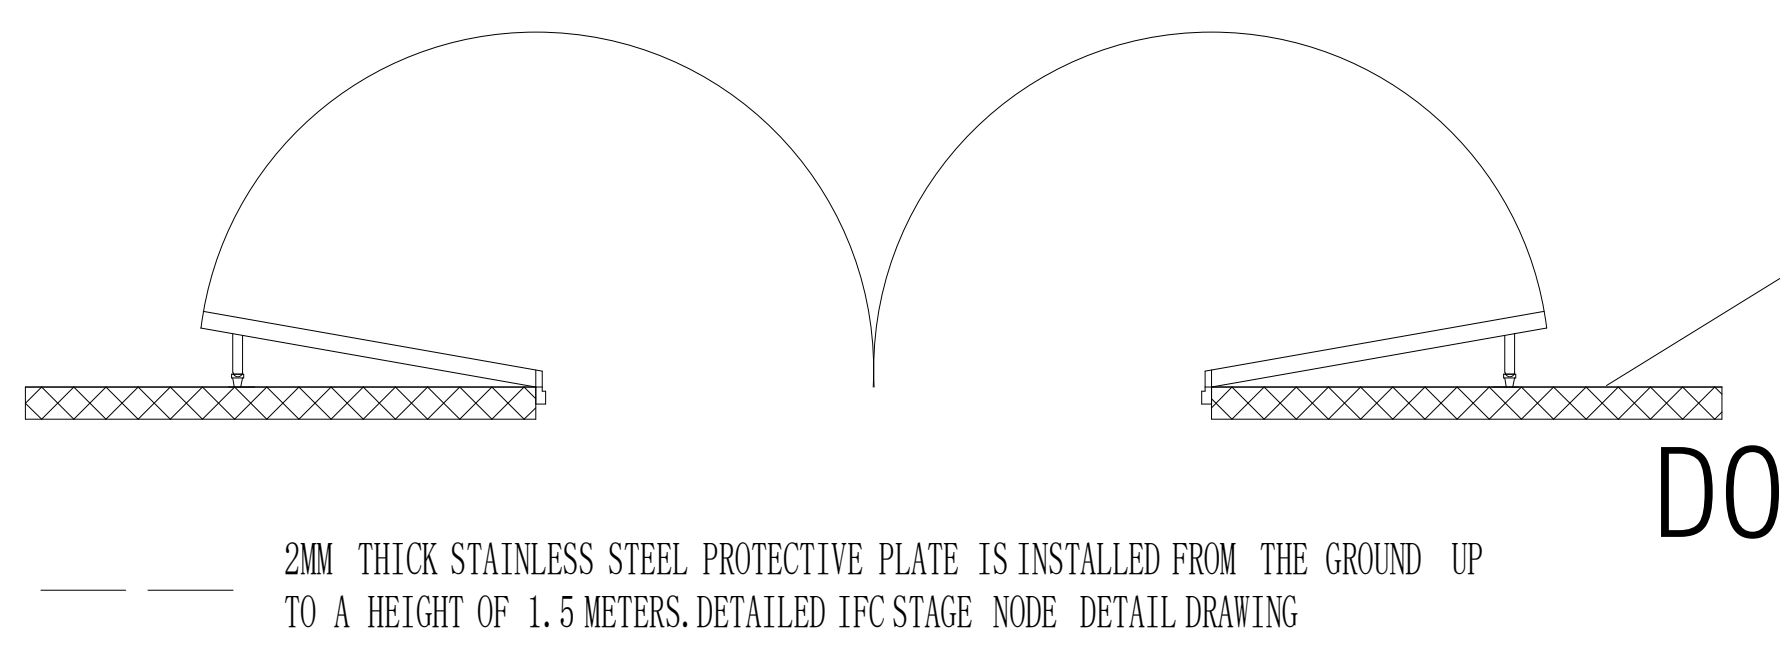

2MM THICK STAINLESS STEEL PROTECTIVE PLATE IS INSTALLED FROM THE GROUND UP TO A HEIGHT OF 1.5 METERS. DETAILED IFC STAGE NODE DETAIL DRAWING

DOOR STOPPER DETAIL

Scale 1:25

FIRE ALARM SPEAKER WALL MOUNTED

COMBINATION HORN/VISIBLE

SURFACE MOUNTED SMOKE DETECTOR, PHOTOELECTRIC TYPE

PHOTOELECTRIC SMOKE DETECTOR

LED double tube lamp; Ceiling Mounted; System Power 2x20W (+/- 10% In Tolerance); System Lumens >2x2000lm (+/- 10% In Tolerance); Luminaire Efficacy >100lm/w; CCT 5000K; CRI>80; CPF>0.9; Input Voltage 220V-240V 50/60Hz (Mounting height 3.0m)

LED double tube lamp; Ceiling Mounted; System Power 2x20W (+/- 10% In Tolerance); System Lumens >2x2000lm (+/- 10% In Tolerance); Luminaire Efficacy >100lm/w; CCT 5000K; CRI>80; CPF>0.9; Input Voltage 220V-240V 50/60Hz (Mounting height 3.0m)

ALARM BELL

CEILING SPEAKER

CLIENT :

GULF EDGE DC 01

87 Wireless Road, M Thai Tower 11th. Floor, All Seasons Place, Lumpini,
Pathumwan, Bangkok 10330, Thailand

CONTRACTOR :

华西发展(泰国)有限公司
บริษัท หัวซือ ดีเวลลอปเม้นต์ (ประเทศไทย) จำกัด
HUASHI DEVELOPMENT CO.,LTD
No. 202, Room No. 1403, 14/F, Le Concorde Building,
Ratchadapisek Road, Huaykhwang Sub-District,
Huaykhwang District, Bangkok Metropolitan 10310.

CONSULTANT :

ARbay
บริษัท เอ อาร์ เบย์ จำกัด
ARbay Company Limited
31 st Floor Bangkok Insurance Building
25 South Sathorn road Thungmahamek
Sathorn Bangkok 10120 THAILAND
T +66 (0) 2286 8199
F +66 (0) 2286 2863
info@arbay.co.th

CONSULTANT :

Qbic Engineers & Architects Co.,Ltd.
8 Soi KALONG 4 SANAMBINNAM ROAD,
THASAI SUB-DISTRICT, MUANG NONTHABURI DISTRICT
, NONTHABURI.
Tel 662-950-4374
Fax 662-580-3231
E-Mail : qbic@qbic.co.th, www.qbic.co.th
QBIC ENGINEERS AND ARCHITECTS CO.,LTD.

CONSULTANT :

MITR
MITR TECHNICAL CONSULTANT CO.,LTD.
1168/8 12th FLOOR, LUMPINI TOWER BUILDING,
RAMA IV RD., THUNGMAHAMEK, SATHORN, BANGKOK 10120, THAILAND
TEL : 0-2679-9079-84
FAX : 0-2679-9085 E-mail: mitr_dd@mitr.com

Architect :	SIGNATURE
ประกิต พนานุรัตน์ วสถ. 580 ที่อยู่ 251/1 ถ.จารุเมือง แขวงรองเมือง เขตปทุมวัน กรุงเทพมหานคร โทรศัพท์ 02-286-8199	
Structural Engineer :	SIGNATURE
วิศวกรผู้ออกแบบโครงสร้าง	
ณัฐสม สงวนวงษ์ วย 1423 ที่อยู่ 2/1 ซ.รามคำแหง 150 ถ.รามคำแหง แขวง สะพานสูง เขต สะพานสูง กทม. 10240	ณัฐสม สงวนวงษ์
Structural Inspector :	SIGNATURE
วิศวกรผู้ตรวจสอบโครงสร้าง	
โกมล จุฑาภัทร วย 964 ที่อยู่ 24/18 ซ.นวมินทร์ 129 ถ. นวมินทร์ แขวง นวลจันทร์ เขต บึงกุ่ม กทม. 10230	
Electrical Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบไฟฟ้ากำลัง	
นายสุภัทร บูรณวิทย์ วฟก.1265 ที่อยู่ 21 ซอยทานสัมฤทธิ์ 13 ตำบลท่าทราย อ.เมืองนนทบุรี จ.นนทบุรี 11000	
Mechanical Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบเครื่องกลและปรับอากาศ	
นายประสิทธิ์ เกี้ยวสุนทร วก.1221 ที่อยู่ 44/372 ซอยบางกระดี่ 35/1 แขวงแสมดำ เขตบางขุนเทียน กทม. 10150	ประสิทธิ์
Sanitary Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบสุขาภิบาล และดับเพลิง	
นายทศวรรษ สนั่นฤทธิ์ วส. 215 ที่อยู่ บ้านเลขที่ 99/107 หมู่ที่ 3 ต.ศีรษะจรเข้น้อย อ.บางเสาธง จ.สมุทรปราการ 10540	ทศวรรษ

ISSUE/REVISION

REV.	DESCRIPTION	DATE
A	90% DEVELOPED	09/05/2026

PROJECT NAME :
GEDC 01

LOCATION:
Nikhom Phattana district, Rayong ,industrial estate,CPGC

BUILDING :
MAIN BUILDING

90% DEVELOPED

TITLE :
DETAIL-3F-DATAHALL3-4(AC)
ROOMWALL ROOM 3-4A,3-4 BPLAN

JOB NO.	SCALE 作为说明
DRAWN LYT	REF.
CHECKED LJC	DWG. NO. MPK01A-90-A-RD-307
APPROVED LXD	
DATE 2026.05.09	

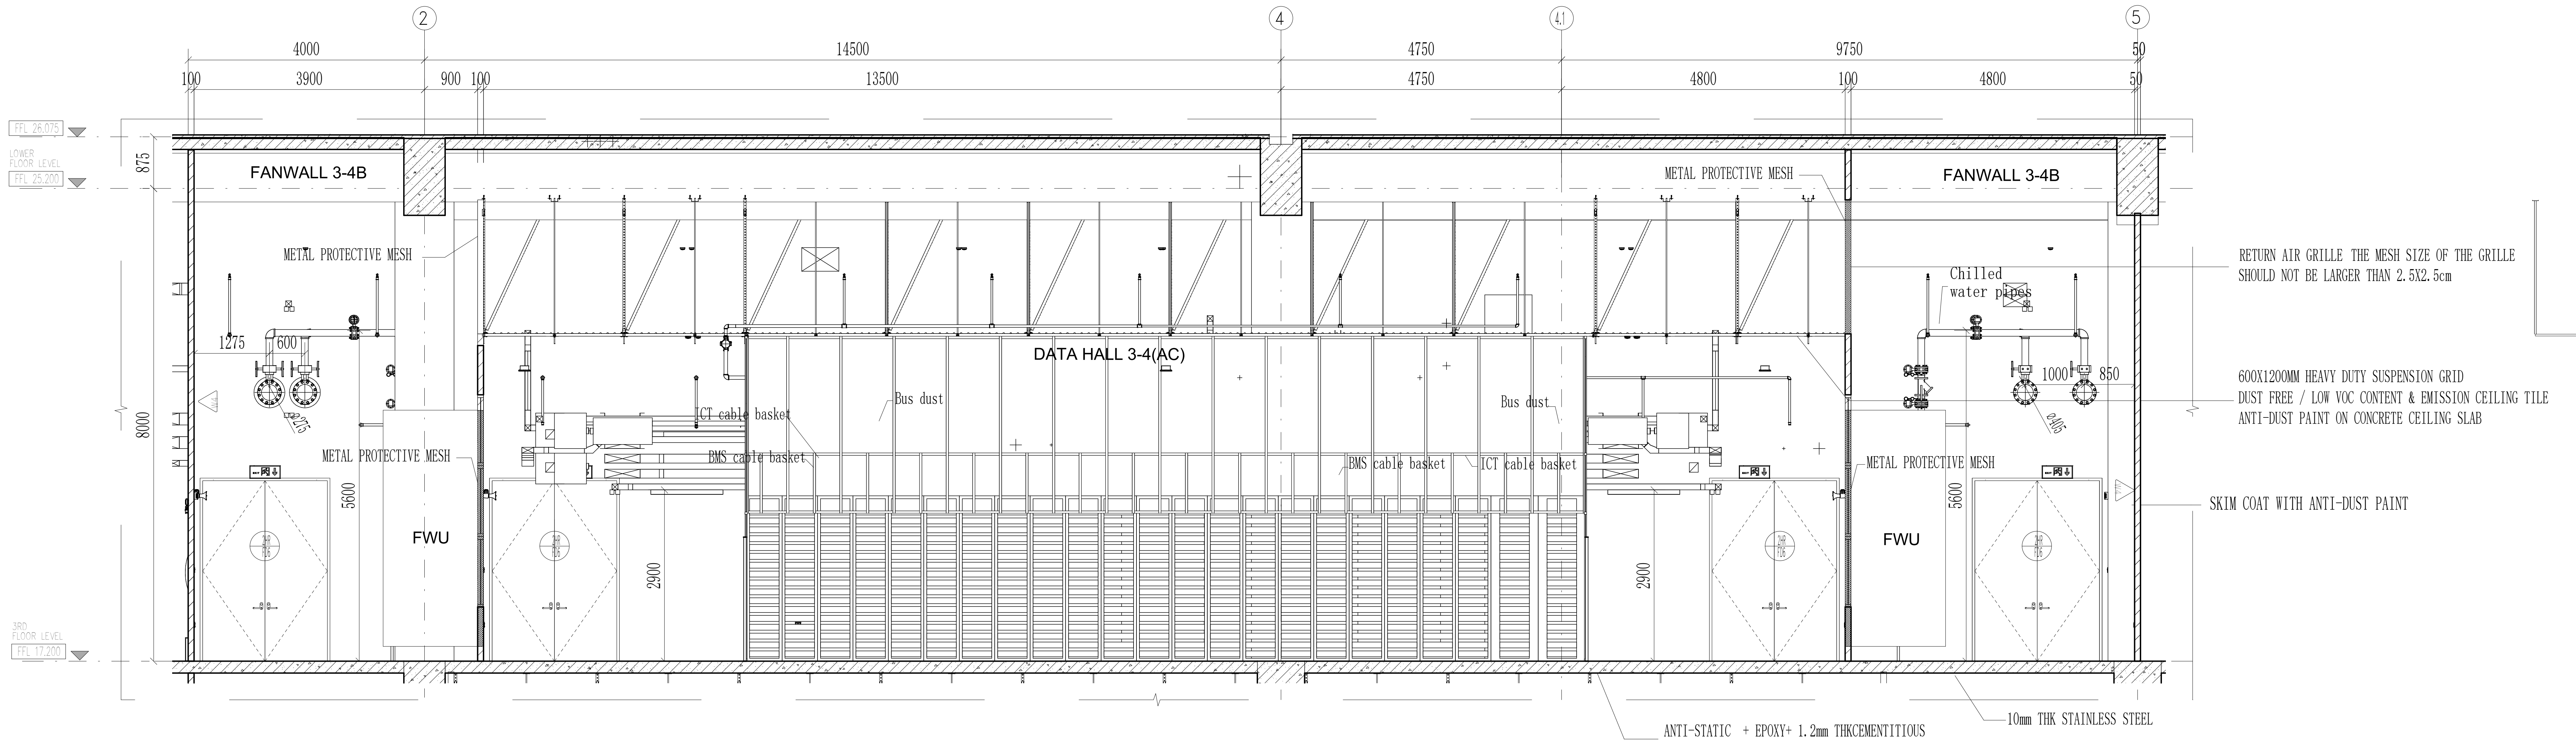
2
4
4'
5
4000
14500
4750
9750
50
100
3900
900
100
13500
4750
4800
100
4800
50
FFL 26.075
LOWER FLOOR LEVEL
FFL 25.200
3RD FLOOR LEVEL
FFL 17.200
875
8000
FANWALL 3-4B
METAL PROTECTIVE MESH
1275
600
Ø275
METAL PROTECTIVE MESH
5600
FWU
2900
DATA HALL 3-4(AC)
ICT cable basket
BMS cable basket
Bus dust
Bus dust
BMS cable basket
ICT cable basket
2900
METAL PROTECTIVE MESH
Chilled water pipes
1000
850
Ø465
5600
FWU
FANWALL 3-4B
RETURN AIR GRILLE THE MESH SIZE OF THE GRILLE SHOULD NOT BE LARGER THAN 2.5X2.5cm
600X1200MM HEAVY DUTY SUSPENSION GRID
DUST FREE / LOW VOC CONTENT & EMISSION CEILING TILE
ANTI-DUST PAINT ON CONCRETE CEILING SLAB
SKIM COAT WITH ANTI-DUST PAINT
10mm THK STAINLESS STEEL
ANTI-STATIC + EPOXY+ 1.2mm THKCEMENTITIOUS WATERPROOF COATING

DH3-4(AC)、FANWALL 3-4 A、FANWALL 3-4 B SECTION A-A Scale 1:50

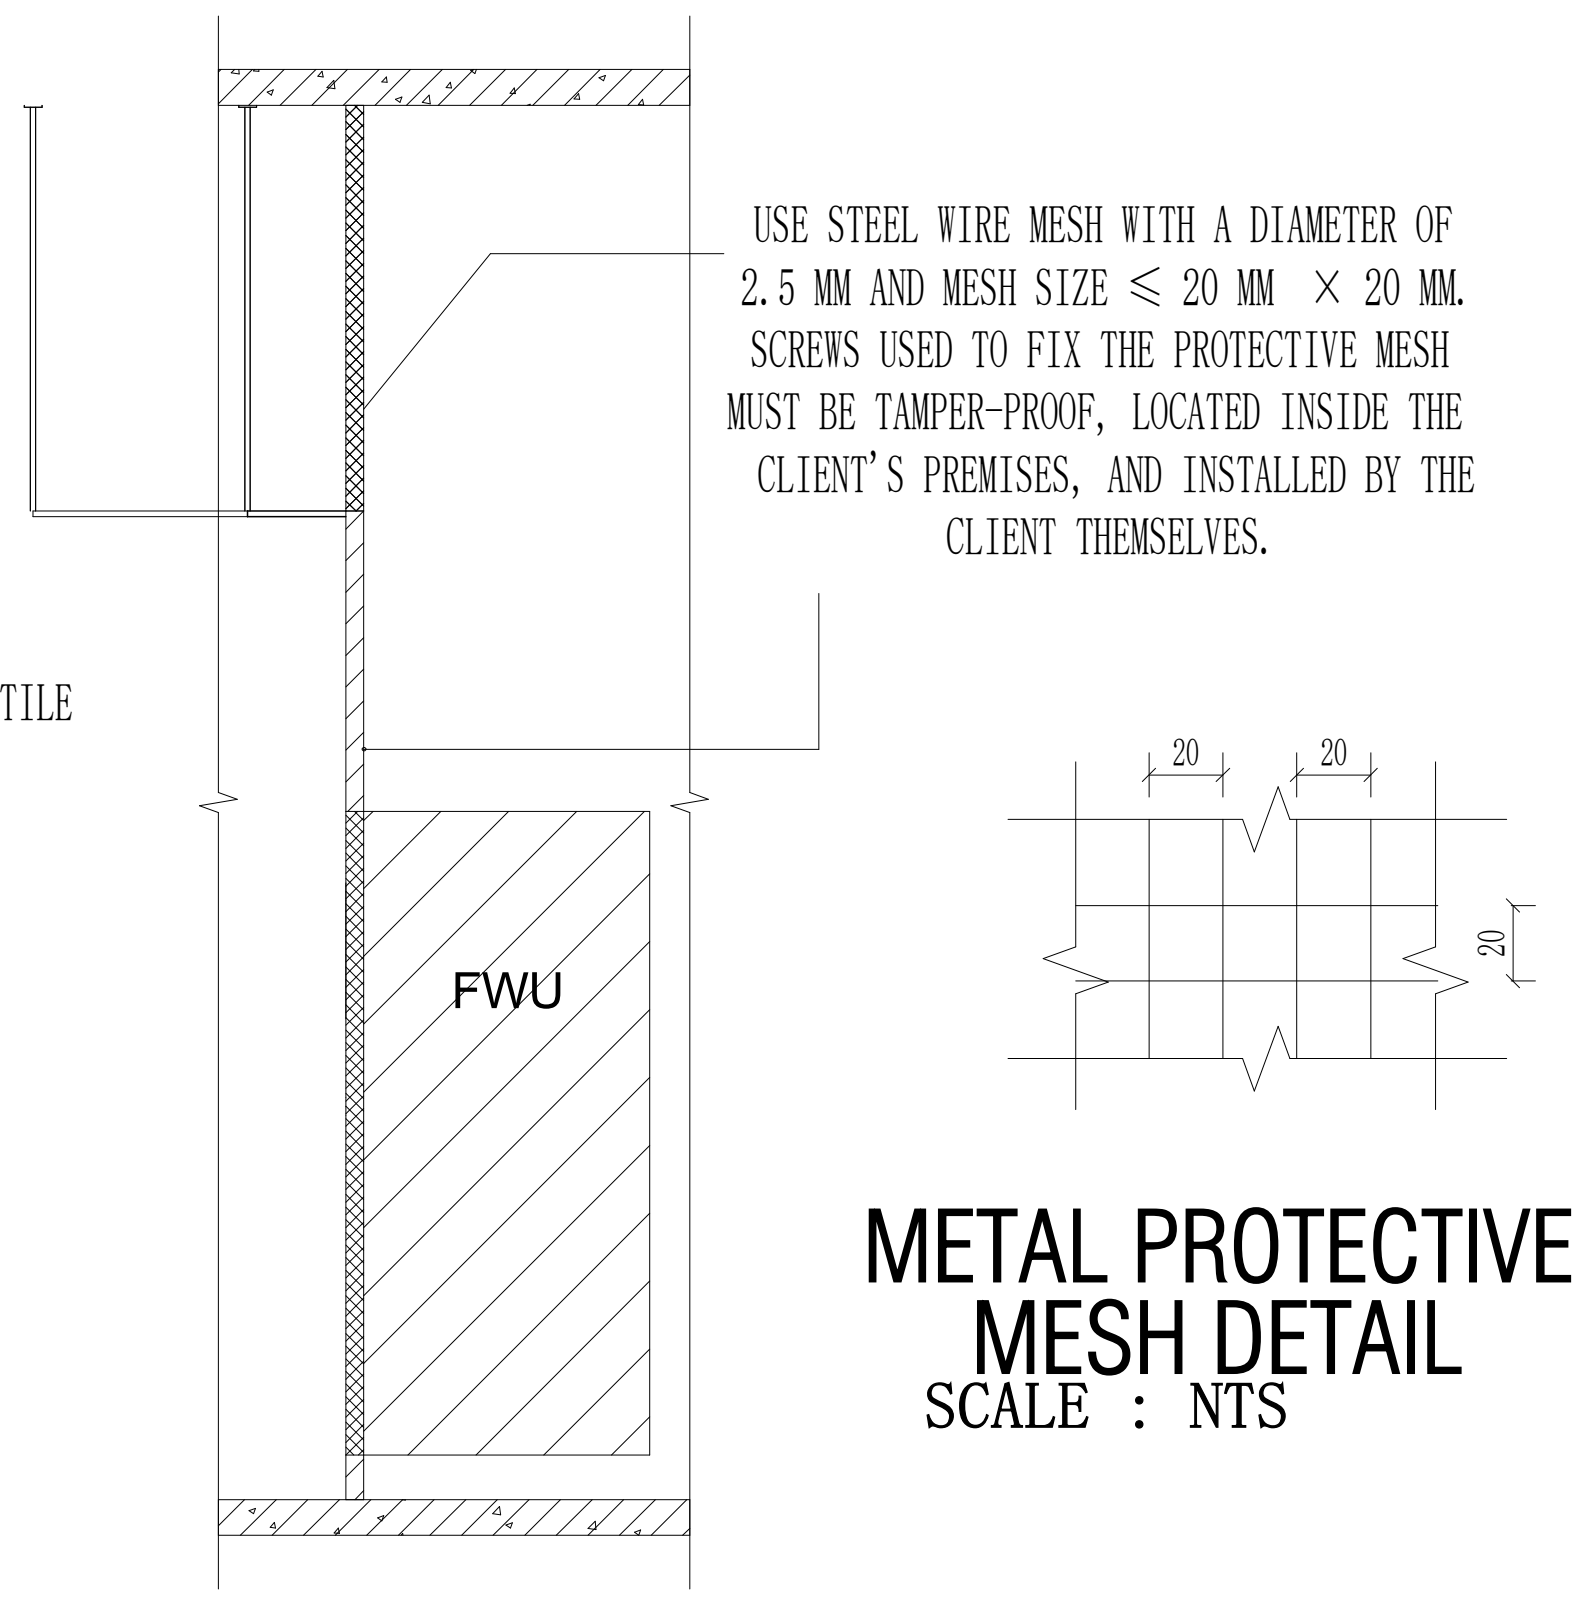
USE STEEL WIRE MESH WITH A DIAMETER OF 2.5 MM AND MESH SIZE ≤ 20 MM × 20 MM. SCREWS USED TO FIX THE PROTECTIVE MESH MUST BE TAMPER-PROOF, LOCATED INSIDE THE CLIENT'S PREMISES, AND INSTALLED BY THE CLIENT THEMSELVES.
FWU
20
20
20

METAL PROTECTIVE MESH DETAIL

SCALE : NTS

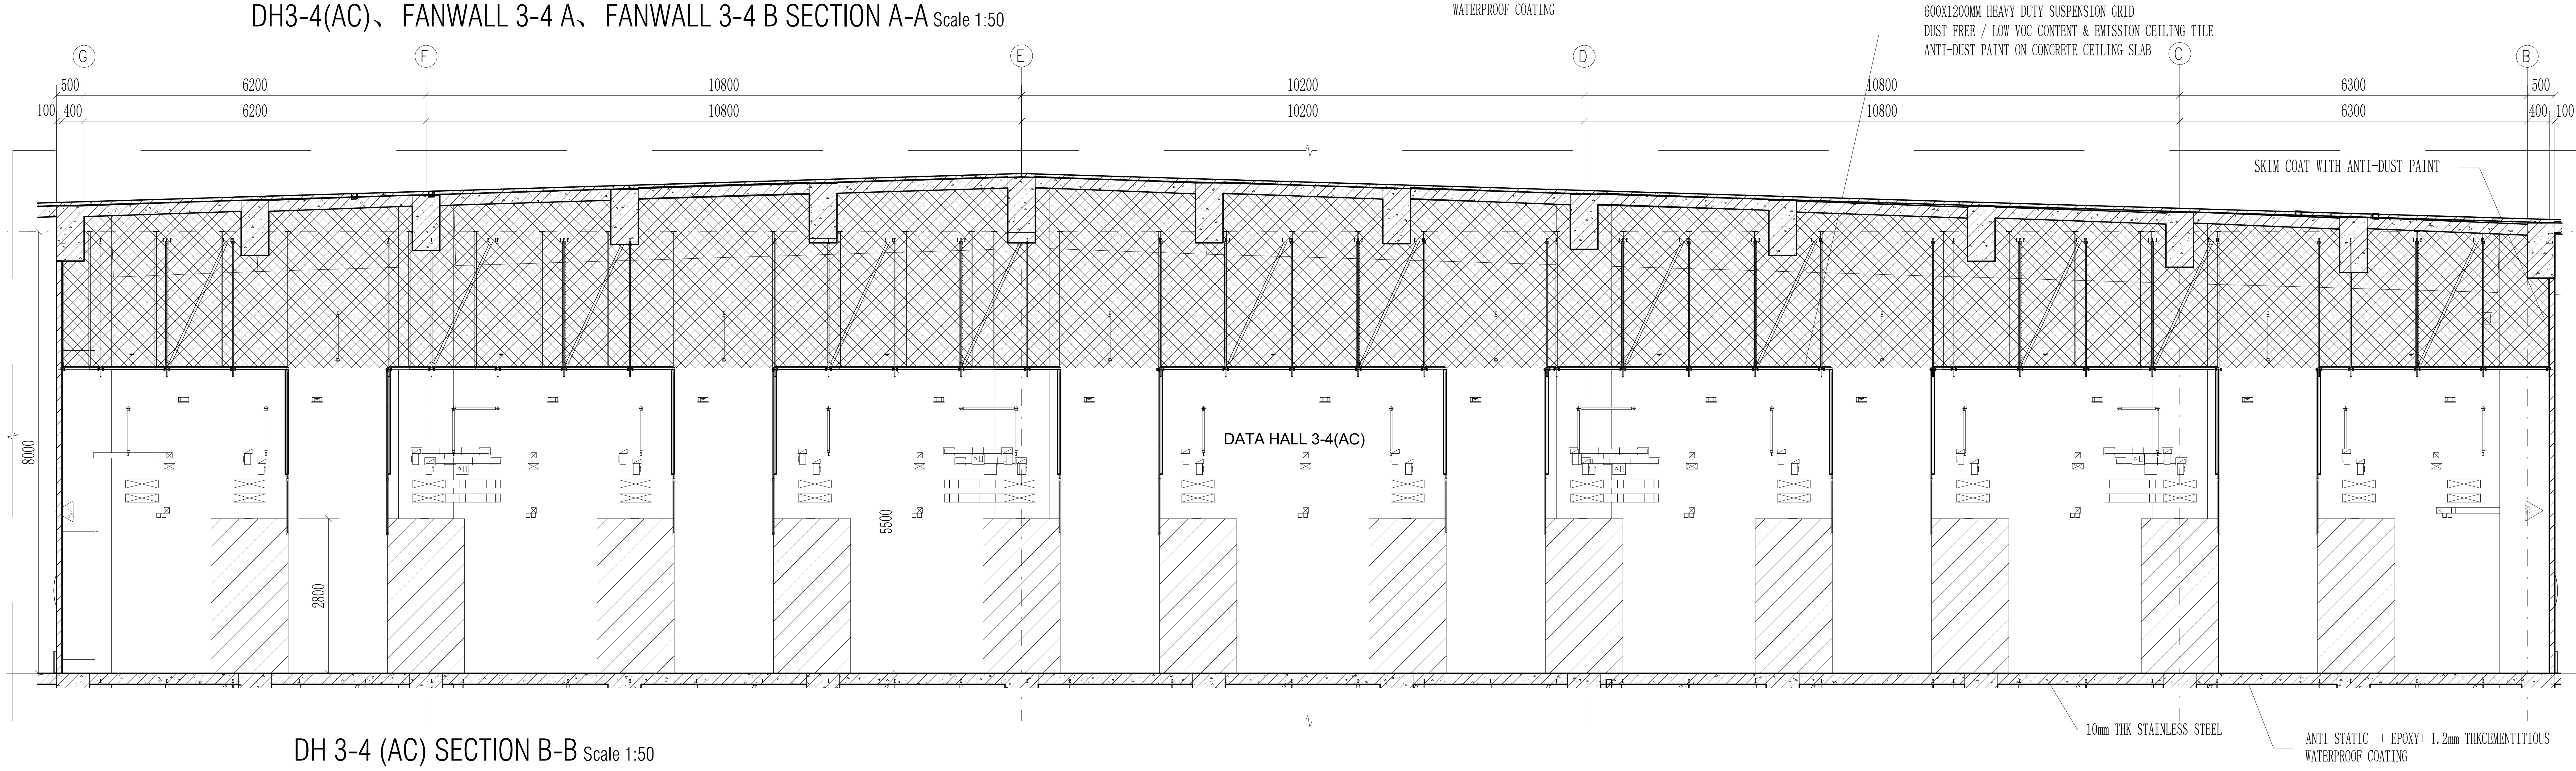
600X1200MM HEAVY DUTY SUSPENSION GRID
DUST FREE / LOW VOC CONTENT & EMISSION CEILING TILE
ANTI-DUST PAINT ON CONCRETE CEILING SLAB
G
F
E
D
C
B
500
6200
10800
10200
10800
6300
500
100
400
6200
10800
10200
10800
6300
400
100
LOWER FLOOR LEVEL
FFL 25.200
3RD FLOOR LEVEL
FFL 17.200
SKIM COAT WITH ANTI-DUST PAINT
8000
DATA HALL 3-4(AC)
5500
2800
10mm THK STAINLESS STEEL
ANTI-STATIC + EPOXY+ 1.2mm THKCEMENTITIOUS WATERPROOF COATING

DH 3-4 (AC) SECTION B-B Scale 1:50

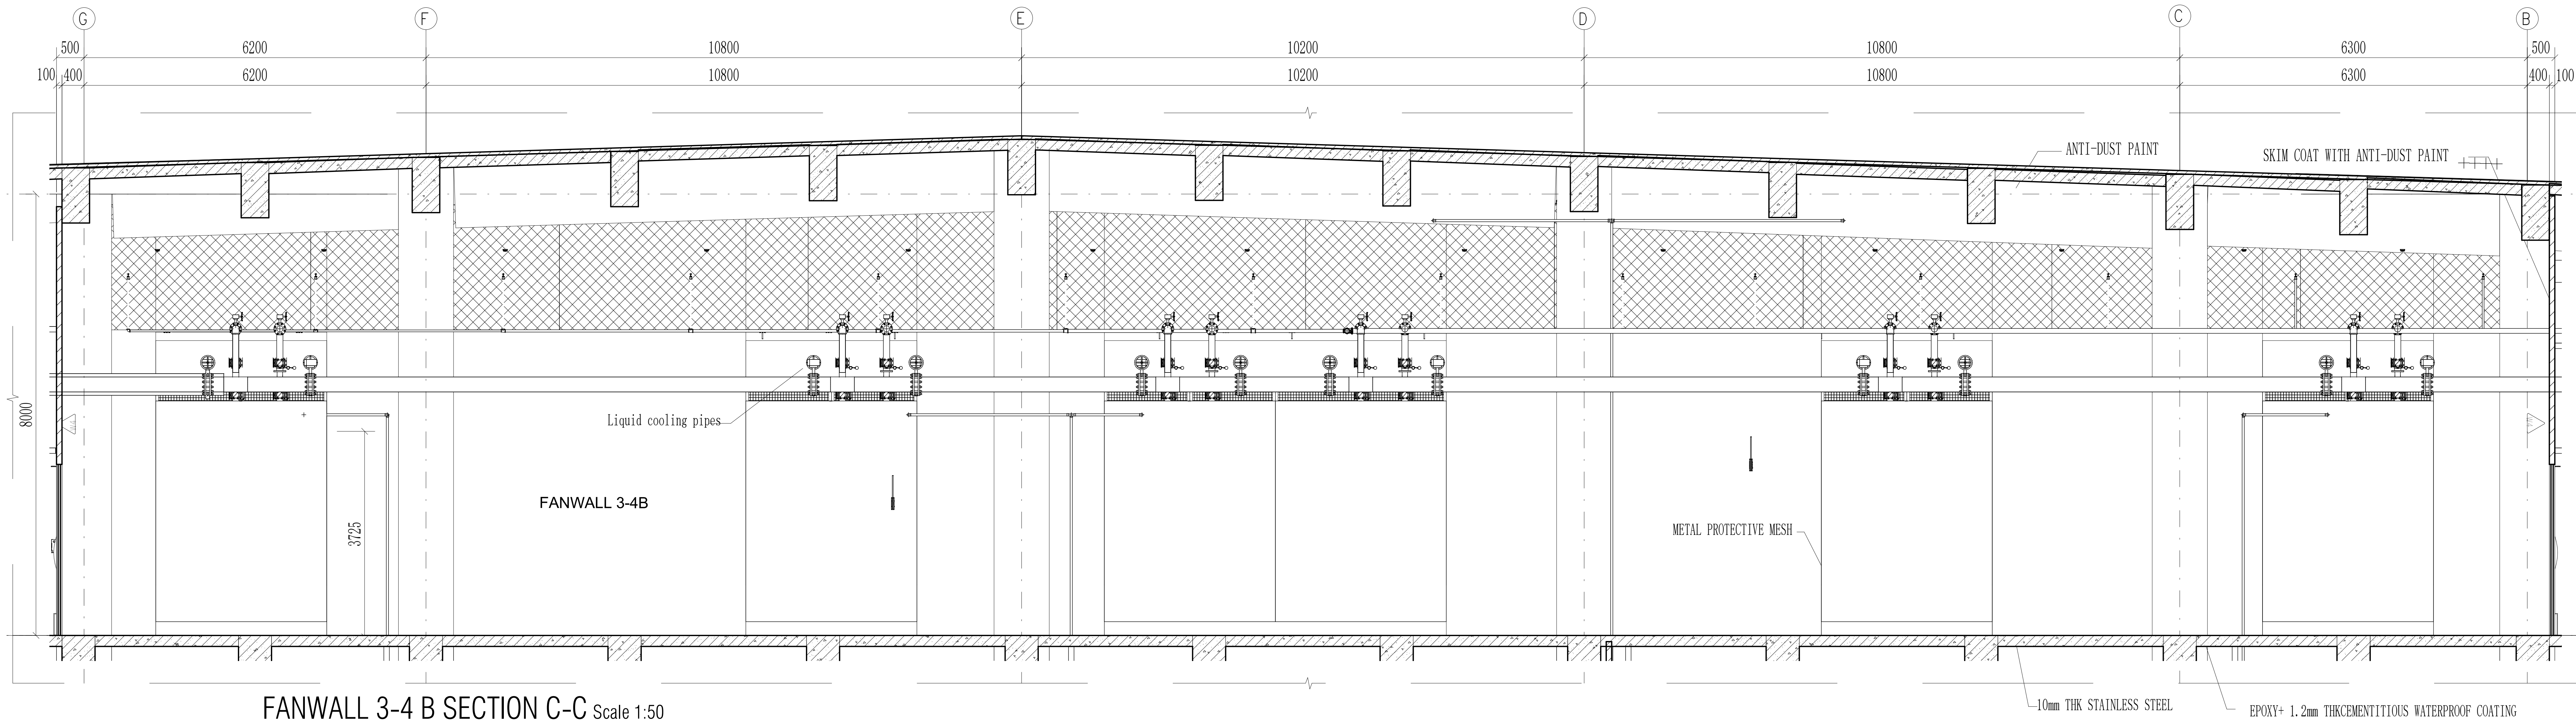
G
F
E
D
C
B
500
6200
10800
10200
10800
6300
500
100
400
6200
10800
10200
10800
6300
400
100
LOWER FLOOR LEVEL
FFL 25.200
3RD FLOOR LEVEL
FFL 17.200
ANTI-DUST PAINT
SKIM COAT WITH ANTI-DUST PAINT
8000
Liquid cooling pipes
FANWALL 3-4B
3725
METAL PROTECTIVE MESH
10mm THK STAINLESS STEEL
EPOXY+ 1.2mm THKCEMENTITIOUS WATERPROOF COATING

FANWALL 3-4 B SECTION C-C Scale 1:50

CLIENT :

GULF EDGE DC 01

87 Wireless Road, M Thai Tower 11th. Floor, All Seasons Place, Lumpini,
Pathumwan, Bangkok 10330, Thailand

CONTRACTOR :

华西发展(泰国)有限公司
บริษัท หัวซือ ดีเวลลอปเม้นต์ (ประเทศไทย) จำกัด
HUASHI DEVELOPMENT CO.,LTD
No. 202, Room No. 1403, 14/F, Le Concorde Building,
Ratchadapisek Road, Huaykhwang Sub-District,
Huaykhwang District, Bangkok Metropolitan 10310.

CONSULTANT :

ARbay
บริษัท เอ อาร์ เบย์ จำกัด
ARbay Company Limited
31 st Floor Bangkok Insurance Building
25 South Sathorn road Thungmahamek
Sathorn Bangkok 10120 THAILAND
T +66 (0) 2286 8199
F +66 (0) 2286 2863
info@arbay.co.th

CONSULTANT :

Qbic Engineers & Architects Co.,Ltd.
8 Soi KALONG 4 SANAMBINNAM ROAD,
THASAI SUB-DISTRICT, MUANG NONTHABURI DISTRICT
, NONTHABURI.
Tel 662-950-4374
Fax 662-580-3231
E-Mail : qbic@qbic.co.th, www.qbic.co.th
QBIC ENGINEERS AND ARCHITECTS CO.,LTD.

CONSULTANT :

MITR
MITR TECHNICAL CONSULTANT CO.,LTD.
1168/8 12th FLOOR, LUMPINI TOWER BUILDING,
RAMA IV RD., THUNGMAHAMEK, SATHORN, BANGKOK 10120, THAILAND
TEL : 0-2679-9079-84
FAX : 0-2679-9085 E-mail: mitr_dd@mitr.com

Architect :	SIGNATURE
ประกิต พนานุรัตน์ วสถ. 580 ที่อยู่ 251/1 ถ.จารุเมือง แขวงรองเมือง เขตปทุมวัน กรุงเทพมหานคร โทรศัพท์ 02-286-8199	
Structural Engineer :	SIGNATURE
วิศวกรผู้ออกแบบโครงสร้าง	
ณัฐสม สงวนวงษ์ วย 1423 ที่อยู่ 2/1 ซ.รามคำแหง 150 ถ.รามคำแหง แขวง สะพานสูง เขต สะพานสูง กทม. 10240	ณัฐสม สงวนวงษ์
Structural Inspector :	SIGNATURE
วิศวกรผู้ตรวจสอบโครงสร้าง	
โกมล จุฑาภัทร วย 964 ที่อยู่ 24/18 ซ.นวมินทร์ 129 ถ. นวมินทร์ แขวง นวลจันทร์ เขต บึงกุ่ม กทม. 10230	
Electrical Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบไฟฟ้ากำลัง	
นายสุภัทร บูรณวิทย์ วฟก.1265 ที่อยู่ 21 ซอยทานสัมฤทธิ์ 13 ตำบลท่าทราย อ.เมืองนนทบุรี จ.นนทบุรี 11000	สุภัทร บูรณวิทย์
Mechanical Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบเครื่องกลและปรับอากาศ	
นายประสิทธิ์ เกี้ยวสุนทร วก.1221 ที่อยู่ 44/372 ซอยบางกระดี่ 35/1 แขวงแสมดำ เขตบางขุนเทียน กทม. 10150	ประสิทธิ์
Sanitary Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบสุขาภิบาล และดับเพลิง	
นายทศวรรษ สนั่นฤทธิ์ วส. 215 ที่อยู่ บ้านเลขที่ 99/107 หมู่ที่ 3 ต.ศีรษะจรเข้น้อย อ.บางเสาธง จ.สมุทรปราการ 10540	ทศวรรษ

ISSUE/REVISION

REV.	DESCRIPTION	DATE
A	90% DEVELOPED	09/05/2026

PROJECT NAME :

GEDC 01

LOCATION:
Nikhom Phattana district, Rayong ,industrial estate,CPGC

BUILDING :
MAIN BUILDING

90% DEVELOPED

TITLE :

DETAIL-3F-DATAHALL3-4(AC)
ROOMWALL ROOM 3-4A,3-4 SECTION

JOB NO.	SCALE 1 : 50
DRAWN LYT	REF.
CHECKED LJC	DWG. NO. MPK01A-90-A-RD-308
APPROVED LXD	
DATE 2026.05.09	

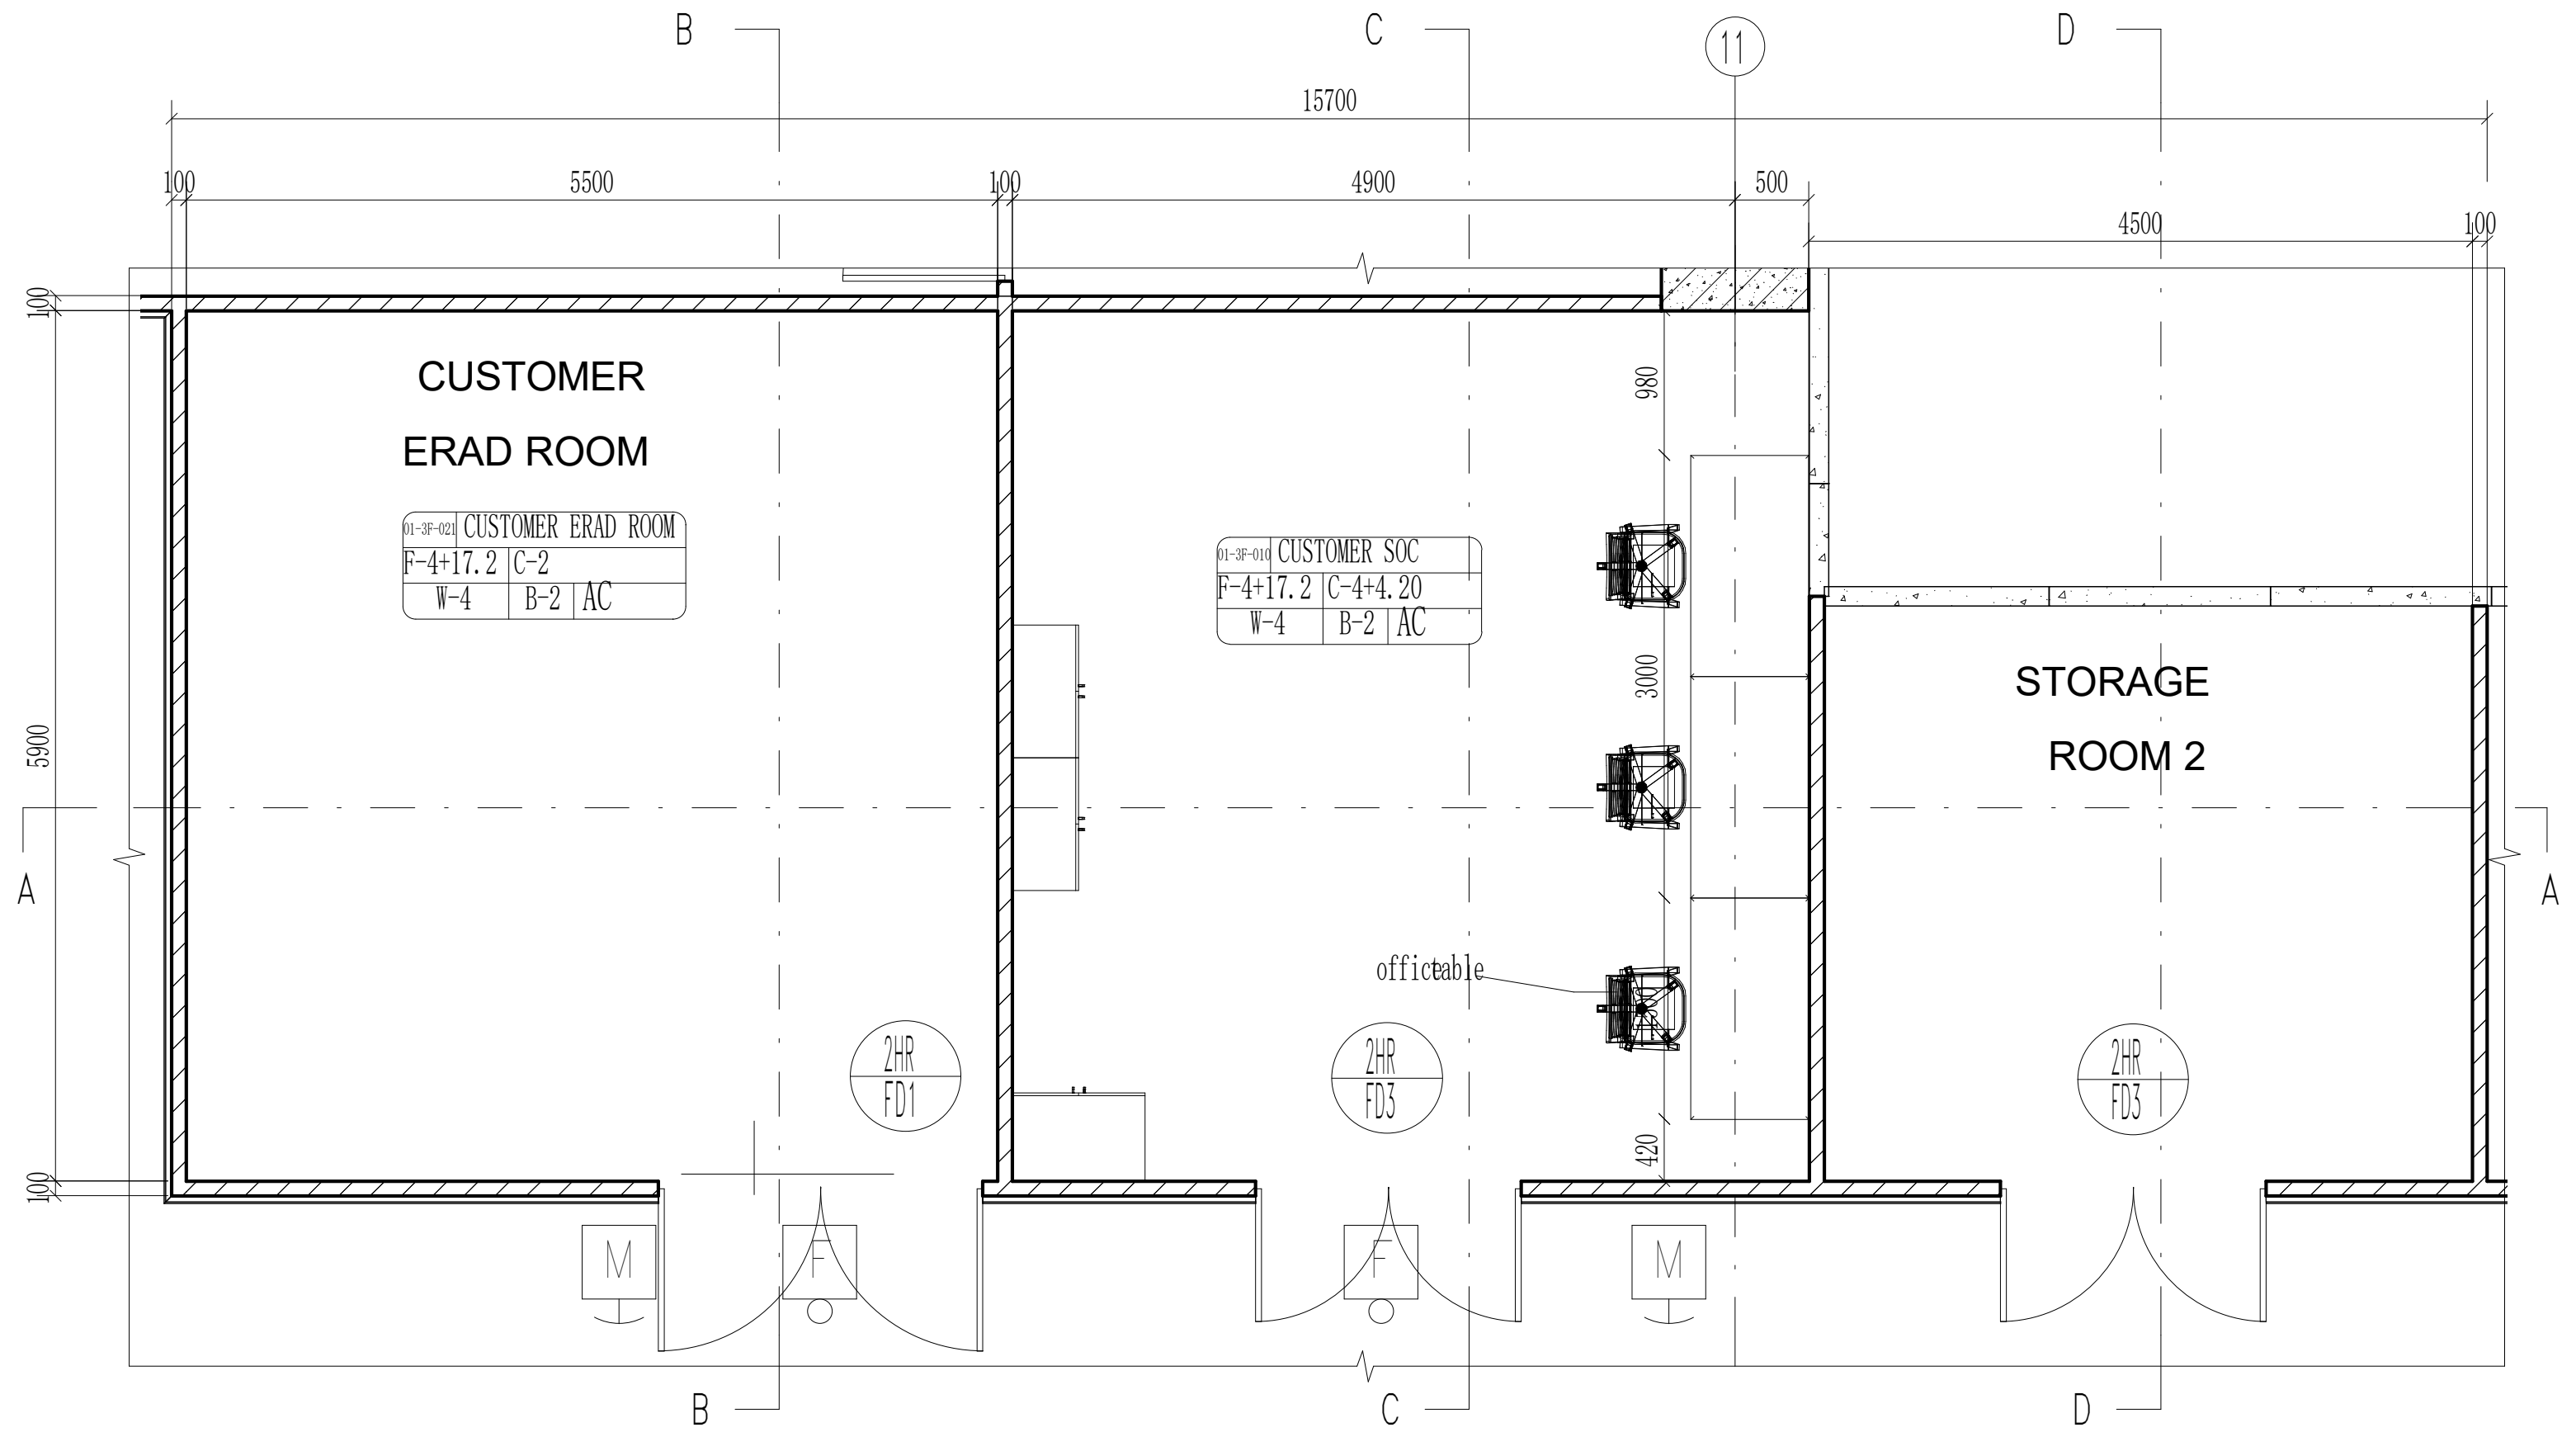
B
C
11
D
15700
100
5500
100
4900
500
4500
100
5900
CUSTOMER
ERAD ROOM
01-3F-021 CUSTOMER ERAD ROOM
F-4+17.2 C-2
W-4 B-2 AC
01-3F-010 CUSTOMER SOC
F-4+17.2 C-4+4.20
W-4 B-2 AC
980
3000
420
officetable
STORAGE
ROOM 2
2HR FD1
2HR FD3
2HR FD3
M
F
F
M
A
A
B
C
D

CUSTOMER ERAD ROOM、CUSTOMER SECURITY STORAGE ROOM、STORAGE ROOM 3RD FLOOR PLAN

Scale 1:50

THE "SFL" MARKED IN THE DRAWING REFERS TO THE STRUCTURAL FLOOR LEVEL, WHILE THE FINISHED FLOOR LEVEL (FFL) IS DETERMINED BASED ON FLOOR FINISHES.

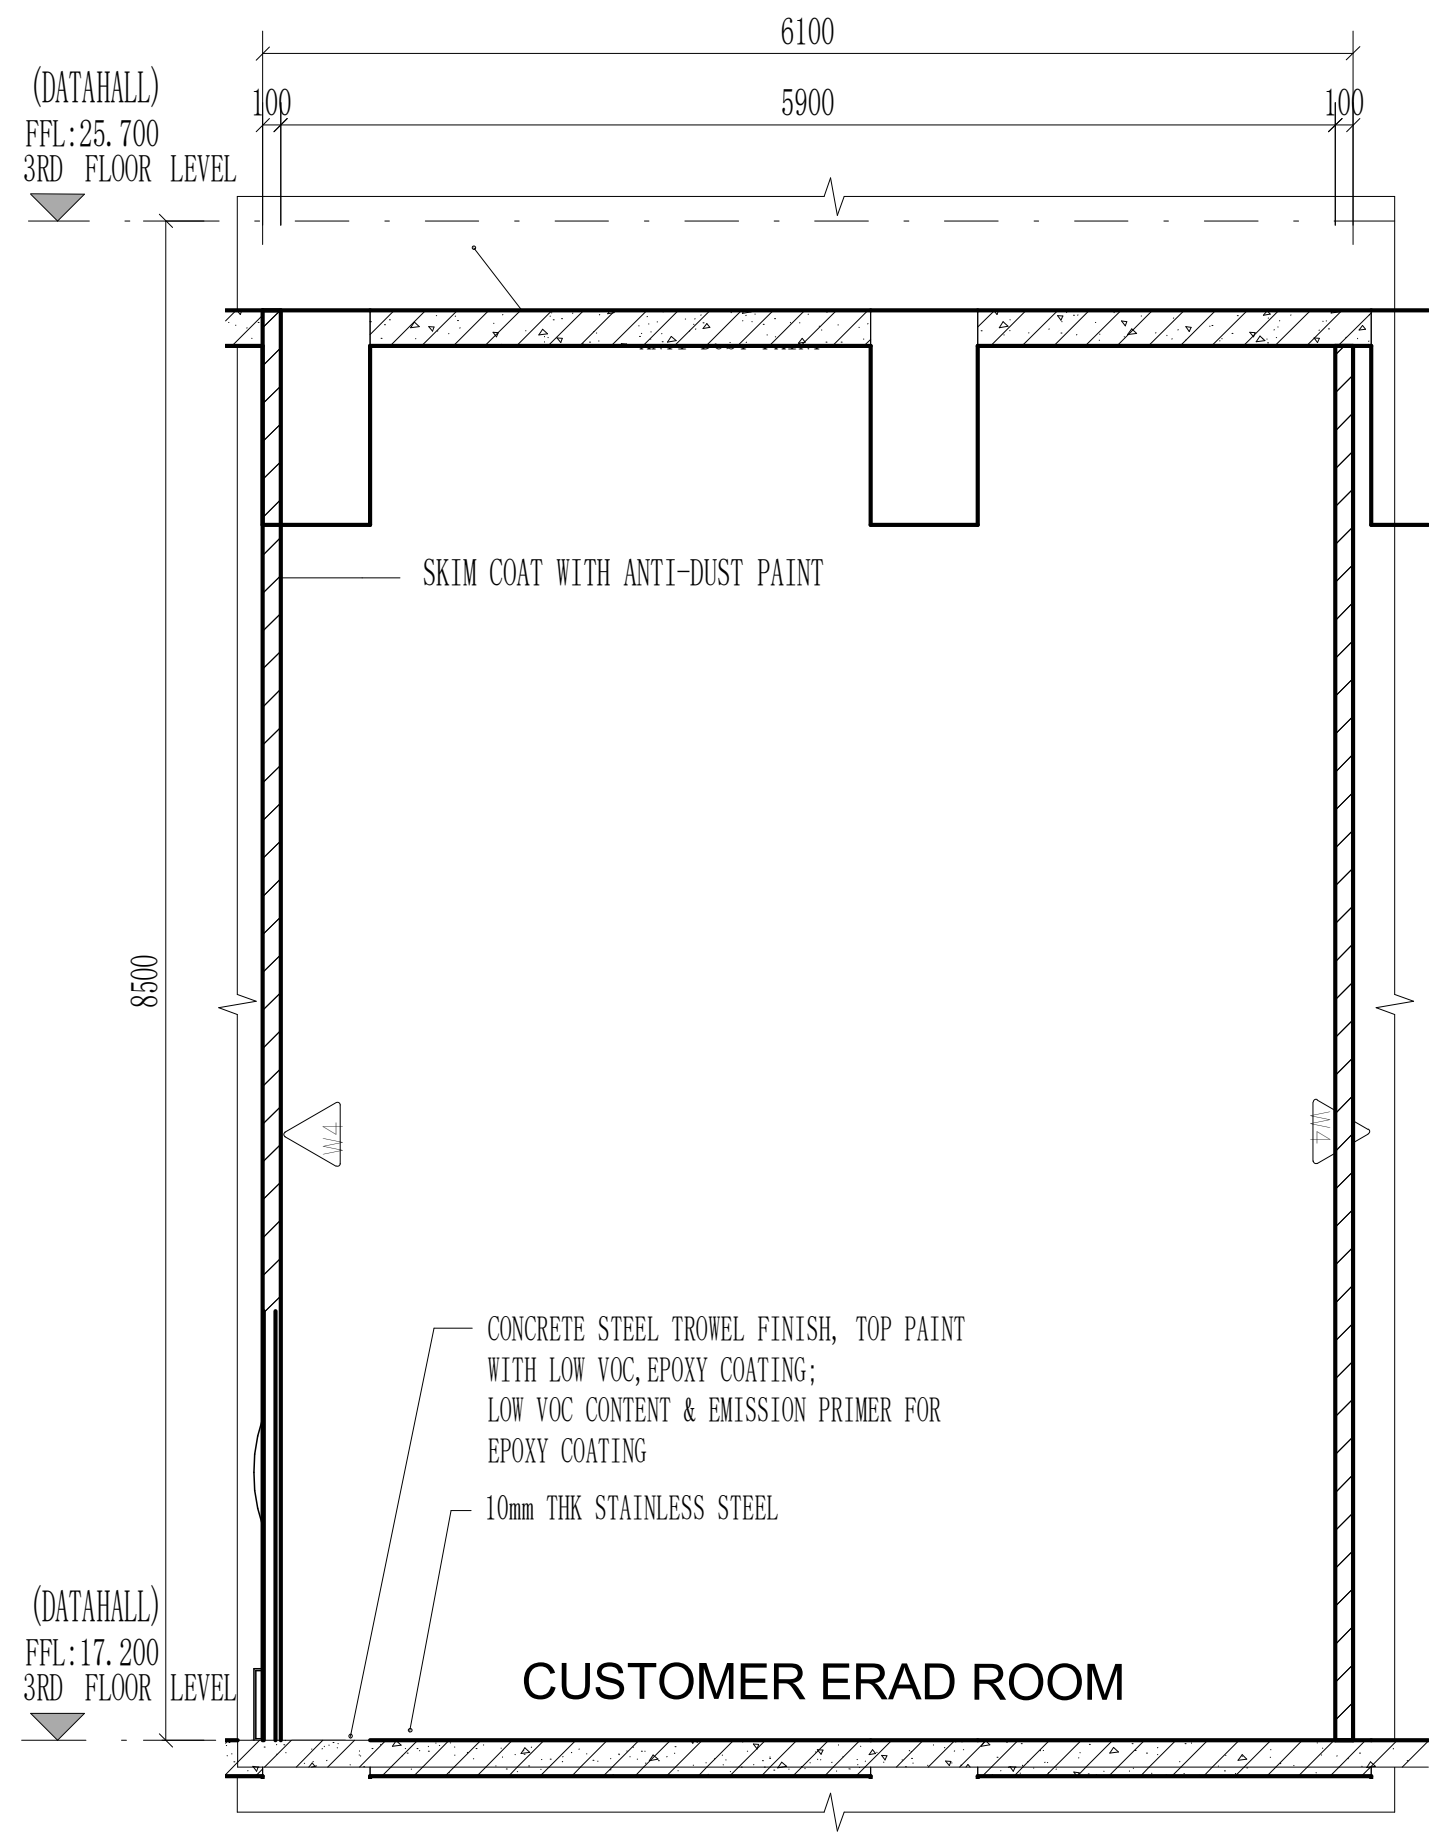
6100
100
5900
100
(DATAHALL)
FFL:25.700
3RD FLOOR LEVEL
8500
SKIM COAT WITH ANTI-DUST PAINT
CONCRETE STEEL TROWEL FINISH, TOP PAINT WITH LOW VOC,EPOXY COATING; LOW VOC CONTENT & EMISSION PRIMER FOR EPOXY COATING
10mm THK STAINLESS STEEL
(DATAHALL)
FFL:17.200
3RD FLOOR LEVEL
CUSTOMER ERAD ROOM

CUSTOMER ERAD ROOM SECTION B-B

Scale 1:50

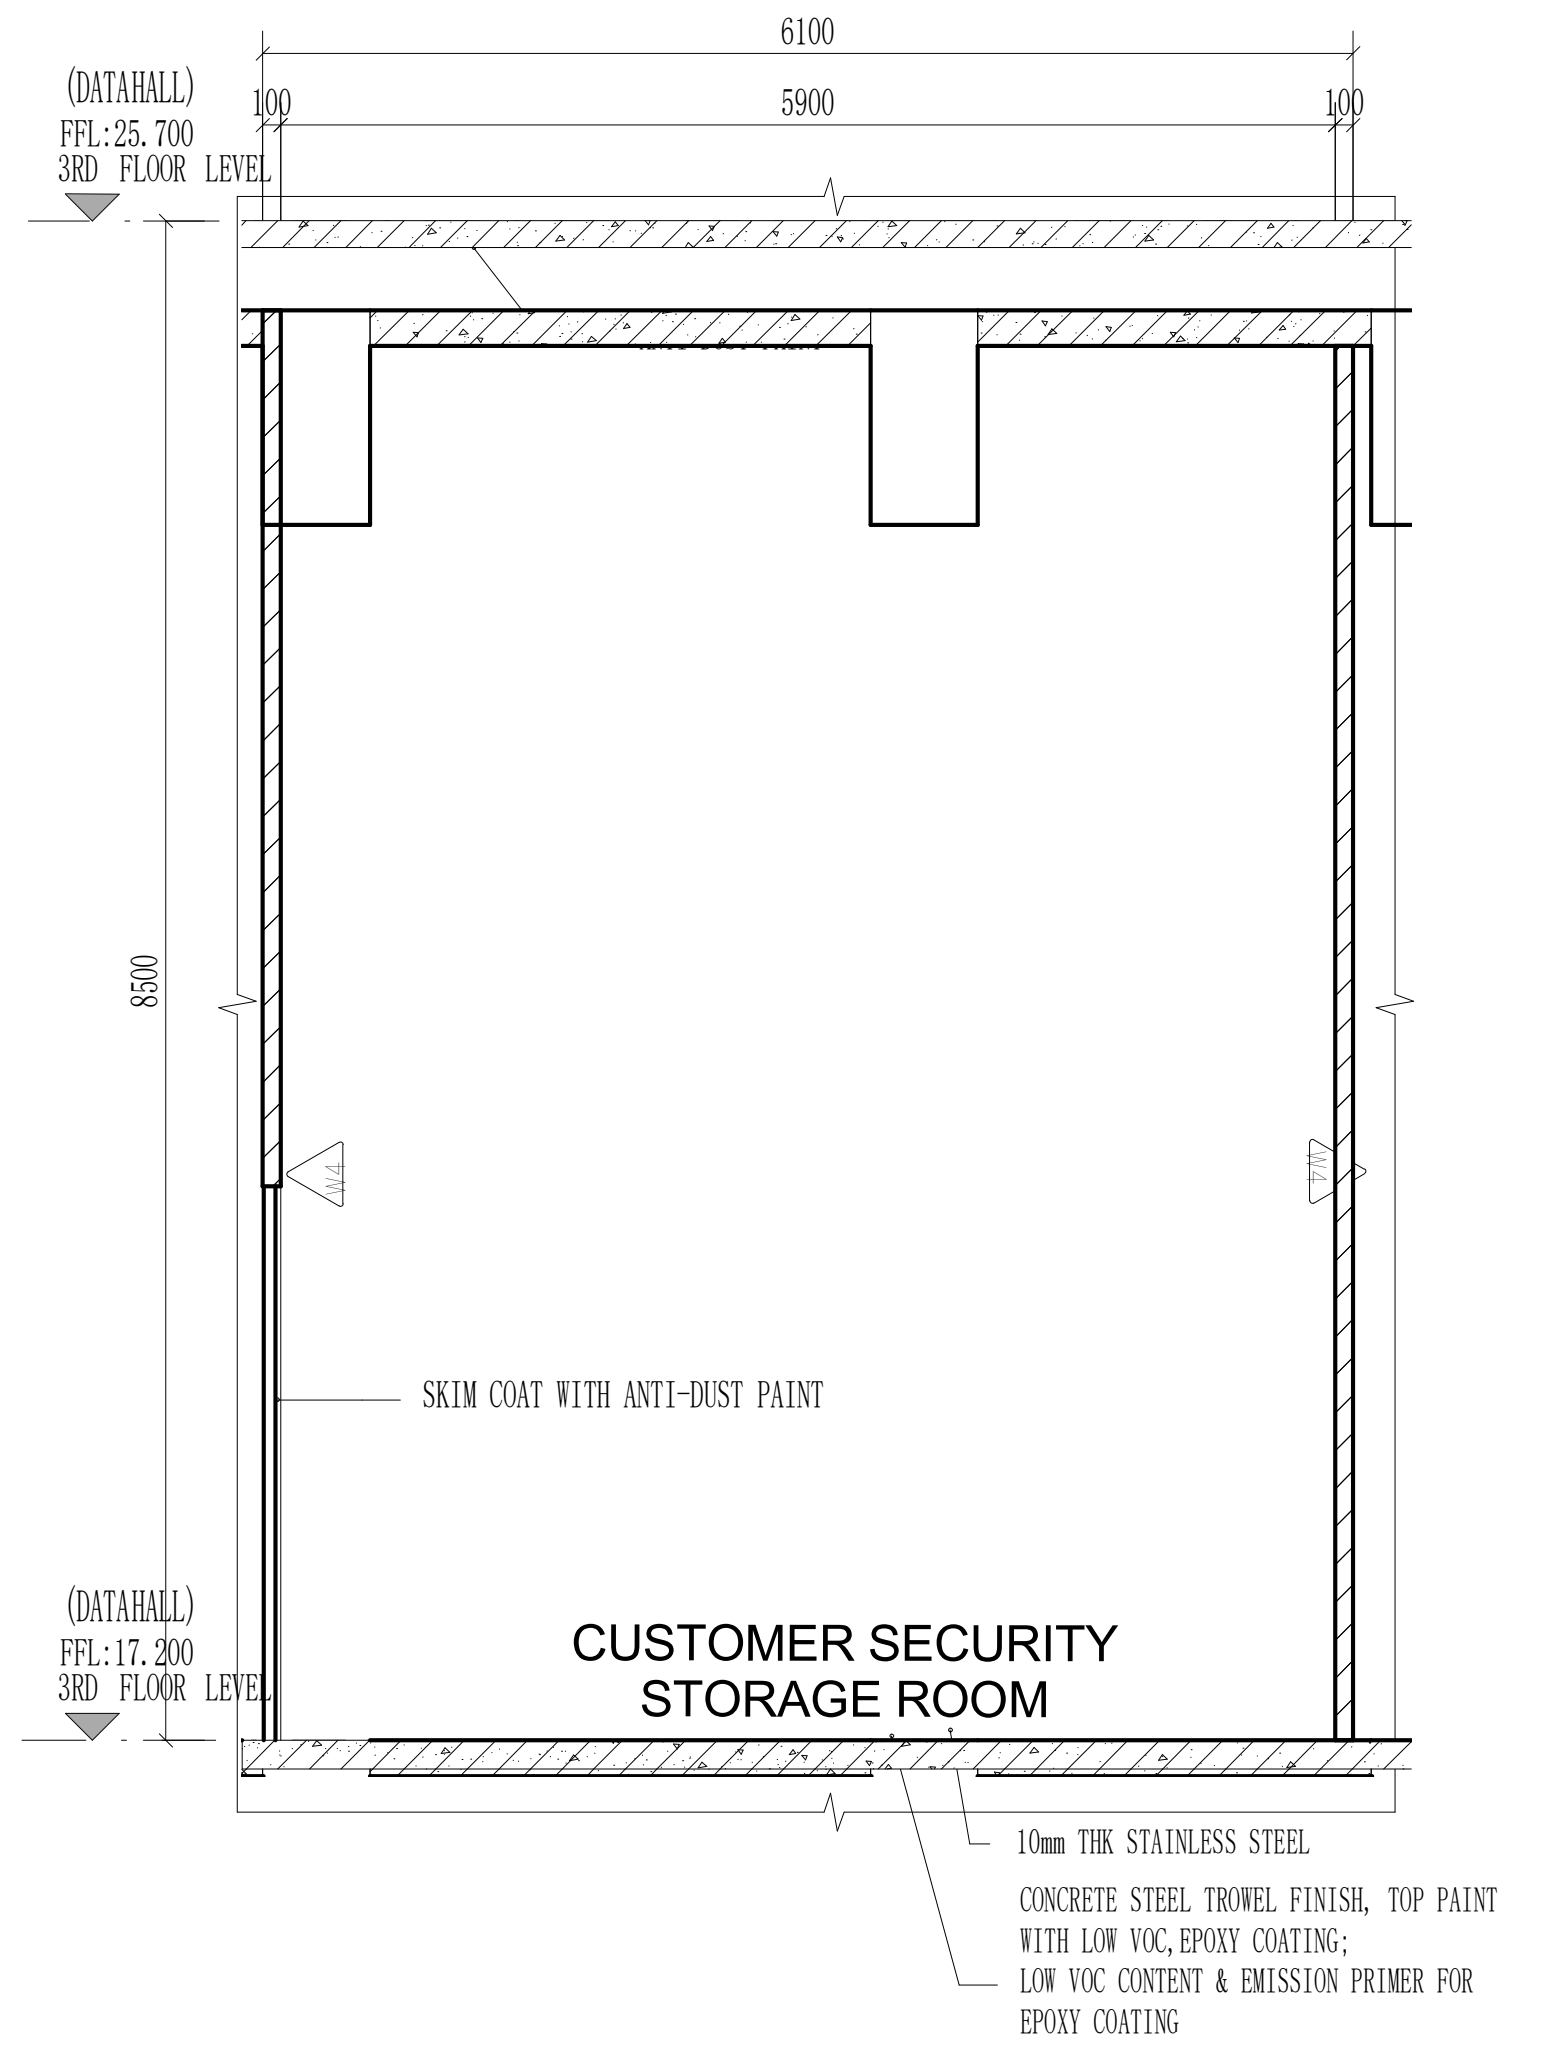
6100
100
5900
100
(DATAHALL)
FFL:25.700
3RD FLOOR LEVEL
8500
SKIM COAT WITH ANTI-DUST PAINT
(DATAHALL)
FFL:17.200
3RD FLOOR LEVEL
CUSTOMER SECURITY STORAGE ROOM
10mm THK STAINLESS STEEL
CONCRETE STEEL TROWEL FINISH, TOP PAINT WITH LOW VOC,EPOXY COATING; LOW VOC CONTENT & EMISSION PRIMER FOR EPOXY COATING

CUSTOMER SECURITY STORAGE ROOMSECTION C-C

Scale 1:50

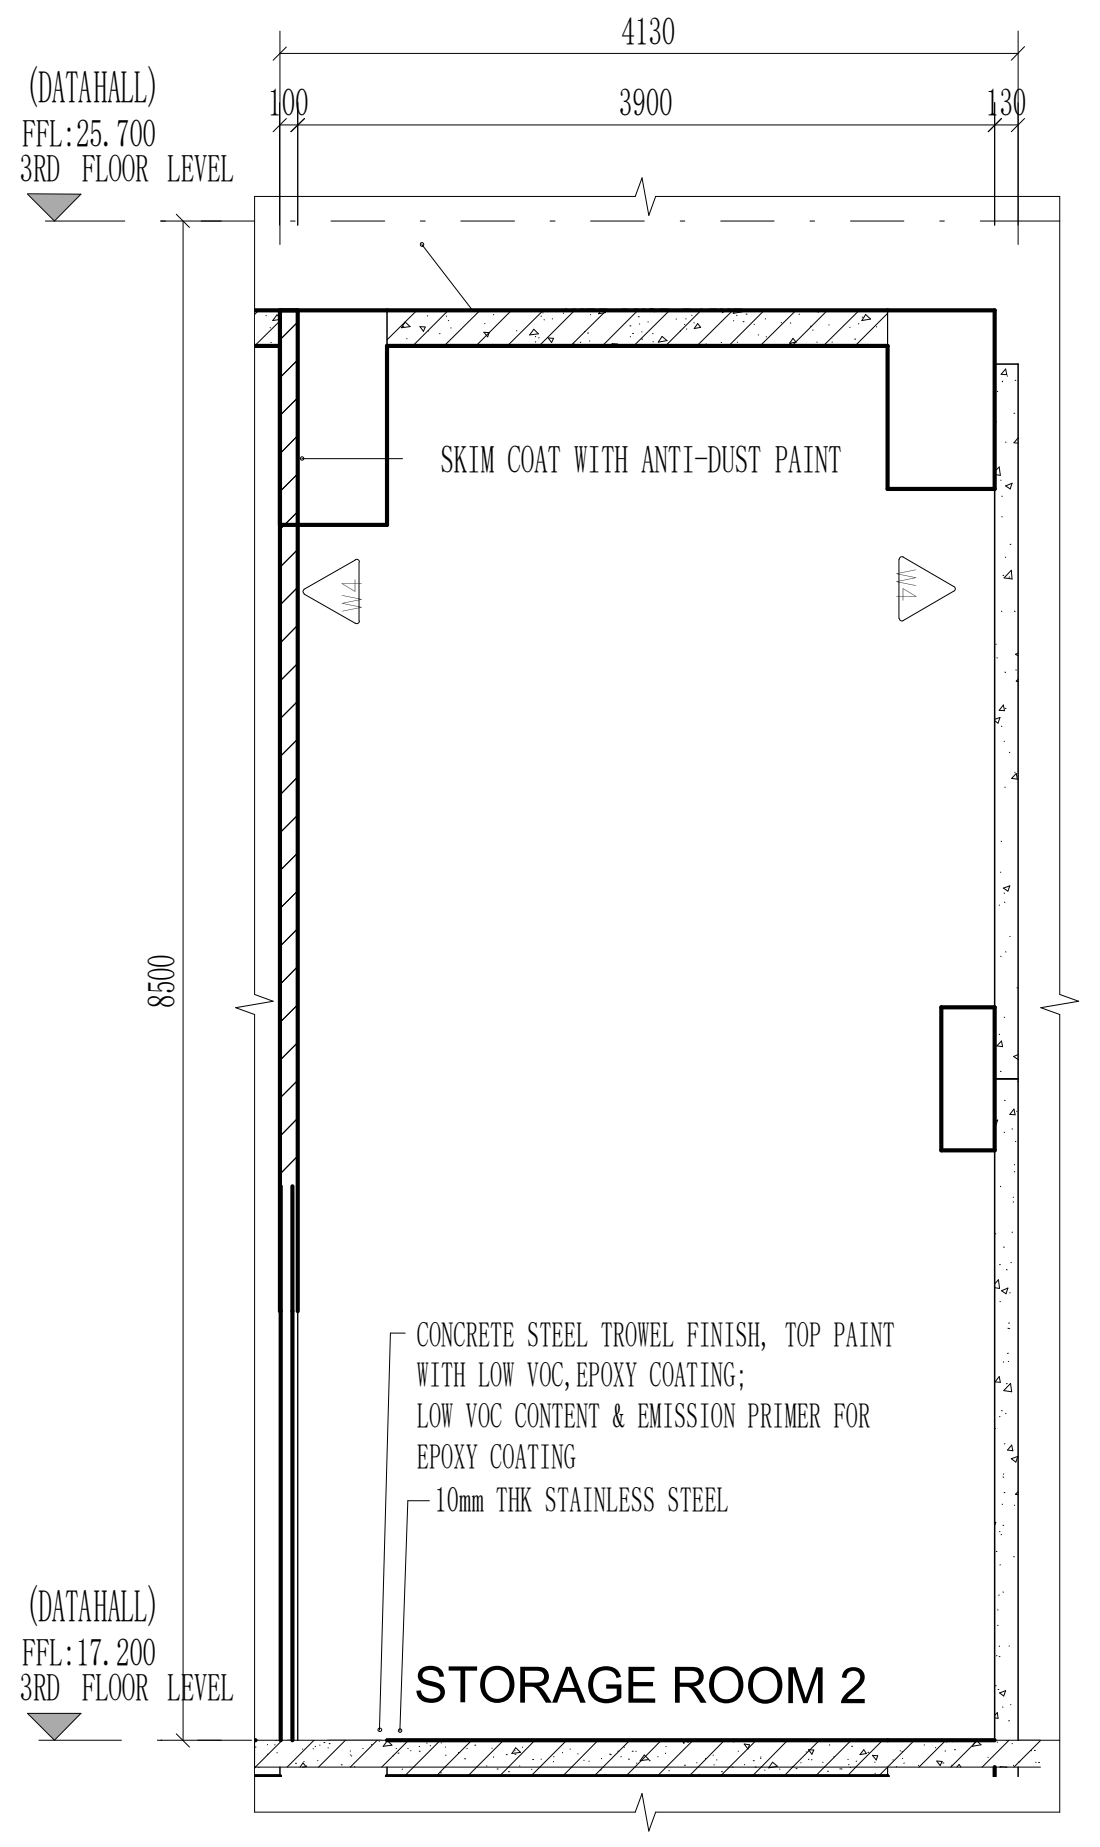
4130
100
3900
130
(DATAHALL)
FFL:25.700
3RD FLOOR LEVEL
8500
SKIM COAT WITH ANTI-DUST PAINT
CONCRETE STEEL TROWEL FINISH, TOP PAINT WITH LOW VOC,EPOXY COATING; LOW VOC CONTENT & EMISSION PRIMER FOR EPOXY COATING
10mm THK STAINLESS STEEL
(DATAHALL)
FFL:17.200
3RD FLOOR LEVEL
STORAGE ROOM 2

STORAGE ROOM SECTION D-D

Scale 1:50

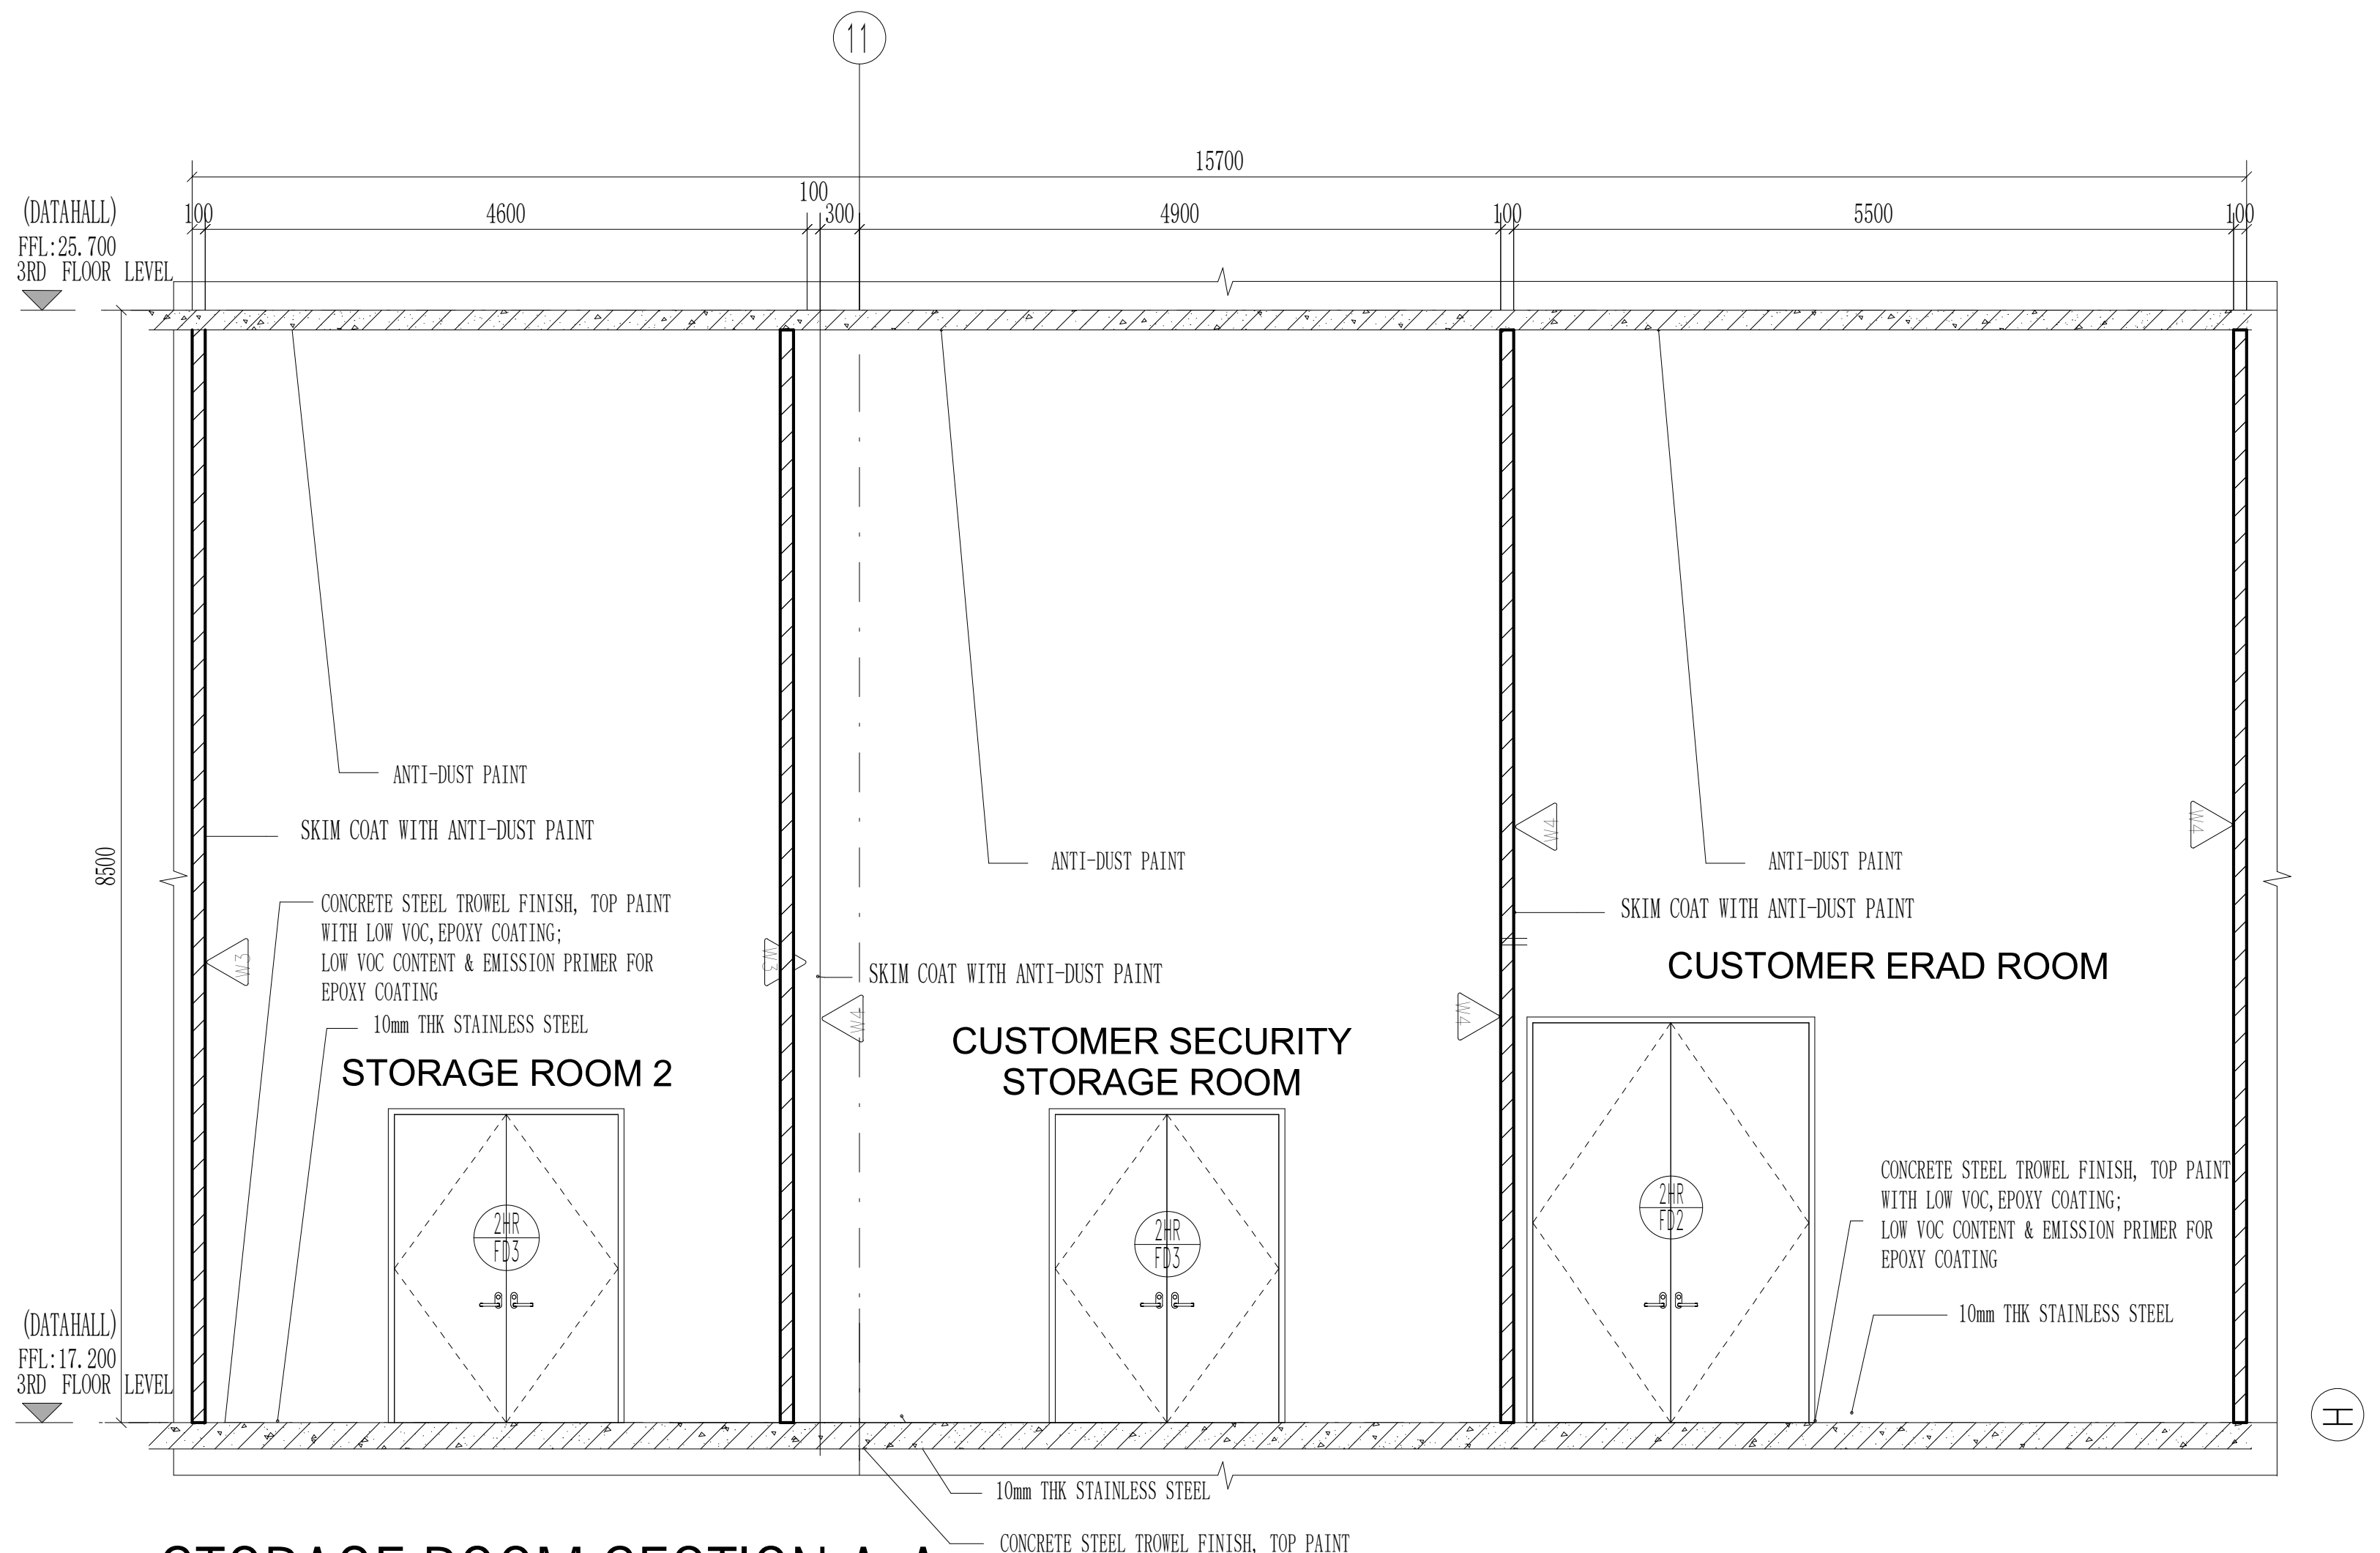
11
15700
100
4600
100
300
4900
100
5500
100
(DATAHALL)
FFL:25.700
3RD FLOOR LEVEL
8500
ANTI-DUST PAINT
SKIM COAT WITH ANTI-DUST PAINT
CONCRETE STEEL TROWEL FINISH, TOP PAINT WITH LOW VOC,EPOXY COATING; LOW VOC CONTENT & EMISSION PRIMER FOR EPOXY COATING
10mm THK STAINLESS STEEL
STORAGE ROOM 2
ANTI-DUST PAINT
SKIM COAT WITH ANTI-DUST PAINT
CUSTOMER SECURITY STORAGE ROOM
ANTI-DUST PAINT
SKIM COAT WITH ANTI-DUST PAINT
CUSTOMER ERAD ROOM
2HR FD3
2HR FD3
2HR FD2
CONCRETE STEEL TROWEL FINISH, TOP PAINT WITH LOW VOC,EPOXY COATING; LOW VOC CONTENT & EMISSION PRIMER FOR EPOXY COATING
10mm THK STAINLESS STEEL
(DATAHALL)
FFL:17.200
3RD FLOOR LEVEL
H
10mm THK STAINLESS STEEL
CONCRETE STEEL TROWEL FINISH, TOP PAINT WITH LOW VOC,EPOXY COATING; LOW VOC CONTENT & EMISSION PRIMER FOR EPOXY COATING

STORAGE ROOM SECTION A-A

Scale 1:50

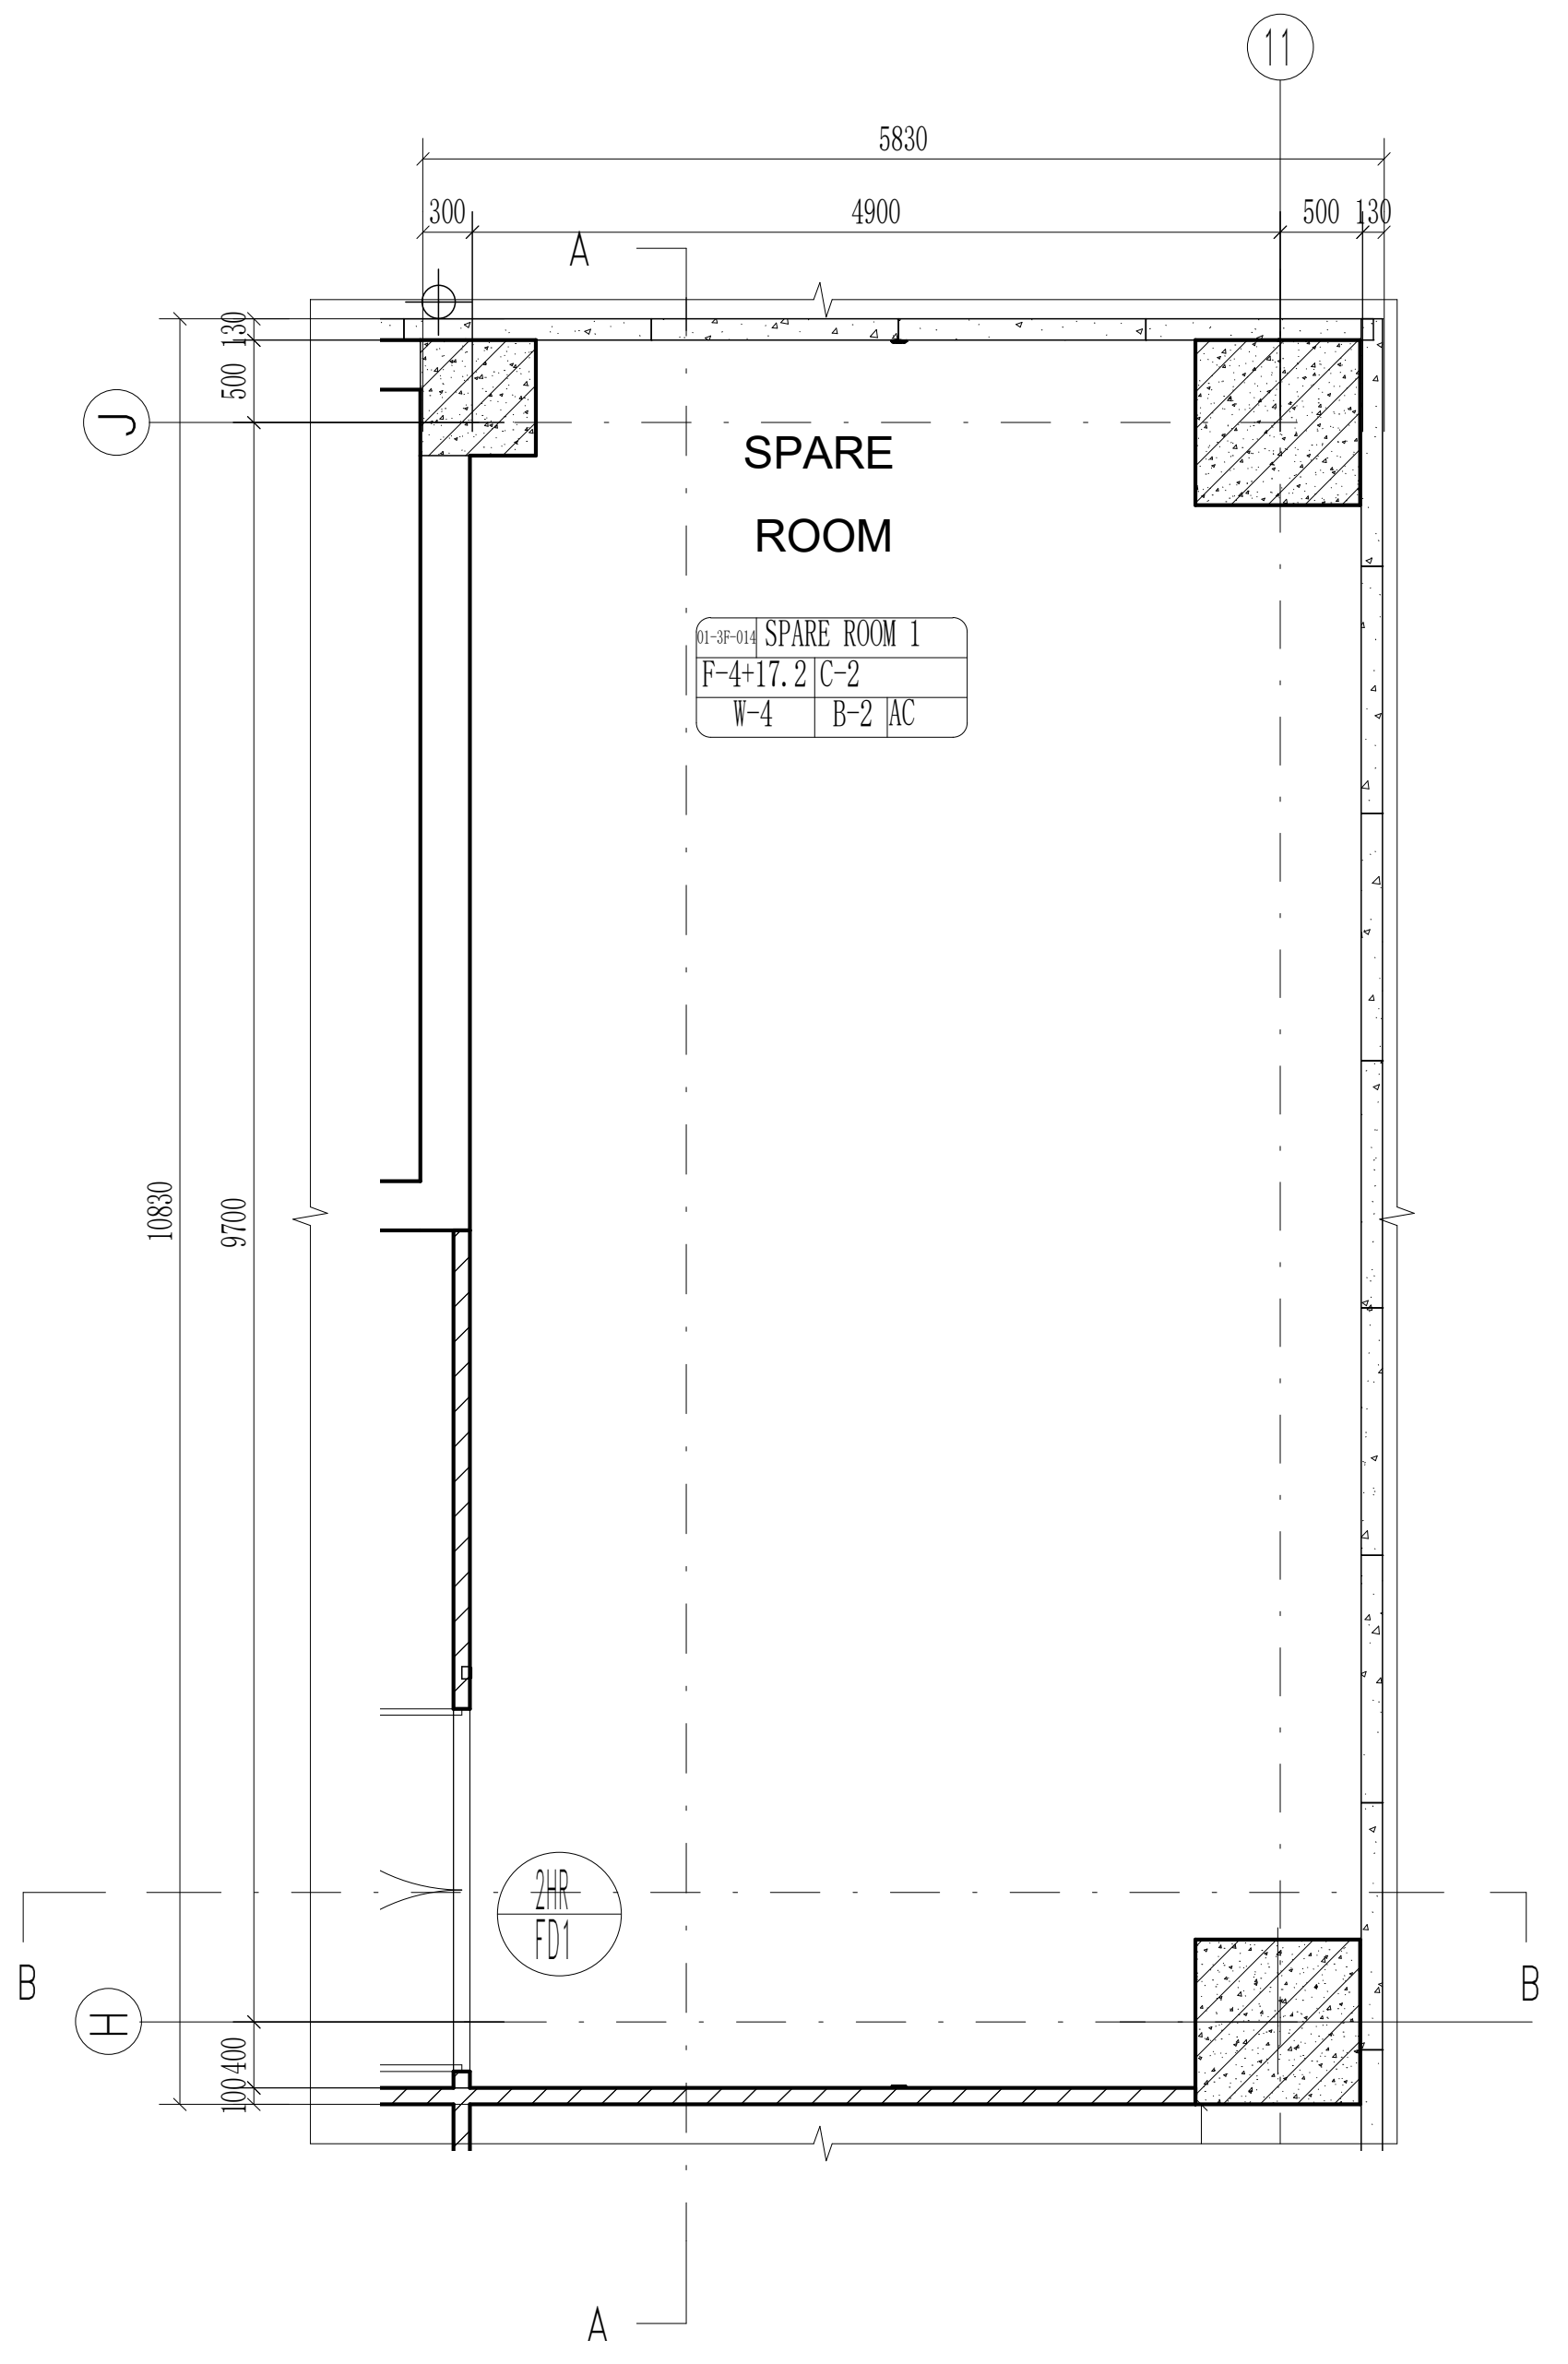
11
5830
300
4900
500
130
A
J
500
130
SPARE
ROOM
01-3F-014 SPARE ROOM 1
F-4+17.2 C-2
W-4 B-2 AC
10830
9700
2HR FD1
B
B
H
100
400
A

SPARE ROOM 3RD FLOOR PLAN

Scale 1:50

THE "SFL" MARKED IN THE DRAWING REFERS TO THE STRUCTURAL FLOOR LEVEL, WHILE THE FINISHED FLOOR LEVEL (FFL) IS DETERMINED BASED ON FLOOR FINISHES.

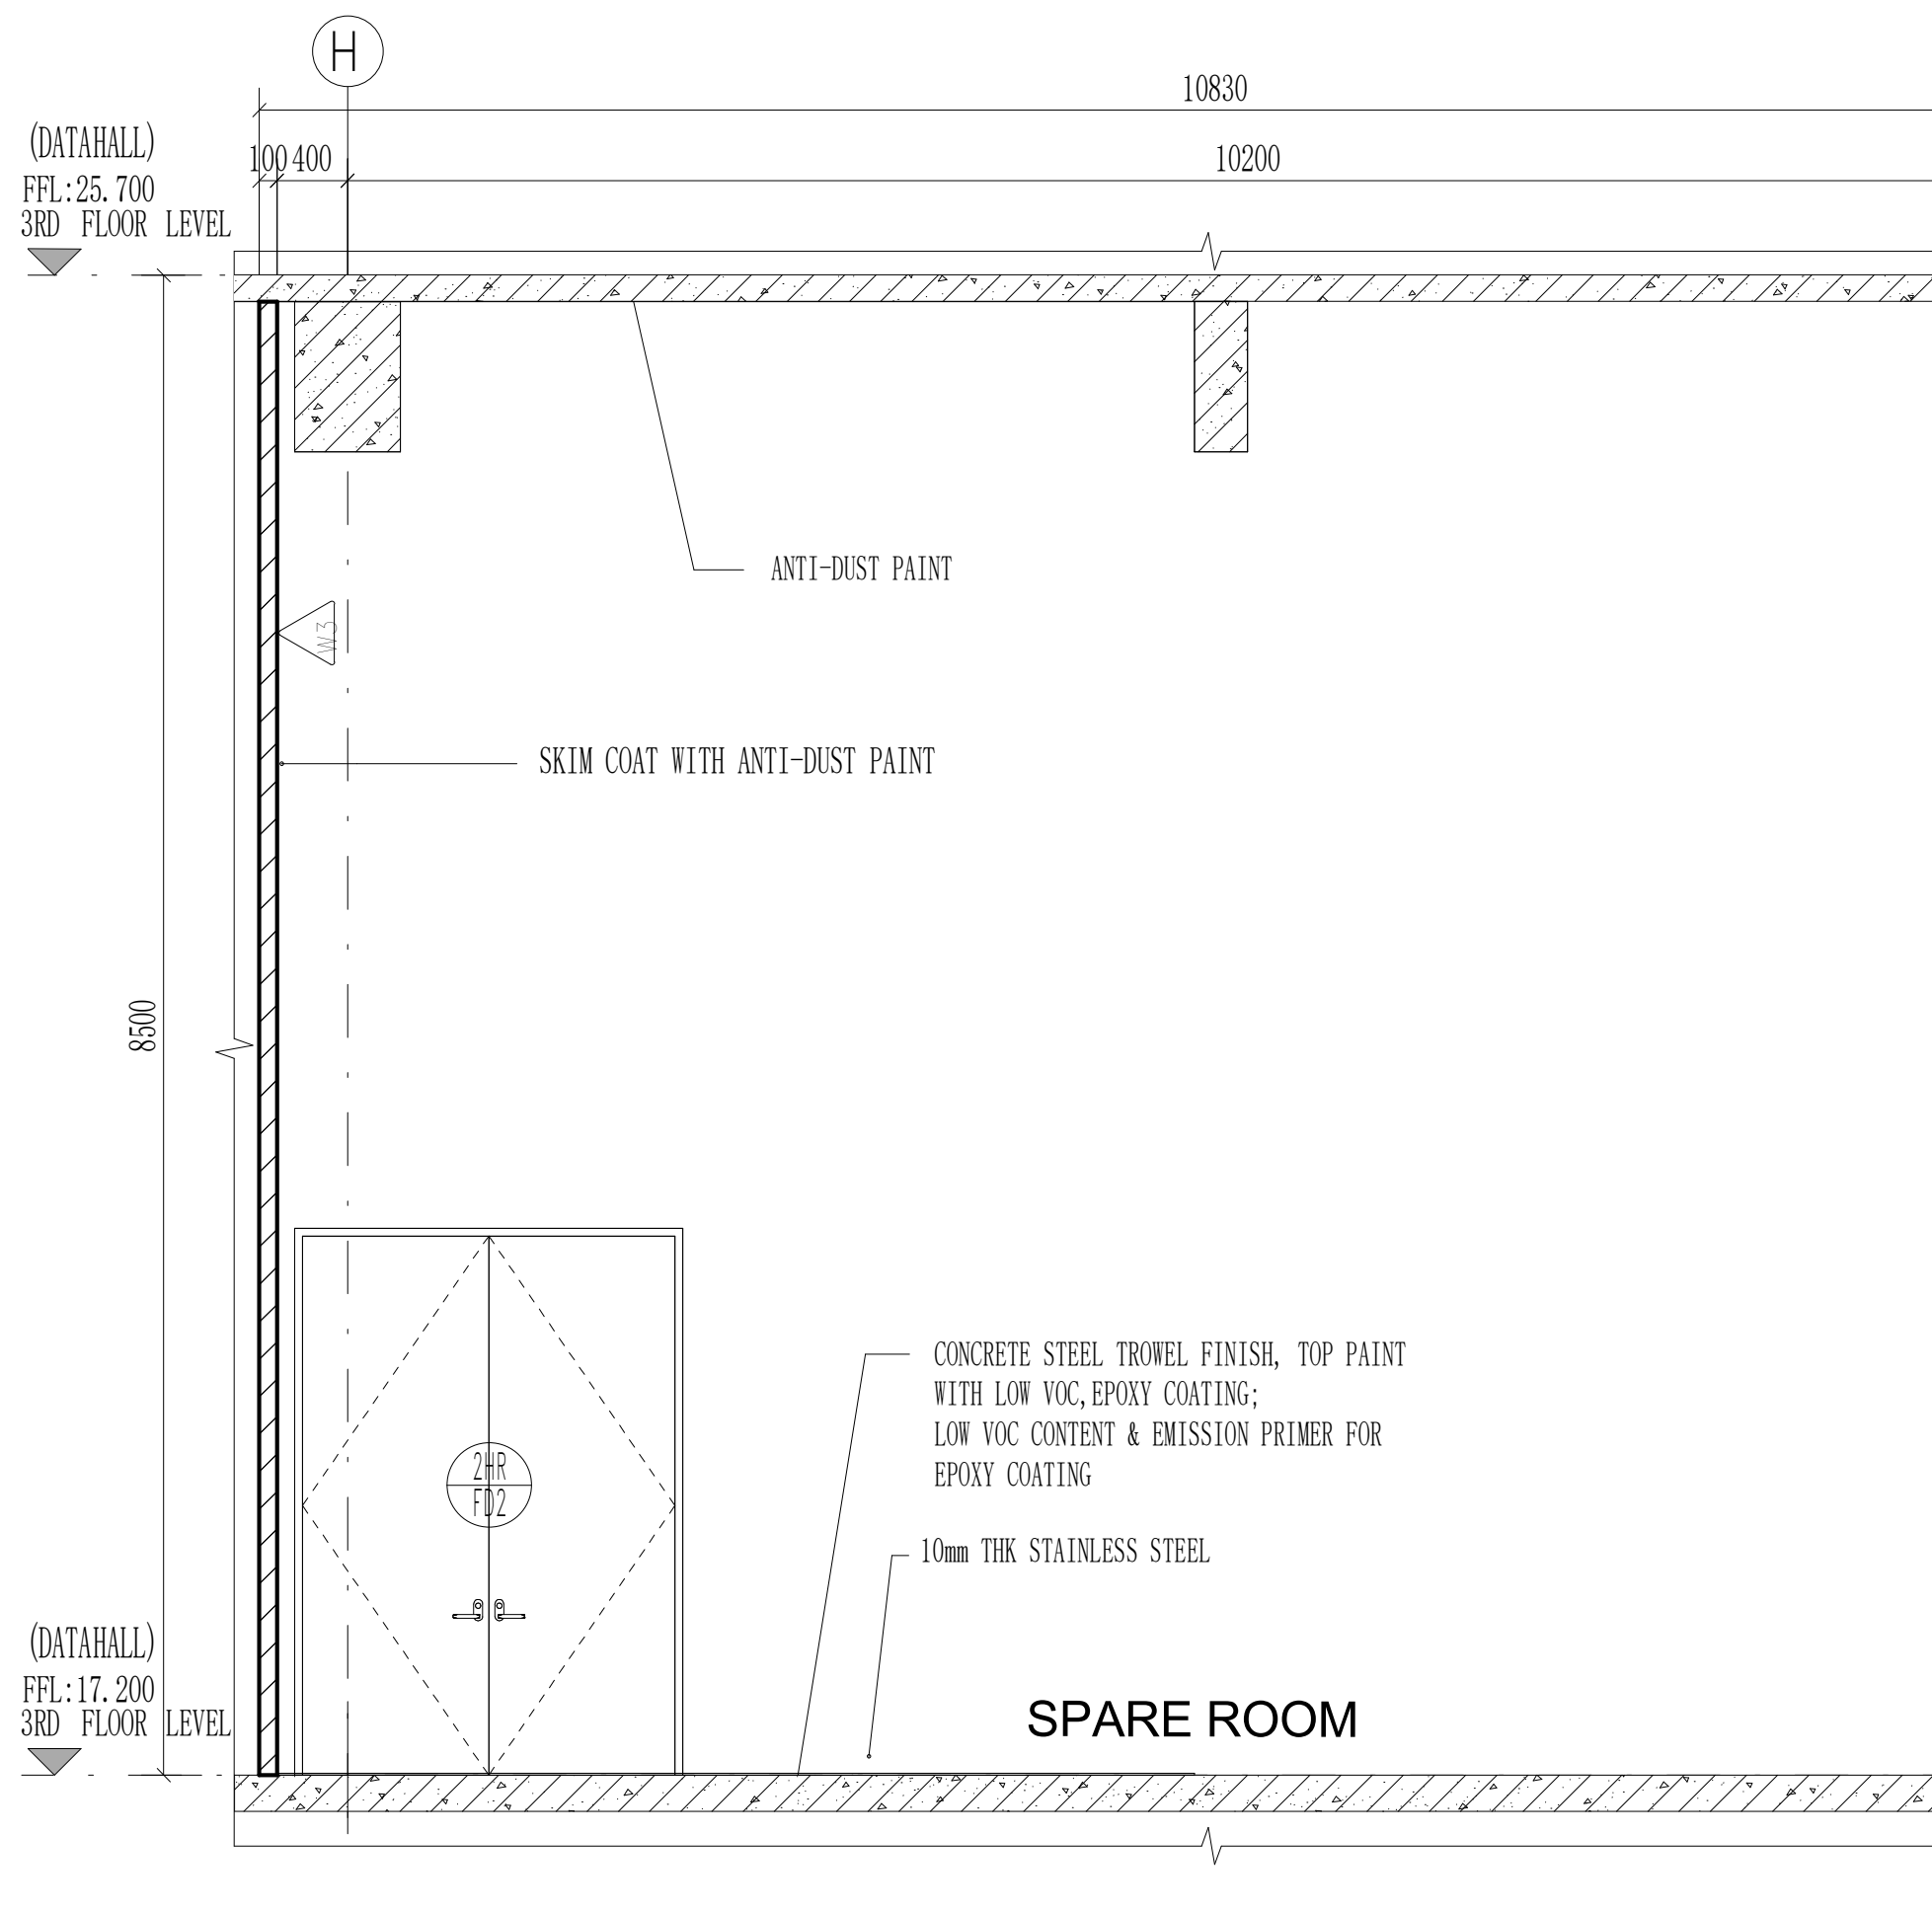
H
10830
100
400
10200
130
(DATAHALL)
FFL:25.700
3RD FLOOR LEVEL
8500
ANTI-DUST PAINT
SKIM COAT WITH ANTI-DUST PAINT
2HR FD2
CONCRETE STEEL TROWEL FINISH, TOP PAINT WITH LOW VOC,EPOXY COATING; LOW VOC CONTENT & EMISSION PRIMER FOR EPOXY COATING
10mm THK STAINLESS STEEL
(DATAHALL)
FFL:17.200
3RD FLOOR LEVEL
SPARE ROOM

SPARE ROOM SECTION A-A

Scale 1:50

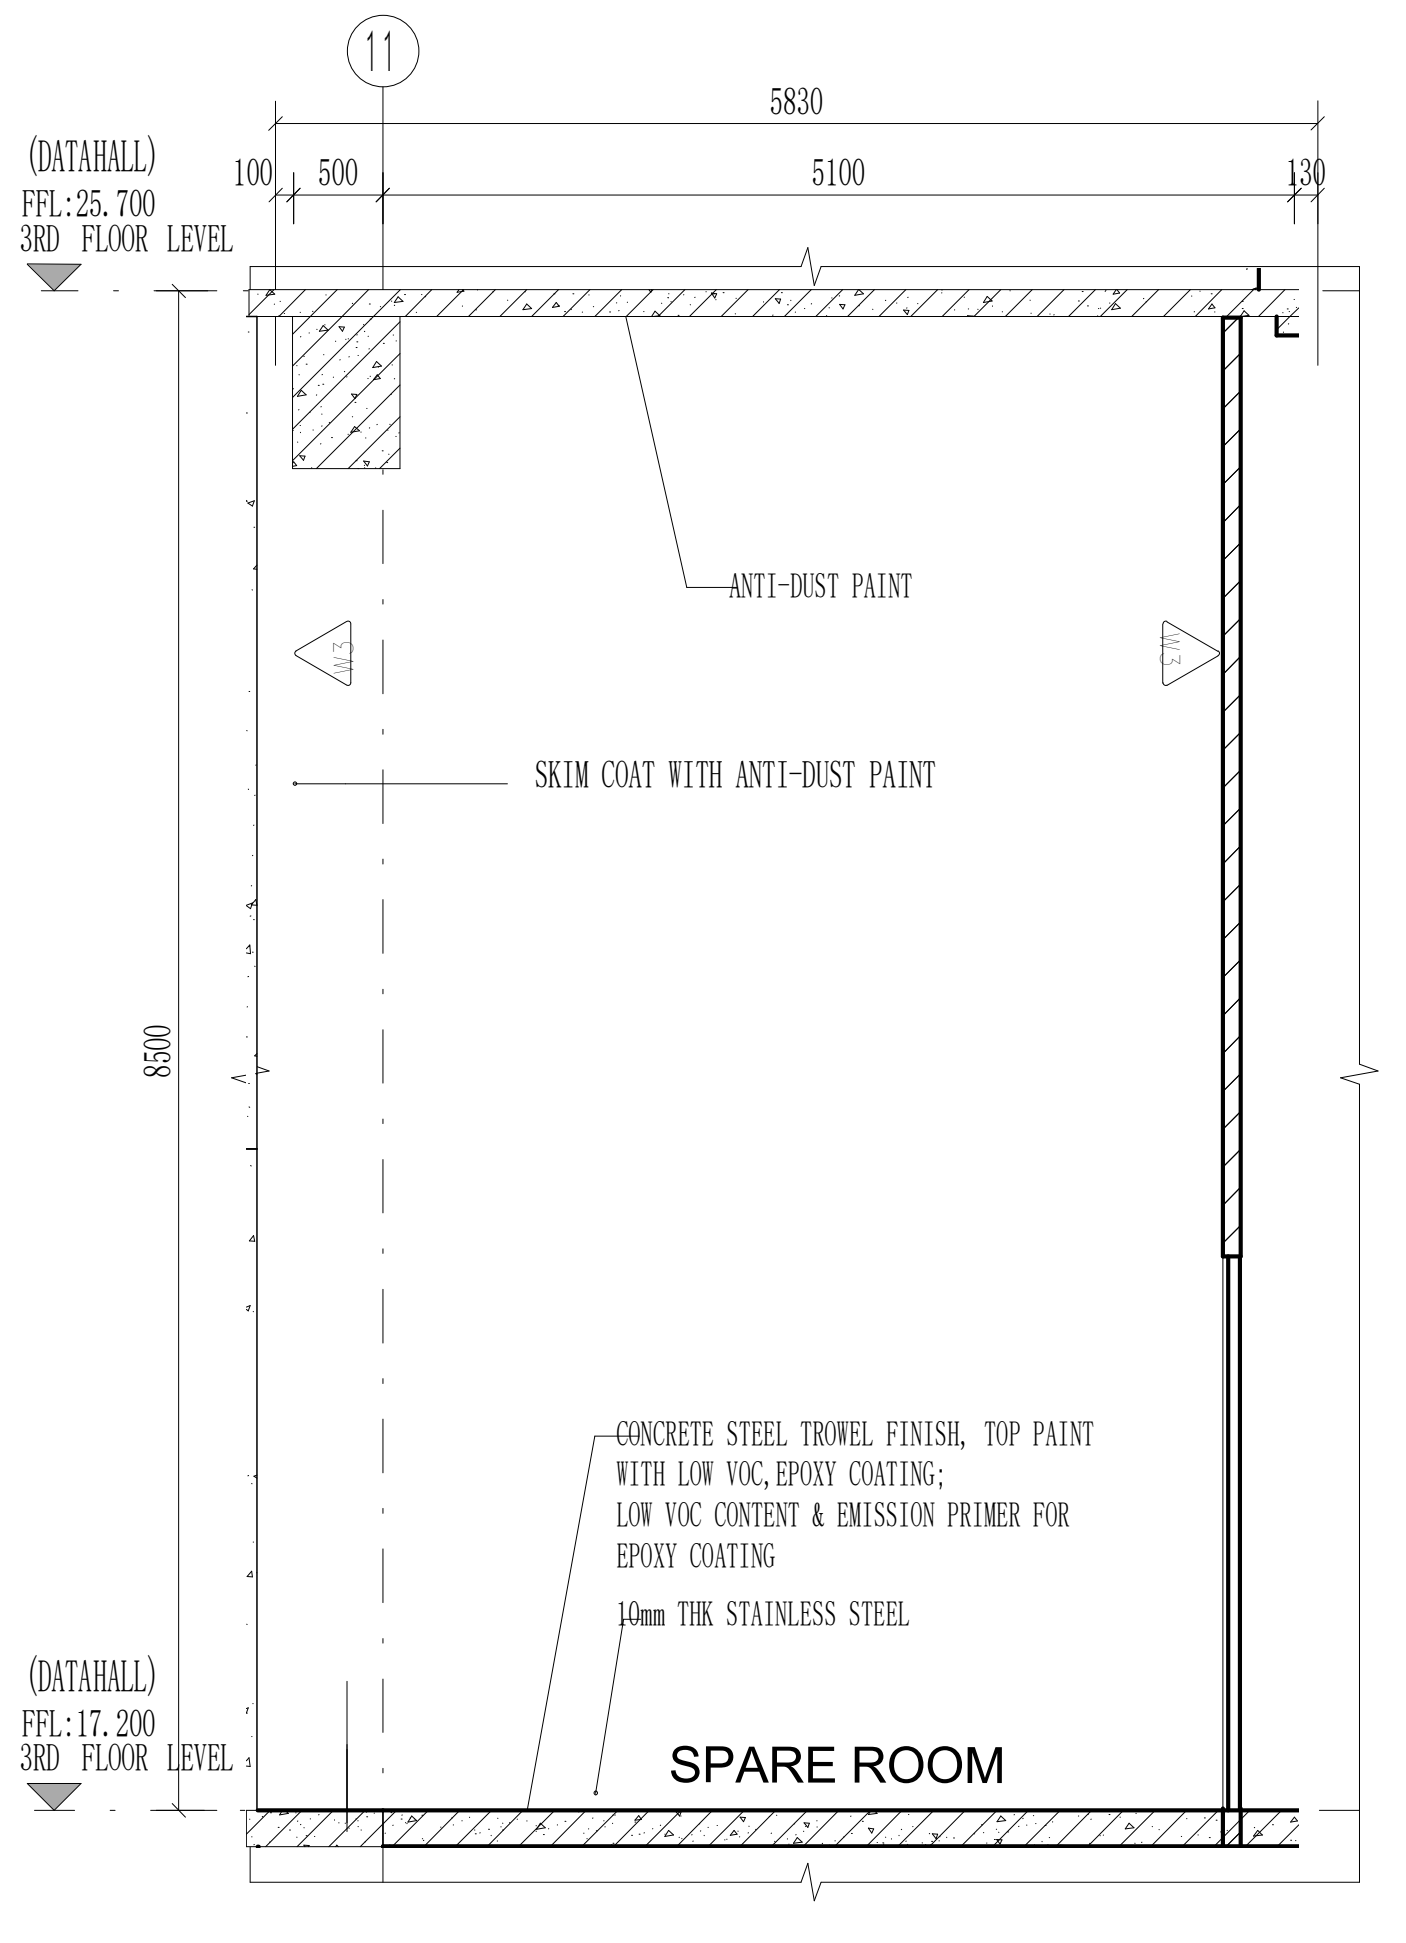
11
5830
100
500
5100
130
(DATAHALL)
FFL:25.700
3RD FLOOR LEVEL
8500
ANTI-DUST PAINT
SKIM COAT WITH ANTI-DUST PAINT
CONCRETE STEEL TROWEL FINISH, TOP PAINT WITH LOW VOC,EPOXY COATING; LOW VOC CONTENT & EMISSION PRIMER FOR EPOXY COATING
10mm THK STAINLESS STEEL
(DATAHALL)
FFL:17.200
3RD FLOOR LEVEL
SPARE ROOM

SPARE ROOM SECTION B-B

Scale 1:50

CLIENT :

GULF EDGE DC 01

87 Wireless Road, M Thai Tower 11th. Floor, All Seasons Place, Lumpini,
Pathumwan, Bangkok 10330, Thailand

CONTRACTOR :

HUASHI
华西发展(泰国)有限公司
บริษัท หัวซือ ดีเวลลอปเม้นต์ (ประเทศไทย) จำกัด
HUASHI DEVELOPMENT CO.,LTD
No. 202, Room No. 1403, 14/F, Le Concorde Building,
Ratchadapisek Road, Huaykhwang Sub-District,
Huaykhwang District, Bangkok Metropolitan 10310.

CONSULTANT :

ARbay
บริษัท เอ อาร์ เบย์ จำกัด
ARbay Company Limited
31 st Floor Bangkok Insurance Building
25 South Sathorn road Thungmahamek
Sathorn Bangkok 10120 THAILAND
T +66 (0) 2286 8199
F +66 (0) 2286 2863
info@arbay.co.th

CONSULTANT :

Qbic
Qbic Engineers & Architects Co.,Ltd.
8 Soi KALONG 4 SANAMBINNAM ROAD,
THASAI SUB-DISTRICT, MUANG NONTHABURI DISTRICT
, NONTHABURI.
Tel 662-950-4374
Fax 662-580-3231
E-Mail : qbic@qbic.co.th, www.qbic.co.th
QBIC ENGINEERS AND ARCHITECTS CO.,LTD.

CONSULTANT :

MITR
MITR TECHNICAL CONSULTANT CO.,LTD.
1168/8 12th FLOOR, LUMPINI TOWER BUILDING,
RAMA IV RD., THUNGMAHAMEK, SATHORN, BANGKOK 10120, THAILAND
TEL : 0-2679-9079-84
FAX : 0-2679-9085 E-mail: mitr_dd@mitr.com

Architect :	SIGNATURE
ประกิต พนานุรัตน์ วสถ. 580 ที่อยู่ 251/1 ถ.จารุเมือง แขวงรองเมือง เขตปทุมวัน กรุงเทพมหานคร โทรศัพท์ 02-286-8199	
Structural Engineer :	SIGNATURE
วิศวกรผู้ออกแบบโครงสร้าง	
ณัฐสม สงวนวงษ์ วย 1423 ที่อยู่ 2/1 ซ.รามคำแหง 150 ถ.รามคำแหง แขวง สะพานสูง เขต สะพานสูง กทม. 10240	ณัฐสม สงวนวงษ์
Structural Inspector :	SIGNATURE
วิศวกรผู้ตรวจสอบโครงสร้าง	
โกมล จุฑาภัทร วย 964 ที่อยู่ 24/18 ซ.นวมินทร์ 129 ถ. นวมินทร์ แขวง นวลจันทร์ เขต บึงกุ่ม กทม. 10230	
Electrical Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบไฟฟ้ากำลัง	
นายสุภัทร บูรณวิทย์ วฟก.1265 ที่อยู่ 21 ซอยทานสัมฤทธิ์ 13 ตำบลท่าทราย อ.เมืองนนทบุรี จ.นนทบุรี 11000	สุภัทร บูรณวิทย์
Mechanical Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบเครื่องกลและปรับอากาศ	
นายประสิทธิ์ เกี้ยวสุนทร วก.1221 ที่อยู่ 44/372 ซอยบางกระดี่ 35/1 แขวงแสมดำ เขตบางขุนเทียน กทม. 10150	ประสิทธิ์
Sanitary Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบสุขาภิบาล และดับเพลิง	
นายทศวรรษ สนั่นฤทธิ์ วส. 215 ที่อยู่ บ้านเลขที่ 99/107 หมู่ที่ 3 ต.ศีรษะจรเข้น้อย อ.บางเสาธง จ.สมุทรปราการ 10540	ทศวรรษ

ISSUE/REVISION

REV.	DESCRIPTION	DATE
A	90% DEVELOPED	09/05/2026

PROJECT NAME :

GEDC 01

LOCATION:
Nikhom Phattana district, Rayong ,industrial estate,CPGC

BUILDING :
MAIN BUILDING

90% DEVELOPED

TITLE :

ROOM DETAIL-3F- CUSTOMERERAD ROOM,SPARE ROOM01

JOB NO.		SCALE	1 : 50
DRAWN	ZYY	REF.	
CHECKED	LJC	DWG. NO.	MPK01A-90-A-RD-309
APPROVED	LXD		
DATE	2026.05.09		

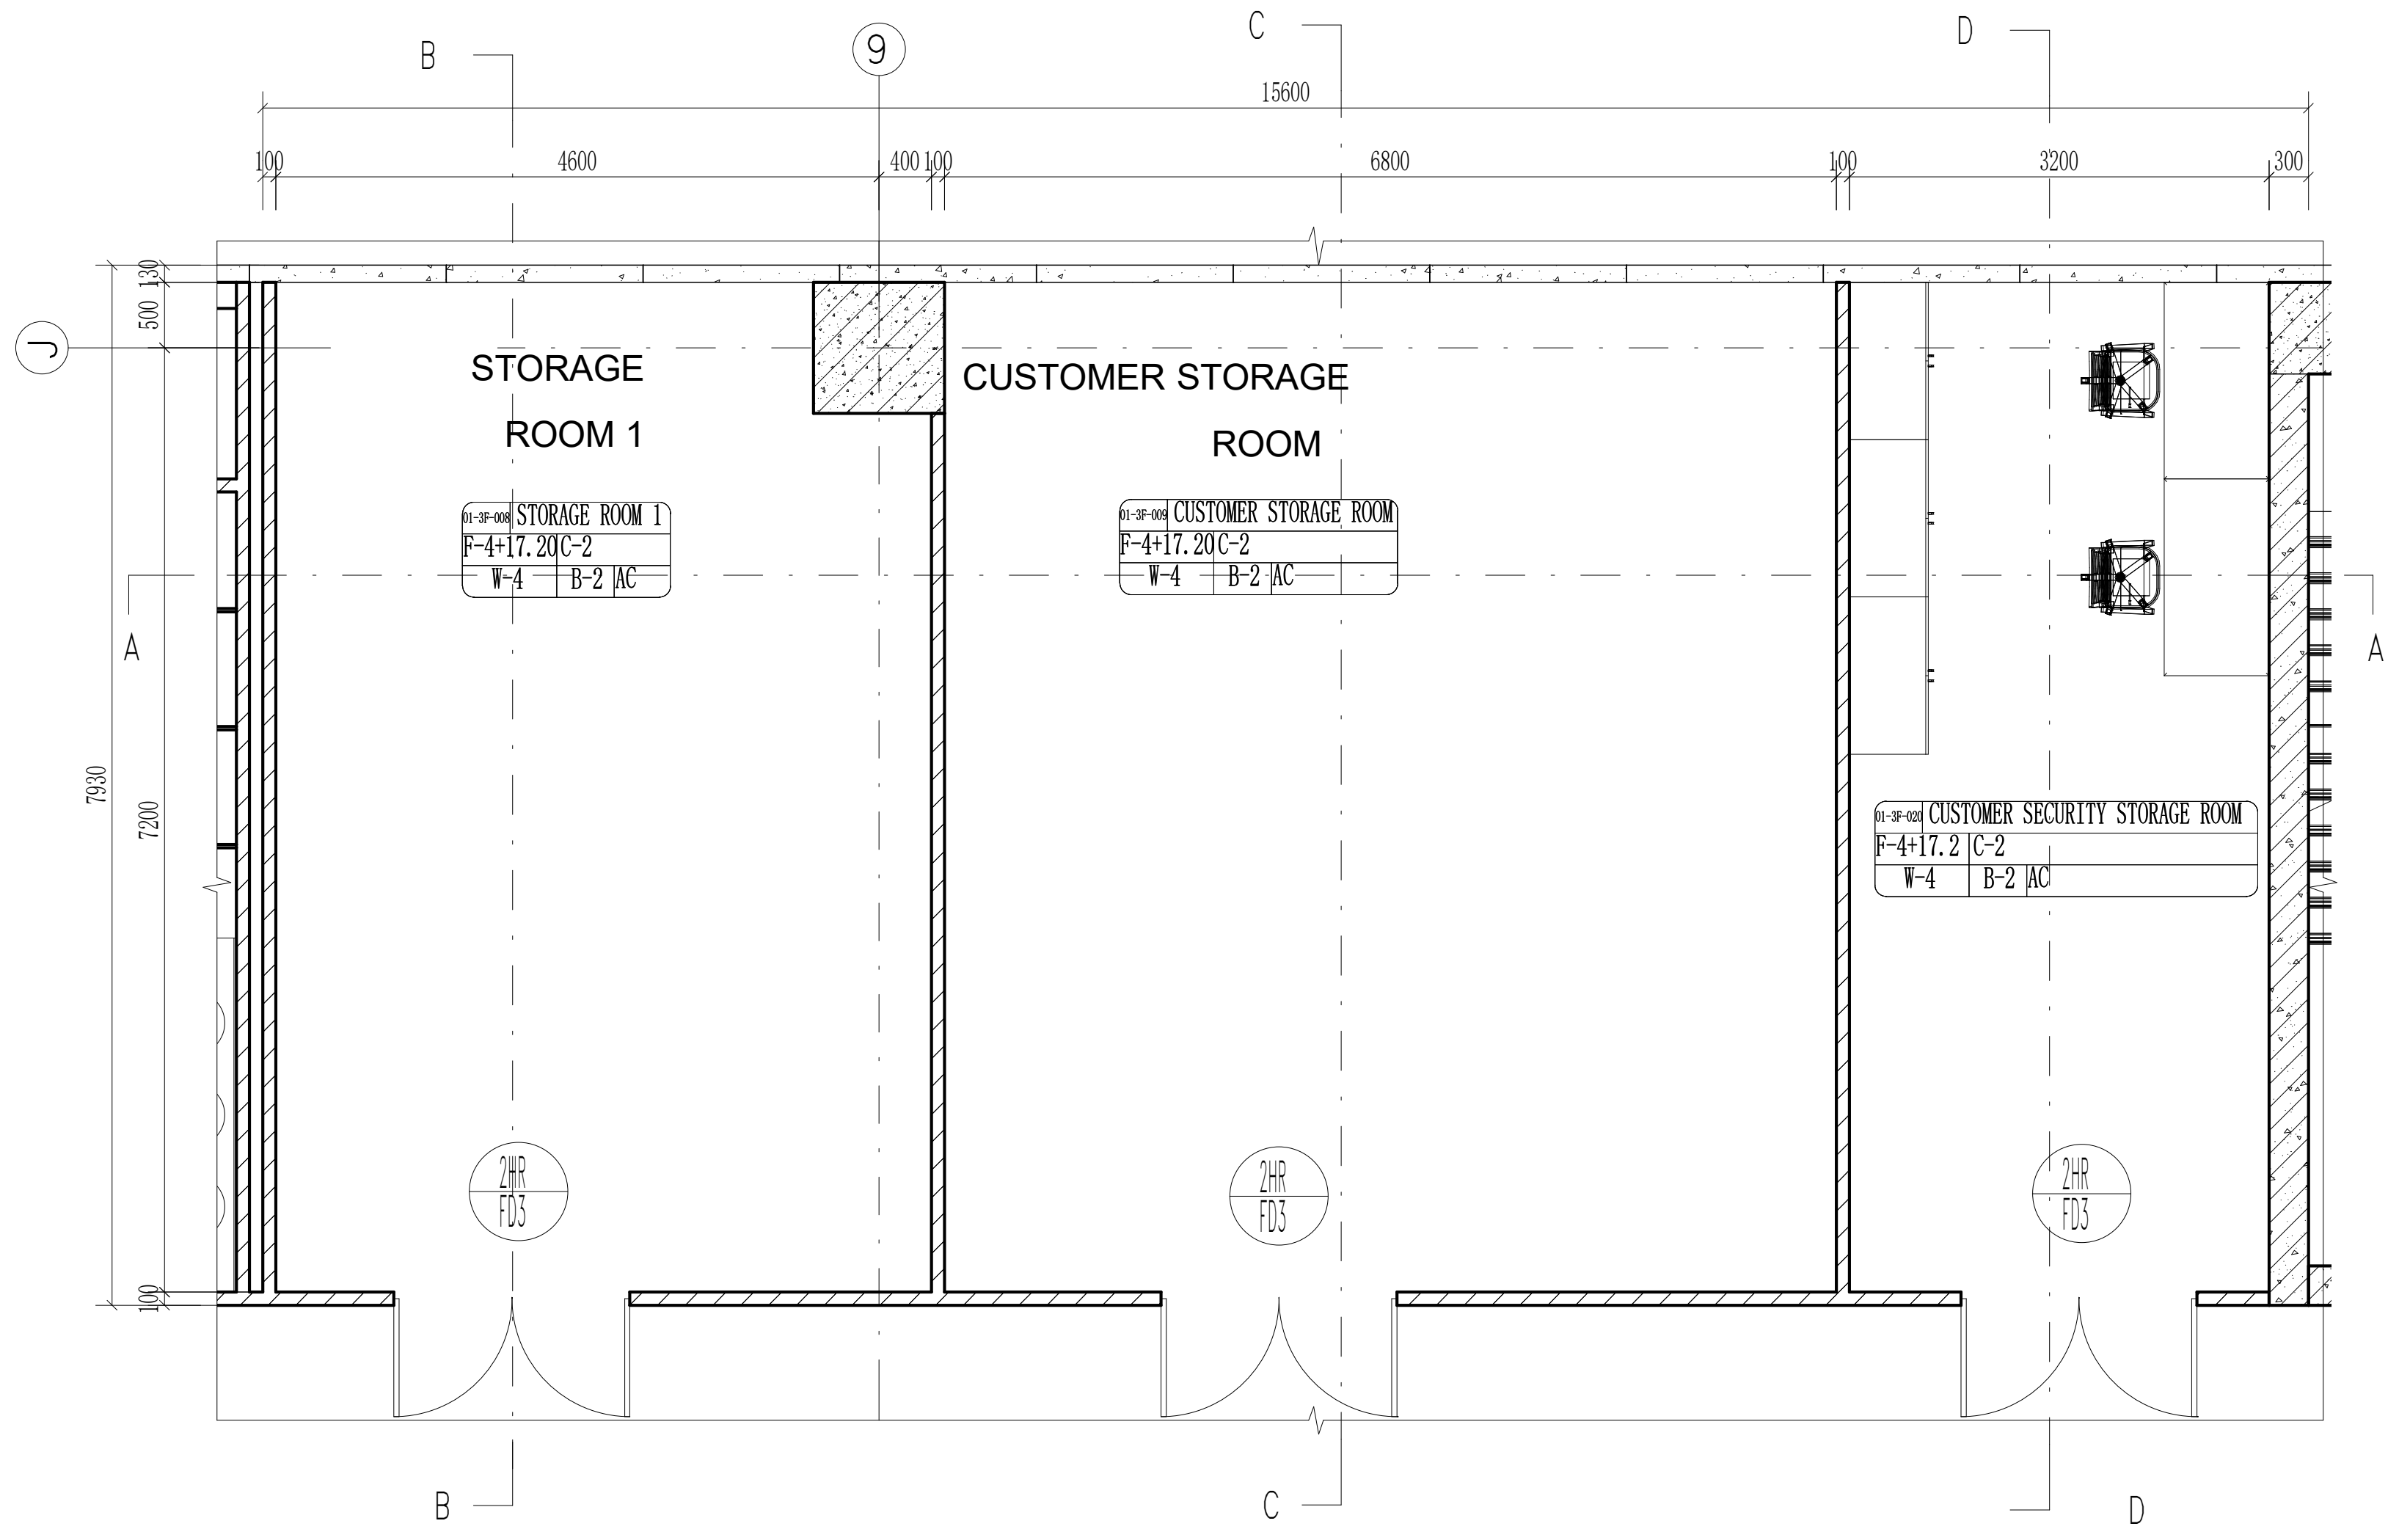
B
9
C
D
15600
100
4600
400
100
6800
100
3200
300
J
500
130
7930
7200
100
A
A
STORAGE
ROOM 1
CUSTOMER STORAGE
ROOM
01-3F-008 STORAGE ROOM 1
F-4+17.20 C-2
W-4 B-2 AC
01-3F-009 CUSTOMER STORAGE ROOM
F-4+17.20 C-2
W-4 B-2 AC
01-3F-020 CUSTOMER SECURITY STORAGE ROOM
F-4+17.2 C-2
W-4 B-2 AC
2HR FD3
2HR FD3
2HR FD3
B
C
D

CUSTOMER SECURITY STORAGE ROOM、CUSTOMER STORAGE ROOM、CUSTOMER SOC

3RD FLOOR PLAN

Scale 1:50

THE "SFL" MARKED IN THE DRAWING REFERS TO THE STRUCTURAL FLOOR LEVEL, WHILE THE FINISHED FLOOR LEVEL (FFL) IS DETERMINED BASED ON FLOOR FINISHES.

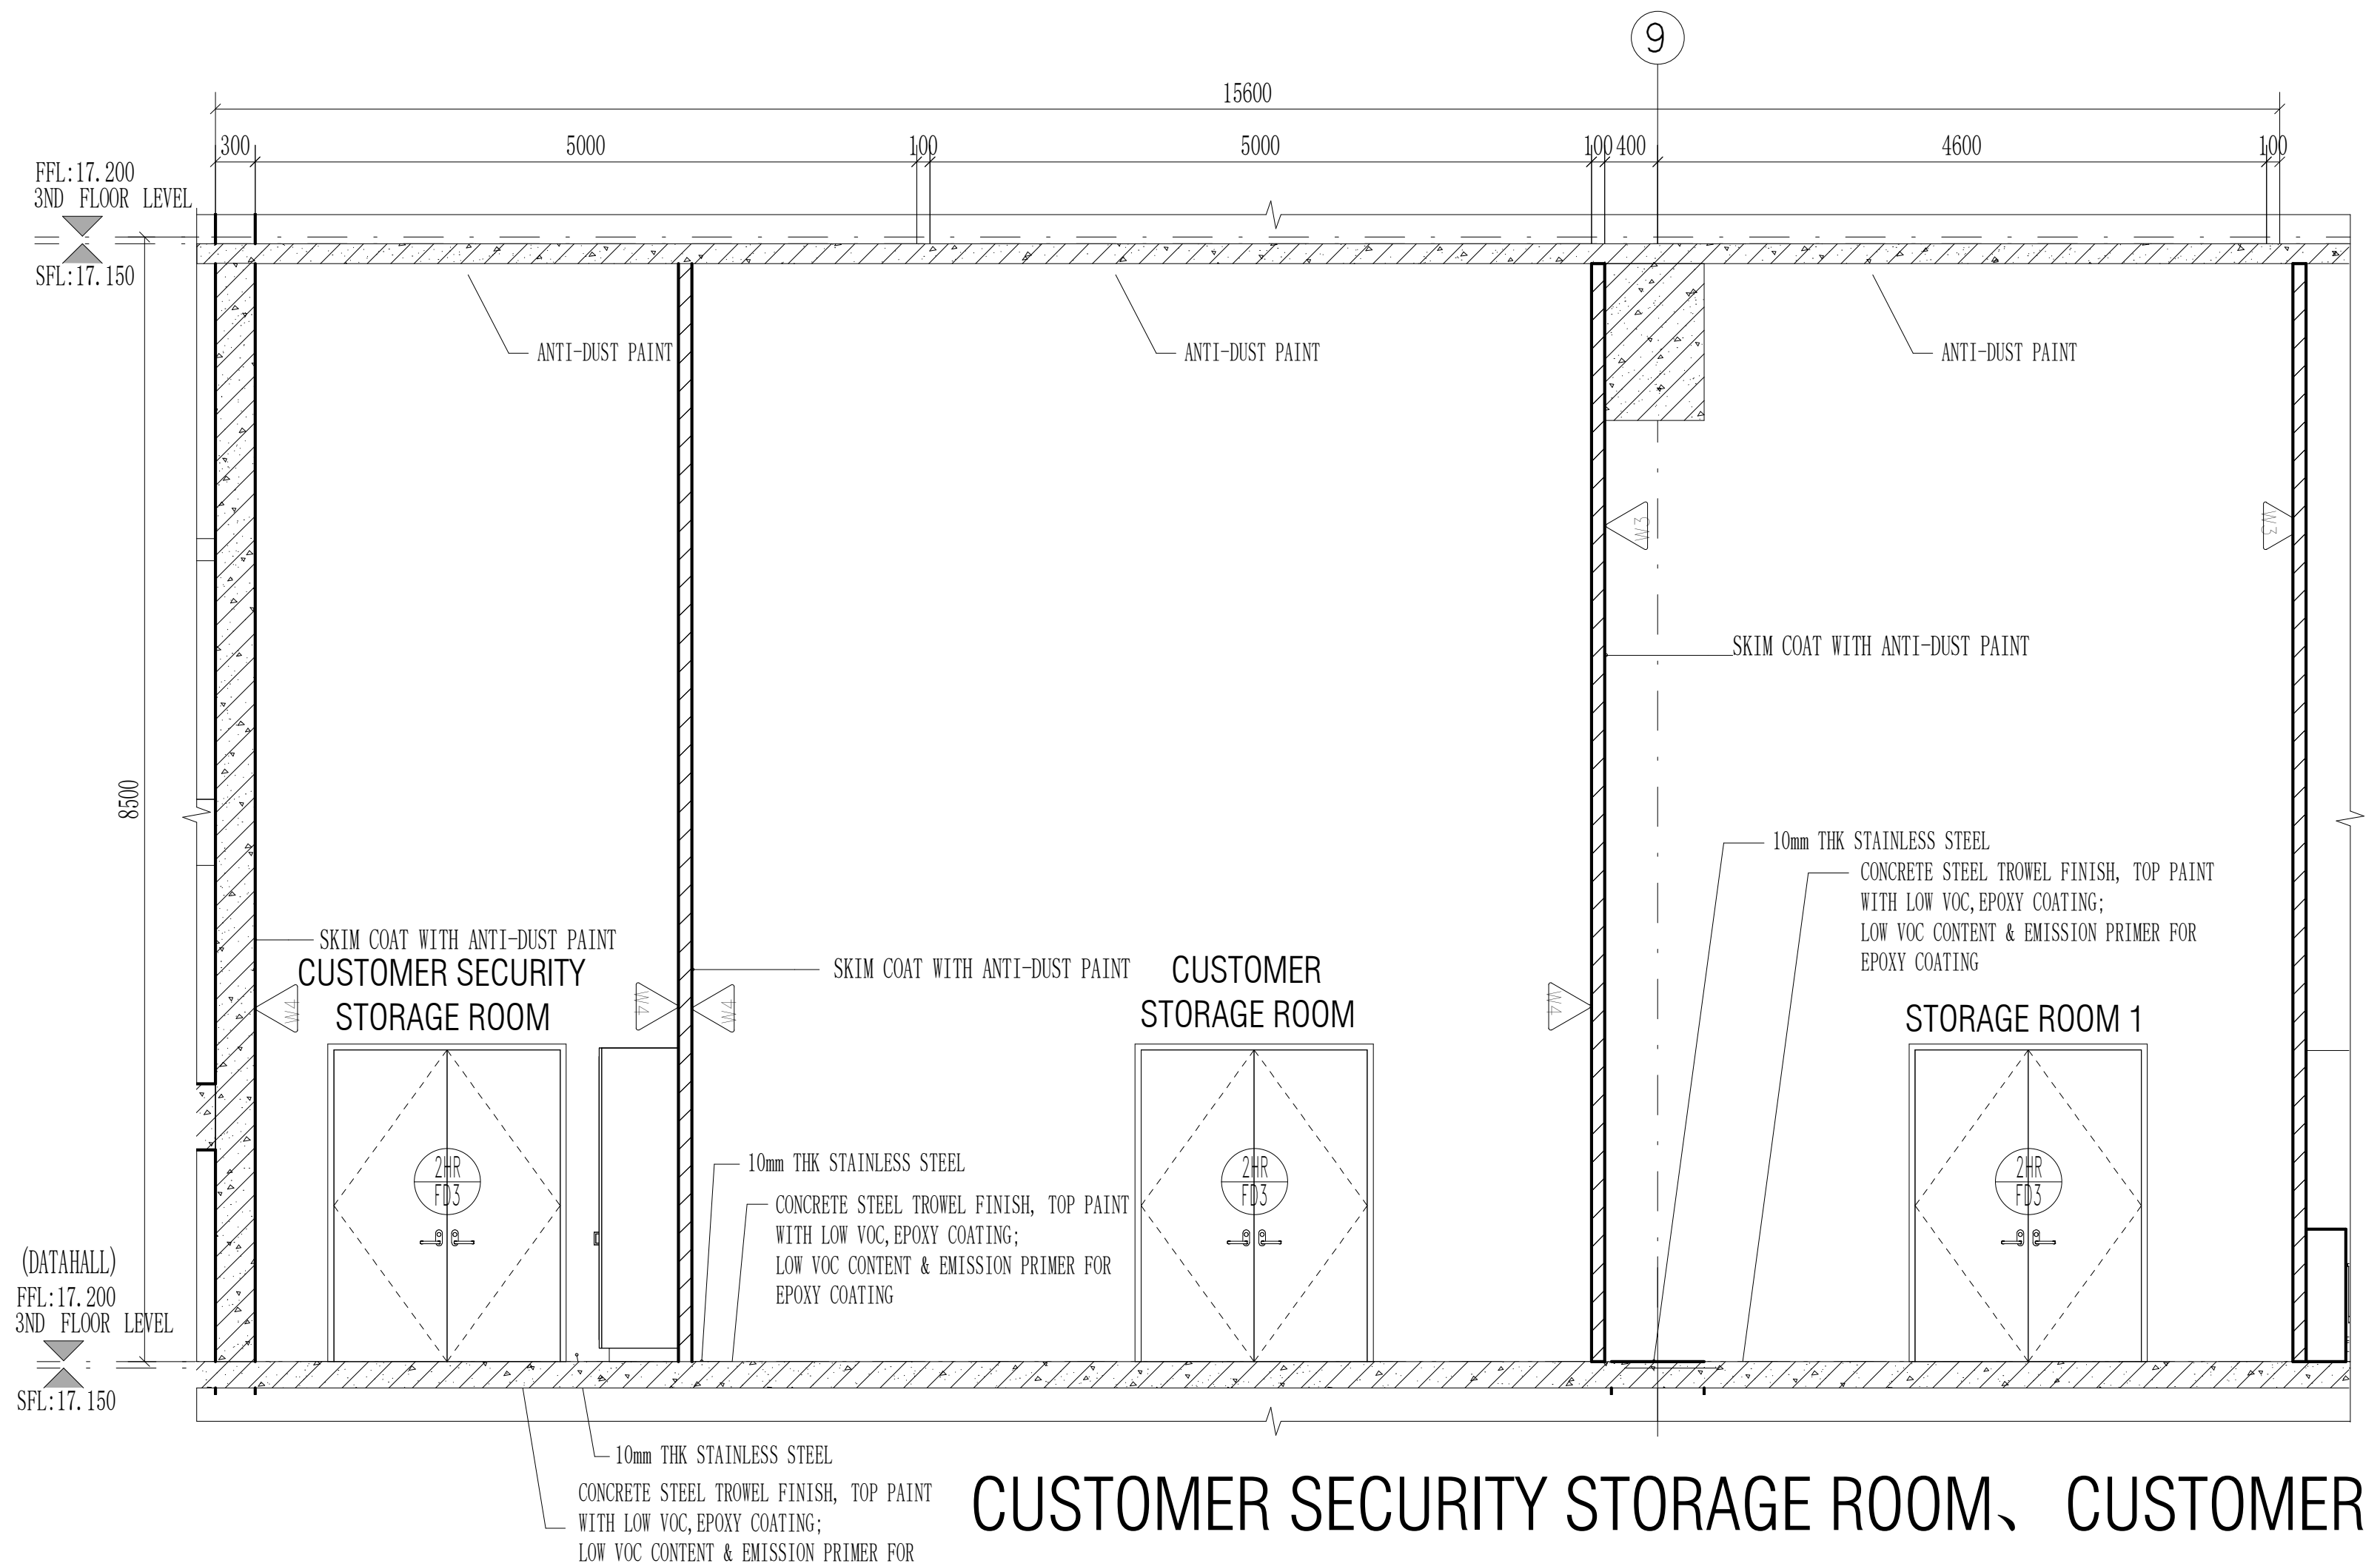
9
15600
300
5000
100
5000
100
400
4600
100
FFL:17.200
3ND FLOOR LEVEL
SFL:17.150
8500
ANTI-DUST PAINT
ANTI-DUST PAINT
ANTI-DUST PAINT
SKIM COAT WITH ANTI-DUST PAINT
SKIM COAT WITH ANTI-DUST PAINT
SKIM COAT WITH ANTI-DUST PAINT
W3
W3
W4
W4
W4
W4
10mm THK STAINLESS STEEL
CONCRETE STEEL TROWEL FINISH, TOP PAINT WITH LOW VOC,EPOXY COATING; LOW VOC CONTENT & EMISSION PRIMER FOR EPOXY COATING
10mm THK STAINLESS STEEL
CONCRETE STEEL TROWEL FINISH, TOP PAINT WITH LOW VOC,EPOXY COATING; LOW VOC CONTENT & EMISSION PRIMER FOR EPOXY COATING
CUSTOMER SECURITY
STORAGE ROOM
CUSTOMER
STORAGE ROOM
STORAGE ROOM 1
2HR FD3
2HR FD3
2HR FD3
(DATAHALL)
FFL:17.200
3ND FLOOR LEVEL
SFL:17.150
10mm THK STAINLESS STEEL
CONCRETE STEEL TROWEL FINISH, TOP PAINT WITH LOW VOC,EPOXY COATING; LOW VOC CONTENT & EMISSION PRIMER FOR EPOXY COATING

CUSTOMER SECURITY STORAGE ROOM、CUSTOMER STORAGE ROOM、STORAGE ROOM 1 SECTION A-A

Scale 1:50

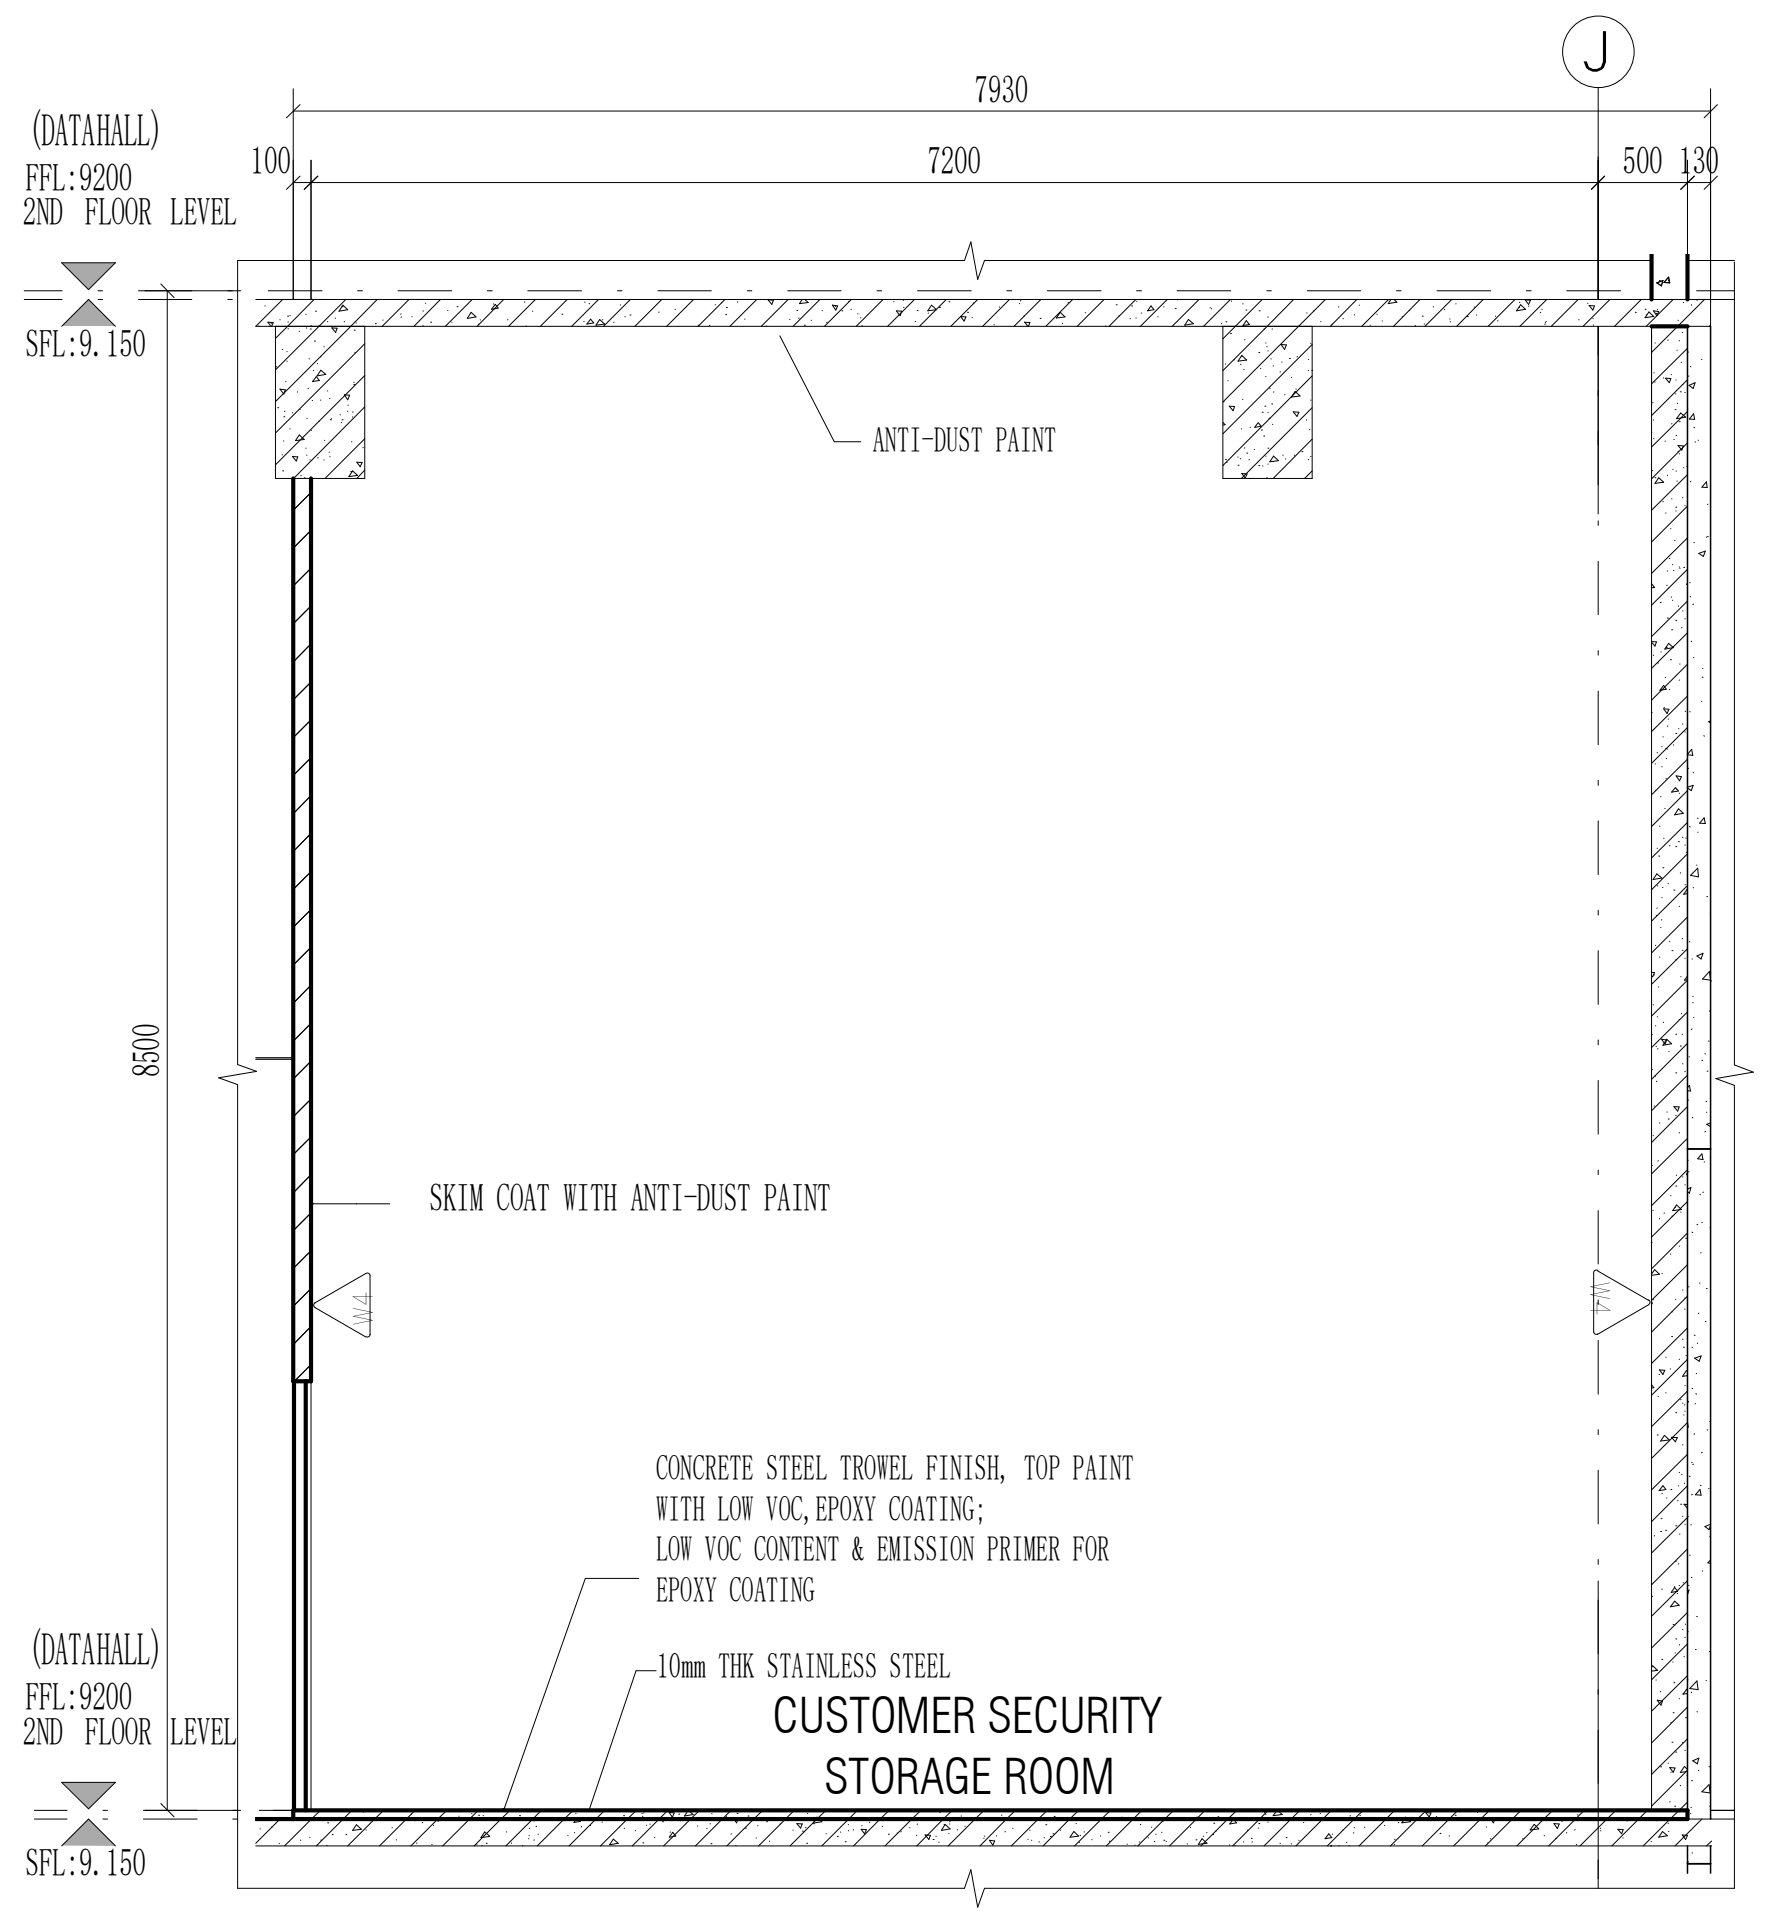
J
7930
100
7200
500
130
(DATAHALL)
FFL:9200
2ND FLOOR LEVEL
SFL:9.150
8500
ANTI-DUST PAINT
SKIM COAT WITH ANTI-DUST PAINT
W4
W4
CONCRETE STEEL TROWEL FINISH, TOP PAINT WITH LOW VOC,EPOXY COATING; LOW VOC CONTENT & EMISSION PRIMER FOR EPOXY COATING
10mm THK STAINLESS STEEL
CUSTOMER SECURITY
STORAGE ROOM
(DATAHALL)
FFL:9200
2ND FLOOR LEVEL
SFL:9.150

CUSTOMER SECURITY STORAGE ROOM SECTION B-B

Scale 1:50

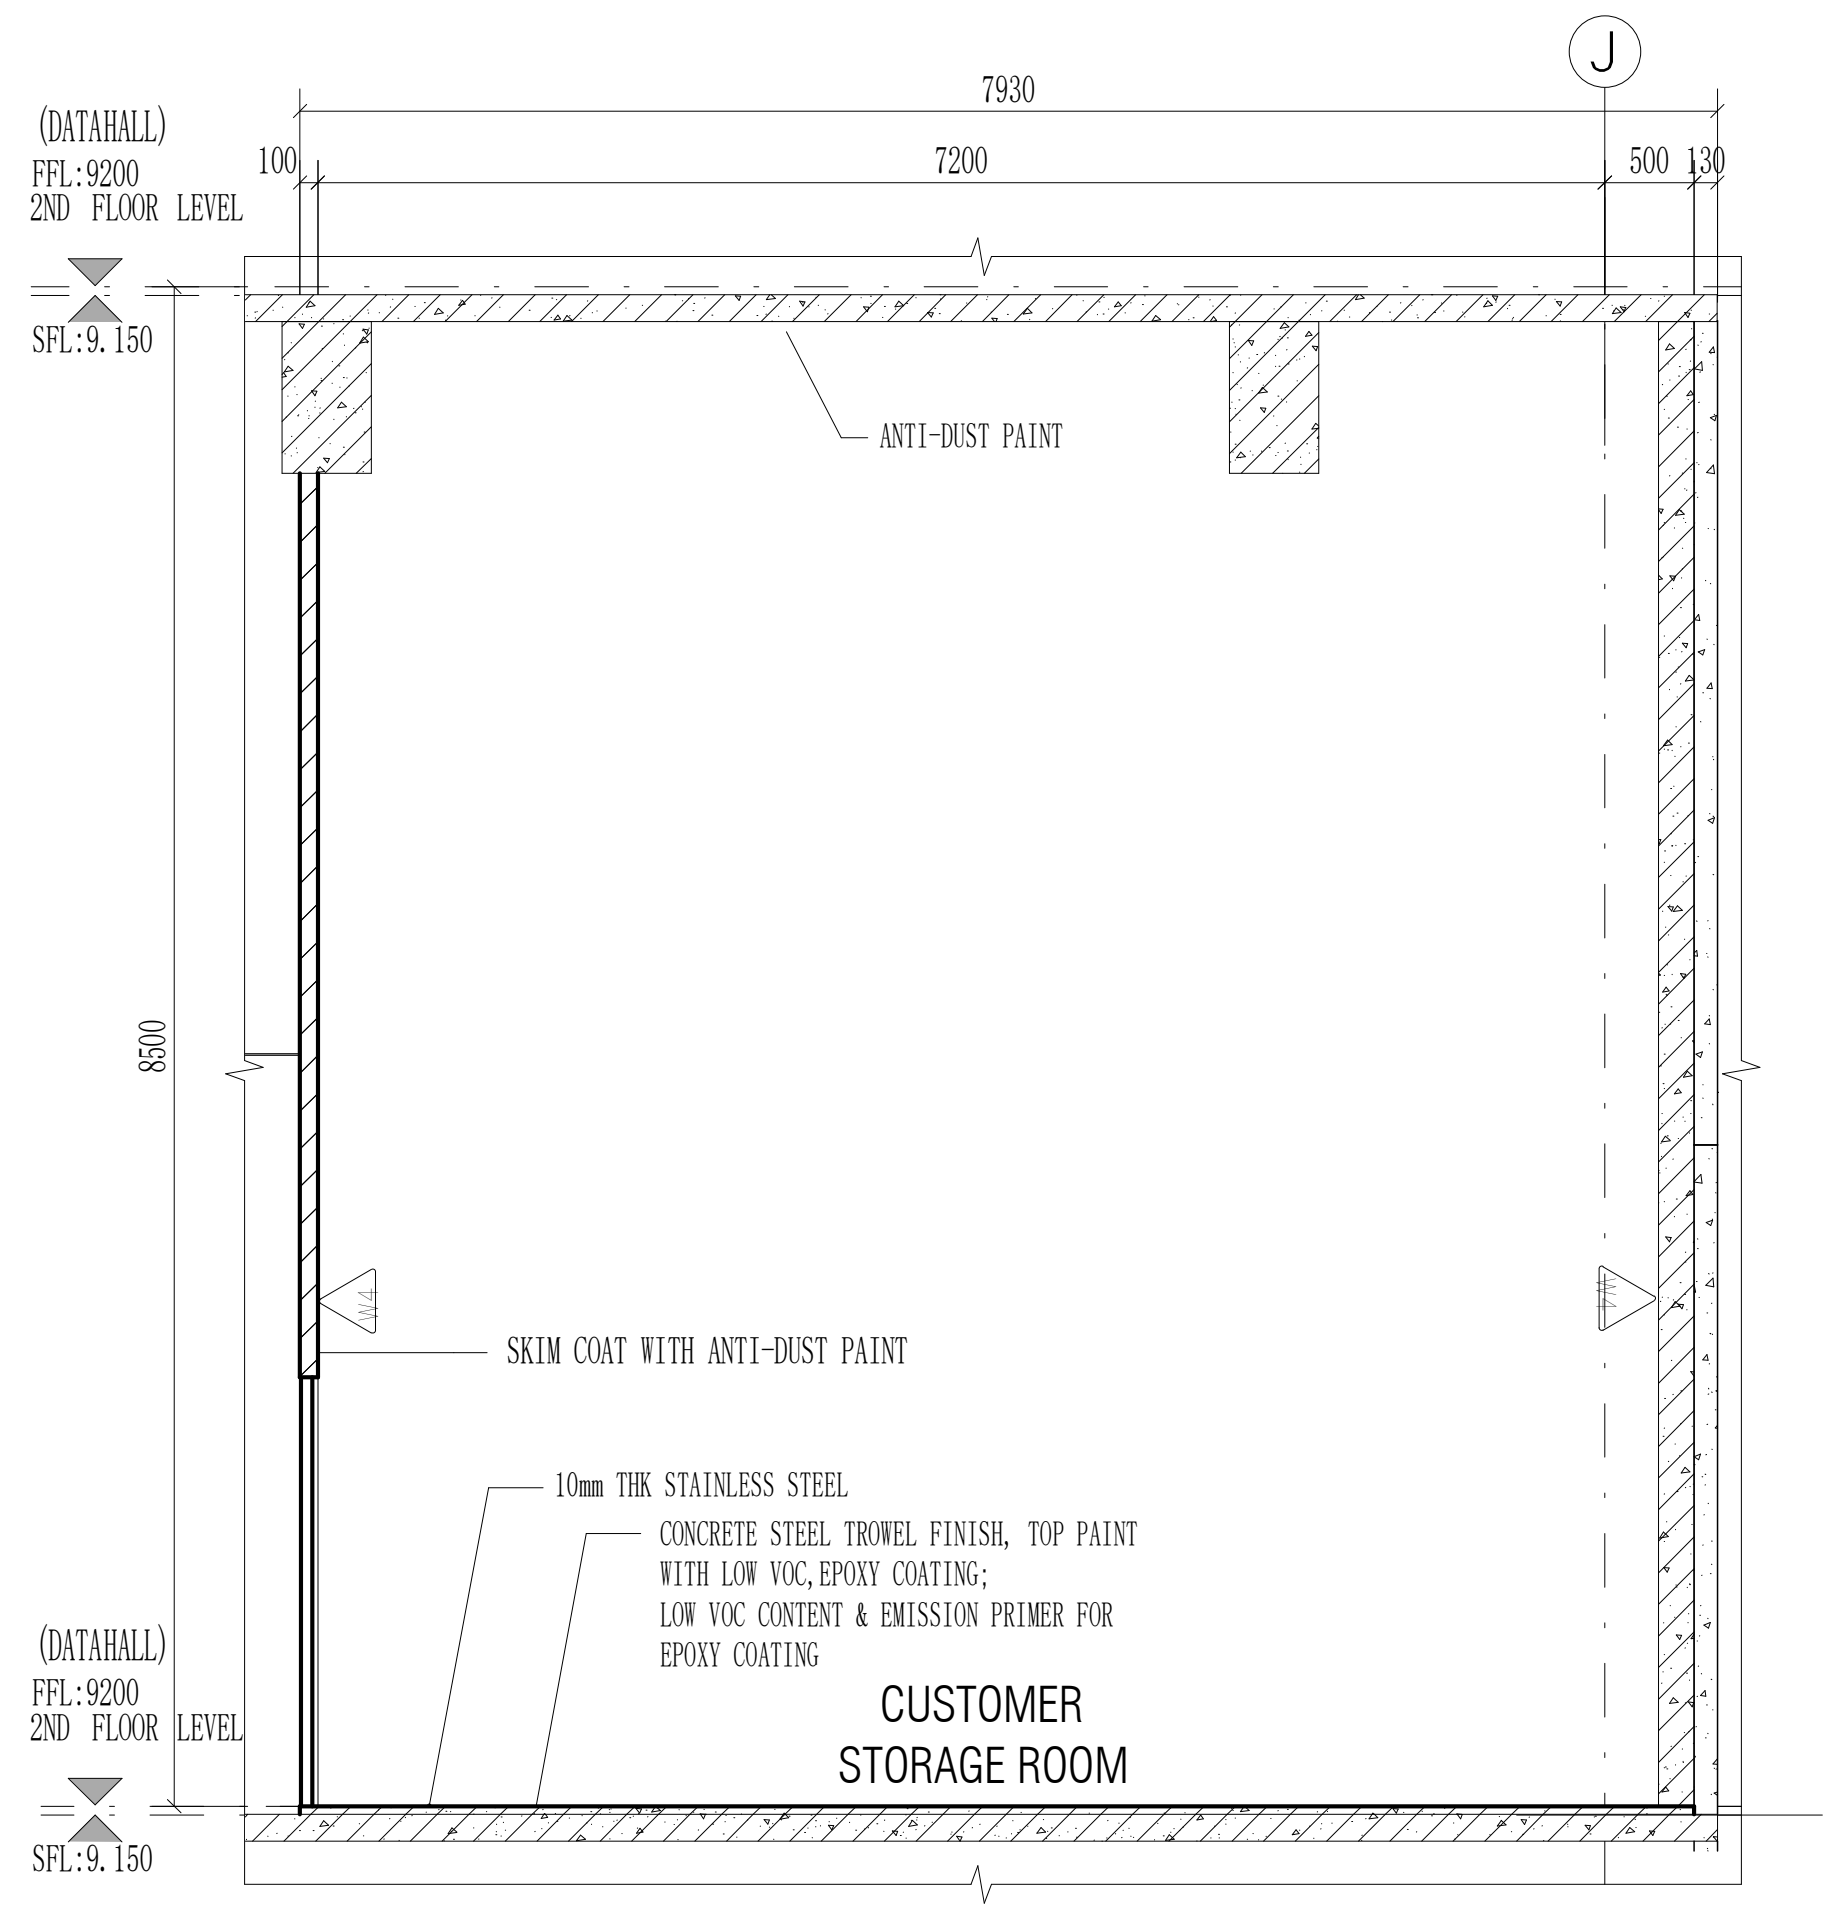
J
7930
100
7200
500
130
(DATAHALL)
FFL:9200
2ND FLOOR LEVEL
SFL:9.150
8500
ANTI-DUST PAINT
SKIM COAT WITH ANTI-DUST PAINT
W4
W4
10mm THK STAINLESS STEEL
CONCRETE STEEL TROWEL FINISH, TOP PAINT WITH LOW VOC,EPOXY COATING; LOW VOC CONTENT & EMISSION PRIMER FOR EPOXY COATING
CUSTOMER
STORAGE ROOM
(DATAHALL)
FFL:9200
2ND FLOOR LEVEL
SFL:9.150

CUSTOMER STORAGE ROOM SECTION C-C

Scale 1:50

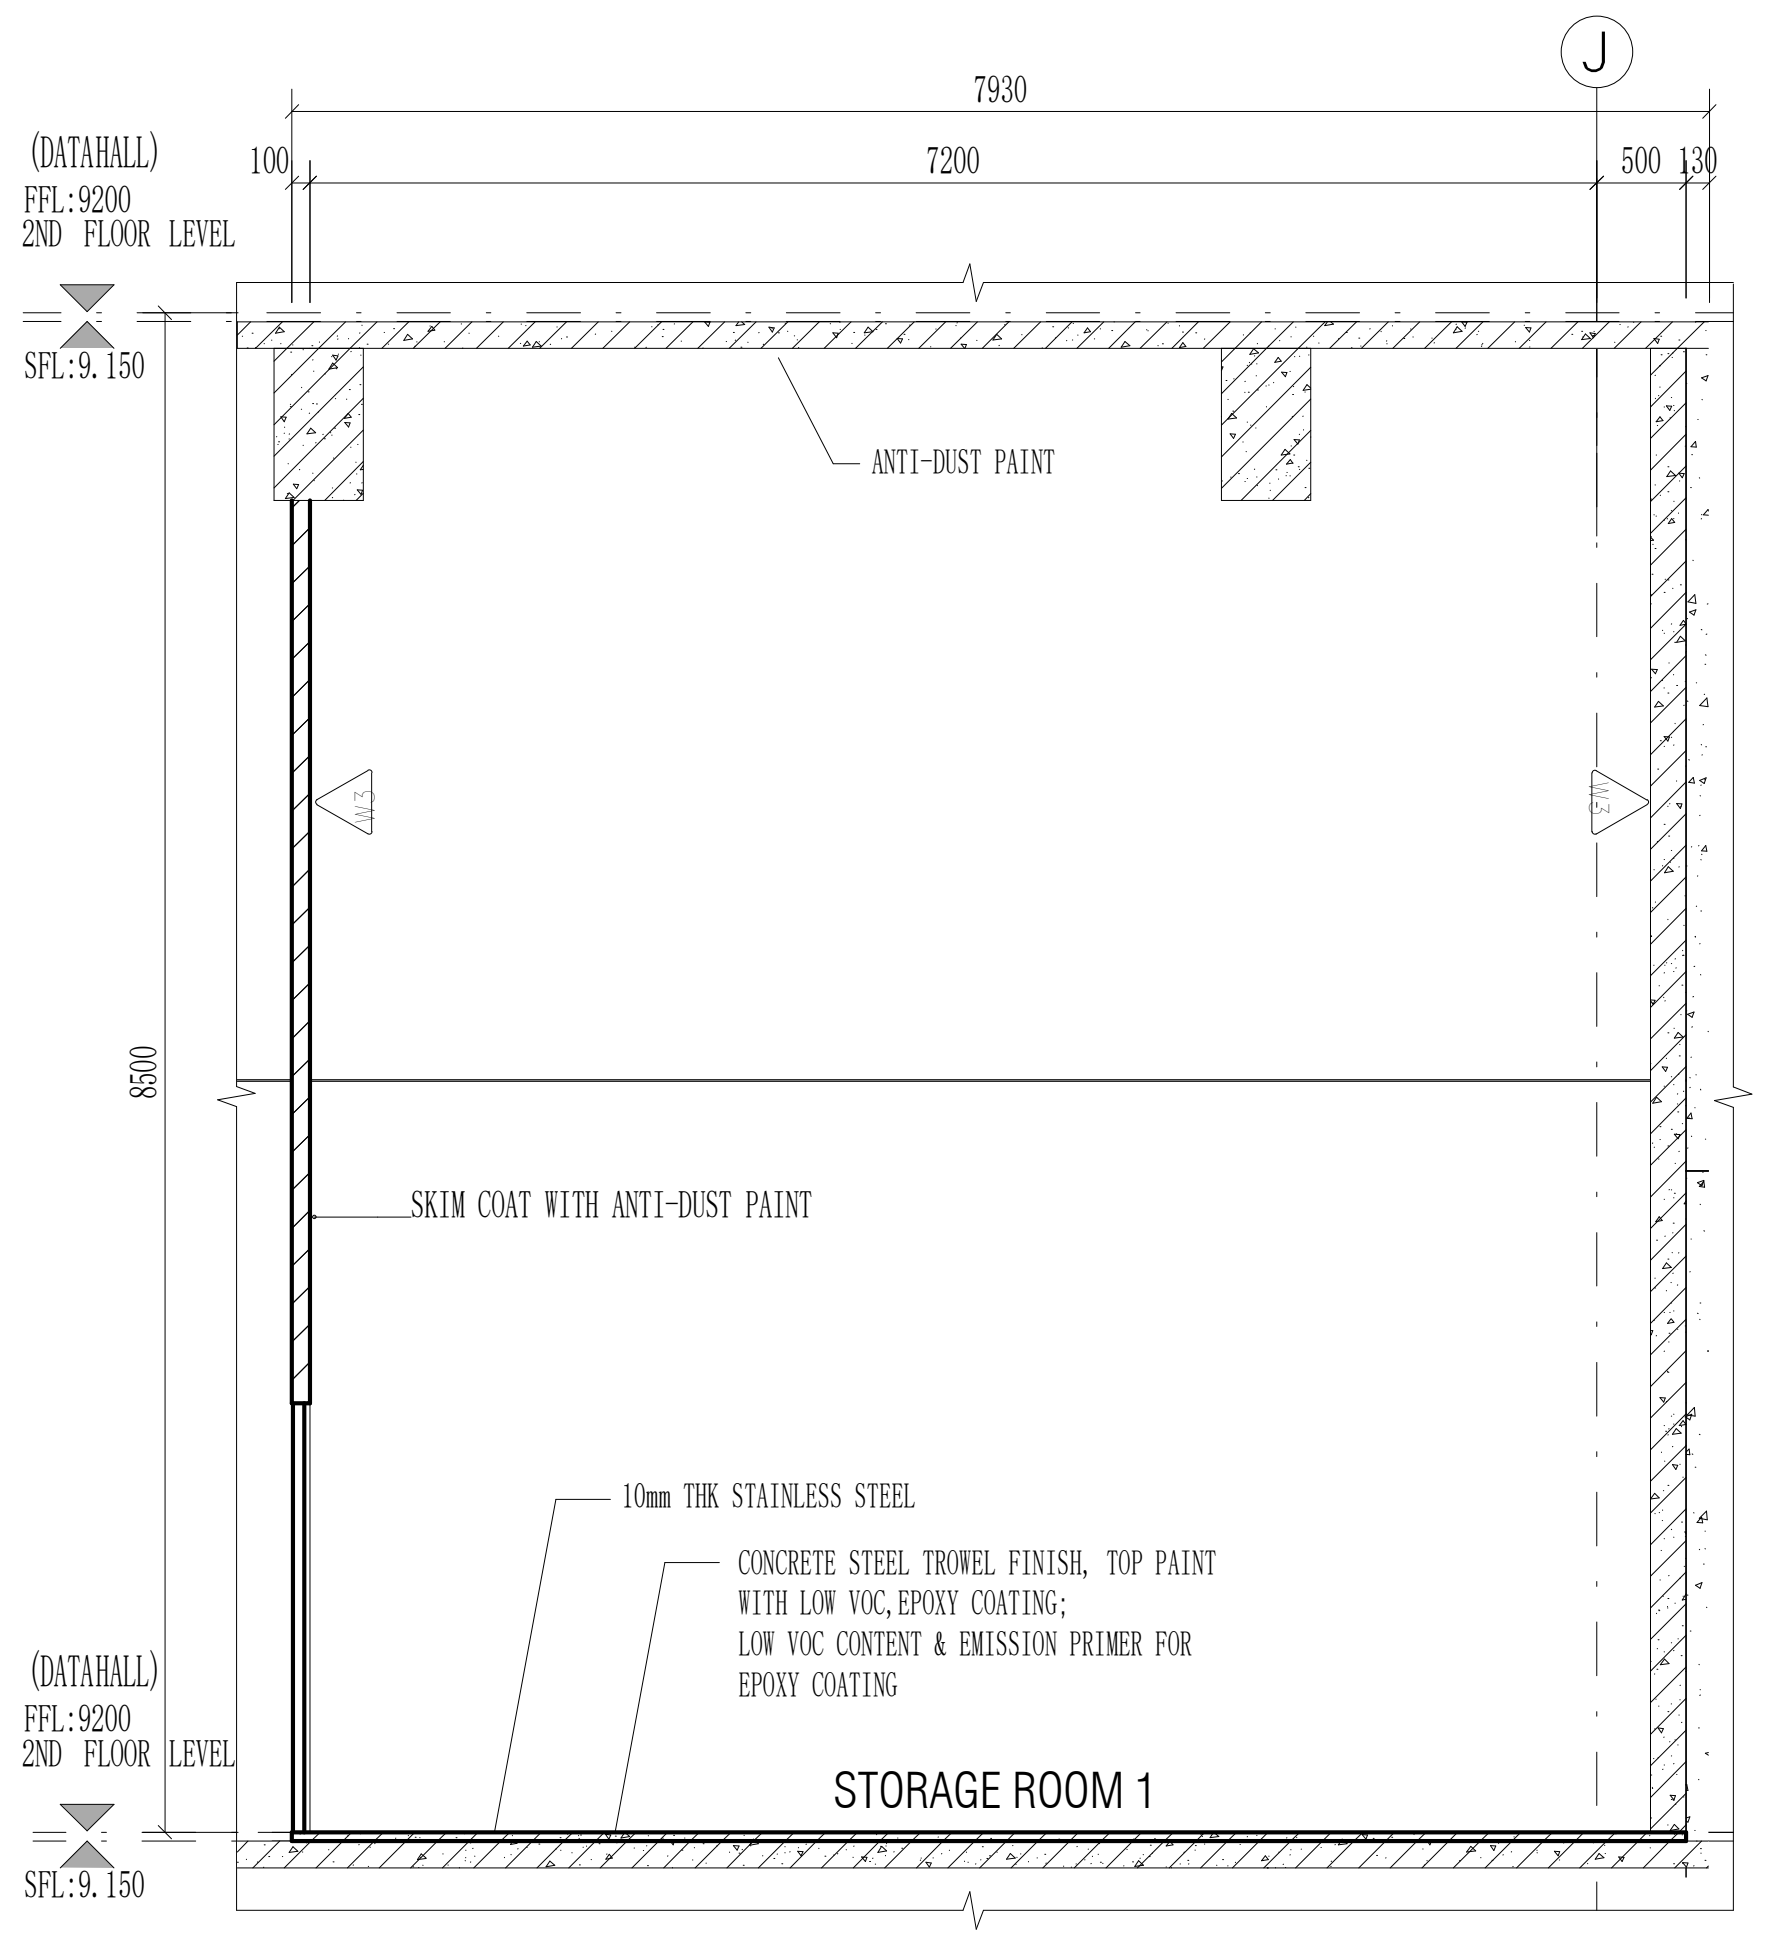
J
7930
100
7200
500
130
(DATAHALL)
FFL:9200
2ND FLOOR LEVEL
SFL:9.150
8500
ANTI-DUST PAINT
W3
W3
SKIM COAT WITH ANTI-DUST PAINT
10mm THK STAINLESS STEEL
CONCRETE STEEL TROWEL FINISH, TOP PAINT WITH LOW VOC,EPOXY COATING; LOW VOC CONTENT & EMISSION PRIMER FOR EPOXY COATING
STORAGE ROOM 1
(DATAHALL)
FFL:9200
2ND FLOOR LEVEL
SFL:9.150

STORAGE ROOM 1 SECTION D-D

Scale 1:50

CLIENT :

GULF EDGE DC 01

87 Wireless Road, M Thai Tower 11th. Floor, All Seasons Place, Lumpini, Pathumwan, Bangkok 10330, Thailand

CONTRACTOR :

华西发展(泰国)有限公司
บริษัท หัวซือ ดีเวลลอปเม้นต์ (ประเทศไทย) จำกัด
HUASHI DEVELOPMENT CO.,LTD
No. 202, Room No. 1403, 14/F, Le Concorde Building,
Ratchadapisek Road, Huaykhwang Sub-District,
Huaykhwang District, Bangkok Metropolitan 10310.

CONSULTANT :

ARbay
บริษัท เอ อาร์ เบย์ จำกัด
ARbay Company Limited
31 st Floor Bangkok Insurance Building
25 South Sathorn road Thungmahamek
Sathorn Bangkok 10120 THAILAND
T +66 (0) 2286 8199
F +66 (0) 2286 2863
info@arbay.co.th

CONSULTANT :

Qbic Engineers & Architects Co.,Ltd.
8 Soi KALONG 4 SANAMBINNAM ROAD,
THASAI SUB-DISTRICT, MUANG NONTHABURI DISTRICT
, NONTHABURI.
Tel 662-950-4374
Fax 662-580-3231
E-Mail : qbic@qbic.co.th, www.qbic.co.th
QBIC ENGINEERS AND ARCHITECTS CO.,LTD.

CONSULTANT :

MITR
MITR TECHNICAL CONSULTANT CO.,LTD.
1168/8 12th FLOOR, LUMPINI TOWER BUILDING,
RAMA IV RD., THUNGMAHAMEK, SATHORN, BANGKOK 10120, THAILAND
TEL : 0-2679-9079-84
FAX : 0-2679-9085 E-mail: mitr_dd@mitr.com

Architect :	SIGNATURE
ประกิต พนานุรัตน์ วสถ. 580 ที่อยู่ 251/1 ถ.จารุเมือง แขวงรองเมือง เขตปทุมวัน กรุงเทพมหานคร โทรศัพท์ 02-286-8199	
Structural Engineer :	SIGNATURE
วิศวกรผู้ออกแบบโครงสร้าง	
ณัฐสม สงวนวงษ์ วย 1423 ที่อยู่ 2/1 ซ.รามคำแหง 150 ถ.รามคำแหง แขวง สะพานสูง เขต สะพานสูง กทม. 10240	
Structural Inspector :	SIGNATURE
วิศวกรผู้ตรวจสอบโครงสร้าง	
โกมล จุฑาภัทร วย 964 ที่อยู่ 24/18 ซ.นวมินทร์ 129 ถ. นวมินทร์ แขวง นวลจันทร์ เขต บึงกุ่ม กทม. 10230	
Electrical Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบไฟฟ้ากำลัง	
นายสุภัทร บูรณวิทย์ วฟก.1265 ที่อยู่ 21 ซอยทานสัมฤทธิ์ 13 ตำบลท่าทราย อ.เมืองนนทบุรี จ.นนทบุรี 11000	
Mechanical Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบเครื่องกลและปรับอากาศ	
นายประสิทธิ์ เกี้ยวสุนทร วก.1221 ที่อยู่ 44/372 ซอยบางกระดี่ 35/1 แขวงแสมดำ เขตบางขุนเทียน กทม. 10150	ประสิทธิ์
Sanitary Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบสุขาภิบาล และดับเพลิง	
นายทศวรรษ สนั่นฤทธิ์ วส. 215 ที่อยู่ บ้านเลขที่ 99/107 หมู่ที่ 3 ต.ศีรษะจรเข้น้อย อ.บางเสาธง จ.สมุทรปราการ 10540	ทศวรรษ

ISSUE/REVISION

REV.	DESCRIPTION	DATE
A	90% DEVELOPED	09/05/2026

PROJECT NAME :

GEDC 01

LOCATION:
Nikhom Phattana district, Rayong ,industrial estate,CPGC

BUILDING :
MAIN BUILDING

90% DEVELOPED

TITLE :

ROOM DETAIL-3F-CUSTOMER
SECURITYSTORAGEROOM,
CUSTOMERSTORAGEROOM,
CUSTOMER SOC

JOB NO.	SCALE 1 : 50
DRAWN ZYY	REF.
CHECKED LJC	DWG. NO. MPK01A-90-A-RD-310
APPROVED LXD	
DATE 2026.05.09	

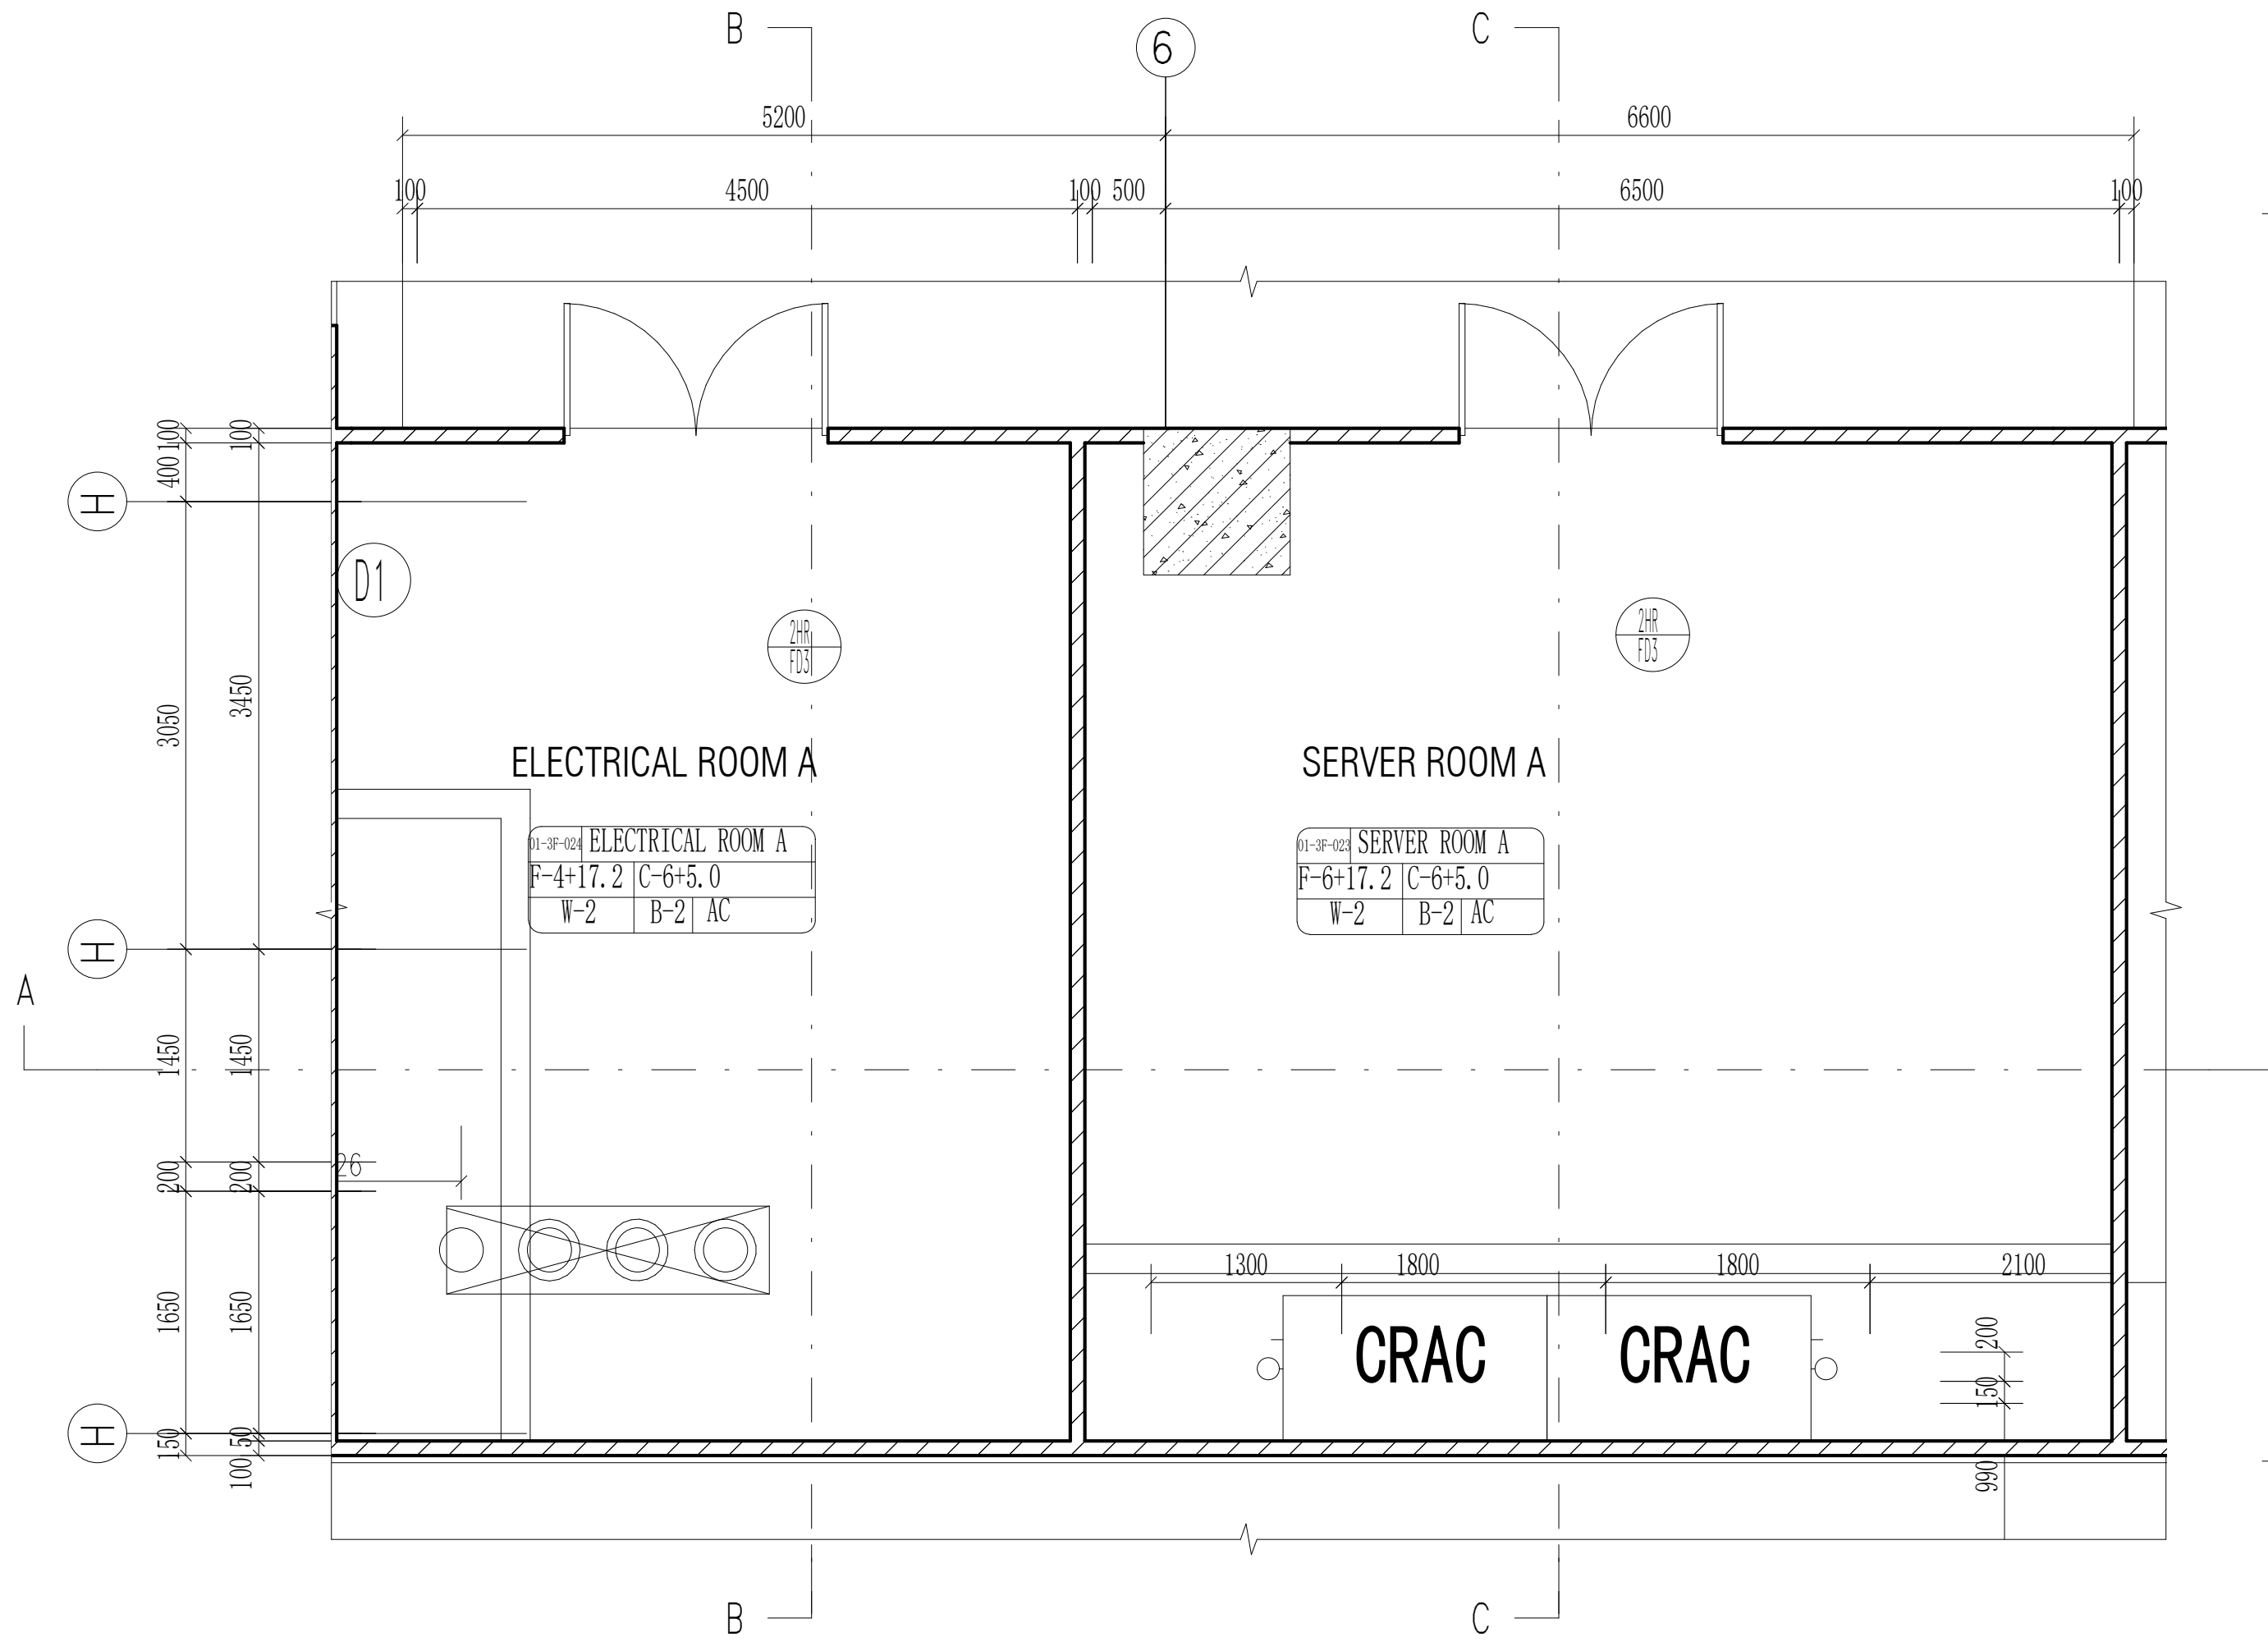
B
6
C
5200
6600
100
4500
100 500
6500
ELECTRICAL ROOM A
01-3F-024 ELECTRICAL ROOM A
F-4+17.2 C-6+5.0
W-2 B-2 AC
SERVER ROOM A
01-3F-023 SERVER ROOM A
F-6+17.2 C-6+5.0
W-2 B-2 AC
D1
2HR FD3
H
A
3050
3450
1450
200
1650
CRAC
CRAC
1300
1800
1800
2100
990

ELECTRICAL ROOM A、SERVER ROOM A PLAN

Scale 1:50

THE "SFL" MARKED IN THE DRAWING REFERS TO THE STRUCTURAL FLOOR LEVEL, WHILE THE FINISHED FLOOR LEVEL (FFL) IS DETERMINED BASED ON FLOOR FINISHES.

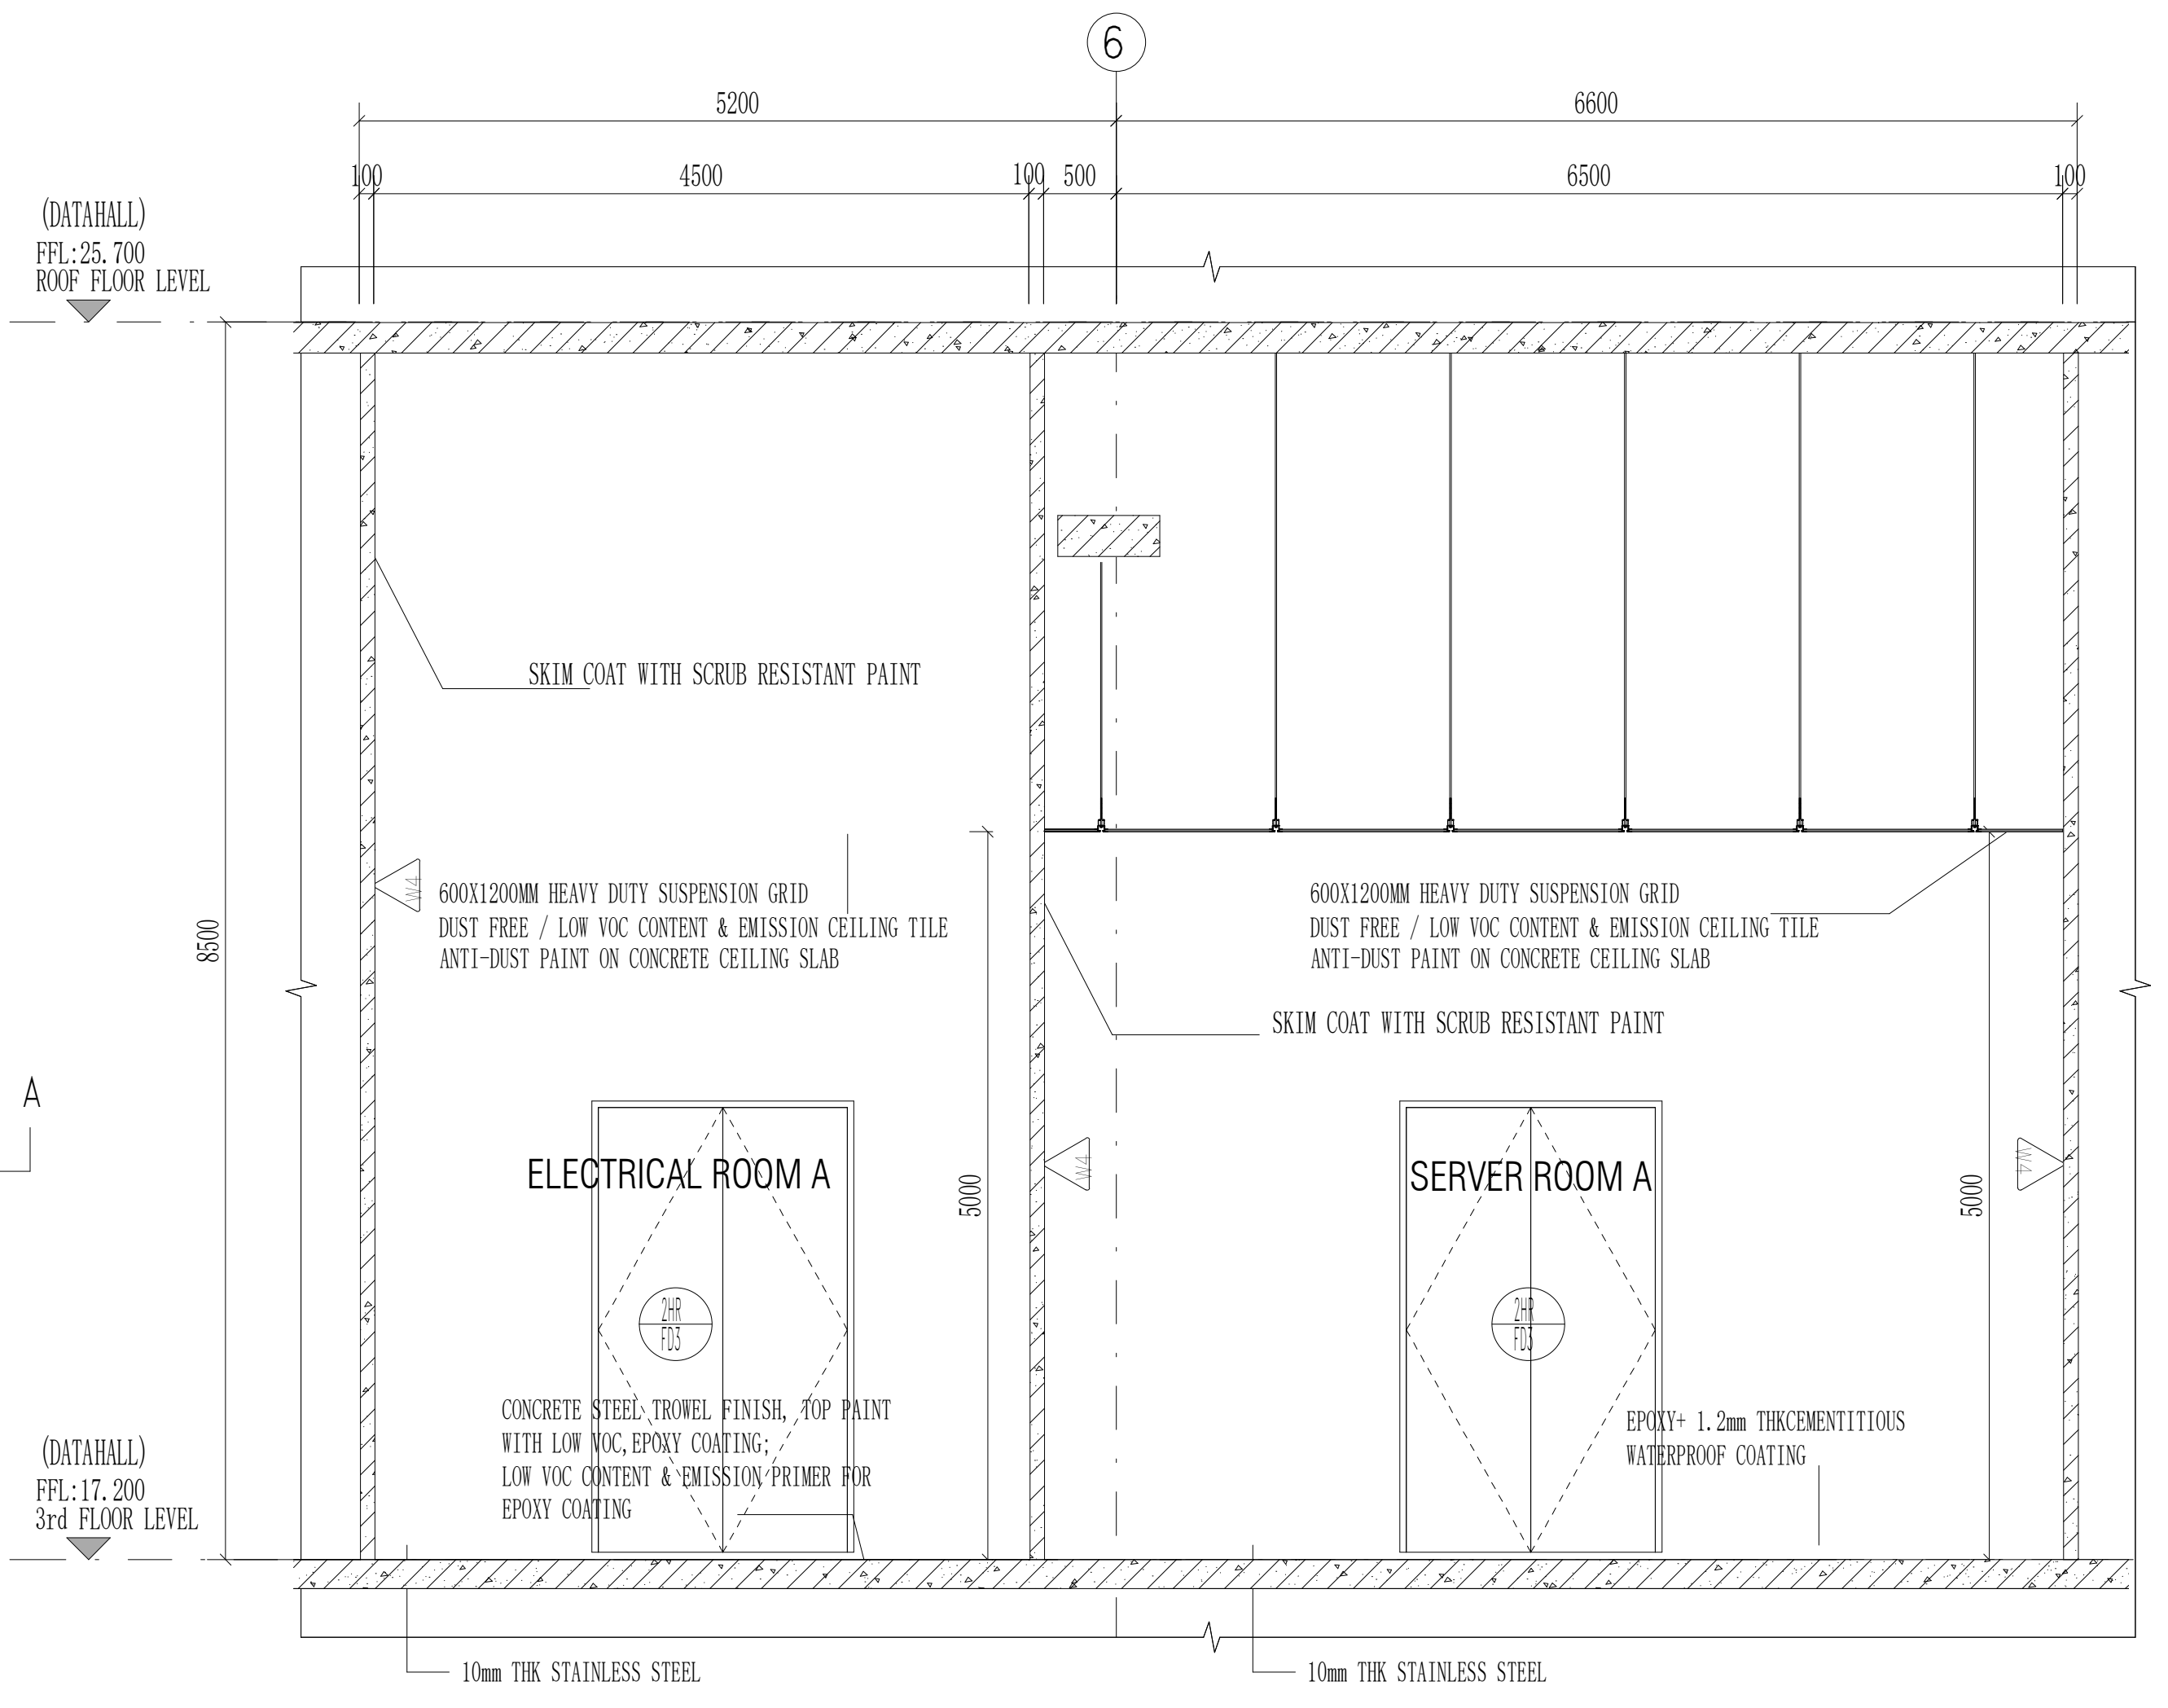
6
5200
6600
100
4500
100 500
6500
(DATAHALL)
FFL:25.700
ROOF FLOOR LEVEL
(DATAHALL)
FFL:17.200
3rd FLOOR LEVEL
8500
5000
SKIM COAT WITH SCRUB RESISTANT PAINT
600X1200MM HEAVY DUTY SUSPENSION GRID
DUST FREE / LOW VOC CONTENT & EMISSION CEILING TILE
ANTI-DUST PAINT ON CONCRETE CEILING SLAB
ELECTRICAL ROOM A
SERVER ROOM A
2HR FD3
W4
CONCRETE STEEL TROWEL FINISH, TOP PAINT WITH LOW VOC,EPOXY COATING;
LOW VOC CONTENT & EMISSION PRIMER FOR EPOXY COATING
EPOXY+ 1.2mm THKCEMENTITIOUS WATERPROOF COATING
10mm THK STAINLESS STEEL
10mm THK STAINLESS STEEL

ELECTRICAL ROOM A、SERVER ROOM A SECTION A-A

Scale 1:50

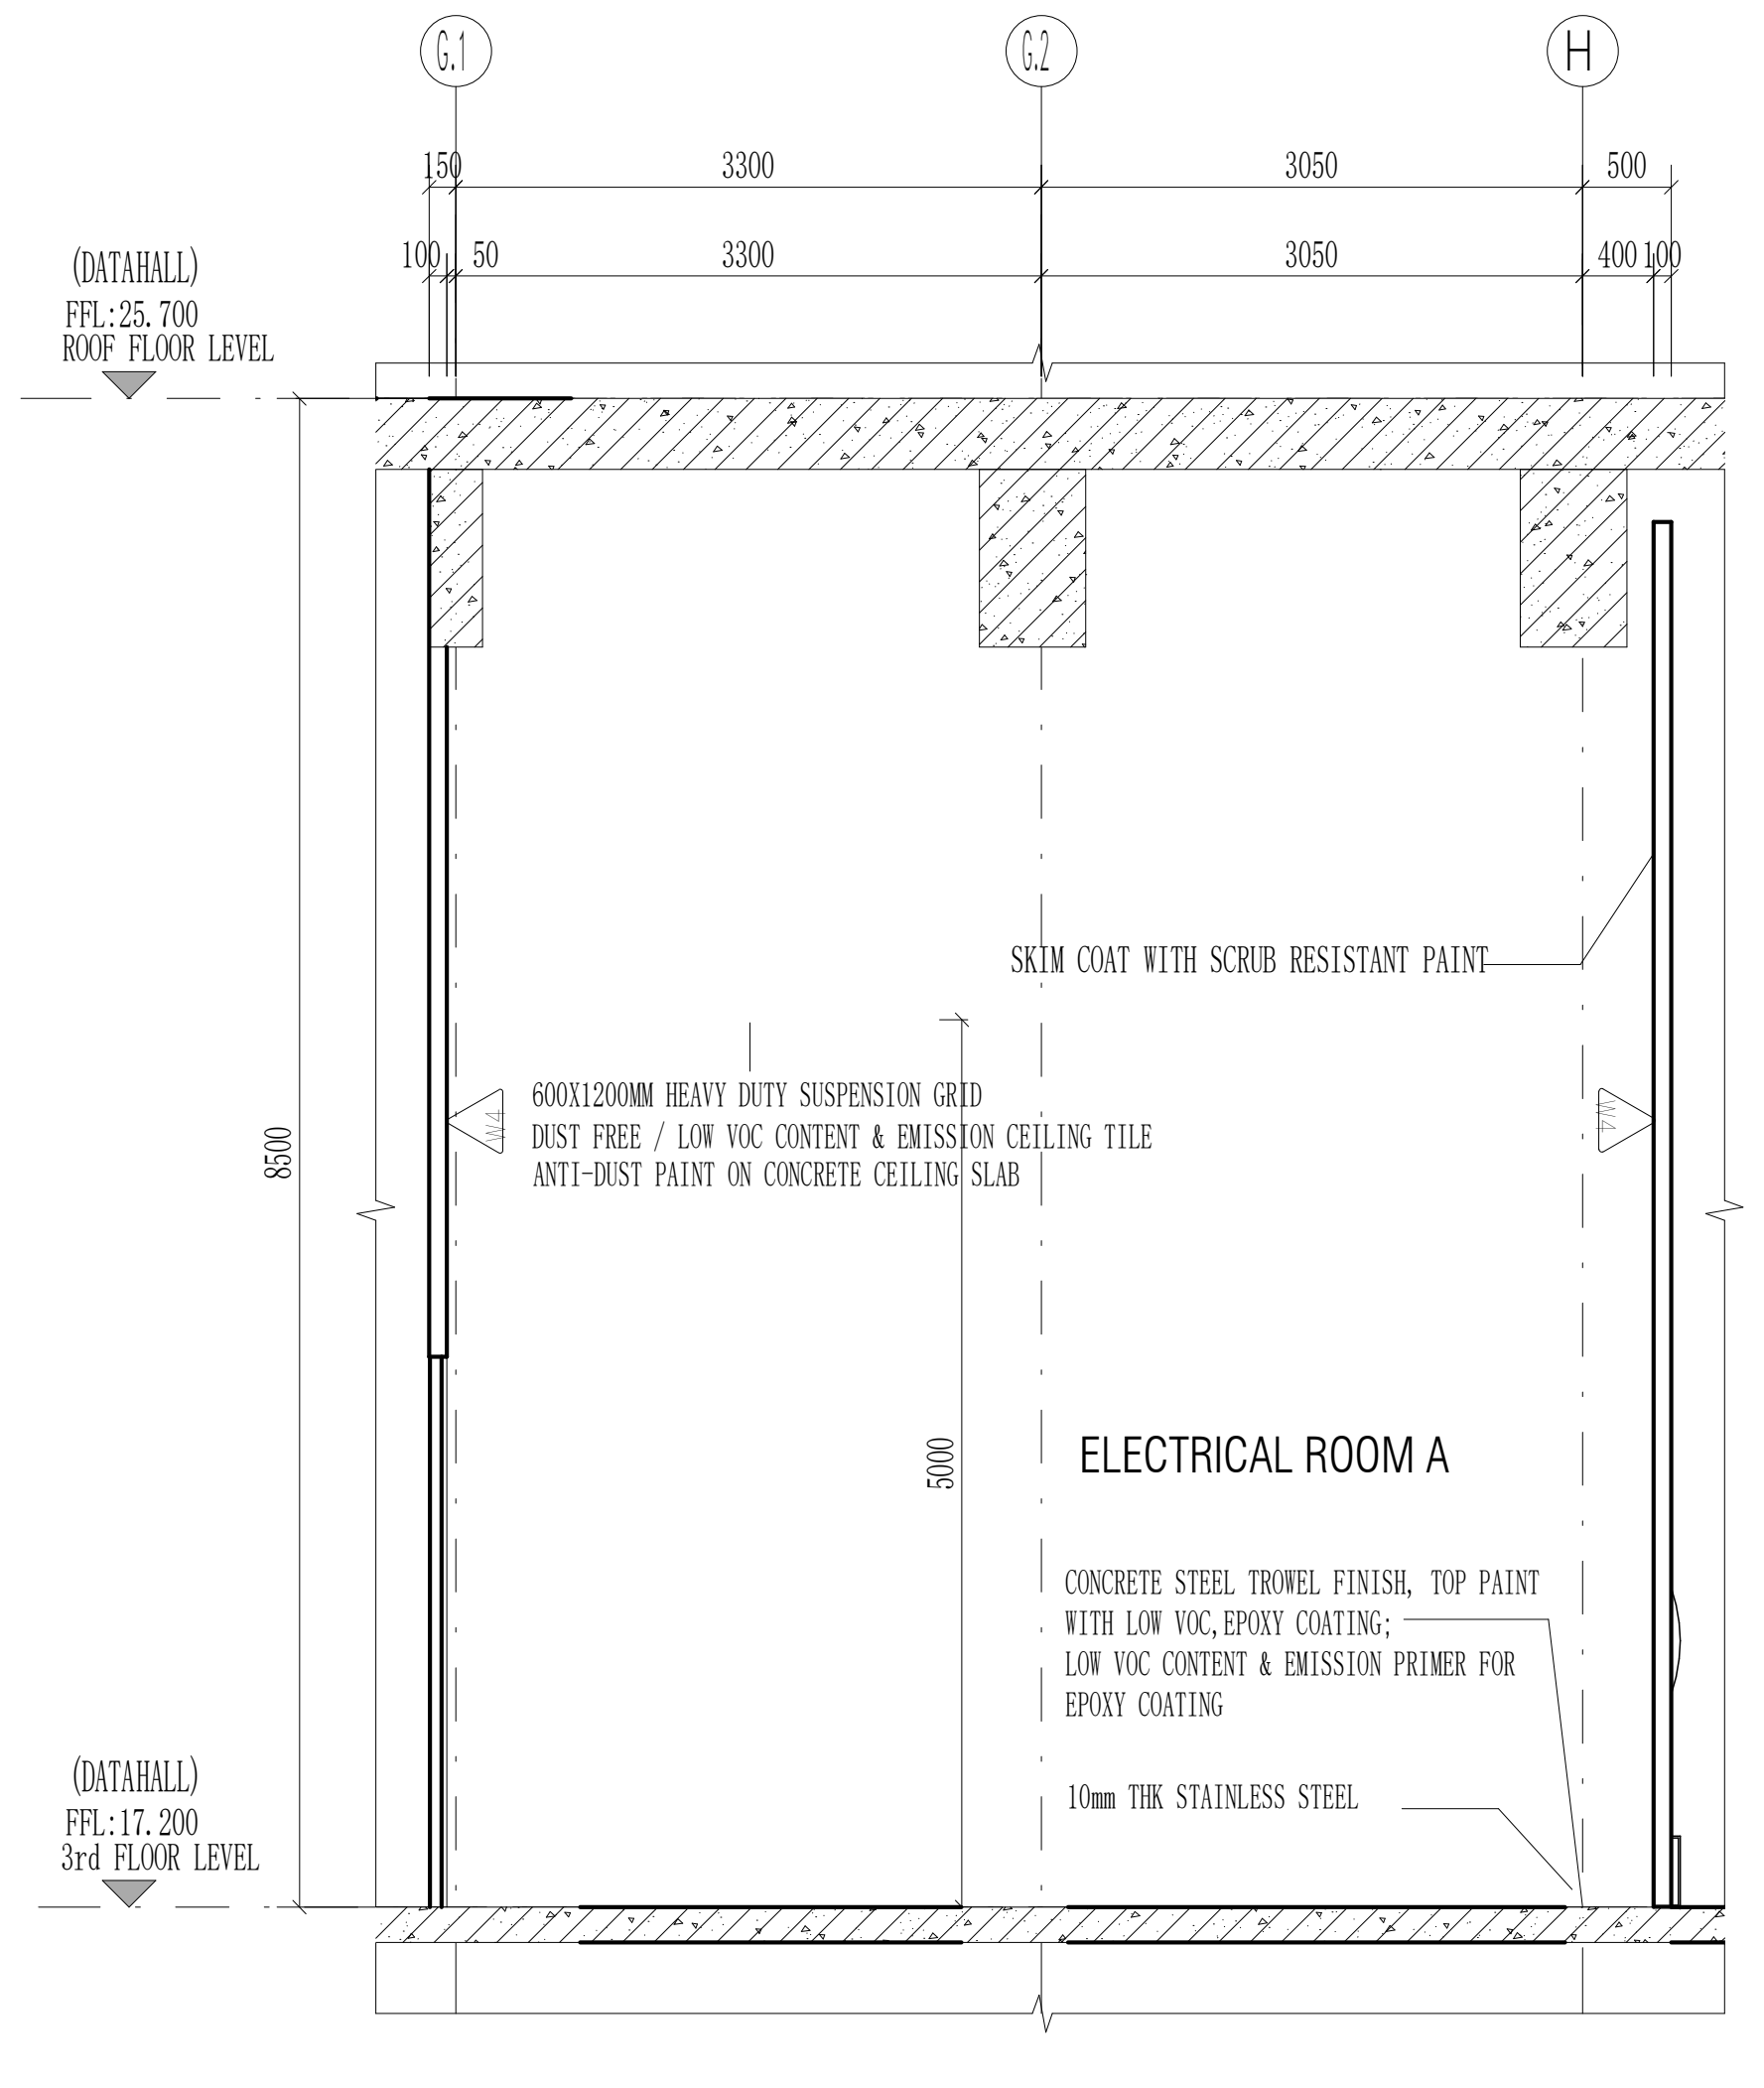
G.1
G.2
H
150
3300
3050
500
100
50
400 100
(DATAHALL)
FFL:25.700
ROOF FLOOR LEVEL
(DATAHALL)
FFL:17.200
3rd FLOOR LEVEL
8500
5000
SKIM COAT WITH SCRUB RESISTANT PAINT
600X1200MM HEAVY DUTY SUSPENSION GRID
DUST FREE / LOW VOC CONTENT & EMISSION CEILING TILE
ANTI-DUST PAINT ON CONCRETE CEILING SLAB
W4
ELECTRICAL ROOM A
CONCRETE STEEL TROWEL FINISH, TOP PAINT WITH LOW VOC,EPOXY COATING;
LOW VOC CONTENT & EMISSION PRIMER FOR EPOXY COATING
10mm THK STAINLESS STEEL

ELECTRICAL ROOM A SECTION B-B

Scale 1:50

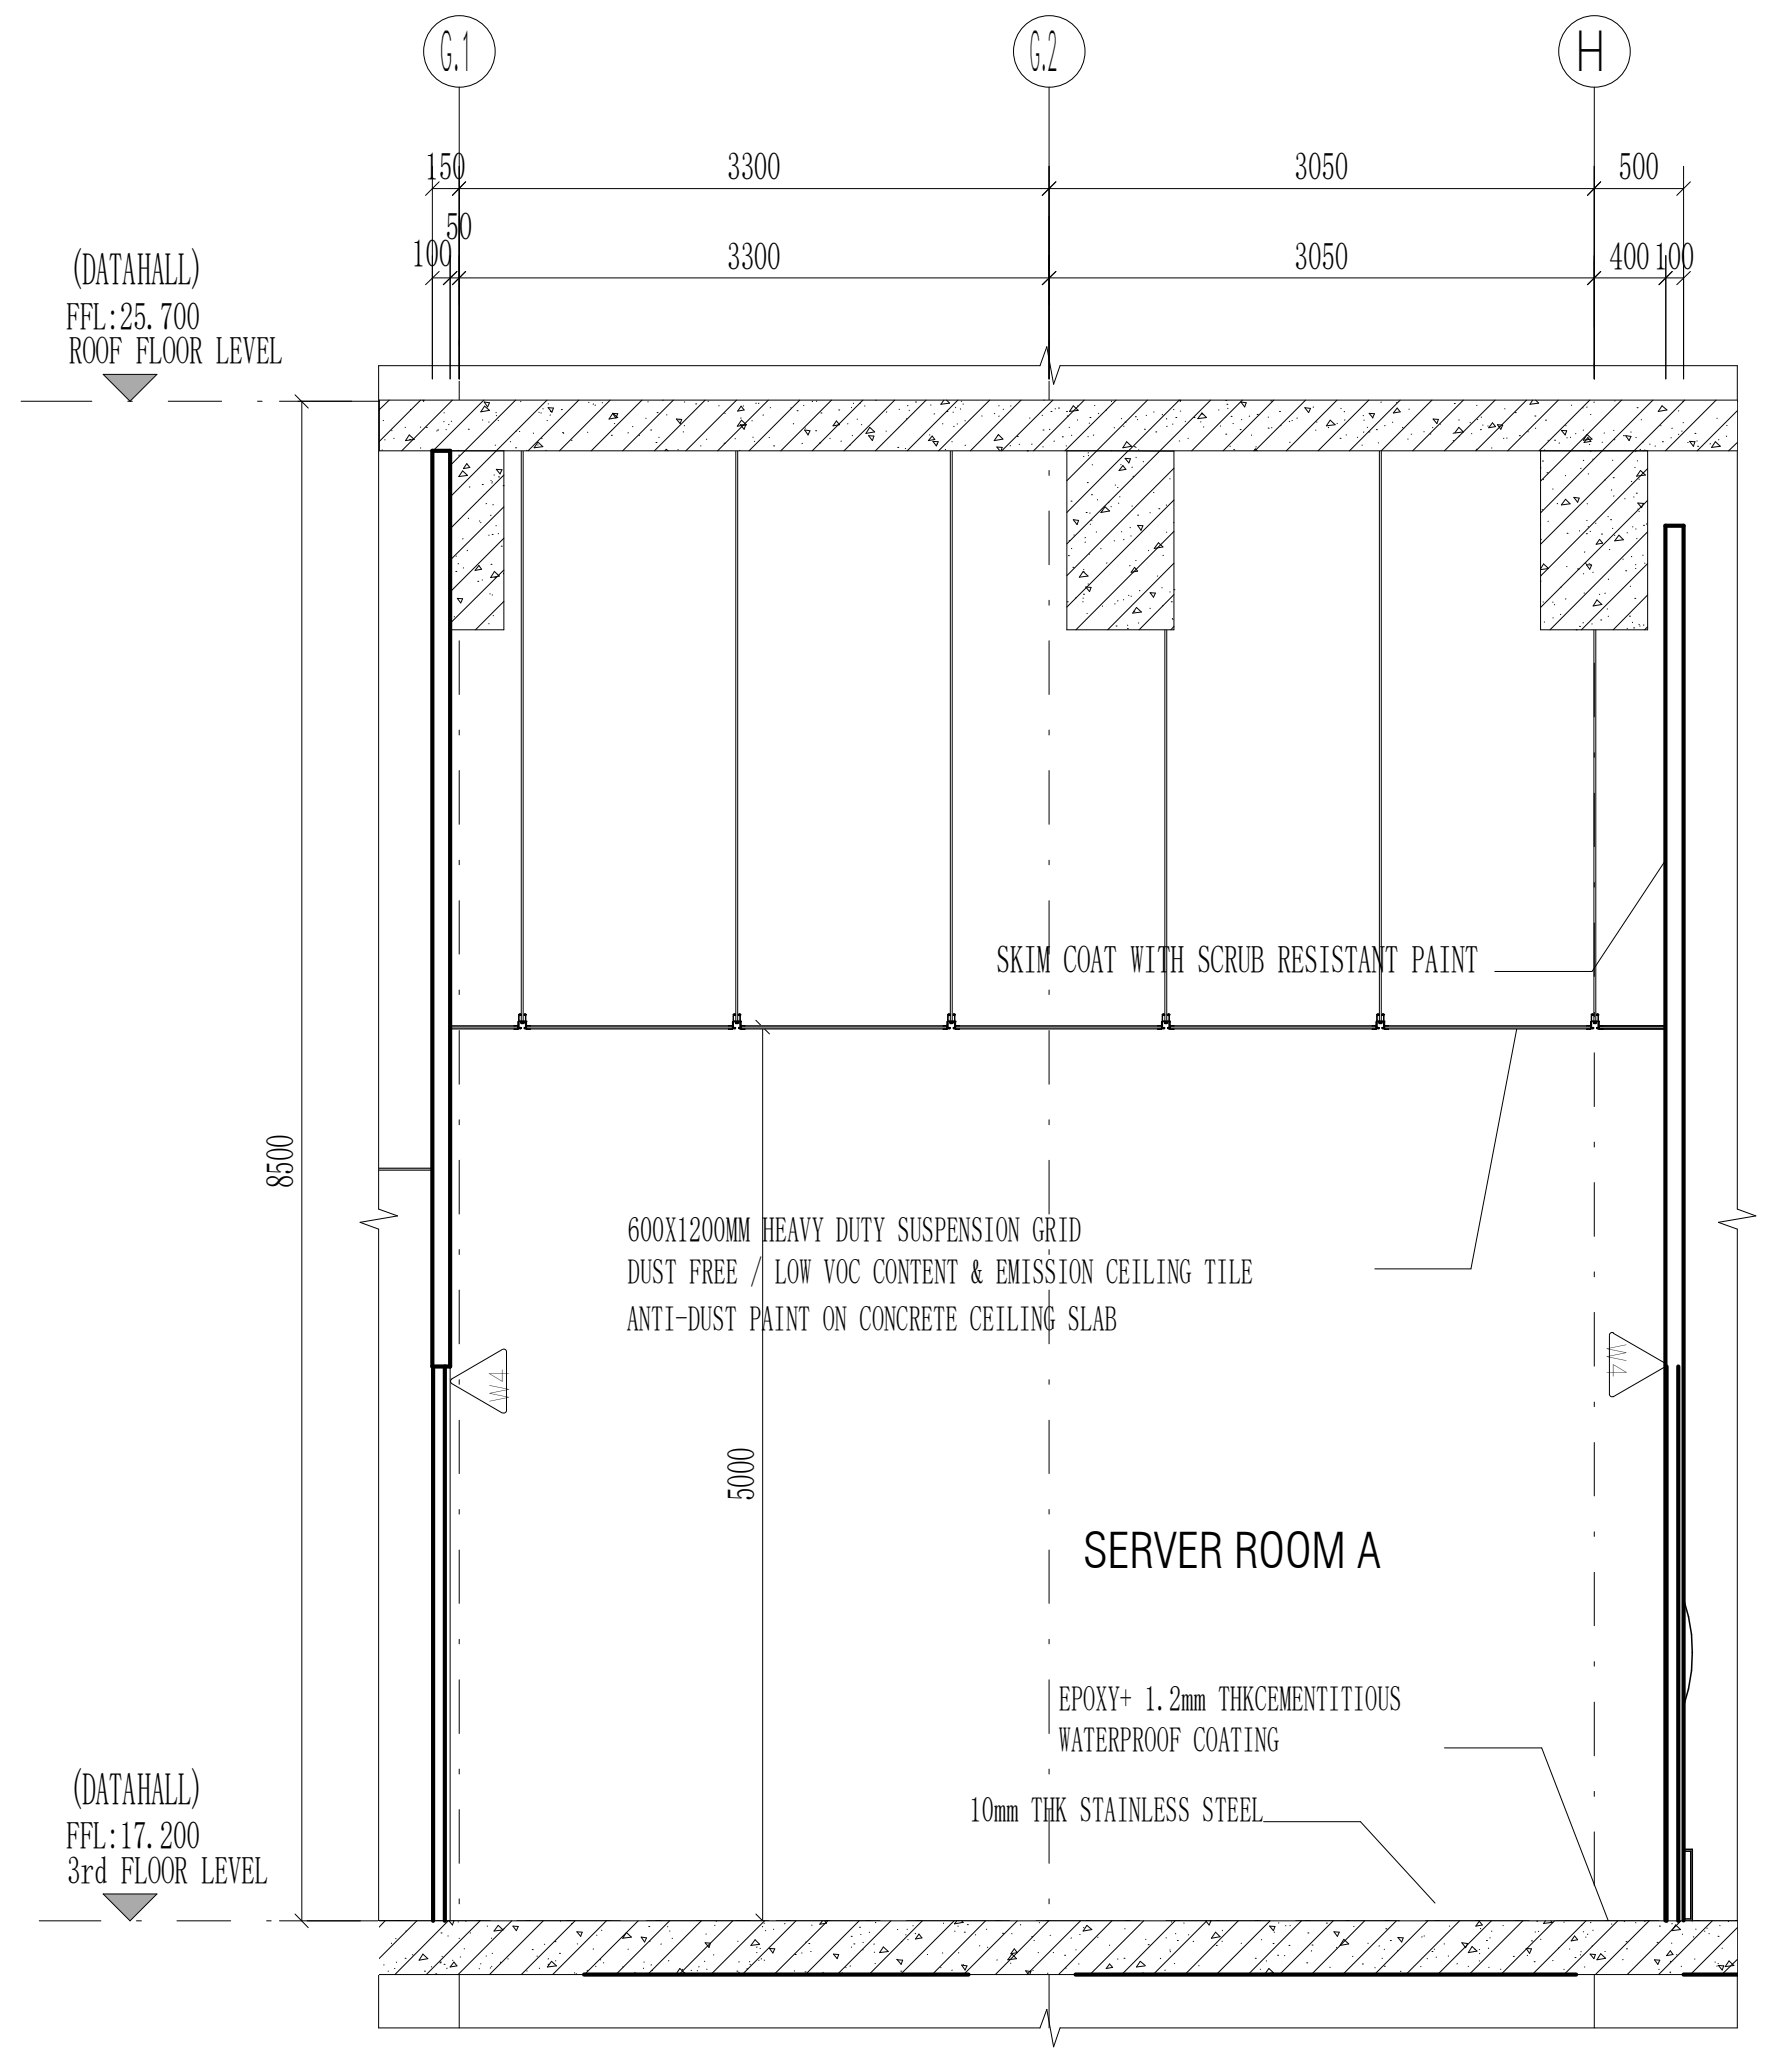
G.1
G.2
H
150
3300
3050
500
100
50
400 100
(DATAHALL)
FFL:25.700
ROOF FLOOR LEVEL
(DATAHALL)
FFL:17.200
3rd FLOOR LEVEL
8500
5000
SKIM COAT WITH SCRUB RESISTANT PAINT
600X1200MM HEAVY DUTY SUSPENSION GRID
DUST FREE / LOW VOC CONTENT & EMISSION CEILING TILE
ANTI-DUST PAINT ON CONCRETE CEILING SLAB
W4
SERVER ROOM A
EPOXY+ 1.2mm THKCEMENTITIOUS WATERPROOF COATING
10mm THK STAINLESS STEEL

SERVER ROOM A SECTION C-C

Scale 1:50

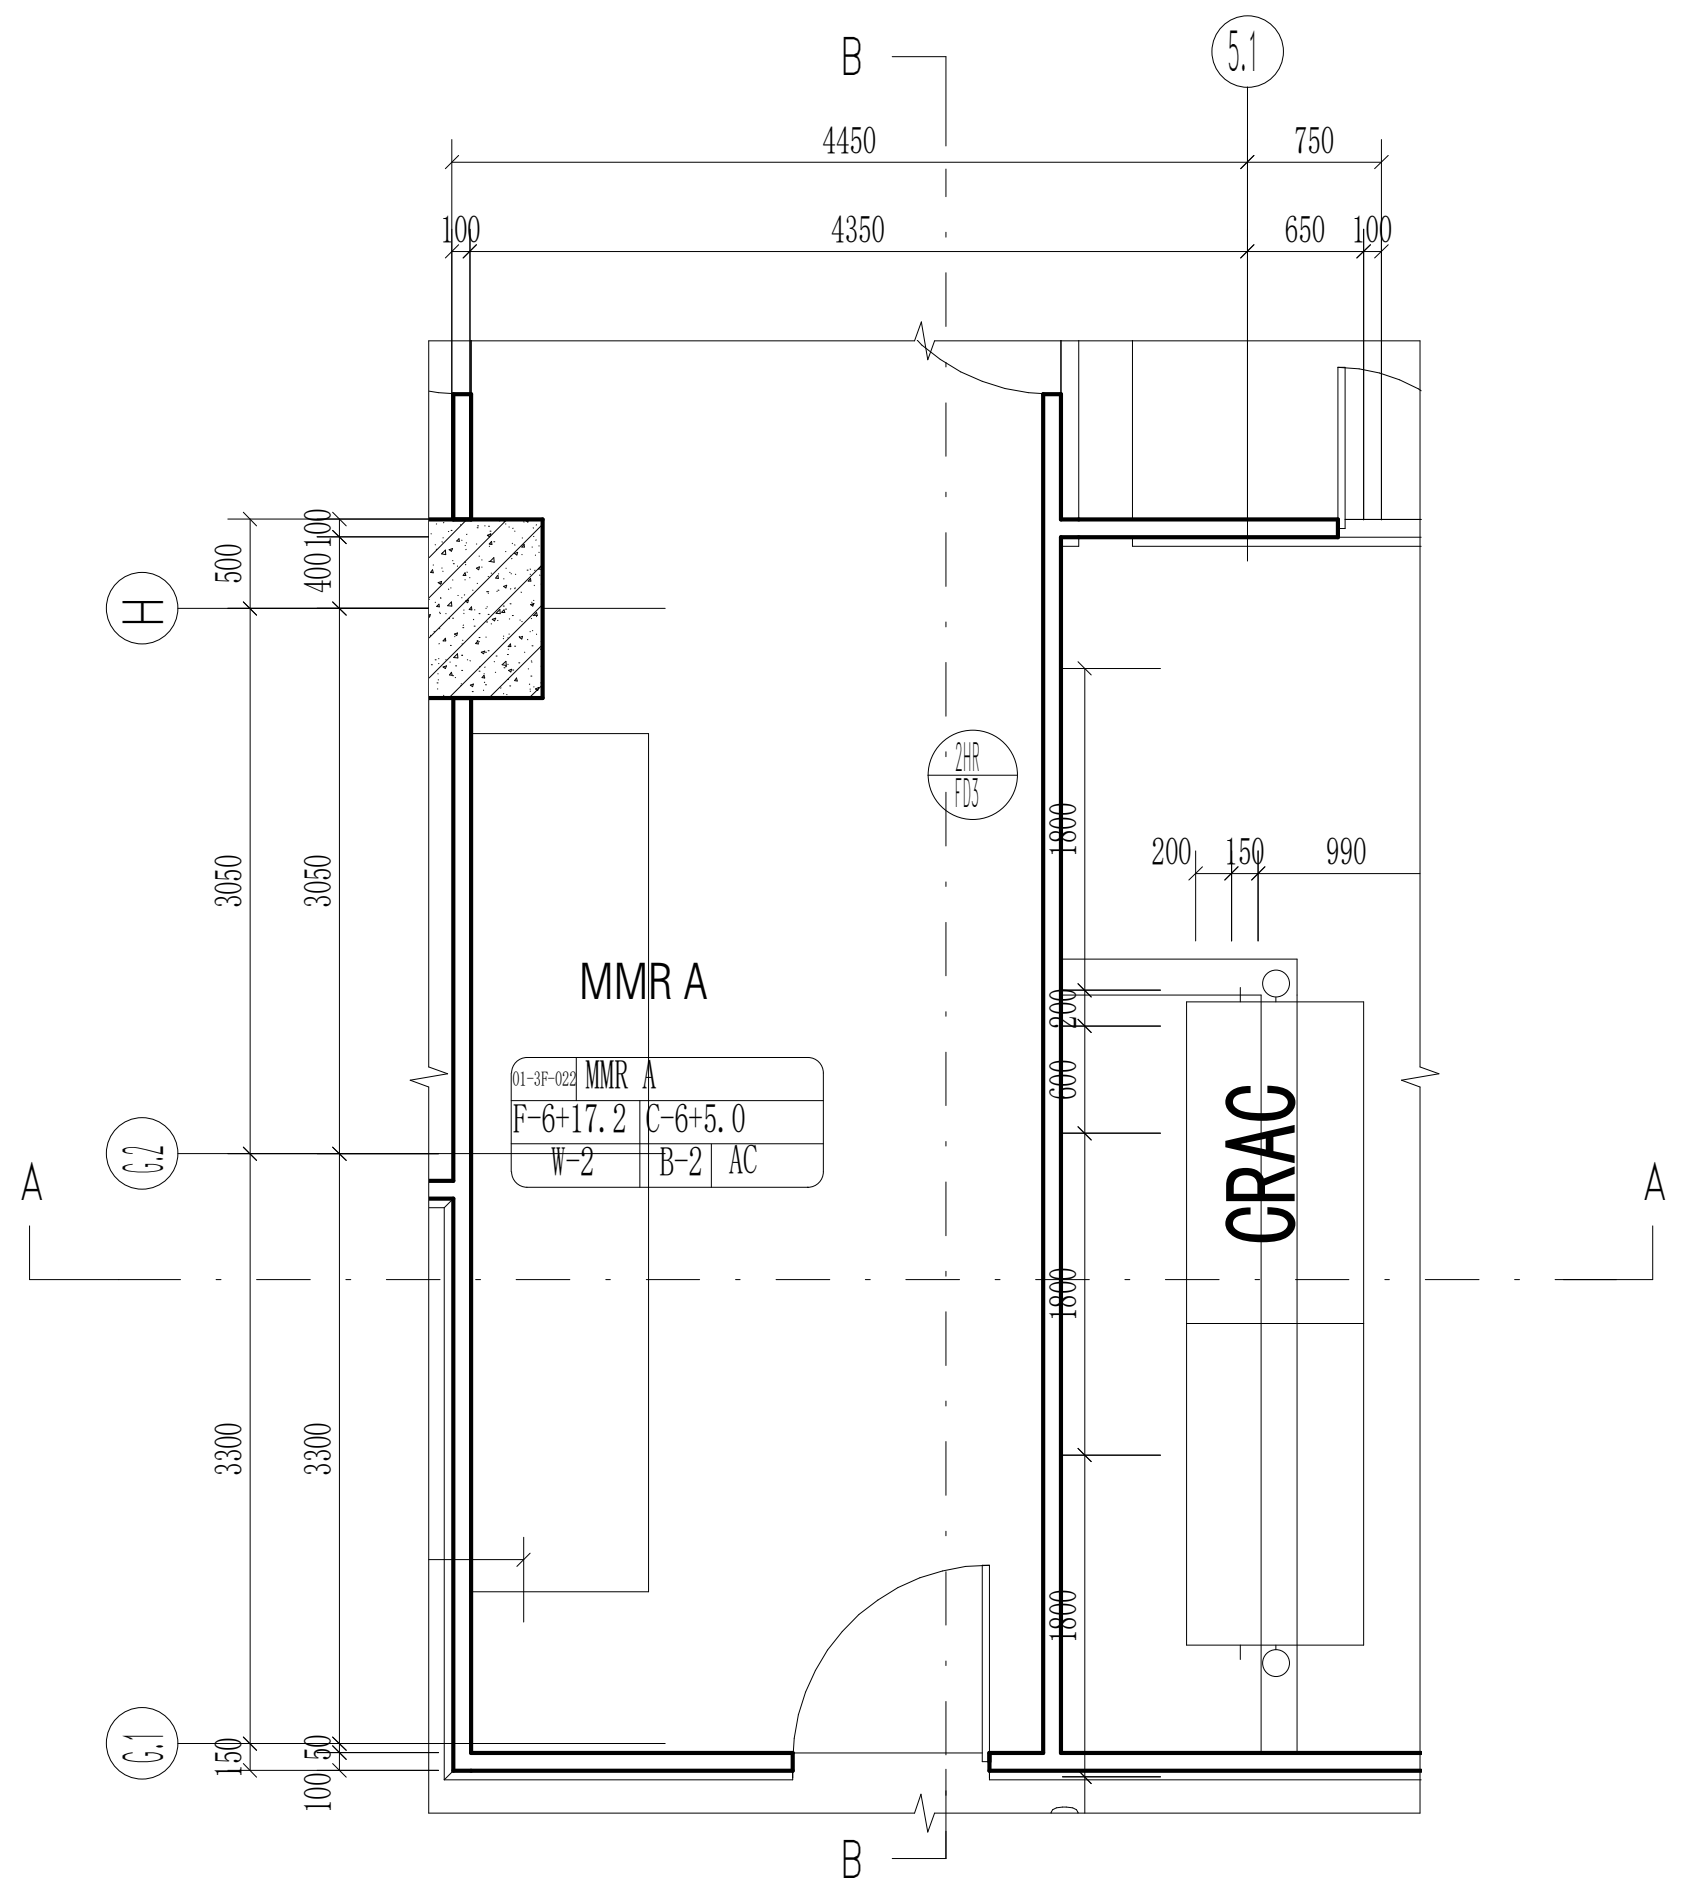
B
5.1
4450
750
100
4350
650 100
H
G.2
G.1
A
500
400 100
3050
3300
150
100 50
MMR A
01-3F-022 MMR A
F-6+17.2 C-6+5.0
W-2 B-2 AC
2HR FD3
CRAC
1800
200 150 990
200
600

MMR A PLAN

Scale 1:50

THE "SFL" MARKED IN THE DRAWING REFERS TO THE STRUCTURAL FLOOR LEVEL, WHILE THE FINISHED FLOOR LEVEL (FFL) IS DETERMINED BASED ON FLOOR FINISHES.

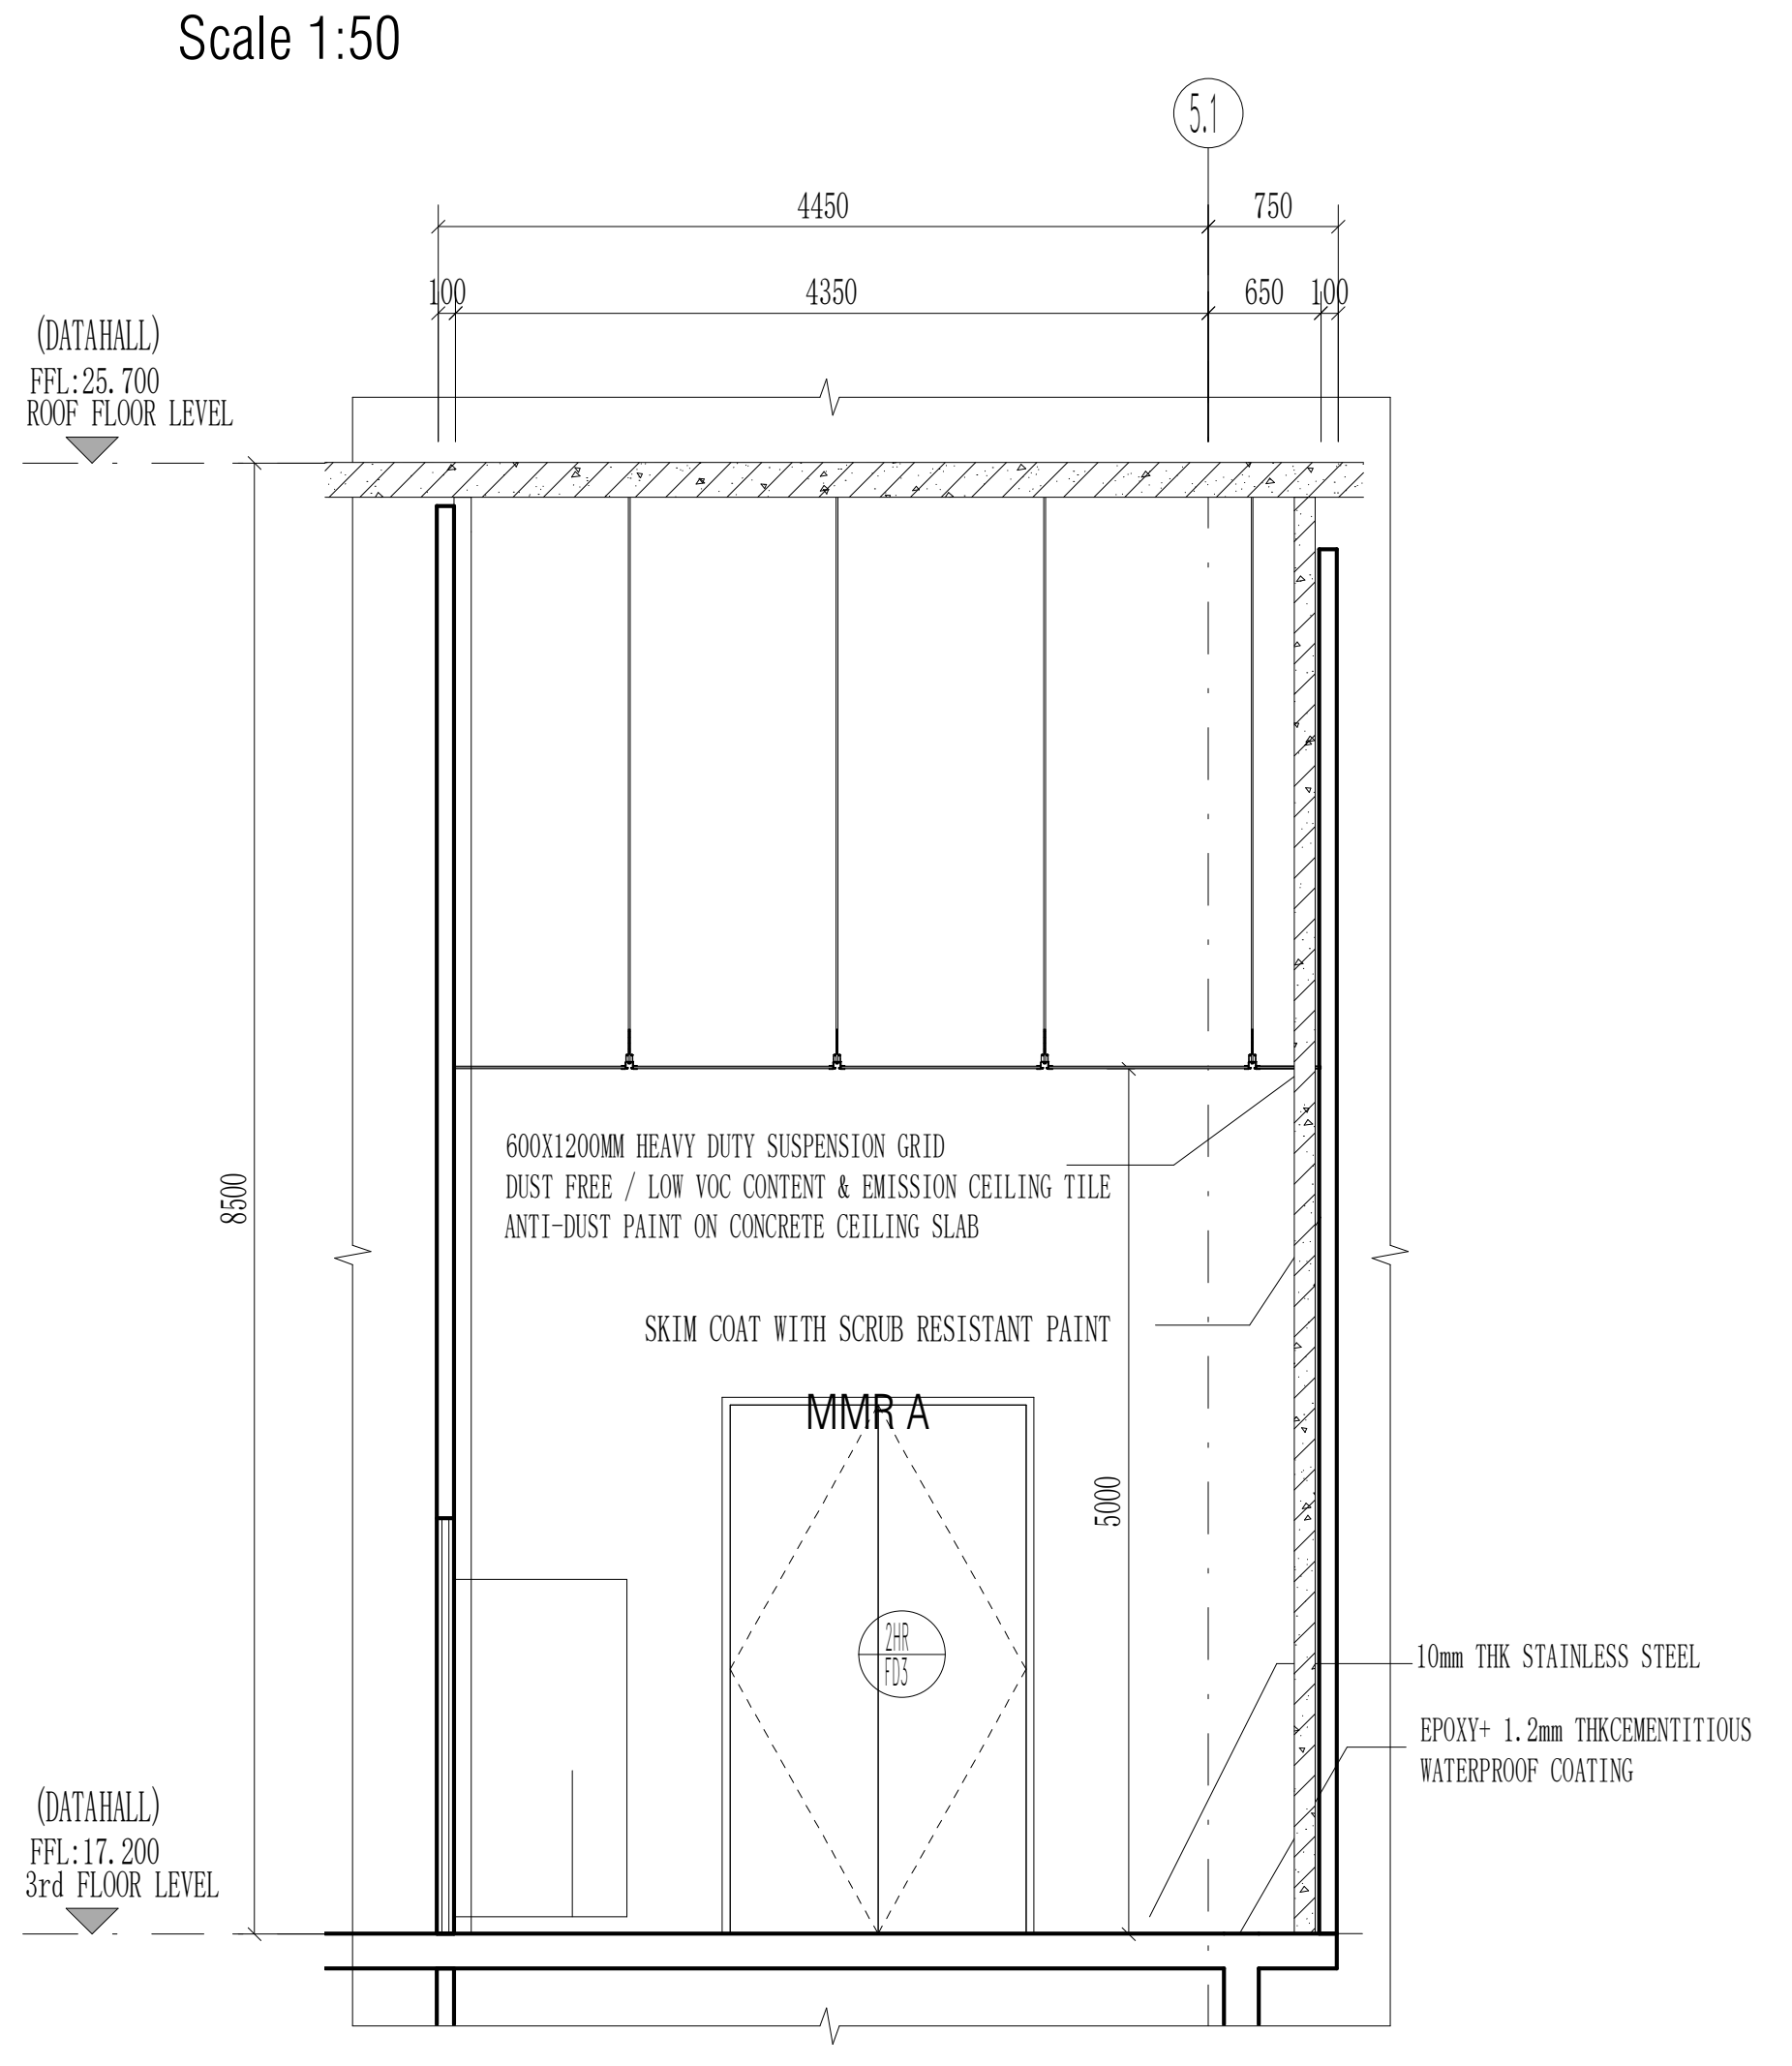
5.1
4450
750
100
4350
650 100
(DATAHALL)
FFL:25.700
ROOF FLOOR LEVEL
(DATAHALL)
FFL:17.200
3rd FLOOR LEVEL
8500
5000
600X1200MM HEAVY DUTY SUSPENSION GRID
DUST FREE / LOW VOC CONTENT & EMISSION CEILING TILE
ANTI-DUST PAINT ON CONCRETE CEILING SLAB
SKIM COAT WITH SCRUB RESISTANT PAINT
MMR A
2HR FD3
10mm THK STAINLESS STEEL
EPOXY+ 1.2mm THKCEMENTITIOUS WATERPROOF COATING

MMR A SECTION A-A

Scale 1:50

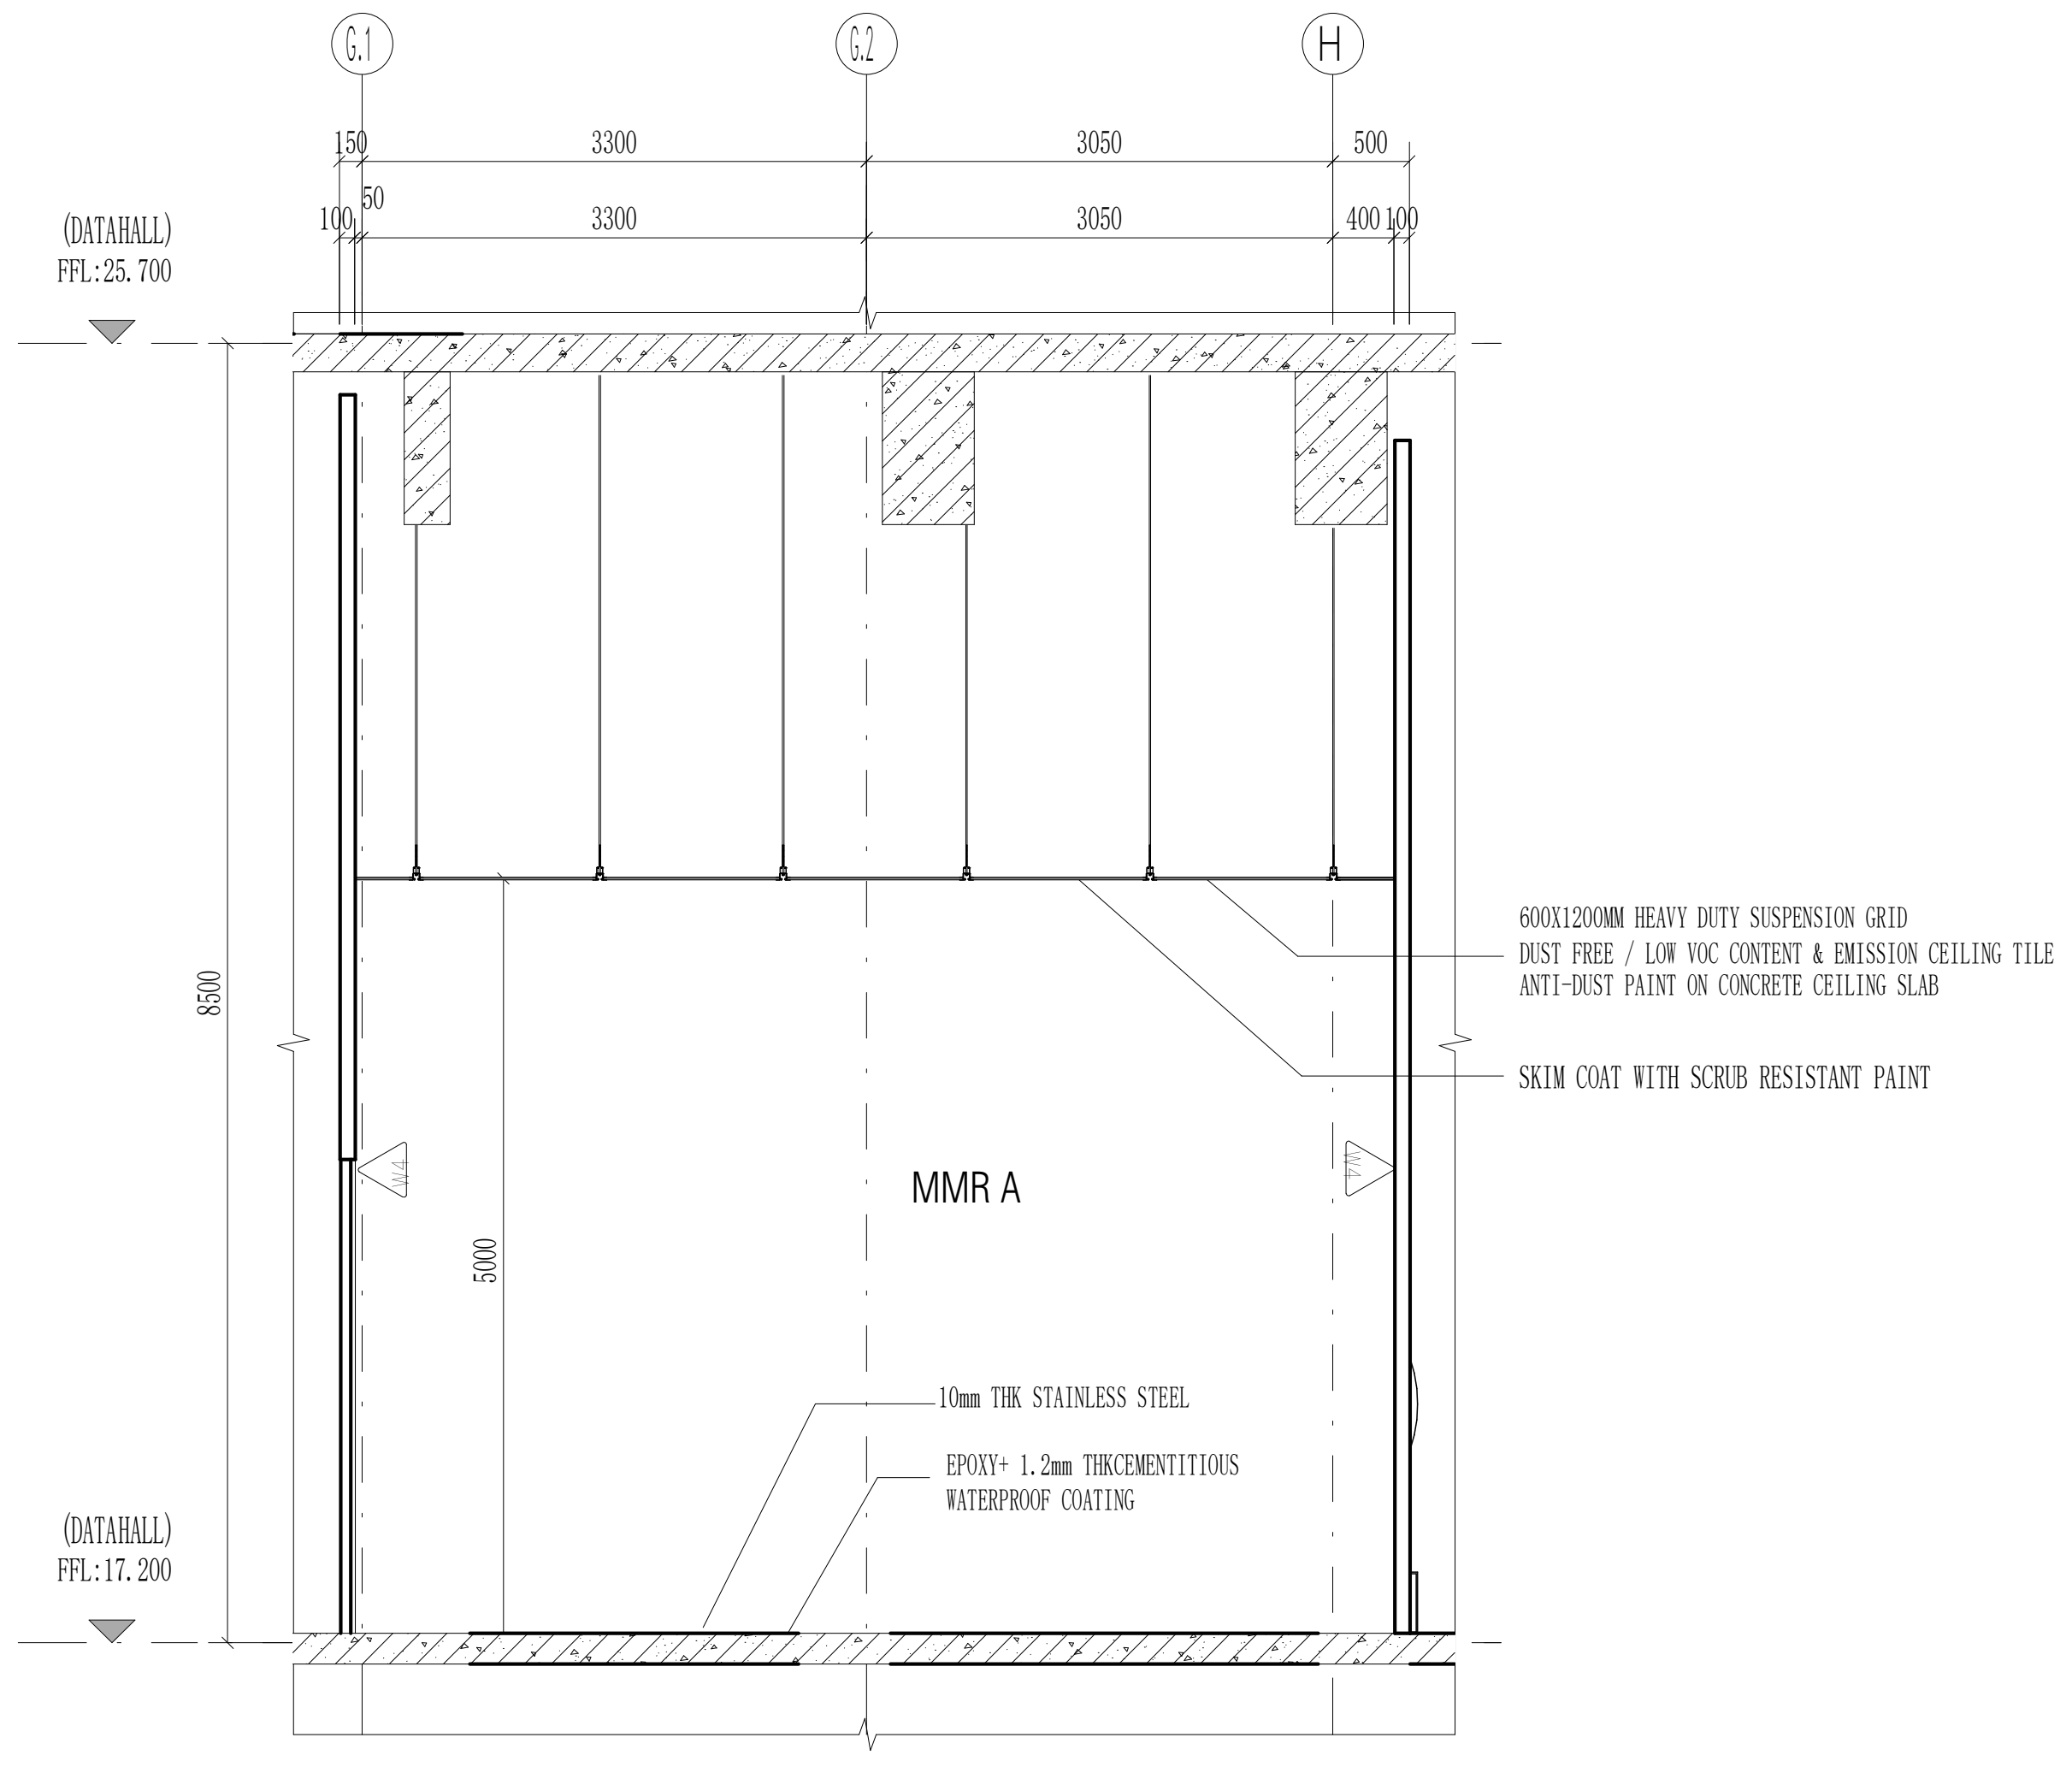
G.1
G.2
H
150
3300
3050
500
100
50
400 100
(DATAHALL)
FFL:25.700
(DATAHALL)
FFL:17.200
8500
5000
600X1200MM HEAVY DUTY SUSPENSION GRID
DUST FREE / LOW VOC CONTENT & EMISSION CEILING TILE
ANTI-DUST PAINT ON CONCRETE CEILING SLAB
SKIM COAT WITH SCRUB RESISTANT PAINT
W4
MMR A
10mm THK STAINLESS STEEL
EPOXY+ 1.2mm THKCEMENTITIOUS WATERPROOF COATING

MMR A SECTION B-B

Scale 1:50

THE "SFL" MARKED IN THE DRAWING REFERS TO THE STRUCTURAL FLOOR LEVEL, WHILE THE FINISHED FLOOR LEVEL (FFL) IS DETERMINED BASED ON FLOOR FINISHES.

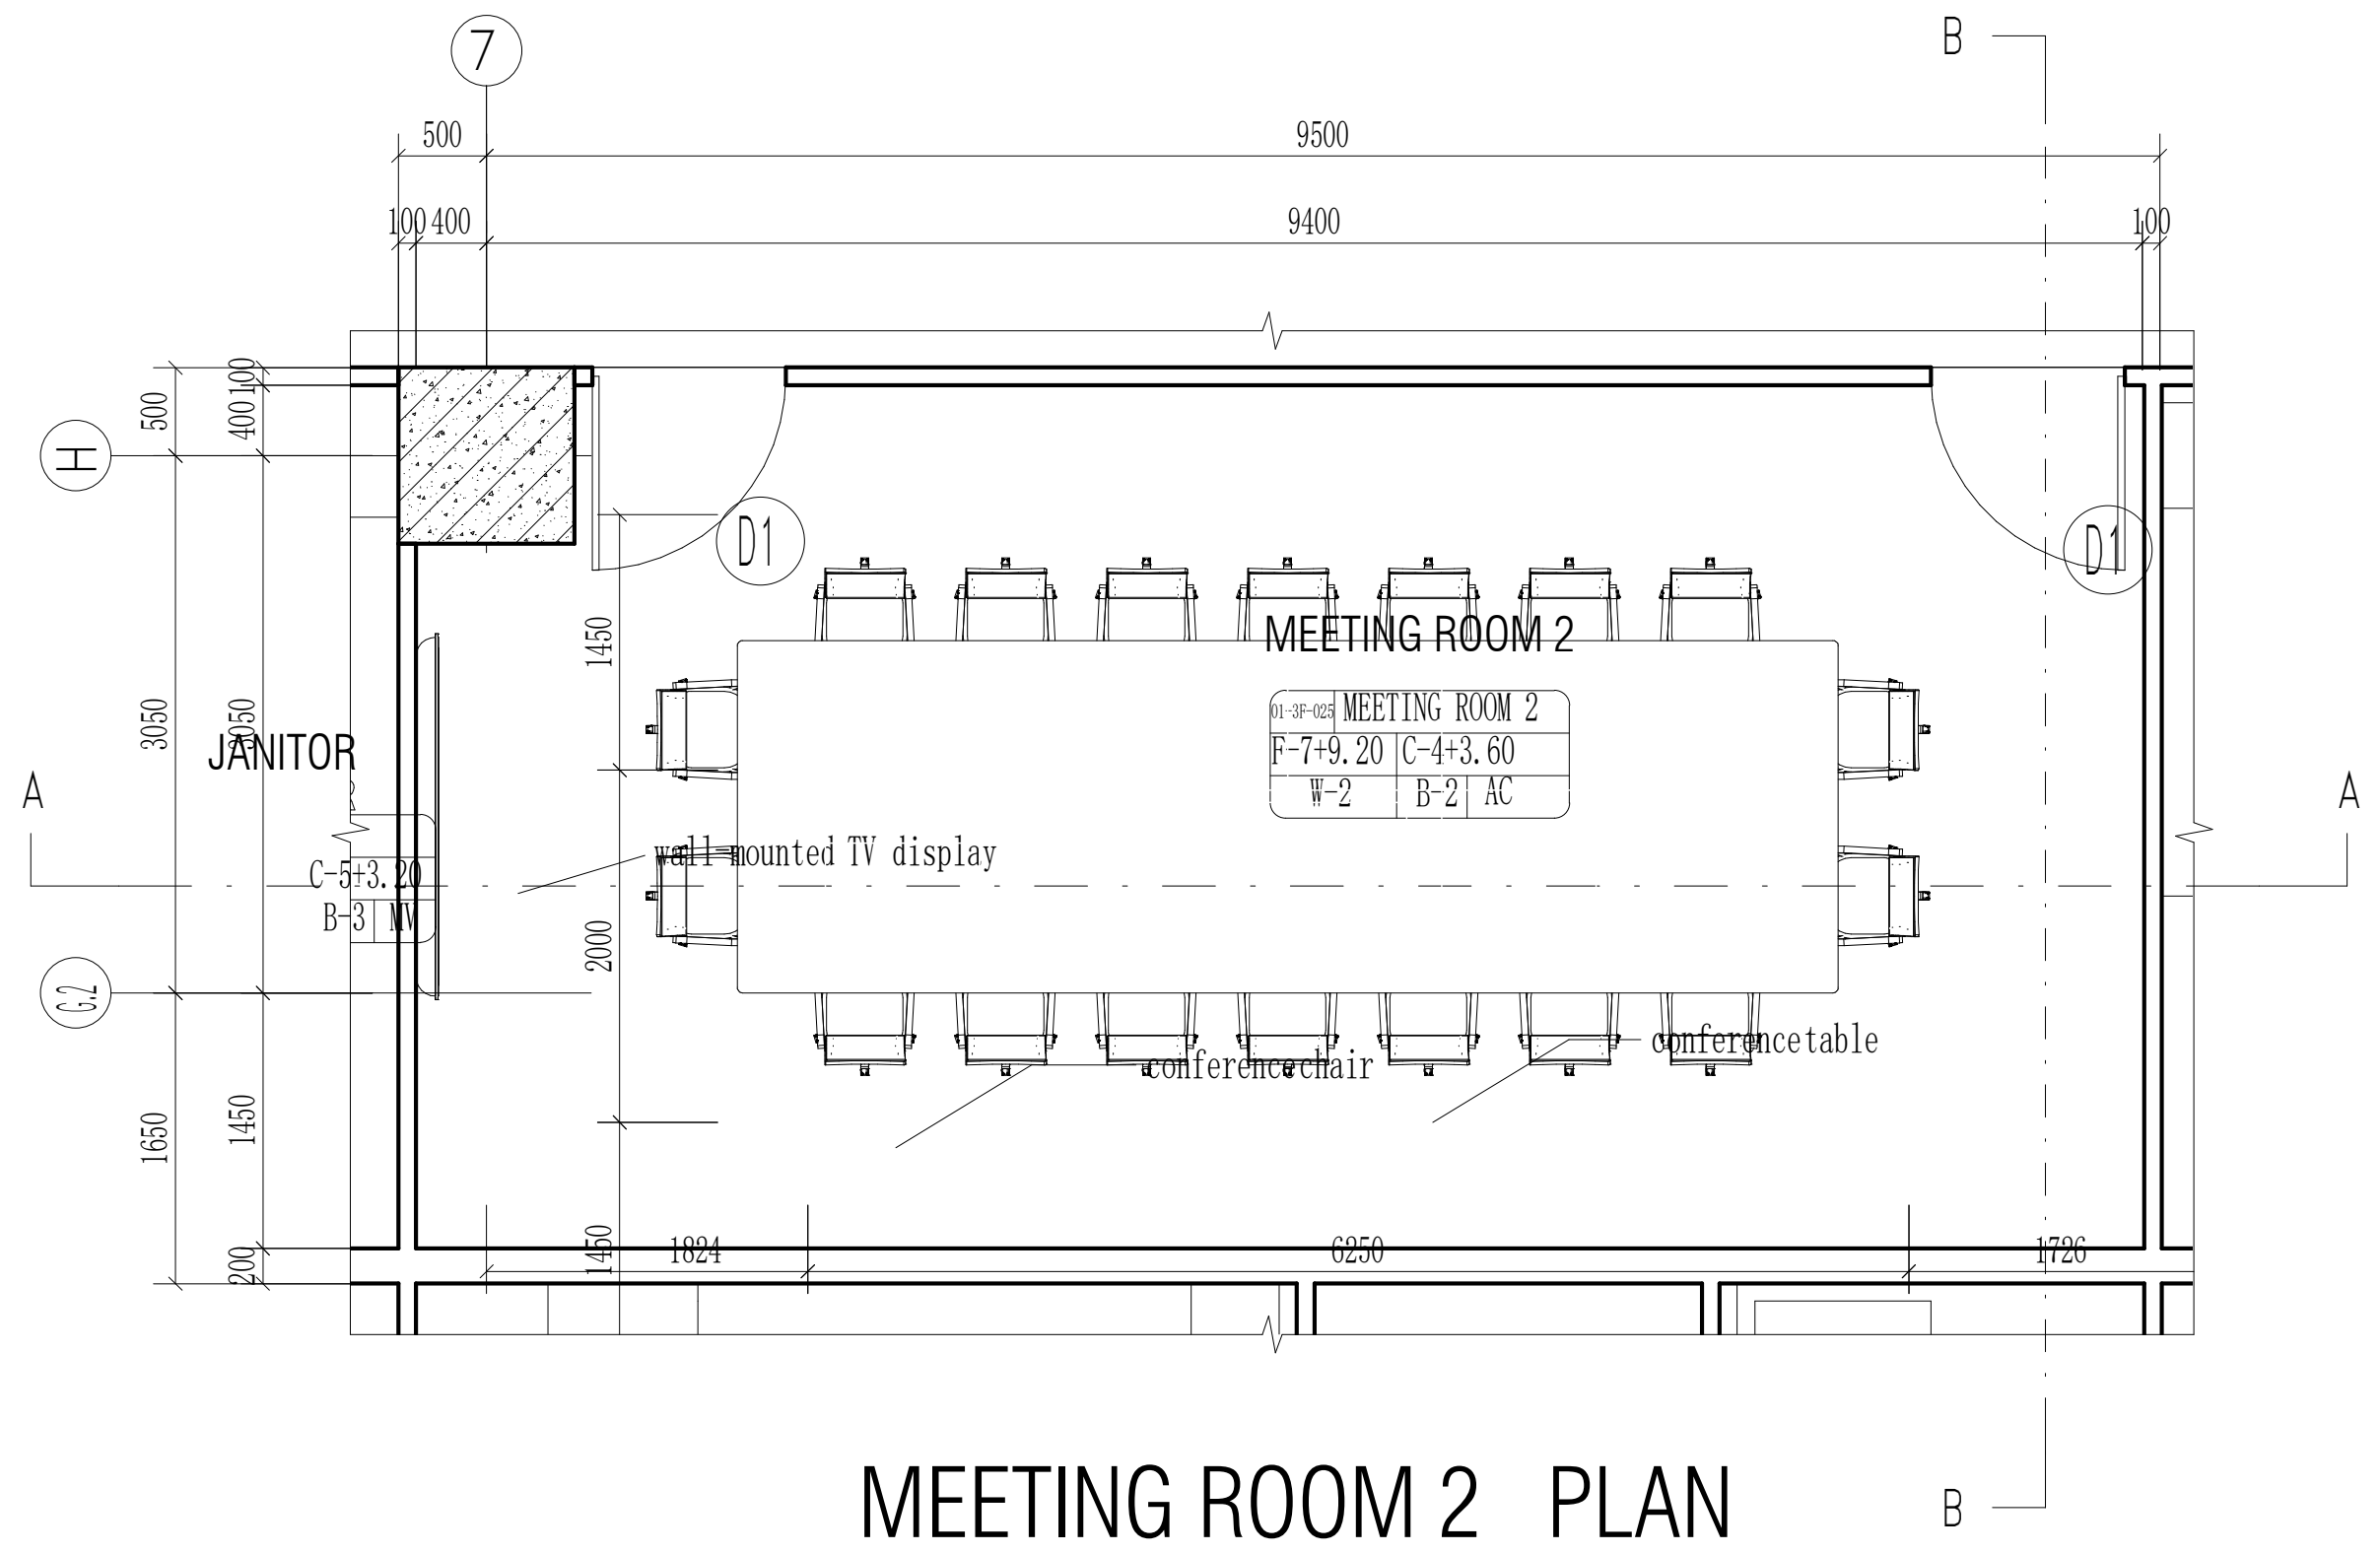
7
B
500
9500
100 400
9400
100
H
G.2
A
3050
1650
1450
2000
200
1824
6250
1726
D1
D1
JANITOR
MEETING ROOM 2
01-3F-025 MEETING ROOM 2
F-7+9.20 C-4+3.60
W-2 B-2 AC
C-5+3.20
B-3 MV
wall mounted TV display
conferencechair
conferencetable

MEETING ROOM 2 PLAN

Scale 1:50

THE "SFL" MARKED IN THE DRAWING REFERS TO THE STRUCTURAL FLOOR LEVEL, WHILE THE FINISHED FLOOR LEVEL (FFL) IS DETERMINED BASED ON FLOOR FINISHES.

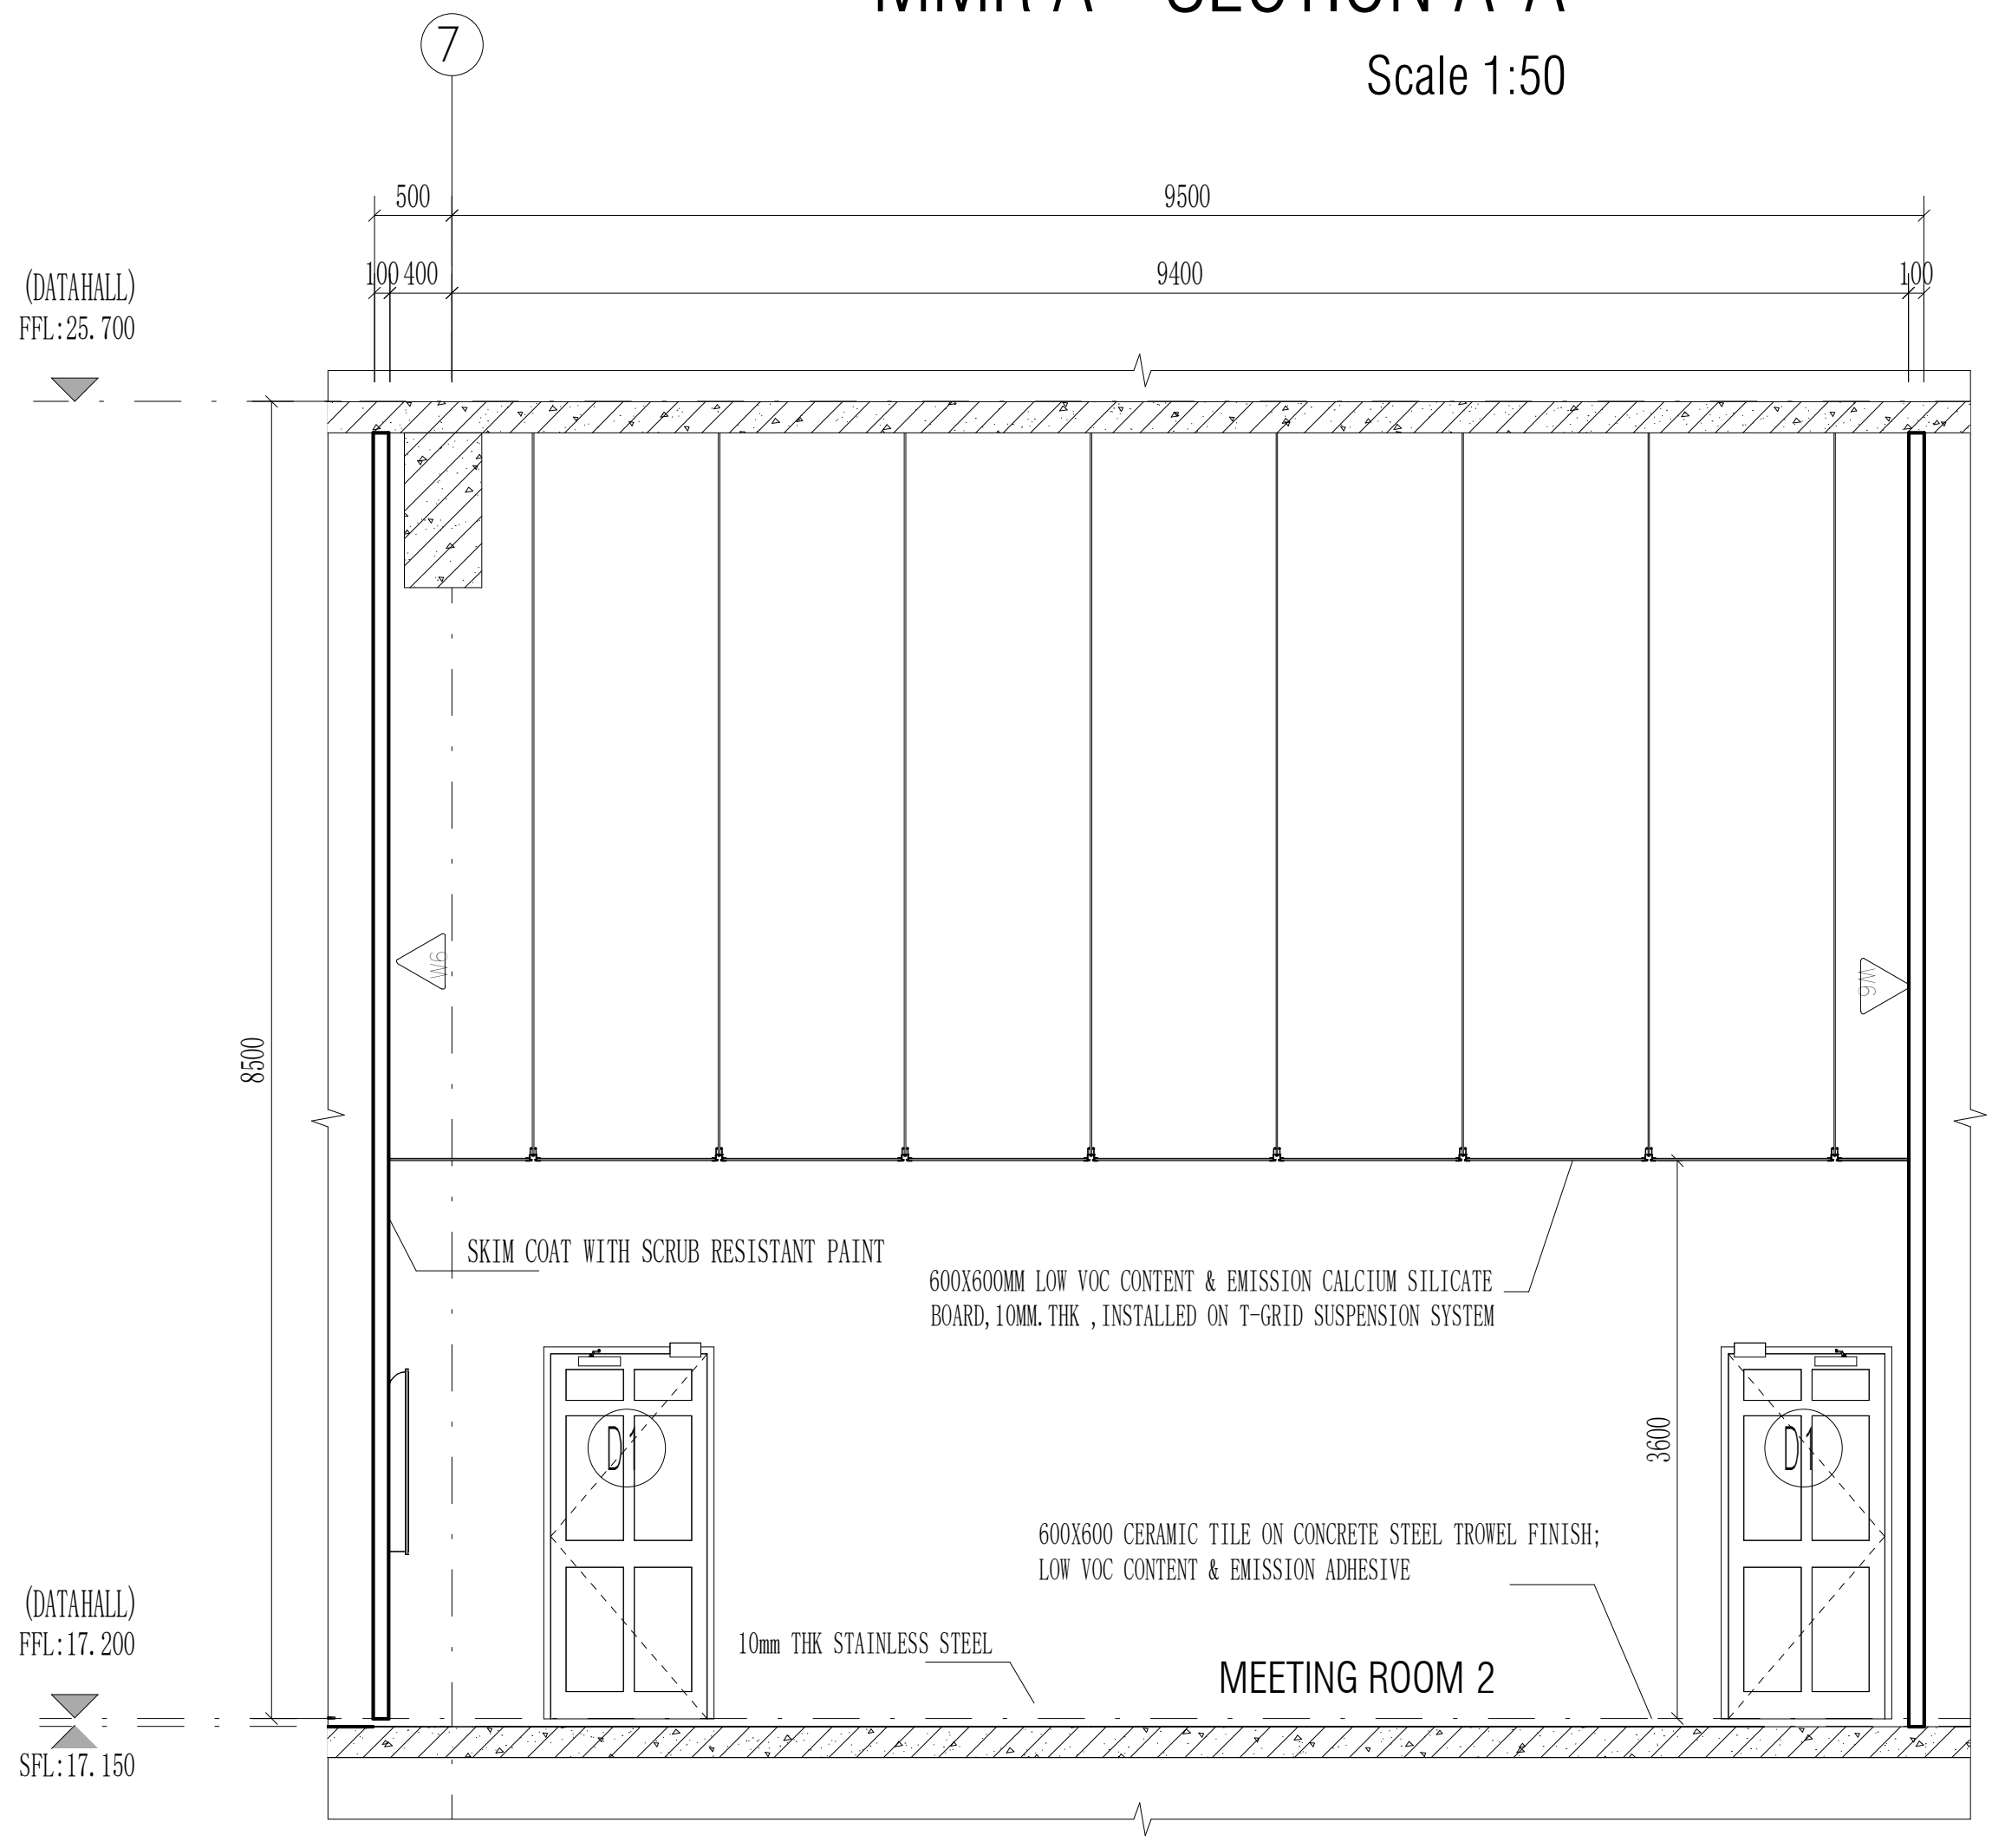
7
500
9500
100 400
9400
100
(DATAHALL)
FFL:25.700
(DATAHALL)
FFL:17.200
SFL:17.150
8500
3600
W6
SKIM COAT WITH SCRUB RESISTANT PAINT
600X600MM LOW VOC CONTENT & EMISSION CALCIUM SILICATE BOARD,10MM.THK ,INSTALLED ON T-GRID SUSPENSION SYSTEM
D1
D1
600X600 CERAMIC TILE ON CONCRETE STEEL TROWEL FINISH;
LOW VOC CONTENT & EMISSION ADHESIVE
10mm THK STAINLESS STEEL
MEETING ROOM 2

MEETING ROOM 2 SECTION A-A

Scale 1:50

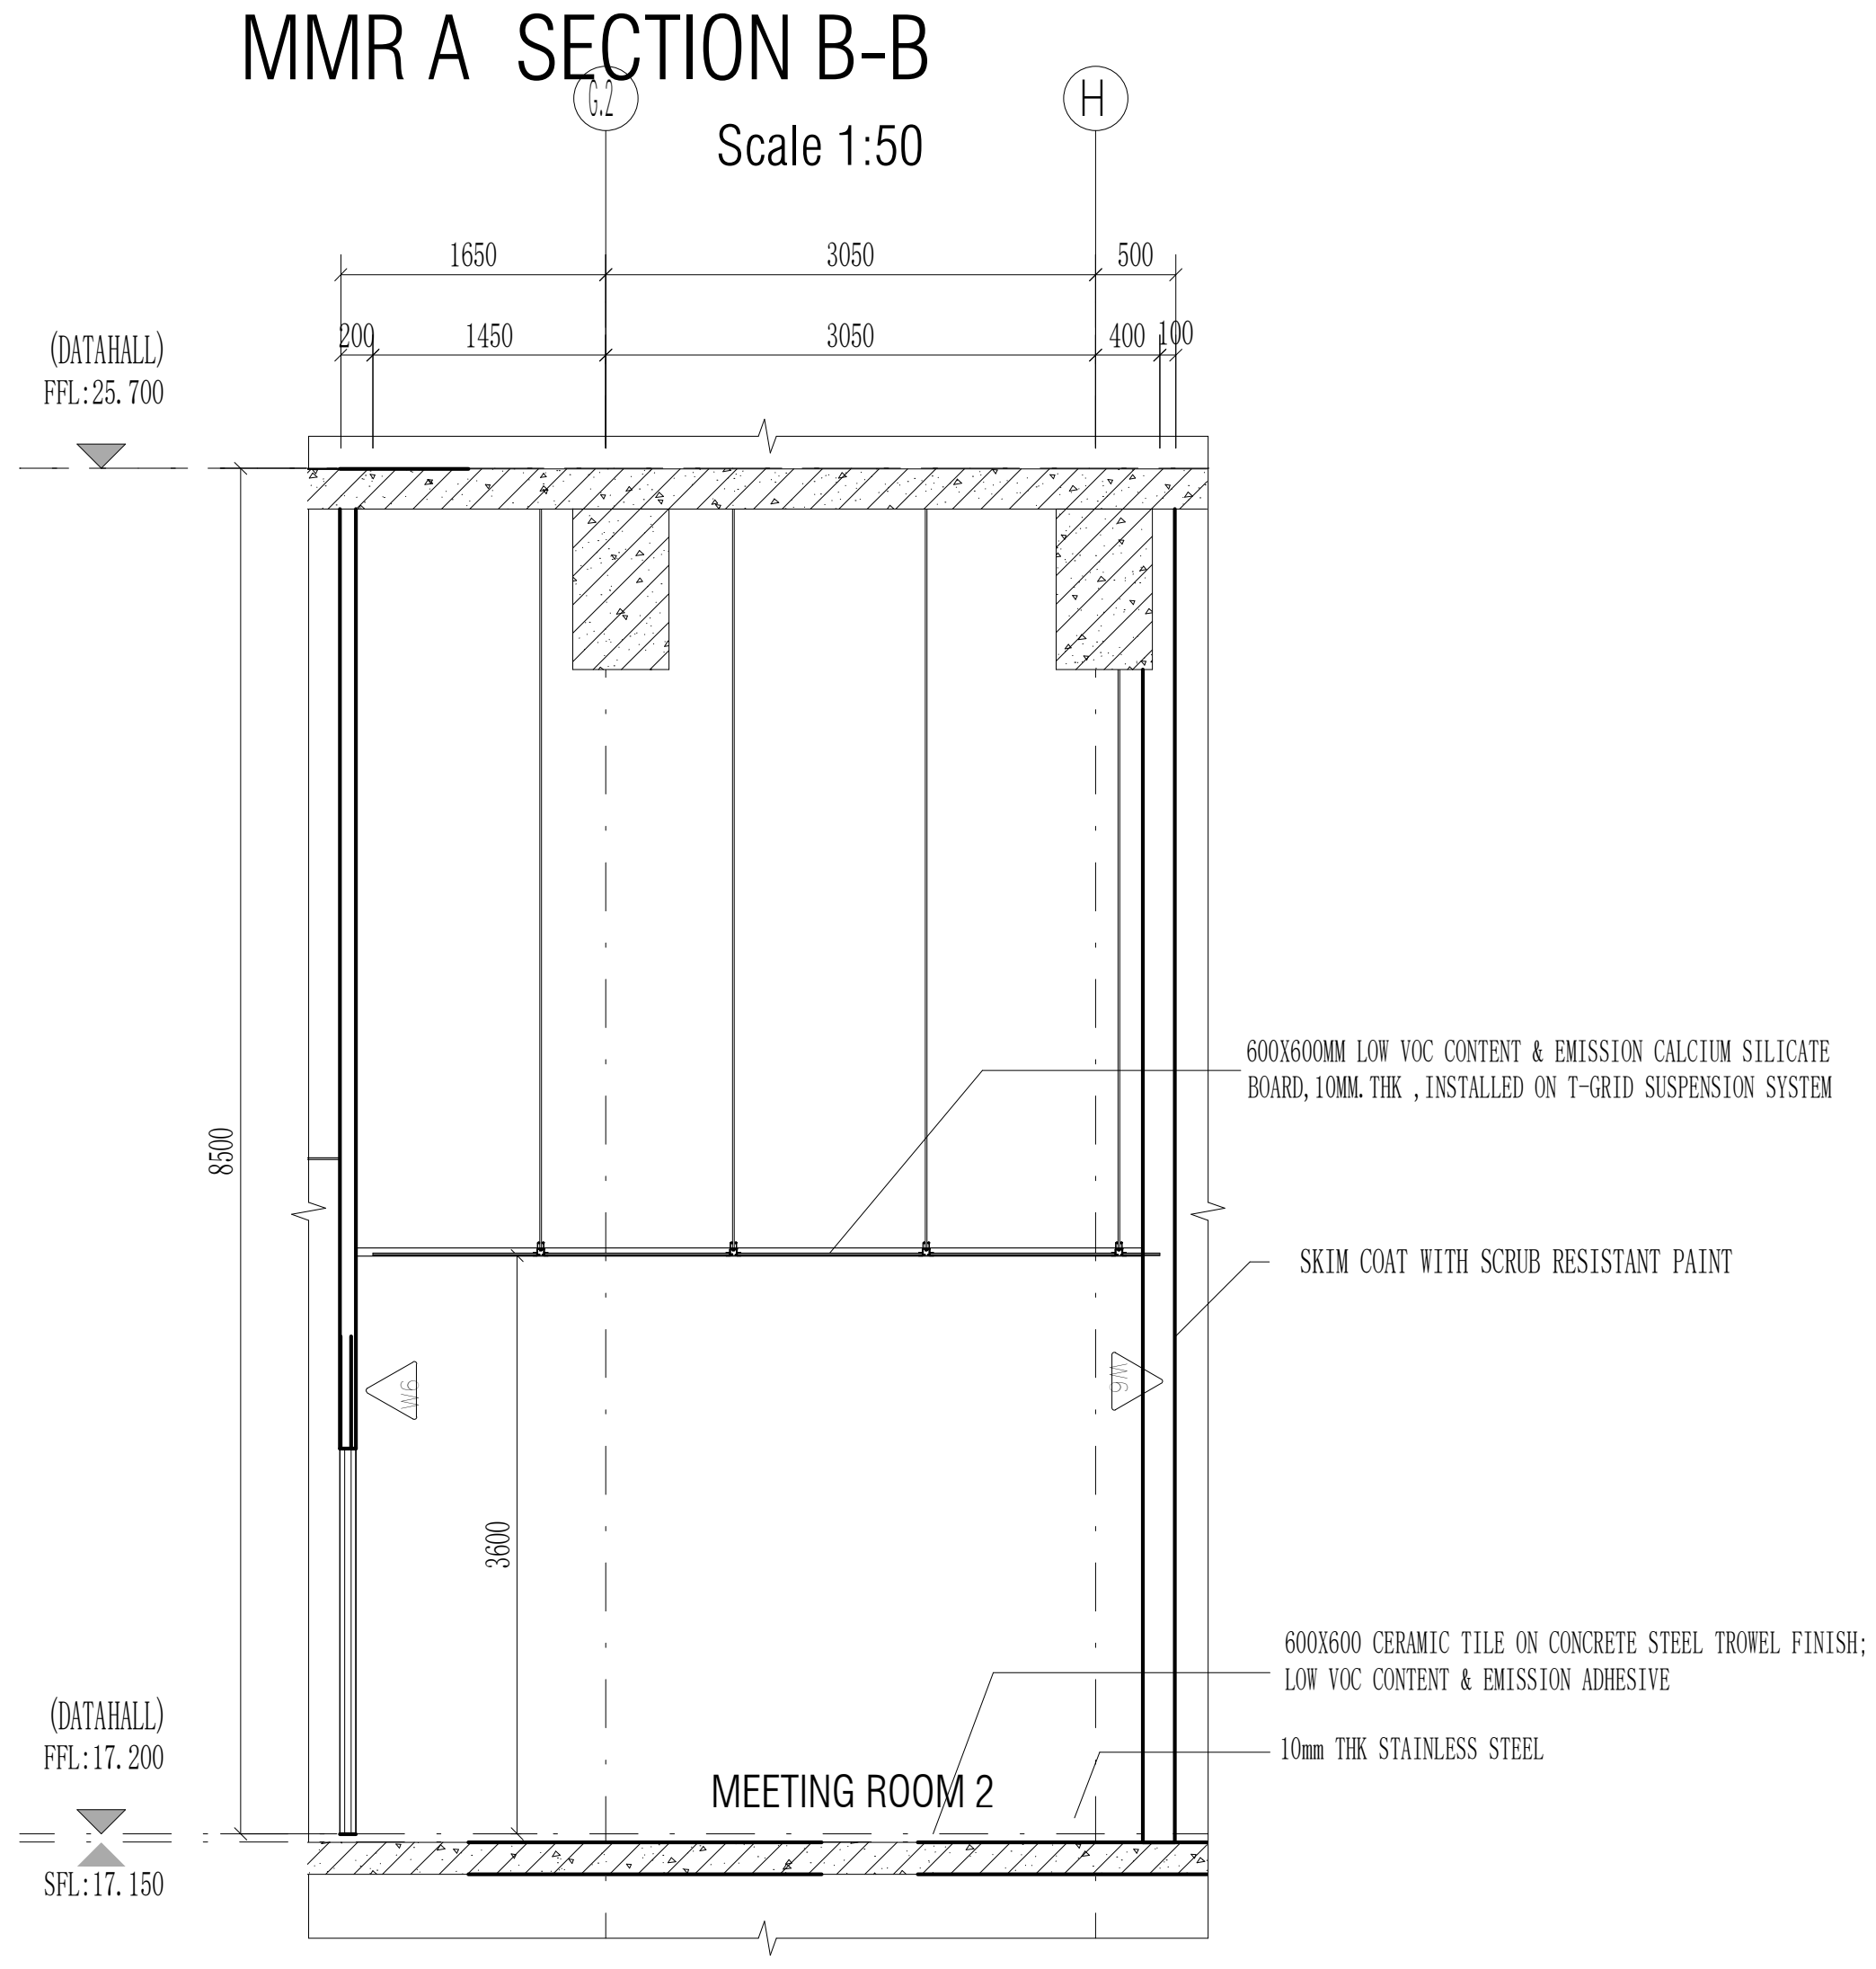
G.2
H
1650
3050
500
200
1450
400 100
(DATAHALL)
FFL:25.700
(DATAHALL)
FFL:17.200
SFL:17.150
8500
3600
W6
600X600MM LOW VOC CONTENT & EMISSION CALCIUM SILICATE BOARD,10MM.THK ,INSTALLED ON T-GRID SUSPENSION SYSTEM
SKIM COAT WITH SCRUB RESISTANT PAINT
600X600 CERAMIC TILE ON CONCRETE STEEL TROWEL FINISH;
LOW VOC CONTENT & EMISSION ADHESIVE
10mm THK STAINLESS STEEL
MEETING ROOM 2

MEETING ROOM 2 SECTION B-B

Scale 1:50

CLIENT :

GULF EDGE DC 01

87 Wireless Road, M Thai Tower 11th. Floor, All Seasons Place, Lumpini,
Pathumwan, Bangkok 10330, Thailand

CONTRACTOR :

华西发展(泰国)有限公司
บริษัท หัวซือ ดีเวลลอปเม้นต์ (ประเทศไทย) จำกัด
HUASHI DEVELOPMENT CO.,LTD
No. 202, Room No. 1403, 14/F, Le Concorde Building,
Ratchadapisek Road, Huaykhwang Sub-District,
Huaykhwang District, Bangkok Metropolitan 10310.

CONSULTANT :

ARbay
บริษัท เอ อาร์ เบย์ จำกัด
ARbay Company Limited
31 st Floor Bangkok Insurance Building
25 South Sathorn road Thungmahamek
Sathorn Bangkok 10120 THAILAND
T +66 (0) 2286 8199
F +66 (0) 2286 2863
info@arbay.co.th

CONSULTANT :

Qbic Engineers & Architects Co.,Ltd.
8 Soi KALONG 4 SANAMBINNAM ROAD,
THASAI SUB-DISTRICT, MUANG NONTHABURI DISTRICT
, NONTHABURI.
Tel 662-950-4374
Fax 662-580-3231
E-Mail : qbic@qbic.co.th, www.qbic.co.th
QBIC ENGINEERS AND ARCHITECTS CO.,LTD.

CONSULTANT :

MITR
MITR TECHNICAL CONSULTANT CO.,LTD.
1168/8 12th FLOOR, LUMPINI TOWER BUILDING,
RAMA IV RD., THUNGMAHAMEK, SATHORN, BANGKOK 10120, THAILAND
TEL : 0-2679-9079-84
FAX : 0-2679-9085 E-mail: mitr_dd@mitr.com

Architect : SIGNATURE
ประกิต พนานุรัตน์ วสถ. 580
ที่อยู่
251/1 ถ.จารุเมือง แขวงรองเมือง เขตปทุมวัน
กรุงเทพมหานคร โทรศัพท์ 02-286-8199

Structural Engineer : SIGNATURE
วิศวกรผู้ออกแบบโครงสร้าง
ณัฐสม สงวนวงษ์ วย 1423
ที่อยู่
2/1 ซ.รามคำแหง 150 ถ.รามคำแหง
แขวง สะพานสูง เขต สะพานสูง กทม. 10240

Structural Inspector : SIGNATURE
วิศวกรผู้ตรวจสอบโครงสร้าง
โกมล จุฑาภัทร วย 964
ที่อยู่
24/18 ซ.นวมินทร์ 129 ถ. นวมินทร์
แขวง นวลจันทร์ เขต บึงกุ่ม กทม. 10230

Electrical Engineer : SIGNATURE
วิศวกรผู้ออกแบบระบบไฟฟ้ากำลัง
นายสุภัทร บูรณวิทย์ วฟก.1265
ที่อยู่
21 ซอยทานสัมฤทธิ์ 13
ตำบลท่าทราย อ.เมืองนนทบุรี จ.นนทบุรี 11000

Mechanical Engineer : SIGNATURE
วิศวกรผู้ออกแบบระบบเครื่องกลและปรับอากาศ
นายประสิทธิ์ เกี้ยวสุนทร วก.1221
ที่อยู่
44/372 ซอยบางกระดี่ 35/1 แขวงแสมดำ
เขตบางขุนเทียน กทม. 10150
ประสิทธิ์

Sanitary Engineer : SIGNATURE
วิศวกรผู้ออกแบบระบบสุขาภิบาล และดับเพลิง
นายทศวรรษ สนั่นฤทธิ์ วส. 215
ที่อยู่
บ้านเลขที่ 99/107 หมู่ที่ 3 ต.ศีรษะจรเข้น้อย
อ.บางเสาธง จ.สมุทรปราการ 10540
ทศวรรษ

ISSUE/REVISION

REV.	DESCRIPTION	DATE
A	90% DEVELOPED	09/05/2026

PROJECT NAME :

GEDC 01

LOCATION:
Nikhom Phattana district, Rayong ,industrial estate,CPGC

BUILDING :
MAIN BUILDING

90% DEVELOPED

TITLE :

ROOM DETAIL-3F-SERVERROOM A,
ELECTRICALROOMA, MMR A,
CUSTOMERMEETING ROOM 02

JOB NO.		SCALE	1 : 50
DRAWN	NXR	REF.	
CHECKED	LJC	DWG. NO.	MPK01A-90-A-RD-311
APPROVED	LXD		
DATE	2026.05.09		

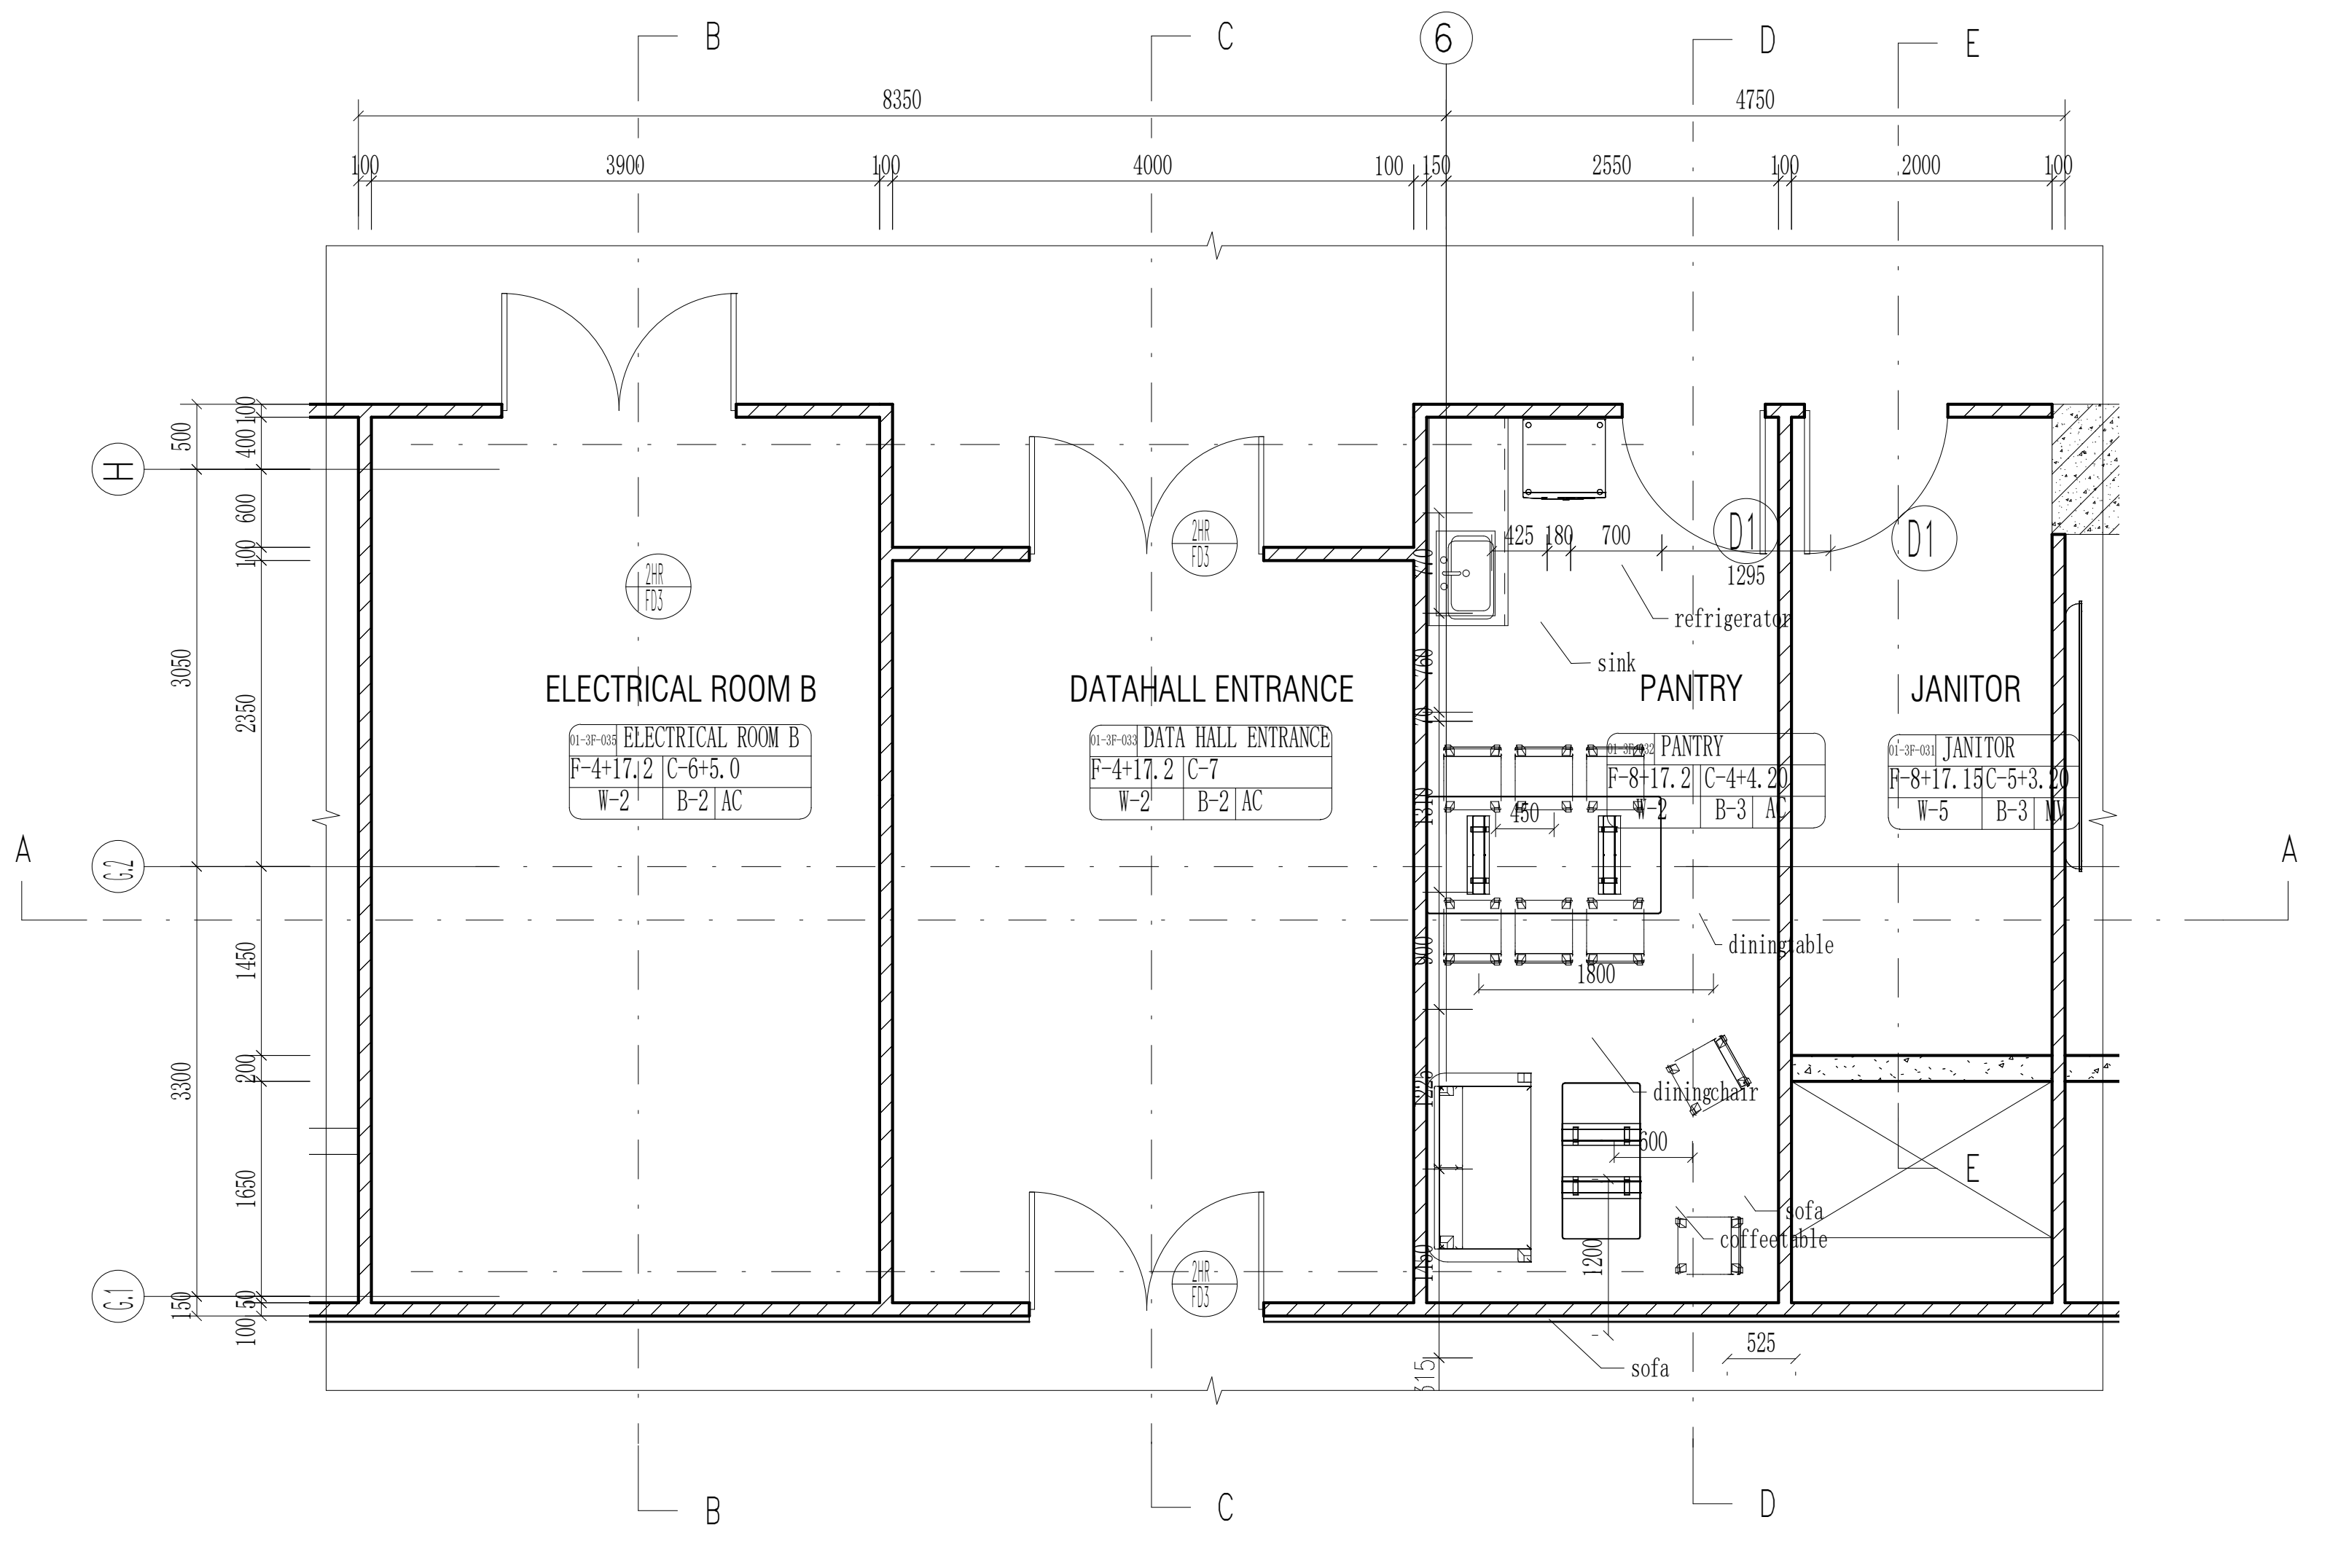
B
C
6
D
E
8350
4750
100
3900
100
4000
100
150
2550
100
2000
100
H
G.2
G.1
A
A
500
400
100
600
100
3050
2350
1450
3300
200
1650
150
50
100
ELECTRICAL ROOM B
01-3F-035 ELECTRICAL ROOM B
F-4+17.2 C-6+5.0
W-2 B-2 AC
DATAHALL ENTRANCE
01-3F-033 DATA HALL ENTRANCE
F-4+17.2 C-7
W-2 B-2 AC
2HR FD3
PANTRY
01-3F-032 PANTRY
F-8+17.2 C-4+4.20
W-2 B-3 AC
JANITOR
01-3F-031 JANITOR
F-8+17.15 C-5+3.20
W-5 B-3 MV
D1
D1
425
180
700
1295
refrigerator
sink
450
diningtable
1800
diningchair
600
sofa
coffeetable
1200
sofa
525
515
E

ELECTRICAL ROOM B、DATAHALLENTRANCE、PANTRY、JANITOR PLAN

Scale 1:50

THE "SFL" MARKED IN THE DRAWING REFERS TO
THE STRUCTURAL FLOOR LEVEL, WHILE THE
FINISHED FLOOR LEVEL (FFL) IS DETERMINED BASED
ON FLOOR FINISHES.

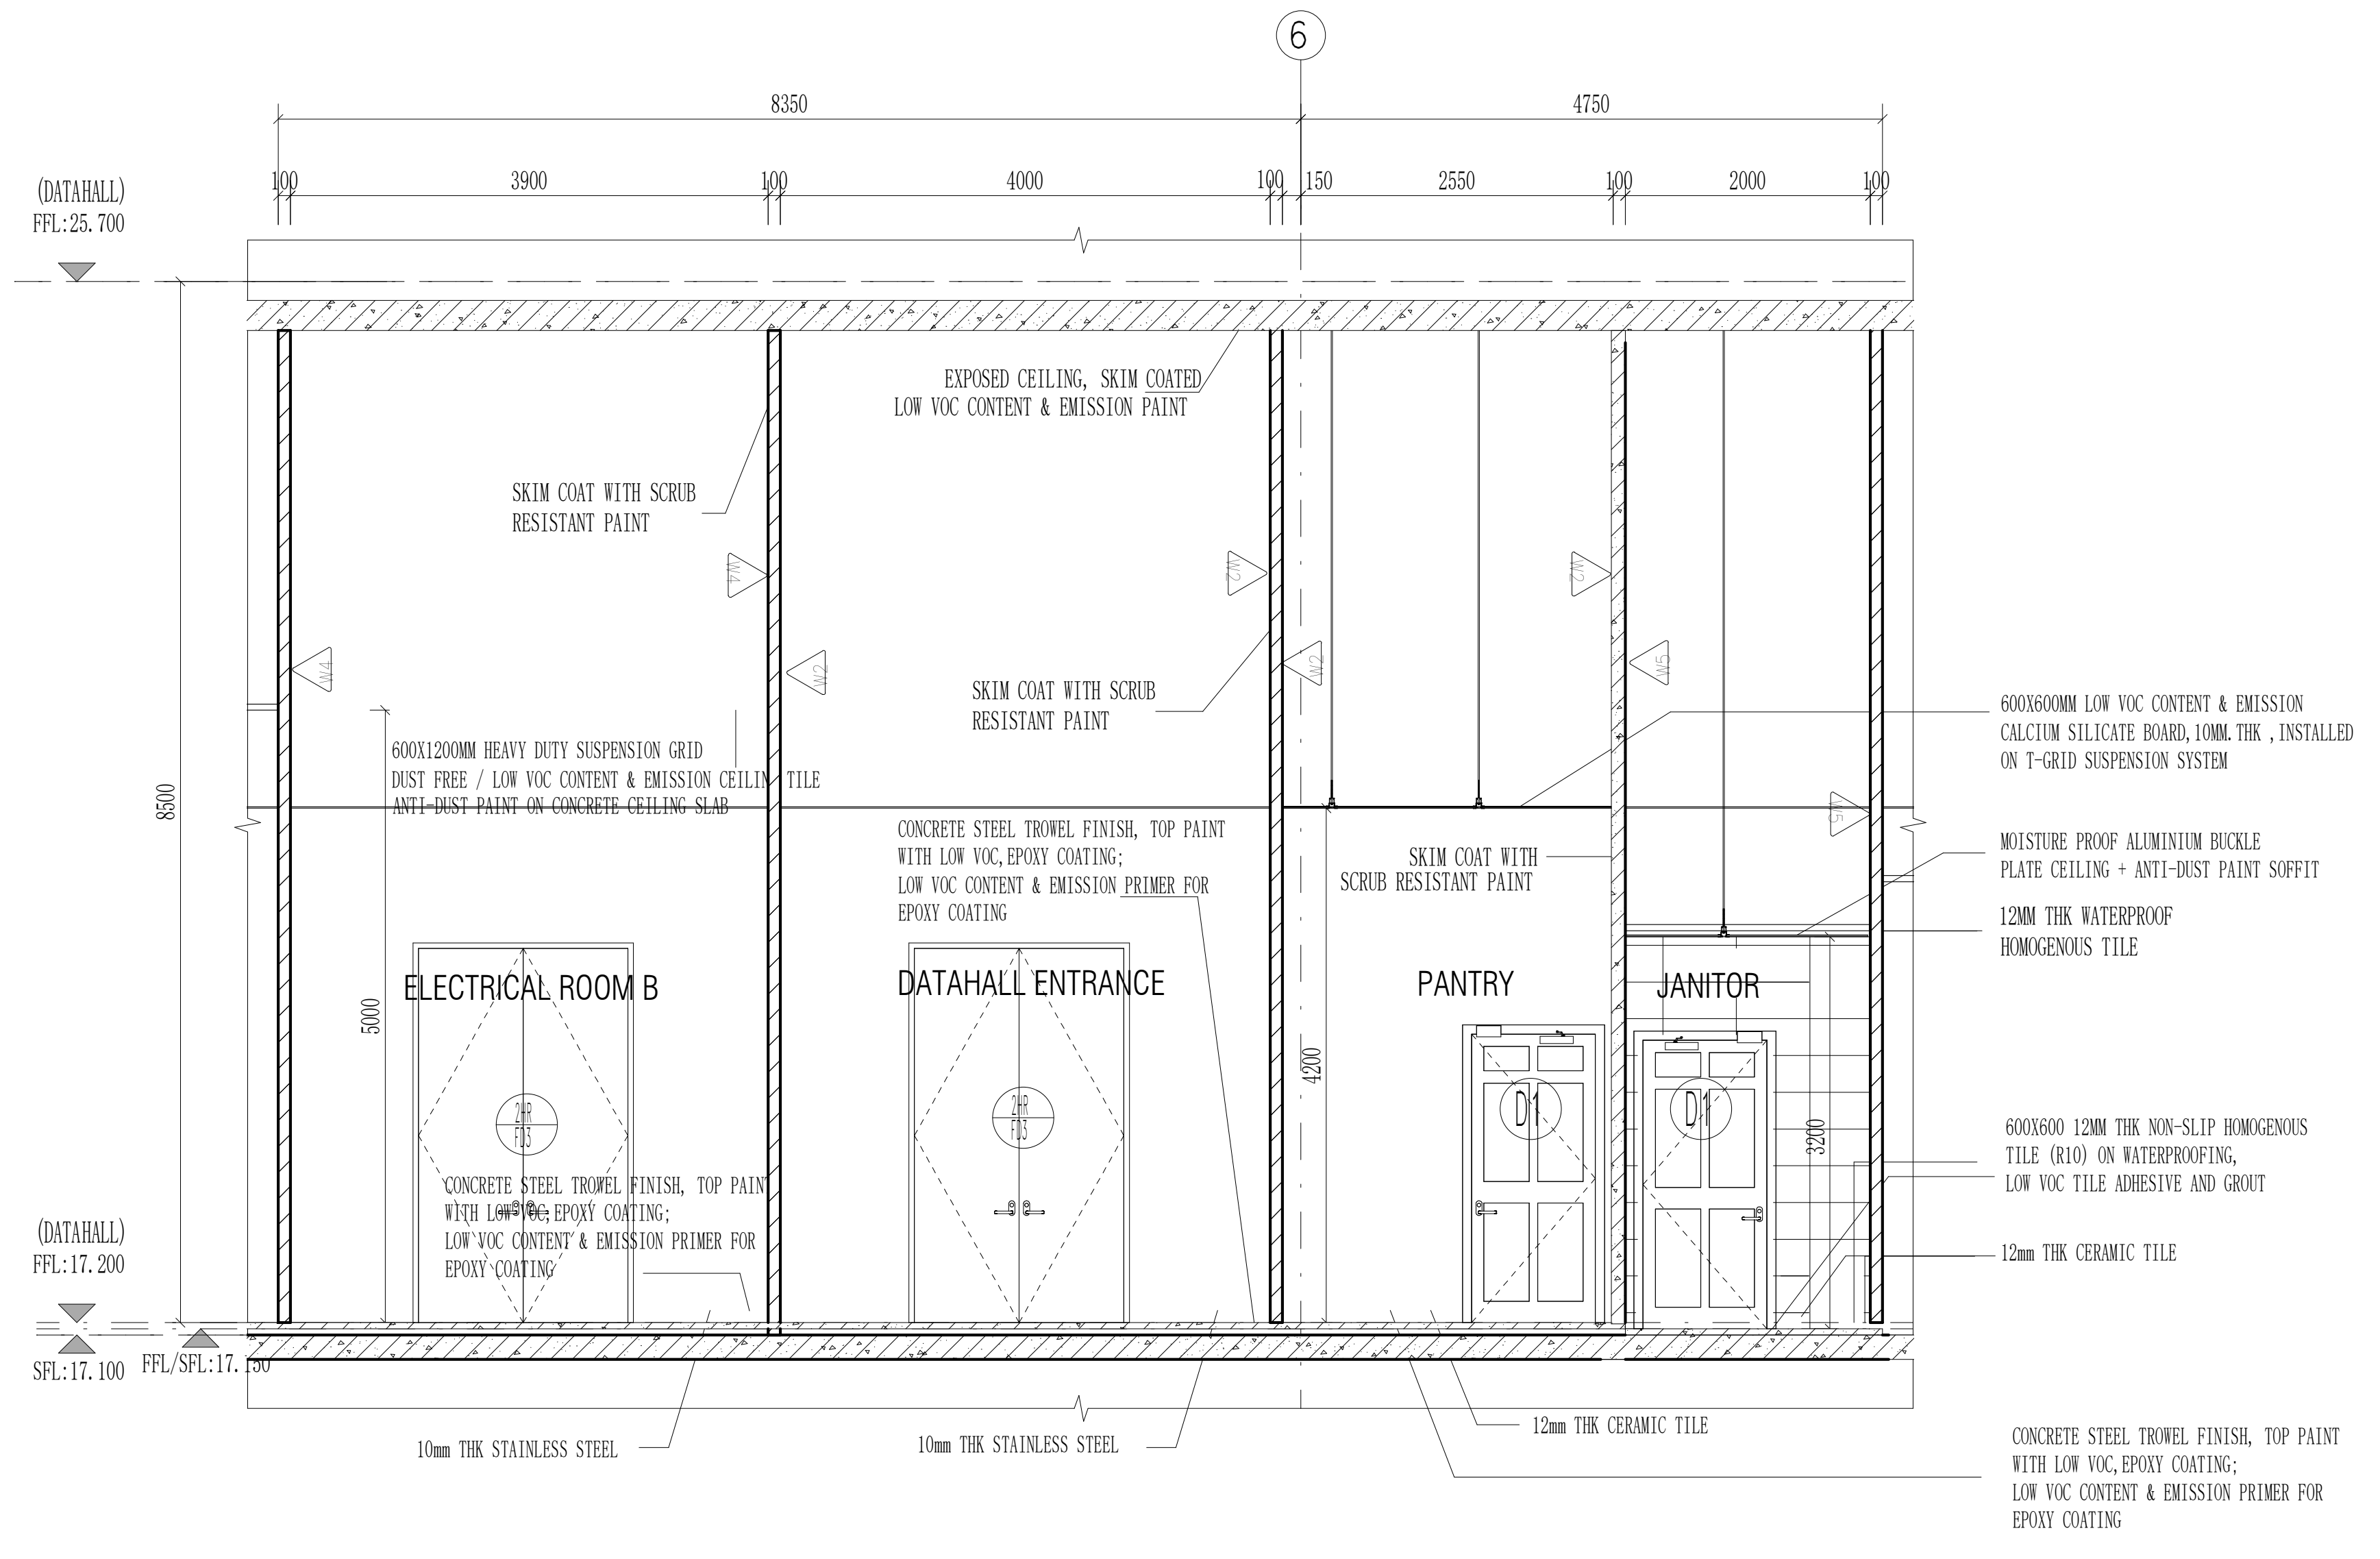
6
8350
4750
100
3900
100
4000
100
150
2550
100
2000
100
(DATAHALL)
FFL:25.700
EXPOSED CEILING, SKIM COATED
LOW VOC CONTENT & EMISSION PAINT
SKIM COAT WITH SCRUB
RESISTANT PAINT
SKIM COAT WITH SCRUB
RESISTANT PAINT
600X1200MM HEAVY DUTY SUSPENSION GRID
DUST FREE / LOW VOC CONTENT & EMISSION CEILING TILE
ANTI-DUST PAINT ON CONCRETE CEILING SLAB
CONCRETE STEEL TROWEL FINISH, TOP PAINT
WITH LOW VOC,EPOXY COATING;
LOW VOC CONTENT & EMISSION PRIMER FOR
EPOXY COATING
SKIM COAT WITH
SCRUB RESISTANT PAINT
600X600MM LOW VOC CONTENT & EMISSION
CALCIUM SILICATE BOARD,10MM.THK ,INSTALLED
ON T-GRID SUSPENSION SYSTEM
MOISTURE PROOF ALUMINIUM BUCKLE
PLATE CEILING + ANTI-DUST PAINT SOFFIT
12MM THK WATERPROOF
HOMOGENOUS TILE
8500
5000
4200
3200
ELECTRICAL ROOM B
DATAHALL ENTRANCE
PANTRY
JANITOR
2HR FD3
D1
D1
600X600 12MM THK NON-SLIP HOMOGENOUS
TILE (R10) ON WATERPROOFING,
LOW VOC TILE ADHESIVE AND GROUT
12mm THK CERAMIC TILE
CONCRETE STEEL TROWEL FINISH, TOP PAINT
WITH LOW VOC,EPOXY COATING;
LOW VOC CONTENT & EMISSION PRIMER FOR
EPOXY COATING
(DATAHALL)
FFL:17.200
SFL:17.100
FFL/SFL:17.150
10mm THK STAINLESS STEEL
10mm THK STAINLESS STEEL
12mm THK CERAMIC TILE
CONCRETE STEEL TROWEL FINISH, TOP PAINT
WITH LOW VOC,EPOXY COATING;
LOW VOC CONTENT & EMISSION PRIMER FOR
EPOXY COATING

ELECTRICAL ROOM B、DATAHALLENTRANCE、PANTRY、JANITOR SECTION A-A

Scale 1:50

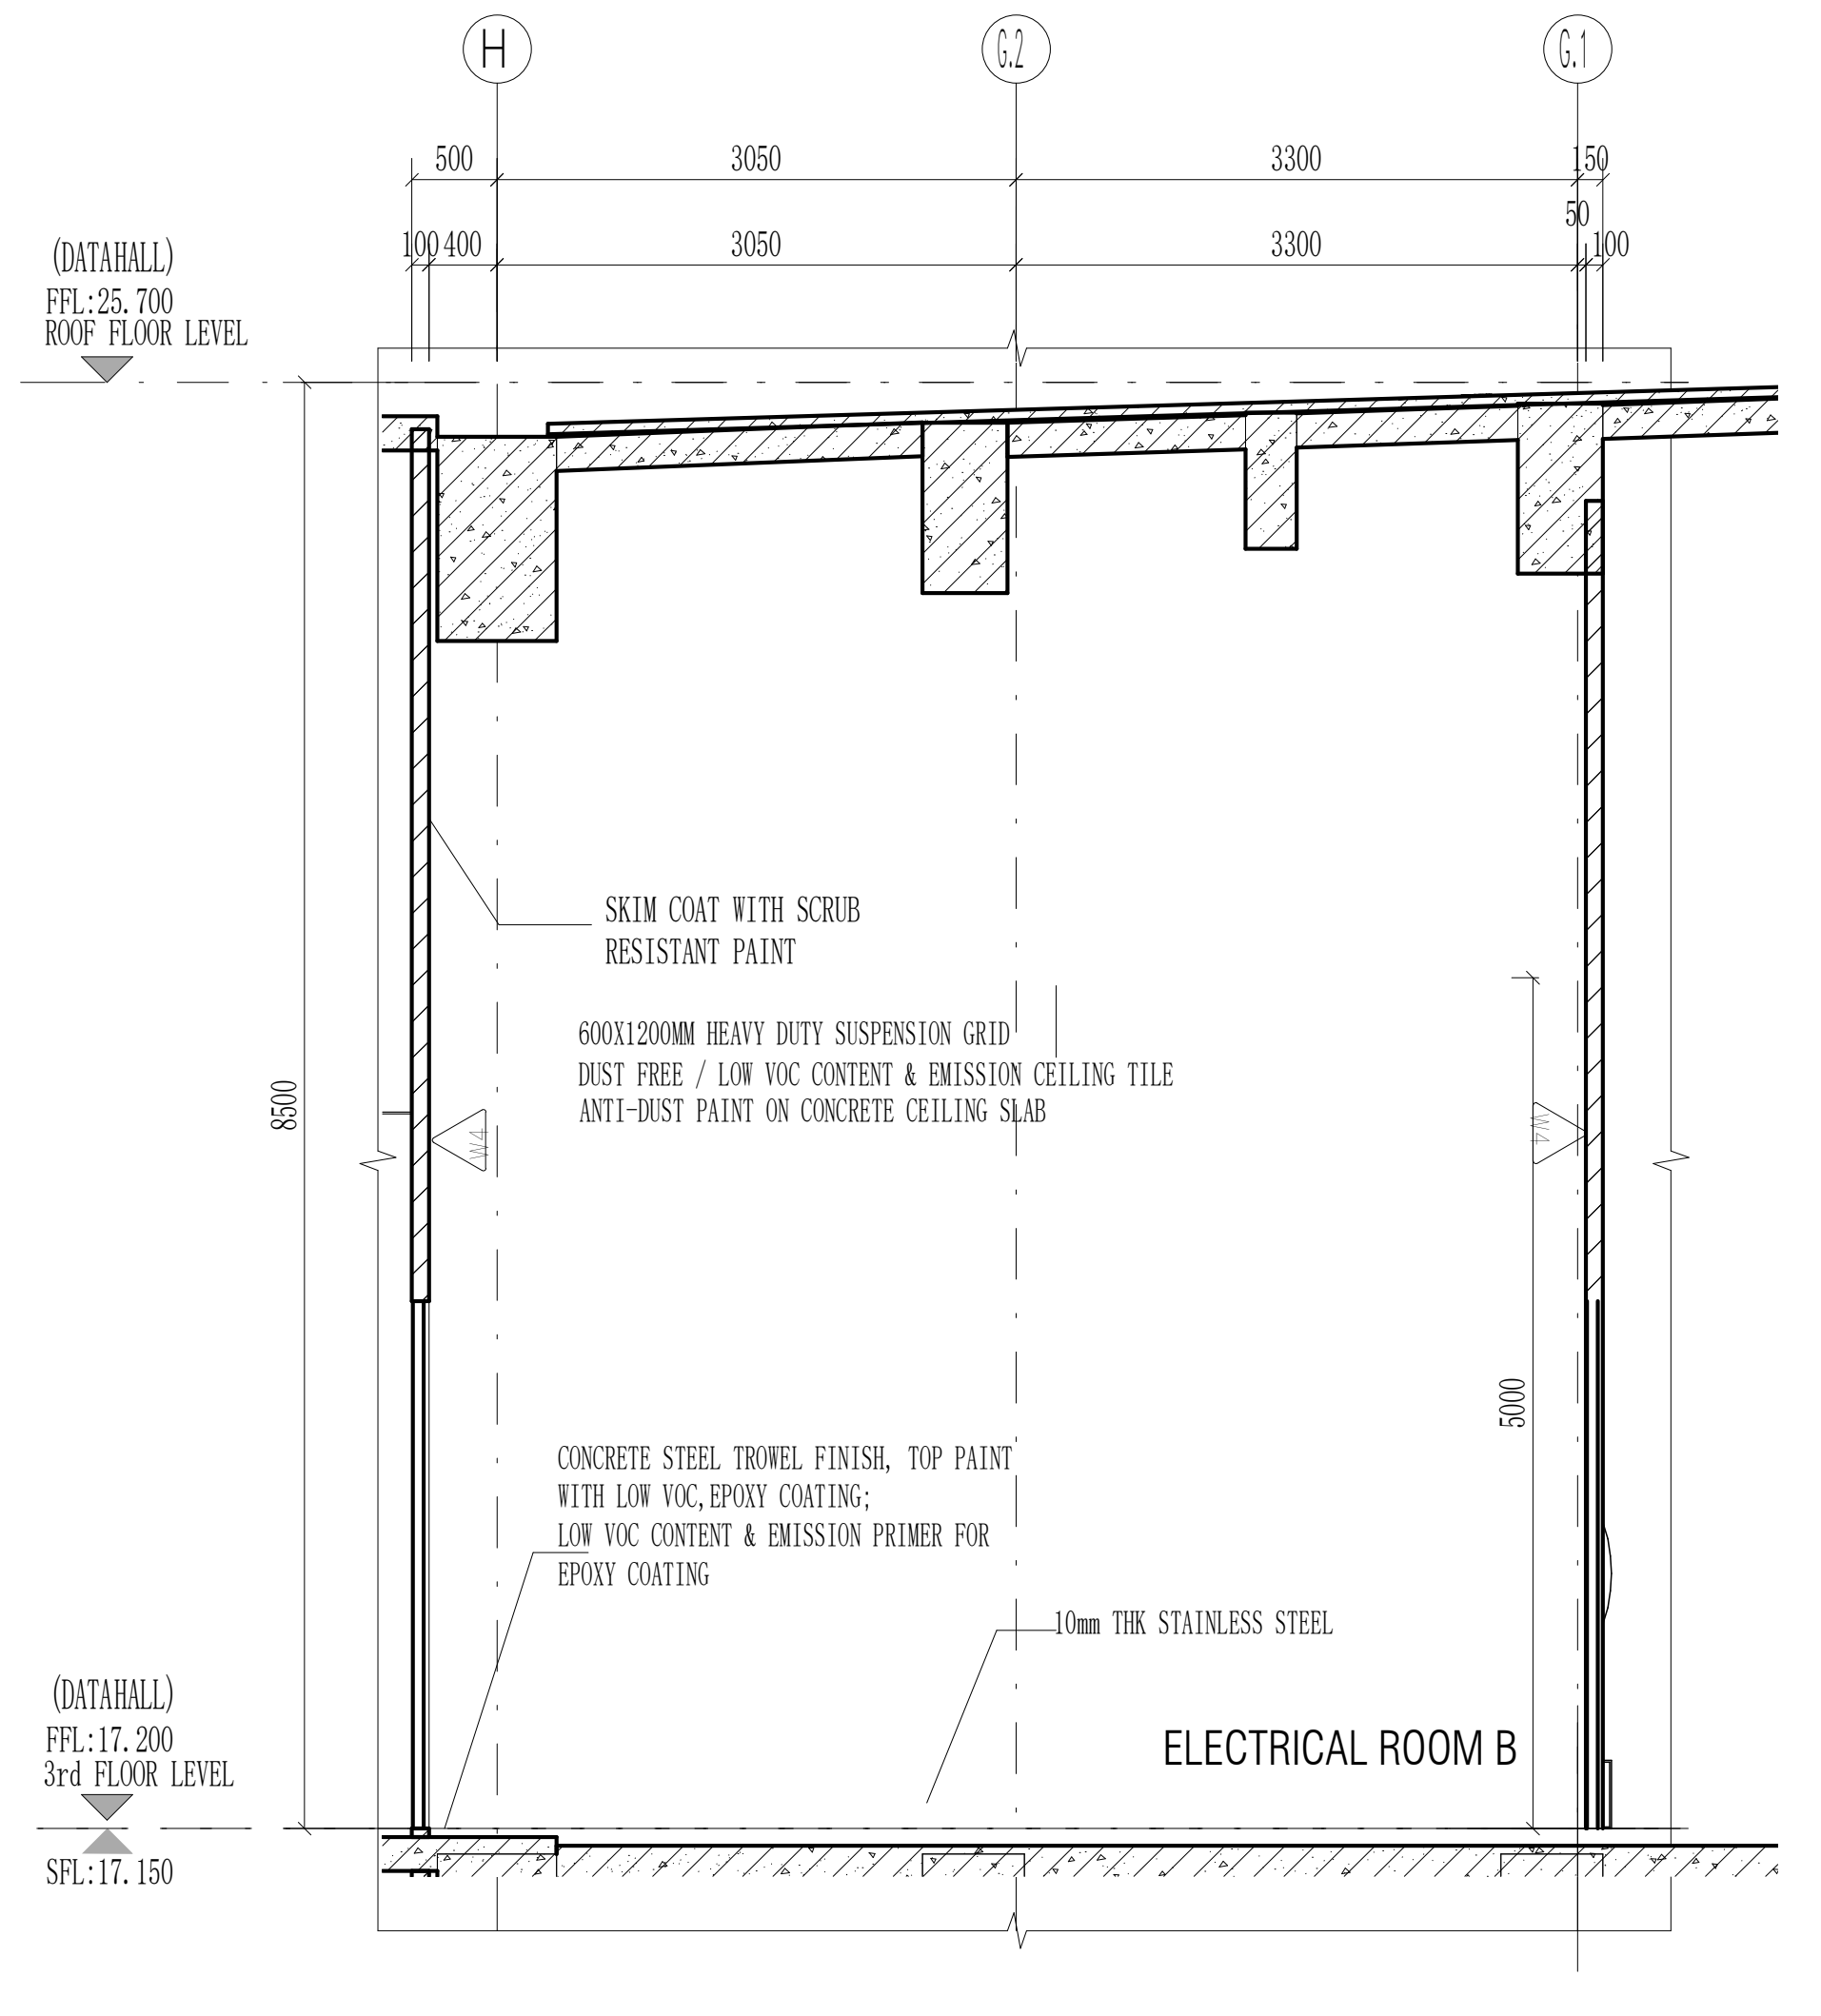
H
G.2
G.1
500
3050
3300
150
100
400
3050
3300
50
100
(DATAHALL)
FFL:25.700
ROOF FLOOR LEVEL
SKIM COAT WITH SCRUB
RESISTANT PAINT
600X1200MM HEAVY DUTY SUSPENSION GRID
DUST FREE / LOW VOC CONTENT & EMISSION CEILING TILE
ANTI-DUST PAINT ON CONCRETE CEILING SLAB
8500
5000
CONCRETE STEEL TROWEL FINISH, TOP PAINT
WITH LOW VOC,EPOXY COATING;
LOW VOC CONTENT & EMISSION PRIMER FOR
EPOXY COATING
10mm THK STAINLESS STEEL
ELECTRICAL ROOM B
(DATAHALL)
FFL:17.200
3rd FLOOR LEVEL
SFL:17.150

ELECTRICAL ROOM B SECTION B-B

Scale 1:50

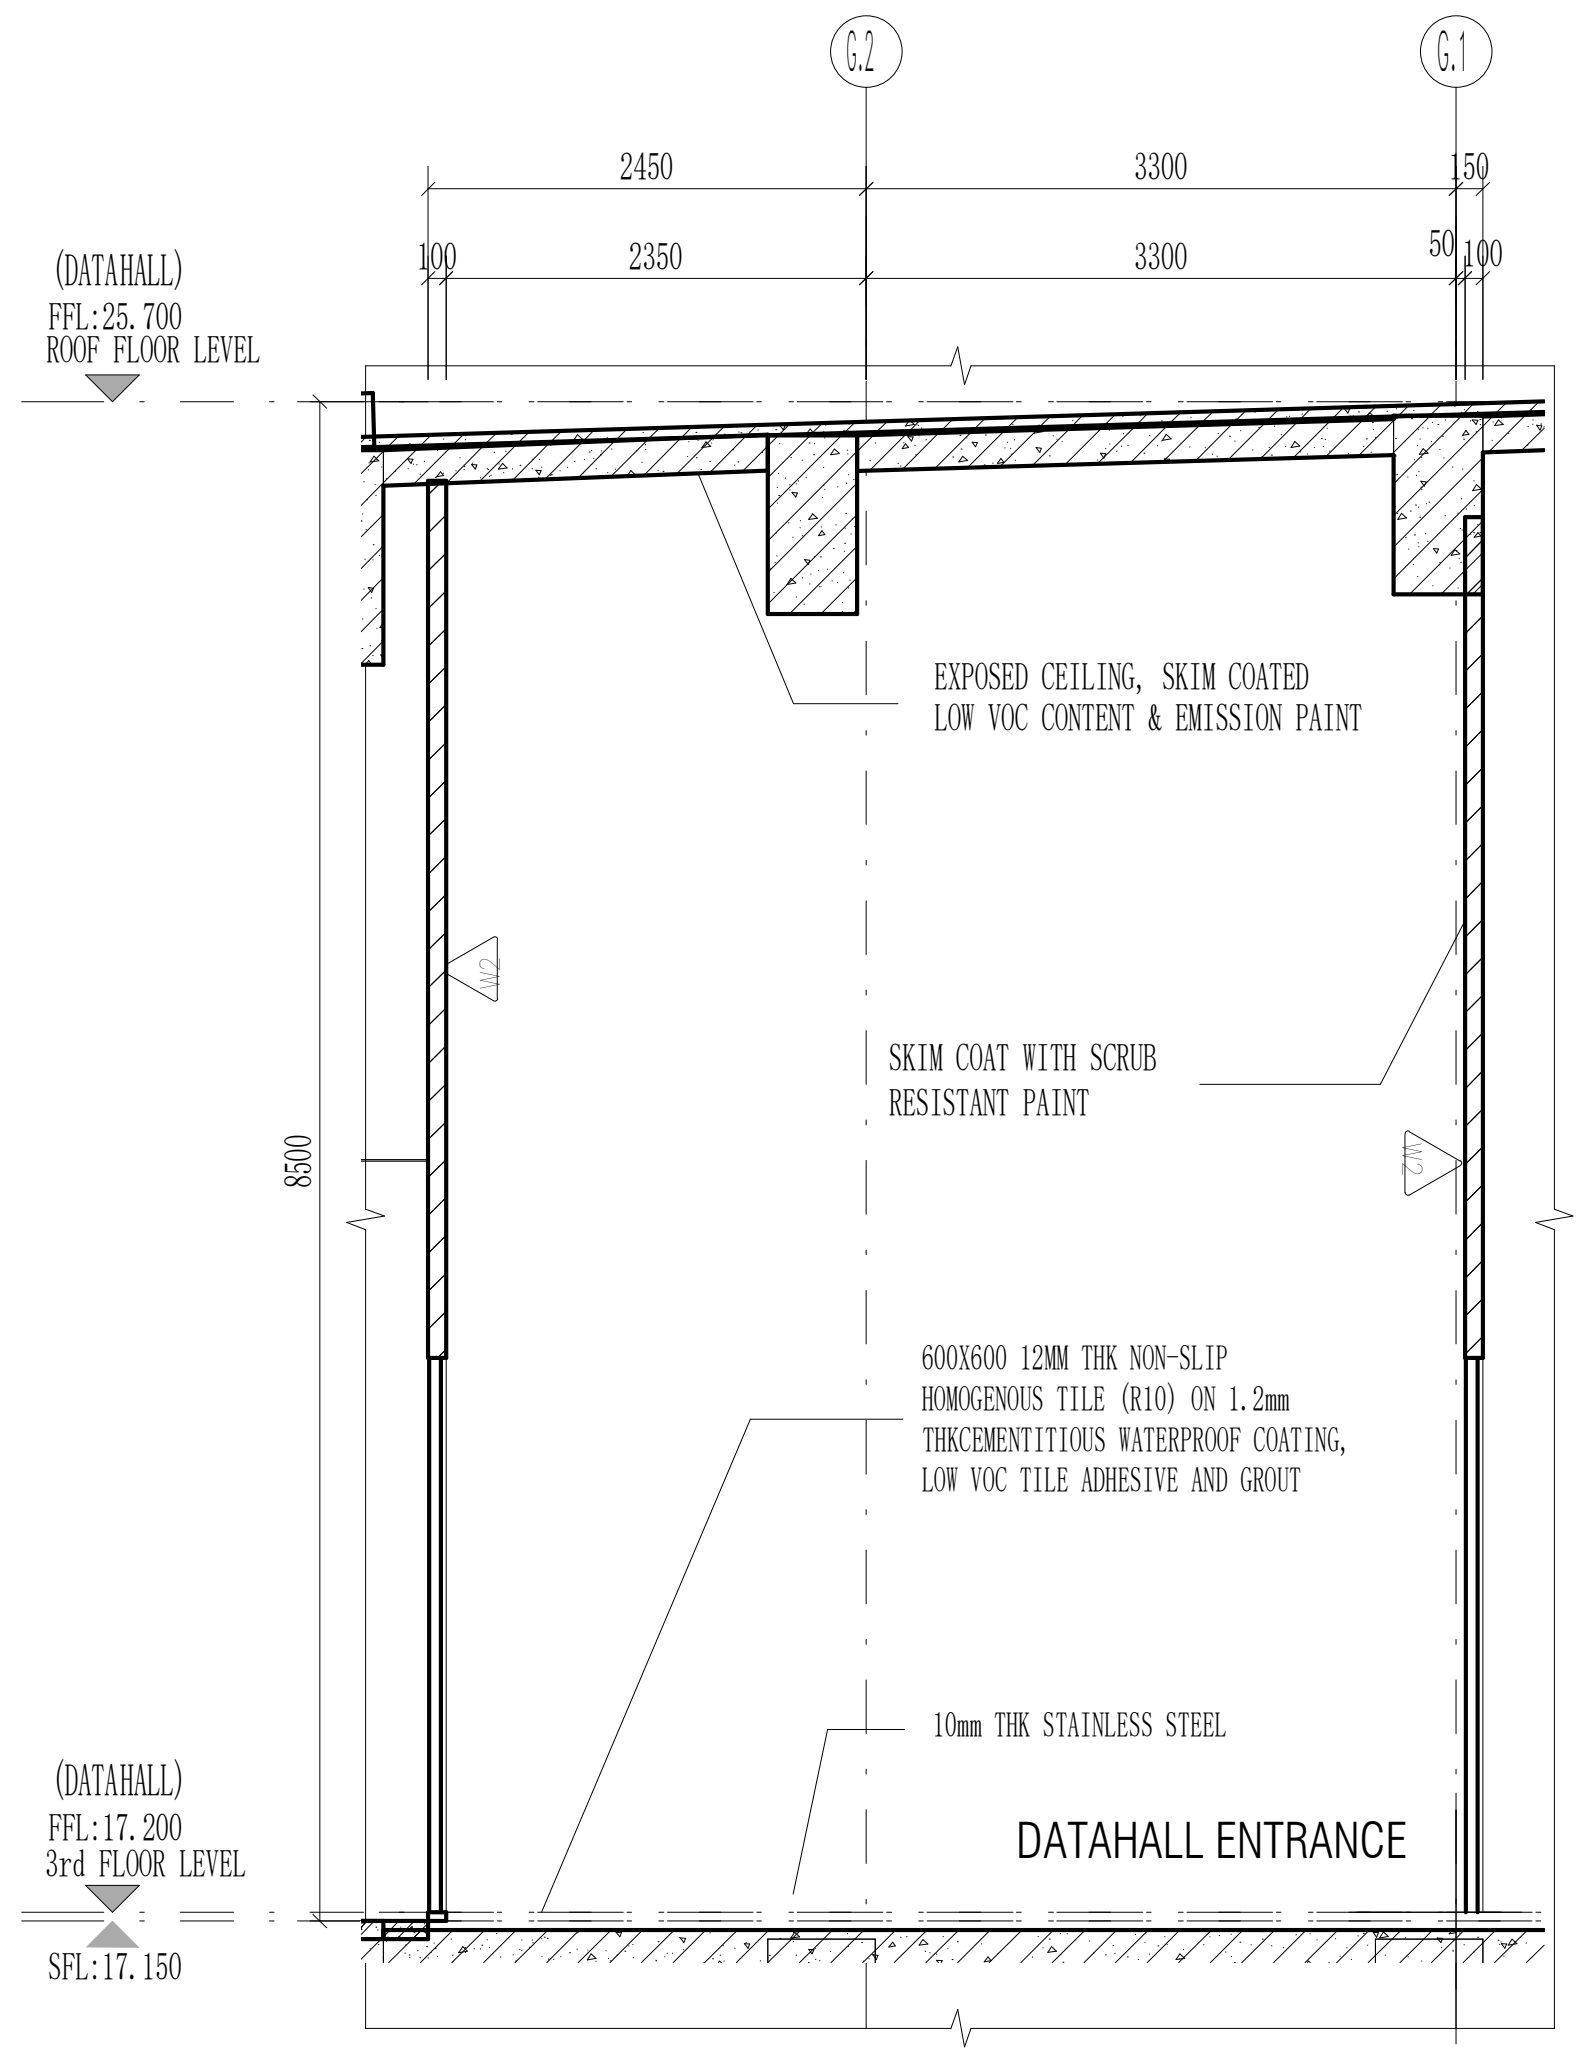
G.2
G.1
2450
3300
50
100
2350
3300
50
100
(DATAHALL)
FFL:25.700
ROOF FLOOR LEVEL
EXPOSED CEILING, SKIM COATED
LOW VOC CONTENT & EMISSION PAINT
SKIM COAT WITH SCRUB
RESISTANT PAINT
8500
600X600 12MM THK NON-SLIP
HOMOGENOUS TILE (R10) ON 1.2mm
THKCEMENTITIOUS WATERPROOF COATING,
LOW VOC TILE ADHESIVE AND GROUT
10mm THK STAINLESS STEEL
DATAHALL ENTRANCE
(DATAHALL)
FFL:17.200
3rd FLOOR LEVEL
SFL:17.150

DATAHALLENTRANCE SECTION C-C

Scale 1:50

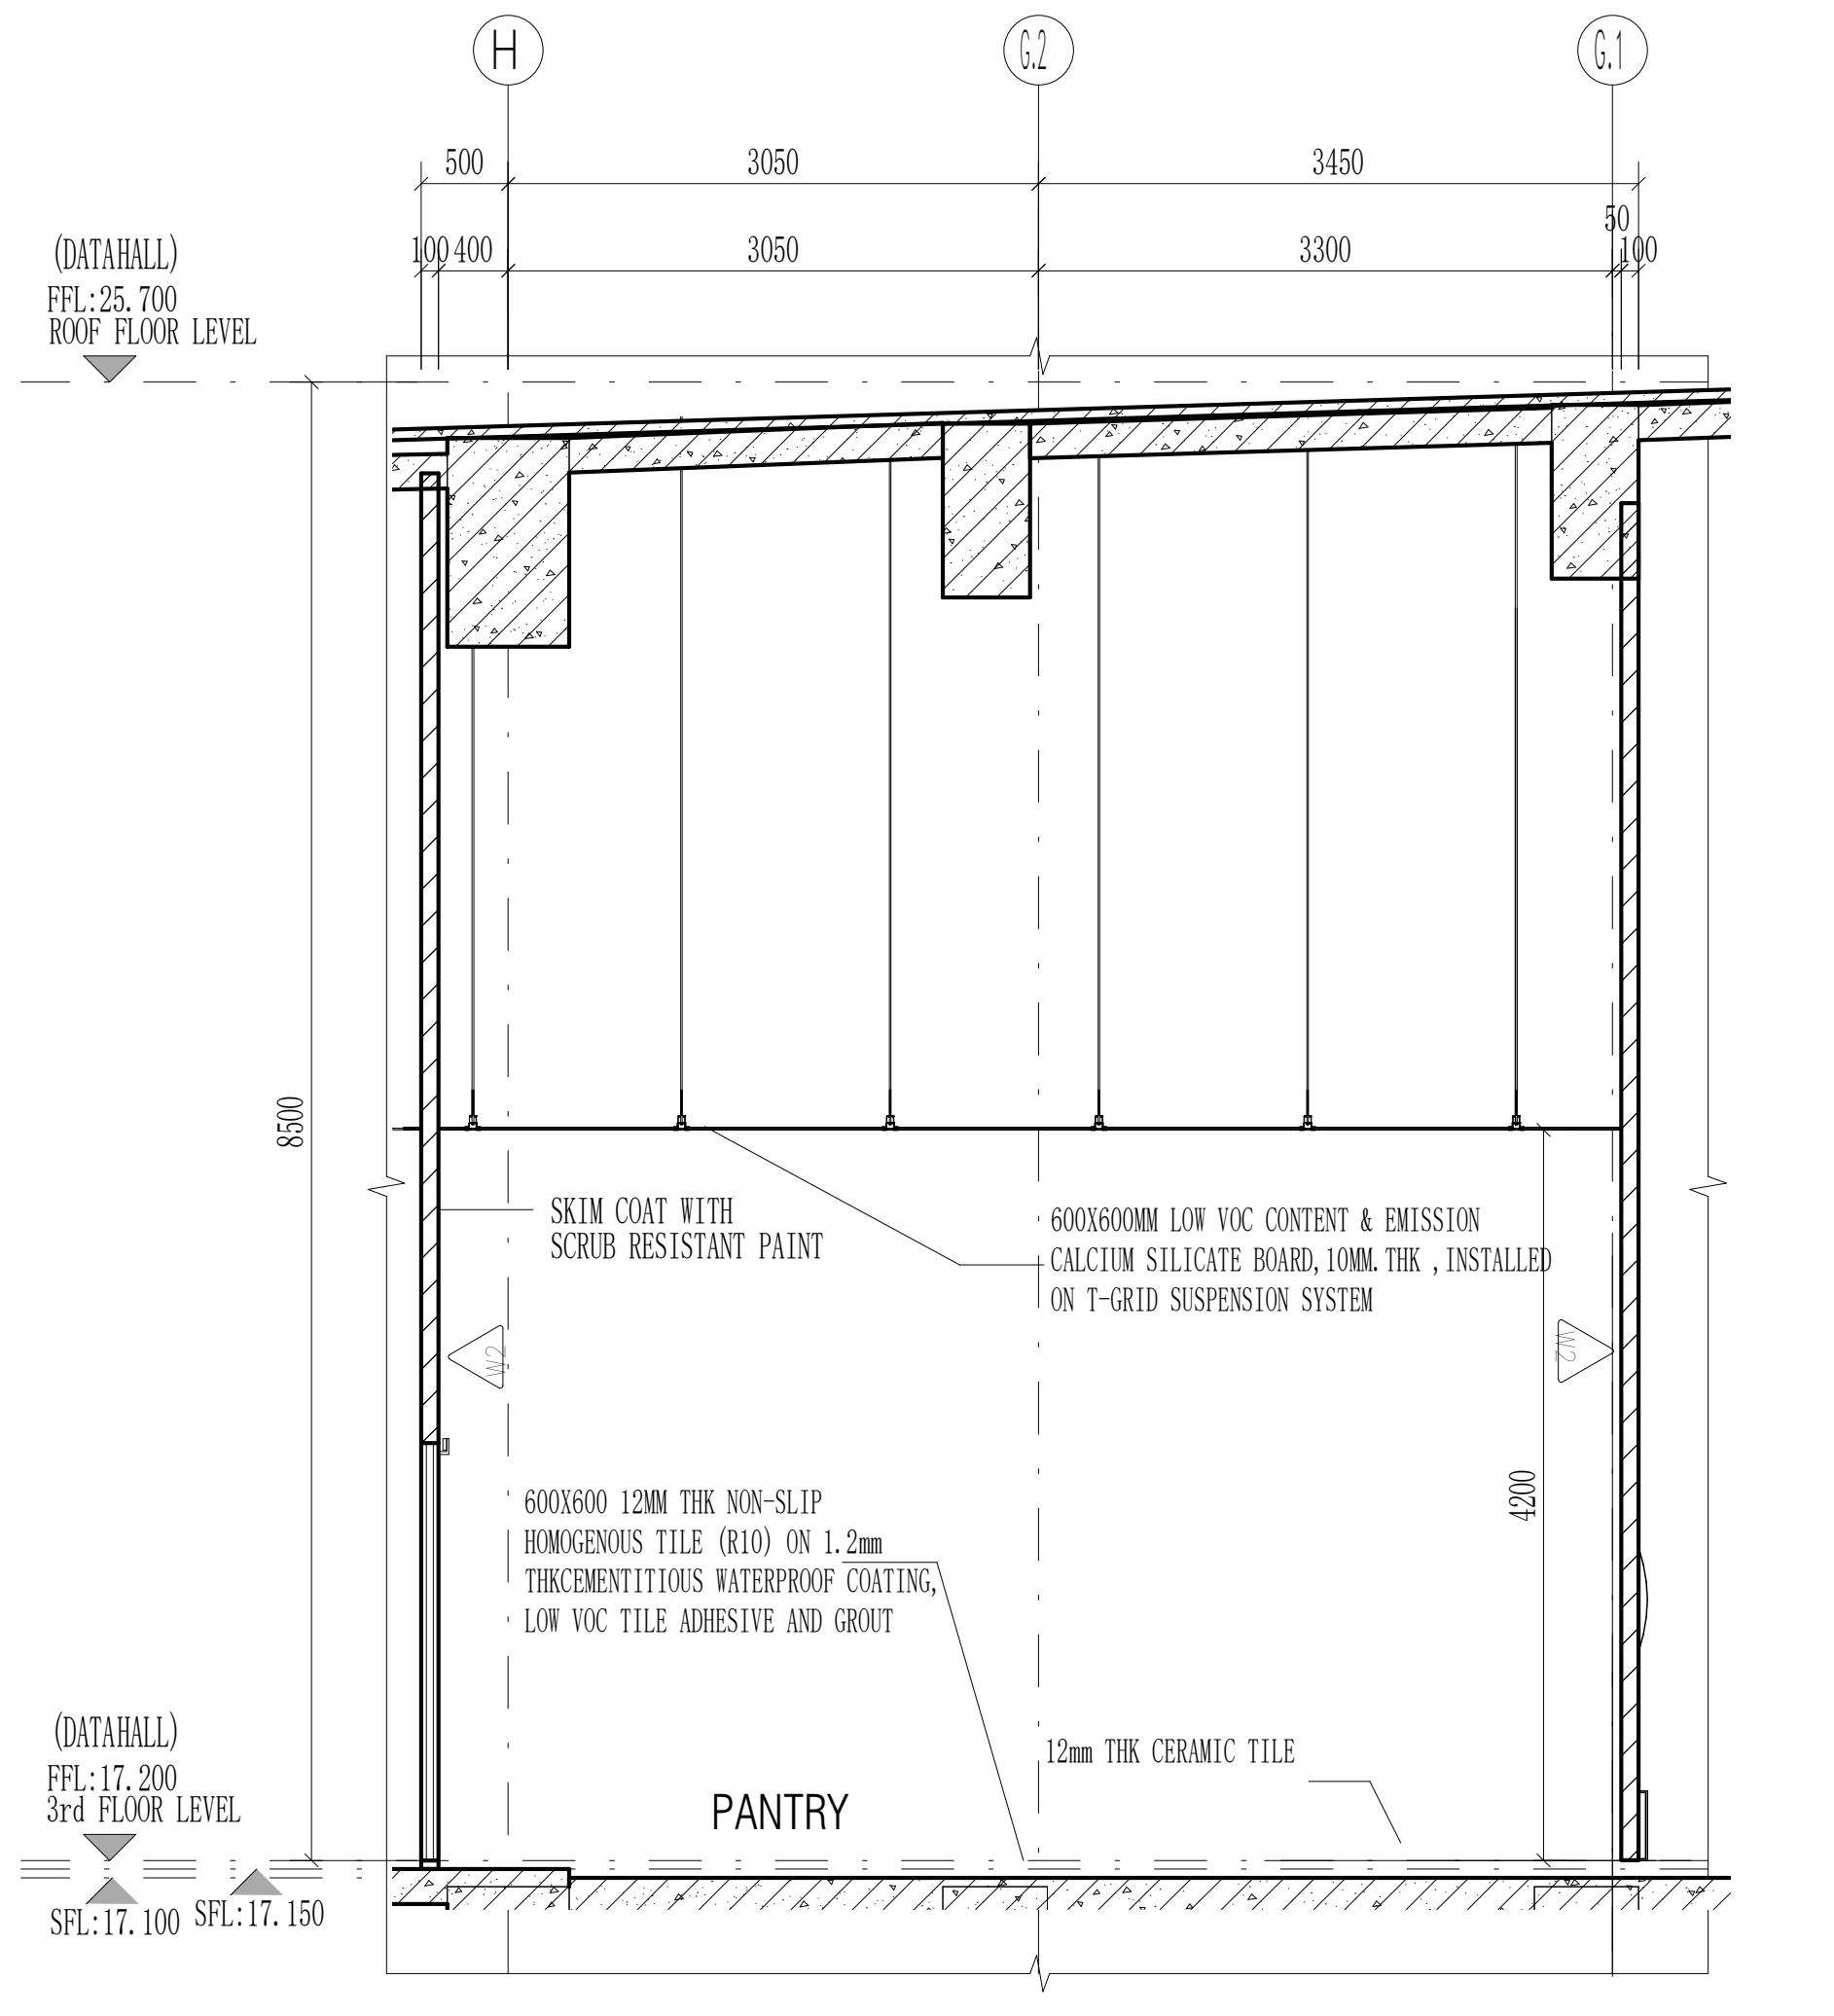
H
G.2
G.1
500
3050
3450
100
400
3050
3300
100
(DATAHALL)
FFL:25.700
ROOF FLOOR LEVEL
8500
SKIM COAT WITH
SCRUB RESISTANT PAINT
600X600MM LOW VOC CONTENT & EMISSION
CALCIUM SILICATE BOARD,10MM.THK ,INSTALLED
ON T-GRID SUSPENSION SYSTEM
600X600 12MM THK NON-SLIP
HOMOGENOUS TILE (R10) ON 1.2mm
THKCEMENTITIOUS WATERPROOF COATING,
LOW VOC TILE ADHESIVE AND GROUT
4200
12mm THK CERAMIC TILE
PANTRY
(DATAHALL)
FFL:17.200
3rd FLOOR LEVEL
SFL:17.100
SFL:17.150

PANTRY SECTION D-D

Scale 1:50

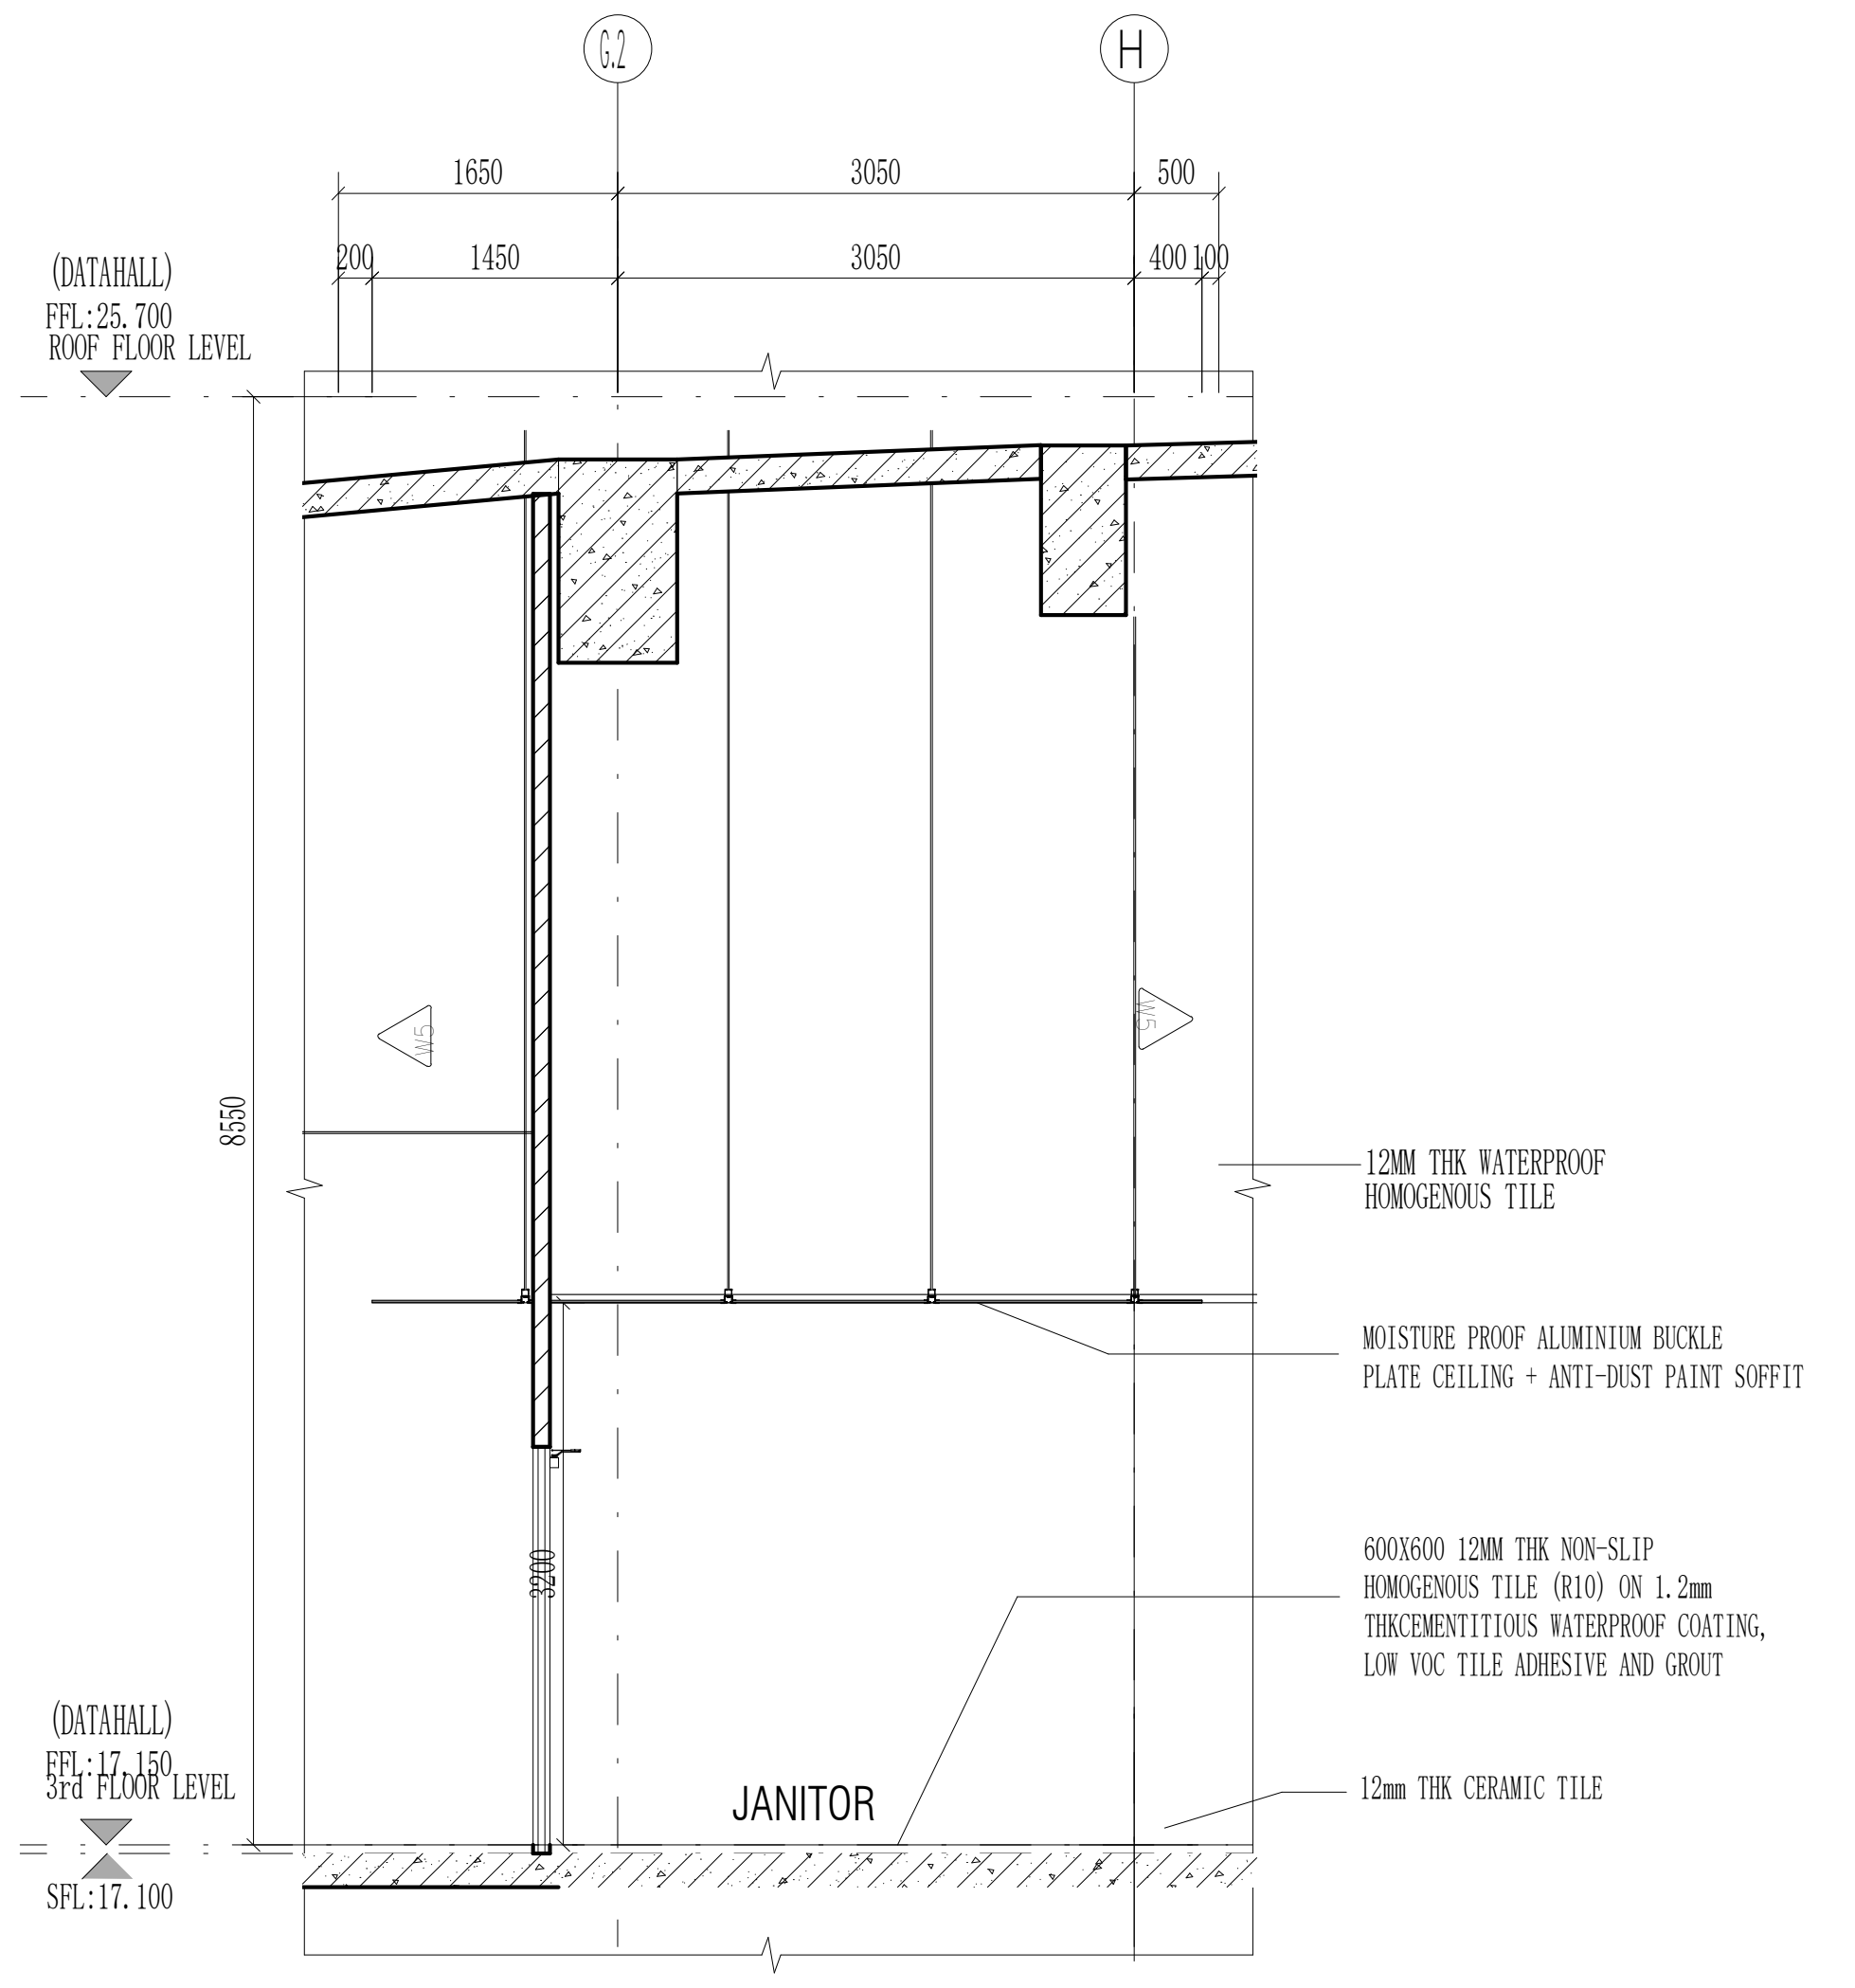
G.2
H
1650
3050
500
200
1450
3050
400
100
(DATAHALL)
FFL:25.700
ROOF FLOOR LEVEL
8550
12MM THK WATERPROOF
HOMOGENOUS TILE
MOISTURE PROOF ALUMINIUM BUCKLE
PLATE CEILING + ANTI-DUST PAINT SOFFIT
3200
600X600 12MM THK NON-SLIP
HOMOGENOUS TILE (R10) ON 1.2mm
THKCEMENTITIOUS WATERPROOF COATING,
LOW VOC TILE ADHESIVE AND GROUT
12mm THK CERAMIC TILE
JANITOR
(DATAHALL)
FFL:17.150
3rd FLOOR LEVEL
SFL:17.100

JANITOR SECTION E-E

Scale 1:50

CLIENT :

GULF EDGE DC 01

87 Wireless Road, M Thai Tower 11th. Floor, All Seasons Place, Lumpini,
Pathumwan, Bangkok 10330, Thailand

CONTRACTOR :

华西发展(泰国)有限公司
บริษัท หัวซือ ดีเวลลอปเม้นต์ (ประเทศไทย) จำกัด
HUASHI DEVELOPMENT CO.,LTD
No. 202, Room No. 1403, 14/F, Le Concorde Building,
Ratchadapisek Road, Huaykhwang Sub-District,
Huaykhwang District, Bangkok Metropolitan 10310.

CONSULTANT :

ARbay
บริษัท เอ อาร์ เบย์ จำกัด
ARbay Company Limited
31 st Floor Bangkok Insurance Building
25 South Sathorn road Thungmahamek
Sathorn Bangkok 10120 THAILAND
T +66 (0) 2286 8199
F +66 (0) 2286 2863
info@arbay.co.th

CONSULTANT :

Qbic Engineers & Architects Co.,Ltd.
8 Soi KALONG 4 SANAMBINNAM ROAD,
THASAI SUB-DISTRICT, MUANG NONTHABURI DISTRICT
, NONTHABURI.
Tel 662-950-4374
Fax 662-580-3231
E-Mail : qbic@qbic.co.th, www.qbic.co.th
QBIC ENGINEERS AND ARCHITECTS CO.,LTD.

CONSULTANT :

MITR
MITR TECHNICAL CONSULTANT CO.,LTD.
1168/8 12th FLOOR, LUMPINI TOWER BUILDING,
RAMA IV RD., THUNGMAHAMEK, SATHORN, BANGKOK 10120, THAILAND
TEL : 0-2679-9079-84
FAX : 0-2679-9085 E-mail: mitr_dd@mitr.com

Architect :	SIGNATURE
ประกิต พนานุรัตน์ วสถ. 580 ที่อยู่ 251/1 ถ.จารุเมือง แขวงรองเมือง เขตปทุมวัน กรุงเทพมหานคร โทรศัพท์ 02-286-8199	
Structural Engineer :	SIGNATURE
วิศวกรผู้ออกแบบโครงสร้าง	
ณัฐสม สงวนวงษ์ วย 1423 ที่อยู่ 2/1 ซ.รามคำแหง 150 ถ.รามคำแหง แขวง สะพานสูง เขต สะพานสูง กทม. 10240	ณัฐสม สงวนวงษ์
Structural Inspector :	SIGNATURE
วิศวกรผู้ตรวจสอบโครงสร้าง	
โกมล จุฑาภัทร วย 964 ที่อยู่ 24/18 ซ.นวมินทร์ 129 ถ. นวมินทร์ แขวง นวลจันทร์ เขต บึงกุ่ม กทม. 10230	
Electrical Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบไฟฟ้ากำลัง	
นายสุภัทร บูรณวิทย์ วฟก.1265 ที่อยู่ 21 ซอยทานสัมฤทธิ์ 13 ตำบลท่าทราย อ.เมืองนนทบุรี จ.นนทบุรี 11000	
Mechanical Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบเครื่องกลและปรับอากาศ	
นายประสิทธิ์ เกี๊ยวสุนทร วก.1221 ที่อยู่ 44/372 ซอยบางกระดี่ 35/1 แขวงแสมดำ เขตบางขุนเทียน กทม. 10150	ประสิทธิ์
Sanitary Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบสุขาภิบาล และดับเพลิง	
นายทศวรรษ สนั่นฤทธิ์ วส. 215 ที่อยู่ บ้านเลขที่ 99/107 หมู่ที่ 3 ต.ศีรษะจรเข้น้อย อ.บางเสาธง จ.สมุทรปราการ 10540	ทศวรรษ

ISSUE/REVISION

REV.	DESCRIPTION	DATE
A	90% DEVELOPED	09/05/2026

PROJECT NAME :

GEDC 01

LOCATION:
Nikhom Phattana district, Rayong ,industrial estate,CPGC

BUILDING :
MAIN BUILDING

90% DEVELOPED

TITLE :

ROOMDETAIL-3F-JANITOR.
PANTRY,DATAHALL
ENTRANCE.ELECTRICALROOM B

JOB NO.	SCALE 1 : 50
DRAWN NXR	REF.
CHECKED LJC	DWG. NO.
APPROVED LXD	MPK01A-90-A-RD-312
DATE 2026.05.09	

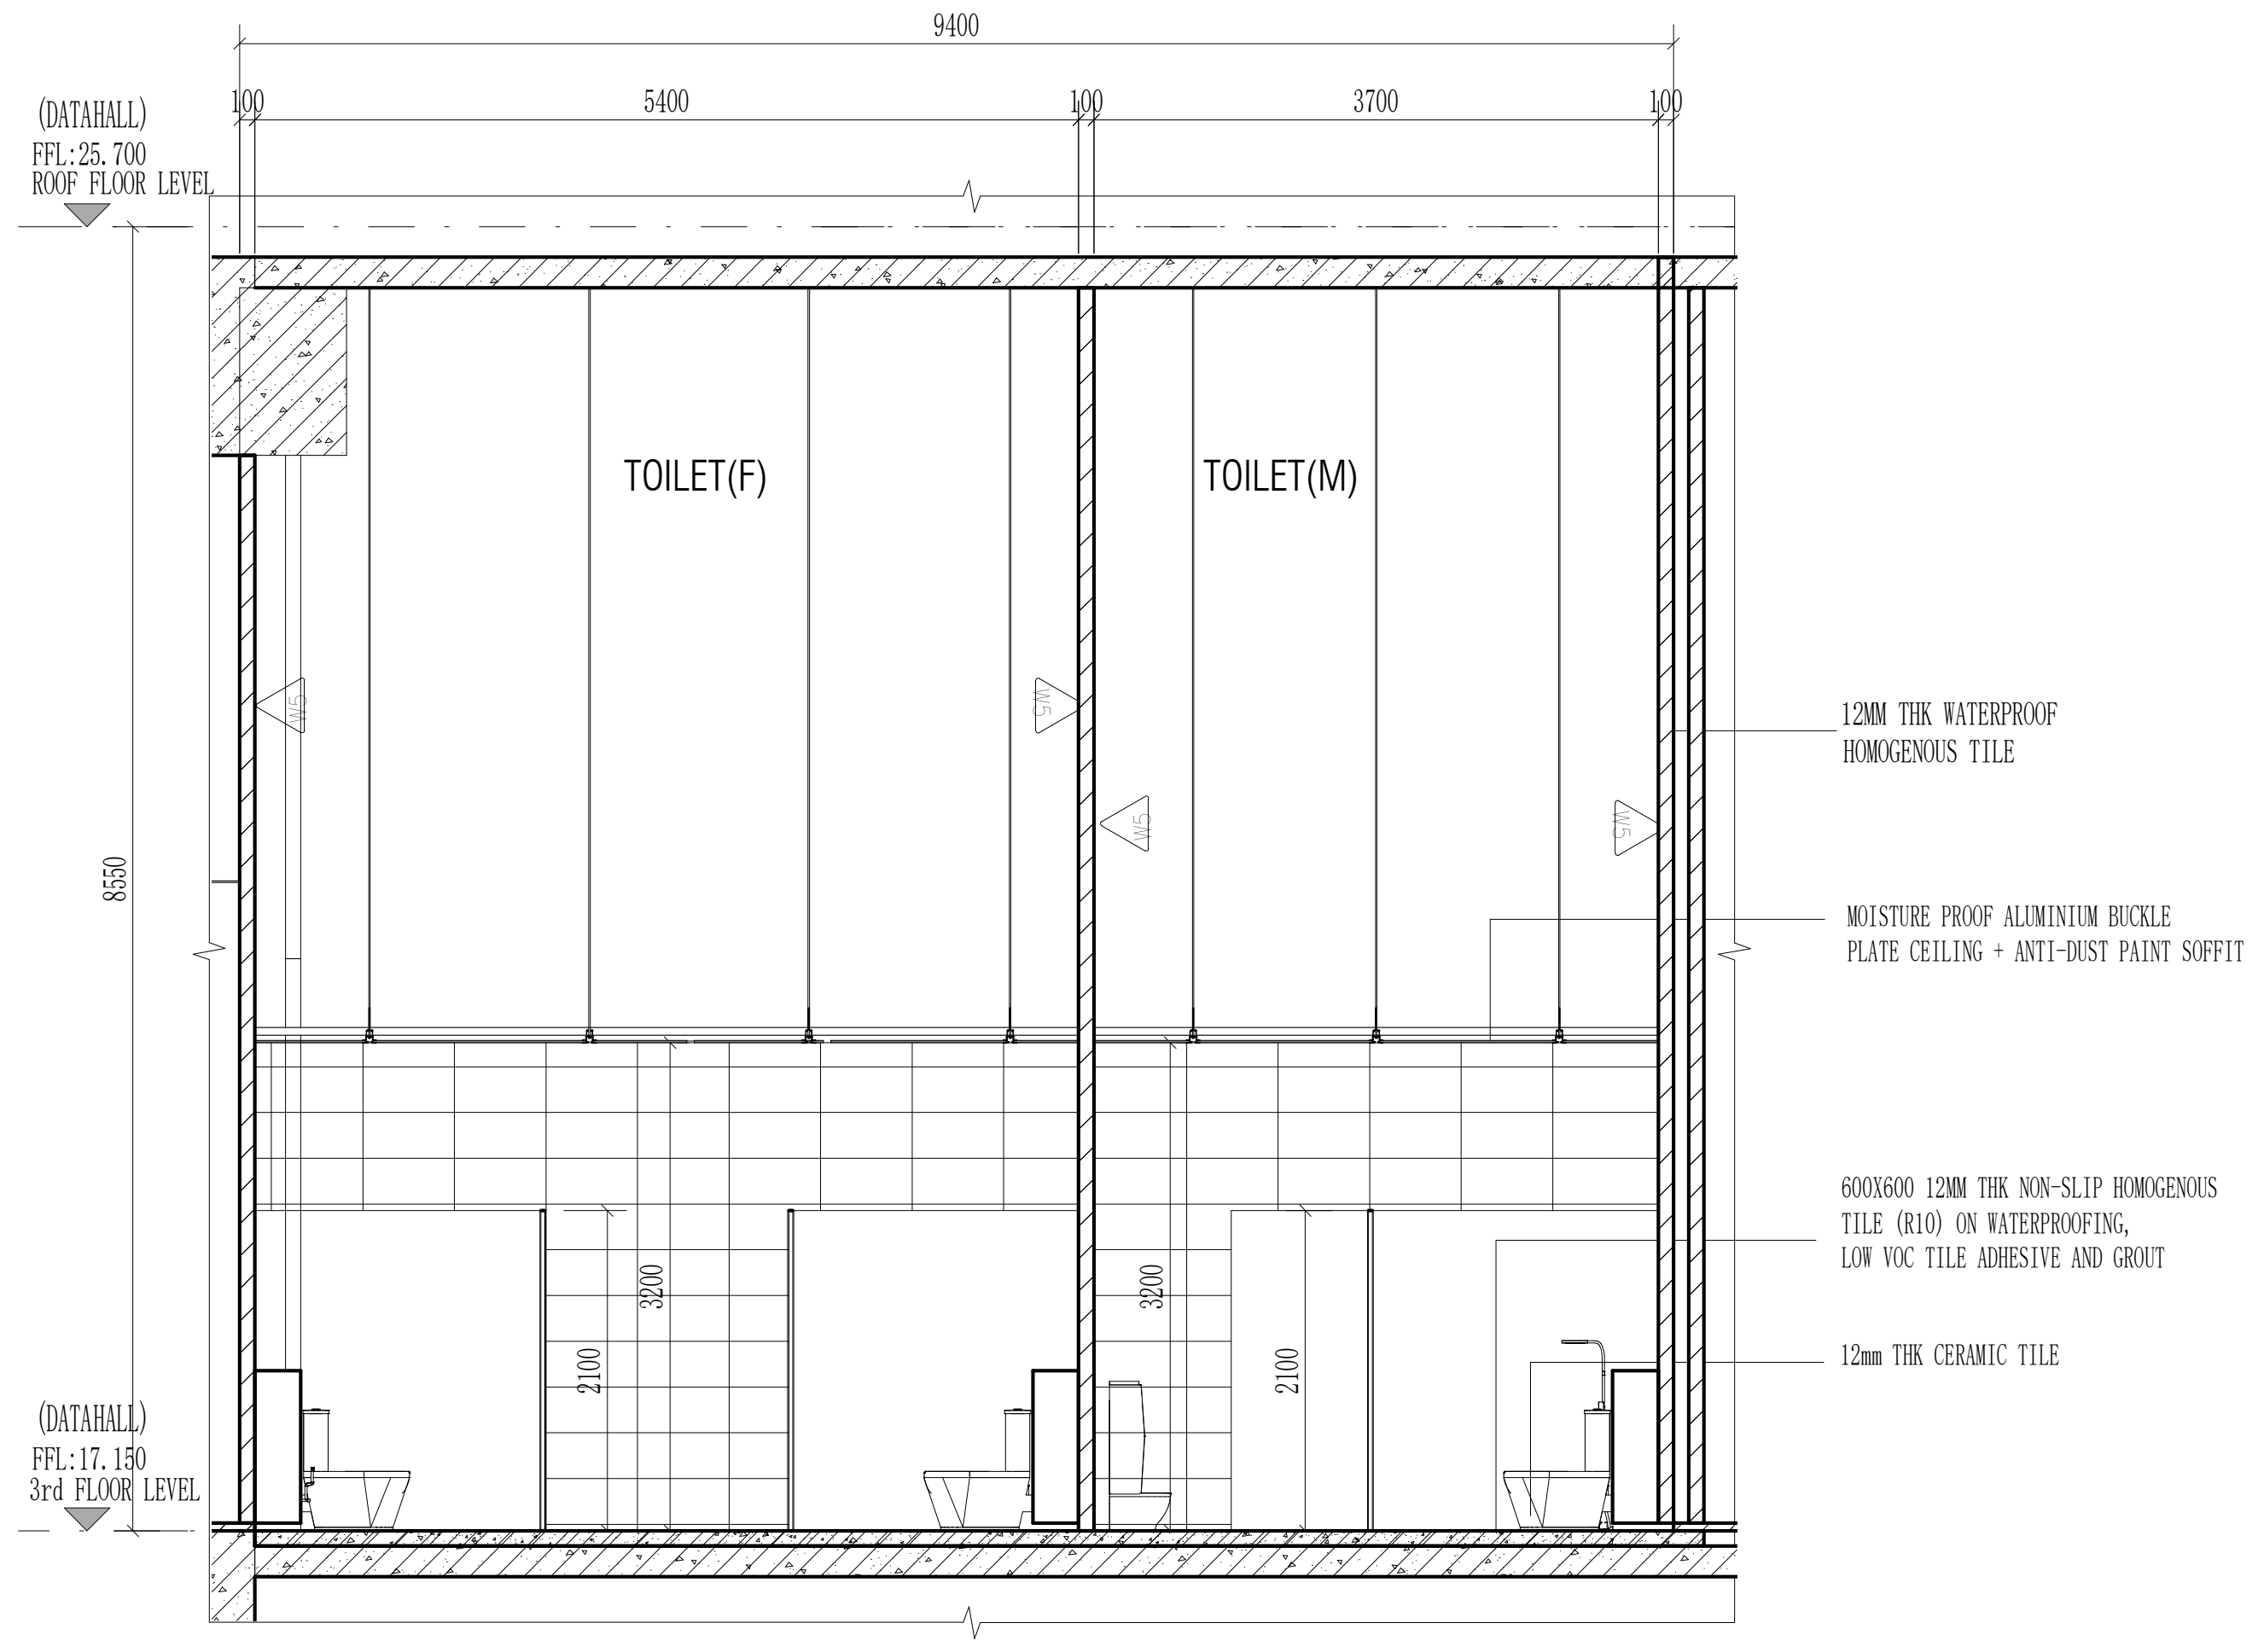
9400
100
5400
100
3700
100
(DATAHALL)
FFL:25.700
ROOF FLOOR LEVEL
TOILET(F)
TOILET(M)
8550
3200
2100
12MM THK WATERPROOF
HOMOGENOUS TILE
MOISTURE PROOF ALUMINIUM BUCKLE
PLATE CEILING + ANTI-DUST PAINT SOFFIT
600X600 12MM THK NON-SLIP HOMOGENOUS
TILE (R10) ON WATERPROOFING,
LOW VOC TILE ADHESIVE AND GROUT
12mm THK CERAMIC TILE
(DATAHALL)
FFL:17.150
3rd FLOOR LEVEL

TOILET(F)、TOILET(M) SECTIONA-A

Scale 1:50

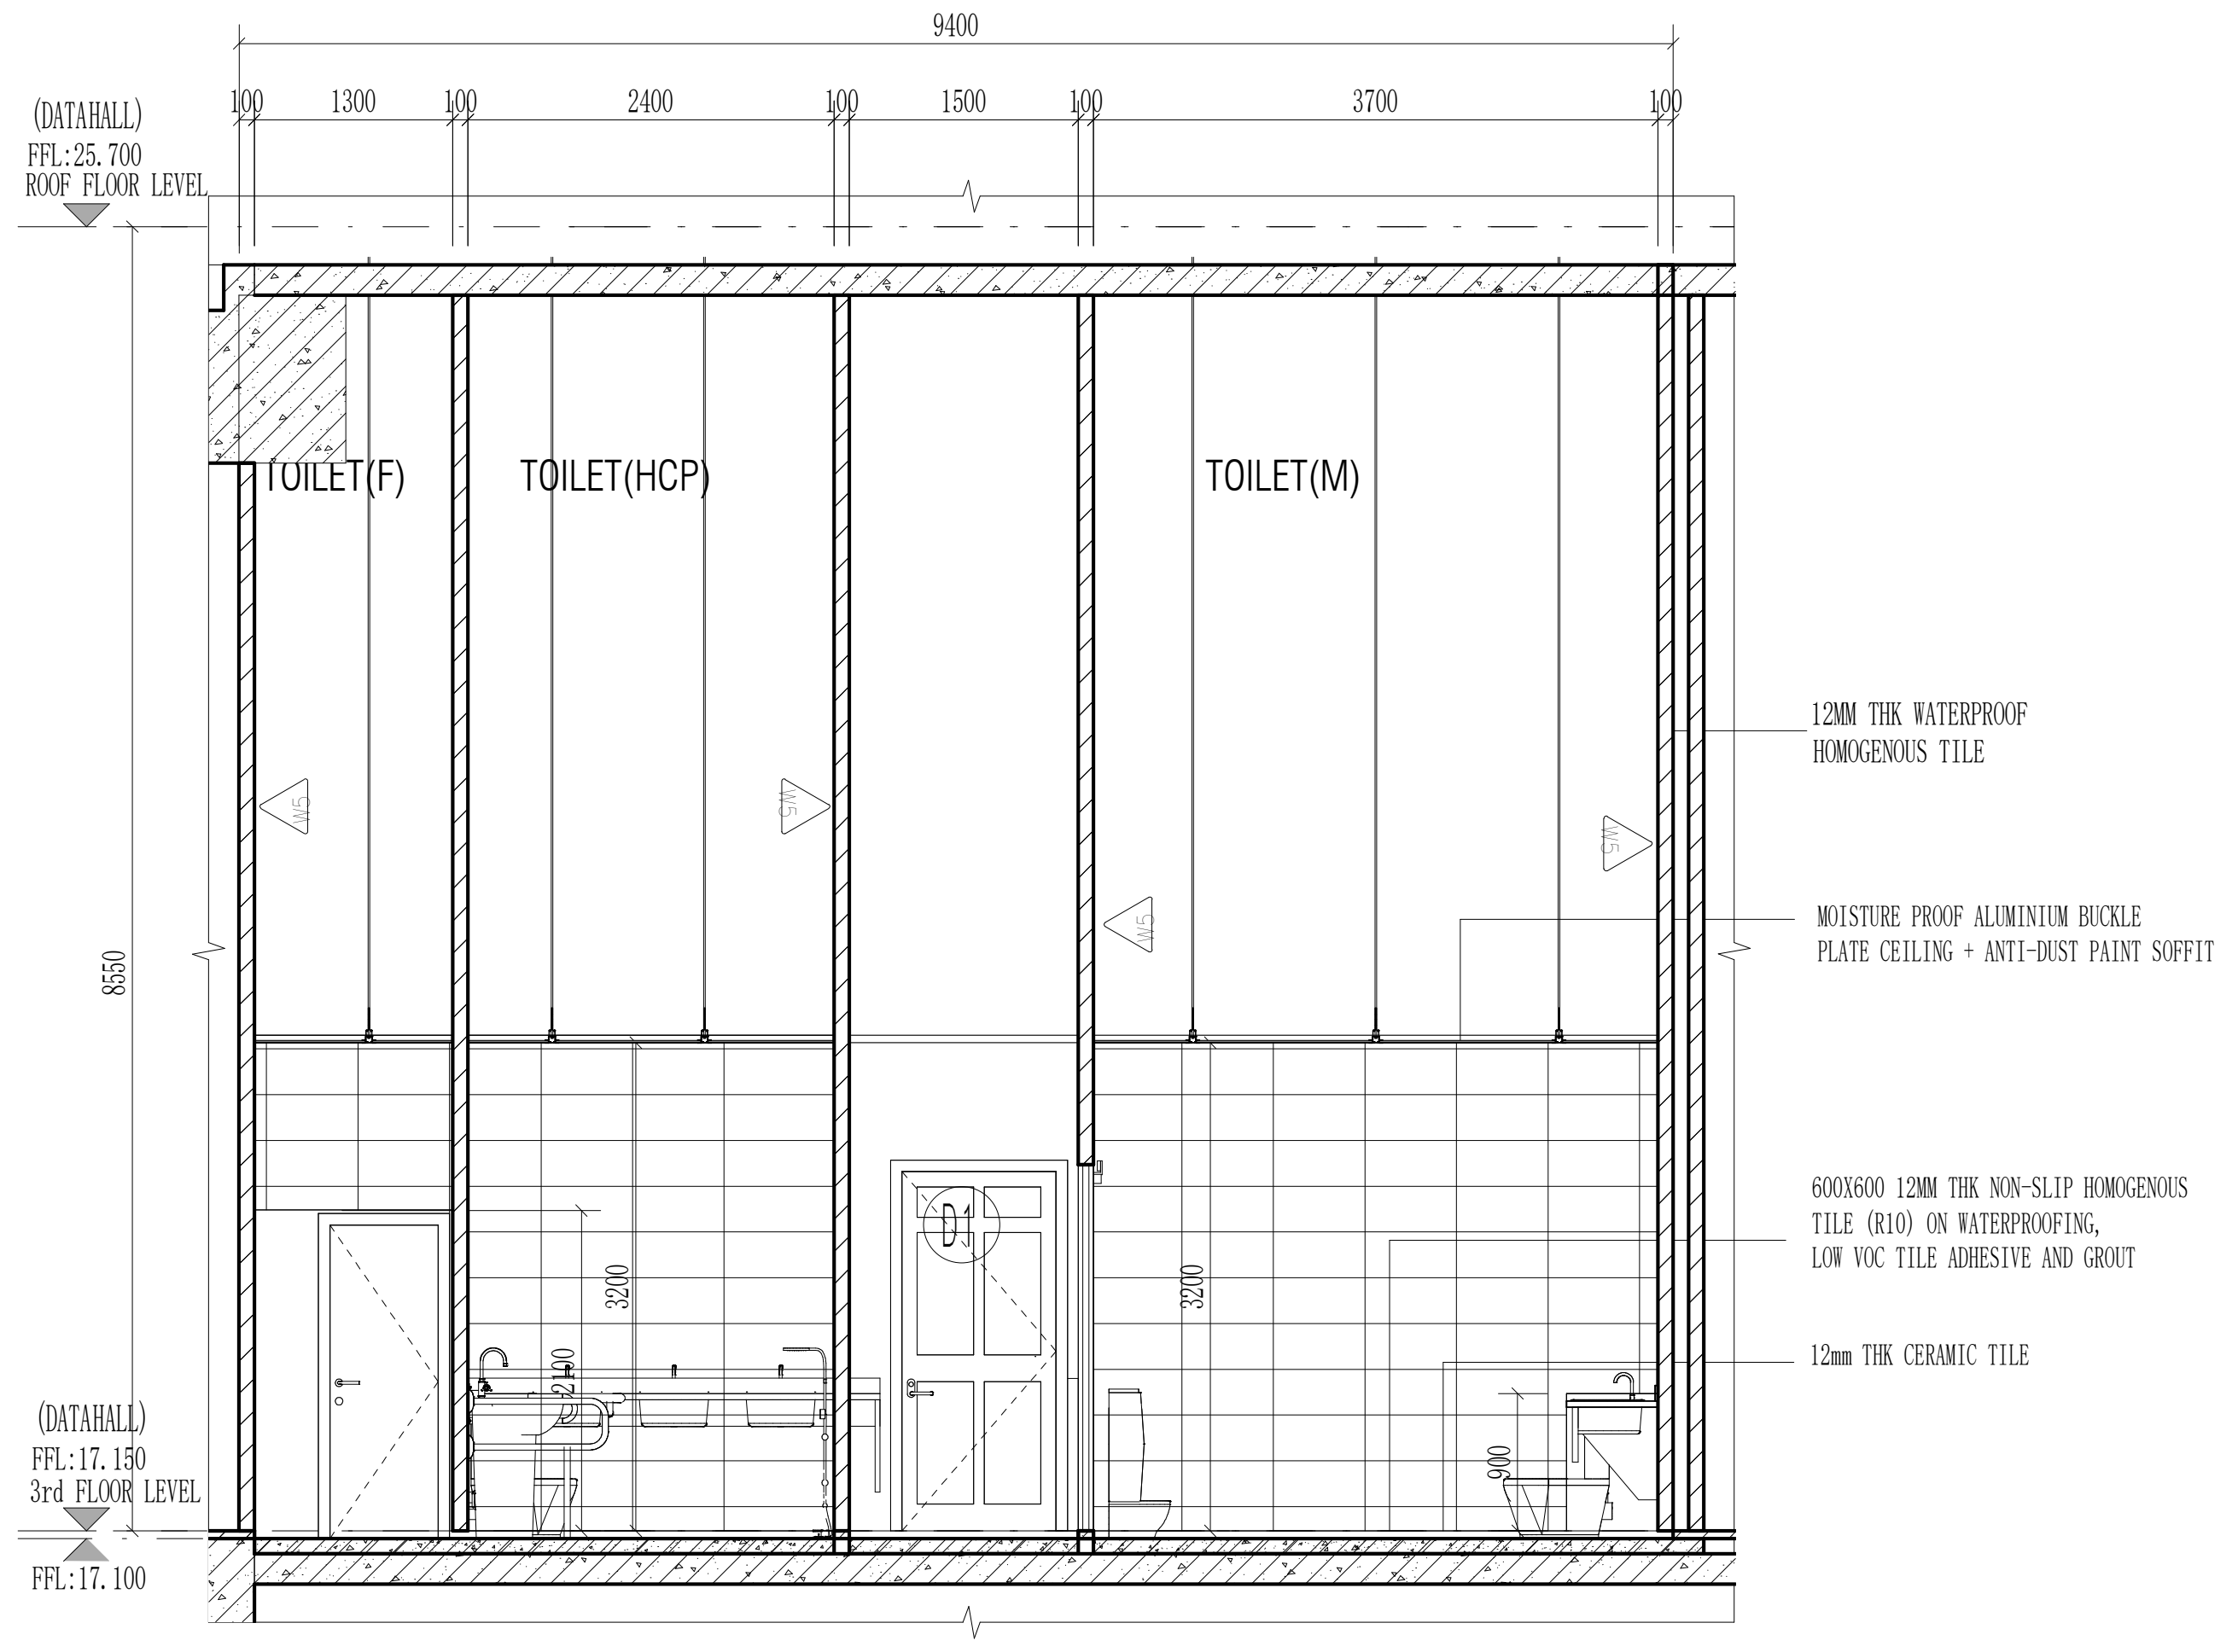
9400
100
1300
100
2400
100
1500
100
3700
100
(DATAHALL)
FFL:25.700
ROOF FLOOR LEVEL
TOILET(F)
TOILET(HCP)
TOILET(M)
8550
3200
D1
12MM THK WATERPROOF
HOMOGENOUS TILE
MOISTURE PROOF ALUMINIUM BUCKLE
PLATE CEILING + ANTI-DUST PAINT SOFFIT
600X600 12MM THK NON-SLIP HOMOGENOUS
TILE (R10) ON WATERPROOFING,
LOW VOC TILE ADHESIVE AND GROUT
12mm THK CERAMIC TILE
(DATAHALL)
FFL:17.150
3rd FLOOR LEVEL
FFL:17.100

SHOWER(F) TOILET(HCP) TOILET(M) SECTION B-B

Scale 1:50

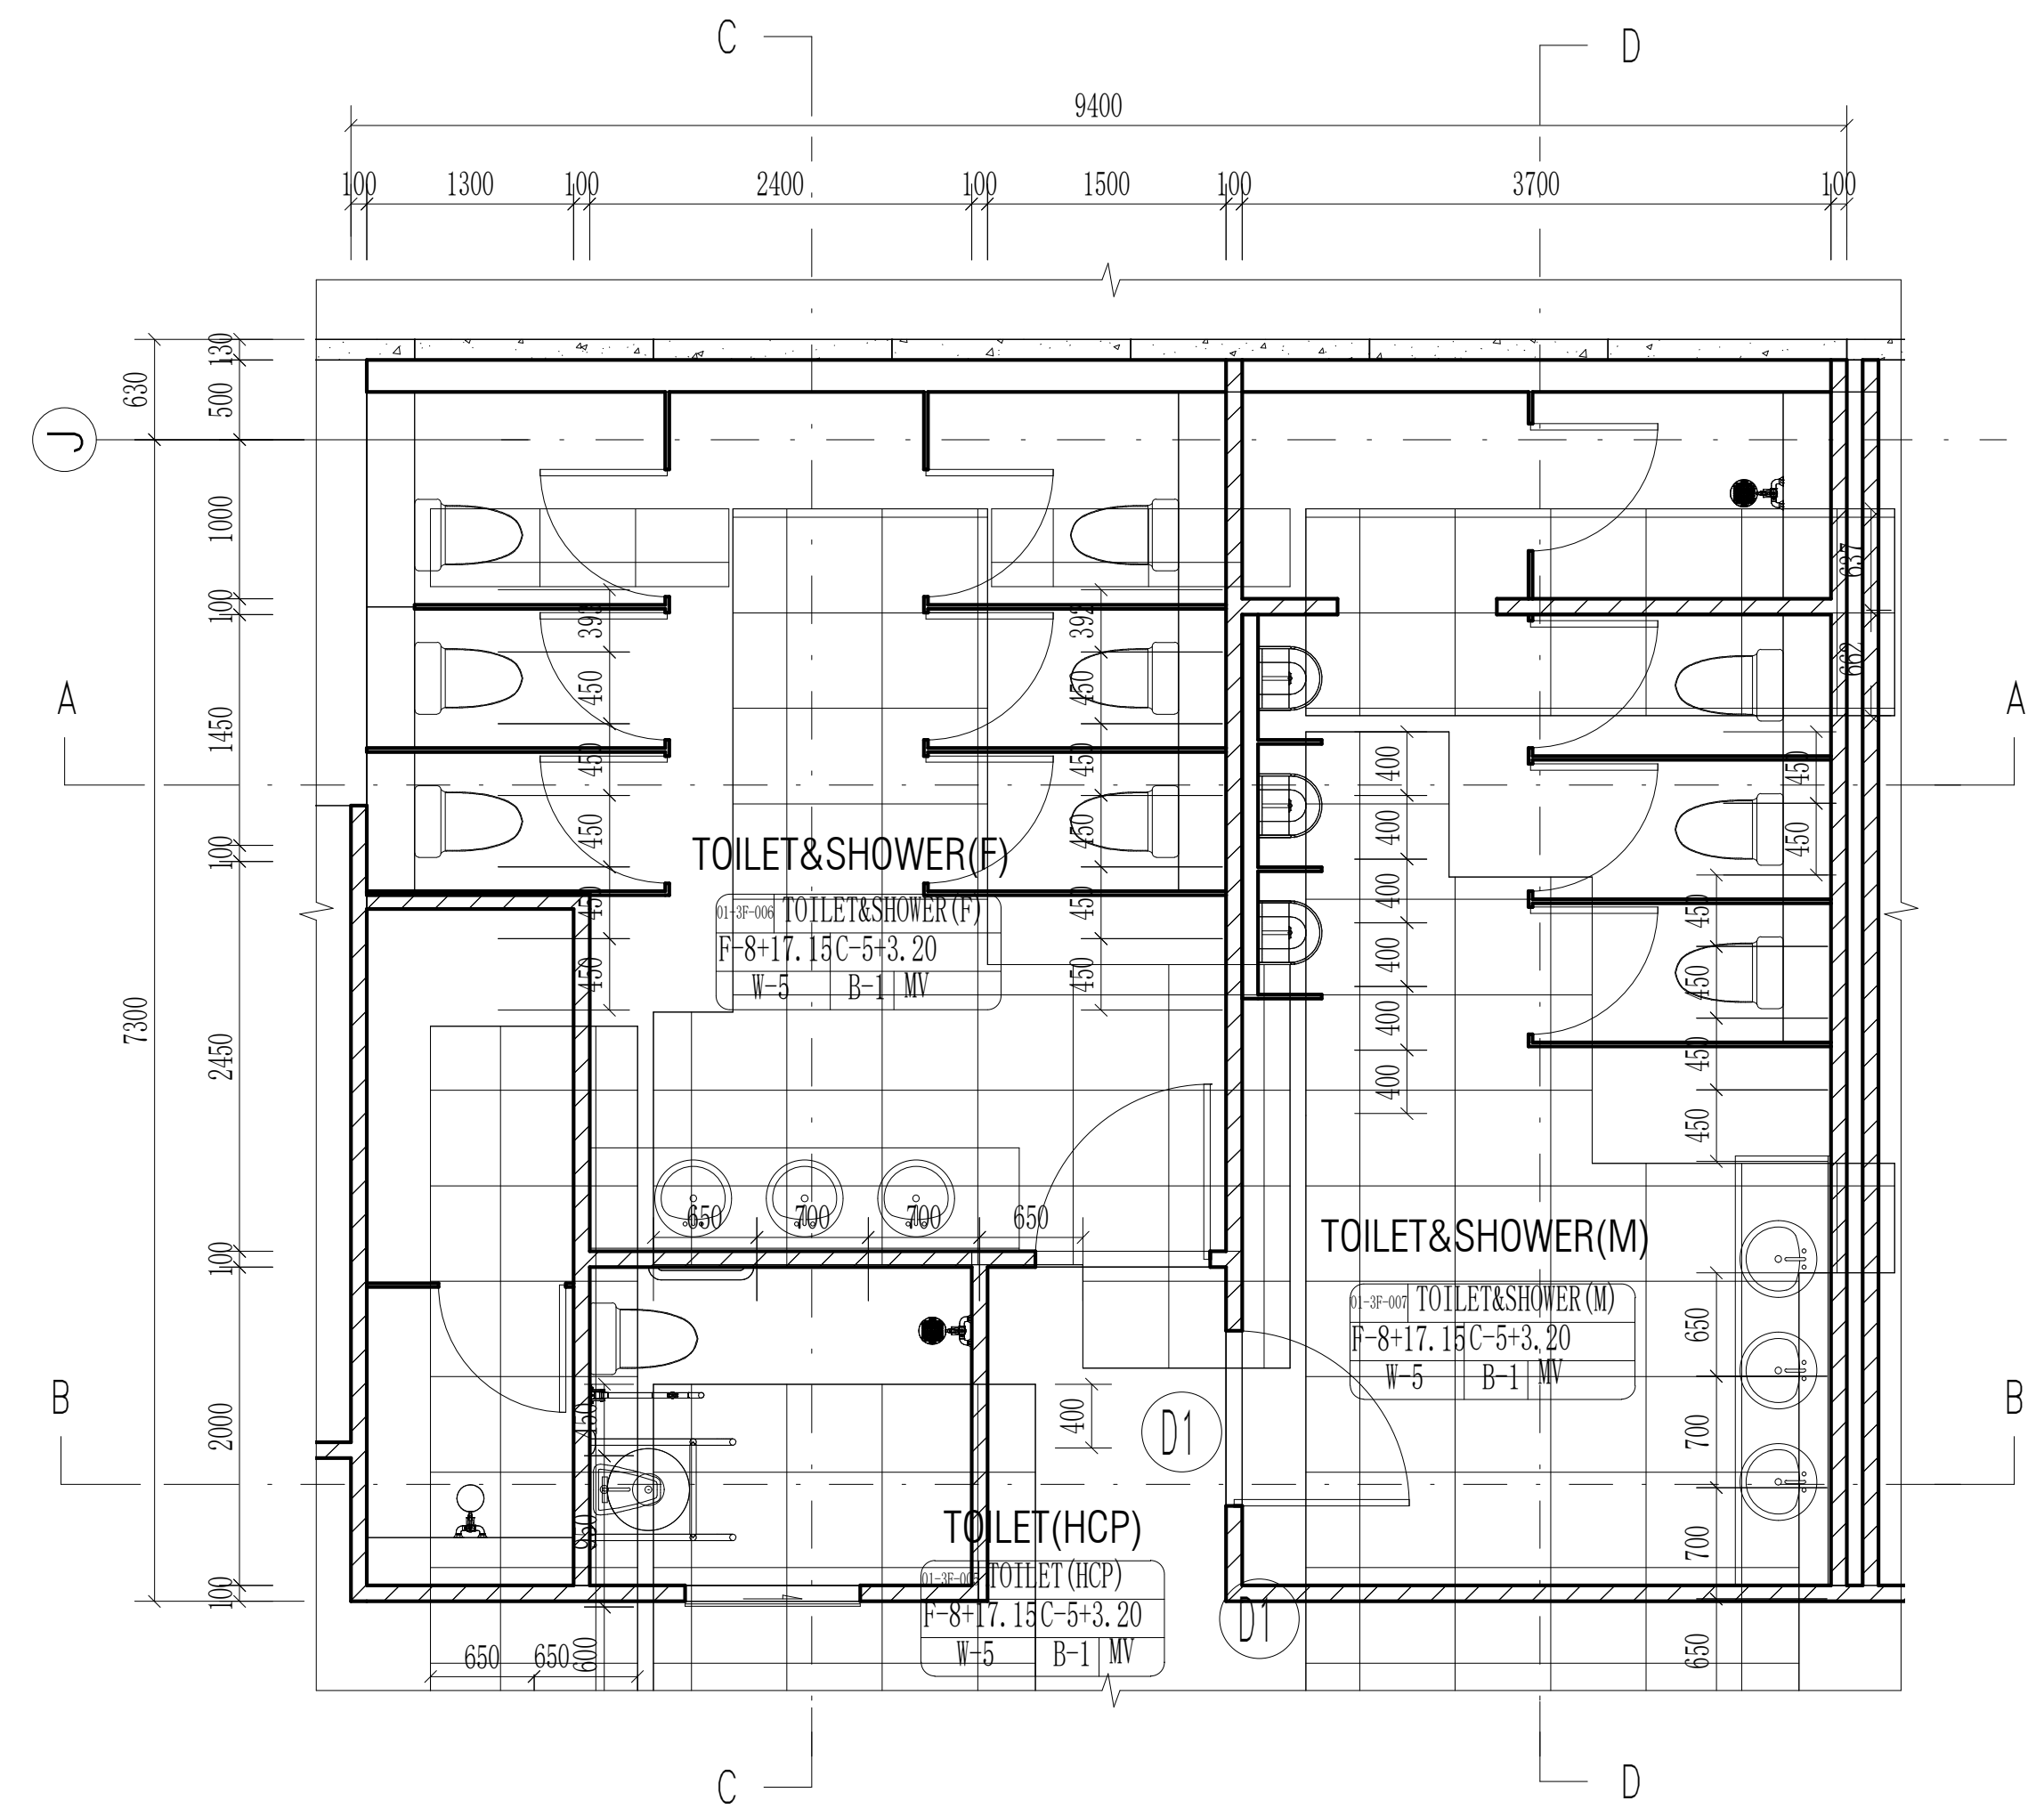
C
D
9400
100
1300
100
2400
100
1500
100
3700
100
J
630
130
500
1000
100
1450
100
2450
100
2000
100
7300
A
B
TOILET&SHOWER(F)
01-3F-006 TOILET&SHOWER(F)
F-8+17.15 C-5+3.20
W-5 B-1 MV
TOILET&SHOWER(M)
01-3F-007 TOILET&SHOWER(M)
F-8+17.15 C-5+3.20
W-5 B-1 MV
TOILET(HCP)
01-3F-00 TOILET(HCP)
F-8+17.15 C-5+3.20
W-5 B-1 MV
D1
392
450
400
650
700
600

TOILET&SHOWER(F)、TOILET&SHOWER(M)、TOILE(HCP) PLAN

Scale 1:50

THE "SFL" MARKED IN THE DRAWING REFERS TO THE STRUCTURAL FLOOR LEVEL, WHILE THE FINISHED FLOOR LEVEL (FFL) IS DETERMINED BASED ON FLOOR FINISHES.

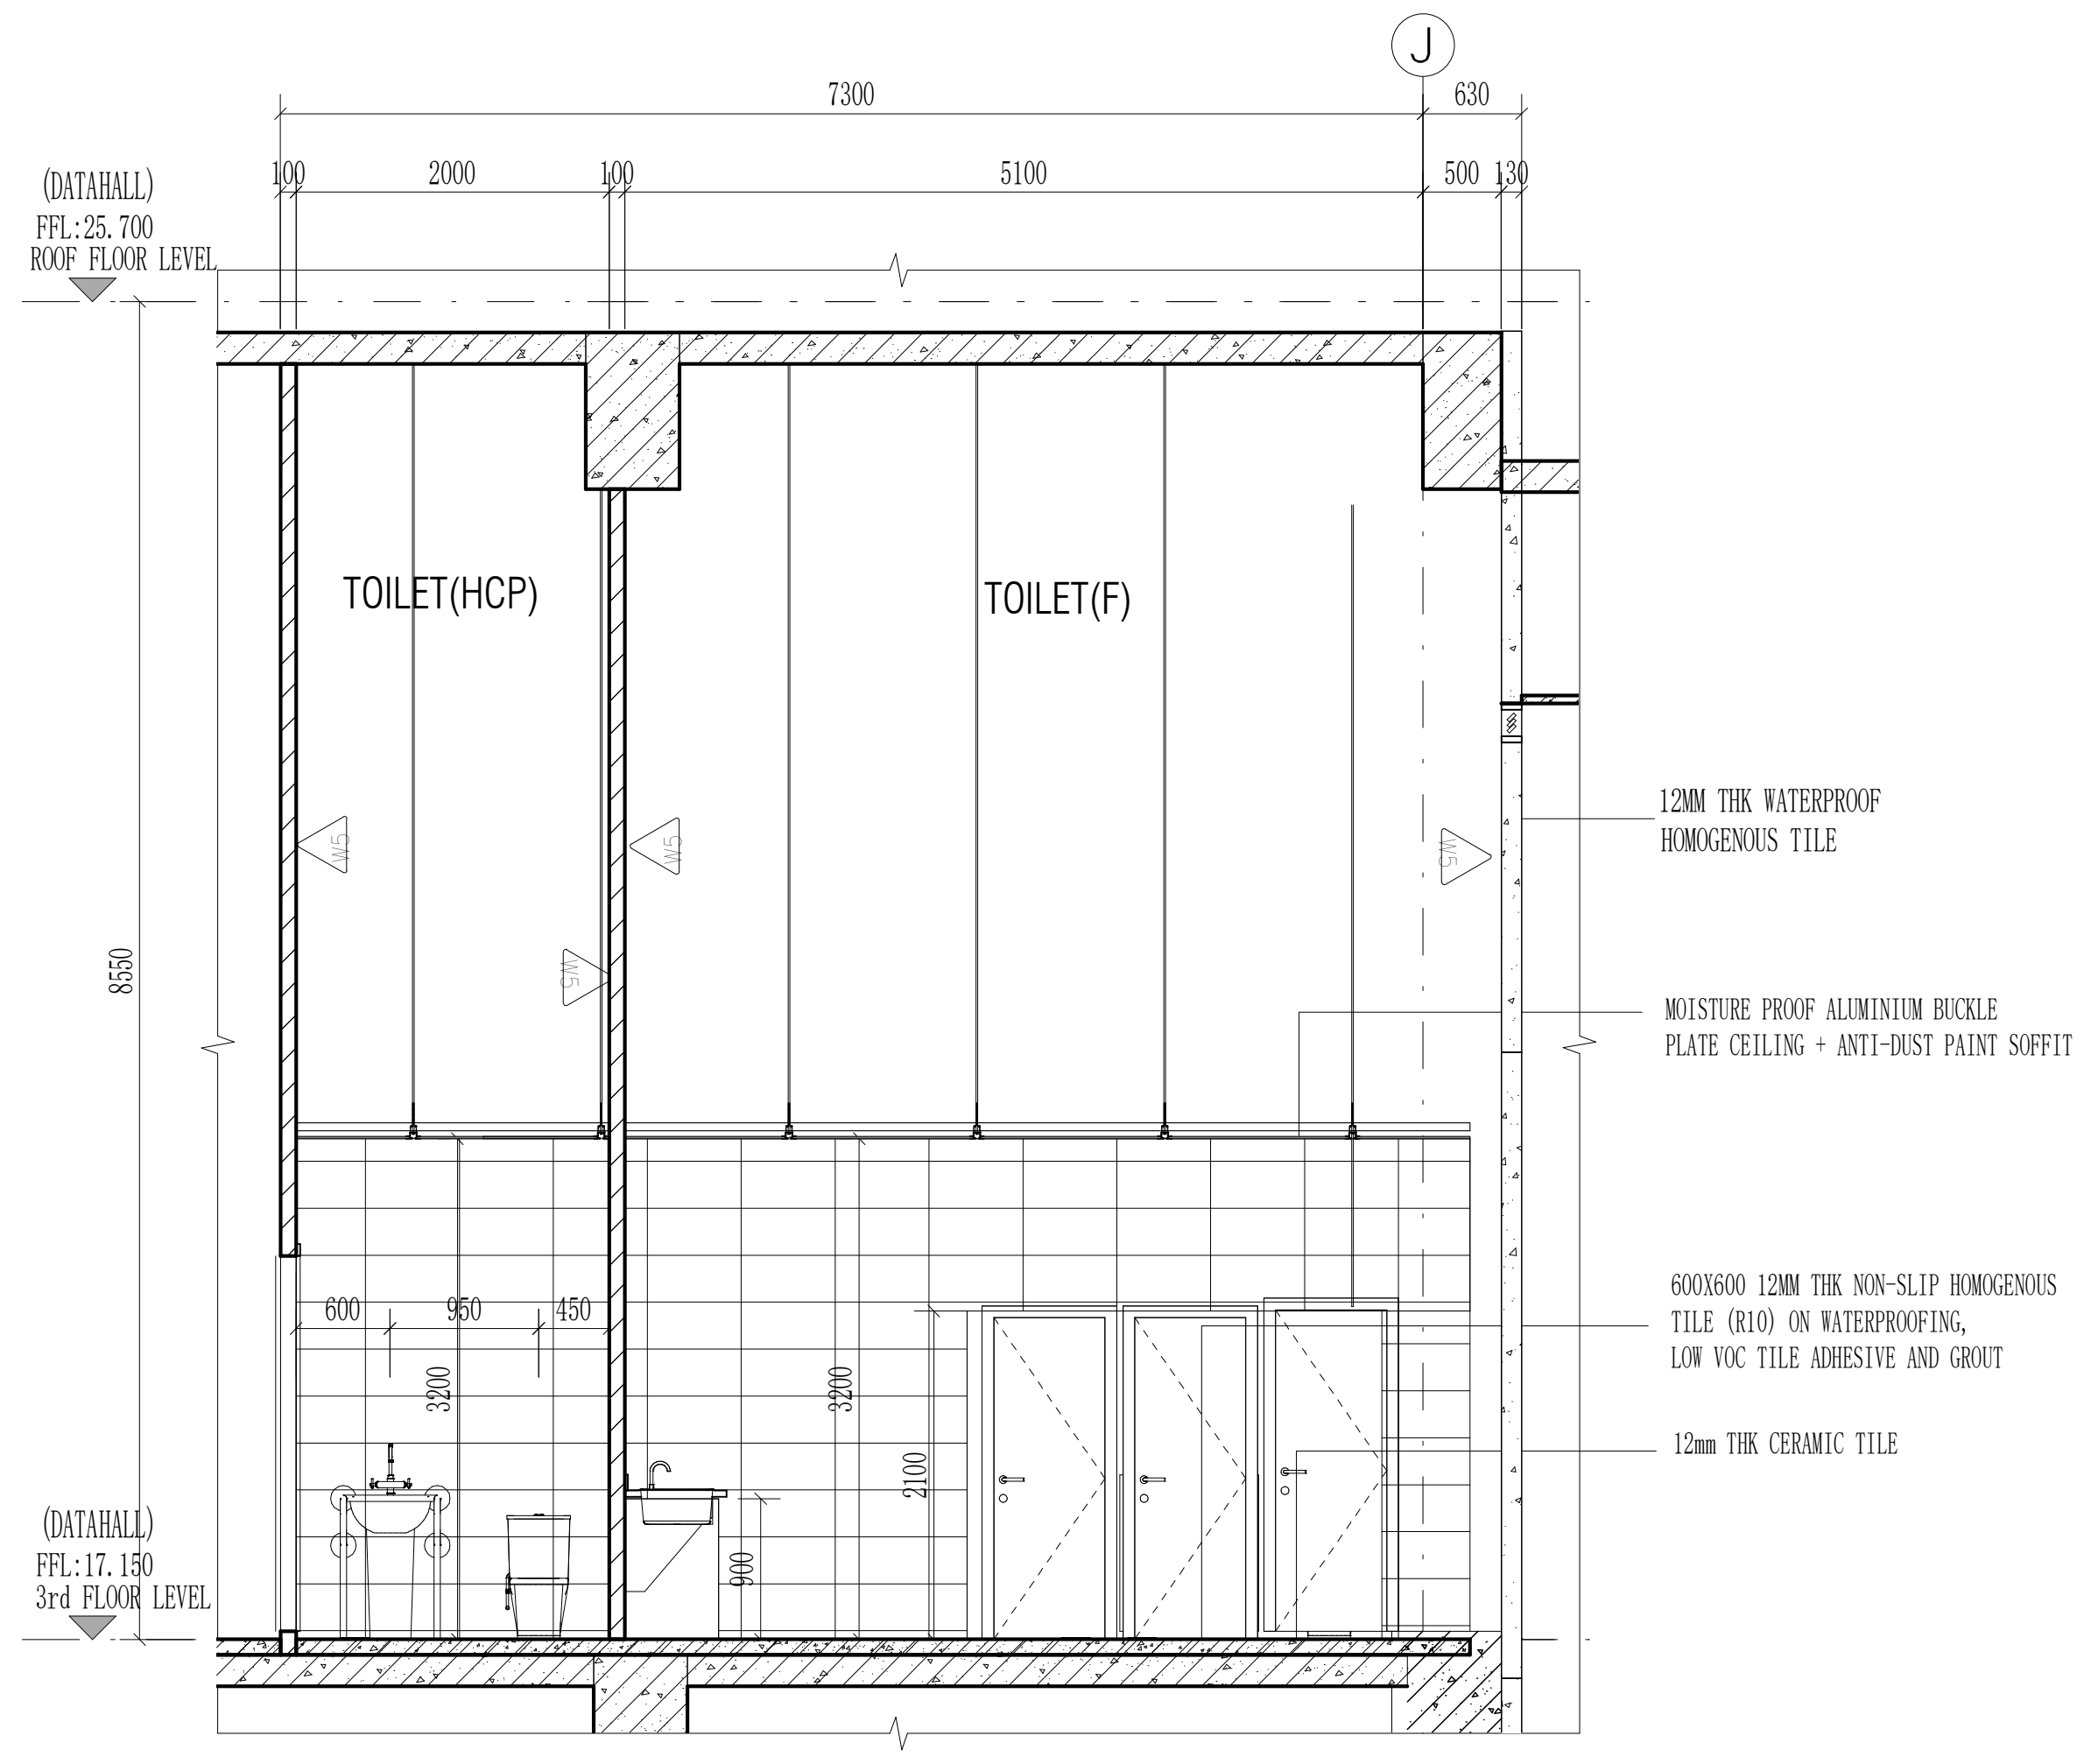
J
7300
100
2000
100
5100
500
130
630
(DATAHALL)
FFL:25.700
ROOF FLOOR LEVEL
TOILET(HCP)
TOILET(F)
8550
3200
2100
600
950
650
12MM THK WATERPROOF
HOMOGENOUS TILE
MOISTURE PROOF ALUMINIUM BUCKLE
PLATE CEILING + ANTI-DUST PAINT SOFFIT
600X600 12MM THK NON-SLIP HOMOGENOUS
TILE (R10) ON WATERPROOFING,
LOW VOC TILE ADHESIVE AND GROUT
12mm THK CERAMIC TILE
(DATAHALL)
FFL:17.150
3rd FLOOR LEVEL

TOILET(F) TOILET(HCP) SECTION C-C

Scale 1:50

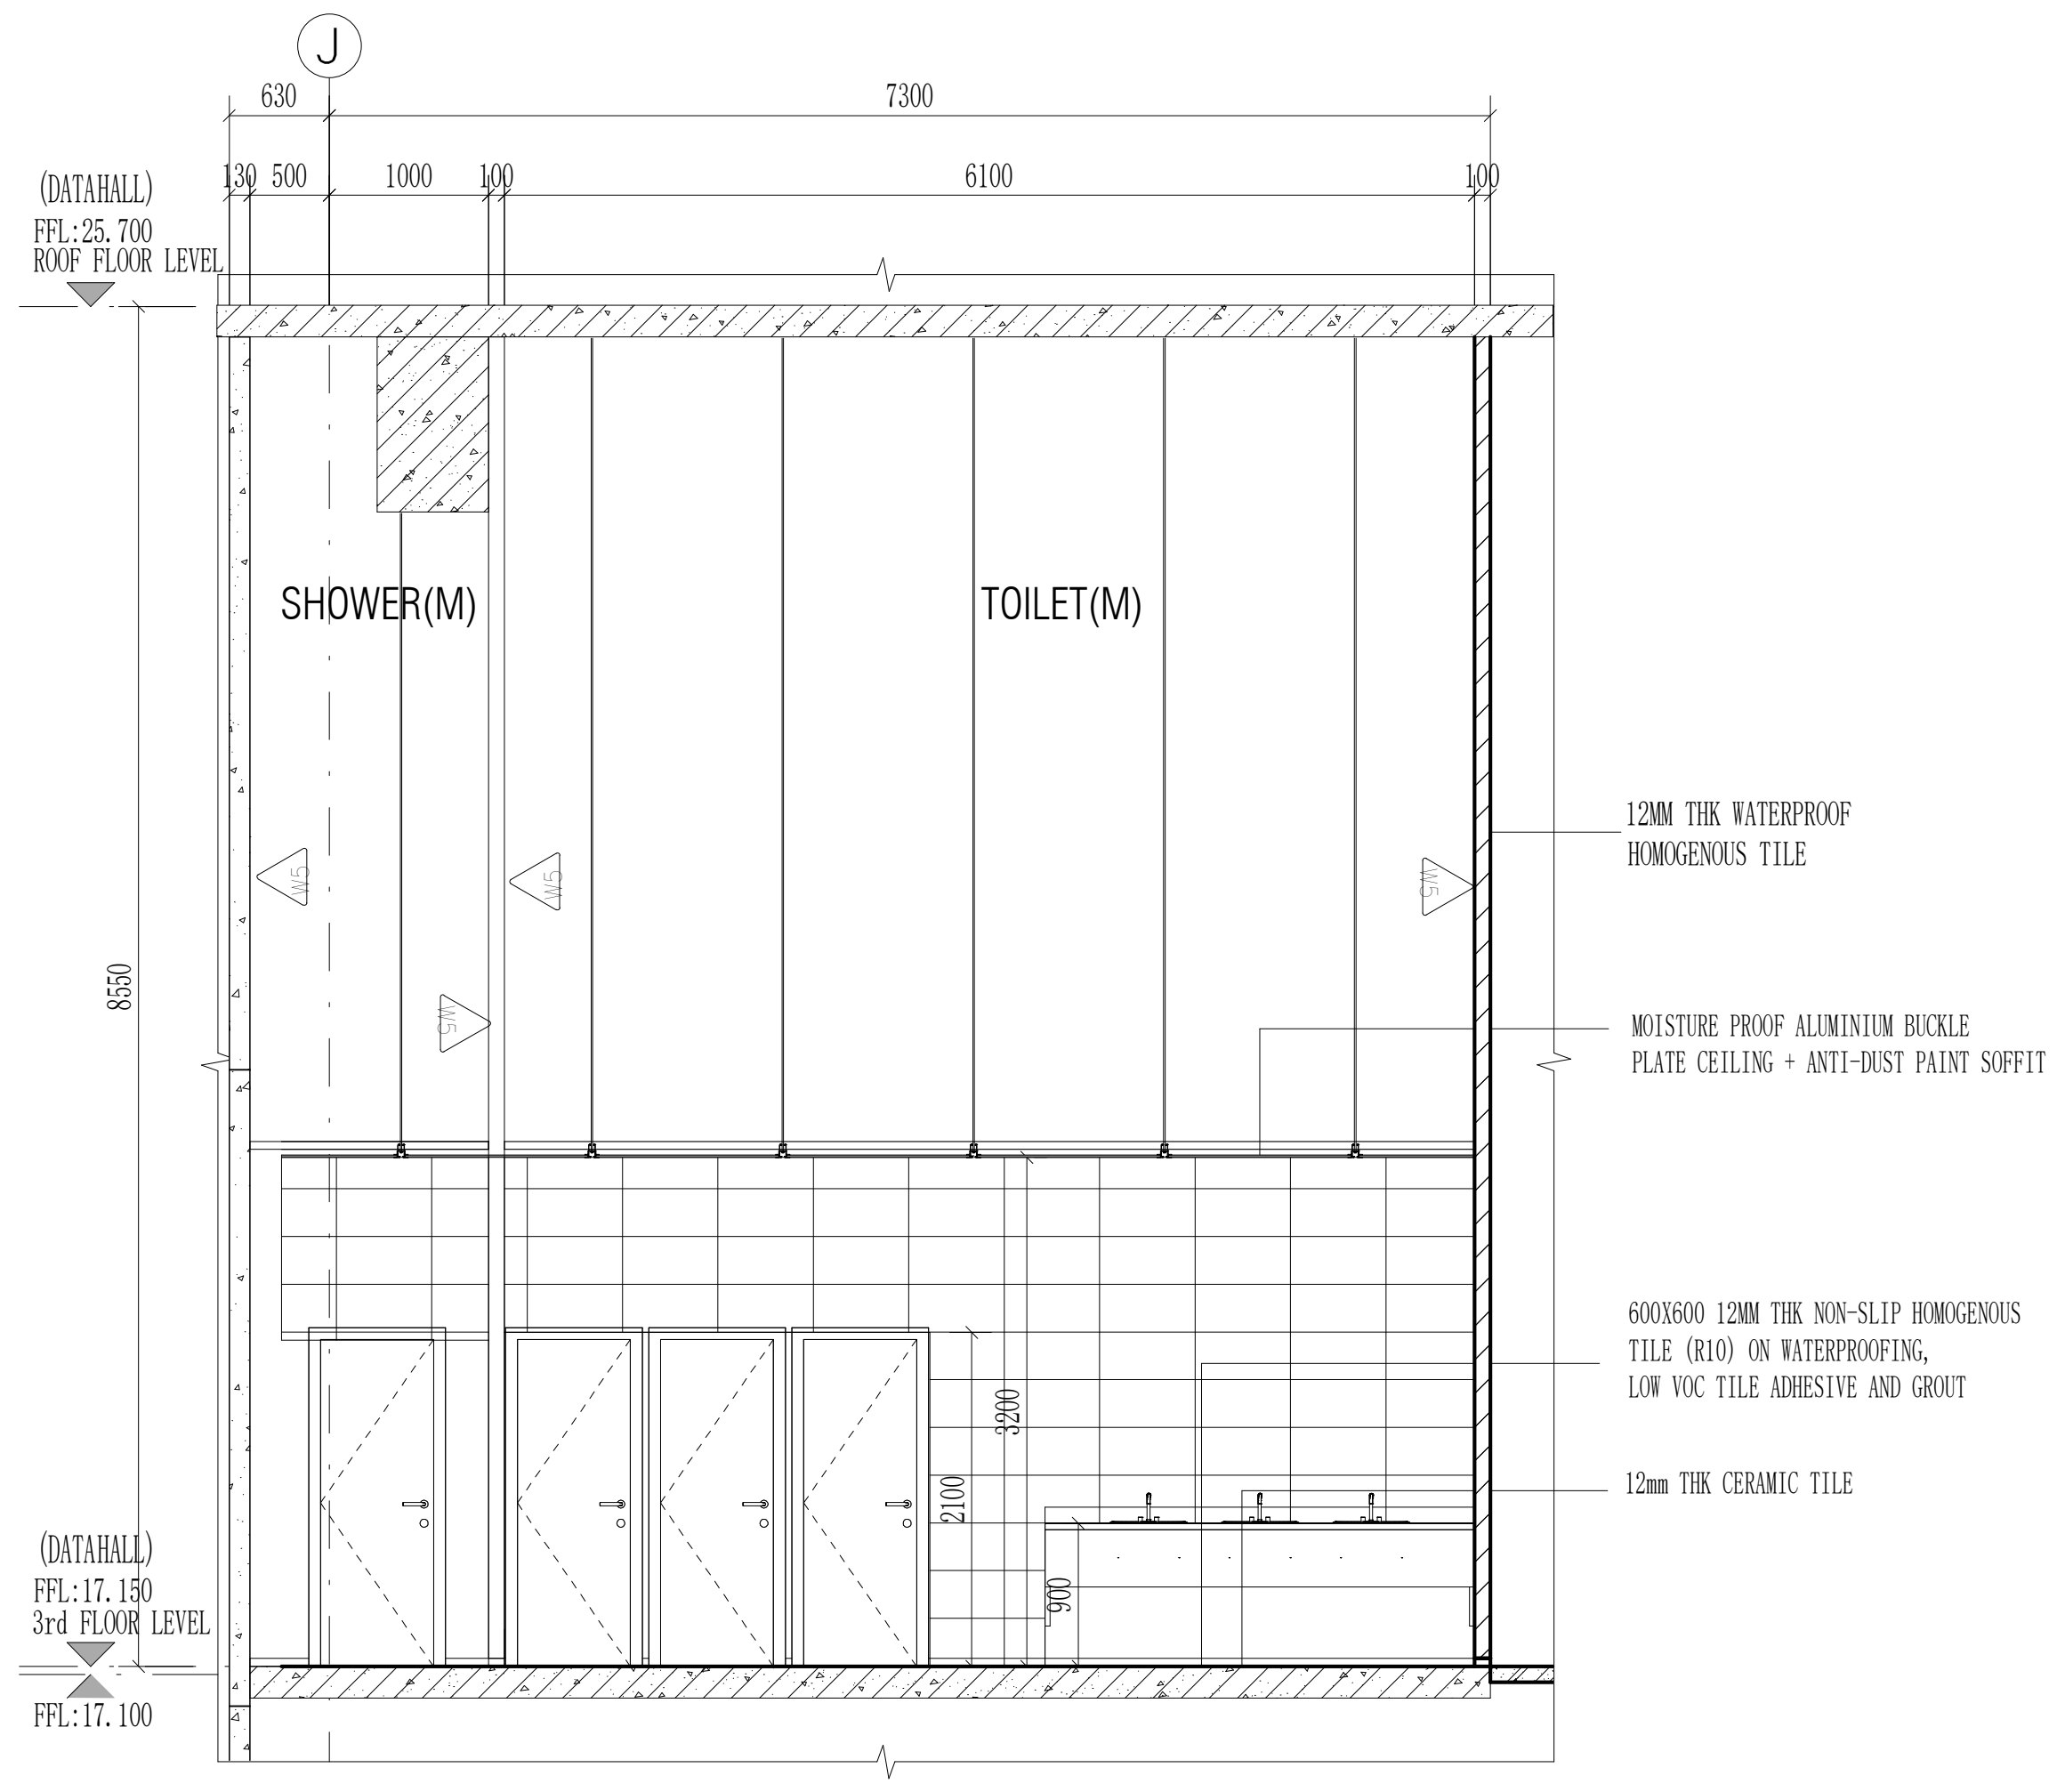
J
630
7300
130
500
1000
100
6100
100
(DATAHALL)
FFL:25.700
ROOF FLOOR LEVEL
SHOWER(M)
TOILET(M)
8550
3200
2100
900
12MM THK WATERPROOF
HOMOGENOUS TILE
MOISTURE PROOF ALUMINIUM BUCKLE
PLATE CEILING + ANTI-DUST PAINT SOFFIT
600X600 12MM THK NON-SLIP HOMOGENOUS
TILE (R10) ON WATERPROOFING,
LOW VOC TILE ADHESIVE AND GROUT
12mm THK CERAMIC TILE
(DATAHALL)
FFL:17.150
3rd FLOOR LEVEL
FFL:17.100

SHOWER(M) TOILET(M) SECTION D-D

Scale 1:50

CLIENT :

GULF EDGE DC 01

87 Wireless Road, M Thai Tower 11th. Floor, All Seasons Place, Lumpini,
Pathumwan, Bangkok 10330, Thailand

CONTRACTOR :

华西发展(泰国)有限公司
บริษัท หัวซือ ดีเวลลอปเม้นต์ (ประเทศไทย) จำกัด
HUASHI DEVELOPMENT CO.,LTD
No. 202, Room No. 1403, 14/F, Le Concorde Building,
Ratchadapisek Road, Huaykhwang Sub-District,
Huaykhwang District, Bangkok Metropolitan 10310.

CONSULTANT :

ARbay
บริษัท เอ อาร์ เบย์ จำกัด
ARbay Company Limited
31 st Floor Bangkok Insurance Building
25 South Sathorn road Thungmahamek
Sathorn Bangkok 10120 THAILAND
T +66 (0) 2286 8199
F +66 (0) 2286 2863
info@arbay.co.th

CONSULTANT :

Qbic Engineers & Architects Co.,Ltd.
8 Soi KALONG 4 SANAMBINNAM ROAD,
THASAI SUB-DISTRICT, MUANG NONTHABURI DISTRICT
, NONTHABURI.
Tel 662-950-4374
Fax 662-580-3231
E-Mail : qbic@qbic.co.th, www.qbic.co.th
QBIC ENGINEERS AND ARCHITECTS CO.,LTD.

CONSULTANT :

MITR
MITR TECHNICAL CONSULTANT CO.,LTD.
1168/8 12th FLOOR, LUMPINI TOWER BUILDING,
RAMA IV RD., THUNGMAHAMEK, SATHORN, BANGKOK 10120, THAILAND
TEL : 0-2679-9079-84
FAX : 0-2679-9085 E-mail: mitr_dd@mitr.com

Architect :	SIGNATURE
ประกิต พนานุรัตน์ วสถ. 580 ที่อยู่ 251/1 ถ.จารุเมือง แขวงรองเมือง เขตปทุมวัน กรุงเทพมหานคร โทรศัพท์ 02-286-8199	
Structural Engineer :	SIGNATURE
วิศวกรผู้ออกแบบโครงสร้าง	
ณัฐสม สงวนวงษ์ วย 1423 ที่อยู่ 2/1 ซ.รามคำแหง 150 ถ.รามคำแหง แขวง สะพานสูง เขต สะพานสูง กทม. 10240	ณัฐสม สงวนวงษ์
Structural Inspector :	SIGNATURE
วิศวกรผู้ตรวจสอบโครงสร้าง	
โกมล จุฑาภัทร วย 964 ที่อยู่ 24/18 ซ.นวมินทร์ 129 ถ. นวมินทร์ แขวง นวลจันทร์ เขต บึงกุ่ม กทม. 10230	
Electrical Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบไฟฟ้ากำลัง	
นายสุภัทร บูรณวิทย์ วฟก.1265 ที่อยู่ 21 ซอยทานสัมฤทธิ์ 13 ตำบลท่าทราย อ.เมืองนนทบุรี จ.นนทบุรี 11000	
Mechanical Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบเครื่องกลและปรับอากาศ	
นายประสิทธิ์ เกี้ยวสุนทร วก.1221 ที่อยู่ 44/372 ซอยบางกระดี่ 35/1 แขวงแสมดำ เขตบางขุนเทียน กทม. 10150	ประสิทธิ์
Sanitary Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบสุขาภิบาล และดับเพลิง	
นายทศวรรษ สนั่นฤทธิ์ วส. 215 ที่อยู่ บ้านเลขที่ 99/107 หมู่ที่ 3 ต.ศีรษะจรเข้น้อย อ.บางเสาธง จ.สมุทรปราการ 10540	ทศวรรษ

ISSUE/REVISION

REV.	DESCRIPTION	DATE
A	90% DEVELOPED	09/05/2026

PROJECT NAME :

GEDC 01

LOCATION:
Nikhom Phattana district, Rayong ,industrial estate,CPGC

BUILDING :
MAIN BUILDING

90% DEVELOPED

TITLE :

DETAIL- TOILET &SHOWER(F).
TOILETROOM&SHOWER(M),
TOILET(HCP)

JOB NO.	SCALE 1 : 50
DRAWN NXR	REF.
CHECKED LJC	DWG. NO. MPK01A-90-A-RD-313
APPROVED LXD	
DATE 2026.05.09	

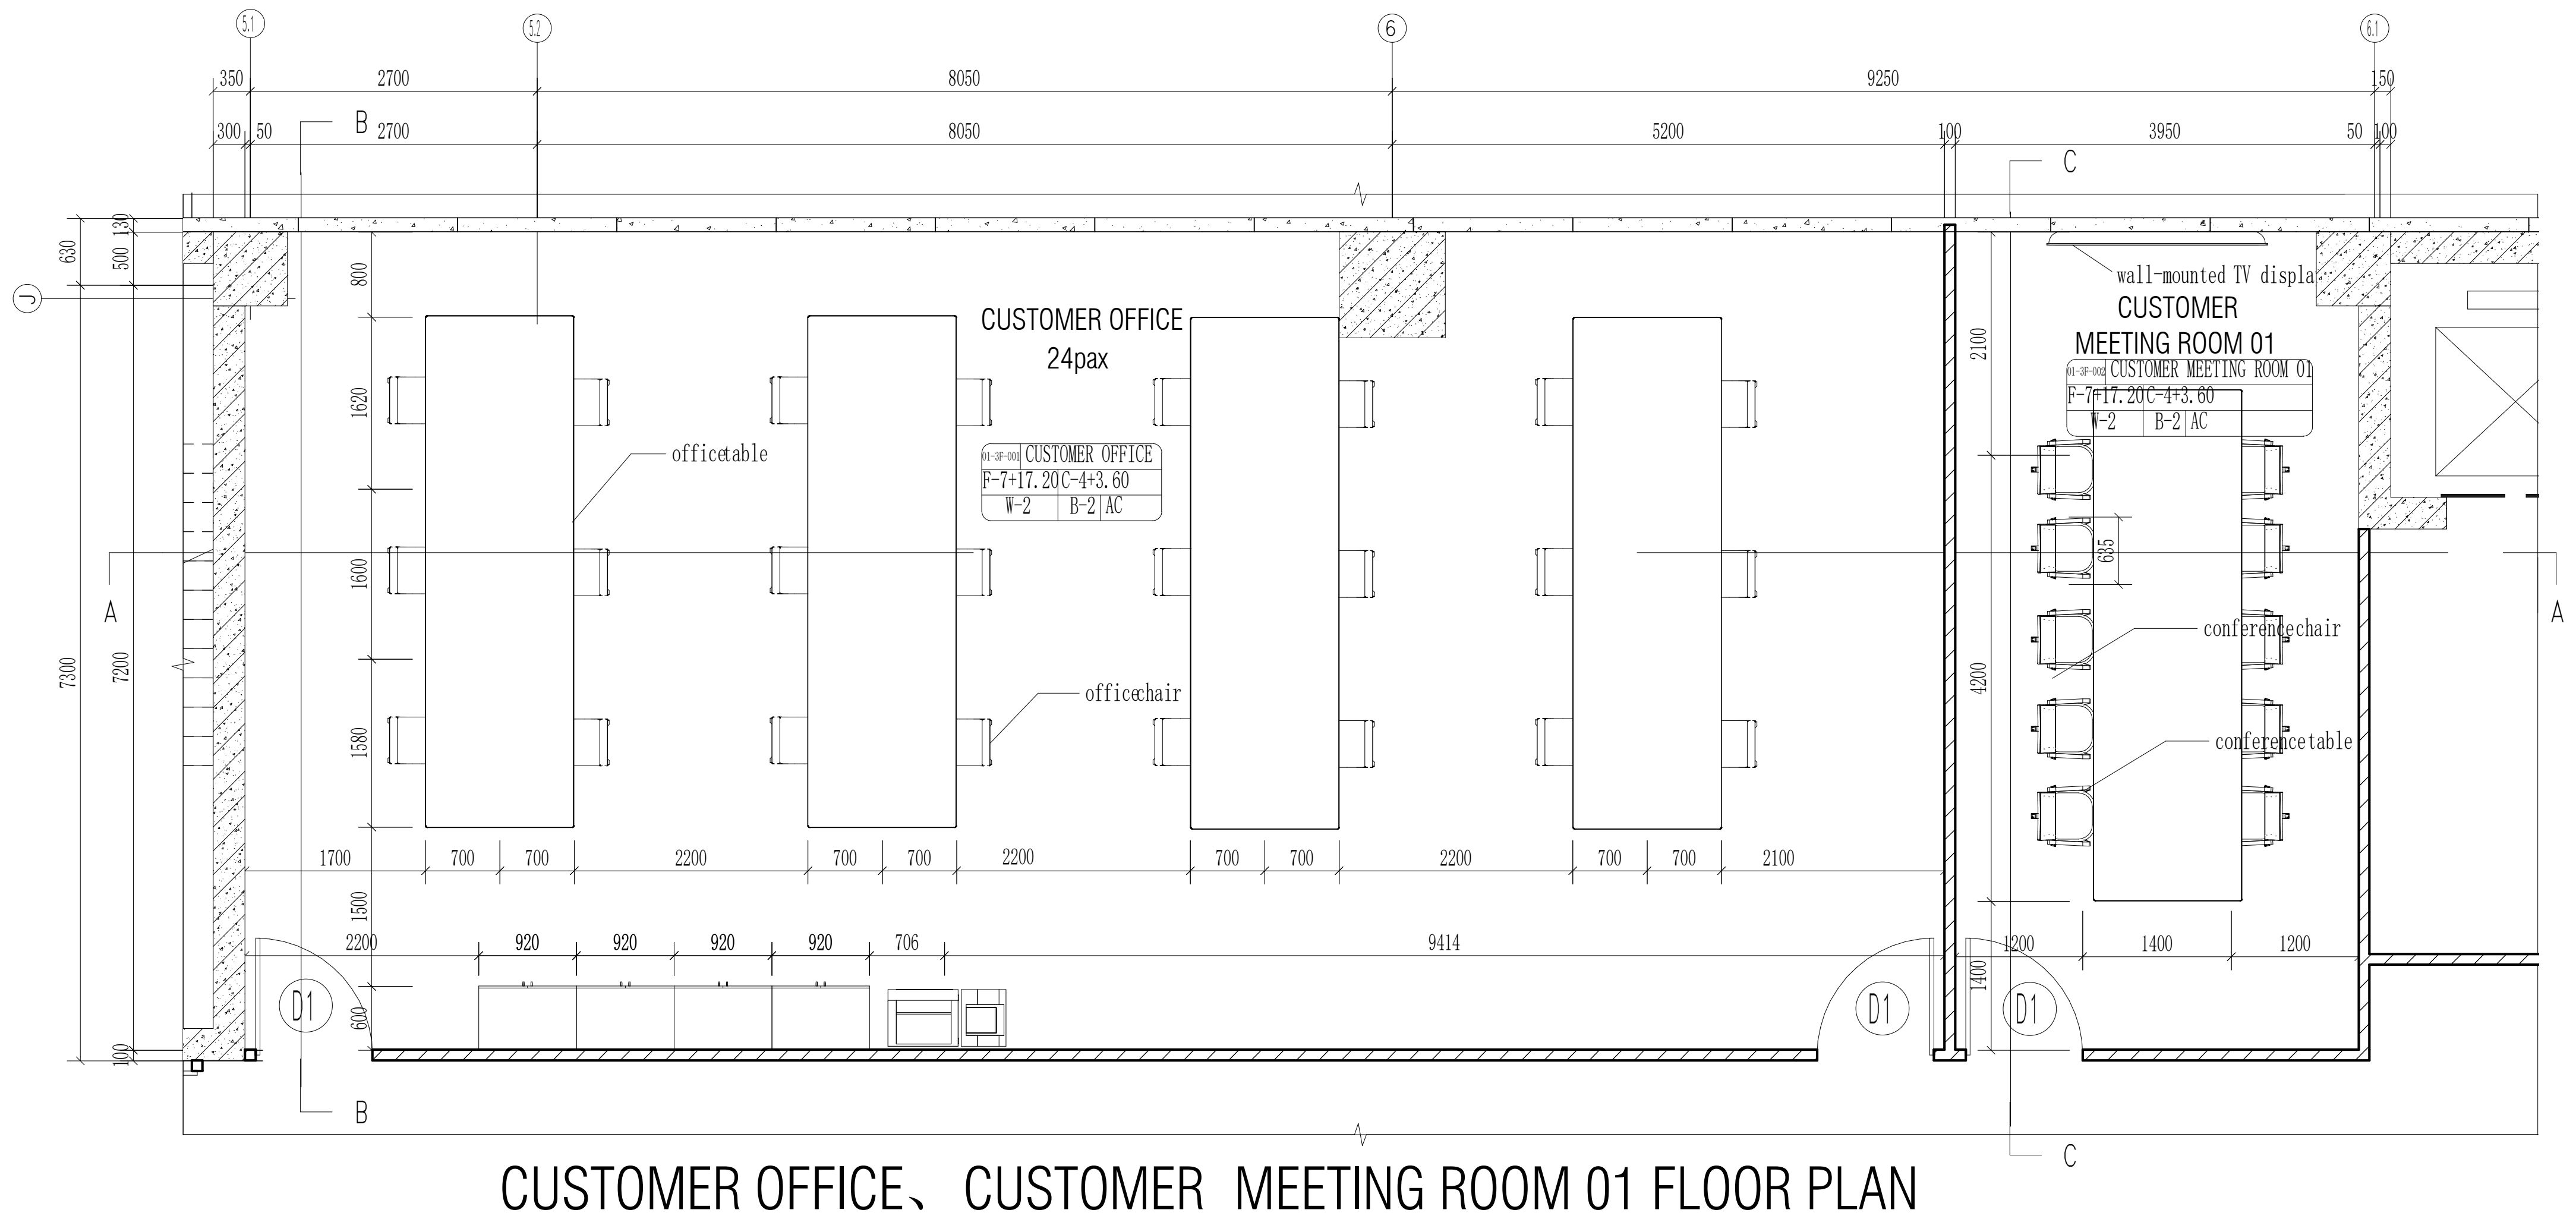
CUSTOMER OFFICE
24pax
CUSTOMER OFFICE F-7 17.20 C-4 3.60 W-2 B-2 AC
CUSTOMER MEETING ROOM 01
CUSTOMER MEETING ROOM 01 F-7 17.20 C-4 3.60 W-2 B-2 AC
wall-mounted TV display
officetable
officechair
conferencechair
conferencetable
2700
8050
9250
5200
3950
D1
A
B
C
J

CUSTOMER OFFICE、CUSTOMER MEETING ROOM 01 FLOOR PLAN

Scale 1:50

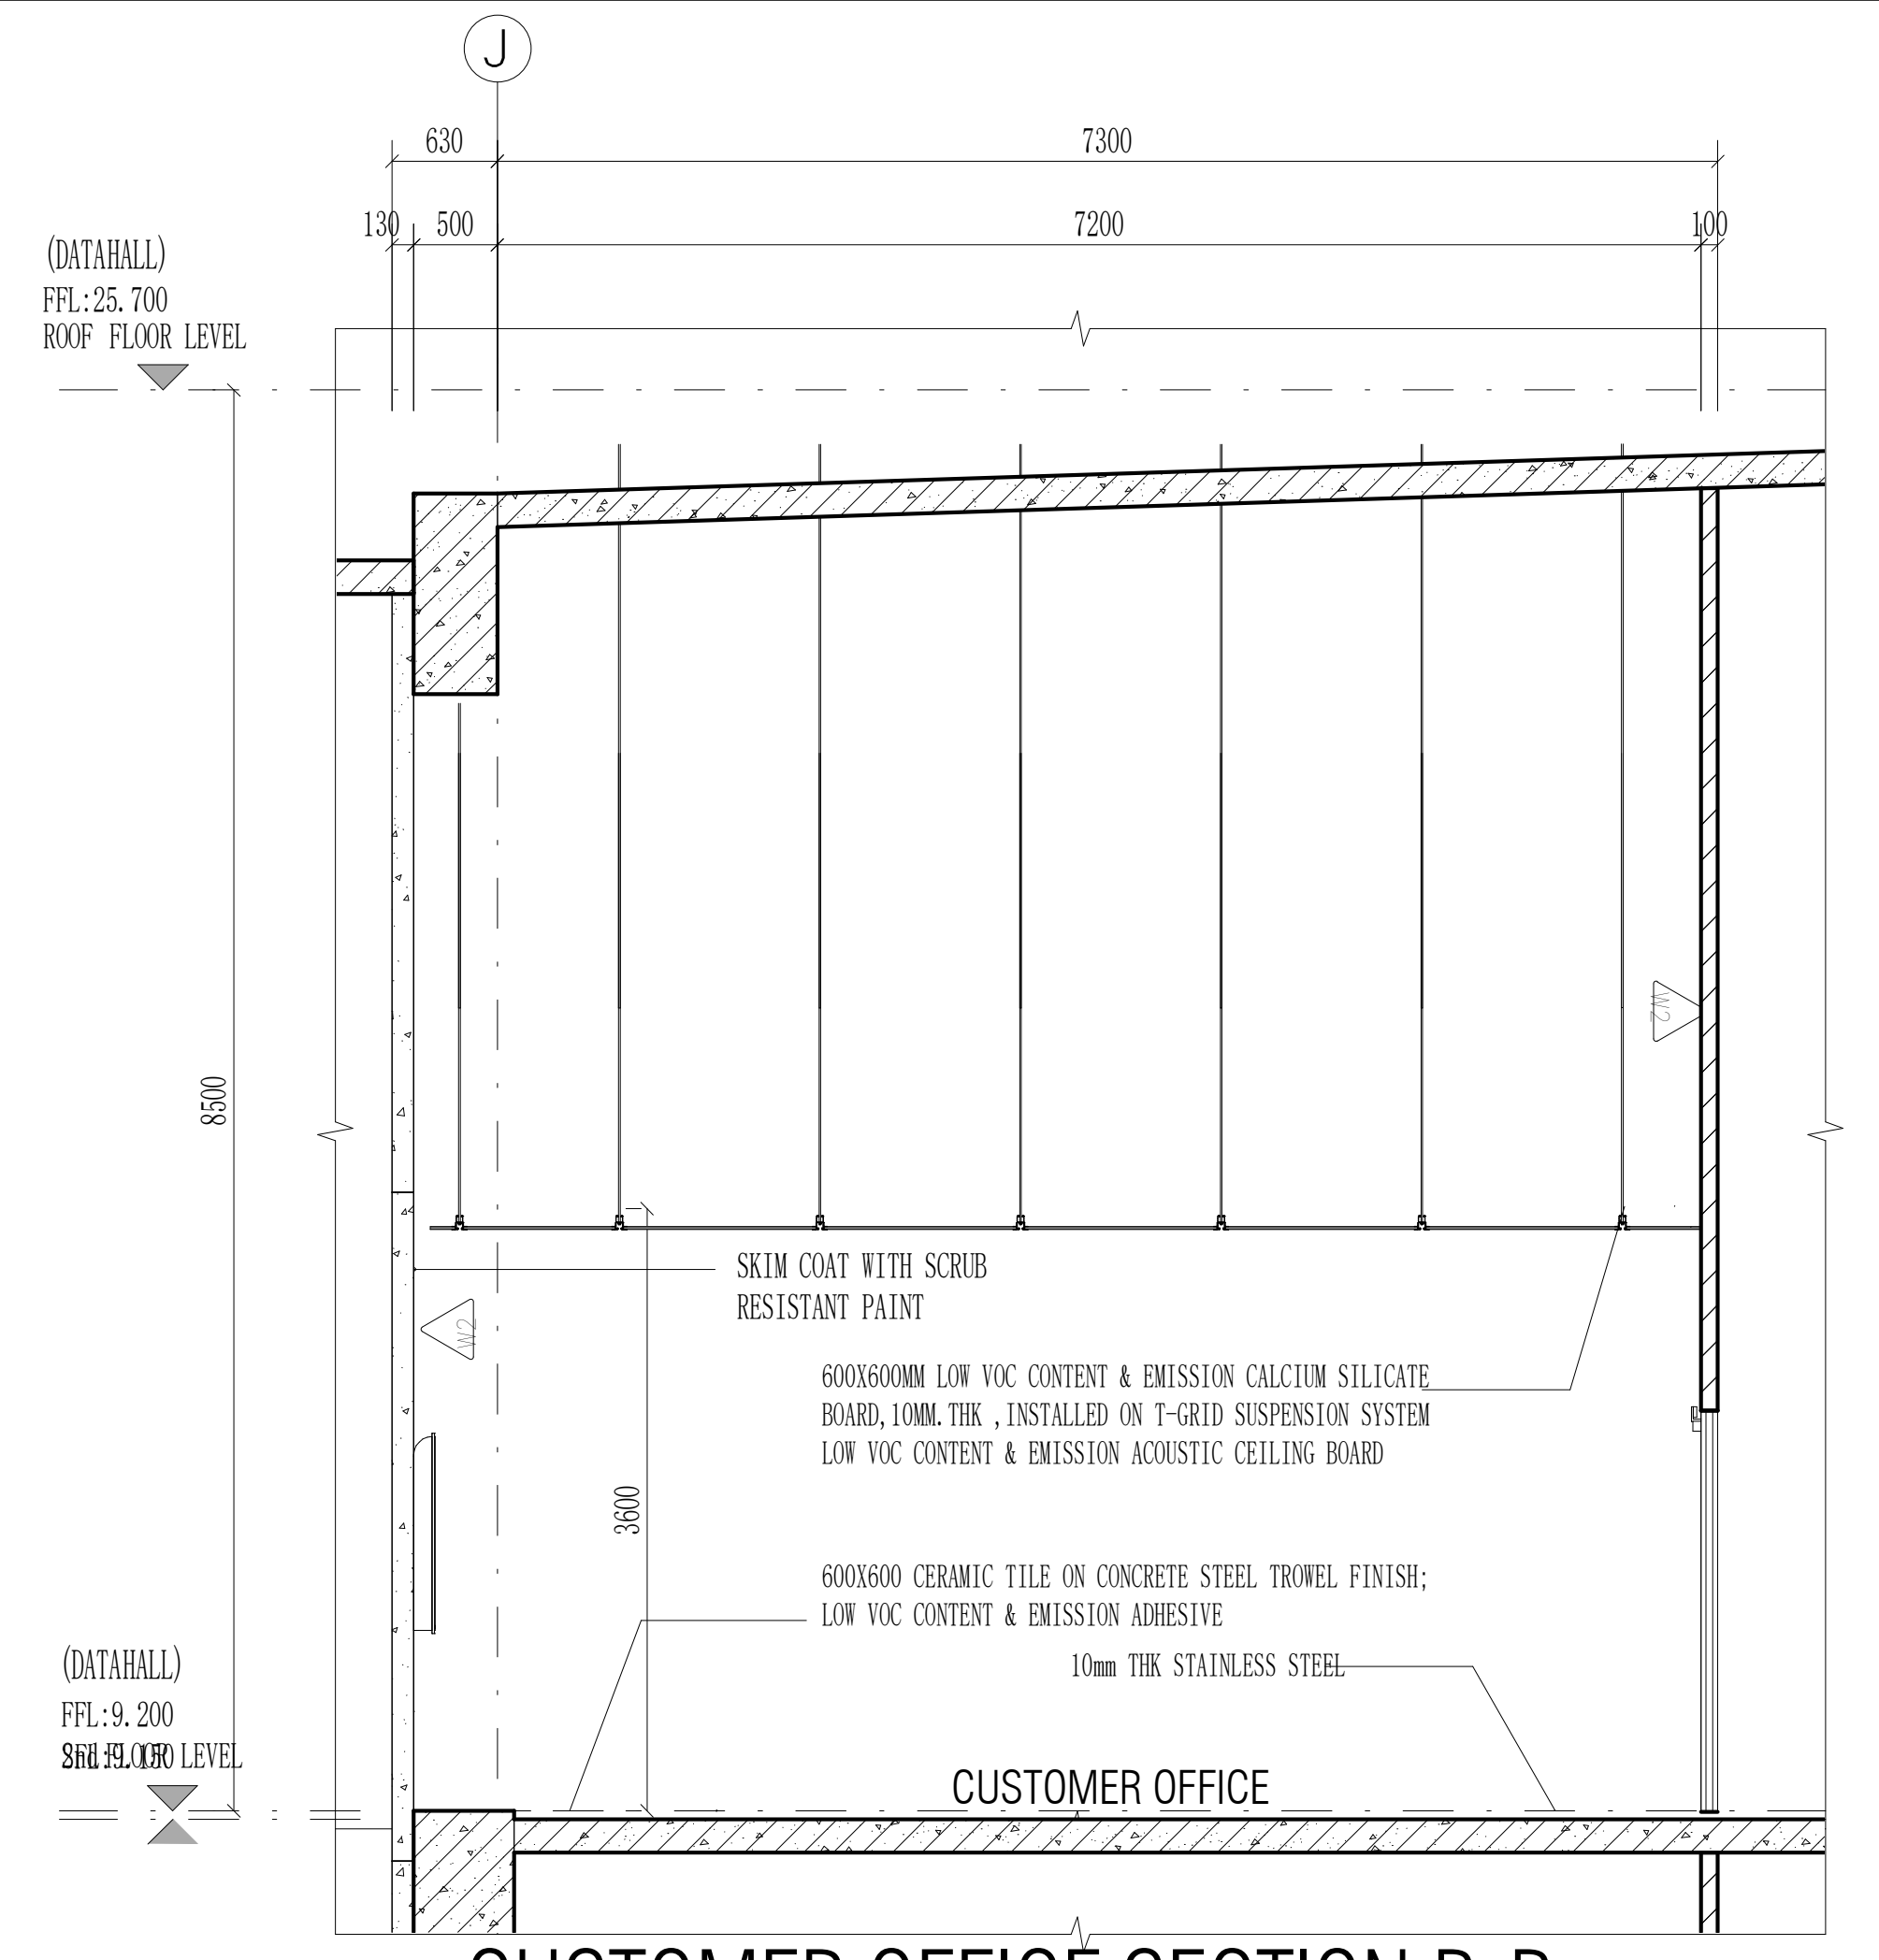
(DATAHALL)
FFL:25.700
ROOF FLOOR LEVEL
SKIM COAT WITH SCRUB RESISTANT PAINT
600X600MM LOW VOC CONTENT & EMISSION CALCIUM SILICATE BOARD,10MM.THK ,INSTALLED ON T-GRID SUSPENSION SYSTEM LOW VOC CONTENT & EMISSION ACOUSTIC CEILING BOARD
600X600 CERAMIC TILE ON CONCRETE STEEL TROWEL FINISH; LOW VOC CONTENT & EMISSION ADHESIVE
10mm THK STAINLESS STEEL
CUSTOMER OFFICE
(DATAHALL)
FFL:9.200
8500
3600
7300
7200
J

CUSTOMER OFFICE SECTION B-B

Scale 1:50

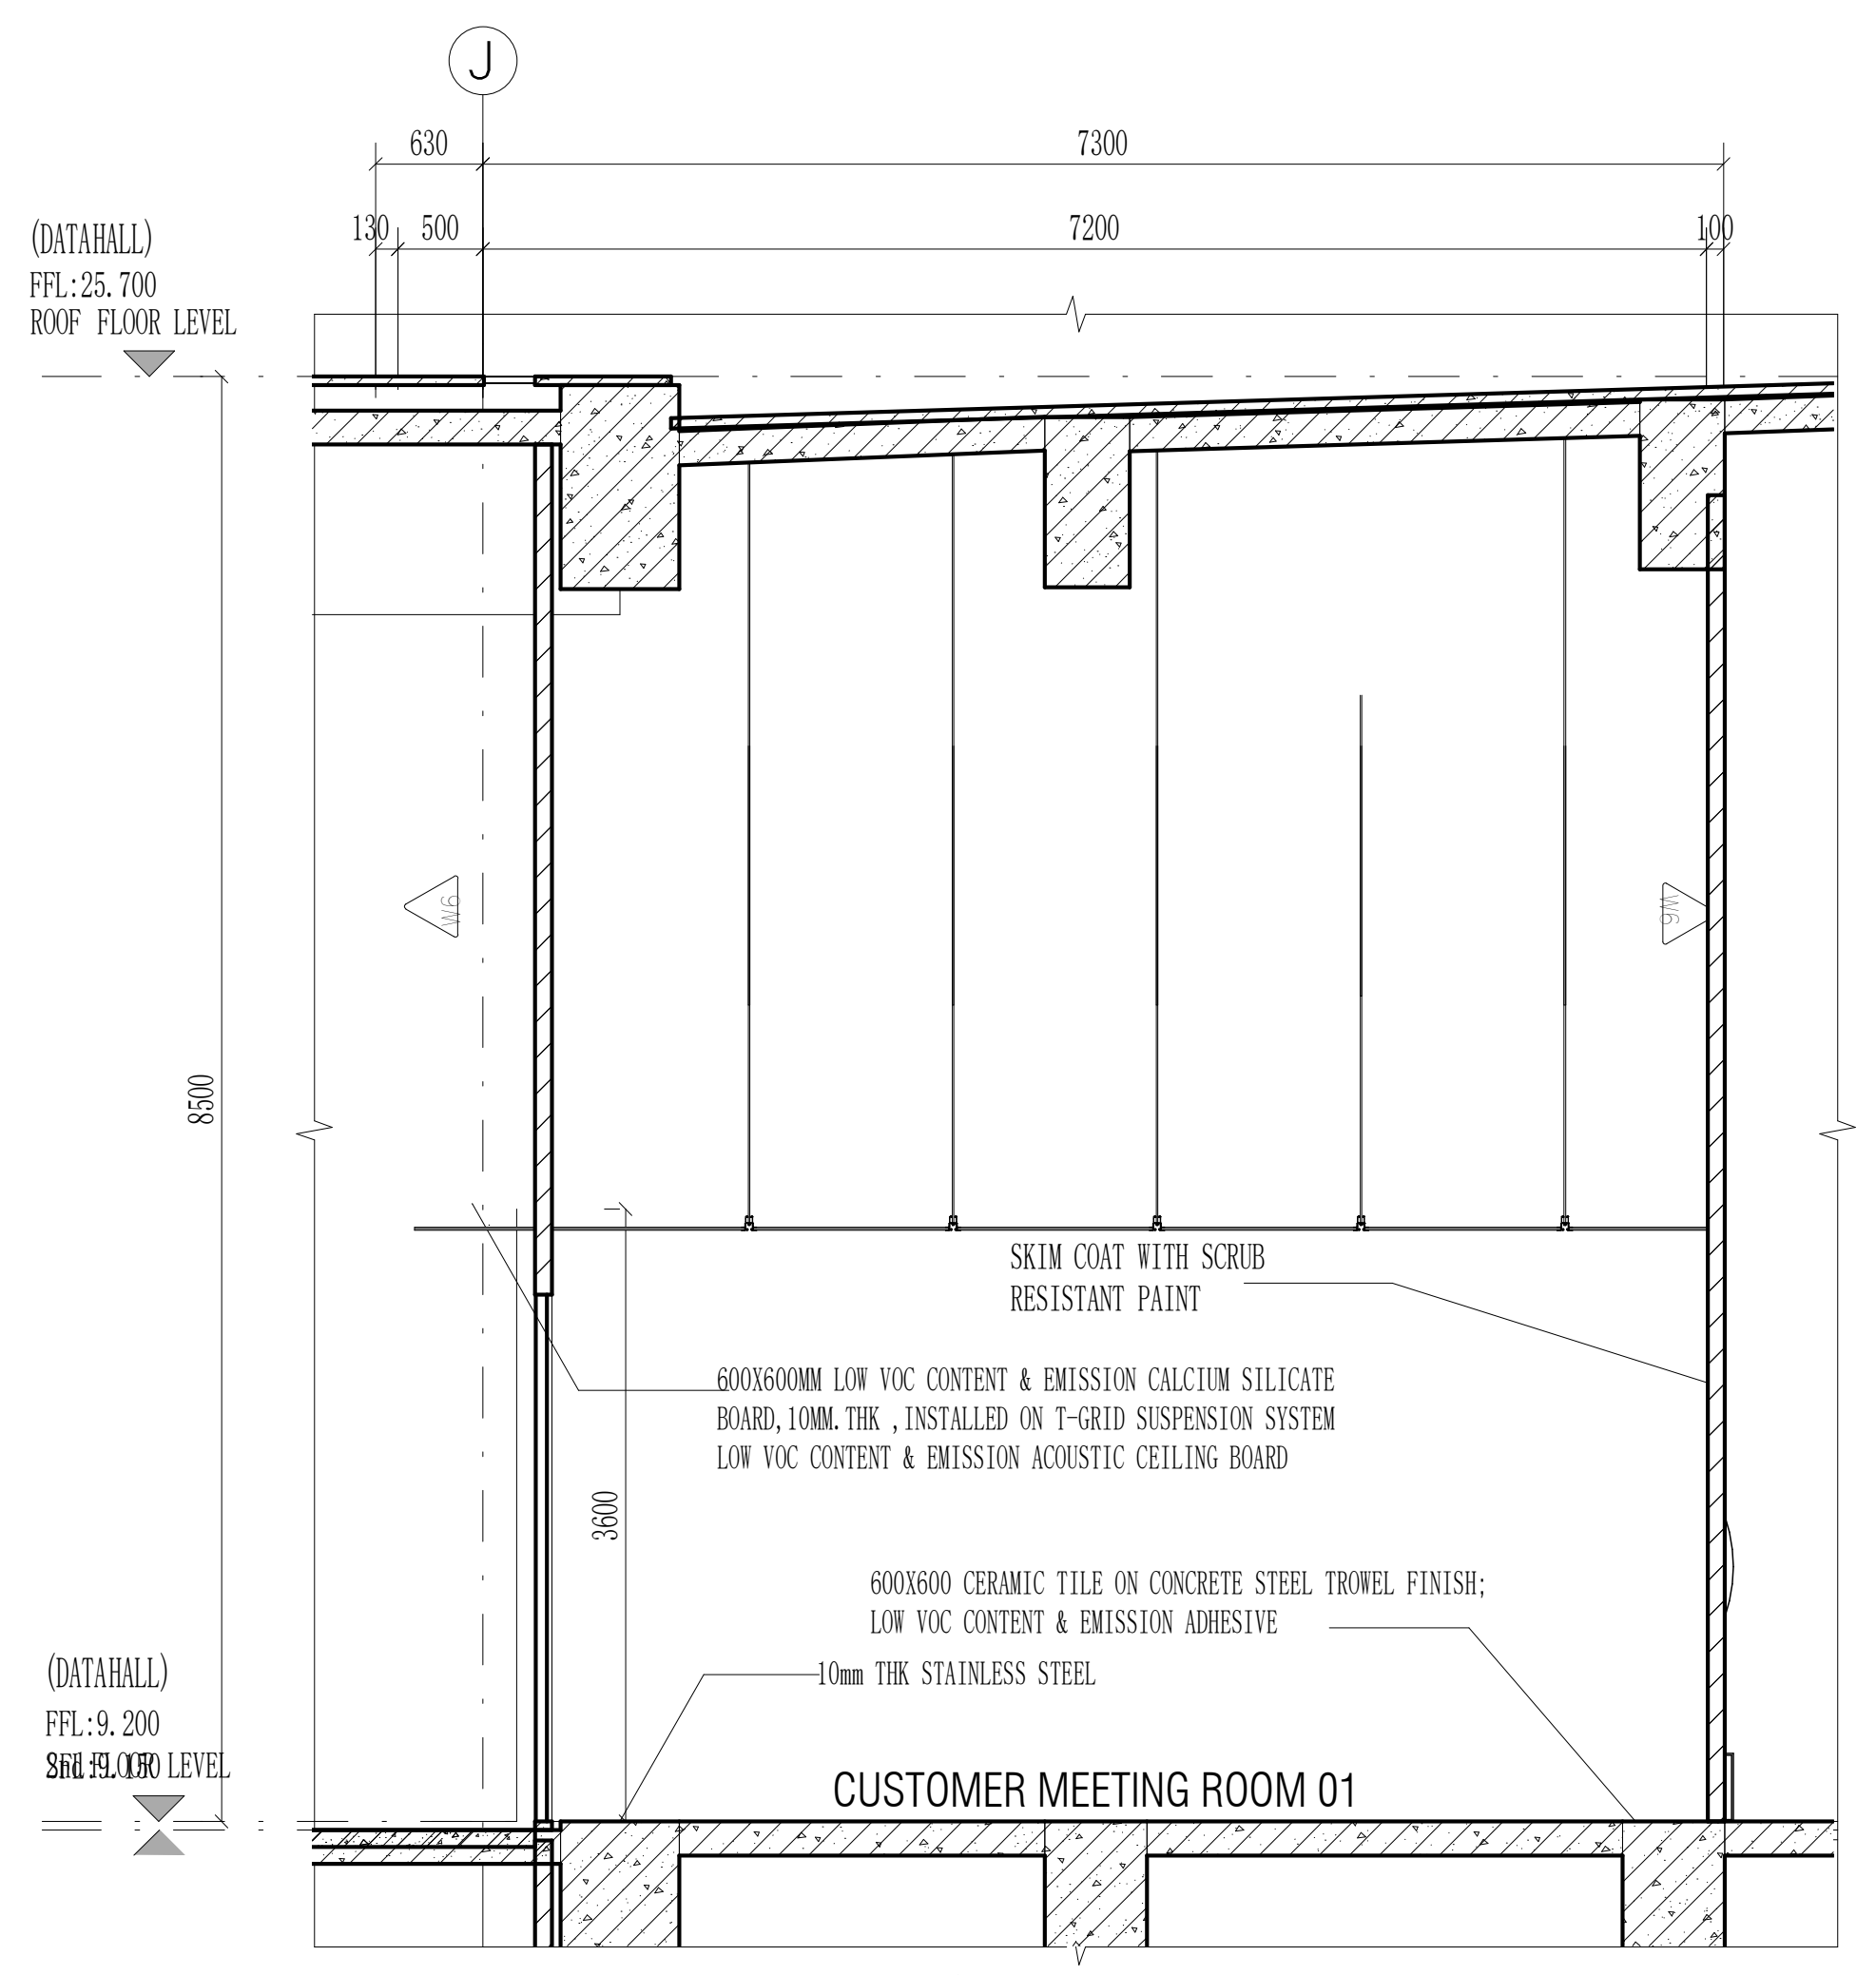
(DATAHALL)
FFL:25.700
ROOF FLOOR LEVEL
SKIM COAT WITH SCRUB RESISTANT PAINT
600X600MM LOW VOC CONTENT & EMISSION CALCIUM SILICATE BOARD,10MM.THK ,INSTALLED ON T-GRID SUSPENSION SYSTEM LOW VOC CONTENT & EMISSION ACOUSTIC CEILING BOARD
600X600 CERAMIC TILE ON CONCRETE STEEL TROWEL FINISH; LOW VOC CONTENT & EMISSION ADHESIVE
10mm THK STAINLESS STEEL
CUSTOMER MEETING ROOM 01
(DATAHALL)
FFL:9.200
8500
3600
7300
7200
J

CUSTOMER MEETING ROOM 01 SECTION C-C

Scale 1:50

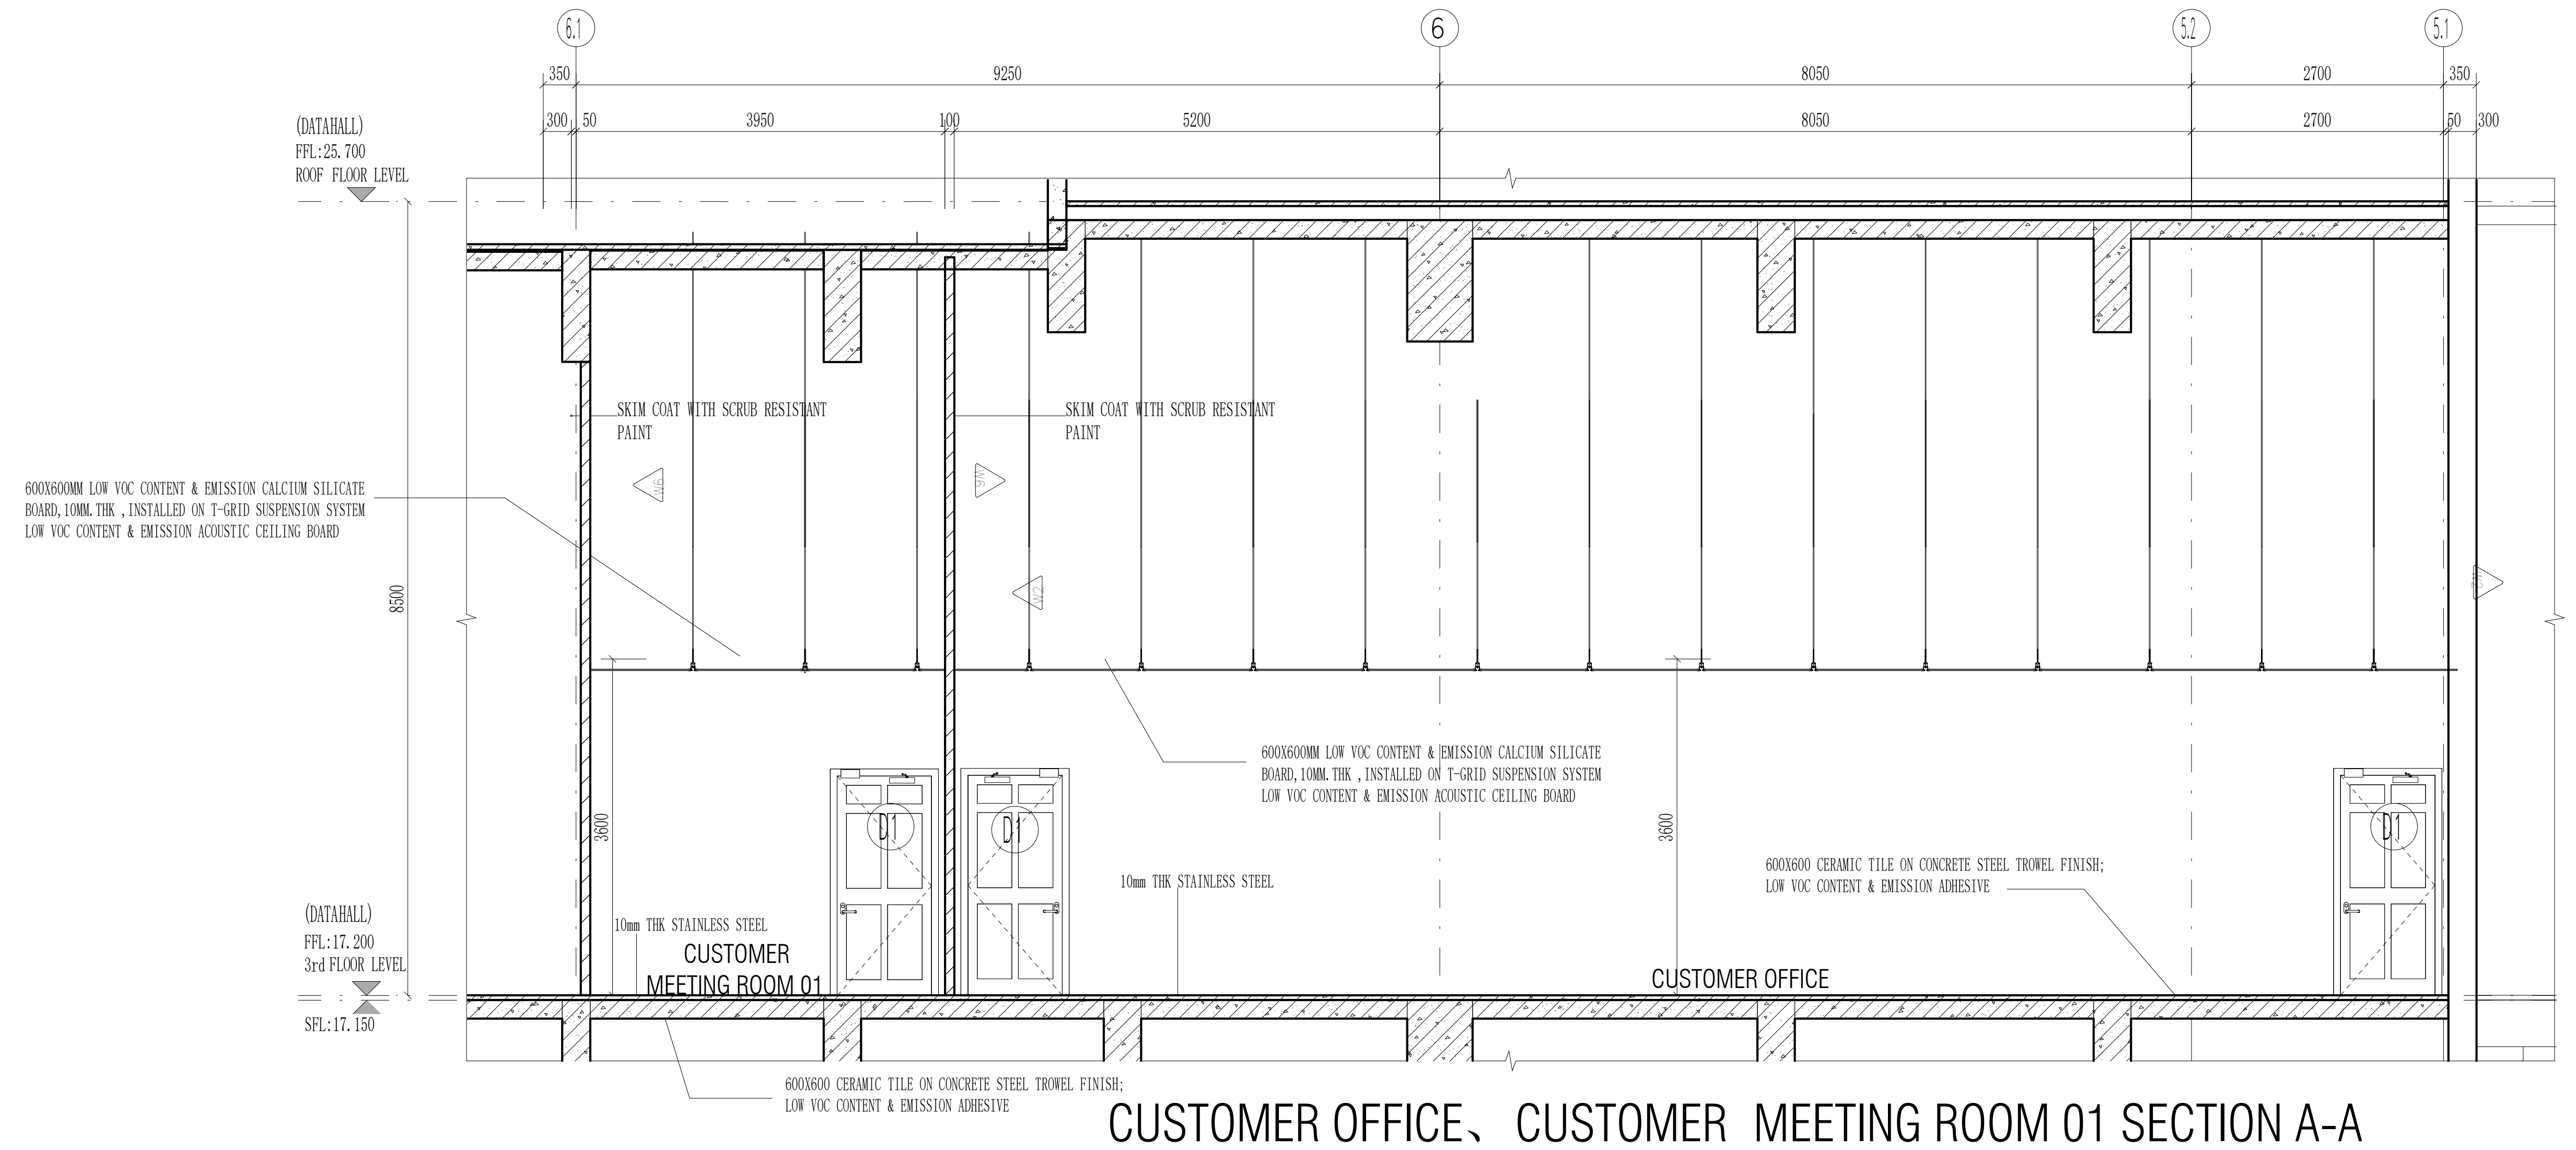
(DATAHALL)
FFL:25.700
ROOF FLOOR LEVEL
SKIM COAT WITH SCRUB RESISTANT PAINT
600X600MM LOW VOC CONTENT & EMISSION CALCIUM SILICATE BOARD,10MM.THK ,INSTALLED ON T-GRID SUSPENSION SYSTEM LOW VOC CONTENT & EMISSION ACOUSTIC CEILING BOARD
10mm THK STAINLESS STEEL
600X600 CERAMIC TILE ON CONCRETE STEEL TROWEL FINISH; LOW VOC CONTENT & EMISSION ADHESIVE
CUSTOMER MEETING ROOM 01
CUSTOMER OFFICE
D1
(DATAHALL)
FFL:17.200
3rd FLOOR LEVEL
SFL:17.150
8500
3600
9250
8050
2700
6

CUSTOMER OFFICE、CUSTOMER MEETING ROOM 01 SECTION A-A

Scale 1:50

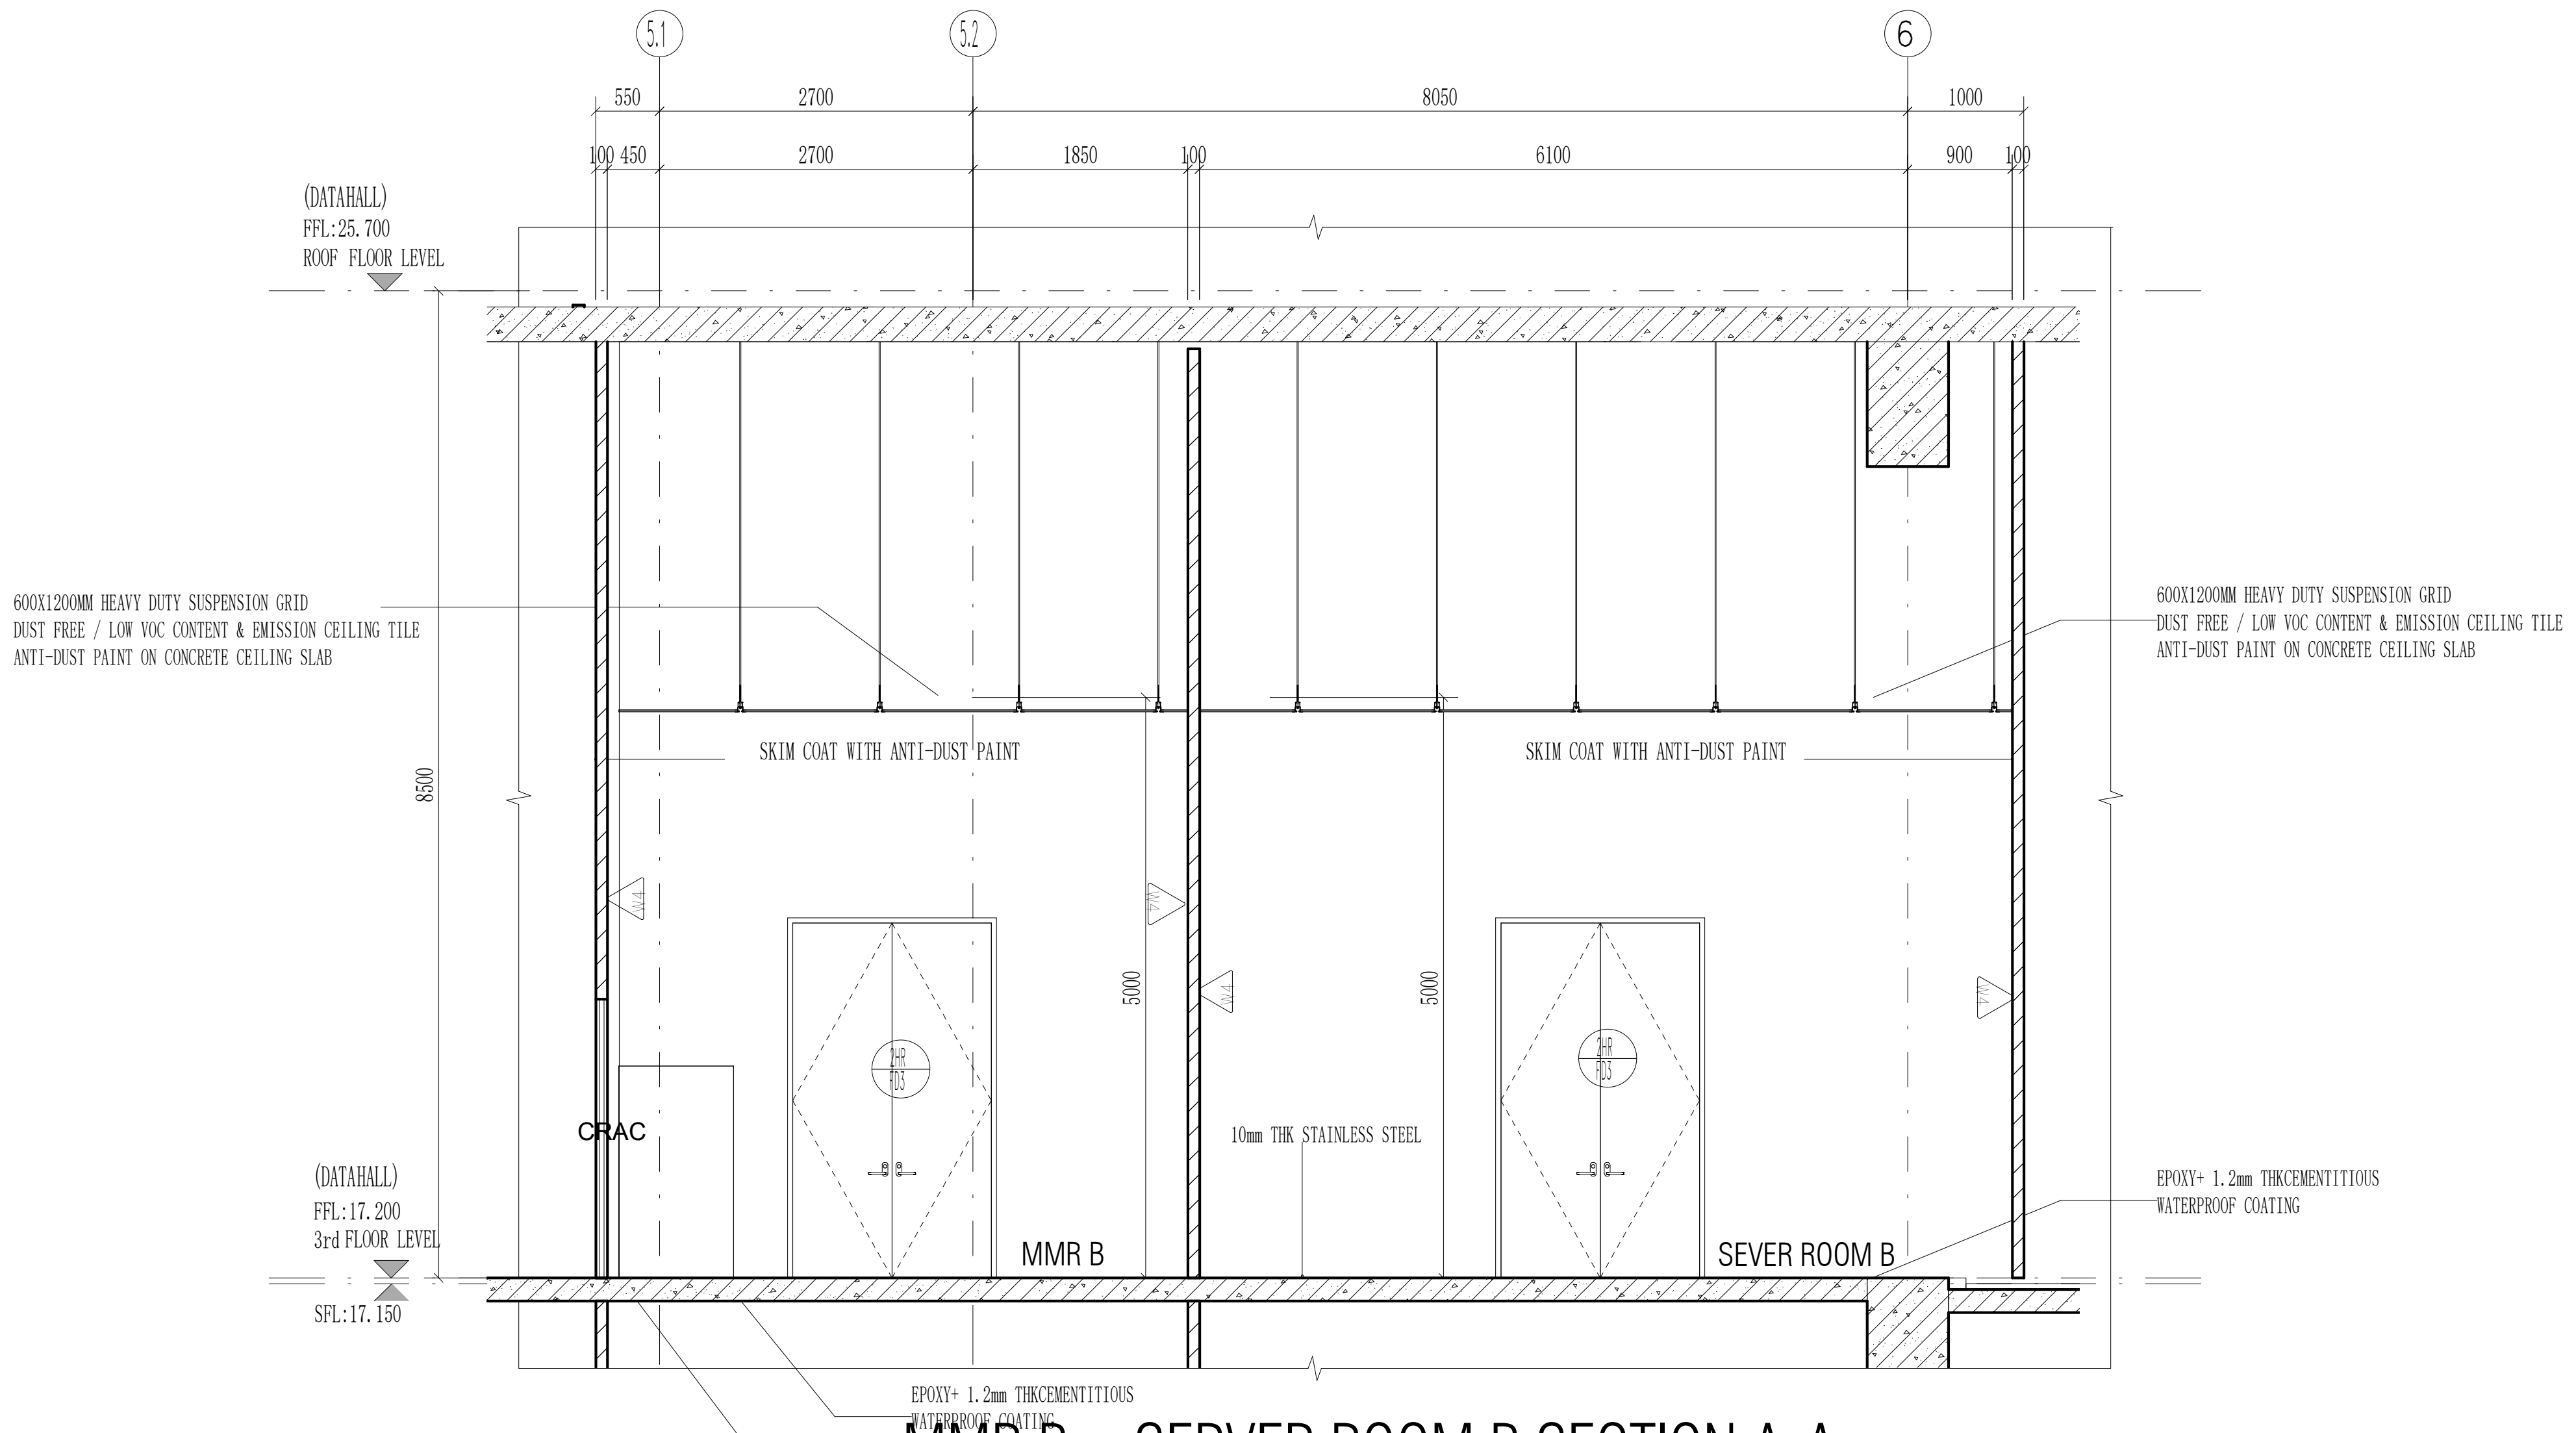
(DATAHALL)
FFL:25.700
ROOF FLOOR LEVEL
600X1200MM HEAVY DUTY SUSPENSION GRID DUST FREE / LOW VOC CONTENT & EMISSION CEILING TILE ANTI-DUST PAINT ON CONCRETE CEILING SLAB
SKIM COAT WITH ANTI-DUST PAINT
CRAC
10mm THK STAINLESS STEEL
EPOXY+ 1.2mm THKCEMENTITIOUS WATERPROOF COATING
MMR B
SEVER ROOM B
(DATAHALL)
FFL:17.200
3rd FLOOR LEVEL
SFL:17.150
8500
5000
2700
8050
6

MMR B、SERVER ROOM B SECTION A-A

Scale 1:50

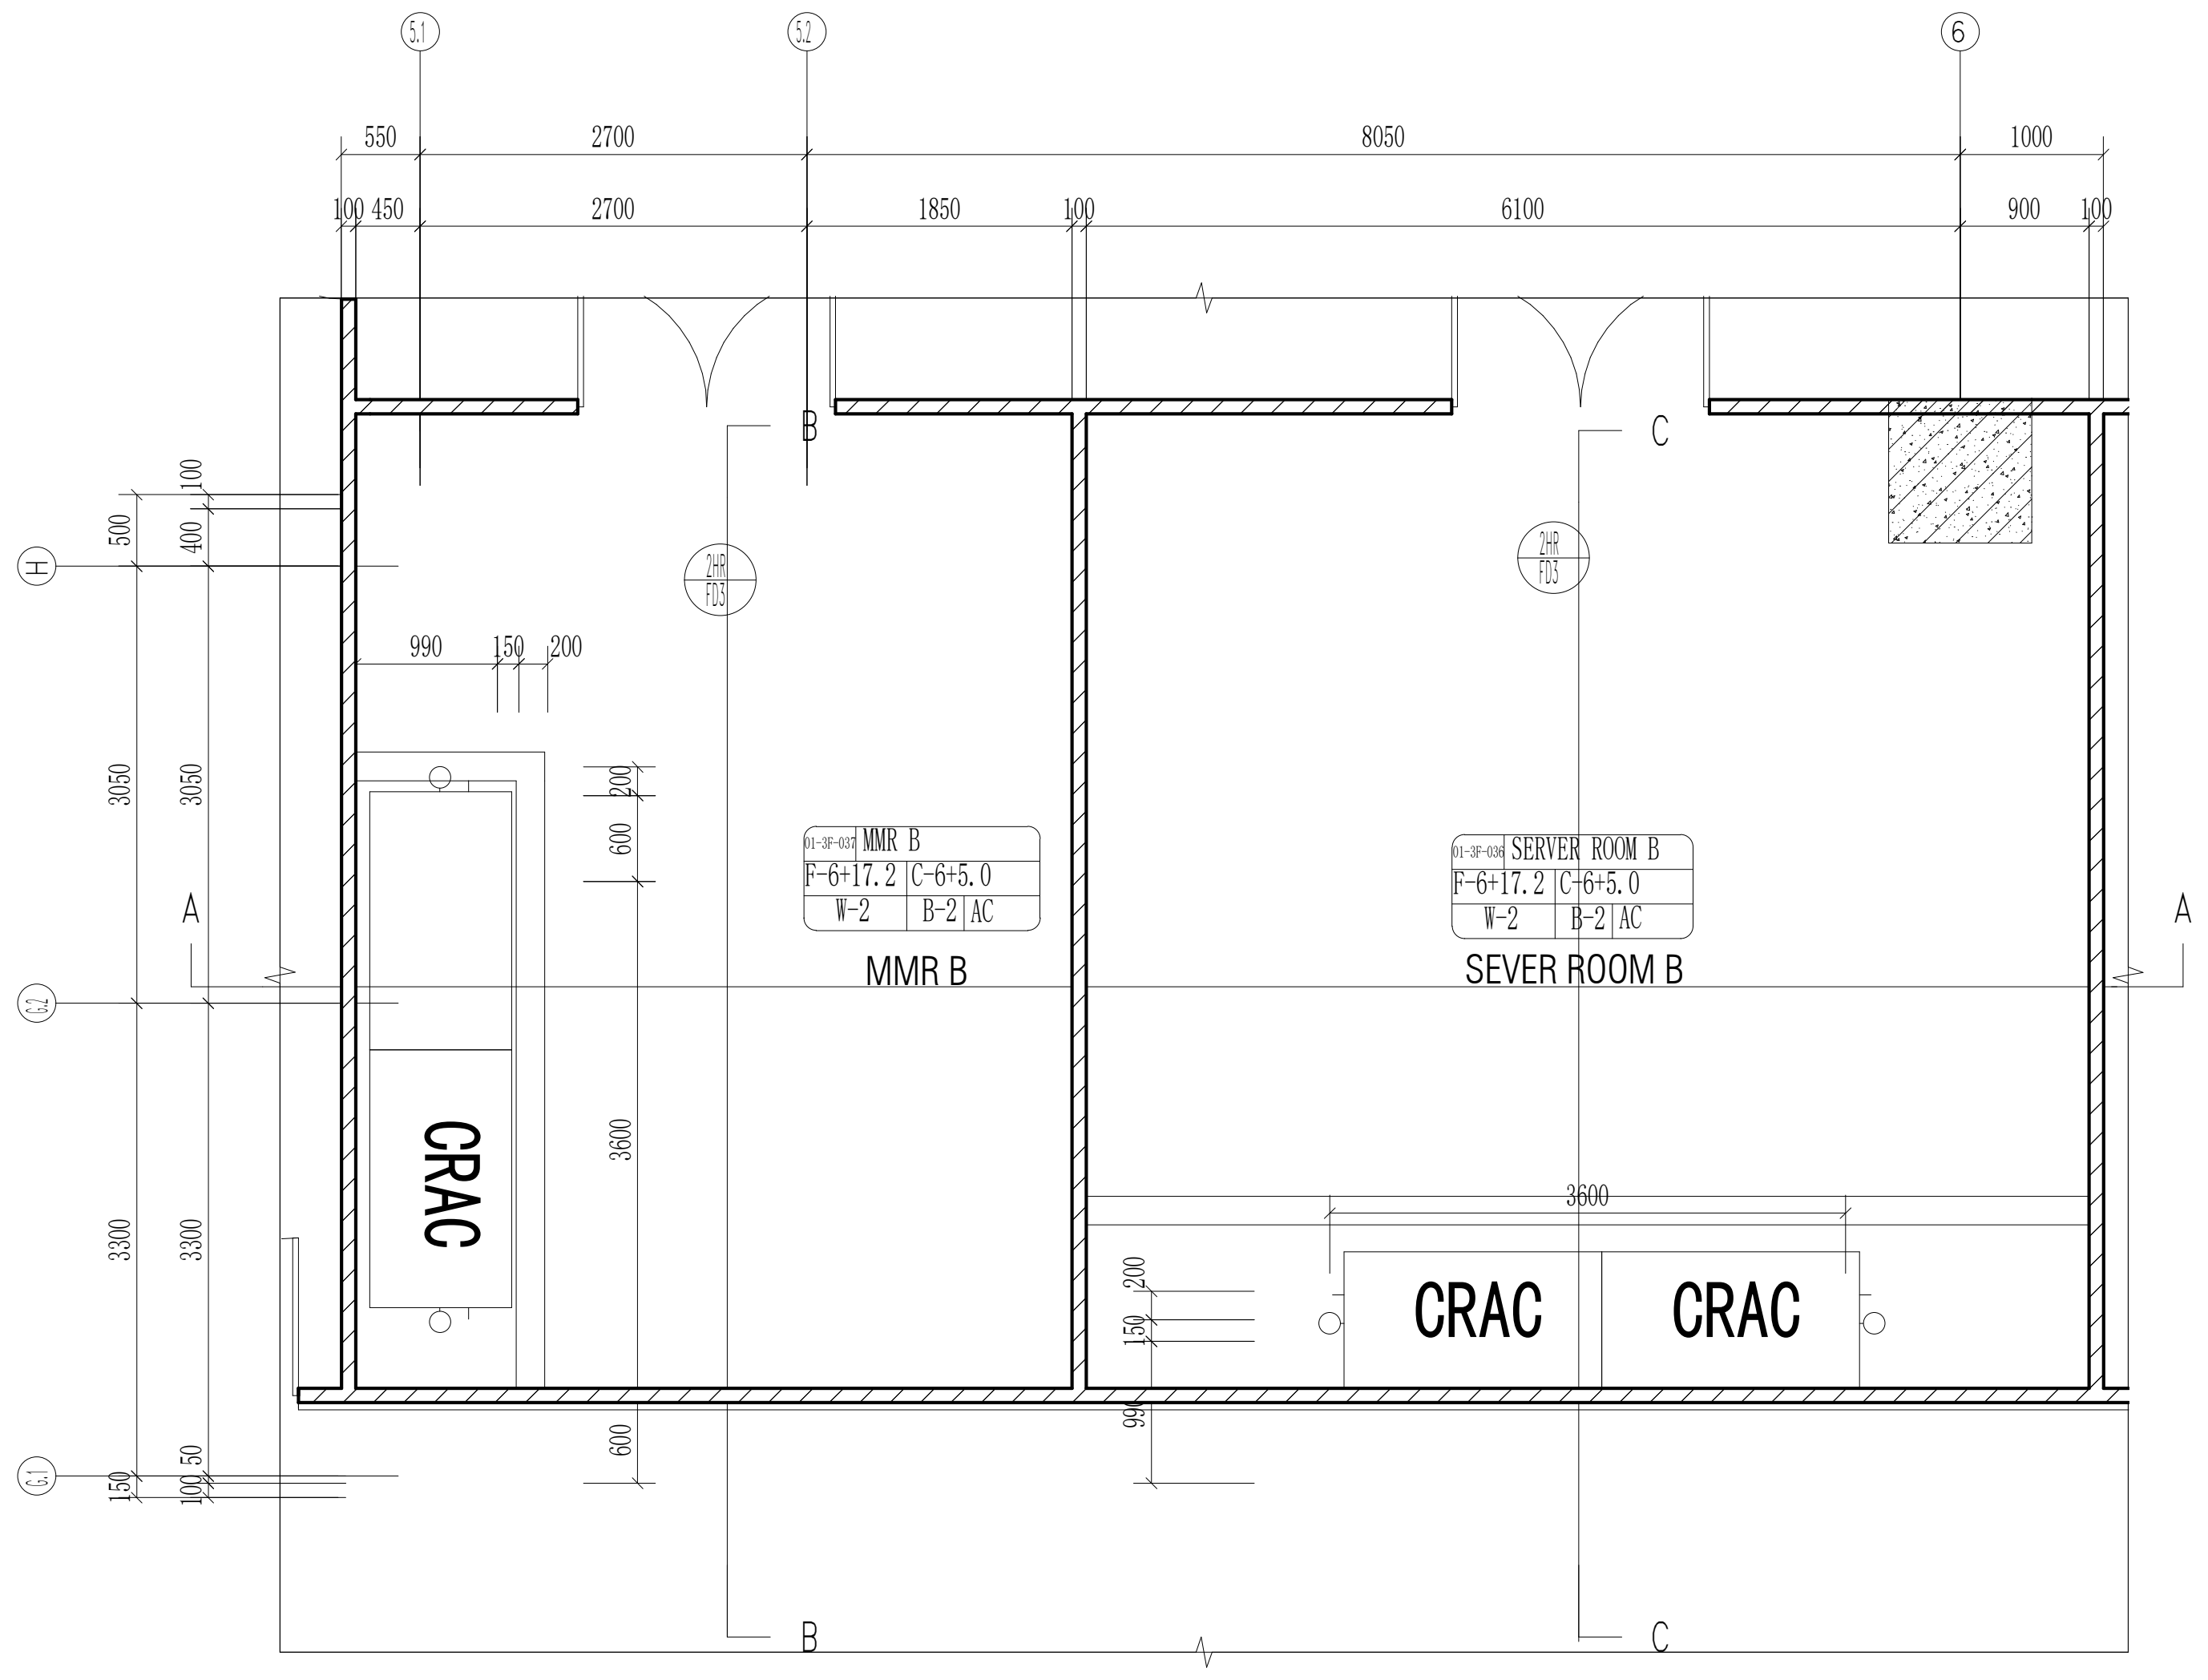
MMR B F-6 17.2 C-6 5.0 W-2 B-2 AC
SERVER ROOM B F-6 17.2 C-6 5.0 W-2 B-2 AC
MMR B
SEVER ROOM B
CRAC
CRAC
CRAC
2700
8050
6100
3600
A
B
C
6

MMR B、SERVER ROOM B FLOOR PLAN

Scale 1:50

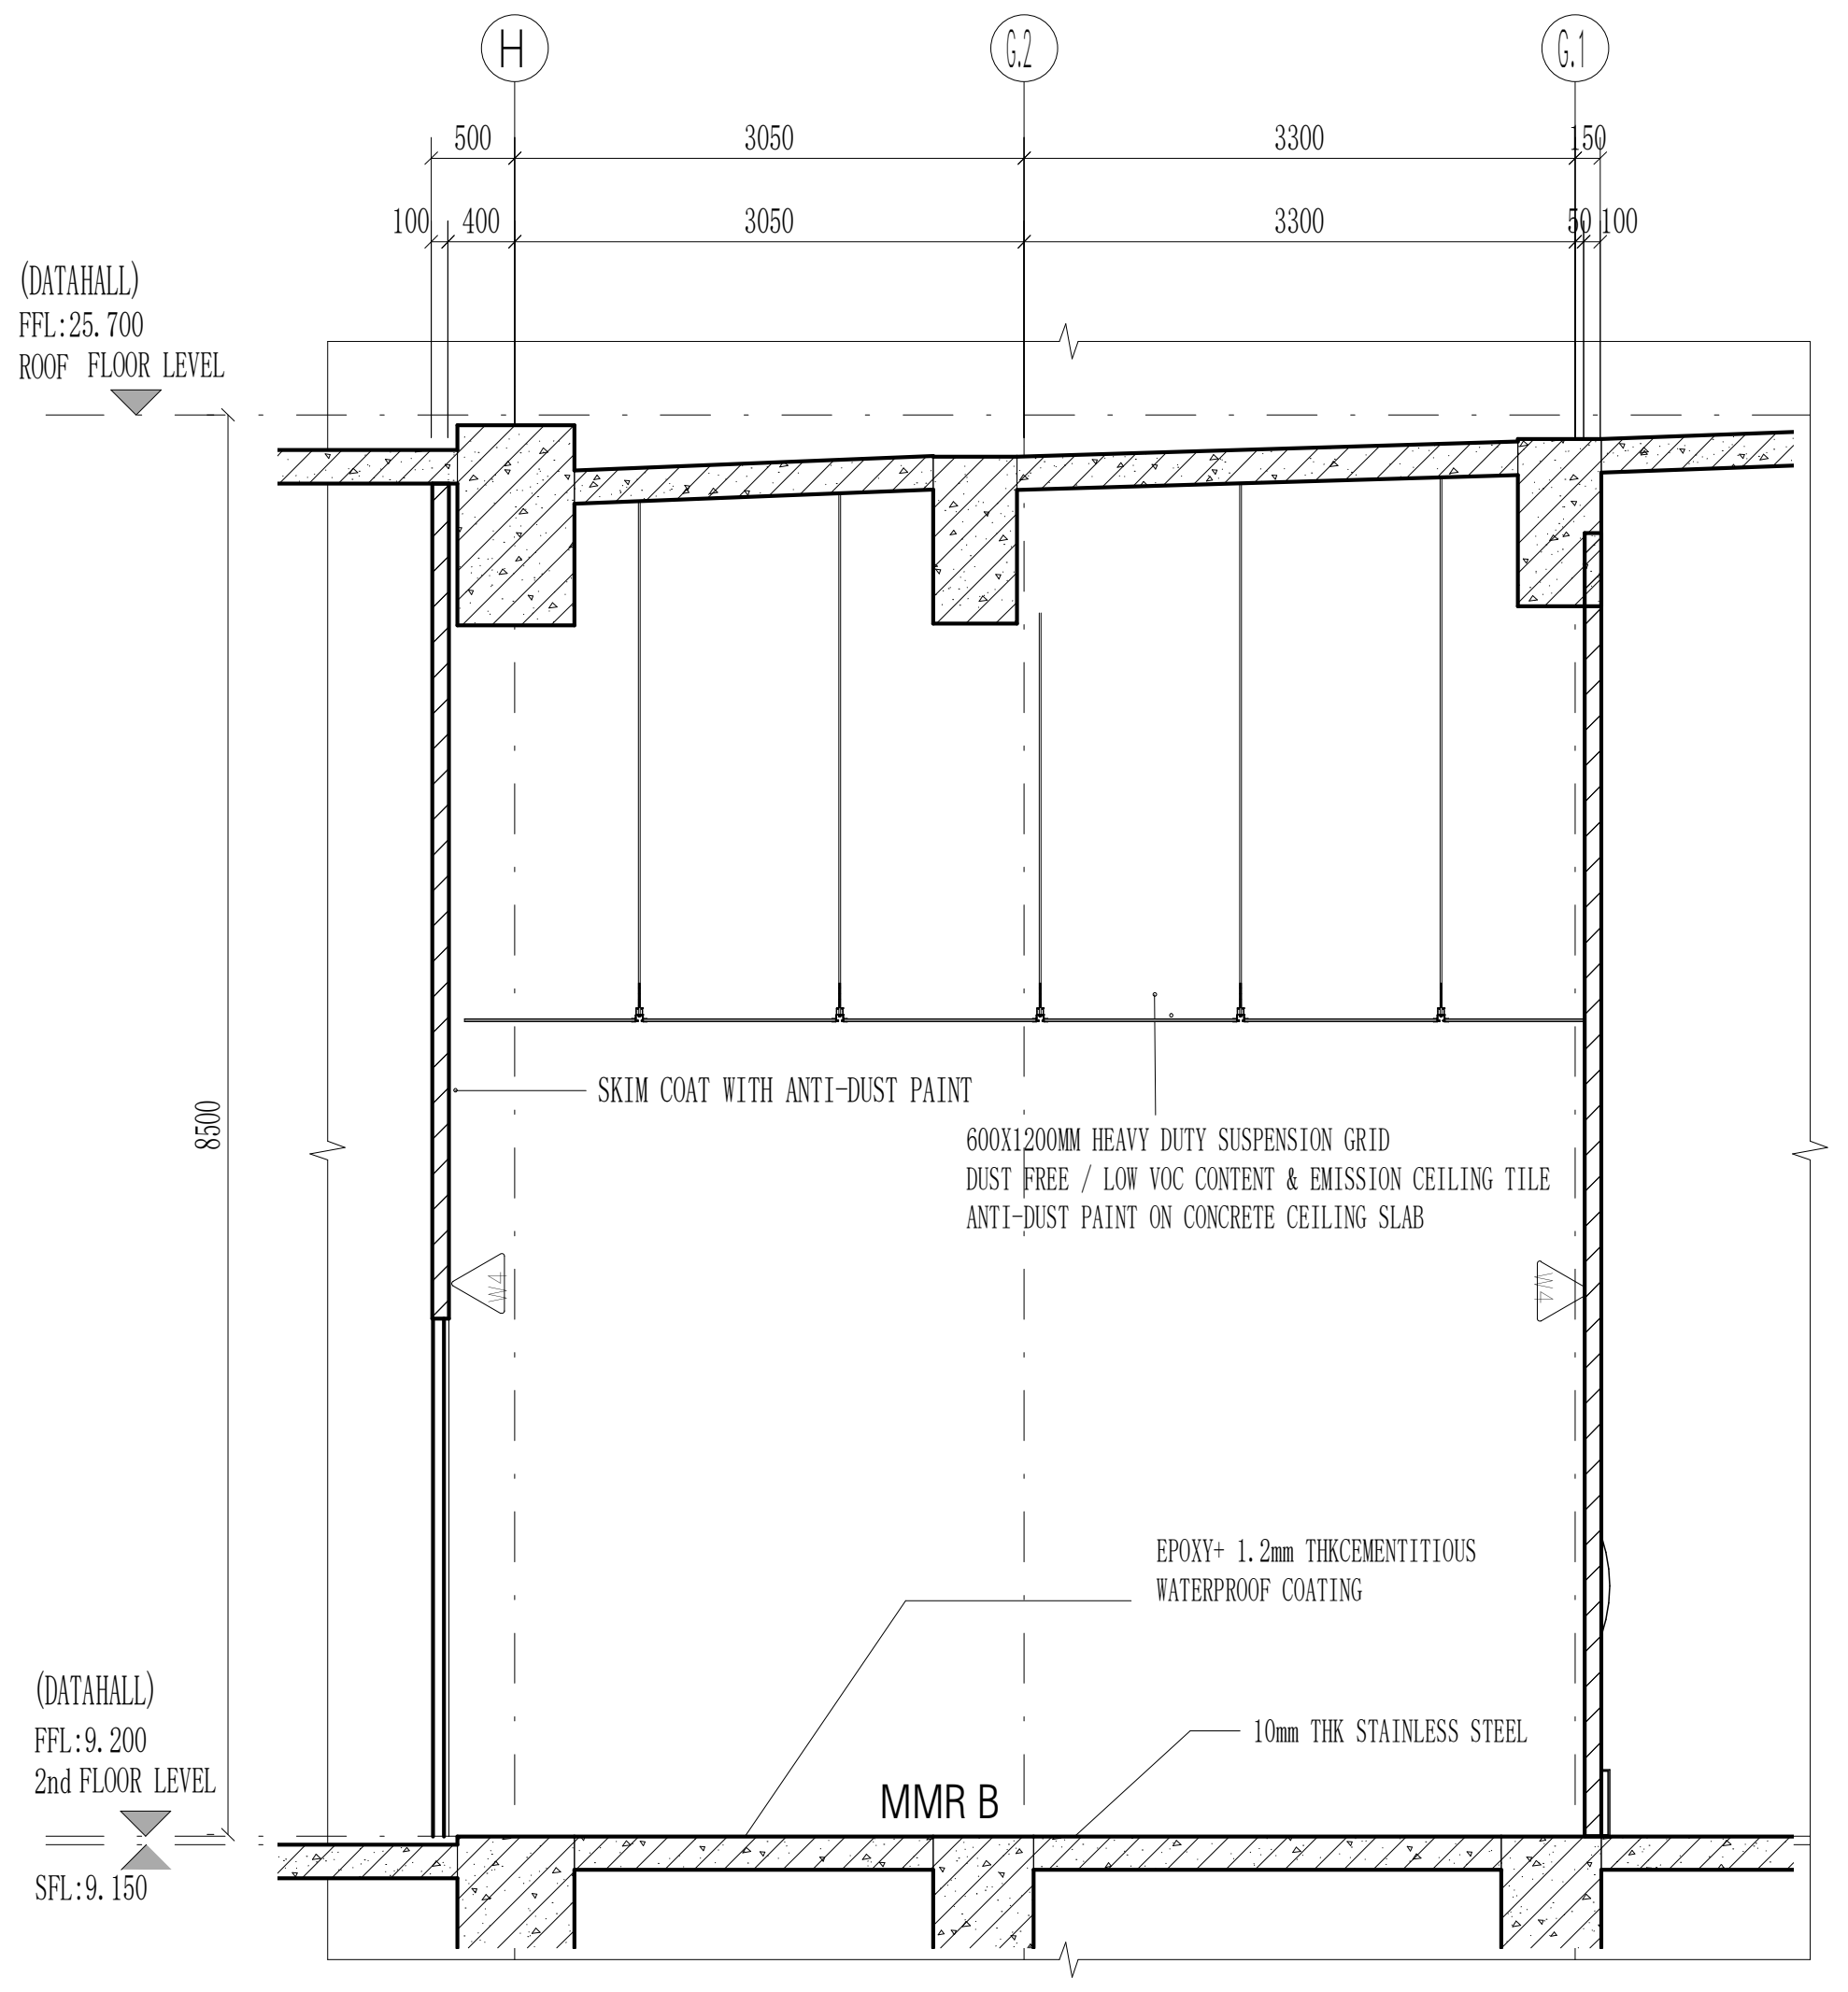
(DATAHALL)
FFL:25.700
ROOF FLOOR LEVEL
SKIM COAT WITH ANTI-DUST PAINT
600X1200MM HEAVY DUTY SUSPENSION GRID DUST FREE / LOW VOC CONTENT & EMISSION CEILING TILE ANTI-DUST PAINT ON CONCRETE CEILING SLAB
EPOXY+ 1.2mm THKCEMENTITIOUS WATERPROOF COATING
10mm THK STAINLESS STEEL
MMR B
(DATAHALL)
FFL:9.200
2nd FLOOR LEVEL
SFL:9.150
8500
3050
3300
H
G.2
G.1

MMR B SECTION B-B

Scale 1:50

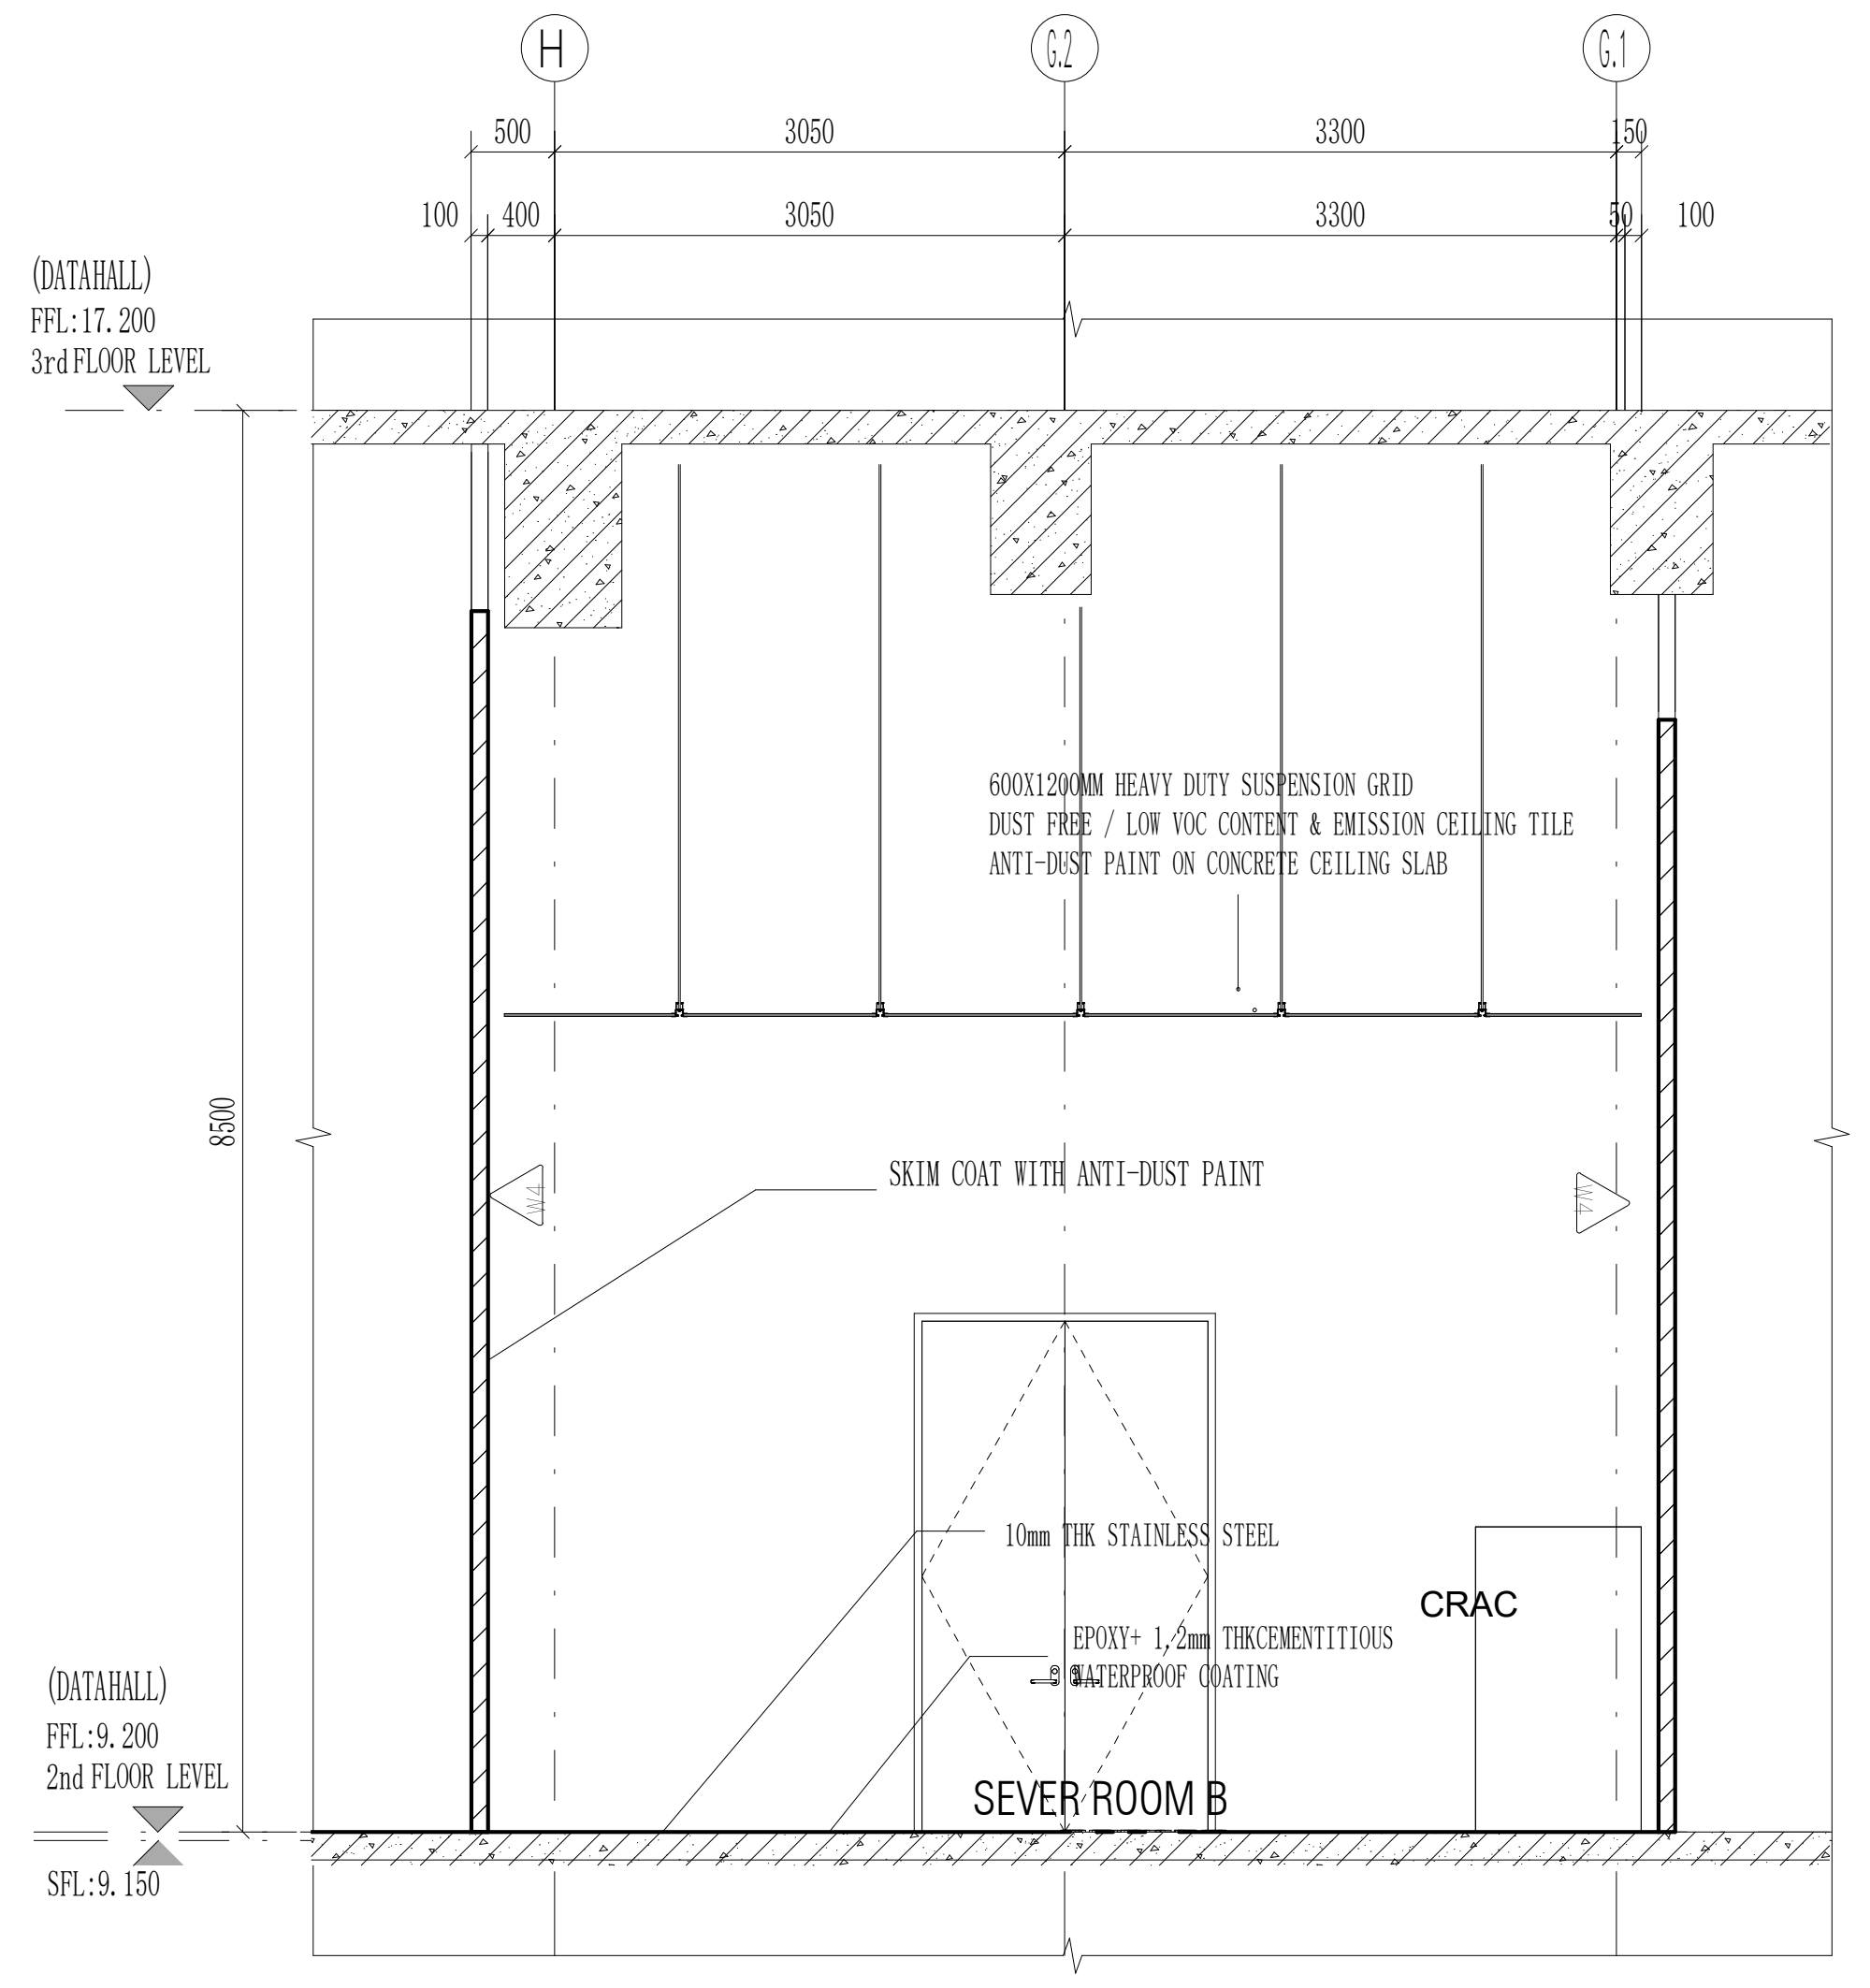
(DATAHALL)
FFL:17.200
3rd FLOOR LEVEL
600X1200MM HEAVY DUTY SUSPENSION GRID DUST FREE / LOW VOC CONTENT & EMISSION CEILING TILE ANTI-DUST PAINT ON CONCRETE CEILING SLAB
SKIM COAT WITH ANTI-DUST PAINT
10mm THK STAINLESS STEEL
EPOXY+ 1.2mm THKCEMENTITIOUS WATERPROOF COATING
CRAC
SEVER ROOM B
(DATAHALL)
FFL:9.200
2nd FLOOR LEVEL
SFL:9.150
8500
3050
3300
H
G.2
G.1

SERVER ROOM B SECTION C-C

Scale 1:50

CLIENT :

GULF EDGE DC 01

87 Wireless Road, M Thai Tower 11th. Floor, All Seasons Place, Lumpini, Pathumwan, Bangkok 10330, Thailand

CONTRACTOR :

华西发展(泰国)有限公司
บริษัท หัวซือ ดีเวลลอปเม้นต์ (ประเทศไทย) จำกัด
HUASHI DEVELOPMENT CO.,LTD
No. 202, Room No. 1403, 14/F, Le Concorde Building,
Ratchadapisek Road, Huaykhwang Sub-District,
Huaykhwang District, Bangkok Metropolitan 10310.

CONSULTANT :

ARbay
บริษัท เอ อาร์ เบย์ จำกัด
ARbay Company Limited
31 st Floor Bangkok Insurance Building
25 South Sathorn road Thungmahamek
Sathorn Bangkok 10120 THAILAND
T +66 (0) 2286 8199
F +66 (0) 2286 2863
info@arbay.co.th

CONSULTANT :

Qbic Engineers & Architects Co.,Ltd.
8 Soi KALONG 4 SANAMBINNAM ROAD,
THASAI SUB-DISTRICT, MUANG NONTHABURI DISTRICT
, NONTHABURI.
Tel 662-950-4374
Fax 662-580-3231
E-Mail : qbic@qbic.co.th, www.qbic.co.th
QBIC ENGINEERS AND ARCHITECTS CO.,LTD.

CONSULTANT :

MITR
MITR TECHNICAL CONSULTANT CO.,LTD.
1168/8 12th FLOOR, LUMPINI TOWER BUILDING,
RAMA IV RD., THUNGMAHAMEK, SATHORN, BANGKOK 10120, THAILAND
TEL : 0-2679-9079-84
FAX : 0-2679-9085 E-mail: mitr_dd@mitr.com

Architect :	SIGNATURE
ประกิต พนานุรัตน์ วสถ. 580 ที่อยู่ 251/1 ถ.จารุเมือง แขวงรองเมือง เขตปทุมวัน กรุงเทพมหานคร โทรศัพท์ 02-286-8199	
Structural Engineer :	SIGNATURE
วิศวกรผู้ออกแบบโครงสร้าง	
ณัฐสม สงวนวงษ์ วย 1423 ที่อยู่ 2/1 ซ.รามคำแหง 150 ถ.รามคำแหง แขวง สะพานสูง เขต สะพานสูง กทม. 10240	
Structural Inspector :	SIGNATURE
วิศวกรผู้ตรวจสอบโครงสร้าง	
โกมล จุฑาภัทร วย 964 ที่อยู่ 24/18 ซ.นวมินทร์ 129 ถ. นวมินทร์ แขวง นวลจันทร์ เขต บึงกุ่ม กทม. 10230	
Electrical Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบไฟฟ้ากำลัง	
นายสุภัทร บูรณวิทย์ วฟก.1265 ที่อยู่ 21 ซอยทานสัมฤทธิ์ 13 ตำบลท่าทราย อ.เมืองนนทบุรี จ.นนทบุรี 11000	
Mechanical Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบเครื่องกลและปรับอากาศ	
นายประสิทธิ์ เกี้ยวสุนทร วก.1221 ที่อยู่ 44/372 ซอยบางกระดี่ 35/1 แขวงแสมดำ เขตบางขุนเทียน กทม. 10150	ประสิทธิ์
Sanitary Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบสุขาภิบาล และดับเพลิง	
นายทศวรรษ สนั่นฤทธิ์ วส. 215 ที่อยู่ บ้านเลขที่ 99/107 หมู่ที่ 3 ต.ศีรษะจรเข้น้อย อ.บางเสาธง จ.สมุทรปราการ 10540	ทศวรรษ

ISSUE/REVISION

REV.	DESCRIPTION	DATE
A	90% DEVELOPED	09/05/2026

PROJECT NAME :

GEDC 01

LOCATION:
Nikhom Phattana district, Rayong ,industrial estate,CPGC

BUILDING :
MAIN BUILDING

90% DEVELOPED

TITLE :

OFFICE、MEETINGROOM
01-MMRB、SERVER ROOM B

JOB NO.		SCALE	1 : 50
DRAWN	LYT	REF.	
CHECKED	LJC	DWG. NO.	MPK01A-90-A-RD-314
APPROVED	LXD		
DATE	2026.05.09		

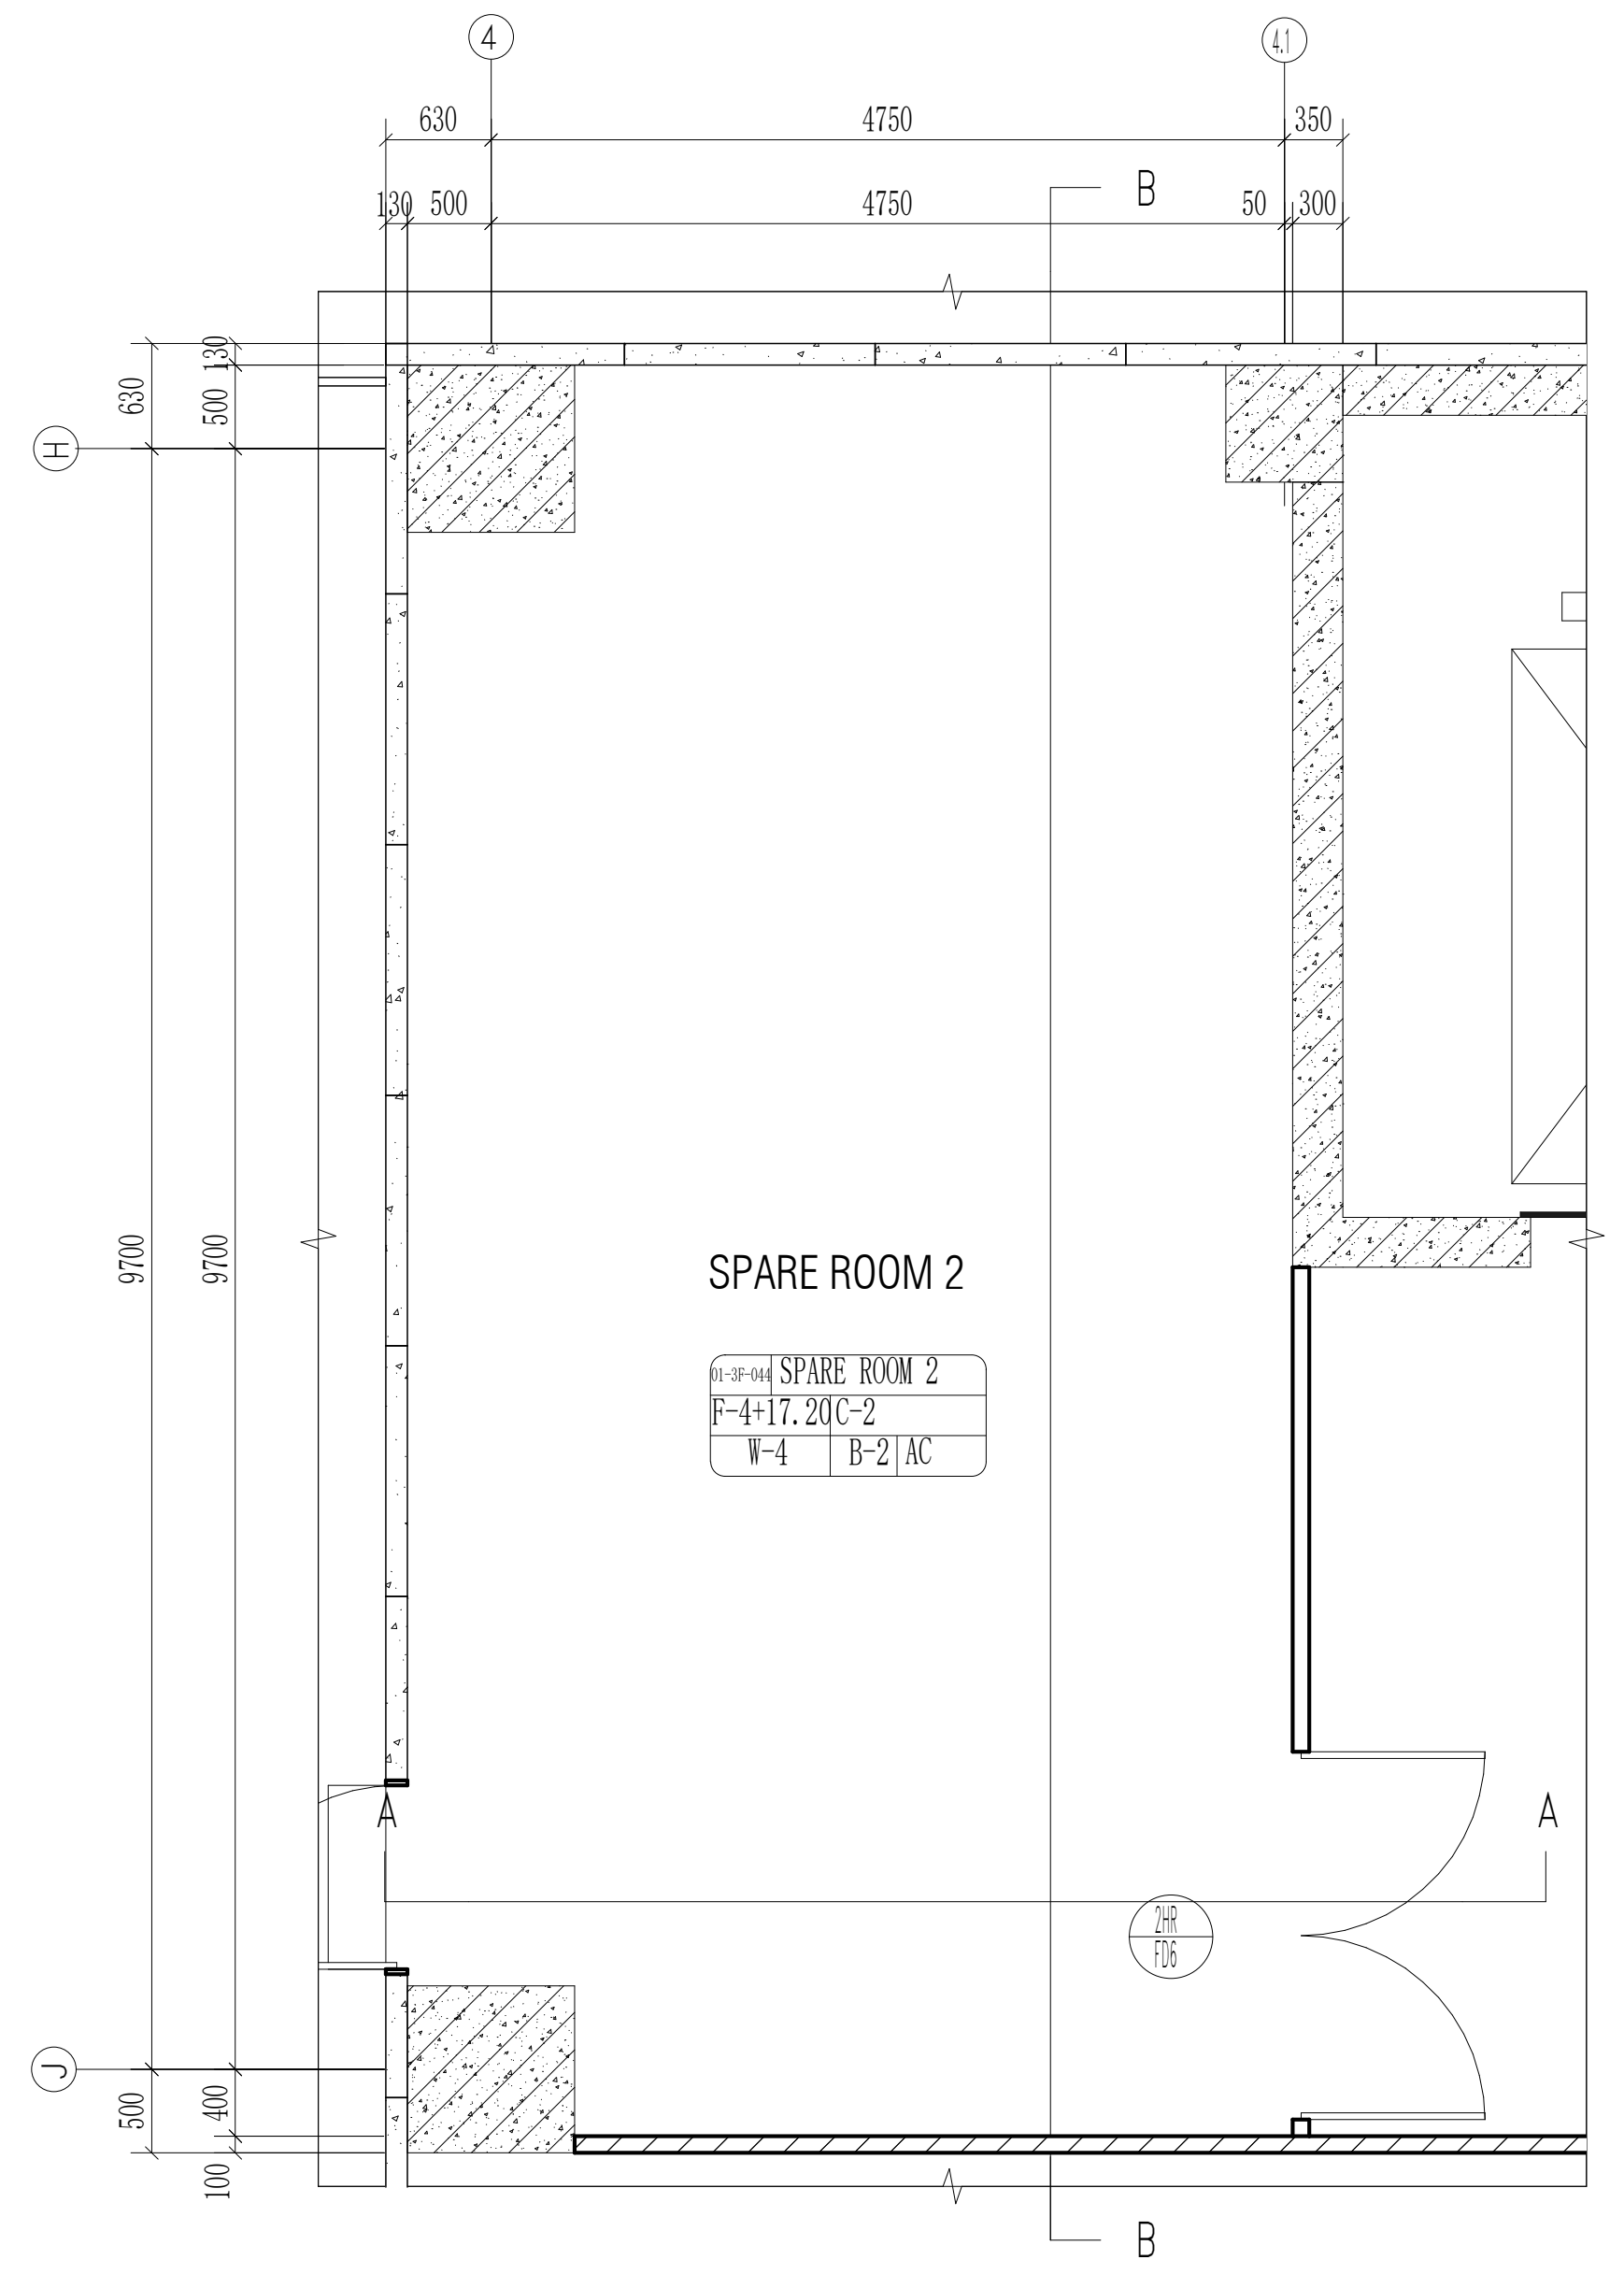
4
4.1
630
4750
350
130
500
4750
50
300
B
H
J
630
500
130
9700
9700
500
400
100
SPARE ROOM 2
01-3F-044 SPARE ROOM 2
F-4+17.20 C-2
W-4 B-2 AC
A
A
2HR
FD6
B

SPARE ROOM 2 FLOOR PLAN

Scale 1:50

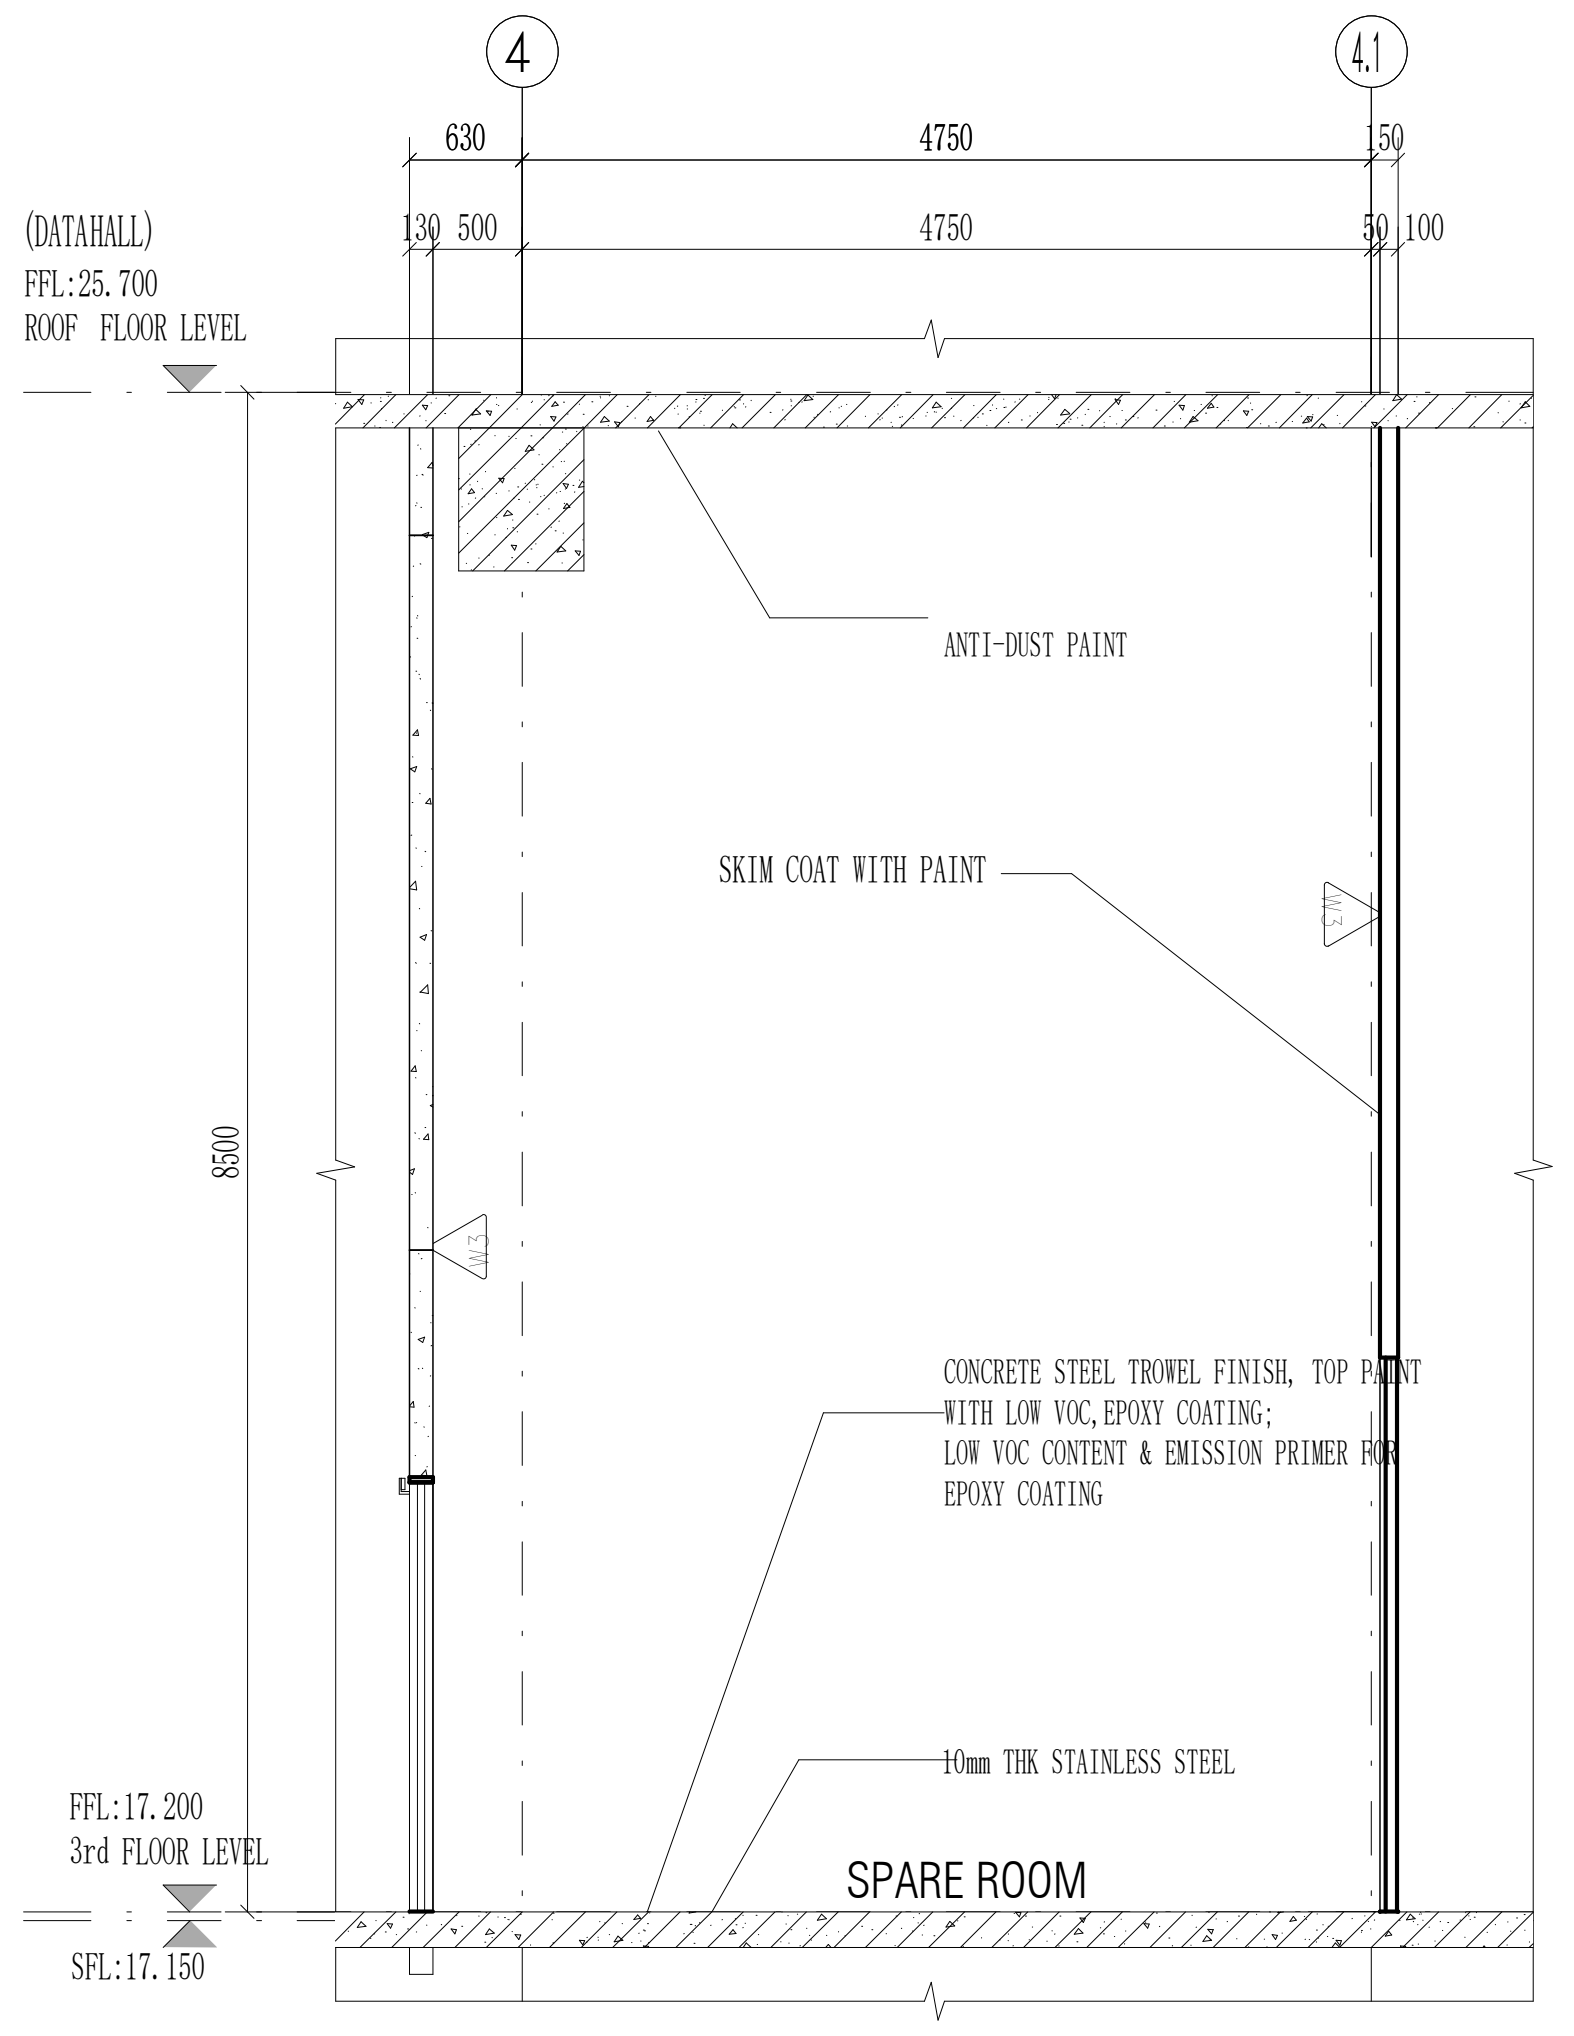
4
4.1
630
4750
150
130
500
4750
50
100
(DATAHALL)
FFL:25.700
ROOF FLOOR LEVEL
ANTI-DUST PAINT
SKIM COAT WITH PAINT
W3
8500
CONCRETE STEEL TROWEL FINISH, TOP PAINT
WITH LOW VOC,EPOXY COATING;
LOW VOC CONTENT & EMISSION PRIMER FOR
EPOXY COATING
10mm THK STAINLESS STEEL
FFL:17.200
3rd FLOOR LEVEL
SFL:17.150
SPARE ROOM

SPARE ROOM SECTION A-A

Scale 1:50

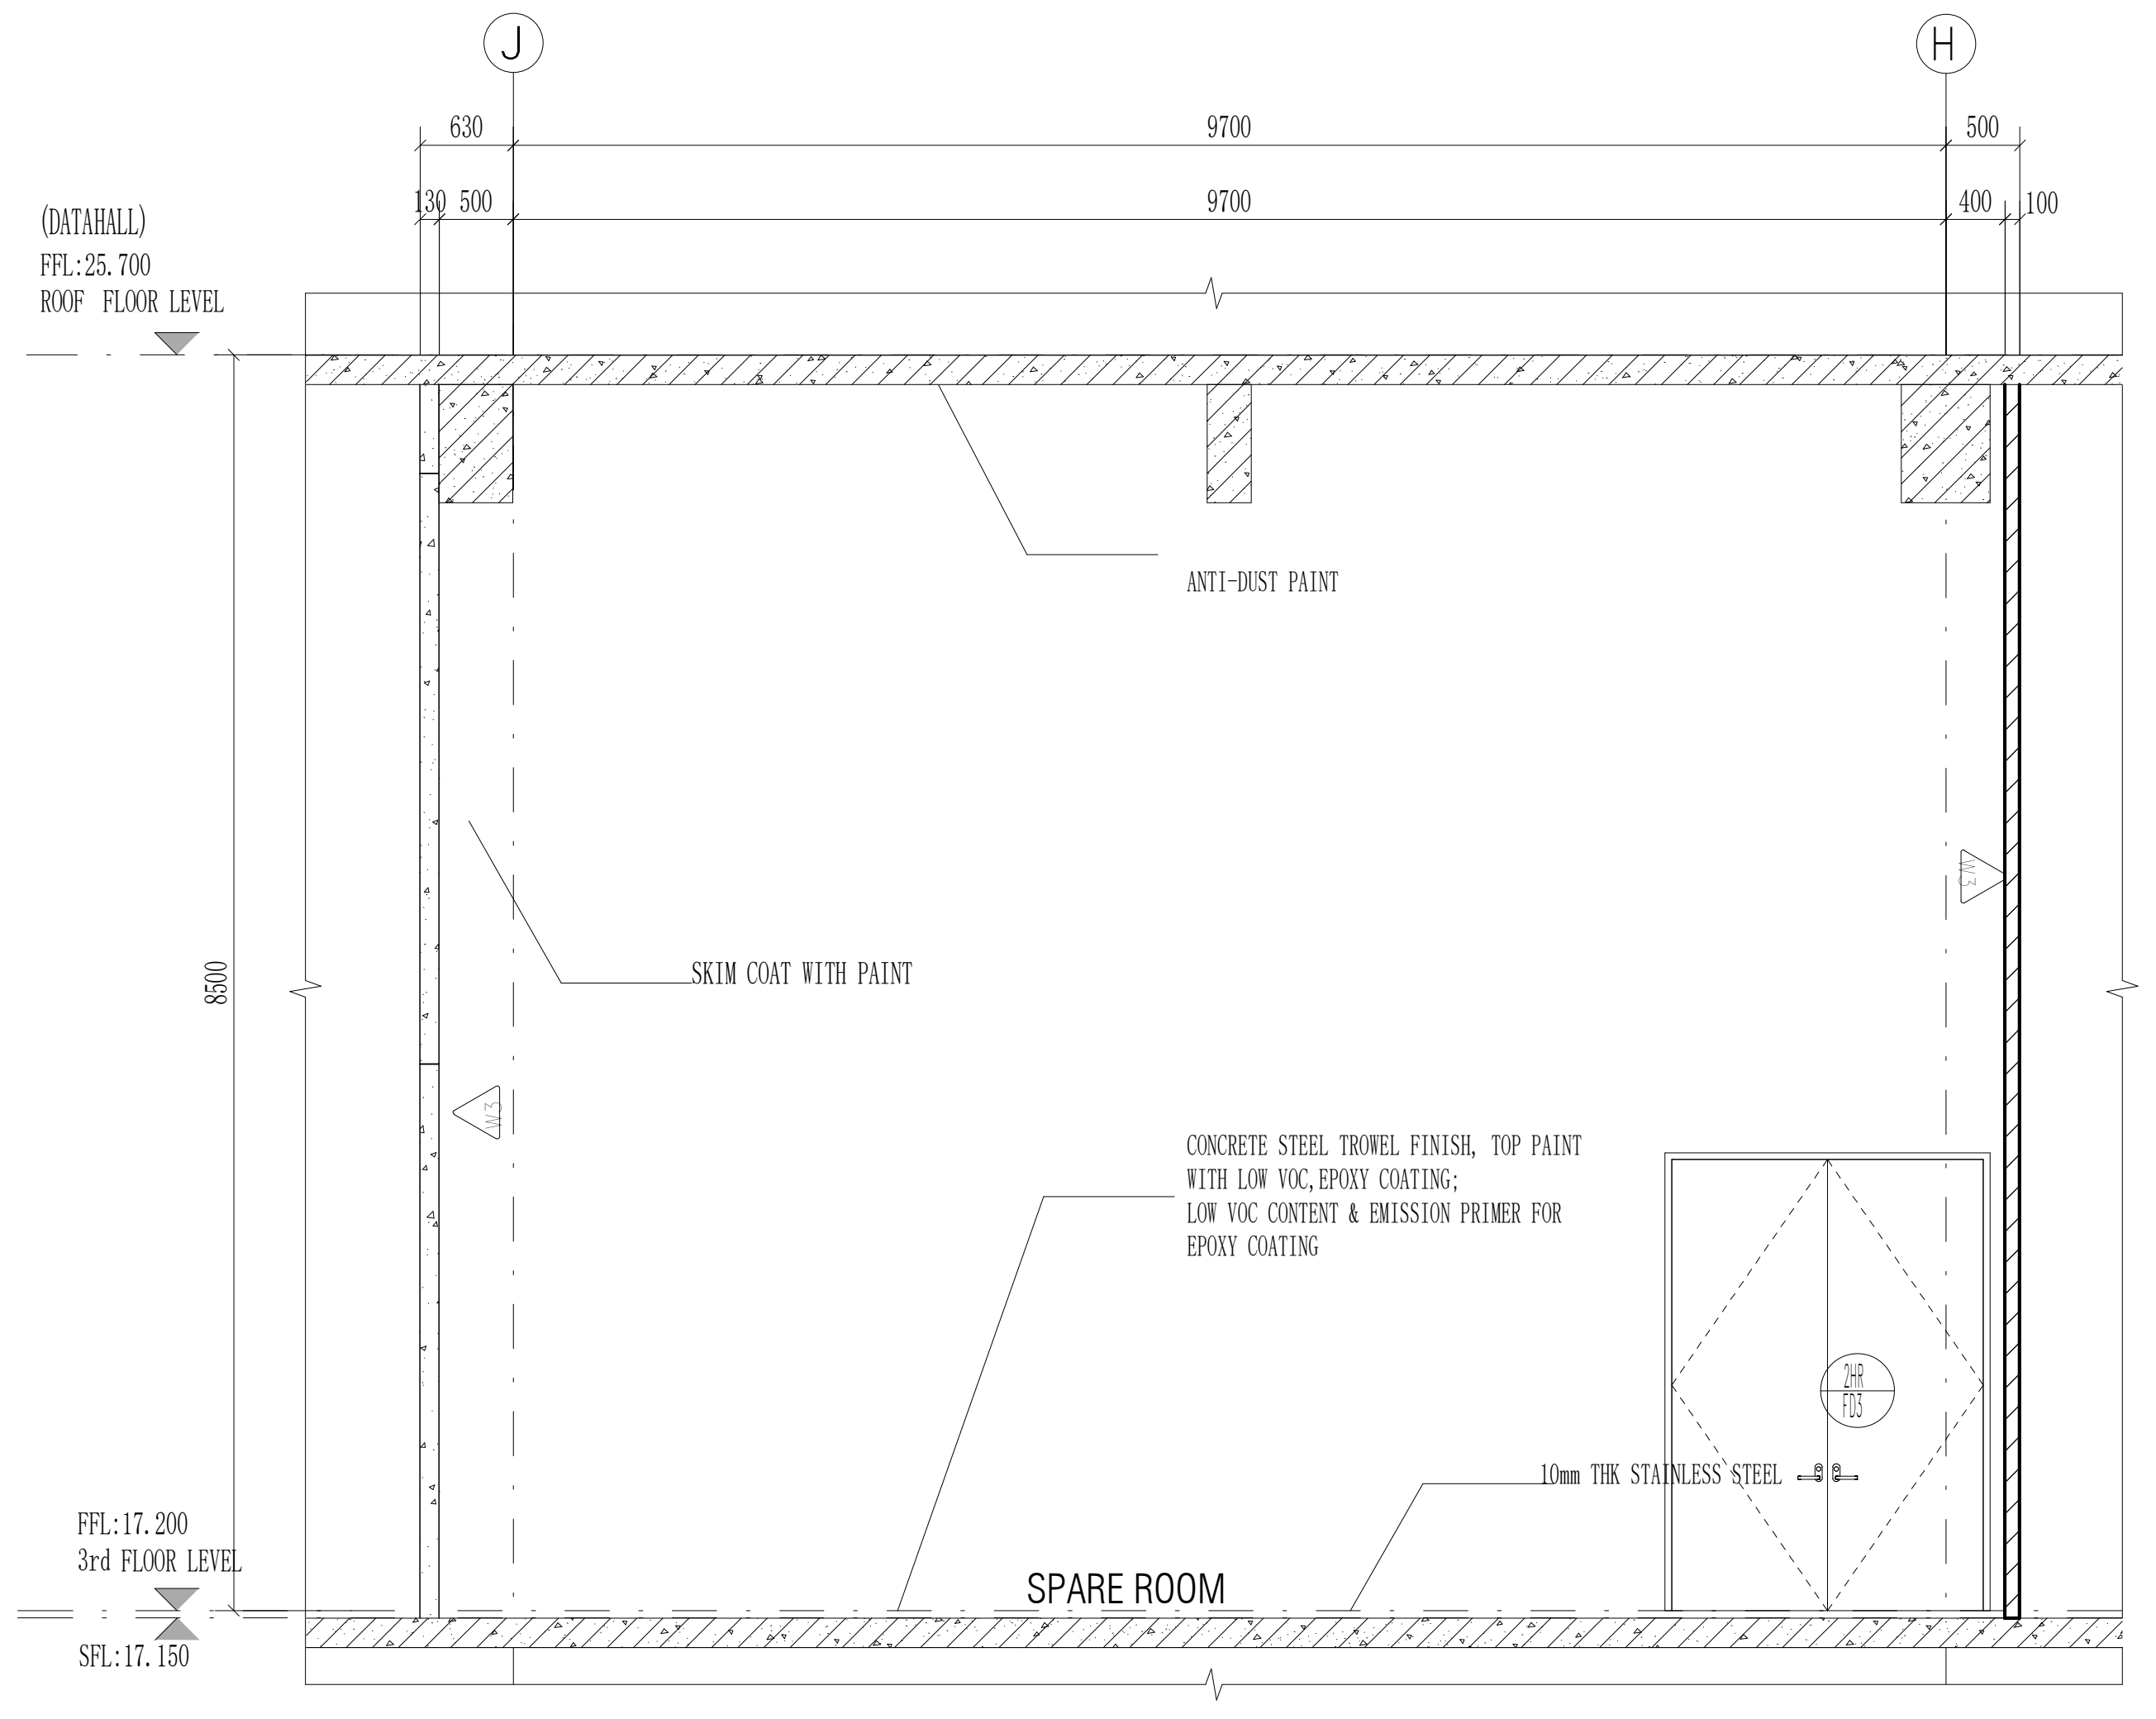
J
H
630
9700
500
130
500
9700
400
100
(DATAHALL)
FFL:25.700
ROOF FLOOR LEVEL
ANTI-DUST PAINT
SKIM COAT WITH PAINT
8500
W3
CONCRETE STEEL TROWEL FINISH, TOP PAINT
WITH LOW VOC,EPOXY COATING;
LOW VOC CONTENT & EMISSION PRIMER FOR
EPOXY COATING
2HR
FD3
10mm THK STAINLESS STEEL
FFL:17.200
3rd FLOOR LEVEL
SFL:17.150
SPARE ROOM

SPARE ROOM SECTION B-B

Scale 1:50

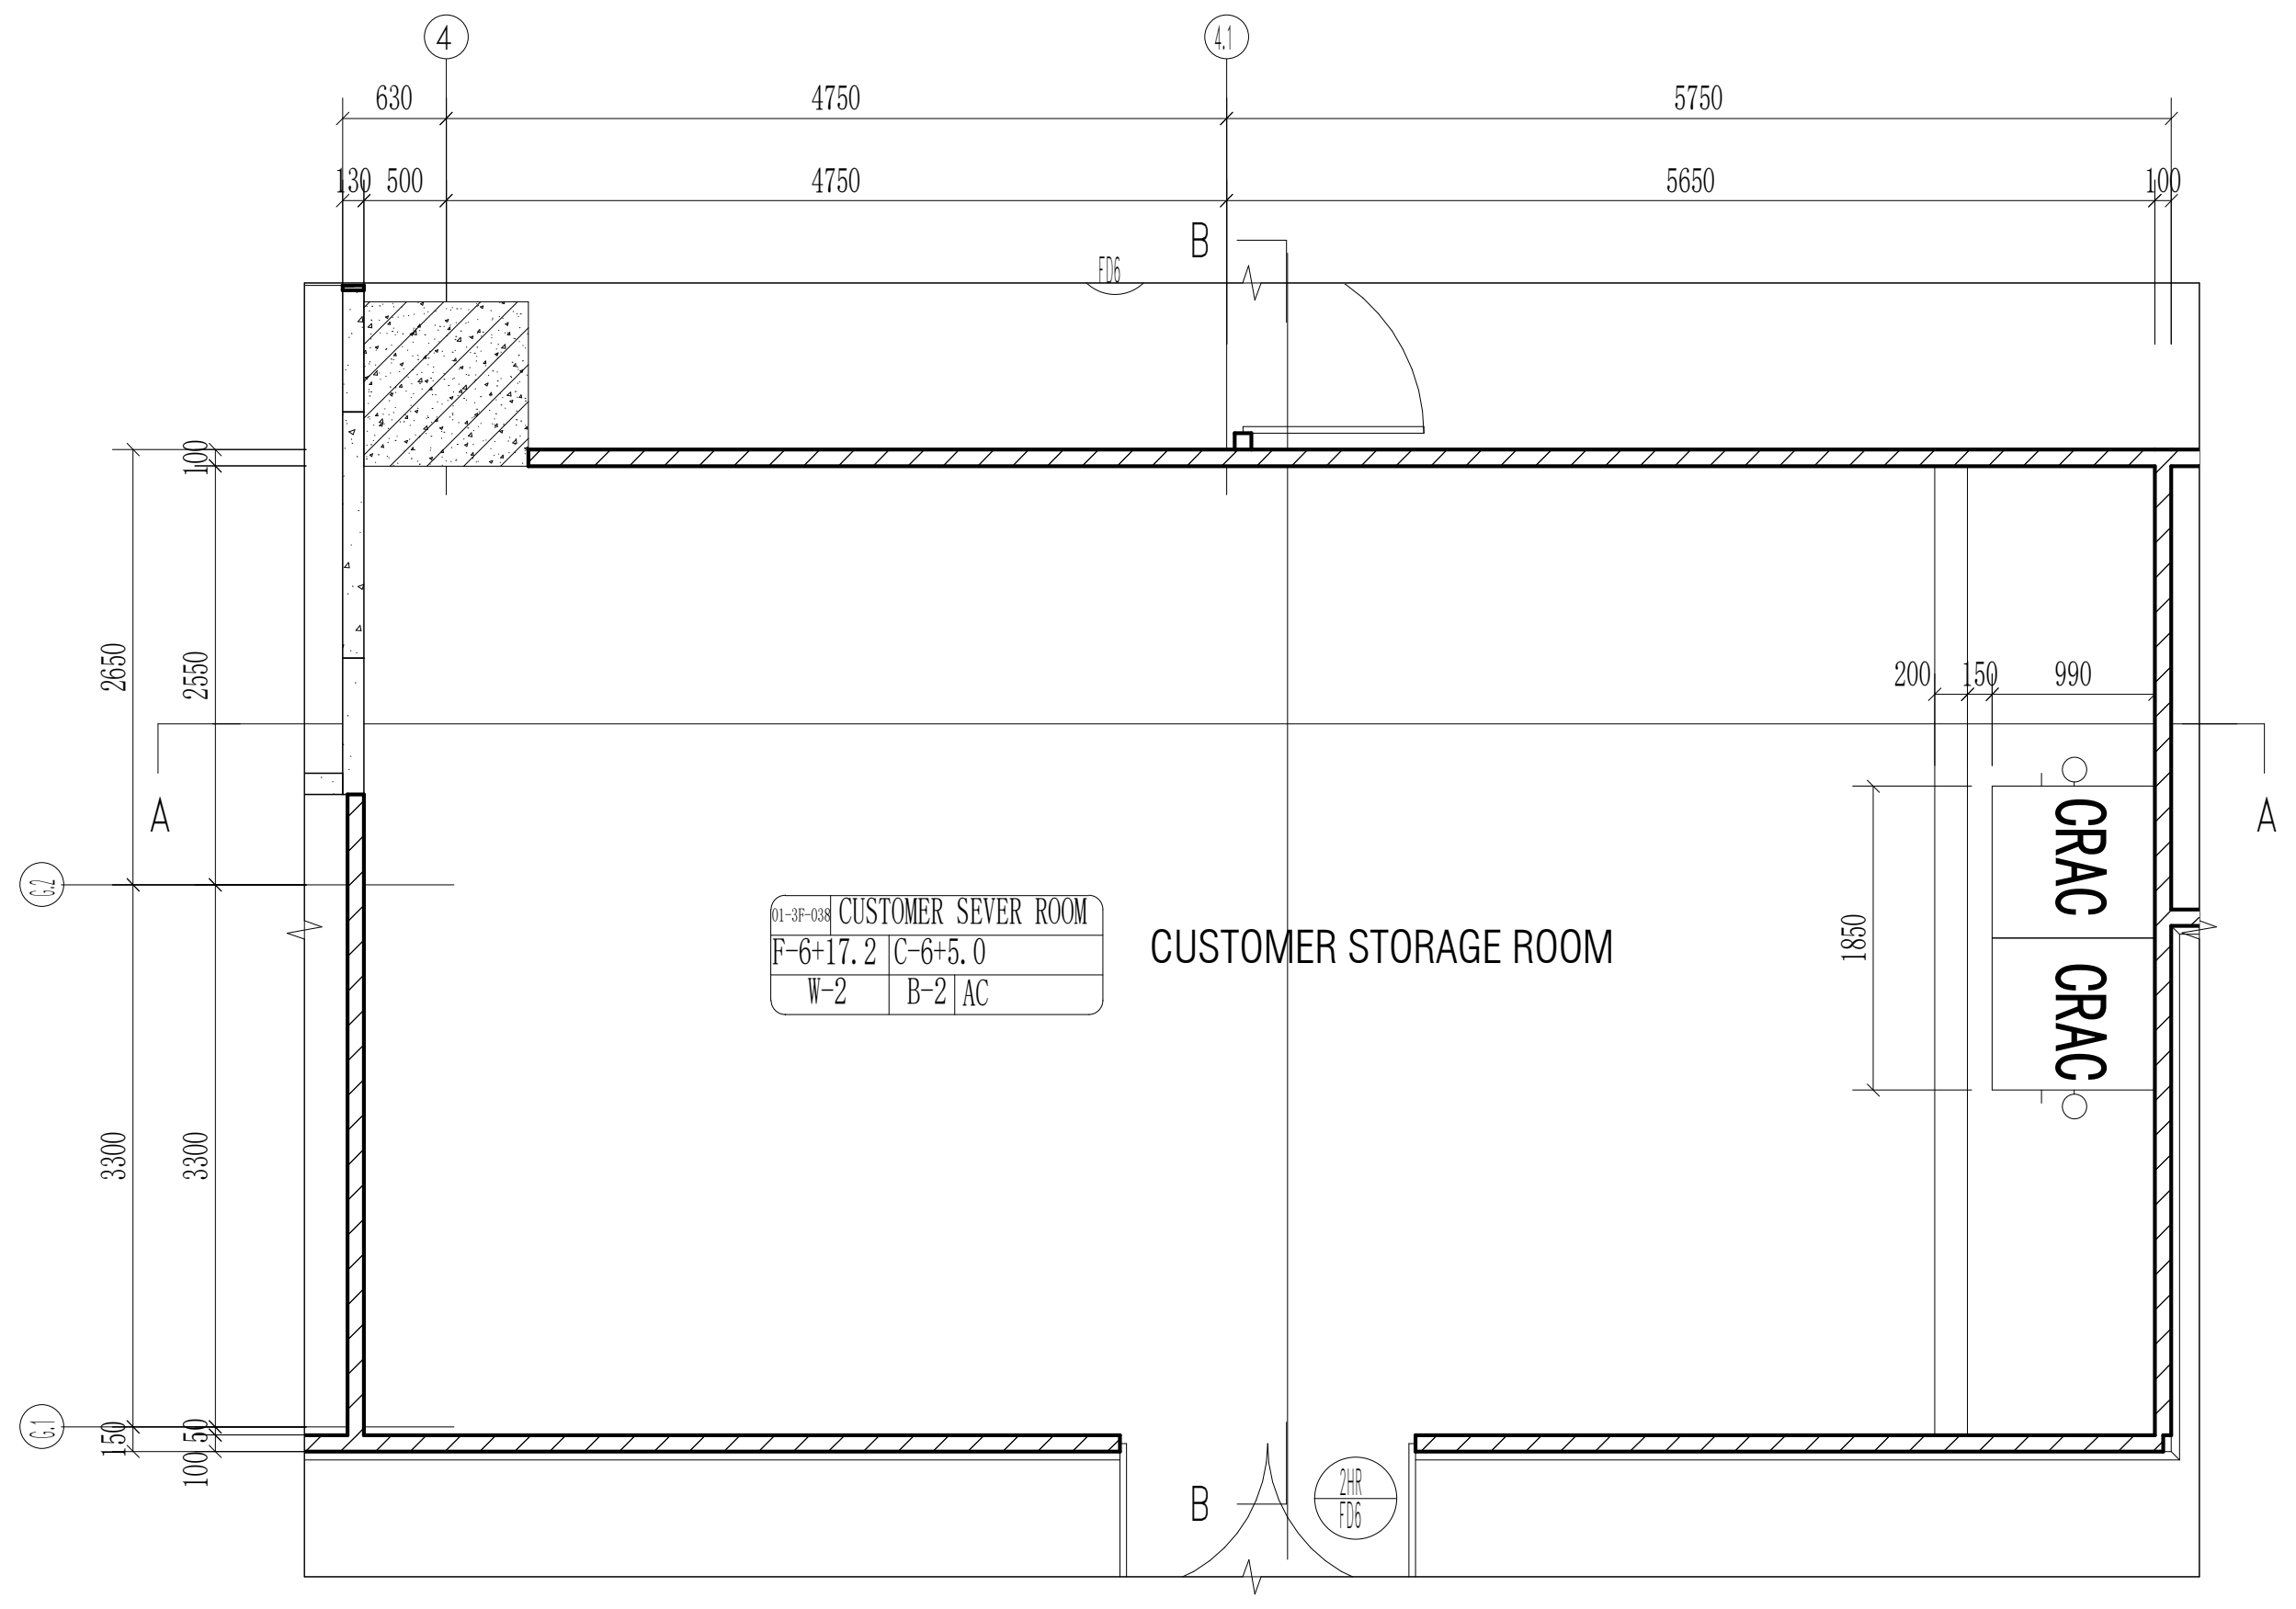
4
4.1
630
4750
5750
130
500
4750
5650
100
B
FD6
2650
2550
100
A
G.2
01-3F-038 CUSTOMER SEVER ROOM
F-6+17.2 C-6+5.0
W-2 B-2 AC
CUSTOMER STORAGE ROOM
200
150
990
1850
CRAC
CRAC
A
3300
3300
G.1
150
100
50
B
2HR
FD6

CUSTOMER SEVER ROOM FLOOR PLAN

Scale 1:50

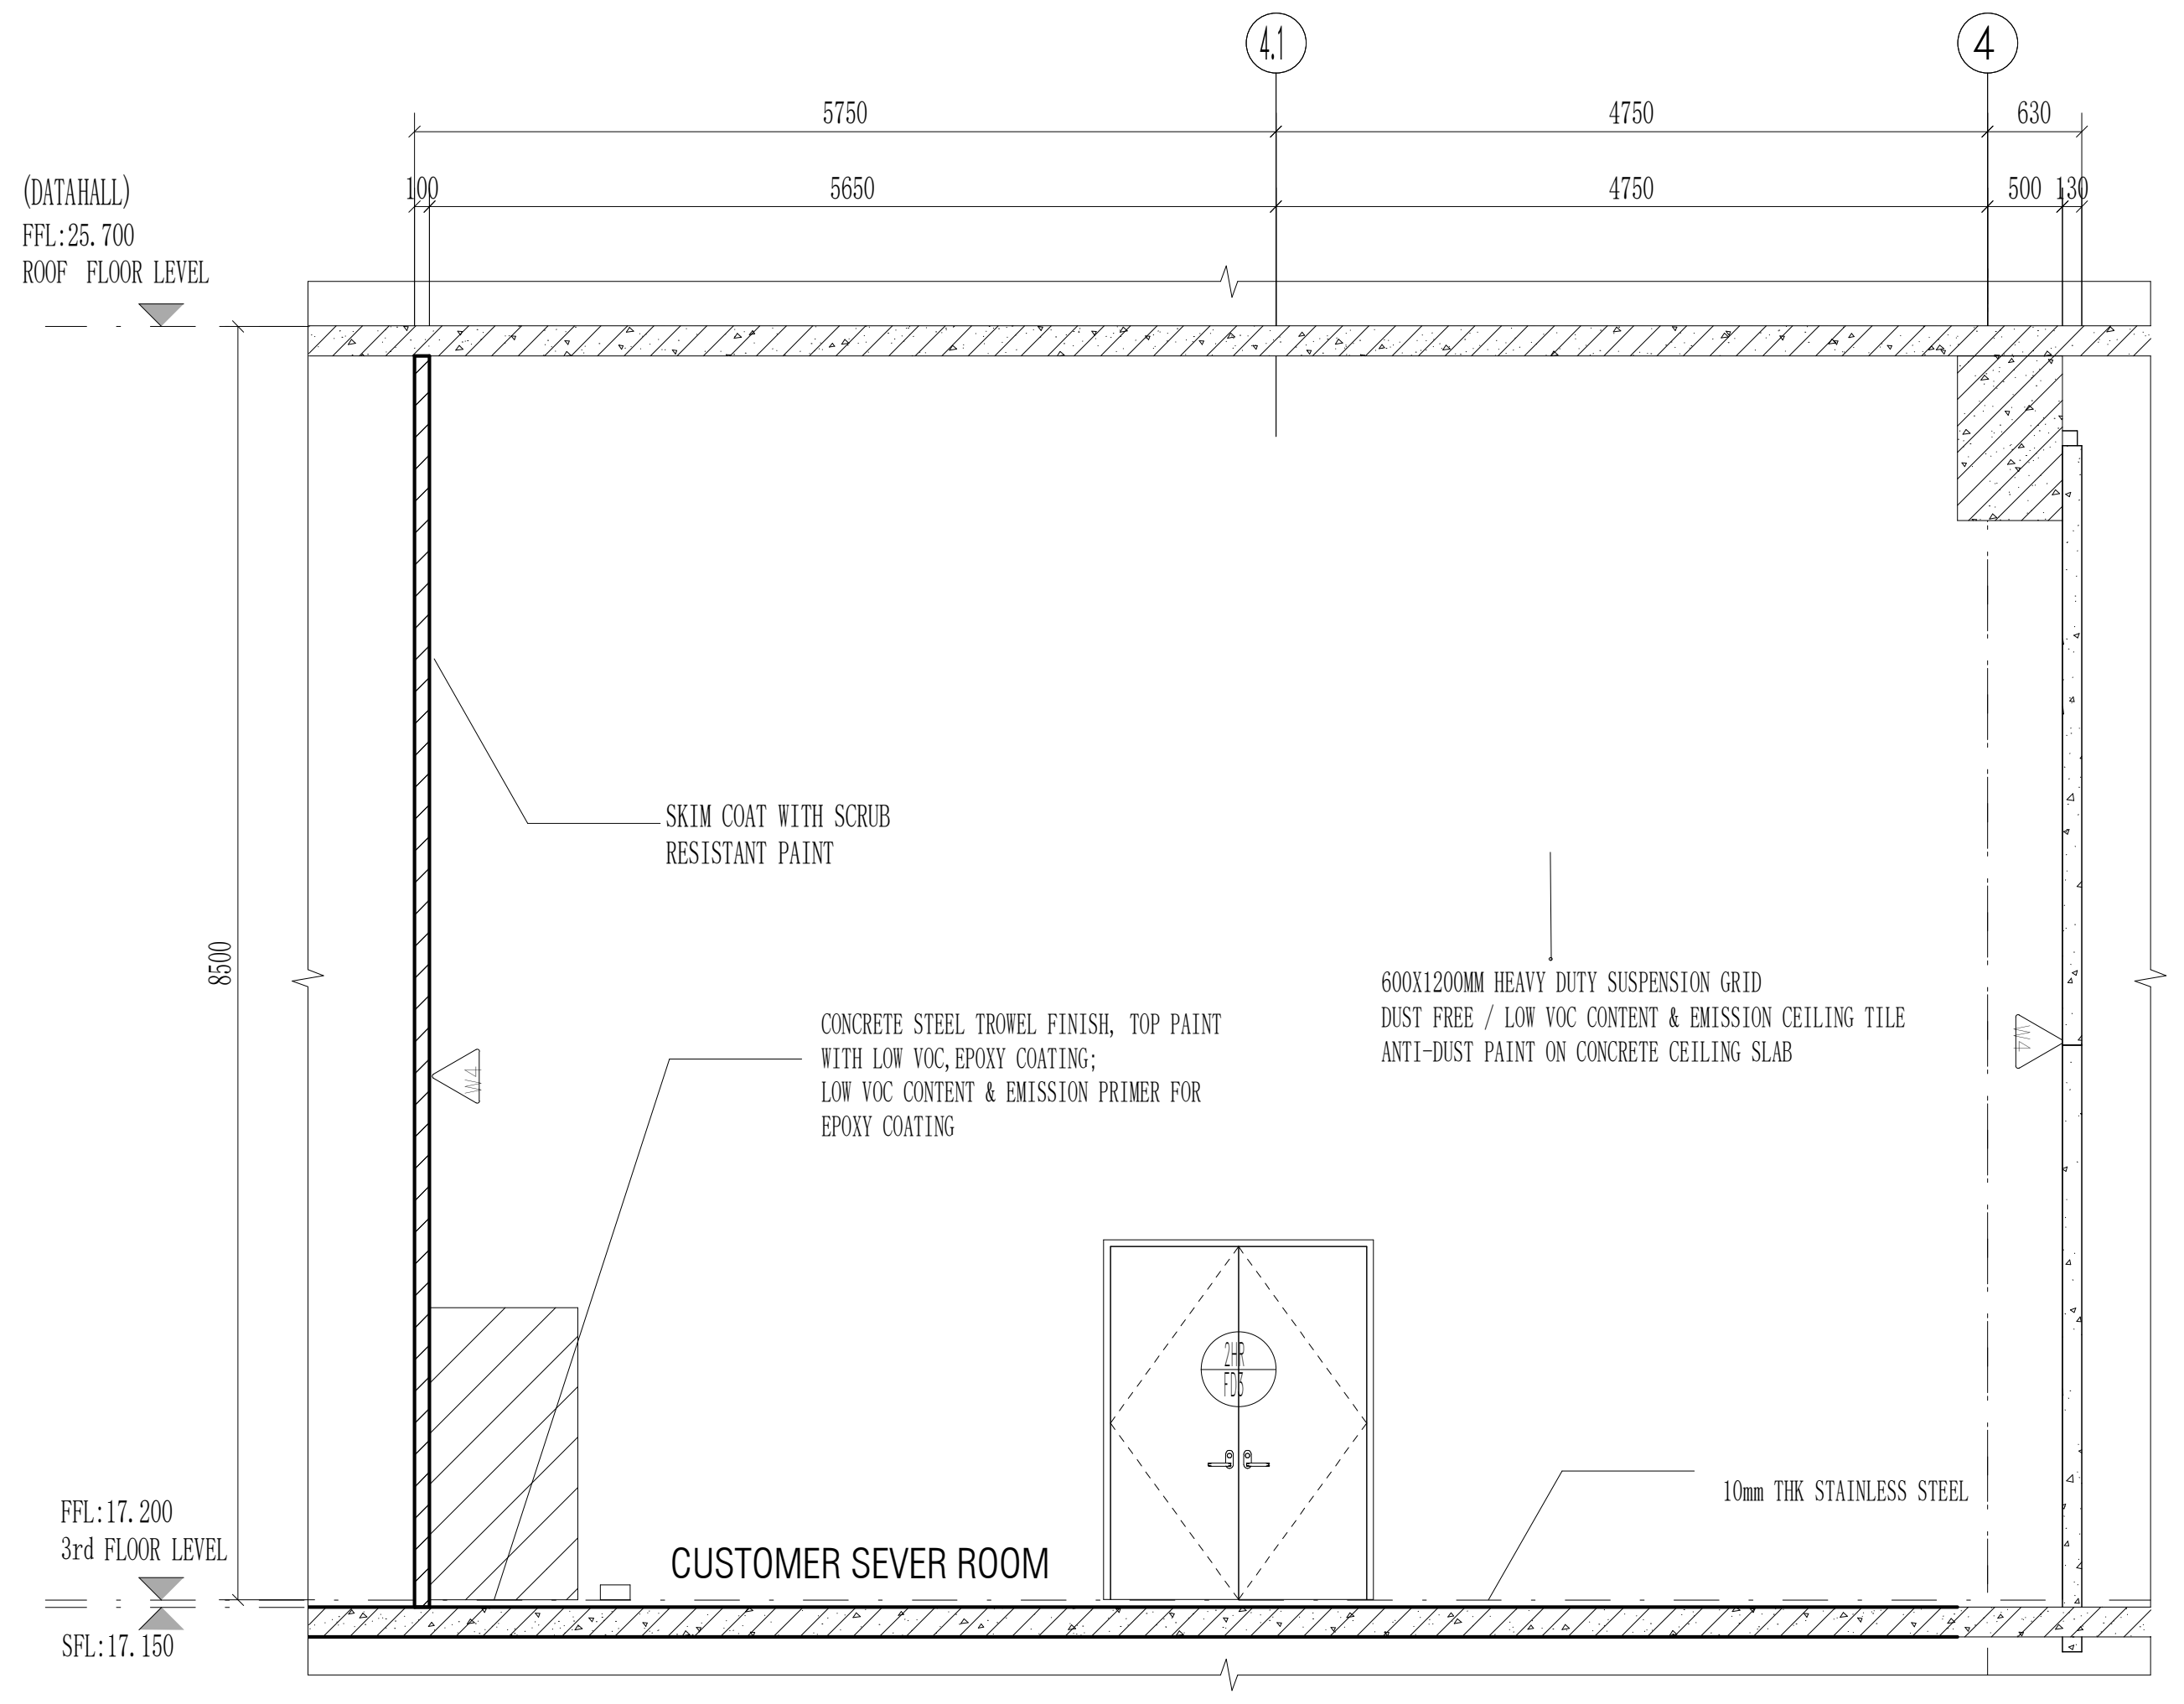
4.1
4
5750
4750
630
100
5650
4750
500
130
(DATAHALL)
FFL:25.700
ROOF FLOOR LEVEL
SKIM COAT WITH SCRUB
RESISTANT PAINT
8500
600X1200MM HEAVY DUTY SUSPENSION GRID
DUST FREE / LOW VOC CONTENT & EMISSION CEILING TILE
ANTI-DUST PAINT ON CONCRETE CEILING SLAB
CONCRETE STEEL TROWEL FINISH, TOP PAINT
WITH LOW VOC,EPOXY COATING;
LOW VOC CONTENT & EMISSION PRIMER FOR
EPOXY COATING
W4
W4
2HR
FD6
10mm THK STAINLESS STEEL
FFL:17.200
3rd FLOOR LEVEL
SFL:17.150
CUSTOMER SEVER ROOM

CUSTOMER SEVER ROOM SECTION A-A

Scale 1:50

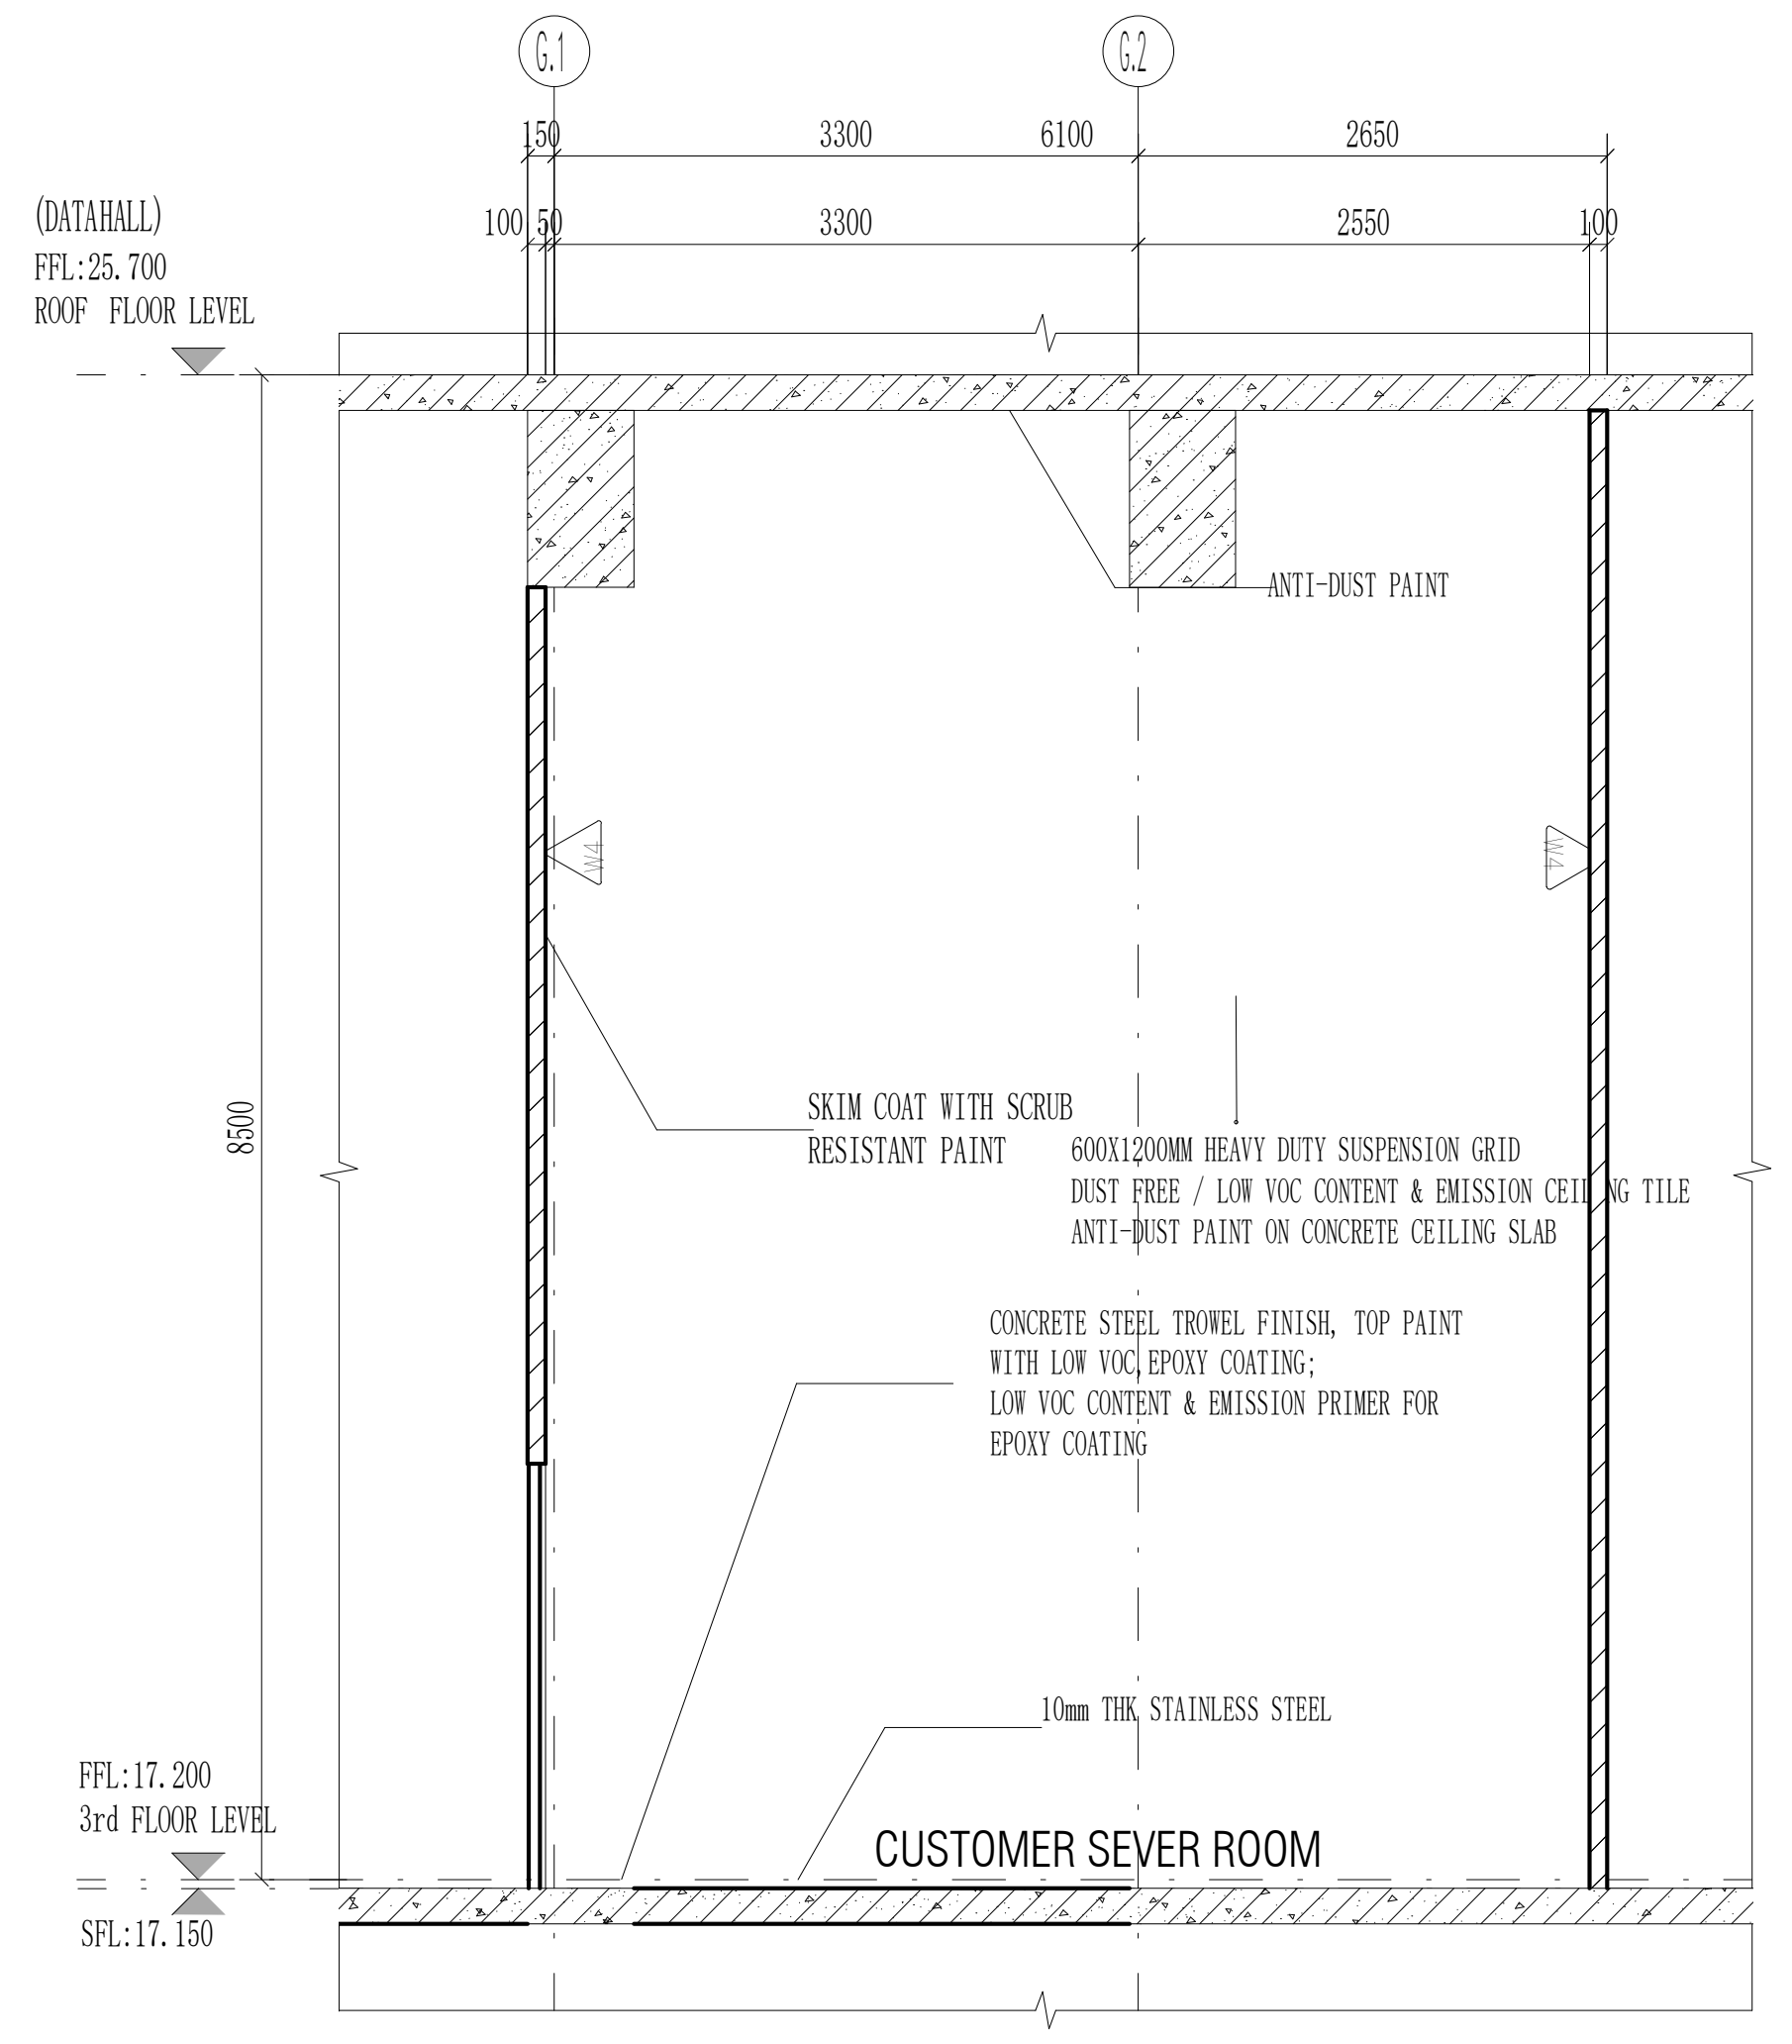
G.1
G.2
150
3300
6100
2650
100
50
3300
2550
100
(DATAHALL)
FFL:25.700
ROOF FLOOR LEVEL
ANTI-DUST PAINT
W4
W4
8500
SKIM COAT WITH SCRUB
RESISTANT PAINT
600X1200MM HEAVY DUTY SUSPENSION GRID
DUST FREE / LOW VOC CONTENT & EMISSION CEILING TILE
ANTI-DUST PAINT ON CONCRETE CEILING SLAB
CONCRETE STEEL TROWEL FINISH, TOP PAINT
WITH LOW VOC,EPOXY COATING;
LOW VOC CONTENT & EMISSION PRIMER FOR
EPOXY COATING
10mm THK STAINLESS STEEL
FFL:17.200
3rd FLOOR LEVEL
SFL:17.150
CUSTOMER SEVER ROOM

CUSTOMER SEVER ROOM SECTION B-B

Scale 1:50

CLIENT :

GULF EDGE DC 01

87 Wireless Road, M Thai Tower 11th. Floor, All Seasons Place, Lumpini,
Pathumwan, Bangkok 10330, Thailand

CONTRACTOR :

华西发展(泰国)有限公司
บริษัท หัวซือ ดีเวลลอปเม้นต์ (ประเทศไทย) จำกัด
HUASHI DEVELOPMENT CO.,LTD
No. 202, Room No. 1403, 14/F, Le Concorde Building,
Ratchadapisek Road, Huaykhwang Sub-District,
Huaykhwang District, Bangkok Metropolitan 10310.

CONSULTANT :

ARbay
บริษัท เอ อาร์ เบย์ จำกัด
ARbay Company Limited
31 st Floor Bangkok Insurance Building
25 South Sathorn road Thungmahamek
Sathorn Bangkok 10120 THAILAND
T +66 (0) 2286 8199
F +66 (0) 2286 2863
info@arbay.co.th

CONSULTANT :

Qbic Engineers & Architects Co.,Ltd.
8 Soi KALONG 4 SANAMBINNAM ROAD,
THASAI SUB-DISTRICT, MUANG NONTHABURI DISTRICT
, NONTHABURI.
Tel 662-950-4374
Fax 662-580-3231
E-Mail : qbic@qbic.co.th, www.qbic.co.th
QBIC ENGINEERS AND ARCHITECTS CO.,LTD.

CONSULTANT :

MITR
MITR TECHNICAL CONSULTANT CO.,LTD.
1168/8 12th FLOOR, LUMPINI TOWER BUILDING,
RAMA IV RD., THUNGMAHAMEK, SATHORN, BANGKOK 10120, THAILAND
TEL : 0-2679-9079-84
FAX : 0-2679-9085 E-mail: mitr_dd@mitr.com

Architect :	SIGNATURE
ประกิต พนานุรัตน์ วสถ. 580 ที่อยู่ 251/1 ถ.จารุเมือง แขวงรองเมือง เขตปทุมวัน กรุงเทพมหานคร โทรศัพท์ 02-286-8199	
Structural Engineer :	SIGNATURE
วิศวกรผู้ออกแบบโครงสร้าง	
ณัฐสม สงวนวงษ์ วย 1423 ที่อยู่ 2/1 ซ.รามคำแหง 150 ถ.รามคำแหง แขวง สะพานสูง เขต สะพานสูง กทม. 10240	ณัฐสม สงวนวงษ์
Structural Inspector :	SIGNATURE
วิศวกรผู้ตรวจสอบโครงสร้าง	
โกมล จุฑาภัทร วย 964 ที่อยู่ 24/18 ซ.นวมินทร์ 129 ถ. นวมินทร์ แขวง นวลจันทร์ เขต บึงกุ่ม กทม. 10230	
Electrical Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบไฟฟ้ากำลัง	
นายสุภัทร บูรณวิทย์ วฟก.1265 ที่อยู่ 21 ซอยทานสัมฤทธิ์ 13 ตำบลท่าทราย อ.เมืองนนทบุรี จ.นนทบุรี 11000	
Mechanical Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบเครื่องกลและปรับอากาศ	
นายประสิทธิ์ เกี้ยวสุนทร วก.1221 ที่อยู่ 44/372 ซอยบางกระดี่ 35/1 แขวงแสมดำ เขตบางขุนเทียน กทม. 10150	ประสิทธิ์
Sanitary Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบสุขาภิบาล และดับเพลิง	
นายทศวรรษ สนั่นฤทธิ์ วส. 215 ที่อยู่ บ้านเลขที่ 99/107 หมู่ที่ 3 ต.ศีรษะจรเข้น้อย อ.บางเสาธง จ.สมุทรปราการ 10540	ทศวรรษ

ISSUE/REVISION

REV.	DESCRIPTION	DATE
A	90% DEVELOPED	09/05/2026

PROJECT NAME :

GEDC 01

LOCATION:
Nikhom Phattana district, Rayong ,industrial estate,CPGC

BUILDING :
MAIN BUILDING

90% DEVELOPED

TITLE :

ROOM DETAIL-3F-SPARE
ROOM、CUSTOMER SERVER ROOM

JOB NO.	SCALE 1 : 50
DRAWN LYT	REF.
CHECKED LJC	DWG. NO. MPK01A-90-A-RD-315
APPROVED LXD	
DATE 2026.05.09	