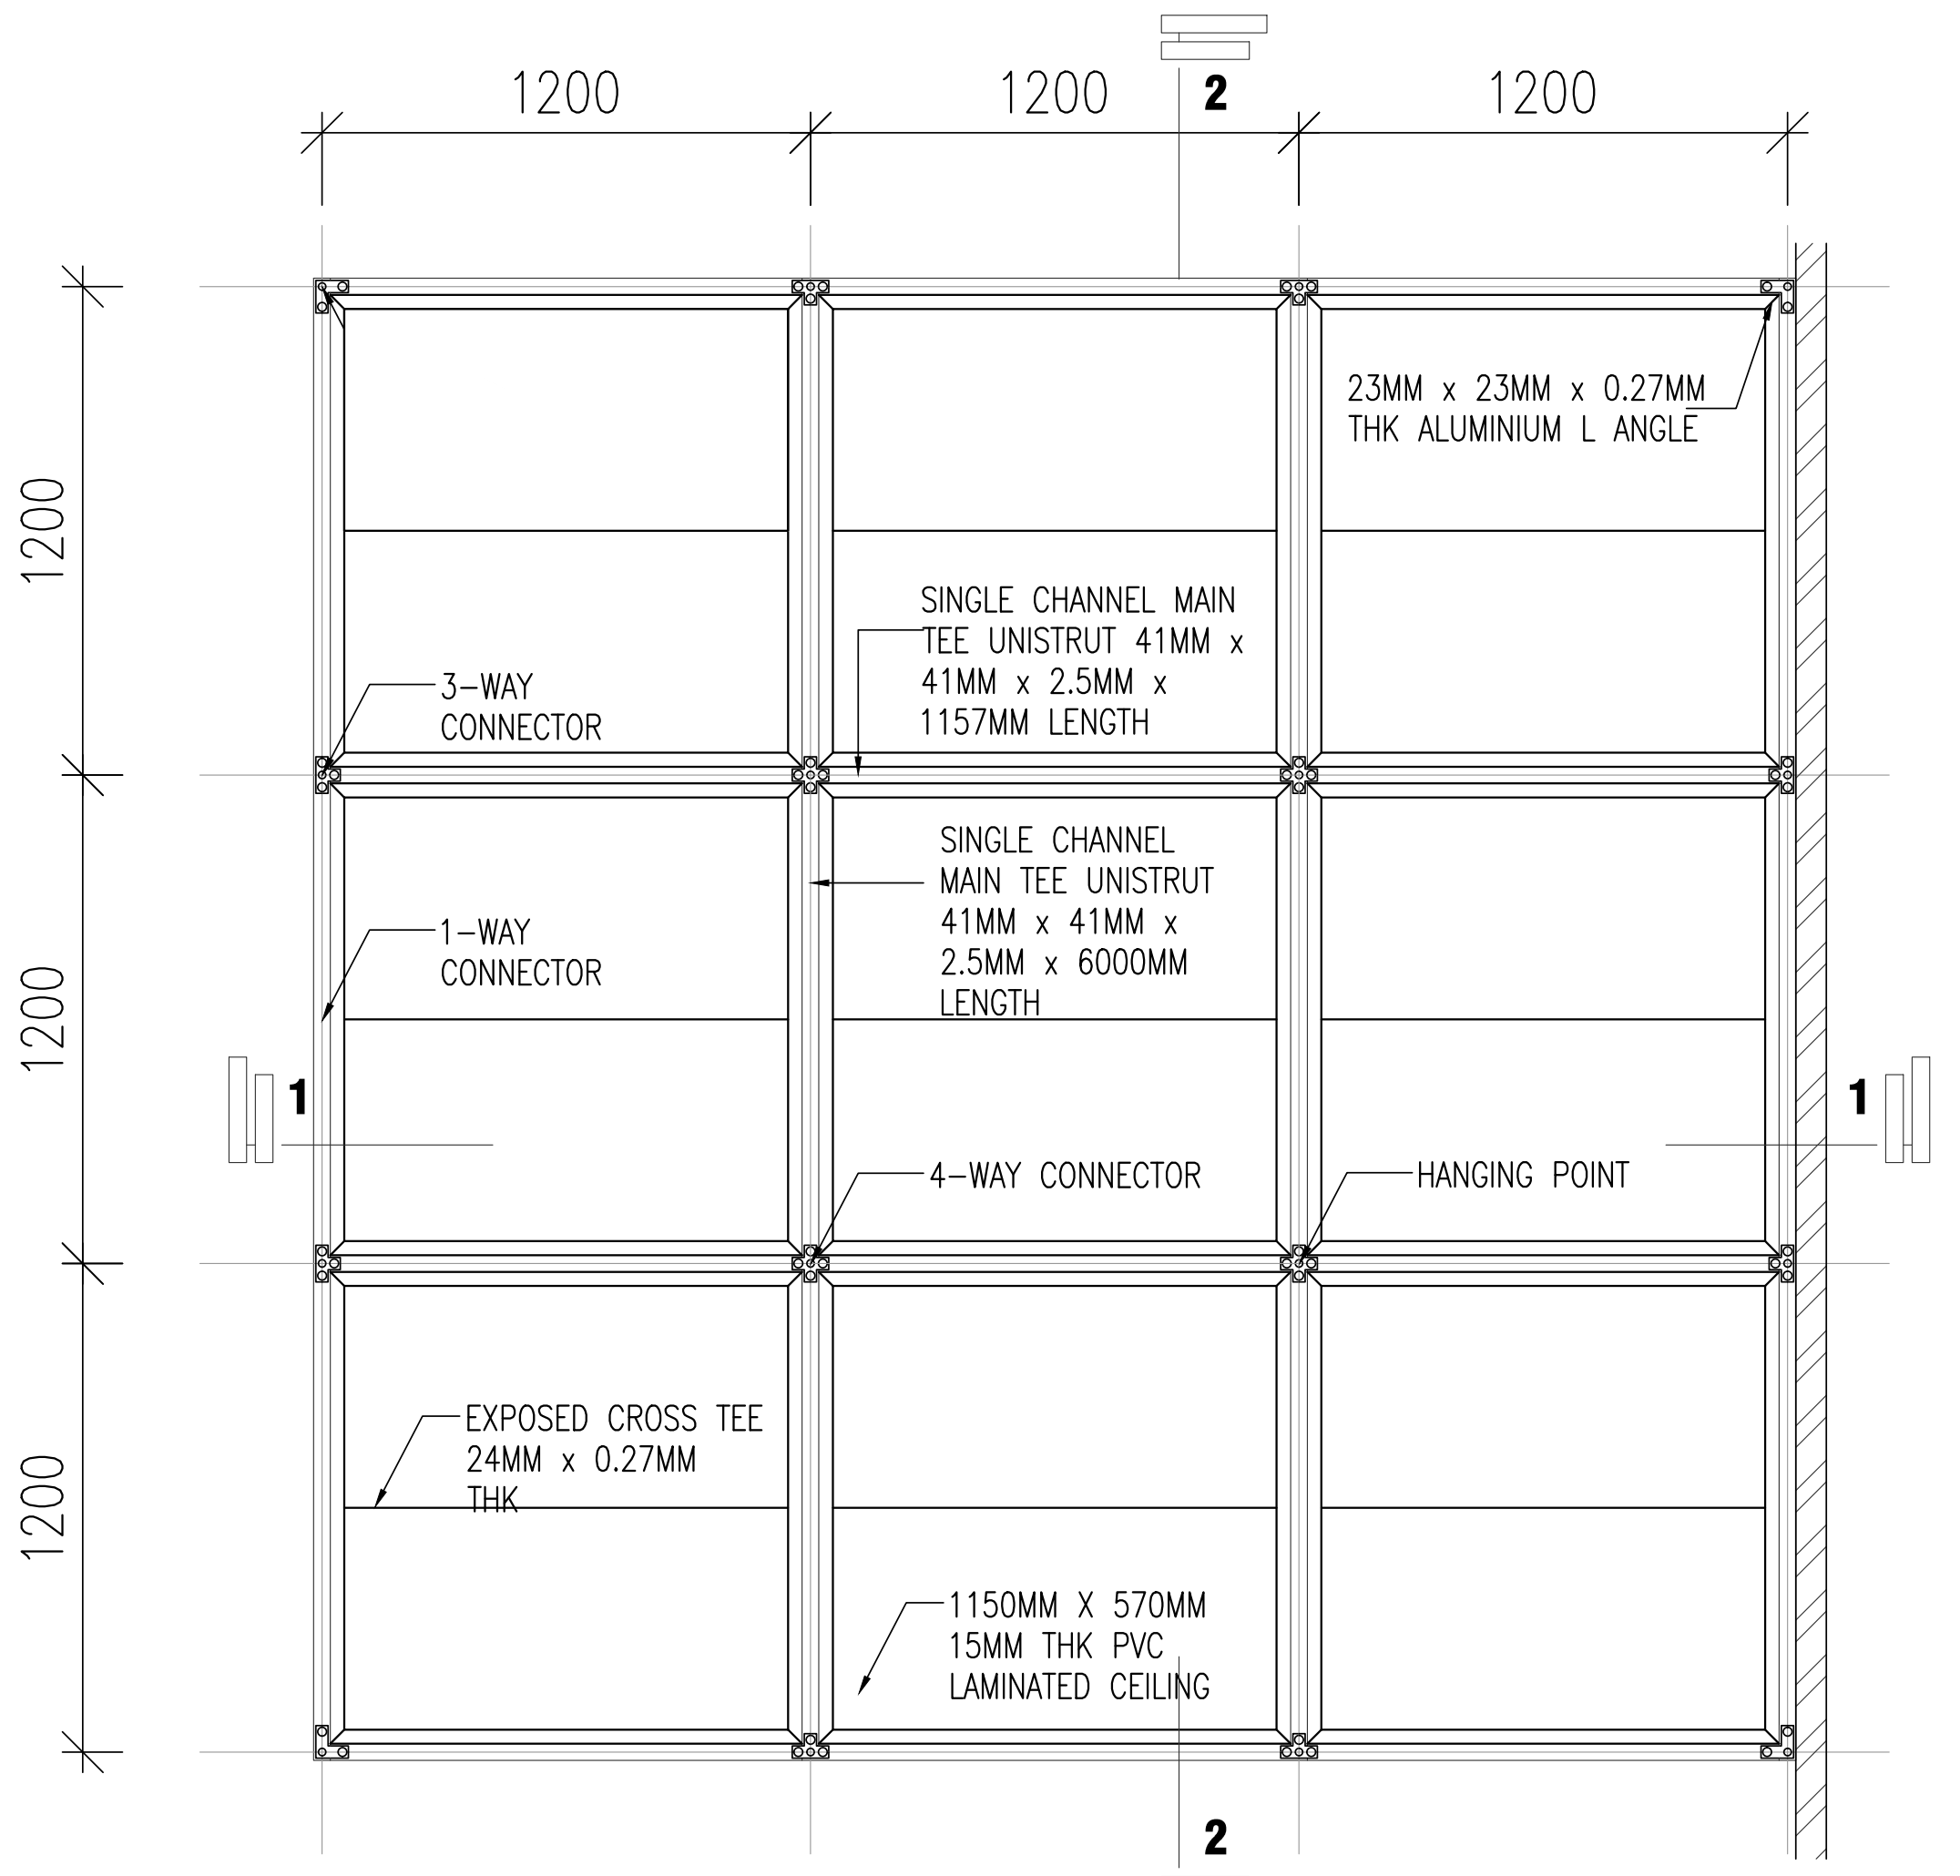
1200
1200
1200
2
2
1
1
1200
1200
1200
23MM x 23MM x 0.27MM THK ALUMINIUM L ANGLE
SINGLE CHANNEL MAIN TEE UNISTRUT 41MM x 41MM x 2.5MM x 1157MM LENGTH
3-WAY CONNECTOR
SINGLE CHANNEL MAIN TEE UNISTRUT 41MM x 41MM x 2.5MM x 6000MM LENGTH
1-WAY CONNECTOR
4-WAY CONNECTOR
HANGING POINT
EXPOSED CROSS TEE 24MM x 0.27MM THK
1150MM X 570MM 15MM THK PVC LAMINATED CEILING

TYPICAL UNISTRUT CEILING DETAIL (PLAN)
1:20

2-WAY CONNECTOR
1:5

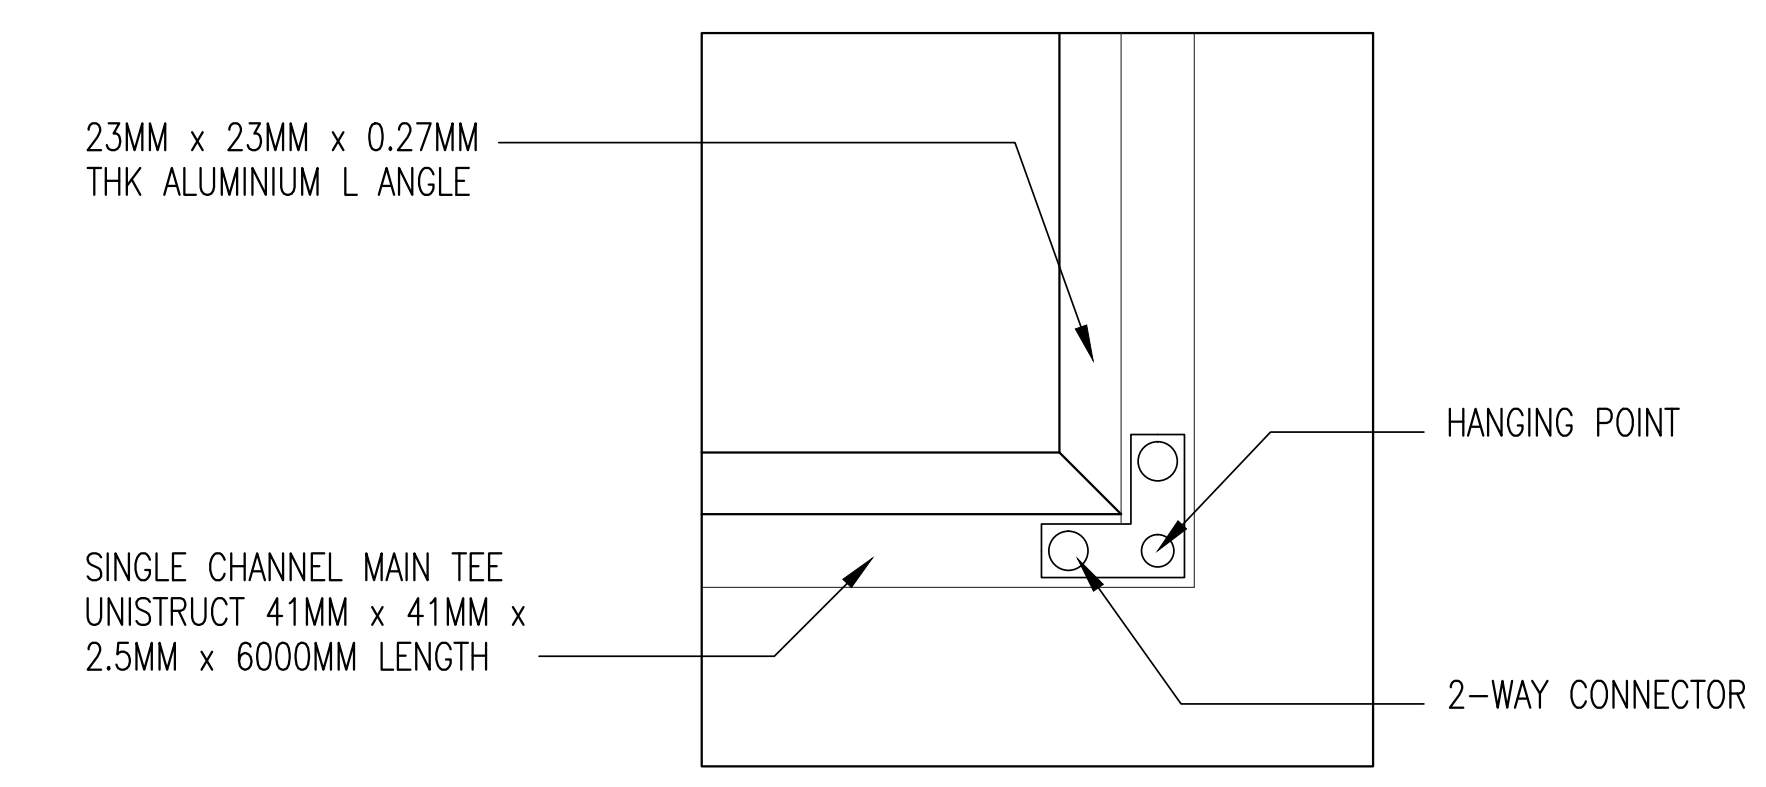
23MM x 23MM x 0.27MM THK ALUMINIUM L ANGLE
HANGING POINT
SINGLE CHANNEL MAIN TEE UNISTRUT 41MM x 41MM x 2.5MM x 6000MM LENGTH
2-WAY CONNECTOR

4-WAY CONNECTOR
1:5

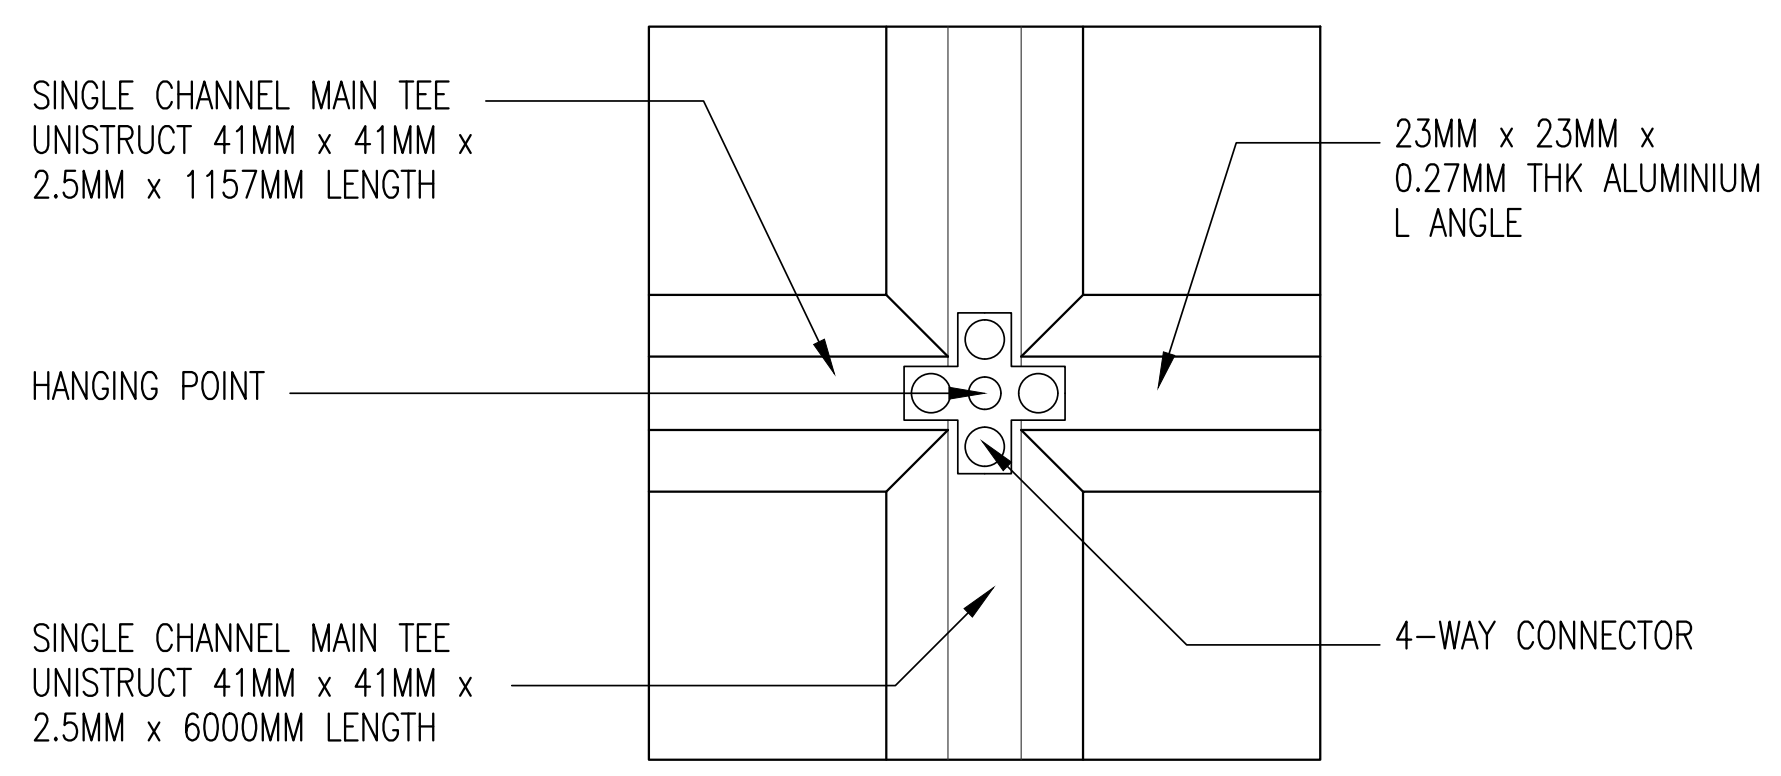
SINGLE CHANNEL MAIN TEE UNISTRUT 41MM x 41MM x 2.5MM x 1157MM LENGTH
23MM x 23MM x 0.27MM THK ALUMINIUM L ANGLE
HANGING POINT
SINGLE CHANNEL MAIN TEE UNISTRUT 41MM x 41MM x 2.5MM x 6000MM LENGTH
4-WAY CONNECTOR

3-WAY CONNECTOR
1:5

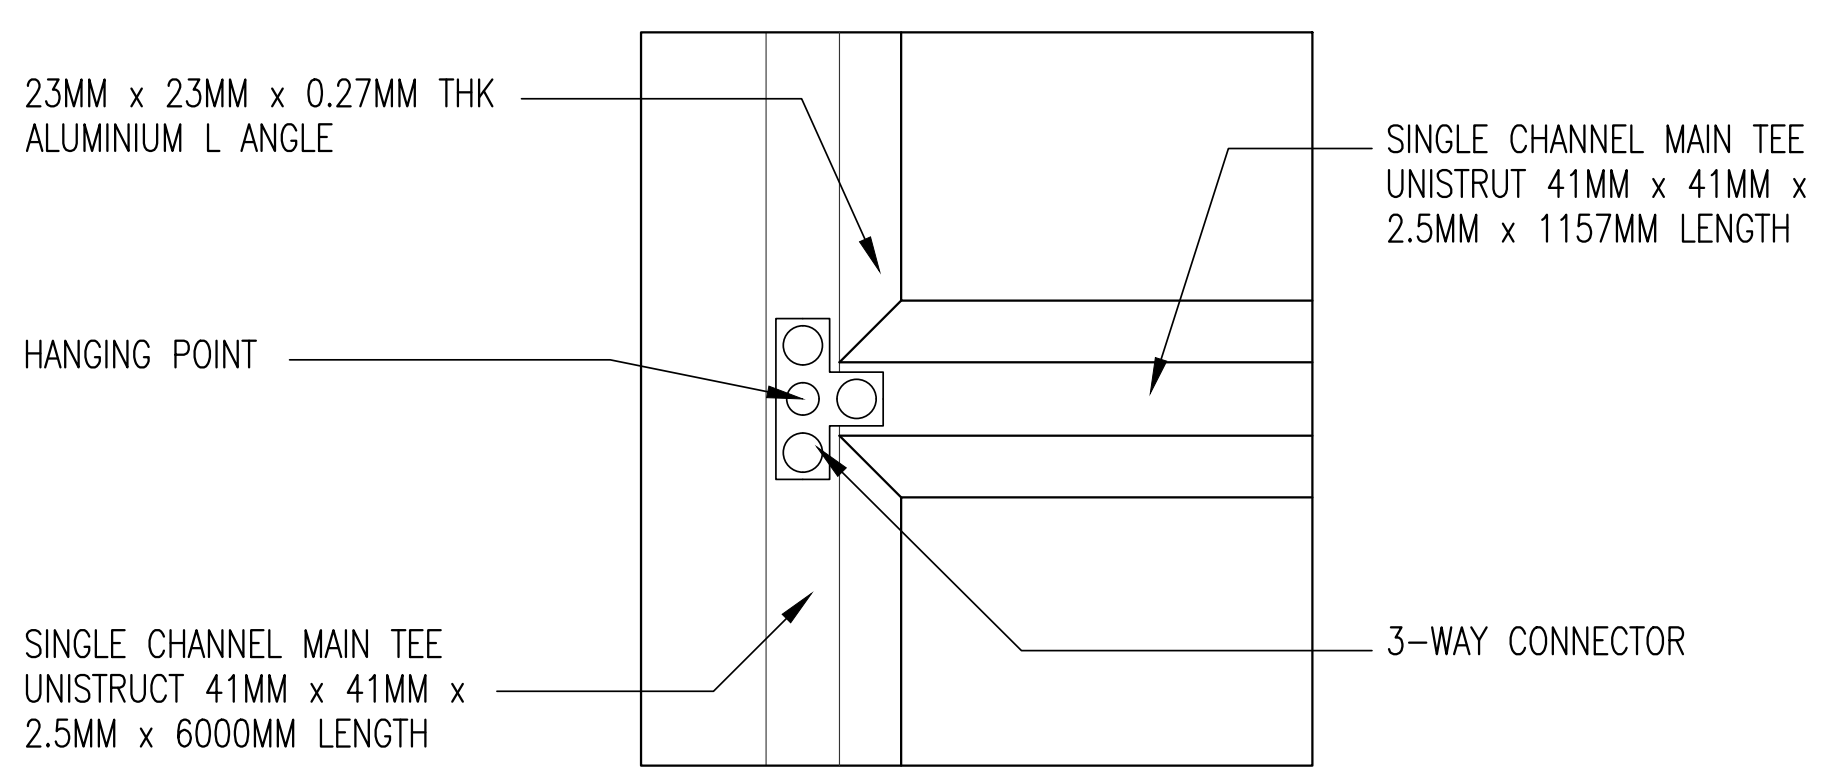
23MM x 23MM x 0.27MM THK ALUMINIUM L ANGLE
SINGLE CHANNEL MAIN TEE UNISTRUT 41MM x 41MM x 2.5MM x 1157MM LENGTH
HANGING POINT
SINGLE CHANNEL MAIN TEE UNISTRUT 41MM x 41MM x 2.5MM x 6000MM LENGTH
3-WAY CONNECTOR

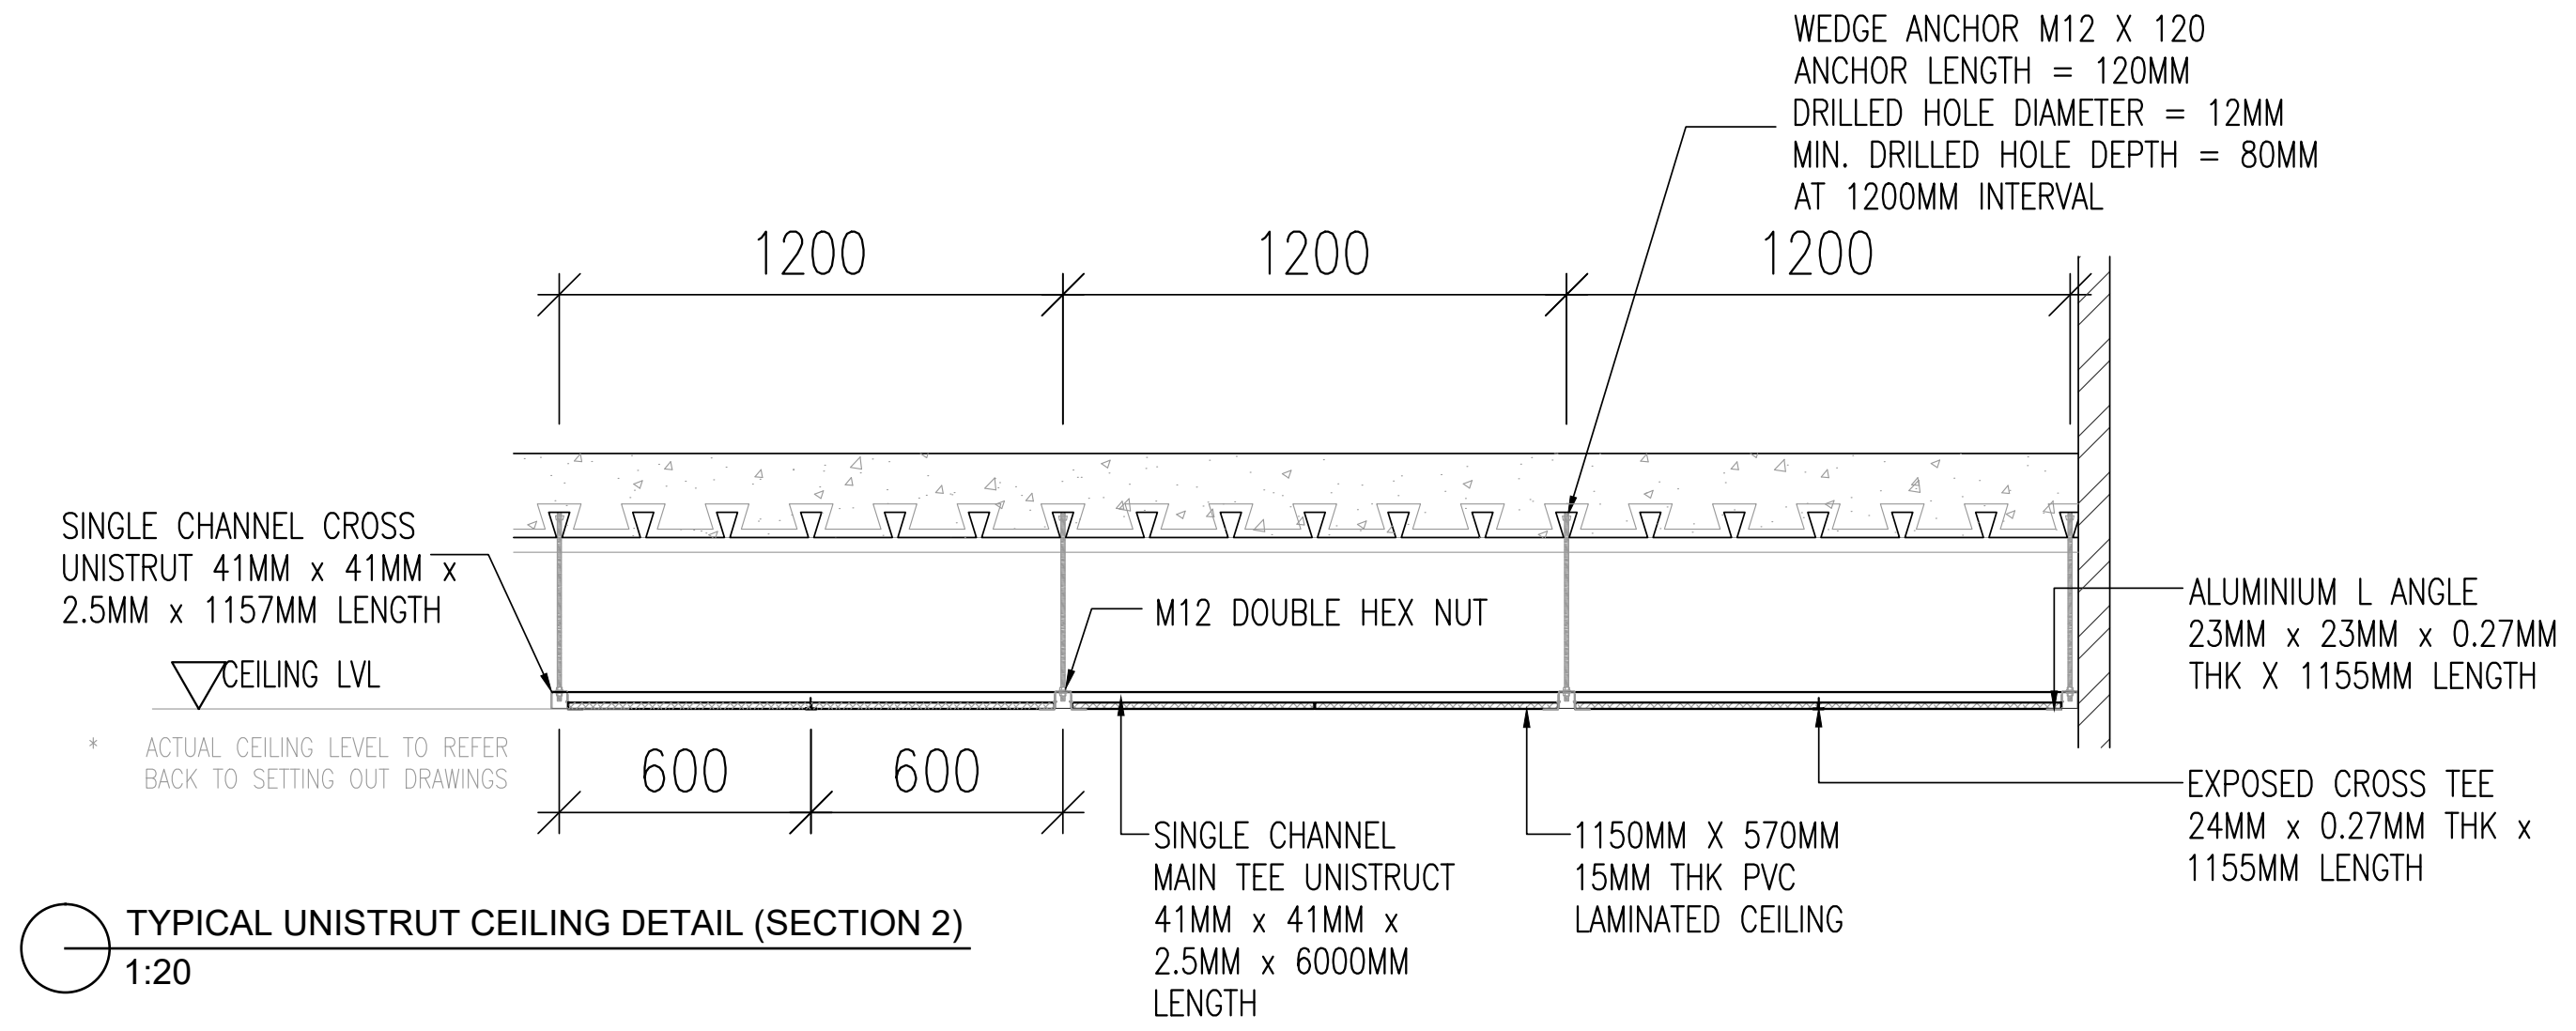
WEDGE ANCHOR M12 X 120
ANCHOR LENGTH = 120MM
DRILLED HOLE DIAMETER = 12MM
MIN. DRILLED HOLE DEPTH = 80MM
AT 1200MM INTERVAL
1200
1200
1200
SINGLE CHANNEL CROSS UNISTRUT 41MM x 41MM x 2.5MM x 1157MM LENGTH
M12 DOUBLE HEX NUT
ALUMINIUM L ANGLE 23MM x 23MM x 0.27MM THK X 1155MM LENGTH
CEILING LVL
* ACTUAL CEILING LEVEL TO REFER BACK TO SETTING OUT DRAWINGS
600
600
EXPOSED CROSS TEE 24MM x 0.27MM THK x 1155MM LENGTH
SINGLE CHANNEL MAIN TEE UNISTRUCT 41MM x 41MM x 2.5MM x 6000MM LENGTH
1150MM X 570MM 15MM THK PVC LAMINATED CEILING

TYPICAL UNISTRUT CEILING DETAIL (SECTION 2)
1:20

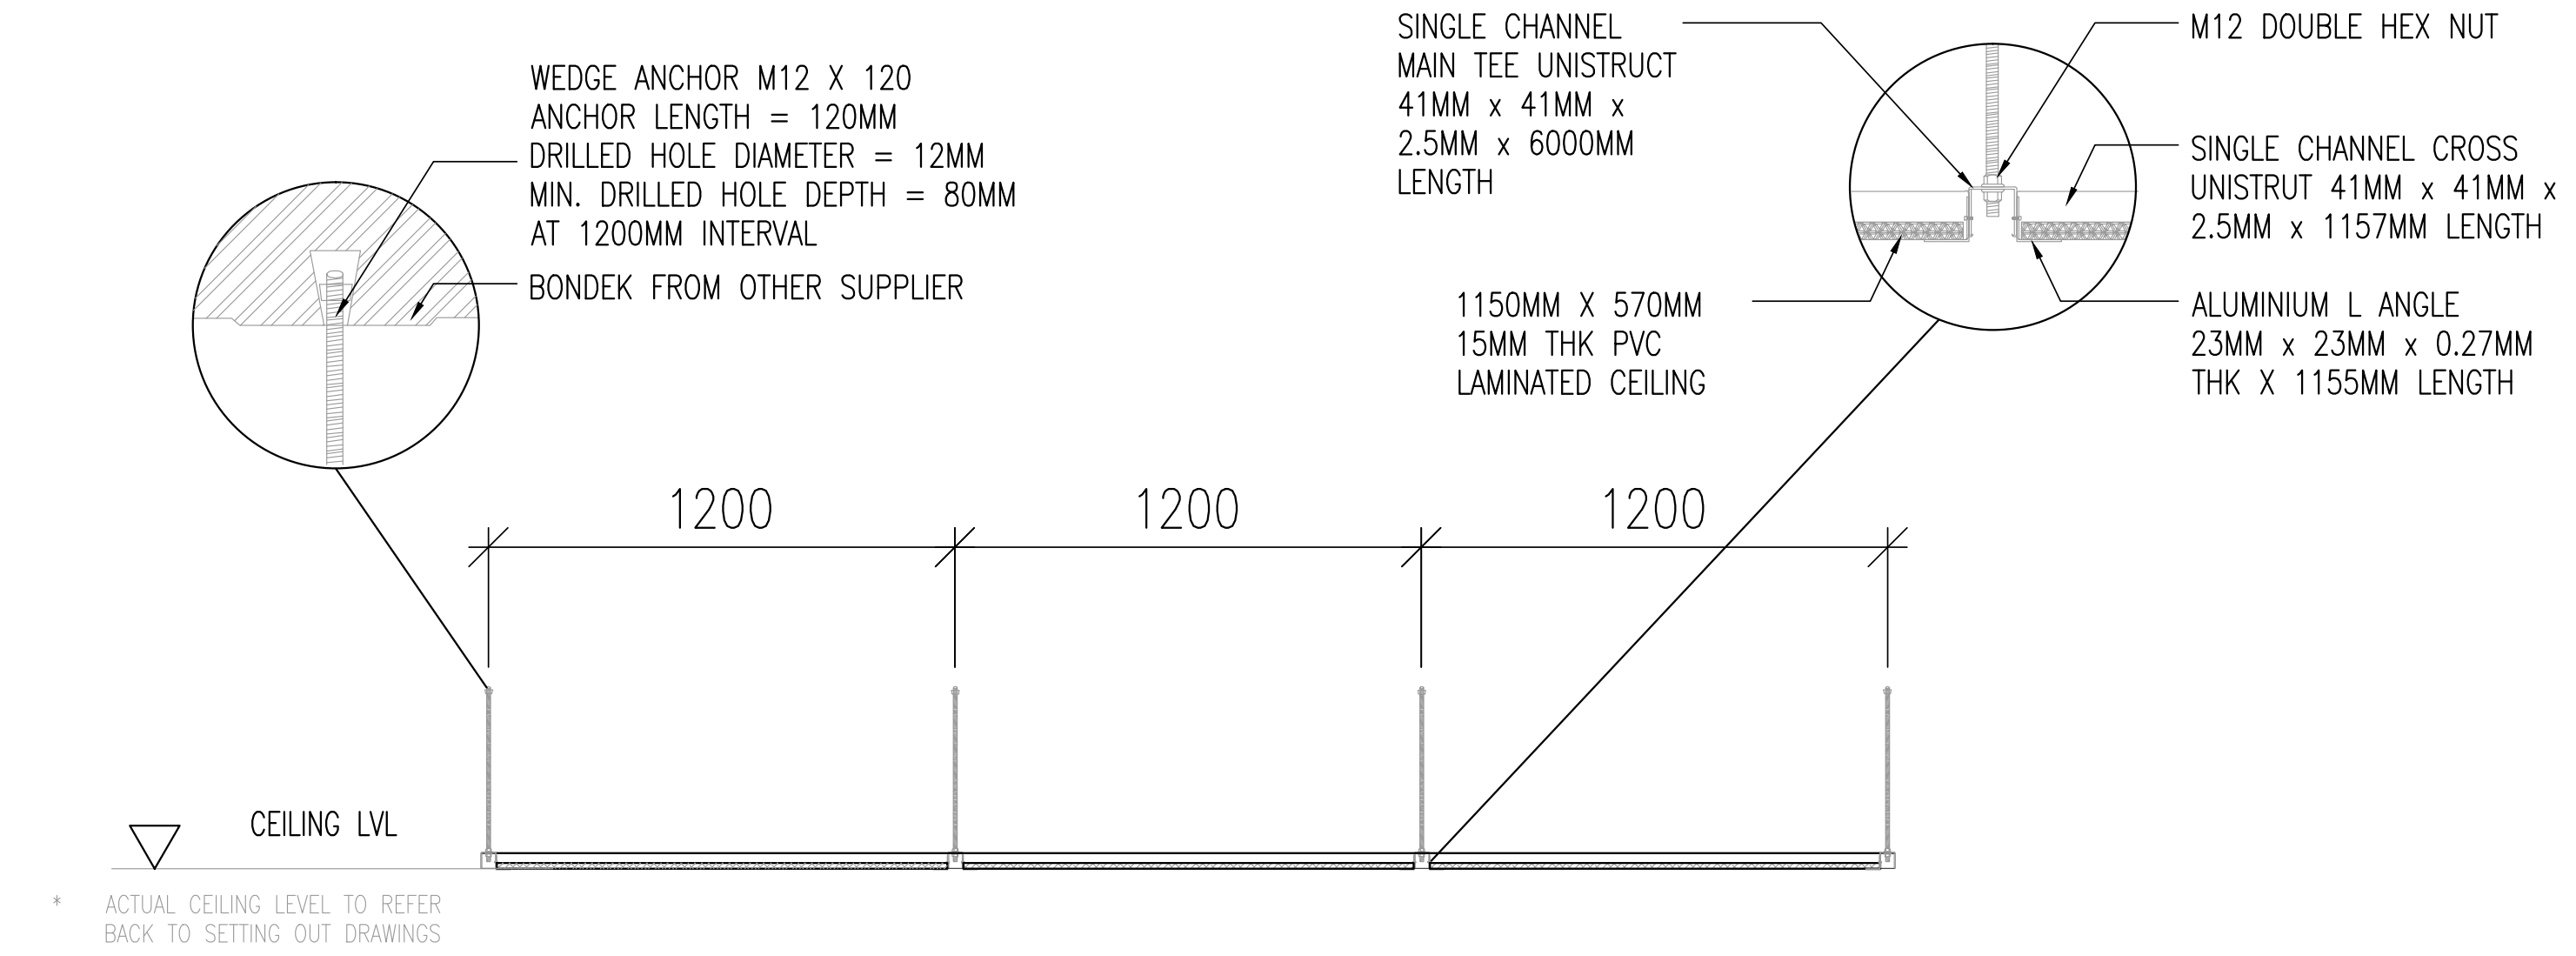
WEDGE ANCHOR M12 X 120
ANCHOR LENGTH = 120MM
DRILLED HOLE DIAMETER = 12MM
MIN. DRILLED HOLE DEPTH = 80MM
AT 1200MM INTERVAL
BONDEK FROM OTHER SUPPLIER
SINGLE CHANNEL MAIN TEE UNISTRUT 41MM x 41MM x 2.5MM x 6000MM LENGTH
1150MM X 570MM 15MM THK PVC LAMINATED CEILING
M12 DOUBLE HEX NUT
SINGLE CHANNEL CROSS UNISTRUT 41MM x 41MM x 2.5MM x 1157MM LENGTH
ALUMINIUM L ANGLE 23MM x 23MM x 0.27MM THK X 1155MM LENGTH
1200
1200
1200
CEILING LVL
* ACTUAL CEILING LEVEL TO REFER BACK TO SETTING OUT DRAWINGS

TYPICAL UNISTRUT CEILING DETAIL (SECTION 1)
1:20

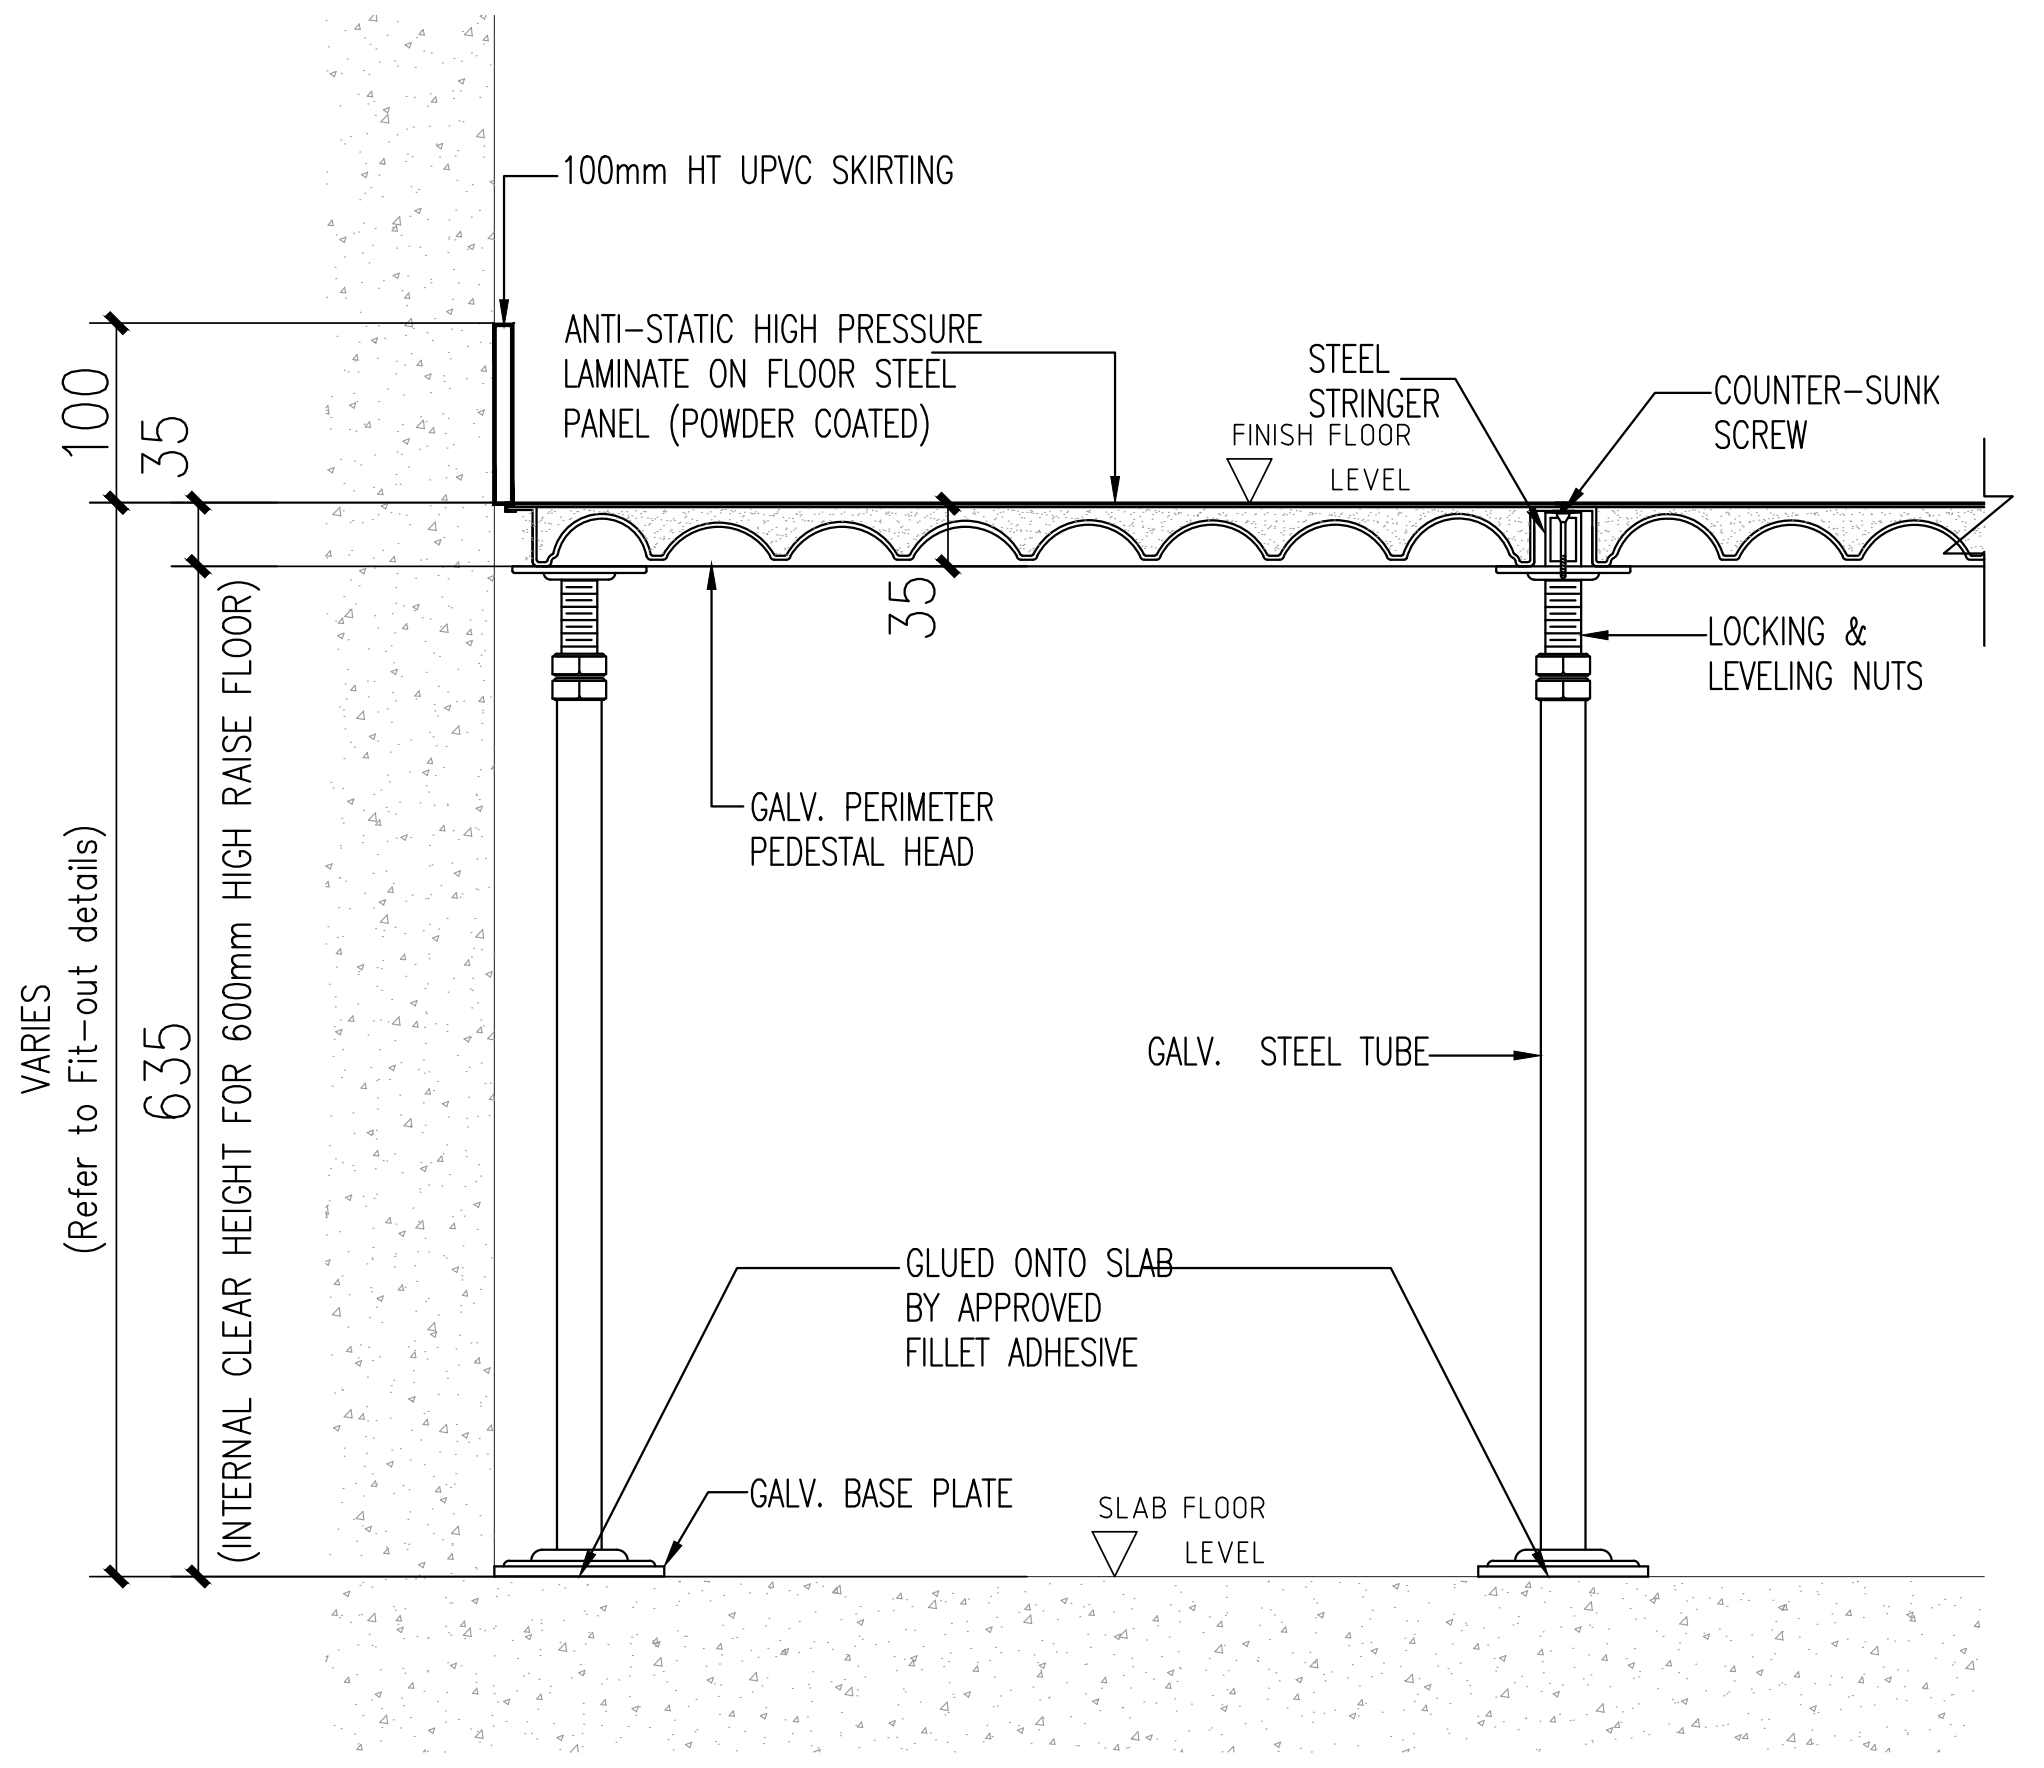
100mm HT UPVC SKIRTING
ANTI-STATIC HIGH PRESSURE LAMINATE ON FLOOR STEEL PANEL (POWDER COATED)
STEEL STRINGER
COUNTER-SUNK SCREW
FINISH FLOOR LEVEL
100
35
35
LOCKING & LEVELING NUTS
GALV. PERIMETER PEDESTAL HEAD
VARIES (Refer to Fit-out details)
635
(INTERNAL CLEAR HEIGHT FOR 600mm HIGH RAISE FLOOR)
GALV. STEEL TUBE
GLUED ONTO SLAB BY APPROVED FILLET ADHESIVE
GALV. BASE PLATE
SLAB FLOOR LEVEL

RAISED FLOOR (600mm HEIGHT) DETAIL
1:5

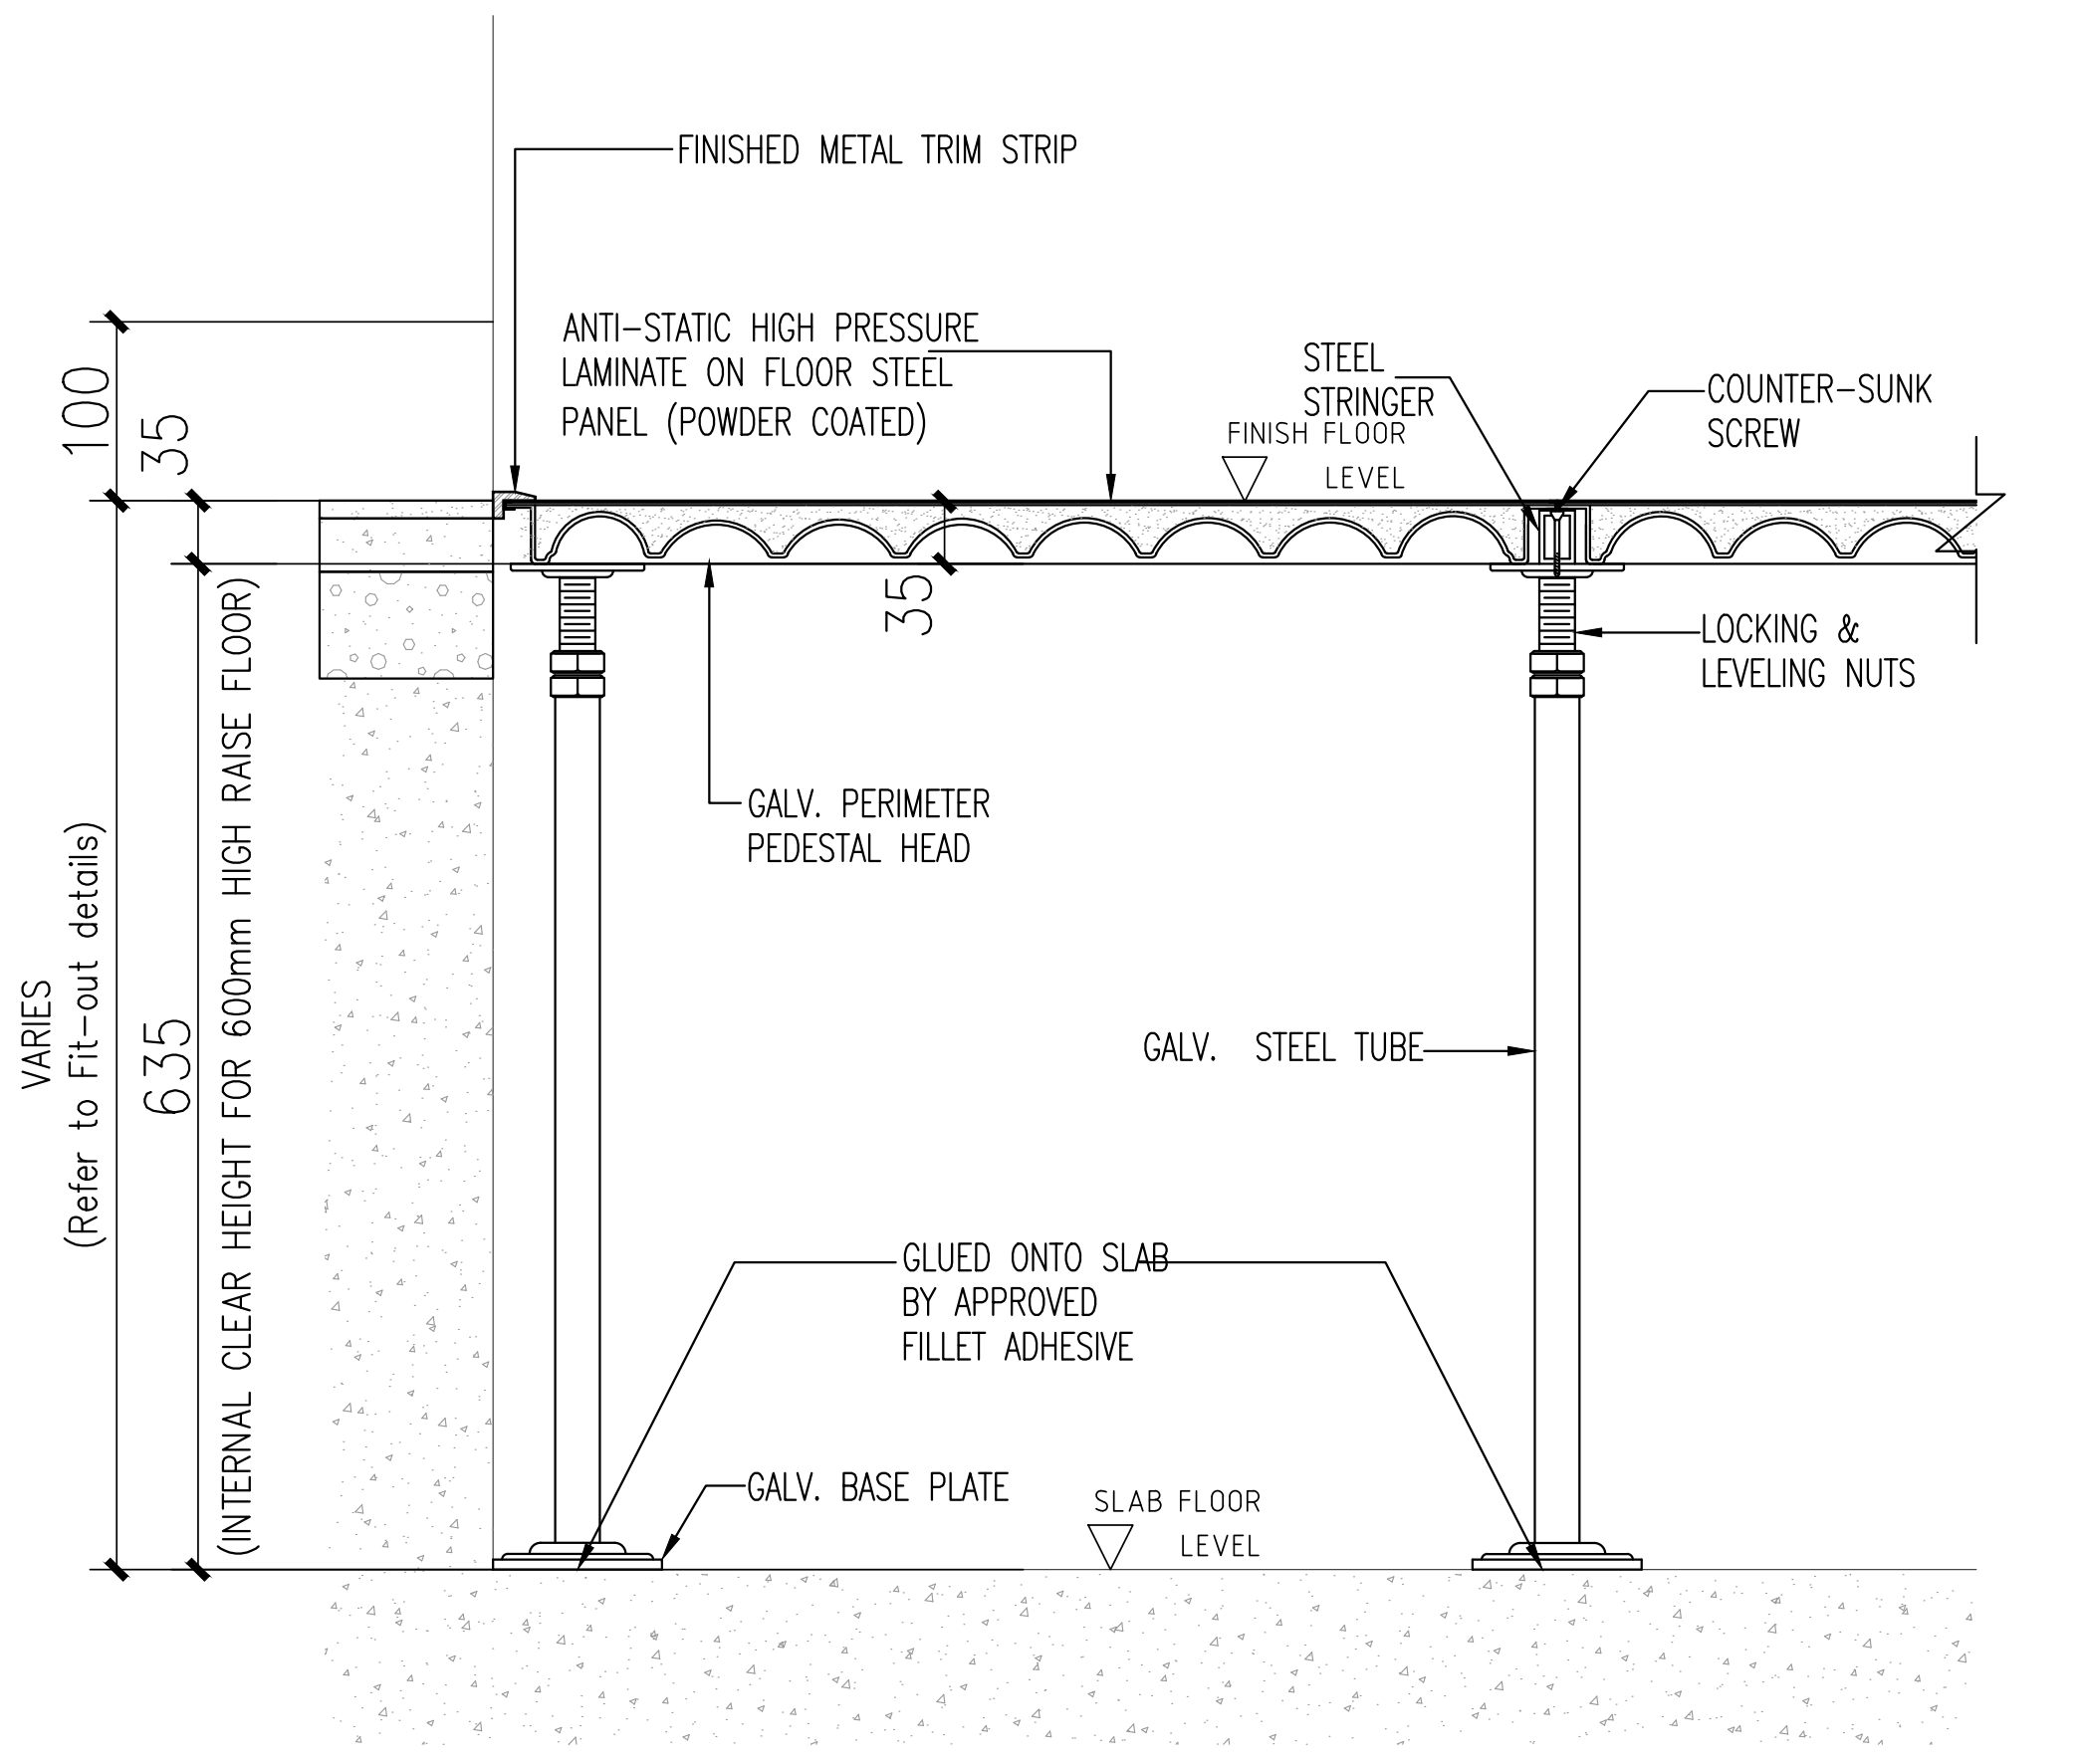
FINISHED METAL TRIM STRIP
ANTI-STATIC HIGH PRESSURE LAMINATE ON FLOOR STEEL PANEL (POWDER COATED)
STEEL STRINGER
COUNTER-SUNK SCREW
FINISH FLOOR LEVEL
100
35
35
LOCKING & LEVELING NUTS
GALV. PERIMETER PEDESTAL HEAD
VARIES (Refer to Fit-out details)
635
(INTERNAL CLEAR HEIGHT FOR 600mm HIGH RAISE FLOOR)
GALV. STEEL TUBE
GLUED ONTO SLAB BY APPROVED FILLET ADHESIVE
GALV. BASE PLATE
SLAB FLOOR LEVEL

FINISHED METAL TRIM STRIP DETAIL
1:5

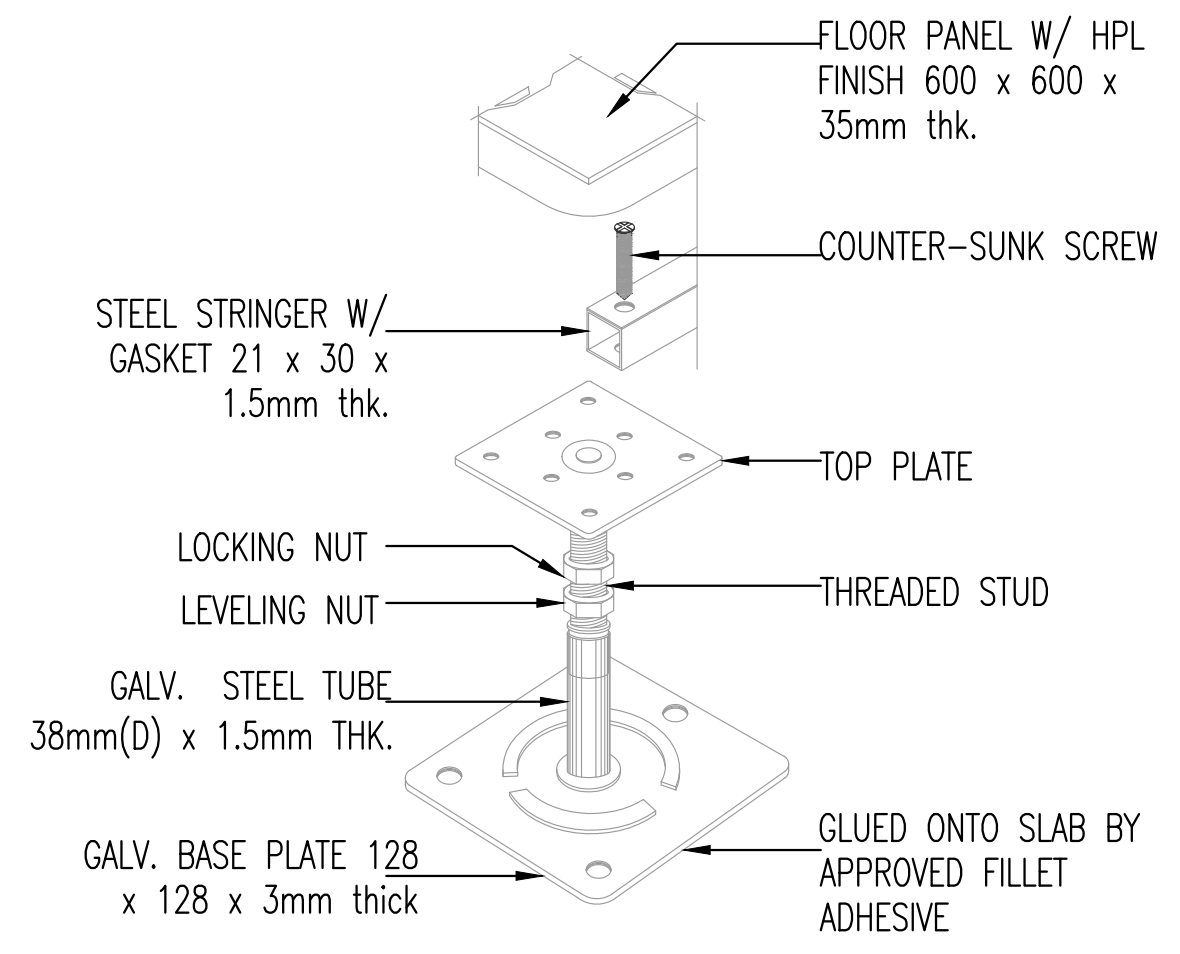
FLOOR PANEL W/ HPL FINISH 600 x 600 x 35mm thk.
COUNTER-SUNK SCREW
STEEL STRINGER W/ GASKET 21 x 30 x 1.5mm thk.
TOP PLATE
LOCKING NUT
LEVELING NUT
THREADED STUD
GALV. STEEL TUBE 38mm(0) x 1.5mm THK.
GALV. BASE PLATE 128 x 128 x 3mm thick
GLUED ONTO SLAB BY APPROVED FILLET ADHESIVE

ISOMETRIC VIEW
1:5

NOTE : THIS PRINT IS OF A CONFIDENTIAL NATURE, IT SHALL NOT BE TRACED,PHOTOGRAPHED,PHOTOSTATED OR REPRODUCED IN ANY MANER,NOR USED FOR ANY PURPOSE WHATSOEVER EXCEPT BY WRITTEN PERMISSION

CLIENT :

GULF EDGE DC 01

87 Wireless Road, M Thai Tower 11th. Floor, All Seasons Place, Lumpini,
Pathumwan, Bangkok 10330, Thailand

CONTRACTOR :

华西发展(泰国)有限公司
บริษัท หัวซือ ดีเวลลอปเม้นต์ (ประเทศไทย) จำกัด
HUASHI DEVELOPMENT CO.,LTD
No. 202, Room No. 1403, 14/F, Le Concorde Building,
Ratchadapisek Road, Huaykhwang Sub-District,
Huaykhwang District, Bangkok Metropolitan 10310.

CONSULTANT :

ARbay
บริษัท เอ อาร์ เบย์ จำกัด
ARbay Company Limited
31 st Floor Bangkok Insurance Building
25 South Sathorn road Thungmahamek
Sathorn Bangkok 10120 THAILAND
T +66 (0) 2286 8199
F +66 (0) 2286 2863
info@arbay.co.th

CONSULTANT :

Qbic Engineers & Architects Co.,Ltd.
8 Soi KALONG 4 SANAMBINNAM ROAD,
THASAI SUB-DISTRICT, MUANG NONTHABURI DISTRICT
, NONTHABURI.
Tel 662-950-4374
Fax 662-580-3231
E-Mail : qbic@qbic.co.th, www.qbic.co.th
QBIC ENGINEERS AND ARCHITECTS CO.,LTD.

CONSULTANT :

MITR
MITR TECHNICAL CONSULTANT CO.,LTD.
1168/8 12th FLOOR, LUMPINI TOWER BUILDING,
RAMA IV RD., THUNGMAHAMEK, SATHORN, BANGKOK 10120, THAILAND
TEL : 0-2679-9079-84
FAX : 0-2679-9085 E-mail: mitr_dd@mitr.com

Architect :	SIGNATURE
ประกิต พนานุรัตน์ วสถ. 580 ที่อยู่ 251/1 ถ.จารุเมือง แขวงรองเมือง เขตปทุมวัน กรุงเทพมหานคร โทรศัพท์ 02-286-8199	
Structural Engineer :	SIGNATURE
วิศวกรผู้ออกแบบโครงสร้าง	
ณัฐสม สงวนวงษ์ วย 1423 ที่อยู่ 2/1 ซ.รามคำแหง 150 ถ.รามคำแหง แขวง สะพานสูง เขต สะพานสูง กทม. 10240	ณัฐสม สงวนวงษ์
Structural Inspector :	SIGNATURE
วิศวกรผู้ตรวจสอบโครงสร้าง	
โกมล จุฑาภัทร วย 964 ที่อยู่ 24/18 ซ.นวมินทร์ 129 ถ. นวมินทร์ แขวง นวลจันทร์ เขต บึงกุ่ม กทม. 10230	
Electrical Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบไฟฟ้ากำลัง	
นายสุภัทร บูรณวิทย์ วฟก.1265 ที่อยู่ 21 ซอยทานสัมฤทธิ์ 13 ตำบลท่าทราย อ.เมืองนนทบุรี จ.นนทบุรี 11000	
Mechanical Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบเครื่องกลและปรับอากาศ	
นายประสิทธิ์ เกียวสุนทร วก.1221 ที่อยู่ 44/372 ซอยบางกระดี่ 35/1 แขวงแสมดำ เขตบางขุนเทียน กทม. 10150	ประสิทธิ์
Sanitary Engineer :	SIGNATURE
วิศวกรผู้ออกแบบระบบสุขาภิบาล และดับเพลิง	
นายทศวรรษ สันนฤทธิ์ วส. 215 ที่อยู่ บ้านเลขที่ 99/107 หมู่ที่ 3 ต.ศีรษะจรเข้น้อย อ.บางเสาธง จ.สมุทรปราการ 10540	ทศวรรษ

ISSUE/REVISION

REV.	DESCRIPTION	DATE
A	90% DEVELOPED	09/05/2026

PROJECT NAME :
GEDC 01

LOCATION:
Nikhom Phattana district, Rayong ,industrial estate,CPGC

BUILDING :
DETAILS

90% DEVELOPED

TITLE :
CEILING&RAISED FLOOR DETAILS

JOB NO.	SCALE 1:20
DRAWN LYT	REF.
CHECKED LJC	DWG.NO. MPK01A-60-A -CFD-001
APPROVED LXD	
DATE 2026.05.09	