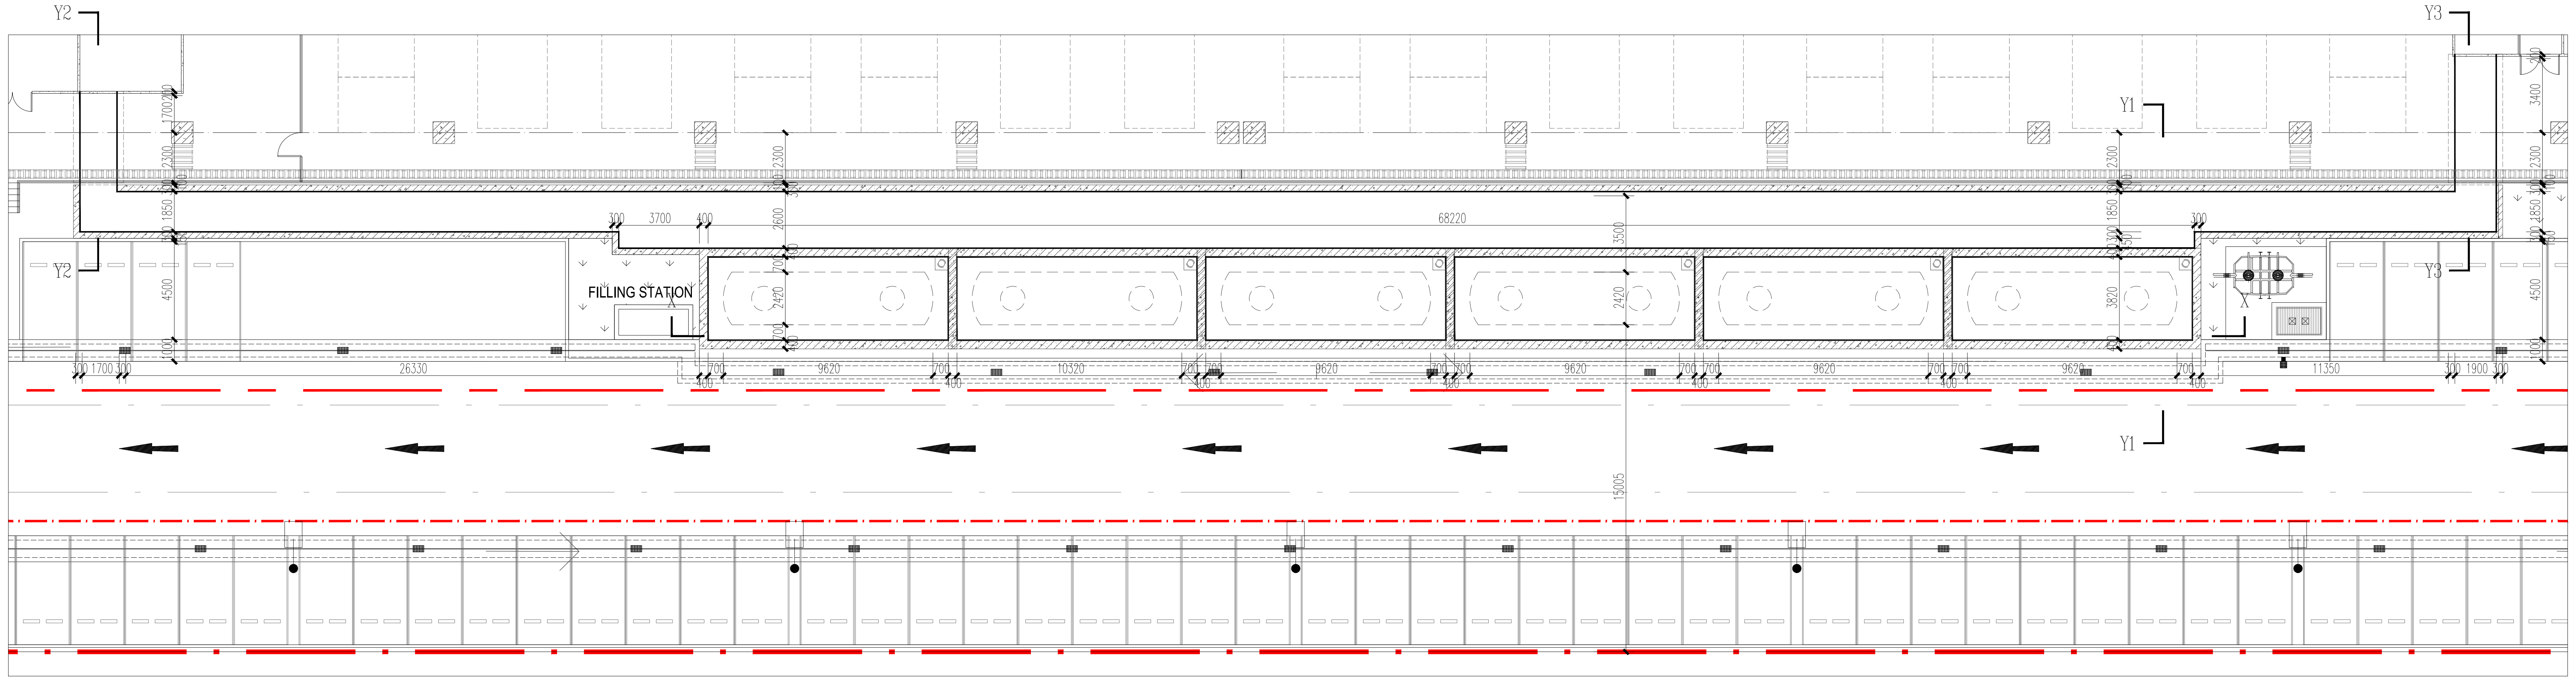

40,000L FUEL TANK PLAN
Scale 1:150

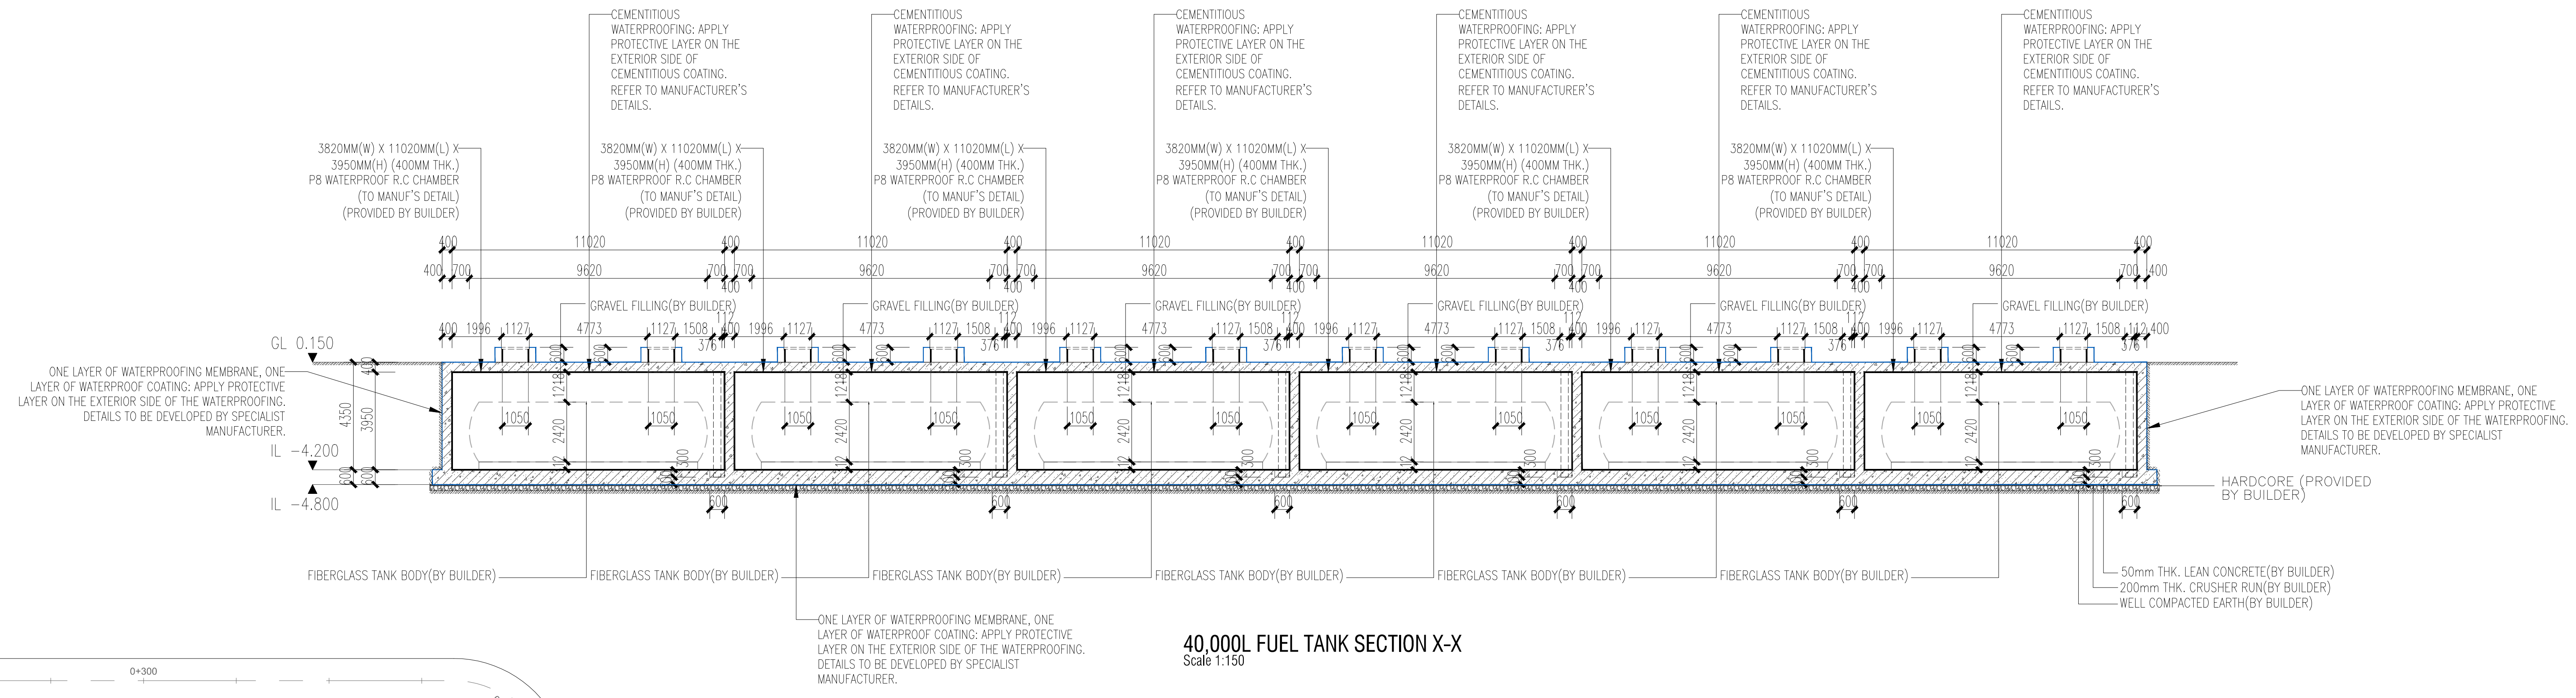
CEMENTITIOUS WATERPROOFING: APPLY PROTECTIVE LAYER ON THE EXTERIOR SIDE OF CEMENTITIOUS COATING. REFER TO MANUFACTURER'S DETAILS.
3820MM(W) X 11020MM(L) X 3950MM(H) (400MM THK.) P8 WATERPROOF R.C CHAMBER (TO MANUF'S DETAIL) (PROVIDED BY BUILDER)
GRAVEL FILLING(BY BUILDER)
11020
9620
4773
1996
1127
1508
1050
2420
GL 0.150
IL −4.200
IL −4.800
4350
3950
ONE LAYER OF WATERPROOFING MEMBRANE, ONE LAYER OF WATERPROOF COATING: APPLY PROTECTIVE LAYER ON THE EXTERIOR SIDE OF THE WATERPROOFING. DETAILS TO BE DEVELOPED BY SPECIALIST MANUFACTURER.
FIBERGLASS TANK BODY(BY BUILDER)
HARDCORE (PROVIDED BY BUILDER)
50mm THK. LEAN CONCRETE(BY BUILDER)
200mm THK. CRUSHER RUN(BY BUILDER)
WELL COMPACTED EARTH(BY BUILDER)

40,000L FUEL TANK SECTION X-X
Scale 1:150

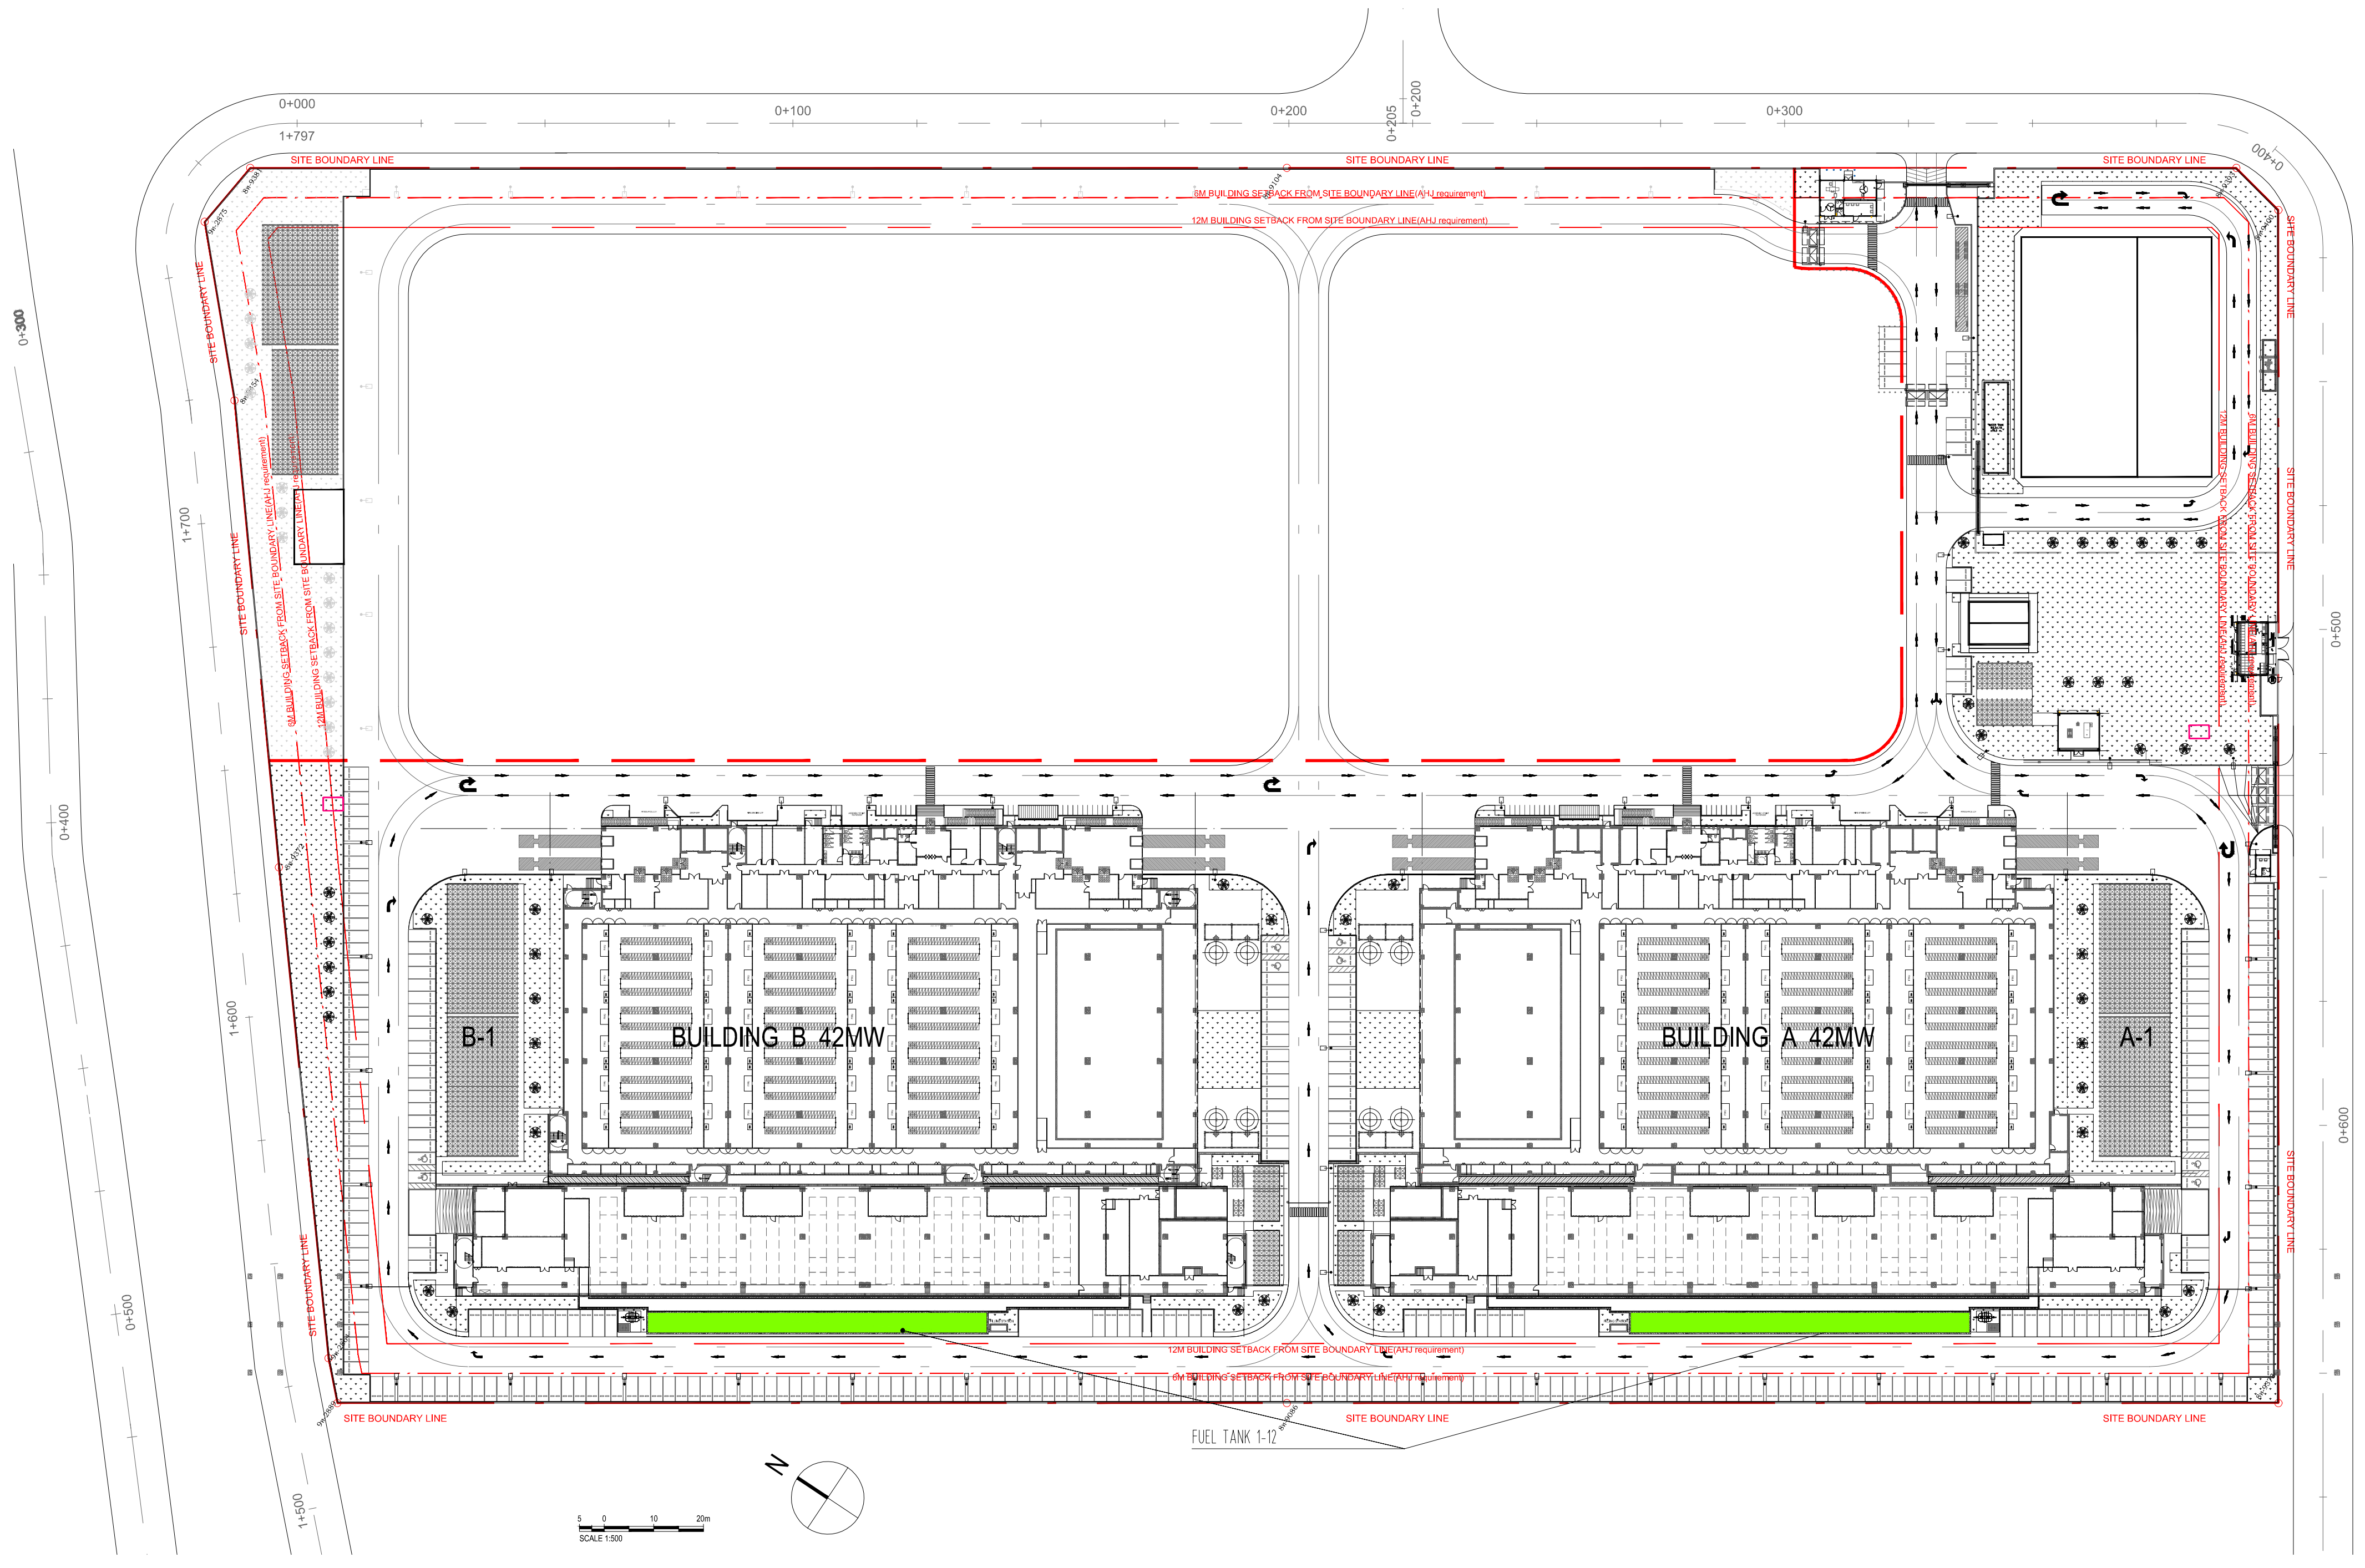

40,000L FUEL TANK KEY PLAN
Scale 1:150

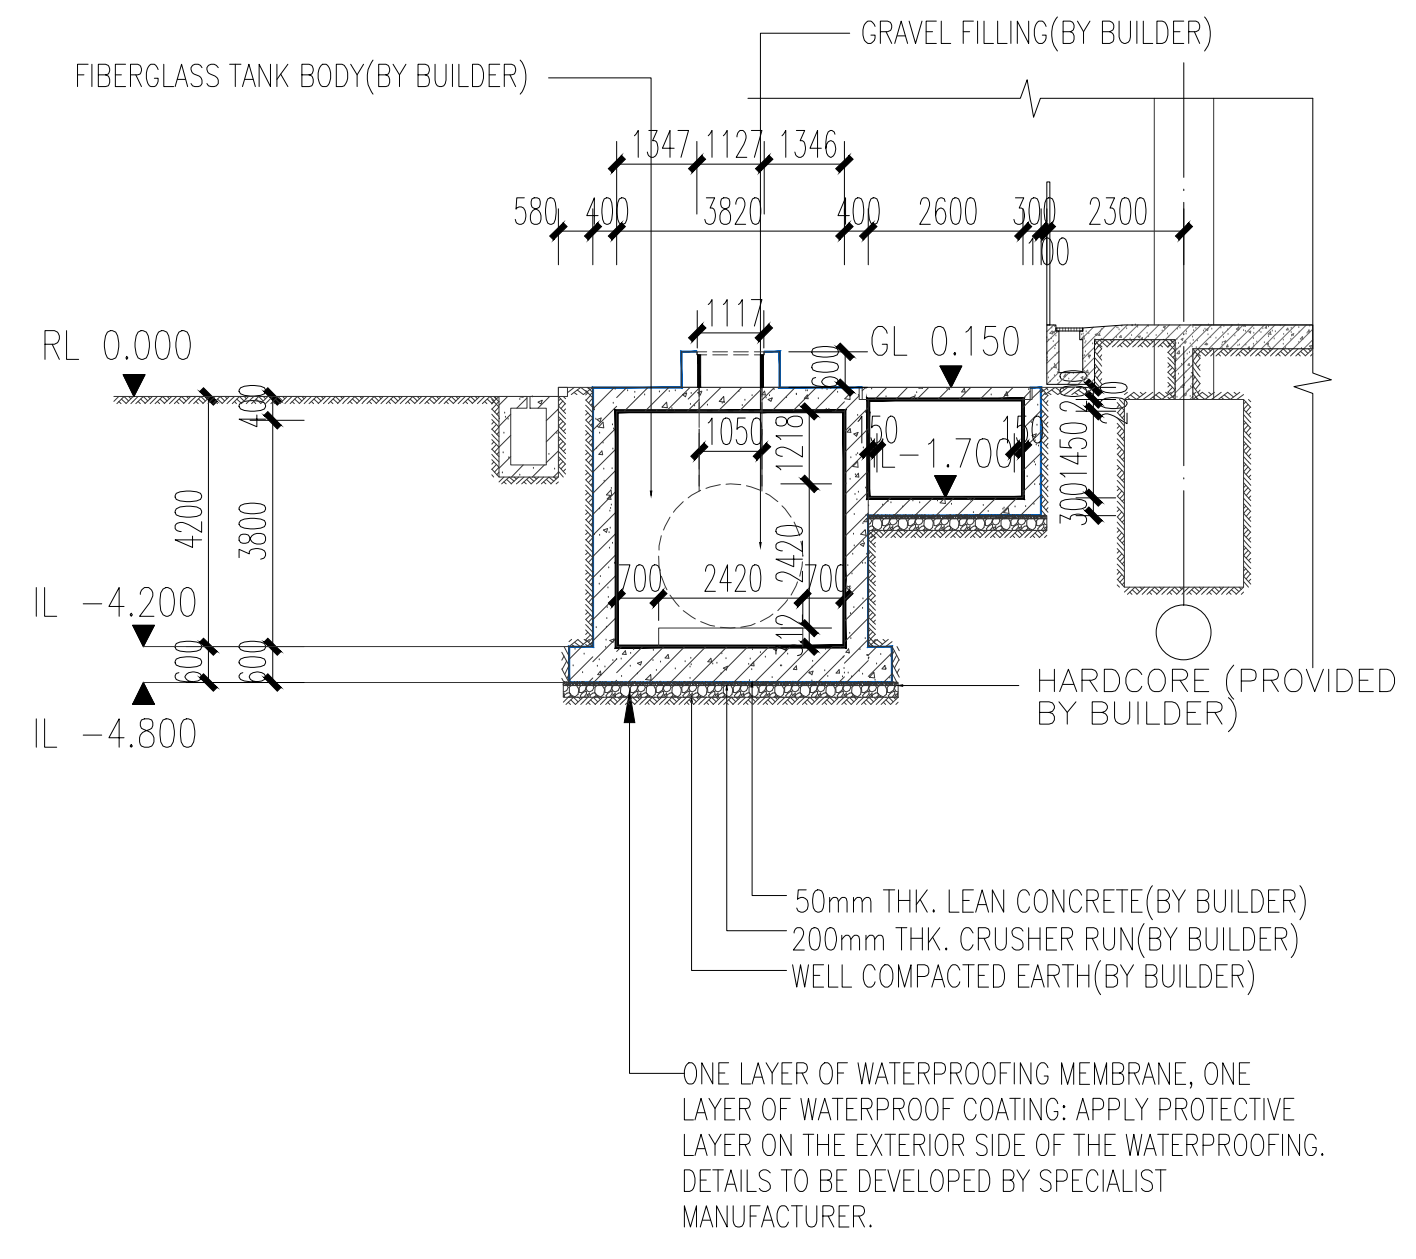
FIBERGLASS TANK BODY(BY BUILDER)
GRAVEL FILLING(BY BUILDER)
1347
1127
1346
580
400
3820
2600
300
2300
1100
1117
1050
1218
2420
700
RL 0.000
GL 0.150
IL −1.700
IL −4.200
IL −4.800
4200
3800
HARDCORE (PROVIDED BY BUILDER)
50mm THK. LEAN CONCRETE(BY BUILDER)
200mm THK. CRUSHER RUN(BY BUILDER)
WELL COMPACTED EARTH(BY BUILDER)
ONE LAYER OF WATERPROOFING MEMBRANE, ONE LAYER OF WATERPROOF COATING: APPLY PROTECTIVE LAYER ON THE EXTERIOR SIDE OF THE WATERPROOFING. DETAILS TO BE DEVELOPED BY SPECIALIST MANUFACTURER.

40,000L FUEL TANK SECTION Y1-Y1
Scale 1:150

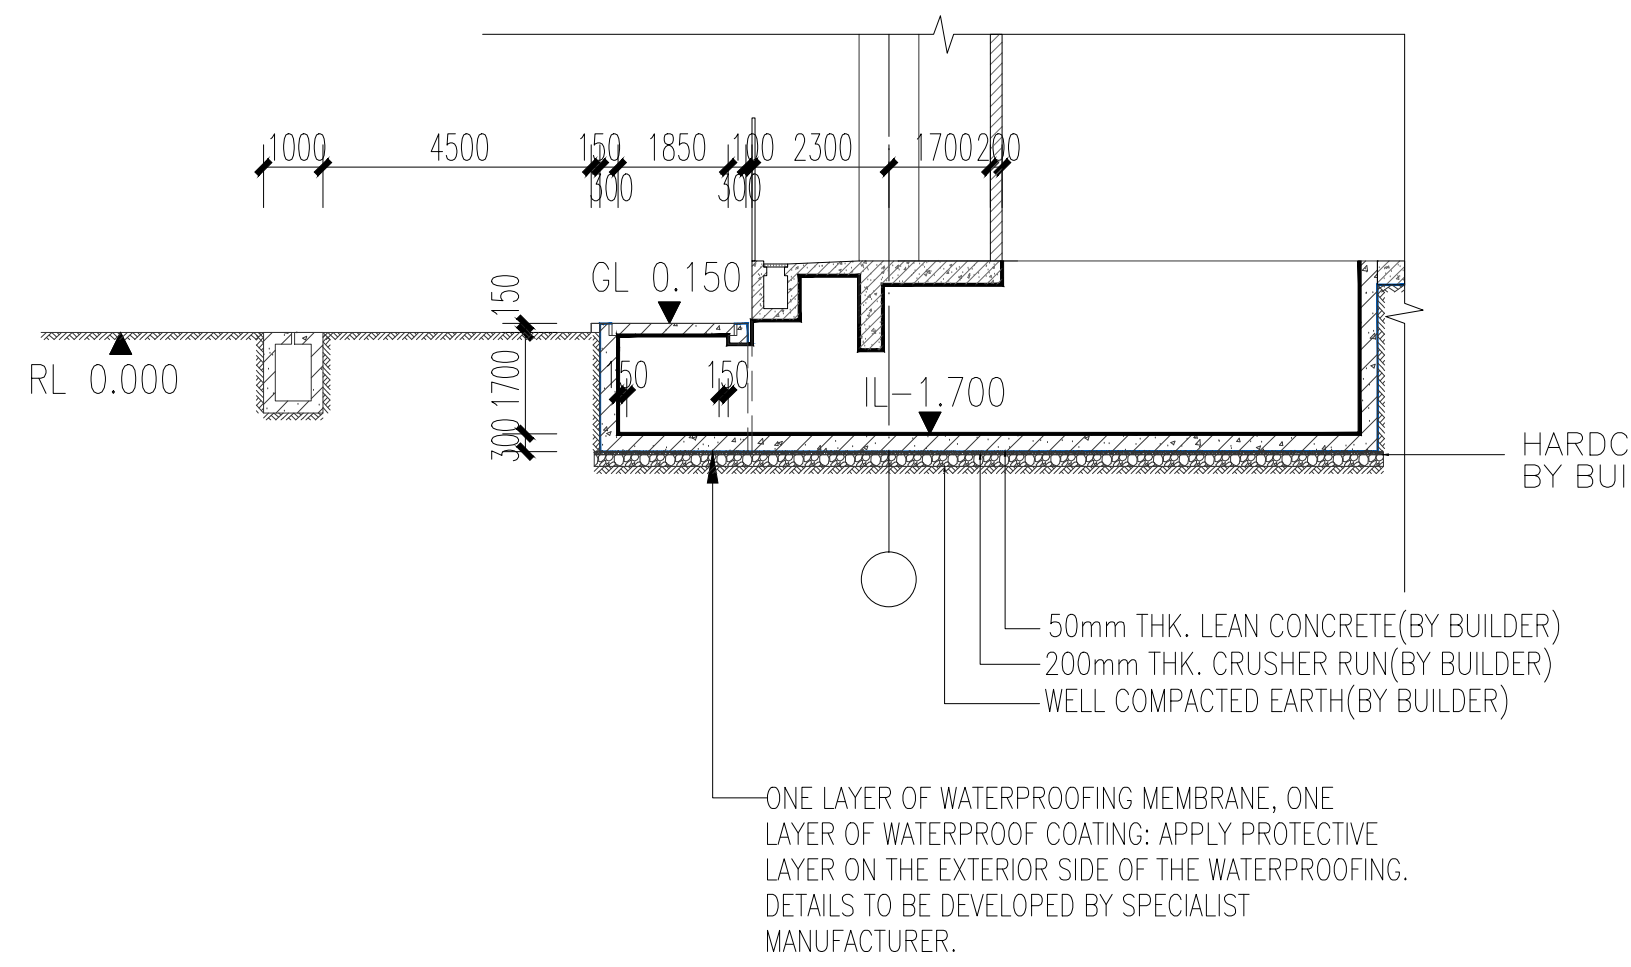
1000
4500
150
1850
100
2300
1700
200
300
RL 0.000
GL 0.150
IL −1.700
HARDCORE (PROVIDED BY BUILDER)
50mm THK. LEAN CONCRETE(BY BUILDER)
200mm THK. CRUSHER RUN(BY BUILDER)
WELL COMPACTED EARTH(BY BUILDER)
ONE LAYER OF WATERPROOFING MEMBRANE, ONE LAYER OF WATERPROOF COATING: APPLY PROTECTIVE LAYER ON THE EXTERIOR SIDE OF THE WATERPROOFING. DETAILS TO BE DEVELOPED BY SPECIALIST MANUFACTURER.

40,000L FUEL TANK SECTION Y2-Y2
Scale 1:150

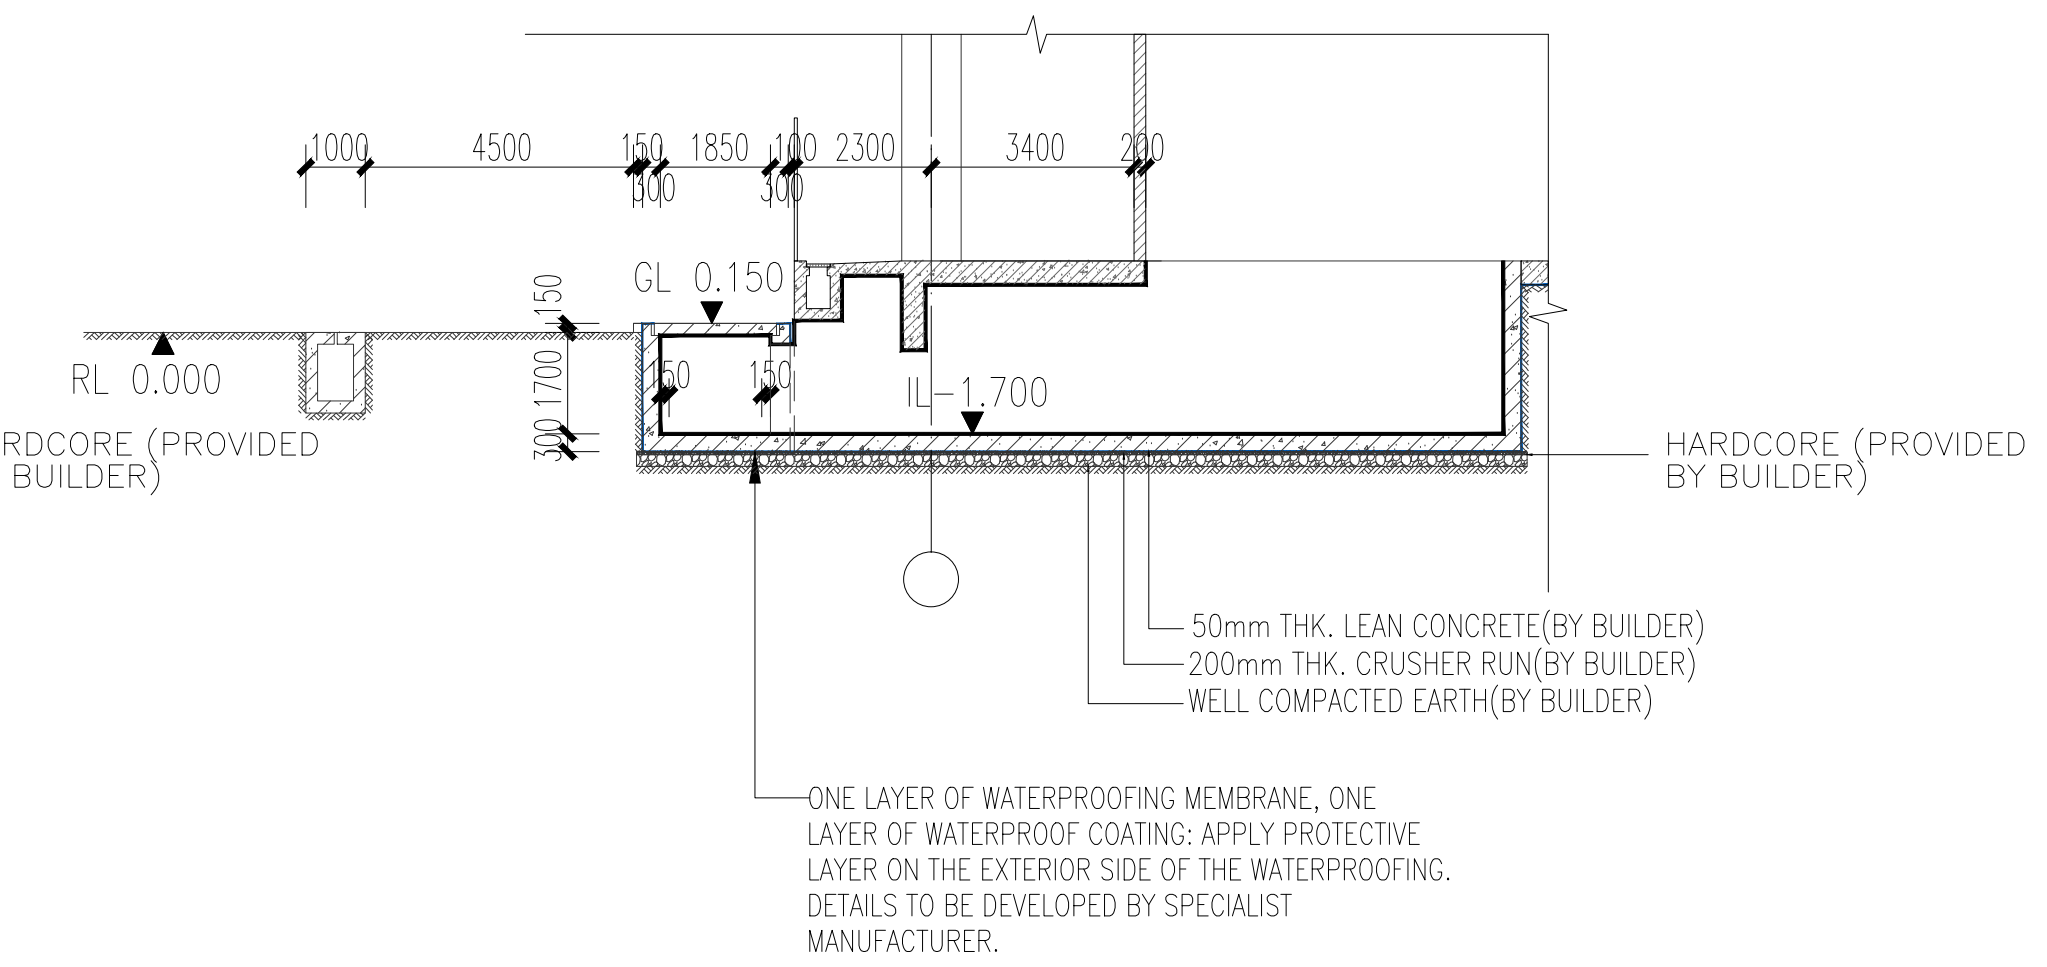
1000
4500
150
1850
100
2300
3400
300
RL 0.000
GL 0.150
IL −1.700
HARDCORE (PROVIDED BY BUILDER)
50mm THK. LEAN CONCRETE(BY BUILDER)
200mm THK. CRUSHER RUN(BY BUILDER)
WELL COMPACTED EARTH(BY BUILDER)
ONE LAYER OF WATERPROOFING MEMBRANE, ONE LAYER OF WATERPROOF COATING: APPLY PROTECTIVE LAYER ON THE EXTERIOR SIDE OF THE WATERPROOFING. DETAILS TO BE DEVELOPED BY SPECIALIST MANUFACTURER.

40,000L FUEL TANK SECTION Y3-Y3
Scale 1:150

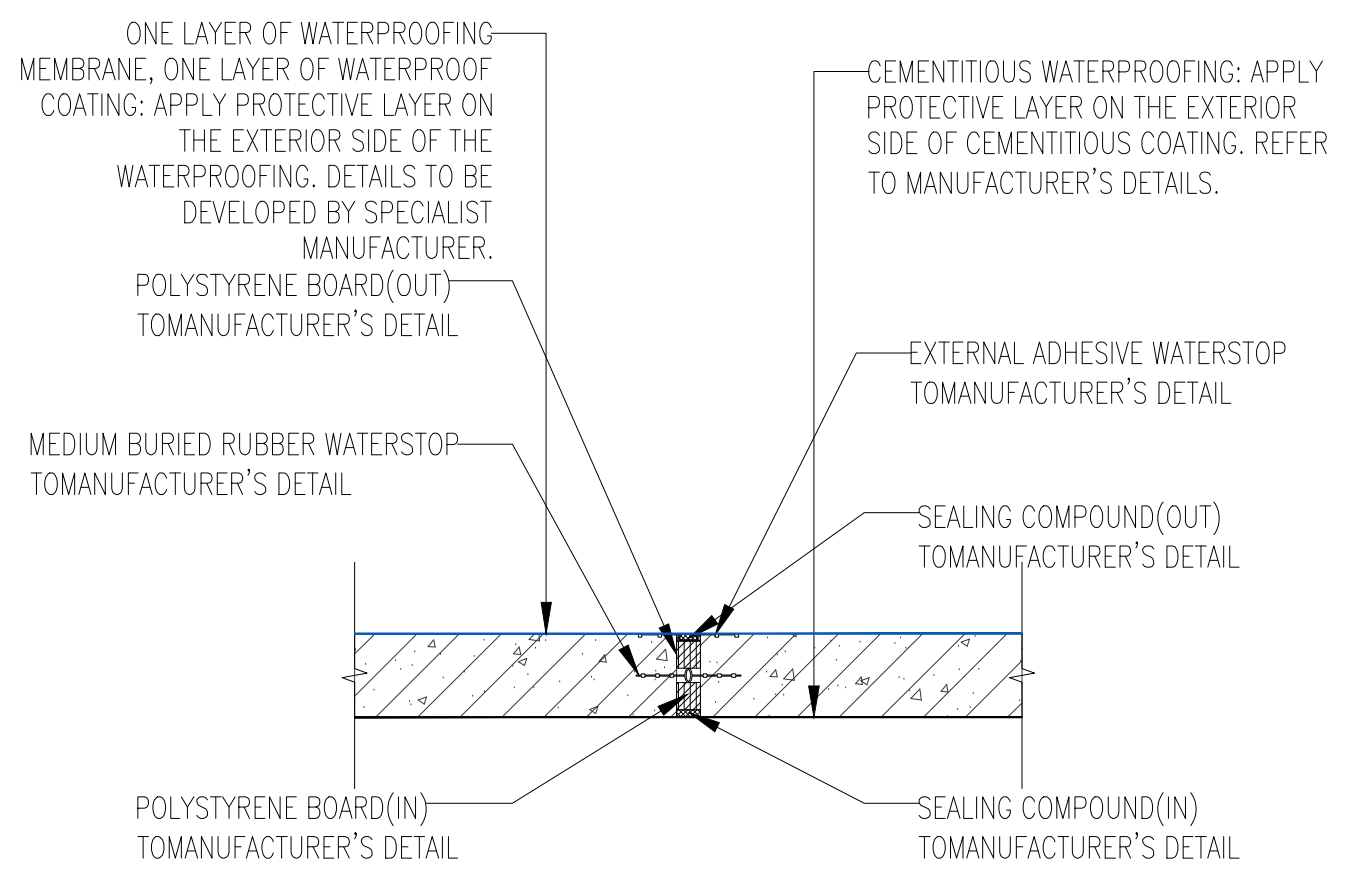
ONE LAYER OF WATERPROOFING MEMBRANE, ONE LAYER OF WATERPROOF COATING: APPLY PROTECTIVE LAYER ON THE EXTERIOR SIDE OF THE WATERPROOFING. DETAILS TO BE DEVELOPED BY SPECIALIST MANUFACTURER.
POLYSTYRENE BOARD(OUT) TOMANUFACTURER'S DETAIL
MEDIUM BURIED RUBBER WATERSTOP TOMANUFACTURER'S DETAIL
CEMENTITIOUS WATERPROOFING: APPLY PROTECTIVE LAYER ON THE EXTERIOR SIDE OF CEMENTITIOUS COATING. REFER TO MANUFACTURER'S DETAILS.
EXTERNAL ADHESIVE WATERSTOP TOMANUFACTURER'S DETAIL
SEALING COMPOUND(OUT) TOMANUFACTURER'S DETAIL
POLYSTYRENE BOARD(IN) TOMANUFACTURER'S DETAIL
SEALING COMPOUND(IN) TOMANUFACTURER'S DETAIL

40,000L FUEL TANK WATERPROOFING FOR ROOF PANEL AND EXTERIOR WALL DEFORMATION DETAILS
Scale 1:50

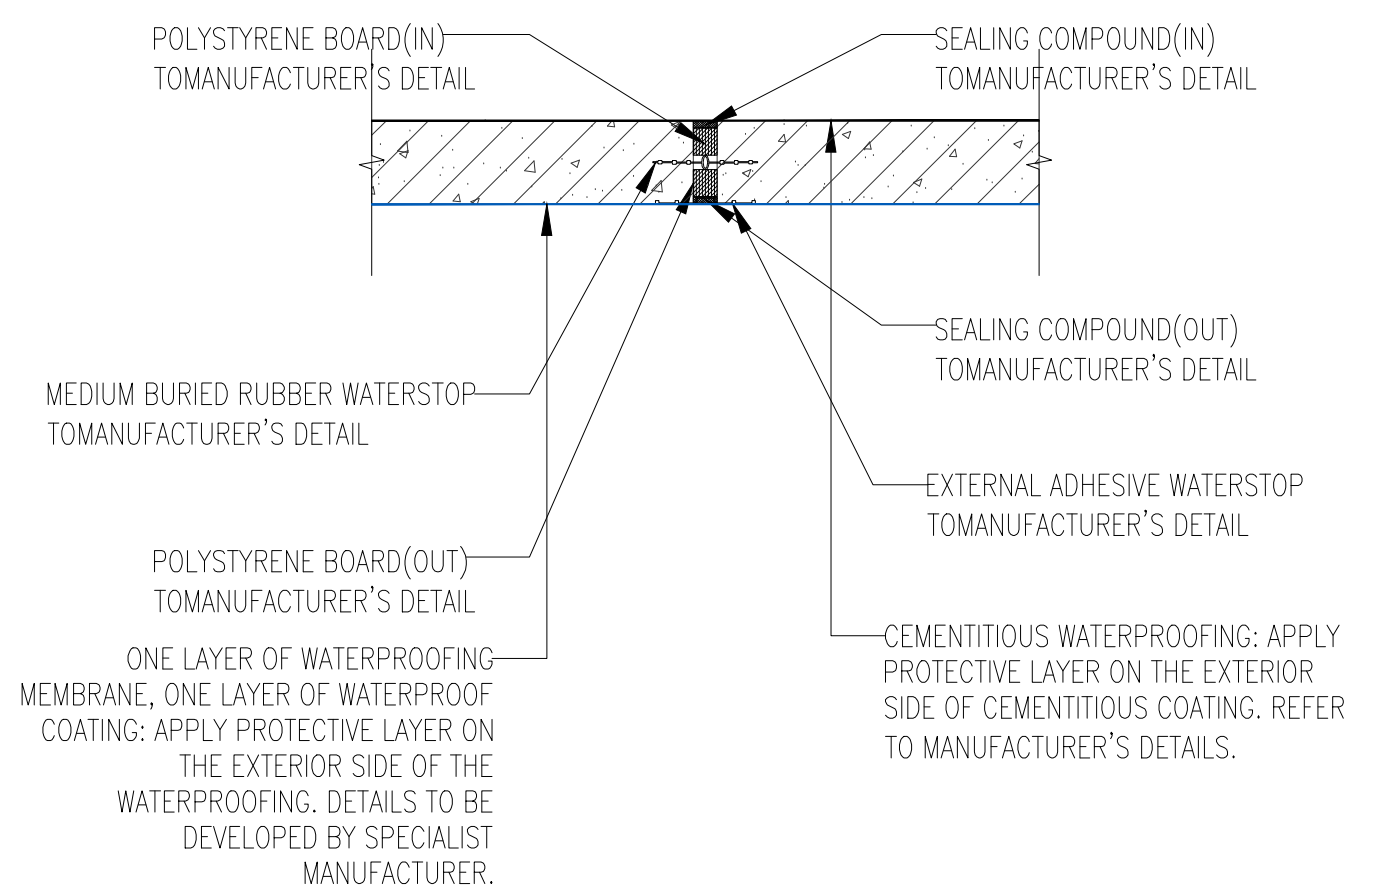
POLYSTYRENE BOARD(IN) TOMANUFACTURER'S DETAIL
SEALING COMPOUND(IN) TOMANUFACTURER'S DETAIL
SEALING COMPOUND(OUT) TOMANUFACTURER'S DETAIL
MEDIUM BURIED RUBBER WATERSTOP TOMANUFACTURER'S DETAIL
EXTERNAL ADHESIVE WATERSTOP TOMANUFACTURER'S DETAIL
POLYSTYRENE BOARD(OUT) TOMANUFACTURER'S DETAIL
ONE LAYER OF WATERPROOFING MEMBRANE, ONE LAYER OF WATERPROOF COATING: APPLY PROTECTIVE LAYER ON THE EXTERIOR SIDE OF THE WATERPROOFING. DETAILS TO BE DEVELOPED BY SPECIALIST MANUFACTURER.
CEMENTITIOUS WATERPROOFING: APPLY PROTECTIVE LAYER ON THE EXTERIOR SIDE OF CEMENTITIOUS COATING. REFER TO MANUFACTURER'S DETAILS.

40,000L FUEL TANK WATERPROOFING FOR BOTTOM PLATE DEFORMATION DETAILS
Scale 1:50

NOTE : THIS PRINT IS OF A CONFIDENTIAL NATURE, IT SHALL NOT BE TRACED,PHOTOGRAPHED,PHOTOSTATED OR REPRODUCED IN ANY MANER,NOR USED FOR ANY PURPOSE WHATSOEVER EXCEPT BY WRITTEN PERMISSION

CLIENT :
GULF EDGE DC 01
87 Wireless Road, M Thai Tower 11th. Floor, All Seasons Place, Lumpini,
Pathumwan, Bangkok 10330, Thailand

CONTRACTOR :
华西发展(泰国)有限公司
บริษัท หัวซีอ ดีเวลลอปเม้นต์ (ประเทศไทย) จำกัด
HUASHI DEVELOPMENT CO.,LTD
No. 202, Room No. 1403, 14/F, Le Concorde Building,
Ratchadapisek Road, Huaykhwang Sub-District,
Huaykhwang District, Bangkok Metropolitan 10310.

CONSULTANT :
ARbay
บริษัท เอ อาร์ เบย์ จำกัด
ARbay Company Limited
31 st Floor Bangkok Insurance Building
25 South Sathorn road Thungmahamek
Sathorn Bangkok 10120 THAILAND
T +66 (0) 2286 8199
F +66 (0) 2286 2863
info@arbay.co.th

CONSULTANT :
Qbic Engineers & Architects Co.,Ltd.
8 Soi KALONG 4 SANAMBINNAM ROAD,
THASAI SUB-DISTRICT, MUANG NONTHABURI DISTRICT
, NONTHABURI.
Tel 662-950-4374
Fax 662-580-3231
E-Mail : qbic@qbic.co.th, www.qbic.co.th
QBIC ENGINEERS AND ARCHITECTS CO.,LTD.

CONSULTANT :
MITR
MITR TECHNICAL CONSULTANT CO.,LTD.
1168/8 12th FLOOR, LUMPINI TOWER BUILDING,
RAMA IV RD., THUNGMAHAMEK, SATHORN, BANGKOK 10120, THAILAND
TEL : 0-2679-9079-84
FAX : 0-2679-9085 E-mail: mitr_dd@mitr.com

Architect : SIGNATURE
ประกิต พนานุรัตน์ วสถ. 580
ที่อยู่
251/1 ถ.จารุเมือง แขวงรองเมือง เขตปทุมวัน
กรุงเทพมหานคร โทรศัพท์ 02-286-8199

Structural Engineer : SIGNATURE
วิศวกรผู้ออกแบบโครงสร้าง
ณัฐสม สงวนวงษ์ วย 1423
ที่อยู่
2/1 ซ.รามคำแหง 150 ถ.รามคำแหง
แขวง สะพานสูง เขต สะพานสูง กทม. 10240

Structural Inspector : SIGNATURE
วิศวกรผู้ตรวจสอบโครงสร้าง
โกมล จุฑาภัทร วย 964
ที่อยู่
24/18 ซ.นวมินทร์ 129 ถ. นวมินทร์
แขวง นวลจันทร์ เขต บึงกุ่ม กทม. 10230

Electrical Engineer : SIGNATURE
วิศวกรผู้ออกแบบระบบไฟฟ้ากำลัง
นายสุภัทร บูรณวิทย์ วฟก.1265
ที่อยู่
21 ซอยทานสัมฤทธิ์ 13
ตำบลท่าทราย อ.เมืองนนทบุรี จ.นนทบุรี 11000

Mechanical Engineer : SIGNATURE
วิศวกรผู้ออกแบบระบบเครื่องกลและปรับอากาศ
นายประสิทธิ์ เกียวสุนทร วก.1221
ที่อยู่
44/372 ซอยบางกระดี่ 35/1 แขวงแสมดำ
เขตบางขุนเทียน กทม. 10150
ประสิทธิ์

Sanitary Engineer : SIGNATURE
วิศวกรผู้ออกแบบระบบสุขาภิบาล และดับเพลิง
นายทศวรรษ สนันฤทธิ์ วส. 215
ที่อยู่
บ้านเลขที่ 99/107 หมู่ที่ 3 ต.ศีรษะจรเข้น้อย
อ.บางเสาธง จ.สมุทรปราการ 10540
ทศวรรษ

ISSUE/REVISION

REV.	DESCRIPTION	DATE
A	90% DEVELOPED	09/05/2026

PROJECT NAME :
GEDC 01
LOCATION:
Nikhom Phattana district, Rayong ,industrial estate,CPGC

BUILDING :
FUEL TANK

90% DEVELOPED

TITLE :
UNDERGROUND FUEL TANK
PLAN&SECTION

JOB NO.	SCALE 1:150
DRAWN HJC	REF.
CHECKED LJC	DWG.NO. MPK00-60-F-GN-006
APPROVED LXD	
DATE 2026.05.09	