

MECHANICAL ABBREVIATIONS

AAV	AUTOMATIC AIR VENT
ABS	ABSOLUTE
ABV	ABOVE
AC	ALTERNATING CURRENT
AFF	ABOVE FINISH FLOOR
AHJ	AUTHORITY HAVING JURISDICTION
ALT	ALTERNATE OR ALTITUDE
ALUM	ALUMINUM
AMP	AMPERE
ANSI	AMERICAN NATIONAL STANDARDS INSTITUTE
APD	AIR PRESSURE DROP
APPROX	APPROXIMATELY
ASHRAE	AMERICAN SOCIETY OF HEATING, REFRIGERANT AND AIR CONDITIONING
ASME	AMERICAN SOCIETY OF MECHANICAL ENGINEERS
ATC	AUTOMATIC TEMPERATURE CONTROL
ATM	ATMOSPHERE
AUTO	AUTOMATIC
AUX	AUXILIARY
AVG	AVERAGE
AWG	AMERICAN WIRE GAUGE
BAS	BUILDING AUTOMATION SYSTEM
BC	BALANCING COCK
BDO	BACKDRAFT DAMPER
BPV	BUTTERFLY VALVE
BGD	BLAST GATE DAMPER
BHP	BRAKE HORSE POWER
BJ	BALL JOINT
BLW	BELOW
BLOG	BUILDING
BO	BLOW OFF
BTU	BRITISH THERMAL UNIT
BV	BALL VALVE
C	CELSIUS
CAP	CAPACITY
CART	CARTIDGE
CCW	COUNTER CLOCKWISE
CENTR	CENTRIFUGAL
CFH	CUBIC FEET PER HOUR
CFM	CUBIC FEET PER MINUTE
CIRC	CIRCULATING
CHKV	CHECK VALVE
CKT	CIRCUIT
CLG	CEILING
CO	CLEAN OUT
COEFF	COEFFICIENT
COL	COLUMN
CONC	CONCRETE
COND	CONDENSATE
CONN	CONNECTION
CONT	CONTINUATION
CONTR	CONTRACTOR
CU FT	CUBIC FEET
CU IN	CUBIC INCH
CW	COLD WATER
dB	DECIBEL
dBa	DECIBEL A-WEIGHTED
DB	DRY BULB TEMPERATURE
DEG (°)	DEGREE
DENS	DENSITY
DHW	DOMESTIC HOT WATER
DN	DRAWN
DIFF	DIFFUSER
DISCH	DISCHARGE
DN	DOWN
DPR	DAMPER
DPT	DEW POINT TEMPERATURE
DR	DRAIN
DS	DISCONNECT SWITCH
DWG	DRAWING
DX	DIRECT EXPANSION
EA	EACH OR EXHAUST AIR
EAT	ENTERING AIR TEMPERATURE
EC	ELECTRICAL CONTRACTOR
EDB	ENTERING DRY BULB
EER	ENERGY EFFICIENCY RATIO
EFF	EFFICIENCY
EL	ELEVATION
ELECT	ELECTRIC
ENCLOS	ENCLOSURE
ENT	ENTERING
EQUIP	EQUIPMENT
ER	ECCENTRIC REDUCER
ESP	EXTERNAL STATIC PRESSURE
EWB	ENTERING WET BULB
EWT	ENTERING WATER TEMPERATURE
EXH	EXHAUST
EXIST	EXISTING
EXP	EXPANSION
F	FAHRENHEIT
F&T	FLOAT AND THERMOSTATIC
FC	FLEXIBLE CONNECTION OR FORWARD CURVED
FCD	FLOW CONTROL DEVICE
FCV	FLOW CONTROL VALVE
FD	FIRE DAMPER
FLG	FLANGE
FLOOR	FLOOR
FLR	FLOOR
FNL	FUNNEL
FNL DR	FUNNEL DRAIN
FO	FLAT OVAL
FPF	FINN PER FOOT
FPI	FINN PER INCH
FPM	FEET PER MINUTE
FPS	FEET PER SECOND
FR	FROM
FSC	FOOD SERVICE CONTRACTOR
FSD	COMBINATION FIRE-SMOKE DAMPER
FT	FEET
FTG	FITTING
FW	FEED WATER
GA	GAUGE
GAL	GALLONS
GC	GENERAL CONTRACTOR
GI	GALVANIZED IRON
GLV	GLOBE VALVE
GPH	GALLONS PER HOUR
GPM	GALLONS PER MINUTE
GRAV	GRAVITY
GV	GATE VALVE
HDR	HEADER
Hg	MERCURY
HORIZ	HORIZONTAL
HP	HORSE POWER
HPD	HIGH PRESSURE DRIP
HR	HOUR
HTG	HEATING
HZ	HERTZ (FREQUENCY)

MECHANICAL ABBREVIATIONS

IBT	INVERTED BUCKET TRAP
ID	INSIDE DIAMETER
IER	INVERTED ECCENTRIC REDUCER
INSUL	INSULATED
IPV	INTEGRATED PART LOAD VALVE
KEM	KITCHEN EQUIPMENT MANUFACTURER
KW	KILOWATT
KWH	KILOWATT HOUR
LAT	LEAVING AIR TEMPERATURE
LBS	POUNDS
LDB	LEAVING DRY BULB
LF	LINEAR FEET
LH	LATENT HEAT
LQ	LIQUID
LP	LOW PRESSURE
LPD	LOW PRESSURE DRIP
LTG	LIGHTING
LWB	LEAVING WET BULB
LWCO	LOW WATER CUT OFF
MAV	MANUAL AIR VENT
MAX	MAXIMUM
MBH	THOUSAND BTU'S
MC	MECHANICAL CONTRACTOR
MCF	THOUSAND CUBIC FEET
MFG	MANUFACTURER
MH	MANHOLE
MIN	MINIMUM
MPD	MEDIUM PRESSURE DRIP
MTO	MOUNTED
MTL	METAL
MTR	MOTOR
N/A	NOT APPLICABLE
NC	NORMALLY CLOSED OR NOISE CRITERIA
NIC	NOT IN CONTRACT
NPLV	NOMINAL PART LOAD VALVE
NO	NORMALLY OPEN OR NUMBER
NTS	NOT TO SCALE
OA	OUTSIDE AIR
OD	OUTSIDE DIAMETER
OPER	OPERATED
OPENING	OPENING
PC	PLUMBING CONTRACTOR
PD	PRESSURE DROP
PG	PRESSURE GAUGE WITH COCK
PH	PHASE
PPM	PARTS PER MILLION
PRV	PRESSURE REDUCING VALVE
PS	PIPE SUPPORT
PSF	POUNDS PER SQUARE FOOT
PSIA	POUNDS PER SQUARE INCH ABSOLUTE
PSIG	POUNDS PER SQUARE INCH GAUGE
PT	PRESSURE TAP
QTY	QUANTITY
R	THERMAL RESISTANCE
RA	RETURN AIR
RD	ROOF DRAIN
REFRIG	REFRIGERANT
REQD	REQUIRED
RET	RETURN
REV	REVOLUTIONS
RH	RELATIVE HUMIDITY
RPM	REVOLUTIONS PER MINUTE
RPS	REVOLUTIONS PER SECOND
RV	RELIEF VALVE
RWC	RAIN WATER CONDUCTOR
SA	SUPPLY AIR
SAT	SATURATED
SCH	SCHEDULE
SEER	SEASONAL ENERGY EFFICIENCY RATIO
SENS	SENSIBLE
SG	SPECIFIC GRAVITY
SH	SENSIBLE HEAT
SP	STATIC PRESSURE
SPEC	SPECIFICATION
SQ FT	SQUARE FEET
SS	STAINLESS STEEL
STD	STANDARD
STR	STRAINER
SUCT	SUCTION
SUP	SUPPLY
SV	SAFETY VALVE
SW	SWITCH
TAB	TEST, ADJUST AND BALANCE
TCV	TEMPERATURE CONTROL VALVE
TDV	TRIPLE DUTY VALVE
TEMP	TEMPERATURE
TH	THERMOMETER
TNS	TONS OF REFRIGERANT
TOT	TOTAL
TRANS	TRANSITION
TSTAT	THERMOSTAT
TSP	TOTAL STATIC PRESSURE
TT	THERMOSTATIC TRAP
TV	TURNING VANE
TYP	TYPICAL
UG	UNDERGROUND
UON	UNLESS OTHERWISE NOTED
V	VOLT
VAC	VACUUM
VEL	VELOCITY
VFS	VENTURI FLOW STATION
VOL	VOLUME
VTR	VENT THRU ROOF
W	WATT
WB	WET BULB
WG	WATER GAUGE
WP	WEATHERPROOF
WPD	WATER PRESSURE DROP
WPS	WATER PRESSURE SWITCH
WT	WEIGHT
WTD	WATER TEMPERATURE DIFFERENCE
XR	EXISTING TO REMAIN
ZCV	ZONE CONTROL VALVE

MECHANICAL EQUIPMENT ABBREVIATIONS

ACC	AIR COOLED CHILLER
ACCU	AIR COOLED CONDENSING UNIT
ACU	AIR CONDITIONING UNIT (SELF-CONTAINED)
AHU	AIR HANDLING UNIT
AS	AIR SEPARATOR
ASHP	AIR SOURCE HEAT PUMP
B	BOLER
BB	BASE BOARD RADIATION
CC	COOLING COIL
CH	CHILLER
CP	CONDENSATE PUMP
COMP	COMPRESSOR
COND	CONDENSER
CONV	CONVECTOR
CRAC	COMPUTER ROOM AIR-CONDITIONING UNIT
CT	COOLING TOWER
CUH	CABINET UNIT HEATER
DOAS	DEDICATED OUTDOOR AIR SYSTEM
EF	EXHAUST FAN
ERU	ENERGY RECOVERY UNIT
ERV	ENERGY RECOVER VENTILATOR
ET	EXPANSION TANK
EVAP	EVAPORATOR
EWI	ELECTRIC WALL HEATER
FCU	FAN COIL UNIT
FPB	FAN POWERED BOX
FT	FINNED TUBE RADIATION
GRV	GRAVITY ROOF VENTILATOR
HC	HEATING COIL
HU	HUMIDIFIER
HUH	HORIZONTAL UNIT HEATER
IDF	INDUCED DRAFT FAN
MAU	MAKE-UP AIR UNIT
P	PUMP
PTAC	PACKAGED TERMINAL AIR CONDITIONING UNIT
PTHP	PACKAGED TERMINAL HEAT PUMP
RF	RETURN FAN
RP	RADIANT PANEL
RTAHU	ROOF TOP AIR HANDLING UNIT
RHC	REHEAT COIL
RTU	ROOF TOP UNIT
SA	SOUND ATTENUATOR
SEF	SMOKE EXHAUST FAN
SF	SUPPLY FAN
SSI	SPLIT SYSTEM (INDOOR UNIT)
SSO	SPLIT SYSTEM (OUTDOOR UNIT)
UH	UNIT HEATER
UV	UNIT VENTILATOR
VFD	VARIABLE FREQUENCY DRIVE
VVB	VARIABLE AIR VOLUME BOX
WSHP	WATER SOURCE HEAT PUMP

MECHANICAL PIPING ABBREVIATIONS

— BBD —	BOILER BLOW DOWN
— BFW —	BOILER FEED WATER
— CHWR —	CHILLED WATER RETURN
— CHWS —	CHILLED WATER SUPPLY
— CA —	COMPRESSED AIR
— COL —	CONDENSATE DRAIN LINE
— CWFT —	CONDENSER WATER FROM TOWER
— CWTI —	CONDENSER WATER TO TOWER
— HIC R —	DUAL TEMPERATURE RETURN
— HIC S —	DUAL TEMPERATURE SUPPLY
— FOF —	FUEL OIL FILL
— FOR —	FUEL OIL RETURN
— FOS —	FUEL OIL SUPPLY
— FOV —	FUEL OIL VENT
— G —	GAS (NATURAL)
— GWR —	GLYCOL WATER RETURN
— GWS —	GLYCOL WATER SUPPLY
— HPR —	HIGH PRESSURE RETURN
— HPS —	HIGH PRESSURE STEAM
— HWR —	HOT WATER RETURN (HEATING)
— HWS —	HOT WATER SUPPLY (HEATING)
— LPR —	LOW PRESSURE RETURN
— LPS —	LOW PRESSURE STEAM
— MU —	MAKE-UP WATER
— MPR —	MEDIUM PRESSURE RETURN
— MPS —	MEDIUM PRESSURE STEAM
— PD —	PUMP DISCHARGE (CONDENSATE)
— RHG —	REFRIGERANT HOT GAS DISCHARGE
— RL —	REFRIGERANT LIQUID
— RS —	REFRIGERANT SUCTION
— VAC —	VACUUM
— V —	VENT

MECHANICAL PIPING SYMBOLS

	FLANGE
	UNION, SCREWED
	CAPPED PIPE
	PIPE ELBOW UP
	PIPE ELBOW DOWN
	PIPE TEE UP
	PIPE TEE DOWN
	DIRECTION OF PIPE SLOPE DOWN
	DIRECTION OF FLOW
	CONCENTRIC REDUCER
	ECCENTRIC REDUCER
	INVERTED ECCENTRIC REDUCER
	ISOLATION VALVE
	PLUG VALVE
	BALANCING COCK
	BALANCING VALVE
	CIRCUIT SETTER VALVE
	MIXING VALVE
	CHECK VALVE
	TRIPLE DUTY VALVE
	ISOLATION VALVE IN RISER
	TWO-WAY VALVE WITH ELECTRONIC ACTUATOR
	THREE-WAY VALVE WITH ELECTRONIC ACTUATOR
	STRAINER
	STRAINER WITH BLOW OFF
	AUTOMATIC AIR VENT
	MANUAL AIR VENT
	AQUASTAT
	CLEAN OUT
	PRESSURE GAUGE WITH SHUT OFF COCK
	THERMOMETER WITH SEPARABLE WELL
	THERMOMETER / INSTRUMENT WELL
	PRESSURE / TEMPERATURE PORT
	SAFETY OR RELIEF VALVE
	VENTURI TYPE FLOW METER
	MULE FLOW METER
	BTU METER
	DIFFERENTIAL PRESSURE SENSOR
	PRESSURE REDUCING VALVE
	FLOW INDICATOR
	WATER FLOW SWITCH
	FUNNEL DRAIN
	THERMOSTATIC TRAP
	INVERTED BUCKET TRAP
	FLOAT & THERMOSTATIC TRAP
	VACUUM BREAKER
	MAIN DRIP
	PIPE GUIDE
	PIPE ANCHOR
	EXPANSION JOINT
	FLEXIBLE CONNECTION / VIBRATION ISOLATION

MECHANICAL ELECTRICAL SYMBOLS

	DUCT MOUNTED SMOKE DETECTOR
	TOGGLE SWITCH
	SWITCH W/ PILOT LIGHT
	EMERGENCY PUSH BUTTON SWITCH
	EMERGENCY BREAK GLASS STATION
	VARIABLE FREQUENCY DRIVE

MECHANICAL SYMBOLS


	THERMOSTAT
	TEMPERATURE SENSOR
	HUMIDISTAT
	HUMIDITY SENSOR
	PRESSURE MONITOR
	CARBON DIOXIDE SENSOR
	CARBON MONOXIDE SENSOR
	NITROGEN DIOXIDE SENSOR
	DIFFERENTIAL PRESSURE SENSOR
	CONNECTION POINT - NEW TO EXISTING
	DISCONNECT POINT - EXTENT OF DEMOLITION
	GRILLE, REGISTER & DIFFUSER TAG
	UNDERCUT
	SUPPLY DIFFUSER - 4-WAY BLOW
	SUPPLY DIFFUSER - 3-WAY BLOW
	SUPPLY DIFFUSER - 2-WAY BLOW
	SUPPLY DIFFUSER - 1-WAY BLOW
	LINEAR SLOT DIFFUSER
	WALL MOUNTED SUPPLY GRILLE OR REGISTER
	WALL MOUNTED RETURN / EXHAUST GRILLE OR REGISTER
	RETURN GRILLE OR REGISTER
	EXHAUST GRILLE OR REGISTER
	INTERIOR CLEAR DUCTWORK DIMENSIONS: W/H
	SUPPLY DUCT TOWARD VIEWER
	SUPPLY DUCT AWAY FROM VIEWER
	RETURN DUCT TOWARD VIEWER
	RETURN DUCT AWAY FROM VIEWER
	EXHAUST DUCT TOWARD VIEWER
	EXHAUST DUCT AWAY FROM VIEWER
	FLEXIBLE DUCT
	FLEXIBLE CONNECTION
	MANUAL VOLUME DAMPER
	MOTORIZED CONTROL DAMPER
	FIRE DAMPER DYNAMIC, VERTICAL OR HORIZONTAL
	SMOKE DAMPER
	COMBINATION FIRESMOKE DAMPER
	AIRFLOW MONITORING STATION
	TRANSITION: SYMMETRIC
	TRANSITION: ASYMMETRIC
	TRANSITION: RECTANGULAR TO ROUND
	90 DEG RADIUS ELBOW
	MITERED ELBOW WITH TURNING VANES
	TEE: 45 DEG ENTRY BRANCH
	TEE: CONICAL ROUND BRANCH
	SINGLE DUCT AIR TERMINAL UNIT (CONSTANT OR VARIABLE VOLUME)
	SINGLE DUCT AIR TERMINAL UNIT WITH REHEAT COIL (CONSTANT OR VARIABLE VOLUME)

SHEET	DESCRIPTION
M-0.01	MECHANICAL COVER SHEET
M-2.01A	FIRST FLOOR PLAN - PART A - DUCTWORK
M-2.01B	FIRST FLOOR PLAN - PART B - DUCTWORK
M-2.02A	SECOND FLOOR PLAN - PART A - DUCTWORK
M-2.02B	SECOND FLOOR PLAN - PART B - DUCTWORK
M-2.03A	ROOF PLAN - PART A - DUCTWORK
M-2.03B	ROOF PLAN - PART B - DUCTWORK
M-3.01A	FIRST FLOOR PLAN - PART A - PIPING
M-3.01B	FIRST FLOOR PLAN - PART B - PIPING
M-3.02A	SECOND FLOOR PLAN - PART A - PIPING
M-3.02B	SECOND FLOOR PLAN - PART B - PIPING
M-3.03	OVERALL ROOF PLAN - PIPING
M-5.01	ENLARGED UNIT TYPES A - DUCTWORK
M-5.02	ENLARGED UNIT TYPES B - DUCTWORK
M-5.03	ENLARGED UNIT TYPES C - DUCTWORK

SHEET	DESCRIPTION
M-5.04	ENLARGED UNIT TYPES D - DUCTWORK
M-7.01	SCHEDULES
M-7.02	SCHEDULES
M-8.01	DETAILS
M-8.02	DETAILS
M-9.01	VRV DETAILS
M-9.02	VRV DETAILS
M-9.03	VRV DETAILS
M-9.04	VRV DETAILS
M-9.05	VRV DETAILS
M-9.06	VRV DETAILS

THIS SHEET IS PROVIDED FOR EASE OF REFERENCE AND SHALL NOT SUPERSEDE THE REQUIREMENTS OF THE PROJECT'S GENERAL OR SUPPLEMENTAL CONDITIONS OR THE TECHNICAL SPECIFICATIONS. SHOULD ANY CONFLICTS BE FOUND BETWEEN THE NOTES ON THIS SHEET AND OTHER CONTRACT DOCUMENTS, NOTIFY THE ENGINEER IN WRITING PRIOR TO BIDDING OR INSTALLATION.

THIS SHEET HAS BEEN ADAPTED TO BE PROJECT SPECIFIC. HOWEVER, NOT ALL SYMBOLS, ABBREVIATIONS OR GENERAL NOTES MAY APPLY TO THIS PROJECT.

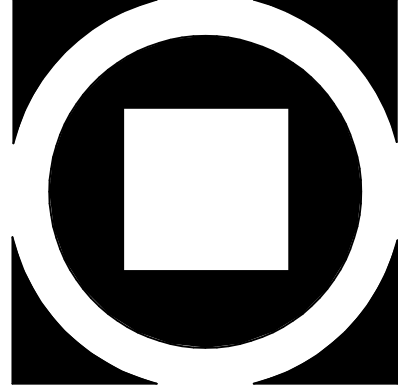

KIMMEL BOGRETTE
Architecture + Site
Blue Bell PA 19322
482 Norristown Rd., Suite 200
Phone 610.834.7805
Copyright 2022 KIMMEL BOGRETTE ARCHITECTURE + SITE, INC. ALL RIGHTS RESERVED.


ENGINEERS, P.C.
232 Howe Street
Jamaison, PA 19002
610.296.1661
Certificate of Authority # 00000208
Expiration: 7-31-2026

SUNRISE
SENIOR LIVING
Sunrise of Northport
1381-1387 Pulaski Road
Huntington, NY 11731
25-013

ISSUE DATE: 04.10.2026
100% CD
DRAWN BY: DOL
CHECKED BY: MAR
SCALE: AS NOTED

MECHANICAL COVER SHEET

M-0.01

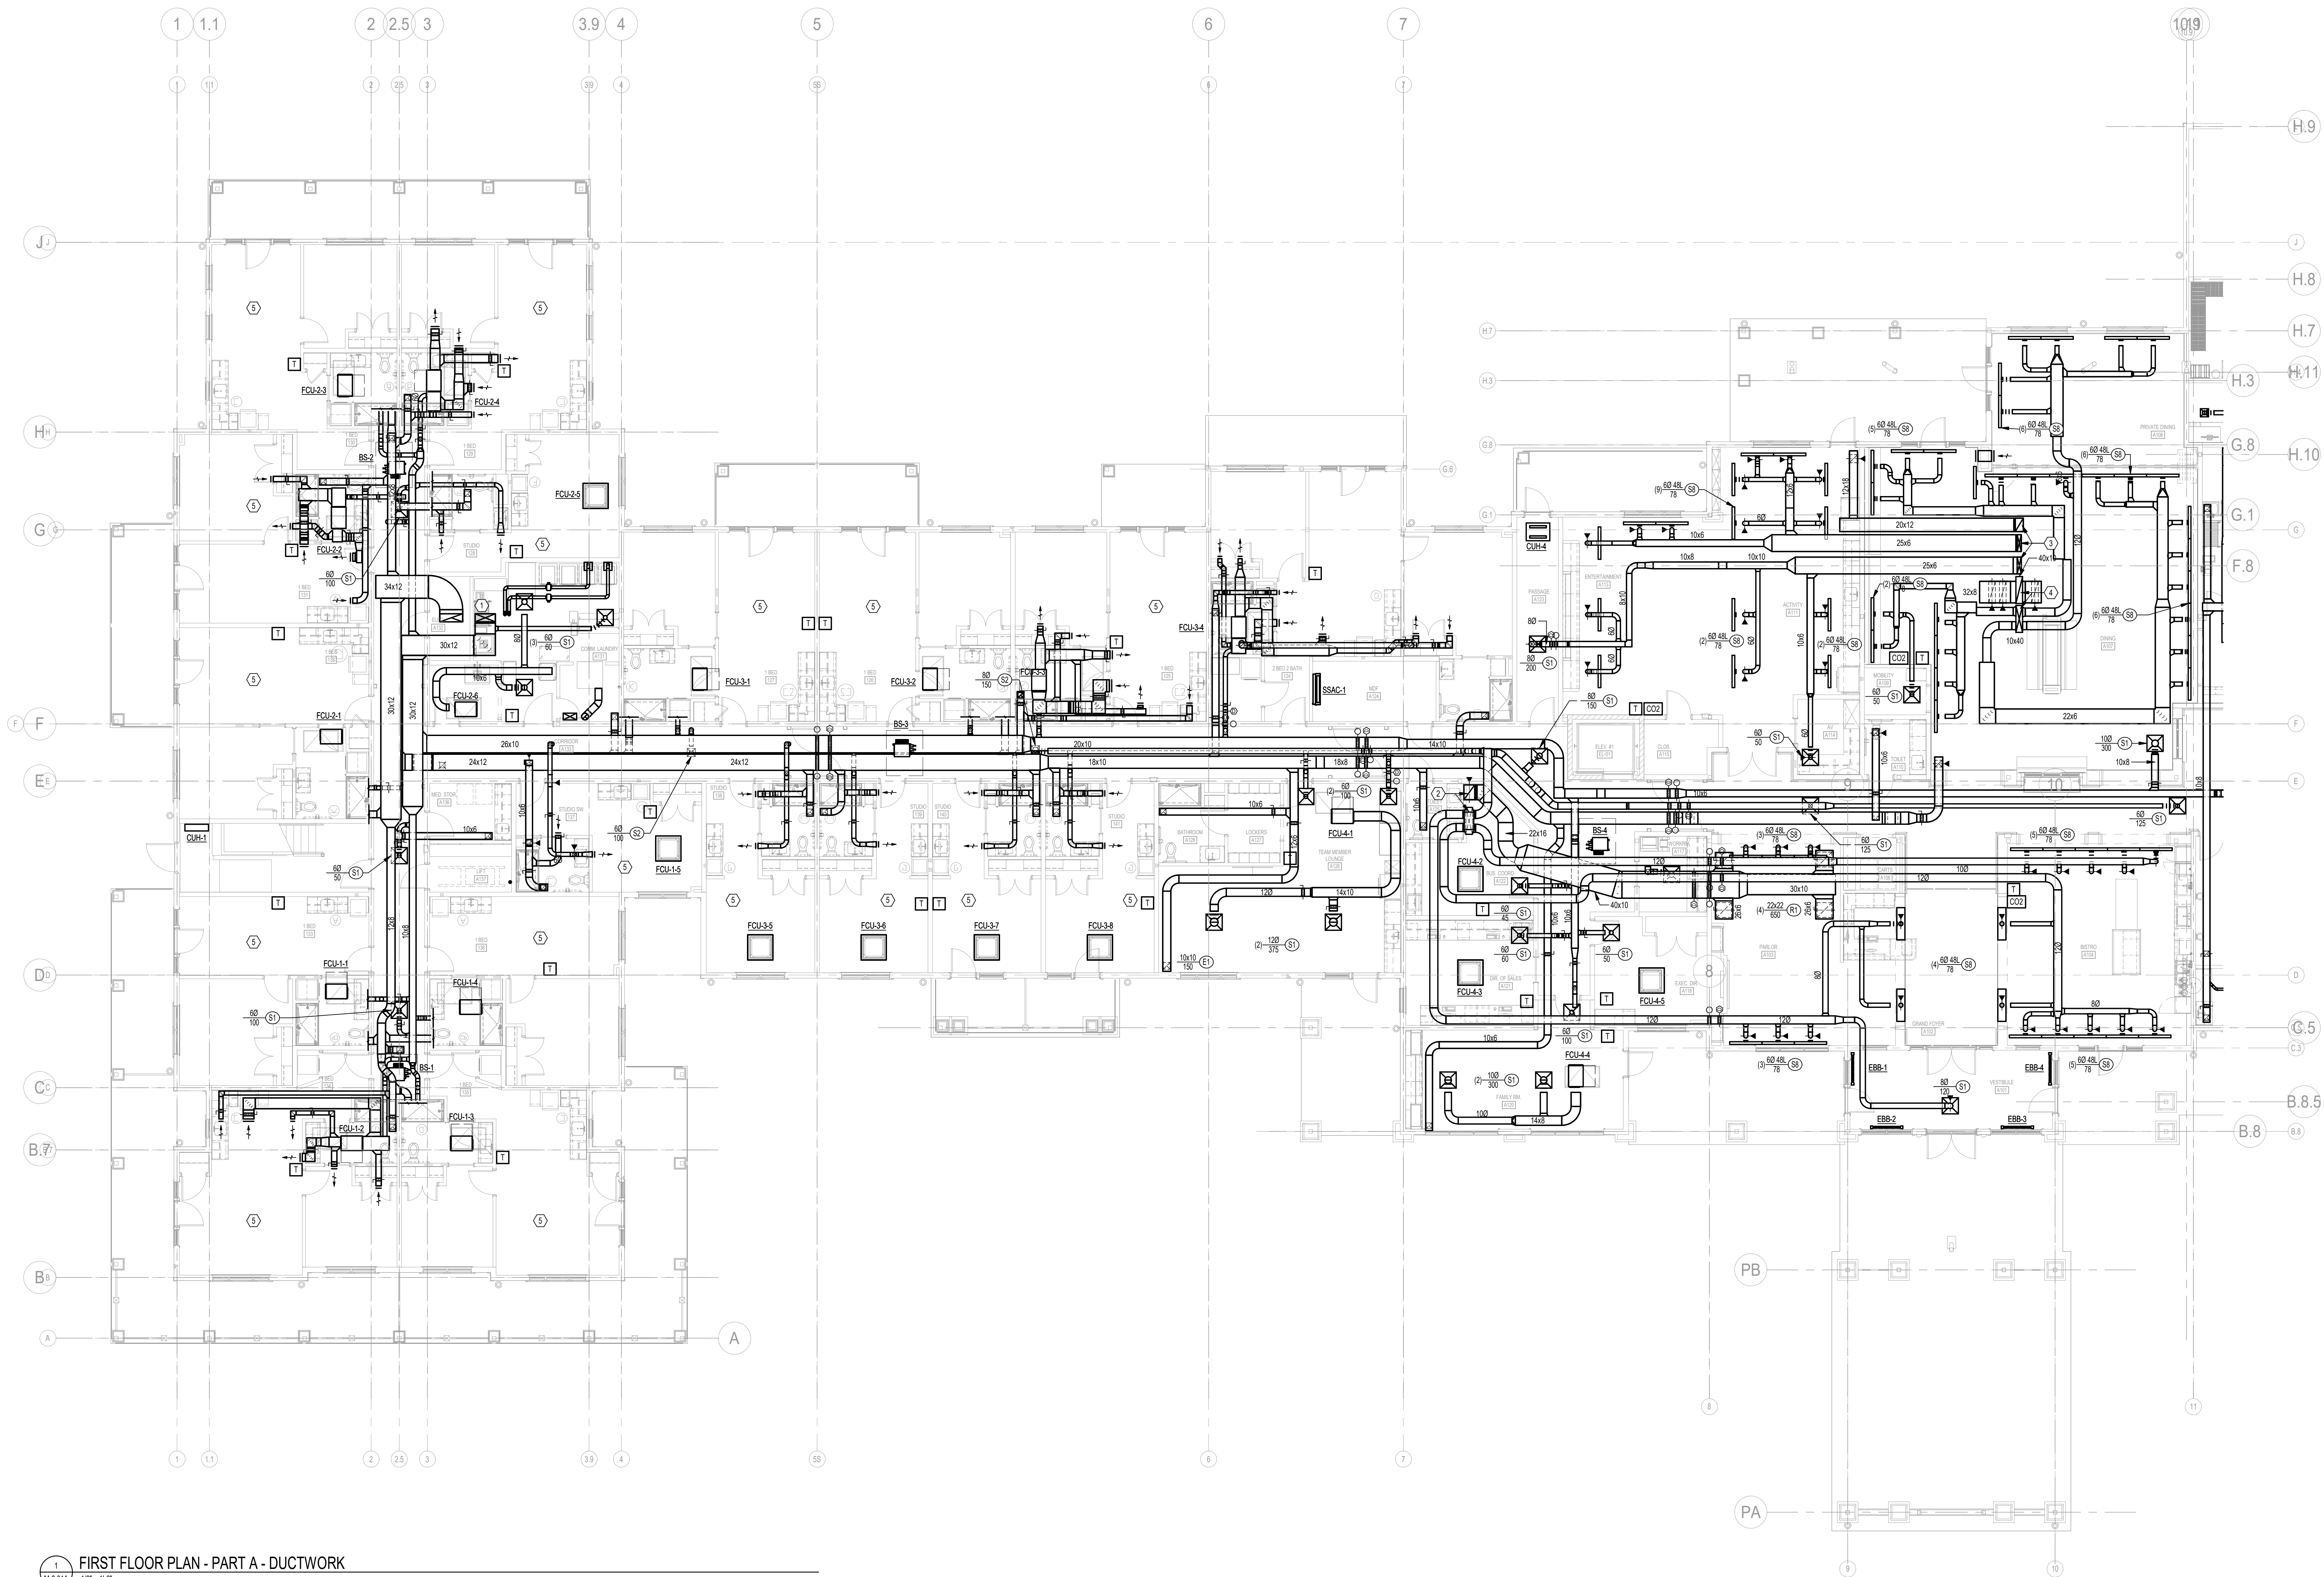

NUMBERED NOTES

- 1 30x12 SA DUCT & 34x12 EA DUCT UP
- 2 26x14 SA DUCT & 22x16 RA DUCT UP
- 3 25x6 SA DUCT & 20x12 RA DUCT UP
- 4 40x10 SA DUCT & 32x8 RA DUCT UP
- 5 REFER TO ENLARGED UNIT PLANS FOR ADDITIONAL WORK IN THIS AREA

1 FIRST FLOOR PLAN - PART A - DUCTWORK
M-2.01A 1/8" = 1'-0"


FIRST FLOOR PLAN - PART A - DUCTWORK

ISSUE DATE:
04.10.2026
100% CD
DRAWN BY: CD
CHECKED BY: MAR
SCALE: AS NOTED


Sunrise of Northport
1381-1387 Pulaski Road
Huntington, NY 11731
25-013




CL ENGINEERS, P.C.
232 Howe Street
Jenkintown, PA 19022
814.296.1661
Certificate of Authority # 0020928
Expiration: 7-31-2026




KIMMEL BOGRETTE
Architecture + Site
482 Norristown Rd., Suite 200
Blue Bell, PA 19322
Phone: 610.634.7865
Fax: 610.634.7815
Copyright 2025 KIMMEL BOGRETTE ARCHITECTURE + SITE, INC. ALL RIGHTS RESERVED

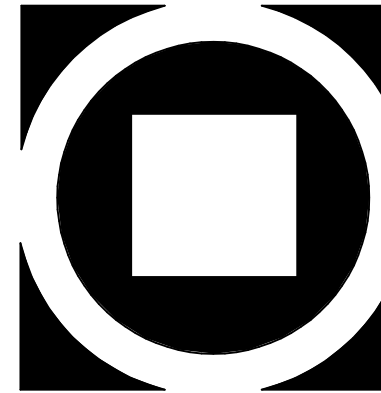

- 1 40x10 SA DUCT & 40x10 RA DUCT UP
- 2 26x14 SA DUCT & 26x14 RA DUCT UP
- 3 24x12 SA DUCT & 25x12 EA DUCT UP
- 4 REFER TO ENLARGED UNIT PLANS FOR ADDITIONAL WORK IN THIS AREA
- 5 16x10 GREASE EXHAUST DUCT DOWN WITH TRANSITION TO ROUND BELOW

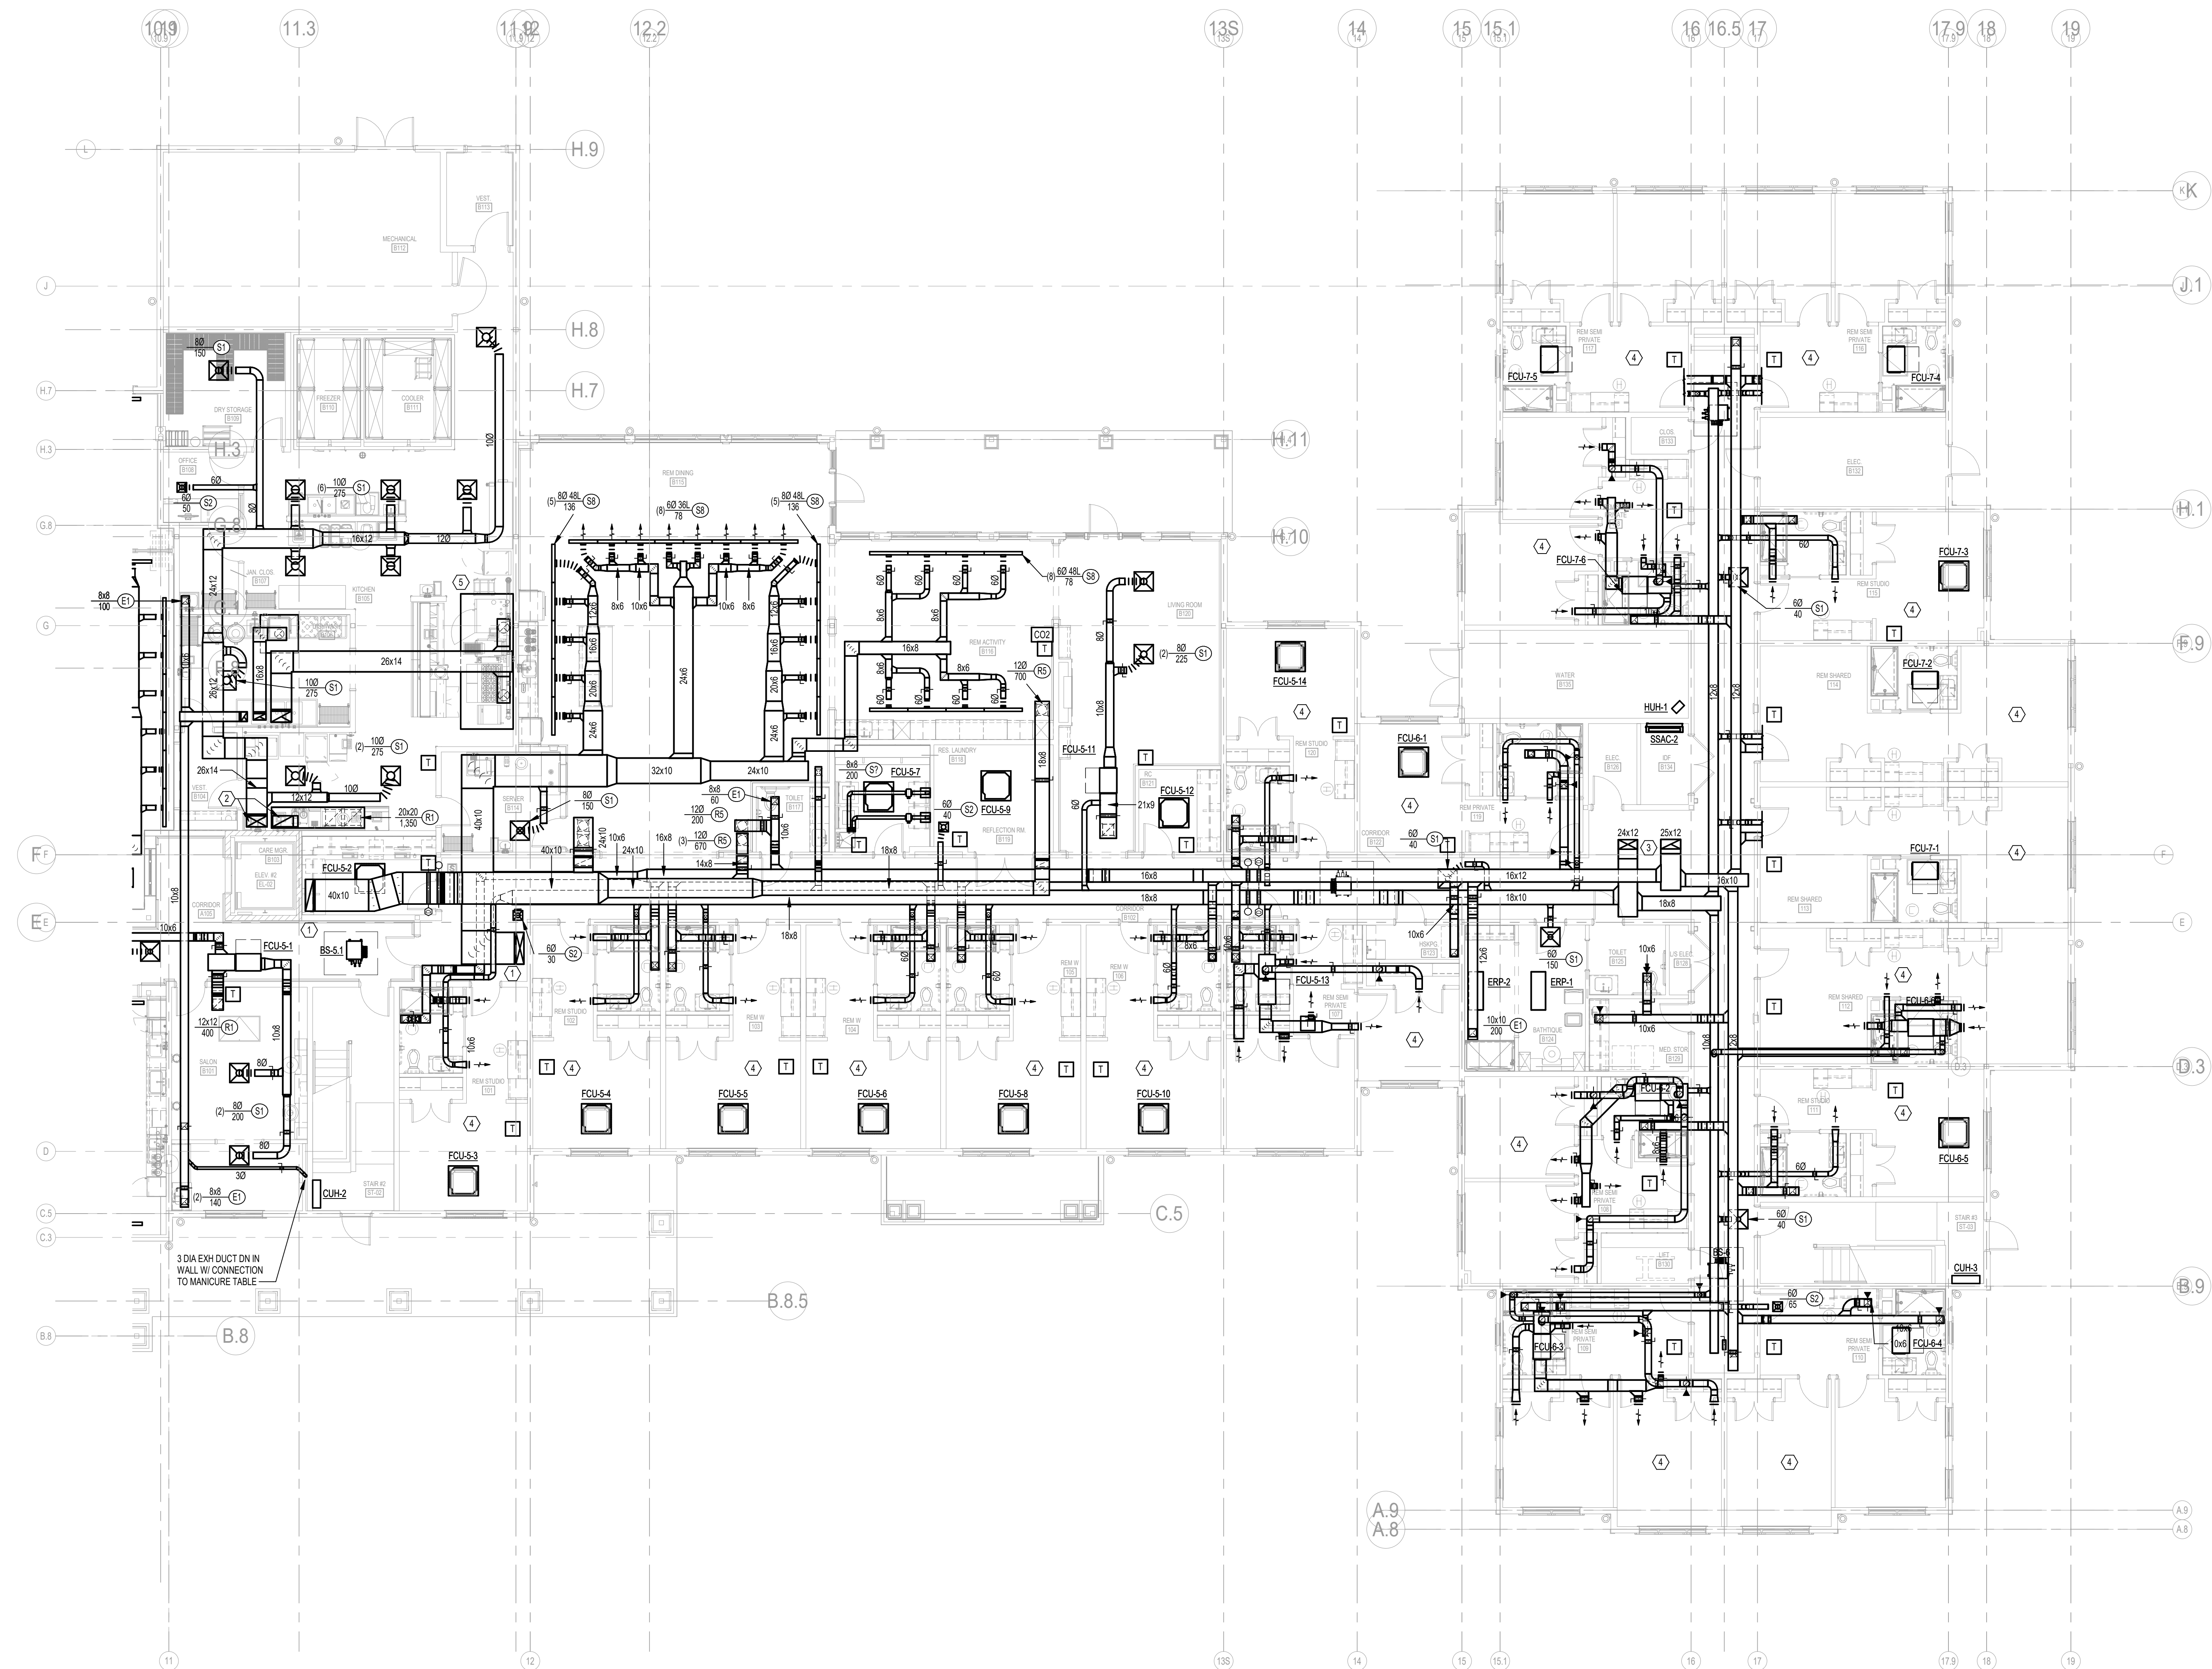


1 FIRST FLOOR PLAN - PART B - DUCTWORK
M-201B 1/8" = 1'-0"

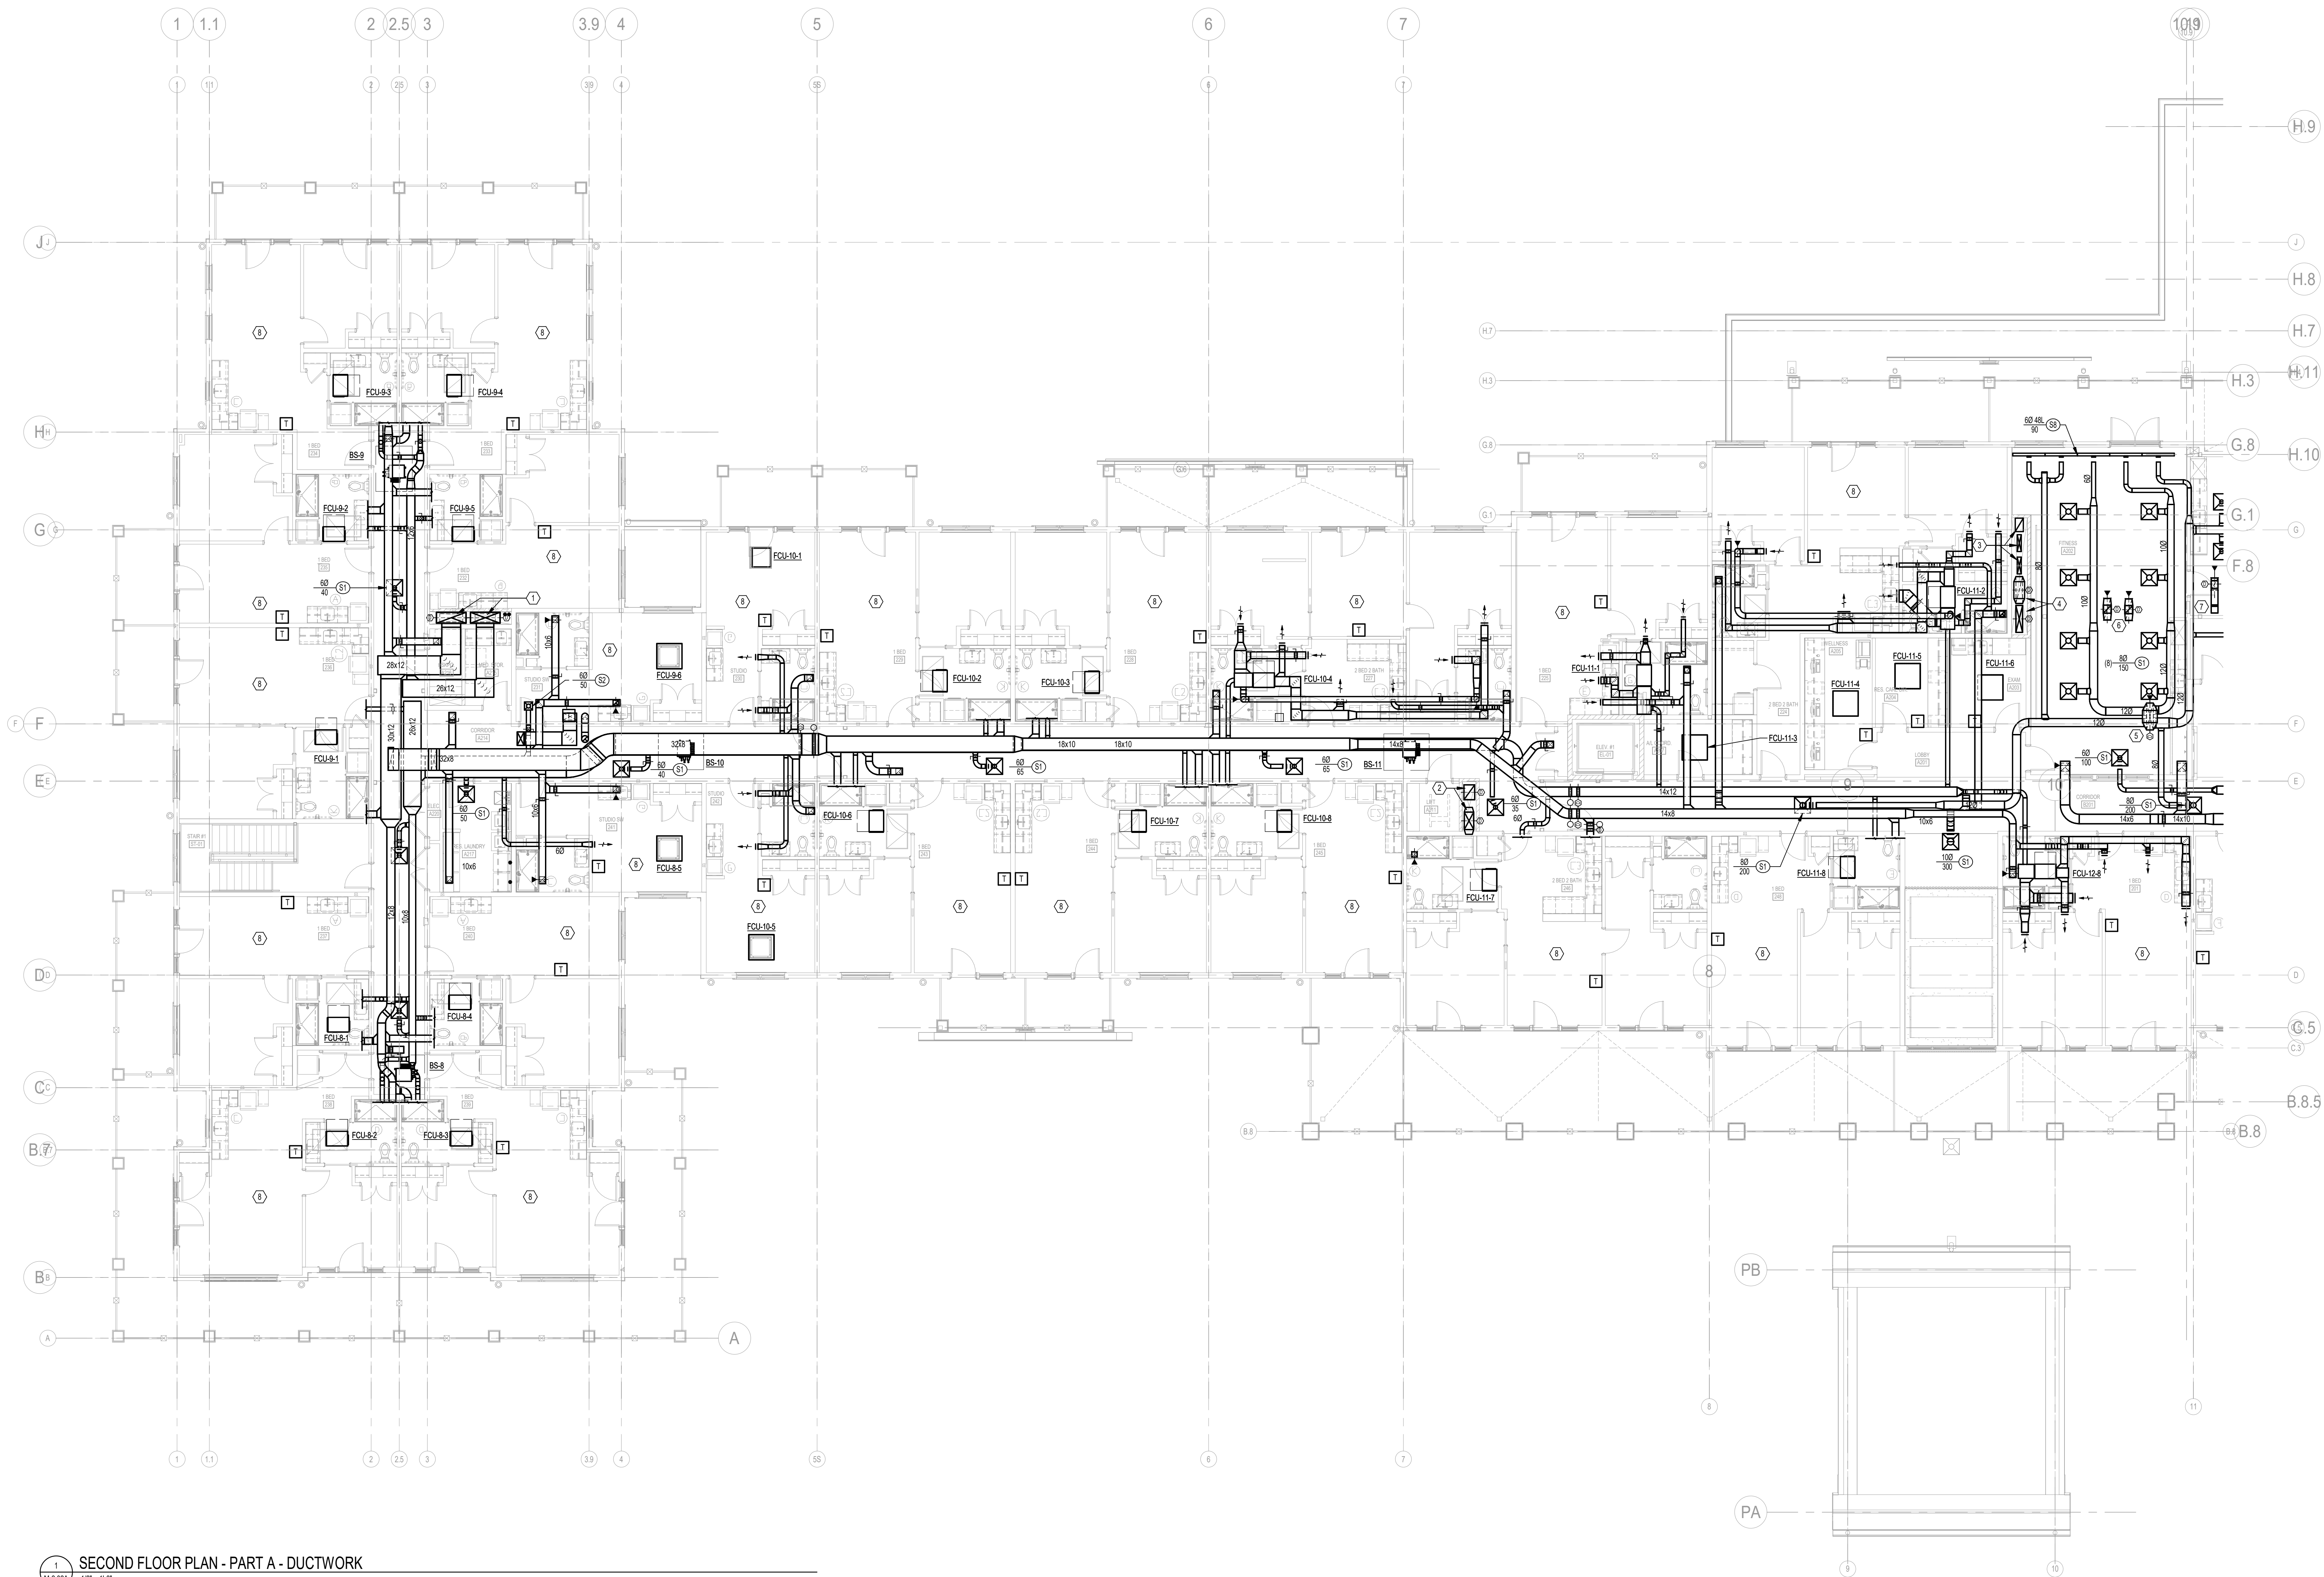

NUMBERED NOTES

- 1 44x16 SA DUCT & 44x16 EA DUCT UP, 30x12 SA DUCT & 34x12 EA DUCT DOWN
- 2 26x14 SA DUCT & 22x16 RA DUCT UP & DOWN
- 3 25x6 SA DUCT & 20x12 RA DUCT UP & DOWN
- 4 40x10 SA DUCT & 25x16 RA DUCT UP
- 5 40x10 SA DUCT UP
- 6 12x12 RA DUCT UP
- 7 10x10 RA DUCT UP
- 8 REFER TO ENLARGED UNIT PLANS FOR ADDITIONAL WORK IN THIS AREA

1 SECOND FLOOR PLAN - PART A - DUCTWORK
M-2.02A 1/8" = 1'-0"

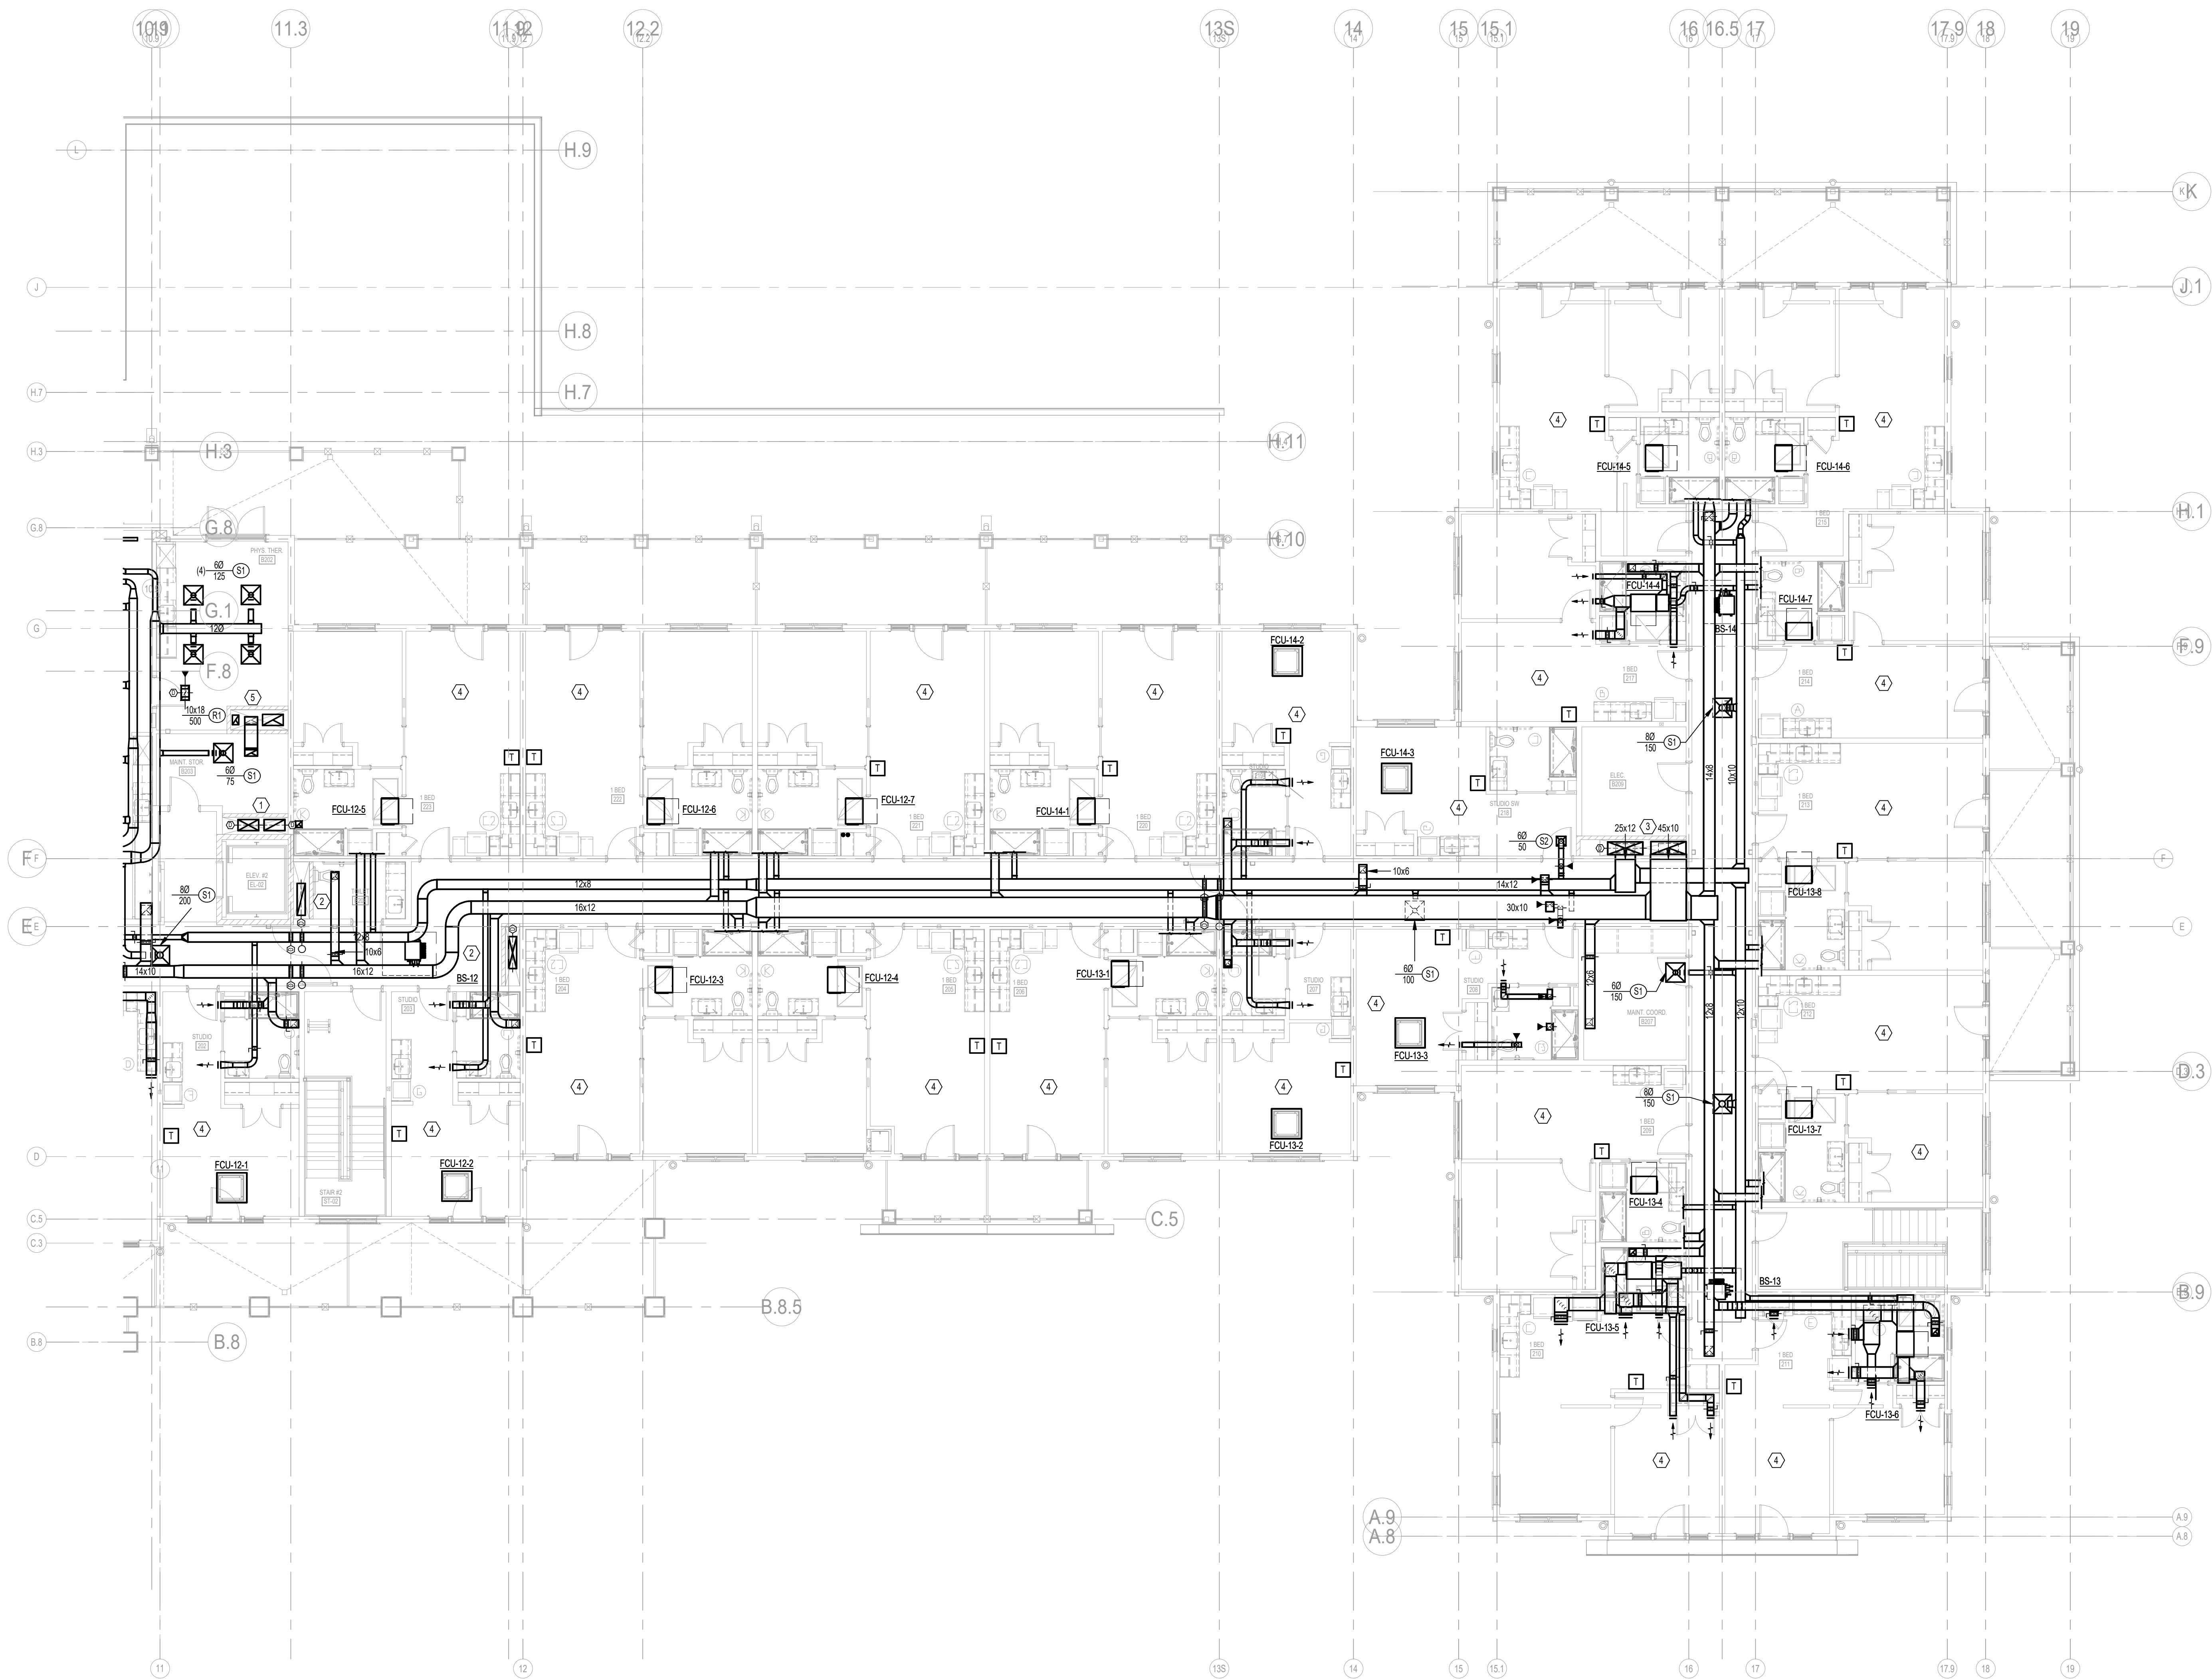


1 SECOND FLOOR PLAN - PART B - DUCTWORK
M-2.02B 1/8" = 1'-0"

NUMBERED NOTES

- 1 26x14 SA DUCT & 26x14 RA DUCT UP & DOWN
 - 2 40x10 SA DUCT & 40x10 RA DUCT UP & DOWN
 - 3 44x16 SA DUCT & 44x16 EA DUCT UP, 24x12 SA DUCT & 25x12 EA DUCT DOWN
 - 4 REFER TO ENLARGED UNIT PLANS FOR ADDITIONAL WORK IN THIS AREA
- KITCHEN EXHAUST DUCTS COMING FROM BELOW TO EXHAUST FANS ON ROOF


4/10/2026 4:14:19 PM

1
M-2.03A
ROOF PLAN - PART A - DUCTWORK
1/8" = 1'-0"

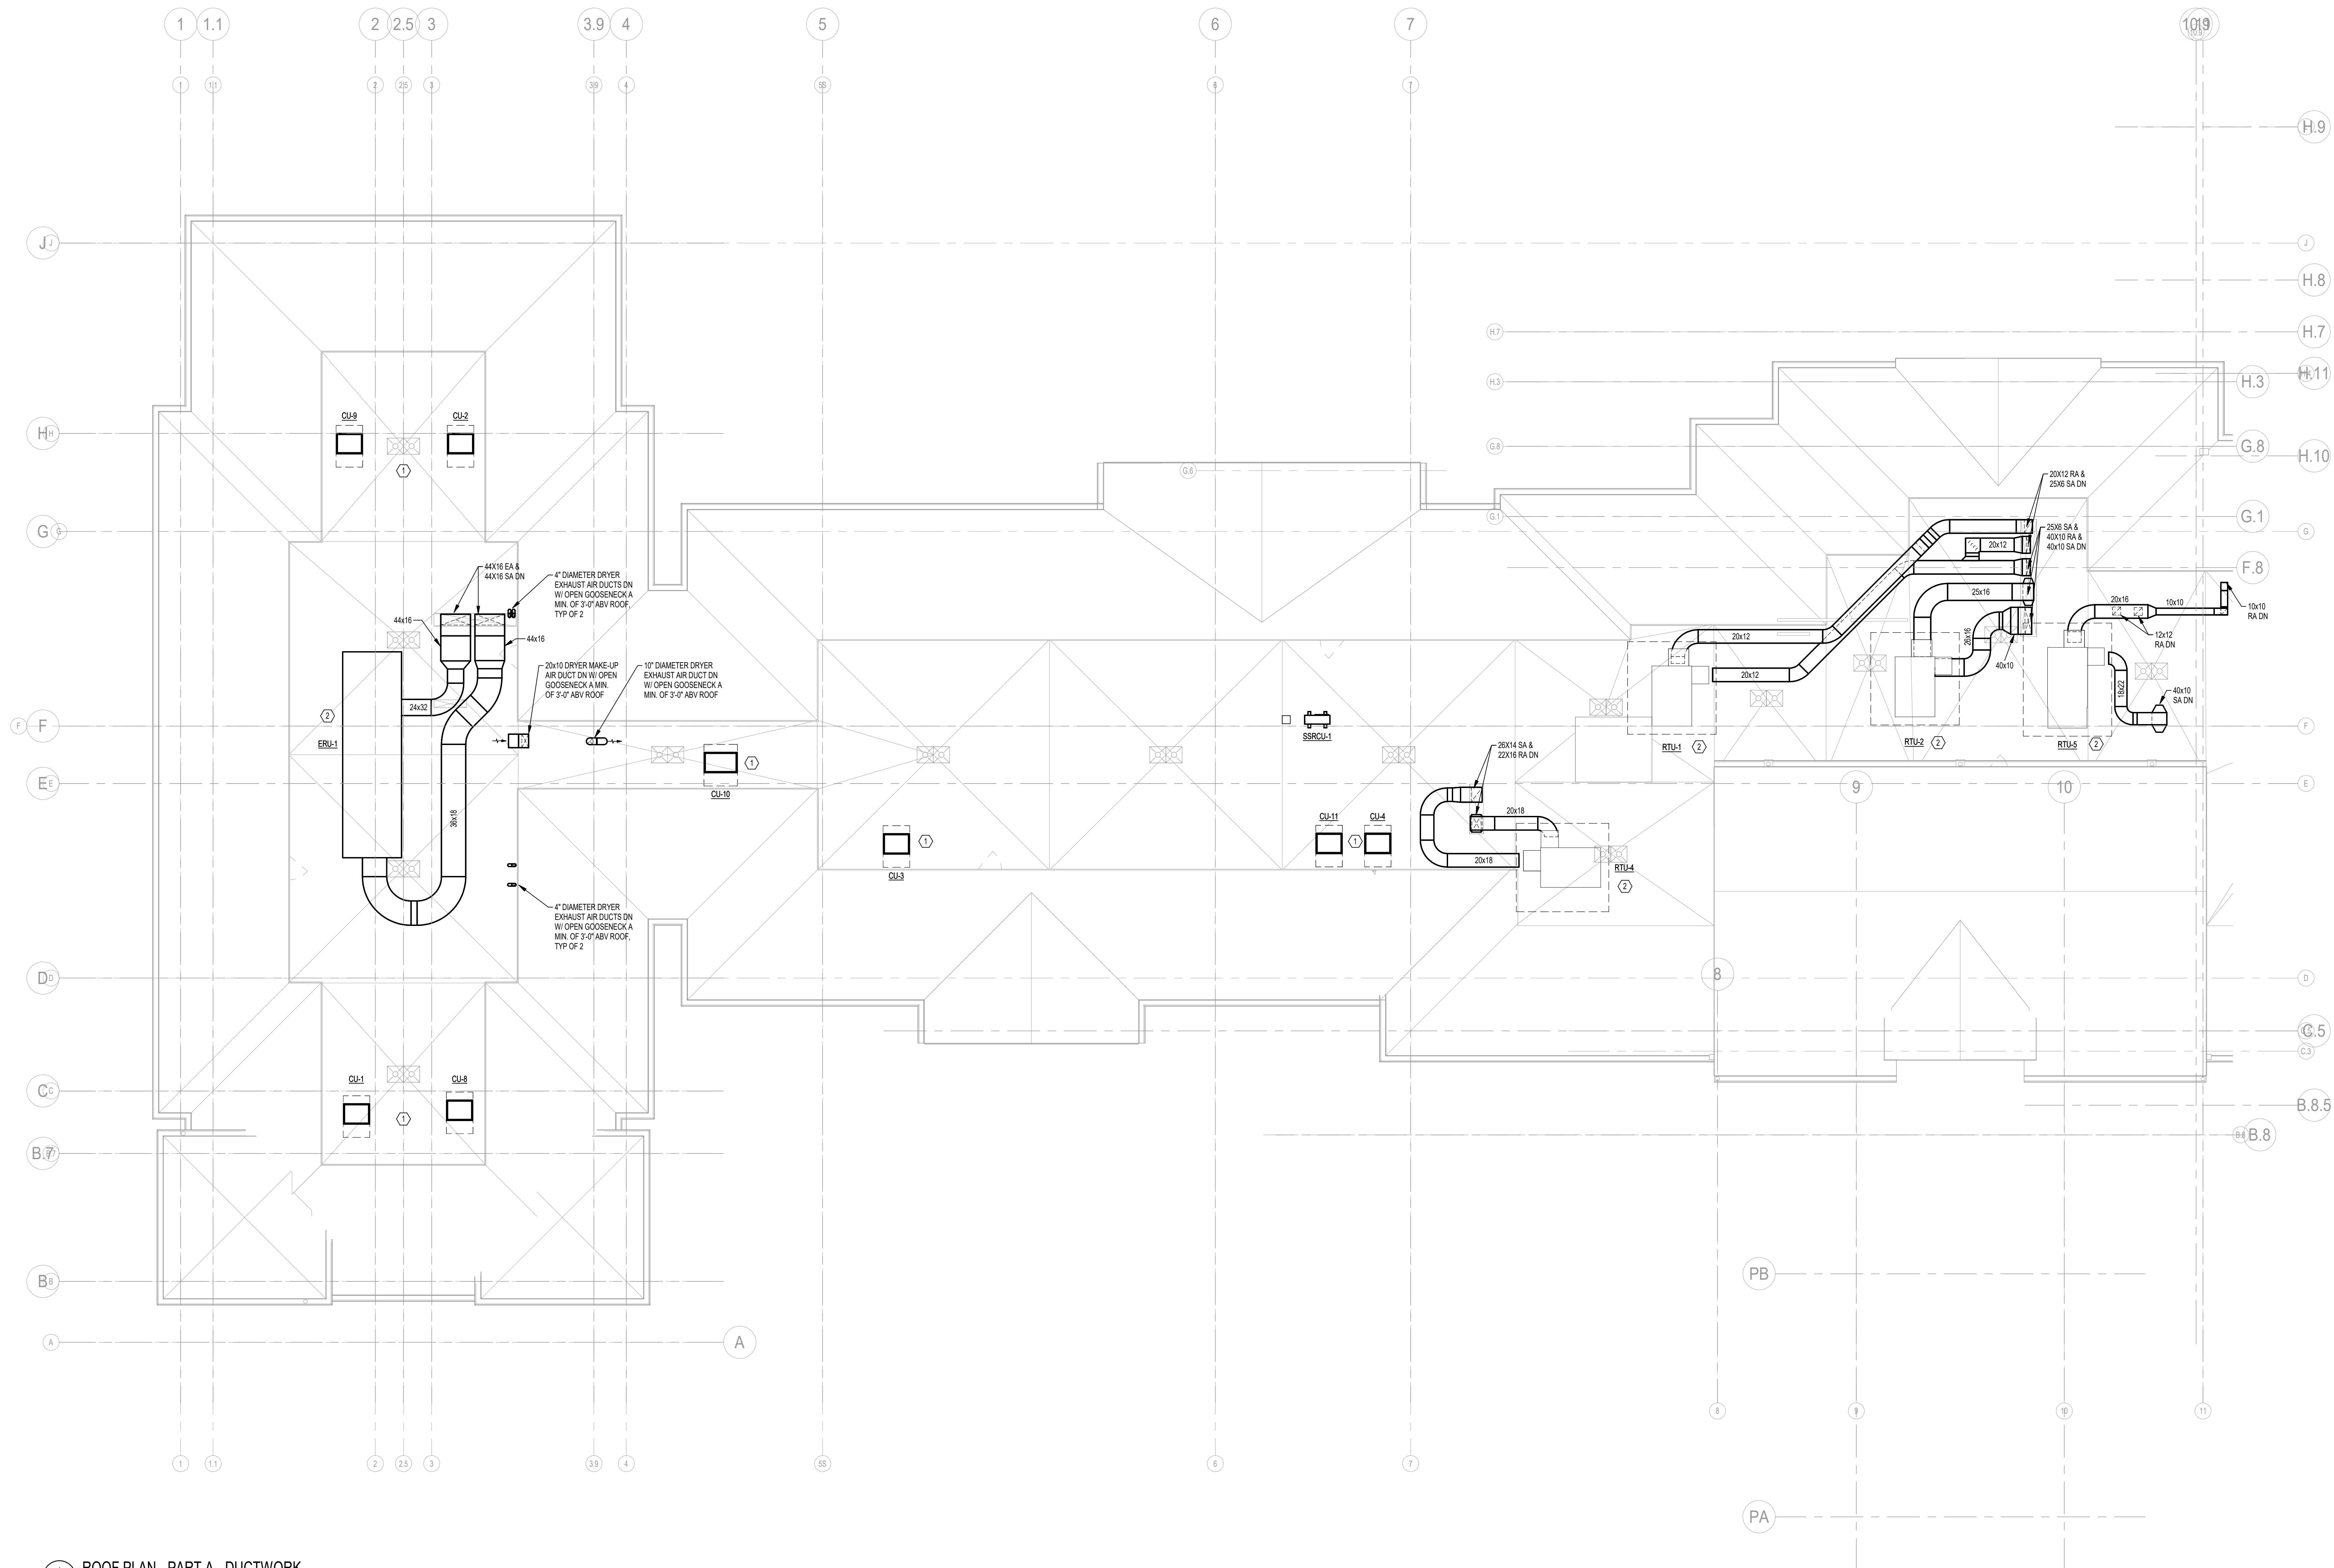

NUMBERED NOTES


- ① INSTALL UNIT ON EQUIPMENT RAILS AND SUPPORT PER MANU. REQUIREMENTS
- ② INSTALL UNIT ON VIBRATION INSULATION ROOF CURB

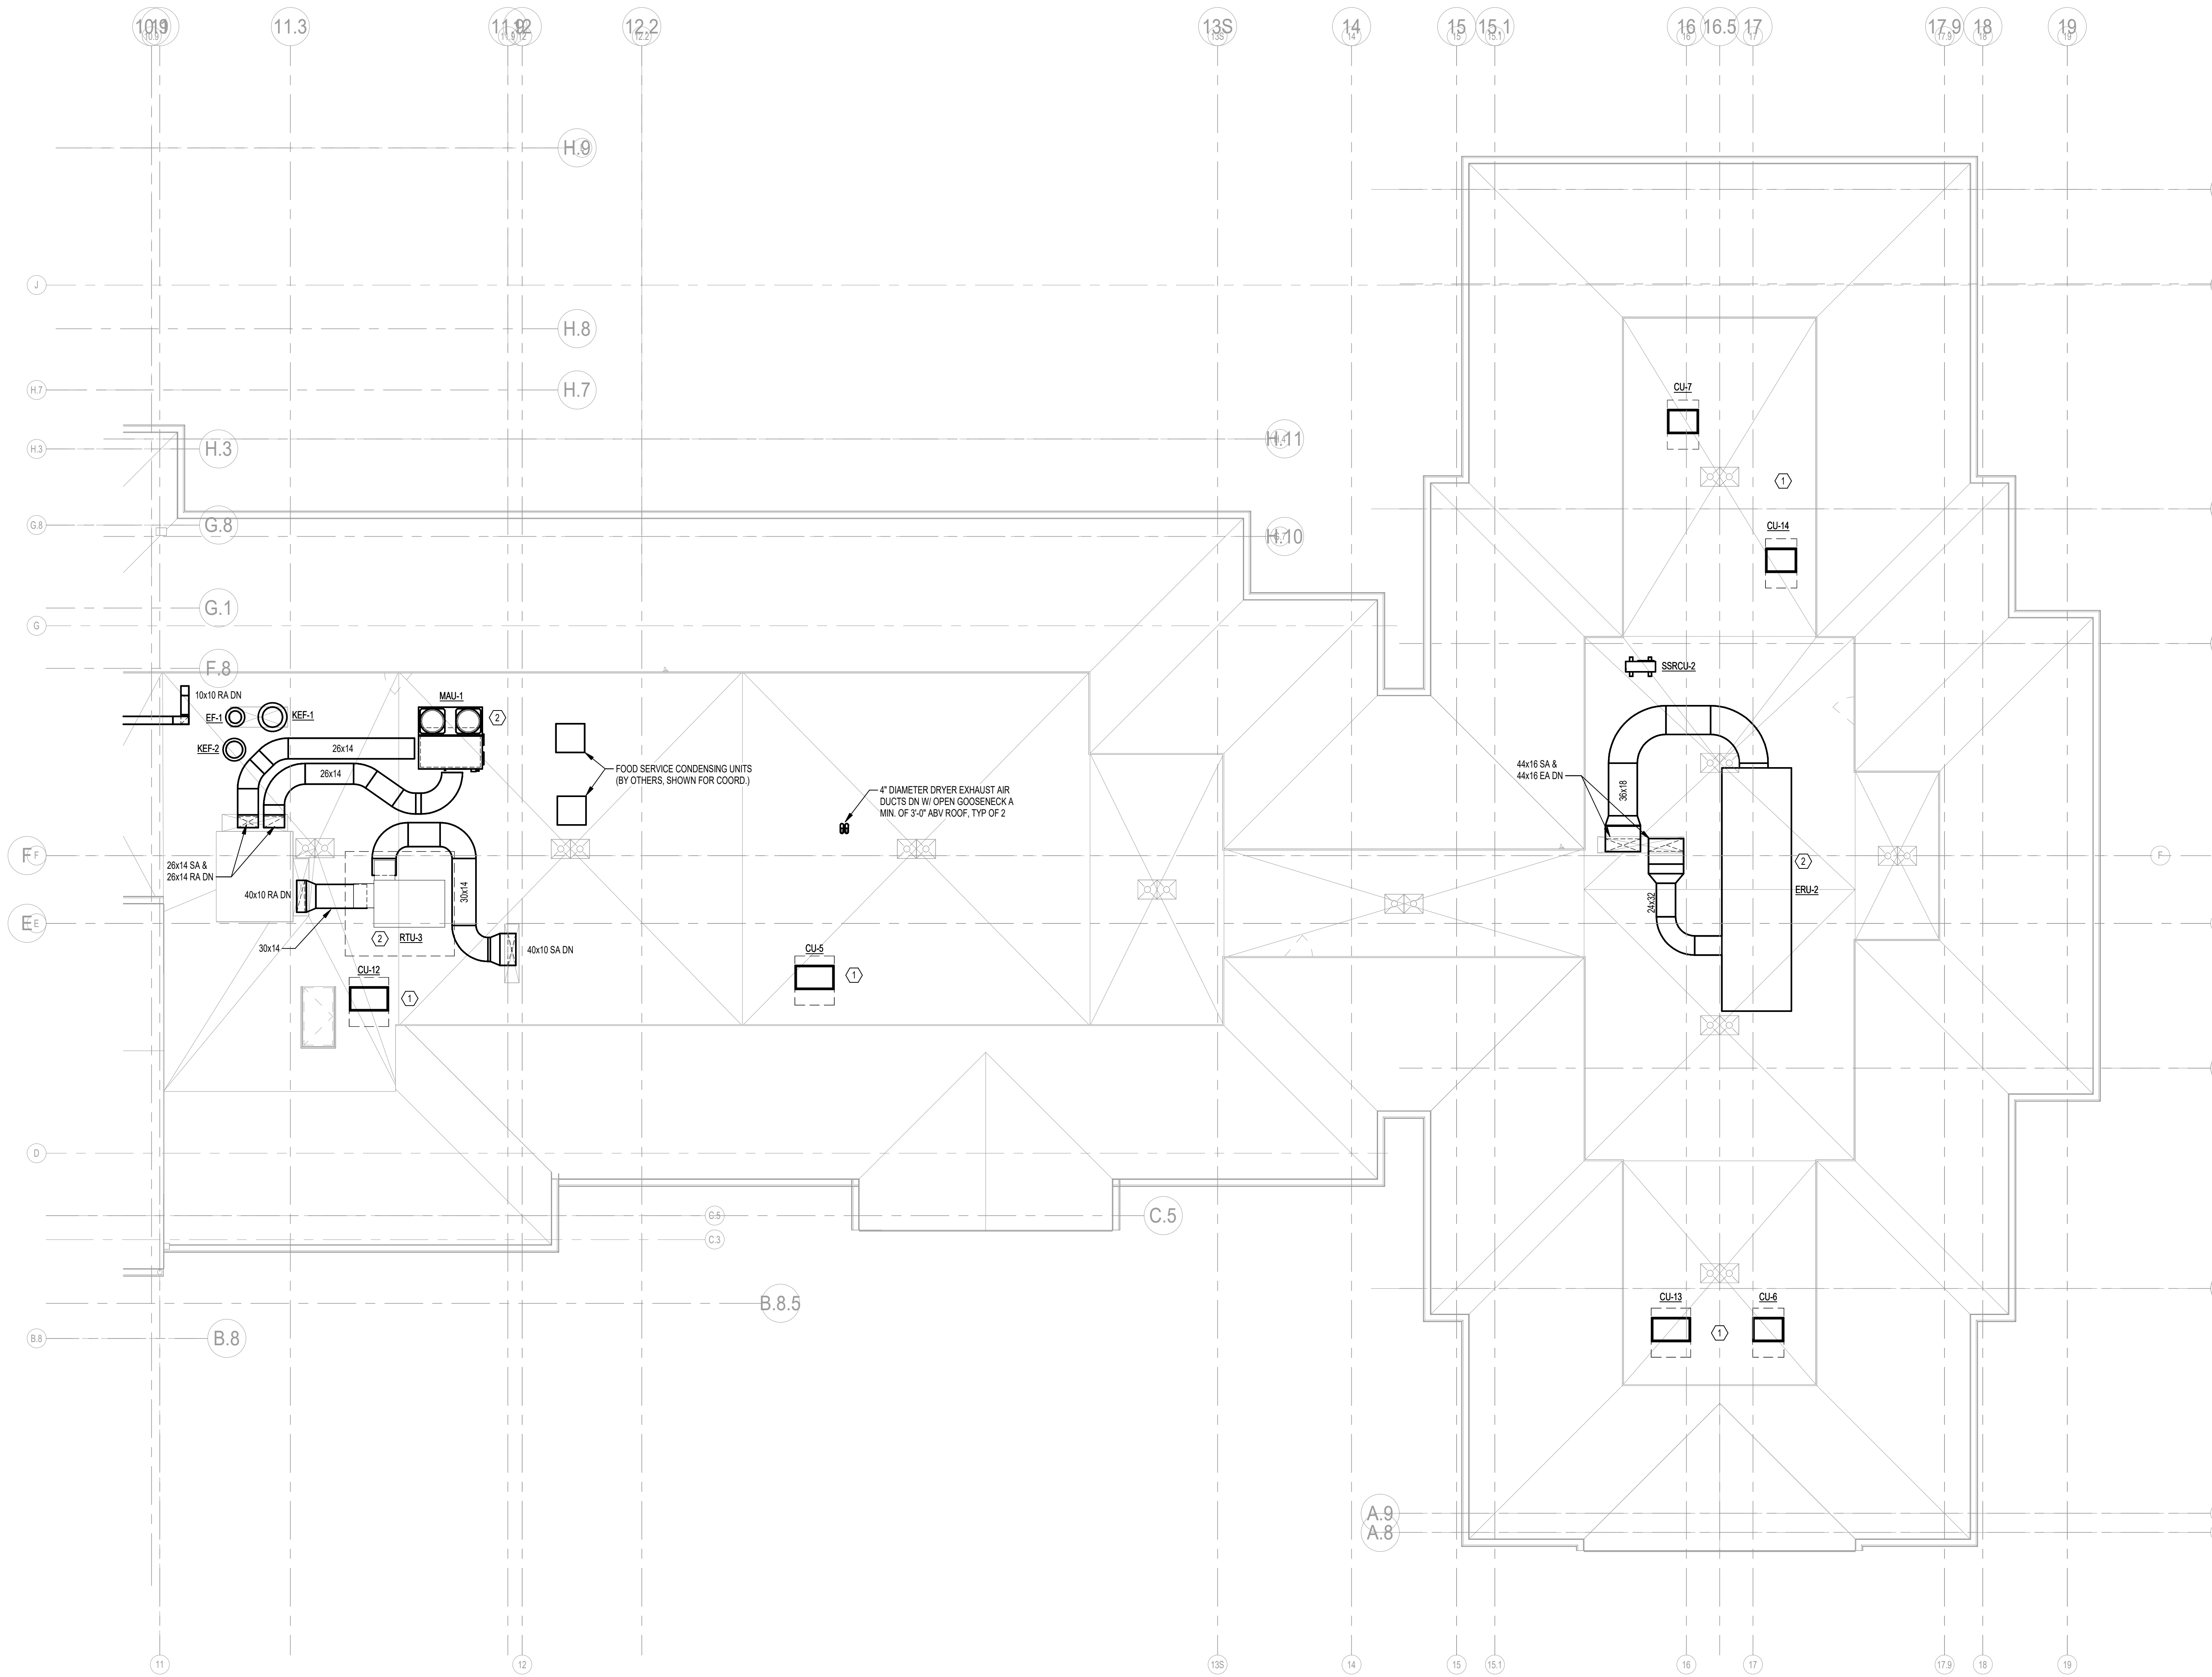

NUMBERED NOTES

- ① INSTALL UNIT ON EQUIPMENT RAILS AND SUPPORT PER MANU. REQUIREMENTS
- ② INSTALL UNIT ON VIBRATION INSULATION ROOF CURB

1 ROOF PLAN - PART B - DUCTWORK
M-2.03B 1/8" = 1'-0"

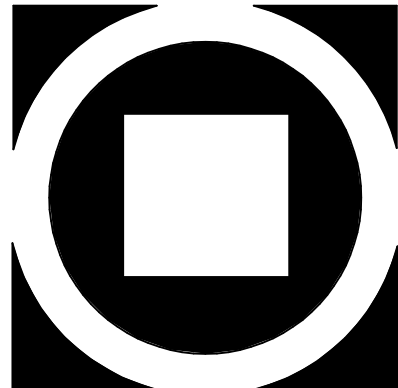

KIMMEL BOGRETTE
Architecture + Site
482 Norristown Rd., Suite 200
Blue Bell PA 19322
Phone: 610.634.7865
Fax: 610.634.7815
Copyright 2022 KIMMEL BOGRETTE ARCHITECTURE + SITE, INC. ALL RIGHTS RESERVED

CL ENGINEERS, P.C.
232 Howe Street
Juniata, PA 15502
814.236.1661
Certificate of Authority # 0020928
Expiration: 7-31-2026

SUNRISE
SENIOR LIVING
Sunrise of Northport
1381-1387 Pulaski Road
Huntington, NY 11731
25-013

ISSUE DATE: 04.10.2026
100% CD
DRAWN BY: DOL
CHECKED BY: MAR
SCALE: AS NOTED


ROOF PLAN - PART B - DUCTWORK

M-2.03B

4/10/2026 4:14:31 PM


1
M-3.01A
1/8" = 1'-0"

FIRST FLOOR PLAN - PART A - PIPING

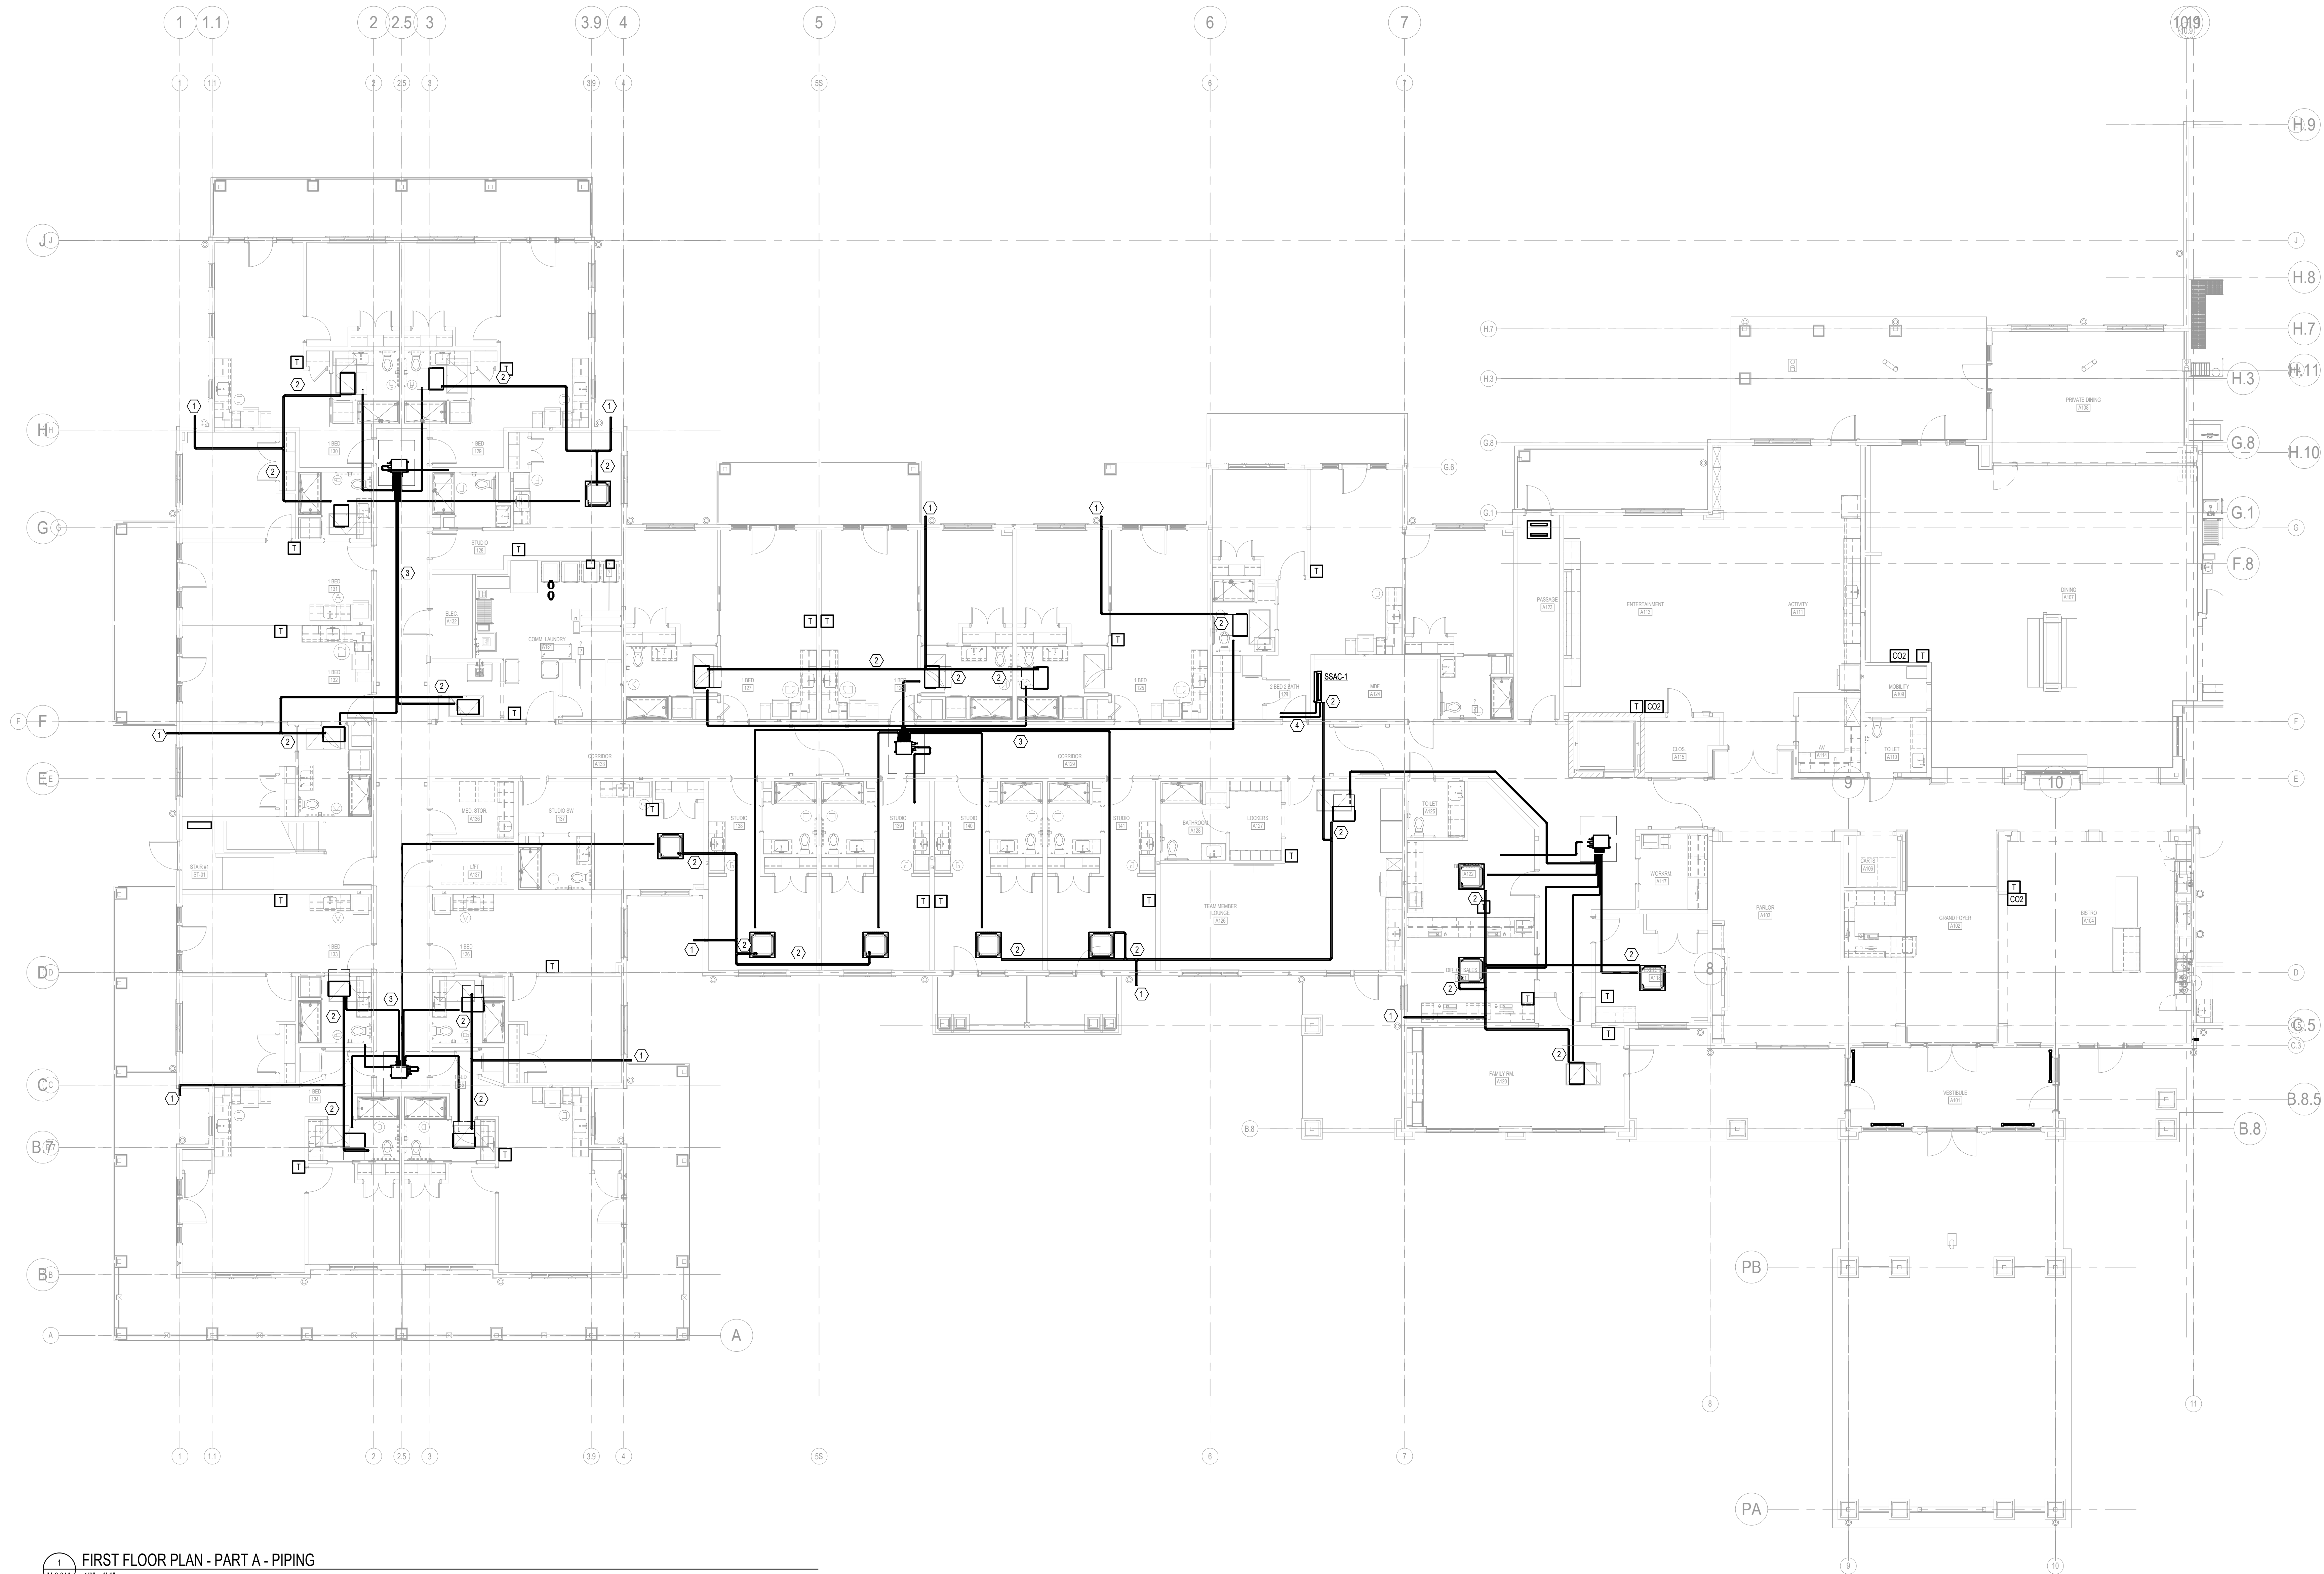

NUMBERED NOTES

- 1-1/4" CONDENSATE DRAIN LINE DOWN IN WALL, EXTEND AND TURN DOWN TO SPLASH BLOCK 12" ABOVE GRADE
- EXTEND AND CONNECT 1-1/4" CONDENSATE DRAIN TO UNIT AS INDICATED, PROVIDE CLEANOUTS AT ALL CHANGES OF DIRECTION
- EXTEND REF. PIPING, SIZED PER MANU. REQUIREMENTS, BETWEEN BRANCH SELECTOR AND INDOOR UNIT.
- EXTEND REF. PIPING, SIZED PER MANU. REQUIREMENTS, BETWEEN INDOOR UNIT AND OUT DOOR UNIT ON ROOF.

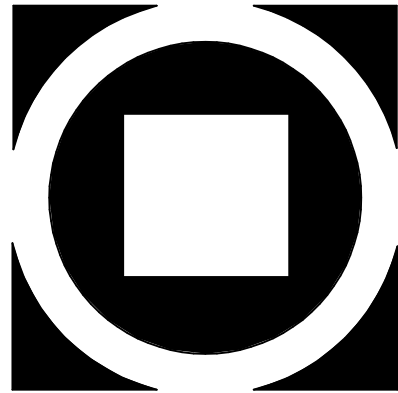

KIMMEL BOGRETTE
Architecture + Site
Blue Bell PA 19322
482 Norristown Rd., Suite 200
Phone 610.634.7865
Fax 610.634.7815
COPYRIGHT 2022 KIMMEL BOGRETTE ARCHITECTURE + SITE, INC. ALL RIGHTS RESERVED

CL ENGINEERS, P.C.
232 Howe Street
Jenkintown, PA 19102
610.296.1661
Certificate of Authority # 0020203
Expiration: 7-31-2026

SUNRISE SENIOR LIVING
Sunrise of Northport
1381-1387 Pulaski Road
Huntington, NY 11731
25-013

ISSUE DATE: 04.10.2026
100% CD
DRAWN BY: DOL
CHECKED BY: MAR
SCALE: AS NOTED

FIRST FLOOR PLAN - PART A - PIPING


M-3.01A



NUMBERED NOTES

- 1-1/4" CONDENSATE DRAIN LINE DOWN IN WALL, EXTEND AND TURN DOWN TO SPLASH BLOCK 12" ABOVE GRADE
- EXTEND AND CONNECT 1-1/4" CONDENSATE DRAIN TO UNIT AS INDICATED, PROVIDE CLEANOUTS AT ALL CHANGES OF DIRECTION
- EXTEND REF. PIPING, SIZED PER MANU. REQUIREMENTS, BETWEEN BRANCH SELECTOR AND INDOOR UNIT.
- EXTEND REF. PIPING, SIZED PER MANU. REQUIREMENTS, BETWEEN INDOOR UNIT AND OUT DOOR UNIT ON ROOF.
- 1-1/4" EXTEND CONDENSATE DRAIN FROM INDOOR UNIT TO DRAIN IN THIS AREA.


1 FIRST FLOOR PLAN - PART B - PIPING
M-3.01B 1/8" = 1'-0"

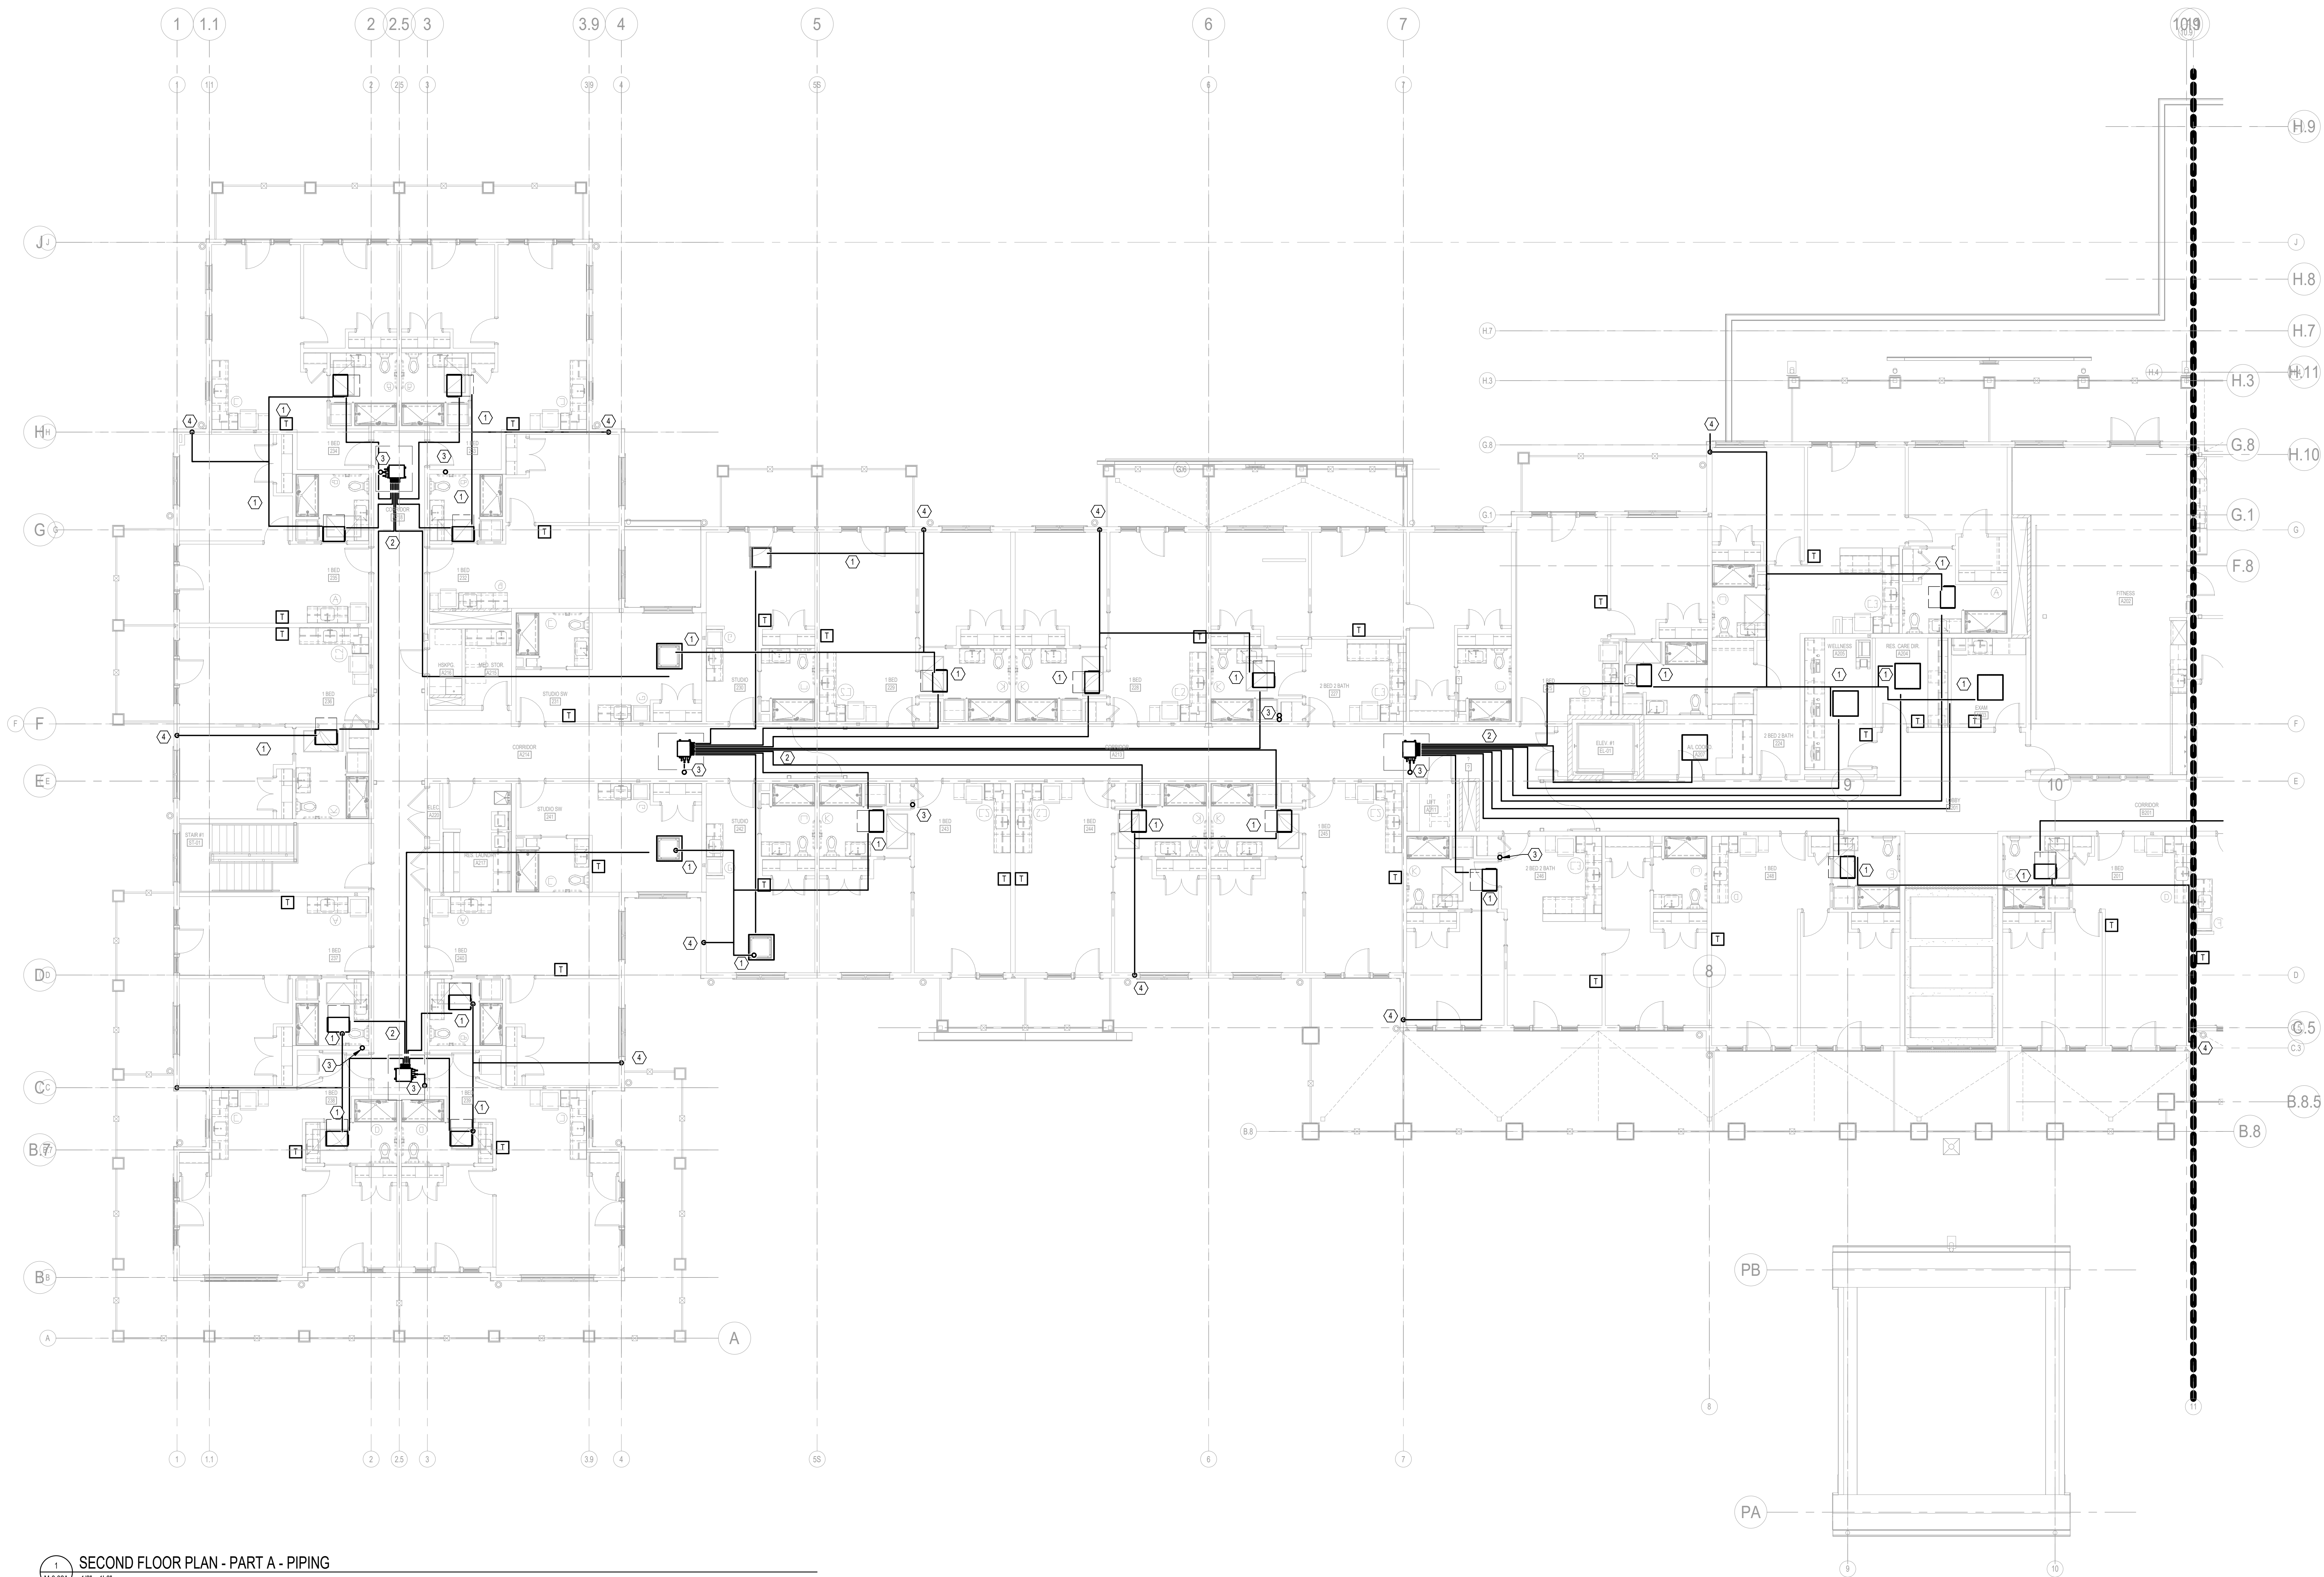

1 SECOND FLOOR PLAN - PART A - PIPING
1/8" = 1'-0"

NUMBERED NOTES


- 1 EXTEND AND CONNECT 1-1/4" CONDENSATE DRAIN TO UNIT AS INDICATED. PROVIDE CLEANOUTS AT ALL CHANGES OF DIRECTION.
- 2 EXTEND REF. PIPING, SIZED PER MANU. REQUIREMENTS, BETWEEN BRANCH SELECTOR AND INDOOR UNIT.
- 3 REF. PIPING, SIZED PER MANU. REQUIREMENTS, BETWEEN BRANCH SELECTOR AND OUTDOOR UNIT ON ROOF.
- 4 1-1/4" COND. DRAIN DOWN IN WALL TO SPLASH BLOCK ON FLOOR BELOW.

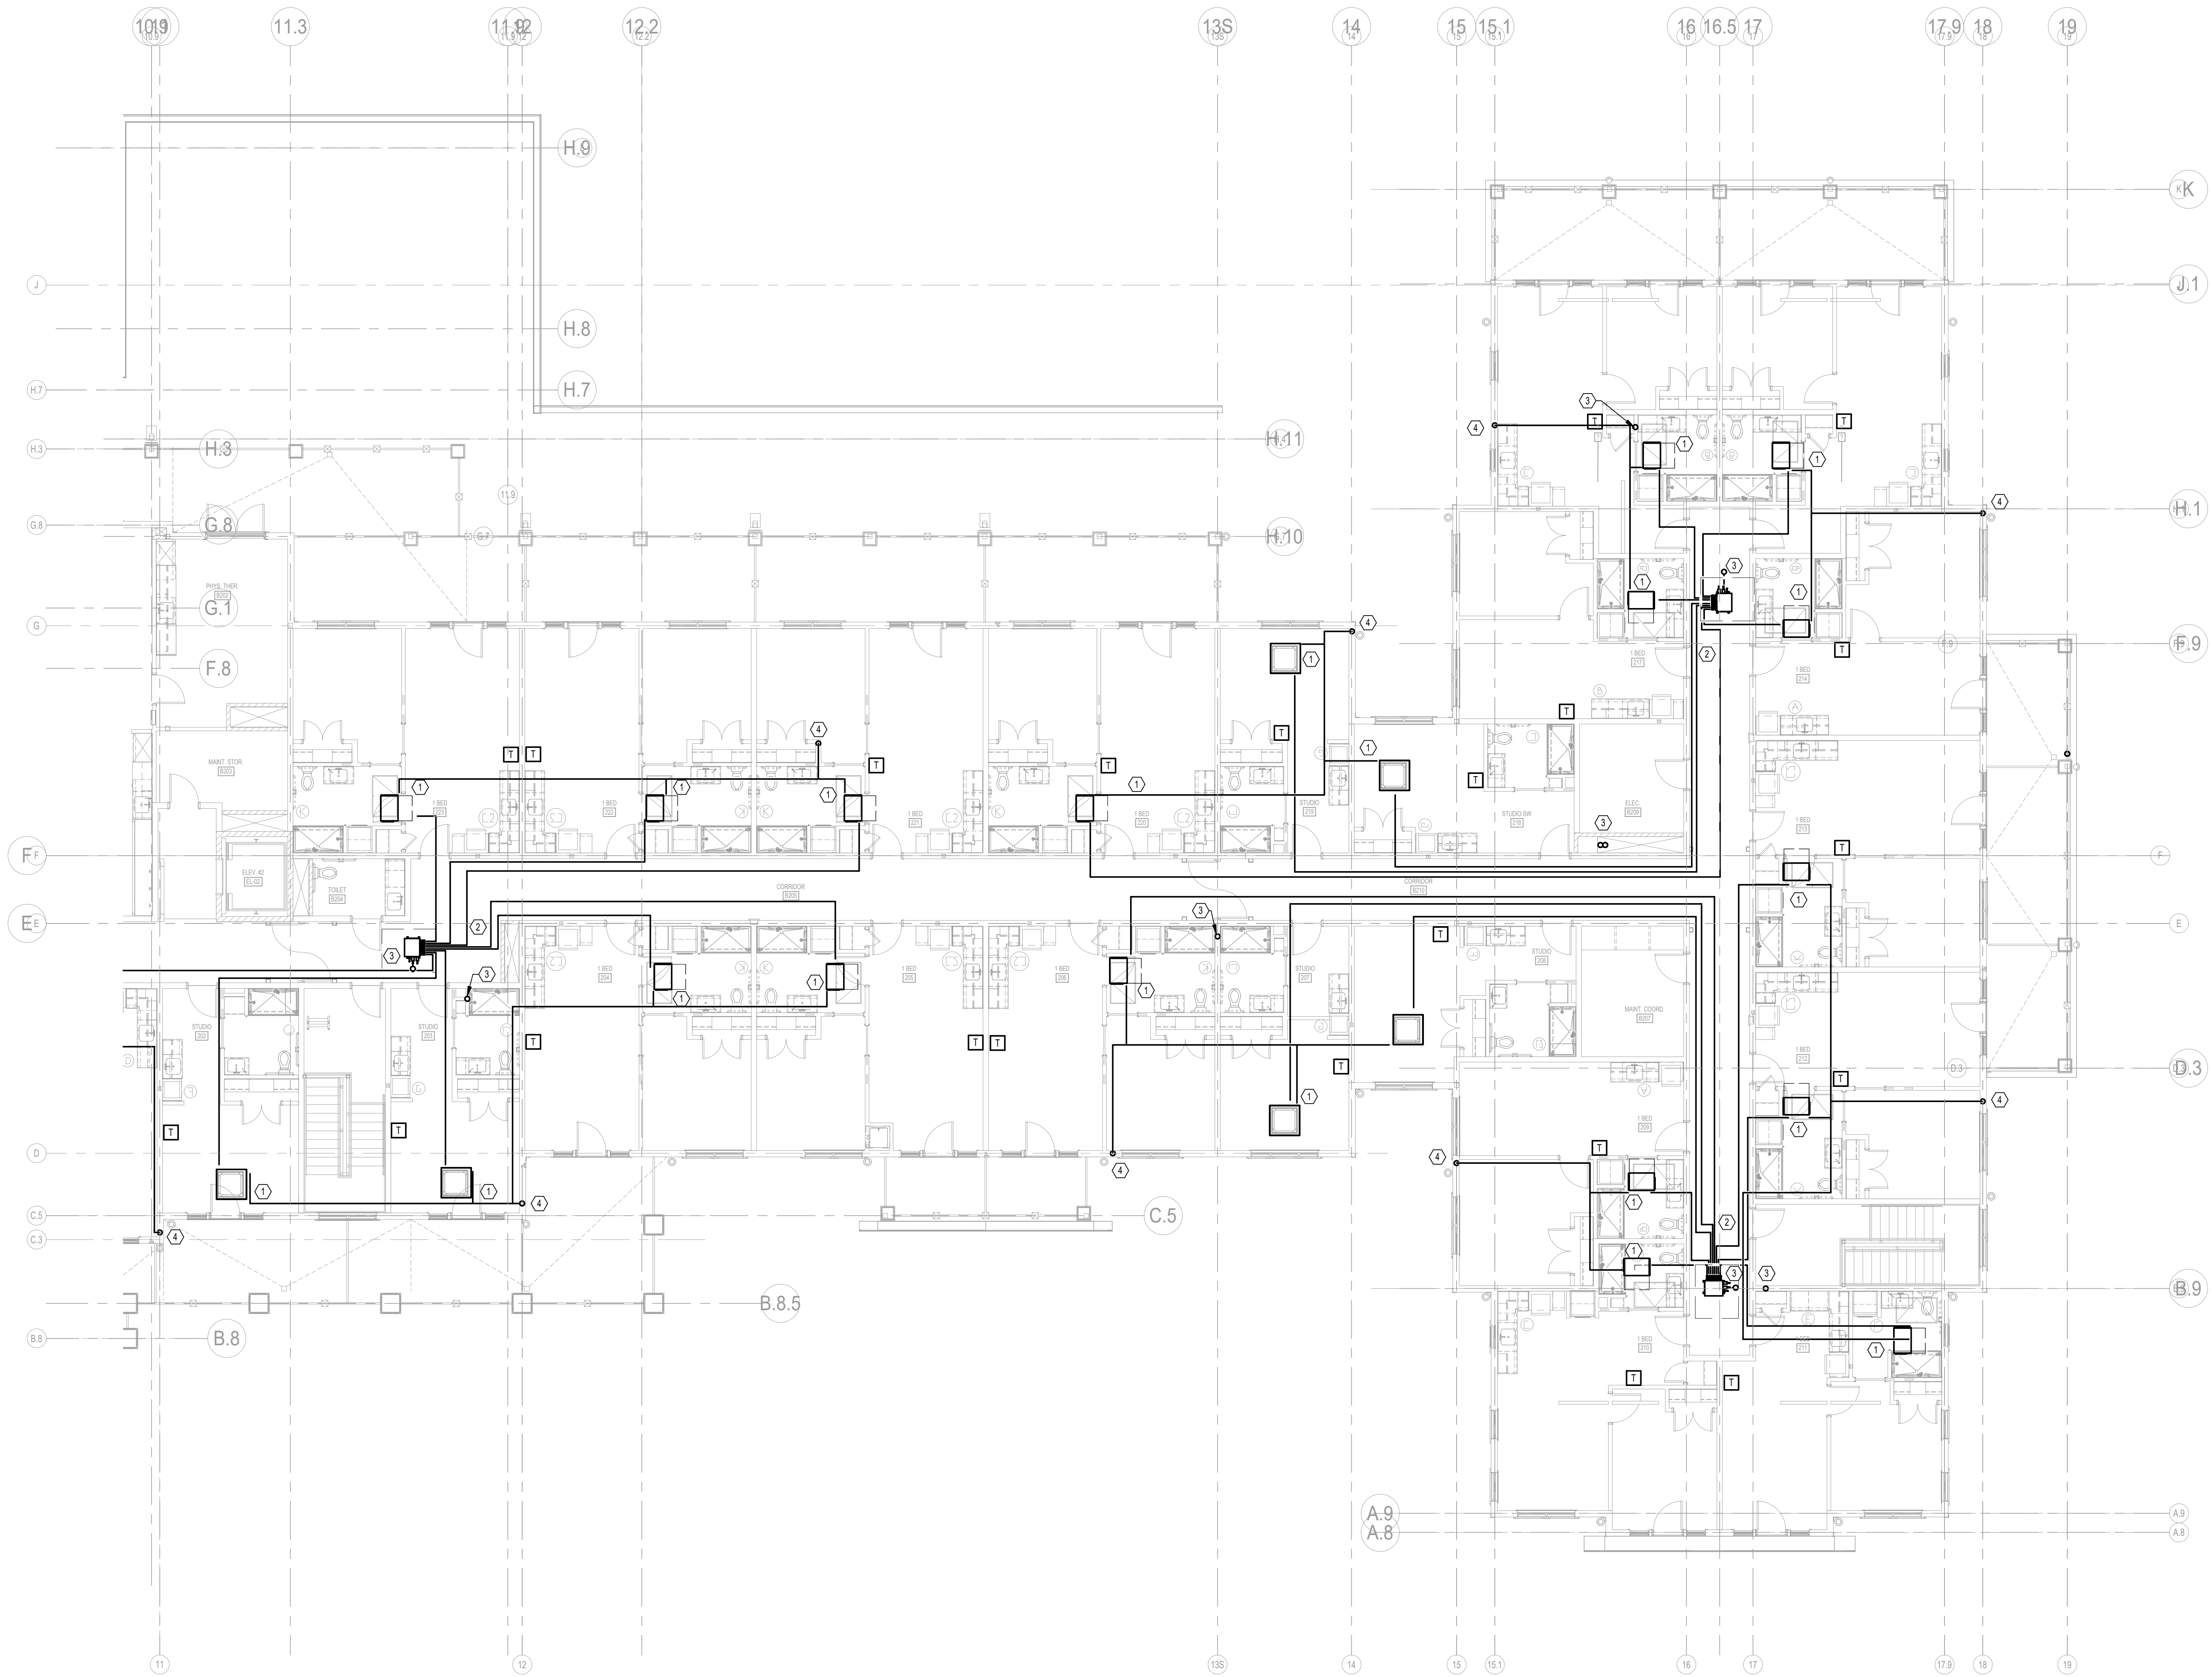

NUMBERED NOTES

- 1 EXTEND AND CONNECT 1-1/4" CONDENSATE DRAIN TO UNIT AS INDICATED. PROVIDE CLEANOUTS AT ALL CHANGES OF DIRECTION.
- 2 EXTEND REF. PIPING, SIZED PER MANU. REQUIREMENTS, BETWEEN BRANCH SELECTOR AND INDOOR UNIT.
- 3 REF. PIPING, SIZED PER MANU. REQUIREMENTS, BETWEEN BRANCH SELECTOR AND OUTDOOR UNIT ON ROOF.
- 4 1-1/4" COND. DRAIN DOWN IN WALL TO SPLASH BLOCK ON FLOOR BELOW.

1 SECOND FLOOR PLAN - PART B - PIPING
M-3.02B 1/8" = 1'-0"

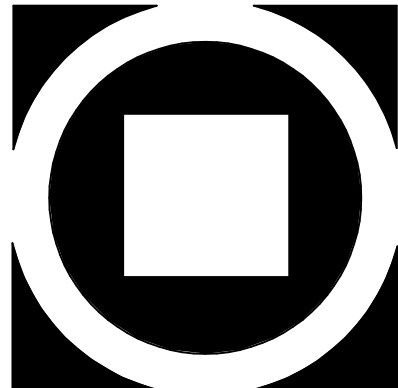

KIMMEL BOGRETTE
Architecture + Site
Blue Bell PA 19322
482 Norristown Rd., Suite 200
Phone 610.634.7865
Fax 610.634.7815
Copyright 2022 KIMMEL BOGRETTE ARCHITECTURE + SITE, INC. ALL RIGHTS RESERVED

CL ENGINEERS, P.C.
232 Howe Street
Jenkintown, PA 19102
610.296.1661
Certificate of Authority # 0020928
Expiration: 7-31-2026

SUNRISE
SENIOR LIVING
Sunrise of Northport
1381-1387 Pulaski Road
Huntington, NY 11731
25-013



ISSUE DATE: 04.10.2026
100% CD
DRAWN BY: DOL
CHECKED BY: MAR
SCALE: AS NOTED

SECOND FLOOR PLAN - PART B - PIPING

M-3.02B

4/10/2026 4:15:00 PM

1
M-3.03A
ROOF PLAN - PART A - PIPING
1/8" = 1'-0"

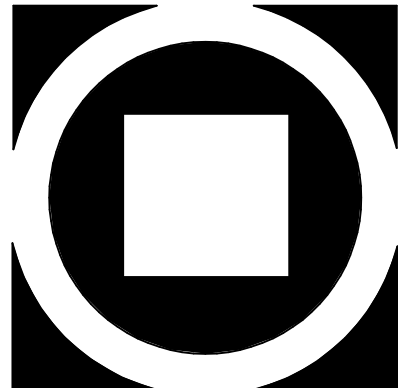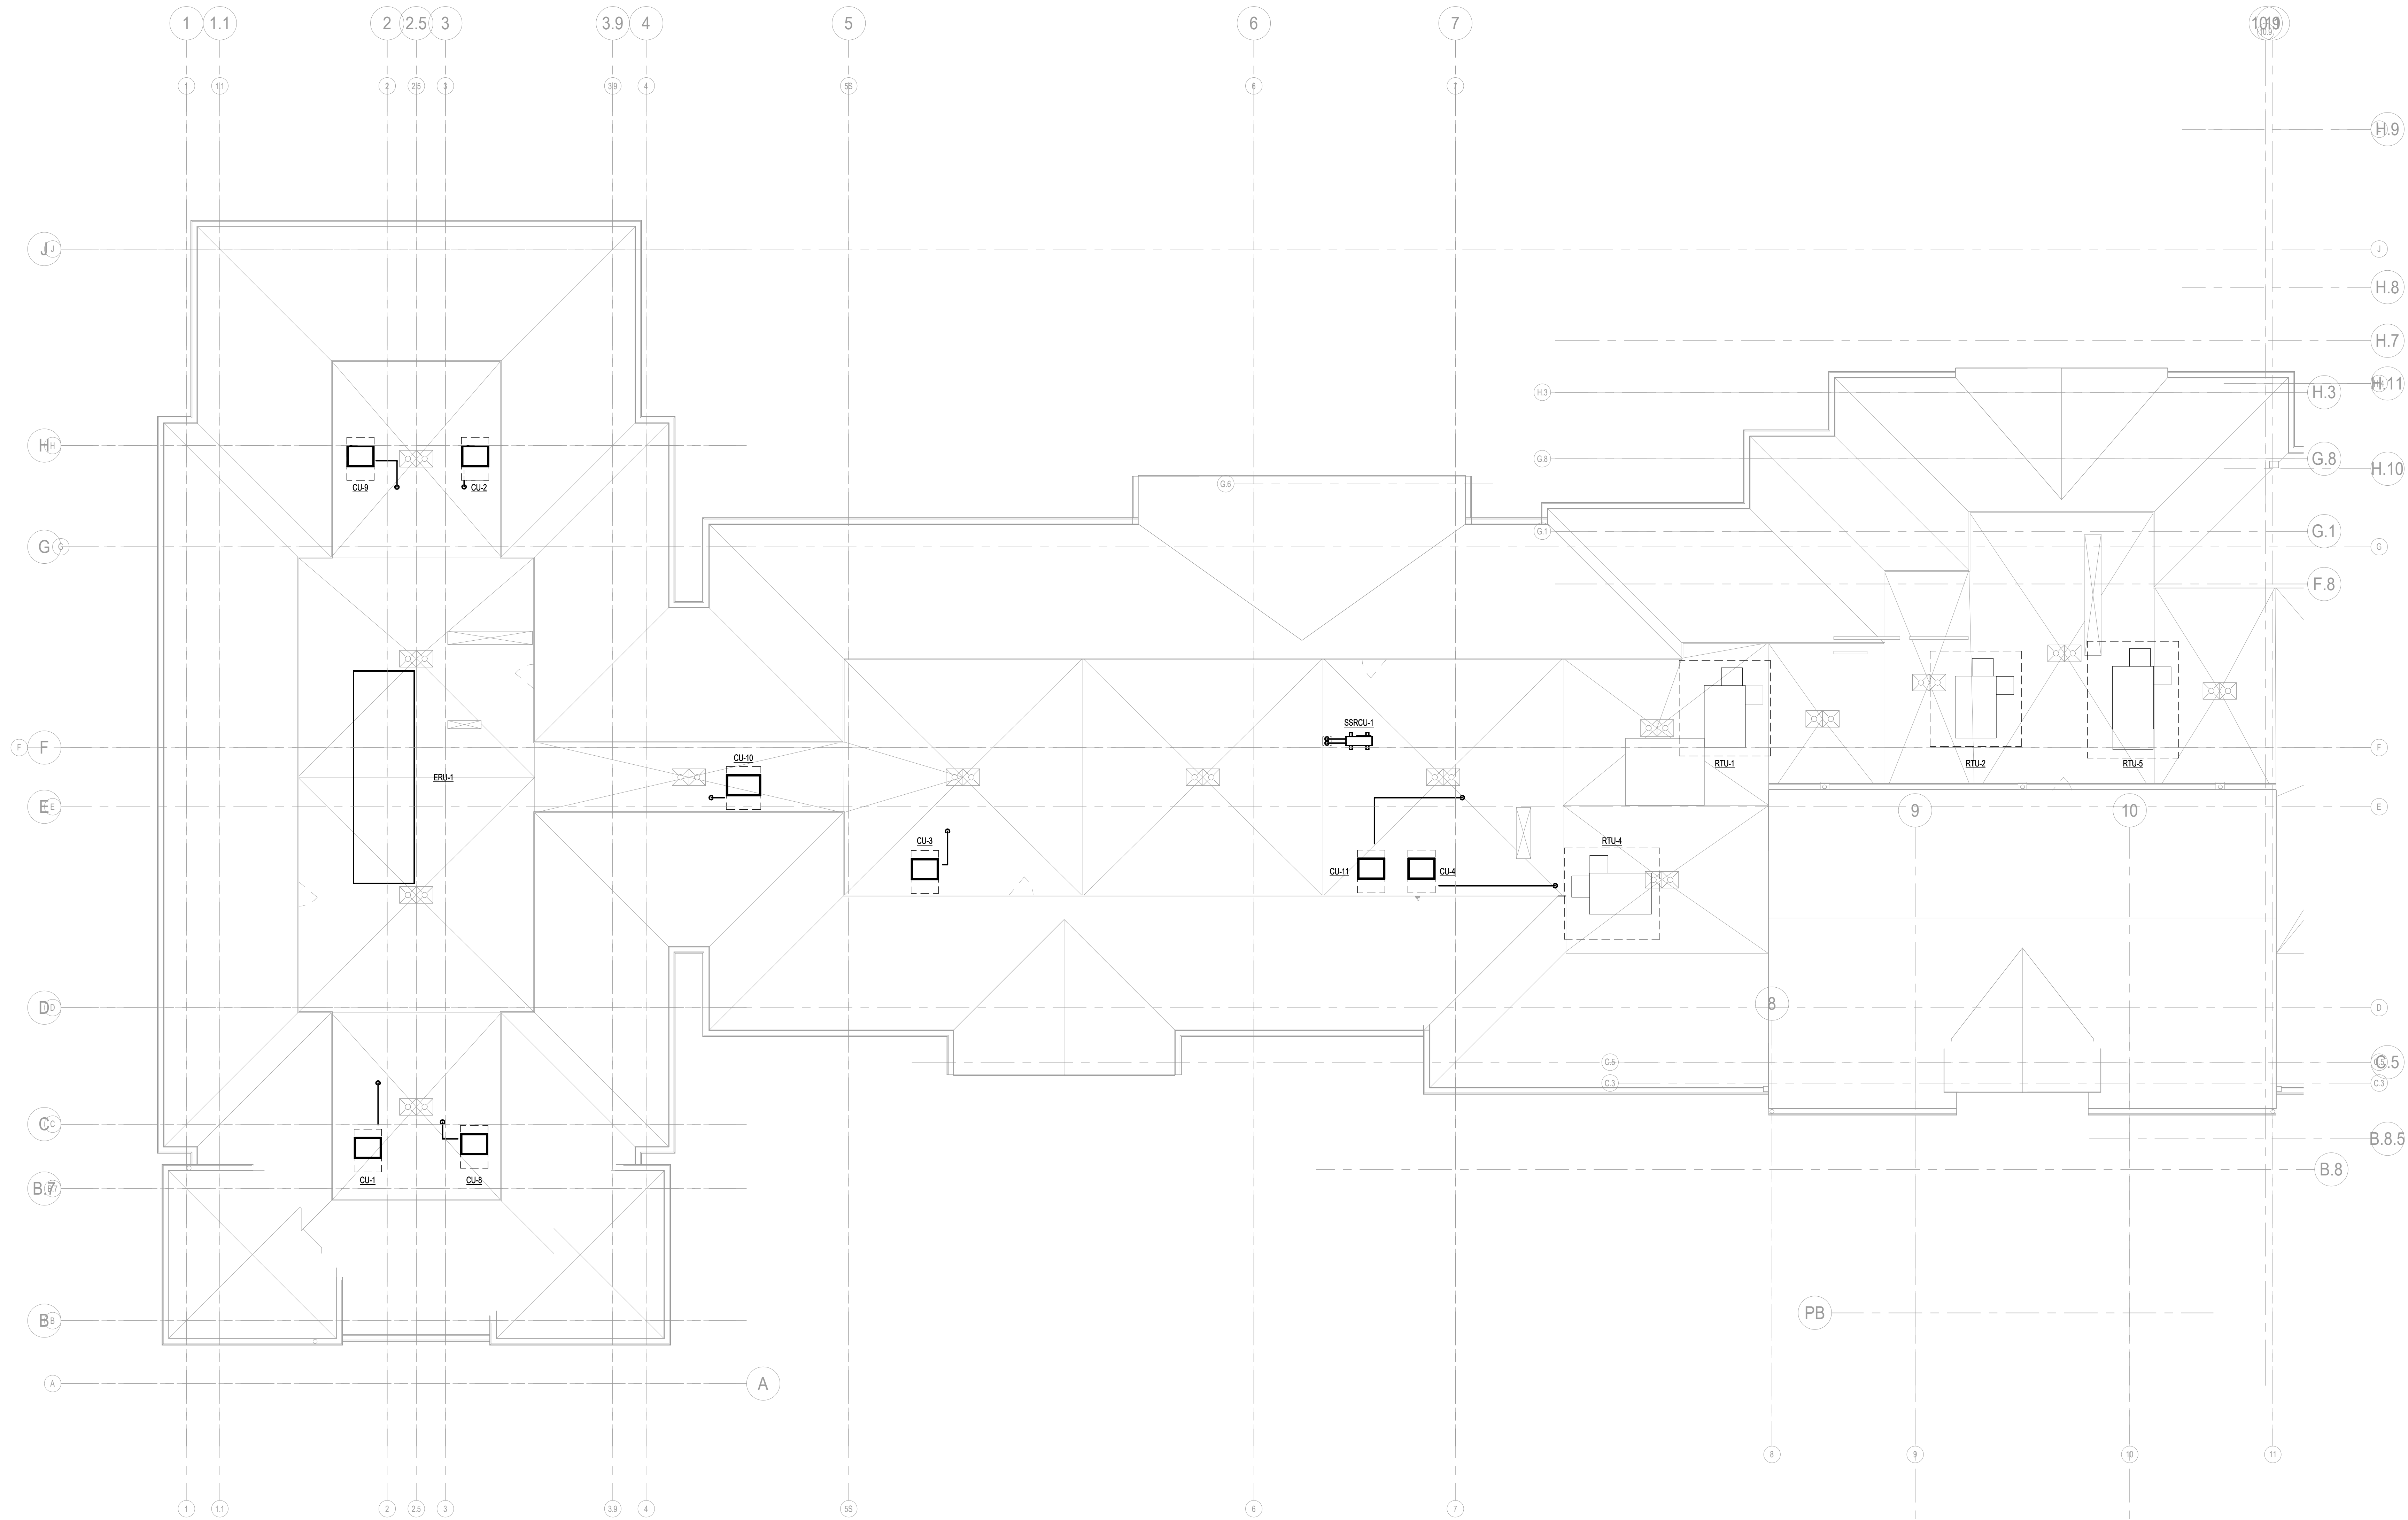

KIMMEL BOGRETTE
Architecture + Site
Blue Bell PA 19322
Phone 610.634.7865
Copyright 2025 KIMMEL BOGRETTE ARCHITECTURE + SITE, INC. ALL RIGHTS RESERVED

CL ENGINEERS, P.C.
232 Howe Street
Jenkintown, PA 19102
814.296.1661
Certificate of Authority # 0020928
Expiration: 7-31-2026


SUNRISE
SENIOR LIVING
Sunrise of Northport
1381-1387 Pulaski Road
Huntington, NY 11731
25-013

ISSUE DATE: 04.10.2026
100% CD
DRAWN BY: Author
CHECKED BY: Checker
SCALE: AS NOTED


ROOF PLAN - PART A - PIPING

M-3.03A




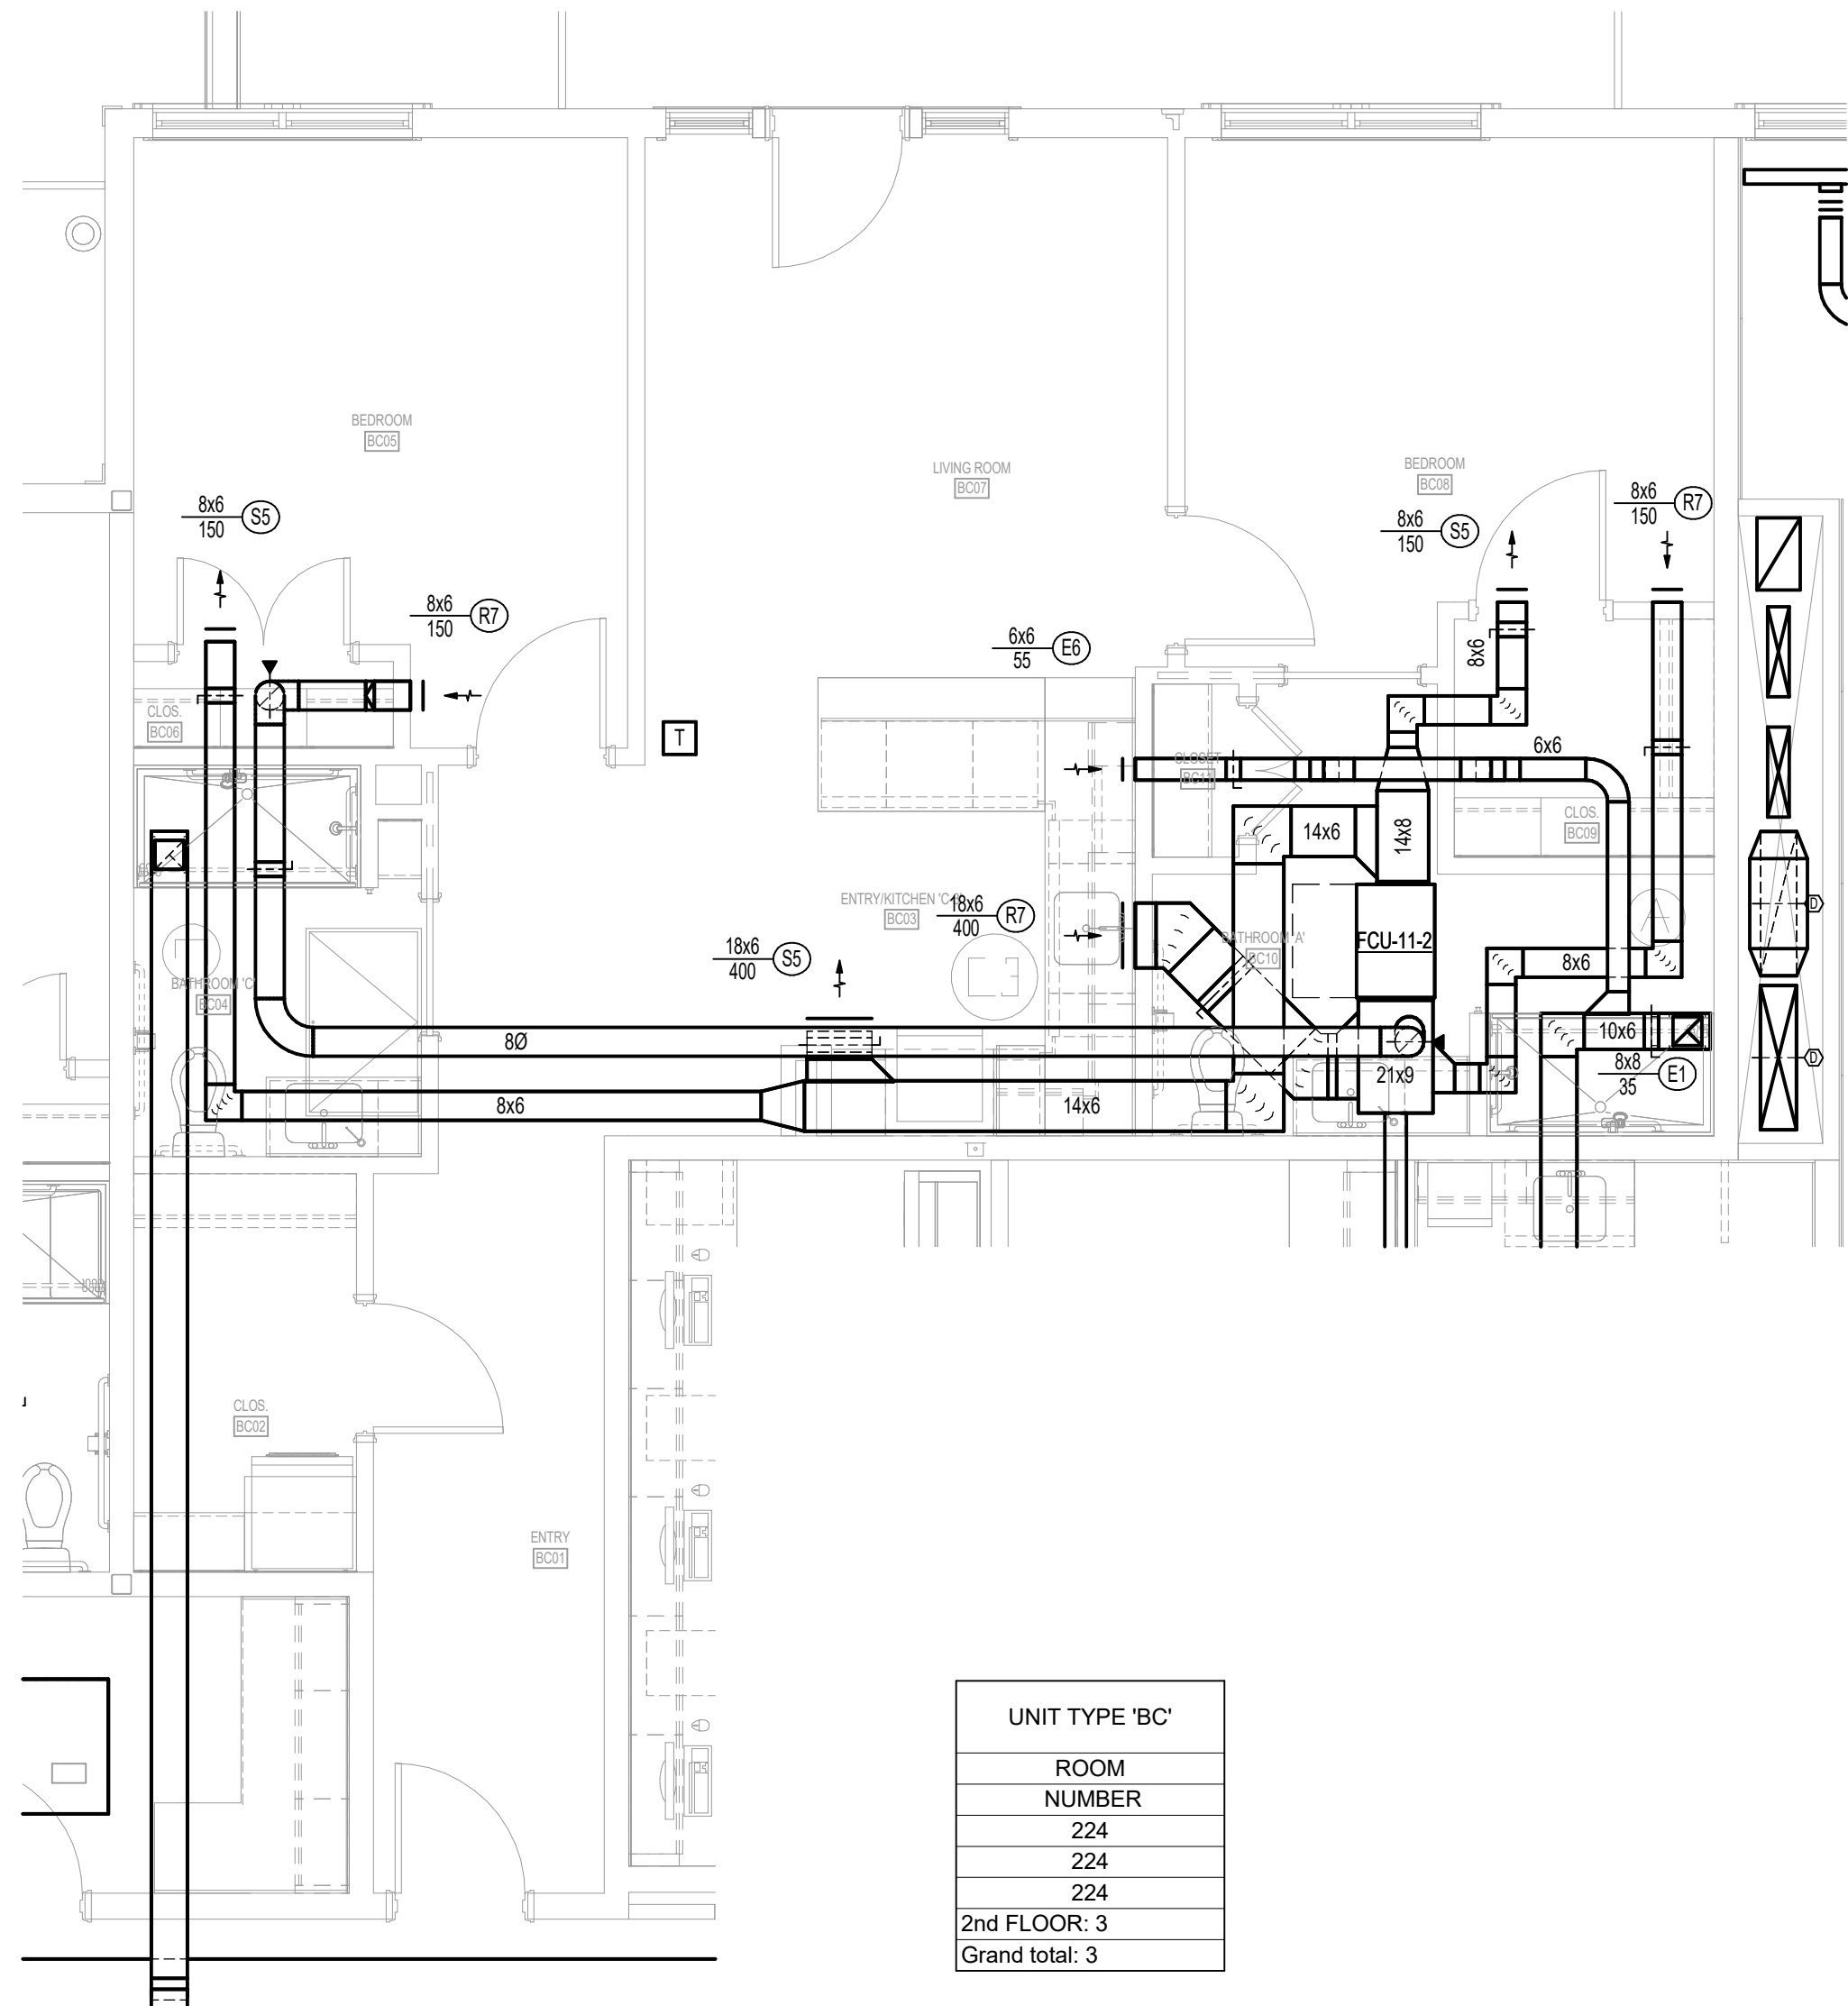


3 UNIT TYPE 'BC' - 2 BED 2 BATH - 991 SF - DUCTWORK
1/4" = 1'-0"

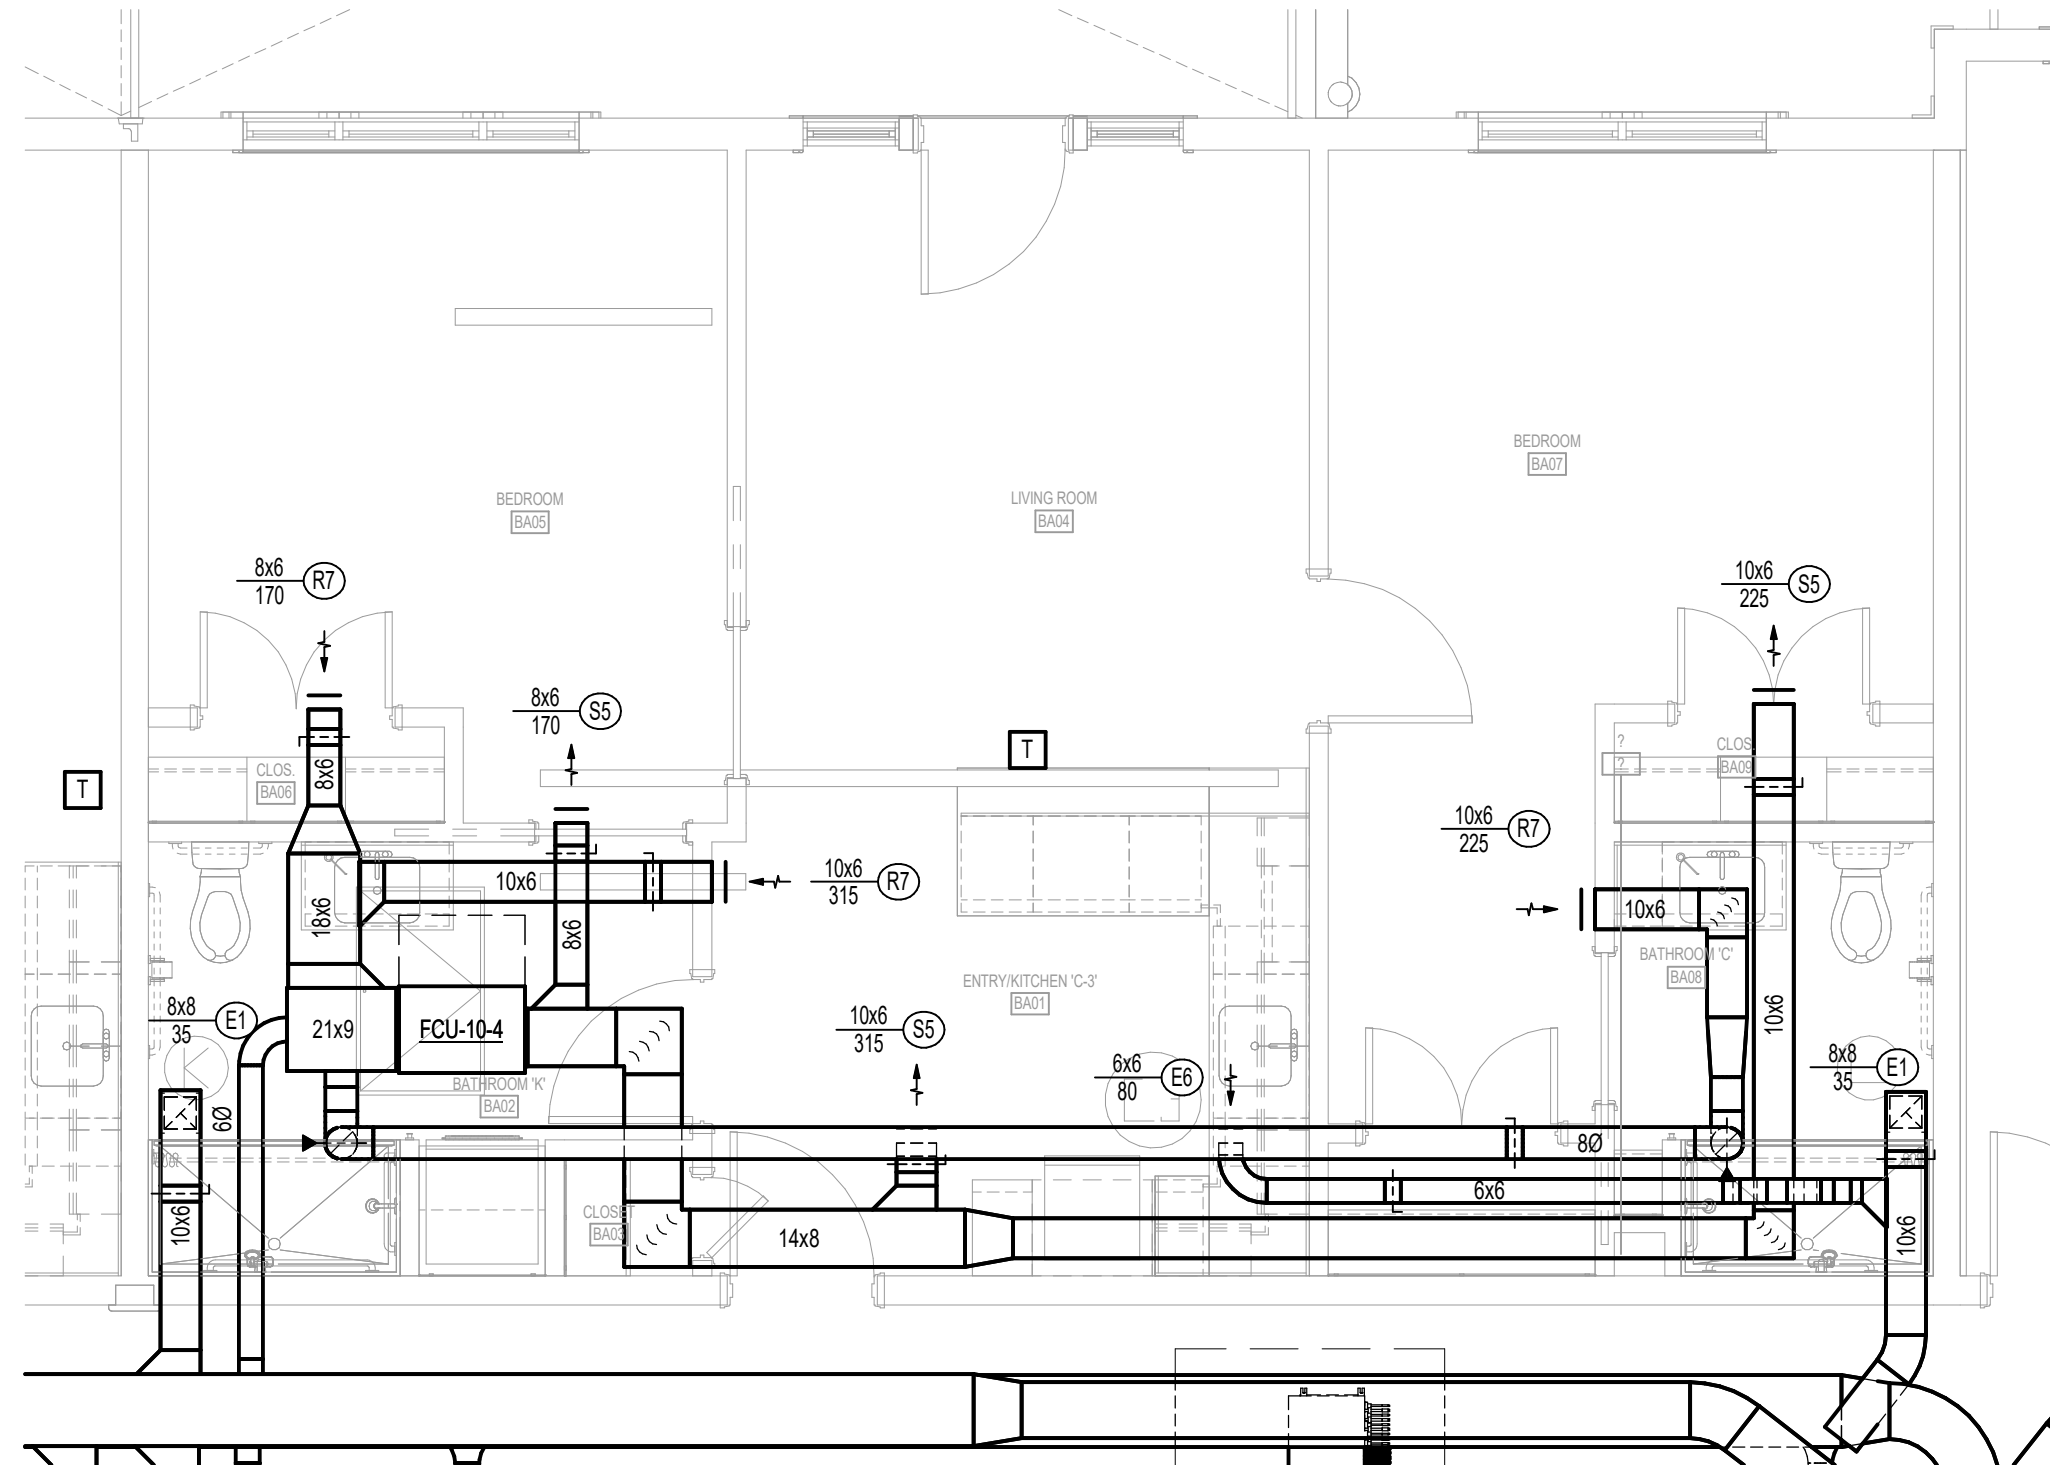

1 UNIT TYPE 'BA' - 2 BED 2 BATH - 567 SF - DUCTWORK
1/4" = 1'-0"

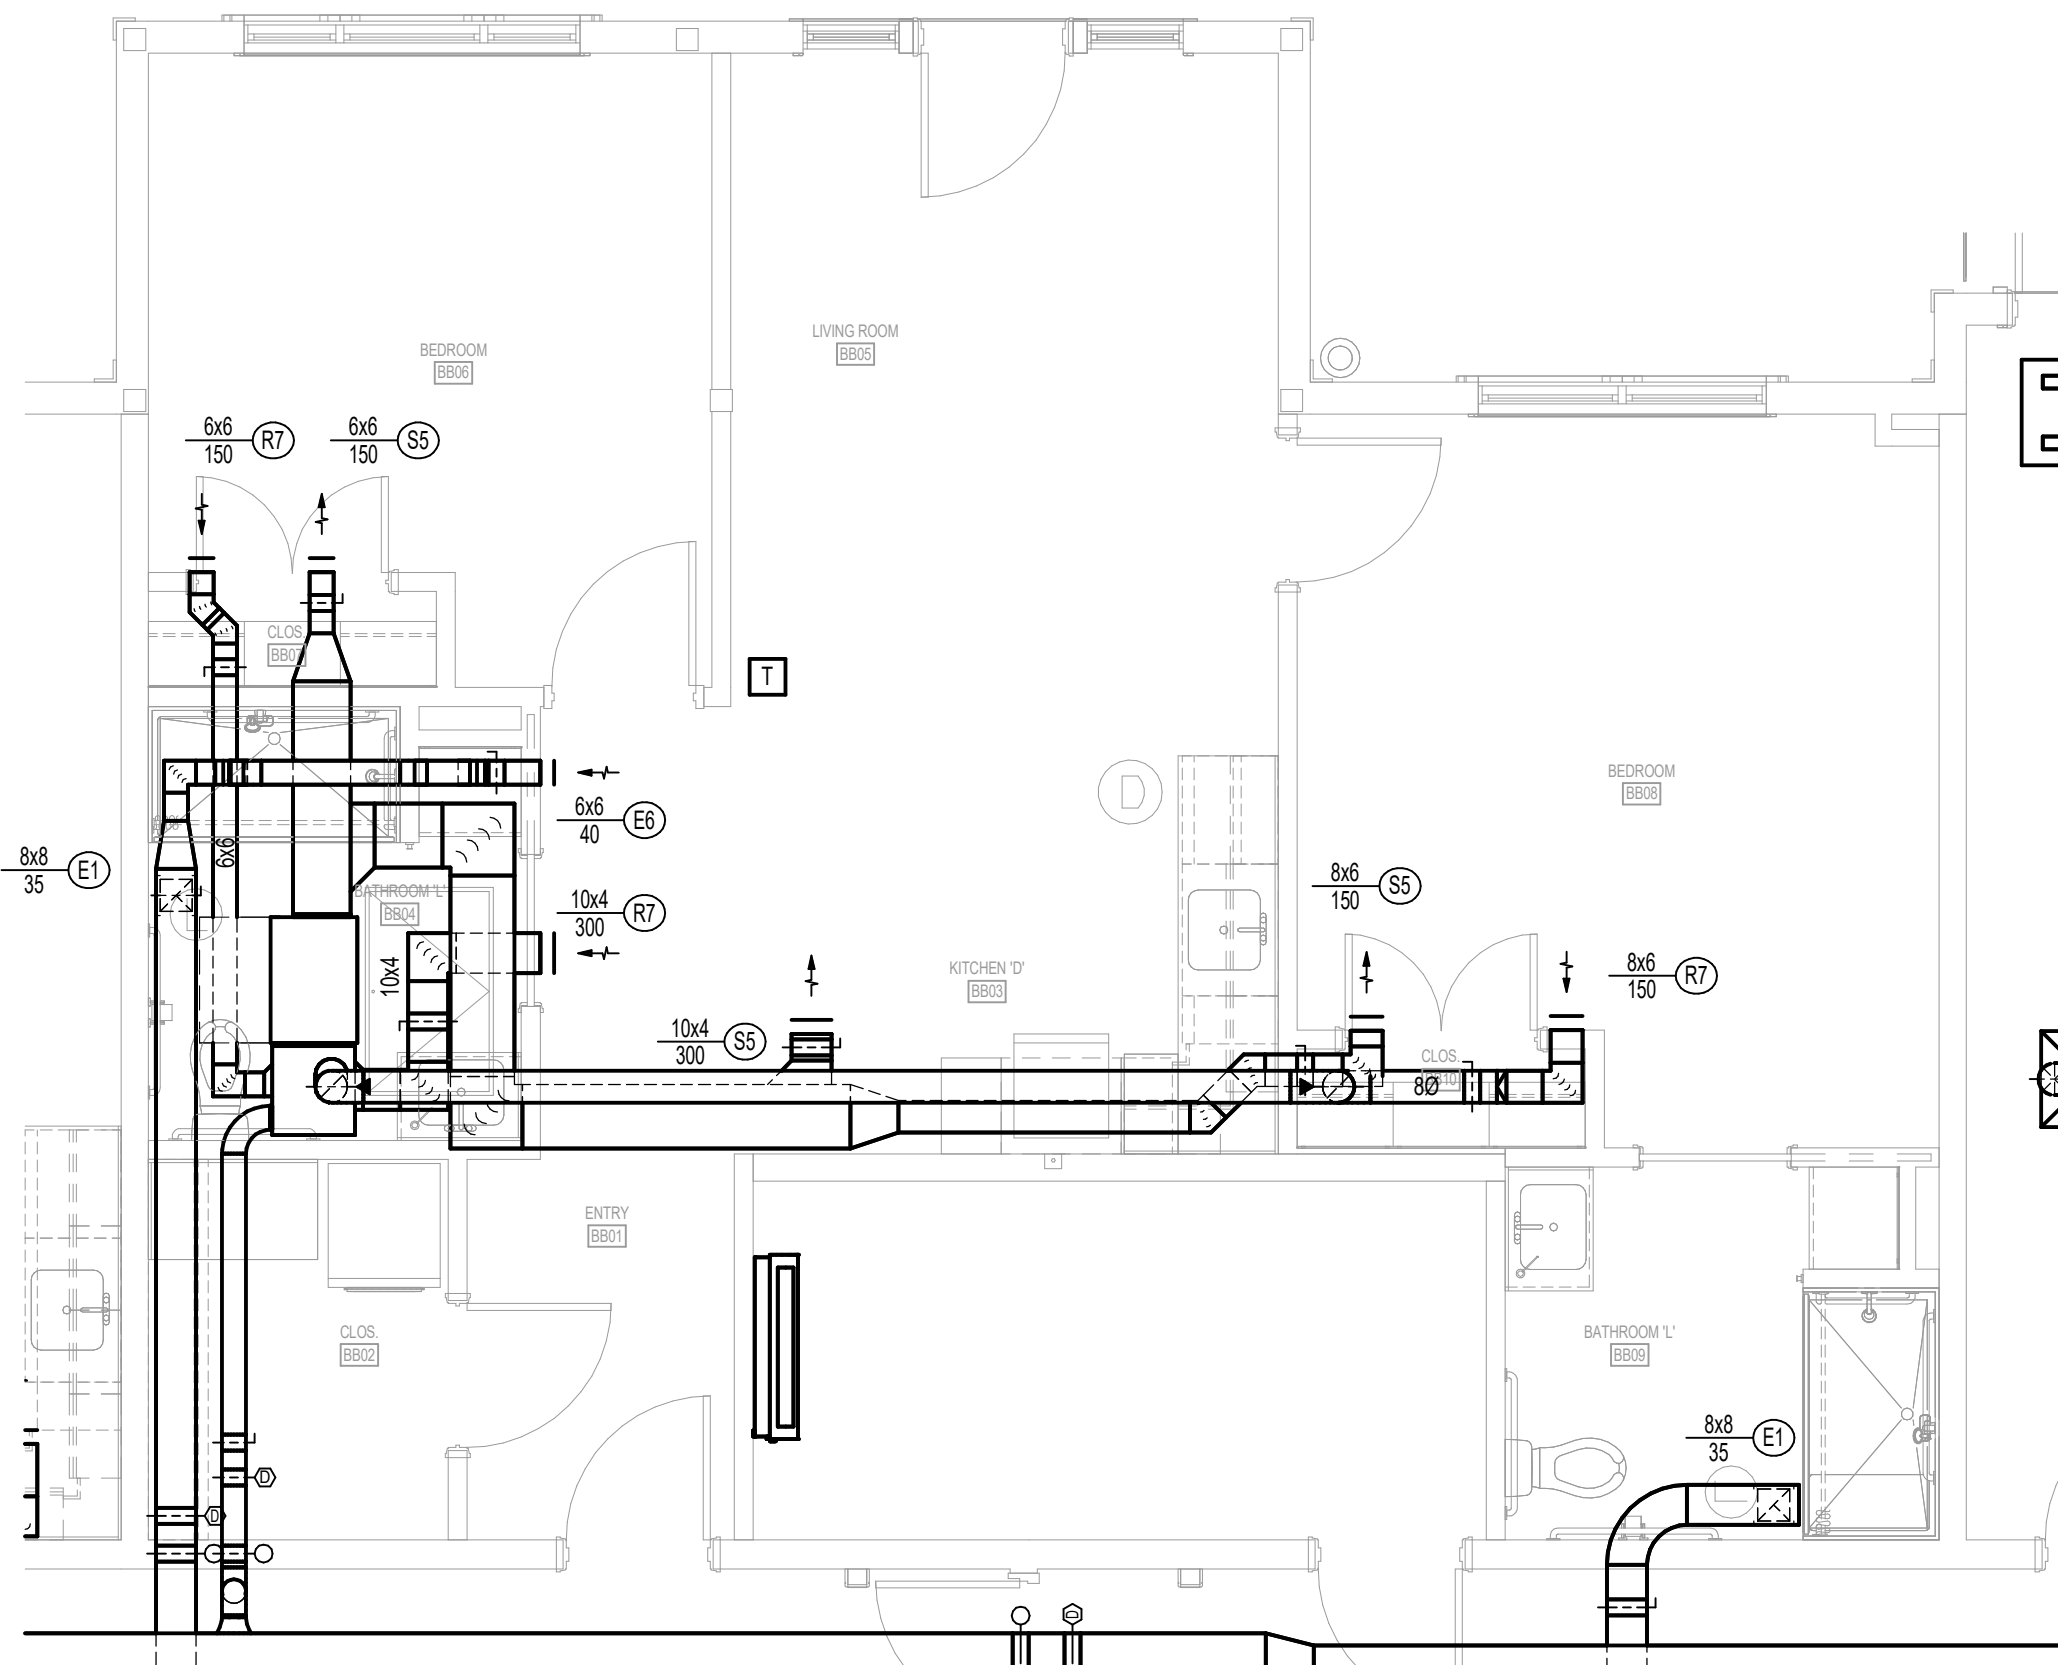

2 UNIT TYPE 'BB'/ADA - 2 BED 2 BATH - 884 SF - DUCTWORK
1/4" = 1'-0"

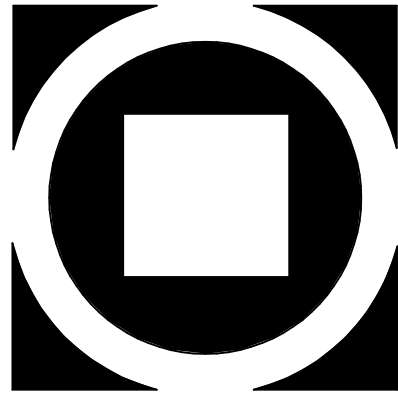

KIMMEL BOGRETTE
Architecture + Site
Blue Bell PA 19322
482 Norristown Rd., Suite 200
Phone 610.634.7805
Copyright 2022 KIMMEL BOGRETTE ARCHITECTURE + SITE, INC. ALL RIGHTS RESERVED


CL ENGINEERS, P.C.
232 Howe Street
Jenkintown, PA 19022
610.296.1661
Certificate of Authority # 0000028
Expiration: 7-31-2026

SUNRISE
SENIOR LIVING
Sunrise of Northport
1381-1387 Pulaski Road
Huntington, NY 11731
25-013


ISSUE DATE:
04.10.2026
100% CD
DRAWN BY: DOL
CHECKED BY: MAR
SCALE: AS NOTED

ENLARGED UNIT TYPES B - DUCTWORK


M-5.02

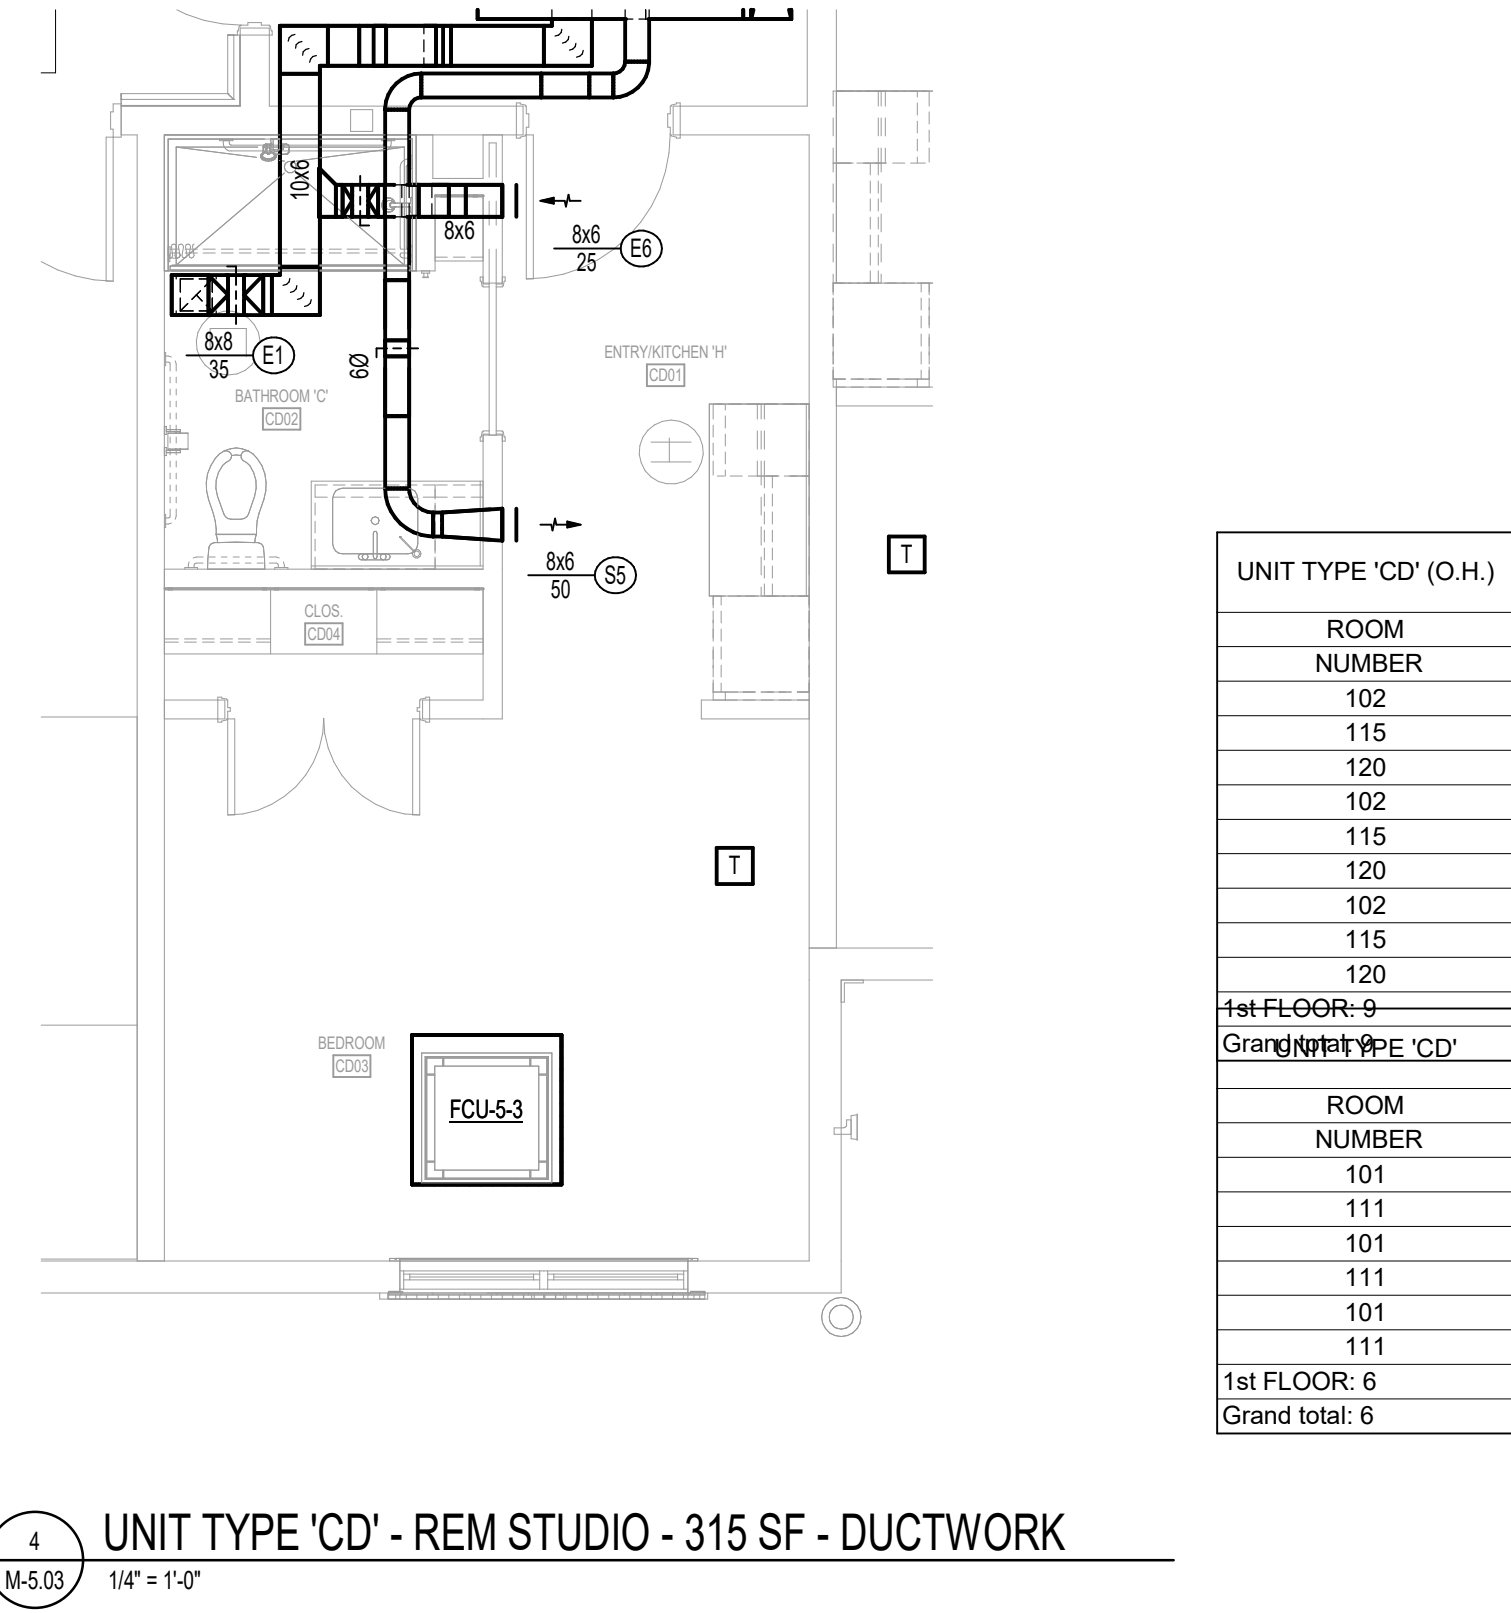


4 UNIT TYPE 'CD' - REM STUDIO - 315 SF - DUCTWORK
M-5.03 1/4" = 1'-0"

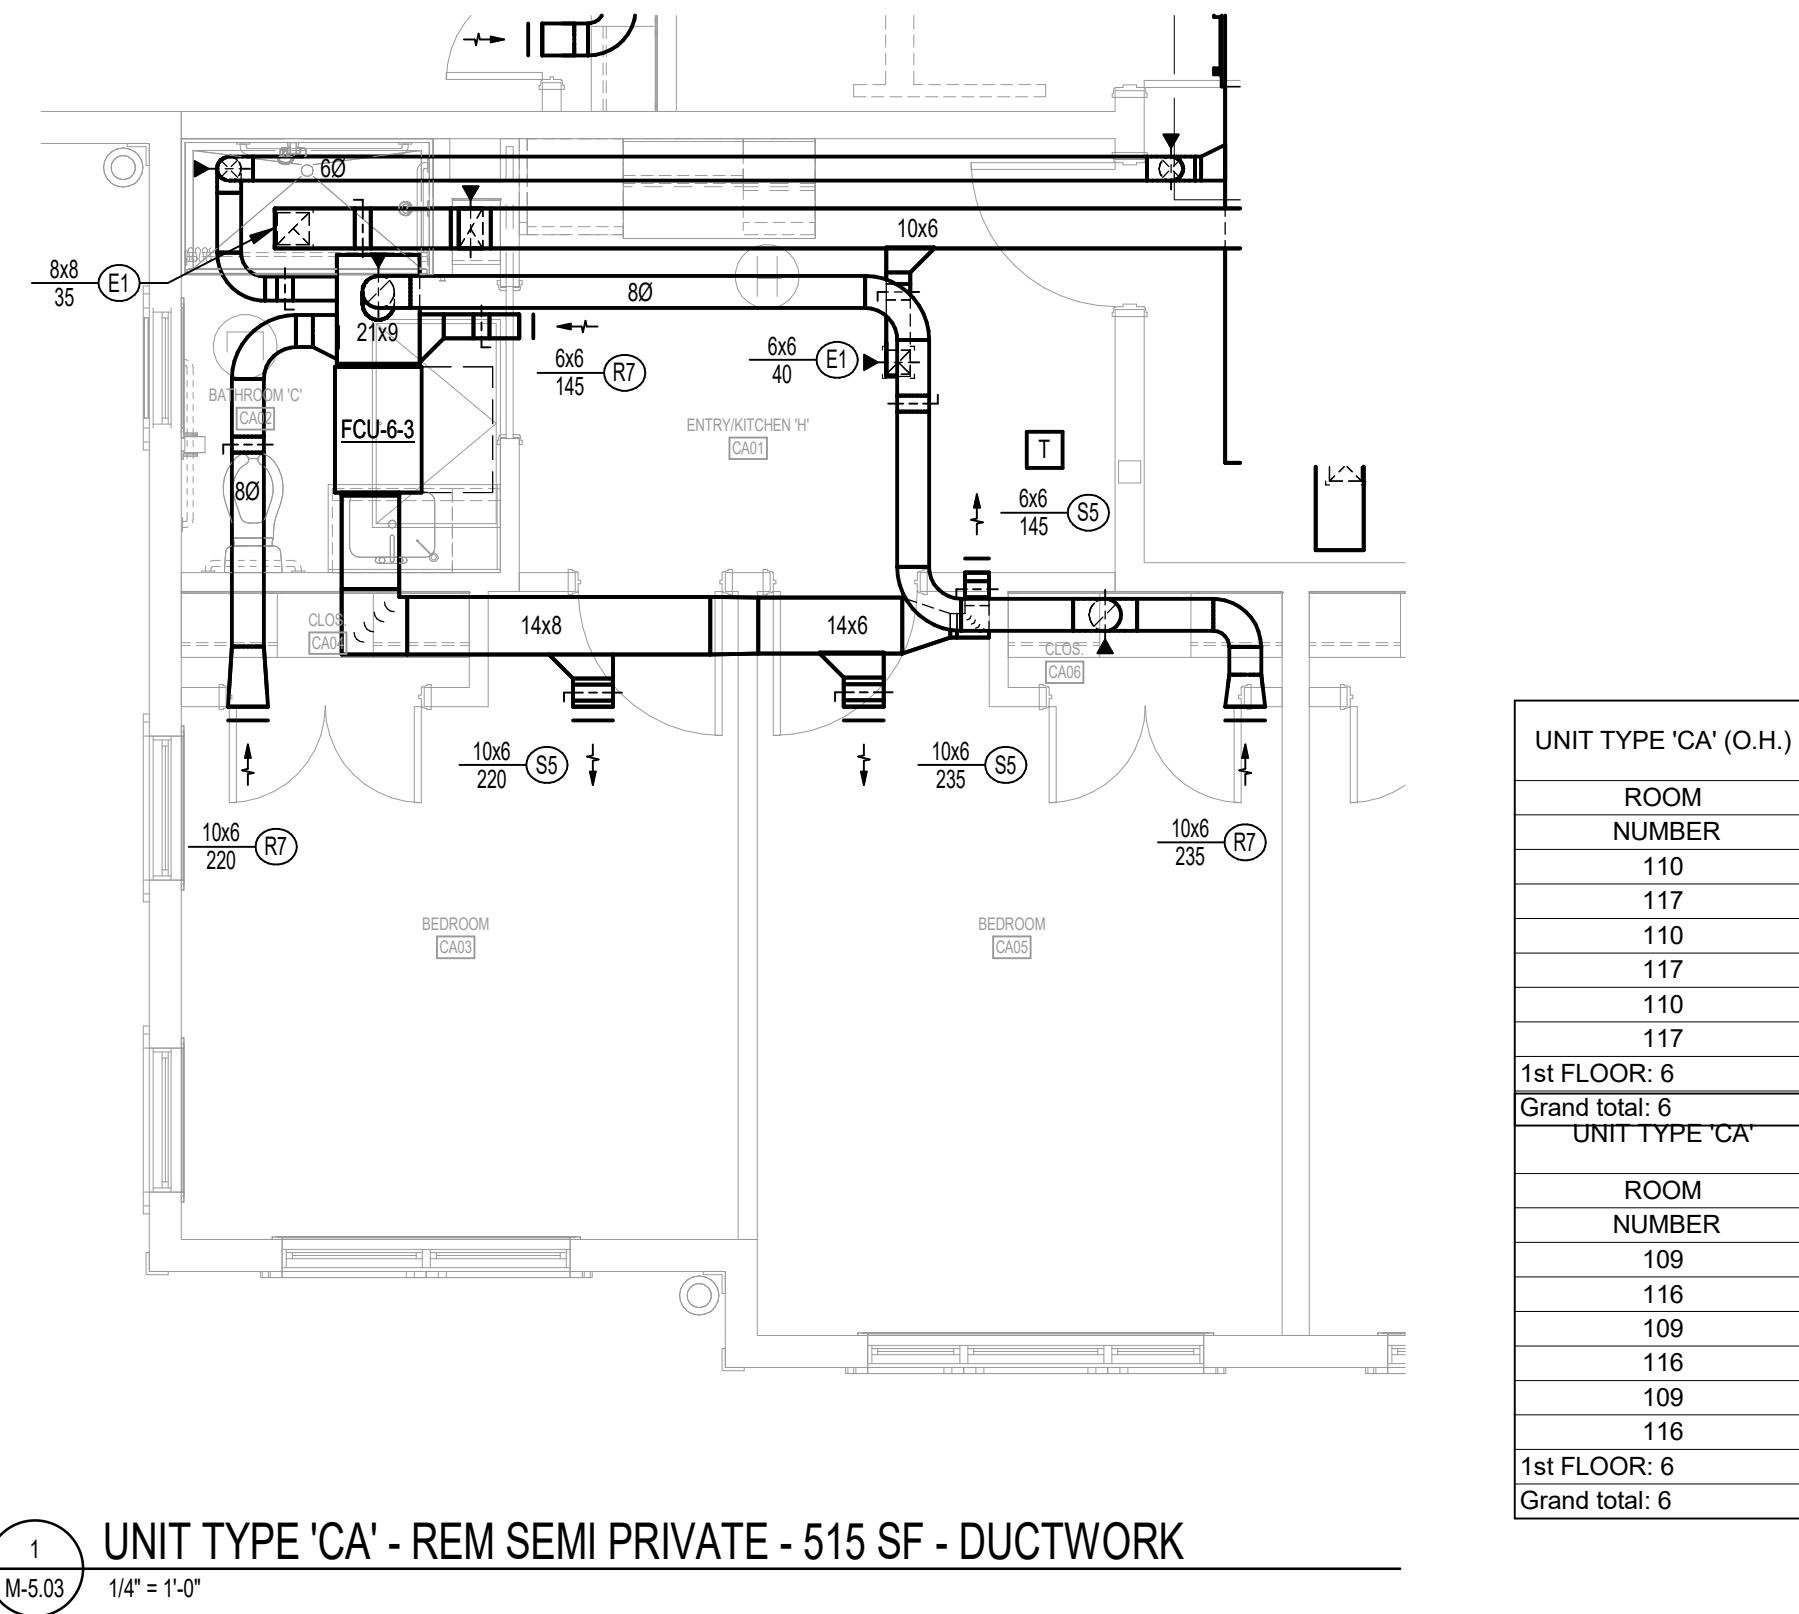


1 UNIT TYPE 'CA' - REM SEMI PRIVATE - 515 SF - DUCTWORK
M-5.03 1/4" = 1'-0"

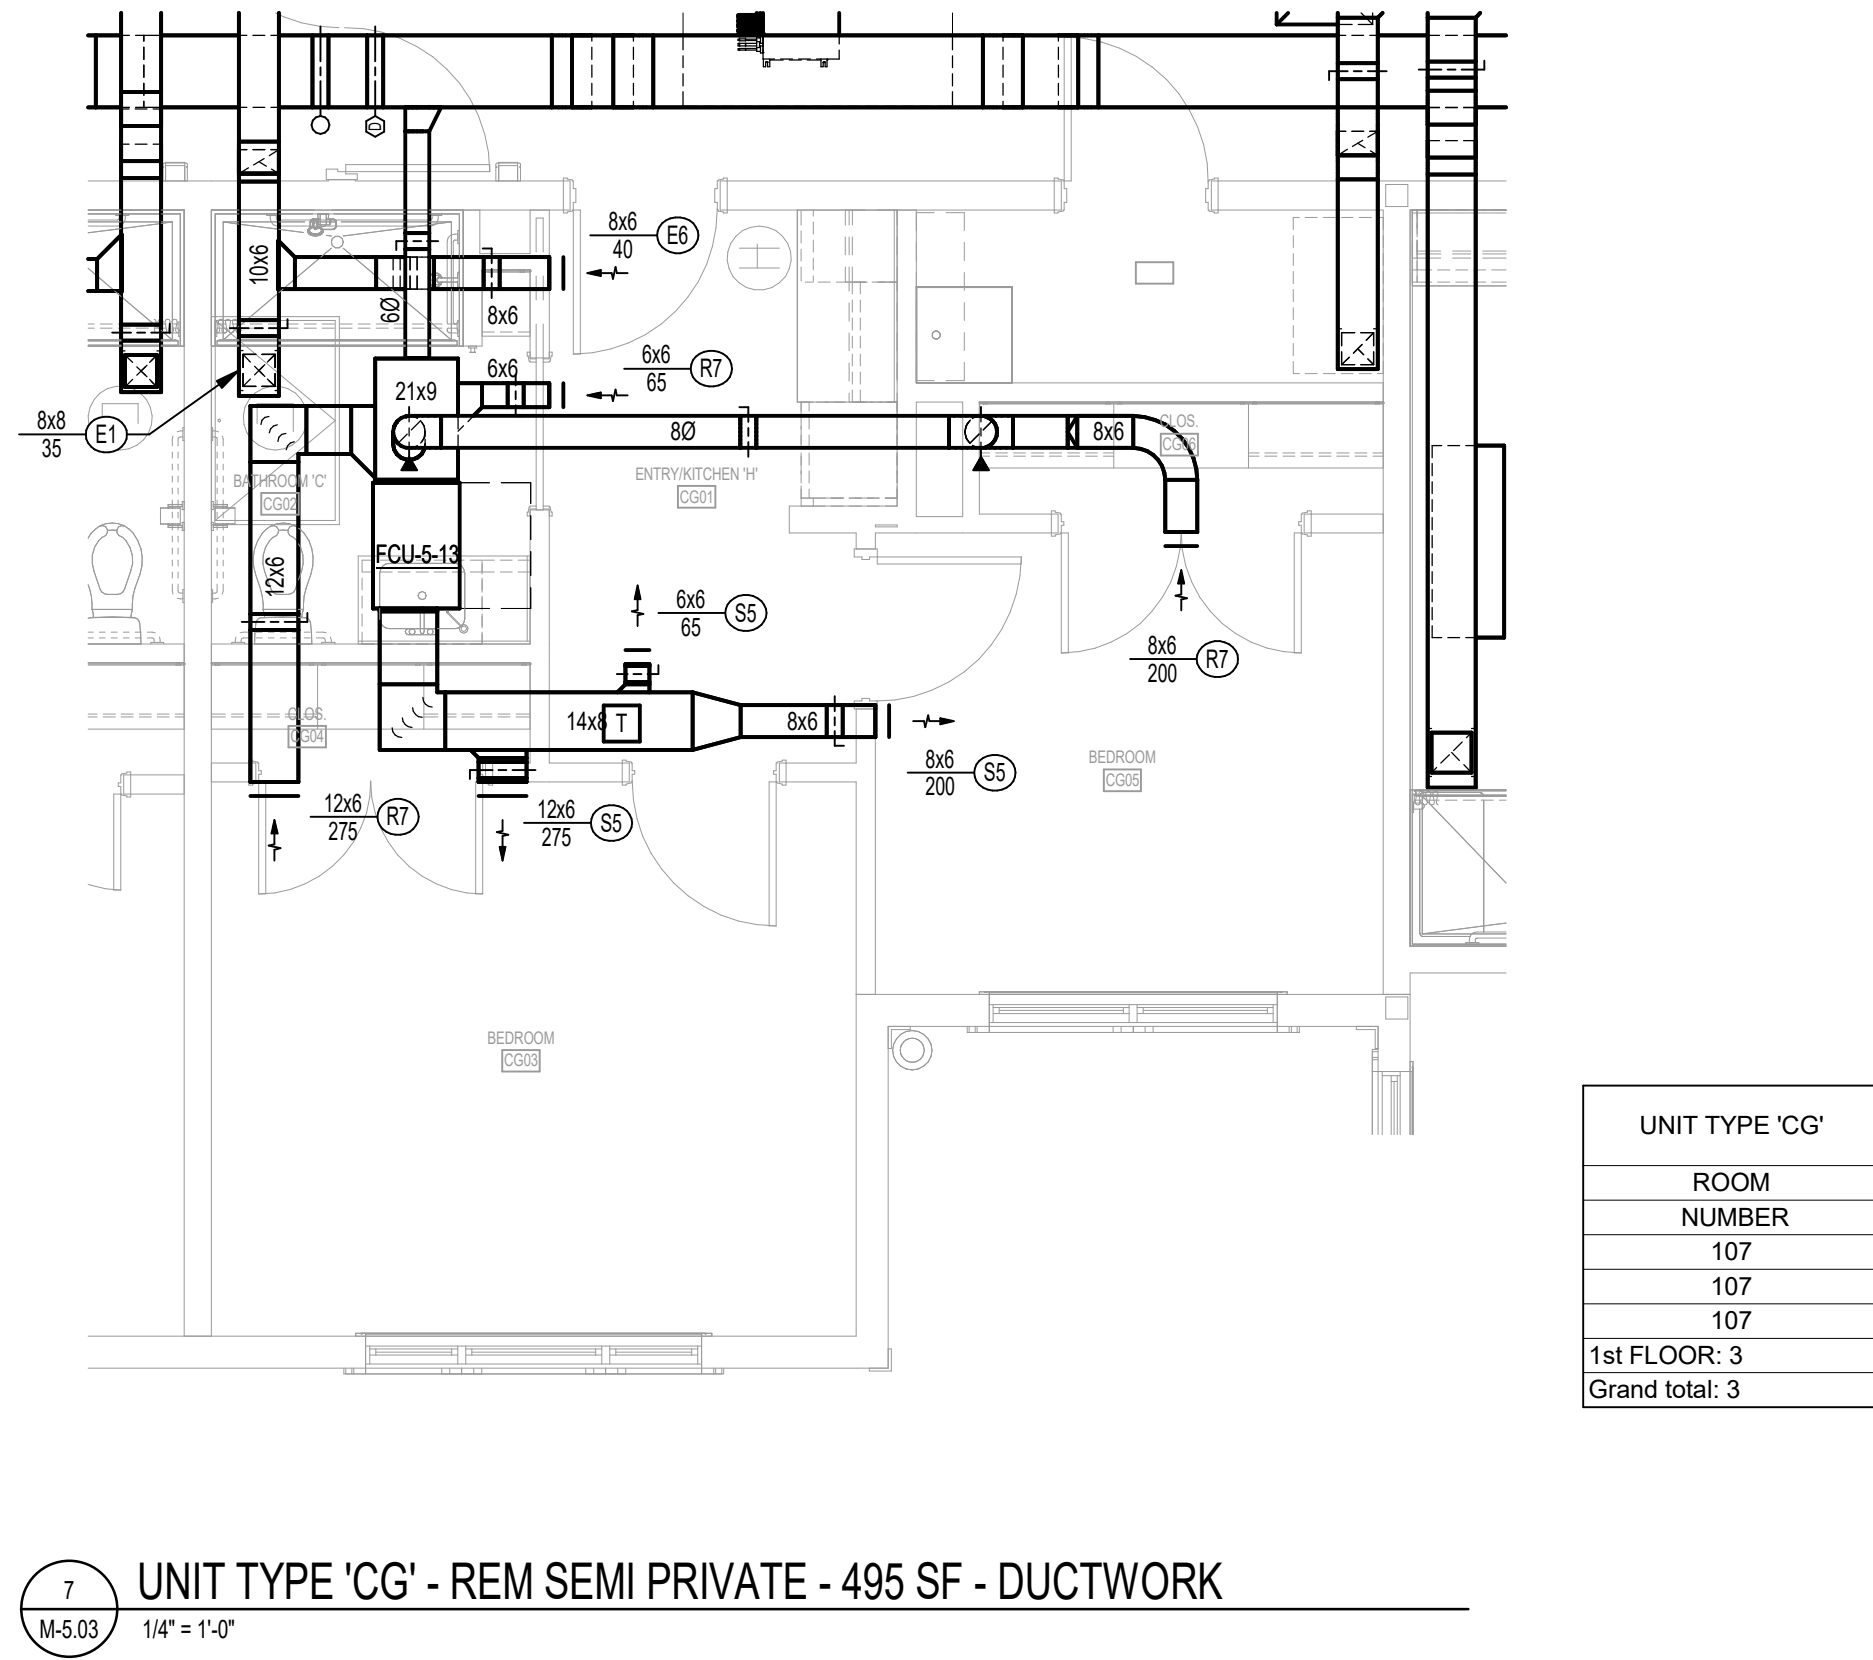


7 UNIT TYPE 'CG' - REM SEMI PRIVATE - 495 SF - DUCTWORK
M-5.03 1/4" = 1'-0"

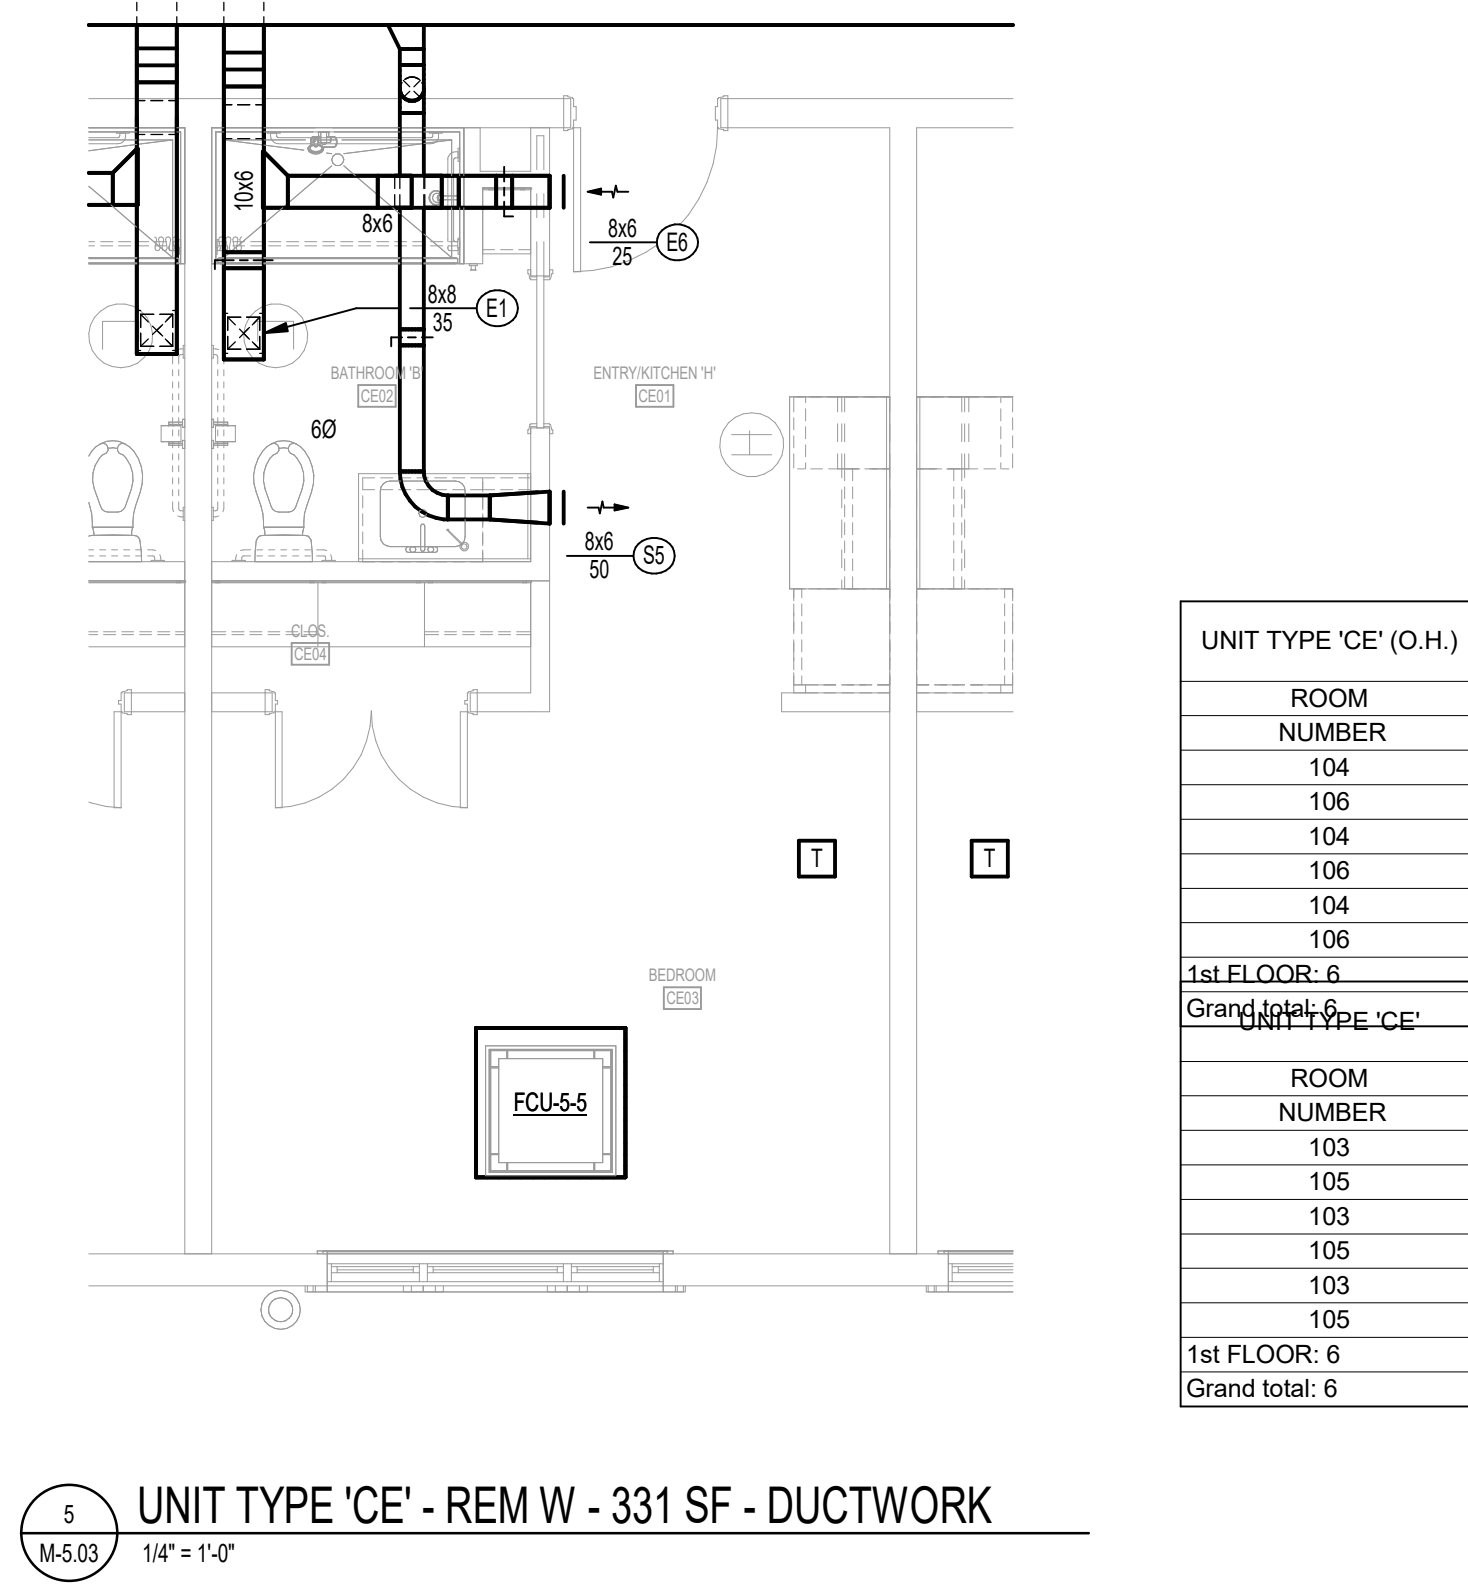


5 UNIT TYPE 'CE' - REM W - 331 SF - DUCTWORK
M-5.03 1/4" = 1'-0"

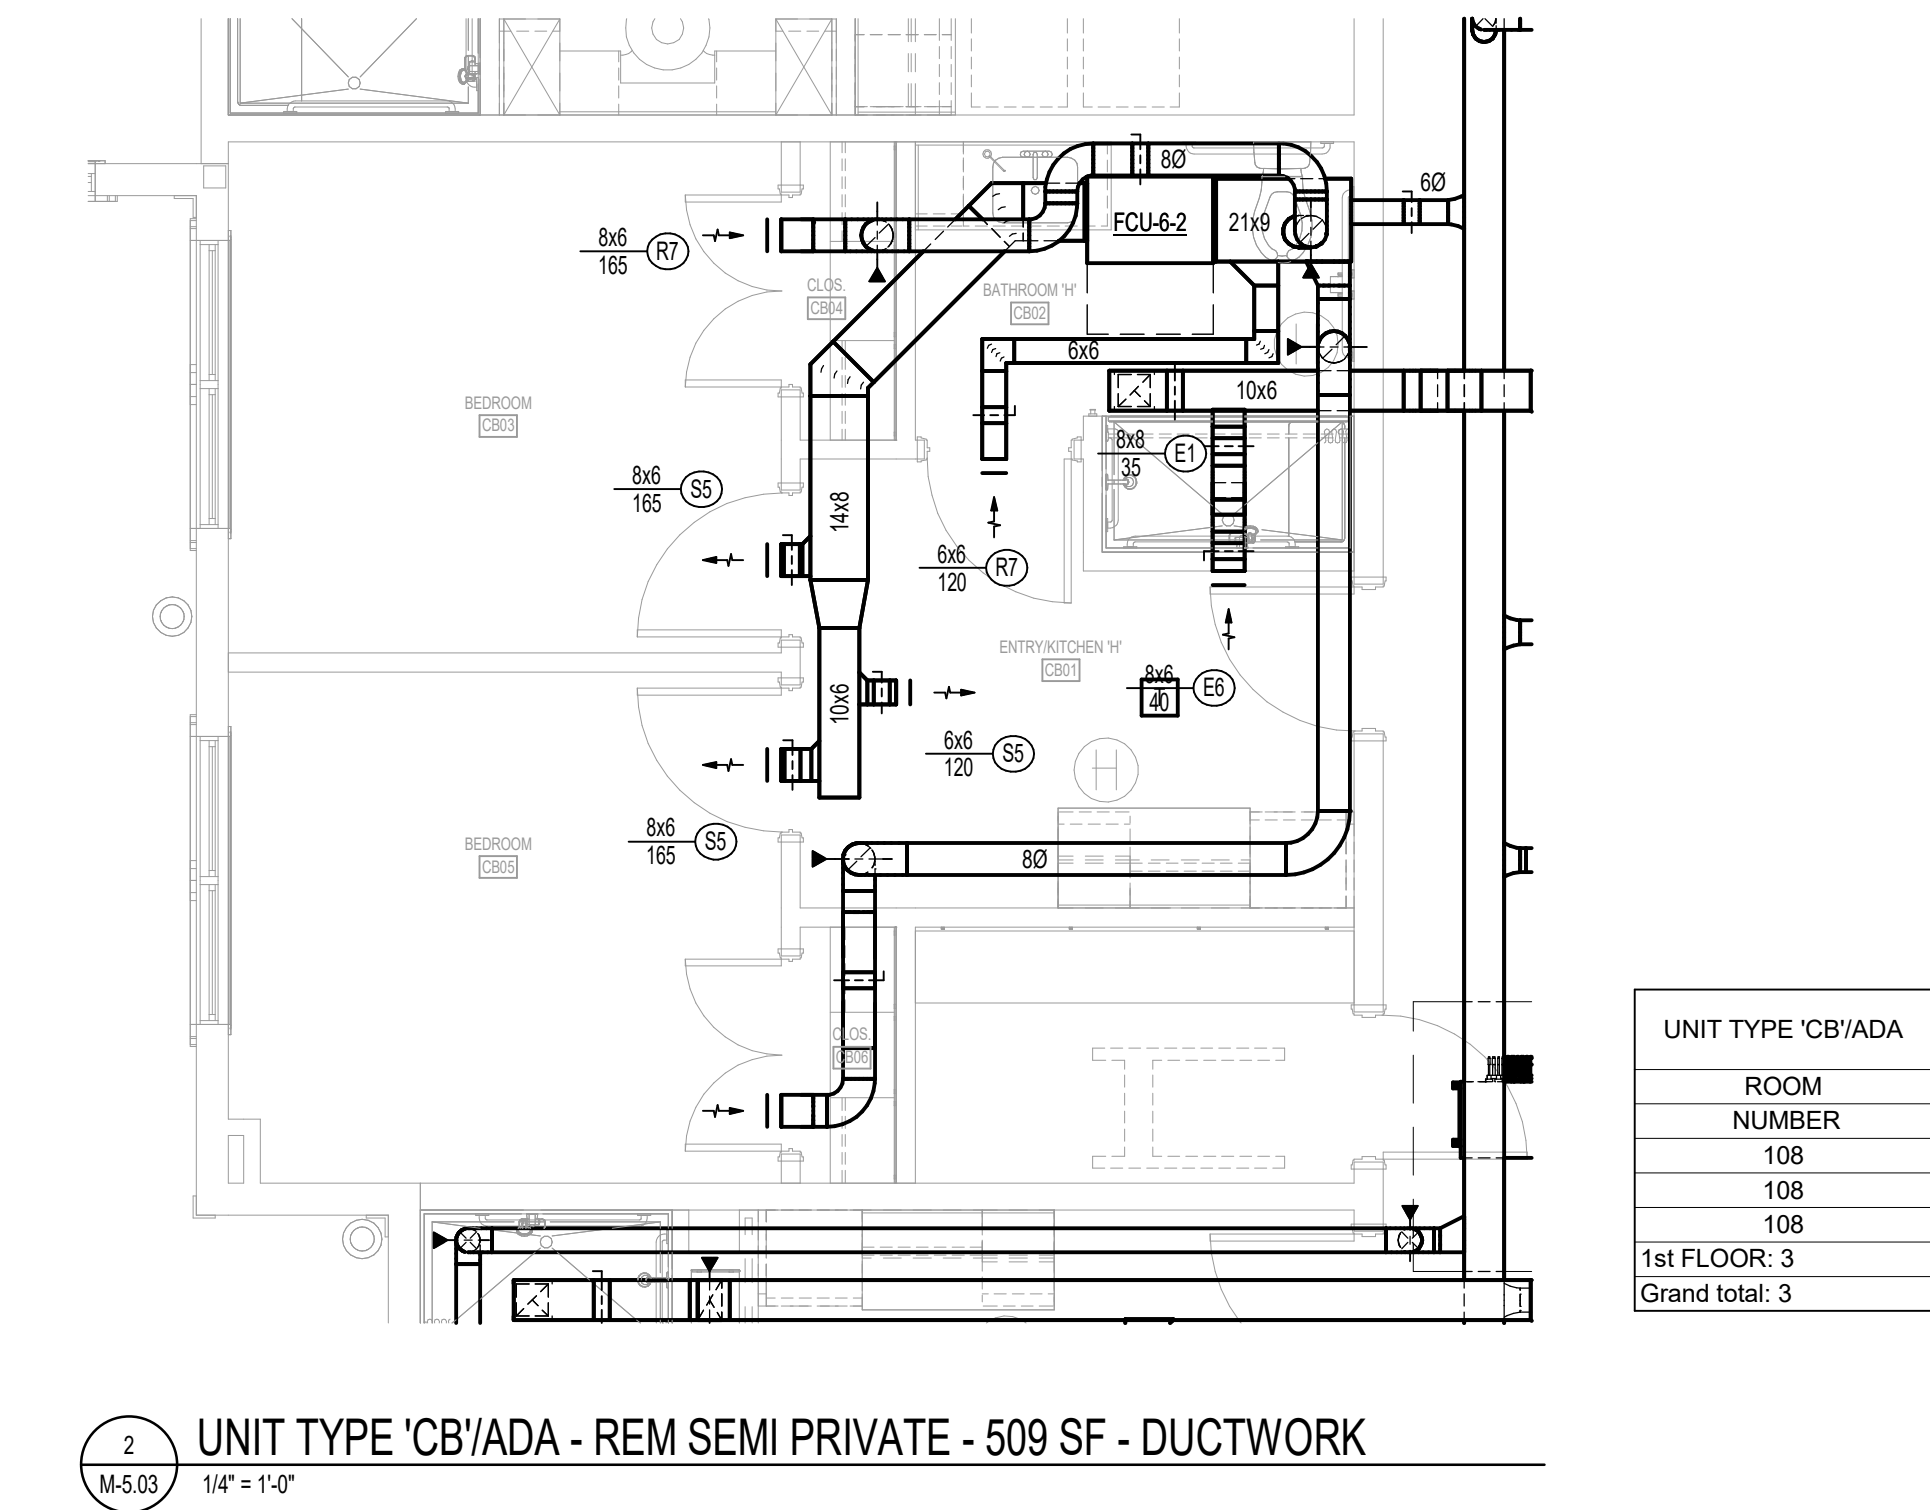


2 UNIT TYPE 'CB/ADA' - REM SEMI PRIVATE - 509 SF - DUCTWORK
M-5.03 1/4" = 1'-0"

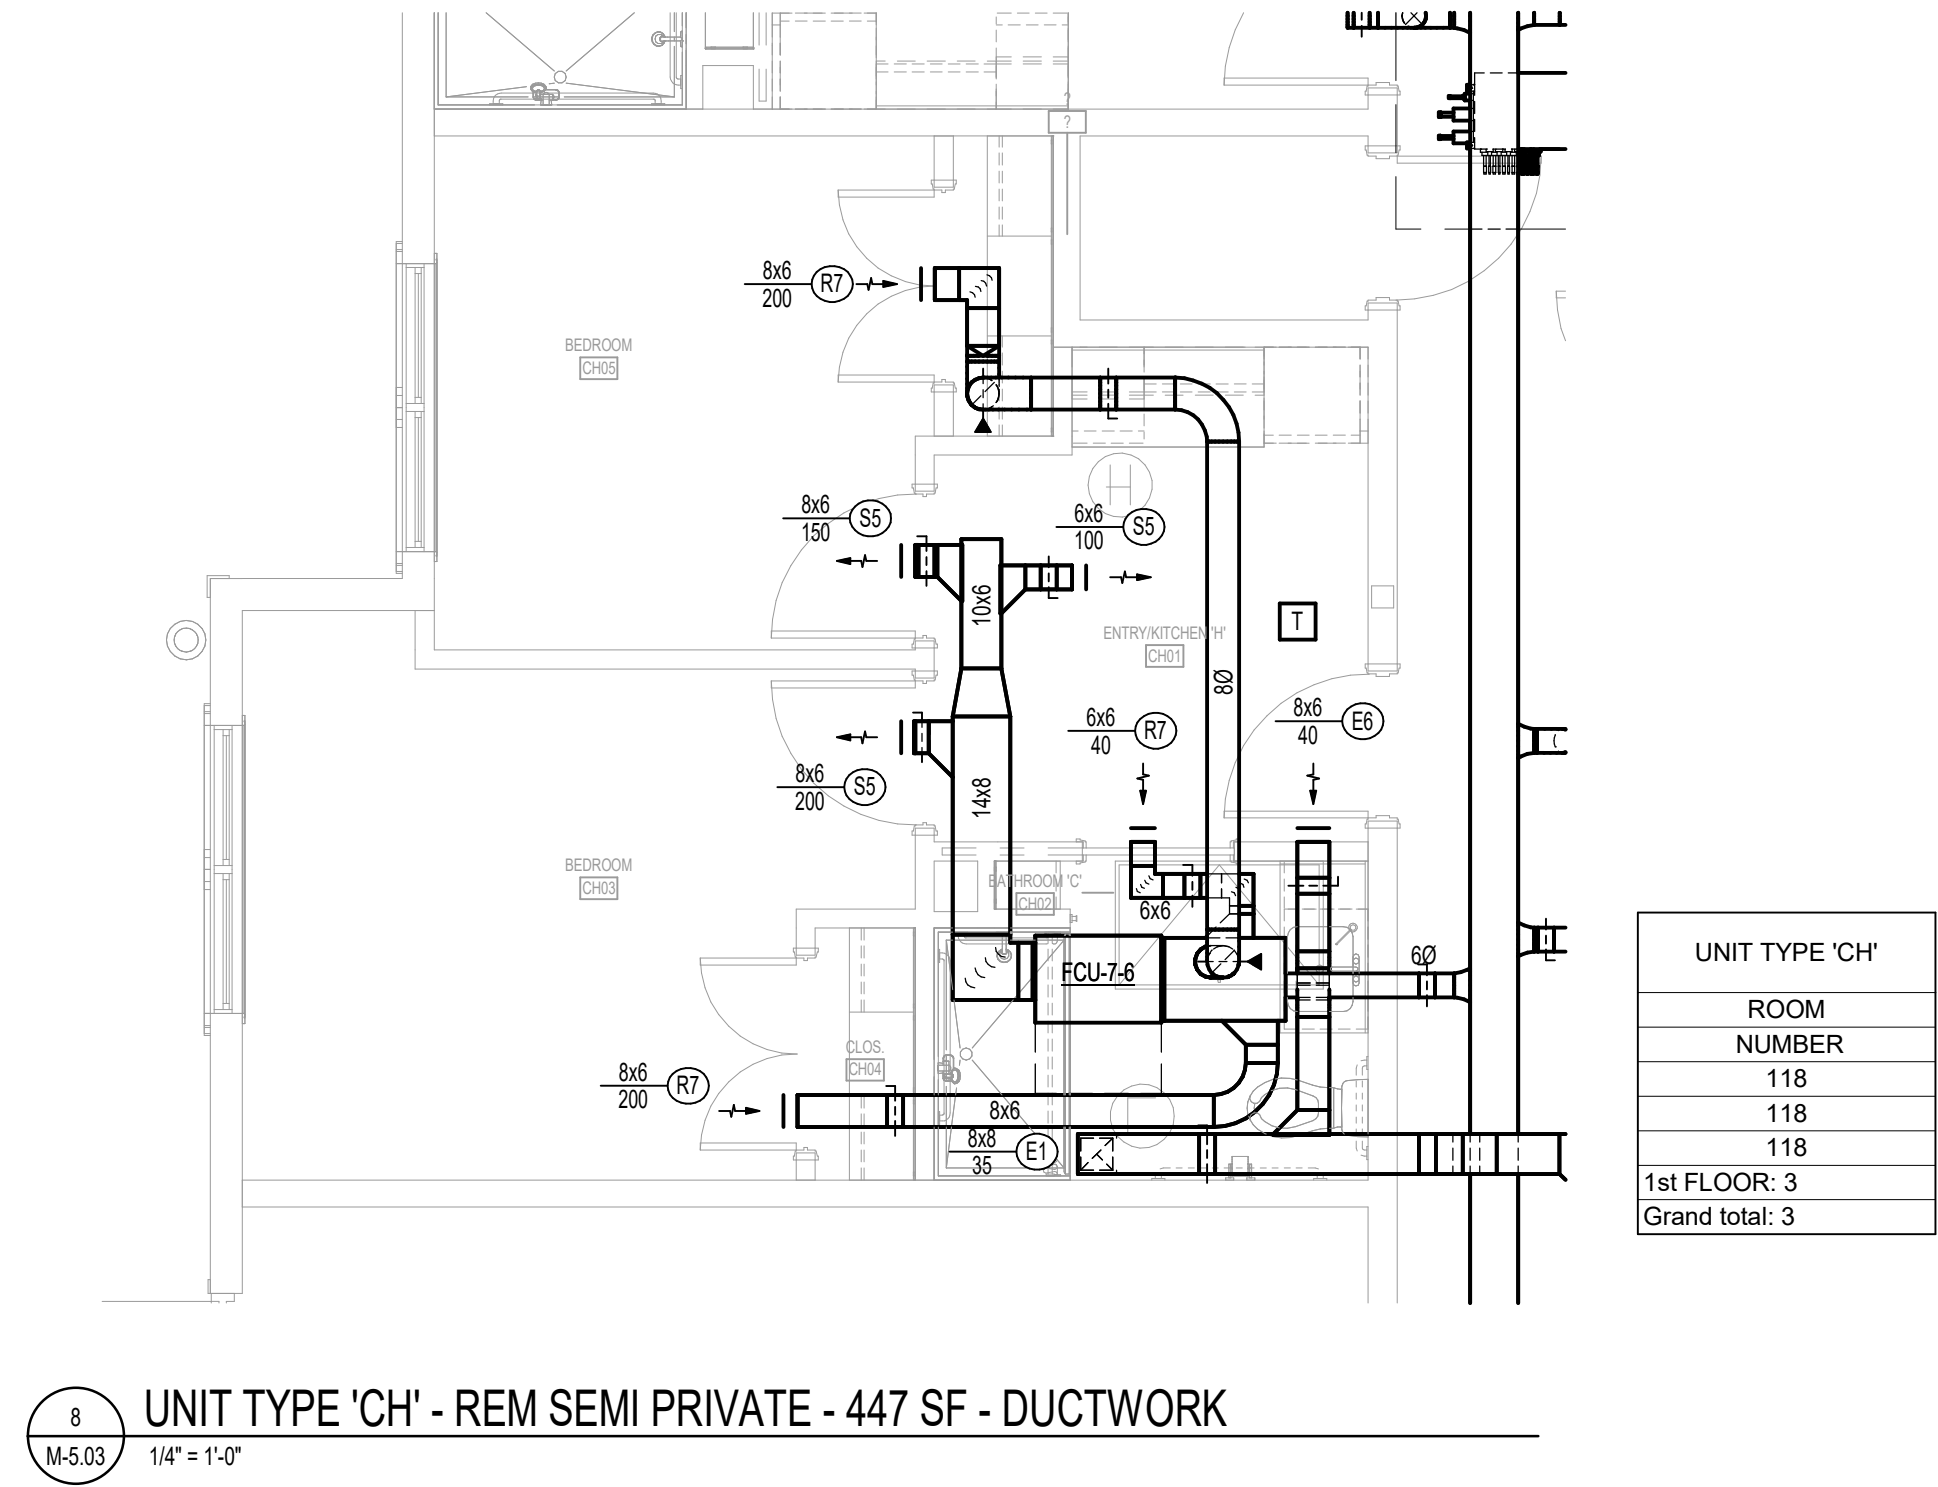


8 UNIT TYPE 'CH' - REM SEMI PRIVATE - 447 SF - DUCTWORK
M-5.03 1/4" = 1'-0"

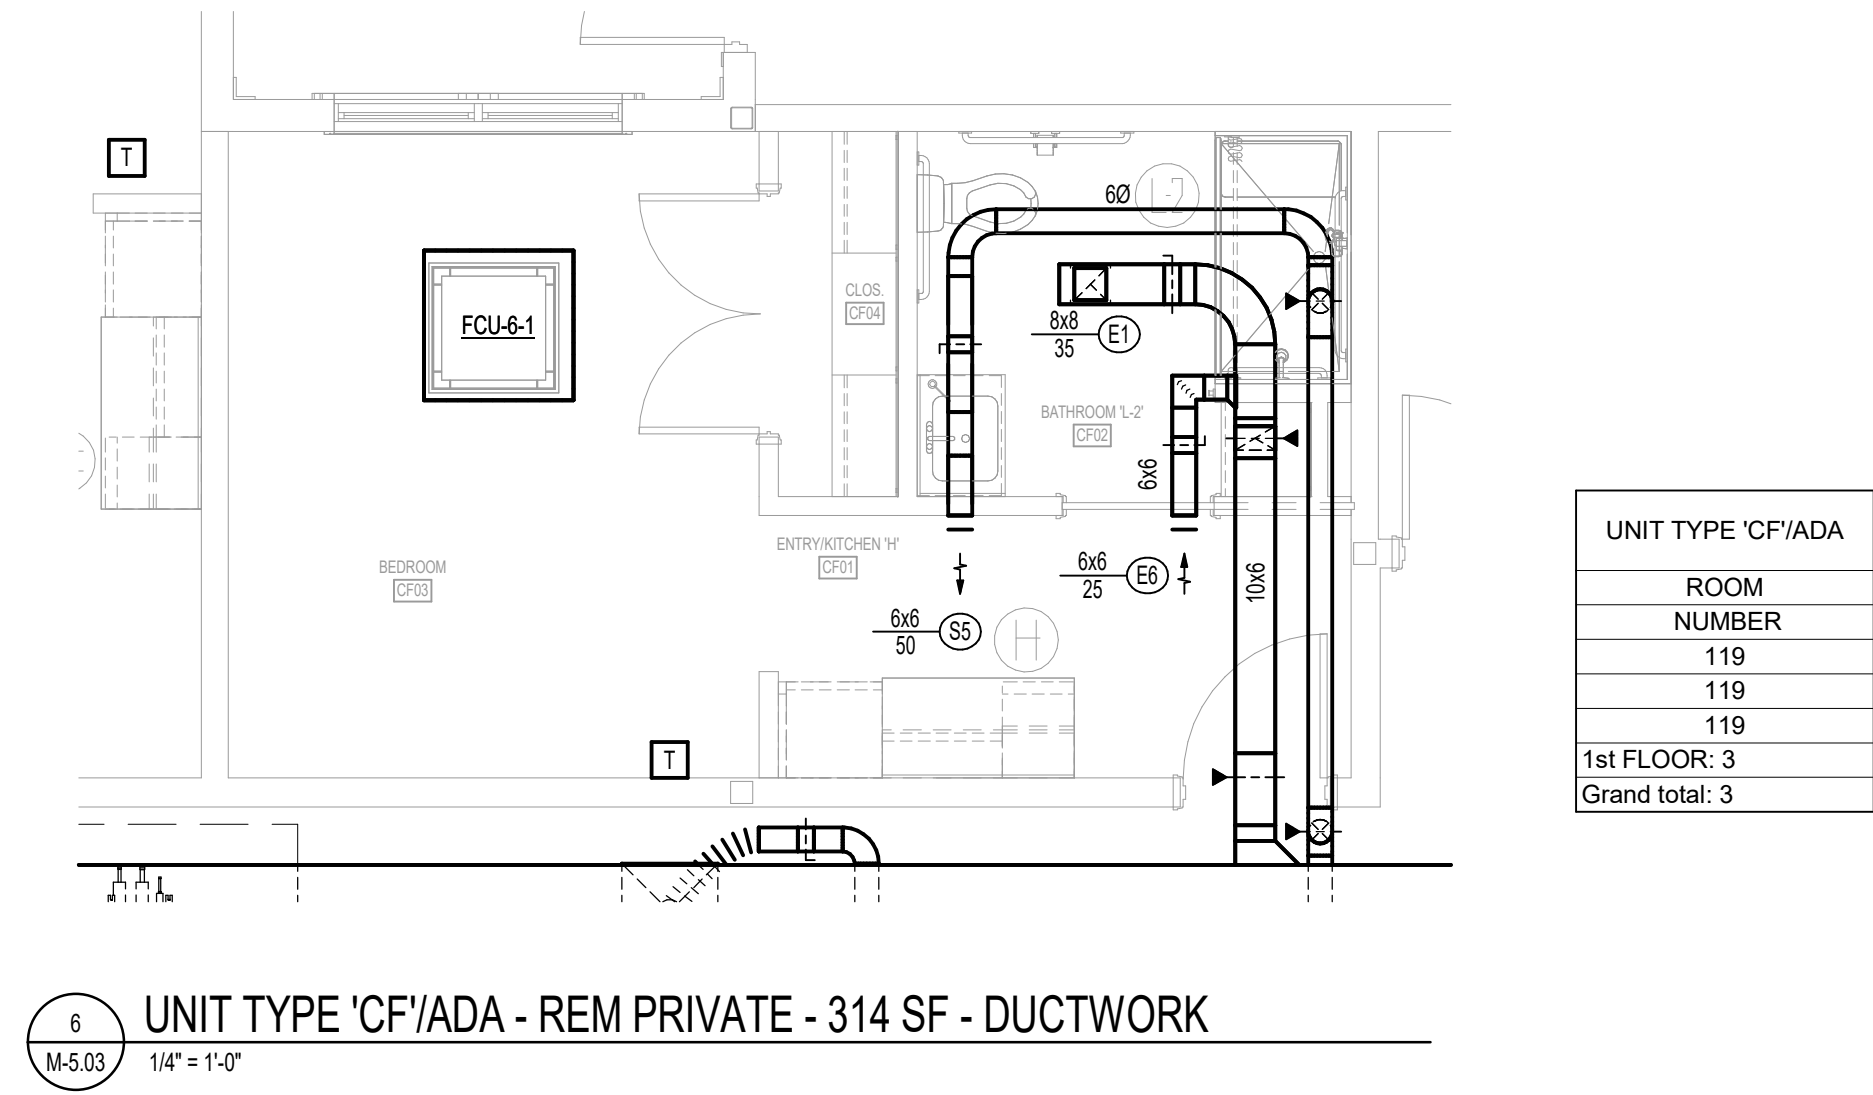

6 UNIT TYPE 'CF/ADA' - REM PRIVATE - 314 SF - DUCTWORK
M-5.03 1/4" = 1'-0"

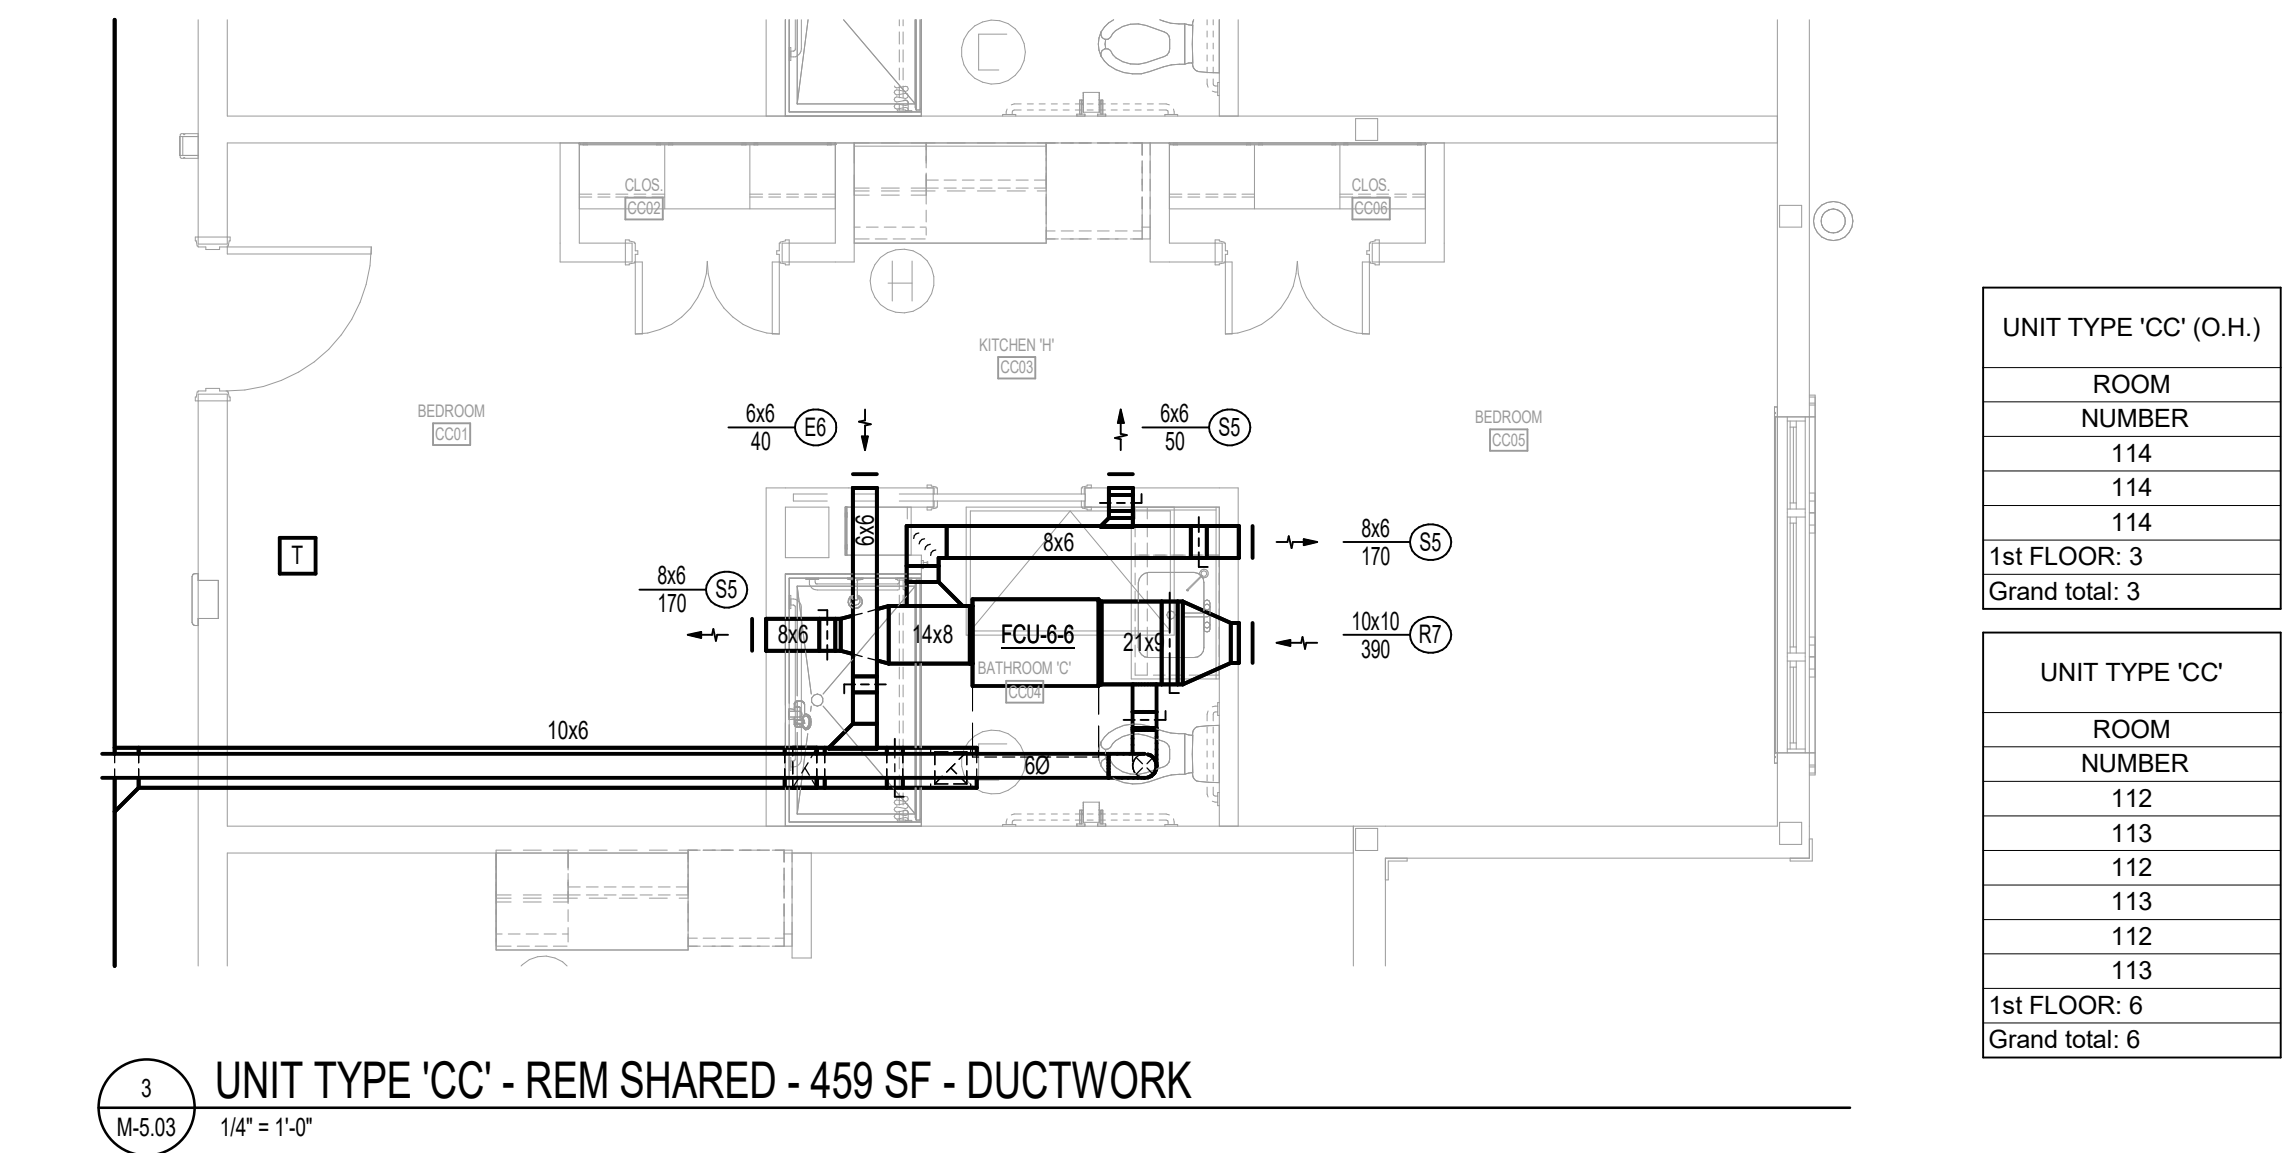

3 UNIT TYPE 'CC' - REM SHARED - 459 SF - DUCTWORK
M-5.03 1/4" = 1'-0"

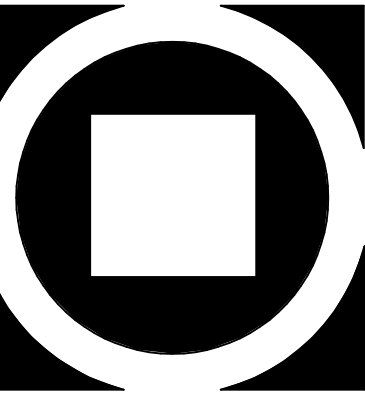

KIMMEL BOGRETTE
Architecture + Site
482 Norristown Rd., Suite 200
Blue Bell PA 19322
Phone 610.834.7865
Fax 610.834.7815
Copyright 2022 KIMMEL BOGRETTE ARCHITECTURE + SITE, INC. ALL RIGHTS RESERVED


CL ENGINEERS, P.C.
232 Howe Street
Jenkintown, PA 19022
610.296.1661
Certificate of Authority # 0000028
Expiration: 7-31-2026

SUNRISE
SENIOR LIVING
Sunrise of Northport
1381-1387 Pulaski Road
Huntington, NY 11731
25-013

ISSUE DATE: 04.10.2026
100% CD
DRAWN BY: DOL
CHECKED BY: MAR
SCALE: AS NOTED

ENLARGED UNIT TYPES C - DUCTWORK

M-5.03

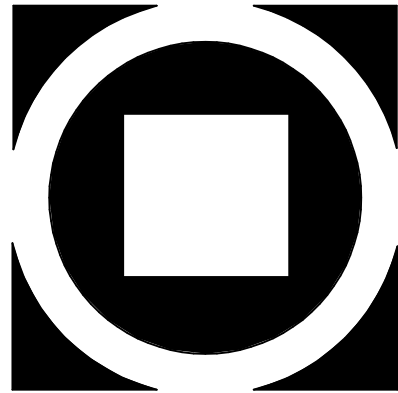

KIMMEL BOGRETTE
Architecture + Site
Blue Bell PA 19322
482 Norristown Rd. Suite 200
Phone 610.634.7865
Copyright 2022 KIMMEL BOGRETTE ARCHITECTURE + SITE, INC. ALL RIGHTS RESERVED


CL ENGINEERS, P.C.
232 Howe Street
Jenkintown, PA 19022
610.296.1661
Certificate of Authority # 0000028
Expiration: 7-31-2026

SUNRISE
SENIOR LIVING
Sunrise of Northport
1381-1387 Pulaski Road
Huntington, NY 11731
25-013

ISSUE DATE:
04.10.2026
100% CD
DRAWN BY: DOL
CHECKED BY: MAR
SCALE: AS NOTED


ENLARGED UNIT TYPES D - DUCTWORK

M-5.04

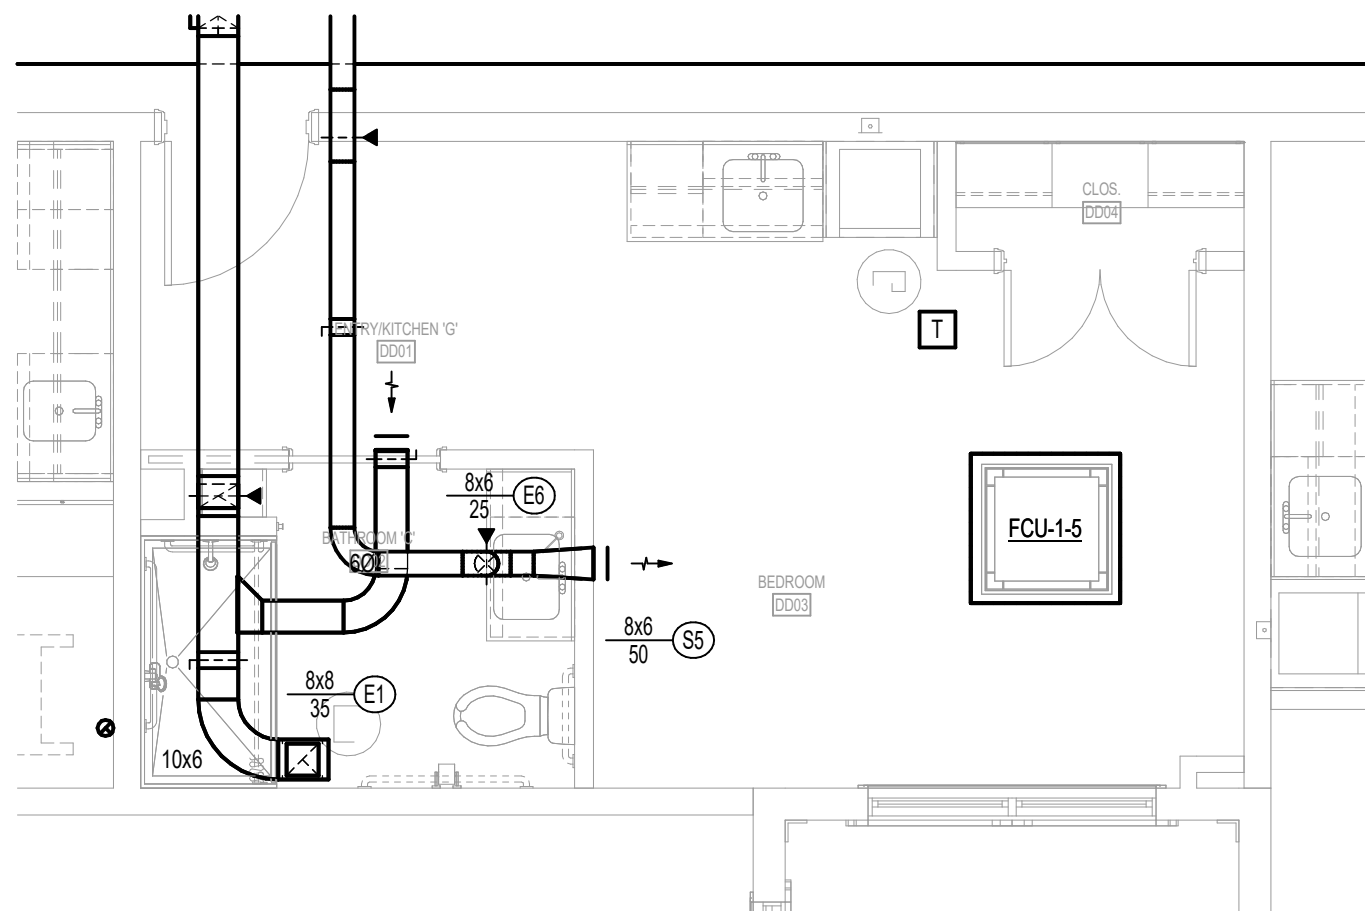


UNIT TYPE 'DD' (O.H.)	
ROOM	NUMBER
231	231
231	231
2nd FLOOR: 3	
Grand total: 3	
UNIT TYPE 'DD'	
ROOM	NUMBER
137	137
137	137
1st FLOOR: 3	
218	218
241	241
218	218
241	241
2nd FLOOR: 6	
Grand total: 9	

4 UNIT TYPE 'DD' - STUDIO SW - 310 SF - DUCTWORK
M-5.04 1/4" = 1'-0"

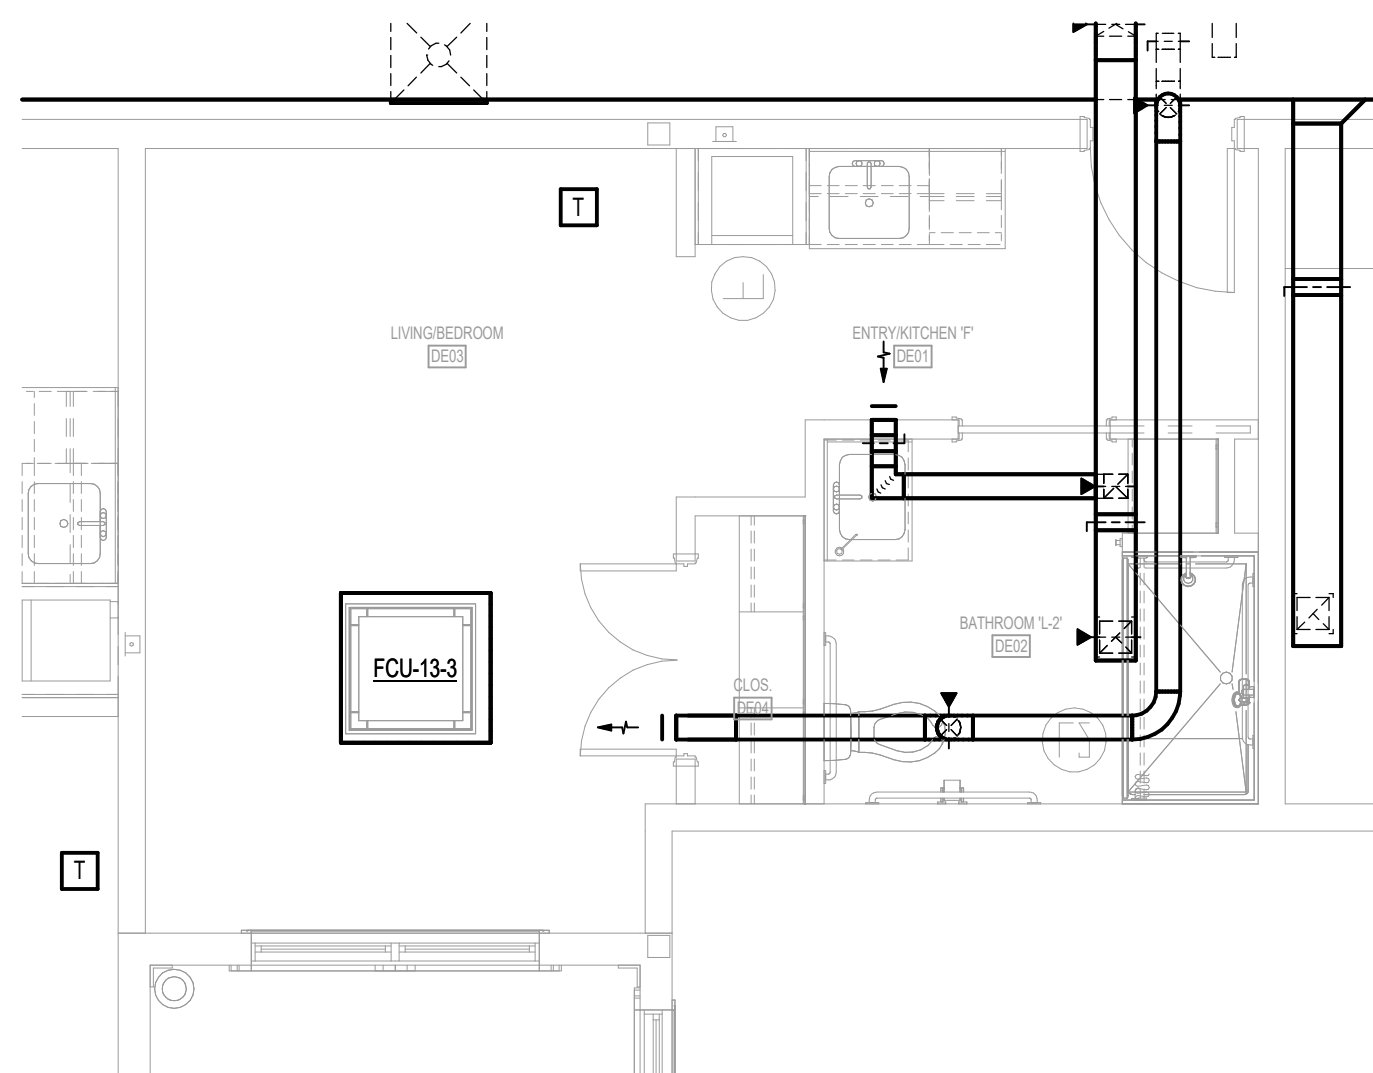


UNIT TYPE 'DE/ADA'	
ROOM	NUMBER
208	208
208	208
2nd FLOOR: 3	
Grand total: 3	

5 UNIT TYPE 'DE/ADA' - STUDIO - 345 SF - DUCTWORK
M-5.04 1/4" = 1'-0"

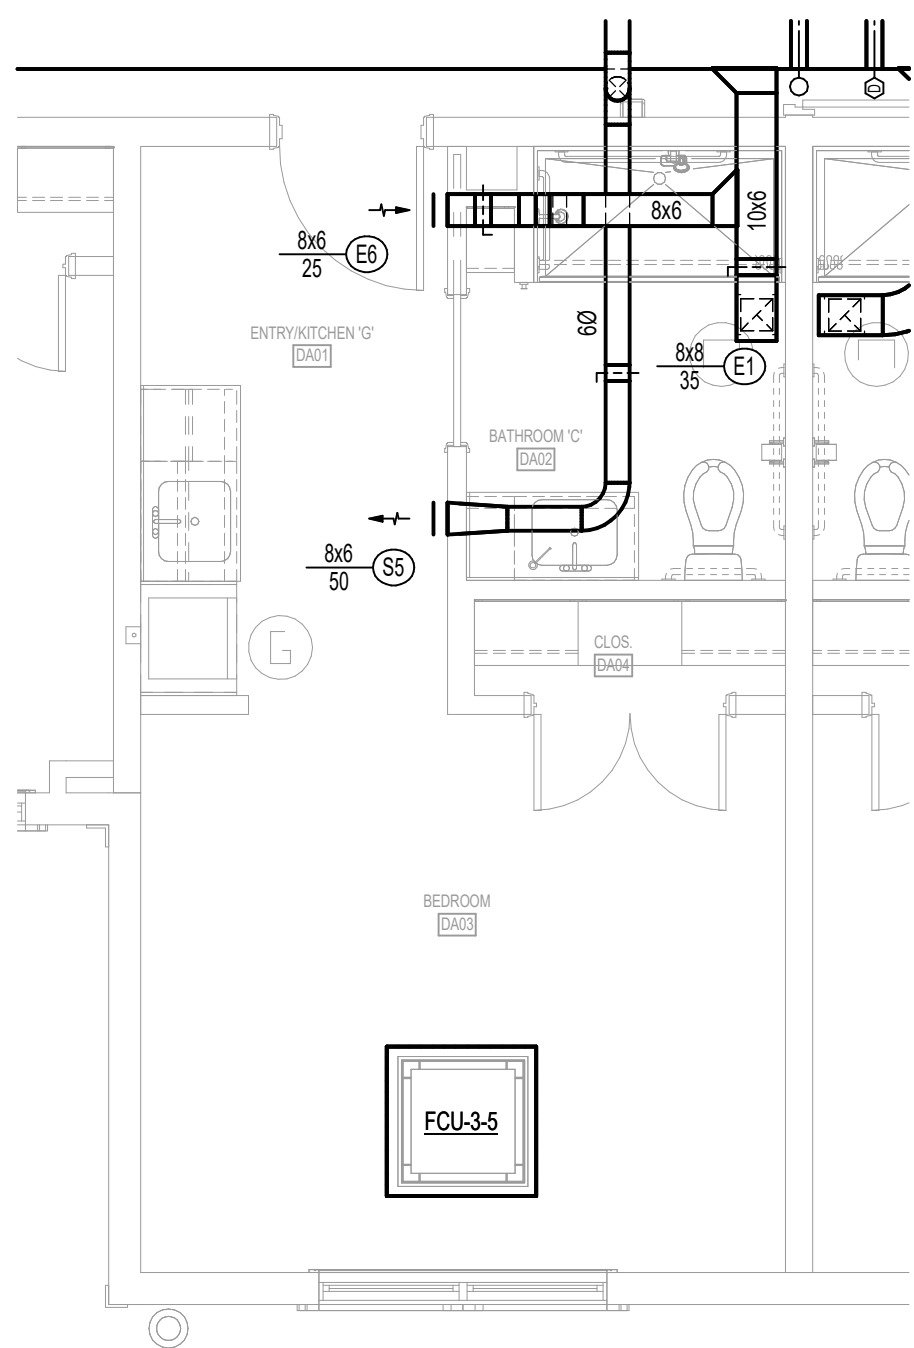


UNIT TYPE 'DA' (O.H.)	
ROOM	NUMBER
139	139
141	141
139	139
141	141
139	139
141	141
1st FLOOR: 6	
207	207
230	230
207	207
230	230
207	207
2nd FLOOR: 6	
Grand total: 12	
UNIT TYPE 'DA'	
ROOM	NUMBER
138	138
140	140
138	138
140	140
138	138
140	140
1st FLOOR: 6	
203	203
219	219
242	242
203	203
219	219
242	242
2nd FLOOR: 9	
Grand total: 15	

1 UNIT TYPE 'DA' - STUDIO - 315 SF - DUCTWORK
M-5.04 1/4" = 1'-0"

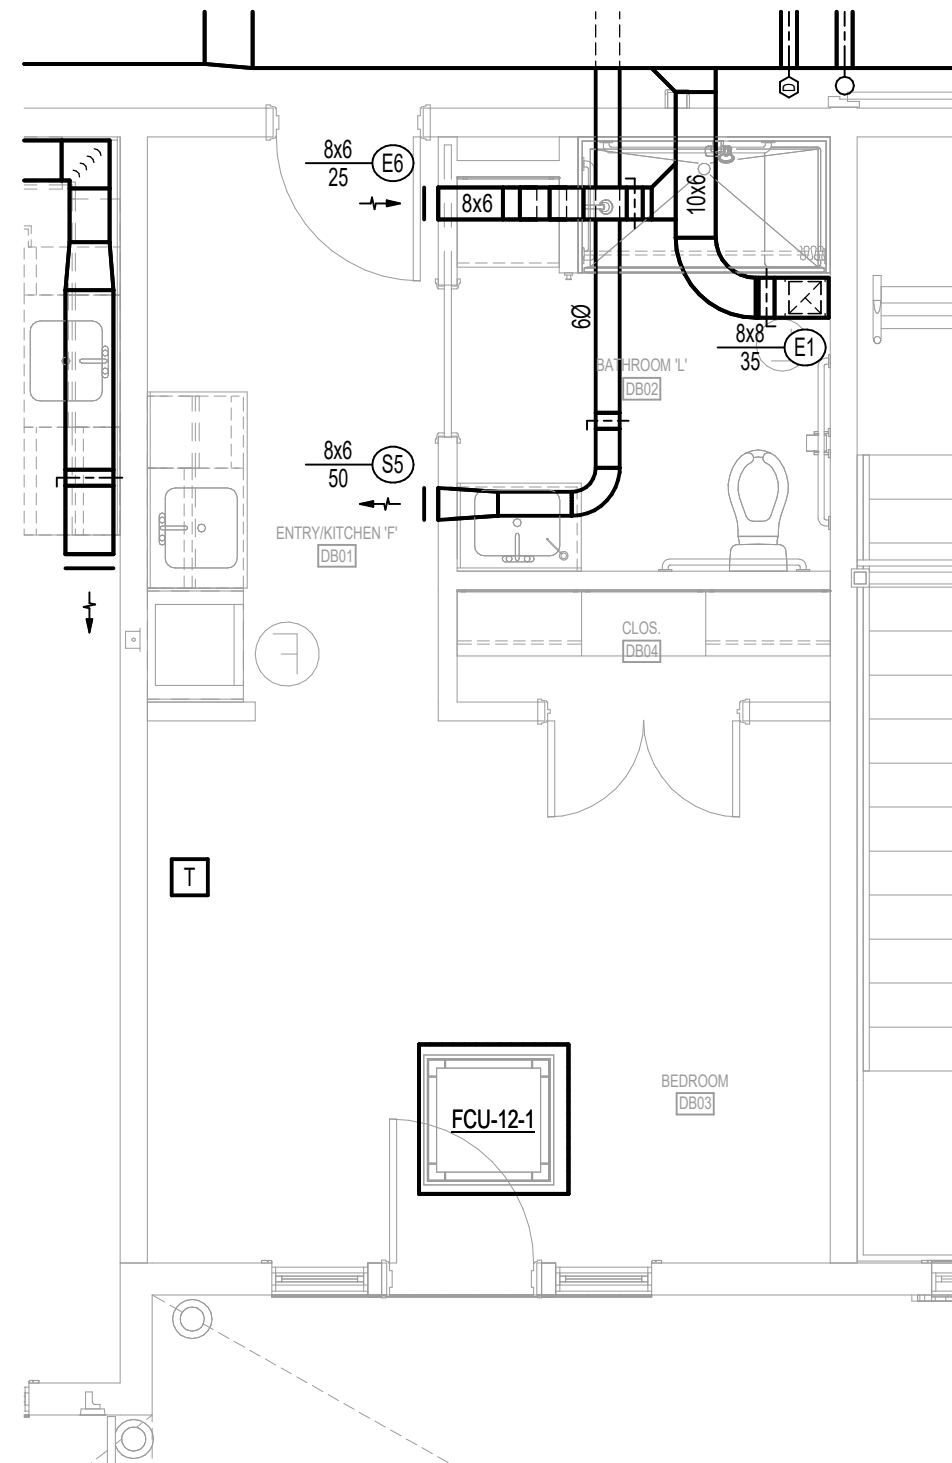

UNIT TYPE 'DB/ADA'	
ROOM	NUMBER
202	202
202	202
2nd FLOOR: 3	
Grand total: 3	

2 UNIT TYPE 'DB/ADA' - STUDIO - 334 SF - DUCTWORK
M-5.04 1/4" = 1'-0"

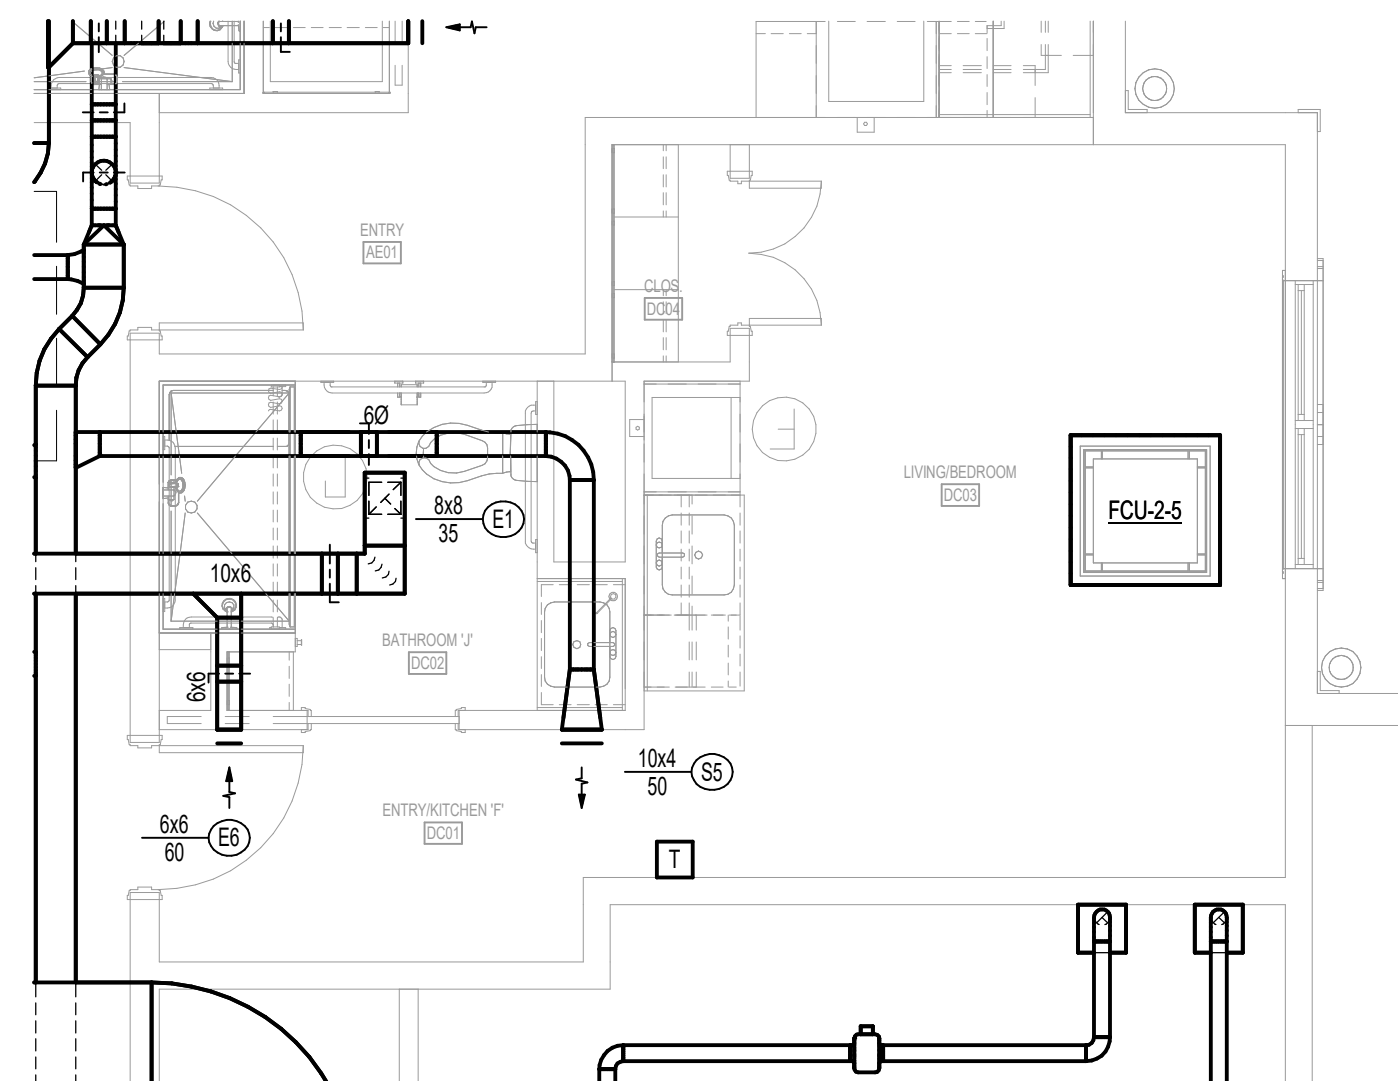

UNIT TYPE 'DC/ADA'	
ROOM	NUMBER
128	128
128	128
1st FLOOR: 3	
Grand total: 3	

3 UNIT TYPE 'DC/ADA' - STUDIO - 355 SF - DUCTWORK
M-5.04 1/4" = 1'-0"

ENERGY RECOVERY UNIT SCHEDULE																																								
MARK	UNIT FAN DATA										ENERGY RECOVERY HEAT EXCHANGER DATA										GAS HEATING PERFORMANCE				DX COOLING PERFORMANCE				ELECTRICAL DATA				UNIT DATA		FILTER BANK		REMARKS			
	SA AIRFLOW (CFM)	SA ESP (IN)	SA MOTOR HP	SA FAN RPM	SA FAN DRIVE	EA AIRFLOW (CFM)	EA ESP (IN)	EA MOTOR HP	EA FAN RPM	EA FAN DRIVE	SUMMER PERFORMANCE					WINTER PERFORMANCE					MBH				EAT °F				LAT °F				APPROX. WEIGHT (LBS)	TYPE	INITIAL	DIRTY				
											OA EAT °F (DBWB)	SA LAT °F (DBWB)	RA EAT °F (DBWB)	EA LAT °F (DBWB)	OA EAT °F (DBWB)	SA LAT °F (DBWB)	RA EAT °F (DBWB)	EA LAT °F (DBWB)	INPUT	OUTPUT	EAT °F	LAT °F	(DBWB)	(DBWB)	AMB °F	TOTAL	SENS	REFRIG	VOLTAGE	MCA	MOP	MCA						MOP	BASIS OF DESIGN MANU.	BASIS OF DESIGN MODEL NO.
ERU-1	5,500	1.5	7.5	1900	DIRECT	6161	1.5	10	1814	DIRECT	9578	8168	7593	8873	0/-1	4544	7058	2422	400	324	41	96	8268	5151	95	276	181	R454B	208/360	117	125	57	70	ADDISON	PROA 240 D4	6,000	2" MERV 8 PRE + 4" MERV 13 + 4" CARBON	0.2	0.5	SEE NOTES
ERU-2	4,700	1.5	5	2145	DIRECT	6424	1.5	10	3581	DIRECT	9578	8067	7593	8772	0/-1	5248	7058	2827	300	243	46	94	8067	4847	95	281	165	R454B	208/360	117	125	44	50	ADDISON	PROA 240 D4	6,000	2" MERV 8 PRE + 4" MERV 13 + 4" CARBON	0.2	0.5	SEE NOTES

NOTES:

1. THE MANUFACTURER BASIS OF DESIGN IS ADDISON. ANY DEVIATION FROM WHAT IS SCHEDULED AND SPECIFIED, EVEN THOUGH THE MANUFACTURER IS LISTED IN THE SPECIFICATION AS AN EQUIVALENT MANUFACTURER, SHALL BE THIS CONTRACTOR'S RESPONSIBILITY FOR COORDINATION, ADDITIONAL WORK AND CONTROLS FOR THIS OR OTHER TRADES AT NO ADDITIONAL COST TO THE PROJECT.
2. HEATING CAPACITY BASED ON 0 DEG F AMBIENT OA TEMPERATURE.
3. COOLING CAPACITY BASED ON 82 DEG F DB/ 72.05 F WB AMBIENT OA TEMPERATURE.
4. UNITS TO HAVE SIDE SUPPLY & EXHAUST DUCT CONNECTIONS.
5. UNITS TO HAVE TWO (2) POWER CONNECTIONS, ONE (1) FOR EMERGENCY OPERATION (HEATING) & ONE (1) FOR NORMAL OPERATION (COOLING). PROVIDE FUSED DISCONNECTS FOR EACH.
6. UNITS TO BE SET ON VIBRATION ISOLATION ROOF CURBS.
7. GAS FURNACE CONTROL SHALL BE 10:1 FULLY MODULATING.
8. UNITS TO HAVE 2" MERV 8 PRE-FILTER + 4" MERV 13 FILTER + 4" CARBON FILTER INSTALLED IN FILTER RACKS PER LEED REQUIREMENTS.
9. REHEAT PROVIDED FOR ROOM/NEUTRAL SUPPLY AIR CONDITIONS (72 DEG F DB @ 50% RH) AT ALL TIMES.
10. UNITS TO HAVE UV LIGHTS ON THE COOLING COILS.

MAKE-UP AIR ROOFTOP UNIT SCHEDULE																																				REMARKS			
MARK	UNIT CFM	OA CFM	OA %	SUPPLY FAN DATA				UNIT ELECTRICAL DATA				GAS HEAT DATA				DX COOLING UNIT								REHEAT DATA						FILTER BANK 1		UNIT WEIGHT (LBS)	BASIS OF DESIGN						
				ESP	BHP	HP	DRIVE	MCA	MOP	PH	HZ	V	GAS TYPE	INPUT BTUS	OUTPUT BTUS	TEMP RISE (°F)	REQUIRED INPUT GAS PRESSURE	OUTSIDE AIR (°F)		MIXED AIR (°F)		LEAVING AIR (COIL) (°F)		CAPACITY		IEER	ISMRE2	DISCHARGE (°F)		CAPACITY				MOISTURE REMOVAL RATE LBS/HR	TYPE		STATIC PRESS		
																		DB	WB	DB	WB	DB	WB	DB	WB			TOTAL MBH	SENS. MBH	DB	WB						DESIRED MBH	MAX MBH	INITIAL
MAU-1	2,700	2,700	-	1.0	1.5	3.0	-	64.9	70	3	60	208	NATURAL	277727	224959	70	7 IN W.C. - 14 IN W.C.	84.3	76.7	84.3	76.7	54.6	54.6	54.6	204.4	87.3	18.8	8.3	70.0	60.5	46.4	129.6	103.7	MERV-13	-	-	3000	CAPTIVEAIRE	SEE NOTES

NOTES:

1. THE MANUFACTURER BASIS OF DESIGN IS CAPTIVEAIRE. ANY DEVIATION FROM WHAT IS SCHEDULED AND SPECIFIED, EVEN THOUGH THE MANUFACTURER IS LISTED IN THE SPECIFICATION AS AN EQUIVALENT MANUFACTURER, SHALL BE THIS CONTRACTOR'S RESPONSIBILITY FOR COORDINATION, ADDITIONAL WORK AND CONTROLS FOR THIS OR OTHER TRADES AT NO ADDITIONAL COST TO THE PROJECT.
2. UNIT TO BE FURNISHED WITH CONTROL PANEL FOR CONTROL OF ALL KITCHEN VENTILATION, INCLUDING HOOD EXHAUST FANS, AS WELL AS KITCHEN TEMPERATURE CONTROL. CONTROLS TO INCLUDE (1) UNOCCUPIED MODE (NO HOODS RUNNING), (2) HOOD A ON, HOOD B OFF, (3) HOOD A OFF, HOOD B ON, AND (4) BOTH HOODS ON.
3. SMOKE DETECTOR TO BE PROVIDED WITH UNIT AND INCLUDE SHUT-DOWN CONTROLS UPON ALARM.
4. UNIT TO HAVE MERV 13 & CARBON FILTERS PER LEED REQUIREMENTS.
5. UNIT TO BE SET ON VIBRATION ISOLATION ROOF CURB.
6. UNIT TO HAVE UV LIGHTS ON THE COOLING COILS.

SPLIT SYSTEM SCHEDULE																																			
MARK		SERVES	INDOOR UNIT DATA										OUTDOOR UNIT DATA						SEER	MCA	MOP	ELECTRICAL DATA			REFRIG	BASIS OF DESIGN	REMARKS								
INDOOR UNIT	OUTDOOR UNIT		CFM			EAT (F)		MAX COOL (MBH)	MOUNTING	WEIGHT (LBS)	CFM	NOM COOL (MBH)	MAX SOUND (dB)	WEIGHT (LBS)	V	PH	HZ																		
			NOM CFM	HIGH	LOW	DB	WB																												
SSAC-1	SSRCU-1	MDF A124	705	775	635	80	67	24	WALL	50	1,940	24	47	200	21.3	19	26	208	1	60	R32	DAIKIN RKF24 & FTKF24	SEE NOTES												
SSAC-2	SSRCU-2	IDF B134	705	775	635	80	67	24	WALL	50	1,940	24	47	200	21.3	19	26	208	1	60	R32	DAIKIN RKF24 & FTKF24	SEE NOTES												

NOTES:

1. THE MANUFACTURER BASIS OF DESIGN IS MITSUBISHI. ANY DEVIATION FROM WHAT IS SCHEDULED AND SPECIFIED, EVEN THOUGH THE MANUFACTURER IS LISTED IN THE SPECIFICATION AS AN EQUIVALENT MANUFACTURER, SHALL BE THIS CONTRACTOR'S RESPONSIBILITY FOR COORDINATION, ADDITIONAL WORK AND CONTROLS FOR THIS OR OTHER TRADES AT NO ADDITIONAL COST TO THE PROJECT.
2. COOLING CAPACITIES BASED ON 95 DEG F AMBIENT TEMPERATURE.
3. ROOF MOUNTED CONDENSING UNITS SHALL BE BOLTED TO EQUIPMENT RAILS OF A LENGTH REQUIRED TO MAKE UNIT STABLE.
4. INDOOR UNITS SHALL BE FURNISHED WITH INTEGRAL CONDENSATE PUMP OR LEFT MECHANISM.
5. UNITS SHALL HAVE LOW AMBIENT CONTROL FOR COOLING TO A MINIMUM OF 0 DEG F AMBIENT TEMPERATURE.
6. POWER SHALL BE RUN TO THE OUTDOOR UNIT BY THE EC AND THE HC SHALL PROVIDE THE POWER & INTERLOCK WIRING BETWEEN THE INDOOR & OUTDOOR UNITS.
7. ALL UNITS SHALL BE R32 COMPLIANT.

EXHAUST FAN SCHEDULE																						
MARK	TYPE		SERVES	ROOF OPENING (IN)	CFM	FAN RPM	MOTOR RPM	ESP (IN WG)	TIP SPEED (FFM)	DRIVE	BHP	HP	ELECTRICAL DATA			CONTROL	BASIS OF DESIGN			REMARKS		
													V	PH	HZ							
EF-1	CENTRIFUGAL ROOF		SALON	14.5 x 14.5	400	1198	1198	0.5	-	DIRECT	0.07	0.25	120	1	60	OCCUNOCC			GREENHECK	SEE NOTES		
KEF-1	CENTRIFUGAL ROOF		KITCHEN	-	800	1426	1426	1	5133	DIRECT	0.298	0.5	120	1	60	HOOD			CAPTIVEAIRE	SEE NOTES		
KEF-2	CENTRIFUGAL ROOF		KITCHEN	-	3,329	1367	1367	1.5	6710	DIRECT	1.825	3	208	3	60	HOOD			CAPTIVEAIRE	SEE NOTES		

NOTES:

1. THE MANUFACTURER BASIS OF DESIGN IS GREENHECK. ANY DEVIATION FROM WHAT IS SCHEDULED AND SPECIFIED, EVEN THOUGH THE MANUFACTURER IS LISTED IN THE SPECIFICATION AS AN EQUIVALENT MANUFACTURER, SHALL BE THIS CONTRACTOR'S RESPONSIBILITY FOR COORDINATION, ADDITIONAL WORK AND CONTROLS FOR THIS OR OTHER TRADES AT NO ADDITIONAL COST TO THE PROJECT.
2. ALL DIRECT DRIVE EXHAUST FANS SHALL BE PROVIDED WITH SPEED CONTROLLER OR ECM MOTORS TO BALANCE FANS TO SYSTEM CFM.

ROOFTOP UNIT SCHEDULE (GAS & DX)																													
MARK	CFM	OA CFM	SUPPLY FAN DATA				HEATING PERFORMANCE										DX COOLING PERFORMANCE										BASIS OF DESIGN	REMARKS	
							MBH		EAT (°F)	LAT (°F)	DB (°F)	WB (°F)	LAT (°F)	WB (°F)	AMB (°F)	MBH		REFRIG	MINIMUM EFFICIENCY (ARI)	V	PH	HZ	MCA	MOP	MCA	MOP			
			INPUT	OUTPUT	TOTAL	SENS																							
			RTU-1	1,610	480	1.25	2	1.05	120	97	49	104.8	81	66.3	57.5	54.5	95	61.8	44.5		R-454B	12.5	208	3	60	32.9			45
RTU-2	3,100	920	1.1	3	2.13	240	194	46	106.9	81	66.3	55.2	53.5	95	120.3	86.3		R-454B	12.2	208	3	60	51.2	60	22	35	JCI	SEE NOTES	
RTU-3	3,050	915	1.35	3	2.31	190	146	49	93.3	81	66.3	55	53.3	95	120	85.7		R-454B	12.2	208	3	60	51.2	60	22	35	JCI	SEE NOTES	
RTU-4	2,650	795	1.35	3	2.14	180	146	49	100	81	66.3	56.2	54.2	95	98	70.9		R-454B	12	208	3	60	42.2	50	22	35	JCI	SEE NOTES	
RTU-5	3,370	1,010	0.9	3	2.28	240	194	49	102.3	81	66.3	53.3	51	95	152.9	101		R-454B	12	208	3	60	66.6	80	22	35	JCI	SEE NOTES	

NOTES:

1. THE MANUFACTURER BASIS OF DESIGN IS JCI. ANY DEVIATION FROM WHAT IS SCHEDULED AND SPECIFIED, EVEN THOUGH THE MANUFACTURER IS LISTED IN THE SPECIFICATION AS AN EQUIVALENT MANUFACTURER, SHALL BE THIS CONTRACTOR'S RESPONSIBILITY FOR COORDINATION, ADDITIONAL WORK AND CONTROLS FOR THIS OR OTHER TRADES AT NO ADDITIONAL COST TO THE PROJECT.
2. UNITS TO HAVE SIDE SUPPLY & RETURN DUCT CONNECTIONS.
3. UNITS TO HAVE TWO (2) POWER CONNECTIONS, ONE (1) FOR EMERGENCY OPERATION (HEATING) & ONE (1) FOR NORMAL OPERATION (COOLING). PROVIDE FUSED DISCONNECTS FOR EACH.
4. UNITS TO BE SET ON VIBRATION ISOLATION ROOF CURBS.
5. GAS FURNACE CONTROL SHALL BE FULLY MODULATING.
6. UNITS TO HAVE 2" MERV 8 PRE-FILTER + 4" MERV 13 FILTER + 4" CARBON FILTER INSTALLED IN FILTER RACKS PER LEED REQUIREMENTS.
7. UNITS TO HAVE POWERED RELIEF EXHAUST.
8. SMOKE DETECTORS SHALL BE INSTALLED IN SUPPLY & RETURN DUCTS OF ALL UNITS 2,000 CFM & GREATER, AS SHOWN ON PLANS. ALL SHALL COMPLY WITH NFPA 90A & NY STATE CODE SECTION 606.
9. UNIT TO HAVE UV LIGHTS ON THE COOLING COILS.


RADIANT HEATING PANEL SCHEDULE (ELECTRIC)										
MARK	DIMENSIONAL DATA (IN)		TOTAL AREA (SF)	WATTS	ELECTRICAL DATA			BASIS OF DESIGN	REMARKS	
	LENGTH	WIDTH			V	PH	HZ			
ERP-1	48	18	6.0	600	208	1	60	QMARK CP SERIES	SEE NOTES	
ERP-2	48	18	6.0	600	208	1	60	QMARK CP SERIES	SEE NOTES	

NOTES:


1. THE MANUFACTURER BASIS OF DESIGN IS BERKO. ANY DEVIATION FROM WHAT IS SCHEDULED AND SPECIFIED, EVEN THOUGH THE MANUFACTURER IS LISTED IN THE SPECIFICATION AS AN EQUIVALENT MANUFACTURER, SHALL BE THIS CONTRACTOR'S RESPONSIBILITY FOR COORDINATION, ADDITIONAL WORK AND CONTROLS FOR THIS OR OTHER TRADES AT NO ADDITIONAL COST TO THE PROJECT.
2. BOTH UNITS SHALL BE CONTROLLED BY THE SAME WALL MOUNTED THERMOSTAT.

HORIZONTAL UNIT HEATER (ELECTRIC)													
MARK	CFM	MBH	EAT (°F)	LAT (°F)	FAN MOTOR	HEATER AMPS	KW	ELECTRICAL DATA			BASIS OF DESIGN	REMARKS	
					HP			RPM	V	PH			HZ
HUH-1	350	0.0102	-	-	0.01	1600	14.5	3	208	1	60	BERKO HUH4K20	SEE NOTES


VARIABLE REFRIGERANT FLOW INDOOR UNIT SCHEDULE																										
MARK	ROOM SERVED	AIRFLOW (CFM)		COOLING DATA		HEATING DATA		MCA	MOP	ELECTRICAL DATA			UNIT DIMENSIONS (IN)		WEIGHT (LBS)	REFRIG	MOUNTING	BASIS OF DESIGN	REMARKS							
		LOW	HIGH	EAT (°F)		TOT MBH				PH	HZ	V	WIDTH	HEIGHT						DEPTH						
				DB	WB	MBH																				
FCU-1-1	133	406	600	80	67	15.4	70	18.3	1.6	15	1	60	208	39.4	9.6	31.5	100	R32	DUCTED	DAIKIN MODEL FXSA18AAVJU	SEE NOTES					
FCU-1-2	134	406	600	80	67	15.4	70	18.3	1.6	15	1	60	208	39.4	9.6	31.5	100	R32	DUCTED	DAIKIN MODEL FXSA18AAVJU	SEE NOTES					
FCU-1-3	135	406	600	80	67	15.4	70	18.3	1.6	15	1	60	208	39.4	9.6	31.5	100	R32	DUCTED	DAIKIN MODEL FXSA18AAVJU	SEE NOTES					
FCU-1-4	136	371	530	80	67	12.8	70	15.4	1.4	15	1	60	208	39.4	9.6	31.5	80	R32	DUCTED	DAIKIN MODEL FXSA15AAVJU	SEE NOTES					
FCU-1-5	137	353	441	80	67	6.5	70	7.8	0.3	15	1	60	208	33.1	9.7	33.1	50	R32	CEILING	DAIKIN MODEL FXFA07AAVJU	SEE NOTES					
FCU-2-1	132	512	742	80	67	20.6	70	24.4	1.8	15	1	60	208	39.4	9.6	31.5	100	R32	DUCTED	DAIKIN MODEL FXSA24AAVJU	SEE NOTES					
FCU-2-2	131	512	742	80	67	20.6	70	24.4	1.8	15	1	60	208	39.4	9.6	31.5	100	R32	DUCTED	DAIKIN MODEL FXSA24AAVJU	SEE NOTES					
FCU-2-3	130	512	742	80	67	20.6	70	24.4	1.8	15	1	60	208	39.4	9.6	31.5	100	R32	DUCTED	DAIKIN MODEL FXSA24AAVJU	SEE NOTES					
FCU-2-4	129	406	600	80	67	15.4	70	18.3	1.6	15	1	60	208	39.4	9.6	31.5	100	R32	DUCTED	DAIKIN MODEL FXSA18AAVJU	SEE NOTES					
FCU-2-5	128	353	441	80	67	6.5	70	7.8	0.3	15	1	60	208	33.1	9.7	33.1	50	R32	CEILING	DAIKIN MODEL FXFA07AAVJU	SEE NOTES					
FCU-2-6	A131	230	280	80	67	5.1	70	6.0	0.8	15	1	60	208	21.7	9.6	31.5	70	R32	DUCTED	DAIKIN MODEL FXSA09AAVJU	SEE NOTES					
FCU-3-1	127	318	318	80	67	8.3	70	9.5	0.8	15	1	60	208	21.7	9.6	31.5	70	R32	DUCTED	DAIKIN MODEL FXSA09AAVJU	SEE NOTES					
FCU-3-2	126	335	447	80	67	10.2	70	12.4	0.8	15	1	60	208	21.7	9.6	31.5	70	R32	DUCTED	DAIKIN MODEL FXSA12AAVJU	SEE NOTES					
FCU-3-3	125	371	530	80	67	12.8	70	15.4	1.4	15	1	60	208	39.4	9.6	31.5	80	R32	DUCTED	DAIKIN MODEL FXSA15AAVJU	SEE NOTES					
FCU-3-4	124	512	742	80	67	20.6	70	24.4	1.8	15	1	60	208	39.4	9.6	31.5	100	R32	DUCTED	DAIKIN MODEL FXSA24AAVJU	SEE NOTES					
FCU-3-5	138	353	441	80	67	8.3	70	9.5	0.3	15	1	60	208	33.1	9.7	33.1	50	R32	CEILING	DAIKIN MODEL FXFA09AAVJU	SEE NOTES					
FCU-3-6	139	353	441	80	67	8.3	70	9.5	0.3	15	1	60	208	33.1	9.7	33.1	50	R32	CEILING	DAIKIN MODEL FXFA09AAVJU	SEE NOTES					
FCU-3-7	140	353	441	80	67	8.3	70	9.5	0.3	15	1	60	208	33.1	9.7	33.1	50	R32	CEILING	DAIKIN MODEL FXFA09AAVJU	SEE NOTES					
FCU-3-8	141	353	441	80	67	8.3	70	9.5	0.3	15	1	60	208	33.1	9.7	33.1	50	R32	CEILING	DAIKIN MODEL FXFA09AAVJU	SEE NOTES					
FCU-4-1	A126	512	742	80	67	20.6	70	24.4	1.8	15	1	60	208	39.4	9.6	31.5	100	R32	DUCTED	DAIKIN MODEL FXSA24AAVJU	SEE NOTES					
FCU-4-2	A122	353	441	80	67	6.5	70	7.8	0.3	15	1	60	208	33.1	9.7	33.1	50	R32	CEILING	DAIKIN MODEL FXFA07AAVJU	SEE NOTES					
FCU-4-3	A121	353	441	80	67	6.5	70	7.8	0.3	15	1	60	208	33.1	9.7	33.1	50	R32	CEILING	DAIKIN MODEL FXFA07AAVJU	SEE NOTES					
FCU-4-4	A120	406	600	80	67	15.4	70	18.3	1.6	15	1	60	208	39.4	9.6	31.5	100	R32	DUCTED	DAIKIN MODEL FXSA18AAVJU	SEE NOTES					
FCU-4-5	A119	353	441	80	67	6.5	70	7.8	0.3	15	1	60	208	33.1	9.7	33.1	50	R32	CEILING	DAIKIN MODEL FXFA07AAVJU	SEE NOTES					
FCU-5-1	B101	230	318	80	67	8.3	70	9.5	0.8	15	1	60	208	21.7	9.6	31.5	70	R32	DUCTED	DAIKIN MODEL FXSA09AAVJU	SEE NOTES					
FCU-5-2	B103	353	441	80	67	6.5	70	7.8	0.3	15	1	60	208	33.1	9.7	33.1	50	R32	CEILING	DAIKIN MODEL FXFA07AAVJU	SEE NOTES					
FCU-5-3	101	353	441	80	67	6.5	70	7.8	0.3	15	1	60	208	33.1	9.7	33.1	50	R32	CEILING	DAIKIN MODEL FXFA07AAVJU	SEE NOTES					
FCU-5-4	102	353	441	80	67	6.5	70	7.8	0.3	15	1	60	208	33.1	9.7	33.1	50	R32	CEILING	DAIKIN MODEL FXFA07AAVJU	SEE NOTES					
FCU-5-5	103	353	441	80	67	10.2	70	12.2	0.3	15	1	60	208	33.1	9.7	33.1	50	R32	CEILING	DAIKIN MODEL FXFA12AAVJU	SEE NOTES					
FCU-5-6	104	353	441	80	67	6.5	70	7.8	0.3	15	1	60	208	33.1	9.7	33.1	50	R32	CEILING	DAIKIN MODEL FXFA07AAVJU	SEE NOTES					
FCU-5-7	B118	353	441	80	67	6.5	70	7.8	0.3	15	1	60	208	33.1	9.7	33.1	50	R32	CEILING	DAIKIN MODEL FXFA07AAVJU	SEE NOTES					
FCU-5-8	105	353	441	80	67	6.5	70	7.8	0.3	15	1	60	208	33.1	9.7	33.1	50	R32	CEILING	DAIKIN MODEL FXFA07AAVJU	SEE NOTES					
FCU-5-9	B119	353	441	80	67	6.5	70	7.8	0.3	15	1	60	208	33.1	9.7	33.1	50	R32	CEILING	DAIKIN MODEL FXFA07AAVJU	SEE NOTES					
FCU-5-10	106	353	441	80	67	8.3	70	9.5	0.3	15	1	60	208	33.1	9.7	33.1	50	R32	CEILING	DAIKIN MODEL FXFA09AAVJU	SEE NOTES					
FCU-5-11	B120	530	80	67	12.8	70	15.4	1.4	15	1	60	208	39.4	9.6	31.5	100	R32	DUCTED	DAIKIN MODEL FXSA15AAVJU	SEE NOTES						
FCU-5-12	B121	353	441	80	67	6.5	70	7.8	0.3	15	1	60	208	33.1	9.7	33.1	50	R32	CEILING	DAIKIN MODEL FXFA07AAVJU	SEE NOTES					
FCU-5-13	107	406	600	80	67	15.4	70	18.3	1.6	15	1	60	208	39.4	9.6	31.5	100	R32	DUCTED	DAIKIN MODEL FXSA18AAVJU	SEE NOTES					
FCU-5-14	120	353	441	80	67	6.5	70	7.8	0.3	15	1	60	208	33.1	9.7	33.1	50	R32	CEILING	DAIKIN MODEL FXFA07AAVJU	SEE NOTES					
FCU-6-1	119	353	441	80	67	6.5	70	7.8	0.3	15	1	60	208	33.1	9.7	33.1	50	R32	CEILING	DAIKIN MODEL FXFA07AAVJU	SEE NOTES					
FCU-6-2	108	371	530	80	67	12.8	70	15.4	1.4	15	1	60	208	39.4	9.6	31.5	80	R32	DUCTED	DAIKIN MODEL FXSA15AAVJU	SEE NOTES					
FCU-6-3	109	406	600	80	67	15.4	70	18.3	1.6	15	1	60	208	39.4	9.6	31.5	100	R32	DUCTED	DAIKIN MODEL FXSA18AAVJU	SEE NOTES					
FCU-6-4	110	406	600	80	67	15.4	70	18.3	1.6	15	1	60	208	39.4	9.6	31.5	100	R32	DUCTED	DAIKIN MODEL FXSA18AAVJU	SEE NOTES					
FCU-6-5	111	230	318	80	67	8.3	70	9.5	0.8	15	1	60	208	21.7	9.6	31.5	70	R32	DUCTED	DAIKIN MODEL FXSA09AAVJU	SEE NOTES					
FCU-6-6	112	318	318	80	67	8.3	70	9.5	0.8	15	1	60	208	21.7	9.6	31.5	70	R32	DUCTED	DAIKIN MODEL FXSA09AAVJU	SEE NOTES					
FCU-7-1	113	230	318	80	67	8.3	70	9.5	0.8	15	1	60	208	21.7	9.6	31.5	70	R32	DUCTED	DAIKIN MODEL FXSA09AAVJU	SEE NOTES					
FCU-7-2	114	230	318	80	67	8.3	70	9.5	0.8	15	1	60	208	21.7	9.6	31.5	70	R32	DUCTED	DAIKIN MODEL FXSA09AAVJU	SEE NOTES					
FCU-7-3	115	353	441	80	67	6.5	70	7.8	0.3	15	1	60	208	33.1	9.7	33.1	50	R32	CEILING	DAIKIN MODEL FXFA07AAVJU	SEE NOTES					
FCU-7-4	116	371	530	80	67	12.8	70	15.4	1.4	15	1	60	208	39.4	9.6	31.5	80	R32	DUCTED	DAIKIN MODEL FXSA15AAVJU	SEE NOTES					
FCU-7-5	117	600	600	80	67	15.4	70	18.3	1.6	15	1	60	208	39.4	9.6	31.5	100	R32	DUCTED	DAIKIN MODEL FXSA18AAVJU	SEE NOTES					
FCU-7-6	118	371	530	80	67	12.8	70	15.4	1.4	15	1	60	208	39.4	9.6	31.5	80	R32	DUCTED	DAIKIN MODEL FXSA15AAVJU	SEE NOTES					
FCU-8-1	237	371	530	80	67	12.8	70	15.4	1.4	15	1	60	208	39.4	9.6	31.5	80	R32	DUCTED	DAIKIN MODEL FXSA15AAVJU	SEE NOTES					
FCU-8-2	238	512	742	80	67	20.6	70	24.4	1.8	15	1	60	208	39.4	9.6	31.5	100	R32	DUCTED	DAIKIN MODEL FXSA24AAVJU	SEE NOTES					
FCU-8-3	239	512	742	80	67	20.6	70	24.4	1.8	15	1	60	208	39.4	9.6	31.5	100	R32	DUCTED	DAIKIN MODEL FXSA24AAVJU	SEE NOTES					
FCU-8-4	240	530	80	67	12.8	70	15.4	1.4	15	1	60	208	39.4	9.6	31.5	80	R32	DUCTED	DAIKIN MODEL FXSA15AAVJU	SEE NOTES						
FCU-8-5	241	353	441	80	67	6.5	70	7.8	0.3	15	1	60	208	33.1	9.7	33.1	50	R32	CEILING	DAIKIN MODEL FXFA07AAVJU	SEE NOTES					
FCU-9-1	236	406	600	80	67	15.4	70	18.3	1.6	15	1	60	208	39.4	9.6	31.5	100	R32	DUCTED	DAIKIN MODEL FXSA18AAVJU	SEE NOTES					
FCU-9-2	235	371	530	80	67	12.8	70	15.4	1.4	15	1	60	208	39.4	9.6	31.5</										

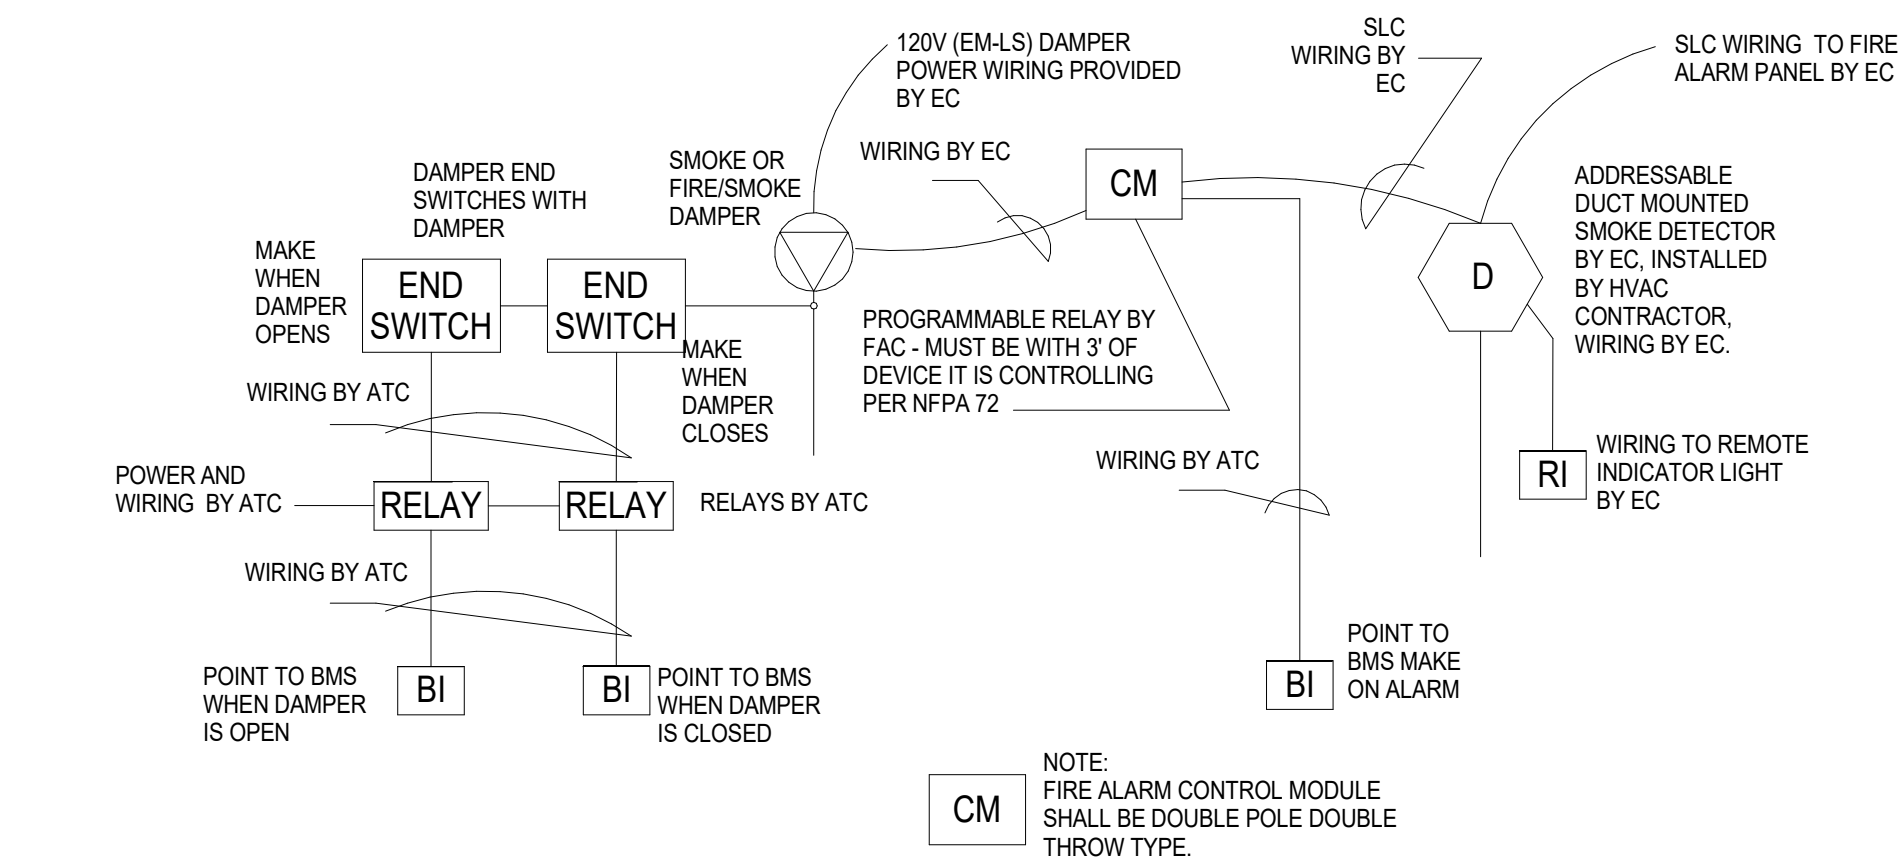


16 DUCT SMOKE DETECTOR & DAMPER DETAIL
1/8" = 1'-0"

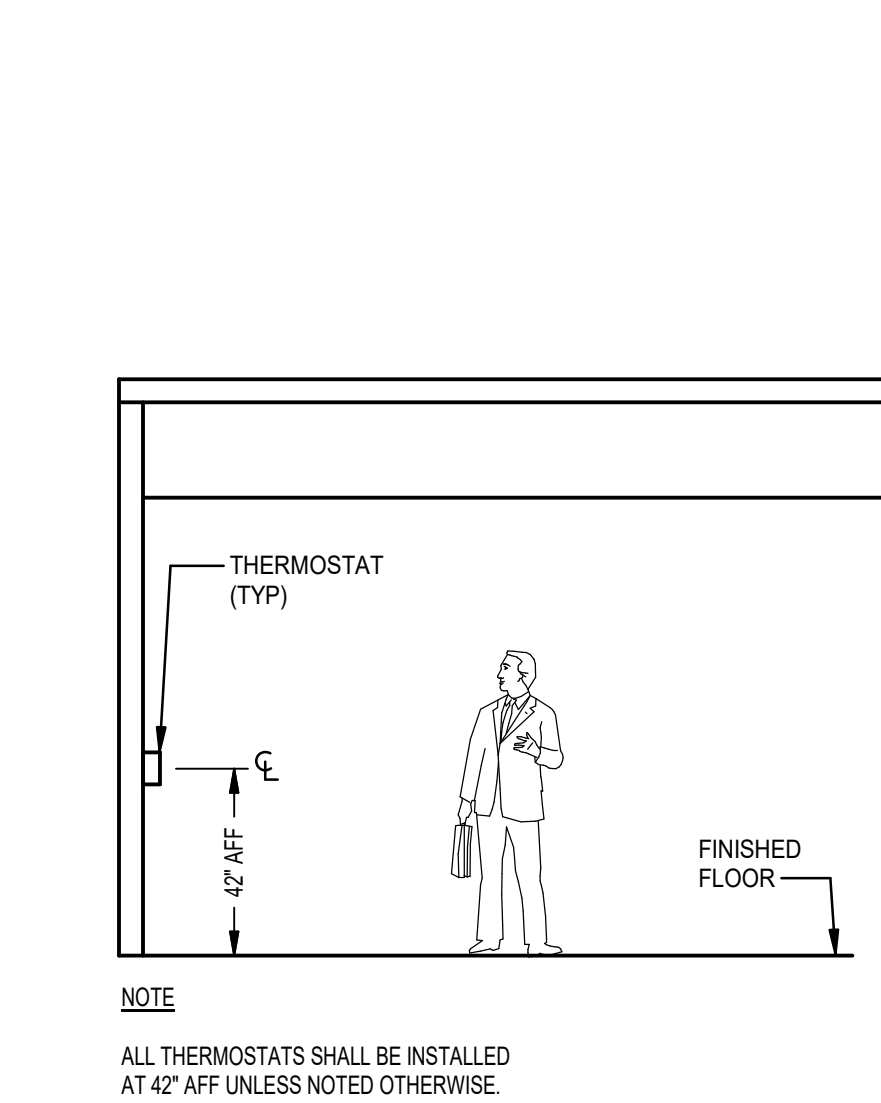


15 THERMOSTAT DETAIL
NO SCALE

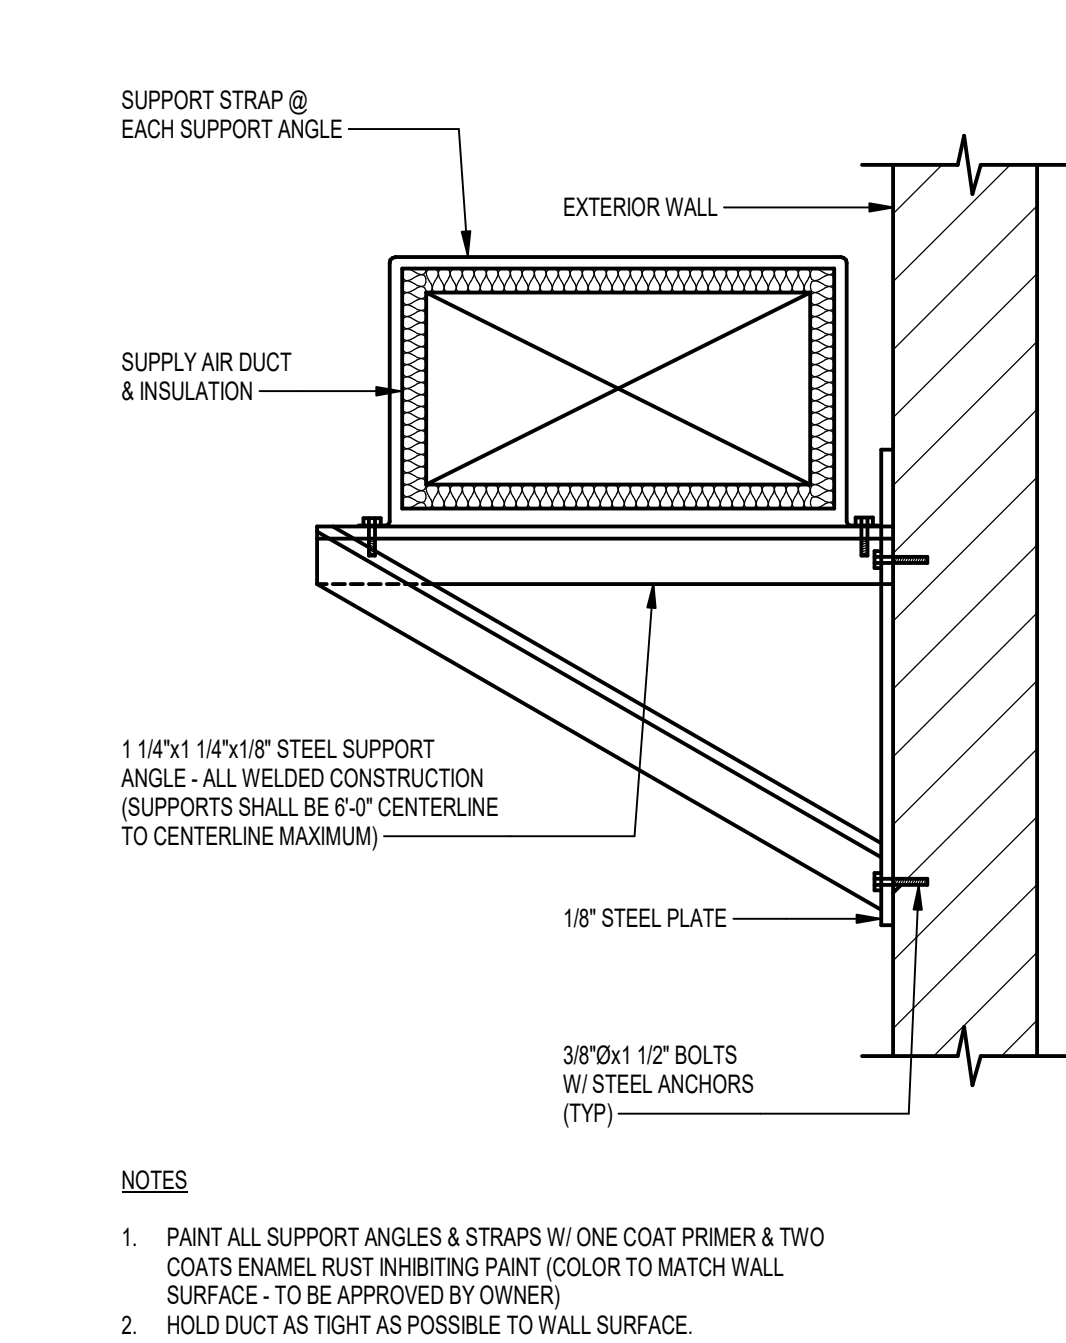


14 ANGLE SUPPORT FOR EXTERIOR DUCT
NO SCALE

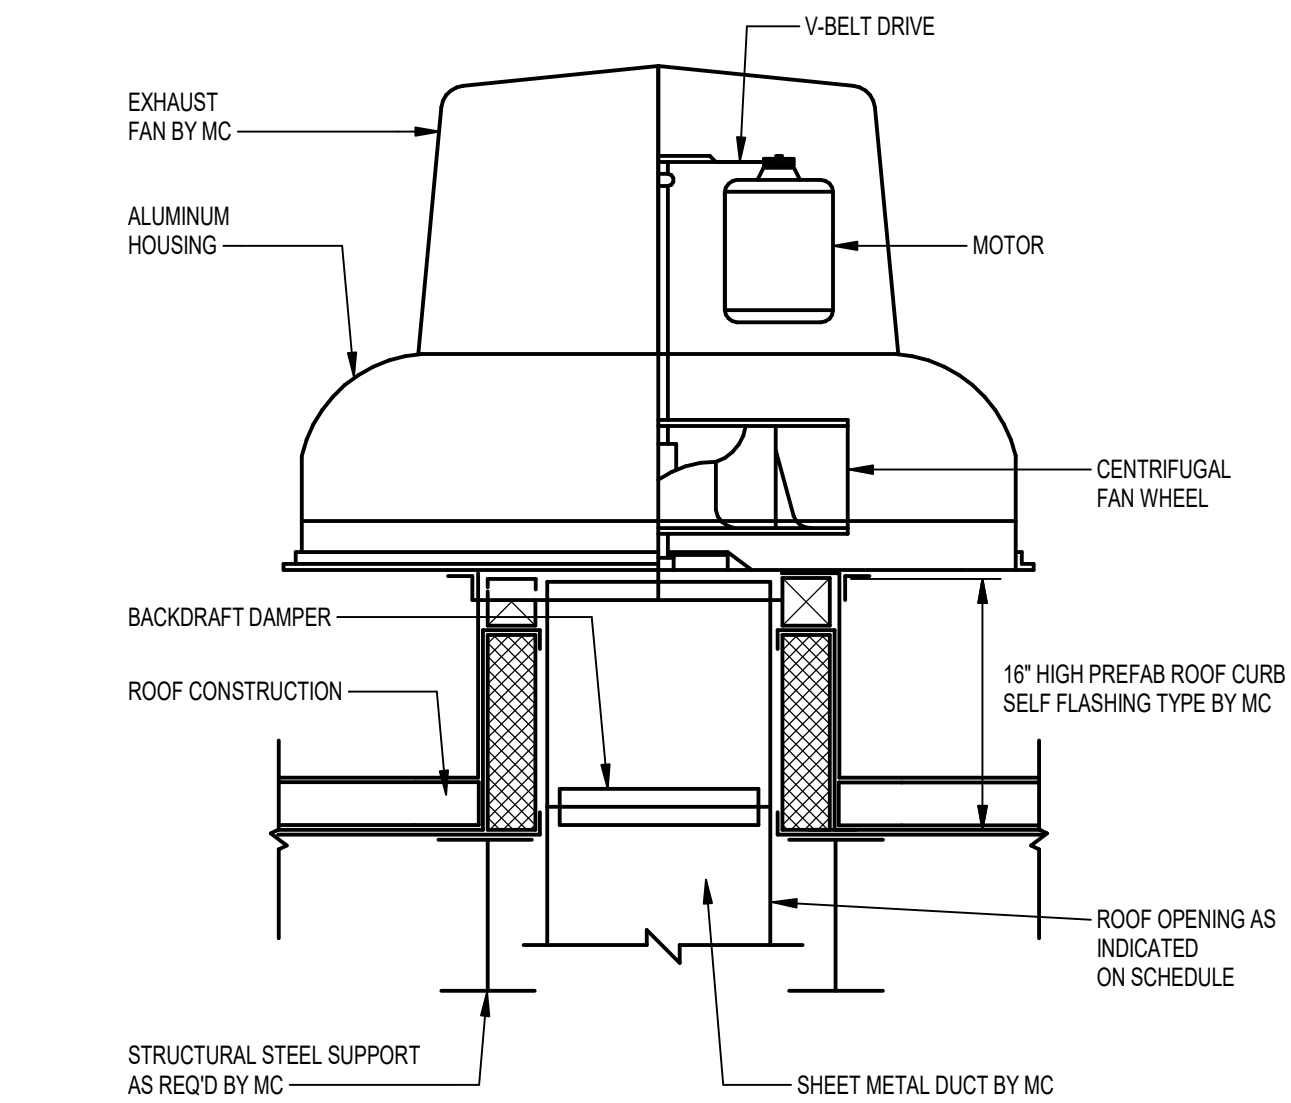


13 TYPE - B ROOF EXHAUST FAN DETAIL
NO SCALE

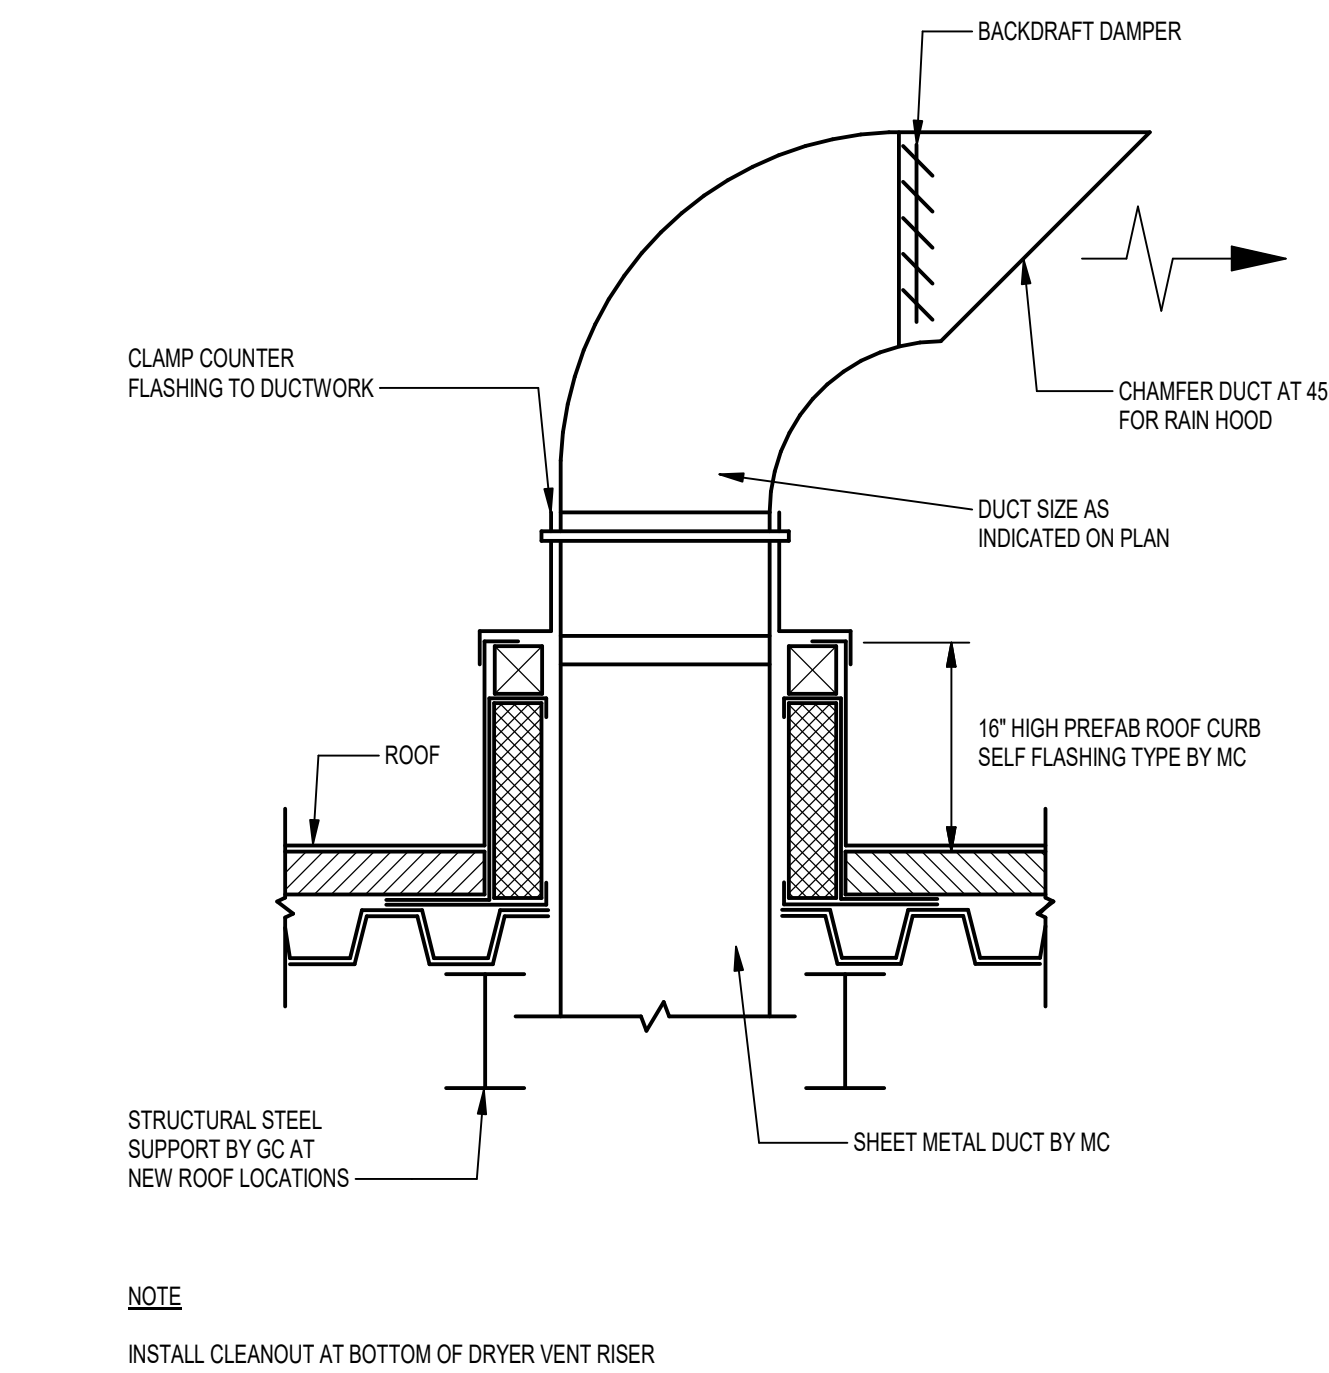


12 DRYER VENT THRU ROOF
NO SCALE

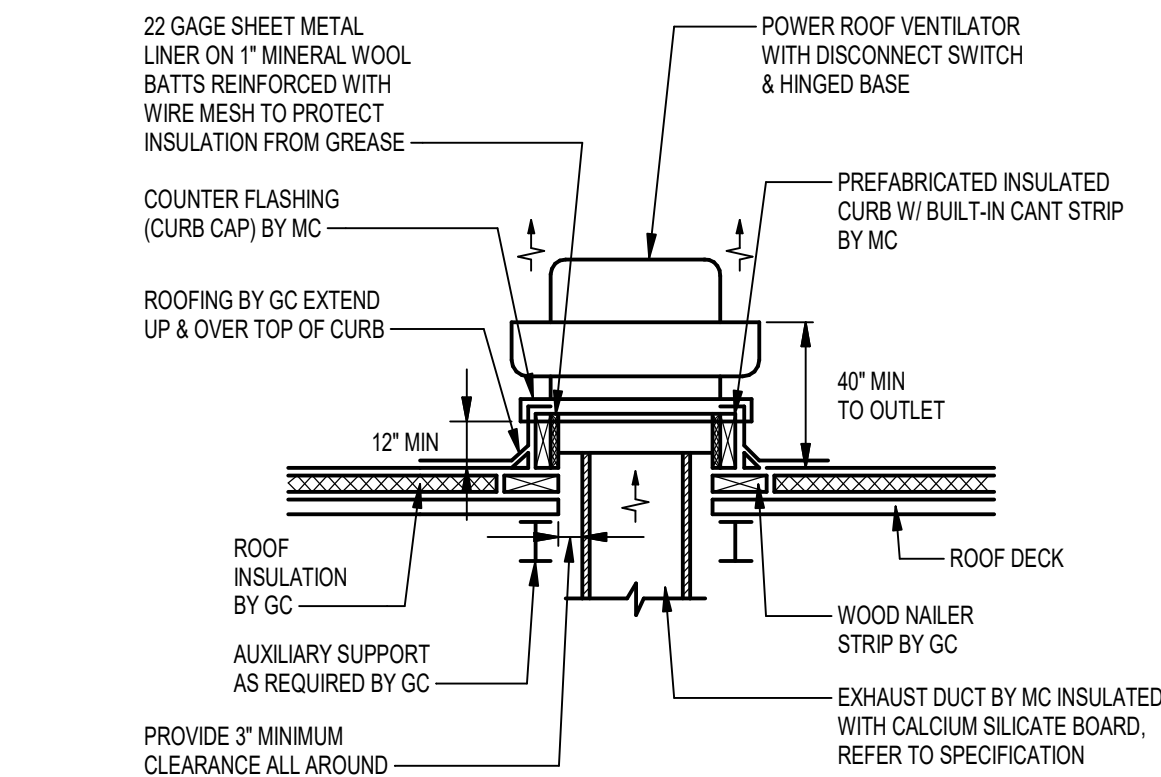


3 KITCHEN ROOF EXHAUST FAN
NO SCALE

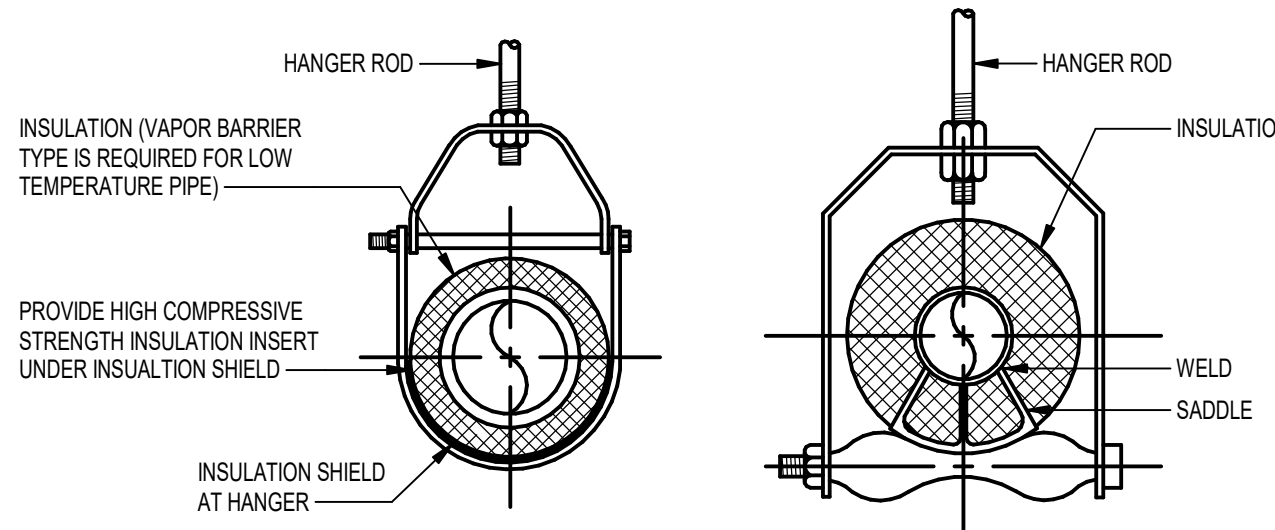


11 PIPE HANGER DIAGRAMS
NO SCALE

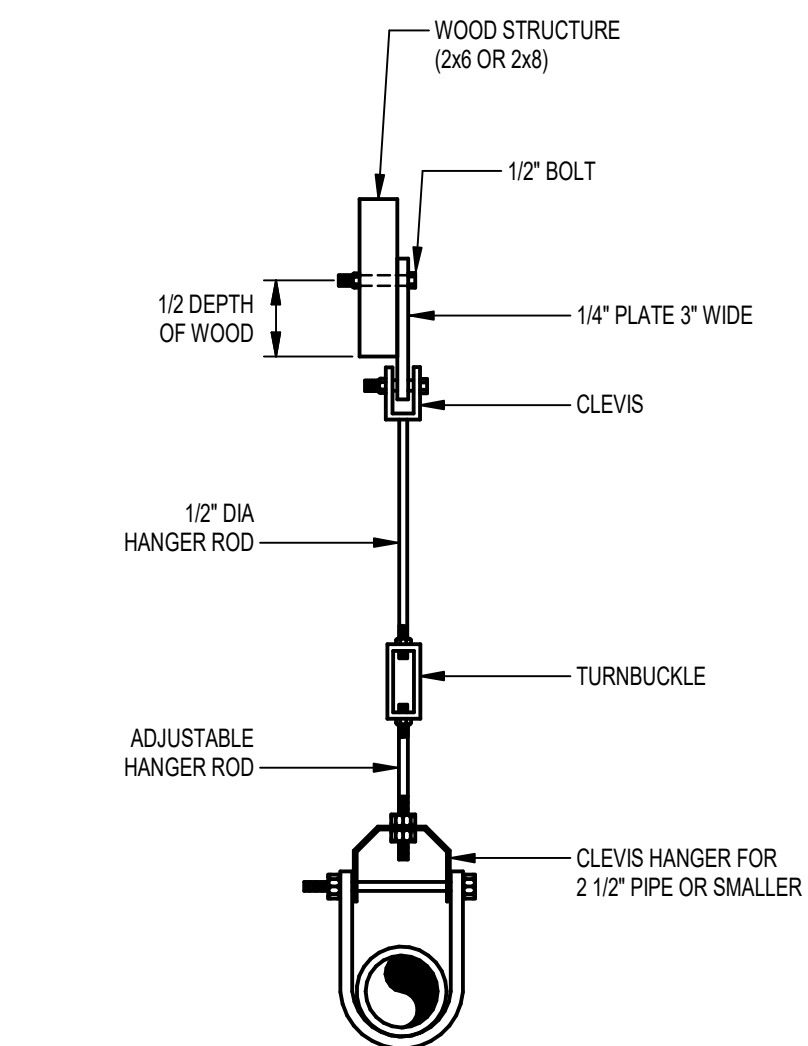


10 PIPE HANGER FROM WOOD STRUCTURE
NO SCALE

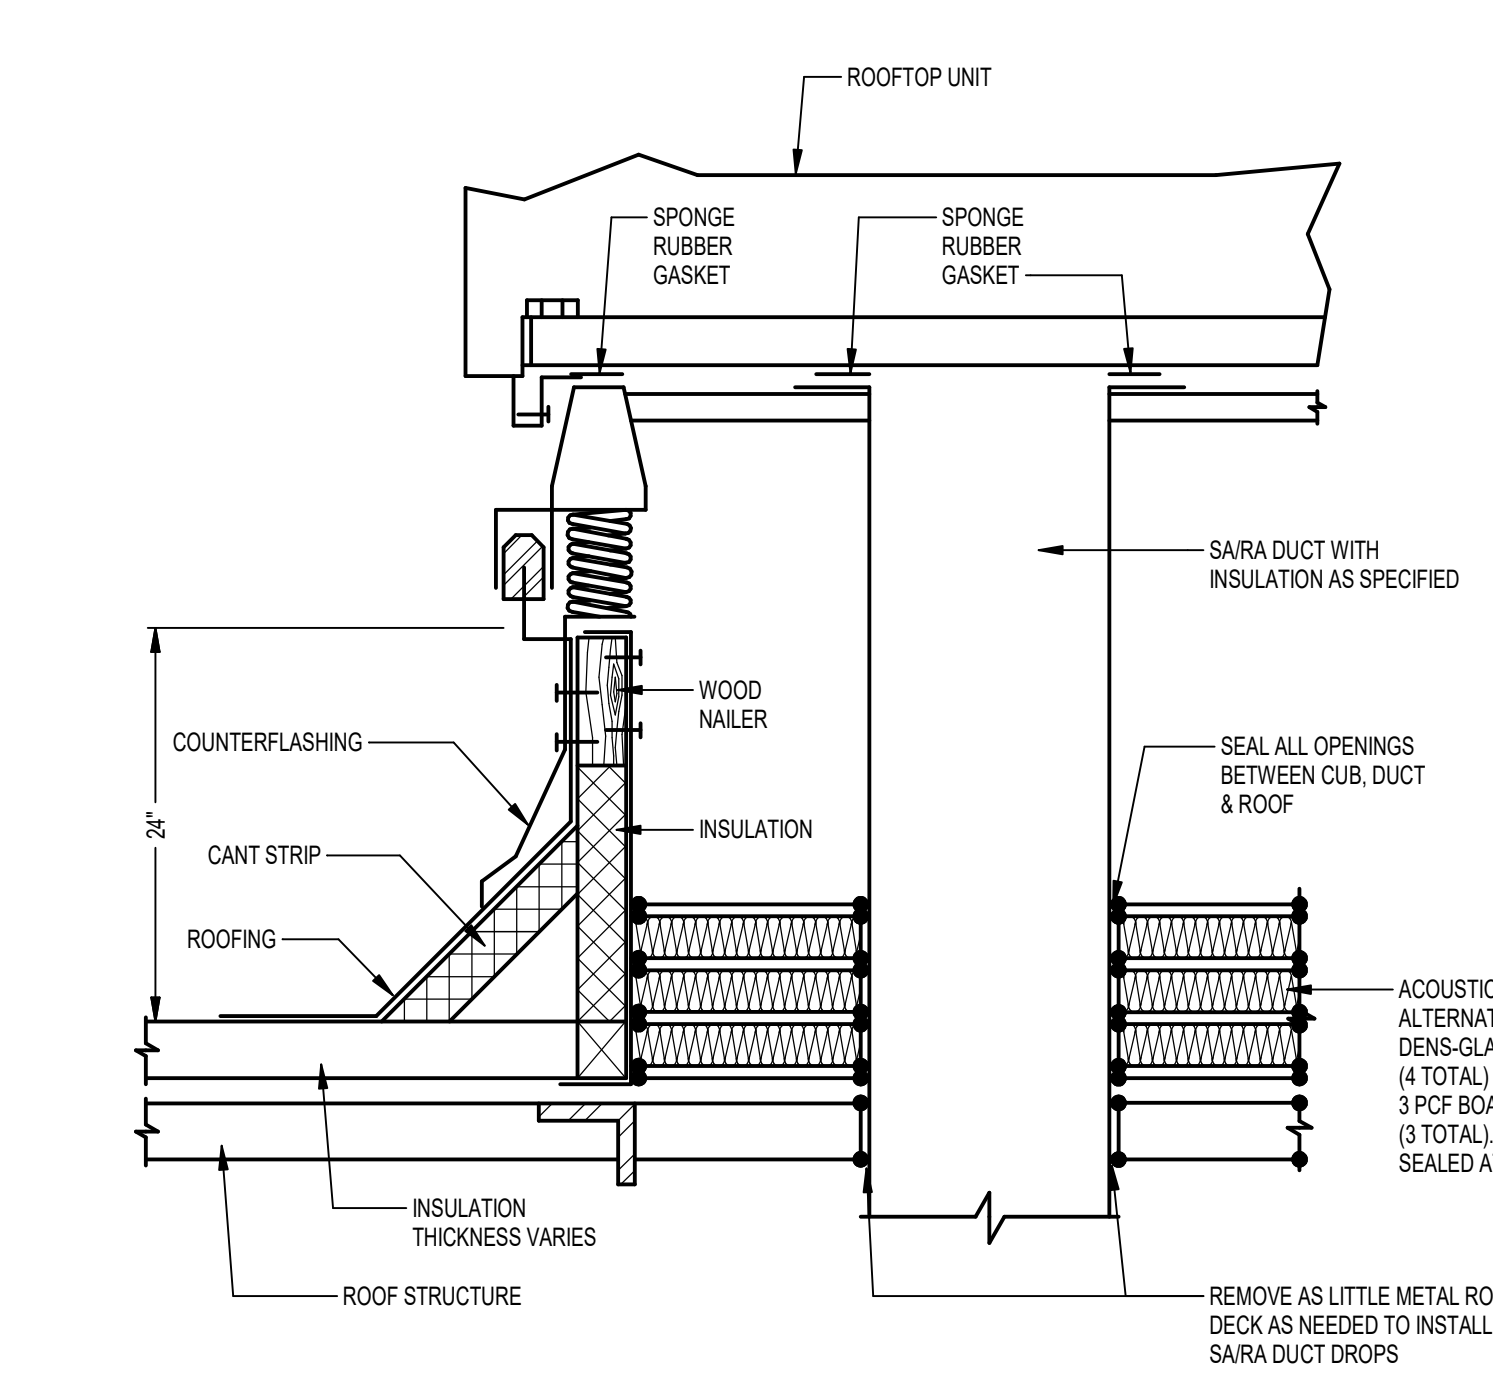


4 ROOFTOP UNIT W/ VIBRATION ISOLATION CURB
NO SCALE

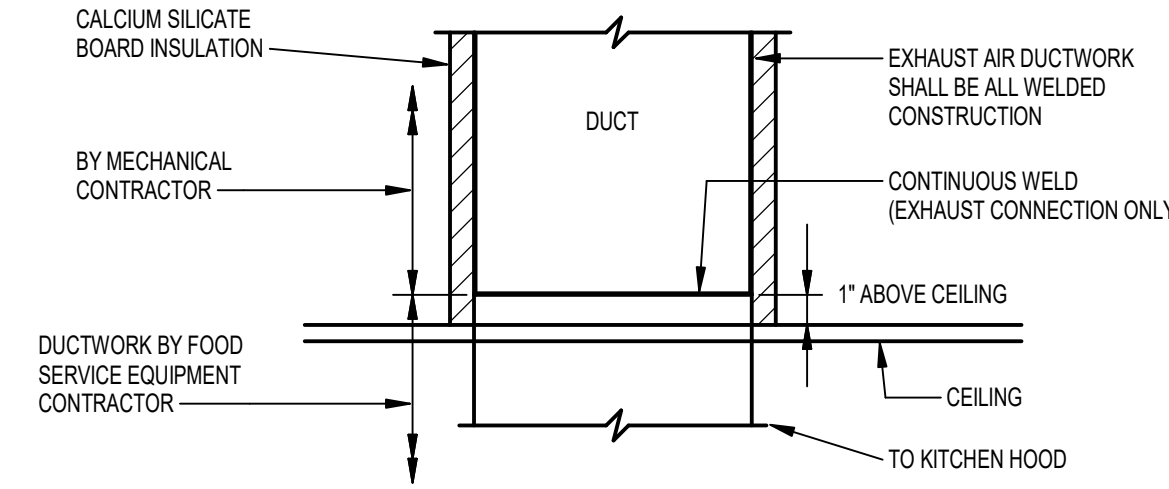


2 KITCHEN HOOD CONNECTION
NO SCALE

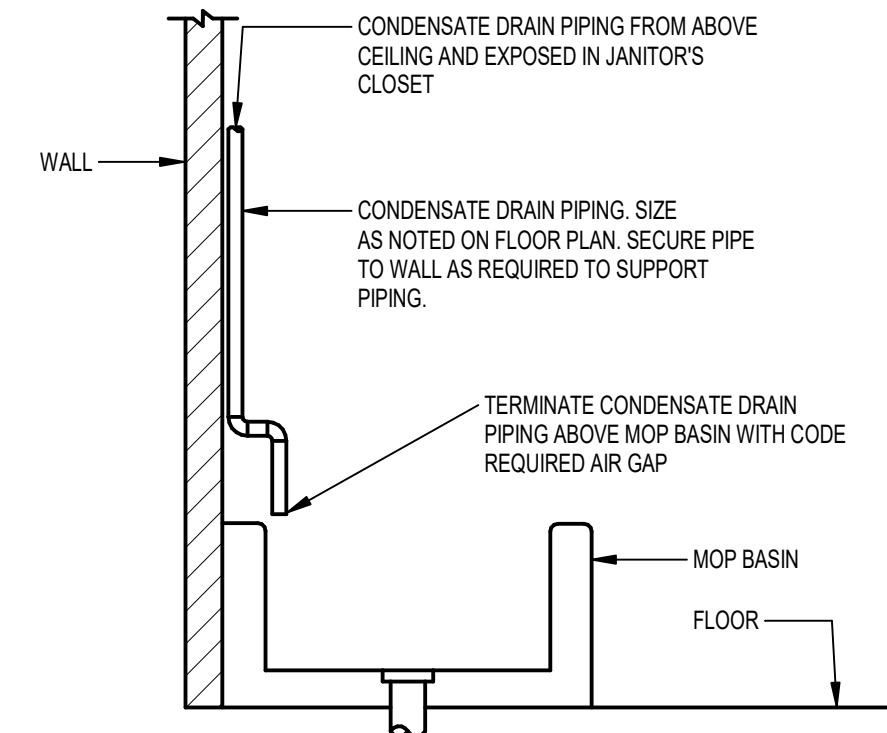


5 CONDENSATE DRAIN TERMINATION
NO SCALE

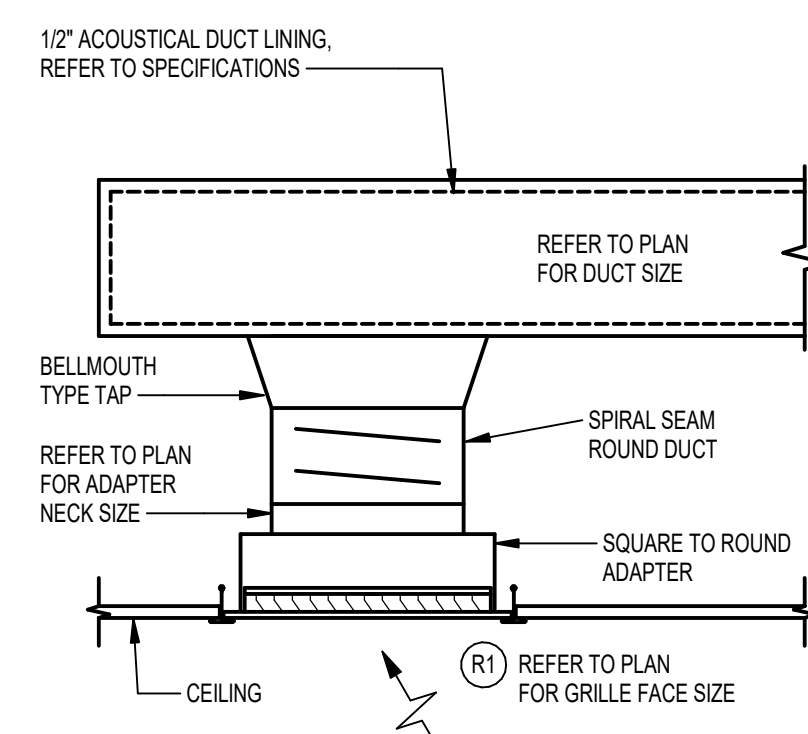

6 RETURN GRILLE & ADAPTER
1/8" = 1'-0"

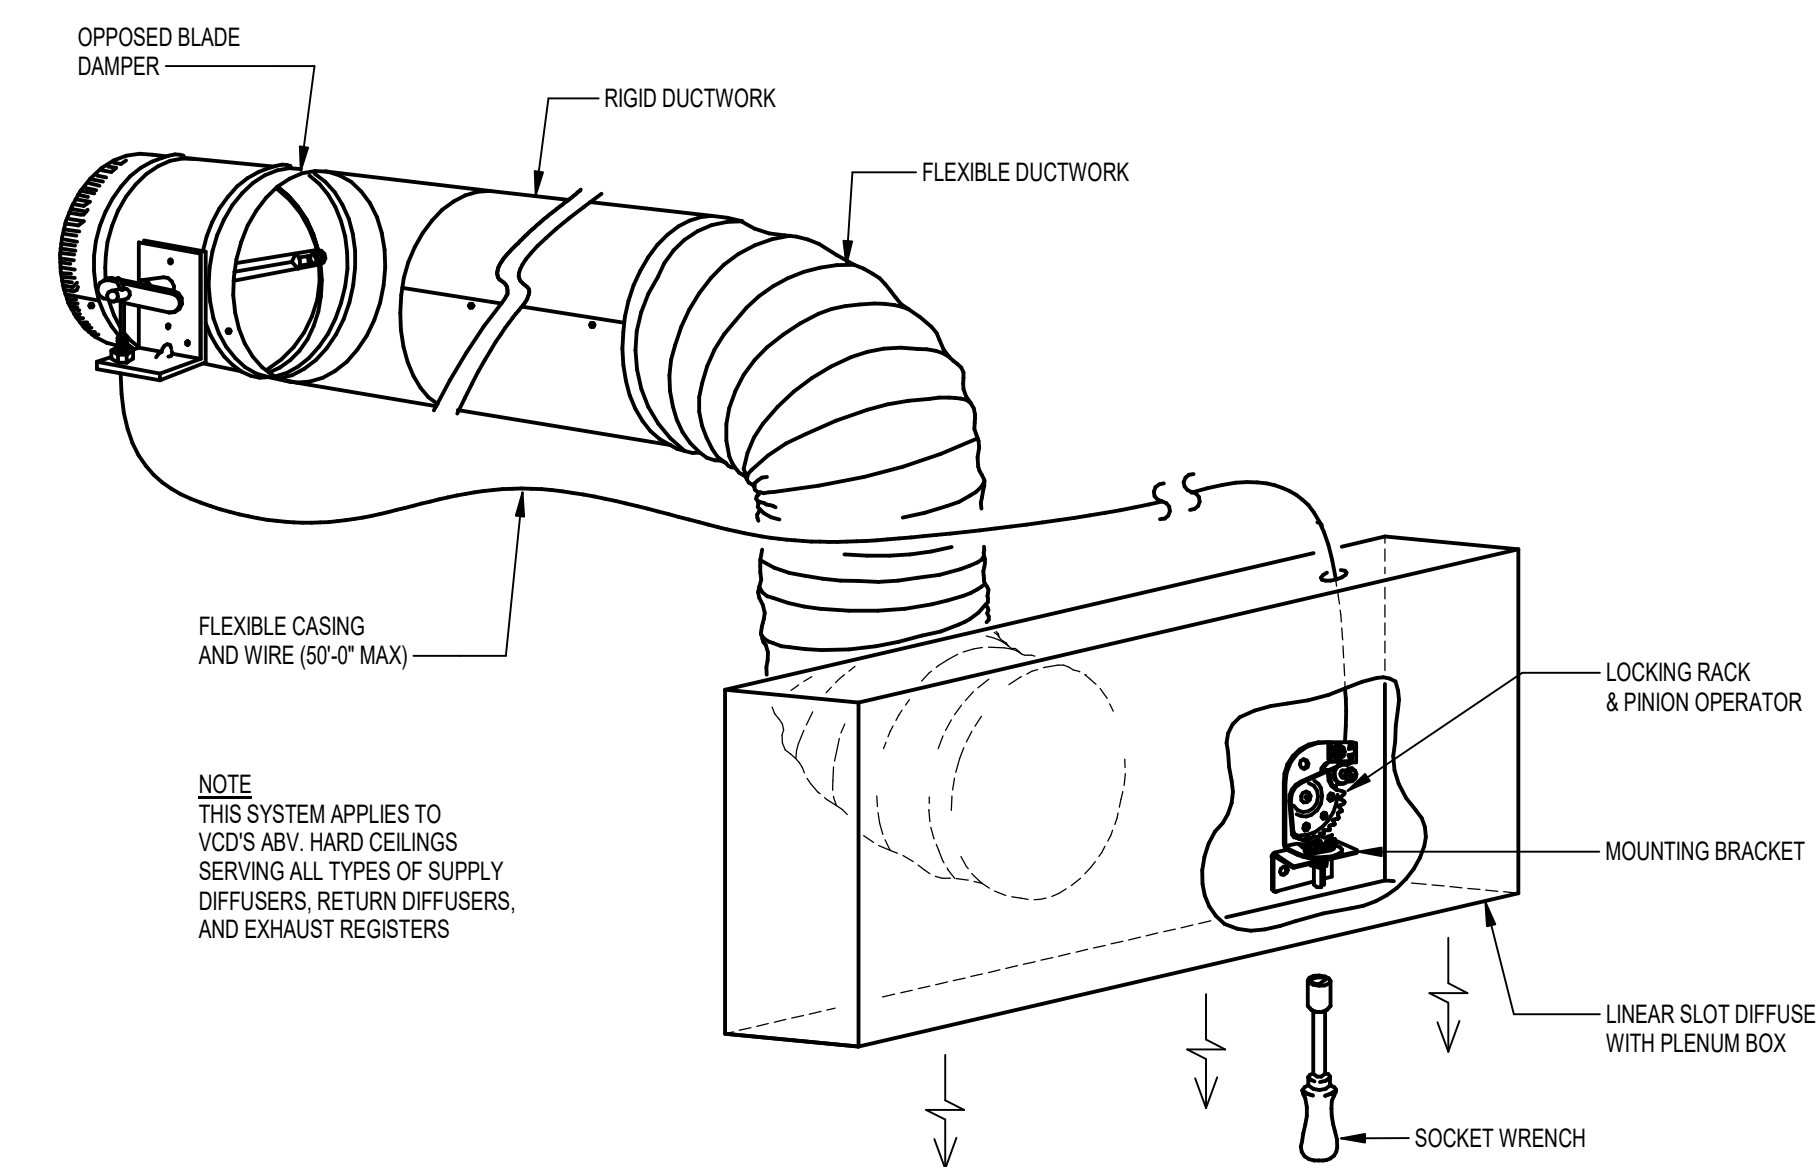

7 REMOTE DAMPER BALANCING CABLE CONTROL SYSTEM
1/2" = 1'-0"

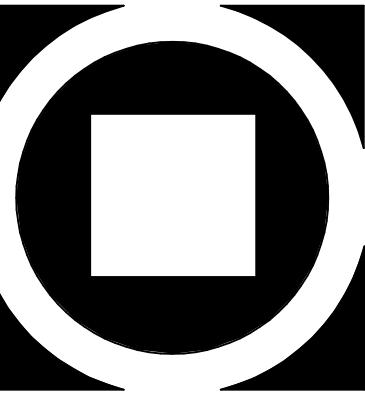

KIMMEL BOGRETTE
Architecture + Site
Blue Bell PA 19322
482 Norristown Rd., Suite 200
Phone 610.834.7865
Copyright 2022 KIMMEL BOGRETTE ARCHITECTURE + SITE, INC. ALL RIGHTS RESERVED.

CL ENGINEERS, P.C.
232 Howe Street
Jenkintown, PA 19102
610.286.1661
Certificate of Authority # 0002028
Expiration: 7-31-2026

SUNRISE
SENIOR LIVING
Sunrise of Northport
1381-1387 Pulaski Road
Huntington, NY 11731
25-013

ISSUE DATE: 04.10.2026
100% CD
DRAWN BY: DOL
CHECKED BY: MAR
SCALE: AS NOTED

DETAILS

M-8.02

