HVAC SYMBOLS

DUCT WORK

- SINGLE LINE DUCTWORK, NEW
- SINGLE LINE DUCTWORK, EXISTING
- DUCTWORK WITH ACCOUSTIC LINING
- FLEXIBLE CONNECTION
- VERTICAL DUCT DROP
- VERTICAL DUCT RISE
- DUCT UNDER PRESSURE (SUPPLY AIR OR FAN DISCHARGE)
- DUCT UNDER NEGATIVE PRESSURE (RETURN, EXHUAST OR OUTSIDE AIR)
- VANED ELBOW
- VANED ELBOW OR RADIUS ELBOW
- RADIUS ELBOW

PIPING SYMBOLS

- BALL VALVE
- GATE VALVE
- "Y" TYPE STRAINER W/BLOWOFF VALVE
- UNION
- AUTOMATIC CONTROL VALVE
- RELIEF VALVE
- T — THERMOSTAT

HVAC ABBREVIATIONS

AC	AIR CONDITIONING
ACS	AUTOMATIC CONTROL SYSTEM
ACU	AIR CONDITIONING UNIT
AD	ACCESS DOOR
AL	ALUMINUM
AP	ACCESS PANEL
CC	COOLING COIL
CD-A	CEILING DIFFUSER, (TYPE A)
CEWA	CRITICAL ENVIRONMENT WORK AUTHORIZATION
CFM	CUBIC FEET PER MINUTE
CG	CEILING GRILLE
CLG	CEILING
COND	CONDENSATE
CR	CEILING REGISTER
CO	CLEANOUT
CV	CONSTANT VOLUME
D	DROP
DB	DRY BULB
DMPR	DAMPER
DOM	DOMESTIC
DWG	DRAWING
EA	EXHAUST AIR
EAT	ENTERING AIR TEMPERATURE
EDB	ENTERING DRY BULB TEMPERATURE
ELEC	ELECTRIC
ELEV	ELEVATION
EQ	EQUAL
EWB	ENTERING WET BULB
EWT	ENTERING WATER TEMPERATURE
EXH	EXHAUST
°F	DEGREES FAHRENHEIT
F	FILTER
FA	FREE AREA
FC	FLEXIBLE CONNECTION
FD	FIRE DAMPER WITH ACCESS DOOR
FSD	FIRE SMOKE DAMPER WITH ACCESS DOOR
FLA	FULL LOAD AMPERES
FPI	FINS PER INCH
FOR	FUEL OIL RETURN
FOS	FUEL OIL SUPPLY
FO	FUEL OIL
FTR	FINNED TUBE RADIATION
FV	FACE VELOCITY
H	HEIGHT
HC	HEATING COIL
HP	HORSE POWER
HUM	HUMIDIFIER
HV	HEATING AND VENTILATING
ID	INSIDE DIAMETER
LAT	LEAVING AIR TEMPERATURE
LWB	LEAVING WET BULB TEMPERATURE
LWT	LEAVING WATER TEMPERATURE
MB	MIXING BOX
MD	MOTORIZED DAMPER
MER	MECHANICAL EQUIPMENT ROOM
MHP	MOTOR HORSEPOWER
NC	NORMALLY CLOSED
NK	NECK
NO	NORMALLY OPEN
OA	OUTSIDE AIR
OAI	OUTSIDE AIR INTAKE
OD	OUTSIDE DIAMETER
OPD	OVERCURRENT PROTECTION DEVICE
OV	OUTLET VELOCITY
PD	PRESSURE DROP
PF	PREFILTER
R	RISE
RA	RETURN AIR
RD	ROOF DRAIN
RAF	RETURN AIR FAN
RH	RELATIVE HUMIDITY
RHC	REHEAT COIL
RM	ROOM
RPM	REVOLUTIONS PER MINUTE
RR	RETURN REGISTER
S.A.	SUPPLY AIR
SA	SOUND ATTENUATION UNIT
SF	SQUARE FOOT
SF	SUPPLY FAN
SP	STATIC PRESSURE
SPEC	SPECIFICATION
SR	SUPPLY REGISTER
SS	STAINLESS STEEL
T	THROAT
TDH	TOTAL DYNAMIC HEAD
TEMP	TEMPERATURE
TG	TOP GRILLE
TR	TOP REGISTER
TRF	TRANSFER FAN
TRG	TRANSFER GRILLE
TRD	TRANSFER DUCT
TX	TOILET EXHAUST
UON	
UH	UNIT HEATER
WMS	WIRE MESH SCREEN
VIV	VARIABLE INLET VANES
WB	WET BULB
WC	WATER COLUMN
WG	WATER GAUGE
WMS	WIRE MESH SCREEN
WSA	WIRE SIZE AMPS

FUEL STORAGE DRAWING LIST

NO.	DWG.	DRAWING TITLE
1.	T-001.00	TITLE SHEET, PLOT PLAN, FUEL STORAGE NOTES AND SCHEDULES
2.	FS-101.00	FUEL STORAGE SUB-CELLAR AND CELLAR FLOOR PLAN
3.	FS-102.00	FUEL STORAGE GROUND AND FIRST FLOOR PLAN
4.	FS-103.00	FUEL STORAGE SECOND AND THIRD FLOOR PLAN
5.	FS-104.00	FUEL STORAGE FOURTH AND FIFTH FLOOR PLAN
6.	FS-105.00	FUEL STORAGE ROOF FLOOR PLAN
7.	FS-300.00	FUEL STORAGE FUEL OIL RISER DIAGRAM & DETAILS

BUILDING DEPARTMENT NOTES, MECHANICAL

1. ALL WORK SHALL COMPLY WITH THE APPLICABLE SECTIONS OF THE BUILDING CODE, CITY OF NEW YORK, EFFECTIVE 2014 AND ALL AMENDMENTS AND RULES AND REGULATIONS OF THE DEPARTMENT OF BUILDINGS TO DATE.
2. MATERIALS AND EQUIPMENT SUBJECT TO SPECIAL INSPECTION:
   A. SPECIAL INSPECTIONS

FUEL OIL STORAGE AND FUEL OIL PIPING SYSTEM	BC 1705.22
FIRE-RESISTANT PENETRATIONS AND JOINTS	BC 1705.17

GENERAL BUILDING CODE NOTES

1. ENERGY CODE COMPLIANCE NOTE:

TO THE BEST OF MY KNOWLEDGE, BELIEF, AND PROFESSIONAL JUDGMENT, THE PLANS AND SPECIFICATIONS ARE IN COMPLIANCE WITH 2020 NYC ECC

2. PERMITS:

CONTRACTOR SHALL FILE FOR AND OBTAIN PERMITS FOR ALL MECHANICAL SYSTEMS. PERMITS SHALL COMPLY WITH SECTION MC 105 WITH ARTICLE 105 OF CHAPTER 1 OF TITLE 28 OF THE ADMINISTRATIVE CODE. EQUIPMENT SHALL BE.

3. LISTED AND LABLED:

ALL APPLIANCES REGULATED BY NYCMC SHALL BE LISTED AND LABELED AS REQUIRED BY MC 301.4
LABEL INFORMATION SHALL COMPLY WITH REQUIREMENTS OF MC 301.6

4. VIBRATION ISOLATION:

ALL MECHANICAL EQUIPMENT SHALL BE MOUNTED AND SUPPORTED AS REQUIRED BY MC 301.10

5. FIRE STOPPING COMPLIANCE NOTE:

A. FOR FIRE STOPPING AT ANY FIRE RATED CONSTRUCTION PENETRATION CONTRACTOR SHALL REFER TO SPECIFICATION SECTION 07270
B. ALL DUCT AND PIPE PENETRATIONS OF RATED CONSTRUCTION SHALL COMPLY WITH NYC BC 712.

6. DUCT SYSTEMS:


DUCT SYSTEMS USED FOR THE MOVEMENT OF AIR IN HVAC SYSTEMS SHALL COMPLY WITH MC CHAPTER 6.
DUCT INSULATION SHALL CONFORM TO THE REQUIREMENTS OF MC 604.2 AND THE ENERGY CONSERVATION CONSTRUCTION CODE OF NEW YORK STATE.

7. MATERIALS:

MATERIALS SHALL BE USED, TESTED, APPROVED FOR USE IN ACCODANCE THE SPECIFIC PROVISIONS OF TITLE 28 OF THE ADMINISTRATIVE CODE ARTICAL 113 "MATERIALS".

INSTALL NEW FUEL OIL TANK, PUMP, PIPING AND RELATED COMPONENTS. IN CONJUDCTION WITH ALT-CO#M01244603. WORK ON FLOORS SUB, CEL, MEZ, 01-05, ROF.

PROPERTY IS NOT IN SPECIAL FLOOD HAZARD AREA (SFHA).

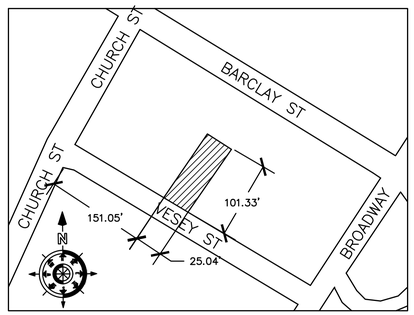

1 PLOT PLAN
N.T.S.

FUEL OIL TRANSFER PUMP SCHEDULE

UNIT NUMBER		F.O.P.-1
LOCATION		TANK ROOM
SERVICE		EMERG. GENERATOR
		DUPPLEX
PUMP DATA	OIL GRADE (#)	#2
	OIL TEMP (°F)	60
	CAPACITY (G.P.H.)	89
	MAX. DISCH. PRESS (PSIG)	100
CASING PRESSURE RATING PSIG		–
MOTOR	TYPE	PISTON DISPL
	H.P.	1/3
	R.P.M.	1725
	V/Ph/Hz	115/1/60
MANUFACTURER		HAYES PUMP, INC.
MODEL		ATPSF-1121-103-120-100-D-DP-L-TG
SERIAL NO.		--
BASE DIMENSIONS (L x W) (INCHES)		--
CONC. HOUSEKEEPING PAD DIMENSIONS (INCHES)		--
OPERATING WEIGHT		--

REMARKS: PROVIDE FACTORY ASSEMBLED SETS WITH STRTAINERS, GAUGES, VALVES, SWITCHES AND CONTROL PANEL

DoB RELATED APPLICATIONS

ALT-CO GENERAL CONSTRUCTION DOB#M01244603-I1

MECHANICAL	DOB#M01244603-S1
PLUMBING	DOB#M01244603-S2
SPRINKLER	DOB#M01244603-S3
FUEL STORAGE	DOB#M01244603-S4
BOILER:	DOB#M01244603-S5

PROPERTY INFORMATION

18 VESEY STREET
NEW YORK, NY, 10007
BLOCK: 88
LOT: 4
BIN: 1001234
COMMUNITY BOARD: 101
ZONING: C5-3, LM (LOWER MANHATTAN)
ZONING MAP: 12B
LOT SIZE = 2,537 SQFT.

HEIGHT: 73 FT
STORIES: 5 STORIES
OCCUPANCY CLASSIFICATION: R-1
CONSTRUCTION CLASSIFICATION: 3
NON-FIREPROOF
MULTIPLE DWELLING CLASSIFICATION: HACB

CONSTRUCTION AREA
SQUARE FOOTAGE: 4175 SQFT


THIS BUILDING WILL BE VACANT DURING CONSTRUCTION

REVIEW REQUESTED UNDER 2022
MECHANICAL CODE

ALL CITY ENGINEERING, P.C.
33 Great Neck Road #3
Great Neck, NY 11021
(516)321-9490
info@allcityengineering.com

OWNER:
SEAFARERS INTERNATIONAL HOUSE
123 EAST 15TH STREET
NEW YORK, NY 1003
TEL: (212) 677-4800
EMAIL: LUCAS@SIHNYC.ORG

SITE PLAN



DoB STAMPS:

No.	DATE	REVISION
	01/08/26	BID SET

NOTE: Drawing may be printed at reduced scale

IT IS A VIOLATION OF THE STATE EDUCATION LAW SECTION 7209 (2) FOR ANY PERSON TO ALTER AN ITEM IN ANY WAY UNLESS SUCH PERSON IS ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, AND THE ENGINEER STAMPS SUCH CHANGES

PROJECT:

18 VESEY STREET
MANHATTAN, NY
BLOCK: 88 LOT: 4

DRAWING TITLE:

TITLE SHEET, PLOT PLAN, FUEL STORAGE NOTES, AND SCHEDULES


DATE:	01/06/2026
PROJECT No.:	25086
CHECKED BY:	
DRAWN BY:	PY/LZ/BL

SEAL AND SIGNATURE

DWG. No.:
T001.00


Sheets: 01 of 07

N.Y.C D.O.B No. :
M01244603-S4

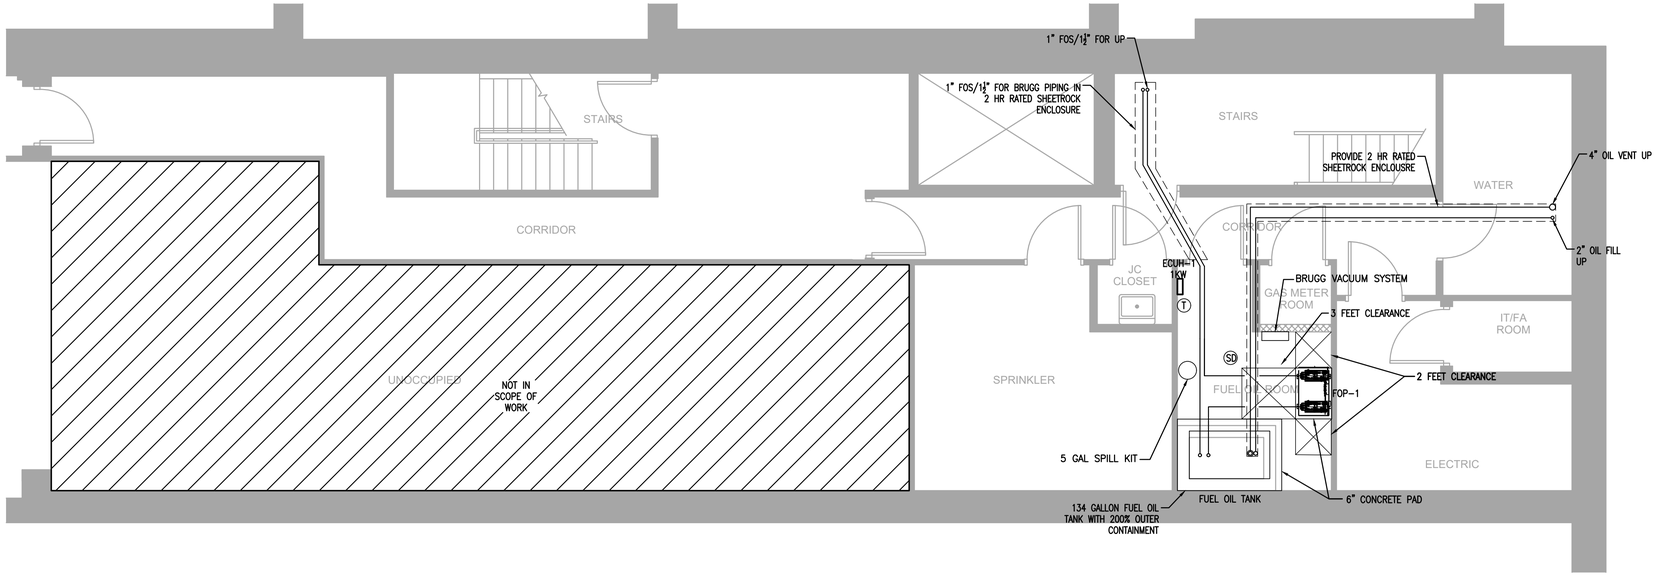

SUB-CELLAR FLOOR PLAN

SCALE: 1/4"=1'-0"

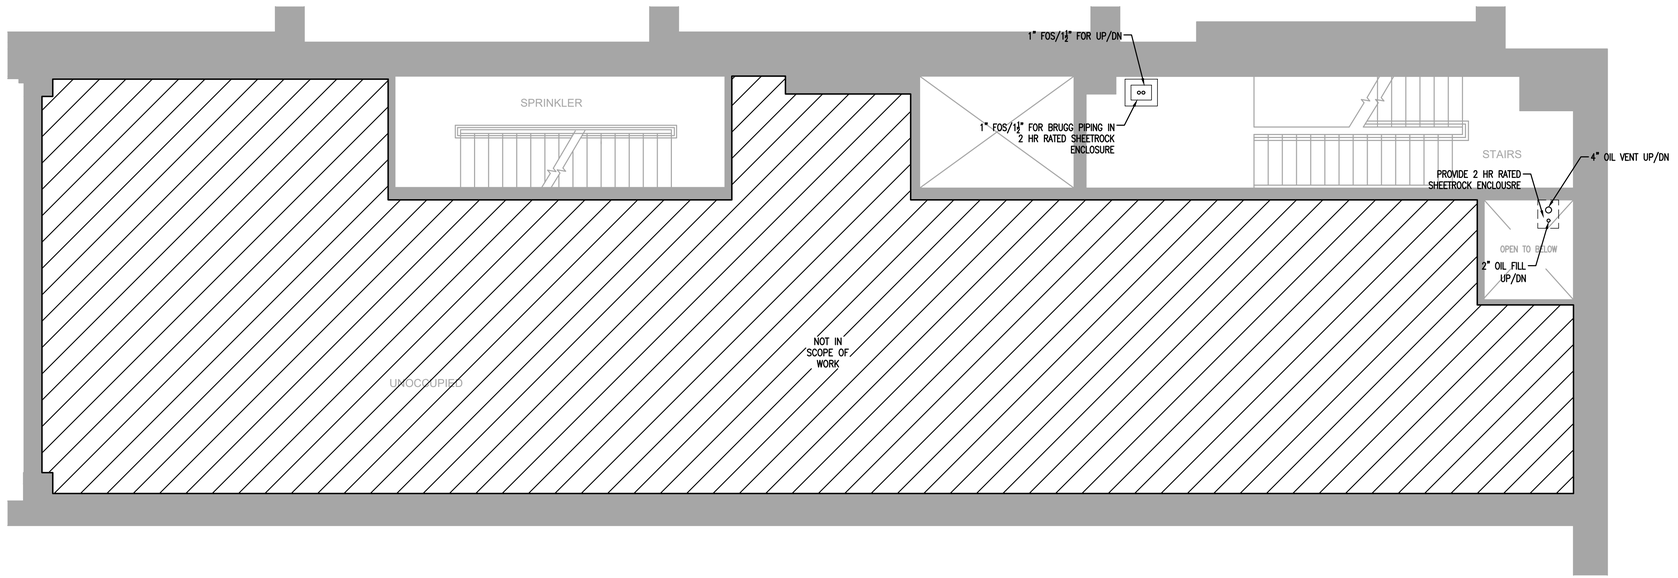


CELLAR FLOOR PLAN

SCALE: 1/4"=1'-0"

ALL CITY ENGINEERING, P.C.
33 Great Neck Road #3
Great Neck, NY 11021
(516)321-9490
info@allcityengineering.com

OWNER:
SEAFARERS INTERNATIONAL HOUSE
123 EAST 15TH STREET
NEW YORK, NY 1003
TEL: (212) 677-4800
EMAIL: LUCAS@SIHNYC.ORG

SITE PLAN



DoB STAMPS:

No.	DATE	REVISION
	01/08/26	BID SET

NOTE: Drawing may be printed at reduced scale

IT IS A VIOLATION OF THE STATE EDUCATION LAW SECTION 7209 (2) FOR ANY PERSON TO ALTER AN ITEM IN ANY WAY UNLESS SUCH PERSON IS ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, AND THE ENGINEER STAMPS SUCH CHANGES

PROJECT:

18 VESEY STREET
MANHATTAN, NY
BLOCK: 88 LOT: 4

DRAWING TITLE:

FUEL STORAGE SUB-CELLAR AND CELLAR FLOOR PLAN


DATE:	01/06/2026
PROJECT No.:	25086
CHECKED BY:	
DRAWN BY:	PY/LZ/BL

SEAL AND SIGNATURE

DWG. No.:
FS101.00


Sheets: 02 of 07

N.Y.C D.O.B No. :
M01244603-S4

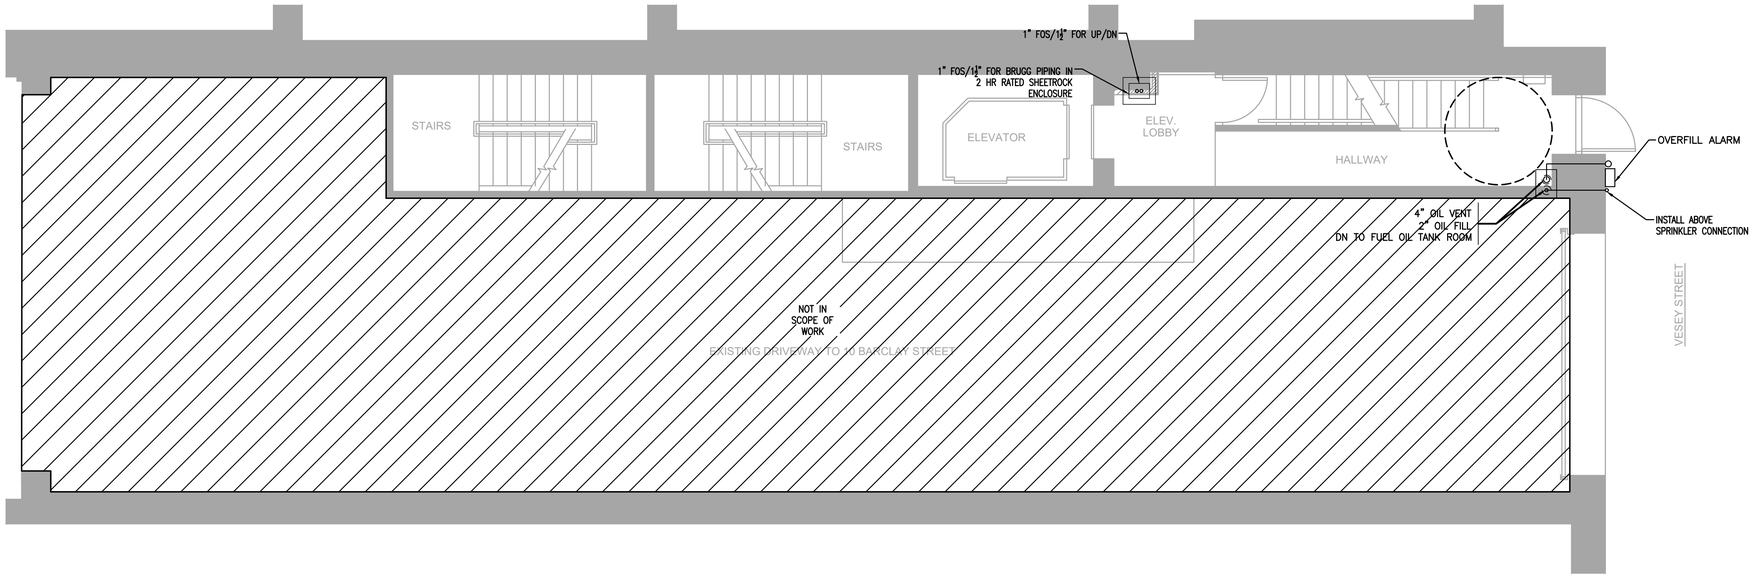

FIRST FLOOR PLAN

SCALE: 1/4"=1'-0"

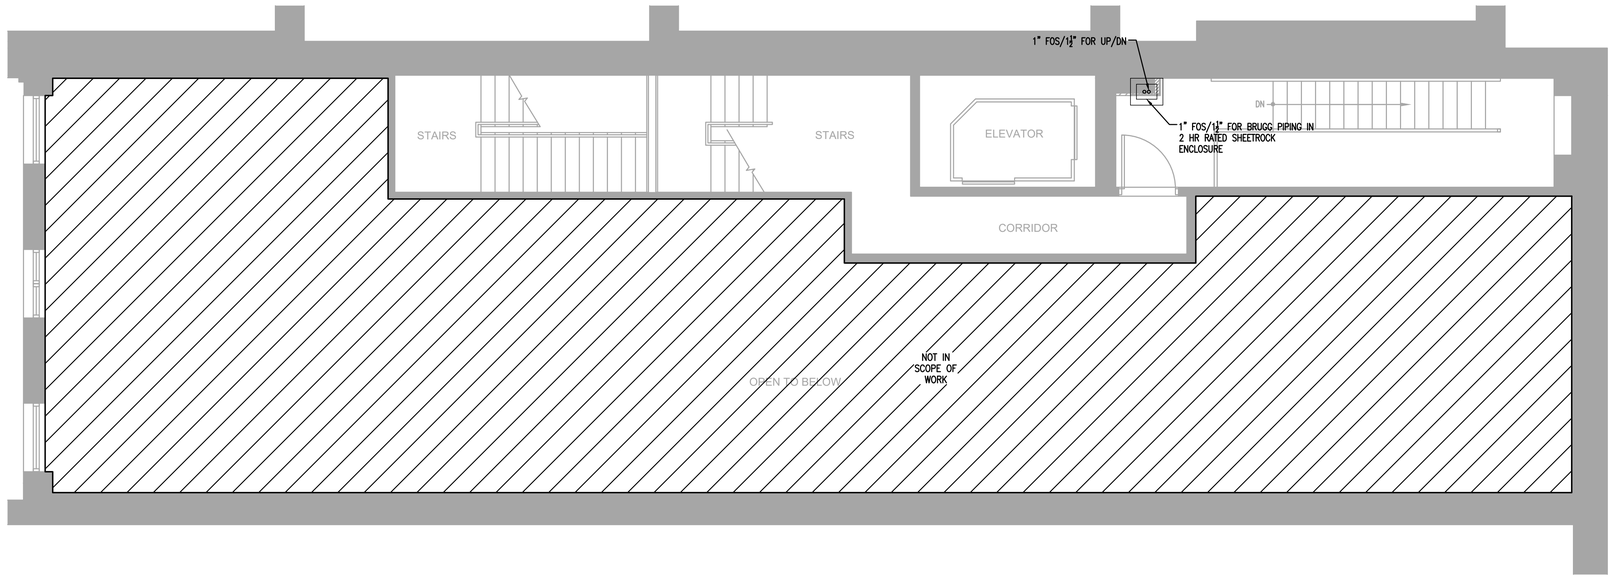


MEZZANINE FLOOR PLAN

SCALE: 1/4"=1'-0"

ALL CITY ENGINEERING, P.C.
33 Great Neck Road #3
Great Neck, NY 11021
(516)321-9490
info@allcityengineering.com

OWNER:
SEAFARERS INTERNATIONAL HOUSE
123 EAST 15TH STREET
NEW YORK, NY 1003
TEL: (212) 677-4800
EMAIL: LUCAS@SIHNYC.ORG

SITE PLAN



DoB STAMPS:

No.	DATE	REVISION
	01/08/26	BID SET

NOTE: Drawing may be printed at reduced scale

IT IS A VIOLATION OF THE STATE EDUCATION LAW SECTION 7209 (2) FOR ANY PERSON TO ALTER AN ITEM IN ANY WAY UNLESS SUCH PERSON IS ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, AND THE ENGINEER STAMPS SUCH CHANGES

PROJECT:

18 VESEY STREET
MANHATTAN, NY
BLOCK: 88 LOT: 4

DRAWING TITLE:

FUEL STORAGE
FIRST AND MEZZANINE FLOOR
PLAN


DATE:	01/06/2026
PROJECT No.:	25086
CHECKED BY:	
DRAWN BY:	PY/LZ/BL

SEAL AND SIGNATURE

DWG. No.:
FS102.00


Sheets: 03 of 07

N.Y.C D.O.B No. :
M01244603-S4

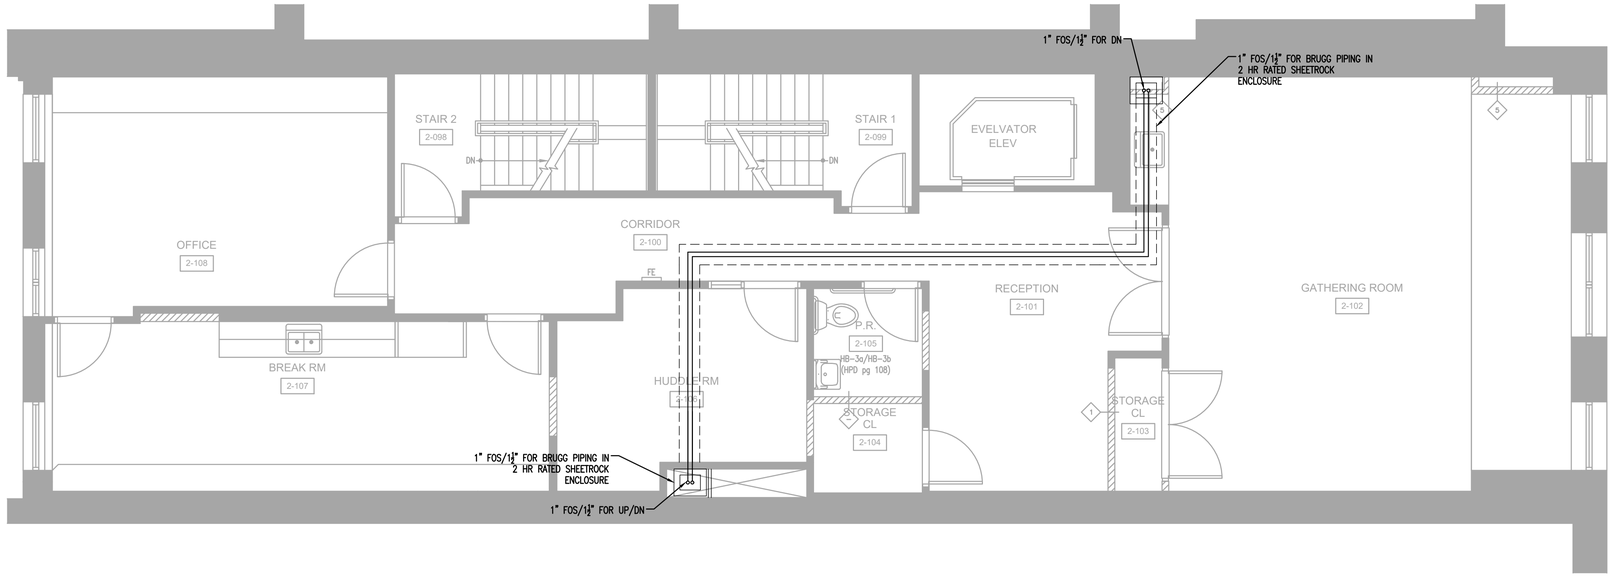

SECOND FLOOR PLAN

SCALE: 1/4"=1'-0"

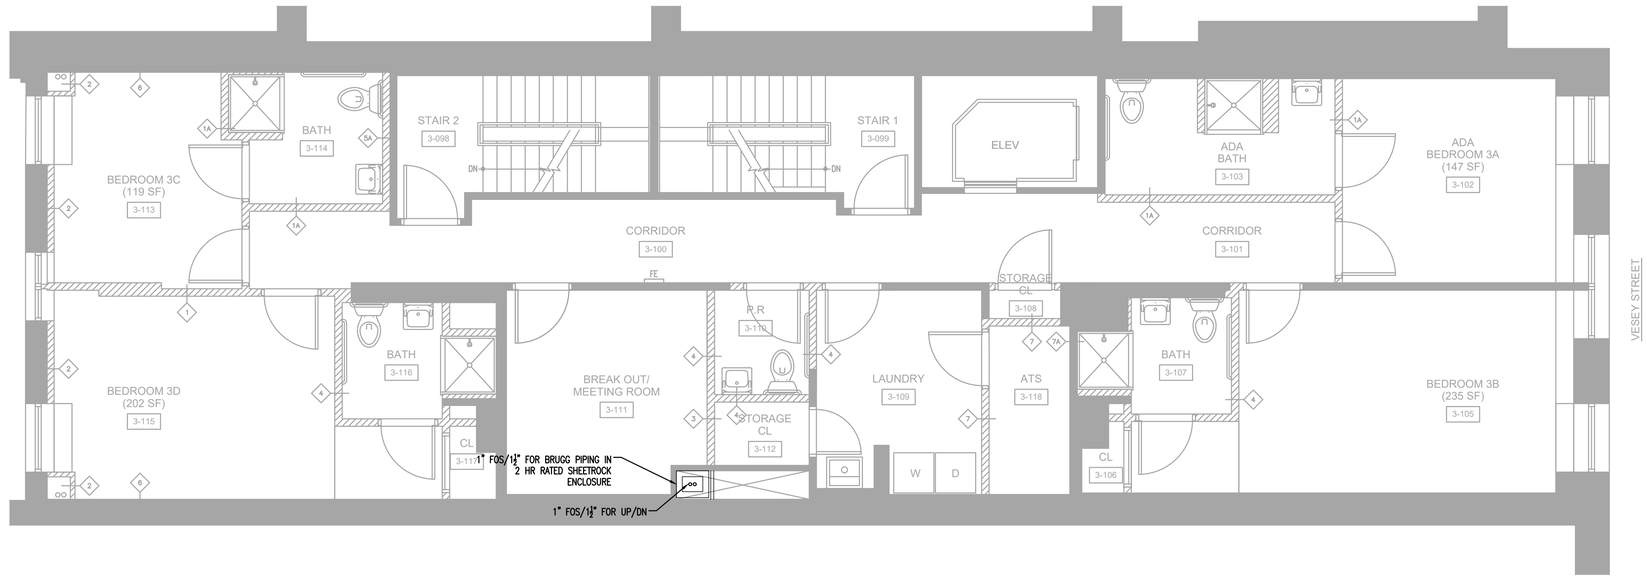


THIRD FLOOR PLAN

SCALE: 1/4"=1'-0"

ALL CITY ENGINEERING, P.C.
33 Great Neck Road #3
Great Neck, NY 11021
(516)321-9490
info@allcityengineering.com

OWNER:
SEAFARERS INTERNATIONAL HOUSE
123 EAST 15TH STREET
NEW YORK, NY 1003
TEL: (212) 677-4800
EMAIL: LUCAS@SIHNYC.ORG

SITE PLAN



DoB STAMPS:

No.	DATE	REVISION
	01/08/26	BID SET

NOTE: Drawing may be printed at reduced scale

IT IS A VIOLATION OF THE STATE EDUCATION LAW SECTION 7209 (2) FOR ANY PERSON TO ALTER AN ITEM IN ANY WAY UNLESS SUCH PERSON IS ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, AND THE ENGINEER STAMPS SUCH CHANGES

PROJECT:

18 VESEY STREET
MANHATTAN, NY
BLOCK: 88 LOT: 4

DRAWING TITLE:

FUEL STORAGE
SECOND AND THIRD
FLOOR PLAN


DATE:	01/06/2026
PROJECT No.:	25086
CHECKED BY:	
DRAWN BY:	PY/LZ/BL

SEAL AND SIGNATURE

DWG. No.:
FS103.00


Sheets: 04 of 07

N.Y.C D.O.B No. :
M01244603-S4

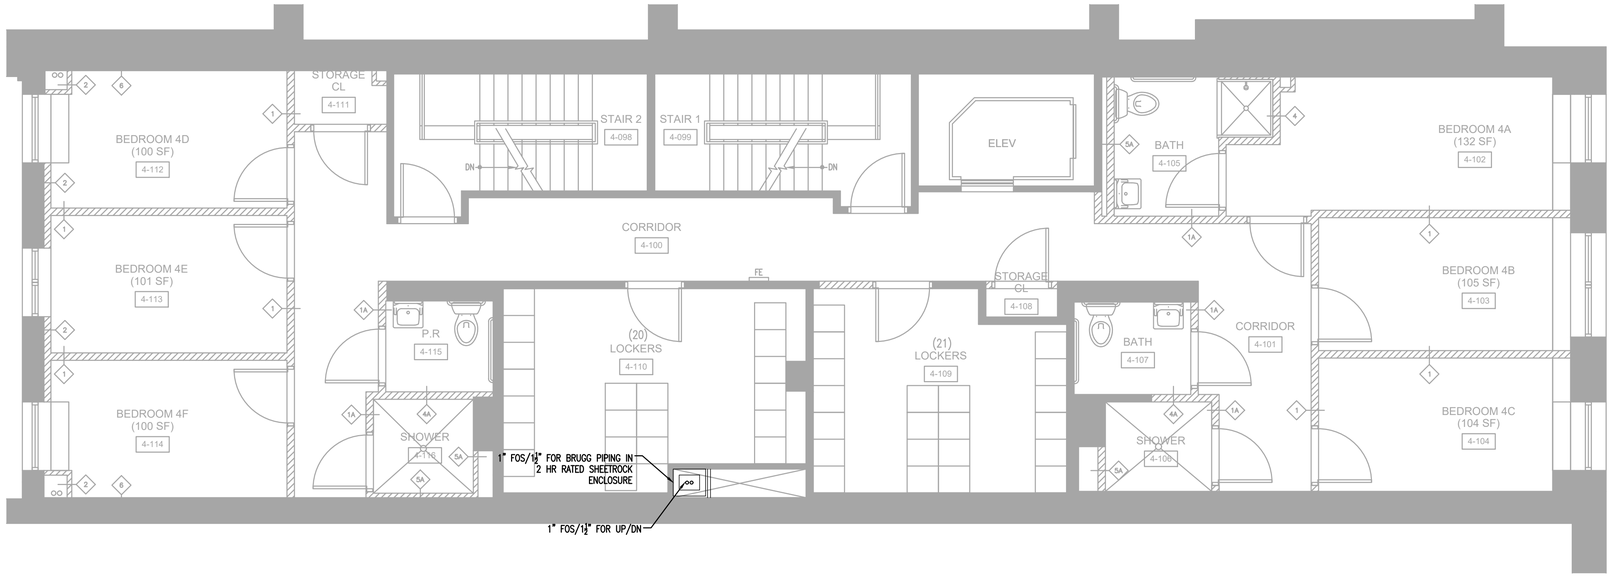

FOURTH FLOOR PLAN

SCALE: 1/4"=1'-0"

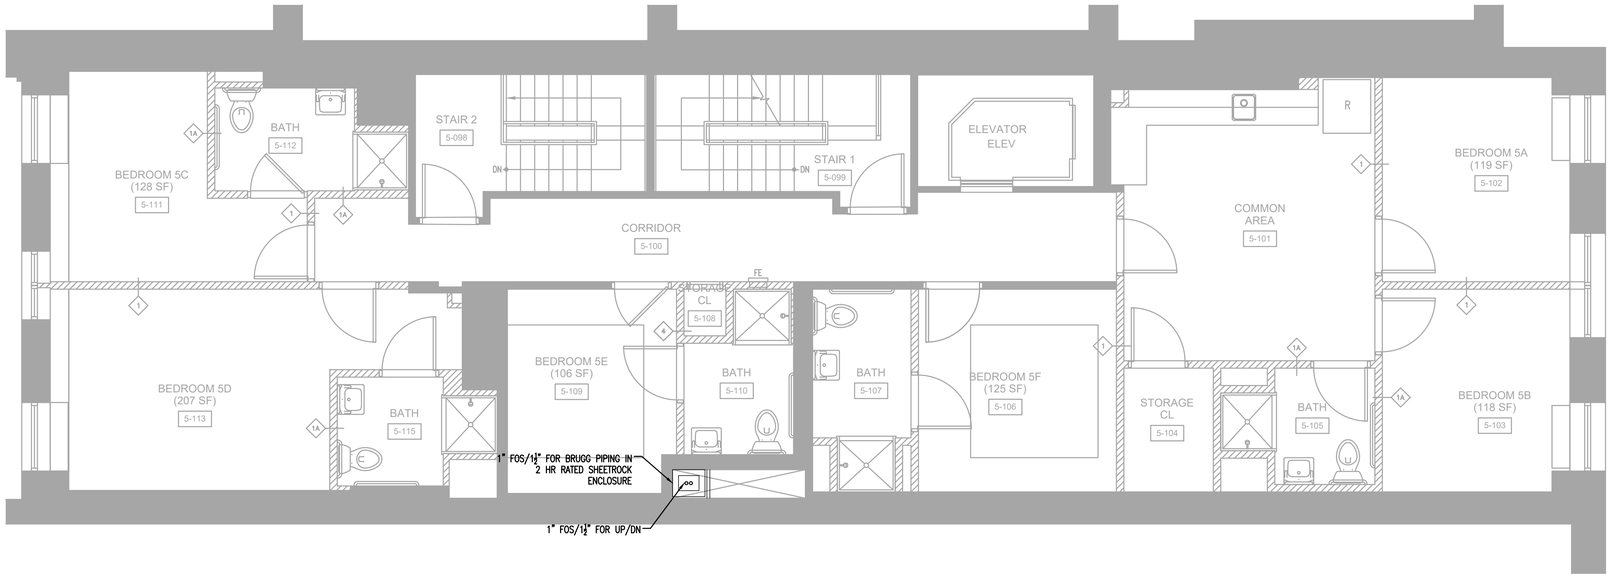


FIFTH FLOOR PLAN

SCALE: 1/4"=1'-0"

ALL CITY ENGINEERING, P.C.
33 Great Neck Road #3
Great Neck, NY 11021
(516)321-9490
info@allcityengineering.com

OWNER:
SEAFARERS INTERNATIONAL HOUSE
123 EAST 15TH STREET
NEW YORK, NY 1003
TEL: (212) 677-4800
EMAIL: LUCAS@SIHNYC.ORG

SITE PLAN



DoB STAMPS:

No.	DATE	REVISION
	01/08/26	BID SET

NOTE: Drawing may be printed at reduced scale

IT IS A VIOLATION OF THE STATE EDUCATION LAW SECTION 7209 (2) FOR ANY PERSON TO ALTER AN ITEM IN ANY WAY UNLESS SUCH PERSON IS ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, AND THE ENGINEER STAMPS SUCH CHANGES

PROJECT:

18 VESEY STREET
MANHATTAN, NY
BLOCK: 88 LOT: 4

DRAWING TITLE:

FUEL STORAGE
FOURTH AND FIFTH
FLOOR PLAN


DATE:	01/06/2026
PROJECT No.:	25086
CHECKED BY:	
DRAWN BY:	PY/LZ/BL

SEAL AND SIGNATURE

DWG. No.:
FS104.00

Sheets: 05 of 07

N.Y.C D.O.B No. :
M01244603-S4

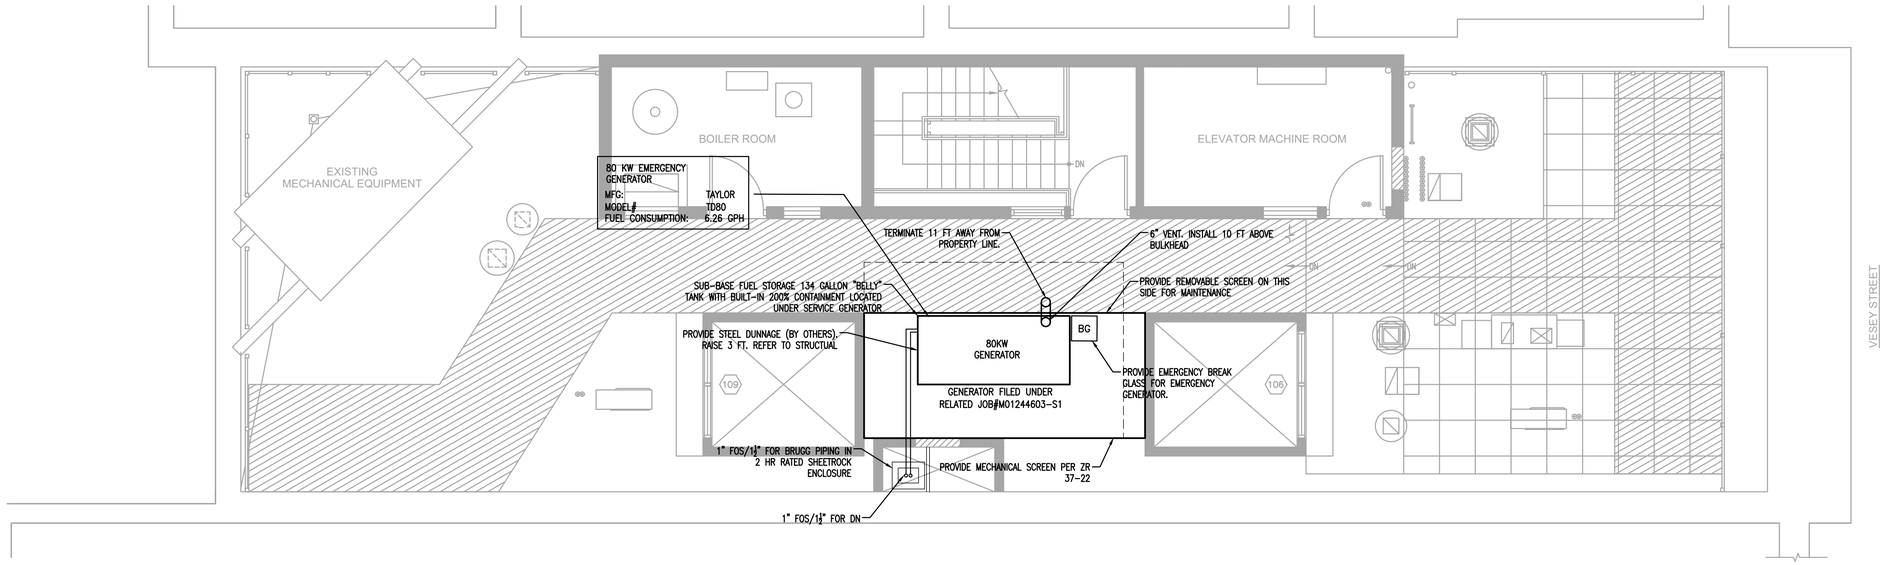


ROOF PLAN

SCALE: 1/4"=1'-0"

ALL CITY ENGINEERING, P.C.
33 Great Neck Road #3
Great Neck, NY 11021
(516)321-9490
info@allcityengineering.com

OWNER:
SEAFARERS INTERNATIONAL HOUSE
123 EAST 15TH STREET
NEW YORK, NY 1003
TEL: (212) 677-4800
EMAIL: LUCAS@SIHNYC.ORG

SITE PLAN



DoB STAMPS:

No.	DATE	REVISION
	01/08/26	BID SET

NOTE: Drawing may be printed at reduced scale

IT IS A VIOLATION OF THE STATE EDUCATION LAW SECTION 7209 (2) FOR ANY PERSON TO ALTER AN ITEM IN ANY WAY UNLESS SUCH PERSON IS ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, AND THE ENGINEER STAMPS SUCH CHANGES

PROJECT:

18 VESEY STREET
MANHATTAN, NY
BLOCK: 88 LOT: 4

DRAWING TITLE:

FUEL STORAGE
ROOF PLAN


DATE:	01/06/2026
PROJECT No.:	25086
CHECKED BY:	
DRAWN BY:	PY/LZ/BL

SEAL AND SIGNATURE


DWG. No.:
FS105.00

Sheets: 06 of 07

N.Y.C D.O.B No. :
M01244603-S4

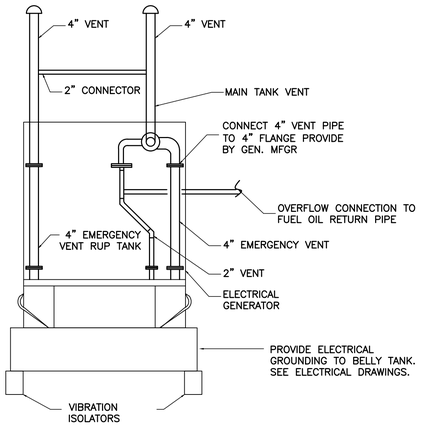

REAR VIEW OF EMERGENCY GENERATOR
N.T.S.



DETAIL- FUEL OIL PIPING CHASE


NO SCALE

AS PER MC 1301.8 ABSORBENT MATERIALS. THE BUILDING OWNER SHALL MAINTAIN A SUFFICIENT QUANTITY OF ABSORBENT MATERIALS NEAR FUEL-OIL STORAGE TANKS, PUMPS, AND RELATED EQUIPMENT TO CONTROL LEAKS AND SLIPPING HAZARDS.

AS PER 1301.9 CERTIFICATE OF FITNESS. WHERE FUEL-OIL PIPING SYSTEMS UTILIZE PUMPS TO TRANSFER FUEL-OIL TO EQUIPMENT AT LEVELS ABOVE THE LOWEST FLOOR OR TO STORAGE TANKS AT LEVELS ABOVE THE LOWEST FLOOR IN BUILDINGS, A QUALIFIED EMPLOYEE OR CONTRACTED GENERAL COMPANY HOLDING A CERTIFICATE OF FITNESS FROM THE FIRE DEPARTMENT SHALL MAINTAIN THE FUEL-OIL SYSTEM.

PER MC 1305.6.2, FUEL OIL FILL PIPE SHALL TERMINATE OUTSIDE OF A BUILDING AT OR ABOVE GRADE AT A POINT LEAST 2 FEET FROM ANY BUILDING OPENING AND 5 FEET AWAY FROM ANY SUBWAY GRATING AT THE SAME OR LOWER LEVEL. A FILL PIPE SHALL TERMINATE IN A MANNER DESIGNED TO MINIMIZE SPILLING WHEN THE FILLING HOSE IS DISCONNECTED.

VENT PIPE SHALL TERMINATE AT LEAST 2 FEET FROM ANY BUILDING OPENING AND NOT LESS THAN 2 FEET NO MORE THAN 12 FEET ABOVE THE THE FILL PIPE TERMINAL AND SHALL COMPLY WITH NEW YORK CITY BUILDING CODE SECTION MC 1305.7.2.

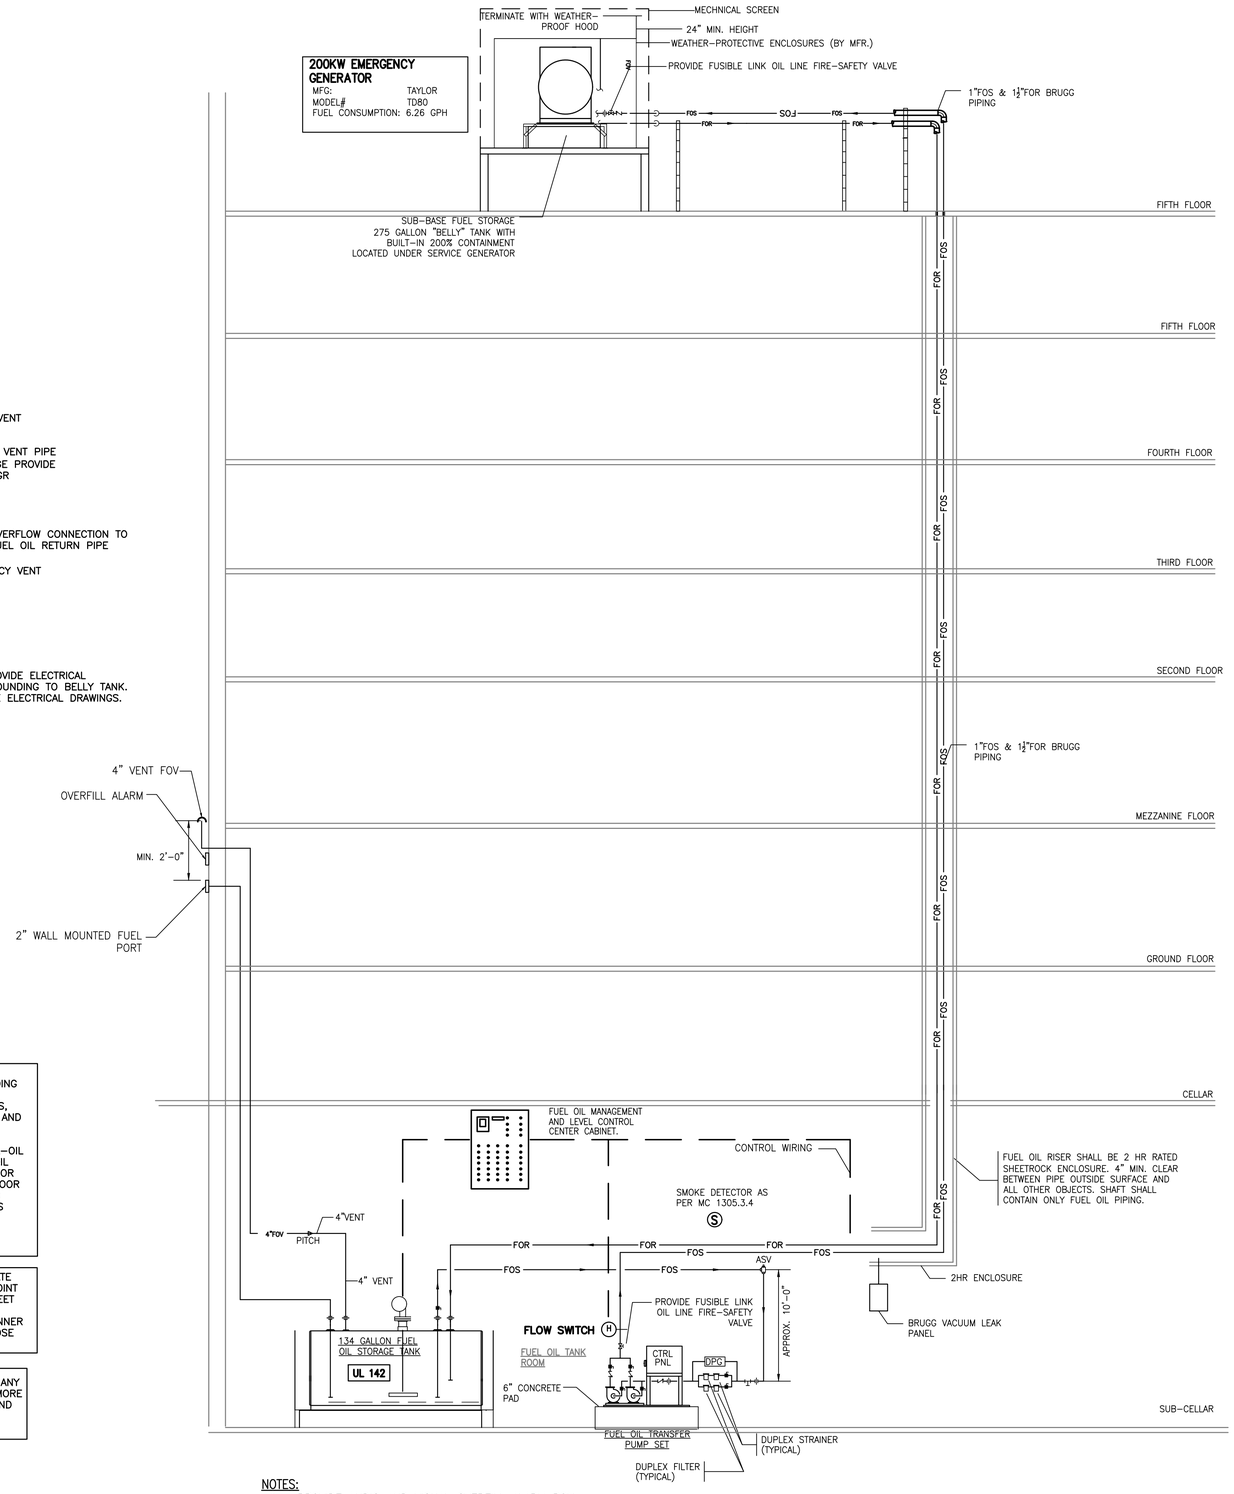

NOTES:
1. PROVIDE AUDIO AND VISUAL OVERFILL ALARM BOX.

FUEL OIL SYSTEM RISER DIAGRAM
NOT TO SCALE

PER NYC BC 2702.1.6, GENERATOR HAS TO BE REGISTERED WITH DEP BEFORE SIGN-OFF.

PER NYC BC 110.6, OBTAIN CERTIFICATE OF COMPLIANCE PRIOR TO SIGN-OFF

NOTES:

1. VENT PIPE SHALL TERMINATE AT LEAST 2 FEET FROM ANY BUILDING OPENING AND LESS THAN 2 FEET NO MORE THAN 12 FEET ABOVE THE THE FILL PIPE TERMINAL AND SHALL COMPLY WITH NEW YORK CITY BUILDING CODE SECTION MC 1305.7.2.

3. THE DIESEL TANK MUST BE FACTORY TESTED FOR AT LEAST 22.5 PSIG AND APPROPRIATE ASME STAMP SHALL BE AFFIXED ON IT. FUEL CONTAINMENT SHALL BE PROVIDED.

4. FUEL OIL LINES:
   A. INSTALL ALL THE FUEL OIL LINES IN SUCH A WAY AS TO FACILITATE TESTING OF THE PIPE WITH THE EQUIPMENT INSTALLED AND VALVED OFF.
   B. THE PIPING WILL HAVE VALVE AND TEE INSTALLED IN THE SUPPLY SIDE AND THE SUCTION SIDE OF THE PUMP TO ALLOW A PRESSURE GAUGE AND ISOLATION VALVE TO BE INSTALLED AND ALL VALVES SHALL HAVE UNIONS INSTALLED AFTER THE VALVES OR ADJACENT TO THE EQUIPMENT.
   C. TEST THE LINES WITH OIL OR WATER.
   D. AFTER THE FUEL OIL PIPING HAS BEEN FILLED AND ALL THE AIR HAS BEEN REMOVED, THE FUEL OIL PIPING SHALL BE PRESSURIZED TO A PRESSURE OF 150 PSI AND SHALL MAINTAIN THAT PRESSURE FOR A PERIOD OF ONE (1) HOUR,
   E. ANY LEAKS DETECTED OR DROP IN PRESSURE INDICATED BY THE PRESSURE GAUGE SHALL INDICATE A FAILED TEST.
   F. IF THE TEST SHOULD FAIL, CONTRACTOR SHALL REPAIR THE PIPE AND/OR REPLACE THE FITTINGS AT NO ADDITIONAL COST.
   G. ALL ISOLATION VALVES INSTALLED FOR THIS TEST AND ALL VALVES SHALL BE OF THE POST INDICATOR TYPE.
   H. THE APPROVED PRESSURE GAUGE USED IN CONJUNCTION WITH THESE TESTS SHALL HAVE PRESSURE INDICATIONS OF ONE (1) POUND/SQUARE INCH INCREMENTS.

5. ALL FIELD TESTING SHALL BE PERFORMED IN THE PRESENCE OF THE DOB INSPECTOR AND THE SPECIAL INSPECTION AGENCY

6. LIFTING POINTS ARE CONSTRUCTED FOR LIFTING 20,000# EACH.

7. PROVIDE FLEXIBLE TYPE FINAL CONNECTIONS FOR DIESEL ENGINE.

8. PIPING FOR OIL BURNING EQUIPMENT
   A. PIPE SHALL BE PITCHED IN THE DIRECTION INDICATED ON THE DRAWINGS, AT LEAST 1" IN 10", UNLESS OTHERWISE SHOWN.
   B. FILL PIPE: PROVIDE FILL PIPE, OF SIZE SHOWN ON DRAWINGS FOR EACH TANK. FILL PIPES SHALL PITCH TOWARD TANKS, SHALL BE CONNECTED INTO TAPPING ON TANKS, AND SHALL BE EXTENDED TO FILL PIPE TERMINALS NEAR THE SIDEWALK CURB, OR OTHERWISE SHOWN ON THE DRAWINGS.
   C. VENT PIPE: A VENT PIPE SIZE INDICATED ON THE DRAWINGS SHALL BE CONNECTED TO THE VENT PIPE TAPPING ON EACH TANK AND EXTENDED TO A VENT HEAD. VENT PIPE SHALL PITCH TOWARD TANK AND SHALL PITCH TOWARD TANK AND SHALL BE SUPPORTED AS INDICATED ON THE DRAWINGS.

9. FUEL OIL GAUGE PIPING SHALL BE COPPER MATERIAL, TYPE L, ASTM B88. PROTECTIVE ENCLOSURE PIPING, IF REQUIRED FOR FUEL OIL GAUGE PIPING SHALL BE BLACK STEEL SCHEDULE 40.

10. FUEL OIL VENT (FOV) 125 PSIG AND LESS:
    NOT DIRECTLY BURIED IN THE GROUND:

    1. 2½" AND LESS: STANDARD WEIGHT BLACK STEEL PIPE, WITH SCREWED END STANDARD WEIGHT MALLEABLE IRON FITTINGS AND FUEL RESISTANT THREAD SEALANT, OR WELD END STANDARD WEIGHT STEEL FITTINGS.
    2. 3" AND UP: STANDARD WEIGHT BLACK STEEL PIPE WITH WELD END STANDARD WEIGHT STEEL FITTINGS.
    3. ACCEPTABLE OPTIONS ARE BRASS PIPE, COPPER OR COPPER-ALLOY PIPE OR TYPE K COPPER OR COPPER ALLOY TUBING PER MC TABLE 1302.3. JOINTS BETWEEN BRASS PIPE OR FITTINGS SHALL BE BRAZED, MECHANICAL THREADED OR WELDED JOINTS COMPLYING WITH SECTION MC 1303.3 AND MC 1303.4. JOINTS BETWEEN COPPER OR COPPER ALLOY PIPE OR FITTINGS SHALL BE BRAZED, MECHANICAL, THREADED OR WELDED JOINTS COMPLYING WITH SECTIONS MC 1303.3 AND MC 1303.6. JOINTS BETWEEN COPPER OR COPPER ALLOY TUBING OR FITTINGS SHALL BE BRAZED OR MECHANICAL JOINTS COMPLYING WITH SECTION MC 1303.3 OR FLARED JOINTS. FLARED JOINTS SHALL BE MADE BY A TOOL DESIGNED FOR THAT OPERATION. (REFER TO SECTION MC 1303.7).

    DIRECTLY BURIED IN THE GROUND:

    1. OPTION 1 (ALL SIZES): EXTRA HEAVY WEIGHT BLACK STEEL PIPE (SCHEDULE 80) WITH WELD END EXTRA HEAVY WEIGHT STEEL FITTINGS WITH CATHODIC PROTECTION. WHERE SACRIFICIAL ANODES OR IMPRESSED CURRENT SYSTEMS ARE USED, MONITORS TO CHECK ON THE ADEQUACY OF THE SYSTEM SHALL BE INSTALLED AND KEPT IN PROPER WORKING CONDITION. EXCEPT WHERE CATHODIC PROTECTION IS PROVIDED BY IMPRESSED CURRENT, UNDERGROUND PIPING SYSTEMS SHALL HAVE DIELECTRIC BUSHINGS, WASHERS, SLEEVES OR GASKETS INSTALLED AT THE END TO ELECTRICALLY ISOLATE THE PIPING SYSTEM FROM THE TANK. THESE DIELECTRIC CONNECTORS MUST BE CHEMICALLY COMPATIBLE WHEN EXPOSED TO PETROLEUM, PETROLEUM ADDITIVES AND CORROSIVE SOILS. THE CORROSION PROTECTION SYSTEM MUST BE DESIGNED BY THE CONTRACTOR'S QUALIFIED ENGINEER OR CORROSION SPECIALIST AND MUST BE DESIGNED TO PROVIDE A MINIMUM OF THIRTY (30) YEARS OF PROTECTION AGAINST EXTERNAL CORROSION. SUBMIT THE UNDERGROUND OIL PIPING PROTECTION SYSTEM DESIGN (CATHODIC PROTECTION BY SACRIFICIAL ANODES OR IMPRESSED CURRENT) FOR APPROVAL.
    2. OPTION 2 (ALL SIZES): DOUBLE WALL STEEL PIPE; INNER PIPE: EXTRA HEAVY WEIGHT BLACK STEEL PIPE (SCHEDULE 80) WITH WELD END EXTRA HEAVY WEIGHT STEEL FITTINGS; OUTER PIPE: STANDARD WEIGHT BLACK STEEL PIPE (SCHEDULE 40) WITH WELD END STANDARD WEIGHT STEEL FITTINGS, PRIMED WITH A FACTORY-FORMULATED GALVANIZED METAL PRIMER FOR EXTERIOR APPLICATION, THEN FINISH COATED WITH BLACK ASPHALTUM..


11. PROVIDE FUSIBLE LINK OPERATED VALVE IN THE SUPPLY LINE TO STOP FUEL OIL FLOW IN AN EVENT OF FIRE.

12. PROVIDE A REMOTE CONTROL TO STOP THE FLOW OF OIL TO THE GENERATOR. LOCATE AND LABEL THE CONTROL "REMOTE CONTROL FOR GENERATOR".

ALL CITY ENGINEERING, P.C.
33 Great Neck Road #3
Great Neck, NY 11021
(516)321-9490
info@allcityengineering.com

OWNER:
SEAFARERS INTERNATIONAL HOUSE
123 EAST 15TH STREET
NEW YORK, NY 1003
TEL: (212) 677-4800
EMAIL: LUCAS@SIHNYC.ORG

SITE PLAN



DoB STAMPS:

No.	DATE	REVISION
	01/08/26	BID SET

NOTE: Drawing may be printed at reduced scale

IT IS A VIOLATION OF THE STATE EDUCATION LAW SECTION 7209 (2) FOR ANY PERSON TO ALTER AN ITEM IN ANY WAY UNLESS SUCH PERSON IS ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, AND THE ENGINEER STAMPS SUCH CHANGES

PROJECT:

18 VESEY STREET
MANHATTAN, NY
BLOCK: 88 LOT: 4

DRAWING TITLE:

FUEL STORAGE FUEL OIL RISER DIAGRAM & DETAILS

DATE:	01/06/2026
PROJECT No.:	25086
CHECKED BY:	
DRAWN BY:	PY/LZ/BL

SEAL AND SIGNATURE

DWG. No.:
FS300.00

Sheets: 07 of 07

N.Y.C D.O.B No. :
M01244603-S4