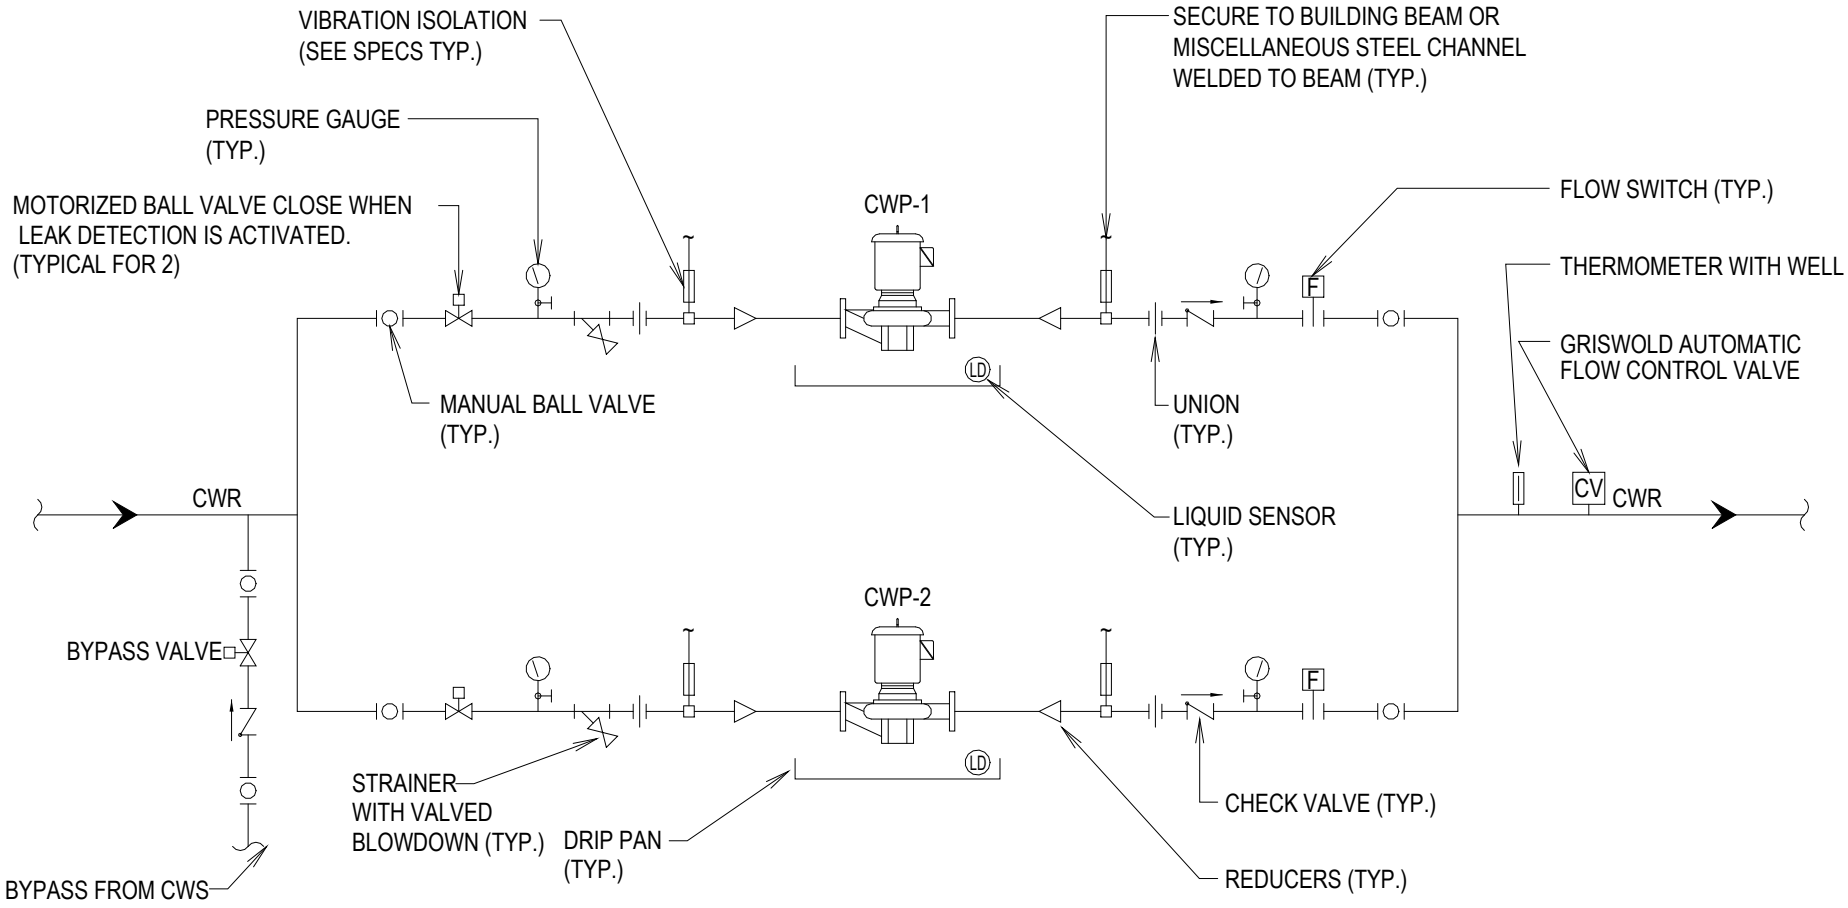


NOTES:

1. CONTRACTOR SHALL PROVIDE SPRING VIBRATION ISOLATORS.
2. CONTRACTOR SHALL COORDINATE WITH ENGINEER IF FLOW SWITCHES ARE REQUIRED.

IN-LINE PUMP SET SCHEMATIC TRIM DETAIL

NOT TO SCALE

HD-053

SUPPLEMENTARY STEEL ANGLE OR CHANNEL SUPPORT WELDED TO BEAM FLANGE, ALL

SUPPLEMENTARY STEEL ANGLE OR CHANNEL SUPPORT WELDED TO BEAM FLANGE, ALL

M-903 detail HD-053 (contract drawings 04/03/2026). Shown per pump: motorized ball valve (closes on leak), drip pan with liquid sensor LD, check valve, flow switch F (note 2: coordinate with engineer if required). Common: Griswold auto flow valve, thermometer. NOT shown: DP transmitter / DP taps (only M-102 seq. 3e: pipe mounted DP sensor 3/4 down the longest run).