


EXPANSION BOARD WIRING DIAGRAM

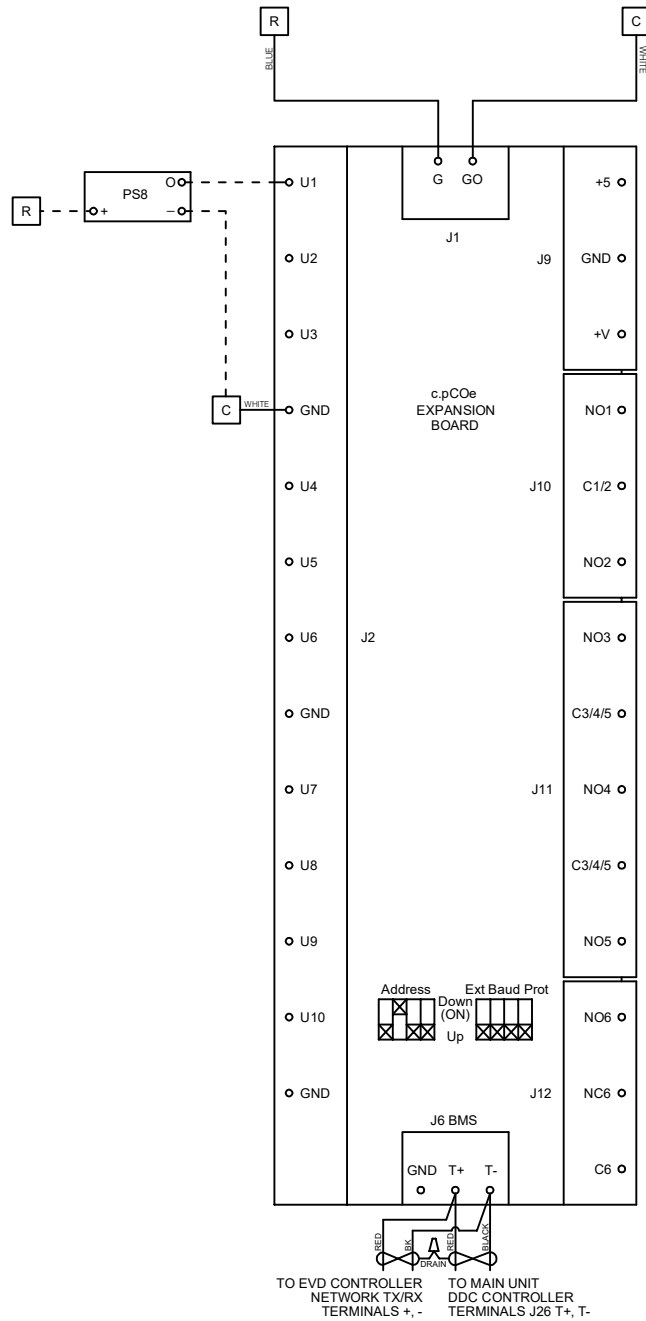

GREENHECK
Building Value in Air.

Wiring Diagram Code:

GD000XXXX000003XY07

CAUTION

UNIT SHALL BE GROUNDED IN ACCORDANCE WITH N.E.C.
POWER MUST BE OFF WHILE SERVICING.

NOTES

USE COPPER CONDUCTORS ONLY
60° C FOR TERMINALS RATED LESS THAN 100 AMPS.
75° C FOR TERMINALS RATED 100 AMPS OR MORE.

FIELD CONTROL WIRING RESISTANCE SHOULD
NOT EXCEED 0.75 OHM.

FIELD WIRED - - - - -

FACTORY SUPPLIED AND WIRED - - - - -

NOTE: 1
MODBUS COMMUNICATION WIRING. DAISY CHAIN TO ALL MODBUS
DEVICES.

WIRE COLOR CODE

BK	BLACK	BL	BLUE	BR	BROWN
GY	GRAY	LT BL	LIGHT BLUE	O	ORANGE
PK	PINK	PR	PURPLE	R	RED
W	WHITE	Y	YELLOW		

LEGEND

PS8 SPACE PRESSURE SENSOR