


ERU-1 / ERU-2 / ERU-3 Greenheck RVE-85-52D - duct sensor field wiring, one unit (typical of 3)

Northern Wolves AC | IPA Church, 310A S. Oyster Bay Rd, Syosset NY | ref. Greenheck submittal wiring diagrams G31 (p.15) and Y07 (p.18)

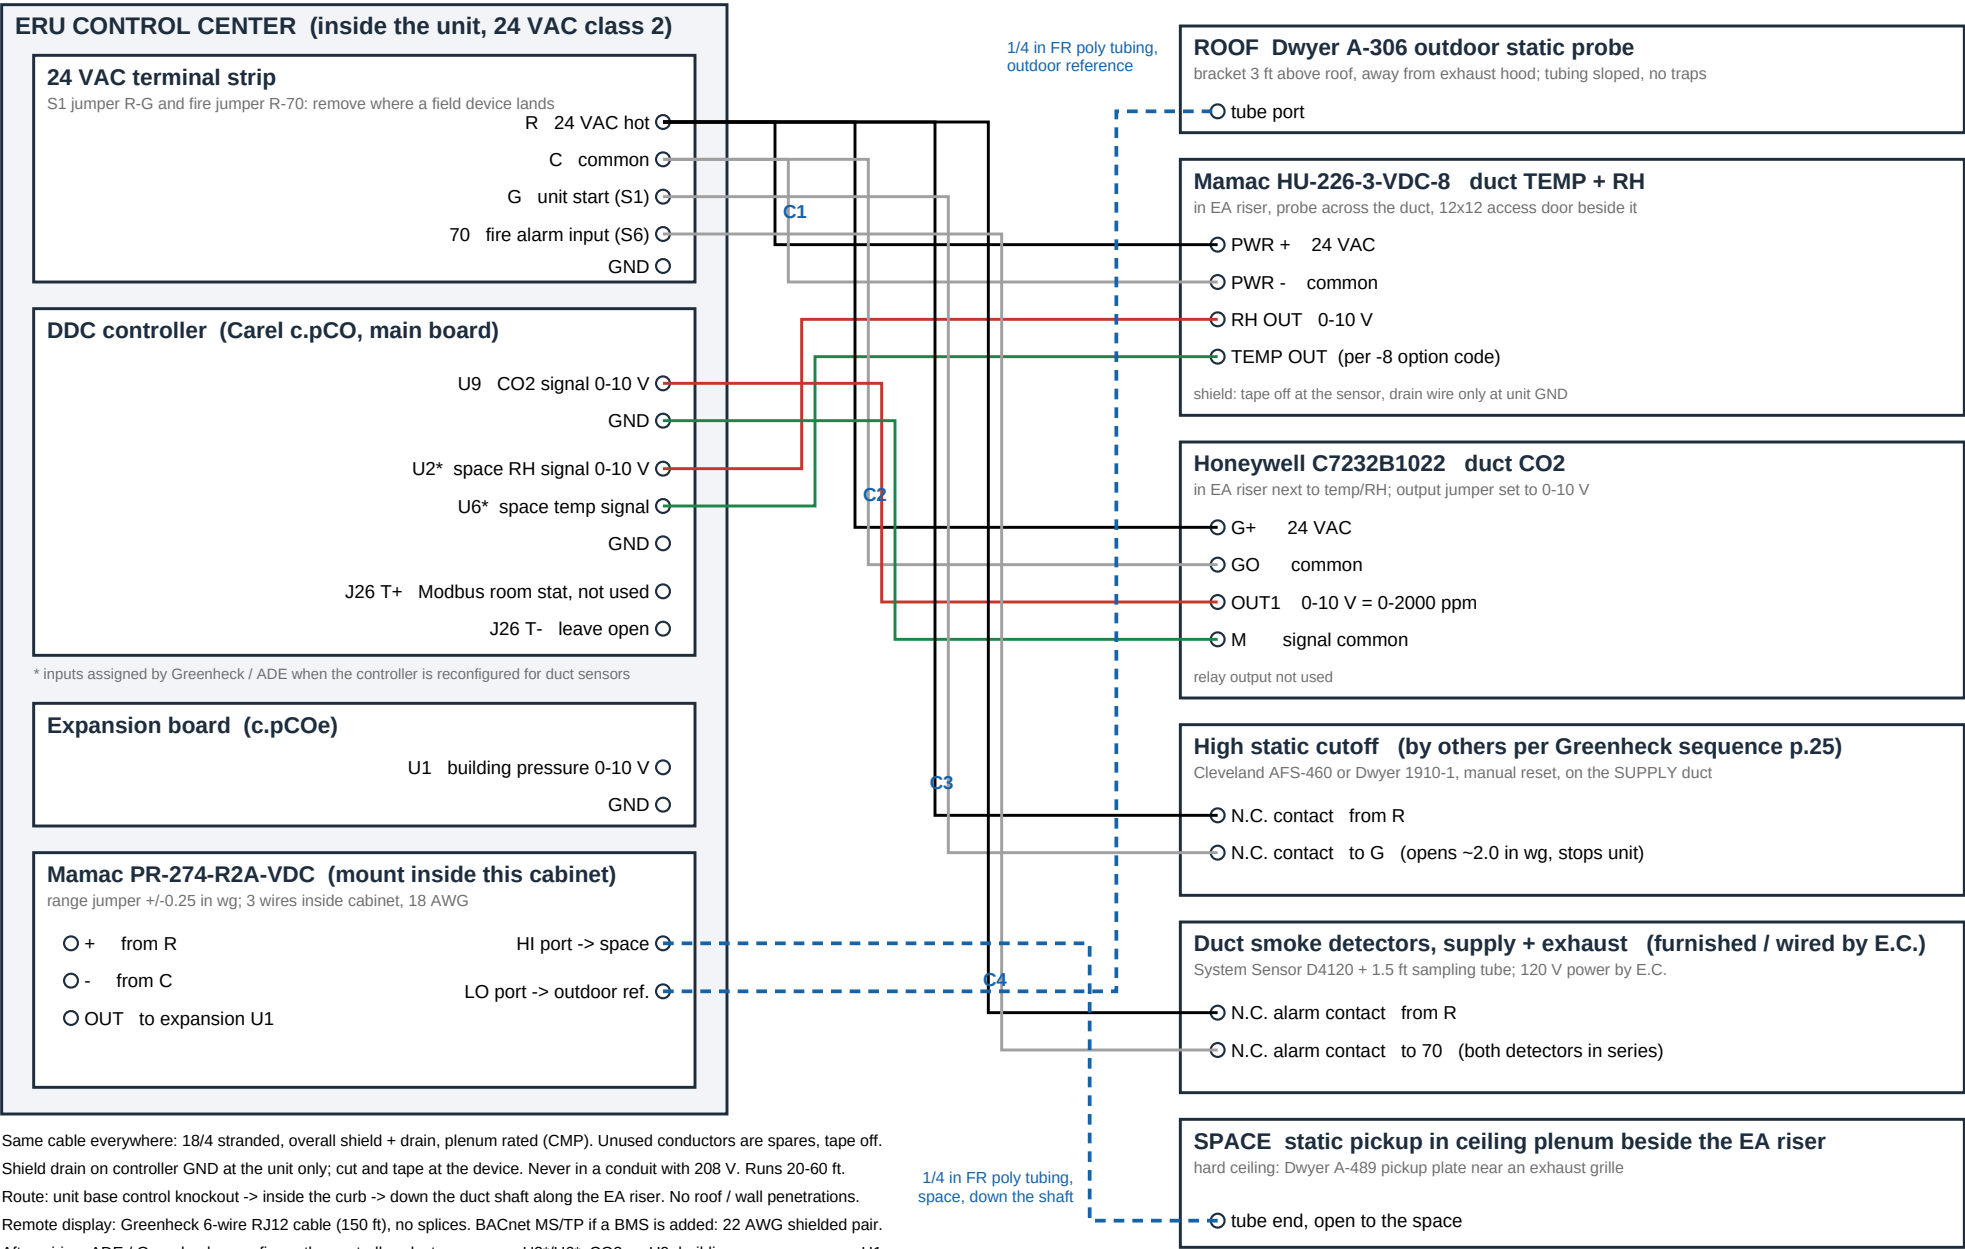

Cable	Device	BLK	WHT	RED	GRN	Length
C1	duct temp/RH Mamac HU-226	R -> PWR+	C -> PWR-	RH OUT -> U2*	TEMP OUT -> U6*	20-60 ft
C2	duct CO2 Honeywell C7232B	R -> G+	C -> GO	OUT1 -> U9	M -> GND	20-60 ft
C3	high static cutoff switch	R -> N.C.	N.C. -> G	spare	spare	< 20 ft
C4	smoke detector contacts (E.C.)	R -> N.C.	N.C. -> 70	spare	spare	< 30 ft

Wire colors are the usual 18/4 jacket set; if the spool differs, keep the same order: 24 V hot, common, signal 1, signal 2.