



Variable:E\_ecal | Cuts: Pcharged < 200 && cos\_thet <= 1


ee

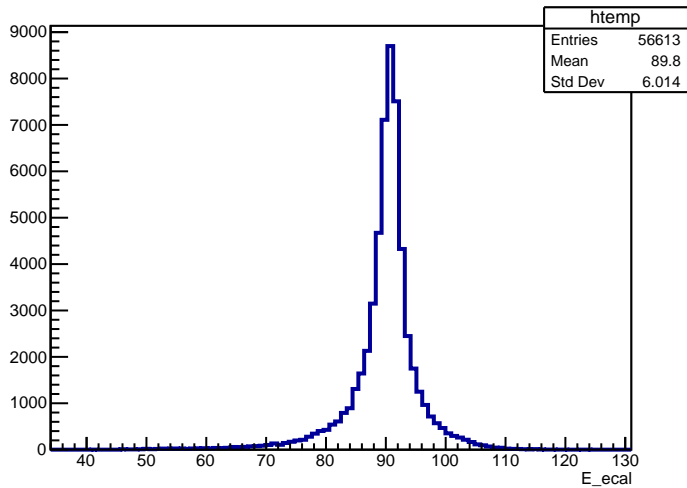

mm

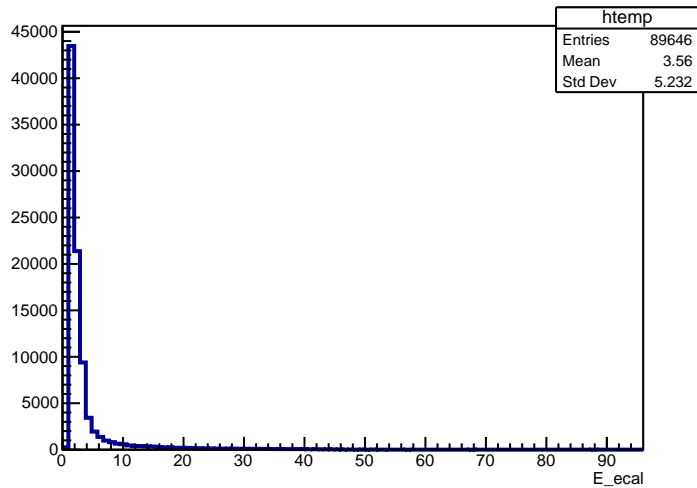

tt

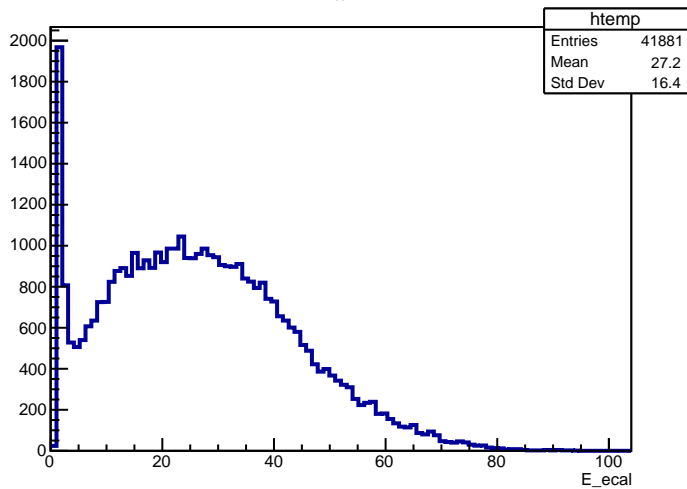

qq

