

Modbus Register Mapping

Control

AUX101/102

DEIF AGC-5

DMC 1000/DMC 1500

DMC 6000/DMC 6600(P)

ECO Tier4

MCM 3320

PC500/PC550

PC40

PC80

PCC 1301

PowerCommand 1.x/2.x/3.x

PS0500/PS060X

TM241 on QSK50 and QSK60 Series
Containerized Generator Sets

CCS/BCS Controller

Table of Contents

1. IMPORTANT SAFETY INSTRUCTIONS	1
1.1 Warning, Caution, and Note Styles Used in This Manual	1
1.2 Fuel and Fumes Are Flammable	1
1.2.1 Gaseous Fuels	2
1.2.2 Exhaust Gases Are Deadly	2
1.3 Moving Parts Can Cause Severe Personal Injury or Death	2
1.4 Do Not Operate in Flammable and Explosive Environments	2
1.5 Electrical Shock Can Cause Severe Personal Injury Or Death	2
1.5.1 Medium Voltage Equipment (601 V to 15 kV - U.S. and Canada)	3
1.6 General Safety Precautions	3
1.7 Decommissioning and Disassembly	6
2. INTRODUCTION	7
2.1 Controllers	7
2.2 Bitmapping	8
2.2.1 32-Bit Float Representation	8
3. NFPA 110 BITMAP	11
3.1 NFPA 110 and Extended Annunciation Bitmap	11
3.2 NFPA 110 Bitmap (PS060X)	13
3.3 NFPA 110 Bitmap (PC80)	15
3.4 NFPA 110 Bitmap (PC40)	16
4. AUX101/102 MODBUS REGISTER MAP	19
5. DEIF AGC-5	23
5.1 DEIF AGC-5 Modbus Register Map	23
5.1.1 Function Code 2 (02h): Read Discrete Input	24
5.1.2 Function Code 3 (03h): Read Holding Registers	35
5.1.3 Function Code 4 (04h): Read Input Registers (Address, Bit: 500-593)	41
5.1.4 Function Code 4 (04h): Read Input Registers (Address, Bit: 642-799)	62
5.1.5 Function Code 4 (04h): Read Input Registers (Address, Bit: 800-900)	71
5.1.6 Function Code 4 (04h): Read Input Registers (Address, Bit: 1000-1003)	88
5.1.7 Function Code 4 (04h): Read Input Registers (Address, Bit: 1004-1010)	95
5.1.8 Function Code 4 (04h): Read Input Registers (Address, Bit: 1011-1017)	102
5.1.9 Function Code 4 (04h): Read Input Registers (Address, Bit: 1018-1040)	109
5.1.10 Function Code 4 (04h): Read Input Registers (Address, Bit: 1041-1054)	119
5.1.11 Function Code 4 (04h): Read Input Registers (Address, Bit: 1055-1650)	129
5.1.12 Function Code 4 (04h): Read Input Registers (Address, Bit: 1651-1714)	140
5.1.13 Function Code 4 (04h): Read Input Registers (Address, Bit: 1715-1728)	151
5.1.14 Function Code 4 (04h): Read Input Registers (Address, Bit: 1732-1750)	161
5.1.15 Function Code 4 (04h): Read Input Registers (Address, Bit: 1751-1762)	172
5.1.16 Function Code 4 (04h): Read Input Registers (Address, Bit: 1763-1773)	183

5.1.17 Function Code 4 (04h): Read Input Registers (EIC) (Address, Bit: 593-1370)	192
5.1.18 Function Code 4 (04h): Read Input Registers (EIC) (Address, Bit: 1371-1994).....	199
6. DMC 1000	209
6.1 DMC 1000 Modbus Register Map	209
6.1.1 DMC 1000 Modbus Parametric Data	209
6.1.2 DMC 1000 Modbus Enumerated Data.....	241
6.1.3 DMC 1000 Modbus Bitmap Data	264
7. DMC 1500	267
7.1 DMC 1500 Communication Server 1	267
7.1.1 Modbus Address: 2 (Slave).....	267
7.1.2 Generator Set Bus Data.....	270
7.1.3 Utility Bus Data	272
7.1.4 ATS 1-5 DATA	273
7.1.5 Word Data	275
7.1.6 ATS 6-10 DATA	276
7.2 DMC 1500 Communication Server 2.....	278
7.2.1 Modbus Address: 1 (Slave).....	278
7.2.2 Generator Raw Data Gen 1-5.....	282
7.2.3 Word Data	284
7.2.4 Generator Raw Data Gen 6-8.....	286
8. DMC 6600 AND DMC 6600P	289
8.1 Modbus TCP Port Configuration	289
8.2 Modbus RTU Serial Port Configuration	289
8.3 Genset Data.....	289
8.4 Metering	298
8.5 Load Demand	300
8.6 Main CBs	300
8.7 Status and Alarms.....	302
9. ECO TIER4 MODBUS TCP REGISTER MAP	305
10. MCM3320	311
10.1 MCM3320 Modbus Register Map	311
10.1.1 Modbus Communications.....	311
10.1.2 Reference Documents	311
10.1.3 Serial Port Configuration	311
10.1.4 Device Addresses	311
10.1.5 Power-Up Time	311
10.1.6 Response Time	311
10.1.7 Data Formatting	311
10.1.8 Modbus Activity LED	312
10.1.9 Supported Functions.....	312
10.1.10 Holding Register Function.....	312
10.1.11 Preset Single/Preset Multiple Registers Function.....	312

10.1.12 Diagnostic Counters.....	312
10.1.13 Register Maps.....	313
10.1.14 Application Layer.....	313
10.1.15 Read Hold Registers.....	313
10.1.16 Set Single Register.....	313
10.1.17 Modbus Loopback.....	313
10.1.18 Set Multiple Registers.....	314
10.1.19 Modbus Register Table.....	314
10.2 MCM3320 Modbus Fault Status Bitmaps.....	411
10.3 MCM3320 Modbus Address 42506, 42507.....	413
11. PC500/550 MODBUS TCP REGISTER MAP.....	415
12. PC40.....	425
12.1 PC40 Modbus Register Map.....	425
12.1.1 PC40 Modbus Parametric Data.....	425
12.1.2 Alarm Condition Codes.....	438
12.1.3 Modbus Alarms.....	439
13. PC80.....	441
13.1 General Instructions.....	441
13.1.1 Modbus Protocol Application Guide Notes.....	441
13.2 PC80 Modbus Register Map.....	454
13.2.1 PC80 Modbus Parametric Data.....	454
13.2.2 PC80 Modbus Enumerated Data.....	481
14. PCC 1301/POWERCOMMAND 1.X/PS0500 MODBUS REGISTER MAP.....	483
15. POWERCOMMAND 2.X/3.X MODBUS REGISTER MAP.....	529
15.1 Modbus Communications.....	529
15.2 Parametrics (Analog Values).....	529
16. POWERCOMMAND 2.X/3.X/PS0500 MODBUS FAULT STATUS BITMAPS.....	847
17. PS060X MODBUS REGISTER MAP.....	951
17.1 General Instructions.....	951
17.1.1 Modbus RTU Supported Functions.....	951
17.1.2 Modbus RTU Serial Port Configuration Options.....	952
17.2 PS060X Modbus Register Map.....	956
18. TM241 ON QSK50 AND QSK60 SERIES CONTAINERIZED GENERATOR SETS.....	991
18.1 PLC Modbus Register Bitmap.....	991
18.2 NFPA 110 Bitmaps.....	1018
18.2.1 NFPA 110(1) Bitmap.....	1018
18.2.2 NFPA 110(2) Bitmap.....	1019
18.3 StatusWord Bitmaps.....	1020
18.3.1 StatusWord 1 Bitmap.....	1020
18.3.2 StatusWord 2 Bitmap.....	1020

18.3.3 StatusWord 3 Bitmap	1021
18.4 AlarmWord Bitmaps	1022
18.4.1 AlarmWord 1 Bitmap	1022
18.4.2 AlarmWord 2 Bitmap	1022
18.4.3 AlarmWord 3 Bitmap	1023
18.4.4 AlarmWord 4 Bitmap	1023
18.4.5 AlarmWord 5 Bitmap	1024
19. CYLINDER CUTOFF SYSTEM (CCS)/ BANK CUTOFF SYSTEM (BCS) MODBUS	
REGISTER MAP	1027
19.1 Configuration of Cylinder Cutoff System (CCS) / Bank Cutoff System (BCS) Logic	1027
19.2 Cylinder Cutoff System (CCS) / Bank Cutoff System (BCS) Logic List of Parameters	1027
19.3 Modbus Setup and Addresses	1029
19.3.1 Modbus RTU Support Functions	1030
19.3.2 Modbus RTU Serial Port Configuration Options	1031
19.3.3 Modbus RTU Extended Status Information	1032
19.3.4 Working with 8 Bit Data Types	1033
19.3.5 Representation of Multi-register Parameters	1033
19.4 Cylinder Cutoff System (CCS) / Bank Cutoff System (BCS) Controller Modbus Parameters List	1033

1 Important Safety Instructions

SAVE THESE INSTRUCTIONS - This manual contains important instructions that should be followed during installation and maintenance of the generator set and batteries.

Before operating the generator set, read the Operator's Manual and become familiar with it and the equipment. **Safe and efficient operation can be achieved only if the equipment is properly operated and maintained.** Many accidents are caused by failure to follow fundamental rules and precautions.

1.1 Warning, Caution, and Note Styles Used in This Manual

The following safety styles and symbols found throughout this manual indicate potentially hazardous conditions to the operator, service personnel, or equipment.

 DANGER
<i>Indicates a hazardous situation that, if not avoided, will result in death or serious injury.</i>
 WARNING
<i>Indicates a hazardous situation that, if not avoided, could result in death or serious injury.</i>
 CAUTION
<i>Indicates a hazardous situation that, if not avoided, could result in minor or moderate injury.</i>
NOTICE
Indicates information considered important, but not hazard-related (e.g., messages relating to property damage).

1.2 Fuel and Fumes Are Flammable

Fire, explosion, and personal injury or death can result from improper practices.

- DO NOT fill fuel tanks while the engine is running unless the tanks are outside the engine compartment. Fuel contact with hot engine or exhaust is a potential fire hazard.
- DO NOT permit any flame, cigarette, pilot light, spark, arcing equipment, or other ignition source near the generator set or fuel tank.
- Fuel lines must be adequately secured and free of leaks. Fuel connection at the engine should be made with an approved flexible line. Do not use copper piping on flexible lines as copper will become brittle if continuously vibrated or repeatedly bent. Do not use zinc coated fuel lines with diesel fuel.
- Make sure all fuel supplies have a positive shutoff valve.
- Make sure the battery area has been well-ventilated prior to servicing near it. Lead-acid batteries emit a highly explosive hydrogen gas that can be ignited by arcing, sparking, smoking, etc.

1.2.1 Gaseous Fuels

Natural gas is lighter than air, and will tend to gather under covered areas.

1.2.2 Exhaust Gases Are Deadly

- Provide an adequate exhaust system to properly expel discharged gases away from enclosed or sheltered areas, and areas where individuals are likely to congregate. Visually and audibly inspect the exhaust system daily for leaks per the maintenance schedule. Make sure that exhaust manifolds are secured and not warped. Do not use exhaust gases to heat a compartment.
- The exhaust vent should be high enough to help clear gases, avoid accumulation of snow, and in accordance with all local mechanical codes.
- Make sure the unit is well ventilated.
- Engine exhaust and some of its constituents are known to the state of California to cause cancer, birth defects, and other reproductive harm.

1.3 Moving Parts Can Cause Severe Personal Injury or Death

- Keep hands, clothing, and jewelry away from moving parts.
- Before starting work on the generator set, disconnect the battery charger from its AC source, then disconnect the starting batteries using an insulated wrench, negative (–) cable first. In lean-burn natural gas (LBNG) generator sets, also make sure the starter's air supply line is disconnected or completely vented until the generator set is ready to start. This will prevent accidental starting.
- Make sure that fasteners on the generator set are secure. Tighten supports and clamps; keep guards in position over fans, drive belts, etc.
- Do not wear loose clothing or jewelry in the vicinity of moving parts or while working on electrical equipment. Loose clothing and jewelry can become caught in moving parts.
- If any adjustments must be made while the unit is running, use extreme caution around hot manifolds, moving parts, etc.

1.4 Do Not Operate in Flammable and Explosive Environments

Flammable vapor can cause an engine to overspeed and become difficult to stop, resulting in possible fire, explosion, severe personal injury, and death. Do not operate a generator set where a flammable vapor environment can be created, unless the generator set is equipped with an automatic safety device to block the air intake and stop the engine. The owners and operators of the generator set are solely responsible for operating the generator set safely. Contact your authorized Cummins distributor for more information.

1.5 Electrical Shock Can Cause Severe Personal Injury Or Death

- Remove electric power before removing protective shields or touching electrical equipment. Use rubber insulated mats placed on dry wood platforms over floors that are metal or concrete when around electrical equipment. Do not wear damp clothing (particularly wet shoes) or allow skin surface to be damp when handling electrical equipment. Do not wear jewelry. Jewelry can short out electrical contacts and cause shock or burning.

- Use extreme caution when working on electrical components. High voltages can cause injury or death. DO NOT tamper with interlocks.
- Follow all applicable state and local electrical codes. Have all electrical installations performed by a qualified licensed electrician. Tag and lock open switches to avoid accidental closure.
- DO NOT CONNECT GENERATOR SET DIRECTLY TO ANY BUILDING ELECTRICAL SYSTEM. Hazardous voltages can flow from the generator set into the utility line. This creates a potential for electrocution or property damage. Connect only through an approved isolation switch or an approved paralleling device.

1.5.1 Medium Voltage Equipment (601 V to 15 kV - U.S. and Canada)

- Medium voltage acts differently than low voltage. Special equipment and training is required to work on or around medium voltage equipment. Operation and maintenance must be done only by persons trained and experienced to work on such devices. Improper use or procedures will result in severe personal injury or death.
- Do not work on energized equipment. Unauthorized personnel must not be permitted near energized equipment. Due to the nature of medium voltage electrical equipment, induced voltage remains even after the equipment is disconnected from the power source. Plan the time for maintenance with authorized personnel so that the equipment can be de-energized and safely grounded.

1.6 General Safety Precautions

 **WARNING**

Hot Pressurized Liquid
Contact with hot liquid can cause severe burns.
Do not open the pressure cap while the engine is running. Let the engine cool down before removing the cap. Turn the cap slowly and do not open it fully until the pressure has been relieved.

 **WARNING**

Moving Parts
Moving parts can cause severe personal injury.
Use extreme caution around moving parts. All guards must be properly fastened to prevent unintended contact.

 **WARNING**

Toxic Hazard
Used engine oils have been identified by some state and federal agencies to cause cancer or reproductive toxicity.
Do not ingest, breathe the fumes, or contact used oil when checking or changing engine oil.
Wear protective gloves and face guard.

 **WARNING**

Electrical Generating Equipment
Incorrect operation can cause severe personal injury or death.
Do not operate equipment when fatigued, or after consuming any alcohol or drug.

⚠ WARNING**Toxic Gases**

Substances in exhaust gases have been identified by some state and federal agencies to cause cancer or reproductive toxicity.

Do not breathe in or come into contact with exhaust gases.

⚠ WARNING**Combustible Liquid**

Ignition of combustible liquids is a fire or explosion hazard which can cause severe burns or death.

Do not store fuel, cleaners, oil, etc., near the generator set.

⚠ WARNING**High Noise Level**

Generator sets in operation emit noise, which can cause hearing damage.

Wear appropriate ear protection at all times.

⚠ WARNING**Hot Surfaces**

Contact with hot surfaces can cause severe burns.

The unit is to be installed so that the risk of hot surface contact by people is minimized. Wear appropriate PPE when working on hot equipment and avoid contact with hot surfaces.

⚠ WARNING**Electrical Generating Equipment**

Incorrect operation and maintenance can result in severe personal injury or death.

Make sure that only suitably trained and experienced service personnel perform electrical and/or mechanical service.

⚠ WARNING**Toxic Hazard**

Ethylene glycol, used as an engine coolant, is toxic to humans and animals.

Wear appropriate PPE. Clean up coolant spills and dispose of used coolant in accordance with local environmental regulations.

⚠ WARNING**Combustible Liquid**

Ignition of combustible liquids is a fire or explosion hazard which can cause severe burns or death.

Do not use combustible liquids like ether.

⚠ WARNING***Automated Machinery***

Accidental or remote starting of the generator set can cause severe personal injury or death. Isolate all auxiliary supplies and use an insulated wrench to disconnect the starting battery cables (negative [-] first).

⚠ WARNING***Fire Hazard***

Materials drawn into the generator set are a fire hazard. Fire can cause severe burns or death. Keep the generator set and the surrounding area clean and free from obstructions.

⚠ WARNING***Fire Hazard***

Materials drawn into the generator set are a fire hazard. Fire can cause severe burns or death. Make sure the generator set is mounted in a manner to prevent combustible materials from accumulating under the unit.

⚠ WARNING***Fire Hazard***

Accumulated grease and oil are a fire hazard. Fire can cause severe burns or death. Keep the generator set and the surrounding area clean and free from obstructions. Repair oil leaks promptly.

NOTICE

Keep multi-type ABC fire extinguishers close by. Class A fires involve ordinary combustible materials such as wood and cloth. Class B fires involve combustible and flammable liquid fuels and gaseous fuels. Class C fires involve live electrical equipment. (Refer to NFPA No. 10 in the applicable region.)

NOTICE

Before performing maintenance and service procedures on enclosed generator sets, make sure the service access doors are secured open.

NOTICE

Stepping on the generator set can cause parts to bend or break, leading to electrical shorts, or to fuel leaks, coolant leaks, or exhaust leaks. Do not step on the generator set when entering or leaving the generator set room.

1.7 Decommissioning and Disassembly

<i>NOTICE</i>
Decommissioning and disassembly of the generator set at the end of its working life must comply with local guidelines and legislation for disposal/recycling of components and contaminated fluids. This procedure must only be carried out by suitably trained and experienced service personnel. For more information contact your authorized distributor.

2 Introduction

2.1 Controllers

NOTICE

- Cummins controllers that have Modbus RS485 Communication built-in have a dedicated Modbus holding register for "Save Trims". The number of write cycles on any flash memory device are finite.
- Only save trims once all configuration changes are complete; saving them on a schedule can reduce the lifetime of the physical control. Do not save trims unless a change has occurred.

NOTICE

There is a fixed number of write cycles available in the life of the control. Once these are used up, the control must be replaced.

NOTICE

Throughout this document, if a parameter is marked for PCC3300 and PCC3300V2, then it is applicable to both. If it is marked for PCC3300V2, then it is applicable to PCC3300V2 only.

This note is targeted to, but not limited to, the following Modbus registers per Cummins device. If the device is not listed in the table, please reference the dedicated Modbus register for "Save Trims".

Device	Holding Register Address	Access	Specifications	Description
PC 1.x PS0500 PCC 1301 PCC 1302	40004	Read and Write	0: No action 1: Save unconditional	Save configuration parameters or adjustments to non-volatile memory. Perform Save Trims after all configurations have been updated. Do not save trims unless a change has occurred.
PS060X	408039	Read and Write	0: IsFalse 1: IsTrue	
PC 2.x PC 3.x PCC 2300 PCC 3300	43910	Read and Write	0: Do nothing 1: Save Trims	
DMC 1000/DMC	42004	Read and Write	0: Do nothing 1: Save Trims Default: Do Nothing	
AUX 101	43052	Read and Write	0: Do Nothing 1: Save Trims	
PC80	410570	Operator (Read and Write)	0: Do Nothing 1: Save Trims	

2.2 Bitmapping

Bitmapped registers are based in a 0-bit system. For a 16-bit register, 0 is the low-order bit and 15 is the high-order bit.

2.2.1 32-Bit Float Representation

For devices that support floating point natively, most parameters that hold values are floating point type.

Use the method below calculate the value of single precision 32-bit float parameters. The architecture of number formatting used is IEEE 754 (see [Figure 1](#)).

- Sign bit (S): 1 bit
- Exponent (E): 8 bits
- Fraction (F): 23 bits

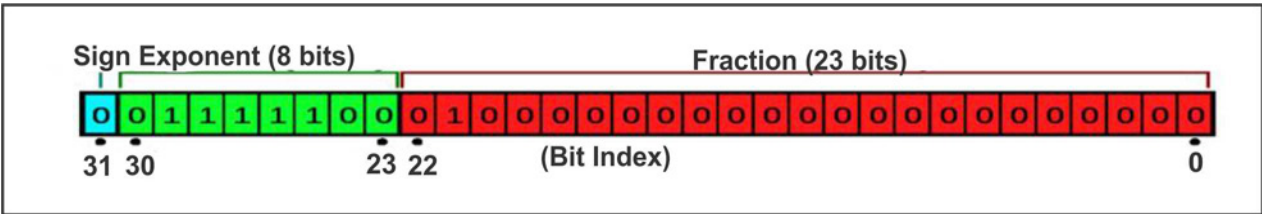


FIGURE 1. BIT FORMAT FOR IEEE 754

The calculation would be $= (-1)^S * 2^{(E \text{ [dec format]} - 127)} * (1.F) \text{[Base 10]}$

- A = high register value
- B = low register value

For example, consider how to read the value of Load L1 RMS Current, a 32-bit parameter in registers 410587 and 410588, as shown below:

- 410587 (High register value): 0100 0001 0100 1100
- 410588 (Low register value): 1010 0011 1110 1110

Combine the two registers in binary format to become: 0100 0001 0100 1100 1010 0011 1110 1110

This combined value can be put in the below IEEE 754 format.

TABLE 1. IEEE 754 FORMAT

S	Exponent								Fraction																						
0	1	0	0	0	0	0	1	0	1	0	0	1	1	0	0	1	0	1	0	0	0	1	1	1	1	1	0	1	1	1	0

The value in **Exponent** is 10000010, which is 130 in decimal. The remaining portion is placed in **Fraction**, which is 0.0100 1100 1010 0011 1110 1110 (base 2).

In base 2 (binary), 1.F is 1.0100 1100 1010 0011 1110 1110, which equals 1.29937636852264404296875 in base 1.0

Placing this in the formula results in the following:

$(-1)^{(0)} * 2^{(130-127)} * (1.29937636852264404296875) = 10.395$

Using this method, here is an example on how to write a value of 12.65 amps to **Load L1 RMS Current**.

- 12.65 can be represented in binary as follows:
 - $12 = 1100$
 - $0.65 = 0.1010\ 0110\ 0110\ 0110\ 0110\ 0110\ 0110\ 0110\ 011001100110011001100110011001...$
- Combining the two values = $1100.1010\ 0110\ 0110\ 0110\ 0110\ 0110$
 - Total of 23 Fraction points can be included in the format of [Figure 1](#)
 - The above number can be represented in the following binary scientific notation: $1.100\ 1010\ 0110\ 0110\ 0110\ 0110\ 0110 \times 2^{\text{exp}3}$
 - $S = 0$ (since value is positive number)
 - $E = 127 + 3 = 130$ (1000 0010) (IEE 754 bias for exponent is 127 for 32 bits)
 - $F = 0.100\ 1010\ 0110\ 0110\ 0110\ 0110\ 0110...$
 - This number can be represented in the below IEEE 754 format.

TABLE 2. IEEE 754 FORMAT FOR LOAD L1 RMS CURRENT

S	Exponent									Fraction																					
0	1	0	0	0	0	0	1	0	1	0	0	1	0	1	0	0	1	1	0	0	1	1	0	0	1	1	0	0	1	1	0

- 410587 (high register value) - 0 1000 010 1001 010 (16716)
- 410588 (low register value) - 0110 0110 0110 0110 (41966)

To write 32-bit values to 2 Modbus addresses, always write the high register value followed by the low register value.

This page is intentionally blank.

3 NFPA 110 Bitmap

3.1 NFPA 110 and Extended Annunciation Bitmap

TABLE 3. NFPA110 BITMAP

Bit	Description
15	Common Alarm
14	Genset Supplying Load
13	Genset Running
12	Not in Auto
11	High Battery Voltage
10	Low Battery Voltage
9	Charger AC Failure
8	Fail to Start
7	Low Coolant Temperature
6	Pre-high Engine Temperature
5	High Engine Temperature
4	Pre-low Oil Pressure
3	Low Oil Pressure
2	Overspeed
1	Low Coolant Level
0	Low Fuel Level

See [Chapter 14](#) Reg. 40016, [Section 15.2](#) Reg. 40716, 40717, and [Section 6.1.1](#)

TABLE 4. EXTENDED ANNUNCIATION BITMAP

Bit	Description
15	Check Genset
14	Ground Fault
13	High AC Voltage
12	Low AC Voltage
11	Under Frequency
10	Overload
9	Overcurrent
8	Short Circuit

Bit	Description
7	Reverse KW
6	Reverse kVAR
5	Fail to Sync
4	Fail to Close
3	Load Demand
2	Genset Circuit Breaker Tripped
1	Utility Circuit Breaker Tripped
0	Emergency Stop

See [Chapter 14](#) Reg. 40017 and [Section 6.1.1](#)

TABLE 5. NFPA110 BITMAP

Bit	Description
15	Source 1 Connected
14	Source 2 Connected
13	NA
12	Not in Auto
11	NA
10	NA
9	Charger AC Failure
8	NA
7	NA
6	NA
5	NA
4	NA
3	NA
2	NA
1	NA
0	NA

See [Section 6.1.2](#)

TABLE 6. EXTENDED ANNUNCIATION BITMAP

Bit	Description
15	Source 1 Available
14	Source 2 Available

Bit	Description
13	Source 1 Connected
12	Source 2 Connected
11	ATS Common Alarm
10	Not In Auto
9	Test / Exercise In Progress
8	Low Battery Voltage
7	Load Shed
6	Transfer Inhibit
5	Retransfer Inhibit
4	Fail To Close
3	Fail To Disconnect
2	Fail To Synchronize
1	Bypass to Source 1
0	Bypass to Source 2

See [Section 6.1.2](#)

3.2 NFPA 110 Bitmap (PS060X)

TABLE 7. NFPA110 BITMAP FOR PS060X

Bit	Description
31	Check Genset
30	Ground Fault
29	High AC Voltage
28	Low AC Voltage
27	Under Frequency
26	Overload Warning OR Overload Shutdown
25	Overcurrent
24	Short Circuit
23	Reverse KW
22	Reverse KVAR
21	Fail to Sync
20	Fail to Close
19	Load Demand
18	Genset Circuit Breaker Tripped

17	Utility Circuit Breaker Tripped
16	Emergency Stop
15	Common Alarm
14	Genset Supplying Load
13	Genset Running
12	Not in Auto
11	High Battery Voltage
10	Low Battery Voltage OR Weak Battery
9	Charger AC Failure
8	Fail to Start
7	Low Coolant Temperature
6	Pre-High Engine Temperature
5	High Engine Temperature
4	Pre-Low Oil Pressure
3	Low Oil Pressure
2	Overspeed
1	Low Coolant Level
0	Low Fuel Level

See [Section 17.2](#).

NOTICE

To view 32-bit data of NFPA110 register in Modbus tool, length shall be provided as 2 for 400016 address for read/write values.

TABLE 8. NFPA110 EXTENDED ANNUNCIATION BITMAP FOR PS060X

Bit	Description
15	Source 1 Available
14	Source 2 Available
13	Source 1 Connected
12	Source 2 Connected
11	ATS Common Alarm
10	Not in Auto
9	Test/Exercise in Progress
8	Low Battery Voltage
7	Load Shed

6	Transfer Inhibit
5	Retransfer Inhibit
4	Fail to close
3	Fail to disconnect
2	Fail to Synchronize
1	Bypass To Source 1
0	Bypass To Source 2

3.3 NFPA 110 Bitmap (PC80)

TABLE 9. NFPA110 STATUS (ADDRESS: 410571) BIT REPRESENTATION

Bit	Description
15 (LSB)	NA
14	NA
13	NA
12	NA
11	NA
10	NA
9	NA
8	NA
7	NA
6	Charger AC Failure
5	NA
4	NA
3	Not in Auto
2	NA
1	Source 2 Connected
0 (MSB)	ATS Common Alarm

TABLE 10. NFPA110 EXTENDED STATUS (ADDRESS: 410572) BIT REPRESENTATION

Bit	Description
15 (LSB)	NA
14	NA
13	Fail to Synchronize
12	Fail to Disconnect

Bit	Description
11	Fail to close
10	Retransfer Inhibit
9	Transfer Inhibit
8	Load Shed
7	NA
6	Test / Exercise in Progress
5	Not in Auto
4	ATS Common Alarm
3	Source 2 Connected
2	Source 1 Connected
1	Source 2 Available
0 (MSB)	Source 1 Available

3.4 NFPA 110 Bitmap (PC40)

TABLE 11. NFPA110 STATUS (ADDRESS: 41649) BIT REPRESENTATION

Bit	Description
15 (LSB)	NA
14	NA
13	NA
12	NA
11	NA
10	NA
9	NA
8	NA
7	NA
6	Charger AC Failure
5	NA
4	NA
3	Not in Auto
2	NA
1	Source 2 Connected
0 (MSB)	ATS Common Alarm

TABLE 12. NFPA110 EXTENDED STATUS (ADDRESS: 41650) BIT REPRESENTATION

Bit	Description
15 (LSB)	NA
14	NA
13	Fail to Synchronize
12	Fail to Disconnect
11	Fail to Close
10	Retransfer Inhibit
9	Transfer Inhibit
8	Load Shed
7	NA
6	Test / Exercise in Progress
5	Not in Auto
4	ATS Common Alarm
3	Source 2 Connected
2	Source 1 Connected
1	Source 2 Available
0 (MSB)	Source 1 Available

This page is intentionally blank.

4 AUX101/102 Modbus Register Map

NOTICE

Earlier versions of software may not support all of the Modbus registers in the following table. If a particular register is not available in your installation, it is possible that the Modbus connection is working but the controller software does not support that particular register.

NOTICE

If an address or bit is not listed in this table it is not implemented.

Addr.	System Name	Access	Specifications		Comments
43044	Modbus Device ID	Read Only	As supported by Modbus protocol	Default: Modbus Address 13 Type: Trim	Changing the address causes no communication with the annunciator until the Modbus Master also changes its sending address.
43045	Modbus Baud Rate	Read Only	0: 2400 Baud	Default: 3 Type: Trim	Changing the baud rate causes no communication with the annunciator until the Modbus Master also changes its baud rate.
			1: 4800 Baud		
			2: 9600 Baud		
			3: 19200 Baud		
			4: 38400 Baud		
			5: 57600 Baud		
43046	Modbus Parity	Read Only	0: Even	Default: 2 Type: Trim	Changing the parity causes no communication with the annunciator until the Modbus Master also changes its parity.
			1: Odd		
			2: None		
43047	Modbus Stop Bits	Read Only	1	Default: 1 Type: Trim	Changing the stop bits causes no communication with the annunciator until the Modbus Master also changes its stop bits.
			2		
43048	Protocol	Read Only	0: RS485	Default: 0 Type: Trim	Changes the communication protocol between RS485 and Modbus.
			1: Modbus		
43049	Software Version	Read Only		Default: NA Type: Trim	Sends AUX101 current firmware version.
43050	Device Type	Read Only		Default: 59 Type: Trim	AUX101 Device Type
43051	AUX 102 Available	Read Only	0: Not Available	Default: 0 Type: Trim	Indicates if AUX102 expansion board is available.
			1: Available		

Addr.	System Name	Access	Specifications		Comments
43052	Save Trims	Read/ Write	0: Do Nothing	Do Nothing Type: Trim	Save configuration parameters or adjustments to non-volatile memory. Perform Save Trims after all configurations have been updated. Do not save trims unless a change has occurred.
			1: Save Trims		
42001	Relay 1	Read/ Write	0: Inactive 1: Active	Default: 0	Parameters to allow the Relay to be turned on/off. The lower 8 bits are used to store out relay values. Relay 1 is stored in bit 0 and Relay 8 is stored in bit 7. The upper 8 bits are 0. In the event of a power cycle or reboot, all the output values are reset to 0. This register is used as heartbeat for AUX101 and indicates a secure communication.
	Relay 2				
	Relay 3				
	Relay 4				
	Relay 5				
	Relay 6				
	Relay 7				
	Relay 8				
42009	Relay 9	Read/ Write	0: Inactive 1: Active	Default: 0	Parameters to allow the Relay to be turned on/off.
	Relay 10				
	Relay 11				
	Relay 12				
	Relay 13				
	Relay 14				
	Relay 15				
	Relay 16				
42017	Input 1	Read Only		Default: NA	Register that contains the value of Input 1.
42018	Input 2	Read Only		Default: NA	Register that contains the value of Input 2.
42019	Input 3	Read Only		Default: NA	Register that contains the value of Input 3.
42020	Input 4	Read Only		Default: NA	Register that contains the value of Input 4.
42021	Input 5	Read Only		Default: NA	Register that contains the value of Input 5.
42022	Input 6	Read Only		Default: NA	Register that contains the value of Input 6.
42023	Input 7	Read Only		Default: NA	Register that contains the value of Input 7.
42024	Input 8	Read Only		Default: NA	Register that contains the value of Input 8.

Addr.	System Name	Access	Specifications		Comments
42025	Input 9	Read Only		Default: NA	Bit 0 of this register is used for Input 9 when AUX102 is available.
	Input 10				Bit 1 of this register is used for Input 10 when AUX102 is available.
	Input 11				Bit 2 of this register is used for Input 11 when AUX102 is available.
	Input 12				Bit 3 of this register is used for Input 12 when AUX102 is available.
42029	Current Source 1 Settings	Read/Write	mA = CS/10	Default: NA Type: Trim	Set for Analog Input 3.
42030	Current Source 2 Settings	Read/Write	mA = CS/10	Default: NA Type: Trim	Set for Analog Input 4.
42031	Current Source 3 Settings	Read/Write	mA = CS/10	Default: NA Type: Trim	Set for Analog Input 5.
42032	Current Source 4 Settings	Read/Write	mA = CS/10	Default: NA Type: Trim	Set for Analog Input 6.
42033	Input 1 Settings	Read/Write	0: Sender	Default: NA Type: Trim	Register to configure Input 1.
			1: Switch - Active Low		
			2: Switch - Active High		
42034	Input 2 Settings	Read/Write	0: Sender	Default: NA Type: Trim	Register to configure Input 2.
			1: Switch - Active Low		
			2: Switch - Active High		
42035	Input 3 Settings	Read/Write	0: Sender	Default: NA Type: Trim	Register to configure Input 3.
			1: Switch - Active Low		
			2: Switch - Active High		
42036	Input 4 Settings	Read/Write	0: Sender	Default: NA Type: Trim	Register to configure Input 4.
			1: Switch - Active Low		
			2: Switch - Active High		
42037	Input 5 Settings	Read/Write	0: Sender	Default: NA Type: Trim	Register to configure Input 5.
			1: Switch - Active Low		
			2: Switch - Active High		
42038	Input 6 Settings	Read/Write	0: Sender	Default: NA Type: Trim	Register to configure Input 6.
			1: Switch - Active Low		
			2: Switch - Active High		

Addr.	System Name	Access	Specifications		Comments
42039	Input 7 Settings	Read/Write	0: Sender	Default: NA Type: Trim	Register to configure Input 7.
			1: Switch - Active Low		
			2: Switch - Active High		
42040	Input 8 Settings	Read/Write	0: Sender	Default: NA Type: Trim	Register to configure Input 8.
			1: Switch - Active Low		
			2: Switch - Active High		

5 DEIF AGC-5

5.1 DEIF AGC-5 Modbus Register Map

The controller contains data that can be read by a device communicating via Modbus PCB or via TCP/IP port, as shown in the figure below.

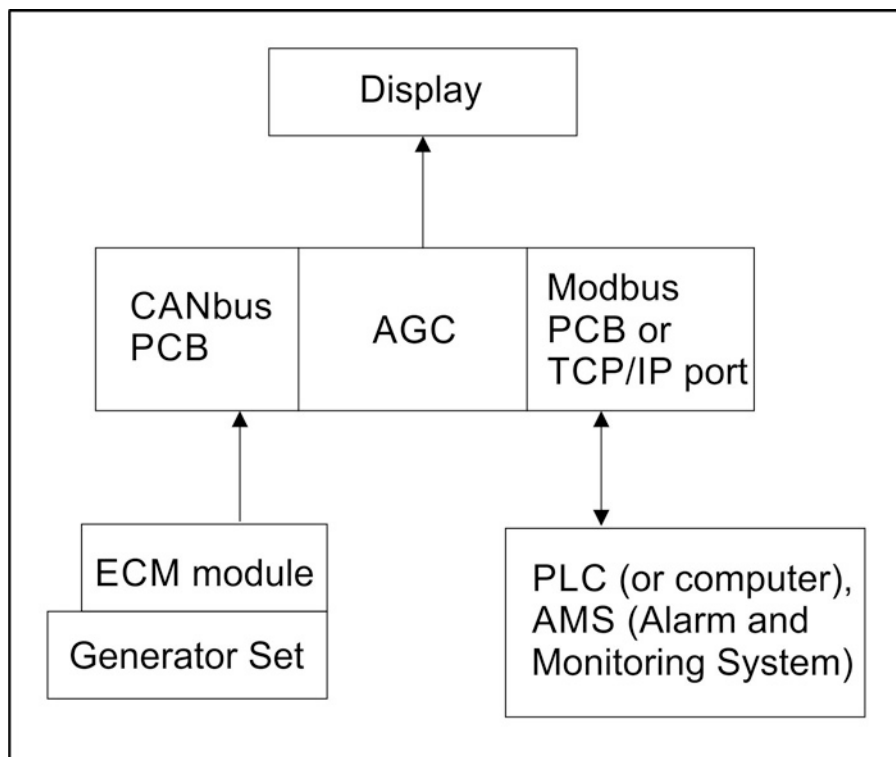


FIGURE 2. DEIF AGC-5 MODBUS REGISTER MAP DIAGRAM

	PLC addresses	Modbus reading		Write functions and modbus addresses		
		read function	Modbus addresses	single writing	multiple writing	Modbus addresses
Bits	1		0			0
		01		05	15	
	65536 (10000)		65535 (9999)			65535 (9999)
	100001 (10001)		0			0
		02				
Words	165536 (20000)		65535 (9999)			65535 (9999)
	200001 (20001)		This area is not used by modbus			
	300000 (30000)					
	300001 (30001)		0			0
		04				
Words	365536 (40000)		65535 (9999)			65535 (9999)
	400001 (40001)		0			0
		03		06	16	
	465536 (50000)		65535 (9999)			65535 (9999)

FIGURE 3. CONVERSION TABLE FROM FUNCTION CODE TO PLC ADDRESSES

5.1.1 Function Code 2 (02h): Read Discrete Input

Address	Content/Position	Description	AGC-5C DG	AGC-5C Group	AGC-5C Plant	AGC-5C Mains
0	GB position ON		X			
0	TB position ON			X		X
1	MB position ON				X	X
1	MB Position ON(stand-alone)		X			
2	Not used					
3	Running		X			
4	Generator voltage/frequency OK		X			
5	Mains failure				X	X
5	Mains failure (stand-alone)		X			
6	Block mode		X			
7	Manual mode		X			

Address	Content/Position	Description	AGC-5C DG	AGC-5C Group	AGC-5C Plant	AGC-5C Mains
8	Semi-auto mode		X	X	X	X
9	Auto mode		X	X	X	X
10	Test mode		X	X	X	X
11	Not used: 11-12					
13	Island		X	X	X	X
14	Automatic mains failure (AMF)		X	X	X	X
15	Peak shaving		X	X	X	X
16	Fixed power		X	X	X	X
17	Mains power export (MPE)		X	X	X	X
18	Load takeover (LTO)		X	X	X	X
19	Power management		X	X		
20	Any alarm DG1		X	X		X
21	Any alarm DG2		X	X		X
22	Any alarm DG3		X	X		X
23	Any alarm DG4		X	X		X
24	Any alarm DG5		X	X		X
25	Any alarm DG6		X	X		X
26	Any alarm DG7		X	X		X
27	Any alarm DG8		X	X		X
28	Any alarm mains (Mains Command Unit)		X	X		X
29	Not used: 29-30					
31	Ready auto-start DG1		X	X		X
32	Ready auto-start DG2		X	X		X
33	Ready auto-start DG3		X	X		X

Address	Content/Position	Description	AGC-5C DG	AGC-5C Group	AGC-5C Plant	AGC-5C Mains
34	Ready auto-start DG4		X	X		X
35	Ready auto-start DG5		X	X		X
36	Ready auto-start DG6		X	X		X
37	Ready auto-start DG7		X	X		X
38	Ready auto-start DG8		X	X		X
39	Not used: 39-54					
55	Any G7 mains sync. inhibit			X	X	
56	Not used: 56-22499					
22500	Digital input 97		X	X	X	X
22501	Digital input 96		X	X	X	X
22502	Digital input 95		X	X	X	X
22503	Digital input 94		X	X	X	X
22504	Digital input 93		X	X	X	X
22505	Digital input 92		X	X	X	X
22506	Digital input 91		X	X	X	X
22507	Digital input 133		X	X	X	X
22508	Digital input 132		X	X	X	X
22509	Digital input 131		X	X	X	X
22510	Digital input 130		X	X	X	X
22511	Digital input 129		X	X	X	X
22512	Digital input 128		X	X	X	X
22513	Digital input 127		X	X	X	X
22514	Digital input 29		X	X	X	X
22515	Digital input 30		X	X	X	X

Address	Content/Position	Description	AGC-5C DG	AGC-5C Group	AGC-5C Plant	AGC-5C Mains
22516	Digital input 31		X	X	X	X
22517	Digital input 32		X	X	X	X
22518	Digital input 33		X	X	X	X
22519	Digital input 34		X	X	X	X
22520	Digital input 35		X	X	X	X
22521	Digital input 65		X	X	X	X
22522	Digital input 66		X	X	X	X
22523	Digital input 67		X	X	X	X
22524	Digital input 68		X	X	X	X
22525	Digital input 69		X	X	X	X
22526	Digital input 70		X	X	X	X
22527	Digital input 71		X	X	X	X
22528	Digital input 43	CH3130 Oil Slow Flow Meter Fault	X	X	X	X
22529	Digital input 44	CH3140 Fault Reset	X	X	X	X
22530	Digital input 45	CH3150 Customer Configurable Input 1 Fault - Warning	X	X	X	X
22531	Digital input 46	CH3160 Customer Configurable Input 2 Fault - Shutdown	X	X	X	X
22532	Digital input 47	CH3170 Customer Configurable Input 3 Fault - Controlled Shutdown	X	X	X	X
22533	Digital input 48	CH3180 Customer Configurable Input 4 Fault - Earth Fault	X	X	X	X

Address	Content/Position	Description	AGC-5C DG	AGC-5C Group	AGC-5C Plant	AGC-5C Mains
22534	Digital input 49	CH3190 Customer Configurable Input 5 Fault - Differential Fault	X	X	X	X
22535	Digital input 50	CH3200 Customer Configurable Input 6 Fault	X	X	X	X
22536	Digital input 51	CH3210 Customer Configurable Input 7 Fault	X	X	X	X
22537	Digital input 52	CH3220 Customer Configurable Input 8 Fault	X	X	X	X
22538	Digital input 53	CH3230 Start Inhibit No 1	X	X	X	X
22539	Digital input 54	CH3240 Start Inhibit No 2	X	X	X	X
22540	Digital input 55	CH3250 Fire Protection Trip Shutdown	X	X	X	X
22541	Digital input 23	CH3000 Local Emergency Stop	X	X	X	X
22542	Not used: 22542-22582					
22583	Digital input 118	Remote Emergency Stop	X	X	X	X
22584	Digital input 117	CH3480 Alternator Voltage Sensing	X	X	X	X
22585	Digital input 116	CH3470 Start System Trip	X	X	X	X
22586	Digital input 115	CH3460 Remote Start	X	X	X	X
22587	Digital input 114	CH3450 Derate Authorization	X	X	X	X

Address	Content/Position	Description	AGC-5C DG	AGC-5C Group	AGC-5C Plant	AGC-5C Mains
22588	Digital input 113	CH3440 Generator Breaker Inhibit	X	X	X	X
22589	Digital input 112	CH3430 Utility Breaker Inhibit	X	X	X	X
22590	Not used					
22591	Digital input 108	Not Used	X	X	X	X
22592	Digital input 105	Alternator Bearing NDE R1 (RD)	X	X	X	X
22593	Digital input 102	Alternator Bearing DE R1 (RD)	X	X	X	X
22594	CIO 116 #1 Input 10	Coolant Heater Element Trip	X	X	X	X
22595	CIO 116 #1 Input 11	Coolant Heater Element On	X	X	X	X
22596	CIO 116 #1 Input 12	Gearbox Oil Heater Element Trip	X	X	X	X
22597	CIO 116 #1 Input 13	Gearbox Oil Heater Element On	X	X	X	X
22598	CIO 116 #1 Input 14	Oil Heater Pump Trip	X	X	X	X
22599	CIO 116 #1 Input 15	Oil Heater Pump On	X	X	X	X
22600	CIO 116 #1 Input 16	Oil Heater Element Trip	X	X	X	X
22601	CIO 116 #1 Input 17	Oil Heater Element On	X	X	X	X
22602	CIO 116 #1 Input 19	AC ISO Switch Status	X	X	X	X
22603	CIO 116 #1 Input 20	Coolant Heater Pump Trip	X	X	X	X
22604	CIO 116 #1 Input 21	Coolant Heater Pump On	X	X	X	X
22605	CIO 116 #1 Input 22	Alternator Heater Trip	X	X	X	X
22606	CIO 116 #1 Input 23	Alternator Heater On	X	X	X	X

Address	Content/Position	Description	AGC-5C DG	AGC-5C Group	AGC-5C Plant	AGC-5C Mains
22607	CIO 116 #1 Input 24	HT Valve Motor Trip	X	X	X	X
22608	CIO 116 #1 Input 25	LT Valve Motor Trip	X	X	X	X
22609	CIO 116 #1 Input 26	AC GFI Outlet	X	X	X	X
22610	CIO 116 #2 Input 10	Alternator Auto-Lube	X	X	X	X
22611	CIO 116 #2 Input 11	Alternator Bearing Vibration Warning	X	X	X	X
22612	CIO 116 #2 Input 12	UPS Control Battery Charge Low	X	X	X	X
22613	CIO 116 #2 Input 13	Replace UPS Control Battery	X	X	X	X
22614	CIO 116 #2 Input 14	Customer Convenience DC Power Fault	X	X	X	X
22615	CIO 116 #2 Input 15	ISB Converter Over Temperature Warning	X	X	X	X
22616	CIO 116 #2 Input 16	ISB Converter Over Temperature Shutdown	X	X	X	X
22617	CIO 116 #2 Input 17	Spare	X	X	X	X
22618	CIO 116 #2 Input 19	HT ACW Stop Indication	X	X	X	X
22619	CIO 116 #2 Input 20	HT CW Stop Indication	X	X	X	X
22620	CIO 116 #2 Input 21	LT ACW Stop Indication	X	X	X	X
22621	CIO 116 #2 Input 22	LT CW Stop Indication	X	X	X	X
22622	CIO 116 #2 Input 23	HT AC Pump State	X	X	X	X
22623	CIO 116 #2 Input 24	HT AC Pump Trip	X	X	X	X

Address	Content/Position	Description	AGC-5C DG	AGC-5C Group	AGC-5C Plant	AGC-5C Mains
22624	CIO 116 #2 Input 25	LT AC Pump State	X	X	X	X
22625	CIO 116 #2 Input 26	LT AC Pump Trip	X	X	X	X
22626	CIO 116 #3 Input 10	HT Tank Low Level	X	X	X	X
22627	CIO 116 #3 Input 11	HT Tank Very Low Level	X	X	X	X
22628	CIO 116 #3 Input 12	LT Tank Low Level	X	X	X	X
22629	CIO 116 #3 Input 13	LT Tank Very Low Level	X	X	X	X
22630	CIO 116 #3 Input 14	Radiator Fan Trip	X	X	X	X
22631	CIO 116 #3 Input 15	Louver Closed	X	X	X	X
22632	CIO 116 #3 Input 16	Louver Trip	X	X	X	X
22633	CIO 116 #3 Input 17	Vent Fan Trip	X	X	X	X
22634	CIO 116 #3 Input 19	Spare	X	X	X	X
22635	CIO 116 #3 Input 20	Spare	X	X	X	X
22636	CIO 116 #3 Input 21	Gearbox Oil Tank Heater Fault	X	X	X	X
22637	CIO 116 #3 Input 22	Engine Oil Pan Heater Fault	X	X	X	X
22638	CIO 116 #3 Input 23	VPS2 Fault	X	X	X	X
22639	CIO 116 #3 Input 24	VPS2 Operation	X	X	X	X
22640	CIO 116 #3 Input 25	FSOV2 V1CPI Upstream Signal	X	X	X	X
22641	CIO 116 #3 Input 26	FSOV2 V2CPI Downstream Signal	X	X	X	X
22642	Not used: 22642-22700					
23000	Relay 65		X	X	X	X

Address	Content/Position	Description	AGC-5C DG	AGC-5C Group	AGC-5C Plant	AGC-5C Mains
23001	Relay 67		X	X	X	X
23002	Relay 69		X	X	X	X
23003	Relay 71		X	X	X	X
23004	Relay 132	Load Dump (NO)	X	X	X	X
23005	Relay 130	Genset Ready To Load (NO)	X	X	X	X
23006	Relay 128	Engine Idle/Rated Speed (NO)	X	X	X	X
23007	Relay 126	Genset Running Above 600 RPM (NO)	X	X	X	X
23008	Relay 96		X	X	X	X
23009	Relay 94		X	X	X	X
23010	Relay 92		X	X	X	X
23011	Relay 90		X	X	X	X
23012	Relay 29		X	X	X	X
23013	Relay 31		X	X	X	X
23014	Relay 33		X	X	X	X
23015	Relay 35		X	X	X	X
23016	Relay 57	ESTOP Reset Latch NO	X	X	X	X
23017	Relay 59	Spare Relay 59	X	X	X	X
23018	Relay 61	Spare Relay 61	X	X	X	X
23019	Relay 63	Gearbox Heater MCB Coil NO	X	X	X	X
23020	Not used					
23021	Not used					
23022	Not used					
23023	Not used					
23024	Not used					
23025	Relay 5	KeySwitch Command	X			
23026	Not used					

Address	Content/Position	Description	AGC-5C DG	AGC-5C Group	AGC-5C Plant	AGC-5C Mains
23027	Not used					
23028	Not used					
23029	Not used					
23030	Relay 20	LVRT event transistor output	X	X	X	X
23031	Relay 21	Spare transistor output	X	X	X	X
23032	Not used: 23032-23046					
23047	Relay 69		X	X	X	X
23048	Relay 71		X	X	X	X
23049	Run coil		X			
23050	Start prepare		X			
23051	Start relay(crank)		X			
23052	Stop coil		X			
23053	LED CAN B		X	X	X	X
23054	LED CAN A		X	X	X	X
23055	LED USB		X	X	X	X
23056	CIO 208 #1 Output 9	Oil Heater COM	X	X	X	X
23057	CIO 208 #1 Output 11	Coolant Heater COM	X	X	X	X
23058	CIO 208 #1 Output 13	Coolant Heater & Oil Heater Pumps COM	X	X	X	X
23059	CIO 208 #1 Output 15	HT Coolant Circuit Colder/Open COM	X	X	X	X
23060	CIO 208 #1 Output 18	HT Coolant Circuit Warmer/Close COM	X	X	X	X
23061	CIO 208 #1 Output 21	Alternator Heater COM	X	X	X	X

Address	Content/Position	Description	AGC-5C DG	AGC-5C Group	AGC-5C Plant	AGC-5C Mains
23062	CIO 208 #1 Output 24	LT Coolant Circuit Colder/Open COM	X	X	X	X
23063	CIO 208 #1 Output 27	LT Coolant Circuit Warmer/Close COM	X	X	X	X
23064	CIO 208 #2 Output 9	Common Fault Event COM	X	X	X	X
23065	CIO 208 #2 Output 11	Start Inhibit Event COM	X	X	X	X
23066	CIO 208 #2 Output 13	Louvre Control COM	X	X	X	X
23067	CIO 208 #2 Output 15	Vent Fan Control COM	X	X	X	X
23068	CIO 208 #2 Output 18	Coolant Rad Control Fan COM	X	X	X	X
23069	CIO 208 #2 Output 21	Common Control Shutdown COM	X	X	X	X
23070	CIO 208 #2 Output 24	Common Shutdown COM	X	X	X	X
23071	CIO 208 #2 Output 27	Common Warning COM	X	X	X	X
23072	CIO 208 #3 Output 9		X	X	X	X
23073	CIO 208 #3 Output 11		X	X	X	X
23074	CIO 208 #3 Output 13		X	X	X	X
23075	CIO 208 #3 Output 15		X	X	X	X
23076	CIO 208 #3 Output 18		X	X	X	X
23077	CIO 208 #3 Output 21		X	X	X	X
23078	CIO 208 #3 Output 24		X	X	X	X

Address	Content/Position	Description	AGC-5C DG	AGC-5C Group	AGC-5C Plant	AGC-5C Mains
23079	CIO 208 #3 Output 27		X	X	X	X
23080	CIO 116 #1 conf. status out		X	X	X	X
23081	CIO 116 #2 conf. status out		X	X	X	X
23082	CIO 116 #3 conf. status out		X	X	X	X
23083	CIO 208 #1 conf. status out		X	X	X	X
23084	CIO 208 #2 conf. status out		X	X	X	X
23085	CIO 208 #3 conf. status out		X	X	X	X
23086	CIO 308 #1 conf. status out		X	X	X	X
23087	CIO 308 #2 conf. status out		X	X	X	X
23088	CIO 308 #3 conf. status out		X	X	X	X
23089	Not used: 23089-23100					

5.1.2 Function Code 3 (03h): Read Holding Registers

Address, Bit	Content	AGC-5C DG	AGC-5C Group	AGC-5C Plant	AGC-5C Mains
0	Power regulator setpoint - 0...100% of nominal power. Activated in menu 7501	X			
1	cosPhi regulator setpoint - 60...100 stated as cosPhi value/100. The value 100 means cosPhi = 1. Activated in menu 7504	X			

Address, Bit	Content	AGC-5C DG	AGC-5C Group	AGC-5C Plant	AGC-5C Mains
2	Reactive power regulator setpoint - +/-100% of nominal power. A negative value means capacitive reactive power and a positive value means inductive reactive power. Activated in menu 7505	X			
3	Frequency regulator setpoint - +/-100% corresponding to +/-10.0% of nominal frequency. Activated in menu 7502	X			
4	Voltage regulator setpoint - +/-100% corresponding to +/-10.0% of nominal voltage. Activated in menu 7503	X			
5.00	Not used				
5.01	Remote start	X			
5.02	Remote GB ON	X			
5.02	Remote TB ON		X		X
5.03	Remote GB OFF	X			
5.03	Remote TB OFF		X		X
5.04	Remote stop	X			
5.05	Reset GOV/AVR regulation output to offset	X			
5.06	Start+sync. (semi)	X			
5.07	Alarm inhibit 1	X	X	X	X
5.08	Alarm inhibit 2	X	X	X	X
5.09	Alarm inhibit 3	X	X	X	X
5.10	Alarm ack.	X	X	X	X

Address, Bit	Content	AGC-5C DG	AGC-5C Group	AGC-5C Plant	AGC-5C Mains
5.11	Nominal setting 1	X	X	X	X
5.12	Nominal setting 2	X	X	X	X
5.13	Nominal setting 3	X	X	X	X
5.14	Nominal setting 4	X	X	X	X
5.15	Deload/stop (semi)	X			
6.00	This bit must be 1 when writing the command word. If the bit is 0, the control command is ignored.	X	X	X	X
6.01	Island	X	X	X	X
6.02	Automatic mains failure (AMF)	X	X	X	X
6.03	Peak shaving	X	X	X	X
6.04	Fixed power	X	X	X	X
6.05	Mains power export (MPE)	X	X	X	X
6.06	Load takeover (LTO)	X	X	X	X
6.07	Not used				
6.08	Not used				
6.09	MB ON (Stand- alone)	X			
6.09	MB ON			X	X
6.10	MB OFF (Stand- alone)	X			
6.10	MB OFF			X	X
6.11	Auto start/stop	X	X	X	X
6.12	Manual mode	X			
6.13	Auto mode	X	X	X	X
6.14	Semi-Auto mode	X	X	X	X
6.15	Test mode	X	X	X	X

Address, Bit	Content	AGC-5C DG	AGC-5C Group	AGC-5C Plant	AGC-5C Mains
7.00	This bit must be 1 when writing the command word. If the bit is 0, the control command is ignored.	X	X	X	X
7.01	External frequency control	X			
7.02	External voltage control	X			
7.03	External power control	X	X	X	X
7.04	External reactive power control	X			
7.05	External power factor control	X			
7.06	Capacitive PF	X	X	X	X
7.07	Not used				
7.08	1. priority	X	X		
7.09	Application 1	X	X	X	X
7.10	Application 2	X	X	X	X
7.11	Application 3	X	X	X	X
7.12	Application 4	X	X	X	X
7.13	Not used				
7.14	Not used				
7.15	Synchronize clock to 4:00 a.m.	X	X	X	X
8.00	This bit must be 1 when writing the command word. If the bit is 0, the control command is ignored.	X	X	X	X
8.01	Virtual event 1	X	X	X	X
8.02	Virtual event 2	X	X	X	X
8.03	Virtual event 3	X	X	X	X
8.04	Virtual event 4	X	X	X	X
8.05	Virtual event 5	X	X	X	X
8.06	Virtual event 6	X	X	X	X

Address, Bit	Content	AGC-5C DG	AGC-5C Group	AGC-5C Plant	AGC-5C Mains
8.07	Virtual event 7	X	X	X	X
8.08	Virtual event 8	X	X	X	X
8.09	Virtual event 9	X	X	X	X
8.10	Virtual event 10	X	X	X	X
8.11	Virtual event 11	X	X	X	X
8.12	Virtual event 12	X	X	X	X
8.13	Virtual event 13	X	X	X	X
8.14	Virtual event 14	X	X	X	X
8.15	Virtual event 15	X	X	X	X
9.00	This bit must be 1 when writing the command word. If the bit is 0, the control command is ignored.	X	X	X	X
9.01	Virtual event 16	X	X	X	X
9.02	Virtual event 17	X	X	X	X
9.03	Virtual event 18	X	X	X	X
9.04	Virtual event 19	X	X	X	X
9.05	Virtual event 20	X	X	X	X
9.06	Virtual event 21	X	X	X	X
9.07	Virtual event 22	X	X	X	X
9.08	Virtual event 23	X	X	X	X
9.09	Virtual event 24	X	X	X	X
9.10	Virtual event 25	X	X	X	X
9.11	Virtual event 26	X	X	X	X
9.12	Virtual event 27	X	X	X	X
9.13	Virtual event 28	X	X	X	X
9.14	Virtual event 29	X	X	X	X
9.15	Virtual event 30	X	X	X	X
10.00	This bit must be 1 when writing the command word. If the bit is 0, the control command is ignored.	X	X	X	X
10.01	Virtual event 31	X	X	X	X

Address, Bit	Content	AGC-5C DG	AGC-5C Group	AGC-5C Plant	AGC-5C Mains
10.02	Virtual event 32	X	X	X	X
10.03	Reserved	X	X	X	X
10.04	Clear log	X	X	X	X
10.05	Clear Parameter edits	X	X	X	X
10.06	Not used				
10.07	Not used				
10.08	Not used				
10.09	Not used				
10.10	Not used				
10.11	Not used				
10.12	Not used				
10.13	Not used				
10.14	Not used				
10.15	Not used				
11	Not used: 11-12				
13.00	This bit must be 1 when writing the command word. If the bit is 0, the control command is ignored.	X	X	X	X
13.01	Enable external frequency control	X			
13.02	Disable external frequency control	X			
13.03	Enable external voltage control	X			
13.04	Disable external voltage control	X			
13.05	Enable external power control	X	X	X	X
13.06	Disable external power control	X	X	X	X
13.07	Enable external VAr control	X			
13.08	Disable external VAr control	X			

Address, Bit	Content	AGC-5C DG	AGC-5C Group	AGC-5C Plant	AGC-5C Mains
13.09	External power factor control	X			
13.09	Enable external CosPhi control	X			
13.10	External power factor control	X			
13.10	Disable external CosPhi control	X			
13.11	Not used				
13.12	Not used				
13.13	Reset horn	X	X	X	X
13.14	Not used				
13.15	Not used				
14	Not used: 14-200				
58000	Year (2003-2099)	X	X	X	X
58001	Month (1-12)	X	X	X	X
58002	Date (1-31)	X	X	X	X
58003	Day (1-7, Monday - Sunday)	X	X	X	X
58004	Hour (0-23)	X	X	X	X
58005	Min (0-59)	X	X	X	X
58006	Sec (0-59)	X	X	X	X

5.1.3 Function Code 4 (04h): Read Input Registers (Address, Bit: 500-593)

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
500		Application version		X	X	X	X
501	^U L1-L2	Generator voltage L1-L2 [V]		X			
501	^U L1-L2	Group voltage L1-L2 [V]			X		

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
501	^u L1-L2	Mains voltage L1-L2 [V]				X	X
502	^u L2-L3	Generator voltage L2-L3 [V]		X			
502	^u L2-L3	Group voltage L2-L3 [V]			X		
502	^u L2-L3	Mains voltage L2-L3 [V]				X	X
503	^u L3-L1	Generator voltage L3-L1 [V]		X			
503	^u L3-L1	Group voltage L3-L1 [V]			X		
503	^u L3-L1	Mains voltage L3-L1 [V]				X	X
504	^u L1-N	Generator voltage L1-N [V]		X			
504	^u L1-N	Group voltage L1-N [V]			X		
504	^u L1-N	Mains voltage L1-N [V]				X	X
505	^u L2-N	Generator voltage L2-N [V]		X			
505	^u L2-N	Group voltage L2-N [V]			X		
505	^u L2-N	Mains voltage L2-N [V]				X	X
506	^u L3-N	Generator voltage L3-N [V]		X			
506	^u L3-N	Group voltage L3-N [V]			X		

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
506	^u L3-N	Mains voltage L3-N [V]				X	X
507	^f L1	Generator f L1 [Hz/100]	1/100	X			
507	^f L1	Group f L1 [Hz/100]	1/100		X		
507	^f L1	Mains f L1 [Hz/100]	1/100			X	X
508	^f L2	Generator f L2 [Hz/100]	1/100	X			
508	^f L2	Group f L2 [Hz/100]	1/100		X		
508	^f L2	Mains f L2 [Hz/100]	1/100			X	X
509	^f L3	Generator f L3 [Hz/100]	1/100	X			
509	^f L3	Group f L3 [Hz/100]	1/100		X		
509	^f L3	Mains f L3 [Hz/100]	1/100			X	X
510	Phi	Generator voltage phase angle L1-L2 [Deg/10]	10-Jan	X			
510	Phi	Group voltage phase angle L1- L2 [Deg/10]			X		
510	Phi	Mains voltage phase angle L1- L2 [Deg/10]				X	X
511	Phi	Generator voltage phase angle L2-L3 [Deg/10]		X			

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
511	Phi	Group voltage phase angle L2- L3 [Deg/10]			X		
511	Phi	Mains voltage phase angle L2- L3 [Deg/10]				X	X
512	Phi	Generator voltage phase angle L3-L1 [Deg/10]		X			
512	Phi	Group voltage phase angle L3- L1 [Deg/10]			X		
512	Phi	Mains voltage phase angle L3- L1 [Deg/10]				X	X
513	I'L1	Generator current L 1 [A]		X			
513	I'L1	Group current L 1 [A]			X		
513	I'L1	Mains current L 1 [A]					X
513	I'L1	Plant current L1 [A]				X	
514	I'L2	Generator current L2 [A]		X			
514	I'L2	Group current L2 [A]			X		
514	I'L2	Mains current L2 [A]					X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
514	I ^{L2}	Plant current L2 [A]				X	
515	I ^{L3}	Generator current L3 [A]		X			
515	I ^{L3}	Group current L3 [A]			X		
515	I ^{L3}	Mains current L3 [A]					X
515	I ^{L3}	Plant current L3 [A]				X	
516	P ^{L1}	Generator power L1 [kW]		X			
516	P ^{L1}	Group power L1 [kW]			X		
516	P ^{L1}	Mains power L1 [kW]					X
516	P ^{L1}	Plant power L1 [kW]				X	
517	P ^{L2}	Generator power L2 [kW]		X			
517	P ^{L2}	Group power L2 [kW]			X		
517	P ^{L2}	Mains power L2 [kW]					X
517	P ^{L2}	Plant power L2 [kW]				X	
518	P ^{L3}	Generator power L3 [kW]		X			
518	P ^{L3}	Group power L3 [kW]			X		
518	P ^{L3}	Mains power L3 [kW]					X
518	P ^{L3}	Plant power L3 [kW]				X	
519	P	Generator power [kW]		X			

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
519	P	Group power [kW]			X		
519	P	Mains power [kW]					X
519	P	Plant power [kW]				X	
520	^Q L1	Generator reactive power L1 [kVAr]		X			
520	^Q L1	Group reactive power L1 [kVAr]			X		
520	^Q L1	Mains reactive power L1 [kVAr]					X
520	^Q L1	Plant reactive power L1 [kVAr]				X	
521	^Q L2	Generator reactive power L2 [kVAr]		X			
521	^Q L2	Group reactive power L2 [kVAr]			X		
521	^Q L2	Mains reactive power L2 [kVAr]					X
521	^Q L2	Plant reactive power L2 [kVAr]				X	
522	^Q L3	Generator reactive power L3 [kVAr]		X			
522	^Q L3	Group reactive power L3 [kVAr]			X		

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
522	^Q L3	Mains reactive power L3 [kVAr]					X
522	^Q L3	Plant reactive power L3 [kVAr]				X	
523	Q	Generator reactive power [kVAr]		X			
523	Q	Group reactive power [kVAr]			X		
523	Q	Mains reactive power [kVAr]					X
523	Q	Plant reactive power [kVAr]				X	
524	^S L1	Generator apparent power L1 [kVA]		X			
524	^S L1	Group apparent power L1 [kVA]			X		
524	^S L1	Mains apparent power L1 [kVA]					X
524	^S L1	Plant apparent power L1 [kVA]				X	
525	^S L2	Generator apparent power L2 [kVA]		X			
525	^S L2	Group apparent power L2 [kVA]			X		

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
525	^s L2	Mains apparent power L2 [kVA]					X
525	^s L2	Plant apparent power L2 [kVA]				X	
526	^s L3	Generator apparent power L3 [kVA]		X			
526	^s L3	Group apparent power L3 [kVA]			X		
526	^s L3	Mains apparent power L3 [kVA]					X
526	^s L3	Plant apparent power L3 [kVA]				X	
527	S	Generator apparent power [kVA]		X			
527	S	Group apparent power [kVA]			X		
527	S	Mains apparent power [kVA]					X
527	S	Plant apparent power [kVA]				X	
528	^R EXP	Generator Export, reactive energy counter [kVArh] [Hi]		X			

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
528	^R EXP	Group Export, reactive energy counter [kVArh] [Hi]			X		
528	^R EXP	Mains Export, reactive energy counter [kVArh] [Hi]					X
528	^R EXP	Plant Export, reactive energy counter [kVArh] [Hi]				X	
529	^R EXP	Generator Export, reactive energy counter [kVArh] [Lo]		X			
529	^R EXP	Group Export, reactive energy counter [kVArh] [Lo]			X		
529	^R EXP	Mains Export, reactive energy counter [kVArh] [Lo]					X
529	^R EXP	Plant Export, reactive energy counter [kVArh] [Lo]				X	
530	^E EXP	Generator Export, active energy counter, day [kWh] [Hi]		X			

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
530	^E EXP	Group Export, active energy counter, day [kWh] [Hi]			X		
530	^E EXP	Mains Export, active energy counter, day [kWh] [Hi]					X
530	^E EXP	Plant Export, active energy counter, day [kWh] [Hi]				X	
531	^E EXP	Generator Export, active energy counter, day [kWh] [Lo]		X			
531	^E EXP	Group Export, active energy counter, day [kWh] [Lo]			X		
531	^E EXP	Mains Export, active energy counter, day [kWh] [Lo]					X
531	^E EXP	Plant Export, active energy counter, day [kWh] [Lo]				X	
532	^E EXP	Generator Export, active energy counter, week [kWh] [Hi]		X			
532	^E EXP	Group Export, active energy counter, week [kWh] [Hi]			X		

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
532	^E EXP	Mains Export, active energy counter, week [kWh] [Hi]					X
532	^E EXP	Plant Export, active energy counter, week [kWh] [Hi]				X	
533	^E EXP	Generator Export, active energy counter, week [kWh] [Lo]		X			
533	^E EXP	Group Export, active energy counter, week [kWh] [Lo]			X		
533	^E EXP	Mains Export, active energy counter, week [kWh] [Lo]					X
533	^E EXP	Plant Export, active energy counter, week [kWh] [Lo]				X	
534	^E EXP	Generator Export, active energy counter, month [kWh] [Hi]		X			
534	^E EXP	Group Export, active energy counter, month [kWh] [Hi]			X		

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
534	^E EXP	Mains Export, active energy counter, month [kWh] [Hi]					X
534	^E EXP	Plant Export, active energy counter, month [kWh] [Hi]				X	
535	^E EXP	Generator Export, active energy counter, month [kWh] [Lo]		X			
535	^E EXP	Group Export, active energy counter, month [kWh] [Lo]			X		
535	^E EXP	Mains Export, active energy counter, month [kWh] [Lo]					X
535	^E EXP	Plant Export, active energy counter, month [kWh] [Lo]				X	
536	^E EXP	Generator Export, active energy counter, total [kWh] [Hi]		X			
536	^E EXP	Group Export, active energy counter, total [kWh] [Hi]			X		
536	^E EXP	Mains Export, active energy counter, total [kWh] [Hi]					X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
536	^E EXP	Plant Export, active energy counter, total [kWh] [Hi]				X	
537	^E EXP	Generator Export, active energy counter, total [kWh] [Lo]		X			
537	^E EXP	Group Export, active energy counter, total [kWh] [Lo]			X		
537	^E EXP	Mains Export, active energy counter, total [kWh] [Lo]					X
537	^E EXP	Plant Export, active energy counter, total [kWh] [Lo]				X	
538	PF	Generator PF [PF/100]		X			
538	PF	Group PF [PF/100]			X		
538	PF	Mains PF [PF/100]				X	X
539	^U L1-L2	Busbar / Generator busbar voltage L1-L2 [V]		X			
539	^U L1-L2	Busbar voltage L1-L2 [V]					X
539	^U L1-L2	Generator busbar voltage L1-L2 [V]			X		
539	^U L1-L2	Group busbar voltage L1-L2 [V]				X	

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
540	^U L2-L3	Busbar / Generator busbar voltage L2-L3 [V]		X			
540	^U L2-L3	Busbar voltage L2-L3 [V]					X
540	^U L2-L3	Generator busbar voltage L2-L3 [V]			X		
540	^U L2-L3	Group busbar voltage L2-L3 [V]				X	
541	^U L3-L1	Busbar / Generator busbar voltage L3-L1 [V]		X			
541	^U L3-L1	Busbar voltage L3-L1 [V]					X
541	^U L3-L1	Generator busbar voltage L3-L1 [V]			X		
541	^U L3-L1	Group busbar voltage L3-L1 [V]				X	
542	^U L1-N	Busbar / Generator busbar voltage L1-N [V]		X			
542	^U L1-N	Busbar voltage L1-N [V]					X
542	^U L1-N	Generator busbar voltage L1-N [V]			X		
542	^U L1-N	Group busbar voltage L1-N [V]				X	

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
543	^u L2-N	Busbar / Generator busbar voltage L2-N [V]		X			
543	^u L2-N	Busbar voltage L2-N [V]					X
543	^u L2-N	Generator busbar voltage L2-N [V]			X		
543	^u L2-N	Group busbar voltage L2-N [V]				X	
544	^u L3-N	Busbar / Generator busbar voltage L3-N [V]		X			
544	^u L3-N	Busbar voltage L3-N [V]					X
544	^u L3-N	Generator busbar voltage L3-N [V]			X		
544	^u L3-N	Group busbar voltage L3-N [V]				X	
545	ⁱ L1	Busbar / Generator busbar f L1 [Hz/100]		X			
545	ⁱ L1	Busbar f L1 [Hz/100]					X
545	ⁱ L1	Generator busbar f L1 [Hz/100]			X		
545	ⁱ L1	Group busbar f L1 [Hz/100]				X	
546	ⁱ L2	Busbar / Generator busbar f L2 [Hz/100]		X			

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
546	^f L2	Busbar f L2 [Hz/100]					X
546	^f L2	Generator busbar f L1 [Hz/100]			X		
546	^f L2	Group busbar f L1 [Hz/100]				X	
547	^f L3	Busbar / Generator busbar f L3 [Hz/100]		X			
547	^f L3	Busbar f L3 [Hz/100]					X
547	^f L3	Generator busbar f L1 [Hz/100]			X		
547	^f L3	Group busbar f L1 [Hz/100]				X	
548	^{Phi} L1-L2	Busbar / Generator busbar volt- age phase angle L1-L2 [Deg/10]		X			
548	^{Phi} L1-L2	Busbar voltage phase angle L1- L2 [Deg/10]					X
548	^{Phi} L1-L2	Generator busbar voltage phase angle L1-L2 [Deg/10]			X		
548	^{Phi} L1-L2	Group busbar voltage phase angle L1-L2 [Deg/10]				X	

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
549	^{Phi} L2-L3	Busbar / Generator busbar voltage phase angle L2-L3 [Deg/10]		X			
549	^{Phi} L2-L3	Busbar voltage phase angle L2- L3 [Deg/10]					X
549	^{Phi} L2-L3	Generator busbar voltage phase angle L2-L3 [Deg/10]			X		
549	^{Phi} L2-L3	Group busbar voltage phase angle L2-L3 [Deg/10]				X	
550	^{Phi} L3-L1	Busbar / Generator busbar voltage phase angle L3-L1 [Deg/10]		X			
550	^{Phi} L3-L1	Busbar voltage phase angle L3- L1 [Deg/10]					X
550	^{Phi} L3-L1	Generator busbar voltage phase angle L3-L1 [Deg/10]			X		
550	^{Phi} L3-L1	Group busbar voltage phase angle L3-L1 [Deg/10]				X	

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
551	Φ_{L1-L1}	U BB L1 - U Gen. L1 phase angle [Deg/10]		X			
551	Φ_{L1-L1}	U BB L1 - U Mains L1 phase angle [Deg/10]					X
551	Φ_{L1-L1}	U Gen. BB L1 - U Group BB L1 phase angle [Deg/10]			X		
551	Φ_{L1-L1}	U Group BB L1 - U Mains L1 phase angle [Deg/10]				X	
552	Φ_{L2-L2}	U BB L2 - U Gen. L2 phase angle [Deg/10]		X			
552	Φ_{L2-L2}	U BB L2 - U Mains L2 phase angle [Deg/10]					X
552	Φ_{L2-L2}	U Gen. BB L2 - U Group BB L2 phase angle [Deg/10]			X		
552	Φ_{L2-L2}	U Group BB L2 - U Mains L2 phase angle [Deg/10]				X	
553	Φ_{L3-L3}	U BB L3 - U Gen. L3 phase angle [Deg/10]		X			
553	Φ_{L3-L3}	U BB L3 - U Mains L3 phase angle [Deg/10]					X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
553	^{Phi} L3-L3	U Gen. BB L3 - U Group BB L3 phase angle [Deg/10]			X		
553	^{Phi} L3-L3	U Group BB L3 - U Mains L3 phase angle [Deg/10]				X	
554	Abs. run. hours	Absolute running hours [Hi]		X			
555	Abs. run. hours	Absolute running hours [Lo]		X			
556	Rel. run. hours	Relative running hours [Hi]		X			
557	Rel. run. hours	Relative running hours [Lo]		X			
558	Alarms	No. of alarms		X	X	X	X
559	Alarms	No. of unacknowledged alarms		X	X	X	X
560	Alarms	No. of active acknowledged alarms		X	X	X	X
561		Not used: 561, 562					
563	^{GB} oper	No. of GB operations		X			
563	^{TB} oper	No. of TB operations			X	X	X
564	^{MB} oper	No. of MB operations		X		X	X
565		Not used					
566	Start attempts	Start attempts		X			
567	^U SUPPLY	DC supply term. 1-2 [V/10]		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
568	^U SUPPLY M4	DC supply term. 98-99 [V/10]		X	X	X	X
569	Service	Service timer 1 running hours		X			
570	Service	Service timer 1 running days		X			
571	Service	Service timer 2 running hours		X			
572	Service	Service timer 2 running days		X			
573	Cos-phi	Cos-phi [cosPhi/100]		X	X	X	X
574	Cos-phi	Cos-phi Inductive/Capacitive 0=Inductive, 1=Capacitive		X	X	X	X
575		Not used					
576	RPM	RPM		X			
577	Running hours load profile	Running hours load profile [Hi]		X			
578	Running hours load profile	Running hours load profile [Lo]		X			
579		Not used					
580		Reserved: 580-582		X	X	X	X
583		Multi-input 102-Alternator Bearing DE R1 (RD)		X	X	X	X
584		Multi-input 105-Alternator Bearing NDE R1 (RD)		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
585		Multi-input 108-		X	X	X	X
		Not Used					
586	Ain	Analogue input 91-		X	X	X	X
		Configurable Analog Output No 2 Return					
587	Ain	Analogue input 93- Not Used		X	X	X	X
588	Ain	Analogue input 95- Configurable Analog Output No 3 Return		X	X	X	X
589	Ain	Analogue input 97- Not Used		X	X	X	X
590		Internal Temperature [Deg C /10]		X	X	X	X
591	P	TB power, Multi-input 105 (Transducer)					X
592	P	Group power, Multi-input 102 (Transducer)			X		
592	P	Mains power, Multi-input 102 (Transducer)		X			
592	P	Mains power, Multi-input 102 (Transducer)					X
592	P	Plant power, Multi-input 102 (Transducer)				X	

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
593		Engine J1939 data, 593-641, see Function code 4 (EIC)		X			

5.1.4 Function Code 4 (04h): Read Input Registers (Address, Bit: 642-799)

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
642	RegAddr.	Control register address 0		X	X	X	X
643	RegAddr.	Control register address 1		X	X	X	X
644	RegAddr.	Control register address 2		X	X	X	X
645	RegAddr.	Control register address 3		X	X	X	X
646	RegAddr.	Control register address 4		X	X	X	X
647	RegAddr.	Control register address 5		X	X	X	X
648	RegAddr.	Control register address 6		X	X	X	X
649	RegAddr.	Control register address 7		X	X	X	X
650	RegAddr.	Control register address 8		X	X	X	X
651	RegAddr.	Control register address 9		X	X	X	X
652	RegAddr.	Control register address 10		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
653	RegAddr.	Control register address 11		X	X	X	X
654	RegAddr.	Control register address 12		X	X	X	X
655	Ain	Control register address 13		X	X	X	X
656	Ain	Analogue input 127		X	X	X	X
657	Ain	Analogue input 129		X	X	X	X
658	Ain	Analogue input 131		X	X	X	X
659	Ext Ain	Analogue input 133		X	X	X	X
660	Ext Ain	External Ain 1/CIO 308 no. 1.		X	X	X	X
		Input 8 [Config]					
661	Ext Ain	External Ain 2/CIO 308 no. 1.		X	X	X	X
		Input 11 [Config]					
662	Ext Ain	External Ain 3/CIO 308 no. 1.		X	X	X	X
		Input 14 [Config]					
663	Ext Ain	External Ain 4/CIO 308 no. 1.		X	X	X	X
		Input 17 [Config]					
664	Ext Ain	External Ain 5/CIO 308 no. 1.		X	X	X	X
		Input 20 [Config]					

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
665	Ext Ain	External Ain 6/CIO 308 no. 1.		X	X	X	X
		Input 23 [Config]					
666	Ext Ain	External Ain 7/CIO 308 no. 1.		X	X	X	X
		Input 26 [Config]					
667	Ext Ain	External Ain 8/CIO 308 no. 1.		X	X	X	X
		Input 29 [Config]					
668	Ext Ain	CIO 308 no. 2. Input 8 [Config]		X	X	X	X
669	Ext Ain	CIO 308 no. 2. Input 11 [Config]		X	X	X	X
670	Ext Ain	CIO 308 no. 2. Input 14 [Config]		X	X	X	X
671	Ext Ain	CIO 308 no. 2. Input 17 [Config]		X	X	X	X
672	Ext Ain	CIO 308 no. 2. Input 20 [Config]		X	X	X	X
673	Ext Ain	CIO 308 no. 2. Input 23 [Config]		X	X	X	X
674	Ext Ain	CIO 308 no. 2. Input 26 [Config]		X	X	X	X
675	Ext Ain	CIO 308 no. 2. Input 29 [Config]		X	X	X	X
676	Ext Ain	CIO 308 no. 3. Input 8 [Config]		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
677	Ext Ain	CIO 308 no. 3. Input 11 [Config]		X	X	X	X
678	Ext Ain	CIO 308 no. 3. Input 14 [Config]		X	X	X	X
679	Ext Ain	CIO 308 no. 3. Input 17 [Config]		X	X	X	X
680	Ext Ain	CIO 308 no. 3. Input 20 [Config]		X	X	X	X
681	Ext Ain	CIO 308 no. 3. Input 23 [Config]		X	X	X	X
682	Ext Ain	CIO 308 no. 3. Input 26 [Config]		X	X	X	X
683		CIO 308 no. 3. Input 29 [Config]		X	X	X	X
684		Not used: 684-689					
690	RegAddr.	Control register address 14		X	X	X	X
691	RegAddr.	Control register address 15		X	X	X	X
692		Not used: 692-695					
696		Engine J1939 data, 696-699, see Function code 4 (EIC)		X			
700		Actual nominal power (Includes derate etc.)		X	X	X	X
701		Group power transducer used			X		

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
701		Mains power transducer used		X			
701		Mains power transducer used				X	X
702		Fan A running hours [Hi]		X			
703		Fan A running hours [Lo]		X			
704		Fan B running hours [Hi]		X			
705		Fan B running hours [Lo]		X			
706		Fan C running hours [Hi]		X			
707		Fan C running hours [Lo]		X			
708		Fan D running hours [Hi]		X			
709		Fan D running hours [Lo]		X			
710		Reserved: 710 to 736		X	X	X	X
737		Not used: 737 to 779		X	X	X	X
780		LVRT activated 1		X			
781		LVRT tripped 1		X			
782		LVRT activated 2		X			
783		LVRT tripped 2		X			
784		Not used: 784-789					

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
790	^R EXP	Generator Export reactive energy counter, month [kvarh] [Hi]		X			
790	^R EXP	Group export reactive energy counter, month [kvarh] [Hi]			X		
790	^R EXP	Mains export reactive energy counter, month [kvarh] [Hi]					X
790	^R EXP	Plant export reactive energy counter, month [kvarh] [Hi]				X	
791	^R EXP	Generator Export reactive energy counter, month [kvarh] [Lo]		X			
791	^R EXP	Group export reactive energy counter, month [kvarh] [Lo]			X		
791	^R EXP	Mains export reactive energy counter, month [kvarh] [Lo]					X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
791	^R EXP	Plant export reactive energy counter, month [kvarh] [Lo]				X	
792	^R EXP	Generator Export reactive energy counter, week [kvarh] [Hi]		X			
792	^R EXP	Group export reactive energy counter, week [kvarh] [Hi]			X		
792	^R EXP	Mains export reactive energy counter, week [kvarh] [Hi]					X
792	^R EXP	Plant export reactive energy counter, week [kvarh] [Hi]				X	
793	^R EXP	Generator Export reactive energy counter, week [kvarh] [Lo]		X			
793	^R EXP	Group export reactive energy counter, week [kvarh] [Lo]			X		

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
793	^R EXP	Mains export reactive energy counter, week [kvarh] [Lo]					X
793	^R EXP	Plant export reactive energy counter, week [kvarh] [Lo]				X	
794	^R EXP	Generator Export reactive energy counter, total [kvarh] [Hi]		X			
794	^R EXP	Group export reactive energy counter, total [kvarh] [Hi]			X		
794	^R EXP	Mains export reactive energy counter, total [kvarh] [Hi]					X
794	^R EXP	Plant export reactive energy counter, total [kvarh] [Hi]				X	
795	^R EXP	Generator Export reactive energy counter, total [kvarh] [Lo]		X			
795	^R EXP	Group export reactive energy counter, total [kvarh] [Lo]			X		
795	^R EXP	Mains export reactive energy counter, total [kvarh] [Lo]					X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
795	^R EXP	Plant export reactive energy counter, total [kvarh] [Lo]				X	
796	^E IMP	Generator Import active energy counter, total [kWh] [Hi]		X			
796	^E IMP	Group import active energy counter, total [kWh] [Hi]			X		
796	^E IMP	Mains import active energy counter, total [kWh] [Hi]					X
796	^E IMP	Plant import active energy counter, total [kWh] [Hi]				X	
797	^E IMP	Generator Import active energy counter, total [kWh] [Lo]		X			
797	^E IMP	Group import active energy counter, total [kWh] [Lo]			X		
797	^E IMP	Mains import active energy counter, total [kWh] [Lo]					X
797	^E IMP	Plant import active energy counter, total [kWh] [Lo]				X	
798	^E IMP	Generator Import active energy counter, month [kWh] [Hi]		X			

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
798	^E IMP	Group import active energy counter, month [kWh] [Hi]			X		
798	^E IMP	Mains import active energy counter, month [kWh] [Hi]					X
798	^E IMP	Plant import active energy counter, month [kWh] [Hi]				X	
799	^E IMP	Generator Import active energy counter, month [kWh] [Lo]		X			
799	^E IMP	Group import active energy counter, month [kWh] [Lo]			X		
799	^E IMP	Mains import active energy counter, month [kWh] [Lo]					X
799	^E IMP	Plant import active energy counter, month [kWh] [Lo]				X	

5.1.5 Function Code 4 (04h): Read Input Registers (Address, Bit: 800-900)

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
800	^E IMP	Generator Import active energy counter, week [kWh] [Hi]		X			
800	^E IMP	Group import active energy counter, week [kWh] [Hi]			X		
800	^E IMP	Mains import active energy counter, week [kWh] [Hi]					X
800	^E IMP	Plant import active energy counter, week [kWh] [Hi]				X	
801	^E IMP	Generator Import active energy counter, week [kWh] [Lo]		X			
801	^E IMP	Group import active energy counter, week [kWh] [Lo]			X		
801	^E IMP	Mains import active energy counter, week [kWh] [Lo]					X
801	^E IMP	Plant import active energy counter, week [kWh] [Lo]				X	
802	^E IMP	Generator Import active energy counter, day [kWh] [Hi]		X			

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
802	^E IMP	Group import active energy counter, day [kWh] [Hi]			X		
802	^E IMP	Mains import active energy counter, day [kWh] [Hi]					X
802	^E IMP	Plant import active energy counter, day [kWh] [Hi]				X	
803	^E IMP	Generator Import active energy counter, day [kWh] [Lo]		X			
803	^E IMP	Group import active energy counter, day [kWh] [Lo]			X		
803	^E IMP	Mains import active energy counter, day [kWh] [Lo]					X
803	^E IMP	Plant import active energy counter, day [kWh] [Lo]				X	
804	^R IMP	Generator Import reactive energy counter, total [kvarh] [Hi]		X			
804	^R IMP	Group import reactive energy counter, total [kvarh] [Hi]			X		
804	^R IMP	Mains import reactive energy counter, total [kvarh] [Hi]					X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
804	^R IMP	Plant import reactive energy counter, total [kvarh] [Hi]				X	
805	^R IMP	Generator Import reactive energy counter, total [kvarh] [Lo]		X			
805	^R IMP	Group import reactive energy counter, total [kvarh] [Lo]			X		
805	^R IMP	Mains import reactive energy counter, total [kvarh] [Lo]					X
805	^R IMP	Plant import reactive energy counter, total [kvarh] [Lo]				X	
806	^R IMP	Generator Import reactive energy counter, month [kvarh] [Hi]		X			
806	^R IMP	Generator Import reactive energy counter, month [kvarh] [Lo]					X
806	^R IMP	Group import reactive energy counter, month [kvarh] [Hi]			X		

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
806	^R IMP	Mains import reactive energy counter, month [kvarh] [Hi]				X	
807	^R IMP	Generator Import reactive energy counter, week [kvarh] [Hi]					X
807	^R IMP	Group import reactive energy counter, month [kvarh] [Lo]		X			
807	^R IMP	Mains import reactive energy counter, month [kvarh] [Lo]				X	
807	^R IMP	Plant import reactive energy counter, month [kvarh] [Lo]			X		
808	^R IMP	Generator Import reactive energy counter, week [kvarh] [Lo]					X
808	^R IMP	Group import reactive energy counter, week [kvarh] [Hi]		X			

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
808	^R IMP	Mains import reactive energy counter, week [kvarh] [Hi]				X	
808	^R IMP	Plant import reactive energy counter, week [kvarh] [Hi]			X		
809	^R IMP	Generator Import reactive energy counter, day [kvarh] [Hi]					X
809	^R IMP	Group import reactive energy counter, week [kvarh] [Lo]		X			
809	^R IMP	Mains import reactive energy counter, week [kvarh] [Lo]				X	
809	^R IMP	Plant import reactive energy counter, week [kvarh] [Lo]			X		
810	^R IMP	Generator Import reactive energy counter, day [kvarh] [Lo]					X
810	^R IMP	Group import reactive energy counter, day [kvarh] [Hi]		X			

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
810	^R IMP	Mains import reactive energy counter, day [kvarh] [Hi]				X	
810	^R IMP	Plant import reactive energy counter, day [kvarh] [Hi]			X		
811	^R IMP	Generator import reactive energy counter, day [kvarh] [Lo]					X
811	^R IMP	Group import reactive energy counter, day [kvarh] [Lo]		X			
811	^R IMP	Mains import reactive energy counter, day [kvarh] [Lo]				X	
811	^R IMP	Plant import reactive energy counter, day [kvarh] [Lo]			X		
812	Counter	Pulse counter 01 [Hi]		X	X	X	X
813	Counter	Pulse counter 01 [Lo]		X	X	X	X
814	Counter	Pulse counter 02 [Hi]		X	X	X	X
815	Counter	Pulse counter 02 [Lo]		X	X	X	X
816	^I peak	Demand of peak current 1		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
817	I _{peak}	Demand of peak current 2		X	X	X	X
818	I _{peak}	Demand of peak current 3		X	X	X	X
819	I _{peak} , AVG	Demand of avg. peak current 1		X	X	X	X
820	I _{peak} , AVG	Demand of avg. peak current 2		X	X	X	X
821	I _{peak} , AVG	Demand of avg. peak current 3		X	X	X	X
822		Digital input 23- Local Emergency Stop (NO)		X	X	X	X
822.01		Digital input 24- Utility Circuit Breaker Tripped (NO) (OPEN)		X	X	X	X
822.02		Digital input 25- Utility Circuit Breaker Position (A) (NO) (CLOSED)		X	X	X	X
822.03		Digital input 26- Genset Circuit Breaker Tripped (NO) (OPEN)		X	X	X	X
822.04		Digital input 27- Genset Circuit Breaker Position (A) (NO) (CLOSED)		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
822.05		Digital input 43- Oil Slow Flow Meter		X	X	X	X
822.06		Digital input 44- Fault Reset (NO)		X	X	X	X
822.07		Digital input 45- Customer Input/Fault No 1 Warning (NO)		X	X	X	X
822.08		Digital input 46- Customer Input/Fault No 2 Shutdown (NO)		X	X	X	X
822.09		Digital input 47- Customer Input/Fault No 3 Controlled Shutdown (NO)		X	X	X	X
822.1		Digital input 48- Customer Input/Fault No 4 Earth Fault (NO)		X	X	X	X
822.11		Digital input 49- Customer Input/Fault No 5 Differential Fault (NC)		X	X	X	X
822.12		Digital input 50- Customer Input/Fault No 6 (Configurable) (NO)		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
822.13		Digital input 51- Customer Input/Fault No 7 (Configurable) (NO)		X	X	X	X
822.14		Digital input 52		X	X	X	X
822.15		Digital input 53		X	X	X	X
823		Digital input 54		X	X	X	X
823.01		Digital input 55- Fire Protection Trip Shutdown (Open to Trip) (NC)		X	X	X	X
823.02		Digital input 112- Utility Circuit Breaker Close (To) Inhibit (NO)		X	X	X	X
823.03		Digital input 113- Genset Circuit Breaker Close (To) Inhibit (NO)		X	X	X	X
823.04		Digital input 114- Derate Authorization (NO)		X	X	X	X
823.05		Digital input 115- Remote Start (NO)		X	X	X	X
823.06		Digital input 116- Alt voltage sensing OK (NC)		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
823.07		Digital input 117- Start system trip warning (NC)		X	X	X	X
823.08		Emergency STOP		X	X	X	X
823.09		Not used					
823.1		Not used					
823.11		Not used					
823.12		Not used					
823.13		Not used					
823.14		Not used					
823.15		Not used					
824		Regulator output, GOV [%/10]		X			
825		Regulator output, AVR [%/10]		X			
826		Regulator output, PID1 [%/10]		X			
827		Regulator output, PID2 [%/10]		X			
828		Regulator output, PID3 [%/10]		X			
829		Regulator output, PID4 [%/10]		X			
830		Mlogic Timer 1 Remaining		X	X	X	X
831		Mlogic Timer 2 Remaining		X	X	X	X
832		Mlogic Timer 3 Remaining		X	X	X	X
833		Mlogic Timer 4 Remaining		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
834		Fan analogue transducer out- put [/10]		X			
835		External digital input/CIO 116 no. 1. Input 10- Coolant Heater Element Trip		X	X	X	X
835.01		External digital input/CIO 116 no. 1. Input 11- Coolant Heater Element CB Feedback		X	X	X	X
835.02		External digital input/CIO 116 no. 1. Input 12- Oil Heater Element Gearbox Trip		X	X	X	X
835.03		External digital input/CIO 116 no. 1. Input 13-		X	X	X	X
835.04		External digital input/CIO 116 no. 1. Input 14- Oil Heater Element (Immersion) CB Feedback		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
835.05		External digital input/CIO 116 no. 1. Input 15- Oil Heater Pump CB Feedback		X	X	X	X
835.06		External digital input/CIO 116 no. 1. Input 16- Oil Heater Element Trip		X	X	X	X
835.07		External digital input/CIO 116 no. 1. Input 17- Oil Heater Element Feedback		X	X	X	X
835.08		External digital input/CIO 116 no. 1. Input 19- AC ISO Switch Status		X	X	X	X
835.09		External digital input/CIO 116 no. 1. Input 20- Coolant Heater Pump Trip		X	X	X	X
835.1		External digital input/CIO 116 no. 1. Input 21- Coolant Heater Pump CB Feedback		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
835.11		External digital input/CIO 116 no. 1. Input 22- Alternator Heater Trip		X	X	X	X
835.12		External digital input/CIO 116 no. 1. Input 23- Alternator Heater CB Feedback		X	X	X	X
835.13		External digital input/CIO 116 no. 1. Input 24- HT Valve Motor Trip		X	X	X	X
835.14		External digital input/CIO 116 no. 1. Input 25- LT Valve Motor Trip		X	X	X	X
835.15		External digital input/CIO 116 no. 1. Input 26- AC GFI Outlet		X	X	X	X
836		CIO 116 no. 2. Input 10- Alternator Auto-Lube Alarm		X	X	X	X
836.01		CIO 116 no. 2. Input 11- Bearing Vibration Warning		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
836.02		CIO 116 no. 2. Input 12-UPS Control Battery Low Signal		X	X	X	X
836.03		CIO 116 no. 2. Input 13-UPS Replace Control Battery Signal		X	X	X	X
836.04		CIO 116 no. 2. Input 14-Customer Convenience DC Power is Applied		X	X	X	X
836.05		CIO 116 no. 2. Input 15-Spare		X	X	X	X
836.06		CIO 116 no. 2. Input 16-ISB Power is Applied		X	X	X	X
836.07		CIO 116 no. 2. Input 17-Spare		X	X	X	X
836.08		CIO 116 no. 2. Input 19-HT ACW Stop Indication		X	X	X	X
836.09		CIO 116 no. 2. Input 20-HT CW Stop Indication		X	X	X	X
836.1		CIO 116 no. 2. Input 21-LT ACW Stop Indication		X	X	X	X
836.11		CIO 116 no. 2. Input 22-LT CW Stop Indication		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
836.12		CIO 116 no. 2. Input 23- HT AC Pump State		X	X	X	X
836.13		CIO 116 no. 2. Input 24- HT AC Pump Trip		X	X	X	X
836.14		CIO 116 no. 2. Input 25- LT AC Pump State		X	X	X	X
836.15		CIO 116 no. 2. Input 26- LT AC Pump Trip		X	X	X	X
837		CIO 116 no. 3. Input 10- HT Tank Low Level		X	X	X	X
837.01		CIO 116 no. 3. Input 11- HT Tank Very Low Level		X	X	X	X
837.02		CIO 116 no. 3. Input 12- LT Tank Low Level		X	X	X	X
837.03		CIO 116 no. 3. Input 13- LT Tank Very Low Level		X	X	X	X
837.04		CIO 116 no. 3. Input 14- Radiator Fan Common Trip Warning		X	X	X	X
837.05		CIO 116 no. 3. Input 15- Louver closed warning		X	X	X	X
837.06		CIO 116 no. 3. Input 16- Louver Trip		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
837.07		CIO 116 no. 3. Input 17-Vent Fan Trip Warning		X	X	X	X
837.08		CIO 116 no. 3. Input 19-Spare		X	X	X	X
837.09		CIO 116 no. 3. Input 20-Gearbox Oil Tank Level Low		X	X	X	X
837.1		CIO 116 no. 3. Input 21-Gearbox Oil Tank Heater Fault		X	X	X	X
837.11		CIO 116 no. 3. Input 22-Engine Oil Pan Heater Fault		X	X	X	X
837.12		CIO 116 no. 3. Input 23-VPS2 Fault		X	X	X	X
837.13		CIO 116 no. 3. Input 24-VPS2 Operation		X	X	X	X
837.14		CIO 116 no. 3. Input 25-V2CPI US Signal		X	X	X	X
837.15		CIO 116 no. 3. Input 26-V2CPI DS Signal		X	X	X	X
838		Not used:838-839					
840		PID 1 reference		X			
841		PID 1 actual		X			
842		PID 1 output		X			
843		PID 1 P		X			

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
844		PID 1 I		X			
845		PID 1 D		X			
846		PID 2 reference		X			
847		PID 2 actual		X			
848		PID 2 output		X			
849		PID 2 P		X			
850		PID 2 I		X			
851		PID 2 D		X			
852		PID 3 reference		X			
853		PID 3 actual		X			
854		PID 3 output		X			
855		PID 3 P		X			
856		PID 3 I		X			
857		PID 3 D		X			
858		PID 4 reference		X			
859		PID 4 actual		X			
860		PID 4 output		X			
862		PID 4 I		X			
863		PID 4 D		X			
864		Not used: 864-867					
900		Engine J1939 data, 900-988, see Function code 4 (EIC)					

5.1.6 Function Code 4 (04h): Read Input Registers (Address, Bit: 1000-1003)

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1000	1000	Gen. -P> 1		X			
1000	1000	Group -P> 1			X		

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1000	1000	Mains -P> 1					X
1000	1000	Plant -P> 1				X	
1000.01	1010	Gen. -P> 2		X			
1000.01	1010	Group -P> 2			X		
1000.01	1010	Mains -P> 2					X
1000.01	1010	Plant -P> 2				X	
1000.02		Not used					
1000.03	1030	Gen. I> 1		X			
1000.03	1030	Group I> 1			X		
1000.03	1030	Mains I> 1					X
1000.03	1030	Plant I> 1				X	
1000.04	1040	Gen. I> 2		X			
1000.04	1040	Group I> 2			X		
1000.04	1040	Mains I> 2					X
1000.04	1040	Plant I> 2				X	
1000.05	1050	Gen. I> 3		X			
1000.05	1050	Group I> 3			X		
1000.05	1050	Mains I> 3					X
1000.05	1050	Plant I> 3				X	
1000.06	1060	Gen. I> 4		X			
1000.06	1060	Group I> 4			X		
1000.06	1060	Mains I> 4					X
1000.06	1060	Plant I> 4				X	
1000.07	1090	Gen. I> inv.		X			
1000.07	1090	Group I> inv.			X		
1000.07	1090	Mains I> inv.					X
1000.07	1090	Plant I> inv.				X	
1000.08	1110	Gen. Iv>		X			
1000.08	1110	Group busbar Iv>			X		
1000.08	1110	Mains Iv>				X	X
1000.09	1130	Gen. I>> 1		X			
1000.09	1130	Group I>> 1			X		
1000.09	1130	Mains I>> 1					X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1000.09	1130	Plant I>> 1				X	
1000.1	1140	Gen I>> 2		X			
1000.1	1140	Group I>> 2			X		
1000.1	1140	Mains I>> 2					X
1000.1	1140	Plant I>> 2				X	
1000.11	1150	Gen. U> 1		X			
1000.11	1150	Group BB U> 1			X		
1000.11	1150	Mains U> 1				X	X
1000.12	1160	Gen. U> 2		X			
1000.12	1160	Group BB U> 2			X		
1000.12	1160	Mains U> 2				X	X
1000.13	1170	Gen. U< 1		X			
1000.13	1170	Group BB U< 1			X		
1000.13	1170	Mains U< 1				X	X
1000.14	1180	Gen. U< 2		X			
1000.14	1180	Group BB U< 2			X		
1000.14	1180	Mains U< 2				X	X
1000.15	1190	Gen. U< 3		X			
1000.15	1190	Group BB U< 3			X		
1001	1210	Gen. f> 1		X			
1001	1210	Group BB f> 1			X		
1001	1210	Mains f> 1				X	X
1001.01	1220	Gen. f> 2		X			
1001.01	1220	Group BB f> 2			X		
1001.01	1220	Mains f> 2				X	X
1001.02	1230	Gen. f> 3		X			
1001.02	1230	Group BB f> 3			X		
1001.02	1230	Mains f> 3				X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1001.03	1240	Gen. f< 1		X			
1001.03	1240	Group BB f< 1			X		
1001.03	1240	Mains f< 1				X	X
1001.04	1250	Gen. f< 2		X			
1001.04	1250	Group BB f< 2			X		
1001.04	1250	Mains f< 2				X	X
1001.05	1260	Gen. f< 3		X			
1001.05	1260	Group BB f< 3			X		
1001.05	1260	Mains f< 3				X	X
1001.06	1270	BB U> 1					X
1001.06	1270	Gen. BB U> 1		X	X		
1001.06	1270	Group BB U> 1				X	
1001.07	1280	BB U> 2					X
1001.07	1280	Gen. BB U> 2		X	X		
1001.07	1280	Group BB U> 2				X	
1001.08	1290	BB U> 3					X
1001.08	1290	Gen. BB U> 3		X	X		
1001.08	1290	Group BB U> 3				X	
1001.09	1300	BB U< 1					X
1001.09	1300	Gen. BB U< 1		X	X		
1001.09	1300	Group BB U< 1				X	
1001.1	1310	BB U< 2					X
1001.1	1310	Gen. BB U< 2		X	X		
1001.1	1310	Group BB U< 2				X	
1001.11	1320	BB U< 3					X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1001.11	1320	Gen. BB U< 3		X	X		
1001.11	1320	Group BB U< 3				X	
1001.12	1330	BB U< 4					X
1001.12	1330	Gen. BB U< 4		X	X		
1001.12	1330	Group BB U< 4				X	
1001.13	1350	BB f> 1					X
1001.13	1350	Gen. BB f> 1		X	X		
1001.13	1350	Group BB f> 1				X	
1001.14	1360	BB f> 2					X
1001.14	1360	Gen. BB f> 2		X	X		
1001.14	1360	Group BB f> 2				X	
1001.15	1370	BB f> 3					X
1001.15	1370	Gen. BB f> 3		X	X		
1001.15	1370	Group BB f> 3				X	
1002	1380	BB f< 1					X
1002	1380	Gen. BB f< 1		X	X		
1002	1380	Group BB f< 1				X	
1002.01	1390	BB f< 2					X
1002.01	1390	Gen. BB f< 2		X	X		
1002.01	1390	Group BB f< 2				X	
1002.02	1400	BB f< 3					X
1002.02	1400	Gen. BB f< 3		X	X		
1002.02	1400	Group BB f< 3				X	
1002.03	1410	BB f< 4					X
1002.03	1410	Gen. BB f< 4		X	X		
1002.03	1410	Group BB f< 4				X	

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1002.04	1420	df/dt (ROCOF)		X	X	X	X
1002.05	1430	Vector jump		X	X	X	X
1002.06	1440	BB pos. seq. volt. low		X	X	X	X
1002.07	1450	Gen. P> 1		X			
1002.07	1450	M P> 1			X	X	
1002.07	1450	Mains P> 1					X
1002.08	1460	Gen. P> 2		X			
1002.08	1460	M P> 2			X	X	
1002.08	1460	Mains P> 2					X
1002.09	1470	Gen. P> 3		X			
1002.09	1470	M P> 3			X	X	
1002.09	1470	Mains P> 3					X
1002.1	1480	Gen. P> 4		X			
1002.1	1480	M P> 4			X	X	
1002.1	1480	Mains P> 4					X
1002.11	1490	Gen. P> 5		X			
1002.11	1490	M P> 5			X	X	
1002.11	1490	Mains P> 5					X
1002.12	1500	Unbalance curr. 1		X	X	X	X
1002.13	1510	Unbalance volt.		X	X	X	X
1002.14	1520	Gen. -Q>		X			
1002.14	1520	M -Q>			X	X	
1002.14	1520	Mains -Q>					X
1002.15	1530	Gen. Q>		X			
1002.15	1530	M Q>			X	X	
1002.15	1530	Mains Q>					X
1003	1540	Gen. neg. seq. I		X			
1003	1540	Group BB neg. seq. I			X		
1003	1540	Mains neg. seq. I				X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1003.01	1550	Generator neg. seq. U		X			
1003.01	1550	Group BB neg. seq. U			X		
1003.01	1550	Mains neg. seq. U				X	X
1003.02	1570	Gen. zero seq. I		X			
1003.02	1570	Group BB zero seq. I			X		
1003.02	1570	Mains zero seq. I				X	X
1003.03	1580	Group BB zero seq. U			X		
1003.03	1580	Mains zero seq. U				X	X
1003.03	1580	Zero seq. U		X			
1003.04	1600	Directional overcurrent 1		X	X	X	X
1003.05	1610	Directional overcurrent 2		X	X	X	X
1003.06	1620	BB unbalance U					X
1003.06	1620	Gen. BB unbalance U		X			
1003.06	1620	Group BB unbalance U			X	X	
1003.07		Not used					
1003.08		Not used					
1003.09		Not used					
1003.1		Not used					
1003.11		Not used					
1003.12		Not used					
1003.13		Not used					
1003.14		Not used					
1003.15		Not used					

5.1.7 Function Code 4 (04h): Read Input Registers (Address, Bit: 1004-1010)

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1004		Not used					
1004.01		Not used					
1004.02		Not used					
1004.03		Not used					
1004.04		Not used					
1004.05		Not used					
1004.06	1960	U and Q< 1		X	X	X	X
1004.07	1970	U and Q< 2		X	X	X	X
1004.08	1981	GB ext. trip		X			
1004.08	1981	TB ext. Trip			X		X
1004.09	1983	MB ext. trip		X			
1004.09	1983	MB ext. Trip				X	
1004.09	1983	MB ext. trip					X
1004.1	1650	Ut< 1 monitoring active		X	X	X	X
1004.11	1660	Ut< 1		X	X	X	X
1004.12	1690	Ut< 2 monitoring active		X	X	X	X
1004.13	1700	Ut< 2		X	X	X	X
1004.14	1760	Gen. P dep. Q<		X			
1004.14	1760	Group BB P dep. Q<			X		
1004.14	1760	Mains P dep. Q<				X	X
1004.15	1790	Gen. P dep. Q>		X			
1004.15	1790	Group BB P dep. Q>			X		
1004.15	1790	Mains P dep. Q>				X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1005	2120	Synchronizing window		X	X	X	X
1005.01	2130	Synchronizing failure GB		X			
1005.01	2130	Synchronizing failure TB			X		X
1005.02	2140	Synchronizing failure MB		X		X	X
1005.03	2150	Phase seq. failure A		X	X	X	X
1005.04	2160	GB open failure		X			
1005.04	2160	TB open failure			X		X
1005.05	2170	GB close failure		X			
1005.05	2170	TB close failure			X		X
1005.06	2180	GB pos. failure		X			
1005.06		Not used					
1005.06	2180	TB pos. failure			X		X
1005.07	2200	MB open failure		X		X	X
1005.07		Not used					
1005.08	2210	MB close failure		X		X	X
1005.08		Not used					
1005.09	2220	MB pos. failure		X		X	X
1005.09		Not used					
1005.1	2270	Close before excitation failure		X			
1005.1		Not used					
1005.11		Not used					
1005.11	2155	Phase seq. failure B		X	X	X	X
1005.12		Not used					

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1005.12		Not used					
1005.13		Not used					
1005.13		Not used					
1005.14		Not used					
1005.14		Not used					
1005.15		Not used					
1005.15		Not used					
1006	2560	GOVERNOR regulation fail.		X			
1006.01	2630	Deload error		X			
1006.02	2680	AVR regulation fail.		X			
1006.03		Not used					
1006.04		Not used					
1006.05		Not used					
1007	3000	Digital alarm input 23- Local Emergency Stop (NO)		X	X	X	X
1007.01	3010	Digital alarm input 24-		X	X	X	X
		Utility Circuit Breaker Tripped (NO) (OPEN)					
1007.02	3020	Digital alarm input 25- Utility Circuit Breaker Position (A) (NO) (CLOSED)		X	X	X	X
1007.03	3030	Digital alarm input 26- Genset Circuit Breaker Tripped (NO) (OPEN)		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1007.04	3040	Digital alarm input 27- Genset Circuit Breaker Position (A) (NO) (CLOSED)		X	X	X	X
1007.05		Not used					
1007.06	3060	Digital alarm input 29		X	X	X	X
1007.07	3070	Digital alarm input 30		X	X	X	X
1007.08	3080	Digital alarm input 31		X	X	X	X
1007.09	3090	Digital alarm input 32		X	X	X	X
1007.1	3100	Digital alarm input 33		X	X	X	X
1007.11	3110	Digital alarm input 34		X	X	X	X
1007.12	3120	Digital alarm input 35		X	X	X	X
1007.13		Not used					
1007.14		Not used					
1007.15		Not used					
1008	3130	Digital alarm input 43- Oil Slow Flow Meter		X	X	X	X
1008.01	3140	Digital alarm input 44- Fault Reset (NO)		X	X	X	X
1008.02	3150	Digital alarm input 45- Customer Input/Fault No 1 Warning (NO)		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1008.03	3160	Digital alarm input 46- Customer Input/Fault No 2 Shutdown (NO)		X	X	X	X
1008.05	3180	Digital alarm input 48- Customer Input/Fault No 4 Earth Fault (NO)		X	X	X	X
1008.06	3190	Digital alarm input 49- Customer Input/Fault No 5 Differential Fault (NC)		X	X	X	X
1008.07	3200	Digital alarm input 50- Customer Input/Fault No 6 (Configurable) (NO)		X	X	X	X
1008.08	3210	Digital alarm input 51- Customer Input/Fault No 7 (Configurable) (NO)		X	X	X	X
1008.09	3220	Digital alarm input 52		X	X	X	X
1008.1	3230	Digital alarm input 53		X	X	X	X
1008.11	3240	Digital alarm input 54		X	X	X	X
1008.12	3250	Digital alarm input 55- Fire Protection Trip Shutdown (Open to Trip) (NC)		X	X	X	X
1008.13		Not used					

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1008.14	3170	Digital alarm input 47- Customer Input/Fault No 3 Controlled Shutdown (NO)		X	X	X	X
1008.14		Not used					
1008.15		Not used					
1009	3260	Digital alarm input 65		X	X	X	X
1009.01	3270	Digital alarm input 66		X	X	X	X
1009.02	3280	Digital alarm input 67		X	X	X	X
1009.03	3290	Digital alarm input 68		X	X	X	X
1009.04	3300	Digital alarm input 69		X	X	X	X
1009.05	3310	Digital alarm input 70		X	X	X	X
1009.06	3320	Digital alarm input 71		X	X	X	X
1009.07	3330	Digital alarm input 91		X	X	X	X
1009.08	3340	Digital alarm input 92		X	X	X	X
1009.09	3350	Digital alarm input 93		X	X	X	X
1009.1	3360	Digital alarm input 94		X	X	X	X
1009.11	3370	Digital alarm input 95		X	X	X	X
1009.12	3380	Digital alarm input 96		X	X	X	X
1009.13	3390	Digital alarm input 97		X	X	X	X
1009.14		Not used					
1009.15		Not used					

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1010	3400	Multi-in. Alarm 102- Alternator Bearing DE		X	X		
1010	3400	Multi-in. Alarm 102- Alternator Bearing DE					X
1010	3400	Wire fail. 102- Alternator Bearing DE				X	
1010.01	3410	Multi-in. Alarm 105- Alternator Bearing NDE		X	X		
1010.01	3410	Multi-in. Alarm 105- Alternator Bearing NDE					X
1010.01	3410	Wire fail. 105- Alternator Bearing NDE				X	
1010.02	3420	Multi-in. Alarm 108		X	X		
1010.02	3420	Multi-in. Alarm 108					X
1010.02	3420	Wire fail. 108				X	
1010.03	3401	Wire fail. 102- Alternator Bearing DE		X	X	X	X
1010.04	3411	Wire fail. 105- Alternator Bearing NDE		X	X	X	X
1010.05	3421	Wire fail. 108		X	X	X	X
1010.06	3430	Digital alarm input 112- Utility Circuit Breaker Close (To) Inhibit (NO)		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1010.07	3440	Digital alarm input 113- Genset Circuit Breaker Close (To) Inhibit (NO)		X	X	X	X
1010.08	3450	Digital alarm input 114- Derate Authorization (NO)		X	X	X	X
1010.09	3460	Digital alarm input 115- Remote Start (NO)		X	X	X	X
1010.1	3470	Digital alarm input 116- Alt voltage sensing OK (NC)		X	X	X	X
1010.11	3480	Digital alarm input 117- Start system trip warning (NC)		X	X	X	X
1010.12	3490	Digital alarm input 118- Emergency stop		X	X	X	X
1010.13		Not used					
1010.14		Not used					
1010.15		Not used					
1010.15		Stop coil relay		X			

5.1.8 Function Code 4 (04h): Read Input Registers (Address, Bit: 1011-1017)

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1011	3500	Digital alarm input 127		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1011.01	3510	Digital alarm input 128		X	X	X	X
1011.02	3520	Digital alarm input 129		X	X	X	X
1011.03	3530	Digital alarm input 130		X	X	X	X
1011.04	3540	Digital alarm input 131		X	X	X	X
1011.05	3550	Digital alarm input 132		X	X	X	X
1011.06	3560	Digital alarm input 133		X	X	X	X
1011.07	3570	M-Logic alarm 1		X	X	X	X
1011.08	3580	M-Logic alarm 2		X	X	X	X
1011.09	3590	M-Logic alarm 3		X	X	X	X
1011.1	3600	M-Logic alarm 4		X	X	X	X
1011.11	3610	M-Logic alarm 5		X	X	X	X
1011.12		Not used					
1011.13		Not used					
1011.14		Not used					
1011.15		Not used					
1012	4000	Analogue input 91.1		X	X	X	X
1012.01	4010	Analogue input 91.2		X	X	X	X
1012.02	4020	Wire failure analogue 91		X	X	X	X
1012.03	4030	Analogue input 93.1		X	X	X	X
1012.04	4040	Analogue input 93.2		X	X	X	X
1012.05	4050	Wire failure analogue 93		X	X	X	X
1012.06	4060	Analogue input 95.1		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1012.07	4070	Analogue input 95.2		X	X	X	X
1012.08	4080	Wire failure analogue 95		X	X	X	X
1012.09	4090	Analogue input 97.1		X	X	X	X
1012.1	4100	Analogue input 97.2		X	X	X	X
1012.11	4110	Wire failure analogue 97		X	X	X	X
1012.12		Not used					
1012.13		Not used					
1012.14		Not used					
1012.15		Not used					
1013	4120	Multi input terminal 102.1		X	X	X	X
1013	4160	Multi input terminal 102.1		X	X	X	X
1013	4180	Multi input terminal 102.1		X	X	X	X
1013	4200	Multi input terminal 102.1		X	X	X	X
1013	4220	Multi input terminal 102.1		X	X	X	X
1013.01	4130	Multi input terminal 102.2		X	X	X	X
1013.01	4170	Multi input terminal 102.2		X	X	X	X
1013.01	4190	Multi input terminal 102.2		X	X	X	X
1013.01	4210	Multi input terminal 102.2		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1013.01	4230	Multi input terminal 102.2		X	X	X	X
1013.02	4240	W. fail. 102		X	X	X	X
1013.03	4250	Multi input terminal 105.1		X	X	X	X
1013.03	4290	Multi input terminal 105.1		X	X	X	X
1013.03	4310	Multi input terminal 105.1		X	X	X	X
1013.03	4330	Multi input terminal 105.1		X	X	X	X
1013.03	4350	Multi input terminal 105.1		X	X	X	X
1013.04	4260	Multi input terminal 105.2		X	X	X	X
1013.04	4300	Multi input terminal 105.2		X	X	X	X
1013.04	4320	Multi input terminal 105.2		X	X	X	X
1013.04	4340	Multi input terminal 105.2		X	X	X	X
1013.04	4360	Multi input terminal 105.2		X	X	X	X
1013.05	4370	W. fail. 105		X	X	X	X
1013.06	4380	Multi input terminal 108.1		X	X	X	X
1013.06	4420	Multi input terminal 108.1					
1013.06	4440	Multi input terminal 108.1					

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1013.06	4460	Multi input terminal 108.1					
1013.06	4480	Multi input terminal 108.1					
1013.07	4390	Multi input terminal 108.2		X	X	X	X
1013.07	4430	Multi input terminal 108.2					
1013.07	4450	Multi input terminal 108.2					
1013.07	4470	Multi input terminal 108.2					
1013.07	4490	Multi input terminal 108.2					
1013.08	4500	W. fail. 108		X	X	X	X
1013.09	4510	Overspeed 1		X			
1013.1	4520	Overspeed 2		X			
1013.11	4530	Crank failure		X			
1013.12	4540	Running feedback failure		X			
1013.13	4550	MPU wire failure		X			
1013.14	4560	Hz/V failure		X			
1013.15	4570	Start failure		X			
1014	4580	Stop failure		X			
1014.01	4960	U< aux. term. 1		X			
1014.02	4970	U> aux. term. 1		X			
1014.03	4980	U< aux. term. 98		X			
1014.04	4990	U> aux. term. 98		X			

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1014.05	4590	Underspeed 1		X			
1014.06		Not used					
1014.07		Not used					
1014.08		Not used					
1014.09		Not used					
1014.1		Not used					
1014.11		Not used					
1014.12		Not used					
1014.13		Not used					
1014.14		Not used					
1014.15		Not used					
1015	6110	Service timer 1		X			
1015.01	6120	Service timer 2		X			
1015.02	6270	Stop coil wire break		X			
1015.03	6280	Internal communication failure		X	X	X	X
1015.04	6270	Standby heat 1 alarm		X			
1015.05		Not used					
1015.07		Not used					
1015.08		Not used					
1015.09		Not used					
1015.1		Not used					
1015.11		Not used					
1015.12	6540	Unit not in auto		X	X	X	X
1015.13	6940	Fuel pump logic		X	X	X	X
1015.14	6290	Standby heat 2 alarm		X			
1015.15		Not used					
1015.16		Not used					

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1016	5000	Relay 5		X	X	X	X
1016.01	5010	Relay 8		X	X	X	X
1016.02	5020	Relay 11		X	X	X	X
1016.03	5030	Relay 14		X	X	X	X
1016.04	5040	Relay 17		X	X	X	X
1016.05	5050	Relay T20		X	X	X	X
1016.06	5060	Relay T21		X	X	X	X
1016.07	5070	Relay 29		X	X	X	X
1016.08	5080	Relay 31		X	X	X	X
1016.09	5090	Relay 33		X	X	X	X
1016.1	5100	Relay 35		X	X	X	X
1016.11	5110	Relay 57		X	X	X	X
1016.12	5120	Relay 59		X	X	X	X
1016.13	5130	Relay 61		X	X	X	X
1016.14	5140	Relay 63		X	X	X	X
1016.15		Not used					
1017	5150	Relay 65		X	X	X	X
1017.01	5160	Relay 67		X	X	X	X
1017.02	5170	Relay 69		X	X	X	X
1017.03	5180	Relay 71		X	X	X	X
1017.04	5190	Relay 90		X	X	X	X
1017.05	5200	Relay 92		X	X	X	X
1017.06	5210	Relay 94		X	X	X	X
1017.07	5220	Relay 96		X	X	X	X
1017.08	5230	Relay 126		X	X	X	X
1017.09	5240	Relay 128		X	X	X	X
1017.1	5250	Relay 130		X	X	X	X
1017.11	5260	Relay 132		X	X	X	X
1017.12		Run. coil relay		X			
1017.13		Start prepare		X			
1017.14		Start relay		X			

5.1.9 Function Code 4 (04h): Read Input Registers (Address, Bit: 1018-1040)

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1018		Mains failure				X	X
1018		Mains failure (stand-alone)		X			
1018.01		MB position ON				X	X
1018.01		MB position ON (stand-alone)		X			
1018.02		DG ramp down		X			
1018.03		Start GOV/AVR regulation		X			
1018.04		GB position ON		X			
1018.04		TB position ON			X		X
1018.05		GB synchronizing		X			
1018.05		TB synchronizing			X		X
1018.06		Engine running		X			
1018.07	6173	Running detected, timer expired		X			
1018.08	6220	DG Hz/V OK, timer expired		X			
1018.09		Not used					
1018.1		Not used					
1018.11		GB position OFF		X			
1018.11		TB position OFF			X		X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1018.12		MB position OFF				X	X
1018.12		MB position OFF (stand-alone)		X			
1018.13		BB Hz/V OK		X			
1018.13		BB Hz/V OK				X	X
1018.13		Generator BB Hz/V OK			X		
1018.14		MB synchronizing (stand-alone)		X			
1018.14		Single DG, MB synchronising				X	X
1018.15		Dry mode		X			
1019		Block mode		X			
1019.01		Manual mode		X			
1019.02		Semi auto mode		X	X	X	X
1019.03		Auto mode		X	X	X	X
1019.04		Test		X	X	X	X
1019.05		Island		X	X	X	X
1019.06		AMF		X	X	X	X
1019.07		Peak shaving		X	X	X	X
1019.08		Fixed power		X	X	X	X
1019.09		Mains power export		X	X	X	X
1019.1		Load takeover		X	X	X	X
1019.11		Genset Group			X		
1019.11		Power management		X			
1019.12		Not used					
1019.13		Not used					

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1019.15		AMF active				X	X
1019.15		AMF active (stand-alone)		X			
1019.4		Not used					
1020		Engine J1939 data, 1020-1029, see Function code 4 (EIC)		X			
1030		CIO 208 no. 3. Out-		X	X	X	X
		put 9					
1030.01		CIO 208 no. 3. Out-		X	X	X	X
		put 11					
1030.02		CIO 208 no. 3. Out-		X	X	X	X
		put 13					
1030.03		CIO 208 no. 3. Out-		X	X	X	X
		put 15					
1030.04		CIO 208 no. 3. Out-		X	X	X	X
		put 18					
1030.05		CIO 208 no. 3. Out-		X	X	X	X
		put 21					
1030.06		CIO 208 no. 3. Out-		X	X	X	X
		put 24					
1030.07		CIO 208 no. 3. Out-		X	X	X	X
		put 27					
1030.08		Not used					
1030.09		Not used					
1030.1		Not used					
1030.11		Not used					
1030.12		Not used					

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1030.13		Not used					
1030.14		Not used					
1030.15		Not used					
1031		Not used: 1031-1032					
1033		Reserved		X	X	X	X
1033.01		Reserved		X	X	X	X
1033.02	7520	Ext . communicati on error		X	X	X	X
1033.03		Not used					
1033.04		Not used					
1033.05		Not used					
1033.06		Not used					
1033.07		Not used					
1033.08		Not used					
1033.09		Not used					
1033.1		Not used					
1033.11		Not used					
1033.12		Not used					
1033.13		Not used					
1033.14		Not used					
1033.15		Not used					
1034		Reserved		X	X	X	X
1034.01		Ext. Modbus comm. error on CAN ID 1		X	X	X	X
1034.02		Ext. Modbus comm. error on CAN ID 2		X	X	X	X
1034.03		Ext. Modbus comm. error on CAN ID 3		X	X	X	X
1034.04		Ext. Modbus comm. error on CAN ID 4		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1034.05		Ext. Modbus comm. error on CAN ID 5		X	X	X	X
1034.06		Ext. Modbus comm. error on CAN ID 6		X	X	X	X
1034.07		Ext. Modbus comm. error on CAN ID 7		X	X	X	X
1034.08		Ext. Modbus comm. error on CAN ID 8		X	X	X	X
1034.09		Ext. Modbus comm. error on CAN ID 9		X	X	X	X
1034.1		Ext. Modbus comm. error on CAN ID 10		X	X	X	X
1034.11		Ext. Modbus comm. error on CAN ID 11		X	X	X	X
1034.12		Ext. Modbus comm. error on CAN ID 12		X	X	X	X
1034.13		Ext. Modbus comm. error on CAN ID 13		X	X	X	X
1034.14		Ext. Modbus comm. error on CAN ID 14		X	X	X	X
1034.15		Ext. Modbus comm. error on CAN ID 15		X	X	X	X
1035		Ext. Modbus comm. error on CAN ID 16		X	X	X	X
1035.01		Not used					
1035.02		Not used					

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1035.03		Not used					
1035.04		Not used					
1035.06		Not used					
1035.07		Not used					
1035.08		Not used					
1035.09		Not used					
1035.1		Not used					
1035.11		Not used					
1035.12		Not used					
1035.13		Not used					
1035.14		Not used					
1035.15		Not used					
1036	12000	Ext. Analogue in. 1.1		X	X	X	X
1036.01	12010	Ext. Analogue in. 1.2		X	X	X	X
1036.02		Not used					
1036.04	12040	Ext. Analogue in. 2.2		X	X	X	X
1036.05		Not used					
1036.06	12060	Ext. Analogue in. 3.1		X	X	X	X
1036.07	12070	Ext. Analogue in. 3.2		X	X	X	X
1036.08		Not used					
1036.09	12090	Ext. Analogue in. 4.1		X	X	X	X
1036.1	12100	Ext. Analogue in. 4.2		X	X	X	X
1036.11		Not used					

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1036.12	12120	Ext. Analogue in. 5.1		X	X	X	X
1036.13	12030	Ext. Analogue in. 2.1		X	X	X	X
1036.13	12130	Ext. Analogue in. 5.2		X	X	X	X
1036.14		Not used					
1036.15	12150	Ext. Analogue in. 6.1		X	X	X	X
1037	12160	Ext. Analogue in. 6.2		X	X	X	X
1037.01		Not used					
1037.02	12180	Ext. Analogue in. 7.1		X	X	X	X
1037.03	12190	Ext. Analogue in. 7.2		X	X	X	X
1037.04		Not used					
1037.05	12210	Ext. Analogue in. 8.1		X	X	X	X
1037.06	12220	Ext. Analogue in. 8.2		X	X	X	X
1037.07		Not used					
1037.08		Not used					
1037.09		Not used					
1037.1		Not used					
1037.11		Not used					
1037.12		Not used					
1037.13		Not used					
1037.14		Not used					
1037.15		Not used					
1038	12540	External digital input 1		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1038.01	12550	External digital input 2		X	X	X	X
1038.02	12560	External digital input 3		X	X	X	X
1038.03	12570	External digital input 4		X	X	X	X
1038.04	12580	External digital input 5		X	X	X	X
1038.05	12590	External digital input 6		X	X	X	X
1038.06	12600	External digital input 7		X	X	X	X
1038.07	12610	External digital input 8		X	X	X	X
1038.08	12620	External digital input 9		X	X	X	X
1038.09	12630	External digital input 10		X	X	X	X
1038.1	12640	External digital input 11		X	X	X	X
1038.11	12650	External digital input 12		X	X	X	X
1038.12	12660	External digital input 13		X	X	X	X
1038.13	12670	External digital input 14		X	X	X	X
1038.14	12680	External digital input 15		X	X	X	X
1038.15	12690	External digital input 16		X	X	X	X
1039	12790	External digital output 1		X	X	X	X
1039.01	12800	External digital output 2		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1039.02	12810	External digital output 3		X	X	X	X
1039.03	12820	External digital output 4		X	X	X	X
1039.04	12830	External digital output 5		X	X	X	X
1039.05	12840	External digital output 6		X	X	X	X
1039.06	12850	External digital output 7		X	X	X	X
1039.07	12860	External digital output 8		X	X	X	X
1039.08	12870	External digital output 9		X	X	X	X
1039.09	12880	External digital output 10		X	X	X	X
1039.1	12890	External digital output 11		X	X	X	X
1039.11	12900	External digital output 12		X	X	X	X
1039.12	12910	External digital output 13		X	X	X	X
1039.13	12920	External digital output 14		X	X	X	X
1039.14	12930	External digital output 15		X	X	X	X
1039.15	12940	External digital output 16		X	X	X	X
1040		CAN Pri. missing ID 1		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1040.01		CAN Pri. missing ID 2		X	X	X	X
1040.02		CAN Pri. missing ID 3		X	X	X	X
1040.03		CAN Pri. missing ID 4		X	X	X	X
1040.04		CAN Pri. missing ID 5		X	X	X	X
1040.05		CAN Pri. missing ID 6		X	X	X	X
1040.06		CAN Pri. missing ID 7		X	X	X	X
1040.07		CAN Pri. missing ID 8		X	X	X	X
1040.08		CAN Pri. missing ID 9		X	X	X	X
1040.09		CAN Pri. missing ID 10		X	X	X	X
1040.1		CAN Pri. missing ID 11		X	X	X	X
1040.11		CAN Pri. missing ID 12		X	X	X	X
1040.12		CAN Pri. missing ID 13		X	X	X	X
1040.13		CAN Pri. missing ID 14		X	X	X	X
1040.14		CAN Pri. missing ID 15		X	X	X	X
1040.15		CAN Pri. missing ID 16		X	X	X	X

5.1.10 Function Code 4 (04h): Read Input Registers (Address, Bit: 1041-1054)

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1041		CAN Pri. missing ID 17		X	X	X	X
1041.01		CAN Pri. missing ID 18		X	X	X	X
1041.02		CAN Pri. missing ID 19		X	X	X	X
1041.03		CAN Pri. missing ID 20		X	X	X	X
1041.04		CAN Pri. missing ID 21		X	X	X	X
1041.05		CAN Pri. missing ID 22		X	X	X	X
1041.06		CAN Pri. missing ID 23		X	X	X	X
1041.07		CAN Pri. missing ID 24		X	X	X	X
1041.08		CAN Pri. missing ID 25		X	X	X	X
1041.09		CAN Pri. missing ID 26		X	X	X	X
1041.1		CAN Pri. missing ID 27		X	X	X	X
1041.11		CAN Pri. missing ID 28		X	X	X	X
1041.12		CAN Pri. missing ID 29		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1041.13		CAN Pri. missing ID 30		X	X	X	X
1041.14		CAN Pri. missing ID 31		X	X	X	X
1041.15		CAN Pri. missing ID 32		X	X	X	X
1042		CAN Pri. missing ID 33		X			X
1042.01		CAN Pri. missing ID 34		X			X
1042.02		CAN Pri. missing ID 35		X			X
1042.03		CAN Pri. missing ID 36		X			X
1042.04		CAN Pri. missing ID 37		X			X
1042.05		CAN Pri. missing ID 38		X			X
1042.06		CAN Pri. missing ID 39		X			X
1042.07		CAN Pri. missing ID 40		X			X
1042.08		Not used					
1042.09		Not used					
1042.1		Not used					
1042.11		Not used					
1042.12		Not used					
1042.13		Not used					
1042.14		Not used					
1042.15		Not used					

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1043		CAN Sec. missing ID 1		X	X	X	X
1043.01		CAN Sec. missing ID 2		X	X	X	X
1043.02		CAN Sec. missing ID 3		X	X	X	X
1043.03		CAN Sec. missing ID 4		X	X	X	X
1043.04		CAN Sec. missing ID 5		X	X	X	X
1043.05		CAN Sec. missing ID 6		X	X	X	X
1043.06		CAN Sec. missing ID 7		X	X	X	X
1043.07		CAN Sec. missing ID 8		X	X	X	X
1043.08		CAN Sec. missing ID 9		X	X	X	X
1043.09		CAN Sec. missing ID 10		X	X	X	X
1043.1		CAN Sec. missing ID 11		X	X	X	X
1043.11		CAN Sec. missing ID 12		X	X	X	X
1043.12		CAN Sec. missing ID 13		X	X	X	X
1043.13		CAN Sec. missing ID 14		X	X	X	X
1043.14		CAN Sec. missing ID 15		X	X	X	X
1043.15		CAN Sec. missing ID 16		X	X	X	X
1044		CAN Sec. missing ID 17		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1044.01		CAN Sec. missing ID 18		X	X	X	X
1044.02		CAN Sec. missing ID 19		X	X	X	X
1044.03		CAN Sec. missing ID 20		X	X	X	X
1044.04		CAN Sec. missing ID 21		X	X	X	X
1044.05		CAN Sec. missing ID 22		X	X	X	X
1044.06		CAN Sec. missing ID 23		X	X	X	X
1044.07		CAN Sec. missing ID 24		X	X	X	X
1044.08		CAN Sec. missing ID 25		X	X	X	X
1044.09		CAN Sec. missing ID 26		X	X	X	X
1044.1		CAN Sec. missing ID 27		X	X	X	X
1044.11		CAN Sec. missing ID 28		X	X	X	X
1044.12		CAN Sec. missing ID 29		X	X	X	X
1044.13		CAN Sec. missing ID 30		X	X	X	X
1044.14		CAN Sec. missing ID 31		X	X	X	X
1044.15		CAN Sec. missing ID 32		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1045		CAN Sec. missing ID 33			X		X
1045.01		CAN Sec. missing ID 34			X		X
1045.02		CAN Sec. missing ID 35			X		X
1045.03		CAN Sec. missing ID 36			X		X
1045.04		CAN Sec. missing ID 37			X		X
1045.05		CAN Sec. missing ID 38			X		X
1045.06		CAN Sec. missing ID 39			X		X
1045.07		CAN Sec. missing ID 40			X		X
1045.08		Not used					
1045.09		Not used					
1045.1		Not used					
1045.11		Not used					
1045.12		Not used					
1045.13		Not used					
1045.14		Not used					
1045.15		Not used					
1046	4800	Analogue input 127.1		X	X	X	X
1046.01	4810	Analogue input 127.2		X	X	X	X
1046.02	4820	Wire fail analogue input 127		X	X	X	X
1046.03	4830	Analogue input 129.1		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1046.04	4840	Analogue input 129.2		X	X	X	X
1046.05	4850	Wire fail analogue input 129		X	X	X	X
1046.06	4860	Analogue input 131.1		X	X	X	X
1046.07	4870	Analogue input 131.2		X	X	X	X
1046.08	4880	Wire fail analogue input 131		X	X	X	X
1046.09	4890	Analogue input 133.1		X	X	X	X
1046.1	4900	Analogue input 133.2		X	X	X	X
1046.11	4910	Wire fail analogue input 133		X	X	X	X
1046.12		Not used					
1046.13		Not used					
1046.14		Not used					
1046.15		Not used					
1047		Top level CAN missing ID 1			X	X	
1047.01		Top level CAN missing ID 2			X	X	
1047.02		Top level CAN missing ID 3			X	X	
1047.03		Top level CAN missing ID 4			X	X	
1047.04		Top level CAN missing ID 5			X	X	
1047.05		Top level CAN missing ID 6			X	X	

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1047.06		Top level CAN miss- ing ID 7			X	X	
1047.07		Top level CAN miss- ing ID 8			X	X	
1047.08		Top level CAN miss- ing ID 9			X	X	
1047.09		Top level CAN miss- ing ID 10			X	X	
1047.1		Top level CAN miss- ing ID 11			X	X	
1047.11		Top level CAN miss- ing ID 12			X	X	
1047.12		Top level CAN miss- ing ID 13			X	X	
1047.13		Top level CAN miss- ing ID 14			X	X	
1047.14		Top level CAN miss- ing ID 15			X	X	
1047.15		Top level CAN miss- ing ID 16			X	X	
1048		Top level CAN miss- ing ID 17			X	X	
1048.01		Top level CAN miss- ing ID 18			X	X	
1048.02		Top level CAN miss- ing ID 19			X	X	
1048.03		Top level CAN miss- ing ID 20			X	X	
1048.04		Top level CAN miss- ing ID 21			X	X	

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1048.05		Top level CAN missing ID 22			X	X	
1048.06		Top level CAN missing ID 23			X	X	
1048.07		Top level CAN missing ID 24			X	X	
1048.08		Top level CAN missing ID 25			X	X	
1048.09		Top level CAN missing ID 26			X	X	
1048.1		Top level CAN missing ID 27			X	X	
1048.11		Top level CAN missing ID 28			X	X	
1048.12		Top level CAN missing ID 29			X	X	
1048.13		Top level CAN missing ID 30			X	X	
1048.14		Top level CAN missing ID 31			X	X	
1048.15		Top level CAN missing ID 32			X	X	
1049		Not used					
1050		Ready to autostart		X			
1050.01		DG $U > 30\% \cdot U_{nominal}$		X			
1050.01		Group BB $U > 30\% \cdot U_{nominal}$			X		

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1050.01		Mains U>30%*U nominal				X	X
1050.02		BB U>30%*U nomi- nal		X			
1050.02		BB U>30%*U nomi- nal					X
1050.02		Generator BB U>30%*U nominal			X		
1050.02		Group BB U>30%*U nominal				X	
1050.03		Not used					
1050.04		Not used					
1050.05		Not used					
1050.06		Not used					
1050.07		Not used					
1050.08		Not used					
1050.09		Not used					
1050.1		Not used					
1050.11		Not used					
1050.12		Not used					
1050.13		Not used					
1050.14		Not used					
1050.15		Not used					
1051		Virtual events 1-16		X	X	X	X
1052		Virtual events 17-32		X	X	X	X
1053	6590	Fan A Failure		X			
1053.01	6600	Fan B Failure		X			
1053.02	6610	Fan C Failure		X			

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1053.03	6620	Fan D Failure		X			
1053.04	4610	Delta analogue 1 - fail 1		X	X	X	X
1053.05	4620	Delta analogue 1 - fail 2		X	X	X	X
1053.06	4630	Delta analogue 2 - fail 1		X	X	X	X
1053.07	4640	Delta analogue 2 - fail 2		X	X	X	X
1053.08	4650	Delta analogue 3 - fail 1		X	X	X	X
1053.09	4660	Delta analogue 3 - fail 2		X	X	X	X
1053.1	4680	Delta analogue 4 - fail 1		X	X	X	X
1053.11	4690	Delta analogue 4 - fail 2		X	X	X	X
1053.12	4700	Delta analogue 5 - fail 1		X	X	X	X
1053.13	4710	Delta analogue 5 - fail 2		X	X	X	X
1053.14	4720	Delta analogue 6 - fail 1		X	X	X	X
1053.15	4730	Delta analogue 6 - fail 2		X	X	X	X
1054		Not used					
1054.01		Not used					
1054.02		Not used					
1054.03	6202	External Engine Stop		X			

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1054.04	1710	Unbalance curr. 2		X	X	X	X
1054.05	7480	Avg U BB > 1		X	X	X	X
1054.06	7490	Avg U BB > 2		X	X	X	X
1054.07		Not used					
1054.08		Not used					
1054.09		Not used					
1054.1		Not used					
1054.11		Not used					
1054.12		Not used					
1054.13		Not used					
1054.14		Not used					
1054.15		Not used					

5.1.11 Function Code 4 (04h): Read Input Registers (Address, Bit: 1055-1650)

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1055		Not used					
1055.01		Not used					
1055.02		Not used					
1055.03		Not used					
1055.04	4750	Delta analogue 7 - fail 1		X	X	X	X
1055.05	4760	Delta analogue 7 - fail 2		X	X	X	X
1055.06	4770	Delta analogue 8 - fail 1		X	X	X	X
1055.07	4780	Delta analogue 8 - fail 2		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1055.08	4790	Delta analogue 9 - fail 1		X	X	X	X
1055.09	4800	Delta analogue 9 - fail 2		X	X	X	X
1055.1		Reserved		X	X	X	X
1055.11		Reserved		X	X	X	X
1055.12		Reserved		X	X	X	X
1055.13		Reserved		X	X	X	X
1055.14		Reserved		X	X	X	X
1055.15		Reserved		X	X	X	X
1056	7830	Digital AVR Communication Error		X			
1056.01	7761	Digital AVR Warning		X			
1056.02	7763	Digital AVR Trip		X			
1056.03		Not used					
1056.04		Not used					
1056.05		Not used					
1056.06		Not used					
1056.07		Not used					
1056.08		Not used					
1056.09		Not used					
1056.1		Not used					
1056.11		Not used					
1056.12		Not used					
1056.13		Not used					
1056.14		Not used					
1056.15		Not used					
1057		Alarm active: Block		X	X	X	X
1057.01		Alarm active: Warning		X	X	X	X
1057.02		Alarm active: Trip GB		X			

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1057.02		Alarm active: Trip TB			X	X	X
1057.03		Alarm active: Trip GB + stop		X			
1057.04		Alarm active: Shut- down		X			
1057.05		Alarm active: Trip MB			X	X	X
1057.05		Alarm active: Trip MB (stand-alone)		X			
1057.06		Alarm active: Safety stop		X			
1057.07		Alarm active: Trip MB/GB		X			
1057.07		Alarm active: Trip MB/TB			X	X	X
1057.08		Alarm active: Controlled stop (deload + cooldown)		X			
1057.09		Not used					
1057.1		Not used					
1057.11		Not used					
1057.12		Not used					
1057.13		Not used					
1057.14		Not used					
1057.15		Not used					
1058		Engine J1939 data, 1058-1075, see Function code 4 (EIC)					
1076		Average Voltage PhPh		X	X	X	X
1077		Average Voltage PhN		X	X	X	X
1078		Average Frequency		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1079		Average Current		X	X	X	X
1080		Engine J1939 data, 1080-1106, see Function code 4 (EIC)		X			
1500		Total active power in present section		X	X	X	X
1501		Total available power in present section		X	X	X	X
1502		Total nominal power in present section		X	X	X	X
1503		Total active DG power in present section		X	X		X
1504		Total reactive power in present section		X	X	X	X
1505		Number of gensets in application		X	X		X
1506		Plant type		X	X	X	X
1507		Load-dependent stop, active setpoint		X	X		
1508		Load-dependent start, active setpoint		X	X		
1509		Not used					
1510		Nominal power ID 1		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1511		Nominal power ID 2		X	X	X	X
1512		Nominal power ID 3		X	X	X	X
1513		Nominal power ID 4		X	X	X	X
1514		Nominal power ID 5		X	X	X	X
1515		Nominal power ID 6		X	X	X	X
1516		Nominal power ID 7		X	X	X	X
1517		Nominal power ID 8		X	X	X	X
1518		Nominal power ID 9		X	X	X	X
1519		Nominal power ID 10		X	X	X	X
1520		Nominal power ID 11		X	X	X	X
1521		Nominal power ID 12		X	X	X	X
1522		Nominal power ID 13		X	X	X	X
1523		Nominal power ID 14		X	X	X	X
1524		Nominal power ID 15		X	X	X	X
1525		Nominal power ID 16		X	X	X	X
1526		Active Power ID 1		X	X	X	X
1527		Active Power ID 2		X	X	X	X
1528		Active Power ID 3		X	X	X	X
1529		Active Power ID 4		X	X	X	X
1530		Active Power ID 5		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1531		Active Power ID 6		X	X	X	X
1532		Active Power ID 7		X	X	X	X
1533		Active Power ID 8		X	X	X	X
1534		Active Power ID 9		X	X	X	X
1535		Active Power ID 10		X	X	X	X
1536		Active Power ID 11		X	X	X	X
1537		Active Power ID 12		X	X	X	X
1538		Active Power ID 13		X	X	X	X
1539		Active Power ID 14		X	X	X	X
1540		Active Power ID 15		X	X	X	X
1541		Active Power ID 16		X	X	X	X
1542		Reactive Power ID 1		X	X	X	X
1543		Reactive Power ID 2		X	X	X	X
1544		Reactive Power ID 3		X	X	X	X
1545		Reactive Power ID 4		X	X	X	X
1546		Reactive Power ID 5		X	X	X	X
1547		Reactive Power ID 6		X	X	X	X
1548		Reactive Power ID 7		X	X	X	X
1549		Reactive Power ID 8		X	X	X	X
1550		Reactive Power ID 9		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1551		Reactive Power ID 10		X	X	X	X
1552		Reactive Power ID 11		X	X	X	X
1553		Reactive Power ID 12		X	X	X	X
1554		Reactive Power ID 13		X	X	X	X
1555		Reactive Power ID 14		X	X	X	X
1556		Reactive Power ID 15		X	X	X	X
1557		Reactive Power ID 16		X	X	X	X
1558		Not used: 1558-1568					
1569		Active Power ID 17		X	X	X	X
1570		Active Power ID 18		X	X	X	X
1571		Active Power ID 19		X	X	X	X
1572		Active Power ID 20		X	X	X	X
1573		Active Power ID 21		X	X	X	X
1574		Active Power ID 22		X	X	X	X
1575		Active Power ID 23		X	X	X	X
1576		Active Power ID 24		X	X	X	X
1577		Active Power ID 25		X	X	X	X
1578		Active Power ID 26		X	X	X	X
1579		Active Power ID 27		X	X	X	X
1580		Active Power ID 28		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1581		Active Power ID 29		X	X	X	X
1582		Active Power ID 30		X	X	X	X
1583		Active Power ID 31		X	X	X	X
1584		Active Power ID 32		X	X	X	X
1585		Reactive Power ID 17		X	X	X	X
1586		Reactive Power ID 18		X	X	X	X
1587		Reactive Power ID 19		X	X	X	X
1588		Reactive Power ID 20		X	X	X	X
1589		Reactive Power ID 21		X	X	X	X
1590		Reactive Power ID 22		X	X	X	X
1591		Reactive Power ID 23		X	X	X	X
1592		Reactive Power ID 24		X	X	X	X
1593		Reactive Power ID 25		X	X	X	X
1594		Reactive Power ID 26		X	X	X	X
1595		Reactive Power ID 27		X	X	X	X
1596		Reactive Power ID 28		X	X	X	X
1597		Reactive Power ID 29		X	X	X	X
1598		Reactive Power ID 30		X	X	X	X
1599		Reactive Power ID 31		X	X	X	X
1600		Reactive Power ID 32		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1601		Active Power ID 33		X			X
1602		Active Power ID 34		X			X
1603		Active Power ID 35		X			X
1604		Active Power ID 36		X			X
1605		Active Power ID 37		X			X
1606		Active Power ID 38		X			X
1607		Active Power ID 39		X			X
1608		Active Power ID 40		X			X
1609		Reactive Power ID 33		X			X
1610		Reactive Power ID 34		X			X
1611		Reactive Power ID 35		X			X
1612		Reactive Power ID 36		X			X
1613		Reactive Power ID 37		X			X
1614		Reactive Power ID 38		X			X
1615		Reactive Power ID 39		X			X
1616		Reactive Power ID 40		X			X
1617		Not used: 1617-1648					
1649		Mains transducer-configured, ID 17		X	X	X	X
1649.01		Mains transducer-configured, ID 18		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1649.02		Mains transducer-configured, ID 19		X	X	X	X
1649.03		Mains transducer-configured, ID 20		X	X	X	X
1649.04		Mains transducer-configured, ID 21		X	X	X	X
1649.05		Mains transducer-configured, ID 22		X	X	X	X
1649.06		Mains transducer-configured, ID 23		X	X	X	X
1649.07		Mains transducer-configured, ID 24		X	X	X	X
1649.08		Mains transducer-configured, ID 25		X	X	X	X
1649.09		Mains transducer-configured, ID 26		X	X	X	X
1649.1		Mains transducer-configured, ID 27		X	X	X	X
1649.11		Mains transducer-configured, ID 28		X	X	X	X
1649.12		Mains transducer-configured, ID 29		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1649.13		Mains transducer-configured, ID 30		X	X	X	X
1649.14		Mains transducer-configured, ID 31		X	X	X	X
1649.15		Mains transducer-configured, ID 32		X	X	X	X
1650		TB transducer-configured, ID 17		X	X	X	X
1650.01		TB transducer-configured, ID 18		X	X	X	X
1650.02		TB transducer-configured, ID 19		X	X	X	X
1650.03		TB transducer-configured, ID 20		X	X	X	X
1650.04		TB transducer-configured, ID 21		X	X	X	X
1650.05		TB transducer-configured, ID 22		X	X	X	X
1650.06		TB transducer-configured, ID 23		X	X	X	X
1650.07		TB transducer-configured, ID 24		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1650.08		TB transducer-configured, ID 25		X	X	X	X
1650.09		TB transducer-configured, ID 26		X	X	X	X
1650.1		TB transducer-configured, ID 27		X	X	X	X
1650.11		TB transducer-configured, ID 28		X	X	X	X
1650.12		TB transducer-configured, ID 29		X	X	X	X
1650.13		TB transducer-configured, ID 30		X	X	X	X
1650.14		TB transducer-configured, ID 31		X	X	X	X
1650.15		TB transducer-configured, ID 32		X	X	X	X

5.1.12 Function Code 4 (04h): Read Input Registers (Address, Bit: 1651-1714)

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1651		Not used: 1651-1652					
1653		Nominal power ID 17		X	X	X	X
1654		Nominal power ID 18		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1655		Nominal power ID 19		X	X	X	X
1656		Nominal power ID 20		X	X	X	X
1657		Nominal power ID 21		X	X	X	X
1658		Nominal power ID 22		X	X	X	X
1659		Nominal power ID 23		X	X	X	X
1660		Nominal power ID 24		X	X	X	X
1661		Nominal power ID 25		X	X	X	X
1662		Nominal power ID 26		X	X	X	X
1663		Nominal power ID 27		X	X	X	X
1664		Nominal power ID 28		X	X	X	X
1665		Nominal power ID 29		X	X	X	X
1666		Nominal power ID 30		X	X	X	X
1667		Nominal power ID 31		X	X	X	X
1668		Nominal power ID 32		X	X	X	X
1669		Not used					
1700		TB available			X		X
1700.01		Mains unit available		X			
1700.02		Any MB pos. ON		X	X	X	X
1700.03		All MB pos. OFF		X	X	X	X
1700.04		TB pos. ON (Mains Command Unit)		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1700.05		TB pos. OFF (Mains Command Unit)		X	X	X	X
1700.06		Any GB pos. ON		X	X		X
1700.07		All GB pos. OFF		X	X		X
1700.08		Any TB pos. ON		X	X	X	X
1700.09		All TB pos. OFF		X	X	X	X
1700.1		Any BTB pos. ON		X	X	X	X
1700.11		Any BTB pos. OFF		X	X	X	X
1700.12		Not used					
1700.13		Not used					
1700.14		Not used					
1700.15		Not used					
1701		GB pos. ON ID 1		X	X		X
1701.01		GB pos. ON ID 2		X	X		X
1701.02		GB pos. ON ID 3		X	X		X
1701.03		GB pos. ON ID 4		X	X		X
1701.04		GB pos. ON ID 5		X	X		X
1701.05		GB pos. ON ID 6		X	X		X
1701.06		GB pos. ON ID 7		X	X		X
1701.07		GB pos. ON ID 8		X	X		X
1701.08		GB pos. ON ID 9		X	X		X
1701.09		GB pos. ON ID 10		X	X		X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1701.1		GB pos. ON ID 11		X	X		X
1701.11		GB pos. ON ID 12		X	X		X
1701.12		GB pos. ON ID 13		X	X		X
1701.13		GB pos. ON ID 14		X	X		X
1701.14		GB pos. ON ID 15		X	X		X
1701.15		GB pos. ON ID 16		X	X		X
1702		GB pos. OFF ID 1		X	X		X
1702.01		GB pos. OFF ID 2		X	X		X
1702.02		GB pos. OFF ID 3		X	X		X
1702.03		GB pos. OFF ID 4		X	X		X
1702.04		GB pos. OFF ID 5		X	X		X
1702.05		GB pos. OFF ID 6		X	X		X
1702.06		GB pos. OFF ID 7		X	X		X
1702.07		GB pos. OFF ID 8		X	X		X
1702.08		GB pos. OFF ID 9		X	X		X
1702.09		GB pos. OFF ID 10		X	X		X
1702.1		GB pos. OFF ID 11		X	X		X
1702.11		GB pos. OFF ID 12		X	X		X
1702.12		GB pos. OFF ID 13		X	X		X
1702.13		GB pos. OFF ID 14		X	X		X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1702.14		GB pos. OFF ID 15		X	X		X
1702.15		GB pos. OFF ID 16		X	X		X
1703		DG Hz/V OK, ID 1		X	X		X
1703.01		DG Hz/V OK, ID 2		X	X		X
1703.02		DG Hz/V OK, ID 3		X	X		X
1703.03		DG Hz/V OK, ID 4		X	X		X
1703.04		DG Hz/V OK, ID 5		X	X		X
1703.05		DG Hz/V OK, ID 6		X	X		X
1703.06		DG Hz/V OK, ID 7		X	X		X
1703.07		DG Hz/V OK, ID 8		X	X		X
1703.08		DG Hz/V OK, ID 9		X	X		X
1703.09		DG Hz/V OK, ID 10		X	X		X
1703.1		DG Hz/V OK, ID 11		X	X		X
1703.11		DG Hz/V OK, ID 12		X	X		X
1703.12		DG Hz/V OK, ID 13		X	X		X
1703.13		DG Hz/V OK, ID 14		X	X		X
1703.14		DG Hz/V OK, ID 15		X	X		X
1703.15		DG Hz/V OK, ID 16		X	X		X
1704		Not used					
1705		Ready for auto start, ID 1		X	X		X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1705.01		Ready for auto start, ID 2		X	X		X
1705.02		Ready for auto start, ID 3		X	X		X
1705.03		Ready for auto start, ID 4		X	X		X
1705.04		Ready for auto start, ID 5		X	X		X
1705.05		Ready for auto start, ID 6		X	X		X
1705.06		Ready for auto start, ID 7		X	X		X
1705.07		Ready for auto start, ID 8		X	X		X
1705.08		Ready for auto start, ID 9		X	X		X
1705.09		Ready for auto start, ID 10		X	X		X
1705.1		Ready for auto start, ID 11		X	X		X
1705.11		Ready for auto start, ID 12		X	X		X
1705.12		Ready for auto start, ID 13		X	X		X
1705.13		Ready for auto start, ID 14		X	X		X
1705.14		Ready for auto start, ID 15		X	X		X
1705.15		Ready for auto start, ID 16		X	X		X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1706		Not used					
1707		Any alarms, ID 1		X	X	X	X
1707.01		Any alarms, ID 2		X	X	X	X
1707.02		Any alarms, ID 3		X	X	X	X
1707.03		Any alarms, ID 4		X	X	X	X
1707.04		Any alarms, ID 5		X	X	X	X
1707.05		Any alarms, ID 6		X	X	X	X
1707.06		Any alarms, ID 7		X	X	X	X
1707.07		Any alarms, ID 8		X	X	X	X
1707.08		Any alarms, ID 9		X	X	X	X
1707.09		Any alarms, ID 10		X	X	X	X
1707.1		Any alarms, ID 11		X	X	X	X
1707.11		Any alarms, ID 12		X	X	X	X
1707.12		Any alarms, ID 13		X	X	X	X
1707.13		Any alarms, ID 14		X	X	X	X
1707.14		Any alarms, ID 15		X	X	X	X
1707.15		Any alarms, ID 16		X	X	X	X
1708		Not used					
1709		Engine running, ID 1		X	X		X
1709.01		Engine running, ID 2		X	X		X
1709.02		Engine running, ID 3		X	X		X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1709.03		Engine running, ID 4		X	X		X
1709.04		Engine running, ID 5		X	X		X
1709.05		Engine running, ID 6		X	X		X
1709.06		Engine running, ID 7		X	X		X
1709.07		Engine running, ID 8		X	X		X
1709.08		Engine running, ID 9		X	X		X
1709.09		Engine running, ID 10		X	X		X
1709.1		Engine running, ID 11		X	X		X
1709.11		Engine running, ID 12		X	X		X
1709.12		Engine running, ID 13		X	X		X
1709.13		Engine running, ID 14		X	X		X
1709.14		Engine running, ID 15		X	X		X
1709.15		Engine running, ID 16		X	X		X
1710		Not used					
1711		GB synchronizing, ID 1		X	X		X
1711.01		GB synchronizing, ID 2		X	X		X
1711.02		GB synchronizing, ID 3		X	X		X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1711.03		GB synchronizing, ID 4		X	X		X
1711.04		GB synchronizing, ID 5		X	X		X
1711.05		GB synchronizing, ID 6		X	X		X
1711.06		GB synchronizing, ID 7		X	X		X
1711.07		GB synchronizing, ID 8		X	X		X
1711.08		GB synchronizing, ID 9		X	X		X
1711.09		GB synchronizing, ID 10		X	X		X
1711.1		GB synchronizing, ID 11		X	X		X
1711.11		GB synchronizing, ID 12		X	X		X
1711.12		GB synchronizing, ID 13		X	X		X
1711.13		GB synchronizing, ID 14		X	X		X
1711.14		GB synchronizing, ID 15		X	X		X
1711.15		GB synchronizing, ID 16		X	X		X
1712		Mains OK, ID 17		X	X	X	X
1712.01		Mains OK, ID 18		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1712.02		Mains OK, ID 19		X	X	X	X
1712.03		Mains OK, ID 20		X	X	X	X
1712.04		Mains OK, ID 21		X	X	X	X
1712.05		Mains OK, ID 22		X	X	X	X
1712.06		Mains OK, ID 23		X	X	X	X
1712.07		Mains OK, ID 24		X	X	X	X
1712.08		Mains OK, ID 25		X	X	X	X
1712.09		Mains OK, ID 26		X	X	X	X
1712.1		Mains OK, ID 27		X	X	X	X
1712.11		Mains OK, ID 28		X	X	X	X
1712.12		Mains OK, ID 29		X	X	X	X
1712.13		Mains OK, ID 30		X	X	X	X
1712.14		Mains OK, ID 31		X	X	X	X
1712.15		Mains OK, ID 32		X	X	X	X
1713		Mains not in semi 17		X	X	X	X
1713.01		Mains not in semi 18		X	X	X	X
1713.02		Mains not in semi 19		X	X	X	X
1713.03		Mains not in semi 20		X	X	X	X
1713.04		Mains not in semi 21		X	X	X	X
1713.05		Mains not in semi 22		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1713.06		Mains not in semi 23		X	X	X	X
1713.07		Mains not in semi 24		X	X	X	X
1713.08		Mains not in semi 25		X	X	X	X
1713.09		Mains not in semi 26		X	X	X	X
1713.1		Mains not in semi 27		X	X	X	X
1713.11		Mains not in semi 28		X	X	X	X
1713.12		Mains not in semi 29		X	X	X	X
1713.13		Mains not in semi 30		X	X	X	X
1713.14		Mains not in semi 31		X	X	X	X
1713.15		Mains not in semi 32		X	X	X	X
1714		Any alarms, ID 17		X	X	X	X
1714.01		Any alarms, ID 18		X	X	X	X
1714.02		Any alarms, ID 19		X	X	X	X
1714.03		Any alarms, ID 20		X	X	X	X
1714.04		Any alarms, ID 21		X	X	X	X
1714.05		Any alarms, ID 22		X	X	X	X
1714.06		Any alarms, ID 23		X	X	X	X
1714.07		Any alarms, ID 24		X	X	X	X
1714.08		Any alarms, ID 25		X	X	X	X
1714.09		Any alarms, ID 26		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1714.1		Any alarms, ID 27		X	X	X	X
1714.11		Any alarms, ID 28		X	X	X	X
1714.12		Any alarms, ID 29		X	X	X	X
1714.13		Any alarms, ID 30		X	X	X	X
1714.14		Any alarms, ID 31		X	X	X	X
1714.15		Any alarms, ID 32		X	X	X	X

5.1.13 Function Code 4 (04h): Read Input Registers (Address, Bit: 1715-1728)

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1715		MB pos. ON, ID 17		X	X	X	X
1715.01		MB pos. ON, ID 18		X	X	X	X
1715.02		MB pos. ON, ID 19		X	X	X	X
1715.03		MB pos. ON, ID 20		X	X	X	X
1715.04		MB pos. ON, ID 21		X	X	X	X
1715.05		MB pos. ON, ID 22		X	X	X	X
1715.06		MB pos. ON, ID 23		X	X	X	X
1715.07		MB pos. ON, ID 24		X	X	X	X
1715.08		MB pos. ON, ID 25		X	X	X	X
1715.09		MB pos. ON, ID 26		X	X	X	X
1715.1		MB pos. ON, ID 27		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1715.11		MB pos. ON, ID 28		X	X	X	X
1715.12		MB pos. ON, ID 29		X	X	X	X
1715.13		MB pos. ON, ID 30		X	X	X	X
1715.14		MB pos. ON, ID 31		X	X	X	X
1715.15		MB pos. ON, ID 32		X	X	X	X
1716		MB pos. OFF, ID 17		X	X	X	X
1716.01		MB pos. OFF, ID 18		X	X	X	X
1716.02		MB pos. OFF, ID 19		X	X	X	X
1716.03		MB pos. OFF, ID 20		X	X	X	X
1716.04		MB pos. OFF, ID 21		X	X	X	X
1716.05		MB pos. OFF, ID 22		X	X	X	X
1716.06		MB pos. OFF, ID 23		X	X	X	X
1716.07		MB pos. OFF, ID 24		X	X	X	X
1716.08		MB pos. OFF, ID 25		X	X	X	X
1716.09		MB pos. OFF, ID 26		X	X	X	X
1716.1		MB pos. OFF, ID 27		X	X	X	X
1716.11		MB pos. OFF, ID 28		X	X	X	X
1716.12		MB pos. OFF, ID 29		X	X	X	X
1716.13		MB pos. OFF, ID 30		X	X	X	X
1716.14		MB pos. OFF, ID 31		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1716.15		MB pos. OFF, ID 32		X	X	X	X
1717		Mains failure, ID 17		X	X	X	X
1717.01		Mains failure, ID 18		X	X	X	X
1717.02		Mains failure, ID 19		X	X	X	X
1717.03		Mains failure, ID 20		X	X	X	X
1717.04		Mains failure, ID 21		X	X	X	X
1717.05		Mains failure, ID 22		X	X	X	X
1717.06		Mains failure, ID 23		X	X	X	X
1717.07		Mains failure, ID 24		X	X	X	X
1717.08		Mains failure, ID 25		X	X	X	X
1717.09		Mains failure, ID 26		X	X	X	X
1717.1		Mains failure, ID 27		X	X	X	X
1717.11		Mains failure, ID 28		X	X	X	X
1717.12		Mains failure, ID 29		X	X	X	X
1717.13		Mains failure, ID 30		X	X	X	X
1717.14		Mains failure, ID 31		X	X	X	X
1717.15		Mains failure, ID 32		X	X	X	X
1718		MB synchronizin g, ID 17		X	X	X	X
1718.01		MB synchronizin g, ID 18		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1718.02		MB synchronizing, ID 19		X	X	X	X
1718.03		MB synchronizing, ID 20		X	X	X	X
1718.04		MB synchronizing, ID 21		X	X	X	X
1718.05		MB synchronizing, ID 22		X	X	X	X
1718.06		MB synchronizing, ID 23		X	X	X	X
1718.07		MB synchronizing, ID 24		X	X	X	X
1718.08		MB synchronizing, ID 25		X	X	X	X
1718.09		MB synchronizing, ID 26		X	X	X	X
1718.1		MB synchronizing, ID 27		X	X	X	X
1718.11		MB synchronizing, ID 28		X	X	X	X
1718.12		MB synchronizing, ID 29		X	X	X	X
1718.13		MB synchronizing, ID 30		X	X	X	X
1718.14		MB synchronizing, ID 31		X	X	X	X
1718.15		MB synchronizing, ID 32		X	X	X	X
1719		TB pos. ON, ID 17		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1719.01		TB pos. ON, ID 18		X	X	X	X
1719.02		TB pos. ON, ID 19		X	X	X	X
1719.03		TB pos. ON, ID 20		X	X	X	X
1719.04		TB pos. ON, ID 21		X	X	X	X
1719.05		TB pos. ON, ID 22		X	X	X	X
1719.06		TB pos. ON, ID 23		X	X	X	X
1719.07		TB pos. ON, ID 24		X	X	X	X
1719.08		TB pos. ON, ID 25		X	X	X	X
1719.09		TB pos. ON, ID 26		X	X	X	X
1719.1		TB pos. ON, ID 27		X	X	X	X
1719.11		TB pos. ON, ID 28		X	X	X	X
1719.12		TB pos. ON, ID 29		X	X	X	X
1719.13		TB pos. ON, ID 30		X	X	X	X
1719.14		TB pos. ON, ID 31		X	X	X	X
1719.15		TB pos. ON, ID 32		X	X	X	X
1720		TB pos. OFF, ID 17		X	X	X	X
1720.01		TB pos. OFF, ID 18		X	X	X	X
1720.02		TB pos. OFF, ID 19		X	X	X	X
1720.03		TB pos. OFF, ID 20		X	X	X	X
1720.04		TB pos. OFF, ID 21		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1720.05		TB pos. OFF, ID 22		X	X	X	X
1720.06		TB pos. OFF, ID 23		X	X	X	X
1720.07		TB pos. OFF, ID 24		X	X	X	X
1720.08		TB pos. OFF, ID 25		X	X	X	X
1720.09		TB pos. OFF, ID 26		X	X	X	X
1720.1		TB pos. OFF, ID 27		X	X	X	X
1720.11		TB pos. OFF, ID 28		X	X	X	X
1720.12		TB pos. OFF, ID 29		X	X	X	X
1720.13		TB pos. OFF, ID 30		X	X	X	X
1720.14		TB pos. OFF, ID 31		X	X	X	X
1720.15		TB pos. OFF, ID 32		X	X	X	X
1721		TB synchronizing, ID 17		X	X	X	X
1721.01		TB synchronizing, ID 18		X	X	X	X
1721.02		TB synchronizing, ID 19		X	X	X	X
1721.03		TB synchronizing, ID 20		X	X	X	X
1721.04		TB synchronizing, ID 21		X	X	X	X
1721.05		TB synchronizing, ID 22		X	X	X	X
1721.06		TB synchronizing, ID 23		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1721.07		TB synchronizing, ID 24		X	X	X	X
1721.08		TB synchronizing, ID 25		X	X	X	X
1721.09		TB synchronizing, ID 26		X	X	X	X
1721.1		TB synchronizing, ID 27		X	X	X	X
1721.11		TB synchronizing, ID 28		X	X	X	X
1721.12		TB synchronizing, ID 29		X	X	X	X
1721.13		TB synchronizing, ID 30		X	X	X	X
1721.14		TB synchronizing, ID 31		X	X	X	X
1721.15		TB synchronizing, ID 32		X	X	X	X
1722		Any alarms, PV ID 33		X			X
1722.01		Any alarms, PV ID 34		X			X
1722.02		Any alarms, PV ID 35		X			X
1722.03		Any alarms, PV ID 36		X			X
1722.04		Any alarms, PV ID 37		X			X
1722.05		Any alarms, PV ID 38		X			X
1722.06		Any alarms, PV ID 39		X			X
1722.07		Any alarms, PV ID 40		X			X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1722.08		Not used					
1722.09		Not used					
1722.1		Not used					
1722.11		Not used					
1722.12		Not used					
1722.13		Not used					
1722.14		Not used					
1722.15		Not used					
1723		BTB pos. ON, ID 33		X	X	X	X
1723.01		BTB pos. ON, ID 34		X	X	X	X
1723.02		BTB pos. ON, ID 35		X	X	X	X
1723.03		BTB pos. ON, ID 36		X	X	X	X
1723.04		BTB pos. ON, ID 37		X	X	X	X
1723.05		BTB pos. ON, ID 38		X	X	X	X
1723.06		BTB pos. ON, ID 39		X	X	X	X
1723.07		BTB pos. ON, ID 40		X	X	X	X
1723.08		Not used					
1723.09		Not used					
1723.1		Not used					
1723.11		Not used					
1723.12		Not used					
1723.13		Not used					
1723.14		Not used					
1723.15		Not used					
1724		BTB pos. OFF, ID 33		X	X	X	X
1724.01		BTB pos. OFF, ID 34		X	X	X	X
1724.02		BTB pos. OFF, ID 35		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1724.03		BTB pos. OFF, ID 36		X	X	X	X
1724.04		BTB pos. OFF, ID 37		X	X	X	X
1724.05		BTB pos. OFF, ID 38		X	X	X	X
1724.06		BTB pos. OFF, ID 39		X	X	X	X
1724.07		BTB pos. OFF, ID 40		X	X	X	X
1724.08		Not used					
1724.09		Not used					
1724.1		Not used					
1724.11		Not used					
1724.12		Not used					
1724.13		Not used					
1724.14		Not used					
1724.15		Not used					
1725		Not used					
1726		Ext. Modbus comm. error, CAN ID 1		X	X	X	X
1726.01		Ext. Modbus comm. error, CAN ID 2		X	X	X	X
1726.02		Ext. Modbus comm. error, CAN ID 3		X	X	X	X
1726.03		Ext. Modbus comm. error, CAN ID 4		X	X	X	X
1726.04		Ext. Modbus comm. error, CAN ID 5		X	X	X	X
1726.05		Ext. Modbus comm. error, CAN ID 6		X	X	X	X
1726.06		Ext. Modbus comm. error, CAN ID 7		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1726.07		Ext. Modbus comm. error, CAN ID 8		X	X	X	X
1726.08		Ext. Modbus comm. error, CAN ID 9		X	X	X	X
1726.09		Ext. Modbus comm. error, CAN ID 10		X	X	X	X
1726.1		Ext. Modbus comm. error, CAN ID 11		X	X	X	X
1726.11		Ext. Modbus comm. error, CAN ID 12		X	X	X	X
1726.12		Ext. Modbus comm. error, CAN ID 13		X	X	X	X
1726.13		Ext. Modbus comm. error, CAN ID 14		X	X	X	X
1726.14		Ext. Modbus comm. error, CAN ID 15		X	X	X	X
1726.15		Ext. Modbus comm. error, CAN ID 16		X	X	X	X
1727		Ext. Modbus comm. error, CAN ID 17		X	X	X	X
1727.01		Ext. Modbus comm. error, CAN ID 18		X	X	X	X
1727.02		Ext. Modbus comm. error, CAN ID 19		X	X	X	X
1727.03		Ext. Modbus comm. error, CAN ID 20		X	X	X	X
1727.04		Ext. Modbus comm. error, CAN ID 21		X	X	X	X
1727.05		Ext. Modbus comm. error, CAN ID 22		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1727.06		Ext. Modbus comm. error, CAN ID 23		X	X	X	X
1727.07		Ext. Modbus comm. error, CAN ID 24		X	X	X	X
1727.08		Ext. Modbus comm. error, CAN ID 25		X	X	X	X
1727.09		Ext. Modbus comm. error, CAN ID 26		X	X	X	X
1727.1		Ext. Modbus comm. error, CAN ID 27		X	X	X	X
1727.11		Ext. Modbus comm. error, CAN ID 28		X	X	X	X
1727.12		Ext. Modbus comm. error, CAN ID 29		X	X	X	X
1727.13		Ext. Modbus comm. error, CAN ID 30		X	X	X	X
1727.14		Ext. Modbus comm. error, CAN ID 31		X	X	X	X
1727.15		Ext. Modbus comm. error, CAN ID 32		X	X	X	X
1728		Not used: 1728-1731					

5.1.14 Function Code 4 (04h): Read Input Registers (Address, Bit: 1732-1750)

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1732		BB Hz/V OK, ID 1		X	X	X	X
1732.01		BB Hz/V OK, ID 2		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1732.02		BB Hz/V OK, ID 3		X	X	X	X
1732.03		BB Hz/V OK, ID 4		X	X	X	X
1732.04		BB Hz/V OK, ID 5		X	X	X	X
1732.05		BB Hz/V OK, ID 6		X	X	X	X
1732.06		BB Hz/V OK, ID 7		X	X	X	X
1732.07		BB Hz/V OK, ID 8		X	X	X	X
1732.08		BB Hz/V OK, ID 9		X	X	X	X
1732.09		BB Hz/V OK, ID 10		X	X	X	X
1732.1		BB Hz/V OK, ID 11		X	X	X	X
1732.11		BB Hz/V OK, ID 12		X	X	X	X
1732.12		BB Hz/V OK, ID 13		X	X	X	X
1732.13		BB Hz/V OK, ID 14		X	X	X	X
1732.14		BB Hz/V OK, ID 15		X	X	X	X
1732.15		BB Hz/V OK, ID 16		X	X	X	X
1733		BB Hz/V OK, ID 17		X	X	X	X
1733.01		BB Hz/V OK, ID 18		X	X	X	X
1733.02		BB Hz/V OK, ID 19		X	X	X	X
1733.03		BB Hz/V OK, ID 20		X	X	X	X
1733.04		BB Hz/V OK, ID 21		X	X	X	X
1733.05		BB Hz/V OK, ID 22		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1733.06		BB Hz/V OK, ID 23		X	X	X	X
1733.07		BB Hz/V OK, ID 24		X	X	X	X
1733.08		BB Hz/V OK, ID 25		X	X	X	X
1733.09		BB Hz/V OK, ID 26		X	X	X	X
1733.1		BB Hz/V OK, ID 27		X	X	X	X
1733.11		BB Hz/V OK, ID 28		X	X	X	X
1733.12		BB Hz/V OK, ID 29		X	X	X	X
1733.13		BB Hz/V OK, ID 30		X	X	X	X
1733.14		BB Hz/V OK, ID 31		X	X	X	X
1733.15		BB Hz/V OK, ID 32		X	X	X	X
1734		BB Hz/V OK, PV ID 33		X			X
1734.01		BB Hz/V OK, PV ID 34		X			X
1734.02		BB Hz/V OK, PV ID 35		X			X
1734.03		BB Hz/V OK, PV ID 36		X			X
1734.04		BB Hz/V OK, PV ID 37		X			X
1734.05		BB Hz/V OK, PV ID 38		X			X
1734.06		BB Hz/V OK, PV ID 39		X			X
1734.07		BB Hz/V OK, PV ID 40		X			X
1734.08		Not used					
1734.09		Not used					
1734.1		Not used					
1734.11		Not used					

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1734.12		Not used					
1734.13		Not used					
1734.14		Not used					
1734.15		Not used					
1735		BB Hz/V present, ID 1		X	X	X	X
1735.01		BB Hz/V present, ID 2		X	X	X	X
1735.02		BB Hz/V present, ID 3		X	X	X	X
1735.03		BB Hz/V present, ID 4		X	X	X	X
1735.04		BB Hz/V present, ID 5		X	X	X	X
1735.05		BB Hz/V present, ID 6		X	X	X	X
1735.06		BB Hz/V present, ID 7		X	X	X	X
1735.07		BB Hz/V present, ID 8		X	X	X	X
1735.08		BB Hz/V present, ID 9		X	X	X	X
1735.09		BB Hz/V present, ID 10		X	X	X	X
1735.1		BB Hz/V present, ID 11		X	X	X	X
1735.11		BB Hz/V present, ID 12		X	X	X	X
1735.12		BB Hz/V present, ID 13		X	X	X	X
1735.13		BB Hz/V present, ID 14		X	X	X	X
1735.14		BB Hz/V present, ID 15		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1735.15		BB Hz/V present, ID 16		X	X	X	X
1736		BB Hz/V present, ID 17		X	X	X	X
1736.01		BB Hz/V present, ID 18		X	X	X	X
1736.02		BB Hz/V present, ID 19		X	X	X	X
1736.03		BB Hz/V present, ID 20		X	X	X	X
1736.04		BB Hz/V present, ID 21		X	X	X	X
1736.05		BB Hz/V present, ID 22		X	X	X	X
1736.06		BB Hz/V present, ID 23		X	X	X	X
1736.07		BB Hz/V present, ID 24		X	X	X	X
1736.08		BB Hz/V present, ID 25		X	X	X	X
1736.09		BB Hz/V present, ID 26		X	X	X	X
1736.1		BB Hz/V present, ID 27		X	X	X	X
1736.11		BB Hz/V present, ID 28		X	X	X	X
1736.12		BB Hz/V present, ID 29		X	X	X	X
1736.13		BB Hz/V present, ID 30		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1736.14		BB Hz/V present, ID 31		X	X	X	X
1736.15		BB Hz/V present, ID 32		X	X	X	X
1737		BB Hz/V present, PV ID 33		X	X	X	X
1737.01		BB Hz/V present, PV ID 34		X	X	X	X
1737.02		BB Hz/V present, PV ID 35		X	X	X	X
1737.03		BB Hz/V present, PV ID 36		X	X	X	X
1737.04		BB Hz/V present, PV ID 37		X	X	X	X
1737.05		BB Hz/V present, PV ID 38		X	X	X	X
1737.06		BB Hz/V present, PV ID 39		X	X	X	X
1737.07		BB Hz/V present, PV ID 40		X	X	X	X
1737.08		Not used					
1737.09		Not used					
1737.1		Not used					
1737.11		Not used					
1737.12		Not used					
1737.13		Not used					
1737.14		Not used					
1737.15		Not used					
1738		BA Hz/V OK, PV ID 33		X	X	X	X
1738.01		BA Hz/V OK, PV ID 34		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1738.02		BA Hz/V OK, PV ID 35		X	X	X	X
1738.03		BA Hz/V OK, PV ID 36		X	X	X	X
1738.04		BA Hz/V OK, PV ID 37		X	X	X	X
1738.05		BA Hz/V OK, PV ID 38		X	X	X	X
1738.06		BA Hz/V OK, PV ID 39		X	X	X	X
1738.07		BA Hz/V OK, PV ID 40		X	X	X	X
1738.08		Not used					
1738.09		Not used					
1738.1		Not used					
1738.11		Not used					
1738.12		Not used					
1738.13		Not used					
1738.14		Not used					
1738.15		Not used					
1739		DG Hz/V present, ID 1		X	X		X
1739.01		DG Hz/V present, ID 2		X	X		X
1739.02		DG Hz/V present, ID 3		X	X		X
1739.03		DG Hz/V present, ID 4		X	X		X
1739.04		DG Hz/V present, ID 5		X	X		X
1739.05		DG Hz/V present, ID 6		X	X		X
1739.06		DG Hz/V present, ID 7		X	X		X
1739.07		DG Hz/V present, ID 8		X	X		X
1739.08		DG Hz/V present, ID 9		X	X		X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1739.09		DG Hz/V present, ID 10		X	X		X
1739.1		DG Hz/V present, ID 11		X	X		X
1739.11		DG Hz/V present, ID 12		X	X		X
1739.12		DG Hz/V present, ID 13		X	X		X
1739.13		DG Hz/V present, ID 14		X	X		X
1739.14		DG Hz/V present, ID 15		X	X		X
1739.15		DG Hz/V present, ID 16		X	X		X
1740		Mains Hz/V present, ID 17		X	X	X	X
1740.01		Mains Hz/V present, ID 18		X	X	X	X
1740.02		Mains Hz/V present, ID 19		X	X	X	X
1740.03		Mains Hz/V present, ID 20		X	X	X	X
1740.04		Mains Hz/V present, ID 21		X	X	X	X
1740.05		Mains Hz/V present, ID 22		X	X	X	X
1740.06		Mains Hz/V present, ID 23		X	X	X	X
1740.07		Mains Hz/V present, ID 24		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1740.08		Mains Hz/V present, ID 25		X	X	X	X
1740.09		Mains Hz/V present, ID 26		X	X	X	X
1740.1		Mains Hz/V present, ID 27		X	X	X	X
1740.11		Mains Hz/V present, ID 28		X	X	X	X
1740.12		Mains Hz/V present, ID 29		X	X	X	X
1740.13		Mains Hz/V present, ID 30		X	X	X	X
1740.14		Mains Hz/V present, ID 31		X	X	X	X
1740.15		Mains Hz/V present, ID 32		X	X	X	X
1741		BA Hz/V present, PV ID 33		X			X
1741.01		BA Hz/V present, PV ID 34		X			X
1741.02		BA Hz/V present, PV ID 35		X			X
1741.03		BA Hz/V present, PV ID 36		X			X
1741.04		BA Hz/V present, PV ID 37		X			X
1741.05		BA Hz/V present, PV ID 38		X			X
1741.06		BA Hz/V present, PV ID 39		X			X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1741.07		BA Hz/V present, PV ID 40		X			X
1741.08		Not used					
1741.09		Not used					
1741.1		Not used					
1741.11		Not used					
1741.12		Not used					
1741.13		Not used					
1741.14		Not used					
1741.15		Not used					
1742		Not used: 1742-1748					
1749		Dry Mode active on ID1		X	X		X
1749.01		Dry Mode active on ID2		X	X		X
1749.02		Dry Mode active on ID3		X	X		X
1749.03		Dry Mode active on ID4		X	X		X
1749.04		Dry Mode active on ID5		X	X		X
1749.05		Dry Mode active on ID6		X	X		X
1749.06		Dry Mode active on ID7		X	X		X
1749.07		Dry Mode active on ID8		X	X		X
1749.08		Dry Mode active on ID9		X	X		X
1749.09		Dry Mode active on ID10		X	X		X
1749.1		Dry Mode active on ID11		X	X		X
1749.11		Dry Mode active on ID12		X	X		X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1749.12		Dry Mode active on ID13		X	X		X
1749.13		Dry Mode active on ID14		X	X		X
1749.14		Dry Mode active on ID15		X	X		X
1749.15		Dry Mode active on ID16		X	X		X
1750		GB pos. ON ID 17		X	X		X
1750.01		GB pos. ON ID 18		X	X		X
1750.02		GB pos. ON ID 19		X	X		X
1750.03		GB pos. ON ID 20		X	X		X
1750.04		GB pos. ON ID 21		X	X		X
1750.05		GB pos. ON ID 22		X	X		X
1750.06		GB pos. ON ID 23		X	X		X
1750.07		GB pos. ON ID 24		X	X		X
1750.08		GB pos. ON ID 25		X	X		X
1750.09		GB pos. ON ID 26		X	X		X
1750.1		GB pos. ON ID 27		X	X		X
1750.11		GB pos. ON ID 28		X	X		X
1750.12		GB pos. ON ID 29		X	X		X
1750.13		GB pos. ON ID 30		X	X		X
1750.14		GB pos. ON ID 31		X	X		X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1750.15		GB pos. ON ID 32		X	X		X

5.1.15 Function Code 4 (04h): Read Input Registers (Address, Bit: 1751-1762)

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1751		GB pos. OFF ID 17		X	X		X
1751.01		GB pos. OFF ID 18		X	X		X
1751.02		GB pos. OFF ID 19		X	X		X
1751.03		GB pos. OFF ID 20		X	X		X
1751.04		GB pos. OFF ID 21		X	X		X
1751.05		GB pos. OFF ID 22		X	X		X
1751.06		GB pos. OFF ID 23		X	X		X
1751.07		GB pos. OFF ID 24		X	X		X
1751.08		GB pos. OFF ID 25		X	X		X
1751.09		GB pos. OFF ID 26		X	X		X
1751.1		GB pos. OFF ID 27		X	X		X
1751.11		GB pos. OFF ID 28		X	X		X
1751.12		GB pos. OFF ID 29		X	X		X
1751.13		GB pos. OFF ID 30		X	X		X
1751.14		GB pos. OFF ID 31		X	X		X
1751.15		GB pos. OFF ID 32		X	X		X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1752		GB synchronizing, ID 17		X	X		X
1752.01		GB synchronizing, ID 18		X	X		X
1752.02		GB synchronizing, ID 19		X	X		X
1752.03		GB synchronizing, ID 20		X	X		X
1752.04		GB synchronizing, ID 21		X	X		X
1752.05		GB synchronizing, ID 22		X	X		X
1752.06		GB synchronizing, ID 23		X	X		X
1752.07		GB synchronizing, ID 24		X	X		X
1752.08		GB synchronizing, ID 25		X	X		X
1752.09		GB synchronizing, ID 26		X	X		X
1752.1		GB synchronizing, ID 27		X	X		X
1752.11		GB synchronizing, ID 28		X	X		X
1752.12		GB synchronizing, ID 29		X	X		X
1752.13		GB synchronizing, ID 30		X	X		X
1752.14		GB synchronizing, ID 31		X	X		X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1752.15		GB synchronizing, ID 32		X	X		X
1753		DG Hz/V OK, ID 17		X	X		X
1753.01		DG Hz/V OK, ID 18		X	X		X
1753.02		DG Hz/V OK, ID 19		X	X		X
1753.03		DG Hz/V OK, ID 20		X	X		X
1753.04		DG Hz/V OK, ID 21		X	X		X
1753.05		DG Hz/V OK, ID 22		X	X		X
1753.06		DG Hz/V OK, ID 23		X	X		X
1753.07		DG Hz/V OK, ID 24		X	X		X
1753.08		DG Hz/V OK, ID 25		X	X		X
1753.09		DG Hz/V OK, ID 26		X	X		X
1753.1		DG Hz/V OK, ID 27		X	X		X
1753.11		DG Hz/V OK, ID 28		X	X		X
1753.12		DG Hz/V OK, ID 29		X	X		X
1753.13		DG Hz/V OK, ID 30		X	X		X
1753.14		DG Hz/V OK, ID 31		X	X		X
1753.15		DG Hz/V OK, ID 32		X	X		X
1754		Ready for auto start, ID 17		X	X		X
1754.01		Ready for auto start, ID 18		X	X		X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1754.02		Ready for auto start, ID 19		X	X		X
1754.03		Ready for auto start, ID 20		X	X		X
1754.04		Ready for auto start, ID 21		X	X		X
1754.05		Ready for auto start, ID 22		X	X		X
1754.06		Ready for auto start, ID 23		X	X		X
1754.07		Ready for auto start, ID 24		X	X		X
1754.08		Ready for auto start, ID 25		X	X		X
1754.09		Ready for auto start, ID 26		X	X		X
1754.1		Ready for auto start, ID 27		X	X		X
1754.11		Ready for auto start, ID 28		X	X		X
1754.12		Ready for auto start, ID 29		X	X		X
1754.13		Ready for auto start, ID 30		X	X		X
1754.14		Ready for auto start, ID 31		X	X		X
1754.15		Ready for auto start, ID 32		X	X		X
1755		Engine running, ID 17		X	X		X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1755.01		Engine running, ID 18		X	X		X
1755.02		Engine running, ID 19		X	X		X
1755.03		Engine running, ID 20		X	X		X
1755.04		Engine running, ID 21		X	X		X
1755.05		Engine running, ID 22		X	X		X
1755.06		Engine running, ID 23		X	X		X
1755.07		Engine running, ID 24		X	X		X
1755.08		Engine running, ID 25		X	X		X
1755.09		Engine running, ID 26		X	X		X
1755.1		Engine running, ID 27		X	X		X
1755.11		Engine running, ID 28		X	X		X
1755.12		Engine running, ID 29		X	X		X
1755.13		Engine running, ID 30		X	X		X
1755.14		Engine running, ID 31		X	X		X
1755.15		Engine running, ID 32		X	X		X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1756		Dry Mode active on ID17		X	X		X
1756.01		Dry Mode active on ID18		X	X		X
1756.02		Dry Mode active on ID19		X	X		X
1756.03		Dry Mode active on ID20		X	X		X
1756.04		Dry Mode active on ID21		X	X		X
1756.05		Dry Mode active on ID22		X	X		X
1756.06		Dry Mode active on ID23		X	X		X
1756.07		Dry Mode active on ID24		X	X		X
1756.08		Dry Mode active on ID25		X	X		X
1756.09		Dry Mode active on ID26		X	X		X
1756.1		Dry Mode active on ID27		X	X		X
1756.11		Dry Mode active on ID28		X	X		X
1756.12		Dry Mode active on ID29		X	X		X
1756.13		Dry Mode active on ID30		X	X		X
1756.14		Dry Mode active on ID31		X	X		X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1756.15		Dry Mode active on ID32		X	X		X
1757		MB pos. ON, ID 1		X	X	X	X
1757.01		MB pos. ON, ID 2		X	X	X	X
1757.02		MB pos. ON, ID 3		X	X	X	X
1757.03		MB pos. ON, ID 4		X	X	X	X
1757.04		MB pos. ON, ID 5		X	X	X	X
1757.05		MB pos. ON, ID 6		X	X	X	X
1757.06		MB pos. ON, ID 7		X	X	X	X
1757.07		MB pos. ON, ID 8		X	X	X	X
1757.08		MB pos. ON, ID 9		X	X	X	X
1757.09		MB pos. ON, ID 10		X	X	X	X
1757.1		MB pos. ON, ID 11		X	X	X	X
1757.11		MB pos. ON, ID 12		X	X	X	X
1757.12		MB pos. ON, ID 13		X	X	X	X
1757.13		MB pos. ON, ID 14		X	X	X	X
1757.14		MB pos. ON, ID 15		X	X	X	X
1757.15		MB pos. ON, ID 16		X	X	X	X
1758		MB pos. OFF, ID 1		X	X	X	X
1758.01		MB pos. OFF, ID 2		X	X	X	X
1758.02		MB pos. OFF, ID 3		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1758.03		MB pos. OFF, ID 4		X	X	X	X
1758.04		MB pos. OFF, ID 5		X	X	X	X
1758.05		MB pos. OFF, ID 6		X	X	X	X
1758.06		MB pos. OFF, ID 7		X	X	X	X
1758.07		MB pos. OFF, ID 8		X	X	X	X
1758.08		MB pos. OFF, ID 9		X	X	X	X
1758.09		MB pos. OFF, ID 10		X	X	X	X
1758.1		MB pos. OFF, ID 11		X	X	X	X
1758.11		MB pos. OFF, ID 12		X	X	X	X
1758.12		MB pos. OFF, ID 13		X	X	X	X
1758.13		MB pos. OFF, ID 14		X	X	X	X
1758.14		MB pos. OFF, ID 15		X	X	X	X
1758.15		MB pos. OFF, ID 16		X	X	X	X
1759		MB synchronizin g, ID 1		X	X	X	X
1759.01		MB synchronizin g, ID 2		X	X	X	X
1759.02		MB synchronizin g, ID 3		X	X	X	X
1759.03		MB synchronizin g, ID 4		X	X	X	X
1759.04		MB synchronizin g, ID 5		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1759.05		MB synchronizing, ID 6		X	X	X	X
1759.06		MB synchronizing, ID 7		X	X	X	X
1759.07		MB synchronizing, ID 8		X	X	X	X
1759.08		MB synchronizing, ID 9		X	X	X	X
1759.09		MB synchronizing, ID 10		X	X	X	X
1759.1		MB synchronizing, ID 11		X	X	X	X
1759.11		MB synchronizing, ID 12		X	X	X	X
1759.12		MB synchronizing, ID 13		X	X	X	X
1759.13		MB synchronizing, ID 14		X	X	X	X
1759.14		MB synchronizing, ID 15		X	X	X	X
1759.15		MB synchronizing, ID 16		X	X	X	X
1760		TB pos. ON, ID 1		X	X	X	X
1760.01		TB pos. ON, ID 2		X	X	X	X
1760.02		TB pos. ON, ID 3		X	X	X	X
1760.03		TB pos. ON, ID 4		X	X	X	X
1760.04		TB pos. ON, ID 5		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1760.05		TB pos. ON, ID 6		X	X	X	X
1760.06		TB pos. ON, ID 7		X	X	X	X
1760.07		TB pos. ON, ID 8		X	X	X	X
1760.08		TB pos. ON, ID 9		X	X	X	X
1760.09		TB pos. ON, ID 10		X	X	X	X
1760.1		TB pos. ON, ID 11		X	X	X	X
1760.11		TB pos. ON, ID 12		X	X	X	X
1760.12		TB pos. ON, ID 13		X	X	X	X
1760.13		TB pos. ON, ID 14		X	X	X	X
1760.14		TB pos. ON, ID 15		X	X	X	X
1760.15		TB pos. ON, ID 16		X	X	X	X
1761		TB pos. OFF, ID 1		X	X	X	X
1761.01		TB pos. OFF, ID 2		X	X	X	X
1761.02		TB pos. OFF, ID 3		X	X	X	X
1761.03		TB pos. OFF, ID 4		X	X	X	X
1761.04		TB pos. OFF, ID 5		X	X	X	X
1761.05		TB pos. OFF, ID 6		X	X	X	X
1761.06		TB pos. OFF, ID 7		X	X	X	X
1761.07		TB pos. OFF, ID 8		X	X	X	X
1761.08		TB pos. OFF, ID 9		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1761.09		TB pos. OFF, ID 10		X	X	X	X
1761.1		TB pos. OFF, ID 11		X	X	X	X
1761.11		TB pos. OFF, ID 12		X	X	X	X
1761.12		TB pos. OFF, ID 13		X	X	X	X
1761.13		TB pos. OFF, ID 14		X	X	X	X
1761.14		TB pos. OFF, ID 15		X	X	X	X
1761.15		TB pos. OFF, ID 16		X	X	X	X
1762		TB synchronizin g, ID 1		X	X	X	X
1762.01		TB synchronizin g, ID 2		X	X	X	X
1762.02		TB synchronizin g, ID 3		X	X	X	X
1762.03		TB synchronizin g, ID 4		X	X	X	X
1762.04		TB synchronizin g, ID 5		X	X	X	X
1762.05		TB synchronizin g, ID 6		X	X	X	X
1762.06		TB synchronizin g, ID 7		X	X	X	X
1762.07		TB synchronizin g, ID 8		X	X	X	X
1762.08		TB synchronizin g, ID 9		X	X	X	X
1762.09		TB synchronizin g, ID 10		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1762.1		TB synchronizing, ID 11		X	X	X	X
1762.11		TB synchronizing, ID 12		X	X	X	X
1762.12		TB synchronizing, ID 13		X	X	X	X
1762.13		TB synchronizing, ID 14		X	X	X	X
1762.14		TB synchronizing, ID 15		X	X	X	X
1762.15		TB synchronizing, ID 16		X	X	X	X

5.1.16 Function Code 4 (04h): Read Input Registers (Address, Bit: 1763-1773)

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1763		Mains transducer-configured, ID 1		X	X	X	X
1763.01		Mains transducer-configured, ID 2		X	X	X	X
1763.02		Mains transducer-configured, ID 3		X	X	X	X
1763.03		Mains transducer-configured, ID 4		X	X	X	X
1763.04		Mains transducer-configured, ID 5		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1763.05		Mains transducer-configured, ID 6		X	X	X	X
1763.06		Mains transducer-configured, ID 7		X	X	X	X
1763.07		Mains transducer-configured, ID 8		X	X	X	X
1763.08		Mains transducer-configured, ID 9		X	X	X	X
1763.09		Mains transducer-configured, ID 10		X	X	X	X
1763.1		Mains transducer-configured, ID 11		X	X	X	X
1763.11		Mains transducer-configured, ID 12		X	X	X	X
1763.12		Mains transducer-configured, ID 13		X	X	X	X
1763.13		Mains transducer-configured, ID 14		X	X	X	X
1763.14		Mains transducer-configured, ID 15		X	X	X	X
1763.15		Mains transducer-configured, ID 16		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1764		TB transducer-configured, ID 1		X	X	X	X
1764.01		TB transducer-configured, ID 2		X	X	X	X
1764.02		TB transducer-configured, ID 3		X	X	X	X
1764.03		TB transducer-configured, ID 4		X	X	X	X
1764.04		TB transducer-configured, ID 5		X	X	X	X
1764.05		TB transducer-configured, ID 6		X	X	X	X
1764.06		TB transducer-configured, ID 7		X	X	X	X
1764.07		TB transducer-configured, ID 8		X	X	X	X
1764.08		TB transducer-configured, ID 9		X	X	X	X
1764.09		TB transducer-configured, ID 10		X	X	X	X
1764.1		TB transducer-configured, ID 11		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1764.11		TB transducer-configured, ID 12		X	X	X	X
1764.12		TB transducer-configured, ID 13		X	X	X	X
1764.13		TB transducer-configured, ID 14		X	X	X	X
1764.14		TB transducer-configured, ID 15		X	X	X	X
1764.15		TB transducer-configured, ID 16		X	X	X	X
1765		Mains OK, ID 1		X	X	X	X
1765.01		Mains OK, ID 2		X	X	X	X
1765.02		Mains OK, ID 3		X	X	X	X
1765.03		Mains OK, ID 4		X	X	X	X
1765.04		Mains OK, ID 5		X	X	X	X
1765.05		Mains OK, ID 6		X	X	X	X
1765.06		Mains OK, ID 7		X	X	X	X
1765.07		Mains OK, ID 8		X	X	X	X
1765.08		Mains OK, ID 9		X	X	X	X
1765.09		Mains OK, ID 10		X	X	X	X
1765.1		Mains OK, ID 11		X	X	X	X
1765.11		Mains OK, ID 12		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1765.12		Mains OK, ID 13		X	X	X	X
1765.13		Mains OK, ID 14		X	X	X	X
1765.14		Mains OK, ID 15		X	X	X	X
1765.15		Mains OK, ID 16		X	X	X	X
1766		Mains not in semi 1		X	X	X	X
1766.01		Mains not in semi 2		X	X	X	X
1766.02		Mains not in semi 3		X	X	X	X
1766.03		Mains not in semi 4		X	X	X	X
1766.04		Mains not in semi 5		X	X	X	X
1766.05		Mains not in semi 6		X	X	X	X
1766.06		Mains not in semi 7		X	X	X	X
1766.07		Mains not in semi 8		X	X	X	X
1766.08		Mains not in semi 9		X	X	X	X
1766.09		Mains not in semi 10		X	X	X	X
1766.1		Mains not in semi 11		X	X	X	X
1766.11		Mains not in semi 12		X	X	X	X
1766.12		Mains not in semi 13		X	X	X	X
1766.13		Mains not in semi 14		X	X	X	X
1766.14		Mains not in semi 15		X	X	X	X
1766.15		Mains not in semi 16		X	X	X	X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1767		Mains failure, ID 1		X	X	X	X
1767.01		Mains failure, ID 2		X	X	X	X
1767.02		Mains failure, ID 3		X	X	X	X
1767.03		Mains failure, ID 4		X	X	X	X
1767.04		Mains failure, ID 5		X	X	X	X
1767.05		Mains failure, ID 6		X	X	X	X
1767.06		Mains failure, ID 7		X	X	X	X
1767.07		Mains failure, ID 8		X	X	X	X
1767.08		Mains failure, ID 9		X	X	X	X
1767.09		Mains failure, ID 10		X	X	X	X
1767.1		Mains failure, ID 11		X	X	X	X
1767.11		Mains failure, ID 12		X	X	X	X
1767.12		Mains failure, ID 13		X	X	X	X
1767.13		Mains failure, ID 14		X	X	X	X
1767.14		Mains failure, ID 15		X	X	X	X
1767.15		Mains failure, ID 16		X	X	X	X
1768		Breaker ON, PV ID 33		X			X
1768.01		Breaker ON, PV ID 34		X			X
1768.02		Breaker ON, PV ID 35		X			X
1768.03		Breaker ON, PV ID 36		X			X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1768.04		Breaker ON, PV ID 37		X			X
1768.05		Breaker ON, PV ID 38		X			X
1768.06		Breaker ON, PV ID 39		X			X
1768.07		Breaker ON, PV ID 40		X			X
1768.08		Not used					
1768.09		Not used					
1768.1		Not used					
1768.11		Not used					
1768.12		Not used					
1768.13		Not used					
1768.14		Not used					
1768.15		Not used					
1769		Breaker OFF, PV ID 33		X			X
1769		Breaker synchronizing, PV ID 33		X			X
1769.01		Breaker OFF, PV ID 34		X			X
1769.01		Breaker synchronizing, PV ID 34		X			X
1769.02		Breaker OFF, PV ID 35		X			X
1769.02		Breaker synchronizing, PV ID 35		X			X
1769.03		Breaker OFF, PV ID 36		X			X
1769.03		Breaker synchronizing, PV ID 36		X			X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1769.04		Breaker OFF, PV ID 37		X			X
1769.04		Breaker synchronizing, PV ID 37		X			X
1769.05		Breaker OFF, PV ID 38		X			X
1769.05		Breaker synchronizing, PV ID 38		X			X
1769.06		Breaker OFF, PV ID 39		X			X
1769.06		Breaker synchronizing, PV ID 39		X			X
1769.07		Breaker OFF, PV ID 40		X			X
1769.07		Breaker synchronizing, PV ID 40		X			X
1769.08		Not used					
1769.09		Not used					
1769.1		Not used					
1769.11		Not used					
1769.12		Not used					
1769.13		Not used					
1769.14		Not used					
1769.15		Not used					
1770		Not used					
1771		Running, PV ID 33		X			X
1771.01		Running, PV ID 34		X			X
1771.02		Running, PV ID 35		X			X
1771.03		Running, PV ID 36		X			X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1771.04		Running, PV ID 37		X			X
1771.05		Running, PV ID 38		X			X
1771.06		Running, PV ID 39		X			X
1771.07		Running, PV ID 40		X			X
1771.08		Not used					
1771.09		Not used					
1771.1		Not used					
1771.11		Not used					
1771.12		Not used					
1771.13		Not used					
1771.14		Not used					
1771.15		Not used					
1772		Not used					
1772		Ready to autostart, PV ID 33		X			X
1772.01		Ready to autostart, PV ID 34		X			X
1772.02		Ready to autostart, PV ID 35		X			X
1772.03		Ready to autostart, PV ID 36		X			X
1772.04		Ready to autostart, PV ID 37		X			X
1772.05		Ready to autostart, PV ID 38		X			X
1772.06		Ready to autostart, PV ID 39		X			X
1772.07		Ready to autostart, PV ID 40		X			X

Address, Bit	Value/Parameter	Content	Scaling	AGC-5CDG	AGC-5CGroup	AGC-5CPlant	AGC-5CMains
1772.08		Not used					
1772.09		Not used					
1772.11		Not used					
1772.12		Not used					
1772.13		Not used					
1772.14		Not used					
1772.15		Not used					
1773		Engine J1939 data, 1773-1999, see Function code 4 (EIC)		X			

5.1.17 Function Code 4 (04h): Read Input Registers (EIC) (Address, Bit: 593-1370)

Address	Content	SPN	Scaling	AGC-5C	Note
593	Engine speed	190	1/1	X	
594	Engine Coolant Temperature	110	1/10	X	
595	Engine Oil Pressure	100	1/100	X	
596	Number of Actual Faults	DM1		X	
597	Engine Oil Temperature	175	1/10	X	
598	Fuel Temperature	174	1/10	X	
599	Boost Pressure	102	1/100	X	
600	Air Inlet Temperature	172	1/1	X	
601	Coolant Level	111	1/10	X	
602	Fuel Rate	182	1/10	X	
604	Charge Air Temperature	105	1/10	X	
605	Drivers demand percent torque	512	1/1	X	
606	Actual engine - percent torque	513	1/1	X	

Address	Content	SPN	Scaling	AGC-5C	Note
609	Air Inlet Pressure	106	1/100	X	
610	Exhaust gas temperature	173	1/10	X	
611	Engine Hours	247	1/1	X	
612	Oil Filter Differential Pressure	99	1/100	X	
613	Battery potential (voltage), switched	158	1/10	X	
614	Fuel delivery pressure	94	1/100	X	
615	Engine oil level	98	1/10	X	
616	Crankcase pressure	101	1/100	X	
617	Coolant pressure	109	1/100	X	
623	Turbo Oil Temperature	176	1/10	X	
624	Particulate Trap Inlet Pressure	81	1/100	X	
625	Air Filter 1 Differential pressure	107	1/1000	X	
626	Coolant filter Differential pressure	112	1/100	X	
627	Atmospheric Pressure	108	1/100	X	
628	Ambient air temperature.	171	1/1	X	
629	Exhaust Temperature Right	2434	1/10	X	
630	Exhaust Temperature Left	2435	1/10	X	
637	Engine Intercooler Temperature	52	1/10	X	
684	Alternator efficiency	4078	1/100	X	
687	Supply gas methane percentage	5867	1/100	X	

Address	Content	SPN	Scaling	AGC-5C	Note
901	Nominal power	166	1/1	X	
911	Intake Manifold 1 Absolute Pressure	3563	1/100	X	
913	Fuel supply pump inlet pres.	1381	1/100	X	
914	Fuel Filter Differential Pressure	1382	1/100	X	
916	DAVR generator voltage		1/1	X	
917	DAVR generator frequency		1/10	X	
918	DAVR generator current		1/1	X	
919	DAVR Excitation Field Current	3381	1/10	X	
921	DAVR generator reactive power		1/1	X	
922	DAVR generator power factor		1/100	X	
923	DAVR generator power factor lagging			X	0 = Lagging 1 = Leading
925	DAVR generator power		1/1	X	
927	DAVR generator apparent power		1/1	X	
928	DAVR PT100 1		1/1	X	
929	DAVR PT100 2		1/1	X	
930	DAVR PT100 3		1/1	X	
939	Engine ECU temperature	1136	1/10	X	
947	Exh.P T01	1137	1/10	X	
948	Exh.P T02	1138	1/10	X	
949	Exh.P T03	1139	1/10	X	
950	Exh.P T04	1140	1/10	X	
951	Exh.P T05	1141	1/10	X	
952	Exh.P T06	1142	1/10	X	
953	Exh.P T07	1143	1/10	X	
954	Exh.P T08	1144	1/10	X	

Address	Content	SPN	Scaling	AGC-5C	Note
955	Exh.P T09	1145	1/10	X	
956	Exh.P T10	1146	1/10	X	
957	Exh.P T11	1147	1/10	X	
958	Exh.P T12	1148	1/10	X	
959	Exh.P T13	1149	1/10	X	
960	Exh.P T14	1150	1/10	X	
961	Exh.P T15	1151	1/10	X	
962	Exh.P T16	1152	1/10	X	
963	Exh.P T17	1153	1/10	X	
964	Exh.P T18	1154	1/10	X	
965	Exh.P T19	1155	1/10	X	
966	Exh.P T20	1156	1/10	X	
971	Aux Coolant temp	1212	1/1	X	
974	Turbo inlet temperature	1172	1/1	X	
975	HT Coolant Outlet Temp. high resolution	1637	1/10	X	
976	Turbocharger Speed 1 Unscaled	103		X	Multiply by 4 for actual RPM
977	Turbocharger Oil Level Switch	1665		X	0=Off
					1=On
978	LT Coolant Outlet Pressure	1203	1/100	X	
981	HT Coolant Inlet Temperature High Resolution	8487	1/10	X	
982	LT Coolant Inlet Temperature High Resolution	8488	1/10	X	
983	LT Coolant Outlet Temperature High Resolution	8489	1/10	X	
984	HT Coolant Outlet Pressure 2	5708	1/100	X	
987	Throttle Valve 1 Differential Pressure	5631	1/100	X	

Address	Content	SPN	Scaling	AGC-5C	Note
988	Turbocharger Speed 2 Unscaled	1169		X	Multiply by 4 for actual RPM
1021.13	Malfunction indicator lamp	1213		X	
1021.14	Amber warning lamp	624		X	
1021.15	Red stop lamp	623		X	
1060	Turbocharger Wastegate Actuator 1 Position	1188	1/1	X	
1072	Engine Mixer 1 Intake Pressure	8477	1/100	X	
1073	Engine Mixer 2 Intake Pressure	8607	1/100	X	
1074	Turbocharger 1 Turbine Outlet Temperature	1184	1/10	X	
1075	Turbocharger 1 Compressor Outlet Temperature	2629	1/10	X	
1080	LT Coolant Inlet Pressure		1/100	X	
1081	Knock Level cyl 1 Child	1352	1/1	X	
1082	Knock Level cyl 2 Child	1353	1/1	X	
1083	Knock Level cyl 3 Child	1354	1/1	X	
1084	Knock Level cyl 4 Child	1355	1/1	X	
1085	Knock Level cyl 5 Child	1356	1/1	X	
1086	Knock Level cyl 6 Child	1357	1/1	X	
1087	Spark Voltage Cylinder 1 Child	1294	1/100	X	
1088	Spark Voltage Cylinder 2 Child	1295	1/100	X	
1089	Spark Voltage Cylinder 3 Child	1296	1/100	X	

Address	Content	SPN	Scaling	AGC-5C	Note
1090	Spark Voltage Cylinder 4 Child	1297	1/100	X	
1091	Spark Voltage Cylinder 5 Child	1298	1/100	X	
1092	Spark Voltage Cylinder 6 Child	1299	1/100	X	
1093	Ignition Timing Cylinder 1 Child	1413	1/10	X	
1094	Ignition Timing Cylinder 2 Child	1414	1/10	X	
1095	Ignition Timing Cylinder 3 Child	1415	1/10	X	
1096	Ignition Timing Cylinder 4 Child	1416	1/10	X	
1097	Ignition Timing Cylinder 5 Child	1417	1/10	X	
1098	Ignition Timing Cylinder 6 Child	1418	1/10	X	
1099	Knock Counter Cylinder 1 Child		1/1	X	
1100	Knock Counter Cylinder 2 Child		1/1	X	
1101	Knock Counter Cylinder 3 Child		1/1	X	
1102	Knock Counter Cylinder 4 Child		1/1	X	
1103	Knock Counter Cylinder 5 Child		1/1	X	
1104	Knock Counter Cylinder 6 Child		1/1	X	
1105	Engine throttle actuator 1 control command	3464	1/100	X	
1106	Engine fuel actuator 1 control command	633	1/100	X	
1365	DAVR LED state U=U			X	
1365.1	DAVR LED state PF/KVAR			X	
1365.2	DAVR LED state Manuel			X	

Address	Content	SPN	Scaling	AGC-5C	Note
1365.3	DAVR LED state Fault			X	
1365.4	DAVR LED state lex			X	
1365.5	DAVR LED state volt			X	
1365.6	DAVR LED state Hz			X	
1365.7	DAVR LED state Power ON			X	
1365.8	DAVR LED state Blink lex			X	
1366	DAVR alarm General trip			X	
1366.1	DAVR alarm Short circuit			X	
1366.1	DAVR alarm over temperature PT100 3			X	
1366.11	DAVR alarm over stator current			X	
1366.12	DAVR alarm current U			X	
1366.13	DAVR alarm current V			X	
1366.14	DAVR alarm current W			X	
1366.15	DAVR alarm imbalance stator current			X	
1366.2	DAVR alarm loss of voltage sensing			X	
1366.3	DAVR alarm under excitation			X	
1366.4	DAVR alarm over excitation on level			X	
1366.5	DAVR alarm over excitation on curve			X	
1366.6	DAVR alarm over voltage alarm			X	

Address	Content	SPN	Scaling	AGC-5C	Note
1366.7	DAVR alarm over temperature PT100 1			X	
1366.8	DAVR alarm over temperature PTC			X	
1366.9	DAVR alarm over temperature PT100 2			X	
1367	DAVR alarm open diode			X	
1367.1	DAVR alarm short circuit diode			X	
1370	SPN1 HI-Word	DM1			

5.1.18 Function Code 4 (04h): Read Input Registers (EIC) (Address, Bit: 1371-1994)

Address	Content	SPN	Scaling	AGC-5C	Note
1371	SPN1 LO-Word	DM1			
1372	SPN2 HI-Word	DM1			
1373	SPN2 LO-Word	DM1			
1374	SPN3 HI-Word	DM1			
1375	SPN3 LO-Word	DM1			
1376	SPN4 HI-Word	DM1			
1377	SPN4 LO-Word	DM1			
1378	SPN5 HI-Word	DM1			
1379	SPN5 LO-Word	DM1			
1380	SPN6 HI-Word	DM1			
1381	SPN6 LO-Word	DM1			
1382	SPN7 HI-Word	DM1			
1383	SPN7 LO-Word	DM1			
1384	SPN8 HI-Word	DM1			
1385	SPN8 LO-Word	DM1			
1386	SPN9 HI-Word	DM1			
1387	SPN9 LO-Word	DM1			
1388	SPN10 HI-Word	DM1			
1389	SPN10 LO-Word	DM1			

Address	Content	SPN	Scaling	AGC-5C	Note
1402	FMI1	DM1			
1403	FMI2	DM1			
1404	FMI3	DM1			
1405	FMI4	DM1			
1406	FMI5	DM1			
1407	FMI6	DM1			
1408	FMI7	DM1			
1409	FMI8	DM1			
1410	FMI9	DM1			
1411	FMI10	DM1			
1418	Occurrence counter 1	DM1			
1419	Occurrence counter 2	DM1			
1420	Occurrence counter 3	DM1			
1421	Occurrence counter 4	DM1			
1422	Occurrence counter 5	DM1			
1423	Occurrence counter 6	DM1			
1424	Occurrence counter 7	DM1			
1425	Occurrence counter 8	DM1			
1426	Occurrence counter 9	DM1			
1427	Occurrence counter 10	DM1			
1434	SPN1 HI-Word	DM2			
1435	SPN1 LO-Word	DM2			
1436	SPN2 HI-Word	DM2			
1437	SPN2 LO-Word	DM2			
1438	SPN3 HI-Word	DM2			
1439	SPN3 LO-Word	DM2			
1440	SPN4 HI-Word	DM2			
1441	SPN4 LO-Word	DM2			

Address	Content	SPN	Scaling	AGC-5C	Note
1442	SPN5 HI-Word	DM2			
1443	SPN5 LO-Word	DM2			
1444	SPN6 HI-Word	DM2			
1445	SPN6 LO-Word	DM2			
1446	SPN7 HI-Word	DM2			
1447	SPN7 LO-Word	DM2			
1448	SPN8 HI-Word	DM2			
1449	SPN8 LO-Word	DM2			
1450	SPN9 HI-Word	DM2			
1451	SPN9 LO-Word	DM2			
1452	SPN10 HI-Word	DM2			
1453	SPN10 LO-Word	DM2			
1466	FMI1	DM2			
1467	FMI2	DM2			
1468	FMI3	DM2			
1469	FMI4	DM2			
1470	FMI5	DM2			
1471	FMI6	DM2			
1472	FMI7	DM2			
1473	FMI8	DM2			
1474	FMI9	DM2			
1475	FMI10	DM2			
1482	Occurrence counter 1	DM2			
1483	Occurrence counter 2	DM2			
1484	Occurrence counter 3	DM2			
1485	Occurrence counter 4	DM2			
1486	Occurrence counter 5	DM2			
1487	Occurrence counter 6	DM2			
1488	Occurrence counter 7	DM2			

Address	Content	SPN	Scaling	AGC-5C	Note
1489	Occurrence counter 8	DM2			
1490	Occurrence counter 9	DM2			
1491	Occurrence counter 10	DM2			
1777	Turbocharger Wastegate Actuator 1 Desired Position	5370	1/1	X	
1792	Maximum Crank Attempts per Start Attempt	3670	1/1	X	
1793	Turbocharger 1 Turbine Outlet Pressure	5541	1/100	X	
1794	Turbocharger 2 Turbine Outlet Pressure	5544	1/100	X	
1795	Engine Fuel System 1 Total Intake Mass Air Flow Rate	6393	1/100	X	
1796	Engine Fuel System 2 Total Intake Mass Air Flow Rate	8310	1/100	X	
1797	Engine Exhaust Pressure 2	5749	1/100	X	
1798	Crank Attempt Count on Present Start Attempt	3671	1/1	X	
1799	Lube Oil Pressure Threshold	8622	1/100	X	
1800	Knock Level cyl 1	1352	1/1	X	
1801	Knock Level cyl 2	1353	1/1	X	
1802	Knock Level cyl 3	1354	1/1	X	
1803	Knock Level cyl 4	1355	1/1	X	
1804	Knock Level cyl 5	1356	1/1	X	
1805	Knock Level cyl 6	1357	1/1	X	
1806	Knock Level cyl 7	1358	1/1	X	
1807	Knock Level cyl 8	1359	1/1	X	

Address	Content	SPN	Scaling	AGC-5C	Note
1808	Knock Level cyl 9	1360	1/1	X	
1809	Knock Level cyl 10	1361	1/1	X	
1810	Knock Level cyl 11	1362	1/1	X	
1811	Knock Level cyl 12	1363	1/1	X	
1824	Exhaust Port Temp cyl 1	1137	1/10	X	
1825	Exhaust Port Temp cyl 2	1138	1/10	X	
1826	Exhaust Port Temp cyl 3	1139	1/10	X	
1827	Exhaust Port Temp cyl 4	1140	1/10	X	
1828	Exhaust Port Temp cyl 5	1141	1/10	X	
1829	Exhaust Port Temp cyl 6	1142	1/10	X	
1830	Exhaust Port Temp cyl 7	1143	1/10	X	
1831	Exhaust Port Temp cyl 8	1144	1/10	X	
1832	Exhaust Port Temp cyl 9	1145	1/10	X	
1833	Exhaust Port Temp cyl 10	1146	1/10	X	
1834	Exhaust Port Temp cyl 11	1147	1/10	X	
1835	Exhaust Port Temp cyl 12	1148	1/10	X	
1844	Ignition Timing Cylinder 1	1413	1/10	X	
1845	Ignition Timing Cylinder 2	1414	1/10	X	
1846	Ignition Timing Cylinder 3	1415	1/10	X	
1847	Ignition Timing Cylinder 4	1416	1/10	X	
1848	Ignition Timing Cylinder 5	1417	1/10	X	

Address	Content	SPN	Scaling	AGC-5C	Note
1849	Ignition Timing Cylinder 6	1418	1/10	X	
1850	Ignition Timing Cylinder 7	1419	1/10	X	
1851	Ignition Timing Cylinder 8	1420	1/10	X	
1852	Ignition Timing Cylinder 9	1421	1/10	X	
1853	Ignition Timing Cylinder 10	1422	1/10	X	
1854	Ignition Timing Cylinder 11	1423	1/10	X	
1855	Ignition Timing Cylinder 12	1424	1/10	X	
1864	Spark Voltage Cylinder 1	1294	1/100	X	
1865	Spark Voltage Cylinder 2	1295	1/100	X	
1866	Spark Voltage Cylinder 3	1296	1/100	X	
1867	Spark Voltage Cylinder 4	1297	1/100	X	
1868	Spark Voltage Cylinder 5	1298	1/100	X	
1869	Spark Voltage Cylinder 6	1299	1/100	X	
1870	Spark Voltage Cylinder 7	1300	1/100	X	
1871	Spark Voltage Cylinder 8	1301	1/100	X	
1872	Spark Voltage Cylinder 9	1302	1/100	X	
1873	Spark Voltage Cylinder 10	1303	1/100	X	
1874	Spark Voltage Cylinder 11	1304	1/100	X	
1875	Spark Voltage Cylinder 12	1305	1/100	X	
1887	Battery Potential / P1	168	1/10	X	
1897	Knock Counter Cylinder 1		1/1	X	

Address	Content	SPN	Scaling	AGC-5C	Note
1898	Knock Counter Cylinder 2		1/1	X	
1899	Knock Counter Cylinder 3		1/1	X	
1900	Knock Counter Cylinder 4		1/1	X	
1901	Knock Counter Cylinder 5		1/1	X	
1902	Knock Counter Cylinder 6		1/1	X	
1903	Knock Counter Cylinder 7		1/1	X	
1904	Knock Counter Cylinder 8		1/1	X	
1905	Knock Counter Cylinder 9		1/1	X	
1906	Knock Counter Cylinder 10		1/1	X	
1907	Knock Counter Cylinder 11		1/1	X	
1908	Knock Counter Cylinder 12		1/1	X	

Address	Content	SPN	Scaling	AGC-5C	Note
1920	Operating State	3543		X	Bit state 0000b = Engine Stopped
					Bit state 0001b = Pre-Start
					Bit state 0010b = Starting
					Bit state 0011b = Warm-Up
					Bit state 0100b = Running
					Bit state 0101b = Cool-down
					Bit state 0110b = Engine Stopping
					Bit state 0111b = Post-Run
					Bit states 1000-1101b = available for SAE assignment
					Bit state 1110b = reserved
					Bit state 1111b = not available
1924	Fuel Shutoff 1 control	632		X	0 = Open (fuel supplied to engine)
					1 = Closed (no fuel supplied to engine)
					2 = Reserved
					3 = Don't care / take no action
1925	Fuel Shutoff 2 control	2807		X	0 = Open (fuel supplied to engine)
					1 = Closed (no fuel supplied to engine)
					2 = Reserved
					3 = Don't care / take no action

Address	Content	SPN	Scaling	AGC-5C	Note
1927	Oil Pressure Priming Pump Control	3589		X	0=Off
					1=On
1932	Controlled Shutdown Request	3606		X	0=Off
					1=On
					2=Reserved
					3=No action
1933	Emergency Shutdown Indication	3607		X	0=Off
					1=On
					2=Reserved
					3=No action
1934	Derate Request	3644	1/1	X	
1936	Fuel Valve Diff Pressure	1391	1/100	X	
1951	Pre Filter Oil Pressure	1208	1/10	X	
1952	Exhaust Gas Pressure	1209	1/100	X	
1954	Gas Mass Flow Rate 1	1241	1/10	X	
1959	Throttle Valve 1 Position	51	1/1	X	
1960	Throttle Valve 2 Position	3673	1/1	X	
1962	ECU Temperature	1136	1/10	X	
1976	Turbo Compr. Bypass Actuator 1 Command	3470	1/100	X	
1978	Turbo Compr. Bypass Actuator 1 Position	3675	1/1	X	
1988	Oil Priming Pump Switch	3550		X	0 = OFF
					1 = ON
					2 = Error

Address	Content	SPN	Scaling	AGC-5C	Note
1989	Oil Priming State	3551		X	0 = Not sufficiently lubricated
					1 = Sufficiently lubricated
					2 = Unable to determine if sufficiently lubricated
					3 = not installed / not available
1994	Engine Torque Mode	899		X	15 states

6 DMC 1000

6.1 DMC 1000 Modbus Register Map

6.1.1 DMC 1000 Modbus Parametric Data

NOTICE

Earlier versions of software may not support all of the Modbus registers in the following table. If a particular register is not available in your installation, it is possible that the Modbus connection is working but the controller software does not support that particular register.

NOTICE

If an address or bit is not listed in this table it is not implemented.

Addr	System Name	Access	Specifications		Description	Function
42001	MB Logical Read Address	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Lower Limit: .000 Upper Limit: 65535.000 Default: 0	Logical address to be read via Modbus	Communications
42002	MB Logical Read Data	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: Lower Limit: Upper Limit: Default:	Logical data to be read via Modbus	Communications
42009	Device Type	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Lower Limit: Upper Limit: Default:	Hard coded device type id = 52 (0x0034)	Communications
42010	Software Version	Read Only	Multiplier: 0.000100000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Lower Limit: Upper Limit: Default:	Software version number	Controller Information
42012	Current Fault Status	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Lower Limit: Upper Limit: Default:	The most recently occurring fault which is still active	Fault and Event Info

Addr	System Name	Access	Specifications		Description	Function
42018	Genset L1N Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Upper Limit: Default	Generator set L1N voltage	Voltage
42019	Genset L2N Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Upper Limit: Default	Generator set L2N voltage	Voltage
42020	Genset L3N Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Upper Limit: Default	Generator set L3N voltage	Voltage
42021	Genset LN Average Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Upper Limit: Default	Generator set LN average voltage	Voltage
42022	Genset L1L2 Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Upper Limit: Default:	Generator set L1L2 voltage	Voltage
42023	Genset L2L3 Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Upper Limit: Default:	Generator set L2L3 voltage	Voltage
42024	Genset L3L1 Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Upper Limit: Default:	Generator set L3L1 voltage	Voltage
42025	Genset LL Average Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Upper Limit: Default:	Generator set LL average voltage	Voltage

Addr	System Name	Access	Specifications		Description	Function
42026	Genset L1 Current	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Amps Lower Limit: Upper Limit: Default	Generator set L1 current	Current
42027	Genset L2 Current	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Amps Lower Limit: Upper Limit: Default	Generator set L2 current	Current
42028	Genset L3 Current	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Amps Lower Limit: Upper Limit: Default	Generator set L3 current	Current
42029	Genset Average Current	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Amps Lower Limit: Upper Limit: Default	Generator set average current	Current
42030	Genset L1 kW	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: Upper Limit: Default:	Generator set L1 kW	Current
42031	Genset L2 kW	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: Upper Limit: Default:	Generator set L2 kW	Current
42032	Genset L3 kW	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: Upper Limit: Default:	Generator set L3 kW	Power
42033	Genset Total kW	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: Upper Limit: Default:	Generator set total kW	Power

Addr	System Name	Access	Specifications		Description	Function
42034	Genset L1 kVAR	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kVAR Lower Limit: Upper Limit: Default:	Generator set L1 kVAR	Power
42035	Genset L2 kVAR	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kVAR Lower Limit: Upper Limit: Default:	Generator set L2 kVAR	Power
42036	Genset L3 kVAR	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kVAR Lower Limit: Upper Limit: Default:	Generator set L3 kVAR	Power
42037	Genset Total kVAR	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kVAR Lower Limit: Upper Limit: Default:	Generator set total kVAR	Power
42038	Genset Total Power Factor	Read Only	Multiplier: 0.010000000000 Offset: 0 Size (bits): 8 Sign: S	Unit: Lower Limit: Upper Limit: Default:	Generator set total power factor	Power
42039	Genset L1 kVA	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: kVA Lower Limit: Upper Limit: Default:	Generator set L1 kVA	Power
42040	Genset L2 kVA	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: kVA Lower Limit: Upper Limit: Default:	Generator Set L2 kVA	Power
42041	Genset L3 kVA	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: kVA Lower Limit: Upper Limit: Default:	Generator set L3 kVA	Power

Addr	System Name	Access	Specifications		Description	Function
42042	Genset Total kVA	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: kVA Lower Limit: kVA Upper Limit: kVA Default:	Generator set total kVA	Power
42043	MB Genset Frequency	Read Only	Multiplier: 0.100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Hz Lower Limit: Hz Upper Limit: Hz Default:	Generator set line frequency scaled by 10 = 1Hz for Modbus	Communications
42044	Genset Total Negative kWh	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: kWh Lower Limit: kWh Upper Limit: kWh Default:	Generator set total negative kWh accumulation	Energy
42046	Genset Total Positive kWh	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: kWh Lower Limit: kWh Upper Limit: kWh Default:	Generator set total positive kWh accumulation	Energy
42048	Genset Total Net kWh	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kWh Lower Limit: kWh Upper Limit: kWh Default:	Generator set total net kWh accumulation	Energy
42050	Genset Total Negative kVARh	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: kVARh Lower Limit: kVARh Upper Limit: kVARh Default:	Generator set total negative kVARh accumulation	Energy
42052	Genset Total Positive kVARh	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: kVARh Lower Limit: kVARh Upper Limit: kVARh Default:	Generator set total positive kVARh accumulation	Energy
42054	Genset Total Net kVARh	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kVARh Lower Limit: kVARh Upper Limit: kVARh Default:	Generator set total net kVARh accumulation	Energy

Addr	System Name	Access	Specifications		Description	Function
40056	Genset Total kVAh	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: kVAh Lower Limit: kVAh Upper Limit: kVAh Default:	Generator set total kVAh accumulation	Energy
42058	Genset Available Current	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Amps Lower Limit: Upper Limit: Default:	Calculated Amps which represent 100% generator set bus current -- used by barograph	Current
42059	Genset L1 Current Percent	Read Only	Multiplier: 0.100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: Upper Limit: Default:	Generator set L1 current as percent of generator set total current capacity--used by barograph	Current
42060	Genset L2 Current Percent	Read Only	Multiplier: 0.100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: Upper Limit: Default:	Generator set L2 current as percent of generator set total current capacity--used by barograph	Current
42061	Genset L3 Current Percent	Read Only	Multiplier: 0.100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: Upper Limit: Default:	Generator set L3 current as percent of generator set total current capacity--used by barograph	Current
42062	Genset Total kW Percent	Read Only	Multiplier: 0.100000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: % Lower Limit: Upper Limit: Default:	Generator set total kW as percent of total generator set capacity -- used by barograph	Power
42063	Genset Frequency Percent	Read Only	Multiplier: 0.100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: Upper Limit: Default:	Generator set frequency as percent of system frequency -- used by barograph	Frequency

Addr	System Name	Access	Specifications		Description	Function
42064	Genset L1L2 Voltage%	Read Only	Multiplier: 0.100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: Upper Limit: Default:	Generator set L1L2 voltage%	Voltage
42065	Genset L2L3 Voltage%	Read Only	Multiplier: 0.100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: Upper Limit: Default:	Generator set L2L3 voltage%	Voltage
42066	Genset L3L1 Voltage%	Read Only	Multiplier: 0.100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: Upper Limit: Default:	Generator set L3L1 voltage%	Voltage
42118	Utility L1N Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Upper Limit: Default: 0	Utility L1N voltage	Voltage
42119	Utility L2N Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Upper Limit: Default: 0	Utility L2N voltage	Voltage
42120	Utility L3N Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Upper Limit: Default: 0	Utility L3N voltage	Voltage
42121	Utility LN Average Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Upper Limit: Default: 0	Utility LN average voltage	Voltage
42122	Utility L1L2 Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Upper Limit: Default: 0	Utility L1L2 voltage	Voltage

Addr	System Name	Access	Specifications		Description	Function
42123	Utility L2L3 Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Upper Limit: Default: 0	Utility L2L3 voltage	Voltage
42124	Utility L3L1 Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Upper Limit: Default: 0	Utility L3L1 voltage	Voltage
42125	Utility LL Average Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Upper Limit: Default: 0	Utility LL average voltage	Voltage
42126	Utility L1 Current	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Amps Lower Limit: Upper Limit: Default:	Utility L1 current	Current
42127	Utility L2 Current	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Amps Lower Limit: Upper Limit: Default:	Utility L2 current	Current
42128	Utility L3 Current	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Amps Lower Limit: Upper Limit: Default:	Utility L3 current	Current
42129	Utility Average Current	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Amps Lower Limit: Upper Limit: Default:	Utility average current	Current
42130	Utility L1 kW	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: Upper Limit: Default:	Utility L1 kW	Power

Addr	System Name	Access	Specifications		Description	Function
42131	Utility L2 kW	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: Upper Limit: Default	Utility L2 kW	Power
42132	Utility L3 kW	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: Upper Limit: Default	Utility L3 kW	Power
42133	Utility Total kW	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: Upper Limit: Default	Utility total kW	Power
42134	Utility L1 kVARt	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kVAR Lower Limit: Upper Limit: Default	Utility L1 kVAR	Power
42135	Utility L2 kVAR	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kVAR Lower Limit: Upper Limit: Default	Utility L2 kVAR	Power
42136	Utility L3 kVAR	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kVAR Lower Limit: Upper Limit: Default:	Utility L3 kVAR	Power
42137	Utility Total kVAR	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kVAR Lower Limit: Upper Limit: Default:	Utility total kVAR	Power
42138	Utility Total Power Factor	Read Only	Multiplier: .010000000000 Offset: 0 Size (bits): 8 Sign: S	Unit: Lower Limit: Upper Limit: Default:	Utility total power factor	Power

Addr	System Name	Access	Specifications		Description	Function
42139	Utility L1 kVA	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: kVA Lower Limit: Upper Limit: Default:	Utility L1 kVA	Power
42140	Utility L2 kVA	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: kVA Lower Limit: Upper Limit: Default:	Utility L2 kVA	Power
42141	Utility L3 kVA	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: kVA Lower Limit: Upper Limit: Default:	Utility L3 kVA	Power
42142	Utility Total kVA	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: kVA Lower Limit: Upper Limit: Default:	Utility total kVA	Power
42143	MB Utility Frequency	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Hz Lower Limit: Upper Limit: Default:	Utility line frequency scaled by 10 = 1Hz for Modbus	Communications
42144	Utility Total Negative kWh	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: kWh Lower Limit: Upper Limit: Default:	Utility total negative kWh accumulation	Energy
42146	Utility Total Positive kWh	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: kWh Lower Limit: Upper Limit: Default:	Utility total positive kWh accumulation	Energy
42148	Utility Total Net kWh	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kWh Lower Limit: Upper Limit: Default:	Utility total net kWh accumulation	Energy

Addr	System Name	Access	Specifications		Description	Function
42150	Utility Total Negative kVARh	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: kVARh Lower Limit: Upper Limit: Default:	Utility total negative kVARh accumulation	Energy
42152	Utility Total Positive kVARh	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: kVARh Lower Limit: Upper Limit: Default:	Utility total positive kVARh accumulation	Energy
42154	Utility Total Net kVARh	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kVARh Lower Limit: Upper Limit: Default:	Utility total net kVARh accumulation	Energy
42156	Utility Total kVAh	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: kVARh Lower Limit: Upper Limit: Default:	Utility total kVAh accumulation	Energy
42158	System Total kW	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: Upper Limit: Default:	Sum of generator set bus and utility bus kW	Power
42159	System Total kVAR	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kVAR Lower Limit: Upper Limit: Default:	Sum of generator set bus and utility bus kVAR	Power
42160	System Total Power Factor	Read Only	Multiplier: 0.010000000000 Offset: 0 Size (bits): 8 Sign: S	Unit: Lower Limit: Upper Limit: Default:	System total power factor (totalized value of utility bus plus generator set bus)	Power
42161	System Total kVA	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: kVA Lower Limit: Upper Limit: Default:	Sum of generator set bus and utility bus kVA	Power

Addr	System Name	Access	Specifications		Description	Function
42162	Utility L1 Current Percent	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: Upper Limit: Default:	barograph	Current
42163	Utility L2 Current Percent	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: Upper Limit: Default:	barograph	Current
42164	Utility L3 Current Percent	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: Upper Limit: Default:	barograph	Current
42165	Utility Total kW Percent	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: % Lower Limit: Upper Limit: Default:	Utility total kW as percent of total utility capacity -- used by barograph	Power
42166	Utility Frequency Percent	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: Upper Limit: Default:	Utility frequency as percent of System Frequency -- used by barograph	Frequency
42167	Utility L1L2 Voltage%	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: Upper Limit: Default:	Utility L1L2 voltage%	Voltage
42168	Utility L2L3 Voltage%	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: Upper Limit: Default:	Utility L2L3 voltage%	Voltage
42169	Utility L3L1 Voltage%	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: Upper Limit: Default:	Utility L3L1 voltage%	Voltage

Addr	System Name	Access	Specifications		Description	Function
42200	Total Number of Gensets	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: Upper Limit: Default:	Number of generator sets with non-zero ratings entered	System Information
42201	Total System Capacity	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: Upper Limit: Default:	Sum of the generator set kW ratings	System Information
42202	Total Online Capacity	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: Upper Limit: Default:	Sum of the generator set kW ratings for generator sets which are online	System Information
42203	Programmed Transition Timer	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: Upper Limit: Default:	Countdown value of the programmed transition timer	PTC Timers
42204	Transfer Timer	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: Upper Limit: Default: 0	Countdown value of the transfer timer	PTC Timers
42205	Retransfer Timer	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: Upper Limit: Default:	Countdown value of the retransfer timer	PTC Timers
42206	Maximum Parallel Timer	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: Upper Limit: Default:	Countdown value of the maximum parallel timer	PTC Timers
42207	kW Load Reference	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: Upper Limit: Default:	kW control reference value for utility paralleling	Master Load Control

Addr	System Name	Access	Specifications		Description	Function
42212	Active Transition Timer	Read Only	Multiplier: .010000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: Upper Limit: Default:	Countdown timer value of active timer	PTC Timers
42213	Hardware Version	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: Lower Limit: Upper Limit: Default:	Indicates the hardware version of the board	Discrete Inputs
42214	Controller On Time	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: seconds Lower Limit: 0.000 Upper Limit: 4294967295.000 Default: 0.000	Amount of time in seconds controller has been powered	Controller Information
42220	kVAR Load Reference	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kVAR Lower Limit: Upper Limit: Default:	kVAR control reference value for extended paralleling	Master Load Control
42221	kVAR Load Setpoint Engr Units Display Value	Read Only	Multiplier: .010000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: % Lower Limit: Upper Limit: Default:	Engineering units value for the kVAR load setpoint analog input	Analog Inputs
42222	kW Load Setpoint Engr Units Display Value	Read Only	Multiplier: .010000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: % Lower Limit: Upper Limit: Default:	Engineering units value for the kW load setpoint analog input	Analog Inputs
42223	Power Factor Setpoint	Read Only	Multiplier: .010000000000 Offset: 0 Size (bits): 8 Sign: S	Unit: Lower Limit: Upper Limit: Default:	Power factor setpoint analog input value (uses kVAR load setpoint analog input)	Analog Inputs
42226	Sync Phase Difference	Read Only	Multiplier: .010000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: degrees Lower Limit: Upper Limit: Default:	Utility to generator set L1 voltage phase angle	Phase

Addr	System Name	Access	Specifications		Description	Function
42250	Current Add Level	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: Lower Limit: Upper Limit: Default:	Indicates the next level to add	Load Add Shed Control
42251	Current Shed Level	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: Lower Limit: Upper Limit: Default	Indicates the next level to shed	Load Add Shed Control
42291	Battery Voltage Engr Units Display Value	Read Only	Multiplier: .010000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: VDC Lower Limit: Upper Limit: Default	Engineering units value for the battery voltage analog input	Analog Inputs
42292	kVAR Master Load Control Output Predictor Value	Read Only	Multiplier: .010000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: VDC Lower Limit: Upper Limit: Default	Voltage level commanded to kVAR Master load control analog output	Analog Outputs
42293	kW Master Load Control Output Predictor Value	Read Only	Multiplier: .010000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: VDC Lower Limit: Upper Limit: Default	Voltage level commanded to kW Master load control analog output	Analog Outputs
42294	Master Frequency Bias Output Predictor Value	Read Only	Multiplier: .010000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: VDC Lower Limit: Upper Limit: Default	Voltage level commanded to Master frequency bias analog output	Analog Outputs
42295	Master Voltage Bias Output Predictor Value	Read Only	Multiplier: .010000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: VDC Lower Limit: Upper Limit: Default:	Voltage level commanded to Master voltage bias analog output	Analog Outputs
42305	Genset 01 kW Rating	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: 0.000 kW Upper Limit: 32000.00 kW Default: 1000.000	Sets gen1 kW rating	System Information

Addr	System Name	Access	Specifications		Description	Function
42306	Genset 02 kW Rating	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: 0.000 kW Upper Limit: 32000.00 kW Default: 0.000	Sets gen2 kW rating	System Information
42307	Genset 03 kW Rating	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: 0.000 kW Upper Limit: 32000.00 kW Default: 0.000	Sets gen3 kW rating	System Information
42308	Genset 04 kW Rating	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: 0.000 kW Upper Limit: 32000.00 kW Default: 0.000	Sets gen4 kW rating	System Information
42309	Genset 05 kW Rating	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: 0.000 kW Upper Limit: 32000.00 kW Default: 0.000	Sets gen5 kW rating	System Information
42310	Genset 06 kW Rating	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: 0.000 kW Upper Limit: 32000.00 kW Default: 0.000	Sets gen6 kW rating	System Information
42311	Genset 07 kW Rating	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: 0.000 kW Upper Limit: 32000.00 kW Default: 0.000	Sets gen7 kW rating	System Information
42312	Genset 08 kW Rating	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: 0.000 kW Upper Limit: 32000.00 kW Default: 0.000	Sets gen8 kW rating	System Information
42313	Genset 09 kW Rating	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: 0.000 kW Upper Limit: 32000.00 kW Default: 0.000	Sets gen9 kW rating	System Information

Addr	System Name	Access	Specifications		Description	Function
42314	Genset 10 kW Rating	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: 0.000 kW Upper Limit: 32000.00 kW Default: 0.000	Sets gen10 kW rating	System Information
42315	Genset 11 kW Rating	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: 0.000 kW Upper Limit: 32000.00 kW Default: 0.000	Sets gen11 kW rating	System Information
42316	Genset 12 kW Rating	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: 0.000 kW Upper Limit: 32000.00 kW Default: 0.000	Sets gen12 kW rating	System Information
42317	Programmed Transition Delay (TDPT)	Read/Write	Multiplier: 0.100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: 0.000 seconds Upper Limit: 60 seconds Default: 3.000	Sets the programmed transition time delay	PTC Timers
42318	Transfer Delay (TDNE)	Read/Write	Multiplier: 0.100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: 0.000 seconds Upper Limit: 120 seconds Default: 10.000	Sets the transfer time delay	PTC Timers
42319	Retransfer Delay (TDEN)	Read/Write	Multiplier: 0.100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: 0.000 seconds Upper Limit: 1800 seconds Default: 600.000	Sets the retransfer time delay	PTC Timers
42320	Maximum Parallel Time (TDMP)	Read/Write	Multiplier: 0.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit seconds Lower Limit: 0.000 seconds Upper Limit: 1800 seconds Default: 20.000	Sets the maximum parallel time for soft load transfers	PTC Timers
42321	Genset Bus %kW Setpoint	Read/Write	Multiplier: .010000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: % Lower Limit: -5.000 % Upper Limit: 105.000 % Default: 80.000	Sets %kW generator set output level for open loop base load extended paralleling	Master Load Control

Addr	System Name	Access	Specifications		Description	Function
42322	Genset Nominal Voltage	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: 110.000 Volts Upper Limit: 45000.000 Volts Default: 480.000	Generator set nominal voltage	AC Setup
42323	Utility Nominal Voltage	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: 110.000 Volts Upper Limit: 45000.000 Volts Default: 480.000	Utility nominal voltage	AC Setup
42324	Genset Center Frequency	Read/Write	Multiplier: 0.100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Hz Lower Limit: 45.000 Hz Upper Limit: 65.000 Hz Default: 60.000	Sets the center frequency for the generator set frequency sensor bandwidth settings	PTC Sensors
42325	Utility Center Frequency	Read/Write	Multiplier: 0.100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Hz Lower Limit: 45.000 Hz Upper Limit: 65.000 Hz Default: 60.000	Sets the center frequency for the utility frequency sensor bandwidth settings	PTC Sensors
42327	System Frequency	Read/Write	Multiplier: 0.100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Hz Lower Limit: 45.000 Hz Upper Limit: 65.000 Hz Default: 60.000	Use to define the system nominal frequency	System Information
42330	Genset Bus kW Setpoint	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: 0.000 kW Upper Limit: 32767.000 kW Default: 0.000	Sets the base load kW setpoint in closed loop extended paralleling	Master Load Control
42331	Genset Bus kVAR Setpoint	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kVAR Lower Limit: 0.000 kVAR Upper Limit: 32767 kVAR Default: 0.000	Sets the base load kVAR setpoint in closed loop extended paralleling	Master Load Control

Addr	System Name	Access	Specifications		Description	Function
42332	Genset Bus %kVAR Setpoint	Read/Write	Multiplier: .010000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: % Lower Limit: -5.000 % Upper Limit: 105.000 % Default: 0.000	Sets %kVAR generator set output level for open loop base load extended paralleling	Master Load Control
42333	Genset Bus Power Factor Setpoint	Read/Write	Multiplier: .010000000000 Offset: 0 Size (bits): 8 Sign: S	Unit: Lower Limit: 0.700 Upper Limit: 1.000 Default: 1.000	Sets the desired generator set bus power factor in closed loop extended paralleling	Master Load Control
42334	Genset Unloaded Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: -32768.000 kW Upper Limit: 32767 kW Default: 50.000	Setpoint for generator set unloaded level	Master Load Control
42337	Utility Bus kW Setpoint	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: -32768.000 kW Upper Limit: 32767 kW Default: 100.000	Sets the peak shave kW setpoint in closed loop extended paralleling	Master Load Control
42338	Utility Bus kW Constraint Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: -32768.000 kW Upper Limit: 32767.000 kW Default: 100.000	Sets the utility kW constraint level for base load extended paralleling	Master Load Control
42339	Utility Bus kVAR Setpoint	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kVAR Lower Limit: 32768.000 kVAR Upper Limit: 32767.000 kVAR Default: 100.000	Sets the peak shave kVAR setpoint in closed loop extended paralleling	Master Load Control
42340	Utility Bus Power Factor Setpoint	Read/Write	Multiplier: .010000000000 Offset: 0 Size (bits): 8 Sign: S	Unit: Lower Limit: 0.700 Upper Limit: 1.000 Default: 1.000	Sets the desired utility bus power factor in closed loop extended paralleling	Master Load Control
42341	Utility Unloaded Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: -32768.000 kW Upper Limit: 32767.000 kVAR Default: 50.000	Setpoint for utility unloaded level	Master Load Control

Addr	System Name	Access	Specifications		Description	Function
42348	Extended Parallel Ramp Load Time	Read/Write	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: 10.000 seconds Upper Limit: 900.000 seconds Default: 60.000	Sets ramp load time for extended paralleling	Master Load Control
42351	Fail To Synchronize Time	Read/Write	Multiplier: .200000000000 Offset: 0 Size (bits):16 Sign: U	Unit: seconds Lower Limit: 10.000 seconds Upper Limit: 900.000 seconds Default: 120.000	Sets the fail to synchronize diagnostic time delay	Master Sync Control
42354	Slip Frequency	Read/Write	Multiplier: .001000000000 Offset: 0 Size (bits):16 Sign: S	Unit: Hz Lower Limit: -3.000 Hz Upper Limit: 3.000 Hz Default: 0.100	Sets the synchronizer slip frequency (used when sync method is slip)	Master Sync Control
42355	Start Time Delay (TDES)	Read/Write	Multiplier: .100000000000 Offset: 0 Size (bits):16 Sign: U	Unit: seconds Lower Limit: 0.000 seconds Upper Limit: 3600.000 seconds Default: 0.000	Sets the generator sets start time delay	PTC Operating Mode
42356	Stop Time Delay (TDEC)	Read/Write	Multiplier: .100000000000 Offset: 0 Size (bits):16 Sign: U	Unit: seconds Lower Limit: 0.000 seconds Upper Limit: 3600.000 seconds Default: 0.000	Sets the generator sets stop time delay	PTC Operating Mode
42364	Genset Bus Load Add Delay	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: 0.000 seconds Upper Limit: 60.000 seconds Default: 1.000	Indicates delay between add levels when all generator sets are online and no utility	Load Add Shed Control
42365	Utility Bus Load Add Delay	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: 0.000 seconds Upper Limit: 60.000 seconds Default: 1.000	Indicates delay between add levels when on utility	Load Add Shed Control

Addr	System Name	Access	Specifications		Description	Function
42366	Load Shed Delay	Read/Write	Multiplier: .1000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: seconds Lower Limit: 1.000 seconds Upper Limit: 10.000 seconds Default: 1.000	Indicates delay between shed levels when on generator sets	Load Add Shed Control
42373	Load 1 Add Level	Read/Write	Multiplier: 1.0000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: Lower Limit: 1.000 Upper Limit: 6.000 Default: 1.000	Indicates which add level load 1 is assigned to	Load Add Shed Control
42374	Load 2 Add Level	Read/Write	Multiplier: 1.0000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: Lower Limit: 1.000 Upper Limit: 6.000 Default: 2.000	Indicates which add level load 2 is assigned to	Load Add Shed Control
42375	Load 3 Add Level	Read/Write	Multiplier: 1.0000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: Lower Limit: 1.000 Upper Limit: 6.000 Default: 3.000	Indicates which add level load 3 is assigned to	Load Add Shed Control
42376	Load 4 Add Level	Read/Write	Multiplier: 1.0000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: Lower Limit: 1.000 Upper Limit: 6.000 Default: 4.000	Indicates which add level load 4 is assigned to	Load Add Shed Control
42377	Load 5 Add Level	Read/Write	Multiplier: 1.0000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: Lower Limit: 1.000 Upper Limit: 6.000 Default: 5.000	Indicates which add level load 5 is assigned to	Load Add Shed Control
42378	Load 6 Add Level	Read/Write	Multiplier: 1.0000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: Lower Limit: 1.000 Upper Limit: 6.000 Default: 6.000	Indicates which add level load 6 is assigned to	Load Add Shed Control
42379	Load 1 Shed Level	Read/Write	Multiplier: 1.0000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: Lower Limit: 0.000 Upper Limit: 5.000 Default: 0.000	Indicates which shed level load 1 is assigned to	Load Add Shed Control

Addr	System Name	Access	Specifications		Description	Function
42380	Load 2 Shed Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: Lower Limit: 0.000 Upper Limit: 5.000 Default: 5.000	Indicates which shed level load 2 is assigned to	Load Add Shed Control
42381	Load 3 Shed Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: Lower Limit: 0.000 Upper Limit: 5.000 Default: 4.000	Indicates which shed level load 3 is assigned to	Load Add Shed Control
42382	Load 4 Shed Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: Lower Limit: 0.000 Upper Limit: 5.000 Default: 3.000	Indicates which shed level load 4 is assigned to	Load Add Shed Control
42383	Load 5 Shed Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: Lower Limit: 0.000 Upper Limit: 5.000 Default: 2.000	Indicates which shed level load 5 is assigned to	Load Add Shed Control
42384	Load 6 Shed Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: Lower Limit: 0.000 Upper Limit: 5.000 Default: 1.000	Indicates which shed level load 6 is assigned to	Load Add Shed Control
42386	Genset Bus %kW Overload Threshold	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: % Lower Limit: 80.000 % Upper Limit: 140.000 % Default: 105.000	Use to set the %kW threshold for gen bus overload condition	System Information
42387	Genset Bus kW Overload Delay	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: second Lower Limit: 0.000 second Upper Limit: 120.000 second Default: 60.000	Sets the delay time for overload based on kW	System Information
42388	Genset Bus Underfrequency Overload Threshold	Read/Write	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Hz Lower Limit: 0.100 Hz Upper Limit: 10.000 Hz Default: 3.000	Use to set the underfrequency offset threshold for gen bus overload condition	System Information

Addr	System Name	Access	Specifications		Description	Function
42389	Genset Bus Underfrequency Overload Delay	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: second Lower Limit: 0.000 Hz Upper Limit: 20.000 Hz Default: 3.000	Sets the delay time for overload based on frequency	System Information
42395	Load Demand Initial Delay	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: minute Lower Limit: 1.000 minute Upper Limit: 60.000 minute Default: 5.000	Sets the initial delay time before load demand will operate	Load Demand Control
42396	Load Demand Restart Percent	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: % Lower Limit: 20 % Upper Limit: 100 % Default: 80.000	Sets the load demand restart threshold (make larger than shutdown percent)	Load Demand Control
42397	Load Demand Run Hours Differential	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: Hours Lower Limit: 1.000 Hours Upper Limit: 500 Hours Default: 50.000	Sets run hours differential for restarting a generator set stopped due to load demand	Load Demand Control
42398	Load Demand Shutdown Delay	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: minute Lower Limit: 1.000 minute Upper Limit: 60.000 minute Default: 5.000	Sets the delay time between stopping generator sets due to load demand	Load Demand Control
42399	Load Demand Shutdown Percent	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: % Lower Limit: 20 % Upper Limit: 100 % Default: 60.000	Sets the load demand shutdown threshold (make smaller than restart percent)	Load Demand Control
42400	Genset Fail Time Delay	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: 10.000 seconds Upper Limit: 900.000 seconds Default: 60.000	Sets how long to wait for a generator set to come online before declaring it failed	Load Demand Control
42401	Util CB Fail to Close Delay	Read/Write	Multiplier: .020000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: 0.100 seconds Upper Limit: 1.000 seconds Default: 0.26	Sets the utility breaker fail to close time delay	Breaker Control

Addr	System Name	Access	Specifications		Description	Function
42402	Util CB Fail to Open Delay	Read/Write	Multiplier: .200000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: seconds Lower Limit: 0.200 seconds Upper Limit: 5.000 seconds Default: 1	Sets the utility breaker fail to open time delay	Breaker Control
42403	Util CB Recharge Delay	Read/Write	Multiplier: .020000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: 0.000 seconds Upper Limit: 60 seconds Default: 10.000	Sets the time to allow for utility breaker recharge	Breaker Control
42404	Gen CB Fail to Close Delay	Read/Write	Multiplier: .020000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: 0.100 seconds Upper Limit: 1.000 seconds Default: 0.260	Sets the generator set breaker fail to close time delay	Breaker Control
42405	Gen CB Fail to Open Delay	Read/Write	Multiplier: 0.200000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: seconds Lower Limit: 0.200 seconds Upper Limit: 5.000 seconds Default: 1.000	Sets the generator set breaker fail to open time delay	Breaker Control
42406	Gen CB Recharge Delay	Read/Write	Multiplier: .020000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: 0.000 seconds Upper Limit: 60.000 seconds Default: 10.000	Sets the time to allow for generator set breaker recharge	Breaker Control
42407	Permissive Phase Window	Read/Write	Multiplier: 0.010000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: degrees Lower Limit: 0.100 degrees Upper Limit: 20.000 degrees Default: 10.000	Sets the permissive +/- phase angle window for the sync check function	Master Sync Control
42408	Permissive Voltage Window	Read/Write	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: 0.5000 % Upper Limit: 10.000 % Default: 5.000	Sets the permissive +/- voltage acceptance window for the sync check function	Master Sync Control

Addr	System Name	Access	Specifications		Description	Function
42409	Permissive Window Time	Read/Write	Multiplier: .020000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: 0.500 seconds Upper Limit: 5.000 seconds Default: 0.500	Sets the permissive acceptance window dwell time for the sync check function	Master Sync Control
42410	Permissive Frequency Window	Read/Write	Multiplier: .001000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: Hz Lower Limit: 0.001 Hz Upper Limit: 1.000 Hz Default: 1.000	Sets the maximum frequency difference allowed for permissive close	Master Sync Control
42412	Sync Phase Offset	Read/Write	Multiplier: 0.010000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: degrees Lower Limit: -50.000 degrees Upper Limit: 50.000 degrees Default: 0.000	Sets a sync phase offset to accommodate sync across transformer with phase shift	Master Sync Control
42414	kW Kp	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Lower Limit: 0.000 Upper Limit: 1000.000 Default: 60.000	Proportional gain for kW closed loop control in extended paralleling	Master Load Control
42415	kW KI	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: Lower Limit: 0.000 Upper Limit: 255.000 Default: 60.000	Integral gain for kW closed loop control in extended paralleling	Master Load Control
42416	kVAR Kp	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Lower Limit: 0.000 Upper Limit: 1000.000 Default: 120.000	Proportional gain for kVAR closed loop control in extended paralleling	Master Load Control
42417	kVAR KI	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: Lower Limit: 0.000 Upper Limit: 255.000 Default: 50.000	Integral gain for kVAR closed loop control in extended paralleling	Master Load Control
42418	Scheduler Program Select	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: Lower Limit: 1.000 Upper Limit: 12.000 Default: 1.000	Selects which scheduler program to view or edit	System Scheduler

Addr	System Name	Access	Specifications		Description	Function
42423	Scheduler Program x Start Hour	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: hour Lower Limit: 0.000 hour Upper Limit: 23.000 hour Default: 0.000	Use to adjust start hour for the selected program	System Scheduler
42424	Scheduler Program x Start Minute	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: minute Lower Limit: 0.000 minute Upper Limit: 59.000 minute Default: 0.000	Use to adjust start minute for the selected program	System Scheduler
42425	Scheduler Program x Duration Hours	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: hour Lower Limit: 0.000 hour Upper Limit: 23.000 hour Default: 0.000	Use to adjust duration hours for the selected program	System Scheduler
42426	Scheduler Program x Duration Minutes	Read / Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: minute Lower Limit: 0.000 minute Upper Limit: 59.000 minute Default: 0.000	Use to adjust duration minutes for the selected program	System Scheduler
42427	Scheduler Exception Select	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: Lower Limit: 1.000 Upper Limit: 6.000 Default: 1.000	Selects which scheduler exception to view or edit	System Scheduler
42430	Scheduler Exception x Month	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: month Lower Limit: 1.000 month Upper Limit: 12.000 month Default: 1.000	Use to adjust the month of the selected exception	System Scheduler
42431	Scheduler Exception x Date	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: date Lower Limit: 1.000 date Upper Limit: 31.000 date Default: 1.000	Use to adjust the date of the selected exception	System Scheduler

Addr	System Name	Access	Specifications		Description	Function
42432	Scheduler Exception x Hour	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: hour Lower Limit: 0.000 hour Upper Limit: 23.000 hour Default: 0.000	Use to adjust the start hour of the selected exception	System Scheduler
42433	Scheduler Exception x Minute	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: minute Lower Limit: 0.000 minute Upper Limit: 59.000 minute Default: 0.000	Use to adjust the start minute of the selected exception	System Scheduler
42434	Scheduler Exception x Duration Days	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: days Lower Limit: 0.000 days Upper Limit: 44.000 days Default: 0.000	Use to adjust the duration days of the selected exception	System Scheduler
42435	Scheduler Exception x Duration Hours	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: hour Lower Limit: 0.000 hour Upper Limit: 23 hour Default: 0.000	Use to adjust the duration hours of the selected exception	System Scheduler
42436	Scheduler Exception x Duration Minutes	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: minute Lower Limit: 0.000 minute Upper Limit: 59.000 minute Default: 0.000	Use to adjust the duration minutes of the selected exception	System Scheduler
42440	Genset PT Primary Voltage	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: 110.000 Volts Upper Limit: 45000.000 Volts Default: 480	Generator Set PT primary voltage	AC Setup
42441	Genset PT Secondary Voltage	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: 110.000 Volts Upper Limit: 500 Volts Default: 120	Generator set PT secondary voltage	AC Setup
42442	Genset CT Primary Current	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Amp Lower Limit: 5.000 Amp Upper Limit: 10000.000 Amp Default: 100	Generator set CT primary current	AC Setup

Addr	System Name	Access	Specifications		Description	Function
42445	Utility PT Primary Voltage	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: 110.000 Volts Upper Limit: 45000.000 Volts Default: 480	Utility PT primary voltage	AC Setup
42446	Utility PT Secondary Voltage	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: 110.000 Volts Upper Limit: 500.000 Volts Default: 120	Utility PT secondary voltage	AC Setup
42447	Utility CT Primary Current	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Amps Lower Limit: 5.000 Amps Upper Limit: 10000.00 Amps Default: 100	Utility primary current	AC Setup
42449	Load Add Shed Required Online Capacity	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: 0.000 kW Upper Limit: 32000.000 kW Default: 0	Generator set kW capacity that must be online to start timed load add; 0 disables this	Load Add Shed Control
42450	Load Demand Minimum Online Capacity	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: 0.000 kW Upper Limit: 32767.000 kW Default: 0	Sets how much capacity must always be online regardless of what the load is	Load Demand Control
42451	Load Demand Restart Delay	Read/Write	Multiplier: 0.100000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: seconds Lower Limit: 0.000 seconds Upper Limit: 25.000 seconds Default: 1	Sets generator restart delay time to avoid nuisance restarts due to load transients	Load Demand Control
42452	Utility Available Current	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Amps Lower Limit: 1.000 Amps Upper Limit: 32000.000 Amps Default: 1000	barograph	AC Setup
42453	Total Utility Capacity	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: 1.000 kW Upper Limit: 32000.00 kW Default: 1000	Use to set how kW = 100% utility kW -- Used by barograph	AC Setup

Addr	System Name	Access	Specifications		Description	Function
42455	24 V High Battery Voltage Threshold	Read/Write	Multiplier: 0.010000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: VDC Lower Limit: 28.000 VDC Upper Limit: 34.000 VDC Default: 32	Sets 24V high battery voltage fault threshold	Battery Voltage Protection
42456	24 V Low Battery Voltage Threshold	Read/Write	Multiplier: 0.010000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: VDC Lower Limit: 22.000 VDC Upper Limit: 26.000 VDC Default: 24	Sets 24V low battery voltage fault threshold	Battery Voltage Protection
42457	12 V High Battery Voltage Threshold	Read/Write	Multiplier: 0.010000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: VDC Lower Limit: 14.000 VDC Upper Limit: 17.000 VDC Default: 16	Sets 12V high battery voltage fault threshold	Battery Voltage Protection
42458	12 V Low Battery Voltage Threshold	Read/Write	Multiplier: 0.010000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: VDC Lower Limit: 11.000 VDC Upper Limit: 13.000 VDC Default: 12	Sets 12V low battery voltage fault threshold	Battery Voltage Protection
42459	High Battery Voltage Set time	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: second Lower Limit: 2 second Upper Limit: 60 second Default: 60	Sets high battery voltage set time	Battery Voltage Protection
42460	Low Battery Voltage Set Time	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: second Lower Limit: 2 second Upper Limit: 60 second Default: 60	Sets low battery voltage set time	Battery Voltage Protection
42462	Genset Online Capacity Sensor Threshold	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: 0.000 kW Upper Limit: 32000.000 kW Default: 0	Sets the online kW threshold at which generator set bus is available for loading	PTC Sensors
42500	Fault Status BitMap 1	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: Lower Limit: Upper Limit: Default:	Bitmapped state of utility and other faults - 32 bits	Fault and Event Info

Addr	System Name	Access	Specifications		Description	Function
42502	Fault Status BitMap 2	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: Lower Limit: Upper Limit: Default:	Bitmapped state of generator set and other faults - 32 bits	Fault and Event Info
42505	Event Status BitMap 1	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: Lower Limit: Upper Limit: Default:	Bitmapped state of events - 32 bits	Fault and Event Info
42506	Genset Metering Fault Status	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Lower Limit: Upper Limit: Default:	Bitmapped word with status of generator set AC metering out of range conditions	AC Interrupt Service
42507	Utility Metering Fault Status	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Lower Limit: Upper Limit: Default:	Bitmapped word with status of utility AC metering out of range conditions	AC Interrupt Service
42704	Gen1 Online Time	Read Only	Multiplier: 0.000277778 Offset: 0 Size (bits): 32 Sign: U	Unit: Hours Lower Limit: 0.000 Hours Upper Limit: 1193046.000 Hours Default: 0	Total online time for Gen1	System Information
42706	Gen2 Online Time	Read Only	Multiplier: 0.000277778 Offset: 0 Size (bits): 32 Sign: U	Unit: Hours Lower Limit: 0.000 Hours Upper Limit: 1193046.000 Hours Default: 0	Total online time for Gen2	System Information
42708	Gen3 Online Time	Read Only	Multiplier: 0.000277778 Offset: 0 Size (bits): 32 Sign: U	Unit: Hours Lower Limit: 0.000 Hours Upper Limit: 1193046.000 Hours Default: 0	Total online time for Gen3	System Information
42710	Gen4 Online Time	Read Only	Multiplier: 0.000277778 Offset: 0 Size (bits): 32 Sign: U	Unit: Hours Lower Limit: 0.000 Hours Upper Limit: 1193046.000 Hours Default: 0	Total online time for Gen4	System Information

Addr	System Name	Access	Specifications		Description	Function
42717	Total Number of Gensets Online	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: Lower Limit: Upper Limit: Default:	Indicates how many of the defined Gen1 thru Gen4 generator sets are online	System Information
42718	Total Spare Online Capacity	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: Upper Limit: Default:	Difference between online capacity (4 generator sets) and Genset Bus Total kW	System Information
42719	Next Gen Restart Threshold	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: Upper Limit: Default:	Indicates kW threshold for gen bus at which the next generator set will restart	Load Demand Control
42720	Next Gen Shutdown Threshold	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: Upper Limit: Default:	Indicates kW threshold for gen bus at which the next generator set will load demand stop	Load Demand Control
42727	Genset Bus kW Overload Threshold	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: Upper Limit: Default:	Calculated kW overload threshold based on online capacity and % setting	System Information
42732	Modbus Bus Message Count	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Lower Limit: Upper Limit: Default:	Modbus bus message count	Communications
42733	Modbus CRC Error Count	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Lower Limit: Upper Limit: Default:	Modbus CRC error count	Communications
42734	Modbus Exception Count	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Lower Limit: Upper Limit: Default:	Modbus exception count	Communications

Addr	System Name	Access	Specifications		Description	Function
42735	Modbus No Response Count	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Lower Limit: Upper Limit: Default:	Modbus no response count	Communications
42736	Modbus Slave Message Count	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Lower Limit: Upper Limit: Default:	Modbus slave message count	Communications
42739	Clock Year	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: year Lower Limit: .000 year Upper Limit: 99.000 year Default:	Use to set or read current year	Real Time Clock
42740	Clock Month	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: month Lower Limit: 1.000 month Upper Limit: 12.000 month Default:	Use to set or read current month	Real Time Clock
42741	Clock Date	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: date Lower Limit: 1.000 date Upper Limit: 31.000 date Default:	Use to set or read current date	Real Time Clock
42742	Clock Hour	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: hour Lower Limit: .000 hour Upper Limit: 23.000 hour Default:	Use to set or read current hour	Real Time Clock
42743	Clock Minute	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: minute Lower Limit: .000 minute Upper Limit: 59.000 minute Default:	Use to set or read current minute	Real Time Clock
42744	Clock Second	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 8 Sign: U	Unit: seconds Lower Limit: .000 seconds Upper Limit: 59.000 seconds Default:	Use to set or read current seconds	Real Time Clock

Addr	System Name	Access	Specifications		Description	Function
42746	Start Timer	Read Only	Multiplier: 0.100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: Upper Limit: Default:	Countdown timer value for generator set start timer	PTC Operating Mode
42747	Stop Timer	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: Upper Limit: Default:	Countdown timer value for generator set stop timer	PTC Operating Mode
42748	Low Battery Voltage Threshold	Read Only	Multiplier: 0.010000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: VDC Lower Limit: Upper Limit: Default:	Battery voltage with respect to the set low battery threshold	Battery Voltage Protection
42749	High Battery Voltage Threshold	Read Only	Multiplier: 0.010000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: VDC Lower Limit: Upper Limit: Default:	Battery voltage with respect to set high battery threshold	Battery Voltage Protection

6.1.2 DMC 1000 Modbus Enumerated Data

NOTICE

Earlier versions of software may not support all of the Modbus registers in the following table. If a particular register is not available in your installation, it is possible that the Modbus connection is working but the controller software does not support that particular register.

NOTICE

If an address or bit is not listed in this table it is not implemented.

Addr.	System Name	Access	Specifications		Description	Function
42004	Save Adjustments	Read / Write	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Save Trims Default: Do Nothing	Save configuration parameters or adjustments to non-volatile memory. Perform Save Trims after all configurations have been updated. Do not save trims unless a change has occurred.	Controller Information
42011	Genset Run Sequence State	Read Only	Size (bits): 8 Number of Fields: 4	0: Time Delay Start 1: Time Delay Stop 2: Stop 3: Run Default:	Indicates state of the generator set run sequence	PTC Operating Mode
42017	Genset Bus Status	Read Only	Size (bits): 8 Number of Fields: 3	0: Unavailable 1: Dead 2: Live Default:	Energization status of the generator set bus	PTC Sensors
42117	Utility Bus Status	Read Only	Size (bits): 8 Number of Fields: 3	0: Unavailable 1: Dead 2: Live Default:	Energization status of the utility bus	PTC Sensors
42208	Utility Unload Status	Read Only	Size (bits): 8 Number of Fields: 3	0: Not Available 1: Not Unloaded 2: Unloaded Default:	Indicates utility unloaded status	Master Load Control
42209	Genset Unload Status	Read Only	Size (bits): 8 Number of Fields: 3	0: Not Available 1: Not Unloaded 2: Unloaded Default:	Indicates generator set unloaded status	Master Load Control

Addr.	System Name	Access	Specifications		Description	Function
42210	System State	Read / Write	Size (bits): 8 Number of Fields: 18	0: Not Available 1: TD Start 2: TD Stop 3: TD Programmed Transition 4: TD Transfer 5: TD Retransfer 6: Synchronizing 7: Sync Check OK 8: Inhibit 9: Unassigned 10: Ramp Unload 11: Ramp Load 12: Manual 13: Utility Failure 14: Test 15: Standby 16: Factory Test 17: Extended Parallel Default: Not Available	Indicates what state the control is currently in	System Information
42211	PTC Operating Mode	Read Only	Size (bits): 8 Number of Fields: 6	0: Manual 1: Normal 2: Normal Override 3: Test 4: Utility Fail 5: Extended Parallel Default:	Indicates the current PTC operating mode. Read/Write in Comp mode	PTC Operating Mode
42216	Genset Availability Status	Read Only	Size (bits): 8 Number of Fields: 3	0: Not Available 1: Available 2: Unknown Default:	Indicates availability of generator set for loading as determined by generator set sensors	Availability
42217	Utility Availability Status	Read Only	Size (bits): 8 Number of Fields: 3	0: Not Available 1: Available 2: Unknown Default:	Indicates availability of utility for loading as determined by utility sensors	Availability
42218	Gen CB Position Status	Read Only	Size (bits): 8 Number of Fields: 3	0: Open 1: Closed 2: Not Available Default:	Generator set breaker position	Breaker Control

Addr.	System Name	Access	Specifications		Description	Function
42219	Util CB Position Status	Read Only	Size (bits): 8 Number of Fields: 3	0: Open 1: Closed 2: Not Available Default:	Utility breaker position	Breaker Control
42224	PTC State	Read Only	Size (bits): 8 Number of Fields: 5	0: Not Enabled 1: No Source Connected 2: Utility Connected 3: Genset Connected 4: Paralleled Default:	Indicates the connected state of the power transfer control Read/Write in Comp.	PTC State Machine
42225	Sync Check Close Allowed	Read Only	Size (bits): 8 Number of Fields: 2	0: Not Allowed 1: Allowed Default:	Indicates whether any sync check conditions for have been met	Master Sync Control
42227	Synchronizer Status	Read Only	Size (bits): 8 Number of Fields: 2	0: Synchronizer Off 1: Synchronizer On Default:	Indicates state of the synchronizer	Master Sync Control
42228	System Lockout Status	Read Only	Size (bits): 8 Number of Fields: 2	0: Inactive 1: Active Default:	Faults have occurred which prevent normal system operation; reset faults	System Information
42229	Breaker 1 Position	Read Only	Size (bits): 8 Number of Fields: 3	0: Open 1: Closed 2: Not Available Default: Not Available	Indicates position status of breaker 1	Load Add Shed Control
42230	Breaker 2 Position	Read Only	Size (bits): 8 Number of Fields: 3	0: Open 1: Closed 2: Not Available Default: Not Available	Indicates position status of breaker 2	Load Add Shed Control
42231	Breaker 3 Position	Read Only	Size (bits): 8 Number of Fields: 3	0: Open 1: Closed 2: Not Available Default: Not Available	Indicates position status of breaker 3	Load Add Shed Control

Addr.	System Name	Access	Specifications		Description	Function
42232	Breaker 4 Position	Read Only	Size (bits): 8 Number of Fields: 3	0: Open 1: Closed 2: Not Available Default: Not Available	Indicates position status of breaker 4	Load Add Shed Control
42233	Breaker 5 Position	Read Only	Size (bits): 8 Number of Fields: 3	0: Open 1: Closed 2: Not Available Default: Not Available	Indicates position status of breaker 5	Load Add Shed Control
42234	Breaker 6 Position	Read Only	Size (bits): 8 Number of Fields: 3	0: Open 1: Closed 2: Not Available Default: Not Available	Indicates position status of breaker 6	Load Add Shed Control
42235	Breaker 1 Trip Status	Read Only	Size (bits): 8 Number of Fields: 3	0: Not Available 1: Normal 2: Tripped Default: Not Available	Indicates trip status of breaker 1	Load Add Shed Control
42236	Breaker 2 Trip Status	Read Only	Size (bits): 8 Number of Fields: 3	0: Not Available 1: Normal 2: Tripped Default: Not Available	Indicates trip status of breaker 2	Load Add Shed Control
42237	Breaker 3 Trip Status	Read Only	Size (bits): 8 Number of Fields: 3	0: Not Available 1: Normal 2: Tripped Default: Not Available	Indicates trip status of breaker 3	Load Add Shed Control
42238	Breaker 4 Trip Status	Read Only	Size (bits): 8 Number of Fields: 3	0: Not Available 1: Normal 2: Tripped Default: Not Available	Indicates trip status of breaker 4	Load Add Shed Control
42239	Breaker 5 Trip Status	Read Only	Size (bits): 8 Number of Fields: 3	0: Not Available 1: Normal 2: Tripped Default: Not Available	Indicates trip status of breaker 5	Load Add Shed Control
42240	Breaker 6 Trip Status	Read Only	Size (bits): 8 Number of Fields: 3	0: Not Available 1: Normal 2: Tripped Default: Not Available	Indicates trip status of breaker 6	Load Add Shed Control

Addr.	System Name	Access	Specifications		Description	Function
42241	ATS 1 Position	Read Only	Size (bits): 8 Number of Fields: 5	0: Not Available 1: No Source Connected 2: Source 1 Connected 3: Source 2 Connected 4: Paralleled Default: Not Available	Indicates position status of ATS 1	Load Add Shed Control
42242	ATS 2 Position	Read Only	Size (bits): 8 Number of Fields: 5	0: Not Available 1: No Source Connected 2: Source 1 Connected 3: Source 2 Connected 4: Paralleled Default: Not Available	Indicates position status of ATS 3	Load Add Shed Control
42243	ATS 3 Position	Read Only	Size (bits): 8 Number of Fields: 5	0: Not Available 1: No Source Connected 2: Source 1 Connected 3: Source 2 Connected 4: Paralleled Default: Not Available	Indicates position status of ATS 3	Load Add Shed Control
42244	ATS 4 Position	Read Only	Size (bits):8 Number of Fields: 5	0: Not Available 1: No Source Connected 2: Source 1 Connected 3: Source 2 Connected 4: Paralleled Default: Not Available	Indicates position status of ATS 4	Load Add Shed Control
42245	ATS 5 Position	Read Only	Size (bits): 8 Number of Fields: 5	0: Not Available 1: No Source Connected 2: Source 1 Connected 3: Source 2 Connected 4: Paralleled Default: Not Available	Indicates position status of ATS 5	Load Add Shed Control
42246	ATS 6 Position	Read Only	Size (bits): 8 Number of Fields: 5	0: Not Available 1: No Source Connected 2: Source 1 Connected 3: Source 2 Connected 4: Paralleled Default: Not Available	Indicates position status of ATS 6	Load Add Shed Control

Addr.	System Name	Access	Specifications		Description	Function
42248	PCCNet Communication Status	Read Only	Size (bits): 8 Number of Fields: 3	0: Failed 1: Good 2: Wait Default: Wait	Indicates status of PCCNet	Communications
42249	Expansion Board Communication	Read Only	Size (bits): 8 Number of Fields: 2	0: Disabled 1: Enabled Default: Disabled	Indicates the status of the SID to expansion board connection	Communications
42252	Add Level 1 Command	Read Only	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates status of add level 1	Load Add Shed Control
42253	Add Level 2 Command	Read Only	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates status of add level 2	Load Add Shed Control
42254	Add Level 3 Command	Read Only	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates status of add level 3	Load Add Shed Control
42255	Add Level 4 Command	Read Only	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates status of add level 4	Load Add Shed Control
42256	Add Level 5 Command	Read Only	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates status of add level 5	Load Add Shed Control
42257	Add Level 6 Command	Read Only	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates status of add level 6	Load Add Shed Control
42258	Shed Level 1 Command	Read / Write	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Shed Level Default: Do Nothing	Indicates status of shed level 1	Load Add Shed Control
42259	Shed Level 2 Command	Read Only	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Shed Level Default: Do Nothing	Indicates status of shed level 2	Load Add Shed Control
42260	Shed Level 3 Command	Read / Write	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Shed Level Default: Do Nothing	Indicates status of shed level 3	Load Add Shed Control
42261	Shed Level 4 Command	Read Only	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Shed Level Default: Do Nothing	Indicates status of shed level 4	Load Add Shed Control

Addr.	System Name	Access	Specifications		Description	Function
42262	Shed Level 5 Command	Read Only	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Shed Level Default: Do Nothing	Indicates status of shed level 5	Load Add Shed Control
42263	Manual add Level 1 Command	Read / Write	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Add Level Default: Do Nothing	Operator input to add loads assigned to level 1	Load Add Shed Control
42264	Manual add Level 2 Command	Read / Write	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Add Level Default: Do Nothing	Operator input to add loads assigned to level 2	Load Add Shed Control
42265	Manual add Level 3 Command	Read / Write	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Add Level Default: Do Nothing	Operator input to add loads assigned to level 3	Load Add Shed Control
42266	Manual add Level 4 Command	Read / Write	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Add Level Default: Do Nothing	Operator input to add loads assigned to level 4	Load Add Shed Control
42267	Manual add Level 5 Command	Read / Write	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Add Level Default: Do Nothing	Operator input to add loads assigned to level 5	Load Add Shed Control
42268	Manual add Level 6 Command	Read / Write	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Add Level Default: Do Nothing	Operator input to add loads assigned to level 6	Load Add Shed Control
42269	Manual Shed Level 1	Read / Write	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Shed Level Default: Do Nothing	Operator input to shed loads assigned to level 1	Load Add Shed Control
42270	Manual Shed Level 2	Read / Write	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Shed Level Default: Do Nothing	Operator input to shed loads assigned to level 2	Load Add Shed Control
42271	Manual Shed Level 3	Read / Write	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Shed Level Default: Do Nothing	Operator input to shed loads assigned to level 3	Load Add Shed Control
42272	Manual Shed Level 4	Read / Write	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Shed Level Default: Do Nothing	Operator input to shed loads assigned to level 4	Load Add Shed Control
42273	Manual Shed Level 5	Read / Write	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Shed Level Default: Do Nothing	Operator input to shed loads assigned to level 5	Load Add Shed Control

Addr.	System Name	Access	Specifications		Description	Function
42274	Restore Shed Level 1 Command	Read / Write	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Restore Level Default: Do Nothing	Indicates if shed level 1 has been restored	Load Add Shed Control
42275	Restore Shed Level 2 Command	Read / Write	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Restore Level Default: Do Nothing	Indicates if shed level 2 has been restored	Load Add Shed Control
42276	Restore Shed Level 3 Command	Read / Write	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Restore Level Default: Do Nothing	Indicates if shed level 3 has been restored	Load Add Shed Control
42277	Restore Shed Level 4 Command	Read / Write	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Restore Level Default: Do Nothing	Indicates if shed level 4 has been restored	Load Add Shed Control
42278	Restore Shed Level 5 Command	Read / Write	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Restore Level Default: Do Nothing	Indicates if shed level 5 has been restored	Load Add Shed Control
42279	Add Load 1 Command	Read Only	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Add Load Default: Do Nothing	Indicates add command for load 1	Load Add Shed Control
42280	Add Load 2 Command	Read Only	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Add Load Default: Do Nothing	Indicates add command for load 2	Load Add Shed Control
42281	Add Load 3 Command	Read Only	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Add Load Default: Do Nothing	Indicates add command for load 3	Load Add Shed Control
42282	Add Load 4 Command	Read Only	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Add Load Default: Do Nothing	Indicates add command for load 4	Load Add Shed Control
42283	Add Load 5 Command	Read Only	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Add Load Default: Do Nothing	Indicates add command for load 5	Load Add Shed Control
42284	Add Load 6 Command	Read Only	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Add Load Default: Do Nothing	Indicates add command for load 6	Load Add Shed Control
42285	Shed Load 1 Command	Read Only	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Shed Load Default: Do Nothing	Indicates shed command for load 1	Load Add Shed Control
42286	Shed Load 2 Command	Read Only	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Shed Load Default: Do Nothing	Indicates shed command for load 2	Load Add Shed Control

Addr.	System Name	Access	Specifications		Description	Function
42287	Shed Load 3 Command	Read Only	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Shed Load Default: Do Nothing	Indicates shed command for load 3	Load Add Shed Control
42288	Shed Load 4 Command	Read Only	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Shed Load Default: Do Nothing	Indicates shed command for load 4	Load Add Shed Control
42289	Shed Load 5 Command	Read Only	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Shed Load Default: Do Nothing	Indicates shed command for load 5	Load Add Shed Control
42290	Shed Load 6 Command	Read Only	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Shed Load Default: Do Nothing	Indicates shed command for load 6	Load Add Shed Control
42296	PTC Genset Operating Mode	Read Only	Size (bits):8 Number of Fields: 6	0: Manual 1: Normal 2: Normal Override 3: Test 4: Utility Fail 5: Extended Parallel Default:	Indicates the current operating mode of the generator sets	PTC Operating Mode
42297	PTC Transfer Pair Operating Mode	Read Only	Size (bits):8 Number of Fields: 6	0: Manual 1: Normal 2: Normal Override 3: Test 4: Utility Fail 5: Extended Parallel Default:	Indicates the current operating mode of the transfer pair	PTC Operating Mode
42298	PTC Operating Transition Type	Read Only	Size (bits): 8 Number of Fields: 3	0: Open Transition 1: Hard Closed Transition 2: Soft Closed Transition Default:	Indicates the transition type currently applicable to the PTC function operation	PTC Operating Mode
42300	System Topology	Read / Write	Size (bits): 8 Number of Fields: 6	0: Master Synchronize Only 1: Isolated Bus w/out GM 2: Isolated Bus w/GM 3: Common Bus 4: Transfer Pair 5: Component Mode Default: Master Synchronize Only	Main setting: Sets system topology; control must be in manual to set	Application Configuration

Addr.	System Name	Access	Specifications		Description	Function
42301	Transition Type	Read / Write	Size (bits):8 Number of Fields: 3	0: Open Transition 1: Hard Closed Transition 2: Soft Closed Transition Default: Open Transition	Sets the type of transition that will be used	Application Configuration
42302	Extended Parallel Enable	Read / Write	Size (bits): 8 Number of Fields: 2	0: Disabled 1: Enabled Default: Disabled	Use to enable extended paralleling operation	Application Configuration
42303	Load Demand Type	Read / Write	Size (bits): 8 Number of Fields: 3	0: None 1: Fixed Sequence 2: Run Hours Default: None	Sets load demand type	Load Demand Control
42304	Priority Control Method	Read / Write	Size (bits): 8 Number of Fields: 2	0: Manual 1: Automatic Default: Manual	Sets priority control method	Priority Control
42326	Test With Load Enable	Read / Write	Size (bits): 8 Number of Fields: 2	0: Disabled 1: Enabled Default: Disabled	Use to enable or disable load transfer during a test	Application Configuration
42328	Genset Bus kW Setpoint Source	Read / Write	Size (bits):8 Number of Fields: 2	0: Internal 1: Analog Input Default: Internal	selects where the generator set kW setpoint will come from for extended paralleling	Master Load Control
42329	Genset Bus kVAR Setpoint Source	Read / Write	Size (bits):8 Number of Fields: 2	0: Internal 1: Analog Input Default: Internal	Selects where the generator set kVAR setpoint will come from extended paralleling	Master Load Control
42335	Utility Bus kW Setpoint Source	Read / Write	Size (bits):8 Number of Fields: 2	0: Internal 1: Analog Input Default: Internal	Selects where the utility kW setpoint will come from for extended paralleling	Master Load Control
42336	Utility Bus kVAR Setpoint Source	Read / Write	Size (bits):8 Number of Fields: 2	0: Internal 1: Analog Input Default: Internal	Selects where the utility kVAR setpoint will come from extended paralleling	Master Load Control

Addr.	System Name	Access	Specifications		Description	Function
42342	Clear Fault History Table	Read / Write	Size (bits):8 Number of Fields: 2	0: Inactive 1: Active Default: Inactive	Use to completely clear the fault history table	Fault and Event Info
42343	Clear Occurrence Table	Read / Write	Size (bits):8 Number of Fields: 2	0: Inactive 1: Active Default: Inactive	Use to completely clear the counts in faults and events occurrence tables	Fault and Event Info
42344	Genset Reset All Energy Meters	Read / Write	Size (bits):8 Number of Fields: 2	0: Do Nothing 1: Clear Counters Default: Do Nothing	Use to permanently clear all generator set energy meter values	Energy
42345	Utility Reset All Energy Meters	Read / Write	Size (bits):8 Number of Fields: 2	0: Do Nothing 1: Clear Counters Default: Do Nothing	Use to permanently clear all utility energy meter values	Energy
42346	Extended Paralleling kW Load Control Type	Read / Write	Size (bits):8 Number of Fields: 4	0: Genset % Level (Open Loop) 1: Genset Bus kW (Closed Loop) 2: Genset Bus kW w/Utility (open Loop) 3: Utility Bus kW (Closed Loop) Default: Genset Bus % Level (Open Loop)	Sets how and where the kW will be controlled for extended parallel operation	Master Load Control
42347	Extended Paralleling kVAR Load Control Type	Read / Write	Size (bits):8 Number of Fields: 7	0: Genset Controllers 1: Genset Bus % Level (Open Loop) 2: Genset Bus Power Factor 3: Genset Bus kVAR (Closed Loop) 4: Genset Bus Power Factor (Closed Loop) 5: Utility Bus kVAR (Closed Loop) 6:Utility Bus Power Factor(Closed Loop) Default: Genset Controllers	Sets how and where the kVAR will be controlled for extended parallel operation	Master Load Control

Addr.	System Name	Access	Specifications		Description	Function
42349	Fail To Sync Lockout Enable	Read / Write	Size (bits):8 Number of Fields: 2	0: Disabled 1: Enabled Default: Disabled	Enable if want synchronizing to stop if fail to sync occurs	Master Sync Control
42350	Fail to Sync Open Transition Retransfer Enable	Read / Write	Size (bits):16 Number of Fields: 2	0: Disabled 1: Enabled Default: Disabled	Use to enable or disable an open transition retransfer upon a fail to sync	PTC State Machine
42352	Gen CB Manual Control	Read / Write	Size (bits):8 Number of Fields: 3	0: Closed Requested 1: No Command 2: Open Command Default: No Command	In manual mode, can be used to semi-manually control the generator set breaker	Breaker Control
42353	Util CB Manual Control	Read / Write	Size (bits):8 Number of Fields: 3	0: Closed Requested 1: No Command 2: Open Command Default: No Command	In manual mode, can be used to semi-manually control the utility breaker	Breaker Control
42357	Synchronizer Polarity	Read / Write	Size (bits):8 Number of Fields: 2	0: Normal 1: Invert Default: Normal	Use to invert synchronizer polarity	Master Sync Control
42358	Synchronize Method	Read / Write	Size (bits):8 Number of Fields: 2	0: Phase Match 1: Slip Frequency Default: Phase Match	Sets the synchronizing method	Master Sync Control
42359	Port Protocol Selection	Read / Write	Size (bits): 8 Number of Fields: 2	0: PCCNet 1: MON Default: PCCNet	Allows protocol CT the PCCNet port to be changed to MON for troubleshooting	Communications
42360	System Scheduler Enable	Read / Write	Size (bits): 8 Number of Fields: 2	0: Disabled 1: Enabled Default: Disabled	Use to enable or disable the system scheduler	System Scheduler
42361	Load Add Shed Enable	Read / Write	Size (bits): 8 Number of Fields: 2	0: Disabled 1: Enabled Default: Disabled	Use to enable or disable the load add shed feature	Load Add Shed Control
42362	Open Transition Retransfer Load Shed Enable	Read / Write	Size (bits): 8 Number of Fields: 2	0: Disabled 1: Enabled Default: Disabled	Use to enable or disable the shedding of loads during open transition retransfer	Load Add Shed Control

Addr.	System Name	Access	Specifications		Description	Function
42363	Auto/Manual Load Add Restore Mode	Read / Write	Size (bits): 8 Number of Fields: 2	0: Auto 1: Manual Default: Auto	Indicates automatic or manual load add restore operation	Load Add Shed Control
42367	Load 1 Device Type	Read / Write	Size (bits): 8 Number of Fields: 3	0: None 1: Breaker 2: ATS Default: None	Indicates type of load connection to load 1 add shed control and status I/O	Load Add Shed Control
42368	Load 2 Device Type	Read / Write	Size (bits): 8 Number of Fields: 3	0: None 1: Breaker 2: ATS Default: None	Indicates type of load connection to load 2 add shed control and status I/O	Load Add Shed Control
42369	Load 3 Device Type	Read / Write	Size (bits): 8 Number of Fields: 3	0: None 1: Breaker 2: ATS Default: None	Indicates type of load connection to load 3 add shed control and status I/O	Load Add Shed Control
42370	Load 4 Device Type	Read / Write	Size (bits): 8 Number of Fields: 3	0: None 1: Breaker 2: ATS Default: None	Indicates type of load connection to load 4 add shed control and status I/O	Load Add Shed Control
42371	Load 5 Device Type	Read / Write	Size (bits): 8 Number of Fields: 3	0: None 1: Breaker 2: ATS Default: None	Indicates type of load connection to load 5 add shed control and status I/O	Load Add Shed Control
42372	Load 6 Device Type	Read / Write	Size (bits):8 Number of Fields: 3	0: None 1: Breaker 2: ATS Default: None	Indicates type of load connected to load 6 add shed control and status I/O	Load Add Shed Control
42385	Genset Bus Overload Method	Read / Write	Size (bits):8 Number of Fields: 3	0: Both kW and Frequency 1: kW Only 2: Frequency Only Default: Both kW and Frequency	Use to choose method for determining generator bus overload condition	System Information

Addr.	System Name	Access	Specifications		Description	Function
42390	Load Demand Enable	Read / Write	Size (bits):8 Number of Fields: 2	0: Disabled 1: Enabled Default: Disabled	Use to enable or disable the load demand feature	Load Demand Control
42391	Load Demand GenA	Read / Write	Size (bits): 8 Number of Fields: 4	0: Gen1 1: Gen2 2: Gen3 3: Gen4 Default: Gen1	Sets GenA for fixed sequence load demand	Load Demand Control
42392	Load Demand GenB	Read / Write	Size (bits):8 Number of Fields: 4	0: Gen1 1: Gen2 2: Gen3 3: Gen4 Default: Gen2	Sets GenB for fixed sequence load demand	Load Demand Control
42393	Load Demand GenC	Read / Write	Size (bits):8 Number of Fields: 4	0: Gen1 1: Gen2 2: Gen3 3: Gen4 Default: Gen3	Sets GenC for fixed sequence load demand	Load Demand Control
42394	Load Demand GenD	Read / Write	Size (bits):8 Number of Fields: 4	0: Gen1 1: Gen2 2: Gen3 3: Gen4 Default: Gen4	Sets GenD (first to stop) for fixed sequence load demand	Load Demand Control
42413	System Phase Rotation	Read / Write	Size (bits):8 Number of Fields: 2	0: L1–L2–L3 1:L1–L3–L2 Default: L1–L2–L3	Defines what the system phase rotation sequence is	System Information
42419	Scheduler Program x Enable	Read / Write	Size (bits):8 Number of Fields: 2	0: Disable 1: Enable Default: Disable	Use to enable or disable the selected program	System Scheduler

Addr.	System Name	Access	Specifications		Description	Function
42420	Scheduler Program x Repeat Interval	Read / Write	Size (bits): 8 Number of Fields: 11	0: Once 1: Every Week 2: Every 2 Weeks 3: Every 3 Weeks 4: Every 4 Weeks 5: Every 5 Weeks 6: First Week of Month 7: Second Week of Month 8: Third Week of month 9: Forth Week of the Month 10: Last Week of the Month Default: Once	Use to adjust repeat interval for the selected program	System Scheduler
42421	Scheduler Program x Run Mode	Read / Write	Size (bits): 8 Number of Fields: 3	0: No Load 1: With Load 2: Extended Parallel Default: No Load	Use to adjust run mode for the selected program	System Scheduler
42422	Scheduler Program x Start Day	Read / Write	Size (bits): 8 Number of Fields: 7	0: Sunday 1: Monday 2: Tuesday 3: Wednesday 4: Thursday 5: Friday 6: Saturday Default: Sunday	Use to adjust start day of week for the selected program	System Scheduler
42428	Scheduler Exception x Enable	Read / Write	Size (bits): 8 Number of Fields: 2	0: Disable 1: Enable Default: Disable	Use to enable or disable the selected exception	System Scheduler
42429	Scheduler Exception x Repeat	Read / Write	Size (bits): 8 Number of Fields: 2	0: Once Only 1: Every Year Default: Once Only	Use to adjust the repeat setting of the selected exception	System Scheduler
42437	Daylight Saving Time Enable	Read / Write	Size (bits): 8 Number of Fields: 2	0: Disabled 1: Enabled Default: Disabled	Enables the daylight savings time feature	Real Time Clock
42438	Load Demand Refresh Sequence Command	Read / Write	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Refresh Sequence Default: Do Nothing	Use to force a refresh of the active load demand sequence	Load Demand Control

Addr.	System Name	Access	Specifications		Description	Function
42439	Genset Connection Type	Read / Write	Size (bits):8 Number of Fields: 2	0: Wye 1: Delta Default: Wye	Delta or Wye for generator set connection	AC Setup
42443	Genset CT Secondary Current	Read / Write	Size (bits): 8 Number of Fields: 2	0: 1 Amp 1: 5 Amp Default: 5 Amp	Generator set CT secondary current	AC Setup
42444	Utility Connection Type	Read / Write	Size (bits): 8 Number of Fields: 2	0: Wye 1: Delta Default: Wye	Delta or Wye for utility connection	AC Setup
42448	Utility CT Secondary Current	Read / Write	Size (bits): 8 Number of Fields: 2	0: 1 Amp 1: 5 Amp Default: 5 Amp	Utility CT secondary current	AC Setup
42454	Nominal Battery Voltage	Read / Write	Size (bits): 8 Number of Fields: 2	0: 12V 1: 24V Default: 24V	DC voltage provided to the control	Battery Voltage Protection
42461	Genset Online Capacity Sensor Enable	Read / Write	Size (bits): 8 Number of Fields: 2	0: Disable 1: Enable Default: Disable	Use to enable or disable the generator set online capacity sensor	PTC Sensors
42472	Gen Bus Base Load Status	Read Only	Size (bits):8 Number of Fields: 2	0: Inactive 1: Active Default:	Indicates that the generator bus is on base load extended paralleling	System Information
42473	Util Bus Peak Shave Status	Read Only	Size (bits): 8 Number of Fields: 2	0: Inactive 1: Active Default:	Indicates that the utility bus is on peak shave extended paralleling	System Information
42600	Extended Parallel Start Vol	Read / Write	Size (bits): 8 Number of Fields: 2	0: Stop 1: Start Default: Stop	State of extended parallel start volatile input	Discrete Inputs
42601	Synchronizer Enable Vol	Read / Write	Size (bits): 8 Number of Fields: 2	0: inactive 1: Active Default: inactive	State of synchronizer enable volatile input	Discrete Inputs
42602	Utility Source Failure Vol	Read / Write	Size (bits): 8 Number of Fields: 2	0: inactive 1: Active Default: inactive	State of utility source failure volatile input	Discrete Inputs
42603	Transfer Inhibit Vol	Read / Write	Size (bits):16 Number of Fields: 2	0: No Inhibit 1: Inhibit Default: No Inhibit	State of transfer inhibit volatile input	Discrete Inputs

Addr.	System Name	Access	Specifications		Description	Function
42604	Retransfer Inhibit Vol	Read / Write	Size (bits):8 Number of Fields: 2	0: No Inhibit 1: Inhibit Default: No Inhibit	State of retransfer inhibit volatile input	Discrete Inputs
42605	Gen CB Inhibit Vol	Read / Write	Size (bits): 8 Number of Fields: 2	0: No Inhibit 1: Inhibit Default: No Inhibit	State of generator CB inhibit volatile input	Discrete Inputs
42606	Util CB Inhibit Vol	Read / Write	Size (bits): 8 Number of Fields: 2	0: No Inhibit 1: Inhibit Default: No Inhibit	State of utility CB inhibit volatile input	Discrete Inputs
42607	Auto/Manual Vol	Read / Write	Size (bits): 8 Number of Fields: 2	0: Auto 1: Manual Default: Auto	State of auto/manual volatile input	Discrete Inputs
42608	Test Start Vol	Read / Write	Size (bits): 8 Number of Fields: 2	0: Stop 1: Start Default: Stop	State of test start volatile input	Discrete Inputs
42609	Fault Reset Vol	Read / Write	Size (bits): 8 Number of Fields: 2	0: Not Reset 1: Reset Default: Not Reset	State of fault reset volatile input	Discrete Inputs
42610	Override Vol	Read / Write	Size (bits): 8 Number of Fields: 2	0: No Override 1: Override Default: No Override	State of override volatile input	Discrete Inputs
42611	Extended Parallel Start Sw	Read Only	Size (bits): 8 Number of Fields: 2	0: Start 1: Stop Default:	State of extended parallel start input	Discrete Inputs
42612	Synchronizer Enable Sw	Read Only	Size (bits): 8 Number of Fields: 2	0: Inactive 1: Active Default:	State of synchronizer enable input	Discrete Inputs
42613	Utility Source Failure Sw	Read Only	Size (bits): 8 Number of Fields: 2	0: Inactive 1: Active Default:	State of utility source failure input	Discrete Inputs
42614	Transfer Inhibit Sw	Read Only	Size (bits): 8 Number of Fields: 2	0: No Inhibit 1: Inhibit Default:	State of transfer inhibit input	Discrete Inputs
42615	Retransfer Inhibit Sw	Read Only	Size (bits): 8 Number of Fields: 2	0: No Inhibit 1: Inhibit Default:	State of retransfer inhibit input	Discrete Inputs
42616	Gen CB Inhibit Sw	Read Only	Size (bits): 8 Number of Fields: 2	0: No Inhibit 1: Inhibit Default:	Sate of generator CB inhibit input	Discrete Inputs

Addr.	System Name	Access	Specifications		Description	Function
42617	Util CB Inhibit Sw	Read Only	Size (bits): 8 Number of Fields: 2	0: No Inhibit 1: Inhibit Default:	State of utility CB inhibit input	Discrete Inputs
42618	Auto/Manual Sw	Read Only	Size (bits): 8 Number of Fields: 2	0: Auto 1: Manual Default:	State of auto/manual input	Discrete Inputs
42619	Test Start Sw	Read Only	Size (bits): 8 Number of Fields: 2	0: Stop 1: Start Default:	State of test start input	Discrete Inputs
42620	Fault Reset Sw	Read Only	Size (bits): 8 Number of Fields: 2	0: No Reset 1: Reset Default:	State of fault reset input	Discrete Inputs
42621	Override Sw	Read Only	Size (bits): 8 Number of Fields: 2	0: No Override 1: Override Default:	State of override input	Discrete Inputs
42622	Master Inhibit	Read Only	Size (bits): 8 Number of Fields: 2	0: No Inhibit 1: Inhibit Default:	Indicates state of Master priority inhibit	Priority Control
42623	Gen CB Tripped Sw	Read Only	Size (bits): 8 Number of Fields: 2	0: Inactive 1: Active Default:	State of generator CB tripped input	Discrete Inputs
42624	Gen CB Tripped Vol	Read / Write	Size (bits): 8 Number of Fields: 2	0: Inactive 1: Active Default: Inactive	State of generator CB tripped volatile input	Discrete Inputs
42625	Util CB Tripped Sw	Read Only	Size (bits): 8 Number of Fields: 2	0: Inactive 1: Active Default:	State of utility CB tripped input	Discrete Inputs
42626	Util Cb Tripped Vol	Read / Write	Size (bits): 8 Number of Fields: 4	0: Inactive 1: Active Default: Inactive	State of utility CB tripped volatile input	Discrete Inputs
42627	Genset Phase Rotation	Read Only	Size (bits): 8 Number of Fields: 2	0: L1–L2–L3 1: L1–L3–L2 Default:	Generator set phase rotation	Phase
42628	Utility Phase Rotation	Read Only	Size (bits): 8 Number of Fields: 2	0: L1–L2–L3 1: L1–L3–L2 Default:	Utility phase rotation	Phase
42629	Gen1 CB Position Sw	Read Only	Size (bits): 8 Number of Fields: 2	0: Breaker Open 1: Breaker Closed Default:	State of Gen1 CB position input	Discrete Inputs

Addr.	System Name	Access	Specifications		Description	Function
42630	Gen1 CB Position Vol	Read / Write	Size (bits): 8 Number of Fields: 2	0: Breaker Open 1: Breaker Closed Default: Open	State of Gen1 CB position volatile input	Discrete Inputs
42631	Gen2 CB Position Sw	Read Only	Size (bits): 8 Number of Fields: 2	0: Breaker Open 1: Breaker Closed Default:	State of Gen2 CB position input	Discrete Inputs
42632	Gen2 CB Position Vol	Read / Write	Size (bits): 8 Number of Fields: 2	0: Breaker Open 1: Breaker Closed Default: Open	State of Gen2 CB position volatile input	Discrete Inputs
42633	Gen3 CB Position Sw	Read Only	Size (bits):16 Number of Fields: 2	0: Breaker Open 1: Breaker Closed Default:	State of Gen3 CB position input	Discrete Inputs
42634	Gen3 CB Position Vol	Read / Write	Size (bits): 8 Number of Fields: 2	0: Breaker Open 1: Breaker Closed Default: Open	State of Gen3 CB position volatile input	Discrete Inputs
42635	Gen4 CB Position Sw	Read Only	Size (bits): 8 Number of Fields: 2	0: Breaker Open 1: Breaker Closed Default:	State of Gen4 CB position input	Discrete Inputs
42636	Gen4 CB Position Vol	Read / Write	Size (bits): 8 Number of Fields: 2	0: Breaker Open 1: Breaker Closed Default: Open	State of Gen4 CB position volatile input	Discrete Inputs
42637	Network Master Inhibit	Read / Write	Size (bits): 8 Number of Fields: 2	0: No Inhibit 1: Inhibit Default: No Inhibit	Use to manually inhibit the module	Priority Control
42700	Gen1 Availability State	Read Only	Size (bits): 8 Number of Fields: 5	0: Gen Does Not Exist 1: Offline 2: Waiting for Gen 3: Online 4: Failed Default:	For load demand use - Indicates status of Gen1	Load Demand Control
42701	Gen2 Availability State	Read Only	Size (bits): 8 Number of Fields: 5	0: Gen Does Not Exist 1: Offline 2: Waiting for Gen 3: Online 4: Failed Default:	For load demand use - Indicates status of Gen2	Load Demand Control
42702	Gen3 Availability State	Read Only	Size (bits): 8 Number of Fields: 5	0:Gen Does Not Exist 1: Offline 2: Waiting for Gen 3: Online 4: Failed Default:	For load demand use - Indicates status of Gen3	Load Demand Control

Addr.	System Name	Access	Specifications		Description	Function
42703	Gen4 Availability State	Read Only	Size (bits): 8 Number of Fields: 5	0: Gen Does Not Exist 1: Offline 2: Waiting for Gen 3: Online 4: Failed Default:	For load demand use - Indicates status of Gen4	Load Demand Control
42712	GenA	Read Only	Size (bits): 8 Number of Fields: 4	0: Gen1 1: Gen2 2: Gen3 3: Gen4 Default:	Indicates which generator set is currently GenA for load demand	Load Demand Control
42713	GenB	Read Only	Size (bits): 8 Number of Fields: 4	0: Gen1 1: Gen2 1: Gen3 1: Gen4 Default:	Indicates which generator set is currently GenB for load demand	Load Demand Control
42714	GenC	Read Only	Size (bits): 8 Number of Fields: 4	0: Gen1 1: Gen2 1: Gen3 1: Gen4 Default:	Indicates which generator set is currently GenC for load demand	Load Demand Control
42715	GenD	Read Only	Size (bits): 8 Number of Fields: 4	0: Gen1 1: Gen2 1: Gen3 1: Gen4 Default:	Indicates which generator set is currently GenD (first to stop) for load demand	Load Demand Control
42716	Load Demand State	Read Only	Size (bits): 8 Number of Fields: 3	0: Off 1: Initial Delay Timing 2: Load Monitor Default:	Indicates operating state of the load demand control	Load Demand Control
42721	Next Gen To Restart	Read Only	Size (bits): 8 Number of Fields: 5	0: Gen1 1: Gen2 2: Gen3 3: Gen4 4: None Default:	Indicates which generator set is next to be restarted if load conditions are met	Load Demand Control
42722	Next Gen To Shutdown	Read Only	Size (bits): 8 Number of Fields: 5	0: Gen1 1: Gen2 2: Gen3 3: Gen4 4: None Default:	Indicates which generator set is next to be stopped if load conditions are met	Load Demand Control

Addr.	System Name	Access	Specifications		Description	Function
42723	Load Demand Gen1 Driver Status	Read Only	Size (bits): 8 Number of Fields: 2	0: Run 1: Load Demand Stop Default:	Status of the load demand Gen1 driver output	Discrete Outputs
42724	Load Demand Gen2 Driver Status	Read Only	Size (bits): 8 Number of Fields: 2	0: Run 1: Load Demand Stop Default:	Status of the load demand Gen2 driver output	Discrete Outputs
42725	Load Demand Gen3 Driver Status	Read Only	Size (bits): 8 Number of Fields: 2	0: Run 1: Load Demand Stop Default:	Status of the load demand Gen3 driver output	Discrete Outputs
42726	Load Demand Gen4 Driver Status	Read Only	Size (bits): 8 Number of Fields: 2	0: Run 1: Load Demand Stop Default:	Status of the load demand Gen4 driver output	Discrete Outputs
42728	Genset Bus kW Overload Status	Read Only	Size (bits): 8 Number of Fields: 2	0: No Overload 1: Overload Default:	Indicates whether generator bus is overloaded based on kW	System Information
42729	Genset Bus Underfrequency Overload Status	Read Only	Size (bits): 8 Number of Fields: 2	0: No Overload 1: Overload Default:	Indicates whether generator bus is overloaded based on frequency	System Information

Addr.	System Name	Access	Specifications		Description	Function
42730	Active Schedule	Read Only	Size (bits): 8 Number of Fields: 19	0: None 1: Program 1 2: Program 2 3: Program 3 4: Program 4 5: Program 5 6: Program 6 7: Program 7 8: Program 8 9: Program 9 10: Program 10 11: Program 11 12: Program 12 13: Exception 1 14: Exception 2 15: Exception 3 16: Exception 4 17: Exception 5 18: Exception 6 Default:	Indicates the currently active scheduler program or exception	System Scheduler
42731	Scheduler Run Command	Read Only	Size (bits): 8 Number of Fields: 4	0: Off 1: No Load 2: With Load 3: Extended Parallel Default:	Indicates current run command coming from the scheduler function	System Scheduler
42737	Modbus Clear Counters	Read / Write	Size (bits): 8 Number of Fields: 2	0: Do Nothing 1: Clear Counters Default: Do Nothing	Clears all the Modbus counters	Communications
42738	Clock Mode	Read / Write	Size (bits): 8 Number of Fields: 3	0: Normal 1: Set Clock 2: Save Clock Default: Normal	Use to set clock and save setting	Real Time Clock
42745	Clock Day	Read Only	Size (bits): 8 Number of Fields: 7	0: Sunday 1: Monday 2: Tuesday 3: Wednesday 4: Thursday 5: Friday 6: Saturday Default:	Indicates day of week for current date	Real Time Clock

6.1.3 DMC 1000 Modbus Bitmap Data

NOTICE

Earlier versions of software may not support all of the Modbus registers in the following table. If a particular register is not available in your installation, it is possible that the Modbus connection is working but the controller software does not support that particular register.

NOTICE

If an address or bit is not listed in this table, it is not implemented.

Addr.	Bit#	System Name	Fault Code	Event Name	Response
42500	0	Fault Status Bitmap 1	1455	Utility Main Breaker Position Contact Warning	Warning
42500	1	Fault Status Bitmap 1	2396	Utility Main Breaker Fail To Close Warning	Warning
42500	2	Fault Status Bitmap 1	2397	Utility Main Breaker Fail To Open Warning	Warning
42500	3	Fault Status Bitmap 1	1219	Utility Main Breaker Tripped Warning	Warning
42500	4	Fault Status Bitmap 1	1914	Utility Bus Phase Rotation Warning	Warning
42500	5	Fault Status Bitmap 1	1912	Utility Bus Loss Of Phase Warning	Warning
42500	6	Fault Status Bitmap 1	2331	Utility Bus Undervoltage Warning	Warning
42500	7	Fault Status Bitmap 1	2358	Utility Bus Overvoltage Warning	Warning
42500	8	Fault Status Bitmap 1	1223	Utility Bus Frequency Warning	Warning
42500	24	Fault Status Bitmap 1	2648	Remote I/O Communication Failure Warning	Warning
42500	25	Fault Status Bitmap 1	1689	Real Time Clock Power Interrupt Warning	Warning
42500	26	Fault Status Bitmap 1	1335	AC Metering Out Of Range Warning	Warning
42500	27	Fault Status Bitmap 1	1999	Maximum Parallel Time Warning	Warning
42500	28	Fault Status Bitmap 1	343	Hardware Failure Warning	Warning

Addr.	Bit#	System Name	Fault Code	Event Name	Response
42500	29	Fault Status Bitmap 1	1456	Synchronizer Output Limit Warning	Warning
42500	30	Fault Status Bitmap 1	2416	Calibration Checksum Warning	Warning
42500	31	Fault Status Bitmap 1	353	EEPROM Write Error Warning	Warning
42502	0	Fault Status Bitmap 2	1454	Genset Main Breaker Position Contact Warning	Warning
42502	1	Fault Status Bitmap 2	1452	Genset Main Breaker Fail To Close Warning	Warning
42502	2	Fault Status Bitmap 2	1453	Genset Main Breaker Tripped Warning	Warning
42502	3	Fault Status Bitmap 2	1328	Genset Bus Phase Rotation Warning	Warning
42502	4	Fault Status Bitmap 2	1915	Genset Bus Phase Rotation Warning	Warning
42502	5	Fault Status Bitmap 2	1913	Genset Bus Loss Of Phase Warning	Warning
42502	6	Fault Status Bitmap 2	1225	Genset Bus Undervoltage Warning	Warning
42502	7	Fault Status Bitmap 2	1224	Genset Bus Overvoltage Warning	Warning
42502	8	Fault Status Bitmap 2	1226	Genset Bus Frequency Warning	Warning
42502	24	Fault Status Bitmap 2	1541	Genset Failed To Come Online Warning	Warning
42502	25	Fault Status Bitmap 2	2647	Load Demand Setup Warning	Warning
42502	26	Fault Status Bitmap 2	1444	Genset Bus Overload Warning	Warning
42502	27	Fault Status Bitmap 2	1989	kW Load Control Output Limit Warning	Warning
42502	28	Fault Status Bitmap 2	1991	kVAR Load Control Output Limit Warning	Warning
42502	29	Fault Status Bitmap 2	1121	Fail To Disconnect Warning	Warning
42502	30	Fault Status Bitmap 2	1458	Synchronizer Phase Rotation Mismatch Warning	Warning
42502	31	Fault Status Bitmap 2	1457	Fail To Synchronizer Warning	Warning

Addr.	Bit#	System Name	Fault Code	Event Name	Response
42505	0	Event Status Bitmap 1	1222	Not in Automatic Event	Event
42505	1	Event Status Bitmap 1	1483	Common Warning Event	Event
42505	2	Event Status Bitmap 1	2965	Genset Bus Available Event	Event
42505	3	Event Status Bitmap 1	2328	Utility Bus Available Event	Event
42505	4	Event Status Bitmap 1	2333	Genset Bus Connected Event	Event
42505	5	Event Status Bitmap 1	2332	Utility Bus Connected Event	Event
42505	6	Event Status Bitmap 1	2971	Test / Extended Parallel Event	Event
42505	7	Event Status Bitmap 1	1916	Synchronized Event	Event
42505	8	Event Status Bitmap 1	1534	Load Control Output Event	Event

7 DMC 1500

7.1 DMC 1500 Communication Server 1

7.1.1 Modbus Address: 2 (Slave)

NOTICE

If an address or bit is not listed in this table, it is not implemented.

NOTICE

The external device can read 1-40 contiguous registers, write 1-40 contiguous registers, or read diagnostic counters.

Modbus Address	Bit #	Alarm Event
40001	0 (LSB)	Utility Main Breaker Position Contact Warning
40001	1	Utility Main Breaker Fail To Close Warning
40001	2	Utility Main Breaker Fail To Open Warning
40001	3	Utility Main Breaker Tripped Warning
40001	4	Utility Bus Phase Rotation Warning
40001	5	Utility Bus Loss of Phase Warning
40001	6	Utility Bus Undervoltage Warning
40001	7	Utility Bus Overvoltage Warning
40001	8	Utility Bus Frequency Warning
40001	9	Remote IO Comm Failure Warning
40001	10	Real Time Clock Power Interrupt Warning
40001	11	AC Metering Out Of Range Warning
40001	12	Maximum Parallel Time Warning
40001	13	Not Implemented
40001	14	Synchronizer Output Limit Warning
40001	15 (MSB)	Calibration Checksum Warning MCM 3320

Modbus Address	Bit #	Alarm Event
40002	0 (LSB)	EEPROM Write Error Warning MCM 3320
40002	1	Genset Main Breaker Position Contact Warning

Modbus Address	Bit #	Alarm Event
40002	2	Genset Main Breaker Fail to Close Warning
40002	3	Genset Main Breaker Fail to Open Warning
40002	4	Genset Main Breaker Tripped Warning
40002	5	Genset Bus Phase Rotation Warning
40002	6	Genset Bus Loss of Phase Warning
40002	7	Genset Bus Undervoltage Warning
40002	8	Genset Bus Overvoltage Warning
40002	9	Genset Bus Frequency Warning
40002	10	Low Battery Voltage Warning MCM 3320
40002	11	High Battery Voltage Warning MCM 3320
40002	12	Genset Failed to Come Online Warning
40002	13	Load Demand Setup Warning
40002	14	Genset Bus Over Load Limit Warning
40002	15 (MSB)	kW Load Control Output Limit Warning

Modbus Address	Bit #	Alarm Event
40003	0 (LSB)	kVAR Load Control Output Limit Warning
40003	1	Fail to Disconnect Warning
40003	2	Synchronizer Phase Rotation Mismatch Warning
40003	3	Fail to Synchronize Warning
40003	4	Normal Operation Lockout
40003	5	Common Warning MCM 3320
40003	6	Common Server 1 to Network ATS Comm Failure
40003	7	Common Server 1 to MCM3320 Comm Failure
40003	8	Common Server 1 Battery Warning
40003	9	Common Server 1 Comm Server 2 Comm Failure
40003	10	Not Implemented
40003	11	Not Implemented
40003	12	Not Implemented
40003	13	Not Implemented
40003	14	Not Implemented
40003	15 (MSB)	Not Implemented

Modbus Address	Bit #	Alarm Event
40004	0 (LSB)	Feeder Breaker 1 Trip
40004	1	Feeder Breaker 2 Trip
40004	2	Feeder Breaker 3 Trip
40004	3	Feeder Breaker 4 Trip
40004	4	Feeder Breaker 5 Trip
40004	5	Feeder Breaker 6 Trip
40004	6	Feeder Breaker 7 Trip
40004	7	Feeder Breaker 8 Trip
40004	8	Feeder Breaker 9 Trip
40004	9	Feeder Breaker 10 Trip
40004	10	Not Implemented
40004	11	Not Implemented
40004	12	Not Implemented
40004	13	Not Implemented
40004	14	Not Implemented
40004	15 (MSB)	Not Implemented

NOTICE

40005 is not implemented.

Modbus Address	Bit #	Alarm Event
40006	0 (LSB)	System in Auto-Opened Transition
40006	1	System in Auto-Hard Closed Transition
40006	2	System in Auto-Soft Closed Transition
40006	3	System Manual Mode Active
40006	4	System Automatic Mode Active
40006	5	Common Warning Event
40006	6	Genset Bus Available Event
40006	7	Utility Bus Available Event
40006	8	Genset Bus Connected Event
40006	9	Utility Bus Connected Event
40006	10	Synchronized Event
40006	11	Load Control Output Event

Modbus Address	Bit #	Alarm Event
40006	12	Genset Source Unloaded Event
40006	13	Utility Source Unloaded Event
40006	14	Genset Bus Load Event
40006	15 (MSB)	Utility Bus Peak Shave Event

Modbus Address	Bit #	Alarm Event
40007	0 (LSB)	Extended Paralleling Enable
40007	1	Extended Paralleling Disable
40007	2	System in Extended Parallel
40007	3	System in Test with Load
40007	4	System in Test without Load
40007	5	System Test Off
40007	6	Load Demand Enable
40007	7	Load Demand Disable
40007	8	Extended Parallel Off
40007	9	Not Implemented
40007	10	Not Implemented
40007	11	Not Implemented
40007	12	Not Implemented
40007	13	Not Implemented
40007	14	Not Implemented
40007	15 (MSB)	Not Implemented

7.1.2 Generator Set Bus Data

Generator Bus Data	MB Address	Data Type	Multiplier	Units
Generator Set L1N Volts	40009	16U	1	Volts
Generator Set L2N Volts	40010	16U	1	Volts
Generator Set L3N Volts	40011	16U	1	Volts
Generator Set LN Average Volt	40012	16U	1	Volts
Generator set L1L2 Volts	40013	16U	1	Volts
Generator Set L2L3 Volts	40014	16U	1	Volts
Generator Set L3L1 Volts	40015	16U	1	Volts
Generator Set LL Average Volts	40016	16U	1	Volts

Generator Bus Data	MB Address	Data Type	Multiplier	Units
Generator Set L1 Current	40017	16U	1	Amps
Generator Set L2 Current	40018	16U	1	Amps
Generator Set L3 Current	40019	16U	1	Amps
Generator Set Average Current	40020	16U	1	Amps
Generator Set L1 kW	40021	16S	1	kW
Generator Set L2 kW	40022	16S	1	kW
Generator Set L3 kW	40023	6S	1	kW
Generator Set Total kW	40024	16S	1	kW
Generator Set L1 kVAR	40025	16S	1	kVAR
Generator Set L2 kVAR	40026	16S	1	kVAR
Generator Set L3 kVAR	40027	16S	1	kVAR
Generator Set Total kVAR	40028	16S	1	kVAR
Generator Set Total Power Factor	40029	16S	0.01	
Generator Set L1 kVA	40030	16U	1	kVA
Generator Set L2 kVA	40031	16U	1	kVA
Generator Set L3 kVA	40032	16U	1	kVA
Generator Set Total kVA	40033	16U	1	kVA
MB Generator Set Frequency	40034	16U	0.1	Hz
Generator Set Total Negative kWh	40035	32U	1	kWh
	40036			
Generator Set Total Positive kWh	40037	32U	1	kWh
	40038			
Generator Set Total Net kWh	40039	32S	1	kWh
	40040			
Generator Set Total Negative kVARh	40041	32U	1	kVARh
	40042			
Generator Set Total Positive kVARh	40043	32U	1	kVARh
	40044			
Generator Set Total Net kVARh	40045	32S	1	kVARh
	40046			
Generator Set Total kVAh	40047	32U	1	kVAh
	40048			
Generator Set Available Current	40049	16U	1	Amps
Generator Set L1 Current Percent	40050	16U	0.1	%

Generator Bus Data	MB Address	Data Type	Multiplier	Units
Generator Set L2 Current Percent	40051	16U	0.1	%
Generator Set L3 Current Percent	40052	16U	0.1	%
Generator Set Total kW Percent	40053	16U	0.1	%
Generator Set Frequency Percent	40054	16S	0.1	%
Generator Set L1L2 Voltage Percent	40055	16U	0.1	%
Generator Set L2L3 Voltage Percent	40056	16U	0.1	%
Generator Set L3L1 Voltage Percent	40057	16U	0.1	%

7.1.3 Utility Bus Data

Utility Bus Data	MB Address	Data Type	Multiplier	Units
Utility L1N Voltage	40059	16U	1	Volts
Utility L2N Voltage	40060	16U	1	Volts
Utility L3N Voltage	40061	16U	1	Volts
Utility LN Average Voltage	40062	16U	1	Volts
Utility L1L2 Voltage	40063	16U	1	Volts
Utility L2L3 Voltage	40064	16U	1	Volts
Utility L3L1 Voltage	40065	16U	1	Volts
Utility LL Average Voltage	40066	16U	1	Volts
Utility L1 Current	40067	16U	1	Amps
Utility L2 Current	40068	16U	1	Amps
Utility L3 Current	40069	16U	1	Amps
Utility Average Current	40070	16U	1	Amps
Utility L1 kW	40071	16S	1	kW
Utility L2 kW	40072	16S	1	kW
Utility L3 kW	40073	16S	1	kW
Utility Total kW	40074	16S	1	kW
Utility L1 kVAR	40075	16S	1	kVAR
Utility L2 kVAR	40076	16S	1	kVAR
Utility L3 kVAR	40077	16S	1	kVAR
Utility Total kVAR	40078	16S	1	kVAR
Utility Total Power Factor	40079	16S	0.01	
Utility L1 kVA	40080	16U	1	kVA
Utility L2 kVA	40081	16U	1	kVA
Utility L3 kVA	40082	16U	1	kVA

Utility Bus Data	MB Address	Data Type	Multiplier	Units
Utility Total kVA	40083	16U	1	kVA
MB Utility Frequency	40084	16U	0.1	Hz
Utility Total Negative kWh	40085	32U	1	kWh
	40086			
Utility Total Positive kWh	40087	32U	1	kWh
	40088			
Utility Total Net kWh	40089	32S	1	kWh
	40090			
Utility Total Negative kVARh	40091	32U	1	kVARh
	40092			
Utility Total Positive kVARh	40093	32U	1	kVARh
	40094			
Utility Total Net kVARh	40095	32S	1	kVARh
	40096			
Utility Total kVAh	40097	32U	1	kVAh
	40098			
System Total kW	40099	16S	1	kW
System Total kVAR	40100	16S	0.01	kVAR
System Total Power Factor	40101	16S	1	
System Total kVA	40102	16U	1	KVA

7.1.4 ATS 1-5 DATA

ATS Raw Data	ATS 1	ATS 2	ATS 3	ATS 4	ATS 5	Multiplier	Units
Device Type	40257	40317	40377	40437	40497		
Mode (See Table 14 on page 275)	40258	40318	40378	40438	40498		
State (See Table 13 on page 275)	40259	40319	40379	40439	40499		
Fault Code	40260	40320	40380	40440	40500		
Fault Type (See Table 15 on page 276)	40261	40321	40381	40441	40501		
Percent Amps	40262	40322	40382	40442	40502	0.5	%
Total kW	40263	40323	40383	40443	40503		
NFPA 110 (See Table 5 on page 12)	40264	40324	40384	40444	40504		
NFPA Extended(See Table 6 on page 12)	40265	40325	40385	40445	40505		

ATS Raw Data	ATS 1	ATS 2	ATS 3	ATS 4	ATS 5	Multiplier	Units
Frequency Load	40266	40326	40386	40446	40506	0.1	Hz
Total pf Load	40267	40327	40387	40447	40507	0.00005	pf
Total kVA Load	40268	40328	40388	40448	40508		kVA
Total kW Load	40269	40329	40389	40449	40509		kW
Total kVAR Load	40270	40330	40390	40450	40510		kVAR
Volts ab Load	40271	40331	40391	40451	40511		Volts
Volts bc Load	40272	40332	40392	40452	40512		Volts
Volts ca Load	40273	40333	40393	40453	40513		Volts
Volts a Load	40274	40334	40394	40454	40514		Volts
Volts b Load	40275	40335	40395	40455	40515		Volt
Volts c Load	40276	40336	40396	40456	40516		Volts
Amps a Load	40277	40337	40397	40457	40517		Amps
Amps b Load	40278	40338	40398	40458	40518		Amps
Amps c Load	40279	40339	40399	40459	40519		Amps
Percent Amps a Load	40280	40340	40400	40460	40520	0.5	%
Percent Amps b Load	40281	40341	40401	40461	40521	0.5	%
Percent Amps c Load	40282	40342	40402	40462	40522	0.5	%
Frequency SRC1	40283	40343	40403	40463	40523	0.1	Hz
Total pf SRC1	40284	40344	40404	40464	40524	0.00005	PF
Total kVA SRC1	40285	40345	40405	40465	40525		
Total kW SRC1	40286	40346	40406	40466	40526		
Total kVAR SRC1	40287	40347	40407	40467	40527		
Volts ab SRC1	40288	40348	40408	40468	40528		
Volts bc SRC1	40289	40349	40409	40469	40529		
Volts ca SRC1	40290	40350	40410	40470	40530		
Volts a SRC1	40291	40351	40411	40471	40531		
Volts b SRC1	40292	40352	40412	40472	40532		Volts
Volts c SRC1	40293	40353	40413	40473	40533		
Amps a SCR1	40294	40354	40414	40474	40534		Amps
Amps b SCR1	40295	40355	40415	40475	40535		
Amps c SRC1	40296	40356	40416	40476	40536		
Percent Amps a SCR1	40297	40357	40417	40477	40537	0.5	%
Percent Amps b SCR1	40298	40358	40418	40478	40538	0.5	%
Percent Amps c SCR1	40299	40359	40419	40479	40539	0.5	%

ATS Raw Data	ATS 1	ATS 2	ATS 3	ATS 4	ATS 5	Multiplier	Units
Frequency SRC2	40300	40360	40420	40480	40540	0.1	Hz
Total pf SRC2	40301	40361	40421	40481	40541	0.00005	pf
Total kVA SRC2	40302	40362	40422	40482	40542		kVA
Total kW SRC2	40303	40363	40423	40483	40543		kW
Total kVAR SRC2	40304	40364	40424	40484	40544		kVAR
Volts ab SRC2	40305	40365	40425	40485	40545		Volts
Volts bc SRC2	40306	40366	40426	40486	40546		Volts
Volts ca SRC2	40307	40367	40427	40487	40547		Volts
Volts a SRC2	40308	40368	40428	40488	40548		Volts
Volts b SRC2	40309	40369	40429	40489	40549		Volts
Volts c SRC2	40310	40370	40430	40490	40550		Volts
Amps a SRC2	40311	40371	40431	40491	40551		Amps
Amps b SRC2	40312	40372	40432	40492	40552		Amps
Amps c SRC2	40313	40373	40433	40493	40553		Amps
Percent Amps a SRC2	40314	40374	40434	40494	40554	0.5	%
Percent Amps b SRC2	40315	40375	40435	40495	40555	0.5	%
Percent Amps c SRC2	40316	40376	40436	40496	40556	0.5	%

7.1.5 Word Data

Reference Tables ATS 1-5 and 6-10.

TABLE 13.

Digital	State
0	Neutral
1	Source 1 Connected
2	Source 2 Connected
3	Source 1 and 2 Connected

TABLE 14.

Digital	Mode
0	Test
1	Utility / Genset
2	Utility / Utility
3	Genset / Genset

TABLE 15.

Digital	Fault Type
0	No Faults
1	Warning

7.1.6 ATS 6-10 DATA

ATS Raw Data	ATS 6	ATS 7	ATS 8	ATS 9	ATS 10	Multiplier	Units
Device Type	40557	40617	40677	40737	40797		
Mode (See Table 14 on page 275)	40558	40618	40678	40738	40798		
State (See Table 13 on page 275)	40559	40619	40679	40739	40799		
Fault Code	40560	40620	40680	40740	40800		
Fault Type (See Table 15 on page 276)	40561	40621	40681	40741	40801		
Percent Amps	40562	40622	40682	40742	40802	0.5	%
Total kW	40563	40623	40683	40743	40803		
NFPA 110 (See Table 3 on page 11)	40564	40624	40684	40744	40804		
NFPA Extended (See Table 4 on page 11)	40565	40625	40685	40745	40805		
Frequency Load	40566	40626	40686	40746	40806	0.1	Hz
Total pf Load	40567	40627	40687	40747	40807	0.00005	PF
Total kVA Load	40568	40628	40688	40748	40808		kVA
Total kW Load	40569	40629	40689	40749	40809		kW
Total kVAR Load	40570	40630	40690	40750	40810		kVAR
Volts ab Load	40571	40631	40691	40751	40811		Volts
Volts bc Load	40572	40632	40692	40752	40812		Volts
Volts ca Load	40573	40633	40693	40753	40813		Volts
Volts a Load	40574	40634	40694	40754	40814		Volts
Volts b Load	40575	40635	40695	40755	40815		Volts
Volts c Load	40576	40636	40696	40756	40816		Volts
Amps a Load	40577	40637	40697	40757	40817		Amps
Amps b Load	40578	40638	40698	40758	40818		Amps
Amps c Load	40579	40639	40699	40759	40819		Amps
Percent Amps a Load	40580	40640	40700	40760	40820	0.5	%
Percent Amps b Load	40581	40641	40701	40761	40821	0.5	%
Percent Amps c Load	40582	40642	40702	40762	40822	0.5	%

ATS Raw Data	ATS 6	ATS 7	ATS 8	ATS 9	ATS 10	Multiplier	Units
Frequency SRC1	40583	40643	40703	40763	40823	0.1	Hz
Total pf SRC1	40584	40644	40704	40764	40824	0.00005	PF
Total kVA SRC1	40585	40645	40705	40765	40825		kVA
Total kW SRC1	40586	40646	40706	40766	40826		kW
Total kVAR SRC1	40587	40647	40707	40767	40827		kVAR
Volts bc SRC1	40588	40648	40708	40868	40828		Volts
Volts bc SRC1	40589	40649	40709	40869	40829		Volts
Volts ca SRC1	40590	40650	40710	40870	40830		Volts
Volts a SRC1	40591	40651	40711	40871	40831		Volts
Volts b SRC1	40592	40652	40712	40872	40832		Volts
Volts c SRC1	40593	40653	40713	40873	40833		Volts
Amps a SCR1	40594	40654	40714	40874	40834		Amps
Amps b SCR1	40595	40655	40715	40875	40835		Amps
Amps c SRC1	40596	40656	40716	40876	40836		Amps
Percent Amps a SCR1	40597	40657	40717	40777	40837	0.5	%
Percent Amps b SCR1	40598	40658	40718	40778	40838	0.5	%
Percent Amps c SCR1	40599	40659	40719	40779	40839	0.5	%
Frequency SRC2	40600	40660	40720	40780	40840	0.1	Hz
Total pf SRC2	40601	40661	40721	40781	40841	0.00005	pf
Total KVA SRC2	40602	40662	40722	40782	40842		kVA
Total kW SRC2	40603	40663	40723	40783	40843		kW
Total KVAR SRC2	40604	40664	40724	40784	40844		kVAR
Volts ab SRC2	40605	40665	40725	40785	40845		Volts
Volts bc SRC2	40606	40666	40726	40786	40846		Volts
Volts ca SRC2	40607	40667	40727	40787	40847		Volts
Volts a SRC2	40608	40668	40728	40788	40848		Volts
Volts b SRC2	40609	40669	40729	40789	40849		Volts
Volts c SRC2	40610	40670	40730	40790	40850		Volts
Amps a SRC2	40611	40671	40731	40791	40851		Amps
Amps b SRC2	40612	40672	40732	40792	40852		Amps
Amps c SRC2	40613	40673	40733	40793	40853		Amps
Percent Amps a SRC2	40614	40674	40734	40794	40854	0.5	%
Percent Amps b SRC2	40615	40675	40735	40795	40855	0.5	%
Percent Amps c SRC2	40616	40676	40736	40796	40856	0.5	%

7.2 DMC 1500 Communication Server 2

7.2.1 Modbus Address: 1 (Slave)

NOTICE

If an address or bit is not listed in this table, it is not implemented.

NOTICE

The external device can read 1-40 contiguous registers, write 1-40 contiguous registers, or read diagnostic counters.

Modbus Address	Bit #	Alarm Event
40001	0 (LSB)	Neutral Earthing 1 Fail to Open Warning
40001	1	Neutral Earthing 2 Fail to Open Warning
40001	2	Neutral Earthing 3 Fail to Open Warning
40001	3	Neutral Earthing 4 Fail to Open Warning
40001	4	Neutral Earthing 5 Fail to Open Warning
40001	5	Neutral Earthing 6 Fail to Open Warning
40001	6	Neutral Earthing 7 Fail to Open Warning
40001	7	Neutral Earthing 8 Fail to Open Warning
40001	8	Neutral Earthing 1 Fail to Closed Warning
40001	9	Neutral Earthing 2 Fail to Closed Warning
40001	10	Neutral Earthing 3 Fail to Closed Warning
40001	11	Neutral Earthing 4 Fail to Closed Warning
40001	12	Neutral Earthing 5 Fail to Closed Warning
40001	13	Neutral Earthing 6 Fail to Closed Warning
40001	14	Neutral Earthing 7 Fail to Closed Warning
40001	15 (MSB)	Neutral Earthing 8 Fail to Closed Warning

Modbus Address	Bit #	Alarm Event
40002	0 (LSB)	Neutral Earthing 1 Tripped Warning
40002	1	Neutral Earthing 2 Tripped Warning
40002	2	Neutral Earthing 3 Tripped Warning
40002	3	Neutral Earthing 4 Tripped Warning
40002	4	Neutral Earthing 5 Tripped Warning

Modbus Address	Bit #	Alarm Event
40002	5	Neutral Earthing 6 Tripped Warning
40002	6	Neutral Earthing 7 Tripped Warning
40002	7	Neutral Earthing 8 Tripped Warning
40002	8	Undergrounded Bus Warning
40002	9	Undergrounded Bus Failure - System Shutdown
40002	10	Multiple NECs Connected
40002	11	Multiple System Grounds Connected
40002	12	Not Implemented
40002	13	Not Implemented
40002	14	Not Implemented
40002	15 (MSB)	Not Implemented

Modbus Address	Bit #	Alarm Event
40003	0 (LSB)	Station Battery Power Supply Fault
40003	1	UPS Fault
40003	2	On Station Battery Warning
40003	3	System Manual Mode Active
40003	4	Utility Failure
40003	5	Utility Out of Limits for Extended Parallel
40003	6	Common Server 2 Battery Warning
40003	7	System Emergency Stop
40003	8	Hardware Failure Warning MCM 3320
40003	9	Not Implemented
40003	10	Not Implemented
40003	11	Not Implemented
40003	12	Not Implemented
40003	13	Not Implemented
40003	14	Not Implemented
40003	15 (MSB)	Not Implemented

Modbus Address	Bit #	Alarm Event
40004	0 (LSB)	Illegal Genset Node Address Assignment
40004	1	Not Implemented

Modbus Address	Bit #	Alarm Event
40004	2	Not Implemented
40004	3	Comm Server 2 to Comm Server 1 Comm Failure
40004	4	Manufacturing Test Mode Active
40004	5	Not Implemented
40004	6	Not Implemented
40004	7	Not Implemented
40004	8	Comm Server 2 to Genset 1 Comm Failure
40004	9	Comm Server 2 to Genset 2 Comm Failure
40004	10	Comm Server 2 to Genset 3 Comm Failure
40004	11	Comm Server 2 to Genset 4 Comm Failure
40004	12	Comm Server 2 to Genset 5 Comm Failure
40004	13	Comm Server 2 to Genset 6 Comm Failure
40004	14	Comm Server 2 to Genset 7 Comm Failure
40004	15 (MSB)	Comm Server 2 to Genset 8 Comm Failure

NOTICE

40005 is unused.

Modbus Address	Bit #	Alarm Event
40006	0 (LSB)	Gen 1 Breaker Closed
40006	1	Gen 2 Breaker Closed
40006	2	Gen 3 Breaker Closed
40006	3	Gen 4 Breaker Closed
40006	4	Gen 5 Breaker Closed
40006	5	Gen 6 Breaker Closed
40006	6	Gen 7 Breaker Closed
40006	7	Gen 8 Breaker Closed
40006	8	Gen 1 Breaker Open
40006	9	Gen 2 Breaker Open
40006	10	Gen 3 Breaker Open
40006	11	Gen 4 Breaker Open
40006	12	Gen 5 Breaker Open
40006	13	Gen 6 Breaker Open

Modbus Address	Bit #	Alarm Event
40006	14	Gen 7 Breaker Open
40006	15 (MSB)	Gen 8 Breaker Open

Modbus Address	Bit #	Alarm Event
40007	0 (LSB)	Gen 1 Running
40007	1	Gen 2 Running
40007	2	Gen 3 Running
40007	3	Gen 4 Running
40007	4	Gen 5 Running
40007	5	Gen 6 Running
40007	6	Gen 7 Running
40007	7	Gen 8 Running
40007	8	Gen 1 Fault
40007	9	Gen 2 Fault
40007	10	Gen 3 Fault
40007	11	Gen 4 Fault
40007	12	Gen 5 Fault
40007	13	Gen 6 Fault
40007	14	Gen 7 Fault
40007	15 (MSB)	Gen 8 Fault

Modbus Address	Bit #	Alarm Event
40008	0 (LSB)	Gen 1 Shut Down in Load Demand
40008	1	Gen 2 Shut Down in Load Demand
40008	2	Gen 3 Shut Down in Load Demand
40008	3	Gen 4 Shut Down in Load Demand
40008	4	Gen 5 Shut Down in Load Demand
40008	5	Gen 6 Shut Down in Load Demand
40008	6	Gen 7 Shut Down in Load Demand
40008	7	Gen 8 Shut Down in Load Demand
40008	8	Gen Start Signal On MCM 3320
40008	9	Gen Start Signal Off MCM 3320
40008	10	Gen Main Breaker Closed

Modbus Address	Bit #	Alarm Event
40008	11	Gen Main Breaker Opened
40008	12	Utility Main Breaker Closed
40008	13	Utility Main Breaker Opened
40008	14	Utility Failure
40008	15 (MSB)	Return to Utility

Modbus Address	Bit #	Alarm Event
40009	0 (LSB)	Remote Commands Enable
40009	1	Remote Commands Disable
40009	2	Remote Test On
40009	3	Remote Test Off
40009	4	Remote Extended Parallel On
40009	5	Remote Extended Parallel Off
40009	6	Remote Transfer Inhibit On
40009	7	Remote Transfer Inhibit Off
40009	8	Remote Retransfer Inhibit On
40009	9	Remote Retransfer Inhibit Off
40009	10	Auto Genset Start Inhibit in Manual Mode Enable
40009	11	Auto Genset Start Inhibit in Manual Mode Disable
40009	12	Not Implemented
40009	13	Not Implemented
40009	14	Not Implemented
40009	15 (MSB)	Not Implemented

7.2.2 Generator Raw Data Gen 1-5

Generator Raw Data	Gen 1	Gen 2	Gen 3	Gen 4	Gen 5	Multiplier	Units
Device Type	40011	40066	40121	40176	40231		
Control Switch (See Table 22 on page 286)	40012	40067	40122	40177	40232		
State (See Table 16 on page 284)	40013	40068	40123	40178	40233		
Fault Code	40014	40069	40124	40179	40234		
Fault Type (See Table 21 on page 285)	40015	40070	40125	40180	40235		
Percent kW Standby	40016	40071	40126	40181	40236	0.5	%

Generator Raw Data	Gen 1	Gen 2	Gen 3	Gen 4	Gen 5	Multiplier	Units
Total kW	40017	40072	40127	40182	40237		
NFPA 110 (See Table 3 on page 11)	40018	40073	40128	40183	40238		
NFPA Extended (See Table 4 on page 11)	40019	40074	40129	40184	40239		
Frequency	40020	40075	40130	40185	40240	0.1	Hz
Total pf	40021	40076	40131	40186	40241	0.00005	pf
Total kVA	40022	40077	40132	40187	40242		kVA
Total kW	40023	40078	40133	40188	40243		kW
Total kVAR	40024	40079	40134	40189	40244		kVAR
Volts ab	40025	40080	40135	40190	40245		Volts
Volts bc	40026	40081	40136	40191	40246		Volts
Volts ca	40027	40082	40137	40192	40247		Volts
Volts a	40028	40083	40138	40193	40248		Volts
Volts b	40029	40084	40139	40194	40249		Volt
Volts c	40030	40085	40140	40195	40250		Volts
Amps a	40031	40086	40141	40196	40251		Amps
Amps b	40032	40087	40142	40197	40252		Amps
Amps c	40033	40088	40143	40198	40253		Amps
Percent Amps a	40034	40089	40144	40199	40254	0.5	%
Percent Amps b	40035	40090	40145	40200	40255	0.5	%
Percent Amps c	40036	40091	40146	40201	40256	0.5	%
Battery Voltage	40037	40092	40147	40202	40257	0.1	Volts
Oil Pressure	40038	40093	40148	40203	40258	0.1	kPa
Oil Temp	40039	40094	40149	40204	40259	0.1	Deg K
Coolant Temp	40040	40095	40150	40205	40260	0.1	Deg K
Fuel Rate	40041	40096	40151	40206	40261	0.001	GPH
Engine RPM	40042	40097	40152	40207	40262		RPM
Engine Starts	40043	40098	40153	40208	40263		Starts
Engine Runtime High	40044	40099	40154	40209	40264		
Engine Runtime Low	40045	40100	40155	40210	40265	0.1	Sec
Total kWH High	40046	40101	40156	40211	40266		
Total kWH Low	40047	40102	40157	40212	40267		KWH
Total Fuel High	40048	40103	40158	40213	40268		
Total Fuel Low	40049	40104	40159	40214	40269	0.01	GAL

Generator Raw Data	Gen 1	Gen 2	Gen 3	Gen 4	Gen 5	Multiplier	Units
Bus Frequency	40050	40105	40160	40215	40270	0.1	Hz
Bus Volts ab	40051	40106	40161	40216	40271		Volts
Bus Volts bc	40052	40107	40162	40217	40272		Volts
Bus Volts ca	40053	40108	40163	40218	40273		Volts
Bus Volts a	40054	40109	40164	40219	40274		Volts
Bus Volts b	40055	40110	40165	40220	40275		Volts
Bus Volts c	40056	40111	40166	40221	40276		Volts
Customer Faults	40057	40112	40167	40222	40277		
Network Faults	40058	40113	40168	40223	40278		
Customer Faults	40059	40114	40169	40224	40279		
ES State (See Table 17 on page 284)	40060	40115	40170	40225	40280		
Load Share State (See Table 18 on page 285)	40061	40116	40171	40226	40281		
Load Govern State kW (See Table 22 on page 286)	40062	40117	40172	40227	40282		
Load Govern State kVAR (See Table 20 on page 285)	40063	40118	40173	40228	40283		

7.2.3 Word Data

Reference the ATS 6-1 and 6-10 tables in Section 8.

TABLE 16.

Digital	State
0	Stopped
1	Start Pending
2	Warm-up at Idle
3	Running
4	Cooldown at Rated
5	Cooldown at idle

TABLE 17.

Digital	ES State
0	Standby
1	Dead Bus Close
2	Synchronizing

Digital	ES State
3	Load Share
4	Load Govern

TABLE 18.

Digital	Load Share State
0	Not in Load Share
1	Track Load
2	Ramp Load
3	Ramp Unload
4	Load Demand Shutdown

TABLE 19.

Digital	Load Govern State kW
0	NA
1	Ramp Load
2	Track Target Load
3	Ramp Unload
4	Ramp Unload Done

TABLE 20.

Digital	Load Govern State kVAR
0	NA
1	Ramp Load
2	Track Target Load
3	Ramp Unload
4	Ramp Unload Done

TABLE 21.

Digital	Fault Type
0	Normal
1	Warning
2	Derate
3	Shutdown with Cooldown

Digital	Fault Type
4	Shutdown

TABLE 22.

Digital	Control Switch
0	Off
1	Manual
2	Automatic

7.2.4 Generator Raw Data Gen 6-8

Generator Raw Data	Gen 6	Gen 7	Gen 8	Multiplier	Units
Device Type	40286	40341	40396		
Control Switch (See Table 22 on page 286)	40287	40342	40397		
State (See Table 16 on page 284)	40288	40343	40398		
Fault Code	40289	40344	40399		
Fault Type (See Table 21 on page 285)	40290	40345	40400		
Percent kW Standby	40291	40346	40401	0.5	%
Total kW	40292	40347	40402		
NFPA 110 (See Table 5 on page 12)	40293	40348	40403		
NFPA Extended (See Table 6 on page 12)	40294	40349	40404		
Frequency	40295	40350	40405	0.1	Hz
Total pf	40296	40351	40406	0.00005	PF
Total kVA	40297	40352	40407		kVA
Total kW	40298	40353	40408		kW
Total kVAR	40299	40354	40409		kVAR
Volts ab	40300	40355	40410		Volts
Volts bc	40301	40356	40411		Volts
Volts ca	40302	40357	40412		Volts
Volts a	40303	40358	40413		Volts
Volts b	40304	40359	40414		Volts
Volts c	40305	40360	40415		Volts
Amps a	40306	40361	40416		Amps
Amps b	40307	40362	40417		Amps
Amps c	40308	40363	40418		Amps
Percent Amps a	40309	40364	40419	0.5	%

Generator Raw Data	Gen 6	Gen 7	Gen 8	Multiplier	Units
Percent Amps b	40310	40365	40420	0.5	%
Percent Amps c	40311	40366	40421	0.5	%
Battery Voltage	40312	40367	40422	0.1	Volts
Oil Pressure	40313	40368	40423	0.1	kPa
Oil Temp	40314	40369	40424	0.1	Deg K
Coolant Temp	40315	40370	40425	0.1	Deg K
Fuel Rate	40316	40371	40426	0.001	GPH
Engine RPM	40317	40372	40427		RPM
Engine Starts	40318	40373	40428		Starts
Engine Runtime High	40319	40374	40429		
Engine Runtime Low	40320	40375	40430	0.1	Sec
Total kWH High	40321	40376	40431		
Total kWH Low	40322	40377	40432		KWH
Total Fuel High	40323	40378	40433		
Total Fuel Low	40324	40379	40434	0.01	GAL
Bus Frequency	40325	40380	40435	0.1	Hz
Bus Volts ab	40326	40381	40436		Volts
Bus Volts bc	40327	40382	40437		Volts
Bus Volts ca	40328	40383	40438		Volts
Bus Volts a	40329	40384	40439		Volts
Bus Volts b	40330	40385	40440		Volts
Bus Volts c	40331	40386	40441		Volts
Customer Faults	40332	40387	40442		
Network Faults	40333	40388	40443		
Customer Faults	40334	40389	40444		
ES State (See Table 17 on page 284)	40335	40390	40445		
Load Share State (See Table 18 on page 285)	40336	40391	40446		
Load Govern State kW (See Table 19 on page 285)	40337	40392	40447		
Load Govern State kVAR (See Table 20 on page 285)	40338	40393	40448		

This page is intentionally blank.

8 DMC 6600 and DMC 6600P

8.1 Modbus TCP Port Configuration

IP: 192.168.0.100

8.2 Modbus RTU Serial Port Configuration

TABLE 23. MODBUS RTU SERIAL PORT CONFIGURATION

Connection	Modbus RTU RS485
Baud Rate	9600
Parity	None
Stop Bits	1
Address	1

8.3 Genset Data

TABLE 24. MODBUS REGISTERS

Parameter	Modbus Registers								Scaling		
	Genset 1	Genset 2	Genset 3	Genset 4	Genset 5	Genset 6	Genset 7	Genset 8	Type	UNIT	Multiplier
Annunciator Misc	40001	40101	40201	40301	40401	40501	40601	40701	U16	Bit Field	N/A
Annunciator NFPA 110	40002	40102	40202	40302	40402	40502	40602	40702	U16	Bit Field	N/A
Annunciator Extended	40003	40103	40203	40303	40403	40503	40603	40703	U16	Bit Field	N/A
CB Line	40004	40104	40204	40304	40404	40504	40604	40704	U16	Enum	N/A
CB Load	40005	40105	40205	40305	40405	40505	40605	40705	U16	Enum	N/A
CB Pos	40006	40106	40206	40306	40406	40506	40606	40706	U16	Enum	N/A
NEC Pos	40007	40107	40207	40307	40407	40507	40607	40707	U16	Enum	N/A
Control Switch	40008	40108	40208	40308	40408	40508	40608	40708	U16	Enum	N/A

Parameter	Modbus Registers								Scaling		
	Genset 1	Genset 2	Genset 3	Genset 4	Genset 5	Genset 6	Genset 7	Genset 8	Type	UNIT	Multiplier
State	40009	40109	40209	40309	40409	40509	40609	40709	U16	Enum	N/A
Fault Code	40010	40110	40210	40310	40410	40510	40610	40710	U16	Enum	N/A
Fault Type	40011	40111	40211	40311	40411	40511	40611	40711	U16	Enum	N/A
Pct kW	40012	40112	40212	40312	40412	40512	40612	40712	U16	%kW	0 1
Frequency	40013	40113	40213	40313	40413	40513	40613	40713	U16	Hz	0 1
Total PF	40014	40114	40214	40314	40414	40514	40614	40714	S16		0 01
Total kVA	40015	40115	40215	40315	40415	40515	40615	40715	S16	kVA	1
Total kW	40016	40116	40216	40316	40416	40516	40616	40716	S16	kW	1
Total kVAR	40017	40117	40217	40317	40417	40517	40617	40717	S16	kVAR	1
Battery Volt	40018	40118	40218	40318	40418	40518	40618	40718	S16	VDC	0 1
Oil Pressure	40019	40119	40219	40319	40419	40519	40619	40719	S16	kPa	0 1
Oil Temp	40020	40120	40220	40320	40420	40520	40620	40720	S16	C	0 1
Coolant Temp	40021	40121	40221	40321	40421	40521	40621	40721	S16	C	0 1
Misc Temp1	40022	40122	40222	40322	40422	40522	40622	40722	S16	C	0 1
Misc Temp2	40023	40123	40223	40323	40423	40523	40623	40723	S16	C	0 1
Fuel Rate	40024	40124	40224	40324	40424	40524	40624	40724	U16	lph	0 1
Engine RPM	40025	40125	40225	40325	40425	40525	40625	40725	U16	RPM	1
Num Engine Start	40026	40126	40226	40326	40426	40526	40626	40726	U16		1
Bus Frequency	40027	40127	40227	40327	40427	40527	40627	40727	U16	Hz	0 1

Parameter	Modbus Registers								Scaling		
	Genset 1	Genset 2	Genset 3	Genset 4	Genset 5	Genset 6	Genset 7	Genset 8	Type	UNIT	Multiplier
Customer Fault	40028	40128	40228	40328	40428	40528	40628	40728	U16	Bit Field	N/A
Network Fault	40029	40129	40229	40329	40429	40529	40629	40729	U16	Bit Field	N/A
Parallel State	40030	40130	40230	40330	40430	40530	40630	40730	U16	Enum	N/A
LD Stop Ind	40031	40131	40231	40331	40431	40531	40631	40731	U16		N/A
Volt L12	40032	40132	40232	40332	40432	40532	40632	40732	U16	V	1
Volt L23	40033	40133	40233	40333	40433	40533	40633	40733	U16	V	1
Volt L31	40034	40134	40234	40334	40434	40534	40634	40734	U16	V	1
Avg Volt LL	40035	40135	40235	40335	40435	40535	40635	40735	U16	V	1
Volt L1	40036	40136	40236	40336	40436	40536	40636	40736	U16	V	1
Volt L2	40037	40137	40237	40337	40437	40537	40637	40737	U16	V	1
Volt L3	40038	40138	40238	40338	40438	40538	40638	40738	U16	V	1
Avg Volt LN	40039	40139	40239	40339	40439	40539	40639	40739	U16	V	1
Amp L1	40040	40140	40240	40340	40440	40540	40640	40740	U16	A	1
Amp L2	40041	40141	40241	40341	40441	40541	40641	40741	U16	A	1
Amp L3	40042	40142	40242	40342	40442	40542	40642	40742	U16	A	1
Avg Amp	40043	40143	40243	40343	40443	40543	40643	40743	U16	A	1
Pct Amp L1	40044	40144	40244	40344	40444	40544	40644	40744	U16	%A	0 1
Pct Amp L2	40045	40145	40245	40345	40445	40545	40645	40745	U16	%A	0 1
Pct Amp L3	40046	40146	40246	40346	40446	40546	40646	40746	U16	%A	0 1
Bus Volt L12	40047	40147	40247	40347	40447	40547	40647	40747	U16	V	1
Bus Volt L23	40048	40148	40248	40348	40448	40548	40648	40748	U16	V	1
Bus Volt L31	40049	40149	40249	40349	40449	40549	40649	40749	U16	V	1

Parameter	Modbus Registers								Scaling		
	Genset 1	Genset 2	Genset 3	Genset 4	Genset 5	Genset 6	Genset 7	Genset 8	Type	UNIT	Multiplier
Bus Volt L1	40050	40150	40250	40350	40450	40550	40650	40750	U16	V	1
Bus Volt L2	40051	40151	40251	40351	40451	40551	40651	40751	U16	V	1
Bus Volt L3	40052	40152	40252	40352	40452	40552	40652	40752	U16	V	1
Engine Runtime	44000	44010	44020	44030	44040	44050	44060	44070	U32	Hr	1
Total kWh	44002	44012	44022	44032	44042	44052	44062	44072	U32	kWh	1
Total Fuel L	44004	44014	44024	44034	44044	44054	44064	44074	U32	l	1

TABLE 25. MODBUS REGISTERS

Parameter	Modbus Registers								Scaling		
	Genset 9	Genset 10	Genset 11	Genset 12	Genset 13	Genset 14	Genset 15	Genset 16	Type	UNIT	Multiplier
Annunciator Misc	40801	40901	41001	41101	41201	41301	41401	41501	U16	Bit Field	N/A
Annunciator NFPA 110	40802	40902	41002	41102	41202	41302	41402	41502	U16	Bit Field	N/A
Annunciator Extended	40803	40903	41003	41103	41203	41303	41403	41503	U16	Bit Field	N/A
CB Line	40804	40904	41004	41104	41204	41304	41404	41504	U16	Enum	N/A
CB Load	40805	40905	41005	41105	41205	41305	41405	41505	U16	Enum	N/A
CB Pos	40806	40906	41006	41106	41206	41306	41406	41506	U16	Enum	N/A
NEC Pos	40807	40907	41007	41107	41207	41307	41407	41507	U16	Enum	N/A
Control Switch	40808	40908	41008	41108	41208	41308	41408	41508	U16	Enum	N/A
State	40809	40909	41009	41109	41209	41309	41409	41509	U16	Enum	N/A
Fault Code	40810	40910	41010	41110	41210	41310	41410	41510	U16	Enum	N/A

Parameter	Modbus Registers								Scaling		
	Genset 9	Genset 10	Genset 11	Genset 12	Genset 13	Genset 14	Genset 15	Genset 16	Type	UNIT	Multiplier
Fault Type	40811	40911	41011	41111	41211	41311	41411	41511	U16	Enum	N/A
Pct kW	40812	40912	41012	41112	41212	41312	41412	41512	U16	%kW	0 1
Frequency	40813	40913	41013	41113	41213	41313	41413	41513	U16	Hz	0 1
Total PF	40814	40914	41014	41114	41214	41314	41414	41514	S16		0 01
Total kVA	40815	40915	41015	41115	41215	41315	41415	41515	S16	kVA	1
Total kW	40816	40916	41016	41116	41216	41316	41416	41516	S16	kW	1
Total kVAR	40817	40917	41017	41117	41217	41317	41417	41517	S16	kVAR	1
Battery Volt	40818	40918	41018	41118	41218	41318	41418	41518	S16	VDC	0 1
Oil Pressure	40819	40919	41019	41119	41219	41319	41419	41519	S16	kPa	0 1
Oil Temp	40820	40920	41020	41120	41220	41320	41420	41520	S16	C	0 1
Coolant Temp	40821	40921	41021	41121	41221	41321	41421	41521	S16	C	0 1
Misc Temp1	40822	40922	41022	41122	41222	41322	41422	41522	S16	C	0 1
Misc Temp2	40823	40923	41023	41123	41223	41323	41423	41523	S16	C	0 1
Fuel Rate	40824	40924	41024	41124	41224	41324	41424	41524	U16	lph	0 1
Engine RPM	40825	40925	41025	41125	41225	41325	41425	41525	U16	RPM	1
Num Engine Start	40826	40926	41026	41126	41226	41326	41426	41526	U16		1
Bus Frequency	40827	40927	41027	41127	41227	41327	41427	41527	U16	Hz	0 1
Customer Fault	40828	40928	41028	41128	41228	41328	41428	41528	U16	Bit Field	N/A
Network Fault	40829	40929	41029	41129	41229	41329	41429	41529	U16	Bit Field	N/A

Parameter	Modbus Registers								Scaling		
	Genset 9	Genset 10	Genset 11	Genset 12	Genset 13	Genset 14	Genset 15	Genset 16	Type	UNIT	Multiplier
Parallel State	40830	40930	41030	41130	41230	41330	41430	41530	U16	Enum	N/A
LD Stop Ind	40831	40931	41031	41131	41231	41331	41431	41531	U16		N/A
Volt L12	40832	40932	41032	41132	41232	41332	41432	41532	U16	V	1
Volt L23	40833	40933	41033	41133	41233	41333	41433	41533	U16	V	1
Volt L31	40834	40934	41034	41134	41234	41334	41434	41534	U16	V	1
Avg Volt LL	40835	40935	41035	41135	41235	41335	41435	41535	U16	V	1
Volt L1	40836	40936	41036	41136	41236	41336	41436	41536	U16	V	1
Volt L2	40837	40937	41037	41137	41237	41337	41437	41537	U16	V	1
Volt L3	40838	40938	41038	41138	41238	41338	41438	41538	U16	V	1
Avg Volt LN	40839	40939	41039	41139	41239	41339	41439	41539	U16	V	1
Amp L1	40840	40940	41040	41140	41240	41340	41440	41540	U16	A	1
Amp L2	40841	40941	41041	41141	41241	41341	41441	41541	U16	A	1
Amp L3	40842	40942	41042	41142	41242	41342	41442	41542	U16	A	1
Avg Amp	40843	40943	41043	41143	41243	41343	41443	41543	U16	A	1
Pct Amp L1	40844	40944	41044	41144	41244	41344	41444	41544	U16	%A	0 1
Pct Amp L2	40845	40945	41045	41145	41245	41345	41445	41545	U16	%A	0 1
Pct Amp L3	40846	40946	41046	41146	41246	41346	41446	41546	U16	%A	0 1
Bus Volt L12	40847	40947	41047	41147	41247	41347	41447	41547	U16	V	1
Bus Volt L23	40848	40948	41048	41148	41248	41348	41448	41548	U16	V	1
Bus Volt L31	40849	40949	41049	41149	41249	41349	41449	41549	U16	V	1
Bus Volt L1	40850	40950	41050	41150	41250	41350	41450	41550	U16	V	1
Bus Volt L2	40851	40951	41051	41151	41251	41351	41451	41551	U16	V	1

Parameter	Modbus Registers								Scaling		
	Genset 9	Genset 10	Genset 11	Genset 12	Genset 13	Genset 14	Genset 15	Genset 16	Type	UNIT	Multiplier
Bus Volt L3	40852	40952	41052	41152	41252	41352	41452	41552	U16	V	1
Engine Runtime	44080	44090	44100	44110	44120	44130	44140	44150	U32	Hr	1
Total kWh	44082	44092	44102	44112	44122	44132	44142	44152	U32	kWh	1
Total Fuel L	44084	44094	44104	44114	44124	44134	44144	44154	U32	l	1

TABLE 26. LINE/LOAD BUS STATUS

Line/Load Bus Status	Enum
Cold	0
Hot	1
Unknown	2

TABLE 27. CB POSITION

CB Position	Enum
Open	0
Closed	1
Unknown	2
Disconnected	3
Earthed	4

TABLE 28. CONTROL SWITCH

Control Switch	Enum
Off	0
Manual	1
Auto	2
Run	3

TABLE 29. STATE

State	Enum
Stopped	0

State	Enum
Start Pending	1
Warm Up at Idle	2
Running	3
Cooldown at Rated	4
Cooldown at Idle	5

TABLE 30. FAULT TYPE

Fault Type	Enum
Warning	1
Derate	2
Shutdown w Cooldown	3
Shutdown	4

TABLE 31. ANNUNCIATOR MISC

Annunciator Misc	Bit
Is Future	0
CB Is Future	1
CB Fail	2
CB Man Ind	3
CB Alarm Fail To Open	4
CB Alarm Fail To Close	5
CB Alarm Gnd Fault	6
CB Alarm LO Trip	7
CB Alarm PR Fail	8
CB Alarm Unexp Disc	9
Alarm Shtdn Fail To Open	10
Alarm Fail To Come Online	11
Data Comms Alarm	12
NEC Exists	13
NEC Fail To Open	14
NEC Fail To Close	15

TABLE 32. ANNUNCIATOR NFPA 110

Annunciator NFPA 110	Bit
Low Coolant Level	1
Overspeed	2
Low Oil Pressure	3
PreLow Oil Pressure	4
High Engine Temp	5
PreHigh Engine Temp	6
Low Coolant Temp	7
Fail to Start	8
Charger AC Failure	9
Low Battery Voltage	10
High Battery Voltage	11
Not in Auto	12
GenSet Running	13
GenSet Supplying Load	14
Common Alarm	15

TABLE 33. ANNUNCIATOR EXTENDED

Annunciator Extended	Bit
Emergency Stop	0
NA	1
NA	2
Load Demand	3
Fail to Close	4
Fail to Sync	5
Reverse KVAR	6
Reverse KW	7
Short Circuit	8
Overcurrent	9
Overload	10
Under Frequency	11
Low AC Voltage	12
High AC Voltage	13
Ground Fault	14

Annunciator Extended	Bit
NA	15

8.4 Metering

TABLE 34. METERING MODBUS REGISTERS/SCALING

Parameter	Modbus Registers		Scaling		
	Meter 1	Meter 2	Type	UNIT	Multiplier
Status	45001	45051	U16	Bit Field	N/A
Volt L1 -N	45002	45052	U16	V	1
Volt L2 -N	45003	45053	U16	V	1
Volt L3 -N	45004	45054	U16	V	1
Avg Volt L-N	45005	45055	U16	V	1
Volt-L1-L2	45006	45056	U16	V	1
Volt-L2-L3	45007	45057	U16	V	1
Volt-L3-L1	45008	45058	U16	V	1
Avg Volt LL	45009	45059	U16	V	1
Amp L1	45010	45060	U16	A	1
Amp L2	45011	45061	U16	A	1
Amp L3	45012	45062	U16	A	1
Avg Amp	45013	45063	U16	A	1
kW L1	45014	45064	S16	kW	1
kW L2	45015	45065	S16	kW	1
kW L3	45016	45066	S16	kW	1
kVAR L1	45017	45067	S16	kVAR	1
kVAR L2	45018	45068	S16	kVAR	1
kVAR L3	45019	45069	S16	kVAR	1
Total PF 100ths	45020	45070	S16		0 01
kVA L1	45021	45071	U16	kVA	1
kVA L2	45022	45072	U16	kVA	1
kVA L3	45023	45073	U16	kVA	1
Hz 10ths	45024	45074	U16	Hz	0 1
Total kW	44500	44520	S32	kW	1
Total kVAR	44502	44522	S32	kVAR	1
Total kVA	44504	44524	U32	kVA	1

Parameter	Modbus Registers		Scaling		
	Meter 1	Meter 2	Type	UNIT	Multiplier
Total Neg kWh	44506	44526	U32	kWh	0 1
Total Poz kWh	44508	44528	U32	kWh	0 1
Total Net kWh	44510	44530	U32	kWh	0 1
Total Neg kVARh	44512	44532	U32	kVARh	0 1
Total Poz kVARh	44514	44534	U32	kVARh	0 1
Total Net kVARh	44516	44536	U32	kVARh	0 1
Total kVAh	44518	44538	U32	Hz	0 1

TABLE 35. METERING STATUS

Status	Bit
Exists	0
Comms Alarm	1
Not Used	2
Not Used	3
Not Used	4
Not Used	5
Not Used	6
Not Used	7
Not Used	8
Not Used	9
Not Used	10
Not Used	11
Not Used	12
Not Used	13
Not Used	14
Not Used	15

8.5 Load Demand

TABLE 36. LOAD DEMAND MODBUS REGISTERS

	Modbus Register								Scaling		
Parameter	Level 1	Level 2	Level 3	Level 4	Level 5	Level 6	Level 7	Level 8	Type	UNIT	Multiplier
Gen Number	46001	46005	46009	46013	46017	46021	46025	46029	U16	N/A	N/A
Is Available	46002	46006	46010	46014	46018	46022	46026	46030	U16	N/A	N/A
Shutdown kW	46003	46007	46011	46015	46019	46023	46027	46031	U16	kW	1
Restart kW	46004	46008	46012	46016	46020	46024	46028	46032	U16	kW	1

TABLE 37. LOAD DEMAND MODBUS REGISTERS

	Modbus Register								Scaling		
Parameter	Level 9	Level 10	Level 11	Level 12	Level 13	Level 14	Level 15	Level 16	Type	UNIT	Multiplier
Gen Number	46033	46037	46041	46045	46049	46053	46057	46061	U16	N/A	N/A
Is Available	46034	46038	46042	46046	46050	46054	46058	46062	U16	N/A	N/A
Shutdown kW	46035	46039	46043	46047	46051	46055	46059	46063	U16	kW	1
Restart kW	46036	46040	46044	46048	46052	46056	46060	46064	U16	kW	1

8.6 Main CBs

TABLE 38. MAIN CBS MODBUS REGISTERS

	Modbus Registers							Scaling		
Parameter	Tie1	Tie2	Feeder1	Feeder2	Feeder3	Feeder4	LB1	Type	UNIT	Multiplier
Line	47201	47205	47779	47783	47787	47791	412001	U16	Enum	N/A
Load	47202	47206	47780	47784	47788	47792	412002	U16	Enum	N/A
Pos	47203	47207	47781	47785	47789	47793	412003	U16	Enum	N/A
Status	47204	47208	47782	47786	47790	47794	412004	U16	Bit Field	N/A

TABLE 39. LINE/LOAD BUS STATUS

Line/Load Bus Status	Enum
Cold	0
Hot	1
Unknown	2

TABLE 40. CB POSITION

CB Position	Enum
Open	0
Closed	1
Unknown	2
Disconnected	3
Earthed	4

TABLE 41. CB STATUS

CB Status	Bit
Is Future	0
Fail	1
Man Ind	2
Sync En	3
Alarm Fail To Open	4
Alarm Fail To Close	5
Alarm Fail To Sync	6
Alarm Aux Fail	7
Alarm Gnd Fault	8
Alarm LO Trip	9
Alarm PR Fail	10
Alarm Unexp Open	11
Alarm Unexp Close	12
Alarm Unexp Auto Man	13
Alarm Unexp Disc	14
Alarm Hw Man	15

8.7 Status and Alarms

TABLE 42. STATUS AND ALARMS

Parameter	Modbus	
	Register	Bit
Trans Mode Man Ind	46240	0
Trans Mode OT Ind	46240	1
Trans Mode SCT Ind	46240	2
Trans Mode HCT Ind	46240	3
Sys Op Mode Off Ind	46241	0
Sys Op Mode Test WO Load Ind	46241	1
Test WO Load A Choose	46241	2
Test WO Load B Choose	46241	3
Sys Op Mode MT Ind	46241	4
MT A Choose	46241	5
MT B Choose	46241	6
Gen Start Mode No Utility Backup Mode Ind	46241	7
Gen Start Mode Utility Backup Mode Ind	46241	8
Gen Start Mode Remote Start Mode Ind	46241	9
Ctrl Selection Operator Ind	46242	0
Ctrl Selection Hardwired Ind	46242	1
Ctrl Selection Scheduler Ind	46242	2
Remote EStop Alarm	46243	0
Quick Shed Alarm	46244	0
Load Dump Signal Error	46244	1
Genbus Overload Alarm[1]	46244	2
PLC Fail Alarm	46246	0
M340 SD Card Fail Alarm	46246	1
IO Alarm Net1 Id[3] Link01 Fail	46251	5
IO Alarm Net1 Id[3] Link02 Fail	46251	1
IO Alarm Net1 Id[3] Device Warn	46251	2
IO Alarm Net1 Id[3] Device Fail	46251	3
IO Alarm Net1 Id[3] Comms Alarm	46251	4
IO Alarm Net1 Id[4] Link01 Fail	46252	0
IO Alarm Net1 Id[4] Link02 Fail	46252	1

Parameter	Modbus	
	Register	Bit
IO Alarm Net1 Id[4] Device Warn	46252	2
IO Alarm Net1 Id[4] Device Fail	46252	3
IO Alarm Net1 Id[4] Comms Alarm	46252	4
IO Alarm Net1 Id[12] Link01 Fail	46260	0
IO Alarm Net1 Id[12] Link02 Fail	46260	1
IO Alarm Net1 Id[12] Device Warn	46260	2
IO Alarm Net1 Id[12] Device Fail	46260	3
IO Alarm Net1 Id[12] Comms Alarm	46260	4
IO Alarm Net1 Id[13] Link01 Fail	46261	0
IO Alarm Net1 Id[13] Link02 Fail	46261	1
IO Alarm Net1 Id[13] Device Warn	46261	2
IO Alarm Net1 Id[13] Device Fail	46261	3
IO Alarm Net1 Id[13] Comms Alarm	46261	4
Load Ctrl Disable Alarm[1]	46281	0
Low Fuel Tank Alarm iRaw	46282	0
MCM H Fault Alarm[1]	46283	0
NGR Fault[1]	46284	0
Station Power Alarm	46285	0
Station Power On Bat Alarm	46285	1
Max Ramp Up Alarm[1]	46286	0
Max Ramp Up Alarm[2]	46286	1
Max Ramp Down Alarm[1]	46287	0
Max Ramp Down Alarm[2]	46287	1
Min Capacity Not Met Alarm[1]	46288	0
Min Capacity Not Met Alarm[2]	46288	1
Fail To Disc Alarm[1]	46289	0
Fail To Disc Alarm[2]	46289	1
NEC Gen Shtdn Fault	46290	0
Utility[1] Fail Alarm	46291	1
Utility[2] Fail Alarm	46291	2
Utility[3] Fail Alarm	46291	3
Utility[4] Fail Alarm	46291	4
Remote Start 1	46291	5

Parameter	Modbus	
	Register	Bit
Remote Start 2	46291	6

9 ECO Tier4 Modbus TCP Register Map

NOTICE

Earlier versions of software may not support all of the Modbus registers in the following table. If a particular register is not available in your installation, it is possible that the Modbus connection is working but the controller software does not support that particular register.

NOTICE

If an address or bit is not listed in this table it is not implemented.

FAULT CODE 3697 - Engine Control Module Calibration Memory - Bad Intelligent Device or Component

Associated Procedures			
Procedure Title	Procedure Number	Service Model Name	Bulletin Number
Engine Control Module	Refer to Procedure 019-031	ISF2.8 CM2220 EC2CF	4310641
Engine Control Module	Refer to Procedure 019-031	ISF2.8 CM2220 E ISF2.8 CM2220 AN ISF2.8 CM2220 IAN	4022178
Engine Control Module	Refer to Procedure 019-031	ISF3.8 CM2220 ISF3.8 CM2220 AN ISF3.8 CM2220 IAN	4021704
Engine Control Module	Refer to Procedure 019-031	ISF2.8 CM2220 F122	5467376
Engine Control Module	Refer to Procedure 019-031	ISF3.8 CM2220 F103	4310839
Engine Control Module	Refer to Procedure 019-031	ISB4.5, ISB6.7, ISD4.5, and ISD6.7 CM2150 SN	4022188
Engine Control Module	Refer to Procedure 019-031	ISV5.0 CM3230 V104	4367291
Engine Control Module	Refer to Procedure 019-031	ISL8.9 CM2150 SN	4022190
Engine Control Module	Refer to Procedure 019-031	ISM11 CM876 SN	4022196
Engine Control Module	Refer to Procedure 019-031	ISZ13 CM2150	4022133
Engine Control Module	Refer to Procedure 019-031	ISX15 CM2250 GX CM2250	4022250
Engine Control Module	Refer to Procedure 019-031	ISX12/ISX11.9 CM2250	2883445
Engine Control Module	Refer to Procedure 019-031	QSL9 CM2250	4022256
Engine Control Module	Refer to Procedure 019-031	QSB6.7 CM2250	4022255
Engine Control Module	Refer to Procedure 019-031	QSB6.7 CM2250 EC	2883621
Engine Control Module	Refer to Procedure 019-031	QSB3.3 CM2250 EC	2883647
Engine Control Module	Refer to Procedure 019-031	QSX15 CM2250 ECF	2883557

Engine Control Module	Refer to Procedure 019-031	PowerGen QSX15 CM2250 ECF	4310661
Engine Control Module	Refer to Procedure 019-031	PowerGen QSX15 CM2250	4310664
Engine Control Module	Refer to Procedure 019-031	QSX11.9 CM2250 ECF	2883561
Engine Control Module	Refer to Procedure 019-031	ISB6.7 CM2350 B101	2883567
Engine Control Module	Refer to Procedure 019-031	ISL9 CM2350 L101	4310787
Engine Control Module	Refer to Procedure 019-031	ISX12 CM2350 X102	4310646
Engine Control Module	Refer to Procedure 019-031	ISX15 CM2350 X101	4310641
Engine Control Module	Refer to Procedure 019-031	ISX15 CM2250 SN	4310736
Engine Control Module	Refer to Procedure 019-031	ISB4.5 CM2350 B104	4332646
Engine Control Module.	Refer to Procedure 019-031	ISB6.7 CM2350 B103	4332641
Engine Control Module	Refer to Procedure 019-031	QSB6.7 CM2350 B105	4332778
Engine Control Module	Refer to Procedure 019-031	QSL9 CM2350 L102	4332796
Engine Control Module	Refer to Procedure 019-031	ISB/ISD4.5 CM2150 B119	4358465
Engine Control Module	Refer to Procedure 019-031	ISB/ISD6.7 CM2150 B120	4358470
Engine Control Module	Refer to Procedure 019-031	ISL8.9 CM2350 L110	4358475
Engine Control Module	Refer to Procedure 019-031	ISF3.8 CM2220 F110	4358480
Engine Control Module	Refer to Procedure 019-031	QSL9 M CM2250 L106	4358343
Engine Control Module	Refer to Procedure 019-031	QSZ13 CM2150 Z101	4358364
Engine Control Module	Refer to Procedure 019-031	QSZ13 CM2150 Z102	4358369
Engine Control Module	Refer to Procedure 019-031	QSB6.7 CM2350 B112	4358498

Associated Procedures			
Procedure Title	Procedure Number	Service Model Name	Bulletin Number
Engine Control Module	Refer to Procedure 019-031	QSF2.8 CM2880 F105	4358561
Engine Control Module	Refer to Procedure 019-031	ISL9 CM2350 L111	4367223
Engine Control Module	Refer to Procedure 019-031	QSB4.5 CM2350 B106	4367376
Engine Control Module	Refer to Procedure 019-031	QSF3.8 CM2350 F107	4367316
Engine Control Module	Refer to Procedure 019-031	QSG12 CM2350 G110	4367323
Engine Control Module	Refer to Procedure 019-031	QSF2.8 CM2880 F114	4383734
Engine Control Module	Refer to Procedure 019-031	ISF2.8 CM2220 F117	4388578
Engine Control Module	Refer to Procedure 019-031	QSL9 CM2350 L107	4367386
Engine Control Module	Refer to Procedure 019-031	QSB6.7 CM2250 B128	4388601
Engine Control Module	Refer to Procedure 019-031	QSL9 CM2250 L115	4388626
Engine Control Module	Refer to Procedure 019-031	QSF3.8 CM2350 F118	4388708

Engine Control Module	Refer to Procedure 019-031	QSF3.8 CM2350 F119	4388703
Engine Control Module	Refer to Procedure 019-031	ISF3.8 CM2220 F116	4383664
Engine Control Module	Refer to Procedure 019-031	QSB6.7 CM2350 B130	4388668
Engine Control Module	Refer to Procedure 019-031	QSL9 CM2350 L118	4388673
Engine Control Module	Refer to Procedure 019-031	QSB4.5 CM2350 B122	4388767
Engine Control Module	Refer to Procedure 019-031	ISF2.8 CM2220 F126	5411159
Engine Control Module	Refer to Procedure 019-031	X15 CM2350 X114B	5411181
Engine Control Module	Refer to Procedure 019-031	X15 CM2350 X116B	5411186
Engine Control Module	Refer to Procedure 019-031	B6.7 CM2350 B121B	5411223
Engine Control Module	Refer to Procedure 019-031	ISB6.7 CM2350 B142	5411131
Engine Control Module	Refer to Procedure 019-031	QSX15 CM2250 X115	4388739
Engine Control Module	Refer to Procedure 019-031	QSB4.5 CM2250 B131	4388774
Engine Control Module	Refer to Procedure 019-031	QSB3.3 CM2250 B137	5411058
Engine Control Module	Refer to Procedure 019-031	L9 CM2350 L116B	5411330
Engine Control Module	Refer to Procedure 019-031	F3.8 CM350 F120B	5411237
Engine Control Module	Refer to Procedure 019-031	B4.5 CM2350 B129B	5411247
Engine Control Module	Refer to Procedure 019-031	B6.7 CM2350 B135B	5411257
Engine Control Module	Refer to Procedure 019-031	B4.5 CM2350 B147B	5411252
Engine Control Module	Refer to Procedure 019-031	B6.7 CM2350 B148B	5411262
Engine Control Module	Refer to Procedure 019-031	L9 CM2350 L119B	5411267
Engine Control Module	Refer to Procedure 019-031	QSB6.7 CM2350 B145	5411273
Engine Control Module	Refer to Procedure 019-031	QSL9 CM2350 L122	5411278
Engine Control Module	Refer to Procedure 019-031	QSB4.5 CM2350 B144	5411382
Engine Control Module	Refer to Procedure 019-031	L9 CM2350 L123B	5411465
Engine Control Module	Refer to Procedure 019-031	QSF2.8 CM2880 F124	5411484
Engine Control Module	Refer to Procedure 019-031	QSF2.8 CM2880 F131	5411489
Engine Control Module	Refer to Procedure 019-031	ISF4.5 CM2220 F123	5411320
Engine Control Module	Refer to Procedure 019-031	QSF3.8 CM2350 F125	5411494
Engine Control Module	Refer to Procedure 019-031	QSX15 CM2350 X118	5467247
Engine Control Module	Refer to Procedure 019-031	QSG12 CM2350 G113	5467252
Engine Control Module	Refer to Procedure 019-031	R2.8 CM2220 R101B	5467556
Engine Control Module	Refer to Procedure 019-031	F3.8 CM2350 F132B	5467327
Engine Control Module	Refer to Procedure 019-031	ISB5.9 CM2880 B110	4332883
Engine Control Module	Refer to Procedure 019-031	B6.7 CM2350 B136C	5504194
Engine Control Module	Refer to Procedure 019-031	L9 CM2350 L120C	5504199

Engine Control Module	Refer to Procedure 019-031	ISF3.8 CM2220 F134B	5504165
-----------------------	----------------------------	---------------------	---------

Associated Procedures			
Procedure Title	Procedure Number	Service Model Name	Bulletin Number
Engine Control Module	Refer to Procedure 019-031	F3.8 CM2350 F133C	5504278
Engine Control Module	Refer to Procedure 019-031	F3.8 CM2350 F128C	5504273
Engine Control Module	Refer to Procedure 019-031	B4.5 CM2350 B145C	5504283
Engine Control Module	Refer to Procedure 019-031	F2.8 CM2620 F135B	5504616
Engine Control Module	Refer to Procedure 019-031	F2.8 CM2620 F136B	5504621
Engine Control Module	Refer to Procedure 019-031	F3.8 CM2620 F137B	5579617
Engine Control Module	Refer to Procedure 019-031	F4.5 CM2620 F139B	5579622

TROUBLESHOOTING STEPS**STEP 1: Check the fault codes.****STEP 1A: Check for active fault codes.**

Condition: - Turn keyswitch ON. - Connect INSITE™ electronic servicetool.		
Action	Specification/Repair	Next Step
Check the fault codes. Use INSITE™ electronic service tool to read the fault codes.	Fault Code 111 active? YES	Fault Code 111 troubleshooting tree.
	Fault Code 111 active? NO	2A

STEP2: Calibrate the ECM.**STEP 2A: Calibrate the ECM.**

Condition: - Connect all components. - Turn keyswitch ON. - Connect INSITE™ electronic service tool.		
Action	Specification/Repair	Next Step

Use INSITE™ electronic service tool to calibrate the ECM with the latest engine calibration. Refer to the calibration revisions listed in the ECM Calibration Revision History to find the latest calibration available for the engine being serviced. • Use INSITE™ electronic service tool to find the present ECM code and revision number in the ECM. The ECM code and revision number are found in the Calibration Information section of System ID and Dataplate in Features and Parameters.	Fault Code 3697 active after calibrating the ECM? YES Repair: Replace the ECM. Refer to Procedure 019-031 in the Associated Procedures Table.	2B
	Fault Code 3697 active after calibrating the ECM? NO	2B

This page is intentionally blank.

10 MCM3320

10.1 MCM3320 Modbus Register Map

10.1.1 Modbus Communications

This section defines the Modbus communications interface. Serial communications use an RTU (Remote Terminal Unit) two-wire RS485 multi-drop network configuration described in the Modbus Protocol Reference Guide. The Cummins control is a Slave unit.

10.1.2 Reference Documents

1. "Modbus Over Serial Line Specification and Implementation Guide V1.02" describes the lower levels of Modbus protocol.
2. "Modbus Application Protocol Specification V1.1b3" describes the application layer of the Modbus protocol.

10.1.3 Serial Port Configuration

The port communications occur, by default, at a baud rate of 19200 using eight data bits, one stop-bit with even parity, and are configurable via MON and PCCNet logically.

10.1.4 Device Addresses

The PLC is the Master device in the Modbus network. The Modbus node address is configurable and is set to node 1 by default.

10.1.5 Power-Up Time

The MCM3320 is capable of supporting communication transactions within 10 seconds following initial power-up.

10.1.6 Response Time

The controller responds within 100 ms of a request for information from the Master.

10.1.7 Data Formatting

The format for each register is defined in the Modbus register table.

All data parameters are transmitted as registers. All registers are two 8 bit bytes in length (16 bits per register). If a register requires more than 16 bits, then, the subsequent registers are also used. Therefore, with a 32 bit register X and X+1, the X register contains the upper 16 bits of data and the X+1 register contains the lower 16 bits. A register with 1 bit of data uses the least significant bit of a 16 bit register.

For all discrete data referenced a by bit number, the least significant bit for the register is numbered as 0 inch and the most significant bit as 15 inch. For all fault statuses and event statuses, a 1 inch indicates the fault or event is active and a 0 inch indicates inactive.

10.1.8 Modbus Activity LED

The Modbus activity LED is on when either the control is receiving a Modbus packet or sending a Modbus packet. It is also on when a protocol timer is in timer mode. This precedes a protocol switch on the SC11 port. Otherwise, the LED is off.

10.1.9 Supported Functions

The controller is only capable of processing the following Modbus data and control function queries from the Master:

- Read holding registers (Function Code 03)
- Preset single register (Function Code 06)
- Diagnostics (Function Code 08)
- Preset multiple registers (Function Code 16)

The control responds to any query containing a function code, other than codes 03, 06, 08 and 16, by sending an exception response with the exception code set to 01 (Illegal Function).

The control responds to any read of a single address that is not defined in this specification by sending an exception response with the exception code set to 02 (Illegal Address).

The control responds to any read of a block of 2 or more addresses containing an address that is not defined in this specification by returning data of 0xFFFF for that address.

The control responds to Preset Single Register and Preset Multiple Register functions when the data is out of bounds by sending an exception response with the exception code set to 03 (Illegal Data Value).

10.1.10 Holding Register Function

The control provides the ability to read all read only and read/write registers in the Modbus Registers Table via the Holding Register function. From 1 to 40 contiguous registers can be read at a time. If an attempt is made to read a register that's not available, then an error is returned and none of the data will be returned.

10.1.11 Preset Single/Preset Multiple Registers Function

The control provides the ability to write to (preset) Read/Write registers in the Modbus registers table via both the preset single register (Function Code 06) and the preset multiple registers (Function Code 16). A write to a single register can be performed by the Master using the Modbus data and control function query preset single register (Function Code 06). For writes requiring writes to 1 to 40 contiguous registers, the Master uses the Modbus data and control function query called preset multiple registers (Function Code 16). If a write attempt is made and any of the data is invalid or if an attempt is made to write to a register that's not available, then an error is returned and none of the data will be written.

10.1.12 Diagnostic Counters

The following diagnostic counters is also available via the Modbus diagnostic function (Function Code 08). The following parameters are updated and available via MON and Modbus logical access. A single logical is also available to clear all counters.

- Bus Message Count - Total Modbus packets on bus
- CRC Errors Count - Total Modbus packets received with a bad CRC
- Exception Count - Total Modbus packets received where an exception was sent back
- No Response Count - Total Modbus packets received where no response sent back
- Slave Message Count - Total Modbus packets on bus addressed to this node

10.1.13 Register Maps

Addresses were assigned to maintain compatibility with the existing Modlon gateway where applicable. The following conventions are followed:

- 40xxx - Genset control registers
- 41xxx - Transfer switch control register
- 42xxx - Master control registers (MCM3320)
- 4x0xx - General data registers (volts, current, etc.) primarily for genset bus
- 4x1xx - General data registers (volts, current, etc.) primarily for utility bus
- 4x2xx - Configuration and status registers - Block 1
- 4x3xx - Settings - Block 1
- 4x4xx - Settings - Block 2
- 4x5xx - Bitmap
- 4x6xx - Switch I/O
- 4x7xx - Configuration and status registers - Block 2

10.1.14 Application Layer

The application layer processes the packet. Four functions are supported: Read Hold Registers, Set Single Register, Modbus Loopback, and Set Multiple Registers. If the request packet specifies an unsupported function, then an illegal function response is returned. See the "Modbus Application Protocol Specification" to see how the request and response packets are formatted and how each function processes the data.

10.1.15 Read Hold Registers

Given a starting address and the quantity of registers desired, this function gets the data, formats it if required, and writes it to the TX buffer. If any register in the range is not supported, then an error is returned.

10.1.16 Set Single Register

Given a register address and data, this function verifies that the data is within range; then if OK, writes the data.

10.1.17 Modbus Loopback

This function performs Modbus diagnostic functionality. Some of the functionality defined here is also available via MON and PCCNet logicals. See the "Diagnostic Counters" section of this document for details. The Loopback function supports:

- 0x00 Return Query Data
- 0x01 Restart
- 0x04 Force Listen Only Mode
- 0x0A Clear Counter
- 0x0B Return Bus Message Count
- 0x0C Return Bus Communication Error Count (bad CRC)
- 0x0D Return Bus Exception Error Count

- 0x0E Return Slave Message Count
- 0x0F Return Slave No Response Count

10.1.18 Set Multiple Registers

Given a starting address, the quantity of registers, and two bytes of data for each register, this function verifies that all the data is within range; then if OK, writes all data. If any register in the range is not supported or any of the data is out of range then an error is returned and no data is written. A 32-bit parameter is written using "Write Multiple Register" (Command Code 16) only. Using "Write Single Register" (Command Code 06) returns an exception code 2 - Illegal Address. If both registers are not in the same block, the control sends an exception code 2-Illegal Address.

10.1.19 Modbus Register Table

NOTICE
Earlier versions of software may not support all of the Modbus registers in the following table. If a particular register is not available in your installation, it is possible that the Modbus connection is working but the controller software does not support that particular register.

NOTICE
If an address or bit is not listed in this table it is not implemented.

Addr.	System Name	Access	Specifications		Description	Function
42001	MB logical Read Address	Read / Write	Multiplier: 1.000000000000 Offset: 0 Size (bits):16 Sign: U	Unit: NA Lower Limit: .000 Upper Limit: 65535.000 Default: 0	Logical address to be read via Modbus	Communications
42002	MB Logical Read Data	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: NA Lower Limit: Upper Limit: Default:	Logical data to be read via Modbus	Communications
42004	Save Adjustments	Read / Write	0: Do Nothing 1: Save Trims Default: Do Nothing		Save configuration parameters or adjustments to non-volatile memory. Perform Save Trims after all configurations have been updated. Do not save trims unless a change has occurred.	Controller Information

Addr.	System Name	Access	Specifications		Description	Function
42009	Device Type	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits):16 Sign: U	Unit: NA Lower Limit: Upper Limit: Default:	Hard coded device type id= 52 (0x0034)	Communications
42010	Software Version	Read Only	Multiplier: .000100000000 Offset: 0 Size (bits):16 Sign: U	Unit: NA Lower Limit: Upper Limit: Default:	Software version number	Controller Information
42011	Genset Run Sequence State	Read Only	0: Time Delay Start 1: Time Delay Stop 2: Stop 3: Run Default:		Indicates state of the generator set run sequence	PTC Operating Mode
42012	Current Fault Status	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits):16 Sign: U	Unit: NA Lower Limit: Upper Limit: Default:	The most recently occurring fault which is still active	Fault and Event Information
42017	Genset Bus Status	Read Only	0: Unavailable 1: Dead 2: Live Default:		Energization status of generator Set bus	PTC Sensors
42018	Genset L1N Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Volts Upper Limit: Volts Default	Generator set L1N voltage	Voltage
42019	Genset L2N Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Volts Upper Limit: Volts Default:	Generator set L2N voltage	Voltage
42020	Genset L3N Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Volts Upper Limit: Volts Default:	Generator set L3N voltage	Voltage
42021	Genset LN Average Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Volts Upper Limit: Volts Default:	Generator set LN average voltage	Voltage

Addr.	System Name	Access	Specifications		Description	Function
42022	Genset L1L2 Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Volts Upper Limit: Volts Default:	Generator set L1L2 voltage	Voltage
42023	Genset L2L3 Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Volts Upper Limit: Volts Default	Generator set L2L3 voltage	Voltage
42024	Genset L3L1 Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Volts Upper Limit: Volts Default	Generator set L3L1 voltage.	Voltage
42025	Genset LL Average Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Volts Upper Limit: Volts Default	Generator set LL Average voltage	Voltage
42026	Genset L1 Current	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Amps Lower Limit: Amps Upper Limit: Amps Default	Generator set L1 current	Current
42027	Genset L2 Current	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Amps Lower Limit: Amps Upper Limit: Amps Default	Generator set L2 current	Current
42028	Genset L3 Current	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Amps Lower Limit: Amps Upper Limit: Amps Default:	Generator set L3 current	Current
42029	Genset Average Current	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Amps Lower Limit: Amps Upper Limit: Amps Default:	Generator set average current	Current

Addr.	System Name	Access	Specifications		Description	Function
42030	Genset L1 kW	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: kW Upper Limit: kW Default:	Generator set L1 kW	Power
42031	Genset L2 kW	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: kW Upper Limit: kW Default:	Generator set L2 kW	Power
42032	Genset L3 kW	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: kW Upper Limit: kW Default:	Generator set L3 kW	Power
42033	Genset Total kW	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: kW Upper Limit: kW Default:	Generator set total kW	Power
42034	Genset L1 kVAR	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kVAR Lower Limit: kVAR Upper Limit: kVAR Default:	Generator set L1 kVAR	Power
42035	Genset L2 kVAR	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kVAR Lower Limit: kVAR Upper Limit: kVAR Default:	Generator set L2 kVAR	Power
42036	Genset L3 kVAR	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kVAR Lower Limit: kVAR Upper Limit: kVAR Default:	Generator set L3 kVAR	Power
42037	Genset Total kVAR	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kVAR Lower Limit: kVAR Upper Limit: kVAR Default:	Generator set total kVAR	Power

Addr.	System Name	Access	Specifications		Description	Function
42038	Genset Total Power Factor	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: NA Lower Limit: Upper Limit: Default:	Generator set L1 power factor	Power
42039	Genset L1 kVA	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: kVA Lower Limit: kVA Upper Limit: kVA Default:	Generator set L1 kVA	Power
42040	Genset L2 kVA	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: kVA Lower Limit: kVA Upper Limit: kVA Default:	Generator set L2 kVA	Power
42041	Genset L3 kVA	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: kVA Lower Limit: kVA Upper Limit: kVA Default:	Generator set L3 kVA	Power
42042	Genset Total kVA	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: kVA Lower Limit: kVA Upper Limit: kVA Default:	Generator set total kVA	Power
42043	MB Genset Frequency	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Hz Lower Limit: Hz Upper Limit: Hz Default:	Generator set line frequency scaled by 10 = 1Hz for Modbus	Communications
42044	Genset Total Negative kWh	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: kWh Lower Limit: kWh Upper Limit: kWh Default:	Generator set total negative kWh accumulation	Energy
42046	Genset Total Positive kWh	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: kWh Lower Limit: kWh Upper Limit: kWh Default:	Generator set total positive kWh accumulation	Energy

Addr.	System Name	Access	Specifications		Description	Function
42048	Genset Total Net kWh	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kWh Lower Limit: kWh Upper Limit: kWh Default:	Generator set total net kWh accumulation	Energy
42050	Genset Total Negative kVARh	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: kVARh Lower Limit: kVARh Upper Limit: kVARh Default:	Generator set total negative kVARh accumulation	Energy
40052	Genset Total Positive kVARh	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: kVARh Lower Limit: kVARh Upper Limit: kVARh Default:	Generator set total positive kVARh accumulation	Energy
42054	Genset Total Net kVARh	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kVARh Lower Limit: kVARh Upper Limit: kVARh Default:	Generator set total net kVARh accumulation	Energy
42056	Genset Total kVAh	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: kVARh Lower Limit: kVARh Upper Limit: kVARh Default:	Generator set total kVAh accumulation	Energy
42058	Genset Available Current	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Amps Lower Limit: Amps Upper Limit: Amps Default:	Calculated amps which represent 100-% generator set bus current - used by bargraph	Current
42059	Genset L1 Current Percent	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: % Lower Limit: % Upper Limit: % Default:	Generator set L1 current as percent of generator Set total current capacity - used by bargraph	Current
42060	Genset L2 Current Percent	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: % Upper Limit: % Default:	Generator set L2 current as percent of generator Set total current capacity - used by bargraph	Current

Addr.	System Name	Access	Specifications		Description	Function
42061	Genset L3 Current Percent	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: % Upper Limit: % Default:	Generator set L3 current as percent of generator Set total current capacity - used by bargraph	Current
42062	Genset Total kW Percent	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: % Lower Limit: % Upper Limit: % Default:	Generator set kW as percent of total generator set capacity - used by bargraph	Power
42063	Genset Frequency Percent	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: % Upper Limit: % Default:	Generator set frequency as percent of system frequency - used by bargraph	Frequency
42064	Genset L1L2 Voltage%	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: % Upper Limit: % Default:	Generator set L1L2 voltage%	Voltage
42065	Genset L2L3 Voltage%	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: % Upper Limit: % Default:	Generator set L2L3 voltage %	Voltage
42066	Genset L3L1 Voltage%	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: % Upper Limit: % Default:	Generator set L3L1 voltage%	Voltage
42070	Genset Total kW_32bit	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kW Lower Limit: kW Upper Limit: kW Default:	Generator set total kW in 32 bit	Power
42072	Genset Total kVAR_32bit	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kVAR Lower Limit: kVAR Upper Limit: kVAR Default:	Generator set total kVAR in 32 bit	Power

Addr.	System Name	Access	Specifications		Description	Function
42074	Genset Total kVA_32bit	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: kVA Lower Limit: kVA Upper Limit: kVA Default:	Generator set total kVA in 32 bit	Power
42117	Utility Bus Status	Read Only	0: Unavailable 1: Dead 2: Live Default:		Energization status of the utility bus	PTC Sensors
42118	Utility L1N Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Volts Upper Limit: Volts Default:	Utility L1N voltage	Voltage
42119	Utility L2N Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Volts Upper Limit: Volts Default:	Utility L2N voltage	Voltage
42120	Utility L3N Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Volts Upper Limit: Volts Default:	Utility L3N voltage	Voltage
42121	Utility LN Average Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Volts Upper Limit: Volts Default:	Utility LN average voltage	Voltage
42122	Utility L1L2 Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Volts Upper Limit: Volts Default:	Utility L1L2 voltage	Voltage
42123	Utility L2L3 Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Volts Upper Limit: Volts Default:	Utility L2L3 voltage	Voltage
42124	Utility L3L1 Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Volts Upper Limit: Volts Default:	Utility L3L1 voltage	Voltage

Addr.	System Name	Access	Specifications		Description	Function
42125	Utility LL Average Voltage	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: Volts Upper Limit: Volts Default:	Utility LL average voltage	Voltage
42126	Utility L1 Current	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Amps Lower Limit: Amps Upper Limit: Amps Default:	Utility L1 current	Current
42127	Utility L2 Current	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Amps Lower Limit: Amps Upper Limit: Amps Default:	Utility L2 current	Current
42128	Utility L3 Current	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Amps Lower Limit: Amps Upper Limit: Amps Default:	Utility L3 current	Current
42129	Utility Average Current	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Amps Lower Limit: Amps Upper Limit: Amps Default:	Utility average current	Current
42130	Utility L1 kW	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: kW Upper Limit: kW Default:	Utility L1 kW	Power
42131	Utility L2 kW	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: kW Upper Limit: kW Default:	Utility L2 kW	Power
42132	Utility L3 kW	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: kW Upper Limit: kW Default:	Utility L3 kW	Power

Addr.	System Name	Access	Specifications		Description	Function
42133	Utility Total kW	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: kW Upper Limit: kW Default:	Utility total kW	Power
42134	Utility L1 kVAR	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kVAR Lower Limit: kVAR Upper Limit: kVAR Default:	Utility L1 kVAR	Power
42135	Utility L2 kVAR	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kVAR Lower Limit: kVAR Upper Limit: kVAR Default:	Utility L2 kVAR	Power
42136	Utility L3 kVAR	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kVAR Lower Limit: kVAR Upper Limit: kVAR Default:	Utility L3 kVAR	Power
42137	Utility Total kVAR	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kVAR Lower Limit: kVAR Upper Limit: kVAR Default:	Utility total kVAR	Power
42138	Utility Total Power Factor	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: NA Lower Limit: Upper Limit: Default:	Utility L1 power factor	Power
42139	Utility L1 kVA	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: kVA Lower Limit: kVA Upper Limit: kVA Default:	Utility L1 kVA	Power
42140	Utility L2 kVA	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: kVA Lower Limit: kVA Upper Limit: kVA Default:	Utility L2 kVA	Power

Addr.	System Name	Access	Specifications		Description	Function
42141	Utility L3 kVA	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: kVA Lower Limit: kVA Upper Limit: kVA Default:	Utility L3 kVA	Power
42142	Utility Total kVA	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: kVA Lower Limit: kVA Upper Limit: kVA Default:	Utility total kVA	Power
42143	MB Utility Frequency	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Hz Lower Limit: Hz Upper Limit: Hz Default:	Utility line frequency scaled by 10 = 1Hz for Modbus	Communications
42144	Utility Total Negative kWh	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: kWh Lower Limit: kWh Upper Limit: kWh Default:	Utility total negative kWh accumulation	Energy
42146	Utility Total Positive kWh	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: kWh Lower Limit: kWh Upper Limit: kWh Default:	Utility total positive kWh accumulation	Energy
42148	Utility Total Net kWh	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kWh Lower Limit: kWh Upper Limit: kWh Default:	Utility total net kWh accumulation	Energy
42150	Utility Total Negative	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: kVARh Lower Limit: kVARh Upper Limit: kVARh Default:	Utility total negative kVARh accumulation	Energy
42152	Utility Total Positive kVARh	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: kVARh Lower Limit: kVARh Upper Limit: kVARh Default:	Utility total positive kVARh accumulation	Energy

Addr.	System Name	Access	Specifications		Description	Function
42154	Utility Total Net kVARh	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kVARh Lower Limit: kVARh Upper Limit: kVARh Default:	Utility total net kVARh accumulation	Energy
42156	Utility Total kVAh	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: kVAh Lower Limit: kVAh Upper Limit: kVAh Default:	Utility total kVARh accumulation	Energy
42158	System Total kW	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: kW Upper Limit: kW Default:	Sum of generator set bus and utility bus kW	Power
42159	System Total kVAR	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kVAR Lower Limit: kVAR Upper Limit: kVAR Default:	Sum of generator set bus and utility bus kVAR	Power
42160	System Total Power Factor	Read Only	Multiplier: .010000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: NA Lower Limit: Upper Limit: Default:	System total power factor (totalized value of utility bus plus generator set bus)	Power
42161	System Total kVA	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: kVA Lower Limit: kVA Upper Limit: kVA Default:	Sum of generator set bus and utility bus kVA	Power
42162	Utility L1 Current Percent	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: % Upper Limit: % Default:	Utility L1 current as % of utility total current capacity - used by bargraph	Current
42163	Utility L2 Current Percent	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: % Upper Limit: % Default:	Utility L2 current as % of utility total current capacity - used by bargraph	Current

Addr.	System Name	Access	Specifications		Description	Function
42164	Utility L3 Current Percent	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: % Upper Limit: % Default:	Utility L3 current as as % of utility total current capacity - used by bargraph	Current
42165	Utility Total kW Percent	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: % Lower Limit: % Upper Limit: % Default:	Utility total kW as percent of total utility capacity - used by bargraph	Power
42166	Utility Frequency Percent	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: % Upper Limit: % Default:	Utility frequency as percent of system frequency - used by bargraph	Frequency
42167	Utility L1L2 Voltage %	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: % Upper Limit: % Default:	Utility L1L2 voltage %	Voltage
42168	Utility L2L3 Voltage %	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: % Upper Limit: % Default:	Utility L2L3 voltage %	Voltage

Addr.	System Name	Access	Specifications		Description	Function
42169	Utility L3L1 Voltage %	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: % Upper Limit: % Default:	Utility L3L1 voltage %	Voltage
42170	Utility Total kW _32 bit	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kW Lower Limit: kW Upper Limit: kW Default:	Utility total kW	Power
42172	Utility total kVAR _32 bit	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kVAR Lower Limit: kVAR Upper Limit: kVAR Default:	Utility total kVAR in 32 bit	Power

Addr.	System Name	Access	Specifications		Description	Function
42174	Utility total kVA_32 bit	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: kVA Lower Limit: kVA Upper Limit: kVA Default:	Utility total kVA in 32 bit	Power
42176	System Total kW_32 bit	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kW Lower Limit: kW Upper Limit: kW Default:	Sum of generator bus and utility bus kW in 32 bit	Power
42178	System Total kVAR_32 bit	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kVAR Lower Limit: kVAR Upper Limit: kVAR Default:	Sum of generator bus and utility bus kVAR in 32 bit	Power
42180	System Total kVA_32 bit	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: kVA Lower Limit: kVA Upper Limit: kVA Default:	Sum of generator set and utility bus kVA in 32 bit	Power
42200	Total Number of Gensets	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: Upper Limit: Default:	Number of generator sets with non-zero rating entered	System Information
42201	Total System Capacity	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: kW Lower Limit: kW Upper Limit: kW Default:	Sum of the generator set kW ratings	System Information
42202	Total Online Capacity	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: kW Upper Limit: kW Default:	Sum of the generator set kW ratings for generator sets which are Online	System Information
42203	Programmed Transition Timer	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: seconds Upper Limit: seconds Default:	Countdown value of the programmed transition timer	PTC Timers

Addr.	System Name	Access	Specifications		Description	Function
42204	Transfer Timer	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: seconds Upper Limit: seconds Default:	Countdown value of the transfer timer	PTC Timers
42205	Retransfer Timer	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: seconds Upper Limit: seconds Default:	Countdown value of the retransfer timer	PTC Timers
42206	Maximum Parallel Timer	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: seconds Upper Limit: seconds Default:	Countdown value of the maximum parallel timer	PTC Timers
42207	kW Reference	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: kW Upper Limit: kW Default:	kW Control reference value for utility paralleling	Master Load Control
42208	Utility Unloaded Status	Read Only	0: Not Available 1: Not Unloaded 2: Unloaded Default:		Indicates utility unloaded status	Master Load Control
42209	Genset Unloaded Status	Read Only	0: Not Available 1: Not Unloaded 2: Unloaded Default:		Indicates generator set unloaded status	Master Load Control

Addr.	System Name	Access	Specifications		Description	Function
42210	System State	Read Only	0: Not Available 1: TD Start 2: TD Stop 3: TD Programmed Transition 4: TD Transfer 5: TD Retransfer 6: Synchronizing 7: Sync Check OK 8: Inhibit 9: Unassigned 10: Ramp Upload 11: Ramp Load 12: Manual 13: Utility Failure 14: Test 15: Standby 16: Factory Test 17: Extended Parallel Default: Not Available		Indicates what state the control is currently IN	System Information
42211	PTC Operating Mode	Read Only	0: Manual 1: Normal 2: Normal Override 3: Test 4: Utility Fail 5: Extended Parallel Default:		Indicates the Current PTC Operating mode. Read/Write on comp mode.	PTC Operating Mode
42212	Active Transition Timer	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: seconds Upper Limit: seconds Default:	Countdown timer value of active timer	PTC Timers
42213	Hardware Version	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: Upper Limit: Default:	Indicates the hardware version of the board	Discrete Inputs
42214	Controller On Time	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: seconds Lower Limit: .000 sec. Upper Limit: 4294967295.000 sec Default: 0	Amount of time in seconds the controller has been powered	Controller Information

Addr.	System Name	Access	Specifications		Description	Function
42216	Genset Availability Status	Read Only	0: Not Available 1: Available 2: Unknown Default:		Indicates availability of generator set for Loading, as determined by the generator set sensors	PTC Availability
42217	Utility Availability Status	Read Only	0: Not Available 1: Available 2: Unknown Default:		Indicates availability of utility for loading as determined by the utility sensors	PTC Availability
42218	Gen CB Position Status	Read Only	0: Open 1: Closed 2: Not Available Default:		Generator set breaker position	Breaker Control
42219	Util CB Position Status	Read Only	0: Open 1: Closed 2: Not Available Default:		Utility breaker position	Breaker Control
42220	kVAR Load Reference	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kVAR Lower Limit: kVAR Upper Limit: kVAR Default:	kVAR control reference value for extended paralleling	Master Load Control
42221	kVAR Load Setpoint Engr Units Display Value	Read Only	Multiplier: .010000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: % Upper Limit: % Default:	Engineering units value for the kVAR load setpoint analog input	Analog Inputs
42222	kW Load Setpoint Engr Units Display Value	Read Only	Multiplier: .010000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: % Lower Limit: % Upper Limit: % Default:	Engineering units value for the kW load setpoint analog input	Analog Inputs
42223	Power Factor Setpoint	Read Only	Multiplier: .010000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: NA Lower Limit: Upper Limit: Default:	Power factor setpoint analog input value (uses kVAR load setpoint analog input)	Analog Inputs

Addr.	System Name	Access	Specifications		Description	Function
42224	PTC State	Read Only	0: Not Enabled 1: No Source Connected 2: Utility Connected 3: Genset Connected 4: Paralleled Default:		Indicates the connected state of power transfer control. read / write in comp.	PTC State Machine
42225	Sync Check Close Allowed	Read Only	0: Not Allowed 1: Allowed Default:		Indicates whether any sync check conditions have been met	Master Sync Control
42226	Sync Phase Difference	Read Only	Multiplier: .010000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: degrees Lower Limit: degrees Upper Limit: degrees Default:	Utility to generator set L1 voltage phase angle	Phase
42227	Synchronizer Status	Read Only	0: Synchronizer Off 1: Synchronizer On Default:		Indicates state of the synchronizer	Master Sync Control
42228	System Lockout Status	Read Only	0: Inactive 1: Active Default:		Faults have occurred which prevent normal system operation; reset faults	System Information
42229	Breaker 1 Position	Read Only	0: Open 1: Closed 2: Not Available Default: Not Available		Indicates the position status of breaker 1	Load Add Shed Control
42230	Breaker 2 Position	Read Only	0: Open 1: Closed 2: Not Available Default: Not Available		Indicates the position status of breaker 2	Load Add Shed Control
42231	Breaker 3 Position	Read Only	0: Open 1: Closed 2: Not Available Default: Not Available		Indicates the position status of breaker 3	Load Add Shed Control
42232	Breaker 4 Position	Read Only	0: Open 1: Closed 2: Not Available Default: Not Available		Indicates the position status of breaker 4	Load Add Shed Control

Addr.	System Name	Access	Specifications	Description	Function
42233	Breaker 5 Position	Read Only	0: Open 1: Closed 2: Not Available Default: Not Available	Indicates the position status of breaker 5	Load Add Shed Control
42234	Breaker 6 Position	Read Only	0: Open 1: Closed 2: Not Available Default: Not Available	Indicates the position status of breaker 6	Load Add Shed Control
42235	Breaker 1 Trip Status	Read Only	0: Not Available 1: Normal 2: Tripped Default: Not Available	Indicates trip status of breaker 1	Load Add Shed Control
42236	Breaker 2 Trip Status	Read Only	0: Not Available 1: Normal 2: Tripped Default: Not Available	Indicates trip status of breaker 2	Load Add Shed Control
42237	Breaker 3 Trip Status	Read Only	0: Not Available 1: Normal 2: Tripped Default: Not Available	Indicates trip status of breaker 3	Load Add Shed Control
42238	Breaker 4 Trip Status	Read Only	0: Not Available 1: Normal 2: Tripped Default: Not Available	Indicates trip status of breaker 4	Load Add Shed Control
42239	Breaker 5 Trip Status	Read Only	0: Not Available 1: Normal 2: Tripped Default: Not Available	Indicates trip status of breaker 5	Load Add Shed Control
42240	Breaker 6 Trip Status	Read Only	0: Not Available 1: Normal 2: Tripped Default: Not Available	Indicates trip status of breaker 6	Load Add Shed Control
42241	ATS 1 Position	Read Only	0: Not Available 1: No Source Connected 2: Source 1 Connected 3: Source 2 Connected 4: Paralleled Default: Not Available	Indicates position status of ATS 1	Load Add Shed Control

Addr.	System Name	Access	Specifications	Description	Function
42242	ATS 2 Position	Read Only	0: Not Available 1: No Source Connected 2: Source 1 Connected 3: Source 2 Connected 4: Paralleled Default: Not Available	Indicates position status of ATS 2	Load Add Shed Control
42243	ATS 3 Position	Read Only	0: Not Available 1: No Source Connected 2: Source 1 Connected 3: Source 2 Connected 4: Paralleled Default: Not Available	Indicates position status of ATS 3	Load Add Shed Control
42244	ATS 4 Position	Read Only	0: Not Available 1: No Source Connected 2: Source 1 Connected 3: Source 2 Connected 4: Paralleled Default: Not Available	Indicates position status of ATS 4	Load Add Shed Control
42245	ATS 5 Position	Read Only	0: Not Available 1: No Source Connected 2: Source 1 Connected 3: Source 2 Connected 4: Paralleled Default: Not Available	Indicates position status of ATS 5	Load Add Shed Control
42246	Position	Read Only	0: Not Available 1: No Source Connected 2: Source 1 Connected 3: Source 2 Connected 4: Paralleled Default: Not Available	Indicates position status of ATS 6	Load Add Shed Control
42247	SID1 Status	Read Only	0: Missing 1: Good 2: Connecting 3: No EXP Board 4: Not Applicable Default:	Indicates status of SID1 (AUX 101 / 102 module 1)	Communications
42248	SID0 Status	Read Only	0: Missing 1: Good 2: Connecting 3: No EXP Board 4: Not Applicable Default:	Indicates status of SID0 (AUX 101 / 102 module 0)	Communications

Addr.	System Name	Access	Specifications		Description	Function
42249	Expansion Board Communications	Read Only	0: Disable 1: Enable Default: Disable		Indicates the status of SIDO to expansion board connection	Communications
42250	Current Add Level	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: Upper Limit: Default:	Indicates the next level to add	Load Add Shed Control
42251	Current Shed Level	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: Upper Limit: Default:	Indicates the next level to shed	Load Add Shed Control
42252	Add Level 1 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing		Indicates status of add level 1	Load Add Shed Control
42253	Add Level 2 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing		Indicates status of add level 2	Load Add Shed Control
42254	Add Level 3 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing		Indicates status of add level 3	Load Add Shed Control
42255	Add Level 4 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing		Indicates status of add level 4	Load Add Shed Control
42256	Add Level 5 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing		Indicates status of add level 5	Load Add Shed Control
42257	Add Level 6 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing		Indicates status of add level 6	Load Add Shed Control
42258	Shed Level 1 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing		Indicates status of shed level 1	Load Add Shed Control
42259	Shed Level 2 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing		Indicates status of shed level 2	Load Add Shed Control
42260	Shed Level 3 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing		Indicates status of shed level 3	Load Add Shed Control

Addr.	System Name	Access	Specifications	Description	Function
42261	Shed Level 4 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates status of shed level 4	Load Add Shed Control
42262	Shed Level 5 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates status of shed level 5	Load Add Shed Control
42263	Manual Add Level 1 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Operator input to add level 1	Load Add Shed Control
42264	Manual Add Level 2 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Operator input to add level 2	Load Add Shed Control
42265	Manual Add Level 3 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Operator input to add level 3	Load Add Shed Control
42266	Manual Add Level 4 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Operator input to add level 4	Load Add Shed Control
42267	Manual Add Level 5 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Operator input to add level 5	Load Add Shed Control
42268	Manual Add Level 6 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Operator input to add level 6	Load Add Shed Control
42269	Manual Shed Level 1 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Operator input to shed loads assigned to level 1	Load Add Shed Control
42270	Manual Shed Level 2 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Operator input to shed loads assigned to level 2	Load Add Shed Control
42271	Manual Shed Level 3 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Operator input to shed loads assigned to level 3	Load Add Shed Control
42272	Manual Shed Level 4 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Operator input to shed loads assigned to level 4	Load Add Shed Control
42273	Manual Shed Level 5 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Operator Input to Shed Loads Assigned to Level 5	Load Add Shed Control

Addr.	System Name	Access	Specifications	Description	Function
42274	Restored Shed Level 1 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates if shed level 1 has been restored	Load Add Shed Control
42275	Restored Shed Level 2 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates if shed level 2 has been restored	Load Add Shed Control
42276	Restored Shed Level 3 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates if shed level 3 has been restored	Load Add Shed Control
42277	Restored Shed Level 4 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates if shed level 4 has been restored	Load Add Shed Control
42278	Restored Shed Level 5 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates if shed level 5 has been restored	Load Add Shed Control
42279	Add Load 1 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates add command for load 1	Load Add Shed Control
42280	Add Load 2 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates add command for load 2	Load Add Shed Control
42281	Add Load 3 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates add command for load 3	Load Add Shed Control
42282	Add Load 4 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates add command for load 4.	Load Add Shed Control
42283	Add Load 5 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates add command for load 5	Load Add Shed Control
42284	Add Load 6 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates add command for load 6	Load Add Shed Control
42285	Shed Load 1 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates shed command for load 1	Load Add Shed Control
42286	Shed Load 2 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates shed command for load 2	Load Add Shed Control

Addr.	System Name	Access	Specifications		Description	Function
42287	Shed Load 3 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing		Indicates shed command for load 3	Load Add Shed Control
42288	Shed Load 4 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing		Indicates Shed Command for Load 4	Load Add Shed Control
42289	Shed Load 5 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing		Indicates shed command for load 5	Load Add Shed Control
42290	Shed Load 6 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing		Indicates shed command for load 6	Load Add Shed Control
42291	Battery Voltage Engr Units Display Value	Read Only	Multiplier: .010000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: VDC Lower Limit: VDC Upper Limit: VDC Default	Engineering units value for the battery voltage analog input	Analog Inputs
42292	kVAR Master Load Control Output Predictor Value	Read Only	Multiplier: .010000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: VDC Lower Limit: VDC Upper Limit: VDC Default	Voltage level commanded to kVAR Master load control analog output	Analog Inputs
42293	kW Master Load Control Output Predictor Value	Read Only	Multiplier: .010000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: VDC Lower Limit: VDC Upper Limit: VDC Default	Voltage level commanded to kW Master load control analog output	Analog Inputs
42294	Master Frequency Bias Output Predictor Value	Read Only	Multiplier: .010000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: VDC Lower Limit: VDC Upper Limit: VDC Default	Voltage level commanded to Master frequency bias analog output	Analog Inputs
42295	Master Voltage Bias Output Predictor Value	Read Only	Multiplier: .010000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: VDC Lower Limit: VDC Upper Limit: VDC Default	Voltage level commanded to Master voltage bias analog output	Analog Inputs

Addr.	System Name	Access	Specifications	Description	Function
42296	PTC Genset Operating Mode	Read Only	0: Manual 1: Normal 2: Normal Override 3: Test 4: Utility Fail 5: Extended Parallel Default	Indicates the current operating mode of the generator set	PTC Genset Operating Mode
42297	PTC Transfer Pair Operating Mode	Read Only	0: Manual 1: Normal 2: Normal Override 3: Test 4: Utility Fail 5: Extended Parallel Default:	Indicates the current operating mode of the transfer pair	PTC Genset Operating Mode
42298	PTC Operating Transition Type	Read Only	0: Open Transition 1: Hard Closed Transition 2: Soft Closed Transition Default:	Indicates the transition type currently applicable to the PTC function operation	PTC Genset Operating Mode

Addr.	System Name	Access	Specifications	Description	Function
42299	Expansion Board Communications 1	Read Only	0: Disabled 1: Enabled Default: Disabled	Indicates the status of the SID1 to expansion board connection	Communications
42300	System Topology	Read/Write	0: Master Synchronize Only 1: Isolated Bus w/ out GM 2: Isolated Bus w/GM 3: Common Bus 4: Transfer Pair 5: Component Mode Default: Master Synchronize Only	Main setting: sets system topology; control must be in manual to set	Application Configuration
42301	Transition Type	Read/Write	0: Open Transition 1: Hard Closed Transition 2: Soft Closed Transition Default: Open Transition	Sets the type of transition that will be used	Application Configuration
42302	Extended Parallel Enable	Read/Write	0: Disabled 1: Enabled Default: Disabled	Use to enable extended paralleling operation	Application Configuration

Addr.	System Name	Access	Specifications		Description	Function
42303	Load Demand Type	Read/Write	0: None 1: Fixed Sequence 2: Run Hours Default: None		Sets the load demand type	Load Demand Control
42304	Priority Control Method	Read/Write	0: Manual 1: Automatic Default: Manual		Set the priority control method	Priority Control
42305	Genset 01 kW Rating	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: .000 kW Upper Limit: 32000.000 kW Default: 1000	Sets generator 1 kW rating	System Information
42306	Genset 02 kW Rating	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: .000 kW Upper Limit: 32000.000 kW Default: 0	Sets generator 2 kW rating	System Information
42307	Genset 03 kW Rating	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: .000 kW Upper Limit: 32000.000 kW Default: 0	Sets generator 3 kW rating	System Information
42308	Genset 04 kW Rating	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: .000 kW Upper Limit: 32000.000 kW Default: 0	Sets generator 4 kW rating	PC 3.x
42309	Genset 05 kW Rating	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: .000 kW Upper Limit: 32000.000 kW Default: 0	Sets generator 5 kW rating	System Information
42310	Genset 06 kW Rating	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: .000 kW Upper Limit: 32000.000 kW Default: 0	Sets generator 6 kW rating	System Information
42311	Genset 07 kW Rating	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: .000 kW Upper Limit: 32000.000 kW Default: 0	Sets generator 7 kW rating	System Information

Addr.	System Name	Access	Specifications		Description	Function
42312	Genset 08 kW Rating	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: .000 kW Upper Limit: 32000.000 kW Default: 0	Sets generator 8 kW rating	System Information
42313	Genset 09 kW Rating	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: .000 kW Upper Limit: 32000.000 kW Default: 0	Sets generator 9 kW rating	System Information
42314	Genset 10 kW Rating	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: .000 kW Upper Limit: 32000.000 kW Default: 0	Sets generator 10 kW rating	System Information
42315	Genset 11 kW Rating	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: .000 kW Upper Limit: 32000.000 kW Default: 0	Sets generator 11 kW rating	System Information
42316	Genset 12 kW Rating	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: .000 kW Upper Limit: 32000.000 kW Default: 0	Sets generator 12 kW rating	System Information
42317	Programmed Transition Delay (TDPT)	Read/Write	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Seconds Lower Limit: .000 Seconds Upper Limit: 60.000 Seconds Default: 3	Set the programmed transition time delay	PTC Timers
42318	Transfer Delay (TDNE)	Read/Write	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Seconds Lower Limit: .000 Seconds Upper Limit: 120.000 Seconds Default: 10	Sets the transfer time delay	PTC Timers
42319	Retransfer Delay (TDEN)	Read/Write	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Seconds Lower Limit: .000 Seconds Upper Limit: 1800.000 Seconds Default: 600	Sets the transfer time delay	PTC Timers

Addr.	System Name	Access	Specifications		Description	Function
42320	Maximum Parallel Time (TDMP)	Read/Write	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Seconds Lower Limit: .000 Seconds Upper Limit: 1800.000 Seconds Default: 20	Sets the maximum parallel time for soft load transfers	PTC Timers
42321	Genset Bus %kW Setpoint	Read/Write	Multiplier: .010000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: % Lower Limit: -5.000% Upper Limit: 105.000% Default: 80	Generator set nominal voltage	Master Load Control
42322	Genset Nominal Voltage	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: 100.000 Volts Upper Limit: 45000.000 Volts Default: 480	Generator set nominal voltage	AC Setup
42323	Utility Nominal Voltage	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Volts Lower Limit: 100.000 Volts Upper Limit: 45000.000 Volts Default: 480	Utility nominal voltage	AC Setup
42324	Genset Center Frequency	Read/Write	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Hz Lower Limit: 45.000 Hz Upper Limit: 65.000 Hz Default: 60	Sets the center frequency sensor bandwidth settings	PTC Sensors
42325	Utility Center Frequency	Read/Write	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Hz Lower Limit: 45.000 Hz Upper Limit: 65.000 Hz Default: 60	Sets the center frequency sensor bandwidth settings	PTC Sensors
42326	test With Load Enable	Read/Write	0: Disable 1: Enable Default: Disable		Use to enable or disable load transfer during a Test	Application Configuration
42327	System Frequency	Read/Write	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Hz Lower Limit: 45.000 Hz Upper Limit: 65.000 Hz Default: 60	Use to define the system nominal frequency	System Information

Addr.	System Name	Access	Specifications		Description	Function
42328	Genset Bus kW Setpoint Source	Read/Write	0: Internal 1: Analog Input Default Internal		Selects where the generator set kW setpoint will come from for extended paralleling	Master Load Control
42329	Genset Bus kVAR Setpoint Source	Read/Write	0: Internal 1: Analog Input Default Internal		Selects where the generator set kVAR setpoint will come from for extended paralleling	Master Load Control
42330	Genset Bus kW Setpoint	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: .000 kW Upper Limit: 32767.000 kW Default: 0	Set the base load kW setpoint in closed loop extended paralleling	Master Load Control
42331	Genset Bus kVAR Setpoint	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kVAR Lower Limit: .000 kVAR Upper Limit: 32767.000 kVAR Default: 0	Sets the base load kVAR setpoint in closed loop extended paralleling	Master Load Control
42332	Genset Bus % kVAR Setpoint	Read/Write	Multiplier: .010000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: % Lower Limit: -5.000% Upper Limit: 105.000% Default: 0	Sets % kVAR generator output level for open loop base load extended paralleling	Master Load Control
42333	Genset Bus Power Factor Setpoint	Read/Write	Multiplier: .010000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: NA Lower Limit: .700 Upper Limit: 1.000 Default: 1.00	Sets the desired generator set bus power factor in closed loop extended paralleling	Master Load Control
42334	Genset Unloaded Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: -32768.000kW Upper Limit: 32767.000 kW Default: 50	Setpoint for generator set unloaded level	Master Load Control

Addr.	System Name	Access	Specifications		Description	Function
42335	Utility Bus kW Setpoint Source	Read/Write	0: Internal 1: Analog Input Default: Internal		Selects where the utility kW setpoint will come from for extended paralleling	Master Load Control
42336	Utility Bus kVAR Setpoint Source	Read/Write	0: Internal 1: Analog Input Default: Internal		Selects where the utility kVAR setpoint will come from for extended paralleling	Master Load Control
42337	Utility Bus kW Setpoint	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: -32768.000kW Upper Limit: 32767.000 kW Default: 100	Sets the peak Shave kW setpoint in closed loop extended paralleling	Master Load Control
42338	Utility Bus kW Constraint Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: -32768.000kW Upper Limit: 32767.000 kW Default: 100	Sets the utility kW constraint level for base load extended paralleling	Master Load Control
42339	Utility Bus kVAR Setpoint	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: -32768.000 kVAR Upper Limit: 32767.000 kVAR Default: 100	Sets the peak shave kVAR setpoint in closed loop extended paralleling	Master Load Control
42340	Utility Bus Power Factor Setpoint	Read/Write	Multiplier: .010000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: NA Lower Limit: .700 Upper Limit: 1.000 Default: 1.00	Sets the desired utility bus power factor in loop extended paralleling	Master Load Control
42341	Utility Unloaded Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: -32768.000kW Upper Limit: 32767.000 kW Default: 50	Setpoint for utility unloaded level	Master Load Control
42342	Clear Fault History Table	Read/Write	0: Inactive 1: Active Default: Inactive		Use to completely clear the fault history table	Fault and Event Info

Addr.	System Name	Access	Specifications		Description	Function
42343	Clear Occurrence Tables	Read/Write	0: Inactive 1: Active Default: Inactive		Use to completely clear the counters in faults and events occurrence tables	Fault and Event Info
42344	Genset Reset All Energy Meters	Read/Write	0: Do Nothing 1: Clear Counters Default: Do Nothing		Use to permanently clear all generator set energy meter values	Energy
42345	Utility Reset All Energy Meters	Read/Write	0: Do Nothing 1: Clear Counters Default: Do Nothing		Use to permanently clear all utility energy meter values	Energy
42346	Extended Paralleling kW Load Control Type	Read/Write	0: Genset Bus % Level (Open Loop) 1: Genset Bus kW (Closed Loop) 2: Genset Bus kW w/ Utility Constraint (Closed Loop) 3: Utility Bus kW (Closed Loop) Default: Genset Bus % Level (Open Loop)		Sets how and where the kW will be controlled for extended parallel operation	Master Load Control
42347	Extended Paralleling kVAR Load Control Type	Read/Write	0: Genset Controllers 1: Genset Bus % Level (Open Loop) 2: Genset Bus Power Factor (Open Loop) 3: Genset Bus kVAR (Closed Loop) 4: Genset Bus Power Factor (Closed Loop) 5: Utility Bus kVAR (Closed Loop) 6: Utility Bus Power Factor (Closed Loop) Default: Genset Controllers		Sets how and where the kVAR will be controlled for extended parallel operation	Master Load Control
42348	Extended Parallel Ramp Load Time	Read/Write	Multiplier: .10000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: 10.000 seconds Upper Limit: 900.000 seconds Default:60	Set ramp load time for extended paralleling	Master Load Control
42349	Fail To Sync Lockout Enable	Read/Write	0:Disabled 1:Enabled Default: Disable		Enable if want synchronizing to stop if fail to sync occurs	Master Sync Control

Addr.	System Name	Access	Specifications		Description	Function
42350	Fail To Sync Open Transition Retransfer Enable	Read/Write	0:Disabled 1:Enabled Default: Disable		Use to enable or disable an open transition retransfer upon fail to sync	PTC State Machine
42351	Fail To Synchronize Time	Read/Write	Multiplier: .200000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: 10.000 seconds Upper Limit: 900.000 seconds Default:120	Set the fill to synchronize diagnostic time delay	Master Sync Control
42352	Gen CB Manual Control	Read/Write	0: Closed Requested 1: No Command 2: Open Commanded Default: No Command		In manual mode can be used to semi-manually control the generator set breaker	Breaker Control
42353	Util CB Manual Control	Read/Write	0: Closed Requested 1: No Command 2: Open Commanded Default: No Command		In Manual Mode can be used to Semi-Manually Control the Utility Breaker	Breaker Control
42354	Slip Frequency	Read/Write	Multiplier: .001000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: seconds Lower Limit: -3.000 Hz Upper Limit: 3.000 Hz Default:0.1	Sets the Synchronizer Slip Frequency (used when Sync Method is Slip)	Master Sync Control
42355	Start Time Delay (TDES)	Read/Write	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: .000 seconds Upper Limit: 3600.000 seconds Default: 0	Sets the generator set Start Time Delay	PTC Operating Mode
42356	Stop Time Delay (TDEC)	Read/Write	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: .000 seconds Upper Limit: 3600.000 seconds Default: 0	Sets the generator set Stop Time Delay	PTC Operating Mode
42357	Synchronizer Polarity	Read/Write	0: Normal 1: Invert Default: Normal		Use to Invert Synchronizer Polarity	Master Sync Control

Addr.	System Name	Access	Specifications		Description	Function
42358	Synchronize Method	Read/Write	0: Phase Match 1: Slip Frequency Default: Phase Match		Sets the synchronizing method	Master Sync Control
42359	Port Protocol Selection	Read/Write	0: PCCNet 1: MON Default: PCCNet		Allows protocol of the PCCNet port to be changed to MON for troubleshooting	Communications
42360	System Scheduler Enable	Read/Write	0: Disabled 1: Enabled Default: Disabled		Use to enable or disable the system scheduler	System Scheduler
42361	Load Add Shed Enable	Read/Write	0: Disabled 1: Enabled Default: Disabled		Use the enable or disable the load add shed feature	Load Add Shed Control
42362	Open Transition Retransfer Load Shed Enable	Read/Write	0: Disabled 1: Enabled Default: Disabled		Use to enable or disable the shedding of loads during open transition retransfer	Load Add Shed Control
42363	Auto/Manual Load Add Restore Mode	Read/Write	0: Auto 1: Manual Default: Auto		Indicates automatic or manual load add restore operation	Load Add Shed Control
42364	Genset Bus Load Add Delay	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: second Lower Limit: .000 second Upper Limit: 60.000 second Default: 1	Indicates delay between add levels when all generator sets are online and no utility	Load Add Shed Control
42365	Utility Bus Load Add Delay	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: second Lower Limit: .000 second Upper Limit: 60.000 second Default: 1	Indicates delay between add levels when on utility	Load Add Shed Control
42366	Load Shed Delay	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: 1.000 seconds Upper Limit: 10.000 seconds Default: 1	Indicates delay between shed levels when on generator sets	Load Add Shed Control

Addr.	System Name	Access	Specifications		Description	Function
42367	Load 1 Device Type	Read/Write	0: None 1: Breaker 2: ATS Default: None		Indicates type of load connected to load 1 add shed control and status I/O	Load Add Shed Control
42368	Load 2 Device Type	Read/Write	0: None 1: Breaker 2: ATS Default: None		Indicates type of load connected to load 2 add shed control and status I/O	Load Add Shed Control
42369	Load 3 Device Type	Read/Write	0: None 1: Breaker 2: ATS Default: None		Indicates type of load connected to load 3 add shed control and status I/O	Load Add Shed Control
42370	Load 4 Device Type	Read/Write	0: None 1: Breaker 2: ATS Default: None		Indicates type of load connected to load 4 add shed control and status I/O	Load Add Shed Control
42371	Load 5 Device Type	Read/Write	0: None 1: Breaker 2: ATS Default: None		Indicates type of load connected to load 5 add shed control and status I/O	Load Add Shed Control
42372	Load 6 Device Type	Read/Write	0: None 1: Breaker 2: ATS Default: None		Indicates type of load connected to load 6 add shed control and status I/O	Load Add Shed Control
42373	Load 1 Add Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: 1.000 Upper Limit: 18.000 Default: 1	Indicates which add level load 1 is assigned to	Load Add Shed Control
42374	Load 2 Add Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: 1.000 Upper Limit: 18.000 Default: 2	Indicates which add level load 2 is assigned to	Load Add Shed Control

Addr.	System Name	Access	Specifications		Description	Function
42375	Load 3 Add Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: 1.000 Upper Limit: 18.000 Default: 3	Indicates which add level load 3 is assigned to	Load Add Shed Control
42376	Load 4 Add Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: 1.000 Upper Limit: 18.000 Default: 4	Indicates which add level load 4 is assigned to	Load Add Shed Control
42377	Load 5 Add Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: 1.000 Upper Limit: 18.000 Default: 5	Indicates which add level load 5 is assigned to	Load Add Shed Control
42378	Load 6 Add Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: 1.000 Upper Limit: 18.000 Default: 6	Indicates which add level load 6 is assigned to	Load Add Shed Control
42379	Load 1 Shed Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: 1.000 Upper Limit: 17.000 Default: 1	Indicates which shed level load 1 is assigned to	Load Add Shed Control
42380	Load 2 Shed Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: 1.000 Upper Limit: 17.000 Default: 2	Indicates which shed level load 2 is assigned to	Load Add Shed Control
42381	Load 3 Shed Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: 1.000 Upper Limit: 17.000 Default: 3	Indicates which shed level load 3 is assigned to	Load Add Shed Control
42382	Load 4 Shed Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: 1.000 Upper Limit: 17.000 Default: 4	Indicates which shed level load 4 is assigned to	Load Add Shed Control

Addr.	System Name	Access	Specifications		Description	Function
42383	Load 5 Shed Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: 1.000 Upper Limit: 17.000 Default: 5	Indicates which shed level load 5 is assigned to	Load Add Shed Control
42384	Load 6 Shed Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: 1.000 Upper Limit: 17.000 Default: 6	Indicates which shed level load 6 is assigned to	Load Add Shed Control
42385	Genset Bus Overload Method	Read/Write	0: Both kW and Frequency 1: kW Only 2: Frequency Only Default: Both kW and Frequency		Use to choose method for determining generator bus overload condition	System Information
42386	Genset Bus kW Overload Delay	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: 80.000% Upper Limit: 140.000% Default: 105	Use to set the % kW threshold for generator bus overload condition	System Information
42387	Genset Bus kW Overload Delay	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: second Lower Limit: .000 second Upper Limit: 120.000 second Default: 60	Sets the delay time for overload based on kW	System Information
42388	Genset Bus Underfrequency Overload Threshold	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Hz Lower Limit: .1000 Hz Upper Limit: 10.000 Hz Default: 3	Use to set the underfrequency offset threshold for generator bus overload condition	System Information
42389	Genset Bus Underfrequency Overload Delay	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: second Lower Limit: .000 second Upper Limit: 20.000 second Default: 3	Sets the delay time for overload based on frequency	System Information
42390	Load Demand Enable	Read/Write	0: Disable 1: Enable Default: Disable		Use enable or disable the load demand feature	Load Demand Control

Addr.	System Name	Access	Specifications	Description	Function
42391	Load Demand GenA	Read/Write	0: Gen1 1: Gen2 2: Gen3 3: Gen4 4: Gen5 5: Gen6 6: Gen7 7: Gen8 8: Gen9 9: Gen10 10: Gen11 11: Gen12 12: Gen13 13: Gen14 14: Gen15 15: Gen16 Default: Gen1	Sets GenA (never stop) for fixed sequence load demand	Load Demand Control
42392	Load Demand GenB	Read/Write	0: Gen1 1: Gen2 2: Gen3 3: Gen4 4: Gen5 5: Gen6 6: Gen7 7: Gen8 8: Gen9 9: Gen10 10: Gen11 11: Gen12 12: Gen13 13: Gen14 14: Gen15 15: Gen16 Default: Gen2	Sets GenB (never stop) for fixed sequence load demand	Load Demand Control

Addr.	System Name	Access	Specifications		Description	Function
42393	Load Demand GenC	Read/Write	0: Gen1 1: Gen2 2: Gen3 3: Gen4 4: Gen5 5: Gen6 6: Gen7 7: Gen8 8: Gen9 9: Gen10 10: Gen11 11: Gen12 12: Gen13 13: Gen14 14: Gen15 15: Gen16 Default: Gen3		Sets GenC (never stop) for fixed sequence load demand	Load Demand Control
42394	Load Demand GenD	Read/Write	0: Gen1 1: Gen2 2: Gen3 3: Gen4 4: Gen5 5: Gen6 6: Gen7 7: Gen8 8: Gen9 9: Gen10 10: Gen11 11: Gen12 12: Gen13 13: Gen14 14: Gen15 15: Gen16 Default: Gen4		Sets GenD (never stop) for fixed sequence load demand	Load Demand Control
42395	Load Demand Initial Delay	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: minute Lower Limit: 1.000 minute Upper Limit: 60.000 minute Default: 5	Sets the Initial delay time before load demand will operate	Load Demand Control
42396	Load Demand Restart Percent	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: 20.000% Upper Limit: 100.000% Default: 80	Sets load demand restart threshold when method is %kW	Load Demand Control

Addr.	System Name	Access	Specifications		Description	Function
42397	Load Demand Run Hours Differential	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: Hours Lower Limit: 1.000 Hours Upper Limit: 500.000 Hours Default: 50	Sets run hours differential for restart a generator set stopped due to load demand	Load Demand Control
42398	Load Demand Shutdown Delay	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: minute Lower Limit: 1.000 minute Upper Limit: 60.000 minute Default: 5	Sets the delay time between stopping generator sets due to load demand	Load Demand Control
42399	Load Demand Shutdown Percent	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: 20.000 % Upper Limit: 100.000 % Default: 60	Sets load demand shutdown threshold when method is %kW	Load Demand Control
42400	General Fail Time Delay	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: 10.000 seconds Upper Limit: 900.000 second Default: 59	Sets how long to wait for a generator set to come online before declaring it failed	Load Demand Control
42401	Util CB Fail to Close Delay	Read/Write	Multiplier: .020000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: .100 seconds Upper Limit: 1.000 seconds Default: 0.26	Sets the utility breaker fail to close time delay	Breaker Control
42402	Util CB Fail to Open Delay	Read/Write	Multiplier: .200000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: .200 seconds Upper Limit: 5.000 seconds Default: 1	Sets the utility breaker fail to open time delay	Breaker Control
42403	Util CB Recharge Delay	Read/Write	Multiplier: .020000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: .000 seconds Upper Limit: 60.000 seconds Default: 10	Sets time to allow for utility breaker recharge	Breaker Control

Addr.	System Name	Access	Specifications		Description	Function
42404	Gen CB Fail to Close Delay	Read/Write	Multiplier: .020000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: seconds Lower Limit: .100 seconds Upper Limit: 1.000 seconds Default: 0.26	Sets the generator Set breaker fail to close time delay	Breaker Control
42405	Gen CB Fail to Open Delay	Read/Write	Multiplier: .200000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: .200 seconds Upper Limit: 5.000 seconds Default: 1	Sets generator set breaker fail to open time delay	Breaker Control
42406	Gen CB Recharge Delay	Read/Write	Multiplier: .020000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: .000 seconds Upper Limit: 60.000 second Default: 10	Sets the time to allow for generator set breaker recharge	Breaker Control
42407	Permissive Phase Window	Read/Write	Multiplier: .010000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: degrees Lower Limit: .100 degrees Upper Limit: 20.000 degrees Default: 10	Sets the permissive +/- phase angle window for sync check function	Master Sync Control
42408	Permissive Voltage Window	Read/Write	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: % Lower Limit: .500 % Upper Limit: 10.000 % Default: 5	Sets the permissive +/- voltage acceptance window for sync check function	Master Sync Control
42409	Permissive Window Time	Read/Write	Multiplier: .020000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: .500 seconds Upper Limit: 5.000 seconds Default: 0.5	Sets the permissive acceptance window dwell time for sync check function	Master Sync Control
42410	Permissive Frequency Window	Read/Write	Multiplier: .001000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: Hz Lower Limit: .001 Hz Upper Limit: 1.000 Hz Default: 1	Sets maximum frequency difference allowed for permissive close	Master Sync Control

Addr.	System Name	Access	Specifications		Description	Function
42412	Sync Phase Offset	Read/Write	Multiplier: .010000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: degrees Lower Limit: -50.000 degrees Upper Limit: 50.000 degrees Default: 0	Sets a sync phase offset to accommodate sync across transformer with phase shift	Master Sync Control
42413	System Phase Rotation	Read/Write	0: L1-L2-L3 1: L1-L3-L2 Default: L1-L2-L3		Defines what the system phase rotation sequence is	System Information
42414	kW Kp	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: .000 Upper Limit: 1000.000 Default: 60	Proportional gain for kW closed loop control in extended paralleling	Master Load Control
42415	kW KI	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: .000 Upper Limit: 255.000 Default: 60	Integral gain for kW closed loop control in extended paralleling	Master Load Control
42416	kVAR Kp	Read/Write	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: .000 Upper Limit: 1000.000 Default: 120	Proportional gain for kVAR closed loop control in extended paralleling	Master Load Control
42417	kVAR K1	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: .000 Upper Limit: 255.000 Default: 50	Integral gain for kVAR closed loop control in extended paralleling	Master Load Control
42418	Scheduler Program Select	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: 1.000 Upper Limit: 12.000 Default: 1	Selects which scheduler program to view or edit	System Scheduler
42419	Scheduler Program Enable	Read/Write	0: Disable 1: Enable Default: Disable		Use to enable or disable the selected program	System Scheduler

Addr.	System Name	Access	Specifications		Description	Function
42420	Scheduler Program x Repeats Interval	Read/Write	0: Once 1: Every Week 2: Every 2 Weeks 3: Every 3 Weeks 4: Every 4 Weeks 5: Every 5 Weeks 6: First Week of the Month 7: Second Week of the Month 8: Third Week of the Month 9: Forth Week of the Month 10: Last Week of the Month Default: Once		use to adjust repeat interval for the selected program	System Scheduler
42421	Scheduler Program x Run Mode	Read/Write	0: No Load 1: With Load 2: Extended Parallel Default: No Load		Use to adjust run mode for the selected program	System Scheduler
42422	Scheduler Program x Start Day	Read/Write	0: Sunday 1: Monday 2: Tuesday 3: Wednesday 4: Thursday 5: Friday 6: Saturday Default: Sunday		Use to adjust start day of week for the selected program	System Scheduler
42423	Scheduler Program x Start Hour	Read/Write	Multiplier: 1.00000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: hour Lower Limit: .000 hour Upper Limit: 23.000 hour Default: 0	Use to adjust start hour for the selected program	System Scheduler
42424	Scheduler Program x Start Minute	Read/Write	Multiplier: 1.00000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: minute Lower Limit: .000 minute Upper Limit: 59.000 minute Default: 0	Use to adjust start minute for the selected program	System Scheduler
42425	Scheduler Program x Duration Hours	Read/Write	Multiplier: 1.00000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: hour Lower Limit: .000 hour Upper Limit: 23.000 hour Default: 0	Use to adjust duration hours for the selected program	System Scheduler

Addr.	System Name	Access	Specifications		Description	Function
42426	Scheduler Program x Duration Minutes	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: minute Lower Limit: .000 minute Upper Limit: 59.000 minute Default: 0	Use to adjust duration minute for the selected program	System Scheduler
42427	Scheduler Exception Select	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: 1.000 Upper Limit: 6.000 Default: 1	Selects which scheduler exception to view or edit	System Scheduler
42428	Scheduler Exception x Enable	Read/Write	0: Disable 1: Enable Default: Disable		Use to enable or disable the selected exception	System Scheduler
42429	Scheduler Exception x Repeat	Read/Write	0: Once Only 1: Every Year Default: Only Once		Use to adjust the repeat setting of the selected exception	System Scheduler
42430	Scheduler Exception x Month	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: month Lower Limit: 1.000 month Upper Limit: 12.000 month Default: 1	Use to adjust the month of the selected exception	System Scheduler
42431	Scheduler Exception x Date	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: date Lower Limit: 1.000 date Upper Limit: 31.000 date Default: 1	Use to adjust the start date of the selected exception	System Scheduler
42432	Scheduler Exception x Hour	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: hour Lower Limit: .000 hour Upper Limit: 23.000 hour Default: 0	Use to adjust the start hour of the selected exception	System Scheduler
42433	Scheduler Exception x Duration Minute	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: minute Lower Limit: .000 minute Upper Limit: 59.000 minute Default: 0	Use to adjust the start minute of the selected exception	System Scheduler

Addr.	System Name	Access	Specifications		Description	Function
42434	Scheduler Exception x Duration Days	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: days Lower Limit: .000 days Upper Limit: 44.000 days Default: 0	Use to adjust the duration days of the selected exception	System Scheduler
42435	Scheduler Exception x Duration Hours	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: hour Lower Limit: .000 hour Upper Limit: 23.000 hour Default: 0	Use to adjust the duration hours of the selected exception	System Scheduler
42436	Scheduler Exception x Duration Minutes	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: minute Lower Limit: .000: minute Upper Limit: 59.000: minute Default: 0	Use to adjust the duration minutes of the selected exception	System Scheduler
42437	Daylight Saving Time Enable	Read/Write	0: Disable 1: Enable Default: Disable		Enables the daylight savings time feature	Real Time Clock
42438	Load Demand Refresh Sequence Command	Read/Write	0: Do Nothing 1: Refresh Sequence Default: Do Nothing		Use to force a refresh of the active load demand sequence	Load Demand Control
42439	Genset Connection Type	Read/Write	0: Wye 1: Delta Default: Wye		Delta or wye for generator set connection	AC Setup
42440	Genset PT Primary Voltage	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size(bits): 16 Sign: U	Unit: Volts Lower Limit: 100.000 Volts Upper Limit: 45000.000 Volts Default: 480	Generator set PT primary voltage	AC Setup
42441	Genset PT Secondary Voltage	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size(bits): 16 Sign: U	Unit: Volts Lower Limit: 100.000 Volts Upper Limit: 500.000 Volts Default: 120	Generator set PT secondary voltage	AC Setup
42442	Genset CT Primary Current	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size(bits): 16 Sign: U	Unit: Amps Lower Limit: 5.000 Amps Upper Limit: 25000.000 Volts Default: 100	Generator set CT primary current	AC Setup

Addr.	System Name	Access	Specifications		Description	Function
42443	Genset CT Secondary Current	Read/Write	0: 1 Amp 1: 5 Amp Default: 5 Amp		Generator set CT secondary current	AC Setup
42444	Utility Connection Type	Read/Write	0: Wye 1: Delta Default: Wye		Delta or wye for utility connection	AC Setup
42445	Utility PT Primary Voltage	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size(bits): 16 Sign: U	Unit: Volts Lower Limit: 100.000 Volts Upper Limit: 45000.000 Volts Default: 480	Utility PT primary voltage	AC Setup
42446	Utility PT Secondary Voltage	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size(bits): 16 Sign: U	Unit: Volts Lower Limit: 100.000 Volts Upper Limit: 500.000 Volts Default: 120	Utility PT secondary voltage	AC Setup
42447	Utility CT Primary Current	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size(bits): 16 Sign: U	Unit: Amps Lower Limit: 5.000 Amps Upper Limit: 25000.000 Amps Default: 100	Utility CT primary current	AC Setup
42448	Utility CT Secondary Current	Read/Write	0: 1 Amp 1: 5 Amp Default: 5 Amp		Utility CT secondary current	AC Setup
42449	Load Add Shed Required Online Capacity	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size(bits): 16 Sign: S	Unit: kW Lower Limit: .000 kW Upper Limit: 32767.000 kW Default: 0	Generator set kW capacity that must be online to start timed load add : 0 disables this	Load Add Shed Control
42450	Load Demand Minimum Online Capacity	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size(bits): 16 Sign: S	Unit: kW Lower Limit: .000 kW Upper Limit: 32767.000 kW Default: 0	Sets how much capacity must always be online regardless of what the load is	Load Demand Control

Addr.	System Name	Access	Specifications		Description	Function
42451	Load Demand Restart Delay	Read/Write	Multiplier: .100000000000 Offset: 0 Size(bits): 16 Sign: U	Unit: second Lower Limit: .000 second Upper Limit: 25.000 second Default: 1	Sets generator restart delay time to avoid nuisance restarts due to load transients	Load Demand Control
42452	Utility Available Current	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size(bits): 16 Sign: U	Unit: Amps Lower Limit: 1.000 Amps Upper Limit: 32000.000 Amps Default: 1000	Use to set how many amps = 100% utility kW - used by bargraph	AC Setup
42453	Total Utility Capacity	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size(bits): 16 Sign: S	Unit: kW Lower Limit: 1.000 kW Upper Limit: 32000.000 kW Default: 1000	Use to set hoe many kW = 100% utility kW - used by bargraph	AC Setup
42454	Nominal Battery Voltage	Read/Write	0: 12V 1: 24V Default: 24V		DC voltage provided to the control	Battery Voltage Protection
42455	24V High Battery Voltage Threshold	Read/Write	Multiplier: .010000000000 Offset: 0 Size(bits): 16 Sign: U	Unit: VDC Lower Limit: 28.000 VDC Upper Limit: 34.000 VDC Default: 32	Sets 24V high battery voltage fault threshold	Battery Voltage Protection
42456	24V Low Battery Voltage Threshold	Read/Write	Multiplier: .010000000000 Offset: 0 Size(bits): 16 Sign: U	Unit: VDC Lower Limit: 22.000 VDC Upper Limit: 26.000 VDC Default: 24	Sets 24V low battery voltage fault threshold	Battery Voltage Protection
42457	12V High Battery Voltage Threshold	Read/Write	Multiplier: .0100000000 Offset: 0 Size(bits): 16 Sign: U	Unit: VDC Lower Limit: 14.000 VDC Upper Limit: 17.000 VDC Default: 16	Sets 12V high battery voltage fault threshold	Battery Voltage Protection
42458	12 V Low Battery Voltage Threshold	Read/Write	Multiplier: .010000000000 Offset: 0 Size(bits): 16 Sign: U	Unit: VDC Lower Limit: 11.000 VDC Upper Limit: 13.000 VDC Default: 12	Sets 12V low battery voltage fault threshold	Battery Voltage Protection

Addr.	System Name	Access	Specifications		Description	Function
42459	High Battery Voltage Set Time	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size(bits): 16 Sign: U	Unit: second Lower Limit: 2.000 second Upper Limit: 60.000 second Default: 60	Sets high battery voltage set time	Battery Voltage Protection
42460	Low Battery Voltage Set Time	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size(bits): 16 Sign: U	Unit: second Lower Limit: 2.000 second Upper Limit: 60.000 second Default: 60	Sets low battery voltage set time	Battery Voltage Protection
42461	Genset Online Capacity Sensor Enable	Read/Write	0: Disable 1: Enable Default: Disable		Used to enable or disable the generator set online capacity sensor	PTC Sensors
42462	Genset Online Capacity Sensor Threshold	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size(bits): 16 Sign: S	Unit: kW Lower Limit: .000 kW Upper Limit: 32000.000 kW Default: 0	Sets the online kW threshold at which generator set bus is available for loading	PTC Sensors
42463	Nominal Battery Voltage Check Enable	Read/Write	0: Disable 1: Enable Default: Disable		Use to enable or disable the nominal battery voltage monitoring	Battery Voltage Protection
42464	Configurable Output1 Code	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size(bits): 16 Sign: U	Unit: NA Lower Limit: .000 Upper Limit: 65535.000 Default: 1483	Event or fault code tied to configurable output 1	Discrete Outputs
42465	Configurable Output2 Code	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size(bits): 16 Sign: U	Unit: NA Lower Limit: .000 Upper Limit: 65535.000 Default: 1457	Event or fault code tied to configurable output 2	Discrete Outputs
42466	Configurable Output3 Code	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size(bits): 16 Sign: U	Unit: NA Lower Limit: .000 Upper Limit: 65535.000 Default: 2965	Event or fault code tied to configurable output 3	Discrete Outputs

Addr.	System Name	Access	Specifications		Description	Function
42467	Configurable Output4 Code	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size(bits): 16 Sign: U	Unit: NA Lower Limit: .000 Upper Limit: 65535.000 Default: 2328	Event or fault code tied to configurable output 4	Discrete Outputs
42468	Configurable Output5 Code	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size(bits): 16 Sign: U	Unit: NA Lower Limit: .000 Upper Limit: 65535.000 Default: 1121	Event or fault code tied to configurable output 5	Discrete Outputs
42469	Configurable Output6 Code	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size(bits): 16 Sign: U	Unit: NA Lower Limit: .000 Upper Limit: 65535.000 Default: 1916	Event or fault code tied to configurable output 6	Discrete Outputs
42470	Configurable Output7 Code	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size(bits): 16 Sign: U	Unit: NA Lower Limit: .000 Upper Limit: 65535.000 Default: 0	Event or fault code tied to configurable output 7	Discrete Outputs
42471	Configurable Output8 Code	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size(bits): 16 Sign: U	Unit: NA Lower Limit: .000 Upper Limit: 65535.000 Default: 343	Event or fault code tied to configurable output 8	Discrete Outputs
42472	Gen Bus Base Load Status	Read/Write	0: None 1: Breaker 2: ATS Default: None		Indicates that the generator bus is on base load extended paralleling	System Information
42473	Util Bus Peak Shave Status	Read/Write	0: None 1: Breaker 2: ATS Default: None		Indicates that the utility bus is on peak shave extended paralleling	System Information
42474	Load 7 Device Type	Read/Write	0: None 1: Breaker 2: ATS Default: None		Indicates type of load connected to load 7 add shed control and status I/O	Load Add Shed Control

Addr.	System Name	Access	Specifications		Description	Function
42475	Load 8 Device Type	Read/Write	0: None 1: Breaker 2: ATS Default: None		Indicates type of load connected to load 8 add shed control and status I/O	Load Add Shed Control
42476	Load 9 Device Type	Read/Write	0: None 1: Breaker 2: ATS Default: None		Indicates type of load connected to load 9 add shed control and status I/O	Load Add Shed Control
42477	Load 10 Device Type	Read/Write	0: None 1: Breaker 2: ATS Default: None		Indicates type of load connected to load 10 add shed control and status I/O	Load Add Shed Control
42478	Load 7 Add Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: .000 Upper Limit: 17.000 Default: 7	Indicates which add level load 7 is assigned to	Load Add Shed Control
42479	Load 8 Add Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: 1.000 Upper Limit: 18.000 Default: 8	Indicates which add level load 8 is assigned to	Load Add Shed control
42480	Load 9 Add Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: 1.000 Upper Limit: 18.000 Default: 9	Indicates which add level load 9 is assigned to	Load Add Shed control
42481	Load 10 Add Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: 1.000 Upper Limit: 18.000 Default: 10	Indicates which add level load 10 is assigned to	Load Add Shed control
42482	Load 7 Shed Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: .000 Upper Limit: 17.000 Default: 6	Indicates which shed level load 7 is assigned to	Load Add Shed control

Addr.	System Name	Access	Specifications		Description	Function
42483	Load 8 Shed Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: .000 Upper Limit: 17.000 Default: 7	Indicates which shed level load 8 is assigned to	Load Add Shed control

Addr.	System Name	Access	Specifications		Description	Function
42484	Load 9 Shed Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: .000 Upper Limit: 17.000 Default: 8	Indicates which shed level load 9 is assigned to	Load Add Shed control
42485	Load 10 Shed Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: .000 Upper Limit: 17.000 Default: 9	Indicates which shed level load 10 is assigned to	Load Add Shed control
42486	Load Demand Threshold Method	Read/Write	0: %kW 1: kW Default: %kW		Selects whether to shutdown / restart generator sets based on %kW or absolute kW	Load Add Shed control
42487	Load Demand Restart kW Threshold	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: .000 kW Upper Limit: 32000.000 kW Default: 500	Sets minimum kW reserve capacity when threshold method is absolute kW	Load Add Shed control
42488	Load Demand Shutdown kW Threshold	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: .000 kW Upper Limit: 32000.000 kW Default: 1000	Sets maximum kW reserve capacity when threshold method is absolute kW	Load Add Shed control

Addr.	System Name	Access	Specifications	Description	Function
42489	Load Demand GenE	Read/Write	0: Gen1 1: Gen2 2: Gen3 3: Gen4 4: Gen5 5: Gen6 6: Gen7 7: Gen8 8: Gen9 9: Gen10 10: Gen11 11: Gen12 12: Gen13 13: Gen14 14: Gen15 15: Gen16 Default: Gen5	Sets GenE for fixed sequence load demand	Load Demand Control
42490	Load Demand GenF	Read/Write	0: Gen1 1: Gen2 2: Gen3 3: Gen4 4: Gen5 5: Gen6 6: Gen7 7: Gen8 8: Gen9 9: Gen10 10: Gen11 11: Gen12 12: Gen13 13: Gen14 14: Gen15 15: Gen16 Default: Gen6	Sets GenF for fixed sequence load demand	Load Demand Control

Addr.	System Name	Access	Specifications		Description	Function
42491	Load Demand GenG	Read/Write	0: Gen1 1: Gen2 2: Gen3 3: Gen4 4: Gen5 5: Gen6 6: Gen7 7: Gen8 8: Gen9 9: Gen10 10: Gen11 11: Gen12 12: Gen13 13: Gen14 14: Gen15 15: Gen16 Default: Gen7		Sets GenG for fixed sequence load demand	Load Demand Control
42492	Load Demand GenH	Read/Write	0: Gen1 1: Gen2 2: Gen3 3: Gen4 4: Gen5 5: Gen6 6: Gen7 7: Gen8 8: Gen9 9: Gen10 10: Gen11 11: Gen12 12: Gen13 13: Gen14 14: Gen15 15: Gen16 Default: Gen8		Sets GenH for fixed sequence load demand	Load Demand Control
42494	Virtual Gen Main Fail to Open Delay	Read/Write	Multiplier: .200000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: second Lower Limit: 2.000 second Upper Limit: 30.000 second Default: 5	Sets how long to wait for generator set paralleling circuit breakers to open when no generator main	Breaker Control

Addr.	System Name	Access	Specifications		Description	Function
42495	Genset 13 kW Rating	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: .000 kW Upper Limit: 32000.000 kW Default: 0	Sets generator 13 kW rating	System Information
42496	Genset 14kW Rating	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: .000 kW Upper Limit: 32000.000 kW Default: 0	Sets generator 14 kW rating	System Information
42497	Genset 15kW Rating	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: .000 kW Upper Limit: 32000.000 kW Default: 0	Sets generator 15 kW rating	System Information
42498	Genset 16kW Rating	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: .000 kW Upper Limit: 32000.000 kW Default: 0	Sets generator 16 kW rating	System Information
42500	Fault Status BitMap 1	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: NA Lower Limit: Upper Limit: Default: 0	Bitmapped state of utility and other faults - 32 bits	Fault and Event Info
42502	Fault Status BitMap 2	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: NA Lower Limit: Upper Limit: Default: 0	Bitmapped state of generator set and other faults - 32 bits	Fault and Event Info
42505	Event Status BitMap 1	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: U	Unit: NA Lower Limit: Upper Limit: Default: 0	Bitmapped state of events - 32 bits	Fault and Event Info
42506	Genset Metering Fault Status	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: Upper Limit: Default: 0	Bit mapped word with status of generator set AC metering out of range conditions	AC Interrupt Service

Addr.	System Name	Access	Specifications		Description	Function
42507	Utility Metering Fault Status	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: Upper Limit: Default: 0	Bit mapped word with status of utility AC metering out of range conditions	AC Interrupt Service
42600	Extended Parallel Start Vol	Read / Write	0: Stop 1: Start Default: Stop		State of extended parallel start volatile input	Discrete Inputs
42601	Synchronizer Enable Vol	Read / Write	0: Inactive 1: Active Default: Inactive		State of synchronizer enable volatile input	Discrete Inputs
42602	Utility Source Fail Vol	Read / Write	0: Inactive 1: Active Default: Inactive		State of utility source failure volatile input	Discrete Inputs
42603	Transfer Inhibit Vol	Read / Write	0: No Inhibit 1: Inhibit Default: No Inhibit		State of transfer inhibit volatile input	Discrete Inputs
42604	Retransfer Inhibit Vol	Read / Write	0: No Inhibit 1: Inhibit Default: No Inhibit		State of retransfer inhibit volatile input	Discrete Inputs
42605	Gen CB Inhibit Vol	Read / Write	0: No Inhibit 1: Inhibit Default: No Inhibit		State of generator CB inhibit volatile input	Discrete Inputs
42606	Utility CB Inhibit Vol	Read / Write	0: No Inhibit 1: Inhibit Default: No Inhibit		State of utility CB inhibit volatile input	Discrete Inputs
42607	Auto/Manual Vol	Read/ Write	0: Auto 1: Manual Default: Auto		State of auto/manual volatile input	Discrete Inputs
42608	Test Start Vol	Read/ Write	0: Stop 1: Start Default: Stop		state of test start volatile input	Discrete Inputs
42609	Fault Reset Vol	Read/ Write	0: No Reset 1: Reset Default: No Reset		state of fault reset volatile input	Discrete Inputs
42610	Override Vol	Read/ Write	0: No Override 1: Override Default: No Override		State of override volatile input	Discrete Inputs

Addr.	System Name	Access	Specifications	Description	Function
42611	Extended Parallel Start Sw	Read Only	0: Stop 1: Start Default:	State of extended parallel start input	Discrete Inputs
42612	Synchronizer Enable Sw	Read Only	0: Inactive 1: Active Default:	State of synchronizer enable input	Discrete Inputs
42613	Utility Source Failure Sw	Read Only	0: Inactive 1: Active Default:	State of utility source failure input	Discrete Inputs
42614	Transfer Inhibit Sw	Read Only	0: No Inhibit 1: Inhibit Default:	Status of transfer inhibit input	Discrete Inputs
42615	Retransfer Inhibit Sw	Read Only	0: No Inhibit 1: Inhibit Default:	Status of retransfer inhibit input	Discrete Inputs
42616	Gen CB Inhibit Sw	Read Only	0: No Inhibit 1: Inhibit Default:	State of generator CB inhibit input	Discrete Inputs
42617	Utility CB Inhibit Sw	Read Only	0: No Inhibit 1: Inhibit Default:	State of utility CB inhibit input	Discrete Inputs
42618	Auto/Manual Sw	Read Only	0: Auto 1: Manual Default:	State of auto / manual input	Discrete Inputs
42619	Test Start Sw	Read Only	0: Stop 1: Start Default:	State of test start input	Discrete Inputs
42620	Fault Reset Sw	Read Only	0: No Reset 1: Reset Default:	State of fault reset input	Discrete Inputs
42621	Override Sw	Read Only	0: No Override 1: Override Default:	State of override input	Discrete Inputs
42622	Master Inhibit	Read Only	0: No Inhibit 1: Inhibit Default:	Indicates state of Master priority inhibit	Priority Control
42623	Genset CB Tripped Sw	Read Only	0: Inactive 1: Active Default:	State of generator CB tripped input	Discrete Inputs

Addr.	System Name	Access	Specifications	Description	Function
42624	Genset CB Tripped Vol	Read/Write	0: Inactive 1: Active Default: Inactive	State of generator CB tripped volatile input	Discrete Inputs
42625	Utility CB Tripped Sw	Read Only	0: Inactive 1: Active Default:	State of Utility CB tripped input	Discrete Inputs
42626	Util CB Tripped Vol	Read/Write	0: Inactive 1: Active Default: Inactive	State of Utility CB tripped volatile input	Discrete Inputs
42627	Genset Phase Rotation	Read Only	0: L1-L2-L3 1: L1-L3-L2 Default:	Generator set phase rotation	Phase
42628	Utility Phase Rotation	Read Only	0: L1-L2-L3 1: L1-L3-L2 Default:	Utility phase rotation	Phase
42929	Gen1 CB Position Sw	Read Only	0: Breaker Open 1: Breaker Closed Default: Open	State of Gen1 CB position input	Discrete Inputs
42630	Gen1 CB Position Vol	Read/Write	0: Breaker Open 1: Breaker Closed Default: Open	State of Gen1 CB volatile input	Discrete Inputs
42631	Gen2 CB Position Sw	Read Only	0: Breaker Open 1: Breaker Closed Default:	State of Gen2 CB position input	Discrete Inputs
42632	Gen2 CB Position Vol	Read/Write	0: Breaker Open 1: Breaker Closed Default: Open	State of Gen2 CB volatile input	Discrete Inputs
42633	Gen3 CB Position Sw	Read Only	0: Breaker Open 1: Breaker Closed Default:	State of Gen3 CB position input	Discrete Inputs
42634	Gen3 CB Position Vol	Read/Write	0: Breaker Open 1: Breaker Closed Default: Open	State of Gen3 CB volatile input	Discrete Inputs
42635	Gen4 CB Position Sw	Read Only	0: Breaker Open 1: Breaker Closed Default:	State of Gen4 CB position input	Discrete Inputs
42636	Gen4 CB Position Vol	Read/Write	0: Breaker Open 1: Breaker Closed Default: Open	State of Gen4 CB volatile input	Discrete Inputs

Addr.	System Name	Access	Specifications	Description	Function
42637	Network Master Inhibit	Read/Write	0: No Inhibit 1: Inhibit Default: No Inhibit	Use to manually inhibit the module	Priority Control
42638	Gen5 CB Position Sw	Read Only	0: Breaker Open 1: Breaker Closed Default:	State of Gen5 CB position input	Discrete Inputs
42639	Gen5 CB Position Vol	Read/Write	0: Breaker Open 1: Breaker Closed Default: Open	State of Gen5 CB position volatile input	Discrete Inputs
42640	Gen6 CB Position Sw	Read Only	0: Breaker Open 1: Breaker Closed Default:	State of Gen6 CB position input	Discrete Inputs
42641	Gen6 CB Position Vol	Read/Write	0: Breaker Open 1: Breaker Closed Default: Open	State of Gen6 CB position volatile input	Discrete Inputs
42642	Gen7 CB Position Sw	Read Only	0: Breaker Open 1: Breaker Closed Default:	State of Gen7 CB position input	Discrete Inputs
42643	Gen7 CB Position Vol	Read/Write	0: Breaker Open 1: Breaker Closed Default: Open	State of Gen7 CB position volatile input	Discrete Inputs
42644	Gen8 CB Position Sw	Read Only	0: Breaker Open 1: Breaker Closed Default:	State of Gen8 CB position input	Discrete Inputs
42645	Gen8 CB Position Vol	Read/Write	0: Breaker Open 1: Breaker Closed Default: Open	State of Gen8 CB position volatile input	Discrete Inputs
42646	ATS 7 Position	Read Only	0: Not Available 1: No Source Connected 2: Source 1 Connected 3: Source 2 Connected 4: Paralleled Default: Not Available	Indicates position status of ATS 7	Load Add Shed Control
42647	ATS 8 Position	Read Only	0: Not Available 1: No Source Connected 2: Source 1 Connected 3: Source 2 Connected 4: Paralleled Default: Not Available	Indicates position status of ATS 8	Load Add Shed Control

Addr.	System Name	Access	Specifications	Description	Function
42648	ATS 9 Position	Read Only	0: Not Available 1: No Source Connected 2: Source 1 Connected 3: Source 2 Connected 4: Paralleled Default: Not Available	Indicates position status of ATS 9	Load Add Shed Control
42649	ATS 10 Position	Read Only	0: Not Available 1: No Source Connected 2: Source 1 Connected 3: Source 2 Connected 4: Paralleled Default: Not Available	Indicates position status of ATS 10	Load Add Shed Control
42650	Breaker 7 Position	Read Only	0: Open 1: Closed 2: Not Available Default: Not Available	Indicates position status of breaker 7	Load Add Shed Control
42651	Breaker 8 Position	Read Only	0: Open 1: Closed 2: Not Available Default: Not Available	Indicates position status of breaker 8	Load Add Shed Control
42652	Breaker 9 Position	Read Only	0: Open 1: Closed 2: Not Available Default: Not Available	Indicates position status of breaker 9	Load Add Shed Control
42653	Breaker 10 Position	Read Only	0: Open 1: Closed 2: Not Available Default: Not Available	Indicates position status of breaker 10	Load Add Shed Control
42654	Breaker 7 Trip Status	Read Only	0: Not Available 1: Normal 2: Tripped Default: Not Available	Indicates trip status of breaker 7	Load Add Shed Control
42655	Breaker 8 Trip Status	Read Only	0: Not Available 1: Normal 2: Tripped Default: Not Available	Indicates trip status of breaker 8	Load Add Shed Control
42656	Breaker 9 Trip Status	Read Only	0: Not Available 1: Normal 2: Tripped Default: Not Available	Indicates trip status of breaker 9	Load Add Shed Control

Addr.	System Name	Access	Specifications	Description	Function
42657	Breaker 10 trip Status	Read Only	0: Not Available 1: Normal 2: Tripped Default: Not Available	Indicates trip status of breaker 10	Load Add Shed Control
42658	Gen9 CB Position Sw	Read Only	0: Breaker Open 1: Breaker Closed Default:	State of Gen9 CB position input	Discrete Inputs
42659	Gen9 CB Position Vol	Read/Write	0: Breaker Open 1: Breaker Closed Default: Open	State of Gen9 CB position volatile input	Discrete Inputs
42660	Gen10 CB Position Sw	Read Only	0: Breaker Open 1: Breaker Closed Default:	State of Gen10 CB position input	Discrete Inputs
42661	Gen10 CB Position Vol	Read/Write	0: Breaker Open 1: Breaker Closed Default: Open	State of Gen10 CB position volatile input	Discrete Inputs
42662	Gen11 CB Position Sw	Read Only	0: Breaker Open 1: Breaker Closed Default:	State of Gen11 CB position input	Discrete Inputs
42663	Gen11 CB Position Vol	Read/Write	0: Breaker Open 1: Breaker Closed Default: Open	State of Gen11 CB position volatile input	Discrete Inputs
42664	Gen12 CB Position Sw	Read Only	0: Breaker Open 1: Breaker Closed Default:	State of Gen12 CB position input	Discrete Inputs
42665	Gen12 CB Position Vol	Read/Write	0: Breaker Open 1: Breaker Closed Default: Open	State of Gen12 CB position volatile input	Discrete Inputs
42666	Gen13 CB Position Sw	Read Only	0: Breaker Open 1: Breaker Closed Default:	State of Gen13 CB position input	Discrete Inputs
42667	Gen13 CB Position Vol	Read/Write	0: Breaker Open 1: Breaker Closed Default: Open	State of Gen13 CB position volatile input	Discrete Inputs
42668	Gen14 CB Position Sw	Read Only	0: Breaker Open 1: Breaker Closed Default:	State of Gen 14 CB position input	Discrete Inputs
42669	Gen14 CB Position Vol	Read/Write	0: Breaker Open 1: Breaker Closed Default: Open	State of Gen 14 CB position volatile input	Discrete Inputs

Addr.	System Name	Access	Specifications	Description	Function
42670	Gen15 CB Position Sw	Read Only	0: Breaker Open 1: Breaker Closed Default:	State of Gen 15 CB position input	Discrete Inputs
42671	Gen15 CB Position Vol	Read/ Write	0: Breaker Open 1: Breaker Closed Default: Open	State of Gen 15 CB position volatile input	Discrete Inputs
42672	Gen16 CB Position Sw	Read Only	0: Breaker Open 1: Breaker Closed Default:	State of Gen 16 CB position input	Discrete Inputs
42673	Gen16 CB Position Vol	Read/ Write	0: Breaker Open 1: Breaker Closed Default: Open	State of Gen 16 CB position volatile input	Discrete Inputs
42674	ATS 11 Position	Read Only	0: Not Available 1: No Source Connected 2: Source 1 Connected 3: Source 2 Connected 4: Paralleled Default: Not Available	Indicates position status of ATS 11	Load Add Shed Control
42675	ATS 12 Position	Read Only	0: Not Available 1: No Source Connected 2: Source 1 Connected 3: Source 2 Connected 4: Paralleled Default: Not Available	Indicates position status of ATS 12	Load Add Shed Control
42676	ATS 13 Position	Read Only	0: Not Available 1: No Source Connected 2: Source 1 Connected 3: Source 2 Connected 4: Paralleled Default: Not Available	Indicates position status of ATS 13	Load Add Shed Control
42677	ATS 14 Position	Read Only	0: Not Available 1: No Source Connected 2: Source 1 Connected 3: Source 2 Connected 4: Paralleled Default: Not Available	Indicates position status of ATS 14	Load Add Shed Control
42678	ATS 15 Position	Read Only	0: Not Available 1: No Source Connected 2: Source 1 Connected 3: Source 2 Connected 4: Paralleled Default: Not Available	Indicates position status of ATS 15	Load Add Shed Control

Addr.	System Name	Access	Specifications	Description	Function
42679	ATS 16 Position	Read Only	0: Not Available 1: No Source Connected 2: Source 1 Connected 3: Source 2 Connected 4: Paralleled Default: Not Available	Indicates position status of ATS 16	Load Add Shed Control
42680	ATS 17 Position	Read Only	0: Not Available 1: No Source Connected 2: Source 1 Connected 3: Source 2 Connected 4: Paralleled Default: Not Available	Indicates position status of ATS 17	Load Add Shed Control
42681	ATS 18 Position	Read Only	0: Not Available 1: No Source Connected 2: Source 1 Connected 3: Source 2 Connected 4: Paralleled Default: Not Available	Indicates position status of ATS 18	Load Add Shed Control
42682	Breaker 11 Position	Read Only	0: Open 1: Closed 2: Not Available Default: Not Available	Indicates position status of breaker 11	Load Add Shed Control
42683	Breaker 12 Position	Read Only	0: Open 1: Closed 2: Not Available Default: Not Available	Indicates position status of breaker 12	Load Add Shed Control
42684	Breaker 13 Position	Read Only	0: Open 1: Closed 2: Not Available Default: Not Available	Indicates position status of breaker 13	Load Add Shed Control
42685	Breaker 14 Position	Read Only	0: Open 1: Closed 2: Not Available Default: Not Available	Indicates position status of breaker 14	Load Add Shed Control
42686	Breaker 15 Position	Read Only	0: Open 1: Closed 2: Not Available Default: Not Available	Indicates position status of breaker 15	Load Add Shed Control
42687	Breaker 16 Position	Read Only	0: Open 1: Closed 2: Not Available Default: Not Available	Indicates position status of breaker 16	Load Add Shed Control

Addr.	System Name	Access	Specifications	Description	Function
42688	Breaker 17 Position	Read Only	0: Open 1: Closed 2: Not Available Default: Not Available	Indicates position status of breaker 17	Load Add Shed Control
42689	Breaker 18 Position	Read Only	0: Open 1: Closed 2: Not Available Default: Not Available	Indicates position status of breaker 18	Load Add Shed Control
42690	Breaker 11 Trip Status	Read Only	0: Not Available 1: Normal 2: Tripped Default: Not Available	Indicates trip status of breaker 11	Load Add Shed Control
42691	Breaker 12 Trip Status	Read Only	0: Not Available 1: Normal 2: Tripped Default: Not Available	Indicates trip status of breaker 12	Load Add Shed Control
42692	Breaker 13 Trip Status	Read Only	0: Not Available 1: Normal 2: Tripped Default: Not Available	Indicates trip status of breaker 13	Load Add Shed Control
42693	Breaker 14 Trip Status	Read Only	0: Not Available 1: Normal 2: Tripped Default: Not Available	Indicates trip status of breaker 14	Load Add Shed Control
42694	Breaker 15 Trip Status	Read Only	0: Not Available 1: Normal 2: Tripped Default: Not Available	Indicates trip status of breaker 15	Load Add Shed Control
42695	Breaker 16 Trip Status	Read Only	0: Not Available 1: Normal 2: Tripped Default: Not Available	Indicates trip status of breaker 16	Load Add Shed Control
42696	Breaker 17 Trip Status	Read Only	0: Not Available 1: Normal 2: Tripped Default: Not Available	Indicates trip status of breaker 17	Load Add Shed Control
42697	Breaker 18 Trip Status	Read Only	0: Not Available 1: Normal 2: Tripped Default: Not Available	Indicates trip status of breaker 18	Load Add Shed Control

Addr.	System Name	Access	Specifications		Description	Function
42698	Load Add Shed Enable Status	Read Only	0: Disabled 1: Enabled 2: Paused Default:		Indicates the overall state of the load add shed function	Load Add Shed Control
42699	PCCNet Status	Read Only	0: No Connection 1: Connected 2: Connecting Default:		Indicates overall state of the PCCNet communication s bus	Communications
42700	Gen1 Availability State	Read Only	0: Gen Does Not Exist 1: Offline 2: Waiting For Gen 3: Online 4: Failed Default:		For load demand use - indicates status of Gen1	Load Demand Control
42701	Gen2 Availability State	Read Only	0: Gen Does Not Exist 1: Offline 2: Waiting For Gen 3: Online 4: Failed Default:		For load demand use - indicates status of Gen2	Load Demand Control
42702	Gen3 Availability State	Read Only	0: Gen Does Not Exist 1: Offline 2: Waiting For Gen 3: Online 4: Failed Default:		For load demand use - indicates status of Gen3	Load Demand Control
42703	Gen4 Availability State	Read Only	0: Gen Does Not Exist 1: Offline 2: Waiting For Gen 3: Online 4: Failed Default:		For load demand use - indicates status of Gen4	Load Demand Control
42704	Gen1 Online Time	Read Only	Multiplier: .000277777780 Offset: 0 Size (bits): 32 Sign: U	Unit: Hours Lower Limit:.000 Hours Upper Limit: 1193046.000 Hours Default: 0	Total online time for Gen1	System Information
42706	Gen2 Online Time	Read Only	Multiplier: .000277777780 Offset: 0 Size (bits): 32	Unit: Hours Lower Limit: .000 Hours Upper Limit: 1193046.000 Hours Default: 0	Total online time for Gen2	System Information
42708	Gen3 Online Time	Read Only	Multiplier: .000277777780 Offset: 0 Size (bits): 32	Unit: Hours Lower Limit: .000 Hours Upper Limit: 1193046.000 Hours Default: 0	Total online time for Gen3	System Information

Addr.	System Name	Access	Specifications		Description	Function
42710	Gen4 Online Time	Read Only	Multiplier: .000277777780 Offset: 0 Size (bits): 32	Unit: Hours Lower Limit: .000 Hours Upper Limit: 1193046.000 Hours Default: 0	Total online time for Gen4	System Information
42712	GenA	Read Only	0: Gen1 1: Gen2 2: Gen3 3: Gen4 4: Gen5 5: Gen6 6: Gen7 7: Gen8 8: Gen9 9: Gen10 10: Gen11 11: Gen12 12: Gen13 13: Gen14 14: Gen15 15: Gen16 Default:		Indicates which generator set is currently GenA (never stops) for load demand	Load Demand Control
42713	GenB	Read Only	0: Gen1 1: Gen2 2: Gen3 3: Gen4 4: Gen5 5: Gen6 6: Gen7 7: Gen8 8: Gen9 9: Gen10 10: Gen11 11: Gen12 12: Gen13 13: Gen14 14: Gen15 15: Gen16 Default:		Indicates which generator set is currently GenB for load demand	Load Demand Control

Addr.	System Name	Access	Specifications		Description	Function
42714	GenC	Read Only	0: Gen1 1: Gen2 2: Gen3 3: Gen4 4: Gen5 5: Gen6 6: Gen7 7: Gen8 8: Gen9 9: Gen10 10: Gen11 11: Gen12 12: Gen13 13: Gen14 14: Gen15 15: Gen16 Default:		Indicates which generator set is currently GenC for load demand	Load Demand Control
42715	GenD	Read Only	0: Gen1 1: Gen2 2: Gen3 3: Gen4 4: Gen5 5: Gen6 6: Gen7 7: Gen8 8: Gen9 9: Gen10 10: Gen11 11: Gen12 12: Gen13 13: Gen14 14: Gen15 15: Gen16 Default:		Indicates which generator sets is currently GenD for load demand	Load Demand Control
42716	Load Demand State	Read Only	0: Off 1: Initial Delay Timing 2: Load Monitor Default		Indicates operating state of the load demand control	Load Demand Control
42717	Total Number of Gensets Online	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: Upper Limit: Default:	Indicates how many of the generator sets are online which are sensed by CB position	System Information

Addr.	System Name	Access	Specifications		Description	Function
42718	Total Spare Online Capacity	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: kW Upper Limit: kW Default:	Difference between sensed online capacity and generator set bus total kW	System Information
42719	Next Gen Shutdown Threshold	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: kW Upper Limit: kW Default:	Indicates kW threshold for generator bus at which next generator set will restart	Load Demand Control
42720	Next Gen Shutdown Threshold	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: kW Upper Limit: kW Default:	Indicates kW threshold for generator bus at which the next generator set will load demand stop	Load Demand Control
42721	Next Gen Restart	Read Only	0: Gen1 1: Gen2 2: Gen3 3: Gen4 4: Gen5 5: Gen6 6: Gen7 7: Gen8 8: Gen9 9: Gen10 10: Gen11 11: Gen12 12: Gen13 13: Gen14 14: Gen15 15: Gen16 Default:		Indicates which generator set is next to be restarted if load conditions are met	Load Demand Control

Addr.	System Name	Access	Specifications		Description	Function
42722	Next Gen Shutdown	Read Only	0: Gen1 1: Gen2 2: Gen3 3: Gen4 4: Gen5 5: Gen6 6: Gen7 7: Gen8 8: Gen9 9: Gen10 10: Gen11 11: Gen12 12: Gen13 13: Gen14 14: Gen15 15: Gen16 Default:		Indicates which generator set is next to be stopped if load conditions are met	Load Demand Control
42723	Load Demand Gen1 Driver Status	Read Only	0: Run 1: Load Demand Stop Default:		Status of the load demand Gen1 driver output	Discrete Outputs
42724	Load Demand Gen2 Driver Status	Read Only	0: Run 1: Load Demand Stop Default:		Status of the load demand Gen2 driver output	Discrete Outputs
42725	Load Demand Gen3 Driver Status	Read Only	0: Run 1: Load Demand Stop Default:		Status of the load demand Gen3 driver output	Discrete Outputs
42726	Load Demand Gen4 Driver Status	Read Only	0: Run 1: Load Demand Stop Default:		Status of the load demand Gen4 driver output	Discrete Outputs
42727	Genset Bus kW Overload Status	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: S	Unit: kW Lower Limit: kW Upper Limit: kW Default:	Calculated kW overload threshold based on online capacity and % setting	System Information
42728	Genset Bus kW Overload Status	Read Only	0: No Overload 1: Overload Default:		Indicates whether generator bus is overloaded based on kW	System Information

Addr.	System Name	Access	Specifications		Description	Function
42729	Genset Bus Underfrequency Overload Status	Read Only	0: No Overload 1: Overload Default:		Indicates whether generator bus is overloaded based on frequency	System Information
42730	Active Schedule	Read Only	0: None 1: Program 1 2: Program 2 3: Program 3 4: Program 4 5: Program 5 6: Program 6 7: Program 7 8: Program 8 9: Program 9 10: Program 10 11: Program 11 12: Program 12 13: Exception 1 14: Exception 2 15: Exception 3 16: Exception 4 17: Exception 5 18: Exception 6 Default:		Indicates the currently active scheduler program or exception	System Scheduler
42731	Scheduler Run Command	Read Only	0: Off 1: No Load 2: With Load 3: Extended Parallel Default:		Indicates current run command coming from scheduler function	System Scheduler
42732	Modbus Bus Message Count	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: Upper Limit: Default:	Modbus message count	Communications
42733	Modbus CRC Error Count	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: Upper Limit: Default:	Modbus CRC error count	Communications

Addr.	System Name	Access	Specifications		Description	Function
42734	Modbus Exception Count	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: Upper Limit: Default:	Modbus exception count	Communications
42735	Modbus No Response Count	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: Upper Limit: Default:	Modbus no response count	Communications
42736	Modbus Slave Message Count	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: Upper Limit: Default:	Modbus slave message count	Communications
42737	Modbus Clear Counters	Read/Write	0: Do Nothing 1: Clear Counters Default: Do Nothing		Clears all Modbus counters	Communications
42738	Clock Mode	Read/Write	0: Normal 1: Set Clock 2: Save Clock Default: Normal		Use to set clock and save setting	Real Time Clock
42739	Clock Year	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: year Lower Limit: .000 year Upper Limit: 99.000 year Default: Read from RTC chip	Use to set or read current year	Real Time Clock
42740	Clock Month	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: month Lower Limit: 1.000 month Upper Limit: 12.000 month Default: Read from RTC chip	Use to set or read current month	Real Time Clock
42741	Clock Date	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: date Lower Limit: 1.000 date Upper Limit: 31.000 date Default: Read from RTC chip	Use to set or read current date	Real Time Clock

Addr.	System Name	Access	Specifications		Description	Function
42742	Clock Hour	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: hour Lower Limit: 1.000 hour Upper Limit: 23.000 hour Default: Read from RTC chip	Use to set or read current hour	Real Time Clock
42743	Clock Minute	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: minute Lower Limit: 1.000 minute Upper Limit: 59.000 minute Default: Read from RTC chip	Use to set or read current minute	Real Time Clock
42744	Clock Second	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: second Lower Limit: .000 second Upper Limit: 59.000 second Default: Read from RTC chip	Use to set or read current second	Real Time Clock
42745	Clock Day	Read Only	0: Sunday 1: Monday 2: Tuesday 3: Wednesday 4: Thursday 5: Friday 6: Saturday Default:		Indicates day of the week for current date	Real Time Clock
42746	Start Timer	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: seconds Upper Limit: seconds Default:	Countdown timer value for generator set start timer	PTC Operating Mode
42747	Stop Timer	Read Only	Multiplier: .100000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: seconds Lower Limit: seconds Upper Limit: seconds Default:	Countdown timer value for generator set stop timer	PTC Operating Mode
42748	Low Battery Voltage Threshold	Read Only	Multiplier: .010000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: VDC Lower Limit: VDC Upper Limit: VDC Default:	Battery voltage with respect to set low battery threshold	Battery Voltage Protection

Addr.	System Name	Access	Specifications		Description	Function
42749	High Battery Voltage Threshold	Read Only	Multiplier: .010000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: VDC Lower Limit: VDC Upper Limit: VDC Default:	Battery voltage with respect to set high battery threshold	Battery Voltage Protection
42750	Gen5 Availability State	Read Only	0: Gen Does Not Exist 1: Offline 2: Waiting for Gen 3: Online 4: Failed Default:		For load demand use - indicates status of Gen5	Load Demand Control
42751	Gen6 Availability State	Read Only	0: Gen Does Not Exist 1: Offline 2: Waiting for Gen 3: Online 4: Failed Default:		For load demand use - indicates status of Gen6	Load Demand Control
42752	Gen7 Availability State	Read Only	0: Gen Does Not Exist 1: Offline 2: Waiting for Gen 3: Online 4: Failed Default:		For load demand use - indicates status of Gen7	Load Demand Control
42753	Gen8 Availability State	Read Only	0: Gen Does Not Exist 1: Offline 2: Waiting for Gen 3: Online 4: Failed Default:		For load demand use - indicates status of Gen8	Load Demand Control
42754	Load Demand Gen5 Driver Status	Read Only	0: Run 1: Load Demand Stop Default:		Status of the load demand Gen5 driver output	Discrete Outputs
42755	Load Demand Gen6 Driver Status	Read Only	0: Run 1: Load Demand Stop Default:		Status of the load demand Gen6 driver output	Discrete Outputs
42756	Load Demand Gen7 Driver Status	Read Only	0: Run 1: Load Demand Stop Default:		Status of the load demand Gen7 driver output	Discrete Outputs
42757	Load Demand Gen8 Driver Status	Read Only	0: Run 1: Load Demand Stop Default:		Status of the load demand Gen8 driver output	Discrete Outputs

Addr.	System Name	Access	Specifications	Description	Function
42758	GenE	Read Only	0: Gen 1 1: Gen 2 2: Gen 3 3: Gen 4 4: Gen 5 5: Gen 6 6: Gen 7 7: Gen 8 8: Gen 9 9: Gen 10 10: Gen 11 11: Gen 12 12: Gen 13 13: Gen 14 14: Gen 15 15: Gen 16 Default:	Indicates which generator set is currently GenE for load demand	Load Demand Control

Addr.	System Name	Access	Specifications	Description	Function
42759	GenF	Read Only	0: Gen 1 1: Gen 2 2: Gen 3 3: Gen 4 4: Gen 5 5: Gen 6 6: Gen 7 7: Gen 8 8: Gen 9 9: Gen 10 10: Gen 11 11: Gen 12 12: Gen 13 13: Gen 14 14: Gen 15 15: Gen 16 Default:	Indicates which generator set is currently GenF for load demand	Load Demand Control

Addr.	System Name	Access	Specifications	Description	Function
42760	GenG	Read Only	0: Gen 1 1: Gen 2 2: Gen 3 3: Gen 4 4: Gen 5 5: Gen 6 6: Gen 7 7: Gen 8 8: Gen 9 9: Gen 10 10: Gen 11 11: Gen 12 12: Gen 13 13: Gen 14 14: Gen 15 15: Gen 16 Default:	Indicates which generator set is currently GenG for load demand	Load Demand Control
42761	GenH	Read Only	0: Gen 1 1: Gen 2 2: Gen 3 3: Gen 4 4: Gen 5 5: Gen 6 6: Gen 7 7: Gen 8 8: Gen 9 9: Gen 10 10: Gen 11 11: Gen 12 12: Gen 13 13: Gen 14 14: Gen 15 15: Gen 16 Default:	Indicates which generator set is currently GenH for load demand	Load Demand Control
42762	Add Level 7 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates status of add level 7	Load Add Shed Control
42763	Add Level 8 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates status of add level 8	Load Add Shed Control
42764	Add Level 9 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates status of add level 9	Load Add Shed Control

Addr.	System Name	Access	Specifications	Description	Function
42765	Add Level 10 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates status of add level 10	Load Add Shed Control
42766	Add Load 7 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates add command for load 7	Load Add Shed Control
42767	Add Load 8 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates add command for load 8	Load Add Shed Control
42768	Add Load 9 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates add command for load 9	Load Add Shed Control
42769	Add Load 10 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates add command for load 10	Load Add Shed Control
42770	Shed Level 6 Command	Read Only	0: Do Nothing 1: Shed Level Default: Do Nothing	Indicates status of shed level 6	Load Add Shed Control
42771	Shed Level 7 Command	Read Only	0: Do Nothing 1: Shed Level Default: Do Nothing	Indicates status of shed level 7	Load Add Shed Control
42772	Shed Level 8 Command	Read Only	0: Do Nothing 1: Shed Level Default: Do Nothing	Indicates status of shed level 8	Load Add Shed Control
42773	Shed Level 9 Command	Read Only	0: Do Nothing 1: Shed Level Default: Do Nothing	Indicates status of shed level 9	Load Add Shed Control
42774	Shed Load 7 Command	Read Only	0: Do Nothing 1: Shed Load Default: Do Nothing	Indicates shed command for load 7	Load Add Shed Control
42775	Shed Load 8 Command	Read Only	0: Do Nothing 1: Shed Load Default: Do Nothing	Indicates shed command for load 8	Load Add Shed Control
42776	Shed Load 9 Command	Read Only	0: Do Nothing 1: Shed Load Default: Do Nothing	Indicates shed command for load 9	Load Add Shed Control
42777	Shed Load 10 Command	Read Only	0: Do Nothing 1: Shed Load Default: Do Nothing	Indicates shed command for load 10	Load Add Shed Control

Addr.	System Name	Access	Specifications		Description	Function
42778	Restore Shed Level 6 Command	Read Only	0: Do Nothing 1: Restore Level Default: Do Nothing		Indicates if shed level 6 has been restored	Load Add Shed Control
42779	Restore Shed Level 7 Command	Read/Write	0: Do Nothing 1: Restore Level Default: Do Nothing		Indicates if shed level 7 has been restored	Load Add Shed Control
42780	Restore Shed Level 8 Command	Read/Write	0: Do Nothing 1: Restore Level Default: Do Nothing		Indicates if shed level 8 has been restored	Load Add Shed Control
42781	Restore Shed Level 9 Command	Read/Write	0: Do Nothing 1: Restore Level Default: Do Nothing		Indicates if shed level 9 has been restored	Load Add Shed Control
42782	Gen5 Online Time	Read Only	Multiplier: .000277777780 Offset: 0 Size (bits): 32 Sign: U	Unit: hours Lower Limit: .000 hours Upper Limit: 1193046.000 hours Default: 0	Total online time for Gen5	System Information
42784	Gen6 Online Time	Read Only	Multiplier: .000277777780 Offset: 0 Size (bits): 32 Sign: U	Unit: hours Lower Limit: .000 hours Upper Limit: 1193046.000 hours Default: 0	Total online time for Gen6	System Information
42786	Gen7 Online Time	Read Only	Multiplier: .000277777780 Offset: 0 Size (bits): 32 Sign: U	Unit: hours Lower Limit: .000 hours Upper Limit: 1193046.000 hours Default: 0	Total online time for Gen7	System Information
42788	Gen8 Online Time	Read Only	Multiplier: .000277777780 Offset: 0 Size (bits): 32 Sign: U	Unit: hours Lower Limit: .000 hours Upper Limit: 1193046.000 hours Default: 0	Total online time for Gen8	System Information
42790	Manual Add Level 7 Command	Read/Write	0: Do Nothing 1: Add Level Default: Do Nothing		Operator input to add loads assigned to level 7	Load Add Shed Control

Addr.	System Name	Access	Specifications	Description	Function
42791	Manual Add Level 8 Command	Read/Write	0: Do Nothing 1: Add Level Default: Do Nothing	Operator input to add loads assigned to level 8	Load Add Shed Control
42792	Manual Add Level 9 Command	Read/Write	0: Do Nothing 1: Add Level Default: Do Nothing	Operator input to add loads assigned to level 9	Load Add Shed Control
42793	Manual Add Level 10 Command	Read/Write	0: Do Nothing 1: Add Level Default: Do Nothing	Operator input to add loads assigned to level 10	Load Add Shed Control
42794	Manual Shed Level 6 Command	Read/Write	0: Do Nothing 1: Shed Level Default: Do Nothing	Operator input to shed loads assigned to level 6	Load Add Shed Control
42795	Manual Shed Level 7 Command	Read/Write	0: Do Nothing 1: Shed Level Default: Do Nothing	Operator input to shed loads assigned to level 7	Load Add Shed Control
42796	Manual Shed Level 8 Command	Read/Write	0: Do Nothing 1: Shed Level Default: Do Nothing	Operator input to shed loads assigned to level 8	Load Add Shed Control
42797	Manual Shed Level 9 Command	Read/Write	0: Do Nothing 1: Shed Level Default: Do Nothing	Operator input to shed loads assigned to level 9	Load Add Shed Control
42798	Gen9 Availability State	Read Only	0: Gen Does Not Exist 1: Offline 2: Waiting For Gen 3: Online 4: Failed Default:	For load demand use - indicates status of Gen9	Load Demand Control
42799	Gen10 Availability State	Read Only	0: Gen Does Not Exist 1: Offline 2: Waiting For Gen 3: Online 4: Failed Default:	For load demand use - indicates status of Gen10	Load Demand Control
42800	Gen11 Availability State	Read Only	0: Gen Does Not Exist 1: Offline 2: Waiting For Gen 3: Online 4: Failed Default:	For load demand use - indicates status of Gen11	Load Demand Control

Addr.	System Name	Access	Specifications	Description	Function
42801	Gen12 Availability State	Read Only	0: Gen Does Not Exist 1: Offline 2: Waiting For Gen 3: Online 4: Failed Default:	For load demand use - indicates status of Gen12	Load Demand Control
42802	Gen13 Availability State	Read Only	0: Gen Does Not Exist 1: Offline 2: Waiting For Gen 3: Online 4: Failed Default:	For load demand use - indicates status of Gen13	Load Demand Control
42803	Gen14 Availability State	Read Only	0: Gen Does Not Exist 1: Offline 2: Waiting for Gen 3: Online 4: Failed Default:	For load demand use - indicates status of Gen14	Load Demand Control
42804	Gen15 Availability State	Read Only	0: Gen Does Not Exist 1: Offline 2: Waiting for Gen 3: Online 4: Failed Default:	For load demand use - indicates status of Gen15	Load Demand Control
42805	Gen16 Availability State	Read Only	0: Gen Does Not Exist 1: Offline 2: Waiting for Gen 3: Online 4: Failed Default:	For load demand use - indicates status of Gen16	Load Demand Control
42806	Load Demand Gen9 Driver Status	Read Only	0: Run 1: Load Demand Stop Default:	Status of load demand Gen9 driver output	Discrete Outputs
42807	Load Demand Gen10 Driver Status	Read Only	0: Run 1: Load Demand Stop Default:	Status of load demand Gen10 driver output	Discrete Outputs
42808	Load Demand Gen11 Driver Status	Read Only	0: Run 1: Load Demand Stop Default:	Status of load demand Gen11 driver output	Discrete Outputs
42809	Load Demand Gen12 Driver Status	Read Only	0: Run 1: Load Demand Stop Default:	Status of load demand Gen12 driver output	Discrete Outputs

Addr.	System Name	Access	Specifications	Description	Function
42810	Load Demand Gen13 Driver Status	Read Only	0: Run 1: Load Demand Stop Default:	Status of load demand Gen13 driver output	Discrete Outputs
42811	Load Demand Gen14 Driver Status	Read Only	0: Run 1: Load Demand Stop Default:	Status of load demand Gen14 driver output	Discrete Outputs
42812	Load Demand Gen15 Driver Status	Read Only	0: Run 1: Load Demand Stop Default:	Status of load demand Gen15 driver output	Discrete Outputs
42813	Load Demand Gen16 Driver Status	Read Only	0: Run 1: Load Demand Stop Default:	Status of load demand Gen16 driver output	Discrete Outputs
42814	GenI	Read Only	0: Gen1 1: Gen2 2: Gen3 3: Gen4 4: Gen5 5: Gen6 6: Gen7 7: Gen8 8: Gen9 9: Gen10 10: Gen11 11: Gen12 12: Gen13 13: Gen14 14: Gen15 15: Gen16 Default:	Indicates which generator set is currently GenI for load demand	Load Demand Control

Addr.	System Name	Access	Specifications	Description	Function
42815	GenJ	Read Only	0: Gen1 1: Gen2 2: Gen3 3: Gen4 4: Gen5 5: Gen6 6: Gen7 7: Gen8 8: Gen9 9: Gen10 10: Gen11 11: Gen12 12: Gen13 13: Gen14 14: Gen15 15: Gen16 Default:	Indicates which generator set is currently GenJ for load demand	Load Demand Control
42816	GenK	Read Only	0: Gen1 1: Gen2 2: Gen3 3: Gen4 4: Gen5 5: Gen6 6: Gen7 7: Gen8 8: Gen9 9: Gen10 10: Gen11 11: Gen12 12: Gen13 13: Gen14 14: Gen15 15: Gen16 Default:	Indicates which generator set is currently GenK for load demand	Load Demand Control

Addr.	System Name	Access	Specifications	Description	Function
42817	GenL	Read Only	0: Gen1 1: Gen2 2: Gen3 3: Gen4 4: Gen5 5: Gen6 6: Gen7 7: Gen8 8: Gen9 9: Gen10 10: Gen11 11: Gen12 12: Gen13 13: Gen14 14: Gen15 15: Gen16 Default:	Indicates which generator set is currently GenL for load demand	Load Demand Control
42818	GenM	Read Only	0: Gen1 1: Gen2 2: Gen3 3: Gen4 4: Gen5 5: Gen6 6: Gen7 7: Gen8 8: Gen9 9: Gen10 10: Gen11 11: Gen12 12: Gen13 13: Gen14 14: Gen15 15: Gen16 Default:	Indicates which generator set is currently GenM for load demand	Load Demand Control

Addr.	System Name	Access	Specifications	Description	Function
42819	GenN	Read Only	0: Gen1 1: Gen2 2: Gen3 3: Gen4 4: Gen5 5: Gen6 6: Gen7 7: Gen8 8: Gen9 9: Gen10 10: Gen11 11: Gen12 12: Gen13 13: Gen14 14: Gen15 15: Gen16 Default:	Indicates which generator set is currently GenN for load demand	Load Demand Control
42820	GenO	Read Only	0: Gen1 1: Gen2 2: Gen3 3: Gen4 4: Gen5 5: Gen6 6: Gen7 7: Gen8 8: Gen9 9: Gen10 10: Gen11 11: Gen12 12: Gen13 13: Gen14 14: Gen15 15: Gen16 Default:	Indicates which generator set is currently GenO for load demand	Load Demand Control

Addr.	System Name	Access	Specifications	Description	Function
42821	GenP	Read Only	0: Gen1 1: Gen2 2: Gen3 3: Gen4 4: Gen5 5: Gen6 6: Gen7 7: Gen8 8: Gen9 9: Gen10 10: Gen11 11: Gen12 12: Gen13 13: Gen14 14: Gen15 15: Gen16 Default:	Indicates which generator set is currently GenP for load demand	Load Demand Control
42822	Add Level 11 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates status of add level 11	Load Add Shed Control
42823	Add Level 12 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates status of add level 12	Load Add Shed Control
42824	Add Level 13 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates status of add level 13	Load Add Shed Control
42825	Add Level 14 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates status of add level 14	Load Add Shed Control
42826	Add Level 15 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates status of add level 15	Load Add Shed Control
42827	Add Level 16 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates status of add level 16	Load Add Shed Control
42828	Add Level 17 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates status of add level 17	Load Add Shed Control
42829	Add Level 18 Command	Read Only	0: Do Nothing 1: Add Level Default: Do Nothing	Indicates status of add level 18	Load Add Shed Control

Addr.	System Name	Access	Specifications	Description	Function
42830	Add Load 11 Command	Read Only	0: Do Nothing 1: Add Load Default: Do Nothing	Indicates add command for load 11	Load Add Shed Control
42831	Add Load 12 Command	Read Only	0: Do Nothing 1: Add Load Default: Do Nothing	Indicates add command for load 12	Load Add Shed Control
42832	Add Load 13 Command	Read Only	0: Do Nothing 1: Add Load Default: Do Nothing	Indicates add command for load 13	Load Add Shed Control
42833	Add Load 14 Command	Read Only	0: Do Nothing 1: Add Load Default: Do Nothing	Indicates add command for load 14	Load Add Shed Control
42834	Add Load 15 Command	Read Only	0: Do Nothing 1: Add Load Default: Do Nothing	Indicates add command for load 15	Load Add Shed Control
42835	Add Load 16 Command	Read Only	0: Do Nothing 1: Add Load Default: Do Nothing	Indicates add command for load 16	Load Add Shed Control
42836	Add Load 17 Command	Read Only	0: Do Nothing 1: Add Load Default: Do Nothing	Indicates add command for load 17	Load Add Shed Control
42837	Add Load 18 Command	Read Only	0: Do Nothing 1: Add Load Default: Do Nothing	Indicates add command for load 18	Load Add Shed Control
42838	Shed Level 10 Command	Read Only	0: Do Nothing 1: Shed Level Default: Do Nothing	Indicates status of shed level 10	Load Add Shed Control
42839	Shed Level 11 Command	Read Only	0: Do Nothing 1: Shed Level Default: Do Nothing	Indicates status of shed level 11	Load Add Shed Control
42840	Shed Level 12 Command	Read Only	0: Do Nothing 1: Shed Level Default: Do Nothing	Indicates status of shed level 12	Load Add Shed Control
42841	Shed Level 13 Command	Read Only	0: Do Nothing 1: Shed Level Default: Do Nothing	Indicates status of shed level 13	Load Add Shed Control
42842	Shed Level 14 Command	Read Only	0: Do Nothing 1: Shed Level Default: Do Nothing	Indicates status of shed level 14	Load Add Shed Control

Addr.	System Name	Access	Specifications	Description	Function
42843	Shed Level 15 Command	Read Only	0: Do Nothing 1: Shed Level Default: Do Nothing	Indicates status of shed level 15	Load Add Shed Control
42844	Shed Level 16 Command	Read Only	0: Do Nothing 1: Shed Level Default: Do Nothing	Indicates status of shed level 16	Load Add Shed Control
42845	Shed Level 17 Command	Read Only	0: Do Nothing 1: Shed Level Default: Do Nothing	Indicates status of shed level 17	Load Add Shed Control
42846	Shed Load 11 Command	Read Only	0: Do Nothing 1: Shed Load Default: Do Nothing	Indicates shed command for load 11	Load Add Shed Control
42847	Shed Load 12 Command	Read Only	0: Do Nothing 1: Shed Load Default: Do Nothing	Indicates shed command for load 12	Load Add Shed Control
42848	Shed Load 13 Command	Read Only	0: Do Nothing 1: Shed Load Default: Do Nothing	Indicates shed command for load 13	Load Add Shed Control
42849	Shed Load 14 Command	Read Only	0: Do Nothing 1: Shed Load Default: Do Nothing	Indicates shed command for load 14	Load Add Shed Control
42850	Shed Load 15 Command	Read Only	0: Do Nothing 1: Shed Load Default: Do Nothing	Indicates shed command for load 15	Load Add Shed Control
42851	Shed Load 16 Command	Read Only	0: Do Nothing 1: Shed Load Default: Do Nothing	Indicates shed command for load 16	Load Add Shed Control
42852	Shed Load 17 Command	Read/Write	0: Do Nothing 1: Shed Load Default: Do Nothing	Indicates shed command for load 17	Load Add Shed Control
42853	Shed Load 18 Command	Read/Write	0: Do Nothing 1: Shed Load Default: Do Nothing	Indicates shed command for load 18	Load Add Shed Control
42854	Restore Shed Level 10 Command	Read/Write	0: Do Nothing 1: Restore Level Default: Do Nothing	Indicates if shed level 10 has been restored	Load Add Shed Control
42855	Restore Shed Level 11 Command	Read/Write	0: Do Nothing 1: Restore Level Default: Do Nothing	Indicates if shed level 11 has been restored	Load Add Shed Control

Addr.	System Name	Access	Specifications		Description	Function
42856	Restore Shed Level 12 Command	Read/Write	0: Do Nothing 1: Restore Level Default: Do Nothing		Indicates if shed level 12 has been restored	Load Add Shed Control
42857	Restore Shed Level 13 Command	Read/Write	0: Do Nothing 1: Restore Level Default: Do Nothing		Indicates if shed level 13 has been restored	Load Add Shed Control
42858	Restore Shed Level 14 Command	Read/Write	0: Do Nothing 1: Restore Level Default: Do Nothing		Indicates if shed level 14 has been restored	Load Add Shed Control
42859	Restore Shed Level 15 Command	Read/Write	0: Do Nothing 1: Restore Level Default: Do Nothing		Indicates if shed level 15 has been restored	Load Add Shed Control
42860	Restore Shed Level 16 Command	Read/Write	0: Do Nothing 1: Restore Level Default: Do Nothing		Indicates if shed level 16 has been restored	Load Add Shed Control
42861	Restore Shed Level 17 Command	Read/Write	0: Do Nothing 1: Restore Level Default: Do Nothing		Indicates if shed level 17 has been restored	Load Add Shed Control
42862	Gen9 Online Time	Read Only	Multiplier: .000277777780 Offset: 0 Size (bits): 32 Sign: U	Unit: Hours Lower Limit: .000 Hours Upper Limit: 1193046.00 Hours Default: 0	Total online time for Gen9	System Information
42864	Gen10 Online Time	Read Only	Multiplier: .000277777780 Offset: 0 Size (bits): 32 Sign: U	Unit: Hours Lower Limit: .000 Hours Upper Limit: 1193046.00 Hours Default: 0	Total online time for Gen10	System Information
42866	Gen11 Online Time	Read Only	Multiplier: .000277777780 Offset: 0 Size (bits): 32 Sign: U	Unit: Hours Lower Limit: .000 Hours Upper Limit: 1193046.00 Hours Default: 0	Total online time for Gen11	System Information

Addr.	System Name	Access	Specifications		Description	Function
42868	Gen12 Online Time	Read Only	Multiplier: .000277777780 Offset: 0 Size (bits): 32 Sign: U	Unit: Hours Lower Limit: .000 Hours Upper Limit: 1193046.00 Hours Default: 0	Total online time for Gen12	System Information
42870	Gen13 Online Time	Read Only	Multiplier: .000277777780 Offset: 0 Size (bits): 32 Sign: U	Unit: Hours Lower Limit: .000 Hours Upper Limit: 1193046.00 Hours Default: 0	Total online time for Gen13	System Information
42872	Gen14 Online Time	Read Only	Multiplier: .000277777780 Offset: 0 Size (bits): 32 Sign: U	Unit: Hours Lower Limit: .000 Hours Upper Limit: 1193046.00 Hours Default: 0	Total online time for Gen14	System Information
42874	Gen15 Online Time	Read Only	Multiplier: .000277777780 Offset: 0 Size (bits): 32 Sign: U	Unit: Hours Lower Limit: .000 Hours Upper Limit: 1193046.00 Hours Default: 0	Total online time for Gen15	System Information
42876	Gen16 Online Time	Read Only	Multiplier: .000277777780 Offset: 0 Size (bits): 32 Sign: U	Unit: Hours Lower Limit: .000 Hours Upper Limit: 1193046.00 Hours Default: 0	Total online time for Gen16	System Information
42878	Manual Add Level 11 Command	Read/Write	0: Do Nothing 1: Add Level Default: Do Nothing		Operator input to add loads assigned to level 11	Load Add Shed Control
42879	Manual Add Level 12 Command	Read/Write	0: Do Nothing 1: Add Level Default: Do Nothing		Operator input to add loads assigned to level 12	Load Add Shed Control
42880	Manual Add Level 13 Command	Read/Write	0: Do Nothing 1: Add Level Default: Do Nothing		Operator input to add loads assigned to level 13	Load Add Shed Control
42881	Manual Add Level 14 Command	Read/Write	0: Do Nothing 1: Add Level Default: Do Nothing		Operator input to add loads assigned to level 14	Load Add Shed Control

Addr.	System Name	Access	Specifications	Description	Function
42882	Manual Add Level 15 Command	Read/Write	0: Do Nothing 1: Add Level Default: Do Nothing	Operator input to add loads assigned to level 15	Load Add Shed Control
42883	Manual Add Level 16 Command	Read/Write	0: Do Nothing 1: Add Level Default: Do Nothing	Operator input to add loads assigned to level 16	Load Add Shed Control
42884	Manual Add Level 17 Command	Read/Write	0: Do Nothing 1: Add Level Default: Do Nothing	Operator input to add loads assigned to level 17	Load Add Shed Control
42885	Manual Add Level 18 Command	Read/Write	0: Do Nothing 1: Add Level Default: Do Nothing	Operator input to add loads assigned to level 18	Load Add Shed Control
42886	Manual Shed Level 10 Command	Read/Write	0: Do Nothing 1: Shed Level Default: Do Nothing	Operator input to shed loads assigned to level 10	Load Add Shed Control
42887	Manual Shed Level 11 Command	Read/Write	0: Do Nothing 1: Shed Level Default: Do Nothing	Operator input to shed loads assigned to level 11	Load Add Shed Control
42888	Manual Shed Level 12 Command	Read/Write	0: Do Nothing 1: Shed Level Default: Do Nothing	Operator input to shed loads assigned to level 12	Load Add Shed Control
42889	Manual Shed Level 13 Command	Read/Write	0: Do Nothing 1: Shed Level Default: Do Nothing	Operator input to shed loads assigned to level 13	Load Add Shed Control
42890	Manual Shed Level 14 Command	Read/Write	0: Do Nothing 1: Shed Level Default: Do Nothing	Operator input to shed loads assigned to level 14	Load Add Shed Control
42891	Manual Shed Level 15 Command	Read/Write	0: Do Nothing 1: Shed Level Default: Do Nothing	Operator input to shed loads assigned to level 15	Load Add Shed Control
42892	Manual Shed Level 16 Command	Read/Write	0: Do Nothing 1: Shed Level Default: Do Nothing	Operator input to shed loads assigned to level 16	Load Add Shed Control
42893	Manual Shed Level 17 Command	Read/Write	0: Do Nothing 1: Shed Level Default: Do Nothing	Operator input to shed loads assigned to level 17	Load Add Shed Control

Addr.	System Name	Access	Specifications	Description	Function
42894	Load 11 Device Type	Read/ Write	0: None 1: Breaker 2: ATS Default: None	Indicates type of load connected to load 11 add shed control and status I/O	Load Add Shed Control
42895	Load 12 Device Type	Read/ Write	0: None 1: Breaker 2: ATS Default: None	Indicates type of load connected to load 12 add shed control and status I/O	Load Add Shed Control
42896	Load 13 Device Type	Read/ Write	0: None 1: Breaker 2: ATS Default: None	Indicates type of load connected to load 13 add shed control and status I/O	Load Add Shed Control
42897	Load 14 Device Type	Read/ Write	0: None 1: Breaker 2: ATS Default: None	Indicates type of load connected to load 14 add shed control and status I/O	Load Add Shed Control
42898	Load 15 Device Type	Read/ Write	0: None 1: Breaker 2: ATS Default: None	Indicates type of load connected to load 15 add shed control and status I/O	Load Add Shed Control
42899	Load 16 Device Type	Read/ Write	0: None 1: Breaker 2: ATS Default: None	Indicates type of load connected to load 16 add shed control and status I/O	Load Add Shed Control
42900	Load 17 Device Type	Read/ Write	0: None 1: Breaker 2: ATS Default: None	Indicates type of load connected to load 17 add shed control and status I/O	Load Add Shed Control
42901	Load 18 Device Type	Read/ Write	0: None 1: Breaker 2: ATS Default: None	Indicates type of load connected to load 18 add shed control and status I/O	Load Add Shed Control

Addr.	System Name	Access	Specifications		Description	Function
42902	Load 11 Add Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 0 Sign: U	Unit: NA Lower Limit: 1.000 Upper Limit: 18.000 Default: 11	Indicates which add level load 11 is assigned to	Load Add Shed Control
42903	Load 12 Add Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 0 Sign: U	Unit: NA Lower Limit: 1.000 Upper Limit: 18.000 Default: 12	Indicates which add level load 12 is assigned to	Load Add Shed Control
42904	Load 13 Add Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 0 Sign: U	Unit: NA Lower Limit: 1.000 Upper Limit: 18.000 Default: 13	Indicates which add level load 13 is assigned to	Load Add Shed Control
42905	Load 14 Add Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 0 Sign: U	Unit: NA Lower Limit: 1.000 Upper Limit: 18.000 Default: 14	Indicates which add level load 14 is assigned to	Load Add Shed Control
42906	Load 15 Add Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 0 Sign: U	Unit: NA Lower Limit: 1.000 Upper Limit: 18.000 Default: 15	Indicates which add level load 15 is assigned to	Load Add Shed Control
42907	Load 16 Add Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 0 Sign: U	Unit: NA Lower Limit: 1.000 Upper Limit: 18.000 Default: 16	Indicates which add level load 16 is assigned to	Load Add Shed Control
42908	Load 17 Add Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 0 Sign: U	Unit: NA Lower Limit: 1.000 Upper Limit: 18.000 Default: 17	Indicates which add level load 17 is assigned to	Load Add Shed Control
42909	Load 18 Add Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 0 Sign: U	Unit: NA Lower Limit: 1.000 Upper Limit: 18.000 Default: 18	Indicates which add level load 18 is assigned to	Load Add Shed Control

Addr.	System Name	Access	Specifications		Description	Function
42910	Load 11 Shed Level	Read/Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 0 Sign: U	Unit: NA Lower Limit: .000 Upper Limit: 17.000 Default: 10	Indicates which shed level load 11 is assigned to	Load Add Shed Control
42911	Load 12 Shed Level	Read /Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 0 Sign: U	Unit: NA Lower Limit: .000 Upper Limit: 17.000 Default: 11	Indicates which shed level load 12 is assigned to	Load Add Shed Control
42912	Load 13 Shed Level	Read /Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: .000 Upper Limit: 17.000 Default: 12	Indicates which shed level load 13 is assigned to	Load Add Shed Control
42913	Load 14 Shed Level	Read /Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: .000 Upper Limit: 17.000 Default: 13	Indicates which shed level load 14 is assigned to	Load Add Shed Control
42914	Load 15 Shed Level	Read /Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: .000 Upper Limit: 17.000 Default: 14	Indicates which shed level load 15 is assigned to	Load Add Shed Control
42915	Load 16 Shed Level	Read /Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: .000 Upper Limit: 17.000 Default: 15	Indicates which shed level load 16 is assigned to	Load Add Shed Control
42916	Load 17 Shed Level	Read /Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: .000 Upper Limit: 17.000 Default: 16	Indicates which shed level load 17 is assigned to	Load Add Shed Control
42917	Load 18 Shed Level	Read /Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 16 Sign: U	Unit: NA Lower Limit: .000 Upper Limit: 17.000 Default: 17	Indicates which shed level load 18 is assigned to	Load Add Shed Control

Addr.	System Name	Access	Specifications	Description	Function
42918	Load Demand GenI	Read /Write	0: Gen 1 1: Gen 2 2: Gen 3 3: Gen 4 4: Gen 5 5: Gen 6 6: Gen 7 7: Gen 8 8: Gen 9 9: Gen 10 10: Gen 11 11: Gen 12 12: Gen 13 13: Gen 14 14: Gen 15 15: Gen 16 Default: Gen9	Sets GenI for fixed sequence load demand	Load Demand Shed Control
42919	Load Demand GenJ	Read /Write	0: Gen 1 1: Gen 2 2: Gen 3 3: Gen 4 4: Gen 5 5: Gen 6 6: Gen 7 7: Gen 8 8: Gen 9 9: Gen 10 10: Gen 11 11: Gen 12 12: Gen 13 13: Gen 14 14: Gen 15 15: Gen 16 Default: Gen10	Sets GenJ for fixed sequence load demand	Load Demand Shed Control

Addr.	System Name	Access	Specifications	Description	Function
42920	Load Demand GenK	Read /Write	0: Gen 1 1: Gen 2 2: Gen 3 3: Gen 4 4: Gen 5 5: Gen 6 6: Gen 7 7: Gen 8 8: Gen 9 9: Gen 10 10: Gen 11 11: Gen 12 12: Gen 13 13: Gen 14 14: Gen 15 15: Gen 16 Default: Gen11	Sets GenK for fixed sequence load demand	Load Demand Shed Control
42921	Load Demand GenL	Read /Write	0: Gen 1 1: Gen 2 2: Gen 3 3: Gen 4 4: Gen 5 5: Gen 6 6: Gen 7 7: Gen 8 8: Gen 9 9: Gen 10 10: Gen 11 11: Gen 12 12: Gen 13 13: Gen 14 14: Gen 15 15: Gen 16 Default: Gen12	Sets GenL for fixed sequence load demand	Load Demand Shed Control

Addr.	System Name	Access	Specifications	Description	Function
42922	Load Demand GenM	Read /Write	0: Gen 1 1: Gen 2 2: Gen 3 3: Gen 4 4: Gen 5 5: Gen 6 6: Gen 7 7: Gen 8 8: Gen 9 9: Gen 10 10: Gen 11 11: Gen 12 12: Gen 13 13: Gen 14 14: Gen 15 15: Gen 16 Default: Gen13	Sets GenM for fixed sequence load demand	Load Demand Control
42923	Load Demand GenN	Read /Write	0: Gen 1 1: Gen 2 2: Gen 3 3: Gen 4 4: Gen 5 5: Gen 6 6: Gen 7 7: Gen 8 8: Gen 9 9: Gen 10 10: Gen 11 11: Gen 12 12: Gen 13 13: Gen 14 14: Gen 15 15: Gen 16 Default: Gen14	Sets GenN for fixed sequence load demand	Load Demand Control

Addr.	System Name	Access	Specifications	Description	Function
42924	Load Demand GenO	Read /Write	0: Gen 1 1: Gen 2 2: Gen 3 3: Gen 4 4: Gen 5 5: Gen 6 6: Gen 7 7: Gen 8 8: Gen 9 9: Gen 10 10: Gen 11 11: Gen 12 12: Gen 13 13: Gen 14 14: Gen 15 15: Gen 16 Default: Gen15	Sets GenO for fixed sequence load demand	Load Demand Control
42925	Load Demand GenP	Read /Write	0: Gen 1 1: Gen 2 2: Gen 3 3: Gen 4 4: Gen 5 5: Gen 6 6: Gen 7 7: Gen 8 8: Gen 9 9: Gen 10 10: Gen 11 11: Gen 12 12: Gen 13 13: Gen 14 14: Gen 15 15: Gen 16 Default: Gen16	Sets GenP for fixed sequence load demand	Load Demand Control
42926	SID2 Status	Read Only	0: Missing 1: Good 2: Connecting 3: No Exp Board 4: Not Applicable Default:	Indicates status of SID2 (aux101/102 module 2)	Communications

Addr.	System Name	Access	Specifications		Description	Function
42927	SID3 Status	Read Only	0: Missing 1: Good 2: Connecting 3: No Exp Board 4: Not Applicable Default:		Indicates status of SID3 (aux101/102 module 3)	Communications
42928	Expansion Board Communications 2	Read Only	0: Disabled 1: Enabled 2: Connecting Default: Disabled		Indicates the status of the SID2 to expansion board connection	Communications
42929	Expansion Board Communications 3	Read Only	0: Disabled 1: Enabled 2: Connecting Default: Disabled		Indicates the status of the SID3 to expansion board connection	Communications
42930	Utility Breaker Opening Point	Read /Write	0: After Transfer Delay 1: Upon Utility Failure Default: After Transfer Delay		PTC - point in time at which system opens utility breaker	PTC Connected
42931	Commit To Transfer Method	Read /Write	0: Utility Disconnect 1: Genset Start 2: No Commit Default: Utility Disconnect		PTC - sets point at which system commits to transfer to generator set	PTC Operating Mode
42932	Commit To Transfer State	Read Only	0: Not Committed 1: Committed Default:		PTC - indicates if system is committed to transferring to generator set	PTC Operating Mode
42933	Total System Capacity 32bit	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kW Lower Limit: kW Upper Limit: kW Default:	Sum of the generator set kW ratings in 32bit	System Information
42935	Total Online Capacity 32bit	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kW Lower Limit: kW Upper Limit: kW Default:	Sum of the generator set kW ratings in 32bit for generator sets which are online	System Information

Addr.	System Name	Access	Specifications		Description	Function
42937	kW Load Reference 32bit	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kW Lower Limit: kW Upper Limit: kW Default:	kW control reference value in 32bit for extended paralleling	Master Load Control
42939	kVAR Load Reference 32bit	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kVAR Lower Limit: kVAR Upper Limit: kVAR Default:	kVAR control reference value in 32bit for extended paralleling	Master Load Control
42943	Genset Bus kW Setpoint 32bit	Read /Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kW Lower Limit: .000 kW Upper Limit: 2147483647.000 kW Default: 0	Sets the base load kW setpoint in 32bit in closed loop extended paralleling	Master Load Control
42945	Genset Bus kVAR Setpoint 32bit	Read /Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kVAR Lower Limit: .000 kVAR Upper Limit: 2147483647.000 kVAR Default: 0	Sets the base load kVAR setpoint in 32bit in closed loop extended paralleling	Master Load Control
42947	Genset Unloaded Level 32bit	Read /Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kW Lower Limit: -2147483648.000 kW Upper Limit: 2147483647.000 kW Default: 50	Setpoint for generator set unloaded level in 32bit	Master Load Control
42949	Utility Bus kW Setpoint 32bit	Read /Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kW Lower Limit: -2147483648.000 kW Upper Limit: 2147483647.000 kW Default: 100	Sets the peak shave kW setpoint in 32bit in closed loop extended paralleling	Master Load Control
42951	Utility Bus kW Constraint Level 32bit	Read / write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kW Lower Limit: -2147483648.000 kW Upper Limit: 2147483647.000 kW Default: 100	sets the utility kW constraint level in 32bit for base load extended paralleling	Master Load Control

Addr.	System Name	Access	Specifications		Description	Function
42953	Utility Bus kVAR Setpoint 32bit	Read / write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kVAR Lower Limit: -2147483648.000 kVAR Upper Limit: 2147483647.000 kVAR Default: 100	Sets the peak shave kVAR setpoint in 32bit in closed loop extended paralleling	Master Load Control
42955	Utility Unloaded Level 32bit	Read / write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kW Lower Limit: -2147483648.000 kW Upper Limit: 2147483647.000 kW Default: 50	Setpoint for utility unload level in 32bit	Master Load Control
42957	Load Add Shed Required Online Capacity 32bit	Read / write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kW Lower Limit: .000 kW Upper Limit: 2147483647.000 kW Default: 0	generator set kW capacity that must be online to start timed load add; 0 disables this	Load Demand Control
42959	Load Demand Minimum Online Capacity 32bit	Read / write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kW Lower Limit: .000 kW Upper Limit: 2147483647.000 kW Default: 0	Sets how much capacity must always be online regardless of what the load is	Load Demand Control
42961	Total Utility Capacity 32bit	Read / write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kW Lower Limit: 1.000 kW Upper Limit: 2147483647.000 kW Default: 1000	Use to set how many kW (32bit) =100% utility kW -- used by bargraph	AC Setup
42963	Genset Online Capacity Sensor Threshold 32bit	Read / write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kW Lower Limit: .000 kW Upper Limit: 2147483647.000 kW Default: 0	Set the online kW threshold 32bit at which generator set but is available for loading	PTC Sensors
42965	Load Demand Restart kW Threshold 32bit	Read /Write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kW Lower Limit: .000 kW Upper Limit: 2147483647.000 kW Default: 500	Set minimum kW reserve capacity when kW in 32bit	Load Demand Control

Addr.	System Name	Access	Specifications		Description	Function
42967	Load Demand Shutdown kW Threshold 32bit	Read / write	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kW Lower Limit: .000 kW Upper Limit: 2147483647.000 kw Default: 1000	Sets maximum kW reserve capacity when threshold method is absolute kW in 32bit	Load Demand Control
42971	Total Spare Online Capacity 32bit	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kW Lower Limit: kW Upper Limit: kW Default:	Difference between sensed online capacity and generator Set bus total kW in 32bit	System Information
42973	Next Gen Restart Threshold 32bit	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kW Lower Limit: kW Upper Limit: kW Default:	Shows 32 bit kW threshold for generator bus at which next generator set will restart	Load Demand Control
42975	Next Gen Shutdown Threshold 32bit	Read Only	Multiplier: 1.000000000000 Offset: 0 Size (bits): 32 Sign: S	Unit: kW Lower Limit: kW Upper Limit: kW Default:	Shows 32 bit kW threshold for generator bus at which next generator set load demand stops in	Load Demand Control
42977	Genset Bus kW Overload Threshold 32bit	Read Only	Multiplier: 1.000000000000 Offset: 0 Size(bits): 32 Sign: S	Unit: kW Lower Limit: kW Upper Limit: kW Default:	Calculated kW overload threshold in 32bit based on online capacity and % setting	System Information

10.2 MCM3320 Modbus Fault Status Bitmaps

NOTICE

Earlier versions of software may not support all of the Modbus registers in the following table. If a particular register is not available in your installation, it is possible that the Modbus connection is working but the controller software does not support that particular register.

NOTICE

If an address or bit is not listed in this table it is not implemented.

Addr.	Bit#	System Name	Fault Code	Event Name	Response
42500	0	Fault Status Bitmap 1	1455	Utility Main Breaker Position Contact Warning	Warning
42500	1	Fault Status Bitmap 1	2396	Utility Main Breaker Fail To Close Warning	Warning
42500	2	Fault Status Bitmap 1	2397	Utility Main Breaker Fail To Open Warning	Warning
42500	3	Fault Status Bitmap 1	1219	Utility Main Breaker Tripped Warning	Warning
42500	4	Fault Status Bitmap 1	1914	Utility Bus Phase Rotation Warning	Warning
42500	5	Fault Status Bitmap 1	1912	Utility Bus Loss Of Phase Warning	Warning
42500	6	Fault Status Bitmap 1	2331	Utility Bus Undervoltage Warning	Warning
42500	7	Fault Status Bitmap 1	2358	Utility Bus Overvoltage Warning	Warning
42500	8	Fault Status Bitmap 1	1223	Utility Bus Frequency Warning	Warning
42500	21	Fault Status Bitmap 1	4137	Advanced Grid Protection Warning	Warning
42500	22	Fault Status Bitmap 1	3924	Utility Reverse kW Warning	Warning
42500	23	Fault Status Bitmap 1	2939	Modbus Communication Failure Warning	Warning
42500	24	Fault Status Bitmap 1	2648	Remote IO Communication Failure Warning	Warning
42500	25	Fault Status Bitmap 1	1689	Real Time Clock Power Interrupt Warning	Warning
42500	26	Fault Status Bitmap 1	1335	AC Metering Out Of Range Warning	Warning
42500	27	Fault Status Bitmap 1	1999	Maximum Parallel Time Warning	Warning
42500	28	Fault Status Bitmap 1	343	Hardware Failure Warning	Warning
42500	29	Fault Status Bitmap 1	1456	Synchronizer Output Limit Warning	Warning
42500	30	Fault Status Bitmap 1	2416	Calibration Checksum Warning	Warning
42500	31	Fault Status Bitmap 1	353	EEPROM Write Error Warning	Warning
42502	0	Fault Status Bitmap 2	1454	Genset Main Breaker Position Contact Warning	Warning
42502	1	Fault Status Bitmap 2	1452	Genset Main Breaker Fail To Close Warning	Warning
42502	2	Fault Status Bitmap 2	1453	Genset Main Breaker Fail To Open	Warning
42502	3	Fault Status Bitmap 2	1328	Genset Main Breaker Tripped Warning	Warning
42502	4	Fault Status Bitmap 2	1915	Genset Bus Phase Rotation Warning	Warning
42502	5	Fault Status Bitmap 2	1913	Genset Bus Loss Of Phase Warning	Warning
42502	6	Fault Status Bitmap 2	1225	Genset Bus Undervoltage Warning	Warning
42502	7	Fault Status Bitmap 2	1224	Genset Bus Overvoltage Warning	Warning
42502	8	Fault Status Bitmap 2	1226	Genset Bus Frequency Warning	Warning
42502	22	Fault Status Bitmap 2	441	Low Battery Voltage Warning	Warning
42502	23	Fault Status Bitmap 2	442	High Battery Voltage Warning	Warning
42502	24	Fault Status Bitmap 2	1541	Genset Failed To Come Online Warning	Warning

Addr.	Bit#	System Name	Fault Code	Event Name	Response
42502	25	Fault Status Bitmap 2	2647	Load Demand Setup Warning	Warning
42502	26	Fault Status Bitmap 2	1444	Genset Bus Overload Warning	Warning
42502	27	Fault Status Bitmap 2	1989	kW Load Control Output Limit Warning	Warning
42502	28	Fault Status Bitmap 2	1991	kVAR Load Control Output Limit Warning	Warning
42502	29	Fault Status Bitmap 2	1121	Failure To Disconnect Warning	Warning
42502	30	Fault Status Bitmap 2	1458	Synchronizer Phase Rotation Mismatch Warning	Warning
42502	31	Fault Status Bitmap 2	1457	Fail To Synchronize Warning	Warning
42505	0	Fault Status Bitmap 1	1222	Not In Automatic Event	Event
42505	1	Fault Status Bitmap 1	1483	Common Warning Event	Event
42505	2	Fault Status Bitmap 1	2965	Genset Bus Available Event	Event
42505	3	Fault Status Bitmap 1	2328	Utility Bus Available Event	Event
42505	4	Fault Status Bitmap 1	2333	Genset Bus Connected Event	Event
42505	5	Fault Status Bitmap 1	2332	Utility Bus Connected Event	Event
42505	6	Fault Status Bitmap 1	2971	Test / Extended Parallel Event	Event
42505	7	Fault Status Bitmap 1	1916	Synchronized Event	Event
42505	8	Fault Status Bitmap 1	1534	Load Control Output Event	Event
42505	9	Fault Status Bitmap 1	2781	Genset Source Unloaded Event	Event
42505	10	Event Status Bitmap 1	2779	Utility Source Unloaded Event	Event
42505	11	Event Status Bitmap 1	3226	Genset Bus Base Load Event	Event
42505	12	Event Status Bitmap 1	3227	Utility Bus Peak Shave Event	Event

10.3 MCM3320 Modbus Address 42506, 42507

NOTICE

Earlier versions of software may not support all of the Modbus registers in the following table. If a particular register is not available in your installation, it is possible that the Modbus connection is working but the controller software does not support that particular register.

NOTICE

If an address or bit is not listed in this table it is not implemented.

Metering Fault Status Bitmaps		
Bit (LSB = 0)	Parameter	Metering Fault Status Bitmaps
0	ZXA Timeout	Zero Crossing cannot be detected on L1 voltage signal
1	ZXB Timeout	Zero Crossing cannot be detected on L2 voltage signal
2	ZXC Timeout	Zero Crossing cannot be detected on L3 voltage signal
3 (See Note 1)	Voltage Out of Range	Voltage scaling error due to incompatible combination of settings for Nominal Voltage, PT Primary Voltage, and PT Secondary Voltage
4 (See Note 1)	Current Out of Range	Current Input is saturated; actual current cannot be determined
5	Frequency Out of Range	Frequency input is out of range; valid range 24-80 Hz
6	Loss Phase Out of Range	One or more zero crossings of voltage cannot be detected; loss phase cannot be determined
7	Sync Phase Out of Range	Synchronizer phase difference cannot be measured due to any of the following: genset frequency out of range, utility frequency out of range, genset L1 voltage zero crossing not detected, or utility L1 voltage zero crossing not detected
8 (See Note 1)	kW Out of Range	kW is out of range; valid range is - 2147483648 to +2147483647 kW
9 (See Note 1)	kVAR Out of Range	kVAR is out of range; valid range is - 2147483648 to +2147483647 kVAR
10 (See Note 1)	kVA Out of Range	kVA is out of range; valid range is 0 to 4294867295 kVA
11 (See Note 1)	Power Factor Out of Range	Power factor is out of range due to either kW > kVA or kVA = 0; should not normally occur
12	AC Metering Failure	Main processor is unable to communicate with metering processor
13	Not Implemented	
14	Not Implemented	
15	Not Implemented	
NOTE: 1. If any of bits are active (1), the "AC Metering Out of Range Warning" fault will be active. 2. If Bit 12 is active (1), the "Hardware Failure Warning" fault will be active. 3. Some bits do not generate warning faults because they are a normal occurrence (e.g. if a source is dead).		

11 PC500/550 Modbus TCP Register Map

NOTICE

Earlier versions of software may not support all of the Modbus registers in the following table. If a particular register is not available in your installation, it is possible that the Modbus connection is working but the controller software does not support that particular register.

NOTICE

If an address or bit is not listed in this table it is not implemented.

PC500/550 (PC5xx)				
Parameter	Modbus Register	Sign	Units	Comments
Device Type in Configuration	40001	U	ENUM	64= PC500/PC550
Device Model	40002	U	ENUM	0=N/A, 1=3300, 2=2300, 4=1301, 8=1302, 16=2100, 32=3100, 64=3200, 128=3201
Modbus TCP Unit ID	40003	U		Configurable from User Interface
Sensor assigned to Analog Input on PC5xx	40004	S	NA	No scaling is required. The scaled value is displayed.
Sensor assigned to Discrete Input 1 on PC5xx	40005	U	NA	
Sensor assigned to Discrete Input 2 on PC5xx	40006	U	NA	
Sensor assigned to Discrete Output 1 status on PC5xx	40007	U	NA	
Sensor assigned to Discrete Output 2 status on PC5xx	40008	U	NA	
PC500/550 (Device 1)				
Parameter	Modbus Register	Sign	Units	Comments
Device Type in Configuration	40011	U	ENUM	1=Genset, 2=ATS, 4=AUX101/102
Device Model	40012	U	ENUM	0=N/A, 1=3300, 2=2300, 4=1301, 8=1302, 16=2100, 32=3100, 64=3200, 128=3201
Modbus TCP Unit ID	40013	U		Configurable from User Interface
Modbus Communication Status	40014	U	ENUM	0=Communicating, 2=Not Communicating
Communications Error Counter	40015	U		

Last Successful Communication (Year, Month)	40016	U	Bitfield	See Note 5
Last Successful Communication (Day, Hour, Minutes)	40017	U	Bitfield	See Note 5
Last Successful Communication (Seconds, Milliseconds)	40018	U	Bitfield	See Note 5
PC500/550 (Device 2)				
Parameter	Modbus Register	Sign	Units	Comments
Device Type in Configuration	40021	U	ENUM	1=Genset, 2=ATS, 4=AUX101/102
Device Model	40022	U	ENUM	0=N/A, 1=3300, 2=2300, 4=1301, 8=1302, 16=2100, 32=3100, 64=3200, 128=3201
Modbus TCP Unit ID	40023	U		Configurable from User Interface
Modbus Communication Status	40024	U	ENUM	0=Communicating, 2=Not Communicating
Communications Error Counter	40025	U		
Last Successful Communication (Year, Month)	40026	U	Bitfield	See Note 5
Last Successful Communication (Day, Hour, Minutes)	40027	U	Bitfield	See Note 5
Last Successful Communication (Seconds, Milliseconds)	40028	U	Bitfield	See Note 5
PC500/550 (Device 3)				
Parameter	Modbus Register	Sign	Units	Comments
Device Type in Configuration	40031	U	ENUM	1=Genset, 2=ATS, 4=AUX101/102
Device Model	40032	U	ENUM	0=N/A, 1=3300, 2=2300, 4=1301, 8=1302, 16=2100, 32=3100, 64=3200, 128=3201
Modbus TCP Unit ID	40033	U		Configurable from User Interface
Modbus Communication Status	40034	U	ENUM	0=Communicating, 2=Not Communicating
Communications Error Counter	40035	U		
Last Successful Communication (Year, Month)	40036	U	Bitfield	See Note 5
Last Successful Communication (Day, Hour, Minutes)	40037	U	Bitfield	See Note 5
Last Successful Communication (Seconds, Milliseconds)	40038	U	Bitfield	See Note 5

PC500/550 (Device 4)				
Parameter	Modbus Register	Sign	Units	Comments
Device Type in Configuration	40041	U	ENUM	1=Genset, 2=ATS, 4=AUX101/102
Device Model	40042	U	ENUM	0=N/A, 1=3300, 2=2300, 4=1301, 8=1302, 16=2100, 32=3100, 64=3200, 128=3201
Modbus TCP Unit ID	40043	U		Configurable from User Interface
Modbus Communication Status	40044	U	ENUM	0=Communicating, 2=Not Communicating
Communications Error Counter	40045	U		
Last Successful Communication (Year, Month)	40046	U	Bitfield	See Note 5
Last Successful Communication (Day, Hour, Minutes)	40047	U	Bitfield	See Note 5
Last Successful Communication (Seconds, Milliseconds)	40048	U	Bitfield	See Note 5
PC500/550 (Device 5)				
Parameter	Modbus Register	Sign	Units	Comments
Device Type in Configuration	40051	U	ENUM	1=Genset, 2=ATS, 4=AUX101/102
Device Model	40052	U	ENUM	0=N/A, 1=3300, 2=2300, 4=1301, 8=1302, 16=2100, 32=3100, 64=3200, 128=3201
Modbus TCP Unit ID	40053	U		Configurable from User Interface
Modbus Communication Status	40054	U	ENUM	0=Communicating, 2=Not Communicating
Communications Error Counter	40055	U		
Last Successful Communication (Year, Month)	40056	U	Bitfield	See Note 5
Last Successful Communication (Day, Hour, Minutes)	40057	U	Bitfield	See Note 5
Last Successful Communication (Seconds, Milliseconds)	40058	U	Bitfield	See Note 5
PC500/550 (Device 6)				
Parameter	Modbus Register	Sign	Units	Comments
Device Type in Configuration	40061	U	ENUM	1=Genset, 2=ATS, 4=AUX101/102

Device Model	40062	U	ENUM	0=N/A, 1=3300, 2=2300, 4=1301, 8=1302, 16=2100, 32=3100, 64=3200, 128=3201
Modbus TCP Unit ID	40063	U		Configurable from User Interface
Modbus Communication Status	40064	U	ENUM	0=Communicating, 2=Not Communicating
Communications Error Counter	40065	U		
Last Successful Communication (Year, Month)	40066	U	Bitfield	See Note 5
Last Successful Communication (Day, Hour, Minutes)	40067	U	Bitfield	See Note 5
Last Successful Communication (Seconds, Milliseconds)	40068	U	Bitfield	See Note 5
PC500/550 (Device 7)				
Parameter	Modbus Register	Sign	Units	Comments
Device Type in Configuration	40071	U	ENUM	1=Genset, 2=ATS, 4=AUX101/102
Device Model	40072	U	ENUM	0=N/A, 1=3300, 2=2300, 4=1301, 8=1302, 16=2100, 32=3100, 64=3200, 128=3201
Modbus TCP Unit ID	40073	U		Configurable from User Interface
Modbus Communication Status	40074	U	ENUM	0=Communicating, 2=Not Communicating
Communications Error Counter	40075	U		
Last Successful Communication (Year, Month)	40076	U	Bitfield	See Note 5
Last Successful Communication (Day, Hour, Minutes)	40077	U	Bitfield	See Note 5
Last Successful Communication (Seconds, Milliseconds)	40078	U	Bitfield	See Note 5
PC500/550 (Device 8)				
Parameter	Modbus Register	Sign	Units	Comments
Device Type in Configuration	40081	U	ENUM	1=Genset, 2=ATS, 4=AUX101/102
Device Model	40082	U	ENUM	0=N/A, 1=3300, 2=2300, 4=1301, 8=1302, 16=2100, 32=3100, 64=3200, 128=3201
Modbus TCP Unit ID	40083	U		Configurable from User Interface
Modbus Communication Status	40084	U	ENUM	0=Communicating, 2=Not Communicating

Communications Error Counter	40085	U		
Last Successful Communication (Year, Month)	40086	U	Bitfield	See Note 5
Last Successful Communication (Day, Hour, Minutes)	40087	U	Bitfield	See Note 5
Last Successful Communication (Seconds, Milliseconds)	40088	U	Bitfield	See Note 5
PC500/550 (Device 9)				
Parameter	Modbus Register	Sign	Units	Comments
Device Type in Configuration	40091	U	ENUM	1=Genset, 2=ATS, 4=AUX101/102
Device Model	40092	U	ENUM	0=N/A, 1=3300, 2=2300, 4=1301, 8=1302, 16=2100, 32=3100, 64=3200, 128=3201
Modbus TCP Unit ID	40093	U		Configurable from User Interface
Modbus Communication Status	40094	U	ENUM	0=Communicating, 2=Not Communicating
Communications Error Counter	40095	U		
Last Successful Communication (Year, Month)	40096	U	Bitfield	See Note 5
Last Successful Communication (Day, Hour, Minutes)	40097	U	Bitfield	See Note 5
Last Successful Communication (Seconds, Milliseconds)	40098	U	Bitfield	See Note 5
PC500/550 (Device 10)				
Parameter	Modbus Register	Sign	Units	Comments
Device Type in Configuration	40101	U	ENUM	1=Genset, 2=ATS, 4=AUX101/102
Device Model	40102	U	ENUM	0=N/A, 1=3300, 2=2300, 4=1301, 8=1302, 16=2100, 32=3100, 64=3200, 128=3201
Modbus TCP Unit ID	40103	U		Configurable from User Interface
Modbus Communication Status	40104	U	ENUM	0=Communicating, 2=Not Communicating
Communications Error Counter	40105	U		
Last Successful Communication (Year, Month)	40106	U	Bitfield	See Note 5
Last Successful Communication (Day, Hour, Minutes)	40107	U	Bitfield	See Note 5

Last Successful Communication (Seconds, Milliseconds)	40108	U	Bitfield	See Note 5
PC500/550 (Device 11)				
Parameter	Modbus Register	Sign	Units	Comments
Device Type in Configuration	40111	U	ENUM	1=Genset, 2=ATS, 4=AUX101/102
Device Model	40112	U	ENUM	0=N/A, 1=3300, 2=2300, 4=1301, 8=1302, 16=2100, 32=3100, 64=3200, 128=3201
Modbus TCP Unit ID	40113	U		Configurable from User Interface
Modbus Communication Status	40114	U	ENUM	0=Communicating, 2=Not Communicating
Communications Error Counter	40115	U		
Last Successful Communication (Year, Month)	40116	U	Bitfield	See Note 5
Last Successful Communication (Day, Hour, Minutes)	40117	U	Bitfield	See Note 5
Last Successful Communication (Seconds, Milliseconds)	40118	U	Bitfield	See Note 5
PC500/550 (Device 12)				
Parameter	Modbus Register	Sign	Units	Comments
Device Type in Configuration	40121	U	ENUM	1=Genset, 2=ATS, 4=AUX101/102
Device Model	40122	U	ENUM	0=N/A, 1=3300, 2=2300, 4=1301, 8=1302, 16=2100, 32=3100, 64=3200, 128=3201
Modbus TCP Unit ID	40123	U		Configurable from User Interface
Modbus Communication Status	40124	U	ENUM	0=Communicating, 2=Not Communicating
Communications Error Counter	40125	U		
Last Successful Communication (Year, Month)	40126	U	Bitfield	See Note 5
Last Successful Communication (Day, Hour, Minutes)	40127	U	Bitfield	See Note 5
Last Successful Communication (Seconds, Milliseconds)	40128	U	Bitfield	See Note 5

NOTES:

1. Modbus TCP can be enabled/disabled in the PC500/550 User Interface (Setup > Modbus Settings).
2. Default Modbus TCP port is 502 and is configurable in the PC500/550 User Interface (Setup > Modbus Settings). No more than 2 Modbus TCP sessions can be established at a time.
3. PC5xx provides READ ONLY access over Modbus TCP.
4. PC500/550 registers return details about all configured devices in PC5xx (Generator Set, ATS, AUX101/102) and can be accessed using Modbus TCP Unit ID 255 (default for PC500/550).
5. In PC500/550 registers, Devices 1 through 12 are numbered in the same order as they are arranged in the Interface Device Configuration grid. To access details of these devices over Modbus TCP, the user must use the Modbus TCP Unit ID (returned by register 4xxx3) in the query.
6. Bitmap registers indicating Last Successful Communication (4xxx6, 4xxx7, 4xxx8) are formatted as below:



7. Site IOs (sensors) and AUX101/102 data cannot be accessed over Modbus TCP.

Generator Set					
Modbus Register	Scale	Sign	Units	Description	Comments
40001	1	U	ENUM	Switch Position	0=Off, 1=AUTO, 2=Manual
40002	1	U	ENUM	Control State	0=Stopped, 1=Pending, 2=Warm Up, 3=Running, 4=Cool Down (rated), 5=Cool Down (idle)
40003	1	U		Fault Code	
40004	1	U	ENUM	Fault Type	0=Normal, 1=Warning, 2=Derate, 3=Shutdown w/Cooldown, 4=Shutdown
40005	1	U	Bitfield	NFPA110	See Table 3 on page 11
40006	1	U	Bitfield	NFPA Extended	See Table 4 on page 11
40007	1	U	Volts	L1N Voltage	
40008	1	U	Volts	L2N Voltage	
40009	1	U	Volts	L3N Voltage	
40010	1	U	Volts	L1L2 Voltage	
40011	1	U	Volts	L2L3 Voltage	
40012	1	U	Volts	L3L1 Voltage	
40013	1	U	Amps	L1 Current	

Generator Set					
Modbus Register	Scale	Sign	Units	Description	Comments
40014	1	U	Amps	L2 Current	
40015	1	U	Amps	L3 Current	
40016	1	S	kVA	Total kVA	
40017	0.01	U	Hz	Frequency	
40018	0.1	U	%	PercentAmps APhase	
40019	0.1	U	%	PercentAmps BPhase	
40020	0.1	U	%	PercentAmps CPhase	
40021	1	S	kW	Total kW	
40022	0.01	S		Total Power Factor	
40023	0.01	S	Volts	Battery Voltage	
40024	0.1	S	psi	Oil Pressure	
40025	0.1	S	_F	Oil Temperature	
40026	0.1	S	_F	Coolant Temperature	
40027	1	U	GPH	Fuel Rate	
40028	0.1	U	Gallons	Fuel Level	
40029	1	U	RPM	Average Engine Speed	
40030	1	U		Engine Starts	
40031	0.1	U	Hours	Engine Runtime	

ATS					
Modbus Register	Scale	Sign	Units	Description	Comments
40001	1	U	ENUM	Mode	0=Test 1=Utility/Genset, 2=Utility/Utility, 3=Genset/Genset
40002	1	U	ENUM	Active Transfer Timer	0=None, 1=EngineStartASource2, 2=EngineStartBSource1, 3=NormaltoEmergency (TDNE), 4=EmergencytoNormal (TDEN), 5=EngineCooldownA (TDECa), 6=EngineCooldownB (TDECb), 7=ProgramTransition (TDPT), 8=Transfer Pend./Elevator (TDEL), 255=Unknown

ATS					
Modbus Register	Scale	Sign	Units	Description	Comments
40003	1	U		Fault Code	
40004	1	U	ENUM	Fault Type	0=No Faults, 1=Warning
40005	1	U	Bitfield	NFPA110	See Table 5 on page 12
40006	1	U	Bitfield	NFPA Extended	See Table 6 on page 12
40007	1	U	Volts	L1N Voltage (Load)	
40008	1	U	Volts	L2N Voltage (Load)	
40009	1	U	Volts	L3N Voltage (Load)	
40010	1	U	Volts	L1L2 Voltage (Load)	
40011	1	U	Volts	L2L3 Voltage (Load)	
40012	1	U	Volts	L3L1 Voltage (Load)	
40013	1	U	Amps	L1 Current (Load)	
40014	1	U	Amps	L2 Current (Load)	
40015	1	U	Amps	L3 Current (Load)	
40016	1	S	kW	Total kW (Load)	
40017	0.01	S		Total Power Factor (Load)	
40018	1	S	kVAR	Total kVAR (Load)	
40019	1	S	kVA	Total kVA (Load)	
40020	0.01	U	Hz	Frequency (Load)	
40021	0.1	U	%	PercentAmps APhase (Load)	
40022	0.1	U	%	PercentAmps BPhase (Load)	
40023	0.1	U	%	PercentAmps CPhase (Load)	
40024	1	U	Volts	L1N Voltage Source1	
40025	1	U	Volts	L2N Voltage Source1	
40026	1	U	Volts	L3N Voltage Source1	
40027	1	U	Volts	L1L2 Voltage Source1	
40028	1	U	Volts	L2L3 Voltage Source1	
40029	1	U	Volts	L3L1 Voltage Source1	
40037	0.01	U	Hz	Frequency Source1	
40041	1	U	Volts	L1N Voltage Source2	
40042	1	U	Volts	L2N Voltage Source2	
40043	1	U	Volts	L3N Voltage Source2	
40044	1	U	Volts	L1L2 Voltage Source2	

ATS					
Modbus Register	Scale	Sign	Units	Description	Comments
40045	1	U	Volts	L2L3 Voltage Source2	
40046	1	U	Volts	L3L1 Voltage Source2	
40054	0.01	U	Hz	Frequency Source2	

12 PC40

12.1 PC40 Modbus Register Map

12.1.1 PC40 Modbus Parametric Data

TABLE 43. PC40 MODBUS PARAMETRIC DATA

Address	System Name	Access	Specifications	System Description
401149	S1 Frequency	Read Only	Multiplier: 0.1 Size (Bits): 16 Sign: U Unit: Hz Lower Limit: 0 Upper Limit: 70 Default:	Measured Frequency
401150-51	S1 L1-N RMS Voltage	Read Only	Multiplier: 0.1 Size (Bits): 32 Sign: U Unit: V Lower Limit: 0 Upper Limit: 18,000 Default:	RMS Voltage between Line 1 and Neutral
401154-53	S1 L2-N RMS Voltage	Read Only	Multiplier: 0.1 Size (Bits): 32 Sign: U Unit: V Lower Limit: 0 Upper Limit: 18,000 Default:	RMS Voltage between Line 2 and Neutral
401154-55	S1 L3-N RMS Voltage	Read Only	Multiplier: 0.1 Size (Bits): 32 Sign: U Unit: V Lower Limit: 0 Upper Limit: 18,000 Default:	RMS Voltage between Line 3 and Neutral

Address	System Name	Access	Specifications	System Description
401156-57	S1 L1-L2 RMS Voltage	Read Only	Multiplier: 0.1 Size (Bits): 32 Sign: U Unit: V Lower Limit: 0 Upper Limit: 30,000 Default:	RMS Voltage between Line 1 and Line 2
401158-59	S1 L2-L3 RMS Voltage	Read Only	Multiplier: 0.1 Size (Bits): 32 Sign: U Unit: V Lower Limit: 0 Upper Limit: 30,000 Default:	RMS Voltage between Line 2 and Line 3
401160-61	S1 L3-L1 RMS Voltage	Read Only	Multiplier: 0.1 Size (Bits): 32 Sign: U Unit: V Lower Limit: 0 Upper Limit: 30,000 Default:	RMS Voltage between Line 3 and Line 1
401162-63	S1 L1 RMS Current	Read Only	Multiplier: 0.1 Size (Bits): 32 Sign: U Unit: A Lower Limit: 0 Upper Limit: 99,999.9 Default:	RMS Current through Line 1
401164-65	S1 L2 RMS Current	Read Only	Multiplier: 0.1 Size (Bits): 32 Sign: U Unit: A Lower Limit: 0 Upper Limit: 99,999.9 Default:	RMS Current through Line 2
401166-67	S1 L3 RMS Current	Read Only	Multiplier: 0.1 Size (Bits): 32 Sign: U Unit: A Lower Limit: 0 Upper Limit: 99,999.9 Default:	RMS Current through Line 3

Address	System Name	Access	Specifications	System Description
401170-71	S1 L1 kW	Read Only	Multiplier: 1 Size (Bits): 32 Sign: S Units: W Lower Limit: -99,999,999 Upper Limit: 99,999,999 Default:	kW value at Line 1
401172-73	S1 L2 kW	Read Only	Multiplier: 1 Size (Bits): 32 Sign: S Units: W Lower Limit: -99,999,999 Upper Limit: 99,999,999 Default:	kW value at Line 2
401174-75	S1 L3 kW	Read Only	Multiplier: 1 Size (Bits): 32 Sign: S Units: W Lower Limit: -99,999,999 Upper Limit: 99,999,999 Default:	kW value at Line 3
401177	S2 Frequency	Read Only	Multiplier: 0.1 Size (Bits): 16 Sign: U Unit: Hz Lower Limit: 0 Upper Limit: 70 Default:	Measured Frequency
401178-79	S2 L1-N RMS Voltage	Read Only	Multiplier: 0.1 Size (Bits): 32 Sign: U Unit: V Lower Limit: 0 Upper Limit: 18,000 Default:	RMS Voltage between Line 1 and Neutral

Address	System Name	Access	Specifications	System Description
401180-81	S2 L2-N RMS Voltage	Read Only	Multiplier: 0.1 Size (Bits): 32 Sign: U Unit: V Lower Limit: 0 Upper Limit: 18,000 Default:	RMS Voltage between Line 2 and Neutral
401182-83	S2 L3-N RMS Voltage	Read Only	Multiplier: 0.1 Size (Bits): 32 Sign: U Unit: V Lower Limit: 0 Upper Limit: 18,000 Default:	RMS Voltage between Line 3 and Neutral
401184-85	S2 L1-L2 RMS Voltage	Read Only	Multiplier: 0.1 Size (Bits): 32 Sign: U Unit: V Lower Limit: 0 Upper Limit: 30,000 Default:	RMS Voltage between Line 1 and Line 2
401186-87	S2 L2-L3 RMS Voltage	Read Only	Multiplier: 0.1 Size (Bits): 32 Sign: U Unit: V Lower Limit: 0 Upper Limit: 30,000 Default:	RMS Voltage between Line 2 and Line 3
401188-89	S2 L3-L1 RMS Voltage	Read Only	Multiplier: 0.1 Size (Bits): 32 Sign: U Unit: V Lower Limit: 0 Upper Limit: 30,000 Default:	RMS Voltage between Line 3 and Line 1
401190-91	S2 L1 RMS Current	Read Only	Multiplier: 0.1 Size (Bits): 32 Sign: U Unit: A Lower Limit: 0 Upper Limit: 99,999.9 Default:	RMS Current through Line 1

Address	System Name	Access	Specifications	System Description
401192-93	S2 L2 RMS Current	Read Only	Multiplier: 0.1 Size (Bits): 32 Sign: U Unit: A Lower Limit: 0 Upper Limit: 99,999.9 Default:	RMS Current through Line 2
401194-95	S2 L3 RMS Current	Read Only	Multiplier: 0.1 Size (Bits): 32 Sign: U Unit: A Lower Limit: 0 Upper Limit: 99,999.9 Default:	RMS Current through Line 3
401198-99	S2 L1 kW	Read Only	Multiplier: 1 Size (Bits): 32 Sign: S Units: W Lower Limit: -99,999,999 Upper Limit: 99,999,999 Default:	kW value at Line 1
401200-01	S2 L2 kW	Read Only	Multiplier: 1 Size (Bits): 32 Sign: S Units: W Lower Limit: -99,999,999 Upper Limit: 99,999,999 Default:	kW value at Line 2
401202-03	S2 L3 kW	Read Only	Multiplier: 1 Size (Bits): 32 Sign: S Units: W Lower Limit: -99,999,999 Upper Limit: 99,999,999 Default:	kW value at Line 3

Address	System Name	Access	Specifications	System Description
401205-06	Load L1 Current	Read Only	Multiplier: NA Size (Bits): 16 Sign: U Unit: A Lower Limit: 0 Upper Limit: 99,999.9 Default:	RMS Current present through Line 1 on the load side
401207-08	Load L2 Current	Read Only	Multiplier: NA Size (Bits): 16 Sign: U Unit: A Lower Limit: 0 Upper Limit: 99,999.9 Default:	RMS Current present through Line 2 on the load side
401209-10	Load L3 Current	Read Only	Multiplier: NA Size (Bits): 16 Sign: U Unit: A Lower Limit: 0 Upper Limit: 99,999.9 Default:	RMS Current present through Line 3 on the load side
401218	S1 Phase Rotation	Read Only	Multiplier: NA Size (Bits): 16 Sign: U Unit: NA Lower Limit: 0 Upper Limit: 3 Default:	Phase rotation of the source in terms of L1-L2-L3 or L1-L3-L2
401219	S2 Phase Rotation	Read Only	Multiplier: NA Size (Bits): 16 Sign: U Unit: NA Lower Limit: 0 Upper Limit: 3 Default:	Phase rotation of the source in terms of L1-L2-L3 or L1-L3-L2
401263-64	Load L1-N Voltage	Read Only	Multiplier: NA Size (Bits): 16 Sign: U Unit: V Lower Limit: 0 Upper Limit: 18,000 Default:	RMS Voltage between Line 1 and Neutral

Address	System Name	Access	Specifications	System Description
401265-66	Load L2-N RMS Voltage	Read Only	Multiplier: NA Size (Bits): 16 Sign: U Unit: V Lower Limit: 0 Upper Limit: 18,000 Default:	RMS Voltage between Line 2 and Neutral
401267-68	Load L3-N RMS Voltage	Read Only	Multiplier: NA Size (Bits): 16 Sign: U Unit: V Lower Limit: 0 Upper Limit: 18,000 Default:	RMS Voltage between Line 3 and Neutral
401269-70	Load L1-L2 Voltage	Read Only	Multiplier: NA Size (Bits): 16 Sign: U Unit: V Lower Limit: 0 Upper Limit: 30,000 Default:	RMS Voltage between Line 1 and Line 2
401271-72	Load L2-L3 Voltage	Read Only	Multiplier: NA Size (Bits): 16 Sign: U Unit: V Lower Limit: 0 Upper Limit: 30,000 Default:	RMS Voltage between Line 2 and Line 3
401273-74	Load L3-L1 Voltage	Read Only	Multiplier: NA Size (Bits): 16 Sign: U Unit: V Lower Limit: 0 Upper Limit: 30,000 Default:	RMS Voltage between Line 3 and Line 1
401275-76	Load Frequency	Read Only	Multiplier: NA Size (Bits): 16 Sign: U Unit: Hz Lower Limit: 0 Upper Limit: 70 Default:	Measured Frequency

Address	System Name	Access	Specifications	System Description
401537-38	S2 Total Watts	Read Only	Multiplier: 1 Size (Bits): 32 Sign: S Unit: W Lower Limit: -99,999,999 Upper Limit: 99,999,999 Default:	Sum of kW values of all phases
401539-40	S2 L1 kVA	Read Only	Multiplier: 1 Size (Bits): 32 Sign: U Unit: VA Lower Limit: 0 Upper Limit: 99,999,999 Default:	kVA value at line 1
401541-42	S2 L2 kVA	Read Only	Multiplier: 1 Size (Bits): 32 Sign: U Unit: VA Lower Limit: 0 Upper Limit: 99,999,999 Default:	kVA value at line 2
401543-44	S2 L3 kVA	Read Only	Multiplier: 1 Size (Bits): 32 Sign: U Unit: VA Lower Limit: 0 Upper Limit: 99,999,999 Default:	kVA value at line 3
401545-46	S2 Total VA	Read Only	Multiplier: 1 Size (Bits): 32 Sign: U Unit: VA Lower Limit: 0 Upper Limit: 99,999,999 Default:	Sum of kVA values of all phases

Address	System Name	Access	Specifications	System Description
401547-48	S2 L1 kVAR	Read Only	Multiplier: 1 Size (Bits): 32 Sign: U Unit: VAR Lower Limit: 0 Upper Limit: 99,999,999 Default:	kVAR value at line 1
401549-50	S2 L2 kVAR	Read Only	Multiplier: 1 Size (Bits): 32 Sign: U Unit: VAR Lower Limit: 0 Upper Limit: 99,999,999 Default:	kVAR value at line 2
401551-52	S2 L3 kVAR	Read Only	Multiplier: 1 Size (Bits): 32 Sign: U Unit: VAR Lower Limit: 0 Upper Limit: 99,999,999 Default:	kVAR value at line 3
401553-54	S2 Total VAR	Read Only	Multiplier: 1 Size (Bits): 32 Sign: U Unit: VAR Lower Limit: 0 Upper Limit: 99,999,999 Default:	Sum of kVAR values of all phases
401555	S2 L1 Power Factor	Read Only	Multiplier: 0.01 Size (Bits): 16 Sign: S Unit: NA Lower Limit: -1 Upper Limit: 1 Default:	Power factor at line 1

Address	System Name	Access	Specifications	System Description
401556	S2 L2 Power Factor	Read Only	Multiplier: 0.01 Size (Bits): 16 Sign: S Unit: NA Lower Limit: -1 Upper Limit: 1 Default:	Power factor at line 2
401557	S2 L3 Power Factor	Read Only	Multiplier: 0.01 Size (Bits): 16 Sign: S Unit: NA Lower Limit: -1 Upper Limit: 1 Default:	Power factor at line 3
401558	S2 Average Power Factor	Read Only	Multiplier: 0.01 Size (Bits): 16 Sign: S Unit: NA Lower Limit: -1 Upper Limit: 1 Default:	Average power factor of all the line power factors
401561-562	S1 Total Watts	Read Only	Multiplier: 1 Size (Bits): 32 Sign: U Unit: VAR Lower Limit: -99,999,999 Upper Limit: 99,999,999 Default:	Sum of kW values of all phases
401563-64	S1 L1 kVA	Read Only	Multiplier: 1 Size (Bits): 32 Sign: U Unit: VAR Lower Limit: 0 Upper Limit: 99,999,999 Default:	kVA value at line 1

Address	System Name	Access	Specifications	System Description
401565-66	S1 L2 kVA	Read Only	Multiplier: 1 Size (Bits): 32 Sign: U Unit: VAR Lower Limit: 0 Upper Limit: 99,999,999 Default:	kVA value at line 2
401567-68	S1 L3 kVA	Read Only	Multiplier: 1 Size (Bits): 32 Sign: U Unit: VAR Lower Limit: 0 Upper Limit: 99,999,999 Default:	kVA value at line 3
401569-70	S1 Total VA	Read Only	Multiplier: 1 Size (Bits): 32 Sign: U Unit: VAR Lower Limit: 0 Upper Limit: 99,999,999 Default:	Sum of kVA values of all phases
401571-72	S1 L1 kVAR	Read Only	Multiplier: 1 Size (Bits): 32 Sign: U Unit: VAR Lower Limit: 0 Upper Limit: 99,999,999 Default:	kVAR value at line 1
401573-74	S1 L2 kVAR	Read Only	Multiplier: 1 Size (Bits): 32 Sign: U Unit: VAR Lower Limit: 0 Upper Limit: 99,999,999 Default:	kVAR value at line 2

Address	System Name	Access	Specifications	System Description
401575-76	S1 L3 kVAR	Read Only	Multiplier: 1 Size (Bits): 32 Sign: U Unit: VAR Lower Limit: 0 Upper Limit: 99,999,999 Default:	kVAR value at line 3
401577-78	S1 Total VAR	Read Only	Multiplier: 1 Size (Bits): 32 Sign: U Unit: VAR Lower Limit: 0 Upper Limit: 99,999,999 Default:	Sum of kVAR values of all phases
401579	S1 L1 Power Factor	Read Only	Multiplier: 0.01 Size (Bits): 16 Sign: S Unit: NA Lower Limit: -1 Upper Limit: 1 Default:	Power factor at line 1
401580	S1 L2 Power Factor	Read Only	Multiplier: 0.01 Size (Bits): 16 Sign: S Unit: NA Lower Limit: -1 Upper Limit: 1 Default:	Power factor at line 2
401581	S1 L3 Power Factor	Read Only	Multiplier: 0.01 Size (Bits): 16 Sign: S Unit: NA Lower Limit: -1 Upper Limit: 1 Default:	Power factor at line 3
401582	S1 Average Power Factor	Read Only	Multiplier: 0.01 Size (Bits): 16 Sign: S Unit: NA Lower Limit: -1 Upper Limit: 1 Default:	Average power factor of all the line power factors

Address	System Name	Access	Specifications	System Description
401801-02	S2 Total Exported kWh	Read Only	Multiplier: 0.1 Size (Bits): 32 Sign: U Unit: kWh Lower Limit: 0 Upper Limit: 4.29 x 10 ⁹ Default:	Total exported kWh
401805-06	S2 Total kVAh	Read Only	Multiplier: 0.1 Size (Bits): 32 Sign: U Unit: kWh Lower Limit: 0 Upper Limit: 4.29 x 10 ⁹ Default:	Total kVAh
401807-08	S2 Total Exported kVAh	Read Only	Multiplier: 0.1 Size (Bits): 32 Sign: U Unit: kWh Lower Limit: 0 Upper Limit: 4.29 x 10 ⁹ Default:	Total exported kVAh
401811-12	S1 Total Exported kWh	Read Only	Multiplier: 0.1 Size (Bits): 32 Sign: U Unit: kWh Lower Limit: 0 Upper Limit: 4.29 x 10 ⁹ Default:	Total exported kWh
401815-16	S1 Total kVAh	Read Only	Multiplier: 0.1 Size (Bits): 32 Sign: U Unit: kWh Lower Limit: 0 Upper Limit: 4.29 x 10 ⁹ Default:	Total kVAh

Address	System Name	Access	Specifications	System Description
401817-18	S1 Total Exported kVArh	Read Only	Multiplier: 0.1 Size (Bits): 32 Sign: U Unit: kWh Lower Limit: 0 Upper Limit: 4.29 x 10 ⁹ Default:	Total exported kVArh

12.1.2 Alarm Condition Codes

TABLE 44. ALARM CONDITION CODES

Condition	Description
0	Disabled Digital Input
1	Not Active Alarm
2	Warning Alarm
3	Shutdown Alarm
4	Electrical Trip Alarm
5–7	Reserved
8	Inactive Indication (No String)
9	Inactive Indication (Displayed String)
10	Active Indication
11–14	Reserved
15	Unimplemented Alarm

12.1.3 Modbus Alarms

TABLE 45. MODBUS ALARMS

Address	Bits	System Name	Access	Specifications		System Description
439426	1/16 - 4/16	S2 Failure Unlatched	Read Only	Size (Bits): 16 Sign: U	See Alarm Condition Codes	Source 2 failure unlatched alarm
439426	5/16 - 8/16	S2 Failure Latched	Read Only	Size (Bits): 16 Sign: U		Source 2 failure latched alarm
439426	9/16 - 12/16	Battery Low Voltage	Read Only	Size (Bits): 16 Sign: U		Battery low voltage alarm
439426	13/16 - 16/16	Battery High Voltage	Read Only	Size (Bits): 16 Sign: U		Battery high voltage alarm
439427	1/16 - 4/16	Fail to Stop	Read Only	Size (Bits): 16 Sign: U		Genset failed to stop alarm
439427	5/16 - 8/16	Fail to Start	Read Only	Size (Bits): 16 Sign: U		Genset failed to start alarm
439427	9/16 - 12/16	S1 Failure Unlatched	Read Only	Size (Bits): 16 Sign: U		Source 1 failure unlatched alarm
439427	13/16 - 16/16	S1 Failure Latched	Read Only	Size (Bits): 16 Sign: U		Source 1 failure latched alarm
439428	9/16 - 12/16	Failed to Reach Loading Frequency	Read Only	Size (Bits): 16 Sign: U		Genset failed to reach loading frequency
439428	13/16 - 16/16	Failed to Reach Loading Voltage	Read Only	Size (Bits): 16 Sign: U		Genset failed to reach loading voltage

This page is intentionally blank.

13 PC80

13.1 General Instructions

13.1.1 Modbus Protocol Application Guide Notes

1) Modbus Supported Functions

The control supports the following Modbus function codes:

- Read Holding Registers (Function Code 03)
- Read Input Registers (Function Code 04)
- Write Single Holding Register (Function Code 06)
- Write Multiple Holding Registers (Function Code 16)

The control shall respond to any function code other than those listed above by sending an exception response of Illegal Function (01).

A. Read Holding Registers

The control provides the ability to read 1 to 125 consecutive holding registers.

The control shall respond to any read request to address not defined in the control by returning 0xFFFF data for that address.

The control will return an Illegal Address exception code 02 if any of the following conditions occur:

- The first register in the holding register read request is not defined on the control.
- The first register in the holding register read request does not allow for the full representation of a numeric value. This would occur if the first register in the read request is not mapped to the most significant 2 bytes of a binary value parameter.
- The last register in the holding register read request does not allow for the full representation of a numeric value. This would occur if the last register in the read request is not mapped to the least significant 2 bytes of a binary value parameter.

Read requests for string type parameters where not every register associated with the string is in the request shall return only the requested portion of the string.

B. Read Input Registers

The control provides the ability to read 1 to 125 consecutive input registers.

The control shall respond to any read request to address not defined in the control by returning 0xFFFF data for that address.

The control will return an Illegal Address exception code 02 if any of the following conditions occur:

- The first register in the input register read request is not defined on the control.
- The first register in the input register read request does not allow for the full representation of a numeric value. This would occur if the first register in the read request is not mapped to the most significant 2 bytes of a parameter.
- The last register in the input register read request does not allow for the full representation of a numeric value. This would occur if the last register in the read request is not mapped to the least significant 2 bytes of a parameter.

The Input Registers support by each port on the control are listed in the Read Input Registers Table below.

C. Write Single Holding Register

The control will return an Illegal Address exception code 02 if any of the following conditions occur:

- The register in the holding register write request is not defined on the control.
- The register in the holding register write request does not allow for the full writing of a numeric value. This would occur if the register is part of a numeric parameter that requires more than one address to represent.
- If writing to a string values, the register in the holding register write request is not the first register of that string.

Write requests for string type parameters where not every register associated with the string is in the request shall write only the requested portion of the string.

Write requests to this control may return an Illegal Data Value exception code 03. This means that the requested write failed to occur.

D. Write Multiple Holding Registers

The control provides the ability to write to 1 to 123 consecutive holding registers.

The control will return an Illegal Address exception code 02 if any of the following conditions occur:

- The first register in the holding register write request is not defined on the control.
- The first register in the holding register write request does not allow for the full writing of a numeric value. This would occur if the first register in the write request is not mapped to the most significant 2 bytes of a parameter.
- The last register in the holding register write request does not allow for the full writing of a numeric value. This would occur if the last register in the write request is not mapped to the least significant 2 bytes of a parameter.
- If string values are in the write request, the first register for any string is not within the requested register range.

Write requests for string type parameters where not every register associated with the string is in the request shall write only the requested portion of the string.

Write requests to this control may return an Illegal Data Value exception code 03. This means that some or all of the requested writes failed to occur. It is the responsibility of the requestor to read the data again to determine which parameters were not written to their requested new values and to respond as necessary.

For any of these function codes, if there is an internal problem within the control software that prevents the control from completing the requested action, the control will return a Server Device Failure exception code of 04.

For any of these function codes while using Modbus TCP only, if data requests come from the Client and fill up internal Modbus TCP Server message queue's faster than the protocol can process these data requests, the control will return a Slave Device Busy exception code of 06.

2) Modbus RTU Serial Port Configuration Options

The following configuration options shall be available for each port the control that supports the Modbus RTU protocol. See the controller Modbus register map for individual register assignments for these parameters on any given port.

TABLE 46. MODBUS RTU SERIAL PORT CONFIGURATION OPTIONS

Parameter Name	Description	Specification
Modbus Node Address	Sets this ports node address.	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Unit: Lower Limit: 1 Upper Limit: 247
Modbus Baud Rate	Sets this ports baud rate.	0: 2400 1: 4800 2: 9600 3: 19200 4: 28800 5: 38400 6: 57600 7: 115200
Modbus Parity and Stop Bit Selection	Sets this ports parity and stop bit communications settings.	0: Even Parity (1 Stop) 1: Odd Parity (1 Stop) 2: No Parity (2 Stop) 3: No Parity (1 Stop)

Parameter Name	Description	Specification
Modbus Failure Time Delay	Sets the time delay for the detection of the lack of Modbus packets on the communications bus.	Multiplier: 1 Offset: 0 Size (bits): 8 Sign: U Unit: seconds Lower Limit: 1 Upper Limit: 60

NOTICE

Changes to the Modbus Baud Rate and the Modbus Parity and Stop Bit Selection parameters will immediately be reflected on the serial port being configured. Any Modbus commands in progress on that port in the old communications settings will fail until the Modbus master also updates its communications settings to match those of the slave.

3) Modbus TCP Port Configuration Options

The following configuration options shall be available for the Modbus TCP port. See the controller Modbus register map for individual register assignments for these parameters.

TABLE 47. MODBUS TCP PORT CONFIGURATION OPTIONS

Parameter Name	Description	Specification
Modbus TCP Unit Identifier	Sets the Unit Identifier (UID) (i.e. the Server Device Address) for Modbus TCP Server.	Multiplier: 1 Offset: 0 Size (bits): 8 Sign: U Unit: Lower Limit: 1 Upper Limit: 255
Modbus TCP Port1 Number	Sets the number for Port1 of Modbus TCP Server. User can Set this number as per requirement - default is 502. Can be set to any value >1024 up to 65535. The number should be unique between Modbus TCP Port1 and Port2. One of the Modbus TCP ports must be set to default value 502.	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Unit: Lower Limit: 0 Upper Limit: 65535 Default: 502

Parameter Name	Description	Specification
Modbus TCP Port2 Number	Sets the number for Port2 of Modbus TCP Server. User can Set this number as per requirement - default is 502. Can be set to any value >1024 up to 65535. The number should be unique between Modbus TCP Port1 and Port2. One of the Modbus TCP ports must be set to default value 502.	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Unit: Lower Limit: 0 Upper Limit: 65535 Default: 1025
Modbus TCP Session Inactivity Timeout	Sets the Modbus TCP Session Inactivity/Timeout. The interval/timeout is for detection of the lack of Modbus TCP packets in a session (on the socket). Common timeout period for every session. If the inactivity timer for a session expires, the Modbus TCP Server will disconnect from the socket maintaining that session.	Multiplier: 1 Offset: 0 Size (bits): 8 Sign: U Unit: seconds Lower Limit: 1 Upper Limit: 60 Default: 10

4) Modbus Extended Status Information

The control represents abnormal states in the data by using the five most positive values of the data to convey that these abnormal states exist. The states will only be applicable to numeric parameters with the following data types:

- UINT8, INT8, UINT16, INT16, UINT32, INT32, UINT64, INT64, FLOAT32 (signed and unsigned 8 bit thru 64-bit parameters and 32-bit floating-point parameters)

Note that enumerated parameters and parameters with a floating-point data type will not follow this abnormal state representation methods.

The following abnormal states are supported:

- **Unsupported (Not Available) Data:** “Not Available” data shall be represented as the highest positive value for that parameter. For example, for a two-byte unsigned integer the value would be 65535. For a signed two-byte integer the value would be 32767. For a 32-bit floating-point value this would be $3.4028234663852886 \times 10^{38}$.
 - Parameters which are not available due to the sensor not being installed or not enabled in the controller’s configuration will be classified as this.
- **Network Failed Data:** “Network Failure” data shall be represented as three · less than the highest positive value for that parameter. For example, for a two-byte unsigned integer the value would be 65532. For a signed two-byte integer the value would be 32764. For a 32-bit floating-point value this would be $3.4028228579130005 \times 10^{38}$.
 - Data that comes from a network that has failed such as sensor data coming from I/O modules on a PCCnet or CAN network will be classified as this.

- **Hardware/Component Failure:** “Hardware/Component Failure” data shall be represented as four less than the highest positive value for that parameter. For example, for a two-byte unsigned integer, the value would be 65531. For a signed two-byte integer the value would be 32763. For a 32-bit floating-point value this would be $3.4028226550889045 \times 10^{+38}$
 - An on-controller hardware/component failure that provides data like voltage, current and power for example will be classified as this.
- **Out of Range High/Out of Range:** “Out of Range High/Out of Range” data shall be represented as one less than the highest positive value for that parameter. For example, for a two-byte unsigned integer the value would be 65534. For a signed two-byte integer the value would be 32766. For a 32-bit floating-point value this would be $3.4028232635611926 \times 10^{+38}$
 - Data that has been determined to be out of range high or out of range (when there is no distinction between out of range high and out of range low) due to an open sensor for example, will be classified as this.
- **Out of Range Low:** “Out of Range Low” data shall be represented as two less than the highest positive value for that parameter. For example, for a two-byte unsigned integer the value would be 65533. For a signed two-byte integer the value would be 32765. For a 32-bit floating-point value this would be $3.4028230607370965 \times 10^{+38}$
 - Data that has been determined to be out of range high or out of range (when there is no distinction between out of range high and out of range low) due to an open sensor, for example, will be classified as this.

Note that this leaves the usable data range for extended data types to the following:

- For unsigned integer datatypes: 0 to $(2^{\text{size}} - 6)$
- For signed datatypes: $-2^{(\text{size}/2)}$ to $(2^{(\text{size}/2)} - 6)$
- For float32: $-3.4028234663852886 \times 10^{+38}$ to $+3.4028224522648084 \times 10^{+38}$

5) Working with 8-Bit Data Types

When reading a register that contains information in an 8-bit data type, the data will be put the least significant byte of the register. If the data type is unsigned, the upper byte will be populated with zero's. If the data type is signed, the upper byte will be sign extended with the sign bit value of the data byte.

When writing a register that contains information that is expected to be in an 8-bit data type, the control will expect the data to be in the least significant byte of the register and ignore the upper byte.

6) Representation of Multi-Register Parameters

For numeric parameters requiring more than one Register to represent the data, the Register Address listed in the Controller's Modbus Register Map represents the most significant 2 bytes of the data. The additional bytes of the data will always be provided in Register Address + 1, Register Address + 2, and Register Address +3 as appropriate.

For string parameters, the first two characters in the string will be mapped to the Register Address listed in the Controllers Modbus Register Map. Additional characters will be provided in the following registers. For example, for the string "String1" at address 40031, the characters will be mapped the following registers: 40031: "St" 40032: "ri" 40033: "ng" 40034: "1_"

7) Modbus RTU Slave Protocol Support for Read Input Registers

Each port instance of Modbus RTU Slave Protocol shall support interface to the following read input registers through function code 04. These are the only input registers supported by this control.

The following table applies for each instance of the Modbus RTU protocol on any control and will return the data from the port being read only.

TABLE 48. READ INPUT REGISTERS TABLE

Register Address	Name	Description	Data Type	Size	Scaling Factor
30001	Bus Message Count	This parameter contains the quantity of messages that this port has detected on the communications system since its last restart, clear counters operation, or power-up.	uint32	2 registers	1
30003	Bus CRC Error Count	This parameter stores quantity of CRC errors encountered by this port since its last restart, clear counters operation, or power-up.	uint32	2 registers	1
30005	Bus Exception Error Count	This parameter contains the quantity of exception responses returned by this port since its last restart, clear counters operation, or power-up.	uint32	2 registers	1

Register Address	Name	Description	Data Type	Size	Scaling Factor
30007	Server No Response Count	This parameter contains the quantity of messages addressed to this port for which it has returned no response since its last restart, clear counters operation, or power-up.	uint32	2 registers	1
30009	Server Message Count	The parameter contains the quantity of messages addressed to this port that it has processed since its last restart, clear counters operation, or power-up.	uint32	2 registers	1
30011	Modbus Time Stamp at Counter Reset - Year	This parameter holds the year of the time stamp record when counters were cleared last time.	uint8	1 register	1
30012	Modbus Time Stamp at Counter Reset - Month	This parameter holds the month of the time stamp record when counters were cleared last time.	uint8	1 register	1
30013	Modbus Time Stamp at Counter Reset - Date	This parameter holds the day of the month of the time stamp record when counters were cleared last time.	uint8	1 register	1
30014	Modbus Time Stamp at Counter Reset – Hour	This parameter holds the hour of the time stamp record when counters were cleared last time.	uint8	1 register	1

Register Address	Name	Description	Data Type	Size	Scaling Factor
30015	Modbus Time Stamp at Counter Reset - Minute	This parameter holds the minute of the time stamp record when counters were cleared last time.	uint8	1 register	1
30016	Modbus Time Stamp at Counter Reset - Seconds	This parameter holds the seconds of the time stamp record when counters were cleared last time.	uint8	1 register	1
30017	Modbus Time Since Last Counter Reset	This parameter maintains the time in seconds since the last reset of Modbus diagnostic counters.	uint32	2 registers	1

8) Modbus TCP Protocol (Server) Support for Read Input Registers

Modbus TCP Protocol (server) implementation shall support interface to the following read input registers through function code 04. These are the only input registers supported by this control.

The following table applies for the only instance of the Modbus TCP protocol on any control and will return the data from the port being read only.

TABLE 49. READ INPUT REGISTERS TABLE

Register Address	Name	Description	Data Type	Size	Scaling Factor
30019	Modbus TCP Port1 Message Count	This parameter contains the quantity of messages that this port has detected on the communications system since its last restart, clear counters operation, or power-up.	uint32	2 registers	1

Register Address	Name	Description	Data Type	Size	Scaling Factor
30021	Port1 Communication Error count	This parameter stores quantity of errors encountered at port 1 of Modbus TCP since its last restart, clear counters operation, or power-up.	uint32	2 registers	1
30023	Modbus TCP Port1 Exception Count	This parameter contains the quantity of exception responses returned by this port since its last restart, clear counters operation, or power-up.	uint32	2 registers	1
30025	Modbus TCP Port1 No Response Count	This parameter contains the quantity of messages addressed to this port for which it has returned no response since its last restart, clear counters operation, or power-up.	uint32	2 registers	1
30027	ModbusTCPPort1 Time Stamp At Counter Reset-Year	This parameter holds the year of the time stamp record when counters were cleared last time.	uint8	1 register	1
30028	ModbusTCPPort1 Time Stamp At Counter Reset-Month	This parameter holds the month of the time stamp record when counters were cleared last time.	uint8	1 register	1

Register Address	Name	Description	Data Type	Size	Scaling Factor
30029	ModbusTCPPort1 Time Stamp At Counter Reset-Date	This parameter holds the day of the month of the time stamp record when counters were cleared last time.	uint8	1 register	1
30030	ModbusTCPPort1 Time Stamp At Counter Reset-Hour	This parameter holds the hour of the time stamp record when counters were cleared last time.	uint8	1 register	1
30031	ModbusTCPPort1 Time Stamp At Counter Reset-Min	This parameter holds the minute of the time stamp record when counters were cleared last time.	uint8	1 register	1
30032	ModbusTCPPort1 Time Stamp At Counter Reset-Sec	This parameter holds the seconds of the time stamp record when counters were cleared last time.	uint8	1 register	1
30033	Modbus TCP Port1 Time Since Last Counter Reset	This parameter maintains the time in seconds since the last reset of Modbus diagnostic counters.	uint8	1 register	1
30035	Modbus TCP Port2 Message Count	This parameter contains the quantity of messages that this port has detected on the communications system since its last restart, clear counters operation, or power-up.	uint8	1 register	1

Register Address	Name	Description	Data Type	Size	Scaling Factor
30037	Port2 Communication Error count	This parameter contains the quantity of errors encountered at port 2 of modbus TCP since its last restart, clear counters operation, or power-up.	uint32	2 registers	1
30039	Modbus TCP Port2 Exception Count	This parameter stores quantity of errors encountered at port 2 of Modbus TCP since its last restart, clear counters operation, or power-up.	uint32	2 registers	1
30041	Modbus TCP Port2 No Response Count	This parameter contains the quantity of messages addressed to this port for which it has returned no response since its last restart, clear counters operation, or power-up.	uint32	2 registers	1
30043	ModbusTCPPort2 Time Stamp At Counter Reset-Year	This parameter holds the year of the time stamp record when counters were cleared last time.	uint8	1 register	1
30044	ModbusTCPPort2 Time Stamp At Counter Reset-Month	This parameter holds the month of the time stamp record when counters were cleared last time.	uint8	1 register	1

Register Address	Name	Description	Data Type	Size	Scaling Factor
30045	ModbusTCPPort2 Time Stamp At Counter Reset-Date	This parameter holds the day of the month of the time stamp record when counters were cleared last time.	uint8	1 register	1
30046	ModbusTCPPort2 Time Stamp At Counter Reset-Hour	This parameter holds the hour of the time stamp record when counters were cleared last time.	uint8	1 register	1
30047	ModbusTCPPort2 Time Stamp At Counter Reset-Min	This parameter holds the minute of the time stamp record when counters were cleared last time.	uint8	1 register	1
30048	ModbusTCPPort2 Time Stamp At Counter Reset-Sec	This parameter holds the seconds of the time stamp record when counters were cleared last time.	uint8	1 register	1
30049	Modbus TCP Port2 Time Since Last Counter Reset	This parameter maintains the time in seconds since the last reset of Modbus diagnostic counters.	uint8	1 register	1

9) Other MODBUS TCP Client Considerations

The Modbus TCP server can only handle 1 Modbus transaction at a time per Client/Server connection. If the Modbus TCP server does not respond to a request in a timely manner (i.e. a Client side transaction timeout occurs), it is recommended that the Client disconnect from the Server and then reconnect before attempting another Modbus transaction.

13.2 PC80 Modbus Register Map

13.2.1 PC80 Modbus Parametric Data

NOTICE
Daily Peak Power Timestamp (Address 410507) will be displayed in format DDMMYY. For example: If Parameter reading shows 81118 this will mean November 8 2018. If parameter reading shows 10120 this will mean January 01, 2020.

TABLE 50. PC80 MODBUS PARAMETRIC DATA

Addr.	System Name	Access	Specifications	System Description
410001	S1 Average Power Factor	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: Lower Limit: -1 Upper Limit: 1 Default/Initial: 0	This is the average power factor of all the line power factors
410003	S1 Frequency	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: Hz Lower Limit: 0 Upper Limit: 100 Default/Initial: 0	Measured Frequency
410013	S1 L1 kVA	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: kVA Lower Limit: -100000 Upper Limit: 100000 Default/Initial: 0	kVA value at Line 1

Addr.	System Name	Access	Specifications	System Description
410017	S1 L1 kVAR	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: kVAR Lower Limit: -100000 Upper Limit: 100000 Default/Initial: 0	kVAR value at Line 1
410019	S1 L1 kW	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: kW Lower Limit: -100000 Upper Limit: 100000 Default/Initial: 0	kW value at Line 1
410021	S1 L1 Power Factor	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: Lower Limit: -1 Upper Limit: 1 Default/Initial: 0	Power factor for Line 1
410023	S1 L1 RMS Current	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: A Lower Limit: 0 Upper Limit: 10000 Default/Initial: 0	RMS Current through Line 1
410025	S1 L1-L2 RMS Voltage	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: V Lower Limit: 0 Upper Limit: 45000 Default/Initial: 0	RMS Voltage between Line 1 and Line 2

Addr.	System Name	Access	Specifications	System Description
410027	S1 L1-N RMS Voltage	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: V Lower Limit: 0 Upper Limit: 45000 Default/Initial: 0	RMS Voltage between Line 1 and Neutral
410037	S1 L2 kVA	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: kVA Lower Limit: -100000 Upper Limit: 100000 Default/Initial: 0	kVA value at Line 2
410041	S1 L2 kVAR	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: kVAR Lower Limit: -100000 Upper Limit: 100000 Default/Initial: 0	kVAR value at Line 2
410043	S1 L2 kW	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: kW Lower Limit: -100000 Upper Limit: 100000 Default/Initial: 0	kW value at Line 2
410045	S1 L2 Power Factor	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: Lower Limit: -1 Upper Limit: 1 Default/Initial: 0	Power factor for Line 2

Addr.	System Name	Access	Specifications	System Description
410047	S1 L2 RMS Current	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: A Lower Limit: 0 Upper Limit: 10000 Default/Initial: 0	RMS Current through Line 2
410049	S1 L2-L3 RMS Voltage	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: V Lower Limit: 0 Upper Limit: 45000 Default/Initial: 0	RMS Voltage between Line 2 and Line 3
410051	S1 L2-N RMS Voltage	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: V Lower Limit: 0 Upper Limit: 45000 Default/Initial: 0	RMS Voltage between Line 2 and Neutral
410061	S1 L3 kVA	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: kVA Lower Limit: -100000 Upper Limit: 100000 Default/Initial: 0	kVA value at Line 3
410065	S1 L3 kVAR	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: kVAR Lower Limit: -100000 Upper Limit: 100000 Default/Initial: 0	kVar value at Line 3

Addr.	System Name	Access	Specifications	System Description
410067	S1 L3 kW	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: kW Lower Limit: -100000 Upper Limit: 100000 Default/Initial: 0	kW value at Line 3
410069	S1 L3 Power Factor	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: Lower Limit: -1 Upper Limit: 1 Default/Initial: 0	Power factor for Line 3
410071	S1 L3 RMS Current	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: A Lower Limit: 0 Upper Limit: 10000 Default/Initial: 0	RMS Current through Line 3
410073	S1 L3-L1 RMS Voltage	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: V Lower Limit: 0 Upper Limit: 45000 Default/Initial: 0	RMS Voltage between Line 3 and Line 1
410075	S1 L3-N RMS Voltage	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: V Lower Limit: 0 Upper Limit: 45000 Default/Initial: 0	RMS Voltage between Line 3 and Neutral

Addr.	System Name	Access	Specifications	System Description
410077	S1 LN RMS Current	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: A Lower Limit: 0 Upper Limit: 10000 Default/Initial: 0	Neutral RMS current
410079	S1 Phase Rotation	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 8 Sign: U Units: Lower Limit: 0 Upper Limit: 1 Default/Initial: 0	Phase rotation of the source in terms of L1-L2-L3 or L1-L3-L2
410080	S1 Total Exported kVArh	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: kVArh Lower Limit: -3.4E+38 Upper Limit: 3.4E+38 Default/Initial: 0	Accumulated total kVArh exported by source on all lines
410082	S1 Total Exported kWh	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: kWh Lower Limit: -3.4E+38 Upper Limit: 3.4E+38 Default/Initial: 0	Accumulated total kWh exported by the source on all lines
410088	S1 Total kVA	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: kVA Lower Limit: -100000 Upper Limit: 100000 Default/Initial: 0	Sum of kVA values of all phases

Addr.	System Name	Access	Specifications	System Description
410090	S1 Total kVAh	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: kVAh Lower Limit: -3.4E+38 Upper Limit: 3.4E+38 Default/Initial: 0	Sum of kVAh values of all phases
410092	S1 Total kVar	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: kVAR Lower Limit: -100000 Upper Limit: 100000 Default/Initial: 0	Sum of kVar values of all phases
410094	S1 Total kW	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: kW Lower Limit: -100000 Upper Limit: 100000 Default/Initial: 0	Sum of kW values of all phases
410096	S1 L1 Voltage THD %	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: % Lower Limit: 0 Upper Limit: 100 Default/Initial: 0	Total Harmonic Distortion present in the Line 1 to neutral voltage.
410098	S1 L2 Voltage THD %	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: % Lower Limit: 0 Upper Limit: 100 Default/Initial: 0	Total Harmonic Distortion present in the Line 2 to neutral voltage.

Addr.	System Name	Access	Specifications	System Description
410100	S1 L3 Voltage THD %	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: % Lower Limit: 0 Upper Limit: 100 Default/Initial: 0	Total Harmonic Distortion present in the Line 3 to neutral voltage.
410102	S1 Average Voltage THD %	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: % Lower Limit: 0 Upper Limit: 100 Default/Initial: 0	Averaged Total Harmonic Distortion present in the line to neutral voltages feeding the load.
410104	S1 L1 Phase Angle	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: deg Lower Limit: -360 Upper Limit: 360 Default/Initial: 0	Angle by which the voltage lags the current on Line 1
410106	S1 L2 Phase Angle	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: deg Lower Limit: -360 Upper Limit: 360 Default/Initial: 0	Angle by which the voltage lags the current on Line 2
410108	S1 L3 Phase Angle	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: deg Lower Limit: -360 Upper Limit: 360 Default/Initial: 0	Angle by which the voltage lags the current on Line 3

Addr.	System Name	Access	Specifications	System Description
410251	S2 Average Power Factor	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: Lower Limit: -1 Upper Limit: 1 Default/Initial: 0	This is the average power factor of all the line power factors
410253	S2 Frequency	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: Hz Lower Limit: 0 Upper Limit: 100 Default/Initial: 0	Measured Frequency
410263	S2 L1 kVA	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: kVA Lower Limit: -100000 Upper Limit: 100000 Default/Initial: 0	kVA value at Line 1
410267	S2 L1 kVar	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: kVAR Lower Limit: -100000 Upper Limit: 100000 Default/Initial: 0	kVar value at Line 1
410269	S2 L1 kW	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: kW Lower Limit: -100000 Upper Limit: 100000 Default/Initial: 0	kW value at Line 1

Addr.	System Name	Access	Specifications	System Description
410271	S2 L1 Power Factor	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: Lower Limit: -1 Upper Limit: 1 Default/Initial: 0	Power factor of Line 1
410273	S2 L1 RMS Current	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: A Lower Limit: 0 Upper Limit: 10000 Default/Initial: 0	RMS Current through Line 1
410275	S2 L1-L2 RMS Voltage	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: V Lower Limit: 0 Upper Limit: 45000 Default/Initial: 0	RMS Voltage between Line 1 and Line 2
410277	S2 L1-N RMS Voltage	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: V Lower Limit: 0 Upper Limit: 45000 Default/Initial: 0	RMS Voltage between Line 1 and Neutral
410287	S2 L2 kVA	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: kVA Lower Limit: -100000 Upper Limit: 100000 Default/Initial: 0	kVA value at Line 2

Addr.	System Name	Access	Specifications	System Description
410291	S2 L2 kVar	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: kVAR Lower Limit: -100000 Upper Limit: 100000 Default/Initial: 0	kVar value at Line 2
410293	S2 L2 kW	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: kW Lower Limit: -100000 Upper Limit: 100000 Default/Initial: 0	kW value at Line 2
410295	S2 L2 Power Factor	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: Lower Limit: -1 Upper Limit: 1 Default/Initial: 0	Power factor of Line 2
410297	S2 L2 RMS Current	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: A Lower Limit: 0 Upper Limit: 10000 Default/Initial: 0	RMS Current through Line 2
410299	S2 L2-L3 RMS Voltage	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: V Lower Limit: 0 Upper Limit: 45000 Default/Initial: 0	RMS Voltage between Line 2 and Line 3

Addr.	System Name	Access	Specifications	System Description
410301	S2 L2-N RMS Voltage	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: V Lower Limit: 0 Upper Limit: 45000 Default/Initial: 0	RMS Voltage between Line 2 and Neutral
410311	S2 L3 kVA	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: kVA Lower Limit: -100000 Upper Limit: 100000 Default/Initial: 0	kVA value at Line 3
410315	S2 L3 kVar	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: kVAR Lower Limit: -100000 Upper Limit: 100000 Default/Initial: 0	kVar value at Line 3
410317	S2 L3 kW	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: kW Lower Limit: -100000 Upper Limit: 100000 Default/Initial: 0	kW value at Line 3
410319	S2 L3 Power Factor	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: Lower Limit: -1 Upper Limit: 1 Default/Initial: 0	Power factor of Line 3

Addr.	System Name	Access	Specifications	System Description
410321	S2 L3 RMS Current	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: A Lower Limit: 0 Upper Limit: 10000 Default/Initial: 0	RMS Current through Line 3
410323	S2 L3-L1 RMS Voltage	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: V Lower Limit: 0 Upper Limit: 45000 Default/Initial: 0	RMS Voltage between Line 3 and Line 1
410325	S2 L3-N RMS Voltage	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: V Lower Limit: 0 Upper Limit: 45000 Default/Initial: 0	RMS Voltage between Line 3 and Neutral
410327	S2 LN RMS Current	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: A Lower Limit: 0 Upper Limit: 10000 Default/Initial: 0	Neutral RMS current
410329	S2 Phase Rotation	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 8 Sign: U Units: Lower Limit: 0 Upper Limit: 1 Default/Initial: 0	Phase rotation of the source in terms of L1-L2-L3 or L1-L3-L2

Addr.	System Name	Access	Specifications	System Description
410330	S2 Total Exported kVARh	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: kVARh Lower Limit: -3.4E+38 Upper Limit: 3.4E+38 Default/Initial: 0	Accumulated total kVARh exported by source on all lines
410332	S2 Total Exported kWh	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: kWh Lower Limit: -3.4E+38 Upper Limit: 3.4E+38 Default/Initial: 0	Accumulated total kWh exported by the source on all lines
410338	S2 Total kVA	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: kVA Lower Limit: -100000 Upper Limit: 100000 Default/Initial: 0	Sum of kVA values of all phases
410340	S2 Total kVAh	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: kVAh Lower Limit: -3.4E+38 Upper Limit: 3.4E+38 Default/Initial: 0	Sum of kVAh values of all phases
410342	S2 Total kVar	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: kVAR Lower Limit: -100000 Upper Limit: 100000 Default/Initial: 0	Sum of kVAR values of all phases

Addr.	System Name	Access	Specifications	System Description
410344	S2 Total kW	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: kW Lower Limit: -100000 Upper Limit: 100000 Default/Initial: 0	Sum of kW values of all phases
410346	Sync Phase Difference	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: deg Lower Limit: -360 Upper Limit: 360 Default/Initial: 0	Phase difference between the two sources
410348	Frequency Difference	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: Hz Lower Limit: -100 Upper Limit: 100 Default/Initial: 0	Measured Frequency difference between the two sources.
410350	S2 L1 Voltage THD %	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: % Lower Limit: 0 Upper Limit: 100 Default/Initial: 0	Total Harmonic Distortion present in the Line 1 to neutral voltage.
410352	S2 L2 Voltage THD %	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: % Lower Limit: 0 Upper Limit: 100 Default/Initial: 0	Total Harmonic Distortion present in the Line 2 to neutral voltage.

Addr.	System Name	Access	Specifications	System Description
410354	S2 L3 Voltage THD %	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: % Lower Limit: 0 Upper Limit: 100 Default/Initial: 0	Total Harmonic Distortion present in the Line 3 to neutral voltage.
410356	S2 Average Voltage THD %	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: % Lower Limit: 0 Upper Limit: 100 Default/Initial: 0	Averaged Total Harmonic Distortion present in the line to neutral voltages feeding the load.
410358	S2 L1 Phase Angle	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: deg Lower Limit: -360 Upper Limit: 360 Default/Initial: 0	Angle by which the voltage lags the current on Line 1
410360	S2 L2 Phase Angle	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: deg Lower Limit: -360 Upper Limit: 360 Default/Initial: 0	Angle by which the voltage lags the current on Line 2
410362	S2 L3 Phase Angle	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: deg Lower Limit: -360 Upper Limit: 360 Default/Initial: 0	Angle by which the voltage lags the current on Line 3

Addr.	System Name	Access	Specifications	System Description
410501	Daily Peak Power	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: kW Lower Limit: -100000 Upper Limit: 100000 Default/Initial: 0	Daily Peak Power in kW
410503	Previous Daily Peak Power	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: kW Lower Limit: -100000 Upper Limit: 100000 Default/Initial: 0	Previous Daily Peak Power in kW
410505	Total Time Load Energized	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: U Units: sec Lower Limit: 0 Upper Limit: 4.29E+09 Default/Initial: 0	Total number of hours for which normal and emergency sources have been connected and available
410507	Daily Peak Power Timestamp	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: U Units: Lower Limit: 0 Upper Limit: 4.29E+09 Default/Initial: 0	Timestamp for Daily Peak Power
410509	Weekly Peak Power	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: kW Lower Limit: -100000 Upper Limit: 100000 Default/Initial: 0	Weekly Peak Power in kW

Addr.	System Name	Access	Specifications	System Description
410511	Previous Weekly Peak Power	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: kW Lower Limit: -100000 Upper Limit: 100000 Default/Initial: 0	Previous Weekly Peak Power in kW
410513	Previous Monthly Peak Power	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: kW Lower Limit: -100000 Upper Limit: 100000 Default/Initial: 0	Previous Monthly Peak Power in kW
410515	Total S2 Failures	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: U Units: Lower Limit: 0 Upper Limit: 4.29E+09 Default/Initial: 0	Total number of source 2 failures detected by the controller
410517	Total S1 Failures	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: U Units: Lower Limit: 0 Upper Limit: 4.29E+09 Default/Initial: 0	Total number of source 1 failures detected by the controller
410519	Monthly Peak Power	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: kW Lower Limit: -100000 Upper Limit: 100000 Default/Initial: 0	Monthly Peak Power in kW

Addr.	System Name	Access	Specifications	System Description
410521	Application Device Type	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 16 Sign: U Units: Lower Limit: 0 Upper Limit: 65535 Default/Initial: 0	Unique identifier for this device.
410522	Application Software Version	Read Only	Multiplier: 0.001 Offset: 0 Size (Bits): 32 Sign: U Units: Lower Limit: 0 Upper Limit: 4294967 Default/Initial: 0	The version of the software running in the device.
410524	Reset Event All Categories	Operator	Multiplier: 1 Offset: 0 Size (Bits): 8 Sign: U Units: Lower Limit: 0 Upper Limit: 1 Default/Initial: 0	When this parameter is set to True Event Handler shall reset events of all categories.
410525	Common Alarm Status	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 8 Sign: U Units: Lower Limit: 0 Upper Limit: 1 Default/Initial: 0	Indicates status of the Common Alarm variable
410526	Load add shed contact 1 connected	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 8 Sign: U Units: Lower Limit: 0 Upper Limit: 1 Default/Initial: 0	Load1 Add/Shed command status: 0=shed, 1=add.

Addr.	System Name	Access	Specifications	System Description
410527	Load add shed contact 3 connected	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 8 Sign: U Units: Lower Limit: 0 Upper Limit: 1 Default/Initial: 0	Load3 Add/Shed command status: 0=shed, 1=add.
410528	Load add shed contact 2 connected	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 8 Sign: U Units: Lower Limit: 0 Upper Limit: 1 Default/Initial: 0	Load2 Add/Shed command status: 0=shed, 1=add.
410529	Load add shed contact 4 connected	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 8 Sign: U Units: Lower Limit: 0 Upper Limit: 1 Default/Initial: 0	Load4 Add/Shed command status: 0=shed, 1=add.
410530	Retransfer Count	Factory	Multiplier: 1 Offset: 0 Size (Bits): 16 Sign: U Units: Lower Limit: 0 Upper Limit: 65535 Default/Initial: 0	Number of times the system has re-transferred from standby to preferred source.
410531	Transfer Count	Factory	Multiplier: 1 Offset: 0 Size (Bits): 16 Sign: U Units: Lower Limit: 0 Upper Limit: 65535 Default/Initial: 0	Number of times the system has transferred from preferred to standby source.

Addr.	System Name	Access	Specifications	System Description
410532	S1 Type	Operator	Multiplier: 1 Offset: 0 Size (Bits): 8 Sign: U Units: Lower Limit: 0 Upper Limit: 1 Default/Initial: 0	Configuration indicating the type of source 1 is an utility or a generator set. In case this source location is upstream select the source type to match the sources connected to the upstream ATS. Assuming both upstream sources are of the same type.
410533	S2 Type	Operator	Multiplier: 1 Offset: 0 Size (Bits): 8 Sign: U Units: Lower Limit: 0 Upper Limit: 1 Default/Initial: 1	Configuration indicating the type of source 2 is an utility or a generator set. In case this source location is upstream select the source type to match the sources connected to the upstream ATS. Assuming both upstream sources are of the same type.
410534	S1 Preferred Standby State	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 8 Sign: U Units: Lower Limit: 0 Upper Limit: 2 Default/Initial: 0	Current effective priority state of source 1.
410535	Time Until Automatic Source Priority Changeover	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: U Units: sec Lower Limit: 0 Upper Limit: 4.29E+09 Default/Initial: 0	Time remaining until automatic source priority changeover takes effect.

Addr.	System Name	Access	Specifications	System Description
410537	S2 Preferred Standby State	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 8 Sign: U Units: Lower Limit: 0 Upper Limit: 2 Default/Initial: 0	Current effective priority state of source 2.
410538	ATS Serial Number	Technician	Multiplier: 1 Offset: 0 Size (Bits): 168 Sign: NA Units: Lower Limit: 1E+10 Upper Limit: 123456789 Default/Initial: 0	Serial Number for the ATS
410548	ATS Model Number	Technician	Multiplier: 1 Offset: 0 Size (Bits): 168 Sign: NA Units: Lower Limit: 0 Upper Limit: 1E+10 Default/Initial: CTPC80	Contains the model number of the ATS
410558	ATS Name Tag	Technician	Multiplier: 1 Offset: 0 Size (Bits): 168 Sign: NA Units: Lower Limit: 0 Upper Limit: 1E+10 Default/Initial: ATS Name	Installation specific name
410568	Network Test Request Boolean	Operator	Multiplier: 1 Offset: 0 Size (Bits): 8 Sign: U Units: Lower Limit: 0 Upper Limit: 1 Default/Initial: 1	A network test request with ON/OFF options

Addr.	System Name	Access	Specifications	System Description
410569	Network Test Request	Operator	Multiplier: 1 Offset: 0 Size (Bits): 8 Sign: U Units: Lower Limit: 0 Upper Limit: 5 Default/Initial: 4	Test request from network source.
410570	Save Trims	Operator	Multiplier: 1 Offset: 0 Size (Bits): 8 Sign: U Units: Lower Limit: 0 Upper Limit: 1 Default/Initial: 0	Setting this parameter to True will trigger a save of all non-volatile trims on the entire device.
410571	NFPA110 Status	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 16 Sign: U Units: Lower Limit: 0 Upper Limit: 65535 Default/Initial: 0	Use to broadcast NFPA110 status on Modbus
410572	NFPA110 Extended Status	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 16 Sign: U Units: Lower Limit: 0 Upper Limit: 65535 Default/Initial: 0	Use to broadcast NFPA110 extended status on Modbus
410573	Broadcast Fault Code	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 16 Sign: U Units: Lower Limit: 0 Upper Limit: 65535 Default/Initial: 0	Use to broadcast the event code over Modbus

Addr.	System Name	Access	Specifications	System Description
410574	Broadcast FC Level	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 8 Sign: U Units: Lower Limit: 0 Upper Limit: 255 Default/Initial: 0	Used to broadcast FC level over Modbus
410575	Load L1-N RMS Voltage	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: V Lower Limit: 0 Upper Limit: 45000 Default/Initial: 0	RMS Voltage between Line 1 and the Neutral on the Load side
410577	Load L2-N RMS Voltage	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: V Lower Limit: 0 Upper Limit: 45000 Default/Initial: 0	RMS Voltage between Line 2 and the Neutral on the Load side.
410579	Load L3-N RMS Voltage	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: V Lower Limit: 0 Upper Limit: 45000 Default/Initial: 0	RMS Voltage between Line 3 and the Neutral on the Load side
410581	Load L1-L2 RMS Voltage	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: V Lower Limit: 0 Upper Limit: 45000 Default/Initial: 0	RMS Voltage between Line 1 and Line 2 on the Load side

Addr.	System Name	Access	Specifications	System Description
410583	Load L2-L3 RMS Voltage	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: V Lower Limit: 0 Upper Limit: 45000 Default/Initial: 0	RMS Voltage between Line 2 and Line 3 on the Load side
410585	Load L3-L1 RMS Voltage	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: V Lower Limit: 0 Upper Limit: 45000 Default/Initial: 0	RMS Voltage between Line 3 and Line 1 on the Load side
410587	Load L1 RMS Current	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: A Lower Limit: 0 Upper Limit: 10000 Default/Initial: 0	RMS current present in line 1 on the load side
410589	Load L2 RMS Current	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: A Lower Limit: 0 Upper Limit: 10000 Default/Initial: 0	RMS current present in line 2 on the load side
410591	Load L3 RMS Current	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: A Lower Limit: 0 Upper Limit: 10000 Default/Initial: 0	RMS Current present in Line 3 on the load side.

Addr.	System Name	Access	Specifications	System Description
410593	Load Average Power Factor	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: Lower Limit: -1 Upper Limit: 1 Default/Initial: 0	3 phase averaged ratio of Watts to Volt-Amperes on the load side
410595	Load LN RMS Current	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: A Lower Limit: 0 Upper Limit: 10000 Default/Initial: 0	RMS Current present in the neutral on the load side.
410597	ATS HMI Banner 1 Text	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 8 Sign: U Units: Lower Limit: 0 Upper Limit: 38 Default/Initial: 0	0
410598	ATS HMI Banner 2 Text	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 8 Sign: U Units: Lower Limit: 0 Upper Limit: 38 Default/Initial: 0	0
410599	ATS HMI Banner 1 Time	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: sec Lower Limit: 0 Upper Limit: 3.4E+38 Default/Initial: 0	0

Addr.	System Name	Access	Specifications	System Description
410601	ATS HMI Banner 2 Time	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: sec Lower Limit: 0 Upper Limit: 3.4E+38 Default/Initial: 0	0
410605	Load Total kW	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: kW Lower Limit: -100000 Upper Limit: 100000 Default/Initial: 0	Total kW provided to load.
410609	Load Total kVAR	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: kVAR Lower Limit: -100000 Upper Limit: 100000 Default/Initial: 0	Total kVAR provided to load
410613	Load Total kVA	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: kVA Lower Limit: -100000 Upper Limit: 100000 Default/Initial: 0	Total kVAR provided to Load.
410615	Load Frequency	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: S Units: Hz Lower Limit: 0 Upper Limit: 100 Default/Initial: 0	Load Frequency

Addr.	System Name	Access	Specifications	System Description
410617	Local Override Request Access	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 8 Sign: U Units: Lower Limit: 0 Upper Limit: 1 Default/Initial: 0	Setting this parameter to True/On (1) requests to override timers and inhibits same as if initiated from HMI front panel Override button. This value will self clear back to False/Off (0). Note: Uses the Off On Enumeration Type. Register is used for PC80 V1.013 only.

13.2.2 PC80 Modbus Enumerated Data

Enumeration Type	Field
System_Phase_Rotation	0: L1 L2 L3 1: L1 L3 L2
BooleanEnum	0: IsFalse 1: IsTrue
Off On	0: Off 1: On
Source Type	0: Utility 1: Genset
Source Priority State	0: UNDETERMINED 1: PREFERRED 2: STANDBY
Test Request Full	0: Test Without Load 1: Test With Load 2: Transfer to Standby 3: Extended Parallel 4: Not in Test 5: Test Button

Enumeration Type	Field
Banner Text	0: Banner Inactive 1: Transfer Timer 2: Retransfer Timer 3: Programmed Transition 4: S2 Engine Start 5: S2 Engine Cooldown 6: S1 Engine Start 7: S1 Engine Cooldown 8: Elevator Pre 9: Elevator Post 10: Automatic Changeover 11: Dual Standby Start Inhibit Active 12: Transfer Inhibit Active 13: Retransfer Inhibit Active 14: Local Test Without Load Active 15: Local Test With Load Active 16: Local Transfer to Standby Active 17: Local Extended Parallel Active 18: Remote Test Without Load Active 19: Remote Test With Load Active 20: Remote Transfer to Standby Active 21: Remote Extended Parallel Active 22: Network Test Without Load Active 23: Network Test With Load Active 24: Network Transfer to Standby Active 25: Network Extended Parallel Active 26: Exercise Without Load Active 27: Exercise With Load Active 28: Exercise Transfer to Standby Active 29: Exercise Extended Parallel Active 30: Exercise Exception Active 31: Local Bypass Test Active 32: Remote Bypass Test Active 33: Network Bypass Test Active 34: Bypass Test Step Timer 35: ATS in Connected Position 36: ATS in Test Position 37: ATS in Isolated Position 38: Load Shed Request Active

14 PCC 1301/PowerCommand 1.x/PS0500 Modbus Register Map

The controller contains data that can be read by a master device communicating via Modbus RTU protocol on a two-wire RS485 multi-drop bus. The Cummins control is a slave unit.

For more information about the Modbus protocol, refer to *Modbus Application Protocol V1.1b3* and *Modbus Serial Line Implementation Guide V1.02*, which are both available at www.modbus.org.

TABLE 51. RS485 PINS

	PCC 1301	PS0500/PowerCommand 1.x
A (+)	TB2-3	TB15-3
B (-)	TB2-4	TB15-4
Common	TB2-1	TB15-1

NOTICE

Earlier versions of this software may not support all of the Modbus registers in the table below. If a particular register is not available in your installation, it is possible that the Modbus connection is working but the controller software does not support that particular register.

NOTICE

For the PS0500 control, Modbus functionality is **ONLY** available from software version 6.02 and later.

NOTICE

If an address or bit is not listed in the table below, it has not been implemented.

NOTICE

The master device can read 1-16 contiguous registers, write 1-16 contiguous registers, or read diagnostic counters.

TABLE 52. PCC 1301/POWERCOMMAND 1.X/PS0500 MODBUS REGISTER MAP

Addr.	Parameter	Access	Specifications	Description	Control
40004	Save Trims	Read and Write	0: No action 1: Save Unconditional	Save configuration parameters or adjustments to non-volatile memory; perform Save Trims after all configurations have been updated; do not save trims unless a change has occurred	PC1.x, PS0500, PCC1301

Addr.	Parameter	Access	Specifications	Description	Control
40009	Controller Type	Read Only	Multiplier: 1 Size(Bits): 8 Sign: U Lower Limit: 0 Upper Limit: 255	Device type of controller	PC1.x, PS0500, PCC1301
40010	Operation Mode Switch Position	Read Only	0: Off 1: Auto 2: Manual	Current position of the generator set switch panel Off-Run-Auto switch as seen by the generator set control	PC1.x, PS0500, PCC1301
40011	Genset State	Read Only	0: Ready 1: Precrank 2: Ramp 3: Running	This parameter reflects the current state of the generator set.	PC1.x, PS0500, PCC1301
40012	Active Fault	Read Only	Multiplier: 1 Offset: 0 Size(Bits) 16 Sign: U Units: NA Lower Limit: 0 Upper Limit: 65535 Default: 0	This register contains the fault code number of the currently active fault. See the service manual for a list of supported fault codes.	PC1.x, PS0500, PCC1301
40013	Active Fault Type	Read Only	0: Normal 1: Warning 4: Shutdown	This register contains the fault type of the currently active fault.	PC1.x, PS0500, PCC1301
40016	NFPA 110 fault register	Read Only	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units: NA Lower Limit: NA Upper Limit: NA Default: NA	16 bit number to represent the status of the NFPA110 logical; see Table 3 on page 11	PC1.x, PS0500, PCC1301
40017	Extended Annunciation fault register	Read Only	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units: NA Lower Limit: NA Upper Limit: NA Default: NA	16 bit number to represent the status of the NFPA110 logical; see Table 3 on page 11	PC1.x, PS0500, PCC1301

Addr.	Parameter	Access	Specifications	Description	Control
40018	Alternator L1-N Voltage	Read Only	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units: Vac Lower Limit: 0 Upper Limit: 65535 Default: NA	Generator set L1-N voltage	PC1.x, PS0500, PCC1301
40019	Alternator L2-N Voltage	Read Only	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units: Vac Lower Limit: 0 Upper Limit: 65535 Default: NA	Generator set L2-N voltage	PC1.x, PS0500, PCC1301
40020	Alternator L3-N Voltage	Read Only	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units: Vac Lower Limit: 0 Upper Limit: 65535 Default: NA	Generator set L3-N voltage	PC1.x, PS0500, PCC1301
40022	Alternator L1-L2 Voltage	Read Only	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units: Vac Lower Limit: 0 Upper Limit: 65535 Default: NA	Generator set L1-L2 voltage	PC1.x, PS0500, PCC1301
40023	Alternator L2-L3 Voltage	Read Only	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units: Vac Lower Limit: 0 Upper Limit: 65535 Default: NA	Generator set L2-L2 voltage	PC1.x, PS0500, PCC1301

Addr.	Parameter	Access	Specifications	Description	Control
40024	Alternator L3-L1 Voltage	Read Only	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units: Vac Lower Limit: 0 Upper Limit: 65535 Default: NA	Generator set L3-L1 voltage	PC1.x, PS0500, PCC1301
40025	Alt Voltage	Read Only	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units: Vac Lower Limit: 0 Upper Limit: 65535 Default: NA	Generator set line to line average voltage	PC1.x, PS0500, PCC1301
40026	Alternator L1 Current	Read Only	Multiplier: 0.1 Offset: 0 Size(Bits): 16 Sign: U Units: amps Lower Limit: 0 Upper Limit: 65535 Default: NA	Monitors the generator set L1 current value	PC1.x, PS0500, PCC1301
40027	Alternator L2 Current	Read Only	Multiplier: 0.1 Offset: 0 Size(Bits): 16 Sign: U Units: amps Lower Limit: 0 Upper Limit: 65535 Default: NA	Monitors the generator set L2 current value	PC1.x, PS0500, PCC1301
40028	Alternator L3 Current	Read Only	Multiplier: 0.1 Offset: 0 Size(Bits): 16 Sign: U Units: amps Lower Limit: 0 Upper Limit: 65535 Default: NA	Monitors the generator set L3 current value	PC1.x, PS0500, PCC1301

Addr.	Parameter	Access	Specifications	Description	Control
40029	Genset Average Current	Read Only	Multiplier: 0.1 Offset: 0 Size(Bits): 16 Sign: U Units: amps Lower Limit: 0 Upper Limit: 65535 Default: NA	Generator set average current	PC1.x, PS0500, PCC1301
40040	Alternator Output Volt-Amperes (Phase A)	Read Only	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units: kVa Lower Limit: 0 Upper Limit: 65535 Default: NA	Alternator output volt-amperes (Phase A)	PC1.x, PS0500, PCC1301
40041	Alternator Output Volt-Amperes (Phase B)	Read Only	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units: kVa Lower Limit: 0 Upper Limit: 65535 Default: NA	Alternator output volt-amperes (Phase B)	PC1.x, PS0500, PCC1301
40042	Alternator Output Volt-Amperes (Phase C)	Read Only	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units: kVa Lower Limit: 0 Upper Limit: 65535 Default: NA	Alternator output volt-amperes (Phase C)	PC1.x, PS0500, PCC1301
40043	Alternator Output Volt-Amperes (Total)	Read Only	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units: kVa Lower Limit: 0 Upper Limit: 65535 Default: NA	Alternator output volt-amperes (total)	PC1.x, PS0500, PCC1301

Addr.	Parameter	Access	Specifications	Description	Control
40044	Average Alt Line Frequency	Read Only	Multiplier: 0.1 Offset: 0 Size(Bits): 16 Sign: U Units: % Lower Limit: 0 Upper Limit: 65535 Default: NA	Average alternator line frequency	PC1.x, PS0500, PCC1301
40058	Rated Alternator L1 Current (%)	Read Only	Multiplier: 0.1 Offset: 0 Size(Bits): 16 Sign: U Units: % Lower Limit: 0 Upper Limit: 65535 Default: NA	Monitors the generator set standby L1 current percentage output	PC1.x, PS0500, PCC1301
40059	Rated Alternator L2 Current (%)	Read Only	Multiplier: 0.1 Offset: 0 Size(Bits): 16 Sign: U Units: % Lower Limit: 0 Upper Limit: 65535 Default: NA	Monitors the generator set standby L2 current percentage output	PC1.x, PS0500, PCC1301
40060	Rated Alternator L3 Current (%)	Read Only	Multiplier: 0.1 Offset: 0 Size(Bits): 16 Sign: U Units: % Lower Limit: 0 Upper Limit: 65535 Default: NA	Monitors the generator set standby L3 current percentage output	PC1.x, PS0500, PCC1301
40061	Battery Voltage	Read Only	Multiplier: 0.1 Offset: 0 Size(Bits): 16 Sign: U Units: Vdc Lower Limit: 0 Upper Limit: 65535 Default: NA	Value of battery voltage	PC1.x, PS0500, PCC1301

Addr.	Parameter	Access	Specifications	Description	Control
40062	Oil Pressure	Read Only	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units: kPa Lower Limit: 0 Upper Limit: 65535 Default: NA	Monitor point for oil pressure	PC1.x, PS0500, PCC1301
40064	Coolant Temperature	Read Only	Multiplier: 0.1 Offset: 0 Size(Bits): 16 Sign: U Units: degc Lower Limit: 0 Upper Limit: 65535 Default: NA	Monitor point for coolant temperature	PC1.x, PS0500, PCC1301
40068	Engine Speed	Read Only	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units: Rpm Lower Limit: 0 Upper Limit: 65535 Default: NA	Monitor point for average engine speed	PC1.x, PS0500, PCC1301
40069	Total Runs	Read Only	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units: NA Lower Limit: 0 Upper Limit: 65535 Default: 0	Parameter reflects total number of starts	PC1.x, PS0500, PCC1301
40070	Engine Run Time (High Byte)	Read Only	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units: Sec Lower Limit: 0 Upper Limit: 65535 Default: NA	Total engine run time	PC1.x, PS0500, PCC1301

Addr.	Parameter	Access	Specifications	Description	Control
40071	Engine Run Time (Low Byte)	Read Only	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units: Sec Lower Limit: 0 Upper Limit: 65535 Default: NA	Total engine run time	PC1.x, PS0500, PCC1301
40210	AUX101 Speed Bias	Read Only	Multiplier: 0.01 Offset: 0 Size(Bits): 16 Sign: S Units: RPM Lower Limit: -100 Upper Limit: 100 Default: NA	AUX101 speed bias	PCC1301
40211	AUX101 Voltage Bias	Read Only	Multiplier: 0.01 Offset: 0 Size(Bits): 16 Sign: S Units: Volt Lower Limit: -100 Upper Limit: 100 Default: NA	AUX101 Voltage bias	PCC1301
40229	Barometric Absolute Pressure	Read Only	Multiplier : 0.1 Offset: 0 Size (Bits) : 16 Sign: U Units: PSI Lower Limit: 0 Upper Limit: 19 Default: NA	Monitor point for the barometric absolute pressure	PC 1.x
40242	LTA Temperature	Read Only	Multiplier : 1 Offset: 0 Size (Bits) : 16 Sign: S Units: degF Lower Limit: NA Upper Limit: NA Default: NA	The processed value of the LTA temperature sensor for the system IO module	PC 1.x
40254	Fuel Pressure Valid	Read Only	0. Invalid 1. Valid	Indicates if the fuel pressure is valid/invalid from the AUX101 or ECM datalink	PC 1.x

Addr.	Parameter	Access	Specifications	Description	Control
40278	Configurable Input #4 Status	Read Only	0: Inactive 1: Active	Measured state of hardware input	PC 1.x
40300	Genset start stop control via Modbus	Read and Write	0: Stop 1: Start	Remote start via Modbus	PC1.x, PS0500, PCC1301
40301	Fault reset via Modbus (No logical)	Read and Write	0: Inactive 1: Active	Fault reset	PC1.x, PCC1301, PS0500
40302	Genset E-stop switch via Modbus (no logical)	Read and Write	0: E-stop Inactive 1: E-stop Active	Status of E-stop switch	PC1.x, PCC1301, PS0500
40400	Fault status Bitmap 1	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 16 Sign: U Unit: NA Lower Limit: 0 Upper Limit: 65535	16bit diesel Fault Bitmap for modbus interface- Shutdown Faults	PS0500
40401	Fault status Bitmap 2	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 16 Sign: U Unit: NA Lower Limit: 0 Upper Limit: 65535	16bit diesel Fault Bitmap for modbus interface- Shutdown Faults	PS0500
40402	Fault status Bitmap 3	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 16 Sign: U Unit: NA Lower Limit: 0 Upper Limit: 65535	16bit diesel Fault Bitmap for modbus interface- Shutdown Faults	PS0500
40403	Fault status Bitmap 4	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 16 Sign: U Unit: NA Lower Limit: 0 Upper Limit: 65535	16bit diesel Fault Bitmap for modbus interface- Shutdown Faults	PS0500

Addr.	Parameter	Access	Specifications	Description	Control
40404	Fault status Bitmap 5	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 16 Sign: U Unit: NA Lower Limit: 0 Upper Limit: 65535	16bit diesel Fault Bitmap for modbus interface- Shutdown Faults	PS0500
40405	Fault status Bitmap 6	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 16 Sign: U Unit: NA Lower Limit: 0 Upper Limit: 65535	16bit diesel Fault Bitmap for modbus interface- Shutdown Faults	PS0500
40406	Fault status Bitmap 7	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 16 Sign: U Unit: NA Lower Limit: 0 Upper Limit: 65535	16bit diesel Fault Bitmap for modbus interface- Shutdown Faults	PS0500
40407	Fault status Bitmap 8	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 16 Sign: U Unit: NA Lower Limit: 0 Upper Limit: 65535	16bit diesel Fault Bitmap for modbus interface- Shutdown Faults	PS0500
40408	Fault status Bitmap 9	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 16 Sign: U Unit: NA Lower Limit: 0 Upper Limit: 65535	16bits diesel Fault Bitmap for modbus interface- Shutdown Faults	PS0500
40409	Fault status Bitmap 10	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 16 Sign: U Unit: NA Lower Limit: 0 Upper Limit: 65535	16bits diesel Fault Bitmap for modbus interface- Shutdown Faults	PS0500

Addr.	Parameter	Access	Specifications	Description	Control
40410	Fault status Bitmap 11	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 16 Sign: U Unit: NA Lower Limit: 0 Upper Limit: 65535	16bits diesel Fault Bitmap for modbus interface- Warning Faults	PS0500
40411	Fault status Bitmap 12	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 16 Sign: U Unit: NA Lower Limit: 0 Upper Limit: 65535	16bits diesel Fault Bitmap for modbus interface- Warning Faults	PS0500
40412	Fault status Bitmap 13	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 16 Sign: U Unit: NA Lower Limit: 0 Upper Limit: 65535	16bits diesel Fault Bitmap for modbus interface- Warning Faults	PS0500
40413	Fault status Bitmap 14	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 16 Sign: U Unit: NA Lower Limit: 0 Upper Limit: 65535	16bits diesel Fault Bitmap for modbus interface- Warning Faults	PS0500
40414	Fault status Bitmap 15	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 16 Sign: U Unit: NA Lower Limit: 0 Upper Limit: 65535	16bits diesel Fault Bitmap for modbus interface- Warning Faults	PS0500
40415	Fault status Bitmap 16	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 16 Sign: U Unit: NA Lower Limit: 0 Upper Limit: 65535	16bits diesel Fault Bitmap for modbus interface- Warning Faults	PS0500

Addr.	Parameter	Access	Specifications	Description	Control
40416	Fault status Bitmap 17	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 16 Sign: U Unit: NA Lower Limit: 0 Upper Limit: 65535	16bits diesel Fault Bitmap for modbus interface- Warning Faults	PS0500
40417	Fault status Bitmap 18	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 16 Sign: U Unit: NA Lower Limit: 0 Upper Limit: 65535	16bits diesel Fault Bitmap for modbus interface- Warning Faults	PS0500
40418	Fault status Bitmap 19	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 16 Sign: U Unit: NA Lower Limit: 0 Upper Limit: 65535	16bits diesel Fault Bitmap for modbus interface- Warning Faults	PS0500
40419	Fault status Bitmap 20	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 16 Sign: U Unit: NA Lower Limit: 0 Upper Limit: 65535	16bits diesel Fault Bitmap for modbus interface- Warning Faults	PS0500
40420	Fault status Bitmap 21	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 16 Sign: U Unit: NA Lower Limit: 0 Upper Limit: 65535	16bits diesel Fault Bitmap for modbus interface- Configurable Input Faults	PS0500
40421	Fault status Bitmap 22	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 16 Sign: U Unit: NA Lower Limit: 0 Upper Limit: 65535	16bits diesel Fault Bitmap for modbus interface- Configurable Input Faults	PS0500

Addr.	Parameter	Access	Specifications	Description	Control
40425	Event status Bitmap 2	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 16 Sign: U Unit: NA Lower Limit: 0 Upper Limit: 65535	16bits diesel Fault Bitmap for modbus interface- Events	PS0500
40426	Event status Bitmap 3	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 16 Sign: U Unit: NA Lower Limit: 0 Upper Limit: 65535	16bits diesel Fault Bitmap for modbus interface- Events	PS0500
40430	Event status Bitmap 1	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 16 Sign: U Unit: NA Lower Limit: 0 Upper Limit: 65535	16bits diesel Fault Bitmap for modbus interface- Events	PS0500
40535	Customer Output 1 Event	Read Only	0. Inactive 1. Active	Output of Customer Output 1 Event command	PC 1.x
40536	Customer Output 2 Event	Read Only	0. Inactive 1. Active	Output of Customer Output 2 Event command	PC 1.x
40583	Dead Battery Prevention Counter	Read Only	Multiplier : 1 Offset: 0 Size (Bits) : 8 Sign: U Units: NA Lower Limit: NA Upper Limit: NA Default: NA	Tracks the number of crank attempts in order to limit the attempts when the battery is so low that the control resets	PC 1.x
40587	Exercise Scheduler Status	Read Only	0. Inactive 1. Active	Displays the status of the Exercise Scheduler	PC 1.x

Addr.	Parameter	Access	Specifications	Description	Control
43000	Alternator Nominal Voltage	Read and Write	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units: Vac Lower Limit: 190 Upper Limit: 600 Default: 208	This register represents alternator nominal voltage.	PC1.x, PS0500, PCC1301
43001	Alternator Frequency Switch	Read and Write	0: 60 Hz 1: 50 Hz	Set to 50 Hz or 60 Hz	PC1.x, PS0500, PCC1301
43002	Single/3 Phase Connection	Read and Write	0: Single Phase 1: Three Phase	Generator output connection type	PC1.x
43003	Connection Type	Read and Write	0: Delta 1: Wye	Alternator connection type	PC1.x, PS0500, PCC1301
43004	Glow Plug Enable	Read and Write	0: Disable 1: Enable	Glow plug driver feature enable	PC1.x, PS0500, PCC1301
43005	Charging Alternator Functions Disable	Read and Write	0: Disable 1: Enable	Used to disable the controller related charging alt functions	PC1.x, PS0500, PCC1301
43006	Start Time Delay	Read and Write	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units: Sec Lower Limit: 0 Upper Limit: 300 Default: 0	Remote start time delay setting	PC1.x, PS0500, PCC1301
43007	Stop Time Delay	Read and Write	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units: Sec Lower Limit: 0 Upper Limit: 600 Default: 0	Remote stop time delay setting	PC1.x, PS0500, PCC1301

Addr.	Parameter	Access	Specifications	Description	Control
43008	Cycle Crank Attempts	Read and Write	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units: NA Lower Limit: 1 Upper Limit: 7 Default: 3	Maximum number of start attempts for cycle crank mode	PC1.x, PS0500, PCC1301
43009	Cycle Crank Engage Time	Read and Write	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units: sec Lower Limit: 3 Upper Limit: 30 Default: 15	Maximum starter engage time for cycle crank mode	PC1.x, PS0500, PCC1301
43010	Cycle Crank Reset Time	Read and Write	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units: sec Lower Limit: 0 Upper Limit: 60 Default: 30	Engine starting cycle crank attempts setting	PC1.x, PS0500, PCC1301
43011	Fault bypass (battle short) feature enable	Read and Write	0: Disable 1: Enable	Operator panel enable for Battle Short	PC1.x, PCC1301

Addr.	Parameter	Access	Specifications	Description	Control
43012	Battle Short Switch Input	Read and Write	0: None, 1: Configurable Input #1, 2: Configurable Input #2, 3: Configurable Input #3, 4: Configurable Input #4, 5: Operator Panel	Switch Input for Battle Short 0= None 1=Customer Input 1 2=Customer Input 2 3 =Customer Input 3 4 =Customer Input 4 5=Operator Panel PCC1301 Modbus mapping for parameters having different limits as compared to PC1.x and PS0500; see Table 53 on page 520 Note: For PC1.x SW versions less than 2.73, the "Battle Short Switch Input" range is 0 to 3. For PC1.x SW versions 2.73 and greater, the "Battle Short Switch Input" range is 0 to 5.	PC1.x
43013	AVR Enable	Read and Write	0: Disable 1: Enable	Automatic voltage regulation enable	PC1.x, PCC1301
43014	V/Hz Knee Frequency	Read and Write	Multiplier: 0.1 Offset: 0 Size(Bits): 16 Sign: S Units: Hz Lower Limit: 0 Upper Limit: 1000 Default: 500	Automatic voltage regulator volts per hertz roll off knee setting	PC1.x, PCC1301
43015	V/Hz Rolloff Slope	Read and Write	Multiplier: 0.1 Offset: 0 Size(Bits): 16 Sign: U Units: %v/Hz Lower Limit: 0 Upper Limit: 50 Default: 22	Automatic voltage regulator volts per hertz roll off slope setting	PC1.x, PCC1301
43016	AVR Gain Adjust	Read and Write	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units: % Lower Limit: 5 Upper Limit: 1000 Default: 100	Automatic voltage regulator gain setting	PC1.x, PCC1301

Addr.	Parameter	Access	Specifications	Description	Control
43017	AVR K2 Gain Adjust	Read and Write	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units: % Lower Limit: 5 Upper Limit: 1000 Default: 100	Automatic voltage regulator K2 gain setting	PC1.x, PCC1301
43018	AVR D Gain Adjust	Read and Write	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units: % Lower Limit: 95 Upper Limit: 105 Default: 100	Automatic voltage regulator K2 gain setting	PC1.x, PCC1301
43019	Electronic Governor Enable	Read and Write	0: Disable 1: Enable	Electronic governor enable feature	PC1.x, PCC1301
43020	Initial Crank Fueling Command	Read and Write	Multiplier: 0.1 Offset: 0 Size(Bits): 16 Sign: U Units: % Lower Limit: 0 Upper Limit: 999 Default: 250	Electronic governing initial duty cycle setting	PC1.x, PCC1301
43021	Initial Crank Fueling Period	Read and Write	Multiplier: 0.1 Offset: 0 Size(Bits): 8 Sign: U Units: % Lower Limit: 0 Upper Limit: 100 Default: 20	Time spent at Initial Crank Fueling command	PC1.x, PCC1301
43022	Crank Fueling Ramp Rate	Read and Write	Multiplier: 0.1 Offset: 0 Size(Bits): 16 Sign: U Units: %/sec Lower Limit: 50 Upper Limit: 1000 Default: 250	Electronic governing start ramp duty cycle setting	PC1.x, PCC1301

Addr.	Parameter	Access	Specifications	Description	Control
43023	Maximum Crank Fueling	Read and Write	Multiplier: 0.1 Offset: 0 Size(Bits): 16 Sign: U Units: % Lower Limit: 500 Upper Limit: 1000 Default: 1000	Electronic governing maximum duty cycle setting	PC1.x, PCC1301
43024	Governor Gain Adjust	Read and Write	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units: % Lower Limit: 5 Upper Limit: 1000 Default: 100	Electronic governing gain setting	PC1.x, PCC1301
43025	Gov K2 Gain Adjust	Read and Write	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units: % Lower Limit: 5 Upper Limit: 1000 Default: 100	Electronic governor K2 gain setting	PC1.x, PCC1301
43026	Gov D Gain Adjust	Read and Write	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units: % Lower Limit: 95 Upper Limit: 105 Default: 100	Electronic governor damping adjustment	PC1.x, PCC1301
43027	Crank Exit Fueling Command	Read and Write	Multiplier: 0.1 Offset: 0 Size(Bits): 16 Sign: U Units: % Lower Limit: 0 Upper Limit: 1000 Default: 250	Electronic governing crank exit fuel duty cycle setting	PC1.x, PCC1301

Addr.	Parameter	Access	Specifications	Description	Control
43028	Dither Factor	Read and Write	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units: % Lower Limit: 0 Upper Limit: 30 Default: 25	Electronic governing dither factor setting	PC1.x, PCC1301
43029	Governor Ramp Time	Read and Write	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units: sec Lower Limit: 0 Upper Limit: 15000 Default: 25	Electronic governing start ramp time setting	PC1.x, PCC1301
43030	Governor Enable Speed	Read and Write	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units: RPM Lower Limit: 0 Upper Limit: 1400 Default: 1100	Engine speed at which governor is enabled	PC1.x, PS0500, PCC1301
43031	Minimum Governor Duty Cycle	Read and Write	Multiplier: 1 Offset: 0 Size(Bits): 8 Sign: U Units: % Lower Limit: 0 Upper Limit: 100 Default: 20	Setting for electronic governor minimum duty cycle	PC1.x, PCC1301
43032	Maximum Governor Duty Cycle	Read and Write	Multiplier: 1 Offset: 0 Size(Bits): 8 Sign: U Units: % Lower Limit: 0 Upper Limit: 100 Default: 95	Setting for electronic governor maximum duty cycle	PC1.x, PCC1301

Addr.	Parameter	Access	Specifications	Description	Control
43033	Model number character #1	Read and Write	Multiplier: 1 Offset: 0 Size(Bits): 8 Sign: Char Units: NA Lower Limit: 0 Upper Limit: 255 Default: NA	Byte 1 for model number	PC1.x, PS0500, PCC1301
43034	Model number character #2	Read and Write	Multiplier: 1 Offset: 0 Size(Bits): 8 Sign: Char Units: NA Lower Limit: 0 Upper Limit: 255 Default: NA	Byte 2 for model number	PC1.x, PS0500, PCC1301
43035	Model number character #3	Read and Write	Multiplier: 1 Offset: 0 Size(Bits): 8 Sign: Char Units: NA Lower Limit: 0 Upper Limit: 255 Default: NA	Byte 3 for model number	PC1.x, PS0500, PCC1301
43036	Model number character #4	Read and Write	Multiplier: 1 Offset: 0 Size(Bits): 8 Sign: Char Units: NA Lower Limit: 0 Upper Limit: 255 Default: NA	Byte 4 for model number	PC1.x, PS0500, PCC1301
43037	Model number character #5	Read and Write	Multiplier: 1 Offset: 0 Size(Bits): 8 Sign: Char Units: NA Lower Limit: 0 Upper Limit: 255 Default: NA	Byte 5 for model number	PC1.x, PS0500, PCC1301

Addr.	Parameter	Access	Specifications	Description	Control
43038	Model number character #6	Read and Write	Multiplier: 1 Offset: 0 Size(Bits): 8 Sign: Char Units: NA Lower Limit: 0 Upper Limit: 255 Default: NA	Byte 6 for model number	PC1.x, PS0500, PCC1301
43039	Model number character #7	Read and Write	Multiplier: 1 Offset: 0 Size(Bits): 8 Sign: Char Units: NA Lower Limit: 0 Upper Limit: 255 Default: NA	Byte 7 for model number	PC1.x, PS0500, PCC1301
43040	Model number character #8	Read and Write	Multiplier: 1 Offset: 0 Size(Bits): 8 Sign: Char Units: NA Lower Limit: 0 Upper Limit: 255 Default: NA	Byte 8 for model number	PC1.x, PS0500, PCC1301
43041	Model number character #9	Read and Write	Multiplier: 1 Offset: 0 Size(Bits): 8 Sign: Char Units: NA Lower Limit: 0 Upper Limit: 255 Default: NA	Byte 9 for model number	PC1.x, PS0500, PCC1301
43042	Model number character #10	Read and Write	Multiplier: 1 Offset: 0 Size(Bits): 8 Sign: Char Units: NA Lower Limit: 0 Upper Limit: 255 Default: NA	Byte 10 for model number	PC1.x, PS0500, PCC1301

Addr.	Parameter	Access	Specifications	Description	Control
43043	Model number character #11	Read and Write	Multiplier: 1 Offset: 0 Size(Bits): 8 Sign: Char Units: NA Lower Limit: 0 Upper Limit: 255 Default: NA	Byte 11 for model number	PC1.x, PS0500, PCC1301
43044	Model number character #12	Read and Write	Multiplier: 1 Offset: 0 Size(Bits): 8 Sign: Char Units: NA Lower Limit: 0 Upper Limit: 255 Default: NA	Byte 12 for model number	PC1.x, PS0500, PCC1301
43045	Model number character #13	Read and Write	Multiplier: 1 Offset: 0 Size(Bits): 8 Sign: Char Units: NA Lower Limit: 0 Upper Limit: 255 Default: NA	Byte 13 for model number	PC1.x, PS0500, PCC1301
43046	Model number character #14	Read and Write	Multiplier: 1 Offset: 0 Size(Bits): 8 Sign: Char Units: NA Lower Limit: 0 Upper Limit: 255 Default: NA	Byte 14 for model number	PC1.x, PS0500, PCC1301
43047	Model number character #15	Read and Write	Multiplier: 1 Offset: 0 Size(Bits): 8 Sign: Char Units: NA Lower Limit: 0 Upper Limit: 255 Default: NA	Byte 15 for model number	PC1.x, PS0500, PCC1301

Addr.	Parameter	Access	Specifications	Description	Control
43048	Model number character #16	Read and Write	Multiplier: 1 Offset: 0 Size(Bits): 8 Sign: Char Units: NA Lower Limit: 0 Upper Limit: 255 Default: NA	Byte 16 for model number	PC1.x, PS0500, PCC1301
43049	Serial number character #1	Read and Write	Multiplier: 1 Offset: 0 Size(Bits): 8 Sign: Char Units: NA Lower Limit: 0 Upper Limit: 255 Default: NA	Byte 1 for serial number	PC1.x, PS0500, PCC1301
43050	Serial number character #2	Read and Write	Multiplier: 1 Offset: 0 Size(Bits): 8 Sign: Char Units: NA Lower Limit: 0 Upper Limit: 255 Default: NA	Byte 2 for serial number	PC1.x, PS0500, PCC1301
43051	Serial number character #3	Read and Write	Multiplier: 1 Offset: 0 Size(Bits): 8 Sign: Char Units: NA Lower Limit: 0 Upper Limit: 255 Default: NA	Byte 3 for serial number	PC1.x, PS0500, PCC1301
43052	Serial number character #4	Read and Write	Multiplier: 1 Offset: 0 Size(Bits): 8 Sign: Char Units: NA Lower Limit: 0 Upper Limit: 255 Default: NA	Byte 4 for serial number	PC1.x, PS0500, PCC1301

Addr.	Parameter	Access	Specifications	Description	Control
43053	Serial number character #5	Read and Write	Multiplier: 1 Offset: 0 Size(Bits): 8 Sign: Char Units: NA Lower Limit: 0 Upper Limit: 255 Default: NA	Byte 5 for serial number	PC1.x, PS0500, PCC1301
43054	Serial number character #6	Read and Write	Multiplier: 1 Offset: 0 Size(Bits): 8 Sign: Char Units: NA Lower Limit: 0 Upper Limit: 255 Default: NA	Byte 6 for serial number	PC1.x, PS0500, PCC1301
43055	Serial number character #7	Read and Write	Multiplier: 1 Offset: 0 Size(Bits): 8 Sign: Char Units: NA Lower Limit: 0 Upper Limit: 255 Default: NA	Byte 7 for serial number	PC1.x, PS0500, PCC1301
43056	Serial number character #8	Read and Write	Multiplier: 1 Offset: 0 Size(Bits): 8 Sign: Char Units: NA Lower Limit: 0 Upper Limit: 255 Default: NA	Byte 8 for serial number	PC1.x, PS0500, PCC1301
43057	Serial number character #9	Read and Write	Multiplier: 1 Offset: 0 Size(Bits): 8 Sign: Char Units: NA Lower Limit: 0 Upper Limit: 255 Default: NA	Byte 9 for serial number	PC1.x, PS0500, PCC1301

Addr.	Parameter	Access	Specifications	Description	Control
43058	Serial number character #10	Read and Write	Multiplier: 1 Offset: 0 Size(Bits): 8 Sign: Char Units: NA Lower Limit: 0 Upper Limit: 255 Default: NA	Byte 10 for serial number	PC1.x, PS0500, PCC1301
43059	Serial number character #11	Read and Write	Multiplier: 1 Offset: 0 Size(Bits): 8 Sign: Char Units: NA Lower Limit: 0 Upper Limit: 255 Default: NA	Byte 11 for serial number	PC1.x, PS0500, PCC1301
43060	Serial number character #12	Read and Write	Multiplier: 1 Offset: 0 Size(Bits): 8 Sign: Char Units: NA Lower Limit: 0 Upper Limit: 255 Default: NA	Byte 12 for serial number	PC1.x, PS0500, PCC1301
43061	Serial number character #13	Read and Write	Multiplier: 1 Offset: 0 Size(Bits): 8 Sign: Char Units: NA Lower Limit: 0 Upper Limit: 255 Default: NA	Byte 13 for serial number	PC1.x, PS0500, PCC1301
43062	Serial number character #14	Read and Write	Multiplier: 1 Offset: 0 Size(Bits): 8 Sign: Char Units: NA Lower Limit: 0 Upper Limit: 255 Default: NA	Byte 14 for serial number	PC1.x, PS0500, PCC1301

Addr.	Parameter	Access	Specifications	Description	Control
43063	Serial number character #15	Read and Write	Multiplier: 1 Offset: 0 Size(Bits): 8 Sign: Char Units: NA Lower Limit: 0 Upper Limit: 255 Default: NA	Byte 15 for serial number	PC1.x, PS0500, PCC1301
43064	Serial number character #16	Read and Write	Multiplier: 1 Offset: 0 Size(Bits): 8 Sign: Char Units: NA Lower Limit: 0 Upper Limit: 255 Default: NA	Byte 16 for serial number	PC1.x, PS0500, PCC1301
43065	Configurable Input #1 Fault Level Response	Read and Write	0: None 1: Warning 2: Shutdown	Configurable Input #1 Fault Level Response	PC1.x, PS0500, PCC1301
43066	Configurable Input #2 Fault Level Response	Read and Write	0: None 1: Warning 2: Shutdown	Configurable Input #2 Fault Level Response	PC1.x, PS0500, PCC1301
43067	Configurable Customer Output 1	Read and Write	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units: NA Lower Limit: 0 Upper Limit: 65535 Default: 1540	Configurable Customer Output 1; the default setting for FC 1540 which is a COMMON WARNING fault	PC1.x, PS0500, PCC1301
43068	Configurable Customer Output 2	Read and Write	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units: NA Lower Limit: 0 Upper Limit: 65535 Default: 1541	Configurable Customer Output 2; the default setting for FC 1541 which is a COMMON SHUTDOWN fault	PC1.x, PS0500, PCC1301

Addr.	Parameter	Access	Specifications	Description	Control
43069	Voltage Regulator Calibration 60Hz	Read and Write	Multiplier: 0.0001 Offset: 0 Size(Bits): 16 Sign: U Units: % Lower Limit: 9000 Upper Limit: 11000 Default: 10000	Make actual voltage match nominals 60 Hz when the set point = 100% PCC1301 Modbus mapping for parameters have different limits as compared to PC1.x; see Table 53 on page 520 .	PC1.x
43070	Voltage Regulator Calibration 50Hz	Read and Write	Multiplier: 0.0001 Offset: 0 Size(Bits): 16 Sign: U Units: % Lower Limit: 9000 Upper Limit: 11000 Default: 10000	Make actual voltage match nominals 50 Hz when the set point = 100% PCC1301 Modbus mapping for parameters have different limits as compared to PC1.x; see Table 53 on page 520 .	PC1.x
43071	Frequency Adjust Trim	Read and Write	Multiplier: 0.1 Offset: 0 Size(Bits): 16 Sign: S Units: Hz Lower Limit: -600 Upper Limit: 600 Default: 0		PC1.x, PCC1301
43072	Alternator L1-N 60Hz Voltage Display Adjust	Read and Write	Multiplier: 0.0001 Offset: 0 Size(Bits): 16 Sign: U Units: % Lower Limit: 9000* Upper Limit: 11000* Default: 10000	60 Hz line 1 to neutral metering voltage calibration PCC1301 Modbus mapping for parameters have different limits as compared to PC1.x and PS0500; see Table 53 on page 520 . *Note: For the PS0500 control, SW versions lower than 6.03, the range is 6000 to 14000. For the PS0500 control, SW versions higher than 6.03, the range is 9000 to 11000.	PC1.x, PS0500

Addr.	Parameter	Access	Specifications	Description	Control
43073	Alternator L2-N 60Hz Voltage Display Adjust	Read and Write	Multiplier: 0.0001 Offset: 0 Size(Bits): 16 Sign: U Units: % Lower Limit: 9000* Upper Limit: 11000* Default: 10000	60 Hz line 2 to neutral metering voltage calibration *Note: For the PS0500 control, SW versions lower than 6.03, the range is 6000 to 14000. For the PS0500 control, SW versions higher than 6.03, the range is 9000 to 11000.	PC1.x, PS0500
43074	Alternator L3-N 60Hz Voltage Display Adjust	Read and Write	Multiplier: 0.0001 Offset: 0 Size(Bits): 16 Sign: U Units: % Lower Limit: 9000* Upper Limit: 11000* Default: 10000	60 Hz line 3 to neutral metering voltage calibration *Note: For the PS0500 control, SW versions lower than 6.03, the range is 6000 to 14000. For the PS0500 control, SW versions higher than 6.03, the range is 9000 to 11000.	PC1.x, PS0500
43075	Alternator L1-N 50Hz Voltage Display Adjust	Read and Write	Multiplier: 0.0001 Offset: 0 Size(Bits): 16 Sign: U Units: % Lower Limit: 9000* Upper Limit: 11000* Default: 10000	50 Hz line 1 to neutral metering voltage calibration *Note: For the PS0500 control, SW versions lower than 6.03, the range is 6000 to 14000. For the PS0500 control, SW versions higher than 6.03, the range is 9000 to 11000.	PC1.x, PS0500
43076	Alternator L2-N 50Hz Voltage Display Adjust	Read and Write	Multiplier: 0.0001 Offset: 0 Size(Bits): 16 Sign: U Units: % Lower Limit: 9000* Upper Limit: 11000* Default: 10000	50 Hz line 2 to neutral metering voltage calibration *Note: For the PS0500 control, SW versions lower than 6.03, the range is 6000 to 14000. For the PS0500 control, SW versions higher than 6.03, the range is 9000 to 11000.	PC1.x, PS0500
43077	Alternator L3-N 50Hz Voltage Display Adjust	Read and Write	Multiplier: 0.0001 Offset: 0 Size(Bits): 16 Sign: U Units: % Lower Limit: 9000* Upper Limit: 11000* Default: 10000	50 Hz line 3 to neutral metering voltage calibration *Note: For the PS0500 control, SW versions lower than 6.03, the range is 6000 to 14000. For the PS0500 control, SW versions higher than 6.03, the range is 9000 to 11000.	PC1.x, PS0500

Addr.	Parameter	Access	Specifications	Description	Control
43078	Alternator L1 60Hz Current Adjust	Read and Write	Multiplier: 0.001 Offset: 0 Size(Bits): 16 Sign: U Units: % Lower Limit: 8000 Upper Limit: 12000* Default: 1000	60 Hz line 1 metering current calibration	PC1.x, PS0500, PCC1301
43079	Alternator L2 60Hz Current Adjust	Read and Write	Multiplier: 0.001 Offset: 0 Size(Bits): 16 Sign: U Units: % Lower Limit: 8000 Upper Limit: 12000* Default: 1000	60 Hz line 2 metering current calibration	PC1.x, PS0500, PCC1301
43080	Alternator L3 60Hz Current Adjust	Read and Write	Multiplier: 0.0001 Offset: 0 Size(Bits): 16 Sign: U Units: NA Lower Limit: .8 Upper Limit: 1.2 Default: 1	Adjust to make the displayed current match actual values in 50 Hz applications	PC1.x
43081	Alternator L1 50Hz Current Adjust	Read and Write	Multiplier: 0.001 Offset: 0 Size(Bits): 16 Sign: U Units: % Lower Limit: 8000 Upper Limit: 12000* Default: 1000	50 Hz line 1 metering current calibration	PC1.x, PS0500, PCC1301
43082	Alternator L2 50Hz Current Adjust	Read and Write	Multiplier: 0.001 Offset: 0 Size(Bits): 16 Sign: U Units: % Lower Limit: 8000 Upper Limit: 12000* Default: 1000	50 Hz line 2 metering current calibration	PC1.x, PS0500, PCC1301

Addr.	Parameter	Access	Specifications	Description	Control
43083	Alternator L3 50Hz Current Adjust	Read and Write	Multiplier: 0.001 Offset: 0 Size(Bits): 16 Sign: U Units: % Lower Limit: 8000 Upper Limit: 12000* Default: 1000	50 Hz line 3 metering current calibration	PC1.x, PS0500, PCC1301
43084	Annunciator #1 Switch Fault Response	Read and Write	0: None 1: Warning 2: Shutdown	Sets the generator set response to an active Annunciator #1 switch input	PC1.x, PCC1301
43085	Annunciator #2 Switch Fault Response	Read and Write	0: None 1: Warning 2: Shutdown	Sets the generator set response to an active Annunciator #2 switch input	PC1.x, PCC1301
43086	Annunciator #3 Switch Fault Response	Read and Write	0: None 1: Warning 2: Shutdown	Sets the generator set response to an active Annunciator #3 switch input	PC1.x, PCC1301
43087	Annunciator Output 1 Event	Read and Write	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units: NA Lower Limit: 0 Upper Limit: 65535 Default: 0	Annunciator configurable output #1 event code number	PC1.x, PCC1301
43088	Annunciator Output 2 Event	Read and Write	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units: NA Lower Limit: 0 Upper Limit: 65535 Default: 0	Annunciator configurable output #2 event code number	PC1.x, PCC1301
43089	Annunciator Output 3 Event	Read and Write	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units: NA Lower Limit: 0 Upper Limit: 65535 Default: 0	Annunciator configurable output #3 event code number	PC1.x, PCC1301

Addr.	Parameter	Access	Specifications	Description	Control
43090	Annunciator Output 4 Event	Read and Write	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units: NA Lower Limit: 0 Upper Limit: 65535 Default: 0	Annunciator configurable output #4 event code number	PC1.x, PCC1301
43344	Clock Date	Read Write	Multiplier : 1 Offset: 0 Size (Bits) : 8 Sign: U Units: NA Lower Limit: 1 Upper Limit: 31 Default: NA	Use to set or read the current date	PC 1.x
43345	Clock Hours	Read Write	Multiplier : 1 Offset: 0 Size (Bits) : 8 Sign: U Units: hours Lower Limit: 1 Upper Limit: 12 Default: 0	Use to set or read the current hour	PC 1.x
43346	Clock Minutes	Read Write	Multiplier : 1 Offset: 0 Size (Bits) : 8 Sign: U Units: minutes Lower Limit: 0 Upper Limit: 59 Default: 0	Use to set or read the current minute	PC 1.x
43347	Clock Mode	Read Write	0. NORMAL_MODE 1. SET_MODE 2. SAVE_CLOCK_MODE	Allows the user to go into Set Mode for Clock setup and in Clock Save Mode	PC 1.x
43348	Clock Month	Read Write	Multiplier : 1 Offset: 0 Size (Bits) : 8 Sign: U Units: NA Lower Limit: 1 Upper Limit: 12 Default: NA	Use to set or read the current month	PC 1.x

Addr.	Parameter	Access	Specifications	Description	Control
43349	Clock Seconds	Read Only	Multiplier : 1 Offset: 0 Size (Bits) : 8 Sign: U Units: seconds Lower Limit: NA Upper Limit: NA Default: 0	Use to set or read the current second	PC 1.x
43350	Clock Year	Read Write	Multiplier : 1 Offset: 0 Size (Bits) : 8 Sign: U Units: NA Lower Limit: 0 Upper Limit: 99 Default: NA	Use to set or read the current year	PC 1.x
43351	Daylight Savings End Hour	Read Write	Multiplier : 1 Offset: 0 Size (Bits) : 8 Sign: U Units: NA Lower Limit: 0 Upper Limit: 23 Default: 2	Use to set the hour of the day when Daylight Savings Time ends	PC 1.x
43352	Daylight Savings End Month	Read Write	Multiplier : 1 Offset: 0 Size (Bits) : 8 Sign: U Units: NA Lower Limit: 1 Upper Limit: 12 Default: 10	Use to set the month when Daylight Savings Time ends	PC 1.x
43353	Daylight Savings End Week Occ Month	Read Write	0. Default 1. FIRST_OCCURRENCE 2. SECOND_OCCURRENCE 3. THIRD_OCCURRENCE 4. FOURTH_OCCURRENCE 5. FIFTH_OCCURRENCE	Use to set the end week occurrence in a Daylight Savings Time end month	PC 1.x

Addr.	Parameter	Access	Specifications	Description	Control
43354	Daylight Savings Start Day	Read Write	0. Sunday 1. Monday 2. Tuesday 3. Wednesday 4. Thursday 5. Friday 6. Saturday	Use to set the day of the week when Daylight Savings Time starts	PC 1.x
43355	Daylight Savings Start Hour	Read Write	Multiplier : 1 Offset: 0 Size (Bits) : 8 Sign: U Units: NA Lower Limit: 0 Upper Limit: 23 Default: 2	Use to set the hour of the day when Daylight Savings Time starts	PC 1.x
43356	Daylight Savings Start Month	Read Write	Multiplier : 1 Offset: 0 Size (Bits) : 8 Sign: U Units: NA Lower Limit: 1 Upper Limit: 12 Default: 4	Use to set the month when Daylight Savings Time starts	PC 1.x
43357	Daylight Savings Start Week Occ Month	Read Write	0. Default 1. FIRST_OCCURRENCE 2. SECOND_OCCURRENCE 3. THIRD_OCCURRENCE 4. FOURTH_OCCURRENCE 5. FIFTH_OCCURRENCE	Use to set the week occurrence in a Daylight Savings Time start month	PC 1.x
43358	Daylight Savings Time Adjustment	Read Write	Multiplier : 1 Offset: 0 Size (Bits) : 8 Sign: U Units: minutes Lower Limit: 0 Upper Limit: 120 Default: 60	Use to set the amount of Daylight Savings Time adjustment applied	PC 1.x
43359	Daylight Savings Time Enable	Read Write	0. Disabled 1. Enabled	Use to enable the Daylight Savings Time feature	PC 1.x
43376	Scheduler Prog Duration (Mins)	Read Write	0. PCCNet Devices 1. Group for PCCNet device interface parameters	User to set Duration in Minutes for Exercise Scheduler	PC 1.x

Addr.	Parameter	Access	Specifications	Description	Control
43377	Scheduler Prog x Enable	Read Write	0. Disabled 1. Enabled	Trim - user to edit for running the Scheduler Exercise Program	PC 1.x
43378	Scheduler Prog Repeat Interval	Read Write	0. Weekly 1. Bi-Monthly 2. Monthly 3. Quarterly 4. Semi-Annual	User to select the Exercise Scheduler Interval	PC 1.x
43380	Scheduler Prog Start Day	Read Write	0. Sunday 1. Monday 2. Tuesday 3. Wednesday 4. Thursday 5. Friday 6. Saturday	User can set the Start Day of the week, month for Exercise Scheduler	PC 1.x
43381	Scheduler Prog Start Hour	Read Write	Multiplier : 1 Offset: 0 Size (Bits) : 8 Sign: U Units: NA Lower Limit: 1 Upper Limit: 12 Default: 2	User to set Start Hour for Exercise Scheduler	PC 1.x
43382	Scheduler Prog Start Minute	Read Write	Multiplier : 1 Offset: 0 Size (Bits) : 8 Sign: U Units: NA Lower Limit: 0 Upper Limit: 59 Default: 1	User to set Start Minute for Exercise Scheduler	PC 1.x
43383	Daylight Savings End Day	Read Write	0. Sunday 1. Monday 2. Tuesday 3. Wednesday 4. Thursday 5. Friday 6. Saturday	Use to set the day of the week when Daylight Savings Time ends	PC 1.x

Addr.	Parameter	Access	Specifications	Description	Control
43719	AUX101 Alternator Temp	Read Only	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units: NA Lower Limit: 0 Upper Limit: 65535 Default: 0	AUX101 input as Alternator Temp	PCC1301
43722	AUX101 Ambient Temp	Read Only	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units: NA Lower Limit: 0 Upper Limit: 65535 Default: 0	AUX101 input as Ambient Temp	PCC1301
43723	AUX101 input 1 Voltage	Read Only	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units: NA Lower Limit: 0 Upper Limit: 65535 Default: 0	AUX101 input 1 voltage	PCC1301
43724	AUX101 input 2 Voltage	Read Only	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units: NA Lower Limit: 0 Upper Limit: 65535 Default: 0	AUX101 input 2 voltage	PCC1301
43725	AUX101 input 3 Voltage	Read Only	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units: NA Lower Limit: 0 Upper Limit: 65535 Default: 0	AUX101 input 3 voltage	PCC1301

Addr.	Parameter	Access	Specifications	Description	Control
43726	AUX101 input 4 Voltage	Read Only	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units: NA Lower Limit: 0 Upper Limit: 65535 Default: 0	AUX101 input 4 voltage	PCC1301
43727	AUX101 input 5 Voltage	Read Only	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units: NA Lower Limit: 0 Upper Limit: 65535 Default: 0	AUX101 input 5 voltage	PCC1301
43728	AUX101 input 6 Voltage	Read Only	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units: NA Lower Limit: 0 Upper Limit: 65535 Default: 0	AUX101 input 6 voltage	PCC1301
43729	AUX101 input 67 Voltage	Read Only	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units: NA Lower Limit: 0 Upper Limit: 65535 Default: 0	AUX101 input 67voltage	PCC1301
43730	AUX101 input 8 Voltage	Read Only	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units: NA Lower Limit: 0 Upper Limit: 65535 Default: 0	AUX101 input 8 voltage	PCC1301

Addr.	Parameter	Access	Specifications	Description	Control
43741	AUX101 Exhaust Temp	Read Only	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units: NA Lower Limit: 0 Upper Limit: 65535 Default: 0	AUX101 input as Exhaust Temp	PCC1301
43745	AUX101 Fuel Level	Read Only	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units: NA Lower Limit: 0 Upper Limit: 65535 Default: 0	AUX101 input as Fuel Level	PCC1301
43750	AUX101 Intake Manifold Temp	Read Only	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units: NA Lower Limit: 0 Upper Limit: 65535 Default: 0	AUX101 input as Intake Manifold Temp	PCC1301
43757	AUX101 Oil Temp	Read Only	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units: NA Lower Limit: 0 Upper Limit: 65535 Default: 0	AUX101 input as Oil Temp	PCC1301
43793	Configurable Input #1 Status	Read Only	0. Inactive 1. Active	Measured state of hardware input	PC 1.x
43794	Configurable Input #2 Status	Read Only	0. Inactive 1. Active	Measured state of hardware input	PC 1.x
43795	Configurable Input #3 Status	Read Only	0. Inactive 1. Active	Measured state of hardware input	PC 1.x

Addr.	Parameter	Access	Specifications	Description	Control
43822	Re-Transfer Delay	Read Write	Multiplier : 1 Offset: 0 Size (Bits) : 8 Sign: U Units: NA Lower Limit: 0 Upper Limit: 59 Default: 1	This is the delay after the utility has returned and before the transfer switch is moved back to the utility side position.	PC 1.x
43825	Transfer Delay	Read Write	Multiplier : 1 Offset: 0 Size (Bits) : 16 Sign: U Units: seconds Lower Limit: 60 Upper Limit: 600 Default: 300	This is the delay after the generator set is started before the transfer switch is moved to the generator set side position.	PC 1.x
43905	Network Speed Adjust Command	Read and Write	0: Normal 1: Active	Used to command a fixed 0.5 Hz increase in the speed setpoint.	PC1.x

TABLE 53. PCC1301 MODBUS MAPPING FOR PARAMETERS HAVING DIFFERENT LIMITS AS COMPARED TO PC1.X AND PS05000

Addr.	Parameter	Access	Specifications	Description	Control
43012	Battle Short Switch Input	Read and Write	0: None, 1: Configurable Input #1, 2: Configurable Input #2, 3: Configurable Input #3	Switch input for Battle Short	PCC1301 ONLY
43069	Voltage Regulator Calibration 60Hz	Read and Write	Multiplier: 0.0001 Offset: 0 Size(Bits): 16 Sign: U Units: % Lower Limit: 6000 Upper Limit: 14000 Default: 10000	Make actual voltage match nominals 60 Hz when the set point = 100%	PCC1301 ONLY
43070	Voltage Regulator Calibration 50Hz	Read and Write	Multiplier: 0.0001 Offset: 0 Size(Bits): 16 Sign: U Units: % Lower Limit: 6000 Upper Limit: 14000 Default: 10000	Make actual voltage match nominals 50 Hz when the set point = 100%	PCC1301 ONLY

Addr.	Parameter	Access	Specifications	Description	Control
43072	Alternator L1-N 60Hz Voltage Display Adjust	Read and Write	Multiplier: 0.0001 Offset: 0 Size(Bits): 16 Sign: U Units: % Lower Limit: 6000 Upper Limit: 14000 Default: 10000	60 Hz line 1 to neutral metering voltage calibration	PCC1301 ONLY
43073	Alternator L2-N 60Hz Voltage Display Adjust	Read and Write	Multiplier: 0.0001 Offset: 0 Size(Bits): 16 Sign: U Units: % Lower Limit: 6000 Upper Limit: 14000 Default: 10000	60 Hz line 2 to neutral metering voltage calibration	PCC1301 ONLY
43074	Alternator L3-N 60Hz Voltage Display Adjust	Read and Write	Multiplier: 0.0001 Offset: 0 Size(Bits): 16 Sign: U Units: % Lower Limit: 6000 Upper Limit: 14000 Default: 10000	60 Hz line 3 to neutral metering voltage calibration	PCC1301 ONLY
43075	Alternator L1-N 50Hz Voltage Display Adjust	Read and Write	Multiplier: 0.0001 Offset: 0 Size(Bits): 16 Sign: U Units: % Lower Limit: 6000 Upper Limit: 14000 Default: 10000	50 Hz line 1 to neutral metering voltage calibration	PCC1301 ONLY
43076	Alternator L2-N 50Hz Voltage Display Adjust	Read and Write	Multiplier: 0.0001 Offset: 0 Size(Bits): 16 Sign: U Units: % Lower Limit: 6000 Upper Limit: 14000 Default: 10000	50 Hz line 2 to neutral metering voltage calibration	PCC1301 ONLY

Addr.	Parameter	Access	Specifications	Description	Control
43077	Alternator L3-N 50Hz Voltage Display Adjust	Read and Write	Multiplier: 0.0001 Offset: 0 Size(Bits): 16 Sign: U Units: % Lower Limit: 6000 Upper Limit: 14000 Default: 10000	50 Hz line 3 to neutral metering voltage calibration	PCC1301 ONLY
46364	Modbus Register RO Enable	Read Only	Multiplier: 0 Offset: 0 Size (Bits): 8 Sign: U Unit: NA Lower Limit: 0 Upper Limit: 1	Modbus register RO Enable	PC 1.x
47031	Auto Mains Failure Enable	Read Only	Multiplier: 0 Offset: 0 Size (Bits): 8 Sign: U Unit: NA Lower Limit: 0 Upper Limit: 1	Auto Mains Failure Enable Disable 0 Enable 1	PC 1.x
47032	Transition to Genset Delay	Read Write	Multiplier : 0 Offset: 0 Size (Bits) : 8 Sign: U Units: seconds Lower Limit: 1 Upper Limit: 10	Transition to genset delay	PC 1.x
47033	Re-Transition to Utility Delay	Read Write	Multiplier : 0 Offset: 0 Size (Bits) : 8 Sign: U Units: seconds Lower Limit: 1 Upper Limit: 10	Re-Transition to Utility Delay	PC 1.x
47034	Utility Fail To Close Delay	Read Write	Multiplier : 0 Offset: 0 Size (Bits) : 8 Sign: U Units: seconds Lower Limit: 1 Upper Limit: 10	Utility Fail To Close Delay	PC 1.x

Addr.	Parameter	Access	Specifications	Description	Control
47035	Genset Fail To Close Delay	Read Write	Multiplier : 0 Offset: 0 Size (Bits) : 8 Sign: U Units: seconds Lower Limit: 1 Upper Limit: 10	Genset Fail To Close Delay	PC 1.x
47036	Transfer Switch Signal Unknown Warning Delay	Read Write	Multiplier : 1 Offset: 0 Size (Bits) : 8 Sign: U Units: seconds Lower Limit: 5 Upper Limit: 10 Default: 5	This is the delay after the transfer switch is moved to any of the sides, awaiting for the fault to become active or inactive.	PC 1.x
47037	Transfer Switch Feedback Status	Read Only	0. At Utility 1. At Genset 2. Unknown Position 3. Not Available	This is the status of the transfer switch depending upon the feedback received.	PC 1.x
47038	Transfer Retransfer Status	Read Only	0. Not Available 1. OFF 2. Transfer Start 3. Retransfer Start 4. Transfer Progress 5. Retransfer Progress 6. Transfer Complete 7. Retransfer Complete 8. Transfer Failed 9. Retransfer Failed	This is the status of the transfer and retransfer process.	PC 1.x
47039	Transfer Switch	Read Only	0. At Utility 1. At Genset 2. Unknown Position 3. Not Available	This is the status of the transfer switch depending upon the fault.	PC 1.x
47040	Clock Cycle	Read Write	0. AM 1. PM	Used to set AM_PM Cycle or read the same	PC 1.x
47041	Scheduler Prog Start Period	Read Write	0. AM 1. PM	User can set the AM/PM period for the Scheduler	PC 1.x
47042	Transfer Switch Feedback Enable	Read Write	0. Disable 1. Enable	Trim to enable transfer switch feedback logic	PC 1.x

Addr.	Parameter	Access	Specifications	Description	Control
47043	Fuel System	Read Write	0. Diesel 1. Gas	Type of fuel and ignition system used by the generator set	PC 1.x
47044	Gas Fuel Type	Read Write	0. Natural Gas 1. Propane 2. Dual	Trim to set the type of gaseous fuel	PC 1.x
47045	Low Fuel Pressure Switch	Read Only	0.Inactive 1.Active	Displays inactive/active status of the switch	PC 1.x
47046	Low Fuel Pressure Switch Active State Selection	Read Write	0. Active Closed 1. Active Open	State selection of the low fuel pressure switch	PC 1.x
47047	LTA Temperature	Read Only	Multiplier : 1 Offset: 0 Size (Bits) : 16 Sign: S Units: DegF Lower Limit: NA Upper Limit: NA Default: NA	The processed value of the LTA Temperature sensor for the System IO Module	PC 1.x
47048	Intake Manifold Over Pressure (IMOP) Enable	Read Write	0. Disabled 1. Enabled	Trim to enable the detection of Intake Manifold Backfire condition	PC 1.x
47049	Intake Manifold Temperature Source	Read Write	0. SPN 105 1. SPN 52	Source for Intake Manifold Temperature; SPN 105 Default Source and SPN 52 when the IMOP is enabled	PC 1.x
47050	Intake Manifold Temp Rate of Change Threshold	Read Write	Multiplier : 0.1 Offset: 0 Size (Bits) : 8 Sign: U Units: DegF/sec Lower Limit: 2 Upper Limit: 10 Default: 5	Threshold to decide the Intake Manifold Backfire condition; the value entered is for degF/secs; degF/2secs is obtained by a scalar of 2 in the PCC software	PC 1.x
47051	Annunciator Output 1 Status	Read Only	0. Driver Off 1.Driver On	State of output as seen by the Annunciator	PC 1.x
47052	Annunciator Output 1 Status	Read Only	0. Driver Off 1.Driver On	State of output as seen by the Annunciator	PC 1.x

Addr.	Parameter	Access	Specifications	Description	Control
47053	Annunciator Output 3 Status	Read Only	0. Driver Off 1.Driver On	State of output as seen by the Annunciator	PC 1.x
47054	Annunciator Output 4 Status	Read Only	0. Driver Off 1.Driver On	State of output as seen by the Annunciator	PC 1.x
47055	KTA Fuel Differential Pressure High Side	Read Only	Multiplier : 0.1 Offset: 0 Size (Bits) : 16 Sign: S Units: PSI Lower Limit: NA Upper Limit: NA Default: NA	The D.F.P for the KTA engine's high side sensor	PC 1.x
47056	KTA Fuel Differential Pressure Low Side	Read Only	Multiplier : 0.1 Offset: 0 Size (Bits) : 16 Sign: S Units: PSI Lower Limit: NA Upper Limit: NA Default: NA	The D.F.P for the KTA engine's low side sensor	PC 1.x
47057	Air Shutoff Valve Voltage	Read Only	Multiplier : 0.01 Offset: 0 Size (Bits) : 16 Sign: S Units: Vdc Lower Limit: NA Upper Limit: NA Default: NA	The Air Shutoff Valve Voltage configured for SID sender input 7 or 8 (enabled only for oil and gas features)	PC 1.x
47058	Percent Dirty Fuel Filter	Read Only	Multiplier : 0.1 Offset: 0 Size (Bits) : 16 Sign: U Units: % Lower Limit: NA Upper Limit: NA Default: NA	The calculated level at which the fuel filter is clogged	PC 1.x

Addr.	Parameter	Access	Specifications	Description	Control
47059	QSK Differential Pressure Low Side	Read Only	Multiplier : 0.1 Offset: 0 Size (Bits) : 16 Sign: S Units: PSI Lower Limit: NA Upper Limit: NA Default: NA	The fuel pressure measure on the QSK engine's low side of the fuel filter	PC 1.x
47060	Main Relay Status	Read Only	Multiplier : 1 Offset: 0 Size (Bits) : 8 Sign: U Units: NA Lower Limit: NA Upper Limit: NA Default: NA	System IO Main Relay Status	PC 1.x
47061	Expansion Relay Status	Read Only	Multiplier : 1 Offset: 0 Size (Bits) : 8 Sign: U Units: NA Lower Limit: NA Upper Limit: NA Default: NA	System IO Expansion Relay Status	PC 1.x
47062	Switched B+ Run Time	Read Only	Multiplier: 0 Offset: 0 Size (Bits): 16 Sign: U Unit: NA Lower Limit: 0 Upper Limit: 1	Switched B+ plus Run Time Higher 2 bytes. Scaling should be same as that of Engine running Time.	PC 1.x
47063	Switched B+ Run Time	Read Only	Multiplier: 0 Offset: 0 Size (Bits): 16 Sign: U Unit: NA Lower Limit: 0 Upper Limit: 1	Switched B+ plus Run Time Lower 2 bytes	PC 1.x

Addr.	Parameter	Access	Specifications	Description	Control
47066	Switched B Plus Run Time Enable	Read/write	Multiplier: 1 Offset: 0 Size (Bits): 8 Sign: U Unit: NA Lower Limit: 0 Upper Limit: 1	Switched B+ plus Enable	PC 1.x

This page is intentionally blank.

15 PowerCommand 2.x/3.x Modbus Register Map

15.1 Modbus Communications

Use the following equation to calculate the value of 32-bit parameters.

- A = high register value
- B = low register value

$\text{parameter} = (A * 65536 * \text{multiplier}) + (B * \text{multiplier})$

alternate formula: $\text{parameter} = ((A * 65536) + B) * \text{multiplier}$

For example: Engine Running Time is a 32-bit parameter in registers 40070 and 40071.

- Register 40070 has 322 (high register value = A).
- Register 40071 has 15637 (low register value = B).

$\text{Engine Running Time} = (322 * 65536 * 0.1) + (15637 * 0.1)$

The engine run-time is 2111823 seconds, or 586.6 hours.

To write a 32-bit value to 2 Modbus registers, calculate the value for each register as follows:

- A (High register value) = $\text{INT} ((\text{Parameter} / \text{Multiplier}) / 65536)$
- B (Low register value) = $\text{INT} ((\text{Parameter} / \text{Multiplier}) \% (65536))$
- % = Modulus (the remainder of integer division)

For example: To write Load Demand Genset Run Hours = 80000.5

- Register 40769 (high register value A) should be written to $\text{INT} ((80000.5 / 0.1) / 65536) = 12$
- Register 40770 (low register value B) should be written to $\text{INT} ((80000.5 / 0.1) \% 65536) = 13573$

To write 32-bit values to 2 modbus addresses always write the high register value followed by the low register value. Both registers must be written to change the 32-bit value in the control.

15.2 Parametrics (Analog Values)

Unsupported (Not Available) Data=> "Not Available" data shall be represented as highest positive value for that parameter. For example for a two byte, unsigned integer that would be 65535. For a signed integer that would be 32767.

- Parameters which are not available due to the sensor not being installed, or not enabled in the controllers configuration will be classified like this.

Network Failed Data=> "Network Failure" data shall be represented as three less than the highest positive value for that parameter. For example for a two byte, unsigned integer that would be 65532. For a signed integer that would be 32764.

- Data that comes from a network that has failed, such as sensors on the PCCnet I/O Module or sensor data coming in via the CAN datalink will be classified like this.

Hardware/Component Failure=> "Hardware/Component Failure" data shall be represented as four less than the highest positive value for that parameter. For example for a two byte, unsigned integer that would be 65531. For a signed integer that would be 32763.

- A hardware/component failure that provides the data, such as the voltage, current and power data that comes from an external metering chip will be classified like this.

Out of Range High/Out of Range=> "Out of Range High/Out of Range" data shall be represented as one less than the highest positive value for that parameter. For example for a two byte, unsigned integer that would be 65534. For a signed integer that would be 32766.

- Data that has been determined to be out of range high or out of range (when there is no distinction between out of range high and out of range low) due to an open sensor for example, will be classified like this.

Out of Range Low=> "Out of Range Low" data shall be represented as two less than the highest positive value for that parameter. For example for a two byte, unsigned integer that would be 65533. For a signed integer that would be 32765.

- Data that has been determined to be out of range low due to a shorted sensor for example, will be classified like this.

Data within Normal Operating Range (Valid)=> Anything other than above.

NOTICE

Earlier versions of software may not support all of the Modbus registers in the following table. If a particular register is not available in your installation, it is possible that the Modbus connection is working but the controller software does not support that particular register.

NOTICE

If an address or bit is not listed in this table it is not implemented.

NOTICE

The Master device can read 1-40 contiguous registers, write 1-40 contiguous registers, or read diagnostic counters.

NOTICE

The lowest Modbus register value is considered as the High Register Value and the highest Modbus register value is considered as the Low Register Value.

NOTICE

Throughout this document, if a parameter is marked for PCC3300 and PCC3300V2, then it is applicable to both. If it is marked for PCC3300V2, then it is applicable to PCC3300V2 only.

TABLE 54.

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40010	Control Switch Position	Read Only	0: Off		Current position of the generator set switch panel Off-Run-Auto switch as seen by the generator set control. Modbus mapping shall be in both addresses 40580 and 40010. For 40010 Modbus Only: 0: Off 1: Auto 2: Manual	PCC3300, PCC2300, PCC3300V2
			1: Manual			
			2: Auto			
40012	Most Recent Fault or Warning	Read Only	Multiplier: 1	Unit: Fault Code	This Modbus Register displays most recent Fault or Warning. It is not mapped with any logical.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40013	Modbus register 40013	Read Only	0: None		This register returns the Fault Type of the Fault Code. This is not associated with any logical.	PCC3300, PCC2300, PCC3300V2
			1: Warning			
			2: Shutdown			
40014	Genset % Standby Total kW	Read Only	Multiplier: 0.01	Unit: %	Monitors the total generator set standby KW percentage output.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
40018	Genset L1N Voltage	Read Only	Multiplier: 1	Unit: Vac	Generator set L1N voltage	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40019	Genset L2N Voltage	Read Only	Multiplier: 1	Unit: Vac	Generator set L2N voltage	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40020	Genset L3N Voltage	Read Only	Multiplier: 1	Unit: Vac	Generator set L3N voltage	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40022	Genset L1L2 Voltage	Read Only	Multiplier: 1	Unit: Vac	Generator set L1L2 voltage	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40023	Genset L2L3 Voltage	Read Only	Multiplier: 1	Unit: Vac	Generator set L2L3 voltage	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40024	Genset L3L1 Voltage	Read Only	Multiplier: 1	Unit: Vac	Generator set L3L1 voltage	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40025	Genset LL Average Voltage	Read Only	Multiplier: 1	Unit: Vac	Generator set Line to Line average voltage	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40026	Genset L1 Current	Read Only	Multiplier: 1	Unit: Amps	Monitors the generator set L1 current value.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40027	Genset L2 Current	Read Only	Multiplier: 1	Unit: Amps	Generator set L2 current	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40028	Genset L3 Current	Read Only	Multiplier: 1	Unit: Amps	Generator set L3 current	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40029	Genset Average Current	Read Only	Multiplier: 1	Unit: Amps	Generator set average current	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40030	Genset Neutral Current	Read Only	Multiplier: 1	Unit: Amps	Generator set neutral current	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40031	Genset L1 kW	Read Only	Multiplier: 1	Unit: kW	Generator set L1 kW	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
40032	Genset L2 kW	Read Only	Multiplier: 1	Unit: kW	Generator set L2 kW	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
40033	Genset L3 kW	Read Only	Multiplier: 1	Unit: kW	Generator set L3 kW	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
40034	Genset Total kW	Read Only	Multiplier: 1	Unit: kW	Generator set total kW	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
40035	Genset L1 kVAR	Read Only	Multiplier: 1	Unit: kVAR	Generator set L1 KVAR	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
40036	Genset L2 kVAR	Read Only	Multiplier: 1	Unit: kVAR	Generator set L2 Kvar	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: -32768		
			Size (bits): 16	Upper Limit: 32762		
			Sign: S			
40037	Genset L3 kVAR	Read Only	Multiplier: 1	Unit: kVAR	Generator set L3 Kvar	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40038	Genset Total kVAR	Read Only	Multiplier: 1	Unit: kVAR	Generator set total kVAR	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
40039	Genset Total Power Factor	Read Only	Multiplier: 0.01	Unit: PF	Generator set total power factor (L1+L2+L3)	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 8	Upper Limit:		
			Sign: S			
40040	Genset L1 kVA	Read Only	Multiplier: 1	Unit: kVA	Generator set L1 kVA	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40041	Genset L2 kVA	Read Only	Multiplier: 1	Unit: kVA	Generator set L2 kVA	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40042	Genset L3 kVA	Read Only	Multiplier: 1	Unit: kVA	Generator set L3 kVA	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40043	Genset Total kVA	Read Only	Multiplier: 1	Unit: kVA	Generator set total kVA	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40046	Genset Total Negative kWh	Read Only	Multiplier: 1	Unit: kWh	Generator set total negative kWh accumulation	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40047	Genset Total Negative kWh	Read Only	Multiplier: 1	Unit: kWh	Generator set total negative kWh accumulation	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40048	Genset Total Positive kWh	Read Only	Multiplier: 1	Unit: kWh	Generator set total positive kWh accumulation	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 32	Upper Limit: 4294967290		
			Sign: U			
40049	Genset Total Positive kWh	Read Only	Multiplier: 1	Unit: kWh	Generator set total positive kWh accumulation	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 32	Upper Limit: 4294967290		
			Sign: U			
40050	Genset Total Net kWh	Read Only	Multiplier: 1	Unit: kWh	Generator set total net kWh accumulation	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: -2147483648		
			Size (bits): 32	Upper Limit: 2147483643		
			Sign: S			
40051	Genset Total Net kWh	Read Only	Multiplier: 1	Unit: kWh	Generator set total net kWh accumulation	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: -2147483648		
			Size (bits): 32	Upper Limit: 2147483643		
			Sign: S			
40052	Genset Total Negative kVARh	Read Only	Multiplier: 1	Unit: kVARh	Generator set total negative kVARh accumulation	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40053	Genset Total Negative kVARh	Read Only	Multiplier: 1	Unit: kVARh	Generator set total negative kVARh accumulation	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40054	Genset Total Positive kVARh	Read Only	Multiplier: 1	Unit: kVARh	Generator set total positive kVARh accumulation	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 32	Upper Limit: 4294967290		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40055	Genset Total Positive kVARh	Read Only	Multiplier: 1	Unit: kVARh	Generator set total positive kVARh accumulation	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 32	Upper Limit: 4294967290		
			Sign: U			
40056	Genset Total Net kVARh	Read Only	Multiplier: 1	Unit: kVARh	Generator set total net kVARh accumulation	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: -2147483648		
			Size (bits): 32	Upper Limit: 2147483643		
			Sign: S			
40057	Genset Total Net kVARh	Read Only	Multiplier: 1	Unit: kVARh	Generator set total net kVARh accumulation	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: -2147483648		
			Size (bits): 32	Upper Limit: 2147483643		
			Sign: S			
40058	Genset % Standby L1 Current	Read Only	Multiplier: 0.1	Unit: %	Monitors the generator set standby L1 current percentage output.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40059	Genset % Standby L2 Current	Read Only	Multiplier: 0.1	Unit: %	Monitors the generator set standby L2 current percentage output.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40060	Genset % Standby L3 Current	Read Only	Multiplier: 0.1	Unit: %	Monitors the generator set standby L3 current percentage output.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40061	Battery Voltage	Read Only	Multiplier: 0.001	Unit: Vdc	"Battery voltage value. Modbus and PCCnet has different multiplier value. For Modbus use only, multiplier/units = 0.1 Volts"	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40062	Oil Pressure	Read Only	Multiplier: 0.1	Unit: psi	Monitor point for the Oil Pressure. Modbus and PCCnet have different multiplier value. For modbus use only, Multiplier/Units = 1kPa	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40063	Oil Temperature	Read Only	Multiplier: 0.1	Unit: degF	Monitor point for the Oil Temperature	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
40064	Coolant Temperature	Read Only	Multiplier: 0.1	Unit: degF	Monitor point for the Coolant Temperature. Modbus mapping shall be to both 46126 and 40064 addresses. For Modbus use only, Multiplier/Units = 0.1C	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
40065	Intake Manifold Temperature	Read Only	Multiplier: 0.1	Unit: degF	To monitor Intake Manifold Temperature. This parameter represents "Intake Manifold Temperature 1".	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: -40		
			Size (bits): 16	Upper Limit: 410		
			Sign: S			
40066	Fuel Temperature	Read Only	Multiplier: 0.1	Unit: degF	Monitor point for the Fuel Temperature	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: -40		
			Size (bits): 16	Upper Limit: 410		
			Sign: S			
40067	Fuel Rate	Read Only	Multiplier: 0.05	Unit: gal/hr	Monitor point for the Fuel Rate	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40068	Average Engine Speed	Read Only	Multiplier: 0.125	Unit: rpm	Monitor point for the Average Engine Speed. Modbus and PCCnet have different multiplier value. For modbus use only, Multiplier/Units = 1 RPM	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40070	Engine Running Time	Read Only	Multiplier: 0.05	Unit: hours	Amount of time that the engine has been running.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40071	Engine Running Time	Read Only	Multiplier: 0.05	Unit: hours	Amount of time that the engine has been running.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40072	Total Fuel Consumption	Read Only	Multiplier: 0.1	Unit: gallons	Total fuel consumption since start of engine.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40073	Total Fuel Consumption	Read Only	Multiplier: 0.1	Unit: gallons	Total fuel consumption since start of engine.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40074	Total Number of Runs	Read/Write	Multiplier: 1	Unit:	Total number of generator set runs.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 32	Upper Limit: 4294967295		
			Sign: U			
40075	Total Number of Runs	Read/Write	Multiplier: 1	Unit:	Total number of generator set runs.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 32	Upper Limit: 4294967295		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40076	Runs Reset Time	Read/Write	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Run Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for ModBus. Modbus implementation or the Real time stamp will use 40076 - 40092 for 17 char of this string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			
40077	Runs Reset Time	Read/Write	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Run Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for ModBus. Modbus implementation or the Real time stamp will use 40076 - 40092 for 17 char of this string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			
40078	Runs Reset Time	Read/Write	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Run Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for ModBus. Modbus implementation or the Real time stamp will use 40076 - 40092 for 17 char of this string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40079	Runs Reset Time	Read/Write	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Run Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for ModBus. Modbus implementation or the Real time stamp will use 40076 - 40092 for 17 char of this string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			
40080	Runs Reset Time	Read/Write	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Run Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for ModBus. Modbus implementation or the Real time stamp will use 40076 - 40092 for 17 char of this string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			
40081	Runs Reset Time	Read/Write	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Run Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for ModBus. Modbus implementation or the Real time stamp will use 40076 - 40092 for 17 char of this string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40082	Runs Reset Time	Read/Write	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Run Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for ModBus. Modbus implementation or the Real time stamp will use 40076 - 40092 for 17 char of this string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			
40083	Runs Reset Time	Read/Write	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Run Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for ModBus. Modbus implementation or the Real time stamp will use 40076 - 40092 for 17 char of this string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			
40084	Runs Reset Time	Read/Write	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Run Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for ModBus. Modbus implementation or the Real time stamp will use 40076 - 40092 for 17 char of this string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40085	Runs Reset Time	Read/Write	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Run Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for ModBus. Modbus implementation or the Real time stamp will use 40076 - 40092 for 17 char of this string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			
40086	Runs Reset Time	Read/Write	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Run Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for ModBus. Modbus implementation or the Real time stamp will use 40076 - 40092 for 17 char of this string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			
40087	Runs Reset Time	Read/Write	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Run Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for ModBus. Modbus implementation or the Real time stamp will use 40076 - 40092 for 17 char of this string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40088	Runs Reset Time	Read/Write	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Run Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for ModBus. Modbus implementation or the Real time stamp will use 40076 - 40092 for 17 char of this string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			
40089	Runs Reset Time	Read/Write	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Run Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for ModBus. Modbus implementation or the Real time stamp will use 40076 - 40092 for 17 char of this string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			
40090	Runs Reset Time	Read/Write	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Run Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for ModBus. Modbus implementation or the Real time stamp will use 40076 - 40092 for 17 char of this string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40091	Runs Reset Time	Read/Write	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Run Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for ModBus. Modbus implementation or the Real time stamp will use 40076 - 40092 for 17 char of this string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			
40092	Runs Reset Time	Read/Write	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Run Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for ModBus. Modbus implementation or the Real time stamp will use 40076 - 40092 for 17 char of this string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			
40096	Start Attempts Reset Time	Read/Write	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Start Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for ModBus. Modbus implementation or the Real time stamp will use 40096 - 0112 for 17 char of this string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40097	Start Attempts Reset Time	Read/Write	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Start Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for ModBus. Modbus implementation or the Real time stamp will use 40096 - 0112 for 17 char of this string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			
40098	Start Attempts Reset Time	Read/Write	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Start Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for ModBus. Modbus implementation or the Real time stamp will use 40096 - 0112 for 17 char of this string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			
40099	Start Attempts Reset Time	Read/Write	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Start Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for ModBus. Modbus implementation or the Real time stamp will use 40096 - 0112 for 17 char of this string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40100	Start Attempts Reset Time	Read/Write	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Start Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for ModBus. Modbus implementation or the Real time stamp will use 40096 - 0112 for 17 char of this string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			
40101	Start Attempts Reset Time	Read/Write	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Start Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for ModBus. Modbus implementation or the Real time stamp will use 40096 - 0112 for 17 char of this string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			
40102	Start Attempts Reset Time	Read/Write	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Start Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for ModBus. Modbus implementation or the Real time stamp will use 40096 - 0112 for 17 char of this string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40103	Start Attempts Reset Time	Read/Write	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Start Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for ModBus. Modbus implementation or the Real time stamp will use 40096 - 0112 for 17 char of this string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			
40104	Start Attempts Reset Time	Read/Write	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Start Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for ModBus. Modbus implementation or the Real time stamp will use 40096 - 0112 for 17 char of this string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			
40105	Start Attempts Reset Time	Read/Write	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Start Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for ModBus. Modbus implementation or the Real time stamp will use 40096 - 0112 for 17 char of this string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40106	Start Attempts Reset Time	Read/Write	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Start Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for ModBus. Modbus implementation or the Real time stamp will use 40096 - 0112 for 17 char of this string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			
40107	Start Attempts Reset Time	Read/Write	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Start Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for ModBus. Modbus implementation or the Real time stamp will use 40096 - 0112 for 17 char of this string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			
40108	Start Attempts Reset Time	Read/Write	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Start Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for ModBus. Modbus implementation or the Real time stamp will use 40096 - 0112 for 17 char of this string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40109	Start Attempts Reset Time	Read/Write	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Start Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for ModBus. Modbus implementation or the Real time stamp will use 40096 - 0112 for 17 char of this string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			
40110	Start Attempts Reset Time	Read/Write	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Start Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for ModBus. Modbus implementation or the Real time stamp will use 40096 - 0112 for 17 char of this string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			
40111	Start Attempts Reset Time	Read/Write	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Start Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for ModBus. Modbus implementation or the Real time stamp will use 40096 - 0112 for 17 char of this string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40112	Start Attempts Reset Time	Read/Write	Multiplier: 1	Unit:	Real Time Clock stamp record of the last time the Start Attempts were reset. This parameter is READ/WRITE for Mon and PCCNet and READ ONLY for ModBus. Modbus implementation or the Real time stamp will use 40096 - 0112 for 17 char of this string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 144	Upper Limit:		
			Sign: C			
40118	Utility L1N Voltage	Read Only	Multiplier: 1	Unit: Vac	Utility L1N voltage	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40119	Utility L2N Voltage	Read Only	Multiplier: 1	Unit: Vac	Utility L2N voltage	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40120	Utility L3N Voltage	Read Only	Multiplier: 1	Unit: Vac	Utility L3N voltage	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40122	Utility L1L2 Voltage	Read Only	Multiplier: 1	Unit: Vac	Utility L1L2 voltage	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40123	Utility L2L3 Voltage	Read Only	Multiplier: 1	Unit: Vac	Utility L2L3 voltage	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40124	Utility L3L1 Voltage	Read Only	Multiplier: 1	Unit: Vac	Utility L3L1 voltage	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40125	Utility LL Average Voltage	Read Only	Multiplier: 1	Unit: Vac	Utility Line to Line average voltage	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40126	Utility L1 Current	Read Only	Multiplier: 1	Unit: Amps	Utility L1 current	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40127	Utility L2 Current	Read Only	Multiplier: 1	Unit: Amps	Utility L2 current	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40128	Utility L3 Current	Read Only	Multiplier: 1	Unit: Amps	Utility L3 current	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40131	Utility L1 kW	Read Only	Multiplier: 1	Unit: kW	Utility L1 kW	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
40132	Utility L2 kW	Read Only	Multiplier: 1	Unit: kW	Utility L2 kW	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
40133	Utility L3 kW	Read Only	Multiplier: 1	Unit: kW	Utility L3 kW	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
40134	Utility Total kW	Read Only	Multiplier: 1	Unit: kW	Utility total kW	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40135	Utility L1 kVAR	Read Only	Multiplier: 1	Unit: kVAR	Utility L1 Kvar	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
40136	Utility L2 kVAR	Read Only	Multiplier: 1	Unit: kVAR	Utility L2 Kvar	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
40137	Utility L3 kVAR	Read Only	Multiplier: 1	Unit: kVAR	Utility L3 Kvar	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
40138	Utility Total kVAR	Read Only	Multiplier: 1	Unit: kVAR	Utility total kVAR	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
40139	Utility Total Power Factor	Read Only	Multiplier: 0.01	Unit: PF	Utility total power factor	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 8	Upper Limit:		
			Sign: S			
40140	Utility L1 kVA	Read Only	Multiplier: 1	Unit: kVA	Utility L1 kVA	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40141	Utility L2 kVA	Read Only	Multiplier: 1	Unit: kVA	Utility L2 kVA	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40142	Utility L3 kVA	Read Only	Multiplier: 1	Unit: kVA	Utility L3 kVA	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40143	Utility Total kVA	Read Only	Multiplier: 1	Unit: kVA	Utility total kVA	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40144	Utility Frequency	Read Only	Multiplier: 0.001	Unit: Hz	Utility line frequency	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40145	Utility Frequency	Read Only	Multiplier: 0.001	Unit: Hz	Utility line frequency	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40146	Utility Total Negative kWh	Read Only	Multiplier: 1	Unit: kWh	Utility total negative kWh accumulation	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40147	Utility Total Negative kWh	Read Only	Multiplier: 1	Unit: kWh	Utility total negative kWh accumulation	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40148	Utility Total Positive kWh	Read Only	Multiplier: 1	Unit: kWh	Utility total positive kWh accumulation	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40149	Utility Total Positive kWh	Read Only	Multiplier: 1	Unit: kWh	Utility total positive kWh accumulation	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40150	Utility Total Net kWh	Read Only	Multiplier: 1	Unit: kWh	Utility total net kWh accumulation	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: S			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40151	Utility Total Net kWh	Read Only	Multiplier: 1	Unit: kWh	Utility total net kWh accumulation	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: S			
40152	Utility Total Negative kVARh	Read Only	Multiplier: 1	Unit: kVARh	Utility total negative kVARh accumulation	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40153	Utility Total Negative kVARh	Read Only	Multiplier: 1	Unit: kVARh	Utility total negative kVARh accumulation	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40154	Utility Total Positive kVARh	Read Only	Multiplier: 1	Unit: kVARh	Utility total positive kVARh accumulation	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40155	Utility Total Positive kVARh	Read Only	Multiplier: 1	Unit: kVARh	Utility total positive kVARh accumulation	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40156	Utility Total Net kVARh	Read Only	Multiplier: 1	Unit: kVARh	Utility total net kVARh accumulation	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: S			
40157	Utility Total Net kVARh	Read Only	Multiplier: 1	Unit: kVARh	Utility total net kVARh accumulation	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: S			
40158	Genset Bus L1N Voltage	Read Only	Multiplier: 1	Unit: Vac	Generator set Bus L1N voltage	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40159	Genset Bus L2N Voltage	Read Only	Multiplier: 1	Unit: Vac	Generator set Bus L2N voltage	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40160	Genset Bus L3N Voltage	Read Only	Multiplier: 1	Unit: Vac	Generator set Bus L3N voltage	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40162	Genset Bus L1L2 Voltage	Read Only	Multiplier: 1	Unit: Vac	Generator set Bus L1L2 voltage	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40163	Genset Bus L2L3 Voltage	Read Only	Multiplier: 1	Unit: Vac	Generator set Bus L2L3 voltage	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40164	Genset Bus L3L1 Voltage	Read Only	Multiplier: 1	Unit: Vac	Generator set Bus L3L1 voltage	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40165	Genset Bus LL Average Voltage	Read Only	Multiplier: 1	Unit: Vac	Generator set Bus Line to Line average voltage	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40166	Genset Bus L1 Current	Read Only	Multiplier: 1	Unit: Amps	Generator set Bus L1 current	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
40167	Genset Bus L2 Current	Read Only	Multiplier: 1	Unit: Amps	Generator set Bus L2 current	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40168	Genset Bus L3 Current	Read Only	Multiplier: 1	Unit: Amps	Generator set Bus L3 current	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40171	Genset Bus L1 kW	Read Only	Multiplier: 1	Unit: kW	Generator set Bus L1 kW	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: -32768		
			Size (bits): 16	Upper Limit: 32762		
			Sign: S			
40172	Genset Bus L2 kW	Read Only	Multiplier: 1	Unit: kW	Generator set Bus L2 kW	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: -32768		
			Size (bits): 16	Upper Limit: 32762		
			Sign: S			
40173	Genset Bus L3 kW	Read Only	Multiplier: 1	Unit: kW	Generator set Bus L3 kW	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
40174	Genset Bus Total kW	Read Only	Multiplier: 1	Unit: kW	Generator set Bus total kW	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
40175	Genset Bus L1 kVAR	Read Only	Multiplier: 1	Unit: kVAR	Generator set bus L1 Kvar	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: -32678		
			Size (bits): 16	Upper Limit: 32672		
			Sign: S			
40176	Genset Bus L2 kVAR	Read Only	Multiplier: 1	Unit: kVAR	Generator set bus L2 Kvar	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: -32768		
			Size (bits): 16	Upper Limit: 32762		
			Sign: S			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40177	Genset Bus L3 kVAR	Read Only	Multiplier: 1	Unit: kVAR	Generator set bus L3 Kvar	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
40178	Genset Bus Total kVAR	Read Only	Multiplier: 1	Unit: kVAR	Generator set bus total kVAR	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
40179	Genset Bus Total Power Factor	Read Only	Multiplier: 0.01	Unit: PF	Generator set Bus Total power factor	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 8	Upper Limit:		
			Sign: S			
40180	Genset Bus L1 kVA	Read Only	Multiplier: 1	Unit: kVA	Generator set Bus L1 kVA	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40181	Genset Bus L2 kVA	Read Only	Multiplier: 1	Unit: kVA	Generator set Bus L2 kVA	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40182	Genset Bus L3 kVA	Read Only	Multiplier: 1	Unit: kVA	Generator set Bus L3 kVA	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40183	Genset Bus Total kVA	Read Only	Multiplier: 1	Unit: kVA	Generator set bus total kVA	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			

TABLE 55.

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40184	Genset Bus Frequency	Read Only	Multiplier: 0.001	Unit: Hz	Generator set bus line frequency	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40185	Genset Bus Frequency	Read Only	Multiplier: 0.001	Unit: Hz	Generator set bus line frequency	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40186	Genset Bus Total Negative kWh	Read Only	Multiplier: 1	Unit: kWh	Generator set bus total negative kWh accumulation	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40187	Genset Bus Total Negative kWh	Read Only	Multiplier: 1	Unit: kWh	Generator set bus total negative kWh accumulation	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40188	Genset Bus Total Positive kWh	Read Only	Multiplier: 1	Unit: kWh	Generator set bus total positive kWh accumulation	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40189	Genset Bus Total Positive kWh	Read Only	Multiplier: 1	Unit: kWh	Generator set bus total positive kWh accumulation	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40190	Genset Bus Total Net kWh	Read Only	Multiplier: 1	Unit: kWh	Generator set bus total net kWh accumulation	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: S			
40191	Genset Bus Total Net kWh	Read Only	Multiplier: 1	Unit: kWh	Generator set bus total net kWh accumulation	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: S			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40192	Genset Bus Total Negative kVARh	Read Only	Multiplier: 1	Unit: kVARh	Generator set bus total negative kVARh accumulation	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40193	Genset Bus Total Negative kVARh	Read Only	Multiplier: 1	Unit: kVARh	Generator set bus total negative kVARh accumulation	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40194	Genset Bus Total Positive kVARh	Read Only	Multiplier: 1	Unit: kVARh	Generator set bus total positive kVARh accumulation	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40195	Genset Bus Total Positive kVARh	Read Only	Multiplier: 1	Unit: kVARh	Generator set bus total positive kVARh accumulation	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40196	Genset Bus Total Net kVARh	Read Only	Multiplier: 1	Unit: kVARh	Generator set Bus total net kVARh accumulation	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: S			
40197	Genset Bus Total Net kVARh	Read Only	Multiplier: 1	Unit: kVARh	Generator set Bus total net kVARh accumulation	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: S			
40198	Ground Current	Read Only	Multiplier: 0.1	Unit: amps	Ground current	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40199	Genset Negative Sequence Current %	Read Only	Multiplier: 0.01	Unit: %	Genset Negative Sequence Current as Percent of Standby Current Rating	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40200	LVRT Counter	Read Only	Multiplier: 1	Unit:	Counter to keep track of number of LVRT Events	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65535		
			Sign: U			
40201	Coolant Temperature Sensor Type	Read Only	0: PGBU		Either PGBU(Onan) or EBU(Cummins) sensor. MODBUS Access: Read Only	PCC3300, PCC3300V2
			1: EBU			
40202	LVRT Enable Status	Read Only	0: Disabled		Displays whether the LVRT Functionality has been enabled to detect LVRT Events.	PCC3300, PCC3300V2
			1: Enabled			
40207	Battery Charger Alternator Flash Voltage	Read Only	Multiplier: 0.001	Unit: Vdc	The Battery Charger Alternator Flash Voltage after all scaling and validity checks.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 35		
			Sign: U			
40208	Battery 1 Voltage (Aux101)	Read Only	Multiplier: 0.01	Unit: Vdc	Battery 1 Voltage measured through AUX101. Applicable when multiple batteries are used.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 3850		
			Sign: U			
40209	Battery 2 Voltage (Aux101)	Read Only	Multiplier: 0.01	Unit: Vdc	Battery 2 Voltage measured through AUX101. Applicable when multiple batteries are used.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 3850		
			Sign: U			
40210	External Speed Bias Input	Read Only	Multiplier: 0.01	Unit: %	Monitor point for the external speed bias input.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: -100		
			Size (bits): 16	Upper Limit: 100		
			Sign: S			
40211	External Voltage Bias Input	Read Only	Multiplier: 0.01	Unit: %	Monitor point for the external voltage bias input.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: -100		
			Size (bits): 16	Upper Limit: 100		
			Sign: S			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40212	Battery 3 Voltage (Aux101)	Read Only	Multiplier: 0.01	Unit: Vdc	Battery 3 Voltage measured through AUX101. Applicable when multiple batteries are used.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 3850		
			Sign: U			
40213	Battery 4 Voltage (Aux101)	Read Only	Multiplier: 0.01	Unit: Vdc	Battery 4 Voltage measured through AUX101. Applicable when multiple batteries are used.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 3850		
			Sign: U			
40226	Speed Bias Output / Configurable Analog output #1 Output Predictor	Read Only	Multiplier: 0.01	Unit: Vdc	Configurable analog output voltage output value (predicted)	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
40227	Voltage Bias Output / Configurable Analog output #2 Output Predictor	Read Only	Multiplier: 0.01	Unit: Vdc	Configurable analog output voltage output value (predicted)	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
40228	Amber Warning Lamp Status	Read Only	0: Inactive		Engine Control System indicates a warning condition.	PCC3300, PCC2300, PCC3300V2
			1: Active			
40229	Barometric Absolute Pressure	Read Only	Multiplier: 0.1	Unit: psi	Monitor point for the Barometric Absolute Pressure. Displayed as "Ambient Pressure" in the HMI.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40230	Boost Pressure	Read Only	Multiplier: 0.1	Unit: psi	Monitor point for the Boost Absolute Pressure	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40231	CAN Datalink Status	Read Only	0: Inactive		Indicates the status of the CAN datalink	PCC3300, PCC2300, PCC3300V2
			1: Active			
			2: Failed			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40232	Crankcase Pressure	Read Only	Multiplier: 0.1	Unit: psi	Monitor point for the Crankcase Pressure.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: -35.67		
			Size (bits): 16	Upper Limit: 38		
			Sign: S			
40235	ECM Derate Request	Read Only	0: No Derate Request		Request made by the ECS for a reduction in load	PCC3300, PCC2300, PCC3300V2
			1: Derate Request			
			2: Error			
			3: Don't Care			
40236	Engine Application Type	Read Only	0: ECM		Monitor point for the output of the Engine application type. Either ECM (CAN) or Hydro-Mechanical.	PCC3300, PCC2300, PCC3300V2
			1: Hydro-Mechanical			
40238	PGI Major Version	Read Only	Multiplier: 1	Unit:	"Displays Power Generation Interface Major Version to which Engine Software is complying"	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 8	Upper Limit: 255		
			Sign: U			
40239	PGI Minor Version	Read Only	Multiplier: 1	Unit:	"Displays Power Generation Interface Minor Version to which Engine Software is complying"	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 8	Upper Limit: 255		
			Sign: U			
40240	PGI Informational Version	Read Only	Multiplier: 1	Unit:	"Displays Power Generation Interface Informational Version to which Engine Software is complying"	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 8	Upper Limit: 255		
			Sign: U			
40242	Aftercooler Temperature	Read Only	Multiplier: 0.1	Unit: degF	Monitor point for the Aftercooler Temperature.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: -40		
			Size (bits): 16	Upper Limit: 410		
			Sign: S			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40243	Internal ECM Module 1 Temperature	Read Only	Multiplier: 0.1	Unit: degF	"Internal temperature of the engine electronic control module 1"	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
40244	Internal ECM Module 2 Temperature	Read Only	Multiplier: 0.1	Unit: degF	"Internal temperature of the engine electronic control module 2"	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
40245	Internal ECM Module 3 Temperature	Read Only	Multiplier: 0.1	Unit: degF	"Internal temperature of the engine electronic control module 3"	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
40246	Internal ECM Module 4 Temperature	Read Only	Multiplier: 0.1	Unit: degF	"Internal temperature of the engine electronic control module 4"	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
40247	ECM Module 1 Battery Voltage	Read Only	Multiplier: 0.1	Unit: Vdc	"Engine Control Module 1 Battery Voltage."	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65535		
			Sign: U			
40248	ECM Module 2 Battery Voltage	Read Only	Multiplier: 0.1	Unit: Vdc	"Engine Control Module 2 Battery Voltage."	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65535		
			Sign: U			
40249	ECM Module 3 Battery Voltage	Read Only	Multiplier: 0.1	Unit: Vdc	"Engine Control Module 3 Battery Voltage."	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65535		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40250	ECM Module 4 Battery Voltage	Read Only	Multiplier: 0.1	Unit: Vdc	"Engine Control Module 4 Battery Voltage."	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65535		
			Sign: U			
40254	Fuel Supply Pressure	Read Only	Multiplier: 0.1	Unit: psi	"Monitor point for the Fuel Supply Pressure. Displayed as Fuel Supply Pressure in the HMI."	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 145		
			Sign: U			
40257	Intake Manifold 4 Temperature	Read Only	Multiplier: 0.1	Unit: degF	Monitor point for the Intake Manifold 4 Temperature	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: -40		
			Size (bits): 16	Upper Limit: 410		
			Sign: S			
40258	Fuel Outlet Pressure	Read Only	Multiplier: 0.1	Unit: psi	"Monitor point for the Fuel Outlet Pressure Pressure. Displayed as Fuel Rail Pressure in the HMI."	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40259	Fuel Outlet Pressure	Read Only	Multiplier: 0.1	Unit: psi	"Monitor point for the Fuel Outlet Pressure Pressure. Displayed as Fuel Rail Pressure in the HMI."	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40260	Intake Manifold 2 Temperature	Read Only	Multiplier: 0.1	Unit: degF	Monitor point for the Intake Manifold 2 Temperature	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: -40		
			Size (bits): 16	Upper Limit: 410		
			Sign: S			
40261	Intake Manifold 3 Temperature	Read Only	Multiplier: 0.1	Unit: degF	Monitor point for the Intake Manifold 3 Temperature	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: -40		
			Size (bits): 16	Upper Limit: 410		
			Sign: S			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40264	Percent Engine Torque/Duty Cycle	Read Only	Multiplier: 1	Unit: %	Monitor point for the percent engine torque output and the governor percent duty cycle output when used with the HM ECM	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
40276	Post-Filter Oil Pressure	Read Only	Multiplier: 0.1	Unit: psi	Monitor point for the Post-Filter Oil Pressure	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 145		
			Sign: U			
40277	Pre-Filter Oil Pressure	Read Only	Multiplier: 0.1	Unit: psi	Monitor point for the Pre-Filter Oil Pressure	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 145		
			Sign: U			
40278	Configurable Input #14 Switch	Read Only	0: Inactive		Configurable Input #14 input software state status. Gives software Inactive/Active state	PCC3300, PCC2300, PCC3300V2
			1: Active			
40279	Turbocharger 1 Speed	Read Only	Multiplier: 1	Unit: rpm	Monitor point for the Turbocharger 1 Speed	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40280	Turbocharger 1 Speed	Read Only	Multiplier: 1	Unit: rpm	Monitor point for the Turbocharger 1 Speed	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40281	Turbocharger 2 Boost Pressure	Read Only	Multiplier: 0.1	Unit: psi	Monitor point for the Turbocharger 2 Boost Pressure	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40282	Water in Fuel Indicator	Read Only	0: No		Water in Fuel Indication	PCC3300, PCC2300, PCC3300V2
			1: Yes			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40283	Controller Mode	Read Only	0: Off		The controller mode	PCC3300, PCC2300, PCC3300V2
			1: Ready			
			2: Setup			
			3: Starting			
			4: Idle			
			5: Rated			
			6: Stop Normal			
			7: Stop Emergency			
			8: Factory Test			
			9: Wait to Power Down			
			10: Regeneration			
40285	Power Down Mode Timer	Read Only	Multiplier: 1	Unit: seconds	Timer to count down the time before the control goes to sleep	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 600		
			Sign: U			
40290	Controller On Time	Read/Write	Multiplier: 1	Unit: Seconds	Controller ON time in seconds. Upper limit is 136 years.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 32	Upper Limit: 4294967295		
			Sign: U			
40291	Controller On Time	Read/Write	Multiplier: 1	Unit: Seconds	Controller ON time in seconds. Upper limit is 136 years.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 32	Upper Limit: 4294967295		
			Sign: U			
40298	Runs Since Reset	Read/Write	Multiplier: 1	Unit:	Number of runs since the last reset. Upper limit is $2^{32} - 1$.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 32	Upper Limit: 4294967290		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40299	Runs Since Reset	Read/Write	Multiplier: 1	Unit:	Number of runs since the last reset. Upper limit is $2^{32} - 1$.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 32	Upper Limit: 4294967290		
			Sign: U			
40300	Remote Start Switch (Modbus)	Read/Write	0: Inactive		Modbus Remote Start	PCC3300, PCC2300, PCC3300V2
			1: Active			
40301	Fault Reset (Modbus)	Read/Write	0: Inactive		Modbus fault reset.	PCC3300, PCC2300, PCC3300V2
			1: Active			
40320	Start Inhibit No1 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the operator panel when this fault becomes active	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40321	Start Inhibit No1 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the operator panel when this fault becomes active	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40322	Start Inhibit No1 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the operator panel when this fault becomes active	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40323	Start Inhibit No1 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the operator panel when this fault becomes active	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40324	Start Inhibit No1 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the operator panel when this fault becomes active	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40325	Start Inhibit No1 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the operator panel when this fault becomes active	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40326	Start Inhibit No1 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the operator panel when this fault becomes active	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40327	Start Inhibit No1 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the operator panel when this fault becomes active	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40328	Start Inhibit No1 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the operator panel when this fault becomes active	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40329	Start Inhibit No1 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the operator panel when this fault becomes active	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40330	Start Inhibit No1 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the operator panel when this fault becomes active	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40331	Start Inhibit No1 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the operator panel when this fault becomes active	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40332	Start Inhibit No1 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the operator panel when this fault becomes active	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40333	Start Inhibit No1 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the operator panel when this fault becomes active	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40334	Start Inhibit No1 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the operator panel when this fault becomes active	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40335	Start Inhibit No1 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the operator panel when this fault becomes active	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40336	Start Inhibit No1 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the operator panel when this fault becomes active	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40337	Start Inhibit No1 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the operator panel when this fault becomes active	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40338	Start Inhibit No1 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the operator panel when this fault becomes active	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40339	Start Inhibit No1 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the operator panel when this fault becomes active	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40340	Start Inhibit No2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40341	Start Inhibit No2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40342	Start Inhibit No2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40343	Start Inhibit No2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40344	Start Inhibit No2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40345	Start Inhibit No2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40346	Start Inhibit No2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40347	Start Inhibit No2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40348	Start Inhibit No2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40349	Start Inhibit No2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40350	Start Inhibit No2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40351	Start Inhibit No2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40352	Start Inhibit No2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40353	Start Inhibit No2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40354	Start Inhibit No2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40355	Start Inhibit No2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40356	Start Inhibit No2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40357	Start Inhibit No2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40358	Start Inhibit No2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40359	Start Inhibit No2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40360	Start Inhibit No3 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40361	Start Inhibit No3 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40362	Start Inhibit No3 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40363	Start Inhibit No3 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40364	Start Inhibit No3 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40365	Start Inhibit No3 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40366	Start Inhibit No3 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40367	Start Inhibit No3 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40368	Start Inhibit No3 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40369	Start Inhibit No3 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40370	Start Inhibit No3 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40371	Start Inhibit No3 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40372	Start Inhibit No3 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40373	Start Inhibit No3 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40374	Start Inhibit No3 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40375	Start Inhibit No3 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40376	Start Inhibit No3 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40377	Start Inhibit No3 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40378	Start Inhibit No3 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40379	Start Inhibit No3 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40380	Start Inhibit Modbus Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40381	Start Inhibit Modbus Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40382	Start Inhibit Modbus Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40383	Start Inhibit Modbus Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40384	Start Inhibit Modbus Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40385	Start Inhibit Modbus Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40386	Start Inhibit Modbus Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40387	Start Inhibit Modbus Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40388	Start Inhibit Modbus Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40389	Start Inhibit Modbus Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40390	Start Inhibit Modbus Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40391	Start Inhibit Modbus Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40392	Start Inhibit Modbus Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40393	Start Inhibit Modbus Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40394	Start Inhibit Modbus Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40395	Start Inhibit Modbus Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40396	Start Inhibit Modbus Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40397	Start Inhibit Modbus Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40398	Start Inhibit Modbus Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40399	Start Inhibit Modbus Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 20 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

TABLE 56.

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40500	Low Fuel Switch	Read Only	0: Inactive		Low Fuel input software state status. Gives software Inactive/Active state	PCC3300, PCC2300, PCC3300V2
			1: Active			
40501	Low Fuel/Configurable Input #6 Switch	Read Only	0: Inactive		This is the status of the Configurable Input #6.	PCC3300, PCC2300, PCC3300V2
			1: Active			
40503	Differential Fault Trip	Read Only	0: Inactive		Differential fault trip monitor point.	PCC3300, PCC3300V2
			1: Active			
			2: Reserved			
			3: Not Available			
40509	PTC Mode Switch	Read Only	0: Inactive		PTC Mode Switch function output status. Gives software Inactive/Active state	PCC3300, PCC3300V2
			1: Active			
40510	Extended Parallel/Configurable Input #32 Switch	Read Only	0: Inactive		This is the status of the Configurable Input #32.	PCC3300, PCC3300V2
			1: Active			
40512	Remote E-stop Switch	Read Only	0: Inactive		Remote E-stop input software state status. Gives software Inactive/Active state	PCC3300, PCC2300, PCC3300V2
			1: Active			

Modbus Address	Parameter/System Name	Modbus Access	Specifications		Description	Control Boards
40513	Remote Start Switch	Read Only	0: Inactive		Remote Start input software state status. Gives software Inactive/Active state	PCC3300, PCC2300, PCC3300V2
			1: Active			
40515	Retransfer Inhibit/Configurable Input #21 Switch	Read Only	0: Inactive		This is the status of the Configurable Input #21.	PCC3300, PCC3300V2
			1: Active			
40516	Rupture Basin Switch	Read Only	0: Inactive		Rupture Basin input software state status. Gives software Inactive/Active state	PCC3300, PCC2300, PCC3300V2
			1: Active			
40517	Rupture Basin/Configurable Input #12 Switch	Read Only	0: Inactive		This is the status of the Configurable Input #12.	PCC3300, PCC2300, PCC3300V2
			1: Active			
40519	Start Type Switch	Read Only	0: Inactive		Start Type input software state status. Gives software Inactive/Active state	PCC3300, PCC2300, PCC3300V2
			1: Active			
40521	Sync Enable/Configurable Input #30 Switch	Read Only	0: Inactive		This is the status of the Configurable Input #30.	PCC3300, PCC3300V2
			1: Active			
40524	Transfer Inhibit/Configurable Input #20 Switch	Read Only	0: Inactive		This is the status of the Configurable Input #20.	PCC3300, PCC3300V2
			1: Active			
40525	Utility CB Inhibit/Configurable Input #25 Switch	Read Only	0: Inactive		This is the status of the Configurable Input #25.	PCC3300, PCC3300V2
			1: Active			
40526	Utility CB Pos B/Configurable Input #23 Switch	Read Only	0: Inactive		This is the status of the Configurable Input #23.	PCC3300, PCC3300V2
			1: Active			
40527	Utility CB Tripped/Configurable Input #24 Switch	Read Only	0: Inactive		This is the status of the Configurable Input #24.	PCC3300, PCC3300V2
			1: Active			
40528	Utility Single Mode Verify/Configurable Input #29 Switch	Read Only	0: Inactive		This is the status of the Configurable Input #29.	PCC3300, PCC3300V2
			1: Active			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40530	Utility CB Pos A Switch	Read Only	0: Inactive		Utility CB Pos A input software state status. Gives software Inactive/Active state	PCC3300, PCC3300V2
			1: Active			
40531	Utility CB Pos B Switch	Read Only	0: Inactive		Utility CB Pos B input software state status. Gives software Inactive/Active state	PCC3300, PCC3300V2
			1: Active			
40535	Configurable Output #1 Status	Read Only	0: Inactive		Indicates if the output's status is Inactive or Active	PCC3300, PCC2300, PCC3300V2
			1: Active			
40536	Configurable Output #2 Status	Read Only	0: Inactive		Indicates if the output's status is Inactive or Active	PCC3300, PCC2300, PCC3300V2
			1: Active			
40537	Configurable Output #20 Status	Read Only	0: Inactive		Indicates if the output's status is Inactive or Active	PCC3300, PCC3300V2
			1: Active			
40538	Configurable Output #21 Status	Read Only	0: Inactive		Indicates if the output's status is Inactive or Active	PCC3300, PCC3300V2
			1: Active			
40539	Configurable Output #22 Status	Read Only	0: Inactive		Indicates if the output's status is Inactive or Active	PCC3300, PCC3300V2
			1: Active			
40540	Configurable Output #3 Status	Read Only	0: Inactive		Indicates if the output's status is Inactive or Active	PCC3300, PCC2300, PCC3300V2
			1: Active			
40541	Configurable Output #4 Status	Read Only	0: Inactive		Indicates if the output's status is Inactive or Active	PCC3300, PCC2300, PCC3300V2
			1: Active			
40542	Delayed Off / Configurable Output #10 Status	Read Only	0: Inactive		Indicates if the output's status is Inactive or Active	PCC3300, PCC2300, PCC3300V2
			1: Active			
40543	Fuel Shutoff Status	Read/Write	0: Inactive		Indicates if the output's status is Inactive or Active	PCC3300, PCC2300, PCC3300V2
			1: Active			
40547	Keyswitch Status	Read Only	0: Inactive		Indicates if the output's status is Inactive or Active	PCC3300, PCC2300, PCC3300V2
			1: Active			
40549	Load Dump / Configurable Output #11 Status	Read Only	0: Inactive		Indicates if the output's status is Inactive or Active	PCC3300, PCC2300, PCC3300V2
			1: Active			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40550	Local Status / Configurable Output #7 Status	Read Only	0: Inactive		Indicates if the output's status is Inactive or Active	PCC3300, PCC2300, PCC3300V2
			1: Active			
40552	Oil Priming Pump / Configurable Output #6 Status	Read Only	0: Inactive		Indicates if the output's status is Inactive or Active	PCC3300, PCC2300, PCC3300V2
			1: Active			
40553	Ready To Load /Configurable Output #5 Status	Read Only	0: Inactive		Indicates if the output's status is Inactive or Active	PCC3300, PCC2300, PCC3300V2
			1: Active			
40554	Run Relay #1 Status	Read Only	0: Inactive		Indicates if the output's status is Inactive or Active	PCC3300, PCC2300, PCC3300V2
			1: Active			
40555	Run Relay #2 Status	Read Only	0: Inactive		Indicates if the output's status is Inactive or Active	PCC3300, PCC2300, PCC3300V2
			1: Active			
40556	Speed/Voltage Bias Relay Status	Read Only	0: Inactive		Indicates if the output's status is Inactive or Active	PCC3300, PCC3300V2
			1: Active			
40561	Common Alarm Fault Status	Read Only	0: Inactive		The status of the Common Alarm Fault	PCC3300, PCC2300, PCC3300V2
			1: Active			
40562	Common Shutdown Command	Read Only	0: Inactive		The status of the common shutdown command	PCC3300, PCC2300, PCC3300V2
			1: Active			
40563	Common Shutdown Event Status	Read Only	0: Inactive		The status of the Common Shutdown Event	PCC3300, PCC2300, PCC3300V2
			1: Active			
40565	Common Warning Event Status	Read Only	0: Inactive		The status of the Common Warning Event	PCC3300, PCC2300, PCC3300V2
			1: Active			
40570	Fault Reset Command	Read Only	0: Inactive		One shot due to fault reset switch being active.	PCC3300, PCC2300, PCC3300V2
			1: Active			
40577	Base Frequency	Read Only	Multiplier: 0.001	Unit: Hz	Provides a point to monitor the base frequency	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40578	Base Frequency	Read Only	Multiplier: 0.001	Unit: Hz	Provides a point to monitor the base frequency	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40586	Excitation State	Read Only	0: Disabled		Shows the enable status of the excitation enabled = regulator on.	PCC3300, PCC2300, PCC3300V2
			1: Enabled			
40587	Exercise Command	Read Only	0: Inactive		The output of the Exercise Command OR logic	PCC3300, PCC2300, PCC3300V2
			1: Active			
			2: Reserved			
			3: Not Available			
40589	Exercise Time Remaining	Read Only	Multiplier: 0.1	Unit: hours	Time remaining until exercise stop sequence begins	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 25		
			Sign: U			
40592	Battle Short Command	Read Only	0: Inactive		Indicates status of battle short inputs	PCC3300, PCC2300, PCC3300V2
			1: Active			
40595	Final Frequency Reference	Read Only	Multiplier: 0.001	Unit: Hz	The frequency scaled version of the final speed reference	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 32	Upper Limit: 100		
			Sign: U			
40596	Final Frequency Reference	Read Only	Multiplier: 0.001	Unit: Hz	The frequency scaled version of the final speed reference	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 32	Upper Limit: 100		
			Sign: U			
40600	Configurable Input #1 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40601	Configurable Input #1 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40602	Configurable Input #1 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40603	Configurable Input #1 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40604	Configurable Input #1 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40605	Configurable Input #1 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40606	Configurable Input #1 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40607	Configurable Input #1 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40608	Configurable Input #1 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40609	Configurable Input #1 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40610	Configurable Input #1 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40611	Configurable Input #1 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40612	Configurable Input #1 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40613	Configurable Input #1 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40614	Configurable Input #1 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40615	Configurable Input #1 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40620	Configurable Input #2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40621	Configurable Input #2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40622	Configurable Input #2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40623	Configurable Input #2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40624	Configurable Input #2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40625	Configurable Input #2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40626	Configurable Input #2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40627	Configurable Input #2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40628	Configurable Input #2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40629	Configurable Input #2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40630	Configurable Input #2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40631	Configurable Input #2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40632	Configurable Input #2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40633	Configurable Input #2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40634	Configurable Input #2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40635	Configurable Input #2 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40640	Configurable Input #13 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40641	Configurable Input #13 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40642	Configurable Input #13 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40643	Configurable Input #13 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40644	Configurable Input #13 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40645	Configurable Input #13 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40646	Configurable Input #13 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40647	Configurable Input #13 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40648	Configurable Input #13 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40649	Configurable Input #13 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40650	Configurable Input #13 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40651	Configurable Input #13 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40652	Configurable Input #13 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40653	Configurable Input #13 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40654	Configurable Input #13 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40655	Configurable Input #13 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40660	Configurable Input #14 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40661	Configurable Input #14 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40662	Configurable Input #14 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40663	Configurable Input #14 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40664	Configurable Input #14 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40665	Configurable Input #14 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40666	Configurable Input #14 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40667	Configurable Input #14 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40668	Configurable Input #14 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40669	Configurable Input #14 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40670	Configurable Input #14 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40671	Configurable Input #14 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40672	Configurable Input #14 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40673	Configurable Input #14 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40674	Configurable Input #14 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40675	Configurable Input #14 Fault Text	Read/Write	Multiplier: 1	Unit:	Trim to define the 16 character string for use by the Operator panel when this fault becomes active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
40709	Device Type (Modlon)	Read Only	Multiplier: 1	Unit:	This modbus register is created for Modlon register mapping. This parameter is not associated with any logical.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 8	Upper Limit:		
			Sign: U			
40710	Control Switch Position (Modlon)	Read Only	0: Off		This modbus register is created for Modlon register mapping.	PCC3300, PCC3300V2
			1: Manual			
			2: Auto			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40711	Genset Run Sequence State (Modlon)	Read Only	0: Stop		This modbus register is created for Modlon register mapping.	PCC3300, PCC3300V2
			1: Time Delay to Start			
			2: Warmup at Idle			
			3: Rated Freq and Voltage			
			4: Cooldown / Stop Delay			
			5: Cooldown at Idle			
			6: Rated to Idle Transition Delay			
40712	Most Recent Fault or Warning (Modlon)	Read Only	Multiplier: 1	Unit: Fault Code	This modbus register is created for Modlon register mapping. This modbus register is not associated with any logical Address	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40713	Fault Type (Modlon)	Read Only	0: None		This modbus register is created for modlon register mapping. This modbus register is not associated with any logical address.	PCC3300, PCC3300V2
			1: Warning			
			2: Derate			
			3: Shutdown with Cooldown			
			4: Shutdown			
40714	Genset % Standby Total kW (Modlon)	Read Only	Multiplier: 0.5	Unit: %	This modbus register is created for modlon register mapping. Monitors the total generator set standby KW percentage output. Modbus has different multiplier than PCCnet. For Modlon use only, use multiplier 0.5 %	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40715	Genset Total kW (Modlon GenStatus)	Read Only	Multiplier: 1	Unit: kW	This modbus register is created for modlon register mapping. Generator set total kW.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			

TABLE 57.

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40716	NFPA 110 Logical Status (Modlon)	Read Only	Multiplier: 1	Unit:	This modbus register is created for modlon register mapping. 32-bit number to represent the status of the NFPA 110 logical. See NFPA110 bitmap.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40717	NFPA 110 Logical Status (Modlon)	Read Only	Multiplier: 1	Unit:	This modbus register is created for modlon register mapping. 32-bit number to represent the status of the NFPA 110 logical. See NFPA110 bitmap.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40718	Genset Frequency OP (Modlon)	Read Only	Multiplier: 0.1	Unit: Hz	This modbus register is created for modlon register mapping. Generator set Frequency OP. Modbus has different multiplier than PCCnet. For Modlon use only, Multiplier/Units = 0.1 Hz	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40719	Genset Total Power Factor (Modlon)	Read Only	Multiplier: 0.00005	Unit: PF	This modbus register is created for modlon register mapping. Generator set total power factor (L1+L2+L3). Modbus and PCCnet has different multiplier value. For Modlon, use 0.00005 PF.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
40720	Genset Total kVA (Modlon)	Read Only	Multiplier: 1	Unit: kVA	This modbus register is created for modlon register mapping. Generator set total kVA	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40721	Genset Total kW (Modlon GenACData)	Read Only	Multiplier: 1	Unit: kW	This modbus register is created for modlon register mapping. Generator set total kW in Gen AC Data.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40722	Genset Total kVAR (Modlon)	Read Only	Multiplier: 1	Unit: kVAR	This modbus register is created for modlon register mapping. Generator set total kVAR	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
40723	Genset L1L2 Voltage (Modlon)	Read Only	Multiplier: 1	Unit: Vac	This modbus register is created for modlon register mapping. Generator set L1L2 voltage	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40724	Genset L2L3 Voltage (Modlon)	Read Only	Multiplier: 1	Unit: Vac	This modbus register is created for modlon register mapping. Generator set L2L3 voltage	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40725	Genset L3L1 Voltage (Modlon)	Read Only	Multiplier: 1	Unit: Vac	This modbus register is created for modlon register mapping. Generator set L3L1 voltage	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40726	Genset L1N Voltage (Modlon)	Read Only	Multiplier: 1	Unit: Vac	This modbus register is created for modlon register mapping. Generator set L1N voltage	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40727	Genset L2N Voltage (Modlon)	Read Only	Multiplier: 1	Unit: Vac	This modbus register is created for modlon register mapping. Generator set L2N voltage	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40728	Genset L3N Voltage (Modlon)	Read Only	Multiplier: 1	Unit: Vac	This modbus register is created for modlon register mapping. Generator set L3N voltage	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40729	Genset L1 Current (Modlon)	Read Only	Multiplier: 1	Unit: Amps	This modbus register is created for modlon register mapping. Monitors the generator set L1 current value.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40730	Genset L2 Current (Modlon)	Read Only	Multiplier: 1	Unit: Amps	This modbus register is created for modlon register mapping. Generator set L2 current	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40731	Genset L3 Current (Modlon)	Read Only	Multiplier: 1	Unit: Amps	This modbus register is created for modlon register mapping. Generator set L3 current	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40732	Genset % Standby L1 Current (Modlon)	Read Only	Multiplier: 0.5	Unit: %	This modbus register is created for modlon register mapping. Monitors the generator set standby L1 current percentage output. Modbus and PCCnet have different multiplier value. For modlon use 0.5 %	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40733	Genset % Standby L2 Current (Modlon)	Read Only	Multiplier: 0.5	Unit: %	This modbus register is created for modlon register mapping. Monitors the generator set standby L2 current percentage output. Modbus and PCCnet has different multiplier value. For Modlon, use 0.5 %	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40734	Genset % Standby L3 Current (Modlon)	Read Only	Multiplier: 0.5	Unit: %	This modbus register is created for modlon register mapping. Monitors the generator set standby L3 current percentage output. Modbus and PCCnet has different multiplier value. For Modlon use 0.5 %	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40735	Battery Voltage (Modlon)	Read Only	Multiplier: 0.1	Unit: Vdc	This modbus register is created for modlon register mapping. Battery voltage value. Modbus and PCCnet has different multiplier value. For Modlon use 0.1Volts	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40736	Oil Pressure (Modlon)	Read Only	Multiplier: 0.1	Unit: kPa	This modbus register is created for modlon register mapping. Monitor point for the Oil Pressure. Modbus and PCCnet have different multiplier value. For modlon, use 0.1 KPA	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40737	Oil Temperature (Modlon)	Read Only	Multiplier: 0.1	Unit: degK	This modbus register is created for modlon register mapping. Monitor point for the Oil Temperature. Modbus and PCCnet has different multiplier value. For Modlon use 0.1 deg Kelvin	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
40738	Coolant Temperature (Modlon)	Read Only	Multiplier: 0.1	Unit: degK	This modbus register is created for modlon register mapping. Monitor point for the Coolant Temperature. Modbus and PCCnet has different multiplier value. For Modlon, use 0.1deg Kelvin.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
40739	Intake Manifold Temperature (Modlon)	Read Only	Multiplier: 0.1	Unit: degK	This modbus register is created for modlon register mapping. To monitor Intake Manifold Temperature. Modbus and PCCnet has different multiplier value. For Modlon, use 0.1 deg Kelvin	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: -40		
			Size (bits): 16	Upper Limit: 410		
			Sign: S			
40740	Fuel Temperature (Modlon)	Read Only	Multiplier: 0.1	Unit: degK	This modbus register is created for modlon register mapping. Monitor point for the Fuel Temperature. Modbus and PCCnet has different multiplier value. For Modlon, use 0.1 deg Kelvin.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: -40		
			Size (bits): 16	Upper Limit: 410		
			Sign: S			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40741	Fuel Rate (Modlon)	Read Only	Multiplier: 0.01	Unit: gal/hr	This modbus register is created for modlon register mapping. Monitor point for the Fuel Rate. Modbus and PCCnet has different multiplier value. For Modlon, use 0.01 gph	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40742	Average Engine Speed (Modlon)	Read Only	Multiplier: 1	Unit: rpm	This modbus register is created for modlon register mapping. Monitor point for the Average Engine Speed. Modbus and PCCnet have different multiplier value. For Modlon, use 1 rpm.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40743	Total Number of Runs (Modlon)	Read Only	Multiplier: 1	Unit:	This modbus register is created for modlon register mapping. Total number of generator set runs.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 32	Upper Limit: 4294967295		
			Sign: U			
40744	Engine Running Time (Modlon)	Read Only	Multiplier: 0.1	Unit: seconds	This modbus register is created for modlon register mapping. Total engine run time. Modbus has different multiplier than PCCnet. For Modbus, use 0.1 sec	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40745	Engine Running Time (Modlon)	Read Only	Multiplier: 0.1	Unit: seconds	This modbus register is created for modlon register mapping. Total engine run time. Modbus has different multiplier than PCCnet. For Modbus, use 0.1 sec	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40746	Genset Total Net kWh (Modlon)	Read Only	Multiplier: 1	Unit: kWh	This modbus register is created for modlon register mapping. Generator set total net kWh accumulation	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: -2147483648		
			Size (bits): 32	Upper Limit: 2147483643		
			Sign: S			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40747	Genset Total Net kWh (Modlon)	Read Only	Multiplier: 1	Unit: kWh	This modbus register is created for modlon register mapping. Generator set total net kWh accumulation	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: -2147483648		
			Size (bits): 32	Upper Limit: 2147483643		
			Sign: S			
40748	Total Fuel Consumption (Modlon)	Read Only	Multiplier: 0.01	Unit: gallons	This modbus register is created for modlon register mapping. Total fuel consumption since start of engine. Modbus and PCCnet has different multiplier value. For Modlon, use 0.01 Gallons	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40749	Total Fuel Consumption (Modlon)	Read Only	Multiplier: 0.01	Unit: gallons	This modbus register is created for modlon register mapping. Total fuel consumption since start of engine. Modbus and PCCnet has different multiplier value. For Modlon, use 0.01 Gallons	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
40750	Utility/Genset Bus Frequency (Modlon)	Read Only	Multiplier: 0.1	Unit: Hz	This modbus register is created for modlon register mapping. Utility line frequency or Generator set Bus Frequency depending on Paralleling Application. Modbus and PCCnet has different multiplier value. For Modlon, use 0.1 Hz.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40751	Utility/Genset Bus L1L2 Voltage (Modlon)	Read Only	Multiplier: 1	Unit: Vac	This modbus register is created for modlon register mapping. Utility L1L2 Voltage or Generator set Bus L1L2 voltage depending on paralleling application.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40752	Utility/Genset Bus L2L3 Voltage (Modlon)	Read Only	Multiplier: 1	Unit: Vac	This modbus register is created for modlon register mapping. Utility L2L3 voltage	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40753	Utility/Genset Bus L3L1 Voltage (Modlon)	Read Only	Multiplier: 1	Unit: Vac	This modbus register is created for modlon register mapping. Utility L3L1 voltage or Generator set Bus L3L1 voltage depending on paralleling application.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40754	Utility/Genset Bus L1N Voltage (Modlon)	Read Only	Multiplier: 1	Unit: Vac	This modbus register is created for modlon register mapping. Utility L1N voltage or Generator set Bus L1N voltage depending on paralleling application.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40755	Utility/Genset Bus L2N Voltage (Modlon)	Read Only	Multiplier: 1	Unit: Vac	This modbus register is created for modlon register mapping. Utility L2N voltage or Generator set Bus L2N voltage depending on paralleling application.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40756	Utility/Genset Bus L3N Voltage (Modlon)	Read Only	Multiplier: 1	Unit: Vac	This modbus register is created for modlon register mapping. Utility L3N voltage or Generator set Bus L3N voltage depending on paralleling application.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
40757	Customer Faults (Modlon)	Read Only	Multiplier: 1	Unit:	This modbus register is created for modlon register mapping. 16 bit fault bitmap for modbus interface.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: S			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40760	ES State (Modlon)	Read Only	0: Standby		This modbus register is created for modlon register mapping. Internal paralleling status variable	PCC3300, PCC3300V2
			1: Dead Bus			
			2: Synchronize			
			3: Load Share			
			4: Load Govern			
40761	Load Demand Stop Command (Modlon)	Read Only	0: Inactive		This modbus register is created for modlon register mapping. Modbus input for load demand stop command.	PCC3300, PCC3300V2
			1: Active			
40764	Genset CB Position Status (Modlon)	Read Only	0: Open		This modbus register is created for modlon register mapping. indicates generator set breaker position	PCC3300, PCC3300V2
			1: Closed			
			2: Not Available			
40765	Utility CB Position Status (Modlon)	Read Only	0: Open		This modbus register is created for modlon register mapping. indicates utility breaker position	PCC3300, PCC3300V2
			1: Closed			
			2: Not Available			
40766	Remote Start Switch (Modlon)	Read/Write	0: Inactive		This modbus register is created for modlon register mapping. Modbus Remote Start	PCC3300, PCC3300V2
			1: Active			
40767	Fault Reset (Modlon)	Read/Write	0: Inactive		This modbus register is created for modlon register mapping. Modbus fault reset.	PCC3300, PCC3300V2
			1: Active			
40768	System Network Datalink Status	Read Only	0: Inactive		Indicates communication status of the local generator set on System Network (used for load demand).	PCC3300, PCC3300V2
			1: Active			
			2: Failed			
40769	Load Demand Genset Run Hours	Read/Write	Multiplier: 0.1	Unit: hours	Run hour accumulator used for load demand run hour equalization. This is writable.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 32	Upper Limit: 999999.9		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40770	Load Demand Genset Run Hours	Read/Write	Multiplier: 0.1	Unit: hours	Run hour accumulator used for load demand run hour equalization. This is writable.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 32	Upper Limit: 999999.9		
			Sign: U			
40771	Load Demand Spare Capacity Request Status	Read Only	0: Inactive		Indicates the status of the spare capacity request input. When ACTIVE additional spare capacity (set by Load Demand Spare Capacity Request Value) is requested.	PCC3300, PCC3300V2
			1: Active			
40772	System Network Termination Resistor Switch Status	Read Only	0: OFF		Indicates the status of the on-board CAN termination resistor switch (S1).	PCC3300, PCC3300V2
			1: ON			
			2: Reserved			
			3: N/A			
			4: Network Failure			
40773	Genset ID	Read/Write	0: Gen1		Generator set identifier. All load demand generator sets must have a unique Generator set ID.	PCC3300, PCC3300V2
			1: Gen2			
			2: Gen3			
			3: Gen4			
			4: Gen5			
			5: Gen6			
			6: Gen7			
			7: Gen8			
			8: Gen9			
			9: Gen10			
			10: Gen11			
			11: Gen12			
			12: Gen13			
			13: Gen14			
			14: Gen15			
			15: Gen16			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40774	Load Demand Spare Capacity Request Value	Read/Write	Multiplier: 1	Unit: kW	Sets the kW value of additional capacity to be requested from the system when the Load Demand Spare Capacity Request Status is YES.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 32	Upper Limit: 80000		
			Sign: U			
40775	Load Demand Spare Capacity Request Value	Read/Write	Multiplier: 1	Unit: kW	Sets the kW value of additional capacity to be requested from the system when the Load Demand Spare Capacity Request Status is YES.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 32	Upper Limit: 80000		
			Sign: U			
40776	Load Demand Genset Enable	Read/Write	0: Disable		Disables or Enables load demand on this genset only. When set to disable the genset is not included in the load demand system and can be removed without triggering a com error.	PCC3300, PCC3300V2
			1: Enable			
40777	System Settings Status	Read Only	0: Out of Sync		Indicates whether the system settings on the local genset are in sync with ones from other genset in the network.	PCC3300, PCC3300V2
			1: In Sync			
			2: Standalone			
40778	ECM 2 Code	Read Only	Multiplier: 1	Unit:	"ECM 2 Calibration ID (DM19)"	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 88	Upper Limit:		
			Sign: C			
40779	ECM 2 Code	Read Only	Multiplier: 1	Unit:	"ECM 2 Calibration ID (DM19)"	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 88	Upper Limit:		
			Sign: C			
40780	ECM 2 Code	Read Only	Multiplier: 1	Unit:	"ECM 2 Calibration ID (DM19)"	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 88	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40781	ECM 2 Code	Read Only	Multiplier: 1	Unit:	"ECM 2 Calibration ID (DM19)"	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 88	Upper Limit:		
			Sign: C			
40782	ECM 2 Code	Read Only	Multiplier: 1	Unit:	"ECM 2 Calibration ID (DM19)"	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 88	Upper Limit:		
			Sign: C			
40783	ECM 2 Code	Read Only	Multiplier: 1	Unit:	"ECM 2 Calibration ID (DM19)"	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 88	Upper Limit:		
			Sign: C			
40784	ECM 2 Code	Read Only	Multiplier: 1	Unit:	"ECM 2 Calibration ID (DM19)"	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 88	Upper Limit:		
			Sign: C			
40785	ECM 2 Code	Read Only	Multiplier: 1	Unit:	"ECM 2 Calibration ID (DM19)"	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 88	Upper Limit:		
			Sign: C			
40786	ECM 2 Code	Read Only	Multiplier: 1	Unit:	"ECM 2 Calibration ID (DM19)"	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 88	Upper Limit:		
			Sign: C			
40787	ECM 2 Code	Read Only	Multiplier: 1	Unit:	"ECM 2 Calibration ID (DM19)"	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 88	Upper Limit:		
			Sign: C			
40788	ECM 3 Code	Read Only	Multiplier: 1	Unit:	"ECM 3 Calibration ID (DM19)"	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 88	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40789	ECM 3 Code	Read Only	Multiplier: 1	Unit:	"ECM 3 Calibration ID (DM19)"	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 88	Upper Limit:		
			Sign: C			
40790	ECM 3 Code	Read Only	Multiplier: 1	Unit:	"ECM 3 Calibration ID (DM19)"	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 88	Upper Limit:		
			Sign: C			
40791	ECM 3 Code	Read Only	Multiplier: 1	Unit:	"ECM 3 Calibration ID (DM19)"	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 88	Upper Limit:		
			Sign: C			
40792	ECM 3 Code	Read Only	Multiplier: 1	Unit:	"ECM 3 Calibration ID (DM19)"	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 88	Upper Limit:		
			Sign: C			
40793	ECM 3 Code	Read Only	Multiplier: 1	Unit:	"ECM 3 Calibration ID (DM19)"	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 88	Upper Limit:		
			Sign: C			
40794	ECM 3 Code	Read Only	Multiplier: 1	Unit:	"ECM 3 Calibration ID (DM19)"	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 88	Upper Limit:		
			Sign: C			
40795	ECM 3 Code	Read Only	Multiplier: 1	Unit:	"ECM 3 Calibration ID (DM19)"	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 88	Upper Limit:		
			Sign: C			
40796	ECM 3 Code	Read Only	Multiplier: 1	Unit:	"ECM 3 Calibration ID (DM19)"	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 88	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40797	ECM 3 Code	Read Only	Multiplier: 1	Unit:	"ECM 3 Calibration ID (DM19)"	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 88	Upper Limit:		
			Sign: C			
40800	Aux101 1 Input 8 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40801	Aux101 1 Input 8 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40802	Aux101 1 Input 8 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40803	Aux101 1 Input 8 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40804	Aux101 1 Input 8 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40805	Aux101 1 Input 8 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40806	Aux101 1 Input 8 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40807	Aux101 1 Input 8 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40808	Aux101 1 Input 8 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40809	Aux101 1 Input 8 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40810	Aux101 1 Input 8 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40811	Aux101 1 Input 8 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40812	Aux101 1 Input 8 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40813	Aux101 1 Input 8 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40814	Aux101 1 Input 8 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40815	Aux101 1 Input 8 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40816	Aux101 1 Input 8 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40817	Aux101 1 Input 8 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40818	Aux101 1 Input 8 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40819	Aux101 1 Input 8 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40820	Aux101 1 Input 7 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40821	Aux101 1 Input 7 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40822	Aux101 1 Input 7 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40823	Aux101 1 Input 7 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40824	Aux101 1 Input 7 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40825	Aux101 1 Input 7 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40826	Aux101 1 Input 7 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40827	Aux101 1 Input 7 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40828	Aux101 1 Input 7 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40829	Aux101 1 Input 7 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40830	Aux101 1 Input 7 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40831	Aux101 1 Input 7 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40832	Aux101 1 Input 7 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40833	Aux101 1 Input 7 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40834	Aux101 1 Input 7 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40835	Aux101 1 Input 7 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40836	Aux101 1 Input 7 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40837	Aux101 1 Input 7 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40838	Aux101 1 Input 7 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40839	Aux101 1 Input 7 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40840	Aux102 0 Fault 9 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40841	Aux102 0 Fault 9 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40842	Aux102 0 Fault 9 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40843	Aux102 0 Fault 9 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40844	Aux102 0 Fault 9 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40845	Aux102 0 Fault 9 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40846	Aux102 0 Fault 9 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40847	Aux102 0 Fault 9 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40848	Aux102 0 Fault 9 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40849	Aux102 0 Fault 9 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40850	Aux102 0 Fault 9 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40851	Aux102 0 Fault 9 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40852	Aux102 0 Fault 9 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40853	Aux102 0 Fault 9 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40854	Aux102 0 Fault 9 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40855	Aux102 0 Fault 9 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40856	Aux102 0 Fault 9 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40857	Aux102 0 Fault 9 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40858	Aux102 0 Fault 9 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40859	Aux102 0 Fault 9 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40860	Aux102 0 Fault 10 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40861	Aux102 0 Fault 10 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40862	Aux102 0 Fault 10 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40863	Aux102 0 Fault 10 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40864	Aux102 0 Fault 10 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40865	Aux102 0 Fault 10 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40866	Aux102 0 Fault 10 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40867	Aux102 0 Fault 10 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40868	Aux102 0 Fault 10 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40869	Aux102 0 Fault 10 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40870	Aux102 0 Fault 10 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40871	Aux102 0 Fault 10 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40872	Aux102 0 Fault 10 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40873	Aux102 0 Fault 10 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40874	Aux102 0 Fault 10 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40875	Aux102 0 Fault 10 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40876	Aux102 0 Fault 10 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40877	Aux102 0 Fault 10 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40878	Aux102 0 Fault 10 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40879	Aux102 0 Fault 10 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40880	Aux102 0 Fault 11 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40881	Aux102 0 Fault 11 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40882	Aux102 0 Fault 11 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40883	Aux102 0 Fault 11 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40884	Aux102 0 Fault 11 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40885	Aux102 0 Fault 11 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40886	Aux102 0 Fault 11 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40887	Aux102 0 Fault 11 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40888	Aux102 0 Fault 11 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40889	Aux102 0 Fault 11 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40890	Aux102 0 Fault 11 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40891	Aux102 0 Fault 11 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40892	Aux102 0 Fault 11 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40893	Aux102 0 Fault 11 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40894	Aux102 0 Fault 11 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40895	Aux102 0 Fault 11 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40896	Aux102 0 Fault 11 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40897	Aux102 0 Fault 11 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40898	Aux102 0 Fault 11 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40899	Aux102 0 Fault 11 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40900	Aux102 0 Fault 12 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40901	Aux102 0 Fault 12 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40902	Aux102 0 Fault 12 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40903	Aux102 0 Fault 12 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40904	Aux102 0 Fault 12 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40905	Aux102 0 Fault 12 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40906	Aux102 0 Fault 12 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40907	Aux102 0 Fault 12 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40908	Aux102 0 Fault 12 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40909	Aux102 0 Fault 12 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40910	Aux102 0 Fault 12 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40911	Aux102 0 Fault 12 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40912	Aux102 0 Fault 12 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40913	Aux102 0 Fault 12 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40914	Aux102 0 Fault 12 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

TABLE 58.

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40915	Aux102 0 Fault 12 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40916	Aux102 0 Fault 12 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40917	Aux102 0 Fault 12 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40918	Aux102 0 Fault 12 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40919	Aux102 0 Fault 12 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40920	Aux102 1 Fault 9 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40921	Aux102 1 Fault 9 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40922	Aux102 1 Fault 9 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40923	Aux102 1 Fault 9 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40924	Aux102 1 Fault 9 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40925	Aux102 1 Fault 9 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40926	Aux102 1 Fault 9 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40927	Aux102 1 Fault 9 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40928	Aux102 1 Fault 9 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40929	Aux102 1 Fault 9 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40930	Aux102 1 Fault 9 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40931	Aux102 1 Fault 9 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40932	Aux102 1 Fault 9 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40933	Aux102 1 Fault 9 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40934	Aux102 1 Fault 9 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40935	Aux102 1 Fault 9 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40936	Aux102 1 Fault 9 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40937	Aux102 1 Fault 9 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40938	Aux102 1 Fault 9 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40939	Aux102 1 Fault 9 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40940	Aux102 1 Fault 10 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40941	Aux102 1 Fault 10 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40942	Aux102 1 Fault 10 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40943	Aux102 1 Fault 10 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40944	Aux102 1 Fault 10 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40945	Aux102 1 Fault 10 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40946	Aux102 1 Fault 10 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40947	Aux102 1 Fault 10 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40948	Aux102 1 Fault 10 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40949	Aux102 1 Fault 10 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40950	Aux102 1 Fault 10 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40951	Aux102 1 Fault 10 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40952	Aux102 1 Fault 10 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40953	Aux102 1 Fault 10 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40954	Aux102 1 Fault 10 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40955	Aux102 1 Fault 10 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40956	Aux102 1 Fault 10 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40957	Aux102 1 Fault 10 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40958	Aux102 1 Fault 10 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40959	Aux102 1 Fault 10 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40960	Aux102 1 Fault 11 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40961	Aux102 1 Fault 11 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40962	Aux102 1 Fault 11 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40963	Aux102 1 Fault 11 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40964	Aux102 1 Fault 11 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40965	Aux102 1 Fault 11 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40966	Aux102 1 Fault 11 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40967	Aux102 1 Fault 11 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40968	Aux102 1 Fault 11 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40969	Aux102 1 Fault 11 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40970	Aux102 1 Fault 11 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40971	Aux102 1 Fault 11 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40972	Aux102 1 Fault 11 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40973	Aux102 1 Fault 11 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40974	Aux102 1 Fault 11 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40975	Aux102 1 Fault 11 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40976	Aux102 1 Fault 11 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40977	Aux102 1 Fault 11 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40978	Aux102 1 Fault 11 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40979	Aux102 1 Fault 11 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40980	Aux102 1 Fault 12 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40981	Aux102 1 Fault 12 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40982	Aux102 1 Fault 12 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40983	Aux102 1 Fault 12 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40984	Aux102 1 Fault 12 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40985	Aux102 1 Fault 12 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40986	Aux102 1 Fault 12 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40987	Aux102 1 Fault 12 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40988	Aux102 1 Fault 12 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40989	Aux102 1 Fault 12 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40990	Aux102 1 Fault 12 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40991	Aux102 1 Fault 12 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40992	Aux102 1 Fault 12 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40993	Aux102 1 Fault 12 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40994	Aux102 1 Fault 12 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40995	Aux102 1 Fault 12 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40996	Aux102 1 Fault 12 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40997	Aux102 1 Fault 12 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
40998	Aux102 1 Fault 12 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
40999	Aux102 1 Fault 12 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
41000	Load Demand System Enable	Read/Write	0: Disable		Disables or Enables load demand operation of all connected gensets.	PCC3300, PCC3300V2
			1: Enable			
41001	Load Demand Type	Read/Write	0: Run Hours Equalization		Sets the sequencing priority for load demand.	PCC3300, PCC3300V2
			1: Fixed Sequence			
41002	Load Demand Threshold Method	Read/Write	0: kW		Sets whether the load demand start/stop control is based on a relative (%) or absolute (kW) threshold.	PCC3300, PCC3300V2
			1: %kW			
41003	Load Demand Start Threshold (%kW)	Read/Write	Multiplier: 1	Unit: %	When the ratio of load to capacity is greater than this value the next genset will start. Must be greater than Load Demand Stop Threshold by at least 5%.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 25		
			Size (bits): 8	Upper Limit: 100		
			Sign: U			
41004	Load Demand Start Threshold (kW)	Read/Write	Multiplier: 1	Unit: kW	When surplus capacity is less than this value the next genset will start. Must be less than Load Demand Stop Threshold (kW).	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 5		
			Size (bits): 16	Upper Limit: 5000		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41005	Load Demand Stop Threshold (%kW)	Read/Write	Multiplier: 1	Unit: %	When the ratio of load to capacity is less than this value the next genset will stop. Must be less than Load Demand Start Threshold by at least 5%.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 20		
			Size (bits): 8	Upper Limit: 95		
			Sign: U			
41006	Load Demand Stop Threshold (kW)	Read/Write	Multiplier: 1	Unit: kW	When surplus capacity is greater than this value the next genset will stop. Must be greater than Load Demand Start Threshold (kW).	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 5		
			Size (bits): 16	Upper Limit: 5000		
			Sign: U			
41007	Load Demand Run Hours Differential	Read/Write	Multiplier: 1	Unit: hours	When the difference between Load Demand Genset Run Hours between any running genset and any stopped genset reaches this value the stopped genset will be started.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 1		
			Size (bits): 16	Upper Limit: 250		
			Sign: U			
41008	Load Demand Genset Fail Delay	Read/Write	Multiplier: 1	Unit: seconds	Sets the time delay that the system waits for a genset to come online before declaring it as failed.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 10		
			Size (bits): 16	Upper Limit: 900		
			Sign: U			
41009	Load Demand Initial Delay	Read/Write	Multiplier: 1	Unit: seconds	Sets the time delay before gensets are allowed to stop after initial start or after resuming halted load demand.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 60		
			Size (bits): 16	Upper Limit: 1500		
			Sign: U			
41010	Load Demand Start Delay	Read/Write	Multiplier: 1	Unit: seconds	Sets the time delay before next genset is allowed to start.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 1500		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41011	Load Demand Stop Delay	Read/Write	Multiplier: 1	Unit: seconds	Sets the time delay before next genset is allowed to stop.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 60		
			Size (bits): 16	Upper Limit: 1500		
			Sign: U			
41012	Clear Lost Gensets Local	Read/Write	0: No		When set to YES all gensets in state "Lost" will change to state "Gen Does Not Exist" in order to clear Lost Genset Warning.	PCC3300, PCC3300V2
			1: Yes			
41013	Load Demand Fixed Priority 1	Read Only	0: Gen1		Assigns a genset to fixed priority 1. Used when Load Demand Type is set to Fixed Sequence.	PCC3300, PCC3300V2
			1: Gen2			
			2: Gen3			
			3: Gen4			
			4: Gen5			
			5: Gen6			
			6: Gen7			
			7: Gen8			
			8: Gen9			
			9: Gen10			
			10: Gen11			
			11: Gen12			
			12: Gen13			
			13: Gen14			
			14: Gen15			
			15: Gen16			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41014	Load Demand Fixed Priority 2	Read Only	0: Gen1		Assigns a genset to fixed priority 2. Used when Load Demand Type is set to Fixed Sequence.	PCC3300, PCC3300V2
			1: Gen2			
			2: Gen3			
			3: Gen4			
			4: Gen5			
			5: Gen6			
			6: Gen7			
			7: Gen8			
			8: Gen9			
			9: Gen10			
			10: Gen11			
			11: Gen12			
			12: Gen13			
			13: Gen14			
			14: Gen15			
			15: Gen16			
41015	Load Demand Fixed Priority 3	Read Only	0: Gen1		Assigns a genset to fixed priority 3. Used when Load Demand Type is set to Fixed Sequence.	PCC3300, PCC3300V2
			1: Gen2			
			2: Gen3			
			3: Gen4			
			4: Gen5			
			5: Gen6			
			6: Gen7			
			7: Gen8			
			8: Gen9			
			9: Gen10			
			10: Gen11			
			11: Gen12			
			12: Gen13			
			13: Gen14			
			14: Gen15			
			15: Gen16			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41016	Load Demand Fixed Priority 4	Read Only	0: Gen1		Assigns a genset to fixed priority 4. Used when Load Demand Type is set to Fixed Sequence.	PCC3300, PCC3300V2
			1: Gen2			
			2: Gen3			
			3: Gen4			
			4: Gen5			
			5: Gen6			
			6: Gen7			
			7: Gen8			
			8: Gen9			
			9: Gen10			
			10: Gen11			
			11: Gen12			
			12: Gen13			
			13: Gen14			
			14: Gen15			
			15: Gen16			
41017	Load Demand Fixed Priority 5	Read Only	0: Gen1		Assigns a genset to fixed priority 5. Used when Load Demand Type is set to Fixed Sequence.	PCC3300, PCC3300V2
			1: Gen2			
			2: Gen3			
			3: Gen4			
			4: Gen5			
			5: Gen6			
			6: Gen7			
			7: Gen8			
			8: Gen9			
			9: Gen10			
			10: Gen11			
			11: Gen12			
			12: Gen13			
			13: Gen14			
			14: Gen15			
			15: Gen16			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41018	Load Demand Fixed Priority 6	Read Only	0: Gen1		Assigns a genset to fixed priority 6. Used when Load Demand Type is set to Fixed Sequence.	PCC3300, PCC3300V2
			1: Gen2			
			2: Gen3			
			3: Gen4			
			4: Gen5			
			5: Gen6			
			6: Gen7			
			7: Gen8			
			8: Gen9			
			9: Gen10			
			10: Gen11			
			11: Gen12			
			12: Gen13			
			13: Gen14			
			14: Gen15			
			15: Gen16			
41019	Load Demand Fixed Priority 7	Read Only	0: Gen1		Assigns a genset to fixed priority 7. Used when Load Demand Type is set to Fixed Sequence.	PCC3300, PCC3300V2
			1: Gen2			
			2: Gen3			
			3: Gen4			
			4: Gen5			
			5: Gen6			
			6: Gen7			
			7: Gen8			
			8: Gen9			
			9: Gen10			
			10: Gen11			
			11: Gen12			
			12: Gen13			
			13: Gen14			
			14: Gen15			
			15: Gen16			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41020	Load Demand Fixed Priority 8	Read Only	0: Gen1		Assigns a genset to fixed priority 8. Used when Load Demand Type is set to Fixed Sequence.	PCC3300, PCC3300V2
			1: Gen2			
			2: Gen3			
			3: Gen4			
			4: Gen5			
			5: Gen6			
			6: Gen7			
			7: Gen8			
			8: Gen9			
			9: Gen10			
			10: Gen11			
			11: Gen12			
			12: Gen13			
			13: Gen14			
			14: Gen15			
			15: Gen16			
41021	Load Demand Fixed Priority 9	Read Only	0: Gen1		Assigns a genset to fixed priority 9. Used when Load Demand Type is set to Fixed Sequence.	PCC3300, PCC3300V2
			1: Gen2			
			2: Gen3			
			3: Gen4			
			4: Gen5			
			5: Gen6			
			6: Gen7			
			7: Gen8			
			8: Gen9			
			9: Gen10			
			10: Gen11			
			11: Gen12			
			12: Gen13			
			13: Gen14			
			14: Gen15			
			15: Gen16			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41022	Load Demand Fixed Priority 10	Read Only	0: Gen1		Assigns a genset to fixed priority 10. Used when Load Demand Type is set to Fixed Sequence.	PCC3300, PCC3300V2
			1: Gen2			
			2: Gen3			
			3: Gen4			
			4: Gen5			
			5: Gen6			
			6: Gen7			
			7: Gen8			
			8: Gen9			
			9: Gen10			
			10: Gen11			
			11: Gen12			
			12: Gen13			
			13: Gen14			
			14: Gen15			
			15: Gen16			
41023	Load Demand Fixed Priority 11	Read Only	0: Gen1		Assigns a genset to fixed priority 11. Used when Load Demand Type is set to Fixed Sequence.	PCC3300, PCC3300V2
			1: Gen2			
			2: Gen3			
			3: Gen4			
			4: Gen5			
			5: Gen6			
			6: Gen7			
			7: Gen8			
			8: Gen9			
			9: Gen10			
			10: Gen11			
			11: Gen12			
			12: Gen13			
			13: Gen14			
			14: Gen15			
			15: Gen16			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41024	Load Demand Fixed Priority 12	Read Only	0: Gen1		Assigns a genset to fixed priority 12. Used when Load Demand Type is set to Fixed Sequence.	PCC3300, PCC3300V2
			1: Gen2			
			2: Gen3			
			3: Gen4			
			4: Gen5			
			5: Gen6			
			6: Gen7			
			7: Gen8			
			8: Gen9			
			9: Gen10			
			10: Gen11			
			11: Gen12			
			12: Gen13			
			13: Gen14			
			14: Gen15			
			15: Gen16			
41025	Load Demand Fixed Priority 13	Read Only	0: Gen1		Assigns a genset to fixed priority 13. Used when Load Demand Type is set to Fixed Sequence.	PCC3300, PCC3300V2
			1: Gen2			
			2: Gen3			
			3: Gen4			
			4: Gen5			
			5: Gen6			
			6: Gen7			
			7: Gen8			
			8: Gen9			
			9: Gen10			
			10: Gen11			
			11: Gen12			
			12: Gen13			
			13: Gen14			
			14: Gen15			
			15: Gen16			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41026	Load Demand Fixed Priority 14	Read Only	0: Gen1		Assigns a genset to fixed priority 14. Used when Load Demand Type is set to Fixed Sequence.	PCC3300, PCC3300V2
			1: Gen2			
			2: Gen3			
			3: Gen4			
			4: Gen5			
			5: Gen6			
			6: Gen7			
			7: Gen8			
			8: Gen9			
			9: Gen10			
			10: Gen11			
			11: Gen12			
			12: Gen13			
			13: Gen14			
			14: Gen15			
			15: Gen16			
41027	Load Demand Fixed Priority 15	Read Only	0: Gen1		Assigns a genset to fixed priority 15. Used when Load Demand Type is set to Fixed Sequence.	PCC3300, PCC3300V2
			1: Gen2			
			2: Gen3			
			3: Gen4			
			4: Gen5			
			5: Gen6			
			6: Gen7			
			7: Gen8			
			8: Gen9			
			9: Gen10			
			10: Gen11			
			11: Gen12			
			12: Gen13			
			13: Gen14			
			14: Gen15			
			15: Gen16			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41028	Load Demand Fixed Priority 16	Read Only	0: Gen1		Assigns a genset to fixed priority 16. Used when Load Demand Type is set to Fixed Sequence.	PCC3300, PCC3300V2
			1: Gen2			
			2: Gen3			
			3: Gen4			
			4: Gen5			
			5: Gen6			
			6: Gen7			
			7: Gen8			
			8: Gen9			
			9: Gen10			
			10: Gen11			
			11: Gen12			
			12: Gen13			
			13: Gen14			
			14: Gen15			
			15: Gen16			
41030	Synchronize System Settings	Read/Write	0: No		When set to YES system settings from the genset will be broadcasted and synchronized to all other gensets in the network.	PCC3300, PCC3300V2
			1: Yes			
41031	Battery Charger 2 Failed Switch	Read Only	0: Inactive		Battery Charger 2 Failed Switch function output status; gives software Inactive/Active state	PCC3300, PCC3300V2
			1: Active			
41032	Battery Charger 3 Failed Switch	Read Only	0: Inactive		Battery Charger 3 Failed Switch function output status; gives software Inactive/Active state	PCC3300, PCC3300V2
			1: Active			
41033	Battery Charger 4 Failed Switch	Read Only	0: Inactive		Battery Charger 4 Failed Switch function output status; gives software Inactive/Active state	PCC3300, PCC3300V2
			1: Active			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41034	Intake Air Restriction Indicator 1 fault switch	Read Only	0: Inactive		Intake Air Restriction Indicator 1 fault switch function output status; gives software Inactive/Active state	PCC3300, PCC3300V2
			1: Active			
41035	Intake Air Restriction Indicator 2 fault switch	Read Only	0: Inactive		Intake Air Restriction Indicator 2 fault switch function output status; gives software Inactive/Active state	PCC3300, PCC3300V2
			1: Active			
41036	Intake Air Restriction Indicator 3 fault switch	Read Only	0: Inactive		Intake Air Restriction Indicator 3 fault switch function output status; gives software Inactive/Active state	PCC3300, PCC3300V2
			1: Active			
41037	Intake Air Restriction Indicator 4 fault switch	Read Only	0: Inactive		Intake Air Restriction Indicator 4 fault switch function output status; gives software Inactive/Active state	PCC3300, PCC3300V2
			1: Active			
41038	Starter Air Supply Pressure Low Fault Switch	Read Only	0: Inactive		"Starter Air Supply Pressure Low Fault Switch function output status; gives software Inactive/Active"	PCC3300, PCC3300V2
			1: Active			
41039	Starter Air Tank Volume Low Fault Switch	Read Only	0: Inactive		"Starter Air Tank Volume Low Fault Switch function output status; gives software Inactive/Active state"	PCC3300, PCC3300V2
			1: Active			
41040	Instantaneous HC	Read Only	Multiplier: 0.0078125	Unit: kg/hr	Instantaneous Emissions Parameter received via PGN 130900 from ECM. The value is for indication only, no accuracy figures are available.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
41041	Instantaneous NOx	Read Only	Multiplier: 0.0078125	Unit: kg/hr	Instantaneous Emissions Parameter received via PGN 130900 from ECM. The value is for indication only, no accuracy figures are available.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41042	Instantaneous CO	Read Only	Multiplier: 0.0078125	Unit: kg/hr	Instantaneous Emissions Parameter received via PGN 130900 from ECM. The value is for indication only, no accuracy figures are available.	PCC3300V2 PCC3300,
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
41043	Instantaneous PM	Read Only	Multiplier: 0.0078125	Unit: kg/hr	Instantaneous Emissions Parameter received via PGN 130900 from ECM. The value is for indication only, no accuracy figures are available.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
41044	Instantaneous SO2	Read Only	Multiplier: 0.0078125	Unit: kg/hr	Instantaneous Emissions Parameter received via PGN 130900 from ECM. The value is for indication only, no accuracy figures are available.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
41045	12 Month Rolling Total Of HC	Read Only	Multiplier: 0.0078125	Unit: kg	12 Month Rolling Total Emissions Parameter received via PGN 130901 from ECM. The value is for indication only, no accuracy figures are available.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
41046	12 Month Rolling Total Of HC	Read Only	Multiplier: 0.0078125	Unit: kg	12 Month Rolling Total Emissions Parameter received via PGN 130901 from ECM. The value is for indication only, no accuracy figures are available.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
41047	12 Month Rolling Total Of NOx	Read Only	Multiplier: 0.0078125	Unit: kg	12 Month Rolling Total Emissions Parameter received via PGN 130901 from ECM. The value is for indication only, no accuracy figures are available.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41048	12 Month Rolling Total Of NOx	Read Only	Multiplier: 0.0078125	Unit: kg	12 Month Rolling Total Emissions Parameter received via PGN 130901 from ECM. The value is for indication only, no accuracy figures are available.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
41049	12 Month Rolling Total Of CO	Read Only	Multiplier: 0.0078125	Unit: kg	12 Month Rolling Total Emissions Parameter received via PGN 130901 from ECM. The value is for indication only, no accuracy figures are available.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
41050	12 Month Rolling Total Of CO	Read Only	Multiplier: 0.0078125	Unit: kg	12 Month Rolling Total Emissions Parameter received via PGN 130901 from ECM. The value is for indication only, no accuracy figures are available.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
41051	12 Month Rolling Total Of PM	Read Only	Multiplier: 0.0078125	Unit: kg	12 Month Rolling Total Emissions Parameter received via PGN 130901 from ECM. The value is for indication only, no accuracy figures are available.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
41052	12 Month Rolling Total Of PM	Read Only	Multiplier: 0.0078125	Unit: kg	12 Month Rolling Total Emissions Parameter received via PGN 130901 from ECM. The value is for indication only, no accuracy figures are available.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
41053	12 Month Rolling Total Of SO2	Read Only	Multiplier: 0.0078125	Unit: kg	12 Month Rolling Total Emissions Parameter received via PGN 130901 from ECM. The value is for indication only, no accuracy figures are available.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41054	12 Month Rolling Total Of SO2	Read Only	Multiplier: 0.0078125	Unit: kg	12 Month Rolling Total Emissions Parameter received via PGN 130901 from ECM. The value is for indication only, no accuracy figures are available.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
41055	Lifetime Rolling Total Of HC	Read Only	Multiplier: 0.0078125	Unit: kg	Lifetime Rolling Total Emissions Parameter received via PGN 130902 from ECM. The value is for indication only, no accuracy figures are available.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
41056	Lifetime Rolling Total Of HC	Read Only	Multiplier: 0.0078125	Unit: kg	Lifetime Rolling Total Emissions Parameter received via PGN 130902 from ECM. The value is for indication only, no accuracy figures are available.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
41057	Lifetime Rolling Total Of NOx	Read Only	Multiplier: 0.0078125	Unit: kg	Lifetime Rolling Total Emissions Parameter received via PGN 130902 from ECM. The value is for indication only, no accuracy figures are available.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
41058	Lifetime Rolling Total Of NOx	Read Only	Multiplier: 0.0078125	Unit: kg	Lifetime Rolling Total Emissions Parameter received via PGN 130902 from ECM. The value is for indication only, no accuracy figures are available.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
41059	Lifetime Rolling Total Of CO	Read Only	Multiplier: 0.0078125	Unit: kg	Lifetime Rolling Total Emissions Parameter received via PGN 130902 from ECM. The value is for indication only, no accuracy figures are available.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41060	Lifetime Rolling Total Of CO	Read Only	Multiplier: 0.0078125	Unit: kg	Lifetime Rolling Total Emissions Parameter received via PGN 130902 from ECM. The value is for indication only, no accuracy figures are available.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
41061	Lifetime Rolling Total Of PM	Read Only	Multiplier: 0.0078125	Unit: kg	Lifetime Rolling Total Emissions Parameter received via PGN 130902 from ECM. The value is for indication only, no accuracy figures are available.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
41062	Lifetime Rolling Total Of PM	Read Only	Multiplier: 0.0078125	Unit: kg	Lifetime Rolling Total Emissions Parameter received via PGN 130902 from ECM. The value is for indication only, no accuracy figures are available.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
41063	Lifetime Rolling Total Of SO2	Read Only	Multiplier: 0.0078125	Unit: kg	Lifetime Rolling Total Emissions Parameter received via PGN 130902 from ECM. The value is for indication only, no accuracy figures are available.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
41064	Lifetime Rolling Total Of SO2	Read Only	Multiplier: 0.0078125	Unit: kg	Lifetime Rolling Total Emissions Parameter received via PGN 130902 from ECM. The value is for indication only, no accuracy figures are available.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
41065	Reverse kVAR Threshold	Read Only	Multiplier: 0.01	Unit: %	Sets the Reverse kVAR fault trip threshold as percentage of Standby kVA rating.	PCC3300V2
			Offset: 0	Lower Limit: 15		
			Size (bits): 16	Upper Limit: 50		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41066	Reverse kVAR Time Delay	Read Only	Multiplier: 0.1	Unit: seconds	Sets the Reverse kVAR fault trip time delay.	PCC3300V2
			Offset: 0	Lower Limit: 1		
			Size (bits): 16	Upper Limit: 60		
			Sign: U			
41067	High AC Voltage Threshold	Read Only	Multiplier: 0.01	Unit: %	Percent of desired voltage at which High AC Voltage fault becomes active.	PCC3300V2
			Offset: 0	Lower Limit: 105		
			Size (bits): 16	Upper Limit: 125		
			Sign: U			
41068	High AC Voltage Trip Characteristic	Read Only	0: Inverse Time		“Fixed Time” setup allows a greater time delay until shutdown when voltage overshoots (good for starting motors). When the control is set up to operate as “Inverse Time”, the fault will be more sensitive to voltage spikes and will trip more rapidly.	PCC3300V2
			1: Fixed Time			
41069	High AC Voltage Delay	Read Only	Multiplier: 0.1	Unit: seconds	Time delay before High AC Voltage fault becomes active.	PCC3300V2
			Offset: 0	Lower Limit: 0.1		
			Size (bits): 8	Upper Limit: 10		
			Sign: U			
41070	Low AC Voltage Threshold	Read Only	Multiplier: 0.01	Unit: %	Percent of desired voltage at which Low AC Voltage fault becomes active.	PCC3300V2
			Offset: 0	Lower Limit: 50		
			Size (bits): 16	Upper Limit: 95		
			Sign: U			
41071	Low AC Voltage Delay	Read Only	Multiplier: 0.1	Unit: seconds	Time delay before Low AC Voltage fault becomes active	PCC3300V2
			Offset: 0	Lower Limit: 2		
			Size (bits): 8	Upper Limit: 20		
			Sign: U			
41072	Reverse kW Threshold	Read Only	Multiplier: 0.01	Unit: %	Sets the Reverse kW fault trip threshold as percentage of Standby kW rating.	PCC3300V2
			Offset: 0	Lower Limit: 5		
			Size (bits): 16	Upper Limit: 30		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41073	Reverse kW Time Delay	Read Only	Multiplier: 0.1	Unit: seconds	Sets the Reverse kW fault trip time delay	PCC3300V2
			Offset: 0	Lower Limit: 1		
			Size (bits): 8	Upper Limit: 15		
			Sign: U			
41074	Overfrequency Threshold	Read Only	Multiplier: 0.1	Unit: Hz	Number of Hertz Alternator Line Frequency may be over nominal frequency before Overfrequency fault becomes active.	PCC3300V2
			Offset: 0	Lower Limit: 2		
			Size (bits): 8	Upper Limit: 10		
			Sign: U			
41075	Overfrequency Delay	Read Only	Multiplier: 0.1	Unit: seconds	Time delay before Overfrequency fault becomes active.	PCC3300V2
			Offset: 0	Lower Limit: 1		
			Size (bits): 8	Upper Limit: 20		
			Sign: U			
41076	Underfrequency Threshold	Read Only	Multiplier: 0.1	Unit: Hz	Number of Hertz Alternator Line Frequency may be under nominal frequency before Underfrequency fault becomes active.	PCC3300V2
			Offset: 0	Lower Limit: 0.1		
			Size (bits): 16	Upper Limit: 10		
			Sign: U			
41077	Underfrequency Delay	Read Only	Multiplier: 0.1	Unit: seconds	Time delay before the Underfrequency fault becomes active.	PCC3300V2
			Offset: 0	Lower Limit: 1		
			Size (bits): 8	Upper Limit: 20		
			Sign: U			
41078	Custom Overcurrent Protection Enable	Read Only	0: Disabled		use to enable custom time overcurrent protection	PCC3300V2
			1: Enabled			
41079	Custom Overcurrent Threshold	Read Only	Multiplier: 0.1	Unit: %	% standby current above which custom overcurrent feature starts timing	PCC3300V2
			Offset: 0	Lower Limit: 50		
			Size (bits): 16	Upper Limit: 150		
			Sign: U			
41080	Custom Overcurrent Time Characteristic	Read Only	Multiplier: 0.001	Unit: seconds	sets the timing characteristic of custom overcurrent	PCC3300V2
			Offset: 0	Lower Limit: 0.1		
			Size (bits): 16	Upper Limit: 65		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41081	Aux101 LBNG Alternator Temp OOR High Limit	Read Only	Multiplier: 1	Unit: degF	Low limit for the LBNG Aux 101 I/O Module Alternator Temp Out of Range faults.	PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 509		
			Sign: U			
41082	Aux101 LBNG Alternator Temp OOR Low Limit	Read Only	Multiplier: 1	Unit: degF	Low limit for the LBNG Aux 101 I/O Module Alternator Temp Out of Range faults.	PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 509		
			Sign: U			
41083	Aux101 LBNG Drive/Non- Drive End Bearing Temp OOR High Limit	Read Only	Multiplier: 1	Unit: degF	High limit for the LBNG Aux 101 I/O Module Drive/Non- Drive End Bearing Temp Out of Range faults.	PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 509		
			Sign: U			
41084	Aux101 LBNG Drive/Non- Drive End Bearing Temp OOR Low Limit	Read Only	Multiplier: 1	Unit: degF	Low limit for the LBNG Aux 101 I/O Module Drive/Non-Drive End Bearing Temp Out of Range faults.	PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 509		
			Sign: U			
41085	Application Rating Select	Read Only	0: Standby		Selects genset's standby/prime/base application rating.	PCC3300V2
			1: Prime			
			2: Base			
41086	AVR Damping Effect (50 Hz)	Read Only	Multiplier: 0.01	Unit:	Increases or decreases the output response of the AVR. A lower input value will increase the transient response. A higher value will decrease the transient response.	PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 99.99		
			Sign: U			
41087	AVR Damping Effect (60 Hz)	Read Only	Multiplier: 0.01	Unit:	Increases or decreases the output response of the AVR. A lower input value will increase the transient response. A higher value will decrease the transient response.	PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 99.99		
			Sign: U			

Modbus Address	Parameter/System Name	Modbus Access	Specifications		Description	Control Boards
41088	V/Hz Method	Read Only	0: Fixed Knee Frequency		Sets the knee frequency logic characteristic of the V/Hz curve either fixed knee or relative (to Target Speed) knee frequency.	PCC3300V2
			1: Relative Knee Frequency			
41089	AmpSentry Maintenance Mode Disable Override	Read Only	0: Disable		"Disable Override function for AmpSentry Maintenance Mode. Used for engineering purposes and heavy motors starting that may look like a short circuit"	PCC3300V2
			1: Enable			
41090	High Alternator Temperature 1 Shutdown Threshold	Read Only	Multiplier: 1	Unit: degF	High Alternator Temperature 1 Shutdown Threshold for the I/O Module Fault (AUX 101)	PCC3300V2
			Offset: 0	Lower Limit: 100		
			Size (bits): 16	Upper Limit: 1000		
			Sign: S			
41091	High Alternator Temperature 1 Shutdown Time	Read Only	Multiplier: 0.1	Unit: seconds	High Alternator Temperature 1 Shutdown Time for the I/O Module Fault (AUX 101)	PCC3300V2
			Offset: 0	Lower Limit: 1		
			Size (bits): 16	Upper Limit: 30		
			Sign: U			
41092	High Alternator Temperature 1 Threshold (Aux101)	Read Only	Multiplier: 1	Unit: degF	High Alternator Temp 1 Threshold for the I/O Module fault. Warning Threshold	PCC3300V2
			Offset: 0	Lower Limit: 100		
			Size (bits): 16	Upper Limit: 1000		
			Sign: S			
41093	High Alternator Temperature 1 Time (Aux101)	Read Only	Multiplier: 0.1	Unit: seconds	High Alternator Temp 1 fault time for the I/O Module fault. Warning Time	PCC3300V2
			Offset: 0	Lower Limit: 0.1		
			Size (bits): 16	Upper Limit: 30		
			Sign: U			
41094	High Alternator Temperature 2 Shutdown Threshold	Read Only	Multiplier: 1	Unit: degF	High Alternator Temperature 2 Shutdown Threshold for the I/O Module Fault	PCC3300V2
			Offset: 0	Lower Limit: 100		
			Size (bits): 16	Upper Limit: 1000		
			Sign: S			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41095	High Alternator Temperature 2 Shutdown Time	Read Only	Multiplier: 0.1	Unit: seconds	High Alternator Temperature 2 Shutdown Time for the I/O Module Fault	PCC3300V2
			Offset: 0	Lower Limit: 1		
			Size (bits): 16	Upper Limit: 30		
			Sign: U			
41096	High Alternator Temperature 2 Threshold (Aux101)	Read Only	Multiplier: 1	Unit: degF	High Alternator Temp 2 Threshold for the I/O Module fault. Warning Threshold	PCC3300V2
			Offset: 0	Lower Limit: 100		
			Size (bits): 16	Upper Limit: 1000		
			Sign: S			
41097	High Alternator Temperature 2 Time (Aux101)	Read Only	Multiplier: 0.1	Unit: seconds	High Alternator Temp 2 fault time for the I/O Module fault. Warning Time.	PCC3300V2
			Offset: 0	Lower Limit: 0.1		
			Size (bits): 16	Upper Limit: 30		
			Sign: U			
41098	High Alternator Temperature 3 Shutdown Threshold	Read Only	Multiplier: 1	Unit: degF	High Alternator Temperature 3 Shutdown Threshold for the I/O Module Fault	PCC3300V2
			Offset: 0	Lower Limit: 100		
			Size (bits): 16	Upper Limit: 1000		
			Sign: S			
41099	High Alternator Temperature 3 Shutdown Time	Read Only	Multiplier: 0.1	Unit: seconds	High Alternator Temperature 3 Shutdown Time for the I/O Module Fault	PCC3300V2
			Offset: 0	Lower Limit: 1		
			Size (bits): 16	Upper Limit: 30		
			Sign: U			
41100	High Alternator Temperature 3 Threshold (Aux101)	Read Only	Multiplier: 1	Unit: degF	High Alternator Temp 3 Threshold for the I/O Module fault. Warning Threshold	PCC3300V2
			Offset: 0	Lower Limit: 100		
			Size (bits): 16	Upper Limit: 1000		
			Sign: S			
41101	High Alternator Temperature 3 Time (Aux101)	Read Only	Multiplier: 0.1	Unit: seconds	High Alternator Temp 3 fault time for the I/O Module fault. Warning Time.	PCC3300V2
			Offset: 0	Lower Limit: 1		
			Size (bits): 16	Upper Limit: 30		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41102	AUX101 DE Temp Shutdown Fault Enable	Read Only	0: Disable		Enables the Drive End Bearing Temperature shutdown Fault for Non LBNG applications.	PCC3300V2
			1: Enable			
41103	High Drive End Bearing Temperature Shutdown Threshold	Read Only	Multiplier: 1	Unit: degF	High Drive End Bearing Temperature Shutdown Threshold for the I/O Module Fault	PCC3300V2
			Offset: 0	Lower Limit: 100		
			Size (bits): 16	Upper Limit: 1000		
			Sign: S			
41104	High Drive End Bearing Temperature Shutdown Time	Read Only	Multiplier: 0.1	Unit: seconds	High Drive End Bearing Temperature Shutdown Time for the I/O Module Fault	PCC3300V2
			Offset: 0	Lower Limit: 1		
			Size (bits): 16	Upper Limit: 30		
			Sign: U			
41105	High Drive End Bearing Temperature Threshold (Aux101)	Read Only	Multiplier: 1	Unit: degF	High Drive End Bearing Temp Threshold for the I/O Module fault.	PCC3300V2
			Offset: 0	Lower Limit: 100		
			Size (bits): 16	Upper Limit: 1000		
			Sign: S			
41106	High Drive End Bearing Temperature Time (Aux101)	Read Only	Multiplier: 0.1	Unit: seconds	The time delay until the High Drive End Bearing Temp fault becomes active, from the I/O Module.	PCC3300V2
			Offset: 0	Lower Limit: 0.1		
			Size (bits): 16	Upper Limit: 30		
			Sign: U			
41107	High Exhaust Stack Temperature 1 Threshold (Aux101)	Read Only	Multiplier: 1	Unit: degF	High Exhaust Stack Temp 1 Threshold for the I/O Module fault.	PCC3300V2
			Offset: 0	Lower Limit: 200		
			Size (bits): 16	Upper Limit: 1600		
			Sign: S			
41108	High Exhaust Stack Temperature 1 Time (Aux101)	Read Only	Multiplier: 0.1	Unit: seconds	The time delay until the High Exhaust Stack Temp 1 fault becomes active, from the I/O Module.	PCC3300V2
			Offset: 0	Lower Limit: 0.1		
			Size (bits): 16	Upper Limit: 30		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41109	High Exhaust Stack Temperature 2 Threshold (Aux101)	Read Only	Multiplier: 1	Unit: degF	High Exhaust Stack Temp 2 Threshold for the I/O Module fault.	PCC3300V2
			Offset: 0	Lower Limit: 200		
			Size (bits): 16	Upper Limit: 1600		
			Sign: S			
41110	High Exhaust Stack Temperature 2 Time (Aux101)	Read Only	Multiplier: 0.1	Unit: seconds	The time delay until the High Exhaust Stack Temp 2 fault becomes active, from the I/O Module.	PCC3300V2
			Offset: 0	Lower Limit: 0.1		
			Size (bits): 16	Upper Limit: 30		
			Sign: U			
41111	High Oil Temperature Threshold (Aux101)	Read Only	Multiplier: 1	Unit: degF	High Oil Temp Threshold for the I/O Module HOT fault.	PCC3300V2
			Offset: 0	Lower Limit: 100		
			Size (bits): 16	Upper Limit: 300		
			Sign: S			
41112	High Oil Temperature Time (Aux101)	Read Only	Multiplier: 0.1	Unit: seconds	The time delay until the High Oil Temp fault becomes active, from the I/O Module.	PCC3300V2
			Offset: 0	Lower Limit: 0.1		
			Size (bits): 16	Upper Limit: 30		
			Sign: U			
41113	High Intake Manifold Temperature 1 Threshold (Aux101)	Read Only	Multiplier: 1	Unit: degF	High Intake Manifold Temp 1 Threshold for the I/O Module fault.	PCC3300V2
			Offset: 0	Lower Limit: 100		
			Size (bits): 16	Upper Limit: 270		
			Sign: S			
41114	High Intake Temperature 1 Time (Aux101)	Read Only	Multiplier: 0.1	Unit: seconds	The time delay until the High Intake Manifold Temp 1 fault becomes active, from the I/O Module.	PCC3300V2
			Offset: 0	Lower Limit: 0.1		
			Size (bits): 16	Upper Limit: 30		
			Sign: U			
41115	AUX101 NDE Temp Shutdown Fault Enable	Read Only	0: Disable		Enables the Non Drive End Bearing Temperature shutdown Fault for Non LBNG applications.	PCC3300V2
			1: Enable			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41116	High Non-Drive End Bearing Temperature Shutdown Threshold	Read Only	Multiplier: 1	Unit: degF	High Non-Drive End Bearing Temperature Shutdown Threshold for the I/O Module Fault	PCC3300V2
			Offset: 0	Lower Limit: 100		
			Size (bits): 16	Upper Limit: 1000		
			Sign: S			
41117	High Non-Drive End Bearing Temperature Shutdown Time	Read Only	Multiplier: 0.1	Unit: seconds	High Non-Drive End Bearing Temperature Shutdown Time for the I/O Module Fault	PCC3300V2
			Offset: 0	Lower Limit: 1		
			Size (bits): 16	Upper Limit: 30		
			Sign: U			
41118	High Non-Drive End Bearing Temperature Threshold (Aux101)	Read Only	Multiplier: 1	Unit: degF	High Non-Drive End Bearing Temp Threshold for the I/O Module fault.	PCC3300V2
			Offset: 0	Lower Limit: 100		
			Size (bits): 16	Upper Limit: 1000		
			Sign: S			
41119	High Non-Drive End Bearing Temperature Time (Aux101)	Read Only	Multiplier: 0.1	Unit: seconds	The time delay until the High Non-Drive End Bearing Temp fault becomes active, from the I/O Module.	PCC3300V2
			Offset: 0	Lower Limit: 0.1		
			Size (bits): 16	Upper Limit: 30		
			Sign: U			
41120	High Fuel Level Threshold (Aux101)	Read Only	Multiplier: 0.1	Unit: %	High Fuel Level Threshold for the I/O Module fault.	PCC3300V2
			Offset: 0	Lower Limit: 50		
			Size (bits): 16	Upper Limit: 100		
			Sign: U			
41121	High Fuel Level Time (Aux101)	Read Only	Multiplier: 0.1	Unit: seconds	The time delay until the High Fuel Level fault becomes active, from the I/O Module.	PCC3300V2
			Offset: 0	Lower Limit: 0.1		
			Size (bits): 16	Upper Limit: 30		
			Sign: U			
41122	Low Fuel Level Threshold (Aux101)	Read Only	Multiplier: 0.1	Unit: %	Low Fuel Level Threshold for the I/O Module fault.	PCC3300V2
			Offset: 0	Lower Limit: 10		
			Size (bits): 16	Upper Limit: 70		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41123	Low Fuel Level Time (Aux101)	Read Only	Multiplier: 0.1	Unit: seconds	Low Fuel Level fault time for the I/O Module fault.	PCC3300V2
			Offset: 0	Lower Limit: 0.1		
			Size (bits): 16	Upper Limit: 30		
			Sign: U			
41124	Very Low Fuel Level Threshold (Aux101)	Read Only	Multiplier: 0.1	Unit: %	Very Low Fuel Level Threshold for the AUX 101 I/O Module fault.	PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 50		
			Sign: U			
41125	Very Low Fuel Level Time (Aux101)	Read Only	Multiplier: 0.1	Unit: seconds	Very Low Fuel Level fault time for the AUX 101 I/O Module fault.	PCC3300V2
			Offset: 0	Lower Limit: 0.1		
			Size (bits): 16	Upper Limit: 30		
			Sign: U			
41126	Fuel Level 100 Percent Resistance (Aux101)	Read Only	Multiplier: 1	Unit: Ohm	During setup this trim is set the 100% resistance, when the fuel tank is full.	PCC3300V2
			Offset: 0	Lower Limit: 30		
			Size (bits): 16	Upper Limit: 2500		
			Sign: U			
41127	Fuel Level Zero Percent Resistance (Aux101)	Read Only	Multiplier: 1	Unit: Ohm	Trim to set the 0% (or empty) resistance level on the sensor for the tank to be measured.	PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 2500		
			Sign: U			
41128	Fuel Tank Capacity (Aux101)	Read Only	Multiplier: 1	Unit: gallons	Trim to set the fuel tank capacity.	PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 15000		
			Sign: U			
41129	Aux101 Alternator Temperature OOR Check Enable	Read Only	0: Disable		Enables the Aux 101 I/O Module Alternator Temp Out of Range faults. For use with either LBNG or non-LBNG gensets.	PCC3300V2
			1: Enable			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41130	Aux101 Alternator Temperature OOR Time	Read Only	Multiplier: 0.1	Unit: seconds	Time limit for the Aux 101 I/O Module Alternator Temp Out of Range faults. For use with either LBNG or non-LBNG gensets.	PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 10		
			Sign: U			
41131	Aux101 Ambient Temp OOR Check Enable	Read Only	0: Disable		Enable the Aux 101 I/O Module Ambient Temp Out of Range faults	PCC3300V2
			1: Enable			
41132	Aux101 Drive End Bearing Temperature OOR Check Enable	Read Only	0: Disable		Enable the Aux 101 I/O Module Drive End Bearing Temp Out of Range faults. For use with either LBNG or non-LBNG gensets.	PCC3300V2
			1: Enable			
41133	Aux101 Drive/Non-Drive End Bearing Temp OOR High Limit	Read Only	Multiplier: 0.01	Unit: Vdc	High limit for the Aux 101 I/O Module Drive/Non-Drive End Bearing Temp Out of Range faults.	PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 5		
			Sign: S			
41134	Aux101 Drive/Non-Drive End Bearing Temp OOR Low Limit	Read Only	Multiplier: 0.01	Unit: Vdc	Low limit for the Aux 101 I/O Module Drive/Non-Drive End Bearing Temp Out of Range faults.	PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 5		
			Sign: S			
41135	Aux101 Drive/Non-Drive End Bearing Temperature OOR Time	Read Only	Multiplier: 0.1	Unit: seconds	Time limit for the Aux 101 I/O Module Bearing Temp Out of Range faults. For use with either LBNG or non-LBNG gensets.	PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 10		
			Sign: U			
41136	Aux101 Exhaust Stack Temp 1 OOR Check Enable	Read Only	0: Disable		Enables the Aux 101 I/O Module Exhaust Stack Temp 1 Out of Range fault.	PCC3300V2
			1: Enable			
41137	Aux101 Exhaust Stack Temp 2 OOR Check Enable	Read Only	0: Disable		Enables the Aux 101 I/O Module Exhaust Stack Temp 2 Out of Range fault.	PCC3300V2
			1: Enable			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41138	Aux101 Exhaust Stack Temp OOR High Limit	Read Only	Multiplier: 0.01	Unit: Vdc	High limit for the Aux 101 I/O Module Exhaust Stack Temp Out of Range faults.	PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 5		
			Sign: S			
41139	Aux101 Exhaust Stack Temp OOR Low Limit	Read Only	Multiplier: 0.01	Unit: Vdc	Low limit for the Aux 101 I/O Module Exhaust Stack Temp Out of Range faults.	PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 5		
			Sign: S			
41140	Aux101 Exhaust Stack Temp OOR Time	Read Only	Multiplier: 0.1	Unit: seconds	Time limit for the Aux 101 I/O Module Exhaust Stack Temp Out of Range faults.	PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 10		
			Sign: U			
41141	Aux101 Fuel Level OOR Check Enable	Read Only	0: Disable		Enables the Aux 101 I/O Module Fuel Level Out of Range fault.	PCC3300V2
			1: Enable			
41142	Aux101 Fuel Level OOR High Limit	Read Only	Multiplier: 0.01	Unit: Vdc	High limit for the Aux 101 I/O Module Fuel Level Out of Range fault.	PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 5		
			Sign: S			
41143	Aux101 Fuel Level OOR Low Limit	Read Only	Multiplier: 0.01	Unit: Vdc	Low limit for the Aux 101 I/O Module Fuel Level Out of Range fault.	PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 5		
			Sign: S			
41144	Aux101 Fuel Level OOR Time	Read Only	Multiplier: 0.1	Unit: seconds	Time limit for the Aux 101 I/O Module Fuel Level Out of Range fault.	PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 10		
			Sign: U			
41145	Aux101 Intake Manifold Temp OOR Check Enable	Read Only	0: Disable		Enables the Aux 101 I/O Module Intake Manifold Temp Out of Range faults.	PCC3300V2
			1: Enable			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41146	Aux101 Non-Drive End Bearing Temperature OOR Check Enable	Read Only	0: Disable		Enables the Aux 101 I/O Module Non-Drive End Bearing Temp Out of Range faults. For use with either LBNG or non-LBNG gensets.	PCC3300V2
			1: Enable			
41147	Aux101 Oil Temp OOR Check Enable	Read Only	0: Disable		Enables the Aux 101 I/O Module Oil Temp Out of Range faults.	PCC3300V2
			1: Enable			
41148	Aux101 Oil/Ambient/Intake Manifold Temp OOR High Limit	Read Only	Multiplier: 0.01	Unit: Vdc	High limit for the Aux 101 I/O Module Oil Temp Ambient Temp and Intake Manifold Temp Out of Range faults	PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 5		
			Sign: S			
41149	Aux101 Oil/Ambient/Intake Manifold Temp OOR Low Limit	Read Only	Multiplier: 0.01	Unit: Vdc	Low limit for the Aux 101 I/O Module Oil Temp Ambient Temp and Intake Manifold Temp Out of Range faults	PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 5		
			Sign: S			
41150	Aux101 Oil/Ambient/Intake Manifold Temp OOR Time	Read Only	Multiplier: 0.1	Unit: seconds	Time limit for the Aux 101 I/O Module Oil Temp Ambient Temp and Intake Manifold Temp Out of Range faults	PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 10		
			Sign: U			
41151	Excitation Source	Read Only	0: Shunt		The type of excitation power source PMG or Shunt	PCC3300V2
			1: PMG			
			2: Auxiliary Winding			
41152	High LTA Temperature Threshold (Aux101)	Read Only	Multiplier: 1	Unit: degF	"High LTA Temperature Threshold for the I/O Module fault"	PCC3300V2
			Offset: 0	Lower Limit: -40		
			Size (bits): 16	Upper Limit: 300		
			Sign: S			
41153	High LTA Temperature Time (Aux101)	Read Only	Multiplier: 0.1	Unit: seconds	"Time limit for the Aux 101 I/O Module High LTA Temperature faults"	PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 30		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41154	Aux101 LTA Temperature OOR High Limit	Read Only	Multiplier: 0.01	Unit: Vdc	"High limit for the Aux 101 I/O Module LTA Temperature Out of Range faults."	PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 5		
			Sign: U			
41155	Aux101 LTA Temperature OOR Low Limit	Read Only	Multiplier: 0.01	Unit: Vdc	"Low limit for the Aux 101 I/O Module LTA Temperature Out of Range faults."	PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 5		
			Sign: U			
41156	Aux101 LTA Temperature OOR Time	Read Only	Multiplier: 0.1	Unit: seconds	"Time limit for the Aux 101 I/O Module LTA Temperature Out of Range faults"	PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 10		
			Sign: U			
41157	Aux101 LTA Temperature OOR Check Enable	Read Only	0: Disabled		"Enables the AUX101 I/O Module LTA Temperature Out Of Range Faults."	PCC3300V2
			1: Enabled			
41158	Aux101 0 Input 1 Function Pointer	Read Only	0: Default	11: Exercise Switch	Selects discrete input fault/event for this input.	PCC3300V2
			1: Do Nothing	12: Battle Short Switch		
			2: Manual Run Switch	13: Battery Charger Failed Switch		
			3: Low Fuel in Day Tank Switch	14: Low Engine Temperature Switch		
			4: Low Coolant Switch #2	15: Speed Droop Enable Switch		
			5: High Alt Temperature Switch	16: Voltage Droop Enable Switch		
			6: Ground Fault Switch	17: Fire Fault Switch		
			7: PTC Mode Switch	18: Differential Fault Switch		
			8: Load Demand Inhibit Switch	19: Rated/Idle Switch		

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
			9: Load Demand Spare Capacity Request	20: AMM Enabled		
			10: Ramp Load/Unload Switch	21: Intake Air Restriction Indicator 1 fault switch		
41158	Aux101 0 Input 1 Function Pointer	Read Only	22: Intake Air Restriction Indicator 2 fault switch	33: Cam Switch Location 4	Selects discrete input fault/event for this input.	PCC3300V2
			23: Intake Air Restriction Indicator 3 fault switch	34: Paralleling Cable Detect		
			24: Intake Air Restriction Indicator 4 fault switch	35: DEF Tank Detector		
			25: Battery Charger 2 Failed Switch	36: Low Fuel Pressure Switch		
			26: Battery Charger 3 Failed Switch	37: Bank A Pressure Switch		
			27: Battery Charger 4 Failed Switch	38: Bank B Pressure Switch		
			28: Starter Air Supply Pressure Low Fault Switch	39: Start Signal Integrity Switch		
			29: Starter Air Tank Volume Low Fault Switch	40: Charging Alternator Fuse Failure Switch		
			30: Cam Switch Location 1	41: STC Bank A Pressure Switch		
			31: Cam Switch Location 2	42: STC Bank B Pressure Switch		
			32: Cam Switch Location 3	43: Transfer/Retransfer Override Switch		

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41159	Aux101 0 Input 2 Function Pointer	Read Only	0: Default	11: Exercise Switch	Selects discrete input fault/event for this input.	PCC3300V2
			1: Do Nothing	12: Battle Short Switch		
			2: Manual Run Switch	13: Battery Charger Failed Switch		
			3: Low Fuel in Day Tank Switch	14: Low Engine Temperature Switch		
			4: Low Coolant Switch #2	15: Speed Droop Enable Switch		
			5: High Alt Temperature Switch	16: Voltage Droop Enable Switch		
			6: Ground Fault Switch	17: Fire Fault Switch		
			7: PTC Mode Switch	18: Differential Fault Switch		
			8: Load Demand Inhibit Switch	19: Rated/Idle Switch		
			9: Load Demand Spare Capacity Request	20: AMM Enabled		
			10: Ramp Load/Unload Switch	21: Intake Air Restriction Indicator 1 fault switch		

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41159	Aux101 0 Input 2 Function Pointer	Read Only	22: Intake Air Restriction Indicator 2 fault switch	33: Cam Switch Location 4	Selects discrete input fault/event for this input.	PCC3300V2
			23: Intake Air Restriction Indicator 3 fault switch	34: Paralleling Cable Detect		
			24: Intake Air Restriction Indicator 4 fault switch	35: DEF Tank Detector		
			25: Battery Charger 2 Failed Switch	36: Low Fuel Pressure Switch		
			26: Battery Charger 3 Failed Switch	37: Bank A Pressure Switch		
			27: Battery Charger 4 Failed Switch	38: Bank B Pressure Switch		
			28: Starter Air Supply Pressure Low Fault Switch	39: Start Signal Integrity Switch		
			29: Starter Air Tank Volume Low Fault Switch	40: Charging Alternator Fuse Failure Switch		
			30: Cam Switch Location 1	41: STC Bank A Pressure Switch		
			31: Cam Switch Location 2	42: STC Bank B Pressure Switch		
			32: Cam Switch Location 3	43: Transfer/Retransfer Override Switch		

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41160	Aux101 0 Input 3 Function Pointer	Read Only	0: Default	11: Exercise Switch	Selects discrete input fault/event for this input.	PCC3300V2
			1: Do Nothing	12: Battle Short Switch		
			2: Manual Run Switch	13: Battery Charger Failed Switch		
			3: Low Fuel in Day Tank Switch	14: Low Engine Temperature Switch		
			4: Low Coolant Switch #2	15: Speed Droop Enable Switch		
			5: High Alt Temperature Switch	16: Voltage Droop Enable Switch		
			6: Ground Fault Switch	17: Fire Fault Switch		
			7: PTC Mode Switch	18: Differential Fault Switch		
			8: Load Demand Inhibit Switch	19: Rated/Idle Switch		
			9: Load Demand Spare Capacity Request	20: AMM Enabled		
			10: Ramp Load/Unload Switch	21: Intake Air Restriction Indicator 1 fault switch		

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41160	Aux101 0 Input 3 Function Pointer	Read Only	22: Intake Air Restriction Indicator 2 fault switch	33: Cam Switch Location 4	Selects discrete input fault/event for this input.	PCC3300V2
			23: Intake Air Restriction Indicator 3 fault switch	34: Paralleling Cable Detect		
			24: Intake Air Restriction Indicator 4 fault switch	35: DEF Tank Detector		
			25: Battery Charger 2 Failed Switch	36: Low Fuel Pressure Switch		
			26: Battery Charger 3 Failed Switch	37: Bank A Pressure Switch		
			27: Battery Charger 4 Failed Switch	38: Bank B Pressure Switch		
			28: Starter Air Supply Pressure Low Fault Switch	39: Start Signal Integrity Switch		
			29: Starter Air Tank Volume Low Fault Switch	40: Charging Alternator Fuse Failure Switch		
			30: Cam Switch Location 1	41: STC Bank A Pressure Switch		
			31: Cam Switch Location 2	42: STC Bank B Pressure Switch		
			32: Cam Switch Location 3	43: Transfer/Retransfer Override Switch		

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41161	Aux101 0 Input 4 Function Pointer	Read Only	0: Default	11: Exercise Switch	Selects discrete input fault/event for this input.	PCC3300V2
			1: Do Nothing	12: Battle Short Switch		
			2: Manual Run Switch	13: Battery Charger Failed Switch		
			3: Low Fuel in Day Tank Switch	14: Low Engine Temperature Switch		
			4: Low Coolant Switch #2	15: Speed Droop Enable Switch		
			5: High Alt Temperature Switch	16: Voltage Droop Enable Switch		
			6: Ground Fault Switch	17: Fire Fault Switch		
			7: PTC Mode Switch	18: Differential Fault Switch		
			8: Load Demand Inhibit Switch	19: Rated/Idle Switch		
			9: Load Demand Spare Capacity Request	20: AMM Enabled		
			10: Ramp Load/Unload Switch	21: Intake Air Restriction Indicator 1 fault switch		

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41161	Aux101 0 Input 4 Function Pointer	Read Only	22: Intake Air Restriction Indicator 2 fault switch	33: Cam Switch Location 4	Selects discrete input fault/event for this input.	PCC3300V2
			23: Intake Air Restriction Indicator 3 fault switch	34: Paralleling Cable Detect		
			24: Intake Air Restriction Indicator 4 fault switch	35: DEF Tank Detector		
			25: Battery Charger 2 Failed Switch	36: Low Fuel Pressure Switch		
			26: Battery Charger 3 Failed Switch	37: Bank A Pressure Switch		
			27: Battery Charger 4 Failed Switch	38: Bank B Pressure Switch		
			28: Starter Air Supply Pressure Low Fault Switch	39: Start Signal Integrity Switch		
			29: Starter Air Tank Volume Low Fault Switch	40: Charging Alternator Fuse Failure Switch		
			30: Cam Switch Location 1	41: STC Bank A Pressure Switch		
			31: Cam Switch Location 2	42: STC Bank B Pressure Switch		
			32: Cam Switch Location 3	43: Transfer/Retransfer Override Switch		

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41162	Aux101 0 Input 5 Function Pointer	Read Only	0: Default	11: Exercise Switch	Selects discrete input fault/event for this input.	PCC3300V2
			1: Do Nothing	12: Battle Short Switch		
			2: Manual Run Switch	13: Battery Charger Failed Switch		
			3: Low Fuel in Day Tank Switch	14: Low Engine Temperature Switch		
			4: Low Coolant Switch #2	15: Speed Droop Enable Switch		
			5: High Alt Temperature Switch	16: Voltage Droop Enable Switch		
			6: Ground Fault Switch	17: Fire Fault Switch		
			7: PTC Mode Switch	18: Differential Fault Switch		
			8: Load Demand Inhibit Switch	19: Rated/Idle Switch		
			9: Load Demand Spare Capacity Request	20: AMM Enabled		
			10: Ramp Load/Unload Switch	21: Intake Air Restriction Indicator 1 fault switch		

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41162	Aux101 0 Input 5 Function Pointer	Read Only	22: Intake Air Restriction Indicator 2 fault switch	33: Cam Switch Location 4	Selects discrete input fault/event for this input.	PCC3300V2
			23: Intake Air Restriction Indicator 3 fault switch	34: Paralleling Cable Detect		
			24: Intake Air Restriction Indicator 4 fault switch	35: DEF Tank Detector		
			25: Battery Charger 2 Failed Switch	36: Low Fuel Pressure Switch		
			26: Battery Charger 3 Failed Switch	37: Bank A Pressure Switch		
			27: Battery Charger 4 Failed Switch	38: Bank B Pressure Switch		
			28: Starter Air Supply Pressure Low Fault Switch	39: Start Signal Integrity Switch		
			29: Starter Air Tank Volume Low Fault Switch	40: Charging Alternator Fuse Failure Switch		
			30: Cam Switch Location 1	41: STC Bank A Pressure Switch		
			31: Cam Switch Location 2	42: STC Bank B Pressure Switch		
			32: Cam Switch Location 3	43: Transfer/Retransfer Override Switch		

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41163	Aux101 0 Input 6 Function Pointer	Read Only	0: Default	11: Exercise Switch	Selects discrete input fault/event for this input.	PCC3300V2
			1: Do Nothing	12: Battle Short Switch		
			2: Manual Run Switch	13: Battery Charger Failed Switch		
			3: Low Fuel in Day Tank Switch	14: Low Engine Temperature Switch		
			4: Low Coolant Switch #2	15: Speed Droop Enable Switch		
			5: High Alt Temperature Switch	16: Voltage Droop Enable Switch		
			6: Ground Fault Switch	17: Fire Fault Switch		
			7: PTC Mode Switch	18: Differential Fault Switch		
			8: Load Demand Inhibit Switch	19: Rated/Idle Switch		
			9: Load Demand Spare Capacity Request	20: AMM Enabled		
			10: Ramp Load/Unload Switch	21: Intake Air Restriction Indicator 1 fault switch		

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41163	Aux101 0 Input 6 Function Pointer	Read Only	22: Intake Air Restriction Indicator 2 fault switch	33: Cam Switch Location 4	Selects discrete input fault/event for this input.	PCC3300V2
			23: Intake Air Restriction Indicator 3 fault switch	34: Paralleling Cable Detect		
			24: Intake Air Restriction Indicator 4 fault switch	35: DEF Tank Detector		
			25: Battery Charger 2 Failed Switch	36: Low Fuel Pressure Switch		
			26: Battery Charger 3 Failed Switch	37: Bank A Pressure Switch		
			27: Battery Charger 4 Failed Switch	38: Bank B Pressure Switch		
			28: Starter Air Supply Pressure Low Fault Switch	39: Start Signal Integrity Switch		
			29: Starter Air Tank Volume Low Fault Switch	40: Charging Alternator Fuse Failure Switch		
			30: Cam Switch Location 1	41: STC Bank A Pressure Switch		
			31: Cam Switch Location 2	42: STC Bank B Pressure Switch		
			32: Cam Switch Location 3	43: Transfer/Retransfer Override Switch		

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41164	Aux101 0 Input 7 Function Pointer	Read Only	0: Default	11: Exercise Switch	Selects discrete input fault/event for this input.	PCC3300V2
			1: Do Nothing	12: Battle Short Switch		
			2: Manual Run Switch	13: Battery Charger Failed Switch		
			3: Low Fuel in Day Tank Switch	14: Low Engine Temperature Switch		
			4: Low Coolant Switch #2	15: Speed Droop Enable Switch		
			5: High Alt Temperature Switch	16: Voltage Droop Enable Switch		
			6: Ground Fault Switch	17: Fire Fault Switch		
			7: PTC Mode Switch	18: Differential Fault Switch		
			8: Load Demand Inhibit Switch	19: Rated/Idle Switch		
			9: Load Demand Spare Capacity Request	20: AMM Enabled		
			10: Ramp Load/Unload Switch	21: Intake Air Restriction Indicator 1 fault switch		

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41164	Aux101 0 Input 7 Function Pointer	Read Only	22: Intake Air Restriction Indicator 2 fault switch	33: Cam Switch Location 4	Selects discrete input fault/event for this input.	PCC3300V2
			23: Intake Air Restriction Indicator 3 fault switch	34: Paralleling Cable Detect		
			24: Intake Air Restriction Indicator 4 fault switch	35: DEF Tank Detector		
			25: Battery Charger 2 Failed Switch	36: Low Fuel Pressure Switch		
			26: Battery Charger 3 Failed Switch	37: Bank A Pressure Switch		
			27: Battery Charger 4 Failed Switch	38: Bank B Pressure Switch		
			28: Starter Air Supply Pressure Low Fault Switch	39: Start Signal Integrity Switch		
			29: Starter Air Tank Volume Low Fault Switch	40: Charging Alternator Fuse Failure Switch		
			30: Cam Switch Location 1	41: STC Bank A Pressure Switch		
			31: Cam Switch Location 2	42: STC Bank B Pressure Switch		
			32: Cam Switch Location 3	43: Transfer/Retransfer Override Switch		

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41165	Aux101 0 Input 8 Function Pointer	Read Only	0: Default	11: Exercise Switch	Selects discrete input fault/event for this input.	PCC3300V2
			1: Do Nothing	12: Battle Short Switch		
			2: Manual Run Switch	13: Battery Charger Failed Switch		
			3: Low Fuel in Day Tank Switch	14: Low Engine Temperature Switch		
			4: Low Coolant Switch #2	15: Speed Droop Enable Switch		
			5: High Alt Temperature Switch	16: Voltage Droop Enable Switch		
			6: Ground Fault Switch	17: Fire Fault Switch		
			7: PTC Mode Switch	18: Differential Fault Switch		
			8: Load Demand Inhibit Switch	19: Rated/Idle Switch		
			9: Load Demand Spare Capacity Request	20: AMM Enabled		
			10: Ramp Load/Unload Switch	21: Intake Air Restriction Indicator 1 fault switch		

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41165	Aux101 0 Input 8 Function Pointer	Read Only	22: Intake Air Restriction Indicator 2 fault switch	33: Cam Switch Location 4	Selects discrete input fault/event for this input.	PCC3300V2
			23: Intake Air Restriction Indicator 3 fault switch	34: Paralleling Cable Detect		
			24: Intake Air Restriction Indicator 4 fault switch	35: DEF Tank Detector		
			25: Battery Charger 2 Failed Switch	36: Low Fuel Pressure Switch		
			26: Battery Charger 3 Failed Switch	37: Bank A Pressure Switch		
			27: Battery Charger 4 Failed Switch	38: Bank B Pressure Switch		
			28: Starter Air Supply Pressure Low Fault Switch	39: Start Signal Integrity Switch		
			29: Starter Air Tank Volume Low Fault Switch	40: Charging Alternator Fuse Failure Switch		
			30: Cam Switch Location 1	41: STC Bank A Pressure Switch		
			31: Cam Switch Location 2	42: STC Bank B Pressure Switch		
			32: Cam Switch Location 3	43: Transfer/Retransfer Override Switch		

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41166	Aux101 1 Input 1 Function Pointer	Read Only	0: Default	11: Exercise Switch	Selects discrete input fault/event for this input.	PCC3300V2
			1: Do Nothing	12: Battle Short Switch		
			2: Manual Run Switch	13: Battery Charger Failed Switch		
			3: Low Fuel in Day Tank Switch	14: Low Engine Temperature Switch		
			4: Low Coolant Switch #2	15: Speed Droop Enable Switch		
			5: High Alt Temperature Switch	16: Voltage Droop Enable Switch		
			6: Ground Fault Switch	17: Fire Fault Switch		
			7: PTC Mode Switch	18: Differential Fault Switch		
			8: Load Demand Inhibit Switch	19: Rated/Idle Switch		
			9: Load Demand Spare Capacity Request	20: AMM Enabled		
			10: Ramp Load/Unload Switch	21: Intake Air Restriction Indicator 1 fault switch		

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41166	Aux101 1 Input 1 Function Pointer	Read Only	22: Intake Air Restriction Indicator 2 fault switch	33: Cam Switch Location 4	Selects discrete input fault/event for this input.	PCC3300V2
			23: Intake Air Restriction Indicator 3 fault switch	34: Paralleling Cable Detect		
			24: Intake Air Restriction Indicator 4 fault switch	35: DEF Tank Detector		
			25: Battery Charger 2 Failed Switch	36: Low Fuel Pressure Switch		
			26: Battery Charger 3 Failed Switch	37: Bank A Pressure Switch		
			27: Battery Charger 4 Failed Switch	38: Bank B Pressure Switch		
			28: Starter Air Supply Pressure Low Fault Switch	39: Start Signal Integrity Switch		
			29: Starter Air Tank Volume Low Fault Switch	40: Charging Alternator Fuse Failure Switch		
			30: Cam Switch Location 1	41: STC Bank A Pressure Switch		
			31: Cam Switch Location 2	42: STC Bank B Pressure Switch		
			32: Cam Switch Location 3	43: Transfer/Retransfer Override Switch		

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41167	Aux101 1 Input 2 Function Pointer	Read Only	0: Default	11: Exercise Switch	Selects discrete input fault/event for this input.	PCC3300V2
			1: Do Nothing	12: Battle Short Switch		
			2: Manual Run Switch	13: Battery Charger Failed Switch		
			3: Low Fuel in Day Tank Switch	14: Low Engine Temperature Switch		
			4: Low Coolant Switch #2	15: Speed Droop Enable Switch		
			5: High Alt Temperature Switch	16: Voltage Droop Enable Switch		
			6: Ground Fault Switch	17: Fire Fault Switch		
			7: PTC Mode Switch	18: Differential Fault Switch		
			8: Load Demand Inhibit Switch	19: Rated/Idle Switch		
			9: Load Demand Spare Capacity Request	20: AMM Enabled		
			10: Ramp Load/Unload Switch	21: Intake Air Restriction Indicator 1 fault switch		

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41167	Aux101 1 Input 2 Function Pointer	Read Only	22: Intake Air Restriction Indicator 2 fault switch	33: Cam Switch Location 4	Selects discrete input fault/event for this input.	PCC3300V2
			23: Intake Air Restriction Indicator 3 fault switch	34: Paralleling Cable Detect		
			24: Intake Air Restriction Indicator 4 fault switch	35: DEF Tank Detector		
			25: Battery Charger 2 Failed Switch	36: Low Fuel Pressure Switch		
			26: Battery Charger 3 Failed Switch	37: Bank A Pressure Switch		
			27: Battery Charger 4 Failed Switch	38: Bank B Pressure Switch		
			28: Starter Air Supply Pressure Low Fault Switch	39: Start Signal Integrity Switch		
			29: Starter Air Tank Volume Low Fault Switch	40: Charging Alternator Fuse Failure Switch		
			30: Cam Switch Location 1	41: STC Bank A Pressure Switch		
			31: Cam Switch Location 2	42: STC Bank B Pressure Switch		
			32: Cam Switch Location 3	43: Transfer/Retransfer Override Switch		

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41168	Aux101 1 Input 3 Function Pointer	Read Only	0: Default	11: Exercise Switch	Selects discrete input fault/event for this input.	PCC3300V2
			1: Do Nothing	12: Battle Short Switch		
			2: Manual Run Switch	13: Battery Charger Failed Switch		
			3: Low Fuel in Day Tank Switch	14: Low Engine Temperature Switch		
			4: Low Coolant Switch #2	15: Speed Droop Enable Switch		
			5: High Alt Temperature Switch	16: Voltage Droop Enable Switch		
			6: Ground Fault Switch	17: Fire Fault Switch		
			7: PTC Mode Switch	18: Differential Fault Switch		
			8: Load Demand Inhibit Switch	19: Rated/Idle Switch		
			9: Load Demand Spare Capacity Request	20: AMM Enabled		
			10: Ramp Load/Unload Switch	21: Intake Air Restriction Indicator 1 fault switch		

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41168	Aux101 1 Input 3 Function Pointer	Read Only	22: Intake Air Restriction Indicator 2 fault switch	33: Cam Switch Location 4	Selects discrete input fault/event for this input.	PCC3300V2
			23: Intake Air Restriction Indicator 3 fault switch	34: Paralleling Cable Detect		
			24: Intake Air Restriction Indicator 4 fault switch	35: DEF Tank Detector		
			25: Battery Charger 2 Failed Switch	36: Low Fuel Pressure Switch		
			26: Battery Charger 3 Failed Switch	37: Bank A Pressure Switch		
			27: Battery Charger 4 Failed Switch	38: Bank B Pressure Switch		
			28: Starter Air Supply Pressure Low Fault Switch	39: Start Signal Integrity Switch		
			29: Starter Air Tank Volume Low Fault Switch	40: Charging Alternator Fuse Failure Switch		
			30: Cam Switch Location 1	41: STC Bank A Pressure Switch		
			31: Cam Switch Location 2	42: STC Bank B Pressure Switch		
			32: Cam Switch Location 3	43: Transfer/Retransfer Override Switch		

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41169	Aux101 1 Input 4 Function Pointer	Read Only	0: Default	11: Exercise Switch	Selects discrete input fault/event for this input.	PCC3300V2
			1: Do Nothing	12: Battle Short Switch		
			2: Manual Run Switch	13: Battery Charger Failed Switch		
			3: Low Fuel in Day Tank Switch	14: Low Engine Temperature Switch		
			4: Low Coolant Switch #2	15: Speed Droop Enable Switch		
			5: High Alt Temperature Switch	16: Voltage Droop Enable Switch		
			6: Ground Fault Switch	17: Fire Fault Switch		
			7: PTC Mode Switch	18: Differential Fault Switch		
			8: Load Demand Inhibit Switch	19: Rated/Idle Switch		
			9: Load Demand Spare Capacity Request	20: AMM Enabled		
			10: Ramp Load/Unload Switch	21: Intake Air Restriction Indicator 1 fault switch		

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41169	Aux101 1 Input 4 Function Pointer	Read Only	22: Intake Air Restriction Indicator 2 fault switch	33: Cam Switch Location 4	Selects discrete input fault/event for this input.	PCC3300V2
			23: Intake Air Restriction Indicator 3 fault switch	34: Paralleling Cable Detect		
			24: Intake Air Restriction Indicator 4 fault switch	35: DEF Tank Detector		
			25: Battery Charger 2 Failed Switch	36: Low Fuel Pressure Switch		
			26: Battery Charger 3 Failed Switch	37: Bank A Pressure Switch		
			27: Battery Charger 4 Failed Switch	38: Bank B Pressure Switch		
			28: Starter Air Supply Pressure Low Fault Switch	39: Start Signal Integrity Switch		
			29: Starter Air Tank Volume Low Fault Switch	40: Charging Alternator Fuse Failure Switch		
			30: Cam Switch Location 1	41: STC Bank A Pressure Switch		
			31: Cam Switch Location 2	42: STC Bank B Pressure Switch		
			32: Cam Switch Location 3	43: Transfer/Retransfer Override Switch		

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41170	Aux101 1 Input 5 Function Pointer	Read Only	0: Default	11: Exercise Switch	Selects discrete input fault/event for this input.	PCC3300V2
			1: Do Nothing	12: Battle Short Switch		
			2: Manual Run Switch	13: Battery Charger Failed Switch		
			3: Low Fuel in Day Tank Switch	14: Low Engine Temperature Switch		
			4: Low Coolant Switch #2	15: Speed Droop Enable Switch		
			5: High Alt Temperature Switch	16: Voltage Droop Enable Switch		
			6: Ground Fault Switch	17: Fire Fault Switch		
			7: PTC Mode Switch	18: Differential Fault Switch		
			8: Load Demand Inhibit Switch	19: Rated/Idle Switch		
			9: Load Demand Spare Capacity Request	20: AMM Enabled		
			10: Ramp Load/Unload Switch	21: Intake Air Restriction Indicator 1 fault switch		

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41170	Aux101 1 Input 5 Function Pointer	Read Only	22: Intake Air Restriction Indicator 2 fault switch	33: Cam Switch Location 4	Selects discrete input fault/event for this input.	PCC3300V2
			23: Intake Air Restriction Indicator 3 fault switch	34: Paralleling Cable Detect		
			24: Intake Air Restriction Indicator 4 fault switch	35: DEF Tank Detector		
			25: Battery Charger 2 Failed Switch	36: Low Fuel Pressure Switch		
			26: Battery Charger 3 Failed Switch	37: Bank A Pressure Switch		
			27: Battery Charger 4 Failed Switch	38: Bank B Pressure Switch		
			28: Starter Air Supply Pressure Low Fault Switch	39: Start Signal Integrity Switch		
			29: Starter Air Tank Volume Low Fault Switch	40: Charging Alternator Fuse Failure Switch		
			30: Cam Switch Location 1	41: STC Bank A Pressure Switch		
			31: Cam Switch Location 2	42: STC Bank B Pressure Switch		
			32: Cam Switch Location 3	43: Transfer/Retransfer Override Switch		
41171	Aux101 1 Analog Input 6 Sensor Type	Read Only	0: Analog Input		Selects whether the input will be active open, active closed, or an analog input.	PCC3300V2
			1: Switch Input - Active Closed			
			2: Switch Input - Active Open			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41172	Aux101 1 Analog Input 6 Function Pointer	Read Only	0: Do Nothing		Selects the type of analog input sensor.	PCC3300V2
			1: Oil Temperature			
			2: Exhaust Stack Temperature 1			
			3: Exhaust Stack Temperature 2			
			4: Ambient Temperature			
			5: Fuel Level			
			6: Alternator Temperature 1			
			7: Alternator Temperature 2			
			8: Alternator Temperature 3			
			9: Intake Manifold Temperature 1			
			10: Drive End Bearing Temperature			
			11: Non-Drive End Bearing Temperature			
			12: LTA Temperature			
			13: Bank A Pressure Sensor			
			14: Bank B Pressure Sensor			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41173	Aux101 1 Input 7 Function Pointer	Read Only	0: Default	11: Exercise Switch	Selects discrete input fault/event for this input.	PCC3300V2
			1: Do Nothing	12: Battle Short Switch		
			2: Manual Run Switch	13: Battery Charger Failed Switch		
			3: Low Fuel in Day Tank Switch	14: Low Engine Temperature Switch		
			4: Low Coolant Switch #2	15: Speed Droop Enable Switch		
			5: High Alt Temperature Switch	16: Voltage Droop Enable Switch		
			6: Ground Fault Switch	17: Fire Fault Switch		
			7: PTC Mode Switch	18: Differential Fault Switch		
			8: Load Demand Inhibit Switch	19: Rated/Idle Switch		
			9: Load Demand Spare Capacity Request	20: AMM Enabled		
			10: Ramp Load/Unload Switch	21: Intake Air Restriction Indicator 1 fault switch		

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41173	Aux101 1 Input 7 Function Pointer	Read Only	22: Intake Air Restriction Indicator 2 fault switch	33: Cam Switch Location 4	Selects discrete input fault/event for this input.	PCC3300V2
			23: Intake Air Restriction Indicator 3 fault switch	34: Paralleling Cable Detect		
			24: Intake Air Restriction Indicator 4 fault switch	35: DEF Tank Detector		
			25: Battery Charger 2 Failed Switch	36: Low Fuel Pressure Switch		
			26: Battery Charger 3 Failed Switch	37: Bank A Pressure Switch		
			27: Battery Charger 4 Failed Switch	38: Bank B Pressure Switch		
			28: Starter Air Supply Pressure Low Fault Switch	39: Start Signal Integrity Switch		
			29: Starter Air Tank Volume Low Fault Switch	40: Charging Alternator Fuse Failure Switch		
			30: Cam Switch Location 1	41: STC Bank A Pressure Switch		
			31: Cam Switch Location 2	42: STC Bank B Pressure Switch		
			32: Cam Switch Location 3	43: Transfer/Retransfer Override Switch		

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41174	Aux101 1 Input 8 Function Pointer	Read Only	0: Default	11: Exercise Switch	Selects discrete input fault/event for this input.	PCC3300V2
			1: Do Nothing	12: Battle Short Switch		
			2: Manual Run Switch	13: Battery Charger Failed Switch		
			3: Low Fuel in Day Tank Switch	14: Low Engine Temperature Switch		
			4: Low Coolant Switch #2	15: Speed Droop Enable Switch		
			5: High Alt Temperature Switch	16: Voltage Droop Enable Switch		
			6: Ground Fault Switch	17: Fire Fault Switch		
			7: PTC Mode Switch	18: Differential Fault Switch		
			8: Load Demand Inhibit Switch	19: Rated/Idle Switch		
			9: Load Demand Spare Capacity Request	20: AMM Enabled		
			10: Ramp Load/Unload Switch	21: Intake Air Restriction Indicator 1 fault switch		

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41174	Aux101 1 Input 8 Function Pointer	Read Only	22: Intake Air Restriction Indicator 2 fault switch	33: Cam Switch Location 4	Selects discrete input fault/event for this input.	PCC3300V2
			23: Intake Air Restriction Indicator 3 fault switch	34: Paralleling Cable Detect		
			24: Intake Air Restriction Indicator 4 fault switch	35: DEF Tank Detector		
			25: Battery Charger 2 Failed Switch	36: Low Fuel Pressure Switch		
			26: Battery Charger 3 Failed Switch	37: Bank A Pressure Switch		
			27: Battery Charger 4 Failed Switch	38: Bank B Pressure Switch		
			28: Starter Air Supply Pressure Low Fault Switch	39: Start Signal Integrity Switch		
			29: Starter Air Tank Volume Low Fault Switch	40: Charging Alternator Fuse Failure Switch		
			30: Cam Switch Location 1	41: STC Bank A Pressure Switch		
			31: Cam Switch Location 2	42: STC Bank B Pressure Switch		
			32: Cam Switch Location 3	43: Transfer/Retransfer Override Switch		
41175	Configurable Input #1 Fault Response	Read Only	0: None		If the configurable input #1 is configured as a fault input, this sets the fault level	PCC3300V2
			1: Warning			
			2: Shutdown			
			3: Shutdown w/Cooldown			
			4: Derate			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41176	Configurable Input #2 Fault Response	Read Only	0: None		If the configurable input #2 is configured as a fault input, this sets the fault level	PCC3300V2
			1: Warning			
			2: Shutdown			
			3: Shutdown w/Cooldown			
			4: Derate			
41177	Start Type/Configurable Input #11 Active State Selection	Read Only	0: Active Closed		Start Type input software logic state inversion bypass control	PCC3300V2
			1: Active Open			
41178	Speed Bias Output / Configurable Analog output #1 Analog Out High Function Setpoint	Read Only	Multiplier: 0.01	Unit: Vdc	The analog value that corresponds to the high engineering value (scaling unit) and upper clamp	PCC3300V2
			Offset: 0	Lower Limit: -10		
			Size (bits): 16	Upper Limit: 10		
			Sign: S			
41179	Speed Bias Output / Configurable Analog output #1 Analog Out High Setpoint	Read Only	Multiplier: 0.01	Unit: Vdc	The analog value that corresponds to the high engineering value (scaling unit) and upper clamp	PCC3300V2
			Offset: 0	Lower Limit: -10		
			Size (bits): 16	Upper Limit: 10		
			Sign: S			
41180	Speed Bias Output / Configurable Analog output #1 Analog Out Low Function Setpoint	Read Only	Multiplier: 0.01	Unit: Vdc	The analog value that corresponds to the Low engineering value (scaling unit) and lower clamp	PCC3300V2
			Offset: 0	Lower Limit: -10		
			Size (bits): 16	Upper Limit: 10		
			Sign: S			
41181	Speed Bias Output / Configurable Analog output #1 Analog Out Low Setpoint	Read Only	Multiplier: 0.01	Unit: Vdc	The analog value that corresponds to the Low engineering value (scaling unit) and lower clamp	PCC3300V2
			Offset: 0	Lower Limit: -10		
			Size (bits): 16	Upper Limit: 10		
			Sign: S			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41182	Speed Bias Output / Configurable Analog Output #1 Analog Output Function Pointer	Read Only	0: Default		Points to the function that controls the analog output	PCC3300V2
			1: Do Nothing			
			2: Genset Average Voltage			
			3: Genset Average Current			
			4: Genset Total Power Factor			
			5: Genset Frequency			
			6: Genset Total kW			
			7: Genset Total kVAR			
			8: Engine Speed			
			9: Coolant Temperature			
			10: Oil Pressure			
			11: Oil Temperature			
			12: Intake Manifold Temperature			
			13: Genset % Application Total kW			
41183	Speed Bias Output / Configurable Analog output #1 Engineering In High Function Setpoint	Read Only	Multiplier: 1	Unit:	The engineering value that corresponds to the High Analog output value (scaling unit)	PCC3300V2
			Offset: 0	Lower Limit: -32768		
			Size (bits): 16	Upper Limit: 32762		
			Sign: S			
41184	Speed Bias Output / Configurable Analog output #1 Engineering In High Setpoint	Read Only	Multiplier: 1	Unit:	The engineering value that corresponds to the High Analog output value (scaling unit)	PCC3300V2
			Offset: 0	Lower Limit: -32768		
			Size (bits): 16	Upper Limit: 32762		
			Sign: S			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41185	Speed Bias Output / Configurable Analog output #1 Engineering In Low Function Setpoint	Read Only	Multiplier: 1	Unit:	The engineering value that corresponds to the Low Analog output value (scaling unit)	PCC3300V2
			Offset: 0	Lower Limit: -32768		
			Size (bits): 16	Upper Limit: 32762		
			Sign: S			
41186	Speed Bias Output / Configurable Analog output #1 Engineering In Low Setpoint	Read Only	Multiplier: 1	Unit:	The engineering value that corresponds to the Low Analog output value (scaling unit)	PCC3300V2
			Offset: 0	Lower Limit: -32768		
			Size (bits): 16	Upper Limit: 32762		
			Sign: S			
41187	Maintenance Due wrt ERT	Read Only	Multiplier: 0.01	Unit: hours	Displays Maintenance required with respect to Engine Running Hours	PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 32	Upper Limit: 4294967295		
			Sign: U			
41188	Maintenance Due wrt ERT	Read Only	Multiplier: 0.01	Unit: hours	Displays Maintenance required with respect to Engine Running Hours	PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 32	Upper Limit: 4294967295		
			Sign: U			
41189	ECM HOT Warning Threshold	Read Only	Multiplier: 0.1	Unit: degF	"Displays High Engine Oil Temperature Warning Threshold value received via ECM over CAN(OTIS)"	PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
41190	ECM HOT Shutdown Threshold	Read Only	Multiplier: 0.1	Unit: degF	"Displays High Engine Oil Temperature Shutdown Threshold value received via ECM over CAN(OTIS)"	PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
41191	ECM HCP Warning Threshold	Read Only	Multiplier: 0.1	Unit: psi	"Displays High Crankcase Pressure Warning Threshold value received via ECM over CAN(OTIS)"	PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41192	ECM HCP Shutdown Threshold	Read Only	Multiplier: 0.1	Unit: psi	"Displays High Crankcase Pressure Shutdown Threshold value received via ECM over CAN(OTIS)"	PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
41193	ECM Overspeed Shutdown Threshold	Read Only	Multiplier: 1	Unit: rpm	"Displays Engine Overspeed Shutdown Threshold received via ECM over CAN(OTIS)"	PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
41194	ECM LOP Warning Threshold (1500 rpm)	Read Only	Multiplier: 0.01	Unit: psi	"Displays Low Engine Oil Pressure Warning Threshold value for 1500 rpm received via ECM over CAN(OTIS)"	PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
41195	ECM LOP Warning Threshold (1800 rpm)	Read Only	Multiplier: 0.01	Unit: psi	"Displays Low Engine Oil Pressure Warning Threshold value for 1800 rpm received via ECM over CAN(OTIS)"	PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
41196	ECM LOP Shutdown Threshold (1500 rpm)	Read Only	Multiplier: 0.01	Unit: psi	"Displays Low Engine Oil Pressure Shutdown Threshold value for 1500 rpm received via ECM over CAN(OTIS)"	PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
41197	ECM LOP Shutdown Threshold (1800 rpm)	Read Only	Multiplier: 0.01	Unit: psi	"Displays Low Engine Oil Pressure Shutdown Threshold value for 1800 rpm received via ECM over CAN(OTIS)"	PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
41198	ECM HCT Warning Threshold	Read Only	Multiplier: 0.1	Unit: degF	"Displays High Coolant Temperature Warning Threshold value received via ECM over CAN(OTIS)"	PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			

Modbus Address	Parameter/System Name	Modbus Access	Specifications		Description	Control Boards
41199	ECM HCT Shutdown/w Cooldown Threshold	Read Only	Multiplier: 0.1	Unit: degF	"Displays High Coolant Temperature Shutdown with Cooldown Threshold value received via ECM over CAN(OTIS)"	PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
41200	ECM HCT Shutdown Threshold	Read Only	Multiplier: 0.1	Unit: degF	"Displays High Coolant Temperature Shutdown Threshold value received via ECM over CAN(OTIS)"	PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
41300	AmpSentry Maintenance Mode Status	Read Only	0: Inactive		"A protection mode that causes the alternator to shutdown instantly when a short circuit is detected. Used to limit arc flash energy with personnel working around set."	PCC3300, PCC2300, PCC3300V2
			1: Active			
41303	Fuel System	Read/Write	0: Diesel		Type of fuel and ignition system used by genset.	PCC3300, PCC2300, PCC3300V2
			1: Gas			
41304	Gas Fuel Type	Read/Write	0: Natural Gas		"Trim to set the type of gaseous fuel."	PCC2300, PCC3300, PCC3300V2
			1: Propane			
			2: Dual			
41305	Low Fuel Pressure Switch Status	Read Only	0: Inactive		"Displays Inactive/Active status of Switch. Activates if Low Fuel Pressure switch remains active for Fuel Pressure Fault delay."	PCC2300, PCC3300, PCC3300V2
			1: Active			
41306	Maintenance ERT Interval	Read/Write	Multiplier: 1	Unit: hours	Sets Hours for Maintenance Diagnostic	PCC3300V2
			Offset: 0	Lower Limit: 250		
			Size (bits): 16	Upper Limit: 5000		
			Sign: U			
41307	Maintenance RTC Date Interval	Read/Write	Multiplier: 1	Unit:	Sets Real Time Clock Date for Maintenance Diagnostic	PCC3300V2
			Offset: 0	Lower Limit: 1		
			Size (bits): 8	Upper Limit: 31		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
41308	Maintenance RTC Month Interval	Read/Write	Multiplier: 1	Unit:	Sets Real Time Clock Month for Maintenance Diagnostic	PCC3300V2
			Offset: 0	Lower Limit: 1		
			Size (bits): 8	Upper Limit: 12		
			Sign: U			
41309	Maintenance RTC Year Interval	Read/Write	Multiplier: 1	Unit:	Sets Real Time Clock Year for Maintenance Diagnostic	PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 8	Upper Limit: 99		
			Sign: U			
42000	Load Demand State	Read Only	0: Off		Indicates the status of Load Demand operation.	PCC3300, PCC3300V2
			1: Halted			
			2: Initial Delay			
			3: Load Monitor			
42001	Load Demand Genset Bus Total kW	Read Only	Multiplier: 1	Unit: kW	Indicates the total load of System Network connected gensets	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 32	Upper Limit: 80000		
			Sign: U			
42002	Load Demand Genset Bus Total kW	Read Only	Multiplier: 1	Unit: kW	Indicates the total load of System Network connected gensets	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 32	Upper Limit: 80000		
			Sign: U			
42003	Load Demand Surplus Capacity	Read Only	Multiplier: 1	Unit: kW	Indicates the amount of unused online kW bus capacity (spinning reserve).	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 32	Upper Limit: 80000		
			Sign: U			
42004	Load Demand Surplus Capacity	Read Only	Multiplier: 1	Unit: kW	Indicates the amount of unused online kW bus capacity (spinning reserve).	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 32	Upper Limit: 80000		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
42005	Load Demand Online Capacity	Read Only	Multiplier: 1	Unit: kW	Indicates the total amount of online kW bus capacity for load demand. Only gensets which are eligible for load demand count.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 32	Upper Limit: 80000		
			Sign: U			
42006	Load Demand Online Capacity	Read Only	Multiplier: 1	Unit: kW	Indicates the total amount of online kW bus capacity for load demand. Only gensets which are eligible for load demand count.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 32	Upper Limit: 80000		
			Sign: U			

TABLE 59.

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
42007	Load Demand Initial Delay Timer	Read Only	Multiplier: 1	Unit: seconds	Indicates the time remaining before generator sets are allowed to stop after initial start or after resuming halted load demand. This timer is set by Load Demand Initial Delay.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 1500		
			Sign: U			
42008	Load Demand Start Delay Timer	Read Only	Multiplier: 1	Unit: seconds	Indicates the time remaining before next generator set is allowed to start. This timer is set by Load Demand Start Delay.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 1500		
			Sign: U			
42009	Load Demand Stop Delay Timer	Read Only	Multiplier: 1	Unit: seconds	Indicates the time remaining before next generator set is allowed to stop. This timer is set by Load Demand Stop Delay.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 1500		
			Sign: U			
42010	Load Demand Spare Capacity Available	Read Only	0: No		Indicates when the current load and spare capacity requirements are satisfied.	PCC3300, PCC3300V2
			1: Yes			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
42011	Load Demand Total Spare Capacity Requested	Read Only	Multiplier: 1	Unit: kW	Indicates the total kW value of all currently active spare capacity requests in the system.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 32	Upper Limit: 80000		
			Sign: U			
42012	Load Demand Total Spare Capacity Requested	Read Only	Multiplier: 1	Unit: kW	Indicates the total kW value of all currently active spare capacity requests in the system.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 32	Upper Limit: 80000		
			Sign: U			
42013	Load Demand Next Start Threshold (kW)	Read Only	Multiplier: 1	Unit: kW	The kW load at which the next generator set will be started.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 32	Upper Limit: 80000		
			Sign: U			
42014	Load Demand Next Start Threshold (kW)	Read Only	Multiplier: 1	Unit: kW	The kW load at which the next generator set will be started.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 32	Upper Limit: 80000		
			Sign: U			
42015	Load Demand Next Stop Threshold (kW)	Read Only	Multiplier: 1	Unit: kW	The kW load at which the next generator set will be stopped.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 32	Upper Limit: 80000		
			Sign: U			
42016	Load Demand Next Stop Threshold (kW)	Read Only	Multiplier: 1	Unit: kW	The kW load at which the next generator set will be stopped.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 32	Upper Limit: 80000		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
42017	Load Demand Next Gen to Start	Read Only	0: Gen1		Indicates the next generator set to start by ID.	PCC3300, PCC3300V2
			1: Gen2			
			2: Gen3			
			3: Gen4			
			4: Gen5			
			5: Gen6			
			6: Gen7			
			7: Gen8			
			8: Gen9			
			9: Gen10			
			10: Gen11			
			11: Gen12			
			12: Gen13			
			13: Gen14			
			14: Gen15			
			15: Gen16			
42018	Load Demand Next Gen to Stop	Read Only	0: Gen1		Indicates the next generator set to stop by ID.	PCC3300, PCC3300V2
			1: Gen2			
			2: Gen3			
			3: Gen4			
			4: Gen5			
			5: Gen6			
			6: Gen7			
			7: Gen8			
			8: Gen9			
			9: Gen10			
			10: Gen11			
			11: Gen12			
			12: Gen13			
			13: Gen14			
			14: Gen15			
			15: Gen16			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
42019	Load Demand Inhibit Local	Read Only	0: Inactive		Indicates the status of the Load Demand Inhibit input. When ACTIVE all the generator sets will start.	PCC3300, PCC3300V2
			1: Active			
42020	ECM 4 Code	Read Only	Multiplier: 1	Unit:	"ECM 4 Calibration ID (DM19)"	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 88	Upper Limit:		
			Sign: C			
42021	ECM 4 Code	Read Only	Multiplier: 1	Unit:	"ECM 4 Calibration ID (DM19)"	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 88	Upper Limit:		
			Sign: C			
42022	ECM 4 Code	Read Only	Multiplier: 1	Unit:	"ECM 4 Calibration ID (DM19)"	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 88	Upper Limit:		
			Sign: C			
42023	ECM 4 Code	Read Only	Multiplier: 1	Unit:	"ECM 4 Calibration ID (DM19)"	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 88	Upper Limit:		
			Sign: C			
42024	ECM 4 Code	Read Only	Multiplier: 1	Unit:	"ECM 4 Calibration ID (DM19)"	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 88	Upper Limit:		
			Sign: C			
42025	ECM 4 Code	Read Only	Multiplier: 1	Unit:	"ECM 4 Calibration ID (DM19)"	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 88	Upper Limit:		
			Sign: C			
42026	ECM 4 Code	Read Only	Multiplier: 1	Unit:	"ECM 4 Calibration ID (DM19)"	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 88	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
42027	ECM 4 Code	Read Only	Multiplier: 1	Unit:	"ECM 4 Calibration ID (DM19)"	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 88	Upper Limit:		
			Sign: C			
42028	ECM 4 Code	Read Only	Multiplier: 1	Unit:	"ECM 4 Calibration ID (DM19)"	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 88	Upper Limit:		
			Sign: C			
42029	ECM 4 Code	Read Only	Multiplier: 1	Unit:	"ECM 4 Calibration ID (DM19)"	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 88	Upper Limit:		
			Sign: C			
43000	Genset % Application L1 Current	Read Only	Multiplier: 0.1	Unit: %	Monitors the generator set application L1 current percentage output.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43001	Genset % Application L2 Current	Read Only	Multiplier: 0.1	Unit: %	Monitors the generator set application L2 current percentage output.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43002	Genset % Application L1 kVA	Read Only	Multiplier: 0.1	Unit: %	Monitors the generator set application L1 KVA percentage output.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43003	Genset % Application L3 Current	Read Only	Multiplier: 0.1	Unit: %	Monitors the generator set application L3 current percentage output.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43004	Genset % Application L2 kVA	Read Only	Multiplier: 0.1	Unit: %	Monitors the generator set application L2 KVA percentage output.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43005	Genset % Application L3 kVA	Read Only	Multiplier: 0.1	Unit: %	Monitors the generator set application L3 KVA percentage output.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43006	Genset % Application L1 kW	Read Only	Multiplier: 0.1	Unit: %	Monitors the generator set application L1 KW percentage output.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
43007	Genset % Application L2 kW	Read Only	Multiplier: 0.1	Unit: %	Monitors the generator set application L2 KW percentage output.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
43008	Genset % Application L3 kW	Read Only	Multiplier: 0.1	Unit: %	Monitors the generator set application L3 KW percentage output.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
43009	Genset % Application Total kVA	Read Only	Multiplier: 0.1	Unit: %	Monitors the total generator set application KVA percentage output.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43010	Genset % Application Total kW	Read Only	Multiplier: 0.1	Unit: %	Monitors the total generator set application KW percentage output.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
43017	Genset % Standby Total kVA	Read Only	Multiplier: 0.1	Unit: %	Monitors the total generator set standby KVA percentage output.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43018	Genset Application kVA rating	Read Only	Multiplier: 0.1	Unit: kVA	The generator set KVA rating.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43019	Genset Application kW rating	Read Only	Multiplier: 0.1	Unit: kW	The generator set KW rating.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43020	Genset Application Nominal Current	Read Only	Multiplier: 1	Unit: Amps	The value of the generator set application nominal current. Displayed as "Genset Application Rated Current" in HMI	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43021	Genset Average Voltage%	Read Only	Multiplier: 0.01	Unit: %	Generator set average voltage percentage.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43030	Genset L1 Power Factor	Read Only	Multiplier: 0.01	Unit: PF	Generator set L1 power factor	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 8	Upper Limit:		
			Sign: S			
43031	Genset L1L2 Phase Difference	Read Only	Multiplier: 0.01	Unit: Degrees	Generator set L1L2 voltage phase angle	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43032	Genset L1L2 Voltage%	Read Only	Multiplier: 0.01	Unit: %	Generator set L1L2 voltage%	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43033	Genset L1N Voltage%	Read Only	Multiplier: 0.01	Unit: %	Generator set L1N voltage%	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43044	Genset L2 Power Factor	Read Only	Multiplier: 0.01	Unit: PF	Generator set L2 power factor	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: -1.28		
			Size (bits): 8	Upper Limit: 1.27		
			Sign: S			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43045	Genset L2L3 Phase Difference	Read Only	Multiplier: 0.01	Unit: Degrees	Generator set L2L3 voltage phase angle	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 655.3		
			Sign: U			
43046	Genset L2L3 Voltage%	Read Only	Multiplier: 0.01	Unit: %	Generator set L2L3 voltage%	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43047	Genset L2N Voltage%	Read Only	Multiplier: 0.01	Unit: %	Generator set L2N voltage%	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 655.3		
			Sign: U			
43058	Genset L3 Power Factor	Read Only	Multiplier: 0.01	Unit: PF	Generator set L3 power factor	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: -1.28		
			Size (bits): 8	Upper Limit: 1.22		
			Sign: S			
43059	Genset L3L1 Phase Difference	Read Only	Multiplier: 0.01	Unit: Degrees	Generator set L3L1 voltage phase angle	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 655.3		
			Sign: U			
43060	Genset L3L1 Voltage%	Read Only	Multiplier: 0.01	Unit: %	Generator set L3L1 voltage%	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 655.3		
			Sign: U			
43061	Genset L3N Voltage%	Read Only	Multiplier: 0.01	Unit: %	Generator set L3N voltage%	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43062	Genset Standby kVA rating	Read Only	Multiplier: 0.1	Unit: kVA	KVA rating for the generator set in Standby configuration.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43063	Genset Standby kW rating	Read Only	Multiplier: 0.1	Unit: kW	KW rating for the generator set in Standby configuration.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43064	Genset Standby Nominal Current	Read Only	Multiplier: 1	Unit: Amps	The value of the generator set standby nominal current. Displayed as "Genset Standby Rated Current" in HMI	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43065	Genset Total kVAh	Read Only	Multiplier: 1	Unit: kVAh	Generator set total kVAh accumulation	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
43066	Genset Total kVAh	Read Only	Multiplier: 1	Unit: kVAh	Generator set total kVAh accumulation	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
43067	Genset Total kVARs per Standby kVA	Read Only	Multiplier: 0.01	Unit: %	Total KVAR's per Standby KVA.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
43111	Genset Bus L1 Power Factor	Read Only	Multiplier: 0.01	Unit: PF	Generator set Bus L1 power factor	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: -1.28		
			Size (bits): 8	Upper Limit: 1.22		
			Sign: S			
43112	Genset Bus L1L2 Phase Difference	Read Only	Multiplier: 0.01	Unit: Degrees	Generator set bus L1L2 voltage phase angle	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43125	Genset Bus L2 Power Factor	Read Only	Multiplier: 0.01	Unit: PF	Generator set Bus L2 power factor	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 8	Upper Limit:		
			Sign: S			
43126	Genset Bus L2L3 Phase Difference	Read Only	Multiplier: 0.01	Unit: Degrees	Generator set bus L2L3 voltage phase angle	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43139	Genset Bus L3 Power Factor	Read Only	Multiplier: 0.01	Unit: PF	Generator set Bus L3 power factor	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: -1.28		
			Size (bits): 8	Upper Limit: 1.22		
			Sign: S			
43140	Genset Bus L3L1 Phase Difference	Read Only	Multiplier: 0.01	Unit: Degrees	Generator set bus L3L1 voltage phase angle	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43143	Genset Bus Total kVAh	Read Only	Multiplier: 1	Unit: kVAh	Generator set bus total kVAh accumulation	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
43144	Genset Bus Total kVAh	Read Only	Multiplier: 1	Unit: kVAh	Generator set bus total kVAh accumulation	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
43146	Paralleling Application	Read/Write	0: None		Determines what the function of the Other Meter is.	PCC3300, PCC3300V2
			1: Utility			
			2: Genset Bus			
43162	Utility L1 Power Factor	Read Only	Multiplier: 0.01	Unit: PF	Utility L1 power factor	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 8	Upper Limit:		
			Sign: S			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43163	Utility L1L2 Phase Difference	Read Only	Multiplier: 0.01	Unit: Degrees	Utility L1L2 voltage phase angle	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43176	Utility L2 Power Factor	Read Only	Multiplier: 0.01	Unit: PF	Utility L2 power factor	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 8	Upper Limit:		
			Sign: S			
43177	Utility L2L3 Phase Difference	Read Only	Multiplier: 0.01	Unit: Degrees	Utility L2L3 voltage phase angle	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43190	Utility L3 Power Factor	Read Only	Multiplier: 0.01	Unit: PF	Utility L3 power factor	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 8	Upper Limit:		
			Sign: S			
43191	Utility L3L1 Phase Difference	Read Only	Multiplier: 0.01	Unit: Degrees	Utility L3L1 voltage phase angle	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43194	Utility Total kVAh	Read Only	Multiplier: 1	Unit: kVAh	Utility total kVAh accumulation	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
43195	Utility Total kVAh	Read Only	Multiplier: 1	Unit: kVAh	Utility total kVAh accumulation	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
43196	Exhaust Stack Temperature Right Bank	Read Only	Multiplier: 0.1	Unit: degF	Monitor point for the Exhaust Stack Temperature Right Bank received from ECM	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: -459		
			Size (bits): 16	Upper Limit: 3155		
			Sign: S			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43197	Exhaust Stack Temperature Left Bank	Read Only	Multiplier: 0.1	Unit: degF	Monitor point for the Exhaust Stack Temperature Left Bank received from ECM	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: -459		
			Size (bits): 16	Upper Limit: 3155		
			Sign: S			
43200	Genset Model Number	Read Only	Multiplier: 1	Unit:	Number identifying the model of this generator set. Modbus uses addresses 43200 - 43219 for the 20 char of this string. Uses logical numbers 2064 - 2083 to hold each of the 20 characters.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43201	Genset Model Number	Read Only	Multiplier: 1	Unit:	Number identifying the model of this generator set. Modbus uses addresses 43200 - 43219 for the 20 char of this string. Uses logical numbers 2064 - 2083 to hold each of the 20 characters.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43202	Genset Model Number	Read Only	Multiplier: 1	Unit:	Number identifying the model of this generator set. Modbus uses addresses 43200 - 43219 for the 20 char of this string. Uses logical numbers 2064 - 2083 to hold each of the 20 characters.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43203	Genset Model Number	Read Only	Multiplier: 1	Unit:	Number identifying the model of this generator set. Modbus uses addresses 43200 - 43219 for the 20 char of this string. Uses logical numbers 2064 - 2083 to hold each of the 20 characters.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43204	Genset Model Number	Read Only	Multiplier: 1	Unit:	Number identifying the model of this generator set. Modbus uses addresses 43200 - 43219 for the 20 char of this string. Uses logical numbers 2064 - 2083 to hold each of the 20 characters.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43205	Genset Model Number	Read Only	Multiplier: 1	Unit:	Number identifying the model of this generator set. Modbus uses addresses 43200 - 43219 for the 20 char of this string. Uses logical numbers 2064 - 2083 to hold each of the 20 characters.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43206	Genset Model Number	Read Only	Multiplier: 1	Unit:	Number identifying the model of this generator set. Modbus uses addresses 43200 - 43219 for the 20 char of this string. Uses logical numbers 2064 - 2083 to hold each of the 20 characters.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43207	Genset Model Number	Read Only	Multiplier: 1	Unit:	Number identifying the model of this generator set. Modbus uses addresses 43200 - 43219 for the 20 char of this string. Uses logical numbers 2064 - 2083 to hold each of the 20 characters.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43208	Genset Model Number	Read Only	Multiplier: 1	Unit:	Number identifying the model of this generator set. Modbus uses addresses 43200 - 43219 for the 20 char of this string. Uses logical numbers 2064 - 2083 to hold each of the 20 characters.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43209	Genset Model Number	Read Only	Multiplier: 1	Unit:	Number identifying the model of this generator set. Modbus uses addresses 43200 - 43219 for the 20 char of this string. Uses logical numbers 2064 - 2083 to hold each of the 20 characters.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43210	Genset Model Number	Read Only	Multiplier: 1	Unit:	Number identifying the model of this generator set. Modbus uses addresses 43200 - 43219 for the 20 char of this string. Uses logical numbers 2064 - 2083 to hold each of the 20 characters.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43211	Genset Model Number	Read Only	Multiplier: 1	Unit:	Number identifying the model of this generator set. Modbus uses addresses 43200 - 43219 for the 20 char of this string. Uses logical numbers 2064 - 2083 to hold each of the 20 characters.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43212	Genset Model Number	Read Only	Multiplier: 1	Unit:	Number identifying the model of this generator set. Modbus uses addresses 43200 - 43219 for the 20 char of this string. Uses logical numbers 2064 - 2083 to hold each of the 20 characters.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43213	Genset Model Number	Read Only	Multiplier: 1	Unit:	Number identifying the model of this generator set. Modbus uses addresses 43200 - 43219 for the 20 char of this string. Uses logical numbers 2064 - 2083 to hold each of the 20 characters.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43214	Genset Model Number	Read Only	Multiplier: 1	Unit:	Number identifying the model of this generator set. Modbus uses addresses 43200 - 43219 for the 20 char of this string. Uses logical numbers 2064 - 2083 to hold each of the 20 characters.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43215	Genset Model Number	Read Only	Multiplier: 1	Unit:	Number identifying the model of this generator set. Modbus uses addresses 43200 - 43219 for the 20 char of this string. Uses logical numbers 2064 - 2083 to hold each of the 20 characters.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43216	Genset Model Number	Read Only	Multiplier: 1	Unit:	Number identifying the model of this generator set. Modbus uses addresses 43200 - 43219 for the 20 char of this string. Uses logical numbers 2064 - 2083 to hold each of the 20 characters.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43217	Genset Model Number	Read Only	Multiplier: 1	Unit:	Number identifying the model of this generator set. Modbus uses addresses 43200 - 43219 for the 20 char of this string. Uses logical numbers 2064 - 2083 to hold each of the 20 characters.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43218	Genset Model Number	Read Only	Multiplier: 1	Unit:	Number identifying the model of this generator set. Modbus uses addresses 43200 - 43219 for the 20 char of this string. Uses logical numbers 2064 - 2083 to hold each of the 20 characters.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43219	Genset Model Number	Read Only	Multiplier: 1	Unit:	Number identifying the model of this generator set. Modbus uses addresses 43200 - 43219 for the 20 char of this string. Uses logical numbers 2064 - 2083 to hold each of the 20 characters.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43220	Genset Serial Number	Read Only	Multiplier: 1	Unit:	Serial number of identifying this generator set. Modbus uses addresses 43220 - 43239 for the 20 char of this string. Uses logical addresses 2048 - 6063 to store the first 16 characters. The last 4 are stored in 691-694.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43221	Genset Serial Number	Read Only	Multiplier: 1	Unit:	Serial number of identifying this generator set. Modbus uses addresses 43220 - 43239 for the 20 char of this string. Uses logical addresses 2048 - 6063 to store the first 16 characters. The last 4 are stored in 691-694.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43222	Genset Serial Number	Read Only	Multiplier: 1	Unit:	Serial number of identifying this generator set. Modbus uses addresses 43220 - 43239 for the 20 char of this string. Uses logical addresses 2048 - 6063 to store the first 16 characters. The last 4 are stored in 691-694.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43223	Genset Serial Number	Read Only	Multiplier: 1	Unit:	Serial number of identifying this generator set. Modbus uses addresses 43220 - 43239 for the 20 char of this string. Uses logical addresses 2048 - 6063 to store the first 16 characters. The last 4 are stored in 691-694.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43224	Genset Serial Number	Read Only	Multiplier: 1	Unit:	Serial number of identifying this generator set. Modbus uses addresses 43220 - 43239 for the 20 char of this string. Uses logical addresses 2048 - 6063 to store the first 16 characters. The last 4 are stored in 691-694.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43225	Genset Serial Number	Read Only	Multiplier: 1	Unit:	Serial number of identifying this generator set. Modbus uses addresses 43220 - 43239 for the 20 char of this string. Uses logical addresses 2048 - 6063 to store the first 16 characters. The last 4 are stored in 691-694.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43226	Genset Serial Number	Read Only	Multiplier: 1	Unit:	Serial number of identifying this generator set. Modbus uses addresses 43220 - 43239 for the 20 char of this string. Uses logical addresses 2048 - 6063 to store the first 16 characters. The last 4 are stored in 691-694.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43227	Genset Serial Number	Read Only	Multiplier: 1	Unit:	Serial number of identifying this generator set. Modbus uses addresses 43220 - 43239 for the 20 char of this string. Uses logical addresses 2048 - 6063 to store the first 16 characters. The last 4 are stored in 691-694.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43228	Genset Serial Number	Read Only	Multiplier: 1	Unit:	Serial number of identifying this generator set. Modbus uses addresses 43220 - 43239 for the 20 char of this string. Uses logical addresses 2048 - 6063 to store the first 16 characters. The last 4 are stored in 691-694.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43229	Genset Serial Number	Read Only	Multiplier: 1	Unit:	Serial number of identifying this generator set. Modbus uses addresses 43220 - 43239 for the 20 char of this string. Uses logical addresses 2048 - 6063 to store the first 16 characters. The last 4 are stored in 691-694.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43230	Genset Serial Number	Read Only	Multiplier: 1	Unit:	Serial number of identifying this generator set. Modbus uses addresses 43220 - 43239 for the 20 char of this string. Uses logical addresses 2048 - 6063 to store the first 16 characters. The last 4 are stored in 691-694.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43231	Genset Serial Number	Read Only	Multiplier: 1	Unit:	Serial number of identifying this generator set. Modbus uses addresses 43220 - 43239 for the 20 char of this string. Uses logical addresses 2048 - 6063 to store the first 16 characters. The last 4 are stored in 691-694.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43232	Genset Serial Number	Read Only	Multiplier: 1	Unit:	Serial number of identifying this generator set. Modbus uses addresses 43220 - 43239 for the 20 char of this string. Uses logical addresses 2048 - 6063 to store the first 16 characters. The last 4 are stored in 691-694.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43233	Genset Serial Number	Read Only	Multiplier: 1	Unit:	Serial number of identifying this generator set. Modbus uses addresses 43220 - 43239 for the 20 char of this string. Uses logical addresses 2048 - 6063 to store the first 16 characters. The last 4 are stored in 691-694.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43234	Genset Serial Number	Read Only	Multiplier: 1	Unit:	Serial number of identifying this generator set. Modbus uses addresses 43220 - 43239 for the 20 char of this string. Uses logical addresses 2048 - 6063 to store the first 16 characters. The last 4 are stored in 691-694.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43235	Genset Serial Number	Read Only	Multiplier: 1	Unit:	Serial number of identifying this generator set. Modbus uses addresses 43220 - 43239 for the 20 char of this string. Uses logical addresses 2048 - 6063 to store the first 16 characters. The last 4 are stored in 691-694.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43236	Genset Serial Number	Read Only	Multiplier: 1	Unit:	Serial number of identifying this generator set. Modbus uses addresses 43220 - 43239 for the 20 char of this string. Uses logical addresses 2048 - 6063 to store the first 16 characters. The last 4 are stored in 691-694.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43237	Genset Serial Number	Read Only	Multiplier: 1	Unit:	Serial number of identifying this generator set. Modbus uses addresses 43220 - 43239 for the 20 char of this string. Uses logical addresses 2048 - 6063 to store the first 16 characters. The last 4 are stored in 691-694.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43238	Genset Serial Number	Read Only	Multiplier: 1	Unit:	Serial number of identifying this generator set. Modbus uses addresses 43220 - 43239 for the 20 char of this string. Uses logical addresses 2048 - 6063 to store the first 16 characters. The last 4 are stored in 691-694.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43239	Genset Serial Number	Read Only	Multiplier: 1	Unit:	Serial number of identifying this generator set. Modbus uses addresses 43220 - 43239 for the 20 char of this string. Uses logical addresses 2048 - 6063 to store the first 16 characters. The last 4 are stored in 691-694.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43240	Alternator Model Number	Read Only	Multiplier: 1	Unit:	Number identifying this generator set's alternator model number. Modbus uses addresses 43240 - 43259 for the 20 char text string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43241	Alternator Model Number	Read Only	Multiplier: 1	Unit:	Number identifying this generator set's alternator model number. Modbus uses addresses 43240 - 43259 for the 20 char text string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43242	Alternator Model Number	Read Only	Multiplier: 1	Unit:	Number identifying this generator set's alternator model number. Modbus uses addresses 43240 - 43259 for the 20 char text string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43243	Alternator Model Number	Read Only	Multiplier: 1	Unit:	Number identifying this generator set's alternator model number. Modbus uses addresses 43240 - 43259 for the 20 char text string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43244	Alternator Model Number	Read Only	Multiplier: 1	Unit:	Number identifying this generator set's alternator model number. Modbus uses addresses 43240 - 43259 for the 20 char text string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43245	Alternator Model Number	Read Only	Multiplier: 1	Unit:	Number identifying this generator set's alternator model number. Modbus uses addresses 43240 - 43259 for the 20 char text string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43246	Alternator Model Number	Read Only	Multiplier: 1	Unit:	Number identifying this generator set's alternator model number. Modbus uses addresses 43240 - 43259 for the 20 char text string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43247	Alternator Model Number	Read Only	Multiplier: 1	Unit:	Number identifying this generator set's alternator model number. Modbus uses addresses 43240 - 43259 for the 20 char text string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43248	Alternator Model Number	Read Only	Multiplier: 1	Unit:	Number identifying this generator set's alternator model number. Modbus uses addresses 43240 - 43259 for the 20 char text string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43249	Alternator Model Number	Read Only	Multiplier: 1	Unit:	Number identifying this generator set's alternator model number. Modbus uses addresses 43240 - 43259 for the 20 char text string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43250	Alternator Model Number	Read Only	Multiplier: 1	Unit:	Number identifying this generator set's alternator model number. Modbus uses addresses 43240 - 43259 for the 20 char text string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43251	Alternator Model Number	Read Only	Multiplier: 1	Unit:	Number identifying this generator set's alternator model number. Modbus uses addresses 43240 - 43259 for the 20 char text string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43252	Alternator Model Number	Read Only	Multiplier: 1	Unit:	Number identifying this generator set's alternator model number. Modbus uses addresses 43240 - 43259 for the 20 char text string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43253	Alternator Model Number	Read Only	Multiplier: 1	Unit:	Number identifying this generator set's alternator model number. Modbus uses addresses 43240 - 43259 for the 20 char text string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43254	Alternator Model Number	Read Only	Multiplier: 1	Unit:	Number identifying this generator set's alternator model number. Modbus uses addresses 43240 - 43259 for the 20 char text string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43255	Alternator Model Number	Read Only	Multiplier: 1	Unit:	Number identifying this generator set's alternator model number. Modbus uses addresses 43240 - 43259 for the 20 char text string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43256	Alternator Model Number	Read Only	Multiplier: 1	Unit:	Number identifying this generator set's alternator model number. Modbus uses addresses 43240 - 43259 for the 20 char text string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43257	Alternator Model Number	Read Only	Multiplier: 1	Unit:	Number identifying this generator set's alternator model number. Modbus uses addresses 43240 - 43259 for the 20 char text string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43258	Alternator Model Number	Read Only	Multiplier: 1	Unit:	Number identifying this generator set's alternator model number. Modbus uses addresses 43240 - 43259 for the 20 char text string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43259	Alternator Model Number	Read Only	Multiplier: 1	Unit:	Number identifying this generator set's alternator model number. Modbus uses addresses 43240 - 43259 for the 20 char text string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43260	Alternator Serial Number	Read Only	Multiplier: 1	Unit:	Unique number identifying this generator set's alternator serial number. Modbus uses addresses 43260 - 43279 for the 20 char text string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43261	Alternator Serial Number	Read Only	Multiplier: 1	Unit:	Unique number identifying this generator set's alternator serial number. Modbus uses addresses 43260 - 43279 for the 20 char text string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43262	Alternator Serial Number	Read Only	Multiplier: 1	Unit:	Unique number identifying this generator set's alternator serial number. Modbus uses addresses 43260 - 43279 for the 20 char text string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43263	Alternator Serial Number	Read Only	Multiplier: 1	Unit:	Unique number identifying this generator set's alternator serial number. Modbus uses addresses 43260 - 43279 for the 20 char text string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43264	Alternator Serial Number	Read Only	Multiplier: 1	Unit:	Unique number identifying this generator set's alternator serial number. Modbus uses addresses 43260 - 43279 for the 20 char text string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43265	Alternator Serial Number	Read Only	Multiplier: 1	Unit:	Unique number identifying this generator set's alternator serial number. Modbus uses addresses 43260 - 43279 for the 20 char text string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43266	Alternator Serial Number	Read Only	Multiplier: 1	Unit:	Unique number identifying this generator set's alternator serial number. Modbus uses addresses 43260 - 43279 for the 20 char text string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43267	Alternator Serial Number	Read Only	Multiplier: 1	Unit:	Unique number identifying this generator set's alternator serial number. Modbus uses addresses 43260 - 43279 for the 20 char text string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43268	Alternator Serial Number	Read Only	Multiplier: 1	Unit:	Unique number identifying this generator set's alternator serial number. Modbus uses addresses 43260 - 43279 for the 20 char text string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

TABLE 60.

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43269	Alternator Serial Number	Read Only	Multiplier: 1	Unit:	Unique number identifying this generator set's alternator serial number. Modbus uses addresses 43260 - 43279 for the 20 char text string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43270	Alternator Serial Number	Read Only	Multiplier: 1	Unit:	Unique number identifying this generator set's alternator serial number. Modbus uses addresses 43260 - 43279 for the 20 char text string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43271	Alternator Serial Number	Read Only	Multiplier: 1	Unit:	Unique number identifying this generator set's alternator serial number. Modbus uses addresses 43260 - 43279 for the 20 char text string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43272	Alternator Serial Number	Read Only	Multiplier: 1	Unit:	Unique number identifying this generator set's alternator serial number. Modbus uses addresses 43260 - 43279 for the 20 char text string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43273	Alternator Serial Number	Read Only	Multiplier: 1	Unit:	Unique number identifying this generator set's alternator serial number. Modbus uses addresses 43260 - 43279 for the 20 char text string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43274	Alternator Serial Number	Read Only	Multiplier: 1	Unit:	Unique number identifying this generator set's alternator serial number. Modbus uses addresses 43260 - 43279 for the 20 char text string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43275	Alternator Serial Number	Read Only	Multiplier: 1	Unit:	Unique number identifying this generator set's alternator serial number. Modbus uses addresses 43260 - 43279 for the 20 char text string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/System Name	Modbus Access	Specifications		Description	Control Boards
43276	Alternator Serial Number	Read Only	Multiplier: 1	Unit:	Unique number identifying this generator set's alternator serial number. Modbus uses addresses 43260 - 43279 for the 20 char text string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43277	Alternator Serial Number	Read Only	Multiplier: 1	Unit:	Unique number identifying this generator set's alternator serial number. Modbus uses addresses 43260 - 43279 for the 20 char text string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43278	Alternator Serial Number	Read Only	Multiplier: 1	Unit:	Unique number identifying this generator set's alternator serial number. Modbus uses addresses 43260 - 43279 for the 20 char text string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43279	Alternator Serial Number	Read Only	Multiplier: 1	Unit:	Unique number identifying this generator set's alternator serial number. Modbus uses addresses 43260 - 43279 for the 20 char text string.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43280	Coolant Level Switch	Read Only	0: Inactive		Coolant Level input software state status. Gives software Inactive/Active state	PCC3300, PCC2300, PCC3300V2
			1: Active			
43281	Coolant Level/Configurable Input #5 Switch	Read Only	0: Inactive		This is the status of the Configurable Input #5.	PCC3300, PCC2300, PCC3300V2
			1: Active			
43283	Fault Reset Switch	Read Only	0: Inactive		Fault Reset input software state status. Gives software Inactive/Active state	PCC3300, PCC2300, PCC3300V2
			1: Active			
43284	Fault Reset/Configurable Input #10 Switch	Read Only	0: Inactive		This is the status of the Configurable Input #10.	PCC3300, PCC2300, PCC3300V2
			1: Active			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43285	Genset CB Inhibit/Configurable Input #28 Switch	Read Only	0: Inactive		This is the status of the Configurable Input #28.	PCC3300, PCC3300V2
			1: Active			
43286	Genset CB Pos B/Configurable Input #26 Switch	Read Only	0: Inactive		This is the status of the Configurable Input #26.	PCC3300, PCC3300V2
			1: Active			
43287	Genset CB Tripped/Configurable Input #27 Switch	Read Only	0: Inactive		This is the status of the Configurable Input #27.	PCC3300, PCC3300V2
			1: Active			
43289	Genset CB Pos A Switch	Read Only	0: Inactive		Generator set CB Pos A input software state status. Gives software Inactive/Active state	PCC3300, PCC3300V2
			1: Active			
43290	Genset CB Pos B Switch	Read Only	0: Inactive		Generator set CB Pos B input software state status. Gives software Inactive/Active state	PCC3300, PCC3300V2
			1: Active			
43292	Ground Fault Switch	Read Only	0: Inactive		Ground Fault Switch function output status. Gives software Inactive/Active state	PCC3300, PCC2300, PCC3300V2
			1: Active			
43293	High Alt Temp Switch	Read Only	0: Inactive		High Alt Temp Switch function output status. Gives software Inactive/Active state	PCC3300, PCC2300, PCC3300V2
			1: Active			
43295	Load Demand Stop/Configurable Input #31 Switch	Read Only	0: Inactive		This is the status of the Configurable Input #31.	PCC3300, PCC3300V2
			1: Active			
43296	Local E-stop Switch	Read Only	0: Inactive		Monitors the E-Stop switch.	PCC3300, PCC2300, PCC3300V2
			1: Active			
43297	Low Coolant #2 Switch	Read Only	0: Inactive		Low Coolant #2 Switch function output status. Gives software Inactive/Active state	PCC3300, PCC2300, PCC3300V2
			1: Active			
43298	Low Engine Temperature Switch	Read Only	0: Inactive		Low Engine Temperature Switch function output status. Gives software Inactive/Active state	PCC3300, PCC2300, PCC3300V2
			1: Active			

Modbus Address	Parameter/System Name	Modbus Access	Specifications		Description	Control Boards
43299	Low Fuel In Day Tank Switch	Read Only	0: Inactive		Low Fuel In Day Tank Switch function output status. Gives software Inactive/Active state	PCC3300, PCC2300, PCC3300V2
			1: Active			
43300	Genset Bus Delta/Wye Connection	Read/Write	0: Delta		Delta or Wye for Utility connection	PCC3300, PCC3300V2
			1: Wye			
43301	Genset Bus Nominal Voltage	Read Only	Multiplier: 1	Unit: Vac	Generator set Bus nominal voltage	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 110		
			Size (bits): 16	Upper Limit: 45000		
			Sign: U			
43302	Genset Delta/Wye Connection	Read Only	0: Delta		Delta or Wye for Generator set connection	PCC3300, PCC2300, PCC3300V2
			1: Wye			
43303	Genset Nominal Voltage	Read Only	Multiplier: 1	Unit: Vac	Generator set nominal line-line voltage	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 1		
			Size (bits): 16	Upper Limit: 45000		
			Sign: U			
43304	Single/3 Phase Connection	Read Only	0: Single Phase		Setup mode interlocked. Generator set's single phase/3 phase metering setup configuration.	PCC3300, PCC2300, PCC3300V2
			1: Three Phase			
43306	Utility Delta/Wye Connection	Read/Write	0: Delta		Delta or Wye for Utility connection	PCC3300, PCC3300V2
			1: Wye			
43307	Utility Nominal Voltage	Read Only	Multiplier: 1	Unit: Vac	Utility nominal voltage	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 110		
			Size (bits): 16	Upper Limit: 45000		
			Sign: U			
43309	Overfrequency Enable	Read/Write	0: Disabled		Enables overfrequency diagnostic witness test.	PCC3300, PCC2300, PCC3300V2
			1: Enabled			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43310	Overload Warning Set Time	Read/Write	Multiplier: 1	Unit: seconds	The time delay until an overload condition is reported as a fault	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 1		
			Size (bits): 8	Upper Limit: 120		
			Sign: U			
43311	Overload Warning Threshold	Read/Write	Multiplier: 0.01	Unit: %	Sets the Overload Warning fault trip threshold as percentage of generator set application kW rating.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 70		
			Size (bits): 16	Upper Limit: 140		
			Sign: U			
43312	Overload Shutdown Set Time	Read/Write	Multiplier: 1	Unit: seconds	The time delay until an overload condition is reported as Shutdown fault	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 1		
			Size (bits): 8	Upper Limit: 120		
			Sign: U			
43313	Overload Shutdown threshold	Read/Write	Multiplier: 0.01	Unit: %	"Sets the Overload Shutdown fault trip threshold as percentage of generator set application kW rating in the range of 70 to 140%. To disable the Overload shutdown fault set the value to 655.35 or Not Available."	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 70		
			Size (bits): 16	Upper Limit: 655.35		
			Sign: U			
43314	Prelube Function Owner	Read/Write	0: GCS		Selects whether prelube function is being controlled by GCS or ECS	PCC3300, PCC3300V2
			1: ECS			
43338	CAN Failure Retries	Read/Write	Multiplier: 1	Unit:	Sets the maximum number of CAN communication retries	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 8	Upper Limit: 10		
			Sign: U			
43339	Auto Sleep Enable	Read/Write	0: Awake in Auto		Trim that determines if the control will Stay Awake in Auto mode or Fall asleep in Auto mode.	PCC3300, PCC2300, PCC3300V2
			1: Sleep in Auto			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43340	Max Setup Mode Time	Read/Write	Multiplier: 1	Unit: Seconds	Max time allowed in Setup Mode.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 30		
			Size (bits): 16	Upper Limit: 3600		
			Sign: U			
43341	Power Down Mode Enable	Read/Write	0: Disable		Trim to enable sleep mode	PCC3300, PCC2300, PCC3300V2
			1: Enable			
43342	Power Down Mode Time Delay	Read/Write	Multiplier: 1	Unit: seconds	Timer setting for the Power Down delay feature	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 600		
			Sign: U			
43343	Setup Mode Enable	Read/Write	0: Disable		Volatile to allow entry into Setup Mode	PCC3300, PCC2300, PCC3300V2
			1: Enable			
43344	Clock Date	Read/Write	Multiplier: 1	Unit:	Use to set or read the current date.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 1		
			Size (bits): 8	Upper Limit: 31		
			Sign: U			
43345	Clock Hour	Read/Write	Multiplier: 1	Unit:	Use to set or read the current hour.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 8	Upper Limit: 23		
			Sign: U			
43346	Clock Minute	Read/Write	Multiplier: 1	Unit:	Use to set or read the current minute.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 8	Upper Limit: 59		
			Sign: U			
43347	Clock Mode	Read/Write	0: Normal		Use to set the real time clock and save settings.	PCC3300, PCC2300, PCC3300V2
			1: Set Clock			
			2: Save Clock			
43348	Clock Month	Read/Write	Multiplier: 1	Unit:	Use to set or read the current month.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 1		
			Size (bits): 8	Upper Limit: 12		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43349	Clock Second	Read/Write	Multiplier: 1	Unit:	Use to set or read the current second.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 8	Upper Limit: 59		
			Sign: U			
43350	Clock Year	Read/Write	Multiplier: 1	Unit:	Use to set or read the current year.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 8	Upper Limit: 99		
			Sign: U			
43351	Daylight Savings End Hour	Read/Write	Multiplier: 1	Unit:	Use to set the hour of the day when daylight savings time ends.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 2		
			Size (bits): 8	Upper Limit: 19		
			Sign: U			
43352	Daylight Savings End Month	Read/Write	Multiplier: 1	Unit:	Use to set the month when daylight savings time ends.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 1		
			Size (bits): 8	Upper Limit: 12		
			Sign: U			
43353	Daylight Savings End Week Occurrence in Month	Read/Write	0: First Occurrence		Use to set the week of the month when daylight savings time ends.	PCC3300, PCC2300, PCC3300V2
			1: Second Occurrence			
			2: Third Occurrence			
			3: Fourth Occurrence			
			4: Last Occurrence			
43354	Daylight Savings Start Day	Read/Write	0: Sunday		Use to set the day of the week when daylight savings time starts.	PCC3300, PCC2300, PCC3300V2
			1: Monday			
			2: Tuesday			
			3: Wednesday			
			4: Thursday			
			5: Friday			
			6: Saturday			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43355	Daylight Savings Start Hour	Read/Write	Multiplier: 1	Unit:	Use to set the hour of the day when daylight savings time starts.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 2		
			Size (bits): 8	Upper Limit: 19		
			Sign: U			
43356	Daylight Savings Start Month	Read/Write	Multiplier: 1	Unit:	Use to set the month when daylight savings time starts.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 1		
			Size (bits): 8	Upper Limit: 12		
			Sign: U			
43357	Daylight Savings Start Week Occurrence in Month	Read/Write	0: First Occurrence		Use to set the week of the month when daylight savings time starts.	PCC3300, PCC2300, PCC3300V2
			1: Second Occurrence			
			2: Third Occurrence			
			3: Fourth Occurrence			
			4: Last Occurrence			
43358	Daylight Savings Time Adjustment	Read/Write	Multiplier: 1	Unit: Minutes	Use to set the amount of daylight savings time adjustment applied.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 8	Upper Limit: 120		
			Sign: U			
43359	Daylight Savings Time Enable	Read/Write	0: Disabled		Use to enable the daylight savings time feature.	PCC3300, PCC2300, PCC3300V2
			1: Enabled			
43360	Exercise Scheduler Enable	Read/Write	0: Disabled		Enables the exercise scheduler.	PCC3300, PCC2300, PCC3300V2
			1: Enabled			
43361	Reset Fuel Consumption	Read/Write	0: Inactive		The reset trip fuel consumption command.	PCC3300, PCC2300, PCC3300V2
			1: Active			
43362	Reset Runs	Read/Write	0: Inactive		The reset runs command.	PCC3300, PCC2300, PCC3300V2
			1: Active			
43363	Reset Start Attempts	Read/Write	0: Inactive		The reset start attempts command.	PCC3300, PCC2300, PCC3300V2
			1: Active			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43364	Scheduler Exception Select	Read/Write	Multiplier: 1	Unit:	Used to select an exception to adjust.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 1		
			Size (bits): 8	Upper Limit: 6		
			Sign: U			
43369	Scheduler Exception x Enable	Read/Write	0: Disable		Used to enable or disable the selected exception.	PCC3300, PCC2300, PCC3300V2
			1: Enable			
43374	Scheduler Program Select	Read/Write	Multiplier: 1	Unit:	Used to select a program to adjust.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 1		
			Size (bits): 8	Upper Limit: 12		
			Sign: U			
43377	Scheduler Program x Enable	Read/Write	0: Disable		Used to enable or disable the selected program.	PCC3300, PCC2300, PCC3300V2
			1: Enable			
43379	Scheduler Program x Run Mode	Read/Write	0: No Load		Used to adjust the run mode for the selected program.	PCC3300, PCC3300V2
			1: With Load			
			2: Extended Parallel			
43383	Daylight Savings End Day	Read/Write	0: Sunday		Use to set the day of the week when daylight savings time ends.	PCC3300, PCC2300, PCC3300V2
			1: Monday			
			2: Tuesday			
			3: Wednesday			
			4: Thursday			
			5: Friday			
			6: Saturday			
43502	Idle Rated Command	Read Only	0: Idle		The output command of the Idle/Rated Logic	PCC3300, PCC2300, PCC3300V2
			1: Rated			
43507	Load Dump Overload Condition	Read Only	0: Inactive		Monitors the state of the load dump overload detection algorithm	PCC3300, PCC2300, PCC3300V2
			1: Active			
			2: Reserved			
			3: Not Available			

Modbus Address	Parameter/System Name	Modbus Access	Specifications		Description	Control Boards
43508	Load Dump Underfrequency Condition	Read Only	0: Inactive		The state of the load dump underfrequency detection algorithm	PCC3300, PCC2300, PCC3300V2
			1: Active			
			2: Reserved			
			3: Not Available			
43509	Low Battery Voltage Running Threshold	Read Only	Multiplier: 0.1	Unit: Vdc	The low battery voltage threshold when the generator set is in rated mode	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43510	Low Battery Voltage Stopped Threshold	Read Only	Multiplier: 0.1	Unit: Vdc	The low battery voltage threshold when the generator set is not in rated mode	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43511	Low Battery Voltage Threshold	Read Only	Multiplier: 0.1	Unit: Vdc	The selection of the running or stopped threshold	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43516	Prelube Mode	Read Only	0: Crank After Prelube		Set to a required mode based on the type of starting requirement	PCC3300, PCC2300, PCC3300V2
			1: Crank With Prelube			
			2: Prelube Only			
43517	Prelube State	Read Only	0: Complete		The monitor point for the prelube state.	PCC3300, PCC2300, PCC3300V2
			1: Armed			
			2: Prelube Output ON			
			3: Prelube Output OFF			
			4: Enable Crank			
43524	Remote Start Command	Read Only	0: Stop		The output of the Remote Start Command OR logic	PCC3300, PCC2300, PCC3300V2
			1: Start			
43530	Speed and Voltage Bias Relay Command	Read Only	0: Inactive		Monitor point for the command which closes the on-board relay enabling the voltage and speed bias outputs.	PCC3300, PCC3300V2
			1: Active			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43533	Start Countdown	Read Only	Multiplier: 1	Unit: seconds	Time remaining until start is initiated	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 300		
			Sign: U			
43538	Starter Command	Read Only	0: Inactive		State of hardware output.	PCC3300, PCC2300, PCC3300V2
			1: Active			
			2: Reserved			
			3: Not Available			
43539	Stop Countdown	Read Only	Multiplier: 1	Unit: seconds	Time remaining until generator set stops	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 5000		
			Sign: U			
43543	Time At No Load	Read Only	Multiplier: 1	Unit: seconds	Amount of time the generator set has run at no load	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 600		
			Sign: U			
43544	Time at Rated Cooldown	Read Only	Multiplier: 1	Unit: seconds	Amount of time spend in Rated Cooldown	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 5000		
			Sign: U			
43547	Voltage Setpoint	Read Only	Multiplier: 0.01	Unit: %	The voltage setpoint command	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 150		
			Sign: U			
43550	Weak Battery Threshold	Read Only	Multiplier: 0.1	Unit: Vdc	Monitor point for the weak battery voltage threshold	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 6		
			Size (bits): 16	Upper Limit: 16		
			Sign: U			
43551	Weak Battery Voltage Set Time	Read/Write	Multiplier: 1	Unit: seconds	The time delay until a weak battery condition is reported as a fault	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 1		
			Size (bits): 16	Upper Limit: 5		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43553	Synchronizer Status	Read Only	0: Synchronizer Off		Indicates whether synchronizer is on or off	PCC3300, PCC3300V2
			1: Synchronizer On			
43554	Active Transition Timer	Read Only	Multiplier: 0.1	Unit: seconds	Countdown value of the active transition timer	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43555	Active Transition Type	Read Only	0: None		Indicates the active transition type for PTC	PCC3300, PCC3300V2
			1: Programmed Transition			
			2: Transfer			
			3: Retransfer			
			4: Max Parallel			
43558	ES State	Read Only	0: Standby		Internal paralleling status variable	PCC3300, PCC3300V2
			1: Dead Bus			
			2: Synchronize			
			3: Load Share			
			4: Load Govern			
43560	Genset CB Close Command	Read Only	0: Inactive		Generator set cb close command status	PCC3300, PCC3300V2
			1: Active			
43562	Genset CB Position Status	Read Only	0: Open		Indicates generator set breaker position	PCC3300, PCC3300V2
			1: Closed			
			2: Not Available			
43563	Genset Availability Status	Read Only	0: Not Available		Indicates status of the generator set source	PCC3300, PCC3300V2
			1: Available			
			2: Unknown			
43564	Bus Status	Read Only	0: Unavailable		Indicates status of the bus	PCC3300, PCC3300V2
			1: Dead			
			2: Live			
43565	Genset CB Inhibit Command	Read Only	0: Inactive		Generator set cb inhibit command	PCC3300, PCC3300V2
			1: Active			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43566	Genset CB Tripped Command	Read Only	0: Inactive		Generator set cb tripped command	PCC3300, PCC3300V2
			1: Active			
43568	Genset Frequency Lower Drop-Out Threshold	Read Only	Multiplier: 0.1	Unit: Hz	Indicates the lower drop-out threshold in Hz for generator set frequency sensor	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43569	Genset Frequency Lower Pick-Up Threshold	Read Only	Multiplier: 0.1	Unit: Hz	Indicates the lower pick-up threshold in Hz for generator set frequency sensor	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43570	Genset Frequency Sensor Status	Read Only	0: Unknown		Indicates generator set frequency sensor status	PCC3300, PCC3300V2
			1: Picked Up			
			2: Dropped Out			
43571	Genset Frequency Upper Drop-Out Threshold	Read Only	Multiplier: 0.1	Unit: Hz	Indicates the upper drop-out threshold in Hz for generator set frequency sensor	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43572	Genset Frequency Upper Pick-Up Threshold	Read Only	Multiplier: 0.1	Unit: Hz	Indicates the upper pick-up threshold in Hz for generator set frequency sensor	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43573	Genset Loss of Phase Sensor Status	Read Only	0: Unknown		Indicates generator set loss of phase sensor status	PCC3300, PCC3300V2
			1: Picked Up			
			2: Dropped Out			
43574	Genset Overvoltage Drop-Out Threshold	Read Only	Multiplier: 1	Unit: Vac	Indicates the drop-out threshold in volts for generator set overvoltage sensor	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43575	Genset Overvoltage Pick-Up Threshold	Read Only	Multiplier: 1	Unit: Vac	Indicates the pick-up threshold in volts for generator set overvoltage sensor	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43576	Genset Overvoltage Sensor Status	Read Only	0: Unknown		Indicates generator set overvoltage sensor status	PCC3300, PCC3300V2
			1: Picked Up			
			2: Dropped Out			
43577	Genset Phase Rotation Sensor Status	Read Only	0: Unknown		Indicates generator set phase rotation sensor status	PCC3300, PCC3300V2
			1: Picked Up			
			2: Dropped Out			
43578	Genset Undervoltage Drop-Out Threshold	Read Only	Multiplier: 1	Unit: Vac	Indicates the drop-out threshold in volts for generator set undervoltage sensor	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43579	Genset Undervoltage Pick-Up Threshold	Read Only	Multiplier: 1	Unit: Vac	Indicates the pick-up threshold in volts for generator set undervoltage sensor	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43580	Genset Undervoltage Sensor Status	Read Only	0: Unknown		Indicates generator set undervoltage sensor status	PCC3300, PCC3300V2
			1: Picked Up			
			2: Dropped Out			
43584	Paralleling Speed Control Mode	Read Only	0: Isochronous		Indicates which speed control algorithm is in effect	PCC3300, PCC2300, PCC3300V2
			1: Droop			
			2: Synchronize			
			3: Load Share			
			4: Load Govern			
43585	Paralleling Voltage Control Mode	Read Only	0: Isochronous		Indicates which voltage control algorithm is in effect	PCC3300, PCC2300, PCC3300V2
			1: Droop			
			2: Synchronize			
			3: Load Share			
			4: Load Govern			
43589	PTC Operating Transition Type	Read Only	0: Open Transition		Indicates the transition type currently in effect	PCC3300, PCC3300V2
			1: Hard Closed Transition			
			2: Soft Closed Transition			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43590	PTC State	Read Only	0: PTC Not Enabled		Indicates the connected state of the Power Transfer Control	PCC3300, PCC3300V2
			1: No Source Connected			
			2: Utility Connected			
			3: Genset Connected			
			4: Paralleled			
43597	Utility CB Close Command	Read Only	0: Inactive		Utility cb close command status	PCC3300, PCC3300V2
			1: Active			
43598	Utility CB Open Command	Read Only	0: Inactive		Utility cb open command status	PCC3300, PCC3300V2
			1: Active			
43599	Utility CB Position Status	Read Only	0: Open		Indicates utility breaker position	PCC3300, PCC3300V2
			1: Closed			
			2: Not Available			
43600	Load Govern kW Method	Read/Write	0: Genset kW		Use to select how generator set kW output will be controlled when paralleled to utility.	PCC3300, PCC3300V2
			1: Genset kW w/Utility Constraint			
			2: Utility kW			
43608	Configurable Output #1 Event Code	Read/Write	Multiplier: 1	Unit:	The event code for this output.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43610	Configurable Output #2 Event Code	Read/Write	Multiplier: 1	Unit:	The event code for this output.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43613	Configurable Output #20 Event Code	Read/Write	Multiplier: 1	Unit:	The event code for this output.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43616	Configurable Output #21 Event Code	Read/Write	Multiplier: 1	Unit:	The event code for this output.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43619	Configurable Output #22 Event Code	Read/Write	Multiplier: 1	Unit:	The event code for this output.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43622	Configurable Output #3 Event Code	Read/Write	Multiplier: 1	Unit:	The event code for this output.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43625	Configurable Output #4 Event Code	Read/Write	Multiplier: 1	Unit:	The event code for this output.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43641	Delayed Shutdown Enable	Read/Write	0: Disabled		Enables the Delayed Shutdown feature.	PCC3300, PCC2300, PCC3300V2
			1: Enabled			
43642	Delayed Shutdown Time Delay	Read/Write	Multiplier: 0.1	Unit: seconds	Sets the shutdown fault delayed time delay for the Delayed Shutdown feature.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 3		
			Sign: U			
43643	Remote Fault Reset Enabled	Read/Write	0: Disable		Trim to enable Remote Fault Reset. Can only reset "Warning" Faults	PCC3300, PCC2300, PCC3300V2
			1: Enable			
43644	Fail To Shutdown Delay	Read/Write	Multiplier: 1	Unit: seconds	Trim to set the time for a shutdown fault to be active and the generator set not shutting down before the Fail to Shutdown fault occurs.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 30		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43645	LCL Detection Response	Read/Write	0: None		Sets low coolant level fault response to None, Warning or Shutdown.	PCC3300, PCC2300, PCC3300V2
			1: Warning			
			2: Shutdown			
43646	LCT Warning Clear Time	Read/Write	Multiplier: 1	Unit: Minutes	Sets time to clear the low coolant temp fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 8	Upper Limit: 30		
			Sign: U			
43647	LCT Warning Set Time	Read/Write	Multiplier: 1	Unit: Minutes	Sets time to set the low coolant temp fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 8	Upper Limit: 30		
			Sign: U			
43648	LCT Warning Threshold	Read/Write	Multiplier: 1	Unit: degF	Sets threshold for the low coolant temp fault warning.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: -20		
			Size (bits): 16	Upper Limit: 130		
			Sign: S			
43649	V/Hz Knee Frequency	Read/Write	Multiplier: 0.1	Unit: Hz	The voltage will roll off (decrease) proportionally to the V/Hz setup, once the frequency drops below the set point in the V/Hz Knee Frequency. This allows the generator set to recover faster when the frequency drops.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 10		
			Sign: U			
43650	V/Hz Rolloff Slop	Read/Write	Multiplier: 0.1	Unit: % / Hz	The amount of voltage roll off when the frequency is below the knee frequency	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 20		
			Sign: U			
43651	12 V High Battery Voltage Threshold	Read Only	Multiplier: 0.1	Unit: Vdc	Sets 12V high battery voltage fault threshold.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 14		
			Size (bits): 16	Upper Limit: 17		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43652	12 V Low Battery Voltage Running Threshold	Read Only	Multiplier: 0.1	Unit: Vdc	Sets 12V low battery voltage fault threshold for generator set operation while in rated mode	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 12		
			Size (bits): 16	Upper Limit: 16		
			Sign: U			
43653	12 V Low Battery Voltage Stopped Threshold	Read Only	Multiplier: 0.1	Unit: Vdc	Sets 12V low battery voltage fault threshold for generator set operation in all modes except rated	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 11		
			Size (bits): 16	Upper Limit: 13		
			Sign: U			
43654	12 V Weak Battery Voltage Threshold	Read/Write	Multiplier: 0.1	Unit: Vdc	Sets 12V weak battery voltage fault threshold	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 6		
			Size (bits): 16	Upper Limit: 10		
			Sign: U			
43655	24 V High Battery Voltage Threshold	Read Only	Multiplier: 0.1	Unit: Vdc	Sets 24V high battery voltage fault threshold	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 28		
			Size (bits): 16	Upper Limit: 34		
			Sign: U			
43656	24 V Low Battery Voltage Running Threshold	Read Only	Multiplier: 0.1	Unit: Vdc	Sets 24V low battery voltage fault threshold for generator set operation while in rated mode	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 24		
			Size (bits): 16	Upper Limit: 28		
			Sign: U			
43657	24 V Low Battery Voltage Stopped Threshold	Read Only	Multiplier: 0.1	Unit: Vdc	Sets 24V low battery voltage fault threshold for generator set operation in all modes except rated	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 22		
			Size (bits): 16	Upper Limit: 26		
			Sign: U			
43658	24 V Weak Battery Voltage Threshold	Read/Write	Multiplier: 0.1	Unit: Vdc	Sets 24V weak battery voltage fault threshold	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 10		
			Size (bits): 16	Upper Limit: 16		
			Sign: U			
43659	Adjustable Freq/Speed Gain	Read/Write	Multiplier: 0.01	Unit: rpm/Hz	Sets the rpm/Hz conversion factor when the Freq to Speed Gain Select trim is set to this trim	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 240		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43660	Alternate Frequency Switch	Read Only	0: 50 Hz		Sets the generator set nominal frequency.	PCC3300, PCC2300, PCC3300V2
			1: 60 Hz			
43661	AVR Gain Adjust Trim	Read/Write	Multiplier: 0.01	Unit:	A trim that allows the user to modify the overall gains of the AVR.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0.05		
			Size (bits): 16	Upper Limit: 10		
			Sign: U			
43662	Charging Alternator Fault Time Delay	Read/Write	Multiplier: 0.1	Unit: seconds	Sets the time delay for the charging alt failure fault	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 2		
			Size (bits): 16	Upper Limit: 300		
			Sign: U			
43663	Continuous Crank Engage Time	Read/Write	Multiplier: 1	Unit: seconds	Sets the maximum amount of time to engage the starter when using the continuous cranking method	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 40		
			Size (bits): 16	Upper Limit: 100		
			Sign: U			
43664	Controlled Shutdown Advance Notice Delay	Read/Write	Multiplier: 1	Unit: seconds	Delay allowed for a shutdown with cooldown fault prior to shutting down the genset	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 300		
			Sign: U			
43665	Crank Attempts	Read/Write	Multiplier: 1	Unit:	Sets the maximum number of times to engage the starter when attempting to start engine using the cycle cranking method	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 1		
			Size (bits): 16	Upper Limit: 7		
			Sign: U			
43666	Cycle / Cont Crank Select	Read Only	0: Cycle		Selects whether to use continuous cranking or cycle cranking when attempting to start engine	PCC3300, PCC2300, PCC3300V2
			1: Continuous			
43667	Cycle Crank Engage Time	Read/Write	Multiplier: 1	Unit: seconds	Sets the maximum amount of time to engage the starter during a single crank attempt when using the cycle cranking method	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 2		
			Size (bits): 16	Upper Limit: 20		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43668	Cycle Crank Rest Time	Read/Write	Multiplier: 1	Unit: seconds	Rest time between start attempts for cycle crank mode.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 7		
			Size (bits): 16	Upper Limit: 40		
			Sign: U			
43669	Delayed Off FSO Relay Time	Read/Write	Multiplier: 0.1	Unit: seconds	Time delay between when the Delayed Off Command turns off and Run Command turns off	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 120		
			Sign: U			

TABLE 61.

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43670	External AVR Knee Frequency	Read/Write	Multiplier: 0.1	Unit: Hz	Sets the knee frequency for the fixed knee freq logic.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 10		
			Sign: U			
43671	External Bias Commands Enable	Read/Write	0: Disabled		Enables the external bias (speed and voltage commands) to the hardware outputs.	PCC3300, PCC3300V2
			1: Enabled			
43672	Frequency Adjust	Read/Write	Multiplier: 0.01	Unit: Hz	A method of adding in a frequency offset to the base frequency subject to high and low limit calibrations.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: -6		
			Size (bits): 16	Upper Limit: 6		
			Sign: S			
43673	Genset Exercise Time	Read/Write	Multiplier: 0.1	Unit: hours	Sets the total exercise time not including warmup at idle or idle cooldown time.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 25		
			Sign: U			
43674	Governor Gain Adjust	Read Only	Multiplier: 0.01	Unit:	A trim that allows the user to modify the overall gain of the governor.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0.05		
			Size (bits): 16	Upper Limit: 15		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43675	High Battery Voltage Set Time	Read Only	Multiplier: 1	Unit: seconds	The time delay until a high battery voltage condition is reported as a fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 2		
			Size (bits): 16	Upper Limit: 60		
			Sign: U			
43676	High Battery Voltage Threshold	Read Only	Multiplier: 0.1	Unit: Vdc	The high battery voltage threshold	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43677	Idle Cooldown Time	Read/Write	Multiplier: 0.25	Unit: minutes	Sets time to run at idle before shutting down generator set on normal stops.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 60		
			Sign: U			
43678	Idle Speed	Read Only	Multiplier: 1	Unit: rpm	Sets the speed at which the engine will idle subject to high and low limit calibrations.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 700		
			Size (bits): 16	Upper Limit: 1100		
			Sign: U			
43679	Idle to Rated Ramp Time	Read/Write	Multiplier: 0.1	Unit: seconds	The time over which the speed reference is to ramp from idle speed to rated speed.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 30		
			Sign: U			
43680	Idle Warmup Coolant Temp	Read/Write	Multiplier: 1	Unit: degF	Coolant temperature threshold to end idle warmup time.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: -40		
			Size (bits): 16	Upper Limit: 300		
			Sign: S			
43681	Idle Warmup Time	Read/Write	Multiplier: 1	Unit: seconds	Sets maximum idle warmup time. Warmup time may be less if coolant temperature exceeds threshold.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 3600		
			Sign: U			

Modbus Address	Parameter/System Name	Modbus Access	Specifications		Description	Control Boards
43682	Load Dump Activation Method	Read/Write	0: Overload		Enables the load dump output as a function of the overload and underfrequency conditions.	PCC3300, PCC2300, PCC3300V2
			1: Underfrequency			
			2: Overload or Underfrequency			
			3: Diasabled			
43683	Load Dump Overload Set Time	Read/Write	Multiplier: 1	Unit: seconds	The time delay until the load dump overload condition is set active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 120		
			Sign: U			
43684	Load Dump Overload Threshold	Read/Write	Multiplier: 1	Unit: %	The load dump overload threshold as a percentage of the generator set application rating.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 80		
			Size (bits): 16	Upper Limit: 140		
			Sign: U			
43685	Load Dump Underfrequency Offset	Read/Write	Multiplier: 1	Unit: Hz	The frequency amount which the load dump underfrequency threshold is below the final frequency reference.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 10		
			Sign: S			
43686	Load Dump Underfrequency Set Time	Read/Write	Multiplier: 1	Unit: seconds	The time delay until the load dump underfrequency condition is set active.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 20		
			Sign: U			
43687	Load Dump Underfrequency Threshold	Read Only	Multiplier: 0.1	Unit: Hz	The frequency trip threshold for the load dump underfrequency condition.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 90		
			Sign: U			
43688	Low Battery Voltage Set Time	Read Only	Multiplier: 1	Unit: seconds	The time delay until a low battery voltage condition is reported as a fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 2		
			Size (bits): 16	Upper Limit: 60		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43689	Low Fuel in Day Tank Time	Read/Write	Multiplier: 1	Unit: seconds	Low Fuel in Day Tank Fault time delay from switch input.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 20		
			Sign: U			
43690	Low Fuel Set/Clear Time	Read/Write	Multiplier: 1	Unit: seconds	A trim that sets the delay time for generating the inactive and active faults.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 2		
			Size (bits): 16	Upper Limit: 60		
			Sign: U			
43691	Manual Warmup Bypass	Read/Write	0: Normal		Use to command idle speed or to bypass idle warmup during a manual run.	PCC3300, PCC2300, PCC3300V2
			1: Bypass Warmup			
43692	Max Idle Time	Read/Write	Multiplier: 0.1	Unit: minutes	Sets the fault time for the Too Long in Idle fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 20		
			Sign: U			
43693	Nominal Battery Voltage	Read Only	0: 12V		Selects the generator set's nominal battery operating voltage.	PCC3300, PCC2300, PCC3300V2
			1: 24V			
43694	Prelube Cycle Enable	Read/Write	0: Disabled		Enables Or Disables the cyclic mode of prelube operation.	PCC3300, PCC2300, PCC3300V2
			1: Enabled			
43695	Prelube Cycle Time	Read/Write	Multiplier: 0.1	Unit: hours	"Sets the period of the Prelube Cycle Iteration. PCC will truncate any 'remainder' minutes time set in the ECM when Prelube Owner is ECS e.g. if 65 or 66 minute is set in ECM then PCC will show 1.0 hours and 1.1 hours respectively."	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0.1		
			Size (bits): 16	Upper Limit: 1000		
			Sign: U			
43696	Prelube Function Enable	Read/Write	0: Disabled		Selects whether the Prelube function is enabled or disabled. This is Setup mode interlocked.	PCC3300, PCC2300, PCC3300V2
			1: Enabled			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43697	Prelube Oil Pressure Threshold	Read/Write	Multiplier: 0.1	Unit: psig	The oil pressure value which when reached the prelube driver will turn off.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 10		
			Sign: U			
43698	Prelube Timeout Period	Read/Write	Multiplier: 0.1	Unit: seconds	Sets the maximum time for which the Prelube Driver will Remain ON.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 60		
			Sign: U			
43699	Rated to Idle Ramp Time	Read/Write	Multiplier: 0.1	Unit: seconds	The time over which the speed reference is to ramp from rated speed to idle speed.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 30		
			Sign: U			
43700	Utility Availability Status	Read Only	0: Not Available		Indicates status of the utility source.	PCC3300, PCC3300V2
			1: Available			
			2: Unknown			
43701	Utility CB Inhibit Command	Read Only	0: Inactive		Utility cb inhibit command	PCC3300, PCC3300V2
			1: Active			
43702	Utility CB Tripped Command	Read Only	0: Inactive		Utility cb tripped command	PCC3300, PCC3300V2
			1: Active			
43703	Utility Current Based Breaker Position	Read Only	0: Unknown		Indicates utility breaker position based on current.	PCC3300, PCC3300V2
			1: Closed			
43704	Utility Frequency Lower Drop-Out Threshold	Read Only	Multiplier: 0.1	Unit: Hz	Indicates the lower drop-out threshold in Hz for utility frequency sensor.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43705	Utility Frequency Lower Pick-Up Threshold	Read Only	Multiplier: 0.1	Unit: Hz	Indicates the lower pick-up threshold in Hz for utility frequency sensor.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43706	Utility Frequency Sensor Status	Read Only	0: Unknown		Indicates utility frequency sensor status.	PCC3300, PCC3300V2
			1: Picked Up			
			2: Dropped Out			
43707	Utility Frequency Upper Drop-Out Threshold	Read Only	Multiplier: 0.1	Unit: Hz	Indicates the upper drop-out threshold in Hz for utility frequency sensor.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43708	Utility Frequency Upper Pick-Up Threshold	Read Only	Multiplier: 0.1	Unit: Hz	Indicates the upper pick-up threshold in Hz for utility frequency sensor.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43709	Utility Loss of Phase Sensor Status	Read Only	0: Unknown		Indicates utility loss of phase sensor status.	PCC3300, PCC3300V2
			1: Picked Up			
			2: Dropped Out			
43710	Utility Overvoltage Drop-Out Threshold	Read Only	Multiplier: 1	Unit: Vac	Indicates the drop-out threshold in volts for utility overvoltage sensor.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43711	Utility Overvoltage Pick-Up Threshold	Read Only	Multiplier: 1	Unit: Vac	Indicates the pick-up threshold in volts for utility overvoltage sensor.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43712	Utility Overvoltage Sensor Status	Read Only	0: Unknown		Indicates utility overvoltage sensor status.	PCC3300, PCC3300V2
			1: Picked Up			
			2: Dropped Out			
43713	Utility Phase Rotation Sensor Status	Read Only	0: Unknown		Indicates utility phase rotation sensor status.	PCC3300, PCC3300V2
			1: Picked Up			
			2: Dropped Out			
43714	Utility Undervoltage Drop-Out Threshold	Read Only	Multiplier: 1	Unit: Vac	Indicates the drop-out threshold in volts for utility undervoltage sensor.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43715	Utility Undervoltage Pick-Up Threshold	Read Only	Multiplier: 1	Unit: Vac	Indicates the pick-up threshold in volts for utility undervoltage sensor.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43716	Utility Undervoltage Sensor Status	Read Only	0: Unknown		Indicates utility undervoltage sensor status.	PCC3300, PCC3300V2
			1: Picked Up			
			2: Dropped Out			
43719	Alternator Temperature 1 (Aux101)	Read Only	Multiplier: 1	Unit: degF	Monitor point for the Alternator Temp 1 input from the Aux 101 I/O Module.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: -32767		
			Size (bits): 16	Upper Limit: 32762		
			Sign: S			
43720	Alternator Temperature 2 (Aux101)	Read Only	Multiplier: 1	Unit: degF	Monitor point for the Alternator Temp 2 input from the Aux 101 I/O Module.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: -32767		
			Size (bits): 16	Upper Limit: 32762		
			Sign: S			
43721	Alternator Temperature 3 (Aux101)	Read Only	Multiplier: 1	Unit: degF	Monitor point for the Alternator Temp 3 input from the Aux 101 I/O Module.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: -32767		
			Size (bits): 16	Upper Limit: 32762		
			Sign: S			
43722	Ambient Temperature (Aux101)	Read Only	Multiplier: 1	Unit: degF	Monitor point for the Ambient Temp input from the Aux 101 I/O Module.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: -32767		
			Size (bits): 16	Upper Limit: 32762		
			Sign: S			
43723	Aux101 0 Analog Input 1 Voltage	Read Only	Multiplier: 0.01	Unit: Vdc	Monitor point for the module 0 analog input 1 in Volts.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: -500		
			Size (bits): 16	Upper Limit: 500		
			Sign: S			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43724	Aux101 0 Analog Input 2 Voltage	Read Only	Multiplier: 0.01	Unit: Vdc	Monitor point for the module 0 analog input 2 in Volts.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: -500		
			Size (bits): 16	Upper Limit: 500		
			Sign: S			
43725	Aux101 0 Analog Input 3 Voltage	Read Only	Multiplier: 0.01	Unit: Vdc	Monitor point for the module 0 analog input 3 in Volts.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43726	Aux101 0 Analog Input 4 Voltage	Read Only	Multiplier: 0.01	Unit: Vdc	Monitor point for the module 0 analog input 4 in Volts.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43727	Aux101 0 Analog Input 5 Voltage	Read Only	Multiplier: 0.01	Unit: Vdc	Monitor point for the module 0 analog input 5 in Volts.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43728	Aux101 0 Analog Input 6 Voltage	Read Only	Multiplier: 0.01	Unit: Vdc	Monitor point for the module 0 analog input 6 in Volts.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43729	Aux101 0 Analog Input 7 Voltage	Read Only	Multiplier: 0.01	Unit: Vdc	Monitor point for the module 0 analog input 7 in Volts.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43730	Aux101 0 Analog Input 8 Voltage	Read Only	Multiplier: 0.01	Unit: Vdc	Monitor point for the module 0 analog input 8 in Volts.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43731	Aux101 1 Analog Input 1 Voltage	Read Only	Multiplier: 0.01	Unit: Vdc	Monitor point for the module 1 analog input 1 in Volts.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: -500		
			Size (bits): 16	Upper Limit: 500		
			Sign: S			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43732	Aux101 1 Analog Input 2 Voltage	Read Only	Multiplier: 0.01	Unit: Vdc	Monitor point for the module 1 analog input 2 in Volts.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: -500		
			Size (bits): 16	Upper Limit: 500		
			Sign: S			
43733	Aux101 1 Analog Input 3 Voltage	Read Only	Multiplier: 0.01	Unit: Vdc	Monitor point for the module 1 analog input 3 in Volts.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43734	Aux101 1 Analog Input 4 Voltage	Read Only	Multiplier: 0.01	Unit: Vdc	Monitor point for the module 1 analog input 4 in Volts.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43735	Aux101 1 Analog Input 5 Voltage	Read Only	Multiplier: 0.01	Unit: Vdc	Monitor point for the module 1 analog input 5 in Volts.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43736	Aux101 1 Analog Input 6 Voltage	Read Only	Multiplier: 0.01	Unit: Vdc	Monitor point for the module 1 analog input 6 in Volts.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43737	Aux101 1 Analog Input 7 Voltage	Read Only	Multiplier: 0.01	Unit: Vdc	Monitor point for the module 1 analog input 7 in Volts.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43738	Aux101 1 Analog Input 8 Voltage	Read Only	Multiplier: 0.01	Unit: Vdc	Monitor point for the module 1 analog input 8 in Volts.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43739	Battery Charger AC Failure (HMI113)	Read Only	0: Inactive		Monitor point for the battery charger failure input from the PCCNET Annunciator.	PCC3300, PCC2300, PCC3300V2
			1: Active			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43740	Drive End Bearing Temperature (Aux101)	Read Only	Multiplier: 1	Unit: degF	Monitor point for the Drive End Bearing Temp input from the I/O Module.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: -32767		
			Size (bits): 16	Upper Limit: 32762		
			Sign: S			
43741	Exhaust Stack Temperature 1 (Aux101)	Read Only	Multiplier: 1	Unit: degF	Monitor point for the Exhaust Stack Temp1 input from the I/O Module.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: -32767		
			Size (bits): 16	Upper Limit: 32762		
			Sign: S			
43742	Exhaust Stack Temperature 2 (Aux101)	Read Only	Multiplier: 1	Unit: degF	Monitor point for the Exhaust Stack Temp2 input from the I/O Module.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: -32768		
			Size (bits): 16	Upper Limit: 32762		
			Sign: S			
43745	Fuel Level % (Aux101)	Read Only	Multiplier: 0.1	Unit: %	Monitor point for the % fuel level input from the I/O Module.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
43746	Fuel Level (Aux101)	Read Only	Multiplier: 1	Unit:	Monitor point for the fuel level (in gallons) input from the I/O Module.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
43747	HMI113 Fault 1 Status	Read Only	0: Inactive		Monitor point for input #1 from the Annunciator.	PCC3300, PCC2300, PCC3300V2
			1: Active			
43748	HMI113 Fault 2 Status	Read Only	0: Inactive		Monitor point for input #2 from the Annunciator.	PCC3300, PCC2300, PCC3300V2
			1: Active			
43749	HMI113 Fault 3 Status	Read Only	0: Inactive		Monitor point for the input #3 from the Annunciator.	PCC3300, PCC2300, PCC3300V2
			1: Active			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43750	Intake Manifold Temperature 1 (Aux101)	Read Only	Multiplier: 1	Unit: degF	Monitor point for the Intake Manifold Temp 1 input from the I/O Module.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: -32768		
			Size (bits): 16	Upper Limit: 32762		
			Sign: S			
43751	Low Coolant Level (HMI113)	Read Only	0: Inactive		Monitor point for the Low Coolant Level input from the PCCnet Annunciator.	PCC3300, PCC2300, PCC3300V2
			1: Active			
43752	Low Fuel Level (HMI113)	Read Only	0: Inactive		Monitor point for the Low Fuel Level input from the PCCnet Annunciator.	PCC3300, PCC2300, PCC3300V2
			1: Active			
43753	LTA Temperature (Aux101)	Read Only	Multiplier: 1	Unit: degF	Monitor point for the LTA Temperature input from the I/O Module	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: -40		
			Size (bits): 16	Upper Limit: 300		
			Sign: S			
43755	Non-Drive End Bearing Temperature (Aux101)	Read Only	Multiplier: 1	Unit: degF	Monitor point for the Non-Drive End Bearing Temp input from the I/O Module.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: -65534		
			Size (bits): 16	Upper Limit: 65535		
			Sign: S			
43756	Number of Connected Bargraph Modules	Read Only	Multiplier: 1	Unit:	Used to monitor the amount of connected Bargraph modules.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 8	Upper Limit: 255		
			Sign: U			
43757	Oil Temperature (Aux101)	Read Only	Multiplier: 1	Unit: degF	Monitor point for the Oil Temp input from the I/O Module.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: -65534		
			Size (bits): 16	Upper Limit: 65535		
			Sign: S			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43758	Modbus Bus Message Count	Read Only	Multiplier: 1	Unit:	Modbus bus message count	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43759	Modbus CRC Errors Count	Read Only	Multiplier: 1	Unit:	Modbus CRC errors count	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43760	Modbus Exception Count	Read Only	Multiplier: 1	Unit:	Modbus exception count	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43761	Modbus No Response Count	Read Only	Multiplier: 1	Unit:	Modbus no response count	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43762	Modbus Slave Message Count	Read Only	Multiplier: 1	Unit:	Modbus slave message count	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
43763	Frequency Match Error	Read Only	Multiplier: 0.001	Unit: Hz	Frequency match error value used by frequency match PI loop.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
43767	Load Govern kVAR Target	Read Only	Multiplier: 0.01	Unit: %	Indicates the final target setpoint for generator set kVAR output when paralleled to utility.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
43769	Load Govern kW Target	Read Only	Multiplier: 0.01	Unit: %	Indicates the final target setpoint for genset kW output when paralleled to utility.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			

Modbus Address	Parameter/System Name	Modbus Access	Specifications		Description	Control Boards
43770	Permissive Close Allowed	Read Only	0: Not Allowed		Indicates when permissive sync check conditions have been met.	PCC3300, PCC3300V2
			1: Allowed			
43773	Phase Match Error	Read Only	Multiplier: 0.01	Unit: deg	Phase error signal for the synchronizer control algorithm.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
43777	Start Type/Configurable Input #11 Switch	Read Only	0: Inactive		This is the status of the Configurable Input #11.	PCC3300, PCC2300, PCC3300V2
			1: Active			
43778	Scheduler Run Command	Read Only	0: Off		Indicates the current run command coming from the scheduler.	PCC3300, PCC2300, PCC3300V2
			1: No Load			
			2: With Load			
			3: Extended Parallel			
43785	Start Attempts Since Reset	Read/Write	Multiplier: 1	Unit:	Number of start attempts since the last reset.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 32	Upper Limit: 4294967290		
			Sign: U			
43786	Start Attempts Since Reset	Read/Write	Multiplier: 1	Unit:	Number of start attempts since the last reset.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 32	Upper Limit: 4294967290		
			Sign: U			
43787	Total Start Attempts	Read/Write	Multiplier: 1	Unit:	Total number of start attempts.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 32	Upper Limit: 4294967295		
			Sign: U			
43788	Total Start Attempts	Read/Write	Multiplier: 1	Unit:	Total number of start attempts.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 32	Upper Limit: 4294967295		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43789	Backup Start Disconnect/Configurable Input #33 Switch	Read Only	0: Inactive		This is the status of the Configurable Input #33.	PCC3300, PCC3300V2
			1: Active			
43791	Battery Charger Failed Switch	Read Only	0: Inactive		Battery Charger Failed Switch function output status; gives software Inactive/Active state.	PCC3300, PCC2300, PCC3300V2
			1: Active			
43792	Battle Short Switch	Read Only	0: Inactive		Battle Short Switch function output status (Active or Inactive).	PCC3300, PCC2300, PCC3300V2
			1: Active			
43793	Configurable Input #1 Switch	Read Only	0: Inactive		Configurable Input #1 input software state status. Gives software Inactive/Active state.	PCC3300, PCC2300, PCC3300V2
			1: Active			
43794	Configurable Input #2 Switch	Read Only	0: Inactive		Configurable Input #2 input software state status. Gives software Inactive/Active state.	PCC3300, PCC2300, PCC3300V2
			1: Active			
43795	Configurable Input #13 Switch	Read Only	0: Inactive		Configurable Input #13 input software state status. Gives software Inactive/Active state.	PCC3300, PCC2300, PCC3300V2
			1: Active			
43796	Genset CB Open Command	Read Only	0: Inactive		Generator set cb open command status.	PCC3300, PCC3300V2
			1: Active			
43800	Rated Cooldown Time	Read/Write	Multiplier: 1	Unit: seconds	Minimum time to spend at rated speed less than 10% load before normal shutdown is allowed	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 600		
			Sign: U			
43801	Rated to Idle Transition Delay	Read/Write	Multiplier: 0.1	Unit: seconds	Sets the delay time for transitioning from Rated to Idle speed. 0 seconds = feature is disabled.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 10		
			Sign: U			
43802	Rupture Basin Time	Read/Write	Multiplier: 0.1	Unit: seconds	Rupture Basin fault time delay	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 20		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43803	Start Time Delay	Read/Write	Multiplier: 1	Unit: seconds	Sets the time to wait from receiving a valid remote start signal until starting the generator set.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 300		
			Sign: U			
43804	Starting to Rated Ramp Time	Read/Write	Multiplier: 0.1	Unit: seconds	The time over which the speed reference is to ramp from starting speed to rated speed	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 30		
			Sign: U			
43805	Time Delay to Stop	Read/Write	Multiplier: 1	Unit: seconds	Sets time to run at rated speed before going to cooldown at idle. Does not apply to manual runs	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 600		
			Sign: U			
43806	Voltage Adjust	Read/Write	Multiplier: 0.01	Unit: %	A trim that allows the user to add/subtract an offset to the nominal voltage when calculating the voltage setpoint	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: -5		
			Size (bits): 16	Upper Limit: 5		
			Sign: S			
43807	Voltage Ramp Time	Read/Write	Multiplier: 0.01	Unit: seconds	The time period over which the voltage setpoint command should rise from 0% to the target voltage	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 5		
			Sign: U			
43808	Commit to Transfer State	Read Only	0: Not Committed		PTC - indicates if system is committed to transferring to generator set	PCC3300, PCC3300V2
			1: Committed			
43810	Battle Short Switch (Modbus)	Read/Write	0: Inactive		Trim to enable Battle Short via Modbus.	PCC3300, PCC2300, PCC3300V2
			1: Active			
43811	Exercise Switch (Modbus)	Read/Write	0: Inactive		Modbus exercise switch	PCC3300, PCC2300, PCC3300V2
			1: Active			
43813	Extended Parallel Switch (Modbus)	Read/Write	0: Inactive		Modbus extended parallel switch	PCC3300, PCC2300, PCC3300V2
			1: Active			
43814	PTC Mode Switch (Modbus)	Read/Write	0: Inactive		Modbus PTC Mode switch	PCC3300, PCC3300V2
			1: Active			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43815	Start Type (Modbus)	Read/Write	0: Emergency			PCC3300, PCC2300, PCC3300V2
			1: Non Emergency			
43818	Isolated Bus Speed Control Method	Read/Write	0: Constant		Sets the speed control method for isolated bus paralleling. Parameter is also known as Load Share Speed Droop Control Method	PCC3300, PCC2300, PCC3300V2
			1: Droop			
43819	Isolated Bus Voltage Control Method	Read/Write	0: Constant		Sets the voltage control method for isolated bus paralleling.	PCC3300, PCC2300, PCC3300V2
			1: Droop			
43820	Maximum Parallel Time (TDMP)	Read/Write	Multiplier: 0.1	Unit: seconds	Sets the maximum time that the generator set can remain paralleled to the utility during closed transition transfers.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 1800		
			Sign: U			
43821	Programmed Transition Delay (TDPT)	Read/Write	Multiplier: 0.1	Unit: seconds	Sets the time delay from when one source opens until the other closes during open transition transfers.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 60		
			Sign: U			
43822	Retransfer Delay (TDEN)	Read/Write	Multiplier: 0.1	Unit: seconds	Sets the amount of time that the utility source must be available before the control will retransfer to that source.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 1800		
			Sign: U			
43823	Synchronizer Speed Control Method	Read/Write	0: Phase Match		Sets the speed control method for synchronizing.	PCC3300, PCC3300V2
			1: Slip Frequency			
			2: External			
43824	Synchronizer Voltage Control Method	Read/Write	0: Voltage Match		Sets the voltage control method for synchronizing.	PCC3300, PCC3300V2
			1: External			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43825	Transfer Delay (TDNE)	Read/Write	Multiplier: 0.1	Unit: seconds	Sets the amount of time that the generator set source must be available before the control will transfer to that source.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 120		
			Sign: U			
43826	Transition Type	Read/Write	0: Open Transition		Sets the load transfer transition type for use when Generator set Application Type = Power Transfer Control.	PCC3300, PCC3300V2
			1: Hard Closed Transition			
			2: Soft Closed Transition			
43829	Utility Parallel Speed Control Method	Read/Write	0: Load Govern		Sets the speed control method for utility paralleling.	PCC3300, PCC3300V2
			1: Droop			
43830	Utility Parallel Voltage Control Method	Read/Write	0: Load Govern		Sets the voltage control method for utility paralleling. Option of 'Load Govern with Droop Feed Forward' is no more available.	PCC3300, PCC3300V2
			1: Droop			
43831	Aux101 Device 0 PCCnet Failure Response Type	Read/Write	0: Critical Device Response		Selects the generator set reaction to a loss of a Device 0 I/O Module as critical (Shutdown) or non-critical (Warning).	PCC3300, PCC2300, PCC3300V2
			1: Non-Critical Device Response			
43832	Aux101 Device 1 PCCnet Failure Response Type	Read/Write	0: Critical Device Response		Selects the generator set reaction to a loss of a Device 1 I/O Module as critical (Shutdown) or non-critical (Warning).	PCC3300, PCC2300, PCC3300V2
			1: Non-Critical Device Response			
43834	HMI113 Annunciator PCCnet Failure Response Type	Read/Write	0: Critical Device Response		Selects the generator set reaction to a loss of an Annunciator as critical or non-critical. Selecting Critical will cause a shutdown when the Annunciator loses communication.	PCC3300, PCC2300, PCC3300V2
			1: Non-Critical Device Response			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43836	HMI220 PCCnet Failure Response Type	Read/Write	0: Critical Device Response		Selects the generator set reaction to a loss of an HMI220 Operator Panel as critical or non-critical. A critical response will shutdown the generator set when PCCnet communication is lost.	PCC3300, PCC2300, PCC3300V2
			1: Non-Critical Device Response			
43837	HMI320 PCCnet Failure Response Type	Read/Write	0: Critical Device Response		Selects the generator set reaction to a loss of an HMI320 Operator Panel as critical or non-critical. A critical response will shutdown the generator set when PCCnet communication is lost.	PCC3300, PCC2300, PCC3300V2
			1: Non-Critical Device Response			
43839	PCCnet Device Failure Time Delay	Read/Write	Multiplier: 1	Unit: seconds	Selects the time allowed for arbitration to occur before a PCCnet failure fault is generated.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 15		
			Size (bits): 8	Upper Limit: 250		
			Sign: U			
43840	Test With Load Enable	Read/Write	0: Disabled		Use to choose whether a test is with load or without load.	PCC3300, PCC3300V2
			1: Enabled			
43842	Commit to Transfer Method	Read/Write	0: Utility Disconnect		PTC - sets point at which system commits to transfer to generator set.	PCC3300, PCC3300V2
			1: Genset Start			
			2: No Commit			
43843	Commit to Transfer Timeout	Read/Write	Multiplier: 1	Unit: seconds	PTC - sets time system will wait for generator set when committed to transfer.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 3200		
			Sign: U			
43844	Commit to Transfer Timer	Read Only	Multiplier: 0.05	Unit: sec	PTC - remaining time system to wait for generator set when committed to transfer.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43845	Modbus Failure Time Delay	Read/Write	Multiplier: 1	Unit: seconds	Time delay before the control activates the modbus failure fault after the master is sensed as no longer present.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 10		
			Sign: U			
43846	Modbus Communications Lost Response Method	Read/Write	0: Do Nothing		When set to Reset Commands will reset the modbus control logicals to an inactive state when Modbus communications are lost.	PCC3300, PCC2300, PCC3300V2
			1: Reset Commands			
43847	Modbus Clear Counters	Read/Write	0: Do Nothing		Resets all modbus counters, including J14 if applicable.	PCC3300, PCC2300, PCC3300V2
			1: Clear Counters			
43848	Controlled Shutdown Max Ramp Unload Time	Read/Write	Multiplier: 1	Unit: seconds	Maximum ramp unload time during a shutdown with cooldown	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 300		
			Sign: U			
43849	Genset kVAR Setpoint	Read/Write	Multiplier: 1	Unit: kVAR	Sets the generator set load govern kVAR base load internal operating setpoint in units of kVAR. Requires that Load Govern kVAR Setpoint Source = Internal and Load Govern kVAR Method = Generator set kVAR.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: -20000		
			Size (bits): 16	Upper Limit: 20000		
			Sign: S			
43850	Genset kVAR Setpoint Percent	Read/Write	Multiplier: 0.01	Unit: %	Sets the generator set load govern kVAR base load internal operating setpoint in % of standby kVA rating. Requires that Load Govern kVAR Setpoint Source = Internal and Load Govern kVAR Method = Generator set kVAR.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: -60		
			Size (bits): 16	Upper Limit: 60		
			Sign: S			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43851	Genset kW Setpoint	Read/Write	Multiplier: 1	Unit: kW	Sets the generator set load govern kW base load internal operating setpoint in units of kW. Requires that Load Govern kW Setpoint Source = Internal and Load Govern kW Method = Generator set kW.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 20000		
			Sign: S			
43852	Genset kW Setpoint Percent	Read/Write	Multiplier: 0.01	Unit: %	Sets the generator set load govern kW base load internal operating setpoint in % of standby rating. Requires that Load Govern kW Setpoint Source = Internal and Load Govern kW Method = Generator set kW.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 100		
			Sign: S			
43853	Genset Power Factor Setpoint	Read/Write	Multiplier: 0.01	Unit: PF	"Sets the load govern setpoint for generator set PF control. Requires that Load Govern kVAR Setpoint Source = Internal and Load Govern kVAR Method = Generator set PF. PF can be set from -0.8 to -1.0 and from 0.7 to 1.0"	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: -1		
			Size (bits): 8	Upper Limit: 1		
			Sign: S			
43854	Load Demand Stop (Modbus)	Read/Write	0: Inactive		Modbus input for activating load demand stop on the generator set	PCC3300, PCC3300V2
			1: Active			
43855	Load Govern kVAR Method	Read/Write	0: Genset kVAR		Use to select how generator set kVAR output will be controlled when paralleled to utility.	PCC3300, PCC3300V2
			1: Genset Power Factor			
			2: Utility kVAR			
			3: Utility Power Factor			
43856	Load Govern kVAR Ramp Load Time	Read/Write	Multiplier: 1	Unit: seconds	Sets load govern kVAR ramp load rate = Generator set Standby kVA * 0.6/ this time.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 900		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43857	Load Govern kVAR Ramp Unload Time	Read/Write	Multiplier: 1	Unit: seconds	Sets load govern kVAR ramp unload rate = Generator set Standby KVA * 0.6/ this time.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 900		
			Sign: U			
43858	Utility Breaker Opening Point	Read/Write	0: After Transfer Delay		PTC - point in time at which system opens utility breaker	PCC3300, PCC3300V2
			1: Upon Utility Failure			
43859	Load Govern kW Ramp Load Time	Read/Write	Multiplier: 1	Unit: seconds	Sets load govern kW ramp load rate = Generator set Standby kW rating/ this time.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 900		
			Sign: U			
43860	Load Govern kW Ramp Unload Time	Read/Write	Multiplier: 1	Unit: seconds	Sets load govern kW ramp unload rate = Generator set Standby kW rating/ this time.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 900		
			Sign: U			
43862	Slip Frequency	Read/Write	Multiplier: 0.001	Unit: Hz	Sets the synchronizer slip frequency. Requires that Sync Speed Control Method = Slip Frequency.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: -3		
			Size (bits): 16	Upper Limit: 3		
			Sign: S			
43863	Utility kVAR Setpoint	Read/Write	Multiplier: 1	Unit: kVAR	Sets the utility kVAR peak shave internal operating setpoint in units of kVAR. Requires that Load Govern kVAR Setpoint Source = Internal and Load Govern kVAR Method = Utility kVAR	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: -20000		
			Size (bits): 16	Upper Limit: 20000		
			Sign: S			
43864	Utility kVAR Setpoint Percent	Read/Write	Multiplier: 0.01	Unit: %	Sets the utility kVAR peak shave internal operating setpoint in % of generator set standby kVA rating. Requires that Load Govern kVAR Setpoint Source = Internal and Load Govern kVAR Method = Utility kVAR.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: -320		
			Size (bits): 16	Upper Limit: 320		
			Sign: S			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43865	Utility kW Constraint	Read/Write	Multiplier: 1	Unit: kW	Sets the utility kW minimum load level for constrained base load mode of operation. Requires that Load Govern kW Setpoint Source = Internal and Load Govern kW Method = Generator set kW w/Utility Constraint.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: -20000		
			Size (bits): 16	Upper Limit: 20000		
			Sign: S			
43866	Utility kW Constraint Percent	Read/Write	Multiplier: 0.01	Unit: %	Sets utility kW minimum load level for constrained base load mode in % of generator set standby rating. Requires that Load Govern kW Setpoint Source = Internal and Load Govern kW Method = Generator set kW w/Utility Constraint.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: -320		
			Size (bits): 16	Upper Limit: 320		
			Sign: S			
43867	Utility kW Setpoint	Read/Write	Multiplier: 1	Unit: kW	Sets the utility kW peak shave internal operating setpoint in units of kW. Requires that Load Govern kW Setpoint Source = Internal and Load Govern kW Method = Utility kW.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: -20000		
			Size (bits): 16	Upper Limit: 20000		
			Sign: S			
43868	Utility kW Setpoint Percent	Read/Write	Multiplier: 0.01	Unit: %	Sets the utility kW peak shave internal operating setpoint in % of generator set standby rating. Requires that Load Govern kW Setpoint Source = Internal and Load Govern kW Method = Utility kW.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: -320		
			Size (bits): 16	Upper Limit: 320		
			Sign: S			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43869	Utility Power Factor Setpoint	Read/Write	Multiplier: 0.01	Unit: PF	Sets the internal setpoint for utility power factor control mode when paralleled to utility. Requires that Load Govern kVAR Setpoint Source = Internal and Load Govern kVAR Method = Utility Power Factor.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0.7		
			Size (bits): 8	Upper Limit: 1		
			Sign: S			
43870	Aux101 0 Output 2 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43871	Aux101 0 Output 4 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43872	Aux101 0 Output 5 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43873	Aux101 0 Output 6 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43874	Aux101 0 Output 7 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43875	Aux101 1 Output 1 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43876	Aux101 1 Output 2 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43877	Aux101 1 Output 3 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43878	Aux101 1 Output 4 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43879	Aux101 1 Output 5 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43880	Aux101 1 Output 6 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43881	Aux101 1 Output 7 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			

Modbus Address	Parameter/System Name	Modbus Access	Specifications		Description	Control Boards
43882	Aux101 1 Output 8 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43883	Aux102 0 Output 10 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43884	Aux102 0 Output 11 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43885	Aux102 0 Output 12 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43886	Aux102 0 Output 13 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43887	Aux102 0 Output 14 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43888	Aux102 0 Output 15 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43889	Aux102 0 Output 16 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43890	Aux102 0 Output 9 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43891	Aux102 1 Output 10 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			

TABLE 62.

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43892	Aux102 1 Output 11 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43893	Aux102 1 Output 12 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43894	Aux102 1 Output 13 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43895	Aux102 1 Output 14 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43896	Aux102 1 Output 15 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43897	Aux102 1 Output 16 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43898	Aux102 1 Output 9 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43900	HMI113 Output 1 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43901	HMI113 Output 2 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43902	HMI113 Output 3 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			

Modbus Address	Parameter/System Name	Modbus Access	Specifications		Description	Control Boards
43903	HMI113 Output 4 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43911	Aux101 0 Output 3 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43912	Aux101 0 Output 1 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43913	Aux101 0 Output 8 Fault/Event	Read/Write	Multiplier: 1	Unit:	Parameter to allow for the entry of the fault/event code which will turn the output relay on and off.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
43914	Transfer/Retransfer Override Switch (Modbus)	Read/Write	0: Inactive		Override switch input status from Modbus.	PCC3300, PCC3300V2
			1: Active			
43915	Extended Parallel Enable	Read/Write	0: Disabled		Use to enable the extended paralleling mode of PTC.	PCC3300, PCC3300V2
			1: Enabled			
43916	V/Hz Knee Frequency 50Hz	Read Only	Multiplier: 0.1	Unit: Hz	The voltage will roll off (decrease) proportionally to the V/Hz setup, once the frequency drops below the set point in the V/Hz Knee Frequency. This allows the generator set to recover faster when the frequency drops. This is for 50Hz frequency.	PCC2300, PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 10		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43917	V/Hz Knee Frequency 60Hz	Read Only	Multiplier: 0.1	Unit: Hz	The voltage will roll off (decrease) proportionally to the V/Hz setup, once the frequency drops below the set point in the V/Hz Knee Frequency. This allows the generator set to recover faster when the frequency drops. This is for 60Hz frequency.	PCC2300, PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 10		
			Sign: U			
43918	V/Hz Rolloff Slope 50Hz	Read Only	Multiplier: 0.1	Unit: % / Hz	The amount of voltage roll off when the frequency is below the knee frequency.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 20		
			Sign: U			
43919	V/Hz Rolloff Slope 60Hz	Read Only	Multiplier: 0.1	Unit: % / Hz	The amount of voltage roll off when the frequency is below the knee frequency.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 20		
			Sign: U			
43920	Genset Source Name	Read/Write	Multiplier: 1	Unit:	Name for the generator set source.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
43921	Genset Source Name	Read/Write	Multiplier: 1	Unit:	Name for the generator set source.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
43922	Genset Source Name	Read/Write	Multiplier: 1	Unit:	Name for the generator set source.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
43923	Genset Source Name	Read/Write	Multiplier: 1	Unit:	Name for the generator set source.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43924	Genset Source Name	Read/Write	Multiplier: 1	Unit:	Name for the generator set source.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
43925	Genset Source Name	Read/Write	Multiplier: 1	Unit:	Name for the generator set source.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
43926	Genset Source Name	Read/Write	Multiplier: 1	Unit:	Name for the generator set source.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
43927	Genset Source Name	Read/Write	Multiplier: 1	Unit:	Name for the generator set source.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
43928	Genset Source Name	Read/Write	Multiplier: 1	Unit:	Name for the generator set source.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
43929	Genset Source Name	Read/Write	Multiplier: 1	Unit:	Name for the generator set source.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
43930	Genset Source Name	Read/Write	Multiplier: 1	Unit:	Name for the generator set source.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
43931	Genset Source Name	Read/Write	Multiplier: 1	Unit:	Name for the generator set source.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/System Name	Modbus Access	Specifications		Description	Control Boards
43932	Genset Source Name	Read/Write	Multiplier: 1	Unit:	Name for the generator set source.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
43933	Genset Source Name	Read/Write	Multiplier: 1	Unit:	Name for the generator set source.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
43934	Genset Source Name	Read/Write	Multiplier: 1	Unit:	Name for the generator set source.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
43935	Genset Source Name	Read/Write	Multiplier: 1	Unit:	Name for the generator set source.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 136	Upper Limit:		
			Sign: C			
43952	Speed/Frequency Delay	Read/Write	Multiplier: 0.1	Unit: seconds	Sets the delay time for generating the Speed/Frequency mismatch fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0.5		
			Size (bits): 16	Upper Limit: 10		
			Sign: U			
43953	Speed/Frequency Threshold	Read/Write	Multiplier: 0.1	Unit: Hz	Sets the threshold for generating the Speed/Frequency mismatch fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 0.5		
			Size (bits): 16	Upper Limit: 20		
			Sign: U			
43955	Genset Idle Enable	Read Only	0: Disabled		Enables or disables idling of generator set with external governor.	PCC3300, PCC2300, PCC3300V2
			1: Enabled			
43959	Utility Unloaded Level	Read/Write	Multiplier: 1	Unit: kW	Sets threshold at which utility source is considered as unloaded.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: -32768		
			Size (bits): 16	Upper Limit: 32762		
			Sign: S			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43960	HMI113 Fault 1 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43961	HMI113 Fault 1 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43962	HMI113 Fault 1 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43963	HMI113 Fault 1 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43964	HMI113 Fault 1 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43965	HMI113 Fault 1 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43966	HMI113 Fault 1 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43967	HMI113 Fault 1 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43968	HMI113 Fault 1 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43969	HMI113 Fault 1 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43970	HMI113 Fault 1 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43971	HMI113 Fault 1 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43972	HMI113 Fault 1 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43973	HMI113 Fault 1 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43974	HMI113 Fault 1 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43975	HMI113 Fault 1 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43976	HMI113 Fault 1 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43977	HMI113 Fault 1 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43978	HMI113 Fault 1 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43979	HMI113 Fault 1 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43980	HMI113 Fault 2 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43981	HMI113 Fault 2 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43982	HMI113 Fault 2 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43983	HMI113 Fault 2 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43984	HMI113 Fault 2 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43985	HMI113 Fault 2 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43986	HMI113 Fault 2 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43987	HMI113 Fault 2 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43988	HMI113 Fault 2 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43989	HMI113 Fault 2 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43990	HMI113 Fault 2 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43991	HMI113 Fault 2 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
43992	HMI113 Fault 2 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43993	HMI113 Fault 2 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43994	HMI113 Fault 2 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43995	HMI113 Fault 2 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43996	HMI113 Fault 2 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43997	HMI113 Fault 2 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43998	HMI113 Fault 2 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
43999	HMI113 Fault 2 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
44001	Secondary Starter Configuration Enabled	Read Only	0: Disabled		"Shows if secondary starter is configured for the generator set"	PCC3300, PCC3300V2
			1: Enabled			
44002	Starter in Use	Read Only	0: Primary		"Shows which starter is currently in use by the generator set"	PCC3300, PCC3300V2
			1: Secondary			
44003	Secondary Starter Command	Read Only	0: Inactive		"Indicates if the secondary starter is Inactive or Active"	PCC3300, PCC3300V2
			1: Active			
44304	Cycle / Cont Crank Select (Secondary)	Read Only	0: Cycle		"Selects whether to use continuous cranking or cycle cranking when attempting to start engine with secondary starter"	PCC3300, PCC3300V2
			1: Continuous			
44305	Cycle Crank Engage Time (Secondary)	Read/Write	Multiplier: 1	Unit: seconds	"Sets the maximum amount of time to engage the secondary starter during a single crank attempt when using the cycle cranking method"	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 2		
			Size (bits): 16	Upper Limit: 20		
			Sign: U			
44306	Continuous Crank Engage Time (Secondary)	Read/Write	Multiplier: 1	Unit: seconds	"Sets the maximum amount of time to engage the secondary starter when using the continuous cranking method"	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 40		
			Size (bits): 16	Upper Limit: 100		
			Sign: U			
44307	Crank Attempts (Secondary)	Read/Write	Multiplier: 1	Unit:	"Sets the maximum number of times to engage the starter when attempting to start engine in cycle cranking method using secondary starter"	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 1		
			Size (bits): 16	Upper Limit: 7		
			Sign: U			
44308	Cycle Crank Rest Time (Secondary)	Read/Write	Multiplier: 1	Unit: seconds	"Sets the amount of time to wait between crank attempts using secondary starter in case of cyclic crank"	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 7		
			Size (bits): 16	Upper Limit: 40		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
44309	Preferred Starter at Critical Battery	Read/Write	0: Use Primary		"Lets you choose the starter to be used by generator set in case of primary starter battery becoming low or weak."	PCC3300, PCC3300V2
			1: Use Secondary			
45999	Unrecognized SPN/FMI Status	Read Only	0: All Pairs Recognized		Indicates whether or not all pairs in current DM1 are recognized.	PCC3300, PCC2300, PCC3300V2
			1: Pair Not Recognized			
46000	Genset Phase Rotation	Read Only	0: L1-L2-L3		Generator set phase rotation	PCC3300, PCC2300, PCC3300V2
			1: L1-L3-L2			
			2: Not Available			
46001	Utility Phase Rotation	Read Only	0: L1-L2-L3		Utility phase rotation	PCC3300, PCC3300V2
			1: L1-L3-L2			
			2: Not Available			
46002	Genset Bus Phase Rotation	Read Only	0: L1-L2-L3		Generator set bus phase rotation	PCC3300, PCC3300V2
			1: L1-L3-L2			
			2: Not Available			
46003	Base Speed	Read Only	Multiplier: 0.0625	Unit: rpm	Provides a point to monitor the base speed.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
46004	Base Speed	Read Only	Multiplier: 0.0625	Unit: rpm	Provides a point to monitor the base speed.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
46005	Final Speed Reference	Read Only	Multiplier: 0.0625	Unit: rpm	Provides a point to monitor the final speed reference.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
46006	Final Speed Reference	Read Only	Multiplier: 0.0625	Unit: rpm	Provides a point to monitor the final speed reference.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46008	Exhaust Port 1 Temperature	Read Only	Multiplier: 0.1	Unit: degF	Monitor point for the Exhaust Port 1 Temperature	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: -459		
			Size (bits): 16	Upper Limit: 3155		
			Sign: S			
46009	Exhaust Port 2 Temperature	Read Only	Multiplier: 0.1	Unit: degF	Monitor point for the Exhaust Port 2 Temperature	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: -460		
			Size (bits): 16	Upper Limit: 3155		
			Sign: S			
46010	Exhaust Port 3 Temperature	Read Only	Multiplier: 0.1	Unit: degF	Monitor point for the Exhaust Port 3 Temperature	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: -460		
			Size (bits): 16	Upper Limit: 3155		
			Sign: S			
46011	Exhaust Port 4 Temperature	Read Only	Multiplier: 0.1	Unit: degF	Monitor point for the Exhaust Port 4 Temperature	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: -460		
			Size (bits): 16	Upper Limit: 3155		
			Sign: S			
46012	Exhaust Port 5 Temperature	Read Only	Multiplier: 0.1	Unit: degF	Monitor point for the Exhaust Port 5 Temperature	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: -460		
			Size (bits): 16	Upper Limit: 3155		
			Sign: S			
46013	Exhaust Port 6 Temperature	Read Only	Multiplier: 0.1	Unit: degF	Monitor point for the Exhaust Port 6 Temperature	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: -460		
			Size (bits): 16	Upper Limit: 3155		
			Sign: S			
46014	Exhaust Port 7 Temperature	Read Only	Multiplier: 0.1	Unit: degF	Monitor point for the Exhaust Port 7 Temperature	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: -460		
			Size (bits): 16	Upper Limit: 3155		
			Sign: S			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46015	Exhaust Port 8 Temperature	Read Only	Multiplier: 0.1	Unit: degF	Monitor point for the Exhaust Port 8 Temperature	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: -460		
			Size (bits): 16	Upper Limit: 3155		
			Sign: S			
46016	Exhaust Port 9 Temperature	Read Only	Multiplier: 0.1	Unit: degF	Monitor point for the Exhaust Port 9 Temperature	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: -460		
			Size (bits): 16	Upper Limit: 3155		
			Sign: S			
46017	Exhaust Port 10 Temperature	Read Only	Multiplier: 0.1	Unit: degF	Monitor point for the Exhaust Port 10 Temperature	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: -460		
			Size (bits): 16	Upper Limit: 3155		
			Sign: S			
46018	Exhaust Port 11 Temperature	Read Only	Multiplier: 0.1	Unit: degF	Monitor point for the Exhaust Port 11 Temperature	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: -460		
			Size (bits): 16	Upper Limit: 3155		
			Sign: S			
46019	Exhaust Port 12 Temperature	Read Only	Multiplier: 0.1	Unit: degF	Monitor point for the Exhaust Port 12 Temperature	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: -460		
			Size (bits): 16	Upper Limit: 3155		
			Sign: S			
46020	Exhaust Port 13 Temperature	Read Only	Multiplier: 0.1	Unit: degF	Monitor point for the Exhaust Port 13 Temperature	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: -460		
			Size (bits): 16	Upper Limit: 3155		
			Sign: S			
46021	Exhaust Port 14 Temperature	Read Only	Multiplier: 0.1	Unit: degF	Monitor point for the Exhaust Port 14 Temperature	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: -460		
			Size (bits): 16	Upper Limit: 3155		
			Sign: S			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46022	Exhaust Port 15 Temperature	Read Only	Multiplier: 0.1	Unit: degF	Monitor point for the Exhaust Port 15 Temperature	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: -460		
			Size (bits): 16	Upper Limit: 3155		
			Sign: S			
46023	Exhaust Port 16 Temperature	Read Only	Multiplier: 0.1	Unit: degF	Monitor point for the Exhaust Port 16 Temperature	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: -460		
			Size (bits): 16	Upper Limit: 3155		
			Sign: S			
46024	Exhaust Port 17 Temperature	Read Only	Multiplier: 0.1	Unit: degF	Monitor point for the Exhaust Port 17 Temperature	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: -460		
			Size (bits): 16	Upper Limit: 3155		
			Sign: S			
46025	Exhaust Port 18 Temperature	Read Only	Multiplier: 0.1	Unit: degF	Monitor point for the Exhaust Port 18 Temperature	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: -460		
			Size (bits): 16	Upper Limit: 3155		
			Sign: S			
46026	Exhaust Port 19 Temperature	Read Only	Multiplier: 0.1	Unit: degF	Monitor point for the Exhaust Port 19 Temperature	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: -460		
			Size (bits): 16	Upper Limit: 3155		
			Sign: S			
46027	Exhaust Port 20 Temperature	Read Only	Multiplier: 0.1	Unit: degF	Monitor point for the Exhaust Port 20 Temperature	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: -460		
			Size (bits): 16	Upper Limit: 3155		
			Sign: S			
46028	Knock Level Cylinder 1	Read Only	Multiplier: 1	Unit: %	Knock Level for cylinder 1	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 8	Upper Limit:		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46029	Knock Level Cylinder 2	Read Only	Multiplier: 1	Unit: %	Knock Level for cylinder 2	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 8	Upper Limit:		
			Sign: U			
46030	Knock Level Cylinder 3	Read Only	Multiplier: 1	Unit: %	Knock Level for cylinder 3	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 8	Upper Limit:		
			Sign: U			
46031	Knock Level Cylinder 4	Read Only	Multiplier: 1	Unit: %	Knock Level for cylinder 4	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 8	Upper Limit:		
			Sign: U			
46032	Knock Level Cylinder 5	Read Only	Multiplier: 1	Unit: %	Knock Level for cylinder 5	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 8	Upper Limit:		
			Sign: U			
46033	Knock Level Cylinder 6	Read Only	Multiplier: 1	Unit: %	Knock Level for cylinder 6	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 8	Upper Limit:		
			Sign: U			
46034	Knock Level Cylinder 7	Read Only	Multiplier: 1	Unit: %	Knock Level for cylinder 7	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 8	Upper Limit:		
			Sign: U			
46035	Knock Level Cylinder 8	Read Only	Multiplier: 1	Unit: %	Knock Level for cylinder 8	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 8	Upper Limit:		
			Sign: U			
46036	Knock Level Cylinder 9	Read Only	Multiplier: 1	Unit: %	Knock Level for cylinder 9	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 8	Upper Limit:		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46037	Knock Level Cylinder 10	Read Only	Multiplier: 1	Unit: %	Knock Level for cylinder 10	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 8	Upper Limit:		
			Sign: U			
46038	Knock Level Cylinder 11	Read Only	Multiplier: 1	Unit: %	Knock Level for cylinder 11	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 8	Upper Limit:		
			Sign: U			
46039	Knock Level Cylinder 12	Read Only	Multiplier: 1	Unit: %	Knock Level for cylinder 12	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 8	Upper Limit:		
			Sign: U			
46040	Knock Level Cylinder 13	Read Only	Multiplier: 1	Unit: %	Knock Level for cylinder 13	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 8	Upper Limit:		
			Sign: U			
46041	Knock Level Cylinder 14	Read Only	Multiplier: 1	Unit: %	Knock Level for cylinder 14	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 8	Upper Limit:		
			Sign: U			
46042	Knock Level Cylinder 15	Read Only	Multiplier: 1	Unit: %	Knock Level for cylinder 15	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 8	Upper Limit:		
			Sign: U			
46043	Knock Level Cylinder 16	Read Only	Multiplier: 1	Unit: %	Knock Level for cylinder 16	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 8	Upper Limit:		
			Sign: U			
46044	Knock Level Cylinder 17	Read Only	Multiplier: 1	Unit: %	Knock Level for cylinder 17	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 8	Upper Limit:		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46045	Knock Level Cylinder 18	Read Only	Multiplier: 1	Unit: %	Knock Level for cylinder 18	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 8	Upper Limit:		
			Sign: U			
46048	Knock Count Cyl 1	Read Only	Multiplier: 1	Unit:	Knock count value for Cylinder 1	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
46049	Knock Count Cyl 2	Read Only	Multiplier: 1	Unit:	Knock count value for Cylinder 2	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
46050	Knock Count Cyl 3	Read Only	Multiplier: 1	Unit:	Knock count value for Cylinder 3	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
46051	Knock Count Cyl 4	Read Only	Multiplier: 1	Unit:	Knock count value for Cylinder 4	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
46052	Knock Count Cyl 5	Read Only	Multiplier: 1	Unit:	Knock count value for Cylinder 5	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
46053	Knock Count Cyl 6	Read Only	Multiplier: 1	Unit:	Knock count value for Cylinder 6	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46054	Knock Count Cyl 7	Read Only	Multiplier: 1	Unit:	Knock count value for Cylinder 7	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
46055	Knock Count Cyl 8	Read Only	Multiplier: 1	Unit:	Knock count value for Cylinder 8	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
46056	Knock Count Cyl 9	Read Only	Multiplier: 1	Unit:	Knock count value for Cylinder 9	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
46057	Knock Count Cyl 10	Read Only	Multiplier: 1	Unit:	Knock count value for Cylinder 10	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
46058	Knock Count Cyl 11	Read Only	Multiplier: 1	Unit:	Knock count value for Cylinder 11	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
46059	Knock Count Cyl 12	Read Only	Multiplier: 1	Unit:	Knock count value for Cylinder 12	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
46060	Knock Count Cyl 13	Read Only	Multiplier: 1	Unit:	Knock count value for Cylinder 13	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46061	Knock Count Cyl 14	Read Only	Multiplier: 1	Unit:	Knock count value for Cylinder 14	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
46062	Knock Count Cyl 15	Read Only	Multiplier: 1	Unit:	Knock count value for Cylinder 15	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
46063	Knock Count Cyl 16	Read Only	Multiplier: 1	Unit:	Knock count value for Cylinder 16	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
46064	Knock Count Cyl 17	Read Only	Multiplier: 1	Unit:	Knock count value for Cylinder 17	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
46065	Knock Count Cyl 18	Read Only	Multiplier: 1	Unit:	Knock count value for Cylinder 18	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
46068	Spark Timing Cyl 1	Read Only	Multiplier: 0.1	Unit: Degres	Spark timing degrees for cylinder 1	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
46069	Spark Timing Cyl 2	Read Only	Multiplier: 0.1	Unit: Degres	Spark timing degrees for cylinder 2	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46070	Spark Timing Cyl 3	Read Only	Multiplier: 0.1	Unit: Degrees	Spark timing degrees for cylinder 3	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
46071	Spark Timing Cyl 4	Read Only	Multiplier: 0.1	Unit: Degrees	Spark timing degrees for cylinder 4	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
46072	Spark Timing Cyl 5	Read Only	Multiplier: 0.1	Unit: Degrees	Spark timing degrees for cylinder 5	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
46073	Spark Timing Cyl 6	Read Only	Multiplier: 0.1	Unit: Degrees	Spark timing degrees for cylinder 6	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
46074	Spark Timing Cyl 7	Read Only	Multiplier: 0.1	Unit: Degrees	Spark timing degrees for cylinder 7	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
46075	Spark Timing Cyl 8	Read Only	Multiplier: 0.1	Unit: Degrees	Spark timing degrees for cylinder 8	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
46076	Spark Timing Cyl 9	Read Only	Multiplier: 0.1	Unit: Degrees	Spark timing degrees for cylinder 9	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
46077	Spark Timing Cyl 10	Read Only	Multiplier: 0.1	Unit: Degrees	Spark timing degrees for cylinder 10	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46078	Spark Timing Cyl 11	Read Only	Multiplier: 0.1	Unit: Degrees	Spark timing degrees for cylinder 11	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
46079	Spark Timing Cyl 12	Read Only	Multiplier: 0.1	Unit: Degrees	Spark timing degrees for cylinder 12	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
46080	Spark Timing Cyl 13	Read Only	Multiplier: 0.1	Unit: Degrees	Spark timing degrees for cylinder 13	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
46081	Spark Timing Cyl 14	Read Only	Multiplier: 0.1	Unit: Degrees	Spark timing degrees for cylinder 14	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
46082	Spark Timing Cyl 15	Read Only	Multiplier: 0.1	Unit: Degrees	Spark timing degrees for cylinder 15	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
46083	Spark Timing Cyl 16	Read Only	Multiplier: 0.1	Unit: Degrees	Spark timing degrees for cylinder 16	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
46084	Spark Timing Cyl 17	Read Only	Multiplier: 0.1	Unit: Degrees	Spark timing degrees for cylinder 17	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
46085	Spark Timing Cyl 18	Read Only	Multiplier: 0.1	Unit: Degrees	Spark timing degrees for cylinder 18	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46088	Internal SSM558 1 Temperature	Read Only	Multiplier: 0.1	Unit: degF	Temperature of the engine electronic control unit SSM558 1	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
46089	Internal SSM558 2 Temperature	Read Only	Multiplier: 0.1	Unit: degF	Temperature of the engine electronic control unit SSM558 2	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			

TABLE 63.

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46090	Internal MCM700 Temperature	Read Only	Multiplier: 0.1	Unit: degF	Temperature of the engine electronic control unit MCM700	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
46091	Derate Authorization	Read Only	0: NO		Derate authorisation request from customer.	PCC3300, PCC3300V2
			1: YES			
			2: Reserved			
			3: N/A			
			4: Network Failure			
46093	Ventilator Fan Status	Read Only	0: OFF		Vent Fan status monitor point.	PCC3300, PCC3300V2
			1: ON			
			2: TRIPPED			
			3: N/A			
46096	GIB Isolator Open (Aux101)	Read Only	0: Close		GIB Isolator Open monitor point.	PCC3300, PCC3300V2
			1: Open			
			2: Reserved			
			3: N/A			
			4: Network Failure			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46097	Alternator Heater Status	Read Only	0: OFF		Alternator Heater status monitor point.	PCC3300, PCC3300V2
			1: ON			
			2: TRIPPED			
			3: N/A			
46101	Start Inhibit No1 (Aux101)	Read Only	0: Inactive		Start Inhibit No1 monitor point.	PCC3300, PCC3300V2
			1: Active			
			2: Reserved			
			3: Not Available			
			4: Network Failure			
46102	Start Inhibit No2 (Aux101)	Read Only	0: Inactive		Start Inhibit No2 monitor point.	PCC3300, PCC3300V2
			1: Active			
			2: Reserved			
			3: Not Available			
			4: Network Failure			
46103	Start Inhibit No3 (Aux101)	Read Only	0: Inactive		Start Inhibit No3 monitor point.	PCC3300, PCC3300V2
			1: Active			
			2: Reserved			
			3: Not Available			
			4: Network Failure			
46104	DC PSU Unavailable (Aux101)	Read Only	0: No		Engine PSU Not Available monitor point.	PCC3300, PCC3300V2
			1: Yes			
			2: Reserved			
			3: N/A			
			4: Network Failure			
46105	Ventilator Fan Trip (Aux101)	Read Only	0: No		Ventilator Fan Trip monitor point.	PCC3300, PCC3300V2
			1: Yes			
			2: Reserved			
			3: N/A			
			4: Network Failure			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46106	Aux101-3 Software Version	Read Only	Multiplier: 0.01	Unit:	Software version of the firmware for the Aux101-3	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
46107	Aux101-4 Software Version	Read Only	Multiplier: 0.01	Unit:	Software version of the firmware for the Aux101-4	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
46108	Aux101-5 Software Version	Read Only	Multiplier: 0.01	Unit:	Software version of the firmware for the Aux101-5	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
46113	Downstream Valve Command Status	Read Only	0: Open		The result of the FSO driver output command logic for fuel shutoff valve 1	PCC3300, PCC3300V2
			1: Closed			
			2: Reserved			
			3: N/A			
46117	Engine Oil PreHeater Ctrl Status	Read Only	0: OFF		Engine Oil pre heater command status	PCC3300, PCC3300V2
			1: ON			
			2: Reserved			
			3: N/A			
			4: Network Failure			
46120	Engine Coolant Pump Ctrl Status	Read Only	0: OFF		Engine coolant circulating pump status	PCC3300, PCC3300V2
			1: ON			
			2: Reserved			
			3: N/A			
			4: Network Failure			
46124	Coolant Pressure	Read Only	Multiplier: 0.1	Unit: psi	Monitor point for the Coolant Pressure.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46125	Coolant 2 Pressure	Read Only	Multiplier: 0.1	Unit: psi	Monitor point for the Coolant 2 Pressure.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 145		
			Sign: U			
46127	Coolant 2 Temperature	Read Only	Multiplier: 0.1	Unit: degF	Monitor point for the Coolant 2 Temperature	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
46128	Compressor Bypass Position	Read Only	Multiplier: 0.1	Unit: %	Engine turbocharger compressor bypass actuator position	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
46130	Oil Priming Pump Control Status	Read Only	0: OFF		Status for the priming pump (ON or OFF)	PCC3300, PCC3300V2
			1: ON			
			2: Reserved			
			3: N/A			
			4: Network Failure			
46131	Oil Priming State	Read Only	0: Low		Status of the engine before start (Pre-Lubed or Not)	PCC3300, PCC3300V2
			1: Optimum			
			2: Reserved			
			3: N/A			
			4: Network Failure			
46133	Coolant Pre-Heated State	Read Only	0: Cold		Status of the engine coolant before start (Pre-Heated or Not)	PCC3300, PCC3300V2
			1: Heated			
			2: Reserved			
			3: N/A			
46135	Intake Manifold Pressure 1	Read Only	Multiplier: 0.1	Unit: psi	Intake Manifold Pressure 1	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46136	Compressor Outlet Pressure	Read Only	Multiplier: 0.1	Unit: kPa	Absolute Pressure at the outlet of the compressor.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
46137	Turbocharger 1 Boost Pressure	Read Only	Multiplier: 0.1	Unit: psi	Monitor point for the Turbocharger 1 Boost Pressure	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
46139	Fuel Valve 1 Inlet Absolute Pressure	Read Only	Multiplier: 0.1	Unit: psi	Absolute Pressure of Gas on the inlet side of the first system control valve	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
46140	Fuel Valve 1 Outlet Absolute Pressure	Read Only	Multiplier: 0.1	Unit: psi	Absolute Pressure of Gas on the outlet side of the first system control valve	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
46141	Fuel Valve 1 Position	Read Only	Multiplier: 0.1	Unit: %		PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
46142	Fuel Valve 2 Inlet Absolute Pressure	Read Only	Multiplier: 0.1	Unit: psi	Absolute Pressure of Gas on the inlet side of the second system control valve	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
46143	Fuel Valve 2 Outlet Absolute Pressure	Read Only	Multiplier: 0.1	Unit: psi	Absolute Pressure of Gas on the outlet side of the second system control valve	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
46144	Fuel Valve 2 Position	Read Only	Multiplier: 0.1	Unit: %		PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46145	Gas Mass Flow	Read Only	Multiplier: 0.1	Unit: Pounds per hour	Gas Mass Flow value of the engine.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
46146	Gas Mass Flow	Read Only	Multiplier: 0.1	Unit: Pounds per hour	Gas Mass Flow value of the engine.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
46147	Throttle 1 Position	Read Only	Multiplier: 0.1	Unit: %	Position of the throttle 1.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
46148	Throttle 2 Position	Read Only	Multiplier: 0.1	Unit: %	Position of the throttle 2.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
46155	MCM700 Battery Voltage	Read Only	Multiplier: 0.1	Unit: Vdc	Engine Control Module Battery Voltage.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65535		
			Sign: U			
46161	SSM558 1 Isolated Battery Voltage	Read Only	Multiplier: 0.1	Unit: Vdc	SSM558 1 Engine Control Module Isolated Battery Voltage.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65535		
			Sign: U			
46163	SSM558 2 Isolated Battery Voltage	Read Only	Multiplier: 0.1	Unit: Vdc	SSM558 2 Engine Control Module Isolated Battery Voltage.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65535		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46164	Intake Manifold Pressure 2	Read Only	Multiplier: 0.1	Unit: psi	Intake Manifold Pressure 2	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
46166	Exhaust Back Pressure	Read Only	Multiplier: 0.1	Unit: psi	Monitor point for exhaust back pressure value	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
46168	Air Filter Differential Pressure	Read Only	Multiplier: 0.1	Unit: psi	Monitor point for air filter differential pressure value	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
46170	Gas Mass Flow 2	Read Only	Multiplier: 0.1	Unit: Pounds per hour	Gas Mass Flow 2 value of the engine.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
46171	Gas Mass Flow 2	Read Only	Multiplier: 0.1	Unit: Pounds per hour	Gas Mass Flow 2 value of the engine.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 32	Upper Limit:		
			Sign: U			
46172	Start Inhibit No1 Op	Read Only	0: Inactive		Start Inhibit No1 Op monitor point.	PCC3300, PCC3300V2
			1: Active			
			2: Reserved			
			3: Not Available			
			4: Network Failure			
46173	Start Inhibit No2 Op	Read Only	0: Inactive		Start Inhibit No2 Op monitor point.	PCC3300, PCC3300V2
			1: Active			
			2: Reserved			
			3: Not Available			
			4: Network Failure			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46174	Start Inhibit No3 Op	Read Only	0: Inactive		Start Inhibit No3 Op monitor point.	PCC3300, PCC3300V2
			1: Active			
			2: Reserved			
			3: Not Available			
			4: Network Failure			
46182	Radiator Fan control	Read Only	0: Inactive		Radiator fan control command	PCC3300, PCC3300V2
			1: Active			
46183	Ventilator Fan mode	Read/Write	0: Limited		Vent fan control mode, limited or continuous	PCC3300, PCC3300V2
			1: Continuous			
46184	Louvre Control	Read Only	0: Inactive		Louvre control	PCC3300, PCC3300V2
			1: Active			
46191	Ventilator Fan control	Read Only	0: Inactive		Ventilator fan control command	PCC3300, PCC3300V2
			1: Active			
46192	Engine Spark Plug Voltage 1	Read Only	Multiplier: 1	Unit: V	Spark Plug Voltage for Cylinder 1	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
46193	Engine Spark Plug Voltage 2	Read Only	Multiplier: 1	Unit: V	Spark Plug Voltage for Cylinder 2	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
46194	Engine Spark Plug Voltage 3	Read Only	Multiplier: 1	Unit: V	Spark Plug Voltage for Cylinder 3	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
46195	Engine Spark Plug Voltage 4	Read Only	Multiplier: 1	Unit: V	Spark Plug Voltage for Cylinder 4	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46196	Engine Spark Plug Voltage 5	Read Only	Multiplier: 1	Unit: V	Spark Plug Voltage for Cylinder 5	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
46197	Engine Spark Plug Voltage 6	Read Only	Multiplier: 1	Unit: V	Spark Plug Voltage for Cylinder 6	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
46198	Engine Spark Plug Voltage 7	Read Only	Multiplier: 1	Unit: V	Spark Plug Voltage for Cylinder 7	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
46199	Engine Spark Plug Voltage 8	Read Only	Multiplier: 1	Unit: V	Spark Plug Voltage for Cylinder 8	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
46200	Engine Spark Plug Voltage 9	Read Only	Multiplier: 1	Unit: V	Spark Plug Voltage for Cylinder 9	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
46201	Engine Spark Plug Voltage 10	Read Only	Multiplier: 1	Unit: V	Spark Plug Voltage for Cylinder 10	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
46202	Engine Spark Plug Voltage 11	Read Only	Multiplier: 1	Unit: V	Spark Plug Voltage for Cylinder 11	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
46203	Engine Spark Plug Voltage 12	Read Only	Multiplier: 1	Unit: V	Spark Plug Voltage for Cylinder 12	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46204	Engine Spark Plug Voltage 13	Read Only	Multiplier: 1	Unit: V	Spark Plug Voltage for Cylinder 13	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
46205	Engine Spark Plug Voltage 14	Read Only	Multiplier: 1	Unit: V	Spark Plug Voltage for Cylinder 14	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
46206	Engine Spark Plug Voltage 15	Read Only	Multiplier: 1	Unit: V	Spark Plug Voltage for Cylinder 15	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
46207	Engine Spark Plug Voltage 16	Read Only	Multiplier: 1	Unit: V	Spark Plug Voltage for Cylinder 16	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
46208	Engine Spark Plug Voltage 17	Read Only	Multiplier: 1	Unit: V	Spark Plug Voltage for Cylinder 17	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
46209	Engine Spark Plug Voltage 18	Read Only	Multiplier: 1	Unit: V	Spark Plug Voltage for Cylinder 18	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
46221	ECM Code	Read Only	Multiplier: 1	Unit:	"ECM 1 Calibration ID (DM19)"	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 88	Upper Limit:		
			Sign: C			
46222	ECM Code	Read Only	Multiplier: 1	Unit:	"ECM 1 Calibration ID (DM19)"	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 88	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46223	ECM Code	Read Only	Multiplier: 1	Unit:	"ECM 1 Calibration ID (DM19)"	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 88	Upper Limit:		
			Sign: C			
46224	ECM Code	Read Only	Multiplier: 1	Unit:	"ECM 1 Calibration ID (DM19)"	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 88	Upper Limit:		
			Sign: C			
46225	ECM Code	Read Only	Multiplier: 1	Unit:	"ECM 1 Calibration ID (DM19)"	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 88	Upper Limit:		
			Sign: C			
46226	ECM Code	Read Only	Multiplier: 1	Unit:	"ECM 1 Calibration ID (DM19)"	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 88	Upper Limit:		
			Sign: C			
46227	ECM Code	Read Only	Multiplier: 1	Unit:	"ECM 1 Calibration ID (DM19)"	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 88	Upper Limit:		
			Sign: C			
46228	ECM Code	Read Only	Multiplier: 1	Unit:	"ECM 1 Calibration ID (DM19)"	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 88	Upper Limit:		
			Sign: C			
46229	ECM Code	Read Only	Multiplier: 1	Unit:	"ECM 1 Calibration ID (DM19)"	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 88	Upper Limit:		
			Sign: C			
46230	ECM Code	Read Only	Multiplier: 1	Unit:	"ECM 1 Calibration ID (DM19)"	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 88	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46288	DE/NDE Cylinder Viewpoint Reference	Read/Write	0: Drive End		Gives reference point for engine cylinder numbering	PCC3300, PCC3300V2
			1: Non-Drive End			
			2: Reserved			
			3: N/A			
46289	Start System Trip (Aux 101)	Read Only	0: Not Tripped		Start system trip monitor point.	PCC3300, PCC3300V2
			1: Tripped			
			2: Reserved			
			3: N/A			
			4: Network Failure			
46290	Louvres Closed (Aux 101)	Read Only	0: Open		Louvres Closed monitor point.	PCC3300, PCC3300V2
			1: Closed			
			2: Reserved			
			3: N/A			
			4: Network Failure			
46291	Radiator Fan Trip (Aux 101)	Read Only	0: Not Tripped		Radiator Fan Trip monitor point.	PCC3300, PCC3300V2
			1: Tripped			
			2: Reserved			
			3: N/A			
			4: Network Failure			
46300	LBNG Genset Enable	Read/Write	0: Disable		Switch to enable or disable the gas specific features and parameters	PCC3300, PCC3300V2
			1: Enable			
46301	Aux101-3 Enable	Read/Write	0: Disable		Enable the processing for Aux101-3 messages	PCC3300, PCC3300V2
			1: Enable			
46302	Aux101-4 Enable	Read/Write	0: Disable		Enable the processing for Aux101-4 messages	PCC3300, PCC3300V2
			1: Enable			
46303	Aux101-5 Enable	Read/Write	0: Disable		Enable the processing for Aux101-5 messages	PCC3300, PCC3300V2
			1: Enable			
46304	Aux101-6 Enable	Read/Write	0: Disable		Enable the processing for Aux101-6 messages	PCC3300, PCC3300V2
			1: Enable			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46308	Aux101-3 Input Port Config	Read Only	Multiplier: 1	Unit:	Input Port configuration bye for the Aux101-3	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 255		
			Sign: U			
46309	Aux101-4 Input Port Config	Read Only	Multiplier: 1	Unit:	Input Port configuration bye for the Aux101-4	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 255		
			Sign: U			
46310	Aux101-5 Input Port Config	Read Only	Multiplier: 1	Unit:	Input Port configuration bye for the Aux101-5	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 255		
			Sign: U			
46311	Aux101-3 DI Active High/Low Selection	Read Only	Multiplier: 1	Unit:	Digital Input Port configuration active High or active low for the Aux101-3	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 255		
			Sign: U			
46312	Aux101-4 DI Active High/Low Selection	Read Only	Multiplier: 1	Unit:	Digital Input Port configuration active High or active low for the Aux101-4	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 255		
			Sign: U			
46313	Aux101-5 DI Active High/Low Selection	Read Only	Multiplier: 1	Unit:	Digital Input Port configuration active High or active low for the Aux101-5	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 255		
			Sign: U			
46314	Aux101-3 DI Config Mask	Read Only	Multiplier: 1	Unit:	Discrete Input configuration bit mask for the Aux101-3	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 255		
			Sign: U			
46315	Aux101-4 DI Config Mask	Read Only	Multiplier: 1	Unit:	Discrete Input configuration bit mask for the Aux101-4	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 255		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46316	Aux101-5 DI Config Mask	Read Only	Multiplier: 1	Unit:	Discrete Input configuration bit mask for the Aux101-5	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 255		
			Sign: U			
46323	Vehicle Electrical Power 2 PGN65165 Enable	Read/Write	0: Disabled		A trim that enables the Vehicle Electrical Power 2 message	PCC3300, PCC3300V2
			1: Enabled			
46326	Gaseous Fuel Pressure PGN65163 Enable	Read/Write	0: Disabled		A trim that enables the Gaseous Fuel Pressure message	PCC3300, PCC3300V2
			1: Enabled			
46327	Fuel Information 3 - Gaseous PGN64930 Enable	Read/Write	0: Disabled		A trim that enables the Fuel Information 3 - Gaseous message	PCC3300, PCC3300V2
			1: Enabled			
46328	Fuel Information 2 - Gaseous PGN65153 Enable	Read/Write	0: Disabled		A trim that enables the Fuel Information 2 - Gaseous message	PCC3300, PCC3300V2
			1: Enabled			
46332	Inlet/Exhaust Conditions PGN65270 Enable	Read/Write	0: Disabled		A trim that enables the Inlet/Exhaust Conditions message	PCC3300, PCC3300V2
			1: Enabled			
46333	Knock Count 1 PGN65336 Enable	Read/Write	0: Disabled		A trim that enables Knock Count 1 message	PCC3300, PCC3300V2
			1: Enabled			
46334	Knock Count 2 PGN65337 Enable	Read/Write	0: Disabled		A trim that enables Knock Count 2 message	PCC3300, PCC3300V2
			1: Enabled			
46335	Knock Count 3 PGN65338 Enable	Read/Write	0: Disabled		A trim that enables Knock Count 3 message	PCC3300, PCC3300V2
			1: Enabled			
46336	Knock Count 4 PGN65339 Enable	Read/Write	0: Disabled		A trim that enables Knock Count 4 message	PCC3300, PCC3300V2
			1: Enabled			
46337	Knock Count 5 PGN65340 Enable	Read/Write	0: Disabled		A trim that enables Knock Count 5 message	PCC3300, PCC3300V2
			1: Enabled			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46338	Ignition Timing 1 PGN65154 Enable	Read/Write	0: Disabled		A trim that enables the Ignition Timing 1 message	PCC3300, PCC3300V2
			1: Enabled			
46339	Ignition Timing 2 PGN65155 Enable	Read/Write	0: Disabled		A trim that enables the Ignition Timing 2 message	PCC3300, PCC3300V2
			1: Enabled			
46340	Ignition Timing 3 PGN65156 Enable	Read/Write	0: Disabled		A trim that enables the Ignition Timing 3 message	PCC3300, PCC3300V2
			1: Enabled			
46341	Ignition Timing 4 PGN65157 Enable	Read/Write	0: Disabled		A trim that enables the Ignition Timing 4 message	PCC3300, PCC3300V2
			1: Enabled			
46342	Ignition Timing 5 PGN65158 Enable	Read/Write	0: Disabled		A trim that enables the Ignition Timing 5 message	PCC3300, PCC3300V2
			1: Enabled			
46344	Start-Enable (MODBUS Input)	Read/Write	0: Disable		Remote MODBUS Start-Enable input.	PCC3300, PCC3300V2
			1: Enable			
46364	Modbus Register Read Only Enable	Read/Write	0: Disable		Modbus Register Read Only Enable For TB15 Modbus Communication Port.	PCC3300, PCC2300, PCC3300V2
			1: Enable			
46365	Modbus Register Read Only Enable (J14)	Read/Write	0: Disable		Modbus Register Read Only Enable For J14 Modbus Communication Port.	PCC3300, PCC3300V2
			1: Enable			
46366	Modbus Stop Bits (J14)	Read/Write	0: 1		Sets the modbus number of stop bits for this node Limited to 1 bit if parity = Odd or Even	PCC3300, PCC3300V2
			1: 2			
46367	Modbus Bus Message Count (J14)	Read Only	Multiplier: 1	Unit:	The number of modbus messages with no response, for J14 port only	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46368	Modbus CRC Error Count (J14)	Read Only	Multiplier: 1	Unit:	The number of modbus CRC errors, for J14 only.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
46369	Modbus Exception Count (J14)	Read Only	Multiplier: 1	Unit:	Modbus exception count, for J14 only.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
46370	Modbus No Response Count (J14)	Read Only	Multiplier: 1	Unit:	Modbus no response count, for J14 only.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
46371	Modbus Slave Message Count (J14)	Read Only	Multiplier: 1	Unit:	The number of modbus slave messages, for J14 only.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
46372	Modbus Node Address (J14)	Read/Write	Multiplier: 1	Unit:	Sets the modbus address for this node, for J14 only.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 1		
			Size (bits): 8	Upper Limit: 247		
			Sign: U			
46373	Modbus Baud Rate (J14)	Read/Write	0: 2400		Sets the baud rate for modbus communications, for J14 only.	PCC3300, PCC3300V2
			1: 4800			
			2: 9600			
			3: 19200			
46374	Modbus Parity (J14)	Read/Write	0: Even		Sets the modbus parity for this node, for J14 only.	PCC3300, PCC3300V2
			1: Odd			
			2: None			
46376	Modbus Baud Rate	Read/Write	0: 2400 Baud		Sets the modbus baud rate.	PCC3300, PCC2300, PCC3300V2
			1: 4800 Baud			
			2: 9600 Baud			
			3: 19200 Baud			
			4: 38400 Baud			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46377	Modbus Parity	Read/Write	0: Even		Sets the modbus parity for this node	PCC3300, PCC2300, PCC3300V2
			1: Odd			
			2: None			
46378	Modbus Node Address	Read/Write	Multiplier: 1	Unit:	Sets the modbus address for this node	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: 1		
			Size (bits): 8	Upper Limit: 247		
			Sign: U			
46379	Modbus Stop Bits	Read/Write	0: 1		Sets the modbus number of stop bits for this node Limited to 1 bit if parity = Odd or Even	PCC3300, PCC2300, PCC3300V2
			1: 2			
46380	HMI113 Fault 3 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46381	HMI113 Fault 3 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46382	HMI113 Fault 3 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46383	HMI113 Fault 3 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46384	HMI113 Fault 3 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46385	HMI113 Fault 3 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46386	HMI113 Fault 3 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46387	HMI113 Fault 3 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46388	HMI113 Fault 3 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46389	HMI113 Fault 3 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46390	HMI113 Fault 3 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46391	HMI113 Fault 3 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46392	HMI113 Fault 3 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46393	HMI113 Fault 3 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46394	HMI113 Fault 3 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46395	HMI113 Fault 3 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46396	HMI113 Fault 3 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46397	HMI113 Fault 3 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46398	HMI113 Fault 3 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46399	HMI113 Fault 3 Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text string to enter the configurable fault text for this fault.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46600	Aux101 0 Input 1 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46601	Aux101 0 Input 1 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46602	Aux101 0 Input 1 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46603	Aux101 0 Input 1 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46604	Aux101 0 Input 1 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46605	Aux101 0 Input 1 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46606	Aux101 0 Input 1 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46607	Aux101 0 Input 1 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46608	Aux101 0 Input 1 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46609	Aux101 0 Input 1 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46610	Aux101 0 Input 1 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46611	Aux101 0 Input 1 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46612	Aux101 0 Input 1 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46613	Aux101 0 Input 1 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46614	Aux101 0 Input 1 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46615	Aux101 0 Input 1 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46616	Aux101 0 Input 1 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46617	Aux101 0 Input 1 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46618	Aux101 0 Input 1 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46619	Aux101 0 Input 1 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46620	Aux101 0 Input 2 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46621	Aux101 0 Input 2 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46622	Aux101 0 Input 2 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46623	Aux101 0 Input 2 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46624	Aux101 0 Input 2 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46625	Aux101 0 Input 2 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

TABLE 64.

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46626	Aux101 0 Input 2 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46627	Aux101 0 Input 2 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46628	Aux101 0 Input 2 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46629	Aux101 0 Input 2 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46630	Aux101 0 Input 2 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46631	Aux101 0 Input 2 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46632	Aux101 0 Input 2 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46633	Aux101 0 Input 2 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46634	Aux101 0 Input 2 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46635	Aux101 0 Input 2 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46636	Aux101 0 Input 2 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46637	Aux101 0 Input 2 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46638	Aux101 0 Input 2 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46639	Aux101 0 Input 2 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46640	Aux101 1 Input 1 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46641	Aux101 1 Input 1 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46642	Aux101 1 Input 1 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46643	Aux101 1 Input 1 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46644	Aux101 1 Input 1 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46645	Aux101 1 Input 1 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46646	Aux101 1 Input 1 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46647	Aux101 1 Input 1 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46648	Aux101 1 Input 1 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46649	Aux101 1 Input 1 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46650	Aux101 1 Input 1 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46651	Aux101 1 Input 1 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46652	Aux101 1 Input 1 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46653	Aux101 1 Input 1 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46654	Aux101 1 Input 1 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46655	Aux101 1 Input 1 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46656	Aux101 1 Input 1 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46657	Aux101 1 Input 1 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46658	Aux101 1 Input 1 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46659	Aux101 1 Input 1 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46660	Aux101 1 Input 2 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46661	Aux101 1 Input 2 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46662	Aux101 1 Input 2 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46663	Aux101 1 Input 2 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46664	Aux101 1 Input 2 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46665	Aux101 1 Input 2 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46666	Aux101 1 Input 2 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46667	Aux101 1 Input 2 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46668	Aux101 1 Input 2 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46669	Aux101 1 Input 2 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46670	Aux101 1 Input 2 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46671	Aux101 1 Input 2 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46672	Aux101 1 Input 2 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46673	Aux101 1 Input 2 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46674	Aux101 1 Input 2 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46675	Aux101 1 Input 2 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46676	Aux101 1 Input 2 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46677	Aux101 1 Input 2 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46678	Aux101 1 Input 2 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46679	Aux101 1 Input 2 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46800	Aux101 0 Input 3 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46801	Aux101 0 Input 3 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46802	Aux101 0 Input 3 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46803	Aux101 0 Input 3 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46804	Aux101 0 Input 3 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46805	Aux101 0 Input 3 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46806	Aux101 0 Input 3 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46807	Aux101 0 Input 3 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46808	Aux101 0 Input 3 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46809	Aux101 0 Input 3 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46810	Aux101 0 Input 3 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46811	Aux101 0 Input 3 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46812	Aux101 0 Input 3 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46813	Aux101 0 Input 3 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46814	Aux101 0 Input 3 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46815	Aux101 0 Input 3 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46816	Aux101 0 Input 3 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46817	Aux101 0 Input 3 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46818	Aux101 0 Input 3 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46819	Aux101 0 Input 3 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46820	Aux101 0 Input 4 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46821	Aux101 0 Input 4 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46822	Aux101 0 Input 4 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46823	Aux101 0 Input 4 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46824	Aux101 0 Input 4 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46825	Aux101 0 Input 4 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46826	Aux101 0 Input 4 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46827	Aux101 0 Input 4 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46828	Aux101 0 Input 4 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46829	Aux101 0 Input 4 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46830	Aux101 0 Input 4 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46831	Aux101 0 Input 4 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46832	Aux101 0 Input 4 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46833	Aux101 0 Input 4 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46834	Aux101 0 Input 4 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46835	Aux101 0 Input 4 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46836	Aux101 0 Input 4 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46837	Aux101 0 Input 4 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46838	Aux101 0 Input 4 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46839	Aux101 0 Input 4 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46840	Aux101 0 Input 5 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46841	Aux101 0 Input 5 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46842	Aux101 0 Input 5 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46843	Aux101 0 Input 5 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46844	Aux101 0 Input 5 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46845	Aux101 0 Input 5 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46846	Aux101 0 Input 5 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46847	Aux101 0 Input 5 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46848	Aux101 0 Input 5 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46849	Aux101 0 Input 5 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46850	Aux101 0 Input 5 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46851	Aux101 0 Input 5 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46852	Aux101 0 Input 5 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46853	Aux101 0 Input 5 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46854	Aux101 0 Input 5 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46855	Aux101 0 Input 5 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46856	Aux101 0 Input 5 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46857	Aux101 0 Input 5 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46858	Aux101 0 Input 5 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46859	Aux101 0 Input 5 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46860	Aux101 0 Input 6 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46861	Aux101 0 Input 6 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46862	Aux101 0 Input 6 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46863	Aux101 0 Input 6 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46864	Aux101 0 Input 6 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46865	Aux101 0 Input 6 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46866	Aux101 0 Input 6 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46867	Aux101 0 Input 6 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46868	Aux101 0 Input 6 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46869	Aux101 0 Input 6 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46870	Aux101 0 Input 6 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46871	Aux101 0 Input 6 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46872	Aux101 0 Input 6 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46873	Aux101 0 Input 6 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46874	Aux101 0 Input 6 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46875	Aux101 0 Input 6 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46876	Aux101 0 Input 6 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46877	Aux101 0 Input 6 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46878	Aux101 0 Input 6 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46879	Aux101 0 Input 6 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46880	Aux101 1 Input 3 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46881	Aux101 1 Input 3 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46882	Aux101 1 Input 3 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46883	Aux101 1 Input 3 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46884	Aux101 1 Input 3 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46885	Aux101 1 Input 3 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46886	Aux101 1 Input 3 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46887	Aux101 1 Input 3 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46888	Aux101 1 Input 3 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46889	Aux101 1 Input 3 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46890	Aux101 1 Input 3 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46891	Aux101 1 Input 3 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46892	Aux101 1 Input 3 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46893	Aux101 1 Input 3 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46894	Aux101 1 Input 3 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46895	Aux101 1 Input 3 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46896	Aux101 1 Input 3 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46897	Aux101 1 Input 3 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46898	Aux101 1 Input 3 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46899	Aux101 1 Input 3 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46900	Aux101 1 Input 4 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46901	Aux101 1 Input 4 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46902	Aux101 1 Input 4 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46903	Aux101 1 Input 4 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46904	Aux101 1 Input 4 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46905	Aux101 1 Input 4 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46906	Aux101 1 Input 4 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46907	Aux101 1 Input 4 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46908	Aux101 1 Input 4 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46909	Aux101 1 Input 4 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46910	Aux101 1 Input 4 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46911	Aux101 1 Input 4 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46912	Aux101 1 Input 4 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46913	Aux101 1 Input 4 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46914	Aux101 1 Input 4 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46915	Aux101 1 Input 4 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46916	Aux101 1 Input 4 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46917	Aux101 1 Input 4 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

TABLE 65.

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46918	Aux101 1 Input 4 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/System Name	Modbus Access	Specifications		Description	Control Boards
46919	Aux101 1 Input 4 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46920	Aux101 1 Input 5 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46921	Aux101 1 Input 5 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46922	Aux101 1 Input 5 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46923	Aux101 1 Input 5 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46924	Aux101 1 Input 5 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46925	Aux101 1 Input 5 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46926	Aux101 1 Input 5 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46927	Aux101 1 Input 5 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46928	Aux101 1 Input 5 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46929	Aux101 1 Input 5 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46930	Aux101 1 Input 5 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46931	Aux101 1 Input 5 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46932	Aux101 1 Input 5 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46933	Aux101 1 Input 5 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46934	Aux101 1 Input 5 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46935	Aux101 1 Input 5 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46936	Aux101 1 Input 5 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46937	Aux101 1 Input 5 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46938	Aux101 1 Input 5 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46939	Aux101 1 Input 5 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46940	Aux101 1 Input 6 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46941	Aux101 1 Input 6 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46942	Aux101 1 Input 6 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46943	Aux101 1 Input 6 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46944	Aux101 1 Input 6 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46945	Aux101 1 Input 6 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46946	Aux101 1 Input 6 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46947	Aux101 1 Input 6 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46948	Aux101 1 Input 6 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46949	Aux101 1 Input 6 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46950	Aux101 1 Input 6 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46951	Aux101 1 Input 6 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46952	Aux101 1 Input 6 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46953	Aux101 1 Input 6 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46954	Aux101 1 Input 6 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46955	Aux101 1 Input 6 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46956	Aux101 1 Input 6 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46957	Aux101 1 Input 6 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46958	Aux101 1 Input 6 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46959	Aux101 1 Input 6 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46960	Aux101 0 Input 7 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46961	Aux101 0 Input 7 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46962	Aux101 0 Input 7 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46963	Aux101 0 Input 7 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46964	Aux101 0 Input 7 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46965	Aux101 0 Input 7 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46966	Aux101 0 Input 7 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46967	Aux101 0 Input 7 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46968	Aux101 0 Input 7 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46969	Aux101 0 Input 7 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46970	Aux101 0 Input 7 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46971	Aux101 0 Input 7 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46972	Aux101 0 Input 7 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46973	Aux101 0 Input 7 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46974	Aux101 0 Input 7 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46975	Aux101 0 Input 7 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46976	Aux101 0 Input 7 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46977	Aux101 0 Input 7 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46978	Aux101 0 Input 7 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46979	Aux101 0 Input 7 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46980	Aux101 0 Input 8 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46981	Aux101 0 Input 8 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46982	Aux101 0 Input 8 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46983	Aux101 0 Input 8 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46984	Aux101 0 Input 8 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46985	Aux101 0 Input 8 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46986	Aux101 0 Input 8 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46987	Aux101 0 Input 8 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46988	Aux101 0 Input 8 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46989	Aux101 0 Input 8 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46990	Aux101 0 Input 8 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46991	Aux101 0 Input 8 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46992	Aux101 0 Input 8 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46993	Aux101 0 Input 8 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46994	Aux101 0 Input 8 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46995	Aux101 0 Input 8 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46996	Aux101 0 Input 8 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46997	Aux101 0 Input 8 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
46998	Aux101 0 Input 8 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
46999	Aux101 0 Input 8 Fault Text	Read/Write	Multiplier: 1	Unit:	Twenty (20) character text field to allow for the entry of the displayed configurable fault text.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 168	Upper Limit:		
			Sign: C			
47002	GK1 (60Hz)	Read Only	Multiplier: 1	Unit:	The governor 60Hz K1 gain adjust. MODBUS Access: Read Only	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
47003	GK2 (60Hz)	Read Only	Multiplier: 1	Unit:	The governor 60Hz integral gain adjust. MODBUS Access: Read Only	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
47004	GK3 (60Hz)	Read Only	Multiplier: 1	Unit:	The governor 60Hz K3 gain adjust. MODBUS Access: Read Only	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
47005	Governor Damping Effect (60Hz)	Read Only	Multiplier: 1.52587890625E -05	Unit:	The governor 60Hz damping adjust. MODBUS Access:Read Only	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0.6		
			Size (bits): 16	Upper Limit: 0.95		
			Sign: U			
47006	GK1 (50Hz)	Read Only	Multiplier: 1	Unit:	The governor 50Hz K1 gain adjust. MODBUS Access: Read Only	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
47007	GK2 (50Hz)	Read Only	Multiplier: 1	Unit:	The governor 50Hz integral gain adjust. MODBUS Access: Read Only	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
47008	GK3 (50Hz)	Read Only	Multiplier: 1	Unit:	The governor 50Hz K3 gain adjust. MODBUS Access: Read Only	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
47009	Governor Damping Effect (50Hz)	Read Only	Multiplier: 1.52587890625E-05	Unit:	The governor 50Hz damping adjust. MODBUS Access: Read Only	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0.6		
			Size (bits): 16	Upper Limit: 0.95		
			Sign: U			
47010	GK1(Idle)	Read Only	Multiplier: 1	Unit:	This trim is used to adjust gk1 in idle mode. MODBUS Access: Read Only	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
47011	GK2(Idle)	Read Only	Multiplier: 1	Unit:	This trim is used to adjust gk2 in idle mode. MODBUS Access: Read Only	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
47014	Gain Windowing Enable	Read Only	0: Disable		Either enables or disables Gain Windowing feature. MODBUS Access: Read Only	PCC3300, PCC3300V2
			1: Enable			
47015	GK1 Low(50Hz)	Read Only	Multiplier: 1	Unit:	The governor 50Hz K1 low gain adjust. MODBUS Access: Read Only	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
47016	GK1 Low(60Hz)	Read Only	Multiplier: 1	Unit:	The governor 60Hz K1 low gain adjust. MODBUS Access: Read Only	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
47017	GK1 High(50Hz)	Read Only	Multiplier: 1	Unit:	The governor 50Hz K1 high gain adjust. MODBUS Access:Read Only	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
47018	GK1 High(60Hz)	Read Only	Multiplier: 1	Unit:	The governor 60Hz K1 high gain adjust. MODBUS Access:Read Only	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 65530		
			Sign: U			
47019	Governor Speed Delta High	Read Only	Multiplier: 1	Unit:	The speed error higher limit. MODBUS Access:Read Only	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 50		
			Size (bits): 16	Upper Limit: 1000		
			Sign: U			
47020	Governor Speed Delta Low	Read Only	Multiplier: 1	Unit:	The speed error lower limit. MODBUS Access: Read Only	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 50		
			Size (bits): 16	Upper Limit: 1000		
			Sign: U			
47021	Intake Manifold Temperature Sensor Type	Read Only	0: PGBU		Either PGBU (Onan) or EBU (Cummins) sensor. MODBUS Access : Read Only	PCC3300, PCC3300V2
			1: EBU			
47022	Intake Manifold Temperature Sensor Enable	Read Only	0: Disable		Intake Manifold Temp Sensor available or not. MODBUS Access : Read Only	PCC3300, PCC3300V2
			1: Enable			
47023	Oil Temperature Sensor Type	Read Only	0: PGBU		Either PGBU(Onan) or EBU(Cummins) sensor.	PCC3300, PCC3300V2
			1: EBU			
47024	Oil Temperature Sensor Enable	Read Only	0: Disable		High Oil Temperature Sensor available or not.	PCC3300, PCC3300V2
			1: Enable			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
47025	AVR PWM Command	Read Only	Multiplier: 0.01	Unit: %	The AVR PWM software command. Linear relationship between counts and % duty cycle with 10000 counts=100% duty cycle. MODBUS Access : Read Only	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
47026	Coolant Temperature 2 Enable	Read Only	0: Disable		Coolant Temperature 2 Enable	PCC3300, PCC3300V2
			1: Enable			
47027	Start Inhibit Delay Progress	Read Only	Multiplier: 0.05	Unit: sec	Delay progress until a fault is declared for start inhibit	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
47028	Genset Voltage Sensing MCB status	Read Only	0: Close		Indicates the Genset Voltage sensing MCB status.	PCC3300, PCC3300V2
			1: Open			
			2: Reserved			
			3: N/A			
			4: Network Failure			
47029	Customer Gas Valve Status	Read Only	0: Open		Indicates the status of the Customer Gas Valve position.	PCC3300, PCC3300V2
			1: Closed			
			2: Reserved			
			3: N/A			
			4: Network Failure			
47030	Crankcase Pressure Extended	Read Only	Multiplier: 0.01	Unit: psi	Monitor point for the Crankcase Pressure with extended precision.	PCC3300, PCC2300, PCC3300V2
			Offset: 0	Lower Limit: -35.67		
			Size (bits): 16	Upper Limit: 38		
			Sign: S			
47031	Throttle Delta Pressure	Read Only	Multiplier: 0.1	Unit: psi	"The differential pressure between the intake and outlet of a throttle valve"	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 6425.5		
			Sign: U			

Modbus Address	Parameter/System Name	Modbus Access	Specifications		Description	Control Boards
47033	Engine Turbocharger 1 Compressor Intake Temperature	Read Only	Multiplier: 0.1	Unit: degF	Intake temperature of engine turbocharger 1 compressor.	PCC3300, PCC3300V2
			Offset: 0	Lower Limit: -273		
			Size (bits): 16	Upper Limit: 1734.968		
			Sign: S			
47048	Intake Manifold Over Pressure(IM OP) Enable	Read/Write	0: Disabled		"Trim to enable the detection of Intake Manifold Backfire condition"	PCC2300, PCC3300, PCC3300V2
			1: Enabled			
47049	Intake Manifold Temperature Source	Read/Write	0: SPN 105		"Source for Intake Manifold Temperature. SPN 105 Default Source and SPN 52 when the IMOP is Enabled"	PCC2300, PCC3300, PCC3300V2
			1: SPN 52			
47050	Intake Manifold Temp Rate of Change Threshold	Read/Write	Multiplier: 0.1	Unit: degF/secs	"Threshold to decide the Intake Manifold Backfire condition, Value entered is for degF/secs, degF/2secs is obtained by a scalar of 2 in PCC software "	PCC2300, PCC3300, PCC3300V2
			Offset: 0	Lower Limit: 2		
			Size (bits): 8	Upper Limit: 20		
			Sign: U			
47051	Gas Temperature	Read Only	Multiplier: 0.1	Unit: degF	This parameter is to display engine gas fuel temperature	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: S			
47052	Turbocharger Wastegate Position	Read Only	Multiplier: 0.1	Unit: %	To display engine turbocharger wastegate position	PCC3300, PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
47100	AT DEF Tank Level	Read Only	Multiplier: 0.1	Unit: %	"After Treatment Diesel Exhaust Fluid Tank Level"	PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit:		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
47101	AT DEF Concentration	Read Only	Multiplier: 0.01	Unit: %	"After Treatment Diesel Exhaust Fluid Concentration"	PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit:		
			Sign: U			
47102	AT DEF Tank Temperature	Read Only	Multiplier: 0.1	Unit: degF	"After Treatment Diesel Exhaust Fluid Tank Temperature"	PCC3300V2
			Offset: 0	Lower Limit: -40		
			Size (bits): 16	Upper Limit:		
			Sign: S			
47103	AT SCR Catalyst Outlet Gas Temperature	Read Only	Multiplier: 0.1	Unit: degF	"After Treatment SCR Catalyst Outlet Gas Temperature"	PCC3300V2
			Offset: 0	Lower Limit: -459.4		
			Size (bits): 16	Upper Limit:		
			Sign: S			
47104	AT 1 DEF Tank 1 Low Level Indicator	Read Only	0: OFF		Driver's warning indicator for diesel exhaust fluid (DEF) tank low level	PCC3300V2
			1: ON Solid			
			2: ON Fast Blink			
			3: Not Available			
			4: Network Failure			
47105	Operator Inducement Time To Torque Derate Level 1	Read Only	Multiplier: 1	Unit: Minutes	Monitor point for Time To Torque Derate Level 1	PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
47106	Operator Inducement Time To Torque Derate Level 2	Read Only	Multiplier: 1	Unit: Minutes	Monitor point for Time To Torque Derate Level 2	PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			
47107	Operator Inducement Time To Final Inducement Action	Read Only	Multiplier: 1	Unit: Minutes	Monitor point for Time To Final Inducement Action	PCC3300V2
			Offset: 0	Lower Limit:		
			Size (bits): 16	Upper Limit:		
			Sign: U			

Modbus Address	Parameter/ System Name	Modbus Access	Specifications		Description	Control Boards
47108	AT 1 DEF Actual Dosing Quantity	Read Only	Multiplier: 0.3	Unit: g/hr	"Monitor Point for Urea dosing-1 (Leg-1) (grams/hour)"	PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 19277		
			Sign: U			
47109	AT 2 DEF Actual Dosing Quantity	Read Only	Multiplier: 0.3	Unit: g/hr	"Monitor Point for Urea dosing-2 (Leg-2) (grams/hour)"	PCC3300V2
			Offset: 0	Lower Limit: 0		
			Size (bits): 16	Upper Limit: 19277		
			Sign: U			
47110	AT 2 SCR Catalyst Outlet Gas Temperature	Read Only	Multiplier: 0.1	Unit: degF	"Monitor Point for SCR out Temperature- 2 (Leg-2)"	PCC3300V2
			Offset: 0	Lower Limit: -459.4		
			Size (bits): 16	Upper Limit: 3155		
			Sign: S			

This page is intentionally blank.

16 PowerCommand 2.x/3.x/PS0500 Modbus Fault Status Bitmaps

NOTICE

Earlier versions of software may not support all of the Modbus registers in the following table. If a particular register is not available in your installation, it is possible that the Modbus connection is working but the controller software does not support that particular register.

NOTICE

If an address or bit is not listed in this table it is not implemented.

NOTICE

The Master device can read 1-40 contiguous registers, write 1-40 contiguous registers, or read diagnostic counters.

TABLE 66.

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40400	0	Fault Status Bitmap 1	115	Engine Magnetic Crankshaft Speed/Position	Shutdown	PCC3300, PCC2300, PCC3300V2
40400	1	Fault Status Bitmap 1	122	Intake Manifold 1 Pressure:Vtg Above Normal	Warning	PCC3300, PCC2300, PCC3300V2
40400	2	Fault Status Bitmap 1	123	Intake Manifold 1 Pressure:Vtg Below Normal	Warning	PCC3300, PCC2300, PCC3300V2
40400	3	Fault Status Bitmap 1	124	Intake Manifold 1 Pressure:Moderately Severe	Warning	PCC3300, PCC2300, PCC3300V2
40400	4	Fault Status Bitmap 1	135	Engine Oil Rifle Pressure 1:Vtg Above Normal	Warning	PCC3300, PCC2300, PCC3300V2
40400	5	Fault Status Bitmap 1	141	Engine Oil Rifle Pressure 1:Vtg Below Normal	Warning	PCC3300, PCC2300, PCC3300V2
40400	6	Fault Status Bitmap 1	143	Engine Oil Rifle Pressure - Moderately Severe	Warning	PCC3300, PCC2300, PCC3300V2
40400	7	Fault Status Bitmap 1	144	Engine Coolant Temp 1:Vtg Above Normal	Warning	PCC3300, PCC2300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40400	8	Fault Status Bitmap 1	145	Engine Coolant Temp 1:Vtg Below Normal	Warning	PCC3300, PCC2300, PCC3300V2
40400	9	Fault Status Bitmap 1	146	Engine Coolant Temp:Moderately Above Normal	Derate	PCC3300, PCC2300, PCC3300V2
40400	10	Fault Status Bitmap 1	151	Engine Coolant Temp:Severely Above Normal	Shutdown	PCC3300, PCC2300, PCC3300V2
40400	1	Fault Status Bitmap 1	151	High Coolant Temp Shutdown	Shutdown	PS0500
40400	11	Fault Status Bitmap 1	153	Intake Manifold 1 Temp:Vtg Above Normal	Warning	PCC3300, PCC2300, PCC3300V2
40400	12	Fault Status Bitmap 1	154	Intake Manifold 1 Temp:Vtg Below Normal	Warning	PCC3300, PCC2300, PCC3300V2
40400	13	Fault Status Bitmap 1	155	Intake Manifold 1 Temp:Severely Above Normal	Shutdown	PCC3300, PCC2300, PCC3300V2
40400	14	Fault Status Bitmap 1	187	Sensor Supply 2:Vtg Below Normal	Warning	PCC3300, PCC2300, PCC3300V2
40400	15	Fault Status Bitmap 1	195	Coolant Level Sensor 1:Vtg Above Normal	Warning	PCC3300, PCC2300, PCC3300V2
40400	8	Fault Status Bitmap 1	234	Engine Overspeed	Shutdown	PS0500
40400	10	Fault Status Bitmap 1	359	Fail to Start Fault	Shutdown	PS0500
40400	2	Fault Status Bitmap 1	415	Low Oil Pressure Shutdown	Shutdown	PS0500
40400	11	Fault Status Bitmap 1	1123	Shutdown After Battleshort	Shutdown	PS0500
40400	9	Fault Status Bitmap 1	1434	Remote E-Stop Fault	Shutdown	PS0500
40400	3	Fault Status Bitmap 1	1446	High AC Voltage	Shutdown	PS0500
40400	4	Fault Status Bitmap 1	1447	Low AC Voltage	Shutdown	PS0500
40400	6	Fault Status Bitmap 1	1448	Underfrequency	Shutdown	PS0500

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40400	5	Fault Status Bitmap 1	1449	Overfrequency	Shutdown	PS0500
40400	13	Fault Status Bitmap 1	1472	High Current Shutdown	Shutdown	PS0500
40400	15	Fault Status Bitmap 1	1541	Common Shutdown	Shutdown	PS0500
40400	7	Fault Status Bitmap 1	2335	Loss of AC Voltage Sensing	Shutdown	PS0500
40400	0	Fault Status Bitmap 1	2677	Fail To Stop	Shutdown	PS0500
40400	14	Fault Status Bitmap 1	2814	Genset CT Ratio Too Small	Shutdown	PS0500
40400	12	Fault Status Bitmap 1	4799	MB Network	Shutdown	PS0500
40401	0	Fault Status Bitmap 2	196	Coolant Level Sensor 1:Vtg Below Normal	Warning	PCC3300, PCC2300, PCC3300V2
40401	1	Fault Status Bitmap 2	197	Coolant Level:Below Normal - Moderately Severe	Warning	PCC3300, PCC2300, PCC3300V2
40401	2	Fault Status Bitmap 2	212	Engine Oil Temp Sensor 1:Vtg Above Normal	Warning	PCC3300, PCC2300, PCC3300V2
40401	3	Fault Status Bitmap 2	213	Engine Oil Temp Sensor 1:Vtg below Normal	Warning	PCC3300, PCC2300, PCC3300V2
40401	4	Fault Status Bitmap 2	214	Engine Oil Temp:Above Normal - Most severe	Shutdown	PCC3300, PCC2300, PCC3300V2
40401	5	Fault Status Bitmap 2	221	Barometric Pressure:Vtg Above Normal	Warning	PCC3300, PCC2300, PCC3300V2
40401	6	Fault Status Bitmap 2	222	Barometric Pressure Sensor:Vtg Below Normal	Warning	PCC3300, PCC2300, PCC3300V2
40401	7	Fault Status Bitmap 2	223	Eng Oil Burn Valve Solenoid:Vtg Below Normal	Warning	PCC3300, PCC2300, PCC3300V2
40401	8	Fault Status Bitmap 2	224	Engine Oil Burn Valve Solenoid:Vtg Above Normal	Warning	PCC3300, PCC2300, PCC3300V2
40401	9	Fault Status Bitmap 2	227	Sensor Supply 2:Vtg Above Normal	Warning	PCC3300, PCC2300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40401	10	Fault Status Bitmap 2	228	Coolant Pressure:Below Normal-Most Severe	Shutdown	PCC3300, PCC2300, PCC3300V2
40401	11	Fault Status Bitmap 2	231	Coolant Pressure Sensor:Vtg Above Normal	Warning	PCC3300, PCC2300, PCC3300V2
40401	12	Fault Status Bitmap 2	232	Coolant Pressure Sensor:Vtg Below Normal	Warning	PCC3300, PCC2300, PCC3300V2
40401	13	Fault Status Bitmap 2	234	Engine Crankshaft Speed/Posn:Above Normal	Shutdown	PCC3300, PCC2300, PCC3300V2
40401	14	Fault Status Bitmap 2	235	Coolant Level:Below Normal-Most Severe	Shutdown	PCC3300, PCC2300, PCC3300V2
40401	15	Fault Status Bitmap 2	238	Sensor Supply 3:Vtg Below Normal	Warning	PCC3300, PCC2300, PCC3300V2
40402	0	Fault Status Bitmap 3	239	Voltage Supply 3 High Error	Warning	PCC3300, PCC2300, PCC3300V2
40402	1	Fault Status Bitmap 3	245	Radiator Fan Control Driver Low Error	Warning	PCC3300, PCC2300, PCC3300V2
40402	2	Fault Status Bitmap 3	261	Engine Fuel Temp:Above Normal-Moderately Severe	Warning	PCC3300, PCC2300, PCC3300V2
40402	3	Fault Status Bitmap 3	263	Engine Fuel Temp Sensor 1:Vtg Above Normal	Warning	PCC3300, PCC2300, PCC3300V2
40402	4	Fault Status Bitmap 3	265	Engine Fuel Temp Sensor 1:Vtg Below Normal	Warning	PCC3300, PCC2300, PCC3300V2
40402	5	Fault Status Bitmap 3	266	Engine Fuel Temp:Above Normal-Most severe	Shutdown	PCC3300, PCC2300, PCC3300V2
40402	6	Fault Status Bitmap 3	271	Fuel Pump Pressurizing Assembly 1:Vtg Below Normal	Warning	PCC3300, PCC2300, PCC3300V2
40402	7	Fault Status Bitmap 3	272	Fuel Pump Pressurizing Assembly 1:Vtg Above Normal	Warning	PCC3300, PCC2300, PCC3300V2
40402	8	Fault Status Bitmap 3	281	APC_DIESEL_CYL_PRS_I MBAL_ERROR	Warning	PCC3300, PCC2300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40402	9	Fault Status Bitmap 3	285	SAE J1939 Muxing PGN Timeout:Abnormal Update Rate	Warning	PCC3300, PCC2300, PCC3300V2
40402	10	Fault Status Bitmap 3	286	SAE J1939 Muxing Config:Out of Calibration	Warning	PCC3300, PCC2300, PCC3300V2
40402	11	Fault Status Bitmap 3	5669	Intake Manifold Over Pressure - Condition Exists	Shutdown	PCC3300, PCC2300, PCC3300V2
40402	13	Fault Status Bitmap 3	295	AMBIENT_AIR_PRESS_KEYON_ERROR	Warning	PCC3300, PCC2300, PCC3300V2
40402	14	Fault Status Bitmap 3	319	RTC PWR Intr:Data Erratic Intermittent or Wrong	Warning	PCC3300, PCC2300, PCC3300V2
40402	15	Fault Status Bitmap 3	322	Injector Solenoid Driver Cylinder 1:UnderCurrent	Warning	PCC3300, PCC2300, PCC3300V2
40403	0	Fault Status Bitmap 4	323	Injector Solenoid Driver Cylinder 5:UnderCurrent	Warning	PCC3300, PCC2300, PCC3300V2
40403	1	Fault Status Bitmap 4	324	Injector Solenoid Driver Cylinder 3:UnderCurrent	Warning	PCC3300, PCC2300, PCC3300V2
40403	2	Fault Status Bitmap 4	325	Injector Solenoid Driver Cylinder 6:UnderCurrent	Warning	PCC3300, PCC2300, PCC3300V2
40403	3	Fault Status Bitmap 4	331	Injector Solenoid Driver Cylinder 2:UnderCurrent	Warning	PCC3300, PCC2300, PCC3300V2
40403	4	Fault Status Bitmap 4	332	Injector Solenoid Driver Cylinder 4:UnderCurrent	Warning	PCC3300, PCC2300, PCC3300V2
40403	6	Fault Status Bitmap 4	342	Electronic Calibration Code:Out of Calibration	Shutdown	PCC3300, PCC2300, PCC3300V2
40403	7	Fault Status Bitmap 4	343	Eng Ctrl:internal h/w failure-Bad Device/Component	Warning	PCC3300, PCC2300, PCC3300V2
40403	8	Fault Status Bitmap 4	351	Injector Power Supply:Bad Device/Component	Warning	PCC3300, PCC2300, PCC3300V2
40403	9	Fault Status Bitmap 4	352	Sensor Supply 1:Vtg Below Normal	Warning	PCC3300, PCC2300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40403	10	Fault Status Bitmap 4	359	Fail To Start Fault	Shutdown	PCC3300, PCC2300, PCC3300V2
40403	11	Fault Status Bitmap 4	386	Sensor Supply 1:Vtg Above Normal	Warning	PCC3300, PCC2300, PCC3300V2
40403	12	Fault Status Bitmap 4	415	Eng Oil Rifle Pressure:Below Normal-Most Severe	Shutdown	PCC3300, PCC2300, PCC3300V2
40403	13	Fault Status Bitmap 4	418	Water in Fuel Indicator:Above Normal-Least Severe	Warning	PCC3300, PCC2300, PCC3300V2
40403	14	Fault Status Bitmap 4	421	Eng Oil Temp:Above Normal-Moderately Severe	Warning	PCC3300, PCC2300, PCC3300V2
40403	15	Fault Status Bitmap 4	422	COOLANT_LEVEL_READING_INCORRECT	Warning	PCC3300, PCC2300, PCC3300V2
40404	0	Fault Status Bitmap 5	425	OIL_TEMPERATURE_IN_RANGE_ERROR	Warning	PCC3300, PCC2300, PCC3300V2
40404	1	Fault Status Bitmap 5	426	J1939 Datalink:Data Erratic/Intermittent/Wrong	NONE	PCC3300, PCC2300, PCC3300V2
40404	2	Fault Status Bitmap 5	427	CAN Datalink Degraded	Warning	PCC3300, PCC2300, PCC3300V2
40404	3	Fault Status Bitmap 5	435	OIL_PRESSURE_SWITCH_ERROR	Warning	PCC3300, PCC2300, PCC3300V2
40404	4	Fault Status Bitmap 5	441	Low Battery Voltage	Warning	PCC3300, PCC2300, PCC3300V2
40404	5	Fault Status Bitmap 5	442	High Battery Voltage	Warning	PCC3300, PCC2300, PCC3300V2
40404	6	Fault Status Bitmap 5	449	Injector Metering Rail 1 Pressure:Above Normal	Shutdown	PCC3300, PCC2300, PCC3300V2
40404	7	Fault Status Bitmap 5	451	Injector Metering Rail 1 Pressure:Vtg Above Normal	Warning	PCC3300, PCC2300, PCC3300V2
40404	8	Fault Status Bitmap 5	452	Injector Metering Rail 1 Pressure:Vtg Below Normal	Warning	PCC3300, PCC2300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40404	9	Fault Status Bitmap 5	488	Intake Manifold 1 Temp:Above Normal-Moderate	Derate	PCC3300, PCC2300, PCC3300V2
40404	10	Fault Status Bitmap 5	546	Fuel Delivery Pressure:Vtg Above Normal	Warning	PCC3300, PCC2300, PCC3300V2
40404	11	Fault Status Bitmap 5	547	Fuel Delivery Pressure:Vtg Below Normal	Warning	PCC3300, PCC2300, PCC3300V2
40404	12	Fault Status Bitmap 5	553	APC_DIESEL_HIGH_PRS_ERROR	Warning	PCC3300, PCC2300, PCC3300V2
40404	13	Fault Status Bitmap 5	554	APC_DIESEL_PRS_SIR_ERROR	Warning	PCC3300, PCC2300, PCC3300V2
40404	15	Fault Status Bitmap 5	559	Injector Metering Rail 1 Pressure:Below Normal	Warning	PCC3300, PCC2300, PCC3300V2
40405	1	Fault Status Bitmap 6	611	Engine Shut Down Hot Condition Exists	Warning	PCC3300, PCC2300, PCC3300V2
40405	2	Fault Status Bitmap 6	698	ECM Internal Temperature Low Error	Warning	PCC3300, PCC2300, PCC3300V2
40405	3	Fault Status Bitmap 6	689	Eng Crankshaft Speed/Pos Warning	Warning	PCC3300, PCC2300, PCC3300V2
40405	4	Fault Status Bitmap 6	731	Eng Speed:Cam/Crankshaft Misalignment	Warning	PCC3300, PCC2300, PCC3300V2
40405	5	Fault Status Bitmap 6	2661	At Least One ACK:Most Severe Fault	Shutdown	PCC3300, PCC2300, PCC3300V2
40405	6	Fault Status Bitmap 6	781	CAN Datalink Failed	Shutdown	PCC3300, PCC2300, PCC3300V2
40405	7	Fault Status Bitmap 6	1117	Power Lost With Ignition On	Warning	PCC3300, PCC3300V2
40405	8	Fault Status Bitmap 6	1122	Rated to Idle Transition	NONE	PCC3300, PCC2300, PCC3300V2
40405	9	Fault Status Bitmap 6	1124	Delayed Shutdown Fault	Warning	PCC3300, PCC2300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40405	10	Fault Status Bitmap 6	1131	Battle Short Mode Active	Warning	PCC3300, PCC2300, PCC3300V2
40405	11	Fault Status Bitmap 6	1132	Controlled Shutdown In Process	Warning	PCC3300, PCC3300V2
40405	13	Fault Status Bitmap 6	1243	Engine Derate	Derate	PCC3300, PCC2300, PCC3300V2
40405	14	Fault Status Bitmap 6	1244	Engine Normal Shutdown	Shutdown w/Cooldown	PCC3300, PCC2300, PCC3300V2
40405	15	Fault Status Bitmap 6	1245	Engine Shutdown	Shutdown	PCC3300, PCC2300, PCC3300V2
40406	0	Fault Status Bitmap 7	1246	Unrecognized Engine Fault	Warning	PCC3300, PCC2300, PCC3300V2
40406	1	Fault Status Bitmap 7	1247	Engine Shutdown – Unannounced	Shutdown	PCC3300, PCC2300, PCC3300V2
40406	2	Fault Status Bitmap 7	1248	Engine Warning	Warning	PCC3300, PCC2300, PCC3300V2
40406	3	Fault Status Bitmap 7	1256	Ctrl Module ID Input State Warning Error	Warning	PCC3300, PCC2300, PCC3300V2
40406	4	Fault Status Bitmap 7	1257	Ctrl Module ID I/P State shutdown Error	Shutdown	PCC3300, PCC2300, PCC3300V2
40406	5	Fault Status Bitmap 7	1322	kW Load Setpoint OOR High	Warning	PCC3300, PCC3300V2
40406	6	Fault Status Bitmap 7	1323	kW Load Setpoint OOR Low	Warning	PCC3300, PCC3300V2
40406	7	Fault Status Bitmap 7	1324	kVAR Load Setpoint OOR High	Warning	PCC3300, PCC3300V2
40406	8	Fault Status Bitmap 7	1325	kVAR Load Setpoint OOR Low	Warning	PCC3300, PCC3300V2
40406	9	Fault Status Bitmap 7	1336	Cooldown Completed Fault	Shutdown	PCC3300, PCC2300, PCC3300V2
40406	10	Fault Status Bitmap 7	1357	Eng Oil Lvl Remote Reservoir:Below Normal	Warning	PCC3300, PCC2300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40406	11	Fault Status Bitmap 7	219	Eng Oil Level Remote Reservoir: Least Severe Level	Warning	PCC3300, PCC2300, PCC3300V2
40406	12	Fault Status Bitmap 7	233	HT Coolant Pressure Moderate Low	Warning	PCC3300, PCC2300, PCC3300V2
40406	13	Fault Status Bitmap 7	254	FSO NON Low Control Error	Shutdown	PCC3300, PCC2300, PCC3300V2
40406	14	Fault Status Bitmap 7	686	Turbo 1 Speed Incorrect	Warning	PCC3300, PCC2300, PCC3300V2
40406	15	Fault Status Bitmap 7	697	ECM Internal Temperature High Error	Warning	PCC3300, PCC2300, PCC3300V2
40407	0	Fault Status Bitmap 8	1376	Eng Camshaft Speed/Pos Warning	Warning	PCC3300, PCC2300, PCC3300V2
40407	1	Fault Status Bitmap 8	3611	Custom Overcurrent Fault	Warning	PCC3300, PCC2300, PCC3300V2
40407	2	Fault Status Bitmap 8	3513	Negative Sequence Overcurrent	Warning	PCC3300, PCC2300, PCC3300V2
40407	3	Fault Status Bitmap 8	1416	Fail to Shutdown	Warning	PCC3300, PCC2300, PCC3300V2
40407	4	Fault Status Bitmap 8	1417	Power Down Failure	Warning	PCC3300, PCC2300, PCC3300V2
40407	5	Fault Status Bitmap 8	1433	Local E-Stop	Shutdown	PCC3300, PCC2300, PCC3300V2
40407	6	Fault Status Bitmap 8	1434	Remote E-Stop	Shutdown	PCC3300, PCC2300, PCC3300V2
40407	7	Fault Status Bitmap 8	1435	Low Coolant Temperature	Warning	PCC3300, PCC2300, PCC3300V2
40407	8	Fault Status Bitmap 8	1438	Fail To Crank Fault	Shutdown	PCC3300, PCC2300, PCC3300V2
40407	9	Fault Status Bitmap 8	1439	Low Fuel in Day Tank	Warning	PCC3300, PCC2300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40407	10	Fault Status Bitmap 8	1441	Low Fuel Level	Warning	PCC3300, PCC2300, PCC3300V2
40407	11	Fault Status Bitmap 8	1442	Weak Battery	Warning	PCC3300, PCC2300, PCC3300V2
40407	12	Fault Status Bitmap 8	1443	Dead Battery	Shutdown	PCC3300, PCC2300, PCC3300V2
40407	13	Fault Status Bitmap 8	1444	Overload	Warning	PCC3300, PCC2300, PCC3300V2
40407	14	Fault Status Bitmap 8	1445	Short Circuit	Shutdown	PCC3300, PCC2300, PCC3300V2
40407	15	Fault Status Bitmap 8	1446	High AC Voltage	Shutdown	PCC3300, PCC2300, PCC3300V2
40408	0	Fault Status Bitmap 9	1447	Low AC Voltage	Shutdown	PCC3300, PCC2300, PCC3300V2
40408	1	Fault Status Bitmap 9	1448	Underfrequency	Shutdown	PCC3300, PCC2300, PCC3300V2
40408	2	Fault Status Bitmap 9	1449	Overfrequency	Warning	PCC3300, PCC2300, PCC3300V2
40408	3	Fault Status Bitmap 9	1459	Reverse kW	Shutdown	PCC3300, PCC2300, PCC3300V2
40408	4	Fault Status Bitmap 9	1461	Loss of Field	Shutdown	PCC3300, PCC2300, PCC3300V2
40408	5	Fault Status Bitmap 9	1463	Not In Auto	NONE	PCC3300, PCC2300, PCC3300V2
40408	6	Fault Status Bitmap 9	1464	Load Dump	Warning	PCC3300, PCC2300, PCC3300V2
40408	7	Fault Status Bitmap 9	1465	Ready To Load	NONE	PCC3300, PCC2300, PCC3300V2
40408	8	Fault Status Bitmap 9	1469	Speed/Frequency Mismatch Fault	Shutdown	PCC3300, PCC2300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40408	9	Fault Status Bitmap 9	1471	High Current Warning	Warning	PCC3300, PCC2300, PCC3300V2
40408	10	Fault Status Bitmap 9	1472	Overcurrent Shutdown	Shutdown	PCC3300, PCC2300, PCC3300V2
40408	11	Fault Status Bitmap 9	1483	Common Alarm	None	PCC3300, PCC2300, PCC3300V2
40408	12	Fault Status Bitmap 9	1548	Injector Solenoid Driver Cylinder 7:UnderCurrent	Warning	PCC3300, PCC2300, PCC3300V2
40408	13	Fault Status Bitmap 9	1549	Injector Solenoid Driver Cylinder 8:UnderCurrent	Warning	PCC3300, PCC2300, PCC3300V2
40408	14	Fault Status Bitmap 9	1551	Injector Solenoid Driver Cylinder 10:UnderCurrent	Warning	PCC3300, PCC2300, PCC3300V2
40408	15	Fault Status Bitmap 9	1552	Injector Solenoid Driver Cylinder 11:UnderCurrent	Warning	PCC3300, PCC2300, PCC3300V2
40409	0	Fault Status Bitmap 10	1553	Injector Solenoid Driver Cylinder 12:UnderCurrent	Warning	PCC3300, PCC2300, PCC3300V2
40409	1	Fault Status Bitmap 10	1554	Injector Solenoid Driver Cylinder 13:UnderCurrent	Warning	PCC3300, PCC2300, PCC3300V2
40409	2	Fault Status Bitmap 10	1555	Injector Solenoid Driver Cylinder 14:UnderCurrent	Warning	PCC3300, PCC2300, PCC3300V2
40409	3	Fault Status Bitmap 10	1556	Injector Solenoid Driver Cylinder 15:UnderCurrent	Warning	PCC3300, PCC2300, PCC3300V2
40409	4	Fault Status Bitmap 10	1557	Injector Solenoid Driver Cylinder 16:UnderCurrent	Warning	PCC3300, PCC2300, PCC3300V2
40409	5	Fault Status Bitmap 10	1452	Genset Breaker Fail To Close	Warning	PCC3300, PCC3300V2
40409	6	Fault Status Bitmap 10	1453	Genset Breaker Fail To Open	Warning	PCC3300, PCC3300V2
40409	7	Fault Status Bitmap 10	1622	Injector Solenoid Driver Cylinder 9:UnderCurrent	Warning	PCC3300, PCC2300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40409	8	Fault Status Bitmap 10	1689	Real Time Clock Power Interrupt Fault	Warning	PCC3300, PCC2300, PCC3300V2
40409	9	Fault Status Bitmap 10	1695	SENSOR_SUPPLY_5_VOLTAGE_HIGH_ERROR	Warning	PCC3300, PCC2300, PCC3300V2
40409	10	Fault Status Bitmap 10	1696	SENSOR_SUPPLY_5_VOLTAGE_LOW_ERROR	Warning	PCC3300, PCC2300, PCC3300V2
40409	11	Fault Status Bitmap 10	1843	Crankcase Pressure:Vtg Above Normal	Warning	PCC3300, PCC2300, PCC3300V2
40409	12	Fault Status Bitmap 10	1844	Crankcase Pressure:Vtg Below Normal	Warning	PCC3300, PCC2300, PCC3300V2
40409	13	Fault Status Bitmap 10	1845	Water in Fuel Indicator:Vtg Above Normal	Warning	PCC3300, PCC2300, PCC3300V2
40409	14	Fault Status Bitmap 10	1846	Water in Fuel Indicator:Vtg Below Normal	Warning	PCC3300, PCC2300, PCC3300V2
40409	15	Fault Status Bitmap 10	1847	Eng Coolant Temp - Shutdown w/Cool	Shutdown w/Cooldown	PCC3300, PCC2300, PCC3300V2
40410	6	Fault Status Bitmap 11	141	Low Oil Pressure OOR Warning	Warning	PS0500
40410	5	Fault Status Bitmap 11	143	Low Oil Pressure Warning	Warning	PS0500
40410	2	Fault Status Bitmap 11	144	Coolant Temp OOR Warning	Warning	PS0500
40410	0	Fault Status Bitmap 11	146	High Coolant Temp Warning	Warning	PS0500
40410	3	Fault Status Bitmap 11	441	Low Battery Voltage	Warning	PS0500
40410	4	Fault Status Bitmap 11	442	High Battery Voltage	Warning	PS0500
40410	7	Fault Status Bitmap 11	1131	Battle Short Mode Active Fault	Warning	PS0500
40410	9	Fault Status Bitmap 11	1416	Fail to Shutdown Fault	Warning	PS0500
40410	1	Fault Status Bitmap 11	1435	Low Coolant Temperature	Warning	PS0500

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40410	10	Fault Status Bitmap 11	1442	Weak Battery Fault	Warning	PS0500
40410	11	Fault Status Bitmap 11	1471	High Current Warning	Warning	PS0500
40410	14	Fault Status Bitmap 11	1540	Common Warning	Warning	PS0500
40410	0	Fault Status Bitmap 11	1852	Water in Fuel Indicator:Above Normal-Moderate	Warning	PCC3300, PCC2300, PCC3300V2
40410	1	Fault Status Bitmap 11	11634	HMI113 Fault 1	Warning	PCC3300, PCC2300, PCC3300V2
40410	2	Fault Status Bitmap 11	11635	HMI113 Fault 2	Warning	PCC3300, PCC2300, PCC3300V2
40410	3	Fault Status Bitmap 11	11636	HMI113 Fault 3	Warning	PCC3300, PCC2300, PCC3300V2
40410	5	Fault Status Bitmap 11	1891	Eng Oil Change Interval	Warning	PCC3300, PCC2300, PCC3300V2
40410	6	Fault Status Bitmap 11	1893	J39_EGR_VALVE_COMM_TIMEOUT_ERROR	Warning	PCC3300, PCC2300, PCC3300V2
40410	7	Fault Status Bitmap 11	1894	J39_VGT_COMM_TIMEOUT_ERROR	Warning	PCC3300, PCC2300, PCC3300V2
40410	8	Fault Status Bitmap 11	1896	EGR_DL_VALVE_STUCK_ERROR	Warning	PCC3300, PCC2300, PCC3300V2
40410	9	Fault Status Bitmap 11	1899	EGR_DELTA_P_IR_LOW_ERROR	Warning	PCC3300, PCC2300, PCC3300V2
40410	11	Fault Status Bitmap 11	1912	Utility Loss Of Phase	Warning	PCC3300, PCC3300V2
40410	12	Fault Status Bitmap 11	1913	Genset Loss Of Phase	Warning	PCC3300, PCC3300V2
40410	13	Fault Status Bitmap 11	1914	Utility Phase Rotation	Warning	PCC3300, PCC3300V2
40410	14	Fault Status Bitmap 11	1915	Genset Phase Rotation	Warning	PCC3300, PCC3300V2
40410	15	Fault Status Bitmap 11	1916	Sync Check OK	NONE	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40410	13	Fault Status Bitmap 11	6226	Maintenance Required - Condition Exists	Warning	PS0500
40410	12	Fault Status Bitmap 11	6227	Current Imbalance - Condition Exists	Warning	PS0500
40410	8	Fault Status Bitmap 11	2678	Charging Alternator Failure Fault	Warning	PS0500
40411	0	Fault Status Bitmap 12	1917	High Fuel Level	Warning	PCC3300, PCC2300, PCC3300V2
40411	1	Fault Status Bitmap 12	1918	Very Low Fuel Level	Shutdown	PCC3300, PCC2300, PCC3300V2
40411	2	Fault Status Bitmap 12	1933	EGR_DL_VOLTAGE_HIGH_ERROR	Warning	PCC3300, PCC2300, PCC3300V2
40411	3	Fault Status Bitmap 12	1934	EGR_DL_VOLTAGE_LOW_ERROR	Warning	PCC3300, PCC2300, PCC3300V2
40411	4	Fault Status Bitmap 12	1935	EGR_DL_COMMAND_SOURCE_ERROR	Warning	PCC3300, PCC2300, PCC3300V2
40411	5	Fault Status Bitmap 12	1942	Crankcase Pressure - Data Erratic, Intermittent, or Incorrect	Warning	PCC3300, PCC2300, PCC3300V2
40411	6	Fault Status Bitmap 12	1943	CBR_DENSITY_DERATE_ERROR_ID	NONE	PCC3300, PCC2300, PCC3300V2
40411	7	Fault Status Bitmap 12	1944	HMI113 Output Configuration Fault	Warning	PCC3300, PCC2300, PCC3300V2
40411	8	Fault Status Bitmap 12	1961	EGR_DL_EDU_TMPTR_HIGH_ERROR	Warning	PCC3300, PCC2300, PCC3300V2
40411	9	Fault Status Bitmap 12	1974	CRANKCASE_PRESSURE_LEAST_SEV_HIGH	Warning	PCC3300, PCC2300, PCC3300V2
40411	10	Fault Status Bitmap 12	1992	Eng Crankshaft Speed/Posn:Above Normal	Shutdown	PCC3300, PCC2300, PCC3300V2
40411	11	Fault Status Bitmap 12	1999	Maximum Parallel Time	Warning	PCC3300, PCC3300V2
40411	12	Fault Status Bitmap 12	2185	Sensor Supply 4:Vtg Above Normal	Warning	PCC3300, PCC2300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40411	13	Fault Status Bitmap 12	2186	Sensor Supply 4:Vtg Below Normal	Warning	PCC3300, PCC2300, PCC3300V2
40411	14	Fault Status Bitmap 12	2215	Fuel Pump Delivery Pressure:Below Normal	Warning	PCC3300, PCC2300, PCC3300V2
40411	15	Fault Status Bitmap 12	2249	Injector Metering Rail 1 Press Hi	Warning	PCC3300, PCC2300, PCC3300V2
40412	0	Fault Status Bitmap 13	2261	Fuel Pump Delivery Pressure:Above Normal	Warning	PCC3300, PCC2300, PCC3300V2
40412	1	Fault Status Bitmap 13	2262	Fuel Pump Delivery-Below Normal	Warning	PCC3300, PCC2300, PCC3300V2
40412	2	Fault Status Bitmap 13	2265	Electric Lift Pump for Eng Fuel:Vtg Above Normal	Warning	PCC3300, PCC2300, PCC3300V2
40412	3	Fault Status Bitmap 13	2266	Electric Lift Pump for Eng Fuel:Vtg Below Normal	Warning	PCC3300, PCC2300, PCC3300V2
40412	4	Fault Status Bitmap 13	2292	APC_DIESEL_FLOW_HIGH_ERROR	Warning	PCC3300, PCC2300, PCC3300V2
40412	5	Fault Status Bitmap 13	2293	APC_DIESEL_FLOW_LOW_ERROR	Warning	PCC3300, PCC2300, PCC3300V2
40412	6	Fault Status Bitmap 13	2311	Electronic Fuel Injection Control Valve	Warning	PCC3300, PCC2300, PCC3300V2
40412	7	Fault Status Bitmap 13	2328	Utility Available	NONE	PCC3300, PCC3300V2
40412	8	Fault Status Bitmap 13	2331	Utility Undervoltage	Warning	PCC3300, PCC3300V2
40412	9	Fault Status Bitmap 13	2332	Utility Connected	NONE	PCC3300, PCC3300V2
40412	10	Fault Status Bitmap 13	2333	Genset Connected	NONE	PCC3300, PCC3300V2
40412	11	Fault Status Bitmap 13	2335	Excitation/Loss of AC Voltage Sensing	Shutdown	PCC3300, PCC2300, PCC3300V2
40412	13	Fault Status Bitmap 13	2342	Too Long in Idle	Warning	PCC3300, PCC2300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40412	14	Fault Status Bitmap 13	2358	Utility Overvoltage	Warning	PCC3300, PCC3300V2
40412	15	Fault Status Bitmap 13	2377	Fan Control:Vtg Above Normal	Warning	PCC3300, PCC2300, PCC3300V2
40413	0	Fault Status Bitmap 14	2396	Utility Breaker Fail To Close	Warning	PCC3300, PCC3300V2
40413	1	Fault Status Bitmap 14	2397	Utility Breaker Fail To Open	Warning	PCC3300, PCC3300V2
40413	2	Fault Status Bitmap 14	3226	Base Load	NONE	PCC3300, PCC3300V2
40413	3	Fault Status Bitmap 14	3227	Peak Shave	NONE	PCC3300, PCC3300V2
40413	4	Fault Status Bitmap 14	2555	Engine Intake Air Heater 1 Circuit Voltage High	Warning	PCC3300, PCC2300, PCC3300V2
40413	5	Fault Status Bitmap 14	2556	Engine Intake Air Heater 1 Circuit - Voltage Low	Warning	PCC3300, PCC2300, PCC3300V2
40413	6	Fault Status Bitmap 14	2678	Charging Alternator Failure Fault	Warning	PCC3300, PCC2300, PCC3300V2
40413	7	Fault Status Bitmap 14	2965	Genset Available	NONE	PCC3300, PCC3300V2
40413	8	Fault Status Bitmap 14	2971	Test/Exercise is Active Fault	NONE	PCC3300, PCC2300, PCC3300V2
40413	9	Fault Status Bitmap 14	2972	Field Overload	Shutdown	PCC3300, PCC2300, PCC3300V2
40413	10	Fault Status Bitmap 14	2973	CHARGE_PRESS_IR_ERR OR	Warning	PCC3300, PCC2300, PCC3300V2
40413	11	Fault Status Bitmap 14	2943	Manual Switch Configuration Fault	Warning	PCC3300, PCC2300, PCC3300V2
40413	12	Fault Status Bitmap 14	2944	Auto Switch Configuration Fault	Warning	PCC3300, PCC2300, PCC3300V2
40413	13	Fault Status Bitmap 14	2914	Genset AC Meter Failed	Shutdown	PCC3300, PCC2300, PCC3300V2
40413	14	Fault Status Bitmap 14	2915	Genset Bus AC Meter Failed	Warning	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40413	15	Fault Status Bitmap 14	2916	Utility AC Meter Failed	Warning	PCC3300, PCC3300V2
40414	0	Fault Status Bitmap 15	2814	Genset CT Ratio Too Small	Shutdown	PCC3300, PCC2300, PCC3300V2
40414	1	Fault Status Bitmap 15	2815	Genset CT Ratio Too Large	Warning	PCC3300, PCC2300, PCC3300V2
40414	2	Fault Status Bitmap 15	2816	Genset PT Ratio Too Small	Shutdown	PCC3300, PCC2300, PCC3300V2
40414	3	Fault Status Bitmap 15	2817	Genset PT Ratio Too Large	Warning	PCC3300, PCC2300, PCC3300V2
40414	4	Fault Status Bitmap 15	2818	Genset Bus PT Ratio Too Small	Shutdown	PCC3300, PCC3300V2
40414	5	Fault Status Bitmap 15	2819	Genset Bus PT Ratio Too Large	Warning	PCC3300, PCC3300V2
40414	6	Fault Status Bitmap 15	2821	Utility PT Ratio Too Small	Shutdown	PCC3300, PCC3300V2
40414	7	Fault Status Bitmap 15	2822	Utility PT Ratio Too Large	Warning	PCC3300, PCC3300V2
40414	8	Fault Status Bitmap 15	5182	AUX101 0 Input 1 Fault	Warning	PCC3300, PCC2300, PCC3300V2
40414	9	Fault Status Bitmap 15	2621	Aux101 0 Input 2 Fault	Warning	PCC3300, PCC2300, PCC3300V2
40414	10	Fault Status Bitmap 15	2622	Aux101 0 Input 3 Fault	Warning	PCC3300, PCC2300, PCC3300V2
40414	11	Fault Status Bitmap 15	2623	Aux101 0 Input 4 Fault	Warning	PCC3300, PCC2300, PCC3300V2
40414	12	Fault Status Bitmap 15	2624	Aux101 0 Input 5 Fault	Warning	PCC3300, PCC2300, PCC3300V2
40414	13	Fault Status Bitmap 15	2625	Aux101 0 Input 6 Fault	Warning	PCC3300, PCC2300, PCC3300V2
40414	14	Fault Status Bitmap 15	2626	Aux101 0 Input 7 Fault	Warning	PCC3300, PCC2300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40414	15	Fault Status Bitmap 15	2627	Aux101 0 Input 8 Fault	Warning	PCC3300, PCC2300, PCC3300V2
40415	0	Fault Status Bitmap 16	2882	Aux101 1 Input 1 Fault	Warning	PCC3300, PCC2300, PCC3300V2
40415	1	Fault Status Bitmap 16	2883	Aux101 1 Input 2 Fault	Warning	PCC3300, PCC2300, PCC3300V2
40415	2	Fault Status Bitmap 16	2884	Aux101 1 Input 3 Fault	Warning	PCC3300, PCC2300, PCC3300V2
40415	3	Fault Status Bitmap 16	2885	Aux101 1 Input 4 Fault	Warning	PCC3300, PCC2300, PCC3300V2
40415	4	Fault Status Bitmap 16	2886	Aux101 1 Input 5 Fault	Warning	PCC3300, PCC2300, PCC3300V2
40415	5	Fault Status Bitmap 16	2887	Aux101 1 Input 6 Fault	Warning	PCC3300, PCC2300, PCC3300V2
40415	6	Fault Status Bitmap 16	2888	Aux101 1 Input 7 Fault	Warning	PCC3300, PCC2300, PCC3300V2
40415	7	Fault Status Bitmap 16	2889	Aux101 1 Input 8 Fault	Warning	PCC3300, PCC2300, PCC3300V2
40415	8	Fault Status Bitmap 16	2628	Aux102 0 Expansion Input 9 Fault	Warning	PCC3300, PCC2300, PCC3300V2
40415	9	Fault Status Bitmap 16	2629	Aux102 0 Expansion Input 10 Fault	Warning	PCC3300, PCC2300, PCC3300V2
40415	10	Fault Status Bitmap 16	2631	Aux102 0 Expansion Input 11 Fault	Warning	PCC3300, PCC2300, PCC3300V2
40415	11	Fault Status Bitmap 16	2632	Aux102 0 Expansion Input 12 Fault	Warning	PCC3300, PCC2300, PCC3300V2
40415	12	Fault Status Bitmap 16	2891	Aux102 1 Expansion Input 9 Fault	Warning	PCC3300, PCC2300, PCC3300V2
40415	13	Fault Status Bitmap 16	2892	Aux102 1 Expansion Input 10 Fault	Warning	PCC3300, PCC2300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40415	14	Fault Status Bitmap 16	2893	Aux102 1 Expansion Input 11 Fault	Warning	PCC3300, PCC2300, PCC3300V2
40415	15	Fault Status Bitmap 16	2894	Aux102 1 Expansion Input 12 Fault	Warning	PCC3300, PCC2300, PCC3300V2
40416	0	Fault Status Bitmap 17	2895	PCCnet Device Failed Warning	Warning	PCC3300, PCC2300, PCC3300V2
40416	1	Fault Status Bitmap 17	2896	PCCnet Device Failed Shutdown	Shutdown	PCC3300, PCC2300, PCC3300V2
40416	2	Fault Status Bitmap 17	2917	Genset Bus Voltage OOR Warning	Warning	PCC3300, PCC3300V2
40416	3	Fault Status Bitmap 17	2918	Utility Voltage OOR Warning	Warning	PCC3300, PCC3300V2
40416	4	Fault Status Bitmap 17	2919	Utility Current OOR Warning	Warning	PCC3300, PCC3300V2
40416	5	Fault Status Bitmap 17	2921	Genset Bus Current OOR Warning	Warning	PCC3300, PCC3300V2
40416	6	Fault Status Bitmap 17	2922	Genset Neutral Current OOR Warning	Warning	PCC3300, PCC3300V2
40416	7	Fault Status Bitmap 17	2923	Genset Bus kW OOR Warning	Warning	PCC3300, PCC3300V2
40416	8	Fault Status Bitmap 17	2924	Genset Bus kVAR OOR Warning	Warning	PCC3300, PCC3300V2
40416	9	Fault Status Bitmap 17	2925	Genset Bus kVA OOR Warning	Warning	PCC3300, PCC3300V2
40416	10	Fault Status Bitmap 17	2926	Utility kW OOR Warning	Warning	PCC3300, PCC3300V2
40416	11	Fault Status Bitmap 17	2927	Utility kVAR OOR Warning	Warning	PCC3300, PCC3300V2
40416	12	Fault Status Bitmap 17	2928	Utility kVA OOR Warning	Warning	PCC3300, PCC3300V2
40416	13	Fault Status Bitmap 17	3599	Ground Current OOR Warning	Warning	PCC3300, PCC3300V2
40416	14	Fault Status Bitmap 17	2931	AUX101 Device ID Fault	Shutdown	PCC3300, PCC2300, PCC3300V2
40416	15	Fault Status Bitmap 17	2779	Utility Unloaded Event	NONE	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40417	0	Fault Status Bitmap 18	4358	Setup Mode Shutdown	Shutdown	PCC3300, PCC2300, PCC3300V2
40417	3	Fault Status Bitmap 18	2932	AUX101 Oil Temp OOR Hi	Warning	PCC3300, PCC2300, PCC3300V2
40417	4	Fault Status Bitmap 18	2933	AUX101 Oil Temp OOR Low	Warning	PCC3300, PCC2300, PCC3300V2
40417	5	Fault Status Bitmap 18	2657	Exhaust Stack Temp Left Bank Above Threshold	Warning	PCC3300, PCC2300, PCC3300V2
40417	6	Fault Status Bitmap 18	2947	Exhaust Stack Temp 1 OOR Low	Warning	PCC3300, PCC2300, PCC3300V2
40417	7	Fault Status Bitmap 18	2949	High Exhaust Stack Temperature 1	Warning	PCC3300, PCC2300, PCC3300V2
40417	8	Fault Status Bitmap 18	2653	Exhaust Stack Temp Right Bank Above Threshold	Warning	PCC3300, PCC2300, PCC3300V2
40417	9	Fault Status Bitmap 18	2946	Exhaust Stack Temp 2 OOR Low	Warning	PCC3300, PCC2300, PCC3300V2
40417	10	Fault Status Bitmap 18	2948	High Exhaust Stack Temperature 2	Warning	PCC3300, PCC2300, PCC3300V2
40417	11	Fault Status Bitmap 18	2934	Ambient Temp OOR High	Warning	PCC3300, PCC2300, PCC3300V2
40417	12	Fault Status Bitmap 18	2935	Ambient Temp OOR Low	Warning	PCC3300, PCC2300, PCC3300V2
40417	13	Fault Status Bitmap 18	2936	Fuel Level OOR High	Warning	PCC3300, PCC2300, PCC3300V2
40417	14	Fault Status Bitmap 18	2937	Fuel Level OOR Low	Warning	PCC3300, PCC2300, PCC3300V2
40417	15	Fault Status Bitmap 18	2951	Alternator Temp 1 OOR High	Warning	PCC3300, PCC2300, PCC3300V2
40418	0	Fault Status Bitmap 19	2952	Alternator Temp 1 OOR Low	Warning	PCC3300, PCC2300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40418	1	Fault Status Bitmap 19	2953	High Alternator Temp 1	Warning	PCC3300, PCC2300, PCC3300V2
40418	2	Fault Status Bitmap 19	2954	Alternator Temp 2 OOR High	Warning	PCC3300, PCC2300, PCC3300V2
40418	3	Fault Status Bitmap 19	2955	Alternator Temp 2 OOR Low	Warning	PCC3300, PCC2300, PCC3300V2
40418	4	Fault Status Bitmap 19	2956	High Alternator Temp 2	Warning	PCC3300, PCC2300, PCC3300V2
40418	5	Fault Status Bitmap 19	2957	Alternator Temp 3 OOR High	Warning	PCC3300, PCC2300, PCC3300V2
40418	6	Fault Status Bitmap 19	2958	Alternator Temp 3 OOR Low	Warning	PCC3300, PCC2300, PCC3300V2
40418	7	Fault Status Bitmap 19	2959	High Alternator Temp 3	Warning	PCC3300, PCC2300, PCC3300V2
40418	8	Fault Status Bitmap 19	2992	Intake Manifold Temp 1 OOR High	Warning	PCC3300, PCC2300, PCC3300V2
40418	9	Fault Status Bitmap 19	2978	Intake Manifold Temp 1 OOR Low	Warning	PCC3300, PCC2300, PCC3300V2
40418	10	Fault Status Bitmap 19	2981	Drive End Bearing Temp OOR High	Warning	PCC3300, PCC2300, PCC3300V2
40418	11	Fault Status Bitmap 19	2982	Drive End Bearing Temp OOR Low	Warning	PCC3300, PCC2300, PCC3300V2
40418	12	Fault Status Bitmap 19	2983	High Drive End Bearing Temperature	Warning	PCC3300, PCC2300, PCC3300V2
40418	13	Fault Status Bitmap 19	2984	Non-Drive End Bearing Temp OOR High	Warning	PCC3300, PCC2300, PCC3300V2
40418	14	Fault Status Bitmap 19	2985	Non-Drive End Bearing Temp OOR Low	Warning	PCC3300, PCC2300, PCC3300V2
40418	15	Fault Status Bitmap 19	2986	High Non-Drive End Bearing Temperature	Warning	PCC3300, PCC2300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40419	0	Fault Status Bitmap 20	2945	Rupture Basin	Warning	PCC3300, PCC2300, PCC3300V2
40419	1	Fault Status Bitmap 20	2979	High Alternator Temp Switch fault	Warning	PCC3300, PCC2300, PCC3300V2
40419	2	Fault Status Bitmap 20	2993	Battery Charger Failed Fault	Warning	PCC3300, PCC2300, PCC3300V2
40419	3	Fault Status Bitmap 20	2938	Earth/Ground Fault	Warning	PCC3300, PCC2300, PCC3300V2
40419	4	Fault Status Bitmap 20	2939	Modbus Failure Fault	Warning	PCC3300, PCC2300, PCC3300V2
40419	5	Fault Status Bitmap 20	2977	Low Coolant Level #2	Warning	PCC3300, PCC2300, PCC3300V2
40419	6	Fault Status Bitmap 20	1978	Speed Bias OOR High	Warning	PCC3300, PCC2300, PCC3300V2
40419	7	Fault Status Bitmap 20	2541	Voltage Bias OOR Low	Warning	PCC3300, PCC2300, PCC3300V2
40419	8	Fault Status Bitmap 20	2539	Voltage Bias OOR High	Warning	PCC3300, PCC2300, PCC3300V2
40419	9	Fault Status Bitmap 20	1573	Configurable Input #1	NONE	PCC3300, PCC2300, PCC3300V2
40419	10	Fault Status Bitmap 20	1312	Configurable Input #2	NONE	PCC3300, PCC2300, PCC3300V2
40419	11	Fault Status Bitmap 20	1317	Configurable Input #13	NONE	PCC3300, PCC2300, PCC3300V2
40419	12	Fault Status Bitmap 20	1318	Configurable Input #14	NONE	PCC3300, PCC2300, PCC3300V2
40419	13	Fault Status Bitmap 20	1979	Speed Bias OOR Low	Warning	PCC3300, PCC2300, PCC3300V2
40419	14	Fault Status Bitmap 20	236	Both Engine Speed Signals Lost: Most Severe Level	Shutdown	PCC3300, PCC2300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40419	15	Fault Status Bitmap 20	3629	Device Calibration Update Recommended	Warning	PCC3300, PCC3300V2
40420	0	Fault Status Bitmap 21	1312	Customer Input Fault	Shutdown	PS0500
40420	0	Fault Status Bitmap 21	3631	Device Calibration Update Required	Shutdown	PCC3300, PCC2300, PCC3300V2
40420	1	Fault Status Bitmap 21	428	Water In Fuel Indicator Sensor: Volt Above Normal	Warning	PCC3300, PCC2300, PCC3300V2
40420	2	Fault Status Bitmap 21	429	Water In Fuel Indicator Sensor: Volt Below Normal	Warning	PCC3300, PCC2300, PCC3300V2
40420	3	Fault Status Bitmap 21	515	Sensor Supply 6 Circuit OORH	Warning	PCC3300, PCC2300, PCC3300V2
40420	4	Fault Status Bitmap 21	516	Sensor Supply 6 Circuit OORL	Warning	PCC3300, PCC2300, PCC3300V2
40420	5	Fault Status Bitmap 21	555	Crankcase Pressure High: Above Normal	Warning	PCC3300, PCC2300, PCC3300V2
40420	6	Fault Status Bitmap 21	691	Turbocharger 1 Comp Intake Temp: Volt Above Normal	Warning	PCC3300, PCC2300, PCC3300V2
40420	7	Fault Status Bitmap 21	692	Turbocharger 1 Comp Intake Temp: Volt Below Normal	Warning	PCC3300, PCC2300, PCC3300V2
40420	8	Fault Status Bitmap 21	1664	Exh Aft Oxidation Catalyst Missing	Warning	PCC3300, PCC2300, PCC3300V2
40420	9	Fault Status Bitmap 21	1691	Aft Oxidation Catalyst Efficiency: Below Normal	Warning	PCC3300, PCC2300, PCC3300V2
40420	10	Fault Status Bitmap 21	1879	Aft Particulate Filter Pressure OORH	Warning	PCC3300, PCC2300, PCC3300V2
40420	11	Fault Status Bitmap 21	1881	Aft Particulate Filter Pressure OORL	Warning	PCC3300, PCC2300, PCC3300V2
40420	12	Fault Status Bitmap 21	1883	Aft Particulate Filter Pressure: Incorrect	Warning	PCC3300, PCC2300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40420	13	Fault Status Bitmap 21	1898	VGT Actuator Controller Out of Calibration	Warning	PCC3300, PCC2300, PCC3300V2
40420	14	Fault Status Bitmap 21	1911	Inj 1 Rail Pressure: Above Normal Severe Level	Warning	PCC3300, PCC2300, PCC3300V2
40420	15	Fault Status Bitmap 21	1921	Aftertreatment DPF Differential Pressure	Warning	PCC3300, PCC2300, PCC3300V2
40421	0	Fault Status Bitmap 22	1922	Aftertreatment DPF Differential Pressure Severe	Shutdown	PCC3300, PCC2300, PCC3300V2
40421	1	Fault Status Bitmap 22	1938	ECU Power Output Volt: Below Normal	Warning	PCC3300, PCC2300, PCC3300V2
40421	2	Fault Status Bitmap 22	1962	VGT Actuator Driver Temperature: Above Normal	Warning	PCC3300, PCC2300, PCC3300V2
40421	3	Fault Status Bitmap 22	1993	Aft Particulate Filter Missing	Warning	PCC3300, PCC2300, PCC3300V2
40421	4	Fault Status Bitmap 22	2198	VGT Actuator Driver Circuit: Unknown Cause	Warning	PCC3300, PCC2300, PCC3300V2
40421	5	Fault Status Bitmap 22	2288	Turbo Charger 1 Speed: Above Normal	NONE	PCC3300, PCC2300, PCC3300V2
40421	7	Fault Status Bitmap 22	2353	EGR Valve Control Circuit: Current OORH	Warning	PCC3300, PCC2300, PCC3300V2
40421	8	Fault Status Bitmap 22	2372	Fuel Filter Pressure: Above Normal	Warning	PCC3300, PCC2300, PCC3300V2
40421	9	Fault Status Bitmap 22	2373	Exhaust Pressure: OORH	Warning	PCC3300, PCC2300, PCC3300V2
40421	10	Fault Status Bitmap 22	2374	Exhaust Pressure: OORL	Warning	PCC3300, PCC2300, PCC3300V2
40421	11	Fault Status Bitmap 22	2387	VGT Actuator: Mechanical Sys Not Responding	Warning	PCC3300, PCC2300, PCC3300V2
40421	12	Fault Status Bitmap 22	2449	VGT Actuator Controller: Out of Calibration	Shutdown	PCC3300, PCC2300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40421	13	Fault Status Bitmap 22	2554	Exhaust Gar Pressure: Incorrect	Warning	PCC3300, PCC2300, PCC3300V2
40421	14	Fault Status Bitmap 22	2634	VGT Actuator Controller: Bad Device/Component	Shutdown	PCC3300, PCC2300, PCC3300V2
40421	15	Fault Status Bitmap 22	2635	VGT Actuator Driver Condition Exists	Shutdown	PCC3300, PCC2300, PCC3300V2
40422	0	Fault Status Bitmap 23	2636	VGT Actuator Circuit: Abnormal Update Rate	Shutdown	PCC3300, PCC2300, PCC3300V2
40422	1	Fault Status Bitmap 23	2637	Aft Catalyst Face Plugged: Reason Unknown	NONE	PCC3300, PCC2300, PCC3300V2
40422	2	Fault Status Bitmap 23	2639	Aftertreatment DPF Differential Press Least Severe	NONE	PCC3300, PCC2300, PCC3300V2
40422	3	Fault Status Bitmap 23	2753	Exhaust Gas Recirculation Temp: Above Normal	Shutdown	PCC3300, PCC2300, PCC3300V2
40422	4	Fault Status Bitmap 23	2754	Diesel Particulate Filter Int Press: Above Normal	Warning	PCC3300, PCC2300, PCC3300V2
40422	5	Fault Status Bitmap 23	2765	Engine Inj Bank 1 Barcode: Out Of Calibration	NONE	PCC3300, PCC2300, PCC3300V2
40422	6	Fault Status Bitmap 23	2777	Particulate Trap Regen Inhibit: Condition Exists	NONE	PCC3300, PCC2300, PCC3300V2
40422	7	Fault Status Bitmap 23	3133	Aft Particulate Filter Outlet Pressure: OORH	Warning	PCC3300, PCC2300, PCC3300V2
40422	8	Fault Status Bitmap 23	3134	Aft Particulate Filter Outlet Pressure: OORL	Warning	PCC3300, PCC2300, PCC3300V2
40422	9	Fault Status Bitmap 23	3135	Aft Particulate Filter Pressure: Data Erratic	Warning	PCC3300, PCC2300, PCC3300V2
40422	10	Fault Status Bitmap 23	3245	Aft Particulate Filter System: Not Responding	Warning	PCC3300, PCC2300, PCC3300V2
40422	11	Fault Status Bitmap 23	3251	Aft Catalyst Intake Temp:Data Valid:Above Normal	Shutdown	PCC3300, PCC2300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40422	12	Fault Status Bitmap 23	3253	Particulate Filter Int Temp: Above Normal Mod Sev	Shutdown	PCC3300, PCC2300, PCC3300V2
40422	13	Fault Status Bitmap 23	3254	Particulate Filter Int Temp: Above Normal	Warning	PCC3300, PCC2300, PCC3300V2
40422	14	Fault Status Bitmap 23	3255	Particulate Filter Out Temp: Above Normal Mod Sev	Shutdown	PCC3300, PCC2300, PCC3300V2
40422	15	Fault Status Bitmap 23	3256	Particulate Filter Outlet Temp: Above Normal	Warning	PCC3300, PCC2300, PCC3300V2
40423	0	Fault Status Bitmap 24	3311	Particulate Filter Int Temp: Above Normal Severe	Shutdown	PCC3300, PCC2300, PCC3300V2
40423	1	Fault Status Bitmap 24	3312	Particulate Filter Out Temp: Above Normal Severe	Shutdown	PCC3300, PCC2300, PCC3300V2
40423	2	Fault Status Bitmap 24	3313	Aft Catalyst Intake Temperature: Below Normal	Warning	PCC3300, PCC2300, PCC3300V2
40423	3	Fault Status Bitmap 24	3314	Aft Catalyst Intake Temperature: Above Normal	Warning	PCC3300, PCC2300, PCC3300V2
40423	4	Fault Status Bitmap 24	3315	Aft Catalyst Intake Temperature: Incorrect	Warning	PCC3300, PCC2300, PCC3300V2
40423	5	Fault Status Bitmap 24	3316	Aft Particulate Filter Intake Temperature: OORL	Warning	PCC3300, PCC2300, PCC3300V2
40423	6	Fault Status Bitmap 24	3317	Aft Particulate Filter Intake Temperature: OORH	Warning	PCC3300, PCC2300, PCC3300V2
40423	7	Fault Status Bitmap 24	3318	Aft Particulate Filter Intake Temp: Data Incorrect	Warning	PCC3300, PCC2300, PCC3300V2
40423	8	Fault Status Bitmap 24	3319	Aft Particulate Filter Outlet Temp Circuit: OORH	Warning	PCC3300, PCC2300, PCC3300V2
40423	9	Fault Status Bitmap 24	3321	Aft Particulate Filter Outlet Temp Circuit: OORL	Warning	PCC3300, PCC2300, PCC3300V2
40423	10	Fault Status Bitmap 24	3322	Aft Particulate Filter Outlet Temp: Data Incorrect	Warning	PCC3300, PCC2300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40423	11	Fault Status Bitmap 24	3325	Aft Catalyst Intake Temp Swapped: Out Of Cal	Warning	PCC3300, PCC2300, PCC3300V2
40423	12	Fault Status Bitmap 24	3694	Gain Adjust Potentiometer Circuit: OORL	Warning	PCC3300, PCC2300, PCC3300V2
40423	13	Fault Status Bitmap 24	3695	Frequency Adjust Potentiometer Circuit: OORL	Warning	PCC3300, PCC2300, PCC3300V2
40423	14	Fault Status Bitmap 24	3696	Droop Adjust Potentiometer Circuit: OORL	Warning	PCC3300, PCC2300, PCC3300V2
40423	15	Fault Status Bitmap 24	3697	RAM Refresh Error	Shutdown	PCC3300, PCC2300, PCC3300V2
40424	0	Fault Status Bitmap 25	3724	Battery 1 Voltage: Below Normal	Warning	PCC3300, PCC2300, PCC3300V2
40424	1	Fault Status Bitmap 25	3727	Common Rail Fuel Press Relief Valve: Not Resp	NONE	PCC3300, PCC2300, PCC3300V2
40424	2	Fault Status Bitmap 25	3741	Common Rail Fuel Pressure: Above Normal	Warning	PCC3300, PCC2300, PCC3300V2
40424	3	Fault Status Bitmap 25	3931	Engine Protection System Approaching Shutdown	Shutdown	PCC3300, PCC2300, PCC3300V2
40424	4	Fault Status Bitmap 25	4135	Inducement Approaching: Performance is Active	Warning	PCC3300, PCC2300, PCC3300V2
40424	5	Fault Status Bitmap 25	4883	Prelube Cycle failed	Warning	PCC3300, PCC3300V2
40424	6	Fault Status Bitmap 25	4884	Prelube Pump Stuck ON	Warning	PCC3300, PCC3300V2
40424	7	Fault Status Bitmap 25	4946	Engine Crank Without Prelube Condition Exists	NONE	PCC3300, PCC3300V2
40424	8	Fault Status Bitmap 25	5149	Prelube Cycle failed during Non-Emergency start	Shutdown	PCC3300, PCC3300V2
40424	9	Fault Status Bitmap 25	5135	Genset Overload	Shutdown	PCC3300, PCC2300, PCC3300V2
40424	10	Fault Status Bitmap 25	5151	Intake air restriction indicator 1 active	Warning	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40424	11	Fault Status Bitmap 25	5152	Intake air restriction indicator 2 active	Warning	PCC3300, PCC3300V2
40424	12	Fault Status Bitmap 25	5153	Intake air restriction indicator 3 active	Warning	PCC3300, PCC3300V2
40424	13	Fault Status Bitmap 25	5154	Intake air restriction indicator 4 active	Warning	PCC3300, PCC3300V2
40424	14	Fault Status Bitmap 25	5164	Battery Charger 2 Failed Fault	Warning	PCC3300, PCC3300V2
40424	15	Fault Status Bitmap 25	5165	Battery Charger 3 Failed Fault	Warning	PCC3300, PCC3300V2
40425	0	Event Status Bitmap 2	637	Exh Gas Temp Cyl 14 Deviation Low: Below Normal	NONE	PCC3300, PCC2300, PCC3300V2
40425	1	Event Status Bitmap 2	638	Exh Gas Temp Cyl 16 Deviation Low: Below Normal	NONE	PCC3300, PCC2300, PCC3300V2
40425	2	Event Status Bitmap 2	649	Engine Oil Change Needed	NONE	PCC3300, PCC2300, PCC3300V2
40425	3	Event Status Bitmap 2	1367	Pre Oil Filter Pressure OORH	NONE	PCC3300, PCC2300, PCC3300V2
40425	4	Event Status Bitmap 2	1368	Pre Oil Filter Pressure OORL	NONE	PCC3300, PCC2300, PCC3300V2
40425	5	Event Status Bitmap 2	1369	Aux Temp 1 Sensor OORH	NONE	PCC3300, PCC2300, PCC3300V2
40425	6	Event Status Bitmap 2	1373	Start Enable Device 1: Cause Unknown	NONE	PCC3300, PCC2300, PCC3300V2
40425	7	Event Status Bitmap 2	1377	Post Oil Filter Pressure OORH	NONE	PCC3300, PCC2300, PCC3300V2
40425	8	Event Status Bitmap 2	1378	Post Oil Filter Pressure OORL	NONE	PCC3300, PCC2300, PCC3300V2
40425	9	Event Status Bitmap 2	1383	Intake Manifold 1 Pressure OORH	NONE	PCC3300, PCC2300, PCC3300V2
40425	10	Event Status Bitmap 2	1384	Intake Manifold 1 Pressure OORL	NONE	PCC3300, PCC2300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40425	11	Event Status Bitmap 2	1385	Intake Manifold 2 Pressure OORH	NONE	PCC3300, PCC2300, PCC3300V2
40425	12	Event Status Bitmap 2	1386	Intake Manifold 2 Pressure OORL	NONE	PCC3300, PCC2300, PCC3300V2
40425	13	Event Status Bitmap 2	1596	Aux Temp 1 Sensor OORL	NONE	PCC3300, PCC2300, PCC3300V2
40425	14	Event Status Bitmap 2	1597	ECM Critical Internal Failure: Bad Device	NONE	PCC3300, PCC2300, PCC3300V2
40425	15	Event Status Bitmap 2	2651	Exhaust Gas Temperature Right Manifold: OORH	NONE	PCC3300, PCC2300, PCC3300V2
40426	0	Event Status Bitmap 3	2652	Exhaust Gas Temperature Right Manifold: OORL	NONE	PCC3300, PCC2300, PCC3300V2
40426	1	Event Status Bitmap 3	2655	Exhaust Gas Temperature Left Manifold: OORH	NONE	PCC3300, PCC2300, PCC3300V2
40426	2	Event Status Bitmap 3	2656	Exhaust Gas Temperature Left Manifold: OORL	NONE	PCC3300, PCC2300, PCC3300V2
40426	3	Event Status Bitmap 3	2346	CBR_TFC_DERATE_ERR OR_ID	NONE	PCC3300, PCC2300, PCC3300V2
40426	4	Event Status Bitmap 3	5631	SCR Sys Cleaning Inhibited due to System Timeout	NONE	PCC3300, PCC3300V2
40426	5	Event Status Bitmap 3	5632	SCR Sys Cleaning Inhibited due to Inhibit Switch	NONE	PCC3300, PCC3300V2
40426	10	Event Status Bitmap 3	3753	Diesel Particulate Filter Active Regen Inhibited	NONE	PCC3300, PCC3300V2
40426	12	Event Status Bitmap 3	4842	Aftertreatment Diesel Exhaust Fluid Quality High	NONE	PCC3300, PCC3300V2
40427	0	Fault Status Bitmap 26	5166	Battery Charger 4 Failed Fault	Warning	PCC3300, PCC3300V2
40427	1	Fault Status Bitmap 26	4872	System Network Failure	Warning	PCC3300, PCC3300V2
40427	2	Fault Status Bitmap 26	4873	Genset Failed to Come Online	Warning	PCC3300, PCC3300V2
40427	3	Fault Status Bitmap 26	4874	Load Demand Version Incompatibility	Warning	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40427	4	Fault Status Bitmap 26	4875	Genset Ineligible For Load Demand	NONE	PCC3300, PCC3300V2
40427	5	Fault Status Bitmap 26	4876	Genset Lost On System Network	Warning	PCC3300, PCC3300V2
40427	6	Fault Status Bitmap 26	4877	System Settings Not Synchronized	Warning	PCC3300, PCC3300V2
40427	7	Fault Status Bitmap 26	4878	Check System Network Installation	Warning	PCC3300, PCC3300V2
40427	8	Fault Status Bitmap 26	4879	Load Demand Setup Error	Warning	PCC3300, PCC3300V2
40427	9	Fault Status Bitmap 26	4881	System Genset ID Conflict	Warning	PCC3300, PCC3300V2
40427	10	Fault Status Bitmap 26	4882	Genset Bus Overload	Warning	PCC3300, PCC3300V2
40427	11	Fault Status Bitmap 26	5145	Load Demand Genset Bus Failure	Warning	PCC3300, PCC3300V2
40427	12	Fault Status Bitmap 26	2658	Exhaust Stack Temp Left Bank Above Sh Threshold	Shutdown	PCC3300, PCC2300, PCC3300V2
40427	13	Fault Status Bitmap 26	556	Crankcase Pressure:Above Normal-Most Severe	Shutdown	PCC3300, PCC2300, PCC3300V2
40427	14	Fault Status Bitmap 26	2619	Auxiliary Input 1 Active-Condition Exists	Warning	PCC3300, PCC2300, PCC3300V2
40427	15	Fault Status Bitmap 26	2654	Exhaust Stack Temp Right Bank Above Sh Threshold	Shutdown	PCC3300, PCC2300, PCC3300V2
40428	0	Fault Status Bitmap 32	5399	AmpSentry Maintenance Mode Active	NONE	PCC3300, PCC2300, PCC3300V2
40428	1	Fault Status Bitmap 32	5492	OTIS Read Failed – Unknown Reason	Warning	PCC3300, PCC3300V2
40428	2	Fault Status Bitmap 32	5489	ECM Write Failed – Multiple Tools connected to ECM	Warning	PCC3300, PCC3300V2
40428	3	Fault Status Bitmap 32	5491	ECM Write Failed – Unknown Reason	Warning	PCC3300, PCC3300V2
40428	4	Fault Status Bitmap 32	5493	ECM Write Failed – Data Save Failure	Warning	PCC3300, PCC3300V2
40428	5	Fault Status Bitmap 32	5529	Prelube Setup Fault - Condition Exists	Warning	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40428	6	Fault Status Bitmap 32	2557	Auxiliary PWM Driver 1 Circuit OOR High	Warning	PCC3300, PCC3300V2
40428	8	Fault Status Bitmap 32	743	Turbocharger 1 Compressor Intake Pressure Error	Warning	PCC3300, PCC3300V2
40428	9	Fault Status Bitmap 32	755	Injector Metering Rail 1 Pressure System Error	Warning	PCC3300, PCC3300V2
40428	10	Fault Status Bitmap 32	1139	UFD_INJECTOR_1_ERROR	Warning	PCC3300, PCC2300, PCC3300V2
40428	11	Fault Status Bitmap 32	1141	UFD_INJECTOR_2_ERROR	Warning	PCC3300, PCC2300, PCC3300V2
40428	12	Fault Status Bitmap 32	1142	UFD_INJECTOR_3_ERROR	Warning	PCC3300, PCC2300, PCC3300V2
40428	13	Fault Status Bitmap 32	1143	UFD_INJECTOR_4_ERROR	Warning	PCC3300, PCC2300, PCC3300V2
40428	14	Fault Status Bitmap 32	1144	UFD_INJECTOR_5_ERROR	Warning	PCC3300, PCC2300, PCC3300V2
40428	15	Fault Status Bitmap 32	1145	UFD_INJECTOR_6_ERROR	Warning	PCC3300, PCC2300, PCC3300V2
40430	0	Event Status Bitmap 1	1463	Not in Auto	NONE	PS0500
40430	1	Event Status Bitmap 1	1468	Ready To Load	NONE	PS0500
40430	2	Event Status Bitmap 1	1483	Common Alarm	NONE	PS0500
40430	3	Event Status Bitmap 1	5671	Cold Start Advance - Condition Exists	NONE	PS0500
40430	0	Event Status Bitmap 1	1540	Common Warning	NONE	PCC3300, PCC2300, PCC3300V2
40430	1	Event Status Bitmap 1	1541	Common Shutdown	NONE	PCC3300, PCC2300, PCC3300V2
40430	2	Event Status Bitmap 1	621	Exh Gas Temp Cyl 1 Deviation Low: Below Normal	NONE	PCC3300, PCC2300, PCC3300V2
40430	3	Event Status Bitmap 1	622	Exh Gas Temp Cyl 3 Deviation Low: Below Normal	NONE	PCC3300, PCC2300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40430	4	Event Status Bitmap 1	623	Exh Gas Temp Cyl 5 Deviation Low: Below Normal	NONE	PCC3300, PCC2300, PCC3300V2
40430	5	Event Status Bitmap 1	624	Exh Gas Temp Cyl 7 Deviation Low: Below Normal	NONE	PCC3300, PCC2300, PCC3300V2
40430	6	Event Status Bitmap 1	625	Exh Gas Temp Cyl 9 Deviation Low: Below Normal	NONE	PCC3300, PCC2300, PCC3300V2
40430	7	Event Status Bitmap 1	626	Exh Gas Temp Cyl 11 Deviation Low: Below Normal	NONE	PCC3300, PCC2300, PCC3300V2
40430	8	Event Status Bitmap 1	627	Exh Gas Temp Cyl 13 Deviation Low: Below Normal	NONE	PCC3300, PCC2300, PCC3300V2
40430	9	Event Status Bitmap 1	628	Exh Gas Temp Cyl 15 Deviation Low: Below Normal	NONE	PCC3300, PCC2300, PCC3300V2
40430	10	Event Status Bitmap 1	631	Exh Gas Temp Cyl 2 Deviation Low: Below Normal	NONE	PCC3300, PCC2300, PCC3300V2
40430	11	Event Status Bitmap 1	632	Exh Gas Temp Cyl 4 Deviation Low: Below Normal	NONE	PCC3300, PCC2300, PCC3300V2
40430	12	Event Status Bitmap 1	633	Exh Gas Temp Cyl 6 Deviation Low: Below Normal	NONE	PCC3300, PCC2300, PCC3300V2
40430	13	Event Status Bitmap 1	634	Exh Gas Temp Cyl 8 Deviation Low: Below Normal	NONE	PCC3300, PCC2300, PCC3300V2
40430	14	Event Status Bitmap 1	635	Exh Gas Temp Cyl 10 Deviation Low: Below Normal	NONE	PCC3300, PCC2300, PCC3300V2
40430	15	Event Status Bitmap 1	636	Exh Gas Temp Cyl 12 Deviation Low: Below Normal	NONE	PCC3300, PCC2300, PCC3300V2

TABLE 67.

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40431	0	Fault Status Gas Bitmap 1	121	EPS Main Channel Lost Error	Warning	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40431	1	Fault Status Gas Bitmap 1	136	Oil Inlet Pressure High Error	Warning	PCC3300, PCC3300V2
40431	2	Fault Status Gas Bitmap 1	137	Oil Inlet Pressure Low Error	Warning	PCC3300, PCC3300V2
40431	3	Fault Status Gas Bitmap 1	142	Oil Overpressure Error	Warning	PCC3300, PCC3300V2
40431	4	Fault Status Gas Bitmap 1	156	Intake Manifold Temp 2 OORH	Warning	PCC3300, PCC3300V2
40431	5	Fault Status Gas Bitmap 1	157	Intake Manifold Temp 2 OORL	Warning	PCC3300, PCC3300V2
40431	6	Fault Status Gas Bitmap 1	158	Intake Manifold Temp 2 High	Shutdown	PCC3300, PCC3300V2
40431	7	Fault Status Gas Bitmap 1	159	Intake Manifold 3 Temp OORH	Warning	PCC3300, PCC3300V2
40431	8	Fault Status Gas Bitmap 1	161	Intake Manifold 3 Temp OORL	Warning	PCC3300, PCC3300V2
40431	9	Fault Status Gas Bitmap 1	162	Intake Manifold 3 Temp High	Shutdown	PCC3300, PCC3300V2
40431	10	Fault Status Gas Bitmap 1	163	Intake Manifold 4 Temp OORH	Warning	PCC3300, PCC3300V2
40431	11	Fault Status Gas Bitmap 1	164	Intake Manifold 4 Temp OORL	Warning	PCC3300, PCC3300V2
40431	12	Fault Status Gas Bitmap 1	165	Intake Manifold 4 Temp High	Shutdown	PCC3300, PCC3300V2
40431	13	Fault Status Gas Bitmap 1	175	Throttle_Driver_Feedback_High_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40431	14	Fault Status Gas Bitmap 1	176	Throttle_Driver_Feedback_Low_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40431	15	Fault Status Gas Bitmap 1	177	Throttle_Actuator_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40432	0	Fault Status Gas Bitmap 2	2118	Low Fuel Pressure	Warning	PCC3300, PCC2300, PCC3300V2
40432	1	Fault Status Gas Bitmap 2	5365	Fuel System on Secondary Source - Condition Exists	Warning	PCC3300, PCC2300, PCC3300V2
40432	2	Fault Status Gas Bitmap 2	244	Red Stop Lamp Driver OORL	Warning	PCC3300, PCC3300V2
40432	3	Fault Status Gas Bitmap 2	246	Exhaust Gas Temp Sensor 1 OORH	Warning	PCC3300, PCC3300V2
40432	4	Fault Status Gas Bitmap 2	247	Exhaust Gas Temp Sensor 1 OORL	Warning	PCC3300, PCC3300V2
40432	5	Fault Status Gas Bitmap 2	248	Exhaust Gas Temp Sensor 1 High	Warning	PCC3300, PCC3300V2
40432	6	Fault Status Gas Bitmap 2	253	Oil Level Low Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40432	8	Fault Status Gas Bitmap 2	277	Fuel Control Valve Out of Adj	Warning	PCC3300, PCC3300V2
40432	9	Fault Status Gas Bitmap 2	346	Powerdown Data Lost Error	Warning	PCC3300, PCC3300V2
40432	10	Fault Status Gas Bitmap 2	354	Manifold_Absolute_Pressur e_1_High_Error	Warning	PCC3300, PCC3300V2
40432	11	Fault Status Gas Bitmap 2	355	Manifold_Absolute_Pressur e_1_Low_Error	Warning	PCC3300, PCC3300V2
40432	12	Fault Status Gas Bitmap 2	412	J1708 Link Cannot Transmit Error	NONE	PCC3300, PCC3300V2
40432	13	Fault Status Gas Bitmap 2	414	J1708 Link Not Fast Enough Error	NONE	PCC3300, PCC3300V2
40432	14	Fault Status Gas Bitmap 2	453	Gas_Mass_Flow_High_Error	Warning	PCC3300, PCC3300V2
40432	15	Fault Status Gas Bitmap 2	454	Gas_Mass_Flow_Low_Error	Warning	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40433	0	Fault Status Gas Bitmap 3	458	Spark_Timing_B_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40433	1	Fault Status Gas Bitmap 3	459	Spark_Timing_A_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40433	2	Fault Status Gas Bitmap 3	461	Spark_Reference_B_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40433	3	Fault Status Gas Bitmap 3	462	Spark_Reference_A_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40433	4	Fault Status Gas Bitmap 3	477	Isolated Battery Voltage Low Error	Warning	PCC3300, PCC3300V2
40433	5	Fault Status Gas Bitmap 3	478	Isolated Battery Voltage High Error	Warning	PCC3300, PCC3300V2
40433	6	Fault Status Gas Bitmap 3	512	Throttle Pos 1 Feedback OOR High	Warning	PCC3300, PCC3300V2
40433	7	Fault Status Gas Bitmap 3	513	Throttle Pos 1 Feedback OOR Low	Warning	PCC3300, PCC3300V2
40433	8	Fault Status Gas Bitmap 3	557	Fuel Control Valve 2 OORH	Shutdown w/Cooldown	PCC3300, PCC3300V2
40433	9	Fault Status Gas Bitmap 3	558	Fuel Control Valve 2 OORL	Warning	PCC3300, PCC3300V2
40433	10	Fault Status Gas Bitmap 3	561	Heavy_Knock_Error_1_(A1)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40433	11	Fault Status Gas Bitmap 3	562	Heavy_Knock_Error_2_(B1)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40433	12	Fault Status Gas Bitmap 3	563	Heavy_Knock_Error_3_(A2)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40433	13	Fault Status Gas Bitmap 3	564	Heavy_Knock_Error_4_(B2)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40433	14	Fault Status Gas Bitmap 3	565	Heavy_Knock_Error_5_(A3)	Shutdown w/Cooldown	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40433	15	Fault Status Gas Bitmap 3	566	Heavy_Knock_Error_6_(B3)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40434	0	Fault Status Gas Bitmap 4	567	Heavy_Knock_Error_7_(A4)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40434	1	Fault Status Gas Bitmap 4	568	Heavy_Knock_Error_8_(B4)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40434	2	Fault Status Gas Bitmap 4	569	Heavy_Knock_Error_9_(A5)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40434	3	Fault Status Gas Bitmap 4	571	Knock Cyl 1 (A1) OORL	Warning	PCC3300, PCC3300V2
40434	4	Fault Status Gas Bitmap 4	572	Knock Cyl 2 (B1) OORL	Warning	PCC3300, PCC3300V2
40434	5	Fault Status Gas Bitmap 4	573	Knock Cyl 3 (A2) OORL	Warning	PCC3300, PCC3300V2
40434	6	Fault Status Gas Bitmap 4	574	Knock Cyl 4 (B2) OORL	Warning	PCC3300, PCC3300V2
40434	7	Fault Status Gas Bitmap 4	575	Knock Cyl 5 (A3) OORL	Warning	PCC3300, PCC3300V2
40434	8	Fault Status Gas Bitmap 4	576	Knock Cyl 6 (B3) OORL	Warning	PCC3300, PCC3300V2
40434	9	Fault Status Gas Bitmap 4	577	Knock Cyl 7 (A4) OORL	Warning	PCC3300, PCC3300V2
40434	10	Fault Status Gas Bitmap 4	578	Knock Cyl 8 (B4) OORL	Warning	PCC3300, PCC3300V2
40434	11	Fault Status Gas Bitmap 4	579	Knock Cyl 9 (A5) OORL	Warning	PCC3300, PCC3300V2
40434	12	Fault Status Gas Bitmap 4	584	High Side DRV3 High Control Error	Warning	PCC3300, PCC3300V2
40434	13	Fault Status Gas Bitmap 4	585	High Side DRV3 Low Control Error	Warning	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40434	14	Fault Status Gas Bitmap 4	591	Exhaust_Backpressure_High_Error	Warning	PCC3300, PCC3300V2
40434	15	Fault Status Gas Bitmap 4	592	Exhaust_Backpressure_Low_Error	Warning	PCC3300, PCC3300V2
40435	0	Fault Status Gas Bitmap 5	595	Turbo 1 Overspeed Warning Error	Warning	PCC3300, PCC3300V2
40435	1	Fault Status Gas Bitmap 5	618	Turbo 1 Inlet Pressure High	Warning	PCC3300, PCC3300V2
40435	2	Fault Status Gas Bitmap 5	619	Turbo 2 Inlet Press High	Warning	PCC3300, PCC3300V2
40435	3	Fault Status Gas Bitmap 5	641	Exhaust Temp 1 (A1) High Serious Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40435	4	Fault Status Gas Bitmap 5	642	Exhaust Temp 3 (A2) High Serious Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40435	5	Fault Status Gas Bitmap 5	643	Exhaust Temp 5 (A3) High Serious Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40435	6	Fault Status Gas Bitmap 5	644	Exhaust Temp 7 (A4) High Serious Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40435	7	Fault Status Gas Bitmap 5	645	Exhaust Temp 9 (A5) High Serious Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40435	8	Fault Status Gas Bitmap 5	646	Exhaust Temp 11 (A6) High Serious Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40435	9	Fault Status Gas Bitmap 5	647	Exhaust Temp 13 (A7) High Serious Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40435	10	Fault Status Gas Bitmap 5	648	Exhaust Temp 15 (A8) High Serious Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40435	11	Fault Status Gas Bitmap 5	651	Exhaust Temp 17 (A9) High Serious Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40435	12	Fault Status Gas Bitmap 5	652	Exhaust Temp 2 (B1) High Serious Error	Shutdown w/Cooldown	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40435	13	Fault Status Gas Bitmap 5	653	Exhaust Temp 4 (B2) High Serious Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40435	14	Fault Status Gas Bitmap 5	654	Exhaust Temp 6 (B3) High Serious Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40435	15	Fault Status Gas Bitmap 5	655	Exhaust Temp 8 (B4) High Serious Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40436	0	Fault Status Gas Bitmap 6	656	Exhaust Temp 10 (B5) High Serious Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40436	1	Fault Status Gas Bitmap 6	657	Exhaust Temp 12 (B6) High Serious Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40436	2	Fault Status Gas Bitmap 6	658	Exhaust Temp 14 (B7) High Serious Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40436	3	Fault Status Gas Bitmap 6	671	Exhaust Gas Temp Cyl 1 (A1) OORL	Warning	PCC3300, PCC3300V2
40436	4	Fault Status Gas Bitmap 6	672	Exhaust Gas Temp Cyl 3 (A2) OORL	Warning	PCC3300, PCC3300V2
40436	5	Fault Status Gas Bitmap 6	673	Exhaust Gas Temp Cyl 5 (A3) OORL	Warning	PCC3300, PCC3300V2
40436	6	Fault Status Gas Bitmap 6	674	Exhaust Gas Temp Cyl 7 (A4) OORL	Warning	PCC3300, PCC3300V2
40436	7	Fault Status Gas Bitmap 6	675	Exhaust Gas Temp Cyl 9 (A5) OORL	Warning	PCC3300, PCC3300V2
40436	8	Fault Status Gas Bitmap 6	676	Exhaust Gas Temp Cyl 11 (A6) OORL	Warning	PCC3300, PCC3300V2
40436	9	Fault Status Gas Bitmap 6	677	Exhaust Gas Temp Cyl 13 (A7) OORL	Warning	PCC3300, PCC3300V2
40436	10	Fault Status Gas Bitmap 6	678	Exhaust Gas Temp Cyl 15 (A8) OORL	Warning	PCC3300, PCC3300V2
40436	11	Fault Status Gas Bitmap 6	683	Turbo 2 Speed Moderate High	Warning	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40436	12	Fault Status Gas Bitmap 6	684	Turbo 2 Speed Moderate Low	Warning	PCC3300, PCC3300V2
40436	13	Fault Status Gas Bitmap 6	685	Turbo 2 Speed Incorrect	Warning	PCC3300, PCC3300V2
40436	15	Fault Status Gas Bitmap 6	687	Turbo 1 Speed Low	Warning	PCC3300, PCC3300V2
40437	2	Fault Status Gas Bitmap 7	721	Exhaust Gas Temp 2 (B1) OORL	Warning	PCC3300, PCC3300V2
40437	3	Fault Status Gas Bitmap 7	722	Exhaust Gas Temp 4 (B2) OORL	Warning	PCC3300, PCC3300V2
40437	4	Fault Status Gas Bitmap 7	723	Exhaust Gas Temp 6 (B3) OORL	Warning	PCC3300, PCC3300V2
40437	5	Fault Status Gas Bitmap 7	724	Exhaust Gas Temp 8 (B4) OORL	Warning	PCC3300, PCC3300V2
40437	6	Fault Status Gas Bitmap 7	725	Exhaust Gas Temp 10 (B5) OORL	Warning	PCC3300, PCC3300V2
40437	7	Fault Status Gas Bitmap 7	726	Exhaust Gas Temp 12 (B6) OORL	Warning	PCC3300, PCC3300V2
40437	8	Fault Status Gas Bitmap 7	727	Exhaust Gas Temp 14 (B7) OORL	Warning	PCC3300, PCC3300V2
40437	9	Fault Status Gas Bitmap 7	728	Exhaust Gas Temp 16 (B8) OORL	Warning	PCC3300, PCC3300V2
40437	10	Fault Status Gas Bitmap 7	736	Starter Air Pressure OORL	Warning	PCC3300, PCC3300V2
40437	11	Fault Status Gas Bitmap 7	737	Starter Air Pressure OORH	Warning	PCC3300, PCC3300V2
40437	12	Fault Status Gas Bitmap 7	738	Starter Air Press Underpressure Error	Warning	PCC3300, PCC3300V2
40437	13	Fault Status Gas Bitmap 7	741	Air Filter Restriction Pressure High Error	Warning	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40437	14	Fault Status Gas Bitmap 7	742	Air Filter Restriction Pressure Low Error	Warning	PCC3300, PCC3300V2
40437	15	Fault Status Gas Bitmap 7	751	Gas_Mass_Flow_In_Range_Error	Warning	PCC3300, PCC3300V2
40438	0	Fault Status Gas Bitmap 8	752	Exhaust_Gas_Oxygen_In_Range_Error	Warning	PCC3300, PCC3300V2
40438	1	Fault Status Gas Bitmap 8	783	Intake Manifold 1 Temp Abnormal	Shutdown w/Cooldown	PCC3300, PCC3300V2
40438	2	Fault Status Gas Bitmap 8	1213	COP_Overboost_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40438	3	Fault Status Gas Bitmap 8	1274	Heavy_Knock_Error_10_(B 5)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40438	4	Fault Status Gas Bitmap 8	1281	Heavy_Knock_Error_12_(B 6)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40438	5	Fault Status Gas Bitmap 8	1285	Continuous_Light_Knock_Error_13_(A7)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40438	6	Fault Status Gas Bitmap 8	1286	Heavy_Knock_Error_13_(A 7)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40438	7	Fault Status Gas Bitmap 8	1291	Heavy_Knock_Error_14_(B 7)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40438	8	Fault Status Gas Bitmap 8	1295	Continuous_Light_Knock_Error_15_(A8)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40438	9	Fault Status Gas Bitmap 8	1296	Heavy_Knock_Error_15_(A 8)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40438	10	Fault Status Gas Bitmap 8	1311	Heavy_Knock_Error_18_(B 9)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40438	11	Fault Status Gas Bitmap 8	1362	Oil Filter Restriction Error	Warning	PCC3300, PCC3300V2
40438	13	Fault Status Gas Bitmap 8	1457	Fail To Synchronize	Warning	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40438	14	Fault Status Gas Bitmap 8	1458	Sync Phase Rotation Mismatch	Warning	PCC3300, PCC3300V2
40438	15	Fault Status Gas Bitmap 8	1474	ECM Software mismatch	Shutdown w/Cooldown	PCC3300, PCC3300V2
40439	0	Fault Status Gas Bitmap 9	1521	Exhaust Gas Temp 3 (A2) OORH	Warning	PCC3300, PCC3300V2
40439	1	Fault Status Gas Bitmap 9	1522	Exhaust Gas Temp 5 (A3) OORH	Warning	PCC3300, PCC3300V2
40439	2	Fault Status Gas Bitmap 9	1523	Exhaust Gas Temp 7 (A4) OORH	Warning	PCC3300, PCC3300V2
40439	3	Fault Status Gas Bitmap 9	1524	Exhaust Gas Temp 9 (A5) OORH	Warning	PCC3300, PCC3300V2
40439	4	Fault Status Gas Bitmap 9	1525	Exhaust Gas Temp 11 (A6) OORH	Warning	PCC3300, PCC3300V2
40439	5	Fault Status Gas Bitmap 9	1526	Exhaust Gas Temp 13 (A7) OORH	Warning	PCC3300, PCC3300V2
40439	6	Fault Status Gas Bitmap 9	1527	Exhaust Gas Temp 15 (A8) OORH	Warning	PCC3300, PCC3300V2
40439	7	Fault Status Gas Bitmap 9	1528	Exhaust Gas Temp 17 (A9) OORH	Warning	PCC3300, PCC3300V2
40439	8	Fault Status Gas Bitmap 9	1529	Exhaust Gas Temp 2 (B1) OORH	Warning	PCC3300, PCC3300V2
40439	9	Fault Status Gas Bitmap 9	1531	Exhaust Gas Temp 6 (B3) OORH	Warning	PCC3300, PCC3300V2
40439	10	Fault Status Gas Bitmap 9	1532	Exhaust Gas Temp 8 (B4) OORH	Warning	PCC3300, PCC3300V2
40439	11	Fault Status Gas Bitmap 9	1533	Exhaust Gas Temp 10 (B5) OORH	Warning	PCC3300, PCC3300V2
40439	12	Fault Status Gas Bitmap 9	1534	Exhaust Gas Temp 12 (B6) OORH	Warning	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40439	13	Fault Status Gas Bitmap 9	1535	Exhaust Gas Temp 14 (B7) OORH	Warning	PCC3300, PCC3300V2
40439	14	Fault Status Gas Bitmap 9	1536	Exhaust Gas Temp 16 (B8) OORH	Warning	PCC3300, PCC3300V2
40439	15	Fault Status Gas Bitmap 9	1537	Exhaust Gas Temp 18 (B9) OORH	Warning	PCC3300, PCC3300V2
40440	0	Fault Status Gas Bitmap 10	1545	EPS Backup Channel Lost	Warning	PCC3300, PCC3300V2
40440	1	Fault Status Gas Bitmap 10	1546	EPS Main Channel Lost	Warning	PCC3300, PCC3300V2
40440	2	Fault Status Gas Bitmap 10	1579	Continuous_Light_Knock_Error_12_(B6)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40440	3	Fault Status Gas Bitmap 10	1581	Continuous_Light_Knock_Error_14_(B7)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40440	4	Fault Status Gas Bitmap 10	1582	Continuous_Light_Knock_Error_16_(B8)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40440	5	Fault Status Gas Bitmap 10	1583	Heavy_Knock_Error_16_(B8)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40440	6	Fault Status Gas Bitmap 10	1587	Continuous_Light_Knock_Error_17_(A9)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40440	7	Fault Status Gas Bitmap 10	1588	Heavy_Knock_Error_17_(A9)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40440	8	Fault Status Gas Bitmap 10	1593	Continuous_Light_Knock_Error_18_(B9)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40440	9	Fault Status Gas Bitmap 10	1618	Exhaust Gas Temp, Cyl 1 (A1) OORH	Warning	PCC3300, PCC3300V2
40440	10	Fault Status Gas Bitmap 10	1619	Exhaust Gas Temp, Cyl 4 (B2) OORH	Warning	PCC3300, PCC3300V2
40440	11	Fault Status Gas Bitmap 10	1636	Intake Manif Press 2 OORH	Warning	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40440	12	Fault Status Gas Bitmap 10	1637	Intake Manif Press 2 OORL	Warning	PCC3300, PCC3300V2
40440	13	Fault Status Gas Bitmap 10	1737	CAN_Throttle_Internal_Failure_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40440	14	Fault Status Gas Bitmap 10	1738	CAN_Throttle_Internal_Fault_Error	Warning	PCC3300, PCC3300V2
40440	15	Fault Status Gas Bitmap 10	1739	Engine Throttle Control Condition Exists	Warning	PCC3300, PCC3300V2
40441	0	Fault Status Gas Bitmap 11	1741	CAN_Throttle_High_Temp_Warning_Error	Warning	PCC3300, PCC3300V2
40441	1	Fault Status Gas Bitmap 11	1742	CAN_Throttle_Temp_Limiting_Error	Warning	PCC3300, PCC3300V2
40441	2	Fault Status Gas Bitmap 11	1743	Throttle Ctrl 2 OOR High	Shutdown w/Cooldown	PCC3300, PCC3300V2
40441	3	Fault Status Gas Bitmap 11	1744	Throttle Ctrl 2 OOR Low	Shutdown w/Cooldown	PCC3300, PCC3300V2
40441	4	Fault Status Gas Bitmap 11	1745	Throttle Ctrl 2 Incorrect	Shutdown w/Cooldown	PCC3300, PCC3300V2
40441	5	Fault Status Gas Bitmap 11	1746	Throttle Ctrl 2 Out of Adjustment	Shutdown w/Cooldown	PCC3300, PCC3300V2
40441	6	Fault Status Gas Bitmap 11	1747	Throttle Ctrl 2 Bad Device	Shutdown w/Cooldown	PCC3300, PCC3300V2
40441	7	Fault Status Gas Bitmap 11	1748	Throttle Ctrl 2 Root Unknown	Warning	PCC3300, PCC3300V2
40441	8	Fault Status Gas Bitmap 11	1749	Throttle Ctrl 2 Condition Exists	Warning	PCC3300, PCC3300V2
40441	9	Fault Status Gas Bitmap 11	1751	Throttle Ctrl 2 Warning High	Warning	PCC3300, PCC3300V2
40441	10	Fault Status Gas Bitmap 11	1752	Throttle Ctrl 2 Moderate High	Warning	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40441	11	Fault Status Gas Bitmap 11	1753	Fuel Shutoff 2 OOR High	Warning	PCC3300, PCC3300V2
40441	12	Fault Status Gas Bitmap 11	1754	Fuel Tmp 2 OOR High	Warning	PCC3300, PCC3300V2
40441	13	Fault Status Gas Bitmap 11	1755	Fuel Tmp 2 OOR Low	Warning	PCC3300, PCC3300V2
40441	14	Fault Status Gas Bitmap 11	1756	Gas Flow 2 OOR High	Warning	PCC3300, PCC3300V2
40441	15	Fault Status Gas Bitmap 11	1757	Gas Flow 2 OOR Low	Warning	PCC3300, PCC3300V2
40442	0	Fault Status Gas Bitmap 12	1758	Gas Flow 2 Incorrect Data	Warning	PCC3300, PCC3300V2
40442	1	Fault Status Gas Bitmap 12	1759	FCV 2 Pos Feedback Incorrect	Shutdown w/Cooldown	PCC3300, PCC3300V2
40442	2	Fault Status Gas Bitmap 12	1761	FCV_Actuator_Error_1761	Shutdown w/Cooldown	PCC3300, PCC3300V2
40442	3	Fault Status Gas Bitmap 12	1984	Int Man 2 Tmp Moderate High	Warning	PCC3300, PCC3300V2
40442	4	Fault Status Gas Bitmap 12	1765	FCV 2 In Pr OOR High	Warning	PCC3300, PCC3300V2
40442	5	Fault Status Gas Bitmap 12	1766	FCV 2 In Pr OOR Low	Warning	PCC3300, PCC3300V2
40442	6	Fault Status Gas Bitmap 12	1767	FCV 2 Out Pr OOR High	Warning	PCC3300, PCC3300V2
40442	7	Fault Status Gas Bitmap 12	1768	FCV 2 Out Pr OOR Low	Warning	PCC3300, PCC3300V2
40442	8	Fault Status Gas Bitmap 12	1769	E_Shutd Indication OORH	Warning	PCC3300, PCC3300V2
40442	9	Fault Status Gas Bitmap 12	1771	E_Shutd Indication OORL	Warning	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40442	10	Fault Status Gas Bitmap 12	1772	Eng Derate Request OORH	Warning	PCC3300, PCC3300V2
40442	11	Fault Status Gas Bitmap 12	1773	Eng Derate Request OORL	Warning	PCC3300, PCC3300V2
40442	12	Fault Status Gas Bitmap 12	1774	Oil Priming Pump OORH	Warning	PCC3300, PCC3300V2
40442	13	Fault Status Gas Bitmap 12	1775	Oil Priming Pump OORL	Warning	PCC3300, PCC3300V2
40442	14	Fault Status Gas Bitmap 12	3362	Power Conservation Control OORH	Warning	PCC3300, PCC3300V2
40442	15	Fault Status Gas Bitmap 12	3363	Power Conservation Control OORL	Warning	PCC3300, PCC3300V2
40443	0	Fault Status Gas Bitmap 13	1778	Engine_Heater_Control_Driver_High_Error	Warning	PCC3300, PCC3300V2
40443	1	Fault Status Gas Bitmap 13	1779	Engine_Heater_Control_Driver_Low_Error	Warning	PCC3300, PCC3300V2
40443	2	Fault Status Gas Bitmap 13	1781	Shutd Request OOR High	Warning	PCC3300, PCC3300V2
40443	3	Fault Status Gas Bitmap 13	1782	Shutd Request OOR Low	Warning	PCC3300, PCC3300V2
40443	4	Fault Status Gas Bitmap 13	1783	Coolant_Pump_Control_Driver_High_Error	Warning	PCC3300, PCC3300V2
40443	5	Fault Status Gas Bitmap 13	1784	Coolant_Pump_Control_Driver_Low_Error	Warning	PCC3300, PCC3300V2
40443	6	Fault Status Gas Bitmap 13	1785	Oil_Priming_Pump_Manual_Override_Input_On	Warning	PCC3300, PCC3300V2
40443	7	Fault Status Gas Bitmap 13	1786	Oil_Priming_Pump_Stuck_On_Error	Warning	PCC3300, PCC3300V2
40443	8	Fault Status Gas Bitmap 13	1787	Post_Lube_Oil_Priming_Error	Warning	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40443	9	Fault Status Gas Bitmap 13	1788	Maintenance_Lube_Oil_Priming_Error	Warning	PCC3300, PCC3300V2
40443	10	Fault Status Gas Bitmap 13	1789	Pre_Start_Lube_Oil_Priming_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40443	11	Fault Status Gas Bitmap 13	1791	Failure_To_Meet_Load_Speed_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40443	12	Fault Status Gas Bitmap 13	1792	Idle when CB Closed	Warning	PCC3300, PCC3300V2
40443	13	Fault Status Gas Bitmap 13	1793	Speed/Posit sensor out of Adj	Warning	PCC3300, PCC3300V2
40443	14	Fault Status Gas Bitmap 13	1794	Fire Detected	Shutdown	PCC3300, PCC3300V2
40443	15	Fault Status Gas Bitmap 13	1795	Compressor_Bypass_Position_High_Error	Warning	PCC3300, PCC3300V2
40444	0	Fault Status Gas Bitmap 14	1796	Compressor_Bypass_Position_Low_Error	Warning	PCC3300, PCC3300V2
40444	1	Fault Status Gas Bitmap 14	1797	Compressor Bypass ctrl OORH	Warning	PCC3300, PCC3300V2
40444	2	Fault Status Gas Bitmap 14	1798	Compressor Bypass ctrl OORL	Warning	PCC3300, PCC3300V2
40444	3	Fault Status Gas Bitmap 14	1799	CB_Position_Err_Status	Warning	PCC3300, PCC3300V2
40444	4	Fault Status Gas Bitmap 14	1811	HIGH_SIDE_DRV2_High_Control_Error (VPS)	Warning	PCC3300, PCC3300V2
40444	5	Fault Status Gas Bitmap 14	1812	HIGH_SIDE_DRV2_Low_Control_Error (VPS)	Warning	PCC3300, PCC3300V2
40444	6	Fault Status Gas Bitmap 14	1813	Valve_Proving_System_Test_Failed_Warning_Error	Warning	PCC3300, PCC3300V2
40444	7	Fault Status Gas Bitmap 14	1814	Valve_Proving_System_Test_Failed_Shutdown_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40444	8	Fault Status Gas Bitmap 14	1815	RLY14_High_Control_Error	Warning	PCC3300, PCC3300V2
40444	9	Fault Status Gas Bitmap 14	1816	Oil PreHtr Ctrl OOR Low	Warning	PCC3300, PCC3300V2
40444	10	Fault Status Gas Bitmap 14	1817	Oil_Pre-Heater_Tripped_Error	Warning	PCC3300, PCC3300V2
40444	11	Fault Status Gas Bitmap 14	1818	Oil_Pre-Heater_Not_Warming_Error	Warning	PCC3300, PCC3300V2
40444	12	Fault Status Gas Bitmap 14	1819	Common AC Aux CB tripped	Warning	PCC3300, PCC3300V2
40444	13	Fault Status Gas Bitmap 14	1821	Min_FSO_Speed_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40444	14	Fault Status Gas Bitmap 14	1822	LT Coolant Level Low Shutdown Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40444	15	Fault Status Gas Bitmap 14	1823	LT Coolant Level Low Warning Error	Warning	PCC3300, PCC3300V2
40445	0	Fault Status Gas Bitmap 15	1824	Idle_Rated_Trans_Oil_Temp_Low_Error	Warning	PCC3300, PCC3300V2
40445	1	Fault Status Gas Bitmap 15	1825	Dirty_Oil_Level_Error	Warning	PCC3300, PCC3300V2
40445	2	Fault Status Gas Bitmap 15	1826	ECM Software incompatible	Shutdown w/Cooldown	PCC3300, PCC3300V2
40445	3	Fault Status Gas Bitmap 15	1827	Fuel_Inlet_Pressure_High_Error	Warning	PCC3300, PCC3300V2
40445	4	Fault Status Gas Bitmap 15	1828	Fuel_Inlet_Pressure_Low_Error	Warning	PCC3300, PCC3300V2
40445	5	Fault Status Gas Bitmap 15	1829	Vent_Gas_Valve_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40445	6	Fault Status Gas Bitmap 15	1831	Upstream_FSO_Valve_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40445	7	Fault Status Gas Bitmap 15	1832	Downstream_FSO_Valve_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40445	8	Fault Status Gas Bitmap 15	1833	Engine_Heater_Trip_Error	Warning	PCC3300, PCC3300V2
40445	9	Fault Status Gas Bitmap 15	1834	Coolant_Pump_Trip_Error	Warning	PCC3300, PCC3300V2
40445	10	Fault Status Gas Bitmap 15	1835	Oil_Priming_Pump_Tripped_Error	Warning	PCC3300, PCC3300V2
40445	11	Fault Status Gas Bitmap 15	1836	LCP_(LT)_Low_Serious_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40445	12	Fault Status Gas Bitmap 15	1837	Permanent_FS_Cam_Sync_Lost_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40445	13	Fault Status Gas Bitmap 15	1838	Partial_Engine_Overload_Shutdown_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40445	14	Fault Status Gas Bitmap 15	1839	Fuel_Supply_Pressure_High_Error	Warning	PCC3300, PCC3300V2
40445	15	Fault Status Gas Bitmap 15	1841	Fuel_Supply_Pressure_Low_Error	Warning	PCC3300, PCC3300V2
40446	0	Fault Status Gas Bitmap 16	1842	Radiator_Fan_Trip_Error	Warning	PCC3300, PCC3300V2
40446	1	Fault Status Gas Bitmap 16	1858	Exhaust_Aft_Inlet_O2_OOR_High	Warning	PCC3300, PCC3300V2
40446	2	Fault Status Gas Bitmap 16	1859	Exhaust_Aft_Inlet_O2_OOR_Low	Warning	PCC3300, PCC3300V2
40446	3	Fault Status Gas Bitmap 16	1861	Exhaust_Aft_Inlet_O2_Incorrect	Warning	PCC3300, PCC3300V2
40446	4	Fault Status Gas Bitmap 16	1862	Exhaust_Aft_Out_O2_OOR_High	Warning	PCC3300, PCC3300V2
40446	5	Fault Status Gas Bitmap 16	1863	Exhaust_Aft_Outlet_O2_OOR_Low	Warning	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40446	6	Fault Status Gas Bitmap 16	1864	Exhaust Aft Outlet O2 Incorrect	Warning	PCC3300, PCC3300V2
40446	7	Fault Status Gas Bitmap 16	1985	Int Man 3 Tmp Moderate High	Warning	PCC3300, PCC3300V2
40446	8	Fault Status Gas Bitmap 16	1986	Int Man 4 Tmp Moderate High	Warning	PCC3300, PCC3300V2
40446	9	Fault Status Gas Bitmap 16	2111	Coolant_Inlet_Temperature_(LT)_High_Error	Warning	PCC3300, PCC3300V2
40446	10	Fault Status Gas Bitmap 16	2112	Coolant_Inlet_Temperature_(LT)_Low_Error	Warning	PCC3300, PCC3300V2
40446	11	Fault Status Gas Bitmap 16	2113	CIT_(LT)_High_Warning_Error	Warning	PCC3300, PCC3300V2
40446	12	Fault Status Gas Bitmap 16	2114	CIT_(LT)_High_Serious_Error	Shutdown	PCC3300, PCC3300V2
40446	13	Fault Status Gas Bitmap 16	2115	LT_Coolant_Pressure_High_Error	Warning	PCC3300, PCC3300V2
40446	14	Fault Status Gas Bitmap 16	2116	LT_Coolant_Pressure_Low_Error	Warning	PCC3300, PCC3300V2
40446	15	Fault Status Gas Bitmap 16	2117	LCP_(LT)_Low_Warning_Error	Warning	PCC3300, PCC3300V2
40447	0	Fault Status Gas Bitmap 17	2121	Exhaust_Temp_1_(A1)_High_Warning_Error	Warning	PCC3300, PCC3300V2
40447	1	Fault Status Gas Bitmap 17	2122	Exhaust_Temp_3_(A2)_High_Warning_Error	Warning	PCC3300, PCC3300V2
40447	2	Fault Status Gas Bitmap 17	2123	Exhaust_Temp_5_(A3)_High_Warning_Error	Warning	PCC3300, PCC3300V2
40447	3	Fault Status Gas Bitmap 17	2124	Exhaust_Temp_7_(A4)_High_Warning_Error	Warning	PCC3300, PCC3300V2
40447	4	Fault Status Gas Bitmap 17	2125	Exhaust_Temp_9_(A5)_High_Warning_Error	Warning	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40447	5	Fault Status Gas Bitmap 17	2126	Exhaust_Temp_11_(A6)_High_Warning_Error	Warning	PCC3300, PCC3300V2
40447	6	Fault Status Gas Bitmap 17	2127	Exhaust_Temp_13_(A7)_High_Warning_Error	Warning	PCC3300, PCC3300V2
40447	7	Fault Status Gas Bitmap 17	2128	Exhaust_Temp_15_(A8)_High_Warning_Error	Warning	PCC3300, PCC3300V2
40447	8	Fault Status Gas Bitmap 17	2129	Exhaust_Temp_17_(A9)_High_Warning_Error	Warning	PCC3300, PCC3300V2
40447	9	Fault Status Gas Bitmap 17	2131	Exhaust_Temp_2_(B1)_High_Warning_Error	Warning	PCC3300, PCC3300V2
40447	10	Fault Status Gas Bitmap 17	2132	Exhaust_Temp_4_(B2)_High_Warning_Error	Warning	PCC3300, PCC3300V2
40447	11	Fault Status Gas Bitmap 17	2133	Exhaust_Temp_6_(B3)_High_Warning_Error	Warning	PCC3300, PCC3300V2
40447	12	Fault Status Gas Bitmap 17	2134	Exhaust_Temp_8_(B4)_High_Warning_Error	Warning	PCC3300, PCC3300V2
40447	13	Fault Status Gas Bitmap 17	2135	Exhaust_Temp_10_(B5)_High_Warning_Error	Warning	PCC3300, PCC3300V2
40447	14	Fault Status Gas Bitmap 17	2136	Exhaust_Temp_12_(B6)_High_Warning_Error	Warning	PCC3300, PCC3300V2
40447	15	Fault Status Gas Bitmap 17	2137	Exhaust_Temp_14_(B7)_High_Warning_Error	Warning	PCC3300, PCC3300V2
40448	0	Fault Status Gas Bitmap 18	2138	Exhaust_Temp_16_(B8)_High_Warning_Error	Warning	PCC3300, PCC3300V2
40448	1	Fault Status Gas Bitmap 18	2139	Exhaust_Temp_18_(B9)_High_Warning_Error	Warning	PCC3300, PCC3300V2
40448	2	Fault Status Gas Bitmap 18	2141	Start_Air_Pressure_High_Error	Warning	PCC3300, PCC3300V2
40448	3	Fault Status Gas Bitmap 18	2142	Start_Air_Pressure_Low_Error	Warning	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40448	4	Fault Status Gas Bitmap 18	2143	SAP_Overpressure_Error	Warning	PCC3300, PCC3300V2
40448	5	Fault Status Gas Bitmap 18	2144	Exhaust Temp 16 (B8) High Serious Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40448	6	Fault Status Gas Bitmap 18	2145	Exhaust Temp 18 (B9) High Serious Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40448	7	Fault Status Gas Bitmap 18	2146	EGT 17 (A9) OOR Low	Warning	PCC3300, PCC3300V2
40448	8	Fault Status Gas Bitmap 18	2147	EGT 18 (B9) OOR Low	Warning	PCC3300, PCC3300V2
40448	9	Fault Status Gas Bitmap 18	2154	Oil_Filter_Outlet_Pressure_High_Error	Warning	PCC3300, PCC3300V2
40448	10	Fault Status Gas Bitmap 18	2155	Oil_Filter_Outlet_Pressure_Low_Error	Warning	PCC3300, PCC3300V2
40448	11	Fault Status Gas Bitmap 18	2157	Int Man 2 Tmp Abnormal Rate	Shutdown w/Cooldown	PCC3300, PCC3300V2
40448	12	Fault Status Gas Bitmap 18	2158	Int Man 3 Tmp Abnormal Rate	Shutdown w/Cooldown	PCC3300, PCC3300V2
40448	13	Fault Status Gas Bitmap 18	2159	Int Man 4 Tmp Abnormal Rate	Shutdown w/Cooldown	PCC3300, PCC3300V2
40448	14	Fault Status Gas Bitmap 18	2188	Exhaust O2 OOR High	Warning	PCC3300, PCC3300V2
40448	15	Fault Status Gas Bitmap 18	2191	ST_Throttle_Press_Err_Stat us	Warning	PCC3300, PCC3300V2
40449	0	Fault Status Gas Bitmap 19	2192	Exhaust O2 OOR Low	Warning	PCC3300, PCC3300V2
40449	1	Fault Status Gas Bitmap 19	2217	RAM_Image_Word_Error	Warning	PCC3300, PCC3300V2
40449	2	Fault Status Gas Bitmap 19	2219	Exhaust O2 Moderate High	Warning	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40449	3	Fault Status Gas Bitmap 19	2221	Exhaust O2 Moderate Low	Warning	PCC3300, PCC3300V2
40449	4	Fault Status Gas Bitmap 19	2281	Knock 11 (A6) Moderate High	Shutdown w/Cooldown	PCC3300, PCC3300V2
40449	5	Fault Status Gas Bitmap 19	2282	Knock 11 (A6) Critical High	Shutdown w/Cooldown	PCC3300, PCC3300V2
40449	6	Fault Status Gas Bitmap 19	2298	Fuel Shutoff 2 OOR Low	Warning	PCC3300, PCC3300V2
40449	7	Fault Status Gas Bitmap 19	2315	Red Lamp OOR High	Warning	PCC3300, PCC3300V2
40449	8	Fault Status Gas Bitmap 19	2316	Amber Lamp OOR High	Warning	PCC3300, PCC3300V2
40449	9	Fault Status Gas Bitmap 19	2317	Amber Lamp OOR Low	Warning	PCC3300, PCC3300V2
40449	10	Fault Status Gas Bitmap 19	2427	Fuel_Outlet_Pressure_High_Error	Warning	PCC3300, PCC3300V2
40449	11	Fault Status Gas Bitmap 19	2428	Fuel_Outlet_Pressure_Low_Error	Warning	PCC3300, PCC3300V2
40449	12	Fault Status Gas Bitmap 19	2453	Total Real Power Circuit OORH	Warning	PCC3300, PCC3300V2
40449	13	Fault Status Gas Bitmap 19	2454	Total Real Power Circuit OORL	Warning	PCC3300, PCC3300V2
40449	14	Fault Status Gas Bitmap 19	2455	Speed_Bias_Low_Error	Warning	PCC3300, PCC3300V2
40449	15	Fault Status Gas Bitmap 19	2456	Speed_Bias_High_Error	Warning	PCC3300, PCC3300V2
40450	0	Fault Status Gas Bitmap 20	2457	Max_Total_Misfire_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40450	1	Fault Status Gas Bitmap 20	2458	Cylinder_2_(B1)_Total_Misfire_Error	Warning	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40450	2	Fault Status Gas Bitmap 20	2459	Cylinder_4_(B2)_Total_Misfire_Error	Warning	PCC3300, PCC3300V2
40450	3	Fault Status Gas Bitmap 20	2461	Cylinder_6_(B3)_Total_Misfire_Error	Warning	PCC3300, PCC3300V2
40450	4	Fault Status Gas Bitmap 20	2462	Cylinder_8_(B4)_Total_Misfire_Error	Warning	PCC3300, PCC3300V2
40450	5	Fault Status Gas Bitmap 20	2463	Cylinder_10_(B5)_Total_Misfire_Error	Warning	PCC3300, PCC3300V2
40450	6	Fault Status Gas Bitmap 20	2464	Cylinder_12_(B6)_Total_Misfire_Error	Warning	PCC3300, PCC3300V2
40450	7	Fault Status Gas Bitmap 20	2465	Cylinder_14_(B7)_Total_Misfire_Error	Warning	PCC3300, PCC3300V2
40450	8	Fault Status Gas Bitmap 20	2466	Cylinder_16_(B8)_Total_Misfire_Error	Warning	PCC3300, PCC3300V2
40450	9	Fault Status Gas Bitmap 20	2467	Cylinder_18_(B9)_Total_Misfire_Error	Warning	PCC3300, PCC3300V2
40450	10	Fault Status Gas Bitmap 20	2469	Cylinder_1_(A1)_Total_Misfire_Error	Warning	PCC3300, PCC3300V2
40450	11	Fault Status Gas Bitmap 20	2471	Cylinder_3_(A2)_Total_Misfire_Error	Warning	PCC3300, PCC3300V2
40450	12	Fault Status Gas Bitmap 20	2472	Cylinder_5_(A3)_Total_Misfire_Error	Warning	PCC3300, PCC3300V2
40450	13	Fault Status Gas Bitmap 20	2473	Cylinder_7_(A4)_Total_Misfire_Error	Warning	PCC3300, PCC3300V2
40450	14	Fault Status Gas Bitmap 20	2475	Cylinder_9_(A5)_Total_Misfire_Error	Warning	PCC3300, PCC3300V2
40450	15	Fault Status Gas Bitmap 20	2476	Cylinder_11_(A6)_Total_Misfire_Error	Warning	PCC3300, PCC3300V2
40451	0	Fault Status Gas Bitmap 21	2477	Cylinder_13_(A7)_Total_Misfire_Error	Warning	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40451	1	Fault Status Gas Bitmap 21	2478	Cylinder_15_(A8)_Total_Mi sfire_Error	Warning	PCC3300, PCC3300V2
40451	2	Fault Status Gas Bitmap 21	2479	Cylinder_17_(A9)_Total_Mi sfire_Error	Warning	PCC3300, PCC3300V2
40451	3	Fault Status Gas Bitmap 21	2482	Start_Before_Ready_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40451	4	Fault Status Gas Bitmap 21	2483	Continuous_Starter_Failure _Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40451	5	Fault Status Gas Bitmap 21	2484	Exhaust Temperature 1 (A1) Abnormal Rate	Shutdown w/Cooldown	PCC3300, PCC3300V2
40451	6	Fault Status Gas Bitmap 21	2485	Exhaust Temperature 3 (A2) Abnormal Rate	Shutdown w/Cooldown	PCC3300, PCC3300V2
40451	7	Fault Status Gas Bitmap 21	2486	Exhaust Temperature 5 (A3) Abnormal Rate	Shutdown w/Cooldown	PCC3300, PCC3300V2
40451	8	Fault Status Gas Bitmap 21	2487	Exhaust Temperature 7 (A4) Abnormal Rate	Shutdown w/Cooldown	PCC3300, PCC3300V2
40451	9	Fault Status Gas Bitmap 21	2488	Exhaust Temperature 9 (A5) Abnormal Rate	Shutdown w/Cooldown	PCC3300, PCC3300V2
40451	10	Fault Status Gas Bitmap 21	2489	Exhaust Temperature 11 (A6) Abnormal Rate	Shutdown w/Cooldown	PCC3300, PCC3300V2
40451	11	Fault Status Gas Bitmap 21	2491	Exhaust Temperature 13 (A7) Abnormal Rate	Shutdown w/Cooldown	PCC3300, PCC3300V2
40451	12	Fault Status Gas Bitmap 21	2492	Exhaust Temperature 15 (A8) Abnormal Rate	Shutdown w/Cooldown	PCC3300, PCC3300V2
40451	13	Fault Status Gas Bitmap 21	2493	Exhaust Temperature 17 (A9) Abnormal Rate	Shutdown w/Cooldown	PCC3300, PCC3300V2
40451	14	Fault Status Gas Bitmap 21	2494	Exhaust Temperature 2 (B1) Abnormal Rate	Shutdown w/Cooldown	PCC3300, PCC3300V2
40451	15	Fault Status Gas Bitmap 21	2495	Exhaust Temperature 4 (B2) Abnormal Rate	Shutdown w/Cooldown	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40452	0	Fault Status Gas Bitmap 22	2496	Exhaust Temperature 6 (B3) Abnormal Rate	Shutdown w/Cooldown	PCC3300, PCC3300V2
40452	1	Fault Status Gas Bitmap 22	2497	Exhaust Temperature 8 (B4) Abnormal Rate	Shutdown w/Cooldown	PCC3300, PCC3300V2
40452	2	Fault Status Gas Bitmap 22	2498	Exhaust Temperature 10 (B5) Abnormal Rate	Shutdown w/Cooldown	PCC3300, PCC3300V2
40452	3	Fault Status Gas Bitmap 22	2499	Exhaust Temperature 12 (B6) Abnormal Rate	Shutdown w/Cooldown	PCC3300, PCC3300V2
40452	4	Fault Status Gas Bitmap 22	2511	Exhaust Temperature 14 (B7) Abnormal Rate	Shutdown w/Cooldown	PCC3300, PCC3300V2
40452	5	Fault Status Gas Bitmap 22	2512	Exhaust Temperature 16 (B8) Abnormal Rate	Shutdown w/Cooldown	PCC3300, PCC3300V2
40452	6	Fault Status Gas Bitmap 22	2513	Exhaust Temperature 18 (B9) Abnormal Rate	Shutdown w/Cooldown	PCC3300, PCC3300V2
40452	7	Fault Status Gas Bitmap 22	2517	Compressor_Outlet_Pressure_High_Error	Warning	PCC3300, PCC3300V2
40452	8	Fault Status Gas Bitmap 22	2518	Compressor_Outlet_Pressure_Low_Error	Warning	PCC3300, PCC3300V2
40452	9	Fault Status Gas Bitmap 22	2521	Bank_Id_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40452	10	Fault Status Gas Bitmap 22	2522	Continuous_Light_Knock_Error_1_(A1)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40452	11	Fault Status Gas Bitmap 22	2523	Continuous_Light_Knock_Error_2_(B1)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40452	12	Fault Status Gas Bitmap 22	2524	Continuous_Light_Knock_Error_3_(A2)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40452	13	Fault Status Gas Bitmap 22	2525	Continuous_Light_Knock_Error_4_(B2)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40452	14	Fault Status Gas Bitmap 22	2526	Continuous_Light_Knock_Error_5_(A3)	Shutdown w/Cooldown	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40452	15	Fault Status Gas Bitmap 22	2527	Continuous_Light_Knock_Error_6_(B3)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40453	0	Fault Status Gas Bitmap 23	2528	Continuous_Light_Knock_Error_7_(A4)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40453	1	Fault Status Gas Bitmap 23	2529	Continuous_Light_Knock_Error_8_(B4)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40453	2	Fault Status Gas Bitmap 23	2531	Continuous_Light_Knock_Error_9_(A5)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40453	3	Fault Status Gas Bitmap 23	2532	Continuous_Light_Knock_Error_10_(B5)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40453	4	Fault Status Gas Bitmap 23	2544	ECM_Overtemp_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40453	5	Fault Status Gas Bitmap 23	2567	DG_Air_Compressor_Trip_Error	Warning	PCC3300, PCC3300V2
40453	6	Fault Status Gas Bitmap 23	2643	Throttle Pos 2 Feedback OOR High	Warning	PCC3300, PCC3300V2
40453	7	Fault Status Gas Bitmap 23	2644	Throttle Pos 2 Feedback OOR Low	Warning	PCC3300, PCC3300V2
40453	9	Fault Status Gas Bitmap 23	2724	Gas Supply Pr Moderate High	Warning	PCC3300, PCC3300V2
40453	10	Fault Status Gas Bitmap 23	2725	Gas Supply Pr Moderate Low	Warning	PCC3300, PCC3300V2
40453	11	Fault Status Gas Bitmap 23	2737	Exh Gas Tmp Critical High	Shutdown w/Cooldown	PCC3300, PCC3300V2
40453	12	Fault Status Gas Bitmap 23	2766	Bank_A_CCD_Failed_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40453	13	Fault Status Gas Bitmap 23	2767	Bank_B_CCD_Failed_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40453	14	Fault Status Gas Bitmap 23	2768	CAN Parent Communication Incorrect	Shutdown w/Cooldown	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40453	15	Fault Status Gas Bitmap 23	2769	CAN Child Com Incorrect	Shutdown w/Cooldown	PCC3300, PCC3300V2
40454	0	Fault Status Gas Bitmap 24	2789	COT_Low_Error	Warning	PCC3300, PCC3300V2
40454	1	Fault Status Gas Bitmap 24	2793	COT_Low_Serious_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40454	2	Fault Status Gas Bitmap 24	2794	Ign Shutd Relay OOR High	Warning	PCC3300, PCC3300V2
40454	3	Fault Status Gas Bitmap 24	2795	Ign Shutd Relay OOR Low	Warning	PCC3300, PCC3300V2
40454	4	Fault Status Gas Bitmap 24	2796	Partial_Engine_Overload_Warning_Error	Warning	PCC3300, PCC3300V2
40454	5	Fault Status Gas Bitmap 24	2797	Inlet Gas Diff Pressure OOR High	Warning	PCC3300, PCC3300V2
40454	6	Fault Status Gas Bitmap 24	2798	Inlet Gas Diff Pressure OOR Low	Warning	PCC3300, PCC3300V2
40454	7	Fault Status Gas Bitmap 24	2799	IMOP_Compressor_Outlet_Presure_Delta_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40454	8	Fault Status Gas Bitmap 24	2811	IMOP_Compressor_Outlet_Pressure_Maximum_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40454	9	Fault Status Gas Bitmap 24	2837	Exhaust_Temp_1_(A1)_Deviation_Error	Warning	PCC3300, PCC3300V2
40454	10	Fault Status Gas Bitmap 24	2838	Exhaust_Temp_3_(A2)_Deviation_Error	Warning	PCC3300, PCC3300V2
40454	11	Fault Status Gas Bitmap 24	2839	Exhaust_Temp_5_(A3)_Deviation_Error	Warning	PCC3300, PCC3300V2
40454	12	Fault Status Gas Bitmap 24	2841	Exhaust_Temp_7_(A4)_Deviation_Error	Warning	PCC3300, PCC3300V2
40454	13	Fault Status Gas Bitmap 24	2842	Exhaust_Temp_9_(A5)_Deviation_Error	Warning	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40454	14	Fault Status Gas Bitmap 24	2843	Exhaust_Temp_11_(A6)_Deviation_Error	Warning	PCC3300, PCC3300V2
40454	15	Fault Status Gas Bitmap 24	2844	Exhaust_Temp_13_(A7)_Deviation_Error	Warning	PCC3300, PCC3300V2
40455	0	Fault Status Gas Bitmap 25	2845	Exhaust_Temp_15_(A8)_Deviation_Error	Warning	PCC3300, PCC3300V2
40455	1	Fault Status Gas Bitmap 25	2846	Exhaust_Temp_17_(A9)_Deviation_Error	Warning	PCC3300, PCC3300V2
40455	2	Fault Status Gas Bitmap 25	2847	Exhaust_Temp_2_(B1)_Deviation_Error	Warning	PCC3300, PCC3300V2
40455	3	Fault Status Gas Bitmap 25	2848	Exhaust_Temp_4_(B2)_Deviation_Error	Warning	PCC3300, PCC3300V2
40455	4	Fault Status Gas Bitmap 25	2849	Exhaust_Temp_6_(B3)_Deviation_Error	Warning	PCC3300, PCC3300V2
40455	5	Fault Status Gas Bitmap 25	2851	Exhaust_Temp_8_(B4)_Deviation_Error	Warning	PCC3300, PCC3300V2
40455	6	Fault Status Gas Bitmap 25	2852	Exhaust_Temp_10_(B5)_Deviation_Error	Warning	PCC3300, PCC3300V2
40455	7	Fault Status Gas Bitmap 25	2853	Exhaust_Temp_12_(B6)_Deviation_Error	Warning	PCC3300, PCC3300V2
40455	8	Fault Status Gas Bitmap 25	2854	Exhaust_Temp_14_(B7)_Deviation_Error	Warning	PCC3300, PCC3300V2
40455	9	Fault Status Gas Bitmap 25	2855	Exhaust_Temp_16_(B8)_Deviation_Error	Warning	PCC3300, PCC3300V2
40455	10	Fault Status Gas Bitmap 25	2856	Exhaust_Temp_18_(B9)_Deviation_Error	Warning	PCC3300, PCC3300V2
40455	11	Fault Status Gas Bitmap 25	2857	Turbo_1_Overspeed_Critical_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40455	12	Fault Status Gas Bitmap 25	2858	Turbo_2_Overspeed_Critical_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40455	13	Fault Status Gas Bitmap 25	2859	Alt Heater Ctrl OOR High	Warning	PCC3300, PCC3300V2
40455	14	Fault Status Gas Bitmap 25	2861	Alt Heater Ctrl OOR Low	Warning	PCC3300, PCC3300V2
40455	15	Fault Status Gas Bitmap 25	2862	Gen Alternator 1st Start Cond Exists	Warning	PCC3300, PCC3300V2

TABLE 68.

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40431	0	Fault Status Gas Bitmap 1	121	EPS Main Channel Lost Error	Warning	PCC3300, PCC3300V2
40431	1	Fault Status Gas Bitmap 1	136	Oil Inlet Pressure High Error	Warning	PCC3300, PCC3300V2
40431	2	Fault Status Gas Bitmap 1	137	Oil Inlet Pressure Low Error	Warning	PCC3300, PCC3300V2
40431	3	Fault Status Gas Bitmap 1	142	Oil Overpressure Error	Warning	PCC3300, PCC3300V2
40431	4	Fault Status Gas Bitmap 1	156	Intake Manifold Temp 2 OORH	Warning	PCC3300, PCC3300V2
40431	5	Fault Status Gas Bitmap 1	157	Intake Manifold Temp 2 OORL	Warning	PCC3300, PCC3300V2
40431	6	Fault Status Gas Bitmap 1	158	Intake Manifold Temp 2 High	Shutdown	PCC3300, PCC3300V2
40431	7	Fault Status Gas Bitmap 1	159	Intake Manifold 3 Temp OORH	Warning	PCC3300, PCC3300V2
40431	8	Fault Status Gas Bitmap 1	161	Intake Manifold 3 Temp OORL	Warning	PCC3300, PCC3300V2
40431	9	Fault Status Gas Bitmap 1	162	Intake Manifold 3 Temp High	Shutdown	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40431	10	Fault Status Gas Bitmap 1	163	Intake Manifold 4 Temp OORH	Warning	PCC3300, PCC3300V2
40431	11	Fault Status Gas Bitmap 1	164	Intake Manifold 4 Temp OORL	Warning	PCC3300, PCC3300V2
40431	12	Fault Status Gas Bitmap 1	165	Intake Manifold 4 Temp High	Shutdown	PCC3300, PCC3300V2
40431	13	Fault Status Gas Bitmap 1	175	Throttle_Driver_Feedback_High_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40431	14	Fault Status Gas Bitmap 1	176	Throttle_Driver_Feedback_Low_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40431	15	Fault Status Gas Bitmap 1	177	Throttle_Actuator_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40432	0	Fault Status Gas Bitmap 2	2118	Low Fuel Pressure	Warning	PCC3300, PCC2300, PCC3300V2
40432	1	Fault Status Gas Bitmap 2	5365	Fuel System on Secondary Source - Condition Exists	Warning	PCC3300, PCC2300, PCC3300V2
40432	2	Fault Status Gas Bitmap 2	244	Red Stop Lamp Driver OORL	Warning	PCC3300, PCC3300V2
40432	3	Fault Status Gas Bitmap 2	246	Exhaust Gas Temp Sensor 1 OORH	Warning	PCC3300, PCC3300V2
40432	4	Fault Status Gas Bitmap 2	247	Exhaust Gas Temp Sensor 1 OORL	Warning	PCC3300, PCC3300V2
40432	5	Fault Status Gas Bitmap 2	248	Exhaust Gas Temp Sensor 1 High	Warning	PCC3300, PCC3300V2
40432	6	Fault Status Gas Bitmap 2	253	Oil Level Low Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40432	8	Fault Status Gas Bitmap 2	277	Fuel Control Valve Out of Adj	Warning	PCC3300, PCC3300V2
40432	9	Fault Status Gas Bitmap 2	346	Powerdown Data Lost Error	Warning	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40432	10	Fault Status Gas Bitmap 2	354	Manifold_Absolute_Pressur e_1_High_Error	Warning	PCC3300, PCC3300V2
40432	11	Fault Status Gas Bitmap 2	355	Manifold_Absolute_Pressur e_1_Low_Error	Warning	PCC3300, PCC3300V2
40432	12	Fault Status Gas Bitmap 2	412	J1708 Link Cannot Transmit Error	NONE	PCC3300, PCC3300V2
40432	13	Fault Status Gas Bitmap 2	414	J1708 Link Not Fast Enough Error	NONE	PCC3300, PCC3300V2
40432	14	Fault Status Gas Bitmap 2	453	Gas_Mass_Flow_High_Err or	Warning	PCC3300, PCC3300V2
40432	15	Fault Status Gas Bitmap 2	454	Gas_Mass_Flow_Low_Error	Warning	PCC3300, PCC3300V2
40433	0	Fault Status Gas Bitmap 3	458	Spark_Timing_B_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40433	1	Fault Status Gas Bitmap 3	459	Spark_Timing_A_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40433	2	Fault Status Gas Bitmap 3	461	Spark_Reference_B_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40433	3	Fault Status Gas Bitmap 3	462	Spark_Reference_A_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40433	4	Fault Status Gas Bitmap 3	477	Isolated Battery Voltage Low Error	Warning	PCC3300, PCC3300V2
40433	5	Fault Status Gas Bitmap 3	478	Isolated Battery Voltage High Error	Warning	PCC3300, PCC3300V2
40433	6	Fault Status Gas Bitmap 3	512	Throttle Pos 1 Feedback OOR High	Warning	PCC3300, PCC3300V2
40433	7	Fault Status Gas Bitmap 3	513	Throttle Pos 1 Feedback OOR Low	Warning	PCC3300, PCC3300V2
40433	8	Fault Status Gas Bitmap 3	557	Fuel Control Valve 2 OORH	Shutdown w/Cooldown	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40433	9	Fault Status Gas Bitmap 3	558	Fuel Control Valve 2 OORL	Warning	PCC3300, PCC3300V2
40433	10	Fault Status Gas Bitmap 3	561	Heavy_Knock_Error_1_(A1)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40433	11	Fault Status Gas Bitmap 3	562	Heavy_Knock_Error_2_(B1)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40433	12	Fault Status Gas Bitmap 3	563	Heavy_Knock_Error_3_(A2)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40433	13	Fault Status Gas Bitmap 3	564	Heavy_Knock_Error_4_(B2)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40433	14	Fault Status Gas Bitmap 3	565	Heavy_Knock_Error_5_(A3)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40433	15	Fault Status Gas Bitmap 3	566	Heavy_Knock_Error_6_(B3)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40434	0	Fault Status Gas Bitmap 4	567	Heavy_Knock_Error_7_(A4)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40434	1	Fault Status Gas Bitmap 4	568	Heavy_Knock_Error_8_(B4)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40434	2	Fault Status Gas Bitmap 4	569	Heavy_Knock_Error_9_(A5)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40434	3	Fault Status Gas Bitmap 4	571	Knock Cyl 1 (A1) OORL	Warning	PCC3300, PCC3300V2
40434	4	Fault Status Gas Bitmap 4	572	Knock Cyl 2 (B1) OORL	Warning	PCC3300, PCC3300V2
40434	5	Fault Status Gas Bitmap 4	573	Knock Cyl 3 (A2) OORL	Warning	PCC3300, PCC3300V2
40434	6	Fault Status Gas Bitmap 4	574	Knock Cyl 4 (B2) OORL	Warning	PCC3300, PCC3300V2
40434	7	Fault Status Gas Bitmap 4	575	Knock Cyl 5 (A3) OORL	Warning	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40434	8	Fault Status Gas Bitmap 4	576	Knock Cyl 6 (B3) OORL	Warning	PCC3300, PCC3300V2
40434	9	Fault Status Gas Bitmap 4	577	Knock Cyl 7 (A4) OORL	Warning	PCC3300, PCC3300V2
40434	10	Fault Status Gas Bitmap 4	578	Knock Cyl 8 (B4) OORL	Warning	PCC3300, PCC3300V2
40434	11	Fault Status Gas Bitmap 4	579	Knock Cyl 9 (A5) OORL	Warning	PCC3300, PCC3300V2
40434	12	Fault Status Gas Bitmap 4	584	High Side DRV3 High Control Error	Warning	PCC3300, PCC3300V2
40434	13	Fault Status Gas Bitmap 4	585	High Side DRV3 Low Control Error	Warning	PCC3300, PCC3300V2
40434	14	Fault Status Gas Bitmap 4	591	Exhaust_Backpressure_High_Error	Warning	PCC3300, PCC3300V2
40434	15	Fault Status Gas Bitmap 4	592	Exhaust_Backpressure_Low_Error	Warning	PCC3300, PCC3300V2
40435	0	Fault Status Gas Bitmap 5	595	Turbo 1 Overspeed Warning Error	Warning	PCC3300, PCC3300V2
40435	1	Fault Status Gas Bitmap 5	618	Turbo 1 Inlet Pressure High	Warning	PCC3300, PCC3300V2
40435	2	Fault Status Gas Bitmap 5	619	Turbo 2 Inlet Press High	Warning	PCC3300, PCC3300V2
40435	3	Fault Status Gas Bitmap 5	641	Exhaust Temp 1 (A1) High Serious Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40435	4	Fault Status Gas Bitmap 5	642	Exhaust Temp 3 (A2) High Serious Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40435	5	Fault Status Gas Bitmap 5	643	Exhaust Temp 5 (A3) High Serious Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40435	6	Fault Status Gas Bitmap 5	644	Exhaust Temp 7 (A4) High Serious Error	Shutdown w/Cooldown	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40435	7	Fault Status Gas Bitmap 5	645	Exhaust Temp 9 (A5) High Serious Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40435	8	Fault Status Gas Bitmap 5	646	Exhaust Temp 11 (A6) High Serious Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40435	9	Fault Status Gas Bitmap 5	647	Exhaust Temp 13 (A7) High Serious Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40435	10	Fault Status Gas Bitmap 5	648	Exhaust Temp 15 (A8) High Serious Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40435	11	Fault Status Gas Bitmap 5	651	Exhaust Temp 17 (A9) High Serious Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40435	12	Fault Status Gas Bitmap 5	652	Exhaust Temp 2 (B1) High Serious Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40435	13	Fault Status Gas Bitmap 5	653	Exhaust Temp 4 (B2) High Serious Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40435	14	Fault Status Gas Bitmap 5	654	Exhaust Temp 6 (B3) High Serious Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40435	15	Fault Status Gas Bitmap 5	655	Exhaust Temp 8 (B4) High Serious Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40436	0	Fault Status Gas Bitmap 6	656	Exhaust Temp 10 (B5) High Serious Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40436	1	Fault Status Gas Bitmap 6	657	Exhaust Temp 12 (B6) High Serious Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40436	2	Fault Status Gas Bitmap 6	658	Exhaust Temp 14 (B7) High Serious Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40436	3	Fault Status Gas Bitmap 6	671	Exhaust Gas Temp Cyl 1 (A1) OORL	Warning	PCC3300, PCC3300V2
40436	4	Fault Status Gas Bitmap 6	672	Exhaust Gas Temp Cyl 3 (A2) OORL	Warning	PCC3300, PCC3300V2
40436	5	Fault Status Gas Bitmap 6	673	Exhaust Gas Temp Cyl 5 (A3) OORL	Warning	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40436	6	Fault Status Gas Bitmap 6	674	Exhaust Gas Temp Cyl 7 (A4) OORL	Warning	PCC3300, PCC3300V2
40436	7	Fault Status Gas Bitmap 6	675	Exhaust Gas Temp Cyl 9 (A5) OORL	Warning	PCC3300, PCC3300V2
40436	8	Fault Status Gas Bitmap 6	676	Exhaust Gas Temp Cyl 11 (A6) OORL	Warning	PCC3300, PCC3300V2
40436	9	Fault Status Gas Bitmap 6	677	Exhaust Gas Temp Cyl 13 (A7) OORL	Warning	PCC3300, PCC3300V2
40436	10	Fault Status Gas Bitmap 6	678	Exhaust Gas Temp Cyl 15 (A8) OORL	Warning	PCC3300, PCC3300V2
40436	11	Fault Status Gas Bitmap 6	683	Turbo 2 Speed Moderate High	Warning	PCC3300, PCC3300V2
40436	12	Fault Status Gas Bitmap 6	684	Turbo 2 Speed Moderate Low	Warning	PCC3300, PCC3300V2
40436	13	Fault Status Gas Bitmap 6	685	Turbo 2 Speed Incorrect	Warning	PCC3300, PCC3300V2
40436	15	Fault Status Gas Bitmap 6	687	Turbo 1 Speed Low	Warning	PCC3300, PCC3300V2
40437	2	Fault Status Gas Bitmap 7	721	Exhaust Gas Temp 2 (B1) OORL	Warning	PCC3300, PCC3300V2
40437	3	Fault Status Gas Bitmap 7	722	Exhaust Gas Temp 4 (B2) OORL	Warning	PCC3300, PCC3300V2
40437	4	Fault Status Gas Bitmap 7	723	Exhaust Gas Temp 6 (B3) OORL	Warning	PCC3300, PCC3300V2
40437	5	Fault Status Gas Bitmap 7	724	Exhaust Gas Temp 8 (B4) OORL	Warning	PCC3300, PCC3300V2
40437	6	Fault Status Gas Bitmap 7	725	Exhaust Gas Temp 10 (B5) OORL	Warning	PCC3300, PCC3300V2
40437	7	Fault Status Gas Bitmap 7	726	Exhaust Gas Temp 12 (B6) OORL	Warning	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40437	8	Fault Status Gas Bitmap 7	727	Exhaust Gas Temp 14 (B7) OORL	Warning	PCC3300, PCC3300V2
40437	9	Fault Status Gas Bitmap 7	728	Exhaust Gas Temp 16 (B8) OORL	Warning	PCC3300, PCC3300V2
40437	10	Fault Status Gas Bitmap 7	736	Starter Air Pressure OORL	Warning	PCC3300, PCC3300V2
40437	11	Fault Status Gas Bitmap 7	737	Starter Air Pressure OORH	Warning	PCC3300, PCC3300V2
40437	12	Fault Status Gas Bitmap 7	738	Starter Air Press Underpressure Error	Warning	PCC3300, PCC3300V2
40437	13	Fault Status Gas Bitmap 7	741	Air Filter Restriction Pressure High Error	Warning	PCC3300, PCC3300V2
40437	14	Fault Status Gas Bitmap 7	742	Air Filter Restriction Pressure Low Error	Warning	PCC3300, PCC3300V2
40437	15	Fault Status Gas Bitmap 7	751	Gas_Mass_Flow_In_Range_Error	Warning	PCC3300, PCC3300V2
40438	0	Fault Status Gas Bitmap 8	752	Exhaust_Gas_Oxygen_In_Range_Error	Warning	PCC3300, PCC3300V2
40438	1	Fault Status Gas Bitmap 8	783	Intake Manifold 1 Temp Abnormal	Shutdown w/Cooldown	PCC3300, PCC3300V2
40438	2	Fault Status Gas Bitmap 8	1213	COP_Overboost_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40438	3	Fault Status Gas Bitmap 8	1274	Heavy_Knock_Error_10_(B 5)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40438	4	Fault Status Gas Bitmap 8	1281	Heavy_Knock_Error_12_(B 6)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40438	5	Fault Status Gas Bitmap 8	1285	Continuous_Light_Knock_Error_13_(A7)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40438	6	Fault Status Gas Bitmap 8	1286	Heavy_Knock_Error_13_(A 7)	Shutdown w/Cooldown	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40438	7	Fault Status Gas Bitmap 8	1291	Heavy_Knock_Error_14_(B 7)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40438	8	Fault Status Gas Bitmap 8	1295	Continuous_Light_Knock_Error_15_(A8)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40438	9	Fault Status Gas Bitmap 8	1296	Heavy_Knock_Error_15_(A 8)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40438	10	Fault Status Gas Bitmap 8	1311	Heavy_Knock_Error_18_(B 9)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40438	11	Fault Status Gas Bitmap 8	1362	Oil Filter Restriction Error	Warning	PCC3300, PCC3300V2
40438	13	Fault Status Gas Bitmap 8	1457	Fail To Synchronize	Warning	PCC3300, PCC3300V2
40438	14	Fault Status Gas Bitmap 8	1458	Sync Phase Rotation Mismatch	Warning	PCC3300, PCC3300V2
40438	15	Fault Status Gas Bitmap 8	1474	ECM Software mismatch	Shutdown w/Cooldown	PCC3300, PCC3300V2
40439	0	Fault Status Gas Bitmap 9	1521	Exhaust Gas Temp 3 (A2) OORH	Warning	PCC3300, PCC3300V2
40439	1	Fault Status Gas Bitmap 9	1522	Exhaust Gas Temp 5 (A3) OORH	Warning	PCC3300, PCC3300V2
40439	2	Fault Status Gas Bitmap 9	1523	Exhaust Gas Temp 7 (A4) OORH	Warning	PCC3300, PCC3300V2
40439	3	Fault Status Gas Bitmap 9	1524	Exhaust Gas Temp 9 (A5) OORH	Warning	PCC3300, PCC3300V2
40439	4	Fault Status Gas Bitmap 9	1525	Exhaust Gas Temp 11 (A6) OORH	Warning	PCC3300, PCC3300V2
40439	5	Fault Status Gas Bitmap 9	1526	Exhaust Gas Temp 13 (A7) OORH	Warning	PCC3300, PCC3300V2
40439	6	Fault Status Gas Bitmap 9	1527	Exhaust Gas Temp 15 (A8) OORH	Warning	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40439	7	Fault Status Gas Bitmap 9	1528	Exhaust Gas Temp 17 (A9) OORH	Warning	PCC3300, PCC3300V2
40439	8	Fault Status Gas Bitmap 9	1529	Exhaust Gas Temp 2 (B1) OORH	Warning	PCC3300, PCC3300V2
40439	9	Fault Status Gas Bitmap 9	1531	Exhaust Gas Temp 6 (B3) OORH	Warning	PCC3300, PCC3300V2
40439	10	Fault Status Gas Bitmap 9	1532	Exhaust Gas Temp 8 (B4) OORH	Warning	PCC3300, PCC3300V2
40439	11	Fault Status Gas Bitmap 9	1533	Exhaust Gas Temp 10 (B5) OORH	Warning	PCC3300, PCC3300V2
40439	12	Fault Status Gas Bitmap 9	1534	Exhaust Gas Temp 12 (B6) OORH	Warning	PCC3300, PCC3300V2
40439	13	Fault Status Gas Bitmap 9	1535	Exhaust Gas Temp 14 (B7) OORH	Warning	PCC3300, PCC3300V2
40439	14	Fault Status Gas Bitmap 9	1536	Exhaust Gas Temp 16 (B8) OORH	Warning	PCC3300, PCC3300V2
40439	15	Fault Status Gas Bitmap 9	1537	Exhaust Gas Temp 18 (B9) OORH	Warning	PCC3300, PCC3300V2
40440	0	Fault Status Gas Bitmap 10	1545	EPS Backup Channel Lost	Warning	PCC3300, PCC3300V2
40440	1	Fault Status Gas Bitmap 10	1546	EPS Main Channel Lost	Warning	PCC3300, PCC3300V2
40440	2	Fault Status Gas Bitmap 10	1579	Continuous_Light_Knock_Error_12_(B6)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40440	3	Fault Status Gas Bitmap 10	1581	Continuous_Light_Knock_Error_14_(B7)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40440	4	Fault Status Gas Bitmap 10	1582	Continuous_Light_Knock_Error_16_(B8)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40440	5	Fault Status Gas Bitmap 10	1583	Heavy_Knock_Error_16_(B8)	Shutdown w/Cooldown	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40440	6	Fault Status Gas Bitmap 10	1587	Continuous_Light_Knock_Error_17_(A9)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40440	7	Fault Status Gas Bitmap 10	1588	Heavy_Knock_Error_17_(A9)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40440	8	Fault Status Gas Bitmap 10	1593	Continuous_Light_Knock_Error_18_(B9)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40440	9	Fault Status Gas Bitmap 10	1618	Exhaust Gas Temp, Cyl 1 (A1) OORH	Warning	PCC3300, PCC3300V2
40440	10	Fault Status Gas Bitmap 10	1619	Exhaust Gas Temp, Cyl 4 (B2) OORH	Warning	PCC3300, PCC3300V2
40440	11	Fault Status Gas Bitmap 10	1636	Intake Manif Press 2 OORH	Warning	PCC3300, PCC3300V2
40440	12	Fault Status Gas Bitmap 10	1637	Intake Manif Press 2 OORL	Warning	PCC3300, PCC3300V2
40440	13	Fault Status Gas Bitmap 10	1737	CAN_Throttle_Internal_Failure_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40440	14	Fault Status Gas Bitmap 10	1738	CAN_Throttle_Internal_Fault_Error	Warning	PCC3300, PCC3300V2
40440	15	Fault Status Gas Bitmap 10	1739	Engine Throttle Control Condition Exists	Warning	PCC3300, PCC3300V2
40441	0	Fault Status Gas Bitmap 11	1741	CAN_Throttle_High_Temp_Warning_Error	Warning	PCC3300, PCC3300V2
40441	1	Fault Status Gas Bitmap 11	1742	CAN_Throttle_Temp_Limiting_Error	Warning	PCC3300, PCC3300V2
40441	2	Fault Status Gas Bitmap 11	1743	Throttle Ctrl 2 OOR High	Shutdown w/Cooldown	PCC3300, PCC3300V2
40441	3	Fault Status Gas Bitmap 11	1744	Throttle Ctrl 2 OOR Low	Shutdown w/Cooldown	PCC3300, PCC3300V2
40441	4	Fault Status Gas Bitmap 11	1745	Throttle Ctrl 2 Incorrect	Shutdown w/Cooldown	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40441	5	Fault Status Gas Bitmap 11	1746	Throttle Ctrl 2 Out of Adjustment	Shutdown w/Cooldown	PCC3300, PCC3300V2
40441	6	Fault Status Gas Bitmap 11	1747	Throttle Ctrl 2 Bad Device	Shutdown w/Cooldown	PCC3300, PCC3300V2
40441	7	Fault Status Gas Bitmap 11	1748	Throttle Ctrl 2 Root Unknown	Warning	PCC3300, PCC3300V2
40441	8	Fault Status Gas Bitmap 11	1749	Throttle Ctrl 2 Condition Exists	Warning	PCC3300, PCC3300V2
40441	9	Fault Status Gas Bitmap 11	1751	Throttle Ctrl 2 Warning High	Warning	PCC3300, PCC3300V2
40441	10	Fault Status Gas Bitmap 11	1752	Throttle Ctrl 2 Moderate High	Warning	PCC3300, PCC3300V2
40441	11	Fault Status Gas Bitmap 11	1753	Fuel Shutoff 2 OOR High	Warning	PCC3300, PCC3300V2
40441	12	Fault Status Gas Bitmap 11	1754	Fuel Tmp 2 OOR High	Warning	PCC3300, PCC3300V2
40441	13	Fault Status Gas Bitmap 11	1755	Fuel Tmp 2 OOR Low	Warning	PCC3300, PCC3300V2
40441	14	Fault Status Gas Bitmap 11	1756	Gas Flow 2 OOR High	Warning	PCC3300, PCC3300V2
40441	15	Fault Status Gas Bitmap 11	1757	Gas Flow 2 OOR Low	Warning	PCC3300, PCC3300V2
40442	0	Fault Status Gas Bitmap 12	1758	Gas Flow 2 Incorrect Data	Warning	PCC3300, PCC3300V2
40442	1	Fault Status Gas Bitmap 12	1759	FCV 2 Pos Feedback Incorrect	Shutdown w/Cooldown	PCC3300, PCC3300V2
40442	2	Fault Status Gas Bitmap 12	1761	FCV_Actuator_Error_1761	Shutdown w/Cooldown	PCC3300, PCC3300V2
40442	3	Fault Status Gas Bitmap 12	1984	Int Man 2 Tmp Moderate High	Warning	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40442	4	Fault Status Gas Bitmap 12	1765	FCV 2 In Pr OOR High	Warning	PCC3300, PCC3300V2
40442	5	Fault Status Gas Bitmap 12	1766	FCV 2 In Pr OOR Low	Warning	PCC3300, PCC3300V2
40442	6	Fault Status Gas Bitmap 12	1767	FCV 2 Out Pr OOR High	Warning	PCC3300, PCC3300V2
40442	7	Fault Status Gas Bitmap 12	1768	FCV 2 Out Pr OOR Low	Warning	PCC3300, PCC3300V2
40442	8	Fault Status Gas Bitmap 12	1769	E_Shutd Indication OORH	Warning	PCC3300, PCC3300V2
40442	9	Fault Status Gas Bitmap 12	1771	E_Shutd Indication OORL	Warning	PCC3300, PCC3300V2
40442	10	Fault Status Gas Bitmap 12	1772	Eng Derate Request OORH	Warning	PCC3300, PCC3300V2
40442	11	Fault Status Gas Bitmap 12	1773	Eng Derate Request OORL	Warning	PCC3300, PCC3300V2
40442	12	Fault Status Gas Bitmap 12	1774	Oil Priming Pump OORH	Warning	PCC3300, PCC3300V2
40442	13	Fault Status Gas Bitmap 12	1775	Oil Priming Pump OORL	Warning	PCC3300, PCC3300V2
40442	14	Fault Status Gas Bitmap 12	3362	Power Conservation Control OORH	Warning	PCC3300, PCC3300V2
40442	15	Fault Status Gas Bitmap 12	3363	Power Conservation Control OORL	Warning	PCC3300, PCC3300V2
40443	0	Fault Status Gas Bitmap 13	1778	Engine_Heater_Control_Driver_High_Error	Warning	PCC3300, PCC3300V2
40443	1	Fault Status Gas Bitmap 13	1779	Engine_Heater_Control_Driver_Low_Error	Warning	PCC3300, PCC3300V2
40443	2	Fault Status Gas Bitmap 13	1781	Shutd Request OOR High	Warning	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40443	3	Fault Status Gas Bitmap 13	1782	Shutd Request OOR Low	Warning	PCC3300, PCC3300V2
40443	4	Fault Status Gas Bitmap 13	1783	Coolant_Pump_Control_Driver_High_Error	Warning	PCC3300, PCC3300V2
40443	5	Fault Status Gas Bitmap 13	1784	Coolant_Pump_Control_Driver_Low_Error	Warning	PCC3300, PCC3300V2
40443	6	Fault Status Gas Bitmap 13	1785	Oil_Priming_Pump_Manual_Override_Input_On	Warning	PCC3300, PCC3300V2
40443	7	Fault Status Gas Bitmap 13	1786	Oil_Priming_Pump_Stuck_On_Error	Warning	PCC3300, PCC3300V2
40443	8	Fault Status Gas Bitmap 13	1787	Post_Lube_Oil_Priming_Error	Warning	PCC3300, PCC3300V2
40443	9	Fault Status Gas Bitmap 13	1788	Maintenance_Lube_Oil_Priming_Error	Warning	PCC3300, PCC3300V2
40443	10	Fault Status Gas Bitmap 13	1789	Pre_Start_Lube_Oil_Priming_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40443	11	Fault Status Gas Bitmap 13	1791	Failure_To_Meet_Load_Speed_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40443	12	Fault Status Gas Bitmap 13	1792	Idle when CB Closed	Warning	PCC3300, PCC3300V2
40443	13	Fault Status Gas Bitmap 13	1793	Speed/Posit sensor out of Adj	Warning	PCC3300, PCC3300V2
40443	14	Fault Status Gas Bitmap 13	1794	Fire Detected	Shutdown	PCC3300, PCC3300V2
40443	15	Fault Status Gas Bitmap 13	1795	Compressor_Bypass_Position_High_Error	Warning	PCC3300, PCC3300V2
40444	0	Fault Status Gas Bitmap 14	1796	Compressor_Bypass_Position_Low_Error	Warning	PCC3300, PCC3300V2
40444	1	Fault Status Gas Bitmap 14	1797	Compressor Bypass ctrl OORH	Warning	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40444	2	Fault Status Gas Bitmap 14	1798	Compressor Bypass ctrl OORL	Warning	PCC3300, PCC3300V2
40444	3	Fault Status Gas Bitmap 14	1799	CB_Position_Err_Status	Warning	PCC3300, PCC3300V2
40444	4	Fault Status Gas Bitmap 14	1811	HIGH_SIDE_DRV2_High_Control_Error (VPS)	Warning	PCC3300, PCC3300V2
40444	5	Fault Status Gas Bitmap 14	1812	HIGH_SIDE_DRV2_Low_Control_Error (VPS)	Warning	PCC3300, PCC3300V2
40444	6	Fault Status Gas Bitmap 14	1813	Valve_Proving_System_Test_Failed_Warning_Error	Warning	PCC3300, PCC3300V2
40444	7	Fault Status Gas Bitmap 14	1814	Valve_Proving_System_Test_Failed_Shutdown_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40444	8	Fault Status Gas Bitmap 14	1815	RLY14_High_Control_Error	Warning	PCC3300, PCC3300V2
40444	9	Fault Status Gas Bitmap 14	1816	Oil PreHtr Ctrl OOR Low	Warning	PCC3300, PCC3300V2
40444	10	Fault Status Gas Bitmap 14	1817	Oil_Pre-Heater_Tripped_Error	Warning	PCC3300, PCC3300V2
40444	11	Fault Status Gas Bitmap 14	1818	Oil_Pre-Heater_Not_Warming_Error	Warning	PCC3300, PCC3300V2
40444	12	Fault Status Gas Bitmap 14	1819	Common AC Aux CB tripped	Warning	PCC3300, PCC3300V2
40444	13	Fault Status Gas Bitmap 14	1821	Min_FSO_Speed_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40444	14	Fault Status Gas Bitmap 14	1822	LT Coolant Level Low Shutdown Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40444	15	Fault Status Gas Bitmap 14	1823	LT Coolant Level Low Warning Error	Warning	PCC3300, PCC3300V2
40445	0	Fault Status Gas Bitmap 15	1824	Idle_Rated_Trans_Oil_Temp_Low_Error	Warning	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40445	1	Fault Status Gas Bitmap 15	1825	Dirty_Oil_Level_Error	Warning	PCC3300, PCC3300V2
40445	2	Fault Status Gas Bitmap 15	1826	ECM Software incompatible	Shutdown w/Cooldown	PCC3300, PCC3300V2
40445	3	Fault Status Gas Bitmap 15	1827	Fuel_Inlet_Pressure_High_Error	Warning	PCC3300, PCC3300V2
40445	4	Fault Status Gas Bitmap 15	1828	Fuel_Inlet_Pressure_Low_Error	Warning	PCC3300, PCC3300V2
40445	5	Fault Status Gas Bitmap 15	1829	Vent_Gas_Valve_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40445	6	Fault Status Gas Bitmap 15	1831	Upstream_FSO_Valve_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40445	7	Fault Status Gas Bitmap 15	1832	Downstream_FSO_Valve_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40445	8	Fault Status Gas Bitmap 15	1833	Engine_Heater_Trip_Error	Warning	PCC3300, PCC3300V2
40445	9	Fault Status Gas Bitmap 15	1834	Coolant_Pump_Trip_Error	Warning	PCC3300, PCC3300V2
40445	10	Fault Status Gas Bitmap 15	1835	Oil_Priming_Pump_Tripped_Error	Warning	PCC3300, PCC3300V2
40445	11	Fault Status Gas Bitmap 15	1836	LCP_(LT)_Low_Serious_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40445	12	Fault Status Gas Bitmap 15	1837	Permanent_FS_Cam_Sync_Lost_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40445	13	Fault Status Gas Bitmap 15	1838	Partial_Engine_Overload_Shutdown_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40445	14	Fault Status Gas Bitmap 15	1839	Fuel_Supply_Pressure_High_Error	Warning	PCC3300, PCC3300V2
40445	15	Fault Status Gas Bitmap 15	1841	Fuel_Supply_Pressure_Low_Error	Warning	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40446	0	Fault Status Gas Bitmap 16	1842	Radiator_Fan_Trip_Error	Warning	PCC3300, PCC3300V2
40446	1	Fault Status Gas Bitmap 16	1858	Exhaust Aft Inlet O2 OOR High	Warning	PCC3300, PCC3300V2
40446	2	Fault Status Gas Bitmap 16	1859	Exhaust Aft Inlet O2 OOR Low	Warning	PCC3300, PCC3300V2
40446	3	Fault Status Gas Bitmap 16	1861	Exhaust Aft Inlet O2 Incorrect	Warning	PCC3300, PCC3300V2
40446	4	Fault Status Gas Bitmap 16	1862	Exhaust Aft Out O2 OOR High	Warning	PCC3300, PCC3300V2
40446	5	Fault Status Gas Bitmap 16	1863	Exhaust Aft Outlet O2 OOR Low	Warning	PCC3300, PCC3300V2
40446	6	Fault Status Gas Bitmap 16	1864	Exhaust Aft Outlet O2 Incorrect	Warning	PCC3300, PCC3300V2
40446	7	Fault Status Gas Bitmap 16	1985	Int Man 3 Tmp Moderate High	Warning	PCC3300, PCC3300V2
40446	8	Fault Status Gas Bitmap 16	1986	Int Man 4 Tmp Moderate High	Warning	PCC3300, PCC3300V2
40446	9	Fault Status Gas Bitmap 16	2111	Coolant_Inlet_Temperature_(LT)_High_Error	Warning	PCC3300, PCC3300V2
40446	10	Fault Status Gas Bitmap 16	2112	Coolant_Inlet_Temperature_(LT)_Low_Error	Warning	PCC3300, PCC3300V2
40446	11	Fault Status Gas Bitmap 16	2113	CIT_(LT)_High_Warning_Error	Warning	PCC3300, PCC3300V2
40446	12	Fault Status Gas Bitmap 16	2114	CIT_(LT)_High_Serious_Error	Shutdown	PCC3300, PCC3300V2
40446	13	Fault Status Gas Bitmap 16	2115	LT_Coolant_Pressure_High_Error	Warning	PCC3300, PCC3300V2
40446	14	Fault Status Gas Bitmap 16	2116	LT_Coolant_Pressure_Low_Error	Warning	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40446	15	Fault Status Gas Bitmap 16	2117	LCP_(LT)_Low_Warning_Error	Warning	PCC3300, PCC3300V2
40447	0	Fault Status Gas Bitmap 17	2121	Exhaust_Temp_1_(A1)_High_Warning_Error	Warning	PCC3300, PCC3300V2
40447	1	Fault Status Gas Bitmap 17	2122	Exhaust_Temp_3_(A2)_High_Warning_Error	Warning	PCC3300, PCC3300V2
40447	2	Fault Status Gas Bitmap 17	2123	Exhaust_Temp_5_(A3)_High_Warning_Error	Warning	PCC3300, PCC3300V2
40447	3	Fault Status Gas Bitmap 17	2124	Exhaust_Temp_7_(A4)_High_Warning_Error	Warning	PCC3300, PCC3300V2
40447	4	Fault Status Gas Bitmap 17	2125	Exhaust_Temp_9_(A5)_High_Warning_Error	Warning	PCC3300, PCC3300V2
40447	5	Fault Status Gas Bitmap 17	2126	Exhaust_Temp_11_(A6)_High_Warning_Error	Warning	PCC3300, PCC3300V2
40447	6	Fault Status Gas Bitmap 17	2127	Exhaust_Temp_13_(A7)_High_Warning_Error	Warning	PCC3300, PCC3300V2
40447	7	Fault Status Gas Bitmap 17	2128	Exhaust_Temp_15_(A8)_High_Warning_Error	Warning	PCC3300, PCC3300V2
40447	8	Fault Status Gas Bitmap 17	2129	Exhaust_Temp_17_(A9)_High_Warning_Error	Warning	PCC3300, PCC3300V2
40447	9	Fault Status Gas Bitmap 17	2131	Exhaust_Temp_2_(B1)_High_Warning_Error	Warning	PCC3300, PCC3300V2
40447	10	Fault Status Gas Bitmap 17	2132	Exhaust_Temp_4_(B2)_High_Warning_Error	Warning	PCC3300, PCC3300V2
40447	11	Fault Status Gas Bitmap 17	2133	Exhaust_Temp_6_(B3)_High_Warning_Error	Warning	PCC3300, PCC3300V2
40447	12	Fault Status Gas Bitmap 17	2134	Exhaust_Temp_8_(B4)_High_Warning_Error	Warning	PCC3300, PCC3300V2
40447	13	Fault Status Gas Bitmap 17	2135	Exhaust_Temp_10_(B5)_High_Warning_Error	Warning	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40447	14	Fault Status Gas Bitmap 17	2136	Exhaust_Temp_12_(B6)_High_Warning_Error	Warning	PCC3300, PCC3300V2
40447	15	Fault Status Gas Bitmap 17	2137	Exhaust_Temp_14_(B7)_High_Warning_Error	Warning	PCC3300, PCC3300V2
40448	0	Fault Status Gas Bitmap 18	2138	Exhaust_Temp_16_(B8)_High_Warning_Error	Warning	PCC3300, PCC3300V2
40448	1	Fault Status Gas Bitmap 18	2139	Exhaust_Temp_18_(B9)_High_Warning_Error	Warning	PCC3300, PCC3300V2
40448	2	Fault Status Gas Bitmap 18	2141	Start_Air_Pressure_High_Error	Warning	PCC3300, PCC3300V2
40448	3	Fault Status Gas Bitmap 18	2142	Start_Air_Pressure_Low_Error	Warning	PCC3300, PCC3300V2
40448	4	Fault Status Gas Bitmap 18	2143	SAP_Overpressure_Error	Warning	PCC3300, PCC3300V2
40448	5	Fault Status Gas Bitmap 18	2144	Exhaust Temp 16 (B8) High Serious Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40448	6	Fault Status Gas Bitmap 18	2145	Exhaust Temp 18 (B9) High Serious Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40448	7	Fault Status Gas Bitmap 18	2146	EGT 17 (A9) OOR Low	Warning	PCC3300, PCC3300V2
40448	8	Fault Status Gas Bitmap 18	2147	EGT 18 (B9) OOR Low	Warning	PCC3300, PCC3300V2
40448	9	Fault Status Gas Bitmap 18	2154	Oil_Filter_Outlet_Pressure_High_Error	Warning	PCC3300, PCC3300V2
40448	10	Fault Status Gas Bitmap 18	2155	Oil_Filter_Outlet_Pressure_Low_Error	Warning	PCC3300, PCC3300V2
40448	11	Fault Status Gas Bitmap 18	2157	Int Man 2 Tmp Abnormal Rate	Shutdown w/Cooldown	PCC3300, PCC3300V2
40448	12	Fault Status Gas Bitmap 18	2158	Int Man 3 Tmp Abnormal Rate	Shutdown w/Cooldown	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40448	13	Fault Status Gas Bitmap 18	2159	Int Man 4 Tmp Abnormal Rate	Shutdown w/Cooldown	PCC3300, PCC3300V2
40448	14	Fault Status Gas Bitmap 18	2188	Exhaust O2 OOR High	Warning	PCC3300, PCC3300V2
40448	15	Fault Status Gas Bitmap 18	2191	ST_Throttle_Press_Err_Stat us	Warning	PCC3300, PCC3300V2
40449	0	Fault Status Gas Bitmap 19	2192	Exhaust O2 OOR Low	Warning	PCC3300, PCC3300V2
40449	1	Fault Status Gas Bitmap 19	2217	RAM_Image_Word_Error	Warning	PCC3300, PCC3300V2
40449	2	Fault Status Gas Bitmap 19	2219	Exhaust O2 Moderate High	Warning	PCC3300, PCC3300V2
40449	3	Fault Status Gas Bitmap 19	2221	Exhaust O2 Moderate Low	Warning	PCC3300, PCC3300V2
40449	4	Fault Status Gas Bitmap 19	2281	Knock 11 (A6) Moderate High	Shutdown w/Cooldown	PCC3300, PCC3300V2
40449	5	Fault Status Gas Bitmap 19	2282	Knock 11 (A6) Critical High	Shutdown w/Cooldown	PCC3300, PCC3300V2
40449	6	Fault Status Gas Bitmap 19	2298	Fuel Shutoff 2 OOR Low	Warning	PCC3300, PCC3300V2
40449	7	Fault Status Gas Bitmap 19	2315	Red Lamp OOR High	Warning	PCC3300, PCC3300V2
40449	8	Fault Status Gas Bitmap 19	2316	Amber Lamp OOR High	Warning	PCC3300, PCC3300V2
40449	9	Fault Status Gas Bitmap 19	2317	Amber Lamp OOR Low	Warning	PCC3300, PCC3300V2
40449	10	Fault Status Gas Bitmap 19	2427	Fuel_Outlet_Pressure_High_Error	Warning	PCC3300, PCC3300V2
40449	11	Fault Status Gas Bitmap 19	2428	Fuel_Outlet_Pressure_Low_Error	Warning	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40449	12	Fault Status Gas Bitmap 19	2453	Total Real Power Circuit OORH	Warning	PCC3300, PCC3300V2
40449	13	Fault Status Gas Bitmap 19	2454	Total Real Power Circuit OORL	Warning	PCC3300, PCC3300V2
40449	14	Fault Status Gas Bitmap 19	2455	Speed_Bias_Low_Error	Warning	PCC3300, PCC3300V2
40449	15	Fault Status Gas Bitmap 19	2456	Speed_Bias_High_Error	Warning	PCC3300, PCC3300V2
40450	0	Fault Status Gas Bitmap 20	2457	Max_Total_Misfire_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40450	1	Fault Status Gas Bitmap 20	2458	Cylinder_2_(B1)_Total_Misfire_Error	Warning	PCC3300, PCC3300V2
40450	2	Fault Status Gas Bitmap 20	2459	Cylinder_4_(B2)_Total_Misfire_Error	Warning	PCC3300, PCC3300V2
40450	3	Fault Status Gas Bitmap 20	2461	Cylinder_6_(B3)_Total_Misfire_Error	Warning	PCC3300, PCC3300V2
40450	4	Fault Status Gas Bitmap 20	2462	Cylinder_8_(B4)_Total_Misfire_Error	Warning	PCC3300, PCC3300V2
40450	5	Fault Status Gas Bitmap 20	2463	Cylinder_10_(B5)_Total_Misfire_Error	Warning	PCC3300, PCC3300V2
40450	6	Fault Status Gas Bitmap 20	2464	Cylinder_12_(B6)_Total_Misfire_Error	Warning	PCC3300, PCC3300V2
40450	7	Fault Status Gas Bitmap 20	2465	Cylinder_14_(B7)_Total_Misfire_Error	Warning	PCC3300, PCC3300V2
40450	8	Fault Status Gas Bitmap 20	2466	Cylinder_16_(B8)_Total_Misfire_Error	Warning	PCC3300, PCC3300V2
40450	9	Fault Status Gas Bitmap 20	2467	Cylinder_18_(B9)_Total_Misfire_Error	Warning	PCC3300, PCC3300V2
40450	10	Fault Status Gas Bitmap 20	2469	Cylinder_1_(A1)_Total_Misfire_Error	Warning	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40450	11	Fault Status Gas Bitmap 20	2471	Cylinder_3_(A2)_Total_Misfire_Error	Warning	PCC3300, PCC3300V2
40450	12	Fault Status Gas Bitmap 20	2472	Cylinder_5_(A3)_Total_Misfire_Error	Warning	PCC3300, PCC3300V2
40450	13	Fault Status Gas Bitmap 20	2473	Cylinder_7_(A4)_Total_Misfire_Error	Warning	PCC3300, PCC3300V2
40450	14	Fault Status Gas Bitmap 20	2475	Cylinder_9_(A5)_Total_Misfire_Error	Warning	PCC3300, PCC3300V2
40450	15	Fault Status Gas Bitmap 20	2476	Cylinder_11_(A6)_Total_Misfire_Error	Warning	PCC3300, PCC3300V2
40451	0	Fault Status Gas Bitmap 21	2477	Cylinder_13_(A7)_Total_Misfire_Error	Warning	PCC3300, PCC3300V2
40451	1	Fault Status Gas Bitmap 21	2478	Cylinder_15_(A8)_Total_Misfire_Error	Warning	PCC3300, PCC3300V2
40451	2	Fault Status Gas Bitmap 21	2479	Cylinder_17_(A9)_Total_Misfire_Error	Warning	PCC3300, PCC3300V2
40451	3	Fault Status Gas Bitmap 21	2482	Start_Before_Ready_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40451	4	Fault Status Gas Bitmap 21	2483	Continuous_Starter_Failure_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40451	5	Fault Status Gas Bitmap 21	2484	Exhaust Temperature 1 (A1) Abnormal Rate	Shutdown w/Cooldown	PCC3300, PCC3300V2
40451	6	Fault Status Gas Bitmap 21	2485	Exhaust Temperature 3 (A2) Abnormal Rate	Shutdown w/Cooldown	PCC3300, PCC3300V2
40451	7	Fault Status Gas Bitmap 21	2486	Exhaust Temperature 5 (A3) Abnormal Rate	Shutdown w/Cooldown	PCC3300, PCC3300V2
40451	8	Fault Status Gas Bitmap 21	2487	Exhaust Temperature 7 (A4) Abnormal Rate	Shutdown w/Cooldown	PCC3300, PCC3300V2
40451	9	Fault Status Gas Bitmap 21	2488	Exhaust Temperature 9 (A5) Abnormal Rate	Shutdown w/Cooldown	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40451	10	Fault Status Gas Bitmap 21	2489	Exhaust Temperature 11 (A6) Abnormal Rate	Shutdown w/Cooldown	PCC3300, PCC3300V2
40451	11	Fault Status Gas Bitmap 21	2491	Exhaust Temperature 13 (A7) Abnormal Rate	Shutdown w/Cooldown	PCC3300, PCC3300V2
40451	12	Fault Status Gas Bitmap 21	2492	Exhaust Temperature 15 (A8) Abnormal Rate	Shutdown w/Cooldown	PCC3300, PCC3300V2
40451	13	Fault Status Gas Bitmap 21	2493	Exhaust Temperature 17 (A9) Abnormal Rate	Shutdown w/Cooldown	PCC3300, PCC3300V2
40451	14	Fault Status Gas Bitmap 21	2494	Exhaust Temperature 2 (B1) Abnormal Rate	Shutdown w/Cooldown	PCC3300, PCC3300V2
40451	15	Fault Status Gas Bitmap 21	2495	Exhaust Temperature 4 (B2) Abnormal Rate	Shutdown w/Cooldown	PCC3300, PCC3300V2
40452	0	Fault Status Gas Bitmap 22	2496	Exhaust Temperature 6 (B3) Abnormal Rate	Shutdown w/Cooldown	PCC3300, PCC3300V2
40452	1	Fault Status Gas Bitmap 22	2497	Exhaust Temperature 8 (B4) Abnormal Rate	Shutdown w/Cooldown	PCC3300, PCC3300V2
40452	2	Fault Status Gas Bitmap 22	2498	Exhaust Temperature 10 (B5) Abnormal Rate	Shutdown w/Cooldown	PCC3300, PCC3300V2
40452	3	Fault Status Gas Bitmap 22	2499	Exhaust Temperature 12 (B6) Abnormal Rate	Shutdown w/Cooldown	PCC3300, PCC3300V2
40452	4	Fault Status Gas Bitmap 22	2511	Exhaust Temperature 14 (B7) Abnormal Rate	Shutdown w/Cooldown	PCC3300, PCC3300V2
40452	5	Fault Status Gas Bitmap 22	2512	Exhaust Temperature 16 (B8) Abnormal Rate	Shutdown w/Cooldown	PCC3300, PCC3300V2
40452	6	Fault Status Gas Bitmap 22	2513	Exhaust Temperature 18 (B9) Abnormal Rate	Shutdown w/Cooldown	PCC3300, PCC3300V2
40452	7	Fault Status Gas Bitmap 22	2517	Compressor_Outlet_Pressure_High_Error	Warning	PCC3300, PCC3300V2
40452	8	Fault Status Gas Bitmap 22	2518	Compressor_Outlet_Pressure_Low_Error	Warning	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40452	9	Fault Status Gas Bitmap 22	2521	Bank_Id_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40452	10	Fault Status Gas Bitmap 22	2522	Continuous_Light_Knock_Error_1_(A1)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40452	11	Fault Status Gas Bitmap 22	2523	Continuous_Light_Knock_Error_2_(B1)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40452	12	Fault Status Gas Bitmap 22	2524	Continuous_Light_Knock_Error_3_(A2)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40452	13	Fault Status Gas Bitmap 22	2525	Continuous_Light_Knock_Error_4_(B2)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40452	14	Fault Status Gas Bitmap 22	2526	Continuous_Light_Knock_Error_5_(A3)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40452	15	Fault Status Gas Bitmap 22	2527	Continuous_Light_Knock_Error_6_(B3)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40453	0	Fault Status Gas Bitmap 23	2528	Continuous_Light_Knock_Error_7_(A4)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40453	1	Fault Status Gas Bitmap 23	2529	Continuous_Light_Knock_Error_8_(B4)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40453	2	Fault Status Gas Bitmap 23	2531	Continuous_Light_Knock_Error_9_(A5)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40453	3	Fault Status Gas Bitmap 23	2532	Continuous_Light_Knock_Error_10_(B5)	Shutdown w/Cooldown	PCC3300, PCC3300V2
40453	4	Fault Status Gas Bitmap 23	2544	ECM_Overtemp_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40453	5	Fault Status Gas Bitmap 23	2567	DG_Air_Compressor_Trip_Error	Warning	PCC3300, PCC3300V2
40453	6	Fault Status Gas Bitmap 23	2643	Throttle Pos 2 Feedback OOR High	Warning	PCC3300, PCC3300V2
40453	7	Fault Status Gas Bitmap 23	2644	Throttle Pos 2 Feedback OOR Low	Warning	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40453	9	Fault Status Gas Bitmap 23	2724	Gas Supply Pr Moderate High	Warning	PCC3300, PCC3300V2
40453	10	Fault Status Gas Bitmap 23	2725	Gas Supply Pr Moderate Low	Warning	PCC3300, PCC3300V2
40453	11	Fault Status Gas Bitmap 23	2737	Exh Gas Tmp Critical High	Shutdown w/Cooldown	PCC3300, PCC3300V2
40453	12	Fault Status Gas Bitmap 23	2766	Bank_A_CCD_Failed_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40453	13	Fault Status Gas Bitmap 23	2767	Bank_B_CCD_Failed_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40453	14	Fault Status Gas Bitmap 23	2768	CAN Parent Communication Incorrect	Shutdown w/Cooldown	PCC3300, PCC3300V2
40453	15	Fault Status Gas Bitmap 23	2769	CAN Child Com Incorrect	Shutdown w/Cooldown	PCC3300, PCC3300V2
40454	0	Fault Status Gas Bitmap 24	2789	COT_Low_Error	Warning	PCC3300, PCC3300V2
40454	1	Fault Status Gas Bitmap 24	2793	COT_Low_Serious_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40454	2	Fault Status Gas Bitmap 24	2794	Ign Shutd Relay OOR High	Warning	PCC3300, PCC3300V2
40454	3	Fault Status Gas Bitmap 24	2795	Ign Shutd Relay OOR Low	Warning	PCC3300, PCC3300V2
40454	4	Fault Status Gas Bitmap 24	2796	Partial_Engine_Overload_Warning_Error	Warning	PCC3300, PCC3300V2
40454	5	Fault Status Gas Bitmap 24	2797	Inlet Gas Diff Pressure OOR High	Warning	PCC3300, PCC3300V2
40454	6	Fault Status Gas Bitmap 24	2798	Inlet Gas Diff Pressure OOR Low	Warning	PCC3300, PCC3300V2
40454	7	Fault Status Gas Bitmap 24	2799	IMOP_Compressor_Outlet_Presure_Delta_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40454	8	Fault Status Gas Bitmap 24	2811	IMOP_Compressor_Outlet_Pressure_Maximum_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40454	9	Fault Status Gas Bitmap 24	2837	Exhaust_Temp_1_(A1)_Deviation_Error	Warning	PCC3300, PCC3300V2
40454	10	Fault Status Gas Bitmap 24	2838	Exhaust_Temp_3_(A2)_Deviation_Error	Warning	PCC3300, PCC3300V2
40454	11	Fault Status Gas Bitmap 24	2839	Exhaust_Temp_5_(A3)_Deviation_Error	Warning	PCC3300, PCC3300V2
40454	12	Fault Status Gas Bitmap 24	2841	Exhaust_Temp_7_(A4)_Deviation_Error	Warning	PCC3300, PCC3300V2
40454	13	Fault Status Gas Bitmap 24	2842	Exhaust_Temp_9_(A5)_Deviation_Error	Warning	PCC3300, PCC3300V2
40454	14	Fault Status Gas Bitmap 24	2843	Exhaust_Temp_11_(A6)_Deviation_Error	Warning	PCC3300, PCC3300V2
40454	15	Fault Status Gas Bitmap 24	2844	Exhaust_Temp_13_(A7)_Deviation_Error	Warning	PCC3300, PCC3300V2
40455	0	Fault Status Gas Bitmap 25	2845	Exhaust_Temp_15_(A8)_Deviation_Error	Warning	PCC3300, PCC3300V2
40455	1	Fault Status Gas Bitmap 25	2846	Exhaust_Temp_17_(A9)_Deviation_Error	Warning	PCC3300, PCC3300V2
40455	2	Fault Status Gas Bitmap 25	2847	Exhaust_Temp_2_(B1)_Deviation_Error	Warning	PCC3300, PCC3300V2
40455	3	Fault Status Gas Bitmap 25	2848	Exhaust_Temp_4_(B2)_Deviation_Error	Warning	PCC3300, PCC3300V2
40455	4	Fault Status Gas Bitmap 25	2849	Exhaust_Temp_6_(B3)_Deviation_Error	Warning	PCC3300, PCC3300V2
40455	5	Fault Status Gas Bitmap 25	2851	Exhaust_Temp_8_(B4)_Deviation_Error	Warning	PCC3300, PCC3300V2
40455	6	Fault Status Gas Bitmap 25	2852	Exhaust_Temp_10_(B5)_Deviation_Error	Warning	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
40455	7	Fault Status Gas Bitmap 25	2853	Exhaust_Temp_12_(B6)_Deviation_Error	Warning	PCC3300, PCC3300V2
40455	8	Fault Status Gas Bitmap 25	2854	Exhaust_Temp_14_(B7)_Deviation_Error	Warning	PCC3300, PCC3300V2
40455	9	Fault Status Gas Bitmap 25	2855	Exhaust_Temp_16_(B8)_Deviation_Error	Warning	PCC3300, PCC3300V2
40455	10	Fault Status Gas Bitmap 25	2856	Exhaust_Temp_18_(B9)_Deviation_Error	Warning	PCC3300, PCC3300V2
40455	11	Fault Status Gas Bitmap 25	2857	Turbo_1_Overspeed_Critical_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40455	12	Fault Status Gas Bitmap 25	2858	Turbo_2_Overspeed_Critical_Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
40455	13	Fault Status Gas Bitmap 25	2859	Alt Heater Ctrl OOR High	Warning	PCC3300, PCC3300V2
40455	14	Fault Status Gas Bitmap 25	2861	Alt Heater Ctrl OOR Low	Warning	PCC3300, PCC3300V2
40455	15	Fault Status Gas Bitmap 25	2862	Gen Alternator 1st Start Cond Exists	Warning	PCC3300, PCC3300V2

TABLE 69.

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
41400	0	Fault Status Bitmap 31	479	Exhaust Gas Temperature Data Incorrect	Warning	PCC3300, PCC3300V2
41400	1	Fault Status Bitmap 31	2343	Fuel Filter Press Hi Above Normal	NONE	PCC3300, PCC3300V2
41400	2	Fault Status Bitmap 31	2442	Inj Solenoid Driver 1 Calib Error	Warning	PCC3300, PCC3300V2
41400	3	Fault Status Bitmap 31	2443	Inj Solenoid Driver 2 Calib Error	Warning	PCC3300, PCC3300V2
41400	4	Fault Status Bitmap 31	2444	Inj Solenoid Driver 3 Calib Error	Warning	PCC3300, PCC3300V2
41400	5	Fault Status Bitmap 31	2445	Inj Solenoid Driver 4 Calib Error	Warning	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
41400	6	Fault Status Bitmap 31	2446	Inj Solenoid Driver 5 Calib Error	Warning	PCC3300, PCC3300V2
41400	7	Fault Status Bitmap 31	2447	Inj Solenoid Driver 6 Calib Error	Warning	PCC3300, PCC3300V2
41400	8	Fault Status Bitmap 31	3329	J1939 Network 2 Data Incorrect	NONE	PCC3300, PCC3300V2
41400	9	Fault Status Bitmap 31	3331	J1939 Network 3 Data Incorrect	NONE	PCC3300, PCC3300V2
41400	10	Fault Status Bitmap 31	4437	J1939 Network 4 Data Incorrect	NONE	PCC3300, PCC3300V2
41400	11	Fault Status Bitmap 31	5377	AUX101-3 Communication Lost Fault	Warning	PCC3300, PCC3300V2
41400	12	Fault Status Bitmap 31	5378	AUX101-4 Communication Lost Fault	Warning	PCC3300, PCC3300V2
41400	13	Fault Status Bitmap 31	5287	Starter Air Supply Pressure Low	Warning	PCC3300, PCC3300V2
41400	14	Fault Status Bitmap 31	5288	Starter Air Tank Volume Low	Warning	PCC3300, PCC3300V2
41400	15	Fault Status Bitmap 31	5148	Allow Start Override Active Cond Exists	Warning	PCC3300, PCC3300V2
41401	0	Fault Status Bitmap 33	4952	Maintain ECU Power Lamp OOR Low	Warning	PCC3300, PCC3300V2
41401	1	Fault Status Bitmap 33	4956	Turbocharger Actuator S/W Out of Calibration	Warning	PCC3300, PCC3300V2
41401	2	Fault Status Bitmap 33	4957	Variable Geometry Turbocharger Actuator Software	Warning	PCC3300, PCC3300V2
41401	3	Fault Status Bitmap 33	5177	VGT Actuator Driver Circuit Abnormal update rate	Warning	PCC3300, PCC3300V2
41401	4	Fault Status Bitmap 33	5576	Engine Air Filter Differential Press Least Severe	Warning	PCC3300, PCC3300V2
41401	5	Fault Status Bitmap 33	5585	Fuel Filter Differential Press Moderately Severe	Warning	PCC3300, PCC3300V2
41401	6	Fault Status Bitmap 33	1867	Exhaust Gas Recirculation Temperature Error	Warning	PCC3300, PCC3300V2
41401	7	Fault Status Bitmap 33	2998	Engine Torque Limit Feature Special Instructions	Warning	PCC3300, PCC3300V2
41401	8	Fault Status Bitmap 33	3614	Coolant Level Sensor Received N/W Data in Error	Warning	PCC3300, PCC3300V2
41401	9	Fault Status Bitmap 33	2448	COOLANT_LEVEL_MODE RATELY_LOW	Warning	PCC3300, PCC2300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
41401	10	Fault Status Bitmap 33	3633	Engine Fan Clutch 2 Control Circuit OOR High	Warning	PCC3300, PCC3300V2
41401	11	Fault Status Bitmap 33	3634	Engine Fan Clutch 2 Control Circuit OOR Low	Warning	PCC3300, PCC3300V2
41401	12	Fault Status Bitmap 33	4265	High Press Common Rail Fuel Press Relief Valve Err	Warning	PCC3300, PCC3300V2
41401	13	Fault Status Bitmap 33	4789	Fan Speed High - Most Severe Level	Warning	PCC3300, PCC3300V2
41401	14	Fault Status Bitmap 33	3341	Engine Air Filter Differential Pressure High	Warning	PCC3300, PCC3300V2
41401	15	Fault Status Bitmap 33	4791	Fan Speed Low - Most Severe Level	Warning	PCC3300, PCC3300V2
41402	0	Fault Status Bitmap 34	3543	NOx limits exceeded - Cond Exists	Warning	PCC3300, PCC3300V2
41402	1	Fault Status Bitmap 34	3555	Engine Wait to Start Lamp - Abnormal	Warning	PCC3300, PCC3300V2
41402	2	Fault Status Bitmap 34	2412	Fan Speed Error	Shutdown w/Cooldown	PCC3300, PCC3300V2
41402	3	Fault Status Bitmap 34	4951	Maintain ECU Power Lamp OOR High	Warning	PCC3300, PCC3300V2
41402	4	Fault Status Bitmap 34	4262	HPCR Fuel Pressure Relief Valve OOR High	Warning	PCC3300, PCC3300V2
41402	5	Fault Status Bitmap 34	4263	HPCR Fuel Pressure Relief Valve OOR Low	Warning	PCC3300, PCC3300V2
41402	7	Fault Status Bitmap 34	4867	HPCR Fuel Pressure Relief Valve - Condition Exists	Warning	PCC3300, PCC3300V2
41402	8	Fault Status Bitmap 34	2662	At Least One ACK:Mod Severe Fault	Warning	PCC3300, PCC2300, PCC3300V2
41402	9	Fault Status Bitmap 34	581	Fuel Pump Intake Pressure Sensor OOR Hi	Warning	PCC3300, PCC3300V2
41402	10	Fault Status Bitmap 34	582	Fuel Pump Intake Pressure Sensor OOR Lo	Warning	PCC3300, PCC3300V2
41402	11	Fault Status Bitmap 34	583	Low Fuel Pump Intake Pressure	Warning	PCC3300, PCC3300V2
41402	12	Fault Status Bitmap 34	1379	Low Fuel Pump Intake Pressure - None severity	NONE	PCC3300, PCC3300V2
41402	13	Fault Status Bitmap 34	1389	High Fuel Pump Intake Pressure	NONE	PCC3300, PCC3300V2
41402	14	Fault Status Bitmap 34	5134	Unknown Shutdown at Idle	Shutdown	PCC3300, PCC2300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
41402	15	Fault Status Bitmap 34	5637	Unknown Shutdown at Startup	Shutdown	PCC3300, PCC2300, PCC3300V2
41403	0	AT Fault Status Bitmap 2	1887	AT1 Outlet NOx Sensor Circuit OOR Low	Warning	PCC3300, PCC3300V2
41403	1	AT Fault Status Bitmap 2	4534	AT1 DOC Intake Temp Sensor Circuit OOR Low	Warning	PCC3300, PCC3300V2
41403	2	AT Fault Status Bitmap 2	4731	AT1 DEF Tank Temp Sensor Out of Calibration	Warning	PCC3300, PCC3300V2
41403	3	AT Fault Status Bitmap 2	2771	Aftertreatment 1 Outlet NOx Sensor Abnormal	Warning	PCC3300, PCC3300V2
41403	4	AT Fault Status Bitmap 2	4732	AT1 DEF Tank Level Sensor Out of Calibration	Warning	PCC3300, PCC3300V2
41403	5	AT Fault Status Bitmap 2	2976	AT1 Diesel Exhaust Fluid Dosing Unit Temp. Error	Warning	PCC3300, PCC3300V2
41403	6	AT Fault Status Bitmap 2	3142	AT1 SCR Intake Temp. Sensor Circuit OOR High	Warning	PCC3300, PCC3300V2
41403	7	AT Fault Status Bitmap 2	3143	AT1 SCR Intake Temp. Sensor Circuit OOR Low	Warning	PCC3300, PCC3300V2
41403	8	AT Fault Status Bitmap 2	3144	AT1 SCR Intake Temperature Sensor Error	Warning	PCC3300, PCC3300V2
41403	9	AT Fault Status Bitmap 2	3146	AT1 SCR Outlet Temp. Sensor Circuit OOR High	Warning	PCC3300, PCC3300V2
41403	10	AT Fault Status Bitmap 2	3147	AT1 SCR Outlet Temp. Sensor Circuit OOR Low	Warning	PCC3300, PCC3300V2
41403	11	AT Fault Status Bitmap 2	3148	AT1 SCR Outlet Temperature Sensor Error	Warning	PCC3300, PCC3300V2
41403	12	AT Fault Status Bitmap 2	3151	AT1 SCR Catalyst System Missing Condition	Warning	PCC3300, PCC3300V2
41403	13	AT Fault Status Bitmap 2	3165	Aftertreatment 1 SCR Outlet Temperature High	Shutdown	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
41403	14	AT Fault Status Bitmap 2	3173	AT1 Warm Up DOCE Low	Warning	PCC3300, PCC3300V2
41403	15	AT Fault Status Bitmap 2	4769	AT1 DEF Tank Level Sensor Abnormal Rate Change	Warning	PCC3300, PCC3300V2
41404	0	AT Fault Status Bitmap 3	3229	AT1 SCR Intake Temp. High - Most Severe Level	Shutdown	PCC3300, PCC3300V2
41404	1	AT Fault Status Bitmap 3	3231	AT1 SCR Intake Temp. High - Moderate Severe Level	Shutdown w/Cooldown	PCC3300, PCC3300V2
41404	2	AT Fault Status Bitmap 3	3235	AT1 SCR Outlet Temperature High	Shutdown w/Cooldown	PCC3300, PCC3300V2
41404	3	AT Fault Status Bitmap 3	3237	AT1 DEF Line Heater 1 Circuit OOR High	Warning	PCC3300, PCC3300V2
41404	4	AT Fault Status Bitmap 3	3238	AT1 DEF Line Heater 1 Circuit OOR Low	Warning	PCC3300, PCC3300V2
41404	5	AT Fault Status Bitmap 3	3239	AT1 DEF Line Heater 2 Circuit OOR High	Warning	PCC3300, PCC3300V2
41404	6	AT Fault Status Bitmap 3	3241	AT1 DEF Line Heater 2 Circuit OOR Low	Warning	PCC3300, PCC3300V2
41404	7	AT Fault Status Bitmap 3	3242	AT1 DEF Tank Heater Mechanical System Error	Warning	PCC3300, PCC3300V2
41404	8	AT Fault Status Bitmap 3	3258	AT1 DEF Line Heater 1 Open Circuit	Warning	PCC3300, PCC3300V2
41404	9	AT Fault Status Bitmap 3	3261	AT1 DEF Line Heater 2 Open Circuit	Warning	PCC3300, PCC3300V2
41404	10	AT Fault Status Bitmap 3	3422	AT DEF Line Heater 3 Circuit OOR High	Warning	PCC3300, PCC3300V2
41404	11	AT Fault Status Bitmap 3	3423	AT DEF Line Heater 3 Circuit OOR Low	Warning	PCC3300, PCC3300V2
41404	12	AT Fault Status Bitmap 3	3425	AT DEF Line Heater 3 Open Circuit	Warning	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
41404	13	AT Fault Status Bitmap 3	3497	Low AT1 Diesel Exhaust Fluid Tank Level	Warning	PCC3300, PCC3300V2
41404	14	AT Fault Status Bitmap 3	3498	AT1 DEF Tank Level Low	Warning	PCC3300, PCC3300V2
41404	15	AT Fault Status Bitmap 3	3545	Aftertreatment 1 Outlet NOx Sensor - Abnormal	Warning	PCC3300, PCC3300V2
41405	0	AT Fault Status Bitmap 4	3547	Aftertreatment Diesel Exhaust Fluid Tank Empty	Warning	PCC3300, PCC3300V2
41405	1	AT Fault Status Bitmap 4	3558	AT1 Diesel Exhaust Fluid Dosing Unit OOR High	Warning	PCC3300, PCC3300V2
41405	2	AT Fault Status Bitmap 4	3559	AT1 Diesel Exhaust Fluid Dosing Unit OOR Low	Warning	PCC3300, PCC3300V2
41405	3	AT Fault Status Bitmap 4	3562	AT DEF Line Heater Relay OOR High	Warning	PCC3300, PCC3300V2
41405	4	AT Fault Status Bitmap 4	3563	AT DEF Line Heater Relay OOR Low	Warning	PCC3300, PCC3300V2
41405	5	AT Fault Status Bitmap 4	3567	AT DEF Dosing Valve Open Circuit	Warning	PCC3300, PCC3300V2
41405	6	AT Fault Status Bitmap 4	3568	AT DEF Dosing Valve Mechanical system Error	Warning	PCC3300, PCC3300V2
41405	7	AT Fault Status Bitmap 4	3571	AT1 Diesel Exhaust Fluid Pressure Sensor OOR High	Warning	PCC3300, PCC3300V2
41405	8	AT Fault Status Bitmap 4	3572	AT1 Diesel Exhaust Fluid Pressure Sensor OOR Low	Warning	PCC3300, PCC3300V2
41405	9	AT Fault Status Bitmap 4	3574	AT1 Diesel Exhaust Fluid Pressure Sensor Low	Warning	PCC3300, PCC3300V2
41405	10	AT Fault Status Bitmap 4	3575	AT1 Diesel Exhaust Fluid Pressure Sensor High	Warning	PCC3300, PCC3300V2
41405	11	AT Fault Status Bitmap 4	3577	AT Diesel Exhaust Fluid Return Valve OOR High	Warning	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
41405	12	AT Fault Status Bitmap 4	3578	AT Diesel Exhaust Fluid Return Valve OOR Low	Warning	PCC3300, PCC3300V2
41405	13	AT Fault Status Bitmap 4	3582	AT SCR Catalyst Conversion Efficiency Low	Warning	PCC3300, PCC3300V2
41405	14	AT Fault Status Bitmap 4	3583	AT1 Outlet NOx Sensor Heater - Abnormal	Warning	PCC3300, PCC3300V2
41405	15	AT Fault Status Bitmap 4	3596	AT1 Diesel Exhaust Fluid Pressure Sensor Error	Warning	PCC3300, PCC3300V2
41406	0	AT Fault Status Bitmap 5	3649	AT1 Intake NOx Sensor Heater - Abnormal	Warning	PCC3300, PCC3300V2
41406	1	AT Fault Status Bitmap 5	3681	AT1 Outlet NOx Sensor Power Supply Error	Warning	PCC3300, PCC3300V2
41406	2	AT Fault Status Bitmap 5	5386	AT1 DOC Intake Temperature Error	Warning	PCC3300, PCC3300V2
41406	3	AT Fault Status Bitmap 5	3717	AT1 Outlet NOx Sensor - Out of Calibration	Warning	PCC3300, PCC3300V2
41406	4	AT Fault Status Bitmap 5	3725	Aftertreatment 1 Intake NOx Sensor - Abnormal	Warning	PCC3300, PCC3300V2
41406	5	AT Fault Status Bitmap 5	5387	AT1 DOC Intake Temperature Most Severe Level	Shutdown	PCC3300, PCC3300V2
41406	6	AT Fault Status Bitmap 5	3748	AT1 Intake NOx Sensor - Data not Rational	Warning	PCC3300, PCC3300V2
41406	7	AT Fault Status Bitmap 5	3749	AT1 Outlet NOx Sensor - Data not Rational	Warning	PCC3300, PCC3300V2
41406	8	AT Fault Status Bitmap 5	5388	AT1 DOC Intake Temp Moderately Severe Level	Shutdown	PCC3300, PCC3300V2
41406	9	AT Fault Status Bitmap 5	3867	AT DEF Quality Low - Moderately Severe level	Warning	PCC3300, PCC3300V2
41406	10	AT Fault Status Bitmap 5	3868	AT Diesel Exhaust Fluid Quality Error	Warning	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
41406	11	AT Fault Status Bitmap 5	3876	AT DEF Quality Sensor Mech system Error	Warning	PCC3300, PCC3300V2
41406	12	AT Fault Status Bitmap 5	5389	AT1 DOC Intake Temperature Least Severe Level	Warning	PCC3300, PCC3300V2
41406	13	AT Fault Status Bitmap 5	3878	AT Diesel Exhaust Fluid Quality Sensor Data error	Warning	PCC3300, PCC3300V2
41406	14	AT Fault Status Bitmap 5	5391	AT DOC Temperature Sensor Module - Abnormal	Warning	PCC3300, PCC3300V2
41406	15	AT Fault Status Bitmap 5	4152	AT SCR Temperature Sensor Module - Abnormal	Warning	PCC3300, PCC3300V2
41407	0	AT Fault Status Bitmap 6	4155	AT1 DEF Dosing Unit Heater Relay OOR High	Warning	PCC3300, PCC3300V2
41407	1	AT Fault Status Bitmap 6	4156	AT1 DEF Dosing Unit Heater Relay OOR Low	Warning	PCC3300, PCC3300V2
41407	2	AT Fault Status Bitmap 6	4157	AT DEF Return Valve Mechanical system Error	Warning	PCC3300, PCC3300V2
41407	3	AT Fault Status Bitmap 6	5392	AT DOC Temperature Sensor Module - Bad device	Warning	PCC3300, PCC3300V2
41407	4	AT Fault Status Bitmap 6	4159	AT SCR Temperature Sensor Module - Bad Device	Warning	PCC3300, PCC3300V2
41407	5	AT Fault Status Bitmap 6	5393	AT DOC Temperature Sensor Module OOR High	Warning	PCC3300, PCC3300V2
41407	6	AT Fault Status Bitmap 6	5394	AT DOC Temperature Sensor Module OOR Low	Warning	PCC3300, PCC3300V2
41407	7	AT Fault Status Bitmap 6	5395	AT DOC Temp Sensor Root Cause Not Known	Warning	PCC3300, PCC3300V2
41407	8	AT Fault Status Bitmap 6	4164	AT SCR Temperature Sensor Module OOR High	Warning	PCC3300, PCC3300V2
41407	9	AT Fault Status Bitmap 6	4165	AT SCR Temperature Sensor Module OOR Low	Warning	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
41407	10	AT Fault Status Bitmap 6	4166	AT SCR Temperature Sensor Module High	Warning	PCC3300, PCC3300V2
41407	11	AT Fault Status Bitmap 6	4168	AT1 DEF Dosing Unit Heater OOR High	Warning	PCC3300, PCC3300V2
41407	12	AT Fault Status Bitmap 6	4169	AT1 DEF Dosing Unit Heater OOR Low	Warning	PCC3300, PCC3300V2
41407	13	AT Fault Status Bitmap 6	4171	Selective Catalytic Reduction Temperature Low	Warning	PCC3300, PCC3300V2
41407	14	AT Fault Status Bitmap 6	5396	AT DOC Temperature Sensor Module High	Warning	PCC3300, PCC3300V2
41407	15	AT Fault Status Bitmap 6	5617	AT1 DOC System - Special Instructions	Shutdown w/Cooldown	PCC3300, PCC3300V2
41408	0	AT Fault Status Bitmap 7	4241	AT DEF Quality - Received Network Data Error	Warning	PCC3300, PCC3300V2
41408	1	AT Fault Status Bitmap 7	4243	AT1 Diesel Exhaust Fluid Temperature 2 - Abnormal	Warning	PCC3300, PCC3300V2
41408	2	AT Fault Status Bitmap 7	5362	Aftertreatment System Normal Shutdown Request	Shutdown w/Cooldown	PCC3300, PCC3300V2
41408	3	AT Fault Status Bitmap 7	5363	Aftertreatment system Datalink Degraded	Warning	PCC3300, PCC3300V2
41408	4	AT Fault Status Bitmap 7	4249	AT1 DEF Dosing Temperature - Abnormal	Warning	PCC3300, PCC3300V2
41408	6	AT Fault Status Bitmap 7	4261	AT SCR Temp Sensor Module - Root Cause Unknown	Warning	PCC3300, PCC3300V2
41408	7	AT Fault Status Bitmap 7	4277	AT Diesel Exhaust Fluid Quality - Abnormal	Warning	PCC3300, PCC3300V2
41408	8	AT Fault Status Bitmap 7	4572	AT1 DEF Tank Temperature - Abnormal	Warning	PCC3300, PCC3300V2
41408	9	AT Fault Status Bitmap 7	4585	AT1 SCR Catalyst System - Special Instructions	Shutdown	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
41408	10	AT Fault Status Bitmap 7	4658	AT SCR Actual Dosing Reagent Quantity Low	Warning	PCC3300, PCC3300V2
41409	0	AT Fault Status Bitmap 8	4739	AT1 DEF Tank Level Sensor - Root Cause Unknown	Warning	PCC3300, PCC3300V2
41409	1	AT Fault Status Bitmap 8	4741	AT DEF Quality Sensor Open Circuit	Warning	PCC3300, PCC3300V2
41409	2	AT Fault Status Bitmap 8	4742	AT DEF Quality Sensor Short Circuit	Warning	PCC3300, PCC3300V2
41409	3	AT Fault Status Bitmap 8	4743	AT1 DEF Temperature 2 Sensor Open Circuit	Warning	PCC3300, PCC3300V2
41409	4	AT Fault Status Bitmap 8	4744	AT1 DEF Temperature 2 Sensor Short Circuit	Warning	PCC3300, PCC3300V2
41409	5	AT Fault Status Bitmap 8	4745	AT1 DEF Temperature 2 - Root Cause Unknown	Warning	PCC3300, PCC3300V2
41409	6	AT Fault Status Bitmap 8	4768	AT1 DEF Property - Root Cause Unknown	Warning	PCC3300, PCC3300V2
41409	7	AT Fault Status Bitmap 8	5711	AT DEF Replenishment Failure	Warning	PCC3300, PCC3300V2
41410	0	AT Fault Status Bitmap 9	3565	AT1 DEF Dosing Valve 1 OOR High	Warning	PCC3300, PCC3300V2
41410	1	AT Fault Status Bitmap 9	3866	AT DEF Quality low Warning	Warning	PCC3300, PCC3300V2
41410	2	AT Fault Status Bitmap 9	4677	AT1 DEF Tank Level Abnormal Update Rate	Warning	PCC3300, PCC3300V2
41410	3	AT Fault Status Bitmap 9	4747	AT Intake Oxygen Sensor Data not Rational - High	Warning	PCC3300, PCC3300V2
41410	4	AT Fault Status Bitmap 9	4748	AT Intake Oxygen Sensor Data not Rational - Low	Warning	PCC3300, PCC3300V2
41410	5	AT Fault Status Bitmap 9	4749	AT Outlet Oxygen Sensor Data not Rational - High	Warning	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
41410	6	AT Fault Status Bitmap 9	4751	AT Outlet Oxygen Sensor Data not Rational - Low	Warning	PCC3300, PCC3300V2
41410	7	AT Fault Status Bitmap 9	5176	AT1 DEF Tank Level2 Abnormal Update Rate	Warning	PCC3300, PCC3300V2
41410	8	AT Fault Status Bitmap 9	5247	AT1 SCR Intake Temp. High Warning	Warning	PCC3300, PCC3300V2
41410	9	AT Fault Status Bitmap 9	5655	AT1 SCR Conversion Efficiency	Warning	PCC3300, PCC3300V2
41410	10	AT Fault Status Bitmap 9	5689	AT1 Outlet NOx Sensor Error	Warning	PCC3300, PCC3300V2
41410	11	AT Fault Status Bitmap 9	5838	AT1 Outlet NOx Sensor Abnormal Rate of Change	Warning	PCC3300, PCC3300V2
41410	12	AT Fault Status Bitmap 9	5864	AT1 DEF Pump Command OOR High	Warning	PCC3300, PCC3300V2
41410	13	AT Fault Status Bitmap 9	5865	AT1 DEF Pump Command OOR Low	Warning	PCC3300, PCC3300V2
41410	14	AT Fault Status Bitmap 9	5866	AT DEF Dosing Unit Relay Feedback OOR High	Warning	PCC3300, PCC3300V2
41410	15	AT Fault Status Bitmap 9	5867	AT DEF Dosing Unit Relay Feedback OOR Low	Warning	PCC3300, PCC3300V2
41411	0	AT Fault Status Bitmap 10	5887	AT1 SCR System Hydrocarbon High	NONE	PCC3300, PCC3300V2
41411	1	AT Fault Status Bitmap 10	5888	AT1 SCR System Hydrocarbon High Warning	Warning	PCC3300, PCC3300V2
41411	2	AT Fault Status Bitmap 10	5889	AT1 SCR System Hydrocarbon High Shutdown	Shutdown	PCC3300, PCC3300V2
41411	3	AT Fault Status Bitmap 10	5935	AT1 DEF Pressure Mechanical System Error	Warning	PCC3300, PCC3300V2
41411	4	AT Fault Status Bitmap 10	5936	AT1 DEF Pressure High Warning	Warning	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
41411	5	AT Fault Status Bitmap 10	6464	AT1 Out Nox Sens Error	NONE	PCC3300, PCC3300V2
41411	6	AT Fault Status Bitmap 10	6475	AT1 DEF Tank Heater Mechanical Error	NONE	PCC3300, PCC3300V2
41411	7	AT Fault Status Bitmap 10	6476	AT1 DEF Tank Heater Low	NONE	PCC3300, PCC3300V2
41411	8	AT Fault Status Bitmap 10	6477	AT1 DEF Line Heater Relay OOR High	NONE	PCC3300, PCC3300V2
41411	9	AT Fault Status Bitmap 10	6478	AT1 DEF Line Heater Relay OOR Low	NONE	PCC3300, PCC3300V2
41411	10	AT Fault Status Bitmap 10	6479	AT1 DEF Tank Heater OOR High	NONE	PCC3300, PCC3300V2
41411	11	AT Fault Status Bitmap 10	6481	AT1 DEF Tank Heater OOR Low	NONE	PCC3300, PCC3300V2
41411	12	AT Fault Status Bitmap 10	6526	AT1 DEF Tank Level Out of Calibration Error	NONE	PCC3300, PCC3300V2
41411	13	AT Fault Status Bitmap 10	6531	AT1 DEF Line Heater1 OOR High	NONE	PCC3300, PCC3300V2
41411	14	AT Fault Status Bitmap 10	6532	AT1 DEF Line Heater1 OOR Low	NONE	PCC3300, PCC3300V2
41411	15	AT Fault Status Bitmap 10	6533	AT1 DEF Line Heater2 OOR High	NONE	PCC3300, PCC3300V2
41412	0	AT Fault Status Bitmap 11	6534	AT1 DEF Line Heater2 OOR Low	NONE	PCC3300, PCC3300V2
41412	1	AT Fault Status Bitmap 11	6535	AT1 DEF Line Heater3 OOR High	NONE	PCC3300, PCC3300V2
41412	2	AT Fault Status Bitmap 11	6536	AT1 DEF Line Heater3 OOR Low	NONE	PCC3300, PCC3300V2
41412	3	AT Fault Status Bitmap 11	6619	AT1 DEF Temperature 2 Abnormal Update Rate	NONE	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
41412	4	AT Fault Status Bitmap 11	6692	AT1 SCR System Soot High	NONE	PCC3300, PCC3300V2
41412	5	AT Fault Status Bitmap 11	6693	AT1 SCR System Soot High Warning	Warning	PCC3300, PCC3300V2
41412	6	AT Fault Status Bitmap 11	6694	AT1 SCR System Soot High Shutdown	Shutdown	PCC3300, PCC3300V2
41412	7	AT Fault Status Bitmap 11	6752	AT DEF Quality Low	NONE	PCC3300, PCC3300V2
41412	8	AT Fault Status Bitmap 11	7268	AT1 SCR System Cleaning Incomplete Error	NONE	PCC3300, PCC3300V2
41412	9	AT Fault Status Bitmap 11	7269	AT1 SCR System Cleaning Incomplete Error Warning	Warning	PCC3300, PCC3300V2
41415	3	AT Fault Status Bitmap 14	4116	AT2 SCR Catalyst Outlet Gas Temp Above Normal	Warning	PCC3300V2
41415	4	AT Fault Status Bitmap 14	8167	AT1 SCR System Hydrocarbon High Most Severe Level	Warning	PCC3300V2
41415	5	AT Fault Status Bitmap 14	7949	AT1 SCR System Soot High Most Severe Level	Warning	PCC3300V2
41415	6	AT Fault Status Bitmap 14	4465	AT2 Diesel Exhaust Fluid Pre 1 OOR Low	Warning	PCC3300V2
41415	7	AT Fault Status Bitmap 14	4464	AT2 Diesel Exhaust Fluid Pressure1 OOR High	Warning	PCC3300V2
41415	8	AT Fault Status Bitmap 14	4466	AT2 Diesel Exhaust Fluid Pressure 1 Below Normal	Warning	PCC3300V2
41415	9	AT Fault Status Bitmap 14	4467	AT2 Diesel Exhaust Fluid Pressure 1 High	Warning	PCC3300V2
41415	10	AT Fault Status Bitmap 14	4456	Aftertreatment 2 Diesel Exhaust FDU Condition	Warning	PCC3300V2
41415	11	AT Fault Status Bitmap 14	4462	AT2 Diesel Exhaust FDV OOR Low	Warning	PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
41415	12	AT Fault Status Bitmap 14	4463	AT2 Diesel Exhaust FDV 1 Failure Error	Warning	PCC3300V2
41415	13	AT Fault Status Bitmap 14	3998	AT2 SCR Catalyst Intake Gas Temperature Incorrect	Warning	PCC3300V2
41415	14	AT Fault Status Bitmap 14	4115	AT2 SCR Catalyst Outlet Gas Temperature Incorrect	Warning	PCC3300V2
41415	15	AT Fault Status Bitmap 14	11147	AT2 Diesel Exhaust FDV 1 OOR High	Warning	PCC3300V2
41416	0	Fault Status Bitmap 35	4252	Engine Wait to Start Lamp - Condition Exists	NONE	PCC3300, PCC3300V2
41416	1	Fault Status Bitmap 35	4688	Water in Fuel Indicator 2 Sensor OOR Hi	Warning	PCC3300, PCC3300V2
41416	2	Fault Status Bitmap 35	4689	Water in Fuel Indicator 2 Sensor OOR Lo	Warning	PCC3300, PCC3300V2
41416	3	Fault Status Bitmap 35	5366	High Water in Fuel Sensed by Indicator 2 - Warning	Warning	PCC3300, PCC3300V2
41416	4	Fault Status Bitmap 35	5367	High Water in Fuel Sensed by Indicator 2-Shutdown	Shutdown	PCC3300, PCC3300V2
41416	5	Fault Status Bitmap 35	5713	Dead Battery Warning	Warning	PCC3300, PCC3300V2
41416	6	Fault Status Bitmap 35	5714	Primary Starting System Failed	Warning	PCC3300, PCC3300V2
41416	7	Fault Status Bitmap 35	483	IMR 2 Pressure Sensor Circuit Shorted to High	Warning	PCC3300, PCC3300V2
41416	8	Fault Status Bitmap 35	484	IMR 2 Pressure Sensor Circuit Shorted to Low	Warning	PCC3300, PCC3300V2
41416	9	Fault Status Bitmap 35	7823	Cylinder Cut-Off System failure	Warning	PCC3300, PCC3300V2
41416	10	Fault Status Bitmap 35	7824	Cylinder Cut-Off System State & Feedback Mismatch	Warning	PCC3300, PCC3300V2
41416	11	Fault Status Bitmap 35	3396	DPF 1 Conditions Not Met for Active Regeneration	Warning	PCC3300, PCC3300V2
41416	12	Fault Status Bitmap 35	3539	Intake Throttle Sensor Circuit shorted to High	Warning	PCC3300, PCC3300V2
41416	13	Fault Status Bitmap 35	3541	Intake Throttle Sensor Circuit shorted to Low	Warning	PCC3300, PCC3300V2
41416	15	Fault Status Bitmap 35	4517	Vehicle Identification Number - Out of Calibration	Warning	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
41417	0	Fault Status Bitmap 36	699	High ECM Internal Temperature	Warning	PCC3300, PCC3300V2
41417	1	Fault Status Bitmap 36	5718	Memory Write Failed	Warning	PCC3300, PCC3300V2
41417	2	Fault Status Bitmap 36	5719	Power Lost During Memory Save	Warning	PCC3300, PCC3300V2
41417	3	Fault Status Bitmap 36	5721	Auto Trims Save Failed	Warning	PCC3300, PCC3300V2
41417	4	Fault Status Bitmap 36	5722	Manual Trims Save Failed	Shutdown	PCC3300, PCC3300V2
41417	5	Fault Status Bitmap 36	5723	Paralleling Cable Not Detected - Condition Exists	NONE	PCC3300, PCC3300V2
41417	6	Fault Status Bitmap 36	5221	ASO Position Switch mismatch	Shutdown	PCC3300, PCC3300V2
41417	7	Fault Status Bitmap 36	5292	Max time exceeded since last ASOV System test	Warning	PCC3300, PCC3300V2
41417	8	Fault Status Bitmap 36	3139	ASO Solenoid out of range high	Warning	PCC3300, PCC3300V2
41417	9	Fault Status Bitmap 36	3141	ASO Solenoid out of range low	Warning	PCC3300, PCC3300V2
41417	10	Fault Status Bitmap 36	4484	Engine Air Shutoff - Mech. Sys. Not Responding	Shutdown	PCC3300, PCC3300V2
41417	11	Fault Status Bitmap 36	5291	ASOV E-Stop Active	Shutdown	PCC3300, PCC3300V2
41417	12	Fault Status Bitmap 36	3722	Intake Manifold Pressure Bank Imbalance	Shutdown	PCC3300, PCC3300V2
41417	13	Fault Status Bitmap 36	4729	Intake Manifold Vacuum Detected – Bank 1	Shutdown	PCC3300, PCC3300V2
41417	14	Fault Status Bitmap 36	5114	Intake Manifold Vacuum Detected – Bank 2	Shutdown	PCC3300, PCC3300V2
41417	15	Fault Status Bitmap 36	3131	Secondary Engine Overspeed	Shutdown	PCC3300, PCC3300V2
41418	0	Fault Status Bitmap 37	5879	"Throttle_Driver_Feedback_High_Error"	Warning	PCC3300, PCC3300V2
41418	1	Fault Status Bitmap 37	5881	"Throttle_Driver_Feedback_Low_Error"	Warning	PCC3300, PCC3300V2
41418	2	Fault Status Bitmap 37	5882	Copy - "Throttle_Driver_Feedback_Low_Error"	Warning	PCC3300, PCC3300V2
41418	3	Fault Status Bitmap 37	5788	Engine Witness Test Abort - Condition Exists	Warning	PCC2300

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
41418	4	Fault Status Bitmap 37	2677	Fail To Stop	Shutdown	PCC3300, PCC2300, PCC3300V2
41418	5	Fault Status Bitmap 37	2727	CRITICAL_CEN_NOT_ACCESSIBLE_ERROR	Shutdown w/Cooldown	PCC3300, PCC2300, PCC3300V2
41418	6	Fault Status Bitmap 37	1135	J1939 Data Link 2 Engine Network - Abnormal	Shutdown	PCC3300, PCC2300, PCC3300V2
41418	7	Fault Status Bitmap 37	782	J1939 Data Link 2 Eng Network No Data Recvd	Shutdown	PCC3300, PCC2300, PCC3300V2
41418	8	Fault Status Bitmap 37	5949	J1939 Data Link 2 Eng Network Special Instructions	Shutdown	PCC3300, PCC2300, PCC3300V2
41418	9	Fault Status Bitmap 37	6487	Nominal Voltage Setup OOR	Shutdown	PCC3300, PCC2300, PCC3300V2
41418	10	Fault Status Bitmap 37	6598	At Least One Uncleared ECS Shutdown Fault Exists	Warning	PCC3300, PCC2300, PCC3300V2
41418	11	Fault Status Bitmap 37	2216	Fuel Pump Delivery Pressure	Warning	PCC3300, PCC2300, PCC3300V2
41418	12	Fault Status Bitmap 37	6251	Exhaust Gas Temperature Bank Imbalance	Warning	PCC3300, PCC2300, PCC3300V2
41418	13	Fault Status Bitmap 37	6252	Exhaust Gas Temperature	Shutdown	PCC3300, PCC2300, PCC3300V2
41418	14	Fault Status Bitmap 37	6719	Engine Fuel Delivery Pressure	Shutdown	PCC3300, PCC2300, PCC3300V2
41418	15	Fault Status Bitmap 37	5863	Engine Diesel Fuel Metering Valve P Err	Warning	PCC3300, PCC3300V2
41419	0	Fault Status Bitmap 38	5875	ECUs Reported DTCs Affecting Operation	Shutdown	PCC3300, PCC3300V2
41419	1	Fault Status Bitmap 38	5876	Other ECUs Reported DTCs Affecting Operation	Warning	PCC3300, PCC3300V2
41419	2	Fault Status Bitmap 38	5777	Diesel Exhaust Fluid Pressure 2 - Data Erratic	Warning	PCC3300, PCC3300V2
41419	3	Fault Status Bitmap 38	249	Ambient Temp(J11) OOR High	Warning	PCC2300

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
41419	4	Fault Status Bitmap 38	256	Ambient Temp(J11) OOR Low	Warning	PCC2300
41419	5	Fault Status Bitmap 38	6638	Cold Start Idle - Active	NONE	PCC3300, PCC2300, PCC3300V2
41419	6	Fault Status Bitmap 38	6818	Alternate Frequency Mismatch-MLD	Shutdown	PCC3300, PCC3300V2
41419	7	Fault Status Bitmap 38	6778	Nominal Voltage Mismatch-MLD	Shutdown	PCC3300, PCC3300V2
41419	8	Fault Status Bitmap 38	6875	Under Excitation Fault	Shutdown	PCC3300, PCC3300V2
41419	9	Fault Status Bitmap 38	7548	Engine Friction Below Baseline - Least Severe	NONE	PCC3300, PCC3300V2
41419	10	Fault Status Bitmap 38	7549	Engine Friction Below Baseline - Moderately Severe	Warning	PCC3300, PCC3300V2
41419	11	Fault Status Bitmap 38	7551	Engine Friction Above Baseline - Least Severe	NONE	PCC3300, PCC3300V2
41419	12	Fault Status Bitmap 38	7552	Engine Friction Above Baseline - Moderately Severe	Warning	PCC3300, PCC3300V2
41419	13	Fault Status Bitmap 38	7553	Engine Friction Devn Above Baseline - Mod Severity	Warning	PCC3300, PCC3300V2
41419	14	Fault Status Bitmap 38	7554	Engine Friction Devn Above Baseline - Most Severe	Shutdown	PCC3300, PCC3300V2
41419	15	Fault Status Bitmap 38	7555	Alternator Feedback Power	Shutdown	PCC3300, PCC3300V2

TABLE 70.

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
41420	0	Fault Status Bitmap 39	7825	Generator Total Real Power Sensing Failure	Shutdown	PCC3300, PCC3300V2
41420	1	Fault Status Bitmap 39	7697	Bank Cut-Off FSO Failure	Shutdown	PCC3300, PCC3300V2
41420	2	Fault Status Bitmap 39	5862	Eng Diesel Fuel Metering Valve Pos-Abv Normal	Warning	PCC3300, PCC3300V2
41420	3	Fault Status Bitmap 39	6253	Ctrl Module Identification I/P State Err Spl Instr	Shutdown	PCC3300, PCC3300V2
41420	4	Fault Status Bitmap 39	6573	Engine Diesel Fuel Metering Valve Temp Mod Hi	NONE	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
41420	5	Fault Status Bitmap 39	6574	Engine Diesel Fuel Metering Valve Temp Hi	Warning	PCC3300, PCC3300V2
41420	6	Fault Status Bitmap 39	344	Fuel Filter Diff Press Above Normal Least Severe	NONE	PCC3300, PCC3300V2
41420	7	Fault Status Bitmap 39	3379	Engine ECU Temp: Above Normal	Warning	PCC3300, PCC3300V2
41420	8	Fault Status Bitmap 39	7892	Start Signal Integrity Failure	Warning	PCC3300, PCC2300, PCC3300V2
41420	9	Fault Status Bitmap 39	7243	Failed Normal Start Attempt	Warning	PCC3300, PCC2300, PCC3300V2
41420	10	Fault Status Bitmap 39	8632	Charging Alternator Fuse Failure	Warning	PCC3300, PCC3300V2
41421	0	Fault Status Bitmap 40	3478	Engine Charge Air Cooler Outlet Temperature Error	Warning	PCC3300, PCC3300V2
41421	1	Fault Status Bitmap 40	3917	Engine Turbocharger Lube Oil Pressure low Warning	Warning	PCC3300, PCC3300V2
41421	2	Fault Status Bitmap 40	4293	Engine Brake Active Lamp OOR High	Warning	PCC3300, PCC3300V2
41421	3	Fault Status Bitmap 40	4294	Engine Brake Active Lamp OOR Low	Warning	PCC3300, PCC3300V2
41421	4	Fault Status Bitmap 40	6256	Battery 1 Voltage High	NONE	PCC3300, PCC3300V2
41421	5	Fault Status Bitmap 40	6257	Battery 1 Voltage Low	NONE	PCC3300, PCC3300V2
41421	6	Fault Status Bitmap 40	6258	Electric Lift Pump for Eng Fuel Supply OOR High	NONE	PCC3300, PCC3300V2
41421	7	Fault Status Bitmap 40	6259	Electric Lift Pump for Eng Fuel Supply OOR Low	NONE	PCC3300, PCC3300V2
41421	8	Fault Status Bitmap 40	6263	Fan Control Circuit OOR High	NONE	PCC3300, PCC3300V2
41421	9	Fault Status Bitmap 40	6264	Fan Control Circuit OOR Low	NONE	PCC3300, PCC3300V2
41421	10	Fault Status Bitmap 40	6336	Crankcase Breather Filter Heater OOR High	NONE	PCC3300, PCC3300V2
41421	11	Fault Status Bitmap 40	6337	Crankcase Breather Filter Heater OOR Low	NONE	PCC3300, PCC3300V2
41421	12	Fault Status Bitmap 40	6467	Fan Speed High	NONE	PCC3300, PCC3300V2
41421	13	Fault Status Bitmap 40	6468	Fan Speed Low	NONE	PCC3300, PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
41421	14	Fault Status Bitmap 40	6522	Coolant Level Sensor 1 OOR Low	NONE	PCC3300, PCC3300V2
41421	15	Fault Status Bitmap 40	6523	Coolant Level Sensor 1 OOR High	NONE	PCC3300, PCC3300V2
41422	0	Fault Status Bitmap 41	6524	Engine Oil Temperature Sensor 1 OOR High	NONE	PCC3300, PCC3300V2
41422	1	Fault Status Bitmap 41	6525	Engine Oil Temperature Sensor 1 OOR Low	NONE	PCC3300, PCC3300V2
41422	2	Fault Status Bitmap 41	6595	Engine Speed Root Cause Unknown	NONE	PCC3300, PCC3300V2
41422	3	Fault Status Bitmap 41	7135	Engine Turbocharger Speed High Warning	Warning	PCC3300, PCC3300V2
41422	4	Fault Status Bitmap 41	8636	Bank A STC Failure on Low Load	Warning	PCC3300V2
41422	5	Fault Status Bitmap 41	8637	Bank B STC Failure on Low Load	Warning	PCC3300V2
41422	6	Fault Status Bitmap 41	8638	Bank A STC Failure on High Load	Shutdown	PCC3300V2
41422	7	Fault Status Bitmap 41	8639	Bank B STC Failure on High Load	Shutdown	PCC3300V2
41422	8	Fault Status Bitmap 41	8641	Bank A Pressure OORH	Warning	PCC3300V2
41422	9	Fault Status Bitmap 41	8642	Bank A Pressure OORL	Warning	PCC3300V2
41422	10	Fault Status Bitmap 41	8643	Bank B Pressure OORH	Warning	PCC3300V2
41422	11	Fault Status Bitmap 41	8644	Bank B Pressure OORL	Warning	PCC3300V2
41422	12	Fault Status Bitmap 41	6226	Maintenance Required - Condition Exists	Warning	PCC3300V2
41423	0	Fault Status Bitmap 42	13266	Crankcase Pres 2 below normal Moderately Severe	Warning	PCC3300V2
41423	3	Fault Status Bitmap 42	13438	PTC Manual Mode Active	NONE	PCC3300, PCC3300V2
41424	2	AT Fault Status Bitmap 43	6227	Current Imbalance Fault	Warning	PCC3300V2
41424	3	Fault Status Bitmap 43	7397	Engine Intake Manifold Press Above Normal	Shutdown	PCC3300V2
41424	4	Fault Status Bitmap 43	3752	Injector Metering Rail 1 Pressure Shutdown Error	Shutdown	PCC3300V2

ModBus Address	Bit Number	System Name	Fault Code	Event Name	Response	Control Boards
41424	5	Fault Status Bitmap 43	125	Intake Manifold 1 Pressure Moderately Severe	Warning	PCC3300V2
41424	5	Fault Status Bitmap 43	1517	Failed Module Shutdown	Shutdown	PCC3300V2
41424	6	Fault Status Bitmap 43	1518	Failed Module Warning	Warning	PCC3300V2
41471	0	AT Fault Status Bitmap 15	11146	AT2 Diesel Exhaust Fluid Supply OOR Low	Warning	PCC3300V2
41471	1	AT Fault Status Bitmap 15	11145	AT2 Diesel Exhaust Fluid Supply OOR High	Warning	PCC3300V2

17 PS060X Modbus Register Map

17.1 General Instructions

17.1.1 Modbus RTU Supported Functions

The control supports the Modbus function codes described below. The control shall respond to any function code other than those listed by sending an exception response of Illegal Function (01).

Read Holding Registers (Function Code 03)

The control provides the ability to read 1 to 125 consecutive holding registers.

The control shall respond to any read request to address not defined in the control by returning 0xFFFF data for that address.

The control will return an Illegal Address exception code 02 if any of the following conditions occur:

- The first register in the holding register read request is not defined on the control.
- The first register in the holding register read request does not allow for the full representation of a numeric value. This would occur if the first register in the read request is not mapped to the most significant 2 bytes of a binary value parameter.
- The last register in the holding register read request does not allow for the full representation of a numeric value. This would occur if the last register in the read request is not mapped to the least significant 2 bytes of a binary value parameter.

Read requests for string type parameters where not every register associated with the string is in the request shall return only the requested portion of the string.

Read Input Registers (Function Code 04)

The control provides the ability to read 1 to 125 consecutive input registers.

The control shall respond to any read request to address not defined in the control by returning 0xFFFF data for that address.

The control will return an Illegal Address exception code 02 if any of the following conditions occur:

- The first register in the input register read request is not defined on the control.
- The first register in the input register read request does not allow for the full representation of a numeric value. This would occur if the first register in the read request is not mapped to the most significant 2 bytes of a parameter.
- The last register in the input register read request does not allow for the full representation of a numeric value. This would occur if the last register in the read request is not mapped to the least significant 2 bytes of a parameter.

The Input Registers support by each port on the control are listed in the Read Input Registers Table below.

Write Single Holding Register (Function Code 06)

The control will return an Illegal Address exception code 02 if any of the following conditions occur:

- The register in the holding register write request is not defined on the control.
- The register in the holding register write request does not allow for the full writing of a numeric value. This would occur if the register is part of a numeric parameter that requires more than one address to represent.

- If writing to a string values, the register in the holding register write request is not the first register of that string.

Write requests for string type parameters where not every register associated with the string is in the request shall write only the requested portion of the string, null terminating the remainder of the string.

Write requests to this control may return an Illegal Data Value exception code 03. This means that the requested write failed to occur.

Write Multiple Holding Registers (Function Code 16)

The control provides the ability to write to 1 to 123 consecutive holding registers.

The control will return an Illegal Address exception code 02 if any of the following conditions occur:

- The first register in the holding register write request is not defined on the control.
- The first register in the holding register write request does not allow for the full writing of a numeric value. This would occur if the first register in the write request is not mapped to the most significant 2 bytes of a parameter.
- The last register in the holding register write request does not allow for the full writing of a numeric value. This would occur if the last register in the write request is not mapped to the least significant 2 bytes of a parameter.
- If string values are in the write request, the first register for any string is not within the requested register range.

Write requests for string type parameters where not every register associated with the string is in the request shall write only the requested portion of the string, null terminating the remainder of the string.

Write requests to this control may return an Illegal Data Value exception code 03. This means that some or all of the requested writes failed to occur. It is the responsibility of the requestor to read the data again to determine which parameters were not written to their requested new values and to respond as necessary.

17.1.2 Modbus RTU Serial Port Configuration Options

The following configuration options shall be available for each port the control that supports the Modbus RTU protocol. See the controller Modbus register map for individual register assignments for these parameters on any given port.

TABLE 71. CONFIGURATION OPTIONS

Parameter Name	Description	Specification
Modbus Node Address	Sets this ports node address.	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Unit: Lower Limit: 1 Upper Limit: 247

Parameter Name	Description	Specification
Modbus Baud Rate	Sets this ports baud rate.	0: 2400 1: 4800 2: 9600 3: 19200 4: 28800 5: 38400 6: 57600 7: 115200
Modbus Parity and Stop Bit Selection	Sets this ports parity and stop bit communications settings.	0: No Parity (1 Stop) 1: No Parity (2 Stop) 2: Even Parity (1 Stop) 3: Odd Parity (1 Stop)
Modbus Failure Time Delay	Sets the time delay for the detection of the lack of Modbus packets on the communications bus.	Multiplier: 1 Offset: 0 Size (bits): 8 Sign: U Unit: seconds Lower Limit: 1 Upper Limit: 60

NOTICE

Changes to the Modbus Baud Rate and the Modbus Parity and Stop Bit Selection parameters will be immediately reflected on the serial port being configured. Any Modbus commands in progress on that port in the old communications settings will fail until the Modbus master also updates its communications settings to match those of the slave.

Modbus RTU Extended Status information

The control represents abnormal states in the data by using the five most positive values of the data to convey that these abnormal states exist. The states will only be applicable to numeric parameters with the following data types:

- UINT8, INT8, UINT16, INT16, UINT32, INT32, UINT64, INT64 (signed and unsigned 8-bit through 64-bit parameters)

Note that enumerated parameters and parameters with a floating point data type will not follow these abnormal state representation methods.

The following abnormal states are supported:

Supported Abnormal States

Abnormal State	Value Description	Value Examples		Examples of Failures
		Unsigned 2-Byte Integer Value	Signed 2-Byte Integer Value	
Hardware/ Component Failure	This data shall be represented as 4 less than the highest positive value for that parameter.	65531	32763	An on controller hardware/component failure that provides data like voltage, current and power
Network Failed Data	This data shall be represented as 3 less than the highest positive value for that parameter.	65532	32764	Data that comes from a network that has failed such as sensor data coming from I/O modules on a PCCnet or CAN network
Out of Range Low	This data shall be represented as 2 less than the highest positive value for that parameter.	65533	32765	Data that has been determined to be out of range LOW or out of range (when there is no distinction between out of range high and out of range low) due to an open sensor
Out of Range High/Out of Range	This data shall be represented as 1 less than the highest positive value for that parameter.	65534	32766	Data that has been determined to be out of range HIGH or out of range (when there is no distinction between out of range high and out of range low) due to an open sensor
Unsupported (Not Available) Data	This data shall be represented as the highest positive value for that parameter.	65535	32767	Parameters which are not available due to the sensor not being installed or not enabled in the controller's configuration

Working with 8-Bit Data Types

When reading a register that contains information in an 8 bit data type, the data will be put the least significant byte of the register. If the data type is unsigned, the upper byte will be populated with zeros. If the data type is signed, the upper byte will be sign extended with the sign bit value of the data byte.

When writing a register that contains information that is expected to be in an 8 bit data type, the control will expect the data to be in the least significant byte of the register and ignore the upper byte.

Representation of Multi-Register Parameters

- For numeric parameters requiring more than one Register to represent the data, the Register Address listed in the Controllers Modbus Register Map represents the most significant 2 bytes of the data. The additional bytes of the data will always be provided in Register Address + 1, Register Address + 2, and Register Address +3 as appropriate.

- For string parameters, the first two characters in the string will be mapped to the Register Address listed in the Controllers Modbus Register Map. Additional characters will be provided in the following registers. For example, for the string "String1" at address 400031, the characters will be mapped the following registers:

400031: "St" 400032: "ri" 400033: "ng" 400034: "1_"

Modbus RTU Slave Protocol Support for Read Input Registers

Each port instance of Modbus RTU Slave Protocol shall support interface to the following read input registers through function code 04. These are the only input registers supported by this control.

The following table applies for each instance of the Modbus RTU protocol on any control and will return the data from the port being read only.

TABLE 72. READ INPUT REGISTERS TABLE

Register Address	Name	Description	Data Type	Size (Registers)	Scaling Factor
30001	Bus Message Count	This parameter contains the quantity of messages that this port has detected on the communications system since its last restart, clear counters operation, or power-up.	uint32	2	1
30003	Bus CRC Error Count	This parameter stores quantity of CRC errors encountered by this port since its last restart, clear counters operation, or power-up.	uint32	2	1
30005	Bus Exception Error Count	This parameter contains the quantity of exception responses returned by this port since its last restart, clear counters operation, or power-up.	uint32	2	1
30007	Server No Response Count	This parameter contains the quantity of messages addressed to this port for which it has returned no response since its last restart, clear counters operation, or power-up,	uint32	2	1
30009	Server Message Count	The parameter contains the quantity of messages addressed to this port that it has processed since its last restart, clear counters operation, or power-up.	uint32	2	1

Register Address	Name	Description	Data Type	Size (Registers)	Scaling Factor
30011	Modbus Time Stamp at Counter Reset - Year	This parameter holds the year of the time stamp record when counters were cleared last time.	uint8	1	1
30012	Modbus Time Stamp at Counter Reset - Month	This parameter holds the month of the time stamp record when counters were cleared last time.	uint8	1	1
30013	Modbus Time Stamp at Counter Reset - Date	This parameter holds the day of the month of the time stamp record when counters were cleared last time.	uint8	1	1
30014	Modbus Time Stamp at Counter Reset – Hour	This parameter holds the hour of the time stamp record when counters were cleared last time.	uint8	1	1
30015	Modbus Time Stamp at Counter Reset - Minute	This parameter holds the minute of the time stamp record when counters were cleared last time.	uint8	1	1
30016	Modbus Time Stamp at Counter Reset - Seconds	This parameter holds the seconds of the time stamp record when counters were cleared last time.	uint8	1	1
30017	Modbus Time Since Last Counter Reset	This parameter maintains the time in seconds since the last reset of Modbus diagnostic counters.	uint32	2	1

17.2 PS060X Modbus Register Map

The controller contains data that can be read by a master device communicating via Modbus RTU protocol on a two-wire RS485 multi-drop bus. The Cummins control is a slave unit.

For more information about the Modbus protocol, refer to *Modbus Application Protocol V1.1b3* and *Modbus Serial Line Implementation Guide V1.02*, which are both available at www.modbus.org.

See also the NFPA 110 Bitmap (PS060X) section.

PS060X RS485 Pins

- A (+): TB15-3
- B (-): TB15-4
- Common: TB15-1

TABLE 73. ACCESS LEVELS

Level	Description
-------	-------------

Read Only	This defines the specific parameter as a read-only type.
Guest	This defines the specific parameter as read or write type.
Technician	An authorized service person must set the Modbus communication port access level parameter to "Technician" through the service tool to enable writing.

NOTICE
If an address or bit is not listed in the table below, it has not been implemented.

NOTICE
The master device can read 1-16 contiguous registers, write 1-16 contiguous registers, or read diagnostic counters.

NOTICE
To connect with the Modbus tool, set the TB15 Protocol selection parameter to “Modbus” via a service tool or LCD, which will immediately disconnect the PC tool. To reconnect the PC tool, set the TB15 protocol selection to “Mon through Display configuration”, or enter "0" in the specific TB15 protocol selection Modbus resistor address.

NOTICE
Earlier versions of this software may not support all of the Modbus registers in the following table. If a particular register is not available in your installation, it is possible that the Modbus connection is working but the controller software does not support that particular register.

TABLE 74. PS060X MODBUS REGISTER MAP

Addr	Parameter	Access	Specifications	Description	Control
400009	Application Device Type	Read Only	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: NA Lower Limit: 0 Upper Limit: 65535	The common device type identifier parameter for all PGBASE applications	PS060X
400010	Control Switch Position	Read Only	0: Off 1: Auto 2: Manual	Current position of the generator set switch panel Off-Run-Auto switch as seen by the generator set control	PS060X

Addr	Parameter	Access	Specifications	Description	Control
400011	Genset State	Read Only	0: Off 1: Stop 2: Preheat 3: Precrank 4: Crank 5: Starter Disconnect 6: PreRamp 7: Ramp 8: Running 9: Fault Shutdown 10: Prerun Setup 11: Runtime Setup 12: Factory Test 13: Waiting For Powerdown	Provides the state in which the generator set is currently present	PS060X
400012	Current Fault	Read Only	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: NA Lower Limit: 0 Upper Limit: 65535	Fault number of active fault; clears when all faults are Inactive	PS060X
400013	Current Fault Severity	Read Only	0: None 1: Warning 2: Shutdown	Displays fault severity of recently occurred fault	PS060X
400016	NFPA 110 Fault Register	Read Only	Multiplier: 1 Size (Bits): 32 Data Type: uint32 Unit: NA Lower Limit: 0 Upper Limit: 4294967295	32-bit number to represent the status of the NFPA 110 fault register; refer to the NFPA 110 Bitmap (PS060X) section	PS060X
400018	Genset L1-N RMS Voltage	Read Only	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: V Lower Limit: 0 Upper Limit: 45000	RMS Voltage between Line 1 and Neutral	PS060X
400019	Genset L2-N RMS Voltage	Read Only	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: V Lower Limit: 0 Upper Limit: 45000	RMS Voltage between Line 2 and Neutral	PS060X

Addr	Parameter	Access	Specifications	Description	Control
400020	Genset L3-N RMS Voltage	Read Only	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: V Lower Limit: 0 Upper Limit: 45000	RMS Voltage between Line 3 and Neutral	PS060X
400022	Genset L1-L2 RMS Voltage	Read Only	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: V Lower Limit: 0 Upper Limit: 45000	RMS Voltage between Line 1 and Line 2	PS060X
400023	Genset L2-L3 RMS Voltage	Read Only	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: V Lower Limit: 0 Upper Limit: 45000	RMS Voltage between Line 2 and Line 3	PS060X
400024	Genset L3-L1 RMS Voltage	Read Only	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: V Lower Limit: 0 Upper Limit: 45000	RMS Voltage between Line 3 and Line 1	PS060X
400026	Genset L1 RMS Current	Read Only	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: Amps Lower Limit: 0 Upper Limit: 10000	RMS Current through Line 1	PS060X
400027	Genset L2 RMS Current	Read Only	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: Amps Lower Limit: 0 Upper Limit: 10000	RMS Current through Line 2	PS060X
400028	Genset L3 RMS Current	Read Only	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: Amps Lower Limit: 0 Upper Limit: 10000	RMS Current through Line 3	PS060X

Addr	Parameter	Access	Specifications	Description	Control
400031	Genset L1 kW	Read Only	Multiplier: 1 Size (Bits): 16 Data Type: int16 Unit: kW Lower Limit: -10000 Upper Limit: 10000	kW value at Line 1	PS060X
400032	Genset L2 kW	Read Only	Multiplier: 1 Size (Bits): 16 Data Type: int16 Unit: kW Lower Limit: -10000 Upper Limit: 10000	kW value at Line 2	PS060X
400033	Genset L3 kW	Read Only	Multiplier: 1 Size (Bits): 16 Data Type: int16 Unit: kW Lower Limit: -10000 Upper Limit: 10000	kW value at Line 3	PS060X
400034	Genset Total kW	Read Only	Multiplier: 1 Size (Bits): 16 Data Type: int16 Unit: kW Lower Limit: -10000 Upper Limit: 10000	Sum of kW values of all phases	PS060X
400035	Genset L1 kVAr	Read Only	Multiplier: 1 Size (Bits): 16 Data Type: int16 Unit: kVAr Lower Limit: -10000 Upper Limit: 10000	kVAR value at Line 1	PS060X
400036	Genset L2 kVAr	Read Only	Multiplier: 1 Size (Bits): 16 Data Type: int16 Unit: kVAr Lower Limit: -10000 Upper Limit: 10000	kVAR value at Line 2	PS060X
400037	Genset L3 kVAr	Read Only	Multiplier: 1 Size (Bits): 16 Data Type: int16 Unit: kVAr Lower Limit: -10000 Upper Limit: 10000	kVAR value at Line 3	PS060X

Addr	Parameter	Access	Specifications	Description	Control
400038	Genset Total kVAr	Read Only	Multiplier: 1 Size (Bits): 16 Data Type: int16 Unit: kVAr Lower Limit: -10000 Upper Limit: 10000	Total kVAR Value	PS060X
400040	Genset L1 kVA	Read Only	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: kVA Lower Limit: 0 Upper Limit: 10000	kVA value at Line 1	PS060X
400041	Genset L2 kVA	Read Only	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: kVA Lower Limit: 0 Upper Limit: 10000	kVA value at Line 2	PS060X
400042	Genset L3 kVA	Read Only	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: kVA Lower Limit: 0 Upper Limit: 10000	kVA value at Line 3	PS060X
400043	Genset Total kVA	Read Only	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: kVA Lower Limit: 0 Upper Limit: 10000	Sum of kVA values of all phases	PS060X
400044	Genset Frequency	Read Only	Multiplier: 0.01 Size (Bits): 16 Data Type: uint16 Unit: Hz Lower Limit: 0 Upper Limit: 100	Measured Frequency for Meter1	PS060X
400058	Genset L1 RMS Current %	Read Only	Multiplier: 0.1 Size (Bits): 16 Data Type: uint16 Unit: % Lower Limit: 0 Upper Limit: 1000	% RMS Current value at Line 1	PS060X

Addr	Parameter	Access	Specifications	Description	Control
400059	Genset L2 RMS Current %	Read Only	Multiplier: 0.1 Size (Bits): 16 Data Type: uint16 Unit: % Lower Limit: 0 Upper Limit: 1000	% RMS Current value at Line 2	PS060X
400060	Genset L3 RMS Current %	Read Only	Multiplier: 0.1 Size (Bits): 16 Data Type: uint16 Unit: % Lower Limit: 0 Upper Limit: 1000	% RMS Current value at Line 3	PS060X
400061	Battery Voltage	Read Only	Multiplier: 0.001 Size (Bits): 16 Data Type: uint16 Unit: V Lower Limit: 0 Upper Limit: 41	Measured battery voltage value.	PS060X
400062	Oil Pressure	Read Only	Multiplier: 0.1 Size (Bits): 16 Data Type: uint16 Unit: psi Lower Limit: 0 Upper Limit: 900	Metered Engine Oil Pressure	PS060X
400063	Oil Temperature	Read Only	Multiplier: 0.1 Size (Bits): 16 Data Type: int16 Unit: degF Lower Limit: 459.4 Upper Limit: 3154.9	Monitor point for Oil Temperature	PS060X
400064	Coolant Temperature	Read Only	Multiplier: 0.1 Size (Bits): 16 Data Type: int16 Unit: degF Lower Limit: -40 Upper Limit: 410	Metered Engine Coolant Temperature value in DegF	PS060X
400065	Intake Manifold Temperature	Read Only	Multiplier: 0.1 Size (Bits): 16 Data Type: int16 Unit: degF Lower Limit: 40 Upper Limit: 410	Monitor point for Intake Manifold Temperature	PS060X

Addr	Parameter	Access	Specifications	Description	Control
400066	Fuel Temperature	Read Only	Multiplier: 0.1 Size (Bits): 16 Data Type: int16 Unit: degF Lower Limit: 40 Upper Limit: 410	Monitor point for Fuel Temperature	PS060X
400068	Average Engine Speed	Read Only	Multiplier: 0.125 Size (Bits): 16 Data Type: uint16 Unit: rpm Lower Limit: 0 Upper Limit: 8191.875	Average Engine Speed used for controls and governing.	PS060X
400069	Start Attempts	Guest	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: NA Lower Limit: 0 Upper Limit: 65535	Number of times generator set start request has been provided over the life of unit.	PS060X
400070	Engine Running Time	Guest	Multiplier: 0.05 Size (Bits): 32 Data Type: uint32 Unit: Hours Lower Limit: 0 Upper Limit: 119304.65	Engine Running time in hours; pper limit is 13.6 years	PS060X
400118	Utility L1-N RMS Voltage	Read Only	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: V Lower Limit: 0 Upper Limit: 45000	RMS Voltage between Line 1 and Neutral	PS060X
400119	Utility L2-N RMS Voltage	Read Only	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: V Lower Limit: 0 Upper Limit: 45000	RMS Voltage between Line 2 and Neutral	PS060X
400120	Utility L3-N RMS Voltage	Read Only	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: V Lower Limit: 0 Upper Limit: 45000	RMS Voltage between Line 3 and Neutral	PS060X

Addr	Parameter	Access	Specifications	Description	Control
400122	Utility L1-L2 RMS Voltage	Read Only	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: V Lower Limit: 0 Upper Limit: 45000	RMS Voltage between Line 1 and Line 2	PS060X
400123	Utility L2-L3 RMS Voltage	Read Only	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: V Lower Limit: 0 Upper Limit: 45000	RMS Voltage between Line 2 and Line 3	PS060X
400124	Utility L3-L1 RMS Voltage	Read Only	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: V Lower Limit: 0 Upper Limit: 45000	RMS Voltage between Line 3 and Line 1	PS060X
400144	Utility Frequency	Read Only	Multiplier: 0.001 Size (Bits): 32 Data Type: uint32 Unit: Hz Lower Limit: 0 Upper Limit: 100	Measured Frequency for Meter 2	PS060X
400146	Customer Input #5	Read Only	0: IsFalse 1: IsTrue	Digital status of Customer Input #5	PS060X
400147	Customer Input #6	Read Only	0: IsFalse 1: IsTrue	Digital status of Customer Input #6	PS060X
400148	Diagnostic Output #7 Output Status	Read Only	0: IsFalse 1: IsTrue	Digital output command to Customer Output #7	PS060X
400149	Diagnostic Output #8 Output Status	Read Only	0: IsFalse 1: IsTrue	Digital output command to Customer Output #8	PS060X
400150	Diagnostic Output #9 Output Status	Read Only	0: IsFalse 1: IsTrue	Digital output command to Customer Output #9	PS060X
400151	Diagnostic Output #4 Fault Code	Guest	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: N/A Lower Limit: 0 Upper Limit: 65535	Sets the diagnostic code to activate Customer Output #4 actuator	PS060X

Addr	Parameter	Access	Specifications	Description	Control
400152	Diagnostic Output #6 Fault Code	Guest	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: N/A Lower Limit: 0 Upper Limit: 65535	Sets the diagnostic code to activate Customer Output #6 actuator	PS060X
400153	Diagnostic Output #5 Fault Code	Guest	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: N/A Lower Limit: 0 Upper Limit: 65535	Sets the diagnostic code to activate Customer Output #5 actuator	PS060X
400154	Customer Input #4 Fault Response	Guest	0: None 1: Warning 2: Shutdown	Fault response for Customer Input #4	PS060X
400155	Customer Input #5 Fault Response	Guest	0: None 1: Warning 2: Shutdown	Fault response for Customer Input #5	PS060X
400156	Customer Input #6 Fault Response	Guest	0: None 1: Warning 2: Shutdown	Fault response for Customer Input #6	PS060X
400157	Customer Input #4	Read Only	0: IsFalse 1: IsTrue	Digital status of Customer Input #4	PS060X
400160	TB17-4 Sensor Selection	Guest	0: Not Connected 1: Diagnostic Input #4	Sets the value of TB17-4 Sensor Selection	PS060X
400161	TB17-5 Sensor Selection	Guest	0: Not Connected 1: Diagnostic Input #5	Sets the value of TB17-5 Sensor Selection	PS060X
400162	TB17-6 Sensor Selection	Guest	0: Not Connected 1: Diagnostic Input #6	Sets the value of TB17-6 Sensor Selection	PS060X
400207	Charging Alternator Voltage	Read Only	Multiplier: 0.001 Size (Bits): 16 Data Type: uint16 Unit: V Lower Limit: 0 Upper Limit: 41	Measured Charging Alternator voltage value	PS060X
400228	Amber Warning Lamp Status	Read Only	0: Inactive 1: Active	Engine Control System warning condition	PS060X

Addr	Parameter	Access	Specifications	Description	Control
400230	Boost Pressure	Read Only	Multiplier: 0.1 Size (Bits): 16 Data Type: uint16 Unit: psi Lower Limit: 0 Upper Limit: 145	Monitor point for Boost Absolute Pressure	PS060X
400231	CAN Datalink Status	Read Only	0: Inactive 1: Active 2: Failed	Status of CAN Datalink	PS060X
400232	Crankcase Pressure	Read Only	Multiplier: 0.1 Size (Bits): 16 Data Type: int16 Unit: psi Lower Limit: 36.2 Upper Limit: 40.0	Monitor point for Crankcase Pressure	PS060X
400238	PGI Major Version	Read Only	Multiplier: 1 Size (Bits): 8 Data Type: uint8 Unit: N/A Lower Limit: 0 Upper Limit: 255	Power Generation Interface Major Version to which Engine Software is complying	PS060X
400239	PGI Minor Version	Read Only	Multiplier: 1 Size (Bits): 8 Data Type: uint8 Unit: N/A Lower Limit: 0 Upper Limit: 255	Power Generation Interface Minor Version to which Engine Software is complying	PS060X
400240	PGI Informational Version	Read Only	Multiplier: 1 Size (Bits): 8 Data Type: uint8 Unit: N/A Lower Limit: 0 Upper Limit: 255	Power Generation Interface Informational Version to which Engine Software is complying	PS060X
400254	Fuel Supply Pressure	Read Only	Multiplier: 0.1 Size (Bits): 16 Data Type: uint16 Unit: psi Lower Limit: 0 Upper Limit: 145	Monitor point for Fuel Supply Pressure	PS060X

Addr	Parameter	Access	Specifications	Description	Control
400258	Fuel Outlet Pressure	Read Only	Multiplier: 0.1 Size (Bits): 32 Data Type: uint32 Unit: psi Lower Limit: 0 Upper Limit: 36404	Monitor point for Fuel Outlet Pressure (Fuel Rail Pressure)	PS060X
400264	Percent Engine Torque/Duty Cycle	Read Only	Multiplier: 1 Size (Bits): 16 Data Type: int16 Unit: Percent Lower Limit: 125 Upper Limit: 125	Monitor point for the percent engine torque output and the governor percent duty cycle output when used with the HM ECM	PS060X
400300	Modbus Remote Start	Guest	0: Inactive 1: Active	Modbus Remote Start	PS060X
400301	Modbus Fault Reset	Guest	0: Inactive 1: Active	Fault reset via Modbus	PS060X
400302	Network Shutdown Modbus Command	Guest	0: Inactive 1: Active	Displays network shutdown Modbus command as received from Modbus master; set to simulate the associated diagnostic	PS060X
400535	Diagnostic Output #1 Fault Code	Guest	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: NA Lower Limit: 0 Upper Limit: 65535	Sets the diagnostic code to activate Customer Output #1 actuator	PS060X
400536	Diagnostic Output #2 Fault Code	Guest	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: NA Lower Limit: 0 Upper Limit: 65535	Sets the diagnostic code to activate Customer Output #2 actuator	PS060X
400540	Diagnostic Output #3 Output Status	Read Only	0: IsFalse 1: IsTrue	The digital output command to the Customer Output #3	PS060X
400541	Diagnostic Output #4 Output Status	Read Only	0: IsFalse 1: IsTrue	The digital output command to the Customer Output #4	PS060X
400543	Fuel Shutoff Output Status	Read Only	0: IsFalse 1: IsTrue	The digital output command to the Fuel Shutoff actuator	PS060X
400547	Keyswitch Command	Guest	0: Inactive 1: Active	Status of Keyswitch command	PS060X

Addr	Parameter	Access	Specifications	Description	Control
400552	Diagnostic Output #6 Output Status	Read Only	0: IsFalse 1: IsTrue	The digital output command to the Customer Output #6	PS060X
400553	Diagnostic Output #5 Output Status	Read Only	0: IsFalse 1: IsTrue	The digital output command to the Customer Output #5	PS060X
400557	Starter Output Status	Read Only	0: IsFalse 1: IsTrue	The digital output command to the Starter actuator	PS060X
400585	Exhaust Gas Temperature	Read Only	Multiplier: 0.1 Size (Bits): 16 Data Type: int16 Unit: degF Lower Limit: 459.4 Upper Limit: 3154.9	Monitor point for Exhaust Gas Temperature	PS060X
400597	SCR Thermal Management Active	Read Only	0: Inactive 1: Active 2: Not Available 3: Network Failure	Indicates that the exhaust temperatures have been elevated for regeneration of the SCR aftertreatment system or in preparation of regeneration of the SCR aftertreatment system	PS060X
400616	DPF Thermal Management Active	Read Only	0: Inactive 1: Active 2: Not Available 3: Network Failure	Indicates that the exhaust temperatures have been elevated for regeneration of the diesel particulate filter aftertreatment system or in preparation of regeneration of the diesel particulate aftertreatment system	PS060X
400617	AT Diesel Oxidation Catalyst Intake Gas Temperature	Read Only	Multiplier: 0.1 Size (Bits): 16 Data Type: int16 Unit: degF Lower Limit: 459.4 Upper Limit: 3154.9	Indicates the temperature of engine combustion by products entering the diesel oxidation catalyst in exhaust bank 1	PS060X
400709	Application Device Type	Read Only	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: NA Lower Limit: 0 Upper Limit: 65535	The common device type identifier parameter for all PGBASE applications	PS060X
401000	Metering Phase Config	Technician	0: Three Phase Wye 1: Three Phase Delta 2: Single Phase 3: Split Phase	Used to select the phase configuration and Delta/Wye configuration for AC power distribution	PS060X

Addr	Parameter	Access	Specifications	Description	Control
401001	Customer Input #3 Fault Response	Guest	0: None 1: Warning 2: Shutdown	The fault response for Customer Input #3	PS060X
401002	Active Shutdown Fault Code Row 1	Read Only	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: NA Lower Limit: 0 Upper Limit: 65535	First entry of Active shutdown fault code present in Active Shutdown Fault table	PS060X
401003	Active Shutdown Fault Code Row 2	Read Only	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: NA Lower Limit: 0 Upper Limit: 65535	Second entry of Active shutdown fault code present in Active Shutdown Fault table	PS060X
401004	Active Shutdown Fault Code Row 3	Read Only	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: NA Lower Limit: 0 Upper Limit: 65535	Third entry of Active shutdown fault code present in Active Shutdown Fault table	PS060X
401005	Active Shutdown Fault Code Row 4	Read Only	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: NA Lower Limit: 0 Upper Limit: 65535	Fourth entry of Active shutdown fault code present in Active Shutdown Fault table	PS060X
401006	Active Shutdown Fault Code Row 5	Read Only	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: NA Lower Limit: 0 Upper Limit: 65535	Fifth entry of Active shutdown fault code present in Active Shutdown Fault table	PS060X
401007	Active Shutdown Fault Code Row 6	Read Only	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: NA Lower Limit: 0 Upper Limit: 65535	Sixth entry of Active shutdown fault code present in Active Shutdown Fault table	PS060X

Addr	Parameter	Access	Specifications	Description	Control
401008	Active Shutdown Fault Code Row 7	Read Only	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: NA Lower Limit: 0 Upper Limit: 65535	Seventh entry of Active shutdown fault code present in Active Shutdown Fault table	PS060X
401009	Active Shutdown Fault Code Row 8	Read Only	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: NA Lower Limit: 0 Upper Limit: 65535	Eighth entry of Active shutdown fault code present in Active Shutdown Fault table	PS060X
401010	Active Shutdown Fault Code Row 9	Read Only	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: NA Lower Limit: 0 Upper Limit: 65535	Ninth entry of Active shutdown fault code present in Active Shutdown Fault table	PS060X
401011	Active Shutdown Fault Code Row 10	Read Only	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: NA Lower Limit: 0 Upper Limit: 65535	Tenth entry of Active shutdown fault code present in Active Shutdown Fault table	PS060X
401012	Active Warning Fault Code Row 1	Read Only	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: NA Lower Limit: 0 Upper Limit: 65535	First entry of Active warning fault code present in Active warning Fault table	PS060X
401013	Active Warning Fault Code Row 2	Read Only	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: NA Lower Limit: 0 Upper Limit: 65535	Second entry of Active warning fault code present in Active warning Fault table	PS060X
401014	Active Warning Fault Code Row 3	Read Only	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: NA Lower Limit: 0 Upper Limit: 65535	Third entry of Active warning fault code present in Active warning Fault table	PS060X

Addr	Parameter	Access	Specifications	Description	Control
401015	Active Warning Fault Code Row 4	Read Only	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: NA Lower Limit: 0 Upper Limit: 65535	Fourth entry of Active warning fault code present in Active warning Fault table	PS060X
401016	Active Warning Fault Code Row 5	Read Only	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: NA Lower Limit: 0 Upper Limit: 65535	Fifth entry of Active warning fault code present in Active warning Fault table	PS060X
401017	Active Warning Fault Code Row 6	Read Only	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: NA Lower Limit: 0 Upper Limit: 65535	Sixth entry of Active warning fault code present in Active warning Fault table	PS060X
401018	Active Warning Fault Code Row 7	Read Only	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: NA Lower Limit: 0 Upper Limit: 65535	Seventh entry of Active warning fault code present in Active warning Fault table	PS060X
401019	Active Warning Fault Code Row 8	Read Only	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: NA Lower Limit: 0 Upper Limit: 65535	Eighth entry of Active warning fault code present in Active warning Fault table	PS060X
401020	Active Warning Fault Code Row 9	Read Only	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: NA Lower Limit: 0 Upper Limit: 65535	Ninth entry of Active warning fault code present in Active warning Fault table	PS060X
401021	Active Warning Fault Code Row 10	Read Only	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: NA Lower Limit: 0 Upper Limit: 65535	Tenth entry of Active warning fault code present in Active warning Fault table	PS060X

Addr	Parameter	Access	Specifications	Description	Control
401022	Auto Mains Failure Enable	Guest	0: Disable 1: Enable	Used to enable or disable the Auto Mains Failure Feature	PS060X
401023	Load Transfer Switch Type	Guest	0: GTEC 1: Contact Pair	Provides the type of Load Transfer Switch	PS060X
401024	AMF State	Read Only	0: AMF Not Available 1: Transfer Retransfer Off 2: Utility Pickup 3: Utility Dropout 4: Genset Starting 5: Transfer Start 6: Utility CB Opened 7: Genset CB Closed 8: Transfer Complete 9: Retransfer Start 10: Genset CB Opened 11: Utility CB Closed 12: Retransfer Complete 13: Transfer Fail 14: Retransfer Fail	Provides the state in which the Auto Mains Failure is currently present	PS060X
401025	Transfer Switch Feedback Status	Read Only	0: Not Available 1: At Utility 2: At Genset 3: Unknown Open 4: Unknown Closed	Provides value of Transfer switch feedback status	PS060X
402355	Time Delay Engine Start	Guest	Multiplier: 0.1 Size (Bits): 16 Data Type: uint16 Unit: sec Lower Limit: 0 Upper Limit: 3600	Provides the value of Time Delay Engine Start (TDES)	PS060X
402356	Time Delay Engine Cooldown	Guest	Multiplier: 0.1 Size (Bits): 16 Data Type: uint16 Unit: sec Lower Limit: 0 Upper Limit: 3600	Provides the value of Time Delay Engine Cooldown (TDEC)	PS060X
402357	AT DEF Tank Level	Read Only	Multiplier: 0.1 Size (Bits): 16 Data Type: uint16 Unit: % Lower Limit: 0 Upper Limit: 100	After Treatment Diesel Exhaust Fluid Tank Level	PS060X

Addr	Parameter	Access	Specifications	Description	Control
402358	AT DEF Concentration	Read Only	Multiplier: 0.1 Size (Bits): 16 Data Type: uint16 Unit: % Lower Limit: 0 Upper Limit: 100	After Treatment Diesel Exhaust Fluid Concentration	PS060X
402359	AT DEF Tank Temperature	Read Only	Multiplier: 1 Size (Bits): 16 Data Type: int16 Unit: degF Lower Limit: 40 Upper Limit: 410	After Treatment Diesel Exhaust Fluid Tank Temperature	PS060X
402360	Aftertreatment SCR Catalyst outlet Gas Temperature	Read Only	Multiplier: 1 Size (Bits): 16 Data Type: int16 Unit: degF Lower Limit: 459.4 Upper Limit: 3154.943	Temperature of engine combustion by products leaving the SCR catalyst exhaust in exhaust bank 1	PS060X
402361	AT 2 SCR Catalyst Outlet Gas Temperature	Read Only	Multiplier: 0.1 Size (Bits): 16 Data Type: int16 Unit: degF Lower Limit: 459.4 Upper Limit: 3154.9	Temperature of engine combustion by products leaving the SCR catalyst exhaust in exhaust bank 2	PS060X
402362	AT 1 DEF Actual Dosing Quantity	Read Only	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: g/f Lower Limit: 0 Upper Limit: 19277	Quantity of diesel exhaust fluid injected in the aftertreatment 1 system	PS060X
402363	AT 2 DEF Actual Dosing Quantity	Read Only	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: g/f Lower Limit: 0 Upper Limit: 19277	Actual reducing agent quantity of SCR system	PS060X
402365	Operator Inducement Time To Torque Derate Level 1	Read Only	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: min Lower Limit: 0 Upper Limit: 64255	Monitor point for Time to Torque Derate Level 1	PS060X

Addr	Parameter	Access	Specifications	Description	Control
402366	Operator Inducement Time To Torque Derate Level 2	Read Only	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: min Lower Limit: 0 Upper Limit: 64255	Monitor point for Time to Torque Derate Level 2	PS060X
402367	Operator Inducement Time To Final Inducement Action	Read Only	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: min Lower Limit: 0 Upper Limit: 64255	Monitor point for Time to Final Inducement Action	PS060X
402368	AT 1 DEF Tank 1 Low Level Indicator	Read Only	0: OFF 1: On Solid 2: On Fast Blink 3: Not Available 4: Network Failure	Driver's warning indicator for diesel exhaust fluid (DEF) tank low level	PS060X
403000	Genset Nominal Voltage	Technician	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: V Lower Limit: 1 Upper Limit: 45000	Nominal voltage for the source	PS060X
403001	System Nominal Frequency	Operator	0: 50 Hz 1: 60 Hz	AC frequency of the power system	PS060X
403005	Charging Alternator Enable	Guest	0: Disable 1: Enable	Used to disable the controller related charging alternator functions	PS060X
403006	Start Time Delay	Technician	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: sec Lower Limit: 0 Upper Limit: 300	Time delay before engine cranks after remote start status becomes active	PS060X
403007	Stop Time Delay	Technician	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: sec Lower Limit: 0 Upper Limit: 600	Time delay after which the engine initiation of cooldown/stop sequence.	PS060X

Addr	Parameter	Access	Specifications	Description	Control
403008	Crank Attempts	Guest	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: NA Lower Limit: 1 Upper Limit: 7	The trim provides number of crank attempts for each genset start request	PS060X
403009	Cycle Crank Engage Time	Guest	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: sec Lower Limit: 2 Upper Limit: 20	Sets the time to engage the starter during a single crank attempt for cycle crank mode	PS060X
403010	Cycle Crank Rest Time	Guest	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: sec Lower Limit: 7 Upper Limit: 40	Sets the starter rest time between start attempts for cycle crank mode	PS060X
403011	Battleshort Enable	Guest	0: Disable 1: Enable	Used to enable or disable the Battle short Feature.	PS060X
403012	TB16-10 Sensor Selection	Guest	0: Not Connected 1: Diagnostic Input #1 2: Battle Short	Used to set the value of TB16-10 Sensor Selection	PS060X
403019	Electronic Governor Enable	Read and Write	0: Disable 1: Enable	Electronic Governor enable feature	PS060X
403020	Initial Crank Fueling Duty Cycle	Read and Write	Multiplier: 0.1 Size (Bits): 16 Data type: uint16 Unit: % Lower Limit: 0 Upper Limit: 100	Electronic governing initial duty cycle setting	PS060X
403021	Initial Crank Fueling Period	Read and Write	Multiplier: 0.1 Size (Bits): 8 Data Type: uint8 Unit: Sec Lower Limit: 0 Upper Limit: 10	Time spent at Initial Crank Fueling Command	PS060X

Addr	Parameter	Access	Specifications	Description	Control
403022	Crank Fueling Ramp Rate	Read and Write	Multiplier: 0.1 Size (Bits): 16 Data Type: uint16 Unit: %/Sec Lower Limit: 5 Upper Limit: 100	Electronic Governing Start ramp duty cycle setting	PS060X
403023	Max Crank Fuel Duty Cycle	Read and Write	Multiplier: 0.1 Size (Bits): 16 Data Type: uint16 Unit: % Lower Limit: 50 Upper Limit: 100	Electronic Governing Maximum duty cycle setting	PS060X
403024	Governor Gain Adjust	Read and Write	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: % Lower Limit: 5 Upper Limit: 1000	Electronic Governing Gain Setting	PS060X
403025	GK2 Gain Adjust	Read and Write	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: % Lower Limit: 5 Upper Limit: 1000	Electronic Governing K2 gain setting	PS060X
403026	Governor Damping Effect Adjust	Read and Write	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: % Lower Limit: 95 Upper Limit: 105	Electronic Governor Damping Adjustment	PS060X
403027	Crank Exit Fuel Duty Cycle	Read and Write	Multiplier: 0.1 Size (Bits): 16 Data Type: uint16 Unit: % Lower Limit: 0 Upper Limit: 100	Electronic Governing Crank Exit Fuel duty cycle setting	PS060X
403028	Dither Factor	Read and Write	Multiplier: 0.01 Size (Bits): 16 Data Type: uint16 Unit: % Lower Limit: 0 Upper Limit: 30	Electronic Governing Dither Factor setting	PS060X

Addr	Parameter	Access	Specifications	Description	Control
403029	Governor Ramp Time	Read and Write	Multiplier: 0.01 Size (Bits): 16 Data Type: uint16 Unit: sec Lower Limit: 0 Upper Limit: 30	Electronic governing start ramp time setting	PS060X
403030	Governor Enable Engine Speed	Read and Write	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: r/min (rpm) Lower Limit: 601 Upper Limit: 1400	Engine Speed at which the governor is enabled	PS060X
403031	Minimum Duty Cycle	Read and Write	Multiplier: 1 Size (Bits): 8 Data Type: uint8 Unit: % Lower Limit: 0 Upper Limit: 100	Setting for Electronic Governor minimum Duty Cycle	PS060X
403032	Maximum Duty Cycle	Read and Write	Multiplier: 1 Size (Bits): 8 Data Type: uint8 Unit: % Lower Limit: 0 Upper Limit: 100	Setting for Electronic Governor maximum Duty Cycle	PS060X
403033	Genset Model Number	Guest	Multiplier: 1 Size (Bits): 168 Data Type: string20 Unit: NA Lower Limit: 0 Upper Limit: 999999999	Number identifying the model of this generator set	PS060X
403049	Genset Serial Number	Guest	Multiplier: 1 Size (Bits): 168 Data Type: string20 Unit: NA Lower Limit: 0 Upper Limit: 999999999	Serial number for identifying this generator set	PS060X
403065	Customer Input #1 Fault Response	Guest	0: None 1: Warning 2: Shutdown	The fault response for Customer Input #1	PS060X
403066	Customer Input #2 Fault Response	Guest	0: None 1: Warning 2: Shutdown	The fault response for Customer Input #2	PS060X

Addr	Parameter	Access	Specifications	Description	Control
403067	Diagnostic Output #1 Output Status	Read Only	0: IsFalse 1: IsTrue	The digital output command to the Customer Output #1	PS060X
403068	Diagnostic Output #2 Output Status	Read Only	0: IsFalse 1: IsTrue	The digital output command to the Customer Output #2	PS060X
403309	Over Frequency Shutdown Enable	Guest	0: Disable 1: Enable	Enables overfrequency diagnostic	PS060X
403344	Clock Day	Technician	Multiplier: 1 Size (Bits): 8 Data Type: uint8 Unit: NA Lower Limit: 1 Upper Limit: 31	Provides the value of Clock Day	PS060X
403345	Clock Hour	Technician	Multiplier: 1 Size (Bits): 8 Data Type: uint8 Unit: NA Lower Limit: 0 Upper Limit: 23	Provides the value of Clock Hour	PS060X
403346	Clock Minute	Technician	Multiplier: 1 Size (Bits): 8 Data Type: uint8 Unit: NA Lower Limit: 0 Upper Limit: 59	Provides the value of Clock Minute	PS060X
403347	Clock Mode	Technician	0: Normal 1: Set Clock 2: Save Clock	Set the value of Clock Mode	PS060X
403348	Clock Month	Technician	Multiplier: 1 Size (Bits): 8 Data Type: uint8 Unit: NA Lower Limit: 1 Upper Limit: 12	Provides the value of Clock Month	PS060X
403349	Clock Second	Technician	Multiplier: 1 Size (Bits): 8 Data Type: uint8 Unit: NA Lower Limit: 0 Upper Limit: 59	Provides the value of Clock Second	PS060X

Addr	Parameter	Access	Specifications	Description	Control
403350	Clock Year	Technician	Multiplier: 1 Size (Bits): 8 Data Type: uint8 Unit: NA Lower Limit: 0 Upper Limit: 99	Provides the value of Clock Year	PS060X
403351	Daylight Saving End Hour	Technician	Multiplier: 1 Size (Bits): 8 Data Type: uint8 Unit: NA Lower Limit: 0 Upper Limit: 23	Provides the value of Daylight Saving End Hour	PS060X
403352	Daylight Saving End Month	Technician	Multiplier: 1 Size (Bits): 8 Data Type: uint8 Unit: NA Lower Limit: 1 Upper Limit: 12	Provides the value of Daylight Saving End Month	PS060X
403353	Daylight Saving End Week	Technician	0: Invalid 1: First Occurrence 2: Second Occurrence 3: Third Occurrence 4: Fourth Occurrence 5: Last Occurrence	Provides the value of Daylight Saving End Week	PS060X
403354	Daylight Saving Start Day	Technician	0: Sunday 1: Monday 2: Tuesday 3: Wednesday 4: Thursday 5: Friday 6: Saturday	Provides the value of Daylight Saving Start Day	PS060X
403355	Daylight Saving Start Hour	Technician	Multiplier: 1 Size (Bits): 8 Data Type: uint8 Unit: NA Lower Limit: 0 Upper Limit: 23	Provides the value of Daylight Saving Start Hour	PS060X
403356	Daylight Saving Start Month	Technician	Multiplier: 1 Size (Bits): 8 Data Type: uint8 Unit: NA Lower Limit: 1 Upper Limit: 12	Provides the value of Daylight Saving Start Month	PS060X

Addr	Parameter	Access	Specifications	Description	Control
403357	Daylight Saving Start Week	Technician	0: Invalid 1: First Occurrence 2: Second Occurrence 3: Third Occurrence 4: Fourth Occurrence 5: Last Occurrence	Provides the value of Daylight Saving Start Week	PS060X
403358	Daylight Saving Time Adjustment	Technician	Multiplier: 1 Size (Bits): 8 Data Type: uint8 Unit: min Lower Limit: 0 Upper Limit: 120	Value of Daylight Saving Time Adjustment	PS060X
403359	Daylight Saving Time Enable	Technician	0: Disable 1: Enable	Used to Enable or Disable the value of Daylight Saving Time	PS060X
403376	Scheduler Program Duration Minute	Guest	Multiplier: 1 Size (Bits): 8 Data Type: uint8 Unit: min Lower Limit: 1 Upper Limit: 60	Used to adjust the length in minutes for the selected program.	PS060X
403377	Scheduler Program Enable	Guest	0: Disable 1: Enable	Used to enable or disable the selected program	PS060X
403378	Scheduler Program Repeat Interval	Guest	0: Weekly 1: Bi-Monthly 2: Monthly 3: Quarterly 4: Semi-Annually	Used to adjust the repeat interval for the selected program	PS060X
403380	Scheduler Program Start Day	Guest	0: Sunday 1: Monday 2: Tuesday 3: Wednesday 4: Thursday 5: Friday 6: Saturday	Used to adjust the start day of the week for the selected program	PS060X
403381	Scheduler Program Start Hour	Guest	Multiplier: 1 Size (Bits): 8 Data Type: uint8 Unit: Hours Lower Limit: 0 Upper Limit: 23	Used to adjust the start hour for the selected program	PS060X

Addr	Parameter	Access	Specifications	Description	Control
403382	Scheduler Program Start Minute	Guest	Multiplier: 1 Size (Bits): 8 Data Type: uint8 Unit: min Lower Limit: 0 Upper Limit: 59	Used to adjust the start minute for the selected program	PS060X
403383	Daylight Saving End Day	Technician	0: Sunday 1: Monday 2: Tuesday 3: Wednesday 4: Thursday 5: Friday 6: Saturday	Provides the value of Daylight Saving End Day	PS060X
403511	Low Battery Voltage Threshold	Read Only	Multiplier: 0.1 Size (Bits): 16 Data Type: uint16 Unit: V Lower Limit: 0 Upper Limit: 99	Holds low battery voltage fault threshold value based upon 12V/24V	PS060X
403550	Weak Battery Voltage Threshold	Read Only	Multiplier: 0.1 Size (Bits): 16 Data Type: uint16 Unit: V Lower Limit: 0 Upper Limit: 99	Holds weak battery voltage fault threshold value based upon 12V/24V	PS060X
403551	Weak Battery Voltage Set Time	Guest	Multiplier: 1 Size (Bits): 8 Data Type: uint8 Unit: sec Lower Limit: 1 Upper Limit: 5	The time delay until a weak battery condition is reported as a fault	PS060X
403562	Customer Input #3	Read Only	0: IsFalse 1: IsTrue	The digital status of Customer Input #3	PS060X
403599	Customer Input #2	Read Only	0: IsFalse 1: IsTrue	The digital status of Customer Input #2	PS060X
403645	LCL Detection Response	Technician	0: None 1: Warning 2: Shutdown	Sets low coolant level fault response	PS060X

Addr	Parameter	Access	Specifications	Description	Control
403647	Low Coolant Temperature Warning Set Time	Guest	Multiplier: 1 Size (Bits): 8 Data Type: uint8 Unit: min Lower Limit: 0 Upper Limit: 30	Sets time to set the low coolant temperature fault	PS060X
403648	Low Coolant Temperature Warning Threshold	Guest	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: degF Lower Limit: -20 Upper Limit: 130	Sets threshold for the low coolant temperature fault warning	PS060X
403651	High Battery Voltage Threshold 12V	Guest	Multiplier: 0.1 Size (Bits): 16 Data Type: uint16 Unit: V Lower Limit: 14 Upper Limit: 17	Sets 12V high battery voltage fault threshold	PS060X
403652	Low Battery Voltage Running Threshold 12V	Guest	Multiplier: 0.1 Size (Bits): 16 Data Type: uint16 Unit: V Lower Limit: 12 Upper Limit: 16	Sets 12V low battery voltage fault threshold for generator set operation while in rated mode	PS060X
403653	Low Battery Voltage Stopped Threshold 12V	Guest	Multiplier: 0.1 Size (Bits): 8 Data Type: uint8 Unit: V Lower Limit: 10 Upper Limit: 13	Sets 12V low battery voltage fault threshold for generator set operation in all modes except rated	PS060X
403654	Weak Battery Voltage Threshold 12V	Guest	Multiplier: 0.1 Size (Bits): 16 Data Type: uint16 Unit: V Lower Limit: 6 Upper Limit: 10	Sets 12V weak battery voltage fault threshold	PS060X
403655	High Battery Voltage Threshold 24V	Guest	Multiplier: 0.1 Size (Bits): 16 Data Type: uint16 Unit: V Lower Limit: 28 Upper Limit: 34	Sets 24V high battery voltage fault threshold	PS060X

Addr	Parameter	Access	Specifications	Description	Control
403656	Low Battery Voltage Running Threshold 24V	Guest	Multiplier: 0.1 Size (Bits): 16 Data Type: uint16 Unit: V Lower Limit: 24 Upper Limit: 28	Sets 24V low battery voltage fault threshold for generator set operation while in rated mode	PS060X
403657	Low Battery Voltage Stopped Threshold 24V	Guest	Multiplier: 0.1 Size (Bits): 16 Data Type: uint16 Unit: V Lower Limit: 22 Upper Limit: 26	Sets 24V low battery voltage fault threshold for generator set operation in all modes except rated	PS060X
403658	Weak Battery Voltage Threshold 24V	Guest	Multiplier: 0.1 Size (Bits): 16 Data Type: uint16 Unit: V Lower Limit: 10 Upper Limit: 16	Sets 24V weak battery voltage fault threshold	PS060X
403662	Charging Alternator Set Time	Guest	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: sec Lower Limit: 2 Upper Limit: 300	Sets the time delay for the charging alt failure fault	PS060X
403676	High Battery Voltage Threshold	Read Only	Multiplier: 0.1 Size (Bits): 16 Data Type: uint16 Unit: V Lower Limit: 0 Upper Limit: 99	Holds high battery voltage fault threshold value based upon 12V/24V	PS060X
403688	Low Battery Voltage Set Time	Guest	Multiplier: 1 Size (Bits): 8 Data Type: uint8 Unit: sec Lower Limit: 2 Upper Limit: 60	The time delay until a low battery voltage condition is reported as a fault	PS060X
403693	Nominal Battery Voltage	Guest	0: Twelve Volt 1: TwentyFour Volt	Selects the nominal battery operating voltage	PS060X

Addr	Parameter	Access	Specifications	Description	Control
403745	Fuel Level Percent	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 16 Sign: U Unit: Percent Lower Limit: 0 Upper Limit: 65535	Measured fuel level value in percent	PS060X
403746	Fuel Level Sensor (A052T244)	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 16 Sign: U Unit: Litre Lower Limit: 0 Upper Limit: 9999	Measured fuel level value in litre	PS060X
403748	ATS Extended Annunciation	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 16 Sign: U Unit: Percent Lower Limit: 0 Upper Limit: 65535	Displays 16-bit number to represent the status of the NFPA 110 fault register for ATS	PS060X
403778	Exercise Scheduler State	Read Only	0: Inactive 1: Active 2: Abort	Indicates state of an exercise scheduler	PS060X
403793	Customer Input #1	Read Only	0: IsFalse 1: IsTrue	The digital status of Customer Input #1	PS060X
403821	Time Delay Programmed Transition	Operator	Multiplier: 0.1 Size (Bits): 16 Data Type: uint16 Unit: sec Lower Limit: 0 Upper Limit: 600	Provides the value of Time Delay Programmed Transition (TDPT)	PS060X
403822	Time Delay Emergency to Normal	Guest	Multiplier: 0.1 Size (Bits): 16 Data Type: uint16 Unit: sec Lower Limit: 0 Upper Limit: 1800	Provides the Value of Time Delay Emergency to Normal (TDEN)	PS060X

Addr	Parameter	Access	Specifications	Description	Control
403825	Time Delay Normal to Emergency	Guest	Multiplier: 1 Size (Bits): 16 Data Type: uint16 Unit: sec Lower Limit: 0 Upper Limit: 300	Provides the value of Time Delay Normal to Emergency (TDNE)	PS060X
403828	Maintenance RTC Date Interval	Guest	Multiplier: 1 Size (Bits): 8 Data Type: uint8 Unit: NA Lower Limit: 1 Upper Limit: 31	Sets real time clock Date for Maintenance Diagnostic	PS060X
403829	Maintenance RTC Month Interval	Guest	Multiplier: 1 Size (Bits): 8 Data Type: uint8 Unit: NA Lower Limit: 1 Upper Limit: 12	Sets real time clock month for Maintenance Diagnostic	PS060X
403830	Maintenance RTC Year Interval	Guest	Multiplier: 1 Size (Bits): 8 Data Type: uint8 Unit: NA Lower Limit: 0 Upper Limit: 99	Sets real time clock year for Maintenance Diagnostic	PS060X
403831	Maintenance Due WRT ERT	Read Only	Multiplier: 0.01 Size (Bits): 32 Data Type: uint32 Unit: hours Lower Limit: 0 Upper Limit: 119304.65	Displays Maintenance required with respect to engine running hours	PS060X
403952	Speed/Frequency Conflict Shutdown Set Time	Guest	Multiplier: 0.1 Size (Bits): 16 Data Type: uint16 Unit: sec Lower Limit: 0.5 Upper Limit: 10	Sets delay time for generating the Speed/Frequency mismatch fault	PS060X
403953	Speed/Frequency Conflict Shutdown Threshold	Guest	Multiplier: 0.1 Size (Bits): 16 Data Type: uint16 Unit: Hz Lower Limit: 0.5 Upper Limit: 20	Sets the threshold for generating the Speed/Frequency mismatch fault	PS060X

Addr	Parameter	Access	Specifications	Description	Control
405999	Unrecognized SPN/FMI Status	Read Only	0: All Pairs Recognized 1: Pair Not Recognized	DM1 recognition status	PS060X
406109	Engine Operating State	Read Only	0: Engine Stopped 1: Prestart 2: Starting 3: Warmup 4: Running 5: Cooldown 6: Engine Stopping 7: Post Run 8: Out of Range 9: N/A 10: Network Failure	Current state or mode of operation by the engine. Added Network Failure as enum option	PS060X
406124	Coolant Pressure	Read Only	Multiplier: 0.1 Size (Bits): 16 Data Type: int16 Unit: psi Lower Limit: 0 Upper Limit: 100	Monitor point for Coolant Pressure	PS060X
408025	TB15 Modbus Inactivity Interval	Technician	Multiplier: 1 Size (Bits): 8 Data Type: uint8 Unit: sec Lower Limit: 1 Upper Limit: 60	This trim allows for the configuring of the Modbus failure time delay for this port.	PS060X
408028	TB15 Modbus Node Address	Technician	Multiplier: 1 Size (Bits): 8 Data Type: uint8 Unit: NA Lower Limit: 1 Upper Limit: 247	This ports node address is configurable from 1 to 247.	PS060X
408029	TB15 Modbus Access Level	Administrator	0: Guest 1: Operator 2: Technician	Used to select the Access Level of this port	PS060X
408031	TB15 UART Protocol Selection	Technician	0: MON 1: Modbus	Used to select the active protocol on this port	PS060X
408033	TB15 Modbus Parity Stop Bit Selection	Technician	0: None (1 Stop) 1: None (2 Stop) 2: Even (1 Stop) 3: Odd (1 Stop)	This trim allows configuring of the parity and stop bits for this port.	PS060X

Addr	Parameter	Access	Specifications	Description	Control
408035	TB15 Modbus Activity Status	Read Only	0: Not Available 1: Inactive 2: Bus Active 3: Local Active	Updates TB15 ports Modbus communication activity	PS060X
408038	TB15 Modbus Baud Rate Selection	Technician	0: 2400 1: 4800 2: 9600 3: 19200 4: 28800 5: 38400 6: 57600 7: 115200	Sets the TB15 ports' baud rate	PS060X
408039	Save Trims	Operator	0: IsFalse 1: IsTrue	Setting this parameter to IsTrue will trigger a save of all non-volatile trims on the entire device.	PS060X
408041	TB15 Modbus Clear Counters	Technician	0: Inactive 1: Active	Setting this to active clears all the Modbus status counters for TB15 port.	PS060X
408047	Reset Fuel Consumption	Technician	0: Inactive 1: Active	Reset trip fuel consumption command	PS060X
410001	Genset Average Power Factor	Read Only	Multiplier: 0.1 Size (Bits): 32 Data Type: float32 Unit: Lower Limit: -1 Upper Limit: 1	Average power factor of all line power factors	PS060X
410007	Genset L1 Exported kWh	Read Only	Multiplier: 0.1 Size (Bits): 32 Data Type: float32 Unit: kWh Lower Limit: 3.40E+38 Upper Limit: 3.40E+38	Active energy exported by Line 1	PS060X
410009	Genset L1 Imported kVarh	Read Only	Multiplier: 0.1 Size (Bits): 32 Data Type: float32 Unit: kVarh Lower Limit: 3.40E+38 Upper Limit: 3.40E+38	Reactive energy imported by Line 1	PS060X

Addr	Parameter	Access	Specifications	Description	Control
410015	Genset L1 kVah	Read Only	Multiplier: 0.1 Size (Bits): 32 Data Type: float32 Unit: kVah Lower Limit: 3.40E+38 Upper Limit: 3.40E+38	Generator set L1 kVAh accumulation	PS060X
410021	Genset L1 Power Factor	Read Only	Multiplier: 0.1 Size (Bits): 32 Data Type: float32 Unit: Lower Limit: -1 Upper Limit: 1	Generator set L1 Power Factor	PS060X
410031	Genset L2 Exported kWh	Read Only	Multiplier: 0.1 Size (Bits): 32 Data Type: float32 Unit: kWh Lower Limit: 3.40E+38 Upper Limit: 3.40E+38	Active energy exported by Line 2	PS060X
410033	Genset L2 Imported kVarh	Read Only	Multiplier: 0.1 Size (Bits): 32 Data Type: float32 Unit: kVarh Lower Limit: 3.40E+38 Upper Limit: 3.40E+38	Reactive energy imported by Line 2	PS060X
410039	Genset L2 kVah	Read Only	Multiplier: 0.1 Size (Bits): 32 Data Type: float32 Unit: kVah Lower Limit: 3.40E+38 Upper Limit: 3.40E+38	Generator set L2 kVAh accumulation	PS060X
410045	Genset L2 Power Factor	Read Only	Multiplier: 0.1 Size (Bits): 32 Data Type: float32 Unit: Lower Limit: -1 Upper Limit: 1	Generator set L2 Power Factor	PS060X
410055	Genset L3 Exported kWh	Read Only	Multiplier: 0.1 Size (Bits): 32 Data Type: float32 Unit: kWh Lower Limit: 3.40E+38 Upper Limit: 3.40E+38	Active energy exported by Line 3	PS060X

Addr	Parameter	Access	Specifications	Description	Control
410057	Genset L3 Imported kVarh	Read Only	Multiplier: 0.1 Size (Bits): 32 Data Type: float32 Unit: kVarh Lower Limit: 3.40E+38 Upper Limit: 3.40E+38	Reactive energy imported by Line 3	PS060X
410063	Genset L3 kVah	Read Only	Multiplier: 0.1 Size (Bits): 32 Data Type: float32 Unit: kVah Lower Limit: 3.40E+38 Upper Limit: 3.40E+38	Generator set L3 kVAh accumulation	PS060X
410069	Genset L3 Power Factor	Read Only	Multiplier: 0.1 Size (Bits): 32 Data Type: float32 Unit: Lower Limit: -1 Upper Limit: 1	Generator set L3 Power Factor	PS060X
410082	Genset Total Exported kWh	Read Only	Multiplier: 0.1 Size (Bits): 32 Data Type: float32 Unit: kWh Lower Limit: 3.40E+38 Upper Limit: 3.40E+38	Total Active energy exported by Genset	PS060X
410084	Genset Total Imported kVarh	Read Only	Multiplier: 0.1 Size (Bits): 32 Data Type: float32 Unit: kVarh Lower Limit: 3.40E+38 Upper Limit: 3.40E+38	Total reactive energy imported by Genset	PS060X
410090	Genset Total kVah	Read Only	Multiplier: 0.1 Size (Bits): 32 Data Type: float32 Unit: kVah Lower Limit: 3.40E+38 Upper Limit: 3.40E+38	Generator set total kVAh accumulation	PS060X

This page is intentionally blank.

18 TM241 on QSK50 and QSK60 Series Containerized Generator Sets

18.1 PLC Modbus Register Bitmap

TABLE 75. PLC MODBUS REGISTER BITMAP

Address	Parameter	Access	Specifications	Description	Control
40010	G_Controller_Switch_Position	Read Only	0: Off 1: Auto 2: Manual	Current position of the generator switch panel Off–Run–Auto switch as seen by the generator set control	
40011	G_Gen_RunSeq_State	Read Only	0: Stop 1: Time Delay to start 2: Warm up at idle 3: Rated Freq and Voltage 4: Cooldown/Stop Delay 5: Cooldown at Idle 6: Rated to Idle Transition	The current state of the generator set	
40012	G_Most_Recent_Fault	Read Only	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units: Lower Limit: Upper Limit:65530	This modbus register displays most recent Fault or Warning. It is not mapped with any logic	
40013	G_Modbus_Register 40013	Read Only	0: None 1: Warning 2: Derate 3: Shutdown with Cooldown 4: Shutdown	This register returns the Fault Type of the Fault Code. This is not associated with any logic	
40014	G_Percent_kW	Read Only	Multiplier: 0.01 Offset: 0 Size (bits): 16 Sign: S Units: % Lower Limit: Upper Limit:	Monitors the total generator set standby KW percentage output	

Address	Parameter	Access	Specifications	Description	Control
40016	G_NFPA_110(1)	Read Only	Multiplier: 1.0 Offset: 0 Size (bits): 16 Sign: U Units: NA Lower Limit: Upper Limit:	16-bit number to represent the status of the NFPA 110 logical. See Table 76 on page 1018 .	
40017	G_NFPA_110(2)	Read Only	Multiplier: 1.0 Offset: 0 Size (bits): 16 Sign: U Units: NA Lower Limit: Upper Limit:	16-bit number to represent the status of the NFPA 110 logical. See Table 77 on page 1019 .	
40018	G_L1N_Volt	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Units: VAC Lower Limit: Upper Limit:	Generator set L1–N voltage	
40019	G_L2N_Volt	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Units: VAC Lower Limit: Upper Limit:	Generator set L2–N voltage	
40020	G_L3N_Volt	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Units: VAC Lower Limit: Upper Limit:	Generator set L3–N voltage	
40021	GN_LN_Avg_Volt	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Units: VAC Upper Limit: NA Default: 0	Generator set Line to Neutral average voltage	

Address	Parameter	Access	Specifications	Description	Control
40022	G_L1L2_Volt	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Units: VAC Lower Limit: Upper Limit:	Generator set L1–L2 voltage	
40023	G_L2L3_Volt	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Units: VAC Lower Limit: Upper Limit:	Generator set L2–L3 voltage	
40024	G_L3L1_Volt	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Units: VAC Lower Limit: Upper Limit:	Generator set L3–L1 voltage	
40025	GN_LL_Avg_Volt	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Units: VAC Lower Limit: Upper Limit:	Generator set Line to Line average voltage	
40026	G_L1_Amp	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Units: Amps Lower Limit: Upper Limit:	Monitors the generator set L1 current value	
40027	G_L2_Amp	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Units: Amps Lower Limit: Upper Limit:	Generator set L2 current	

Address	Parameter	Access	Specifications	Description	Control
40028	G_L3_Amp	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Units: Amps Lower Limit: Upper Limit:	Generator set L3 current	
40029	G_Avg_Current	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Units: Amps Lower Limit: Upper Limit:	Generator set average current	
40030	G_Current_N	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Units: VAC Lower Limit: Upper Limit:	Generator set neutral current	
40031	G_L1_kW	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: S Units: kW Lower Limit: -32768 Upper Limit: 32762	Generator set L1 kW	
40032	G_L2_kW	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: S Units: kW Lower Limit: -32768 Upper Limit: 32762	Generator set L2 kW	
40033	G_L3_kW	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: S Units: kW Lower Limit: -32768 Upper Limit: 32762	Generator set L3 kW	

Address	Parameter	Access	Specifications	Description	Control
40034	G_Total_kW	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: S Units: kW Lower Limit: Upper Limit:	Generator set total kW	
40035	G_L1_kVAR	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Units: kVAR Lower Limit: Upper Limit:	Generator set L1 kVAR	
40036	G_L2_kVAR	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Units: kVAR Lower Limit: Upper Limit:	Generator set L2 kVAR	
40037	G_L3_kVAR	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Units: kVAR Lower Limit: Upper Limit:	Generator set L3 kVAR	
40038	G_Total_kVAR	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 16 Sign: U Units: kVAR Lower Limit: Upper Limit:	Generator set total kVAR	
40039	G_Total_PF	Read Only	Multiplier: 0.01 Offset: 0 Size (bits): 8 Sign: S Units: PF Lower Limit: Upper Limit:	Generator set total power factor (L1+L2+L3)	

Address	Parameter	Access	Specifications	Description	Control
40040	G_L1_kVA	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Units: kVA Lower Limit: Upper Limit:	Generator set L1 kVA	
40041	G_L2_kVA	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Units: kVA Lower Limit: Upper Limit:	Generator set L2 kVA	
40042	G_L3_kVA	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Units: kVA Lower Limit: Upper Limit:	Generator set L3 kVA	
40043	G_Total_kVA	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Units: kVA Lower Limit: Upper Limit:	Generator set total kVA	
40044	G_Frequency	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Units: Hz Lower Limit: NA Upper Limit: NA	Generator set Frequency OP	
40046–40047	G_Neg_kWh	Read Only	Multiplier: 1 Offset: 0 Size (bits): 32 Sign: U Units: kWh Lower Limit: Upper Limit:	Generator set total negative kWh accumulation	

Address	Parameter	Access	Specifications	Description	Control
40048–40049	G_Pos_kWh	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 32 Sign: U Units: kWh Lower Limit: Upper Limit: 4294967290	Generator set total positive kWh accumulation	
40050–40051	G_Tot_kWh	Read Only	Multiplier: 1 Offset: 0 Size (bits): 32 Sign: S Units: kWh Lower Limit: –2147483648 Upper Limit: 2147483643	Generator set total net kWh accumulation	
40052–40053	G_Neg_kVARh	Read Only	Multiplier: 1 Offset: 0 Size (bits): 32 Sign: U Units: kVARh Lower Limit: Upper Limit:	Generator set total negative kVARh accumulation	
40054–40055	G_Pos_kVAh	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Units: kVARh Lower Limit: Upper Limit: 4294967290	Generator set total positive kVARh accumulation	
40056–40057	G_kVARh	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Units: kVARh Lower Limit: –2147483648 Upper Limit: 2147483643	Generator set total net kVARh accumulation	

Address	Parameter	Access	Specifications	Description	Control
40061	G_Battery_Volt	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Units: V Lower Limit: Upper Limit:	Battery voltage value	
40062	G_Oil_Pre	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Units: kPA Lower Limit: Upper Limit:	Monitor point for the Oil Pressure	
40063	G_Oil_Temp	Read Only	Multiplier: 0.1 Offset: 0 Size (bits): 16 Sign: S Units: °F Lower Limit: Upper Limit:	Monitor point for the Oil Temperature	
40064	G_Coolant_Temp	Read Only	Multiplier: 0.1 Offset: 0 Size (bits): 16 Sign: S Units: °C Lower Limit: Upper Limit:	Monitor point for the Coolant Temperature	
40065	G_IMT_Temp	Read Only	Multiplier: 0.1 Offset: 0 Size (bits): 16 Sign: S Units: °F Lower Limit: -40 Upper Limit: 410	To monitor Intake Manifold Temperature 1	
40066	G_Fuel_Temp	Read Only	Multiplier: 0.1 Offset: 0 Size (bits): 16 Sign: S Units: °F Lower Limit: -40 Upper Limit: 410	Monitor point for Fuel Temperature	

Address	Parameter	Access	Specifications	Description	Control
40067	G_Fuel_Rate	Read Only	Multiplier: 0.05 Offset: 0 Size (bits): 16 Sign: S Units: gal/hr Lower Limit: Upper Limit:	Monitor point for the Fuel Rate	
40068	G_Engine_Speed	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Units: RPM Lower Limit: Upper Limit:	Monitor point for the Average Engine Speed	
40069	G_Tot_StAmpOP	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Units: NAr Lower Limit: Upper Limit: 65535	Total number of start attempts	
40070–40071	G_Eng_Runtime	Read Only	Multiplier: 0.1 Offset: 0 Size (bits): 32 Sign: U Units: seconds Lower Limit: Upper Limit:	Total engine run time	
40072–40073	G_Tot_Fuel_Consp	Read Only	Multiplier: 0.1 Offset: 0 Size (bits): 32 Sign: U Units: gallons Lower Limit: Upper Limit:	Total fuel consumption since start of engine	
40074–40075	G_Tot_num_Runs	Read Only	Multiplier: 1 Offset: 0 Size (bits): 32 Sign: U Units: Lower Limit: Upper Limit: 4294967295	Total number of generator set runs	

Address	Parameter	Access	Specifications	Description	Control
40125	G_Utility_Volt	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Units: VAC Lower Limit: Upper Limit:	Utility Line to Line average voltage	
40158	Genset Bus L1N Voltage	Read Only	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units:VAC Lower Limit: Upper Limit:	Generator set Bus L1N voltage	
40159	Genset Bus L2N Voltage	Read Only	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units:VAC Lower Limit: Upper Limit:	Generator set Bus L2N voltage	
40160	Genset Bus L3N Voltage	Read Only	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units:VAC Lower Limit: Upper Limit:	Generator set Bus L3N voltage	
40162	Genset Bus L1L2 Voltage	Read Only	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units:VAC Lower Limit: Upper Limit:	Generator set Bus L1L2 voltage	
40163	Genset Bus L2L3 Voltage	Read Only	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units:VAC Lower Limit: Upper Limit:	Generator set Bus L2L3 voltage	

Address	Parameter	Access	Specifications	Description	Control
40164	Genset Bus L3L1 Voltage	Read Only	Multiplier: 1 Offset: 0 Size(Bits): 16 Sign: U Units:VAC Lower Limit: Upper Limit:	Generator set Bus L3L1 voltage	
40165	G_GenBus_LL_Avg_Volt	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Units: VAC Lower Limit: Upper Limit:	Generator set Bus Line to Line average voltage	
40184	Genset Bus Frequency	Read Only	Multiplier: 0.001 Offset: 0 Size (bits): 32 Sign: U Units: HZ Lower Limit: Upper Limit:	Generator set bus line frequency	
40185	Genset Bus Frequency	Read Only	Multiplier: 0.001 Offset: 0 Size (bits): 32 Sign: U Units: HZ Lower Limit: Upper Limit:	Generator set bus line frequency	
40230	G_Bosst_Pre	Read Only	Multiplier: 0.1 Offset: 0 Size (bits): 16 Sign: U Units: psi Lower Limit: Upper Limit:	Monitor point for Boost Absolute Pressure	
40232	G_Crankcase_Pre	Read Only	Multiplier: 0.1 Offset: 0 Size (bits): 16 Sign: S Units: psi Lower Limit: Upper Limit:	Monitor point for Crankcase Pressure	

Address	Parameter	Access	Specifications	Description	Control
40242	G_Aftercooler_Temp	Read Only	Multiplier: 0.1 Offset: 0 Size (bits): 16 Sign: S Units: °F Lower Limit: -40 Upper Limit: 410 Default: NA	Monitor point for Aftercooler Temperature	
40243	G_ECM_Temp	Read Only	Multiplier: 0.1 Offset: 0 Size (bits): 16 Sign: S Units: °F Lower Limit: NA Upper Limit: NA Default: NA	Internal temperature of the engine electronic control module 1	
40264	G_Eng_PercentTor	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: S Units: % Lower Limit: -40 Upper Limit: 410	Monitor point for percent engine torque output and governor percent duty cycle output when used with the HM ECM	
40278	G_Cfg_Input14_High_High_Fuel_Level	Read Only	0: Inactive 1: Active		
40282	G_Eng_WIF	Read Only	0: No 1: Yes	Water in Fuel Indication	
40283	G_Controller_Mode	Read Only	0: OFF 1: Ready 2: Setup 3: Starting 4: Idle 5: Rated 6: Stop Normal 7: Stop Emergency 8: Factory Test 9: Wait to Power Down	The controller mode	

Address	Parameter	Access	Specifications	Description	Control
40290–40291	G_Controller_RunTime	Read Only	Multiplier: 1 Offset: 0 Size (bits): 32 Sign: U Units: seconds Lower Limit: 0 Upper Limit: 4294967295 (136 years) Default: NA	Controller On time in seconds	
40501	G_Cfg_Input6_Low_Fuel_Shutdown	Read Only	0: Inactive 1: Active	Status of low fuel level shutdown event	
40517	G_Leakage_Alr	Read Only	0: Inactive 1: Active	Status of leakage warning event	
40563	G_Gen_Shutdown	Read Only	0: Inactive 1: Active	Status of common shutdown event	
40565	G_Gen_Warning	Read Only	0: Inactive 1: Active	Status of common warning event	
43220	G_Gen_SN	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: C Units: Lower Limit: Upper Limit:	Modbus uses addresses 43220–43239 for the 20 characters of the serial number of this generator set.	
43221	G_Gen_SN	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: C Units: Lower Limit: Upper Limit:	Modbus uses addresses 43220–43239 for the 20 characters of the serial number of this generator set.	
43222	G_Gen_SN	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: C Units: Lower Limit: Upper Limit:	Modbus uses addresses 43220–43239 for the 20 characters of the serial number of this generator set.	

Address	Parameter	Access	Specifications	Description	Control
43223	G_Gen_SN	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: C Units: Lower Limit: Upper Limit:	Modbus uses addresses 43220–43239 for the 20 characters of the serial number of this generator set.	
43224	G_Gen_SN	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: C Units: Lower Limit: Upper Limit:	Modbus uses addresses 43220–43239 for the 20 characters of the serial number of this generator set.	
43225	G_Gen_SN	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: C Units: Lower Limit: Upper Limit:	Modbus uses addresses 43220–43239 for the 20 characters of the serial number of this generator set.	
43226	G_Gen_SN	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: C Units: Lower Limit: Upper Limit:	Modbus uses addresses 43220–43239 for the 20 characters of the serial number of this generator set.	
43227	G_Gen_SN	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: C Units: Lower Limit: Upper Limit:	Modbus uses addresses 43220–43239 for the 20 characters of the serial number of this generator set.	
43228	G_Gen_SN	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: C Units: Lower Limit: Upper Limit:	Modbus uses addresses 43220–43239 for the 20 characters of the serial number of this generator set.	

Address	Parameter	Access	Specifications	Description	Control
43229	G_Gen_SN	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: C Units: Lower Limit: Upper Limit:	Modbus uses addresses 43220–43239 for the 20 characters of the serial number of this generator set.	
43230	G_Gen_SN	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: C Units: Lower Limit: Upper Limit:	Modbus uses addresses 43220–43239 for the 20 characters of the serial number of this generator set.	
43231	G_Gen_SN	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: C Units: Lower Limit: Upper Limit:	Modbus uses addresses 43220–43239 for the 20 characters of the serial number of this generator set.	
43232	G_Gen_SN	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: C Units: Lower Limit: Upper Limit:	Modbus uses addresses 43220–43239 for the 20 characters of the serial number of this generator set.	
43233	G_Gen_SN	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: C Units: Lower Limit: Upper Limit:	Modbus uses addresses 43220–43239 for the 20 characters of the serial number of this generator set.	
43234	G_Gen_SN	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: C Units: Lower Limit: Upper Limit:	Modbus uses addresses 43220–43239 for the 20 characters of the serial number of this generator set.	

Address	Parameter	Access	Specifications	Description	Control
43235	G_Gen_SN	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: C Units: Lower Limit: Upper Limit:	Modbus uses addresses 43220–43239 for the 20 characters of the serial number of this generator set.	
43236	G_Gen_SN	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: C Units: Lower Limit: Upper Limit:	Modbus uses addresses 43220–43239 for the 20 characters of the serial number of this generator set.	
43237	G_Gen_SN	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: C Units: Lower Limit: Upper Limit:	Modbus uses addresses 43220–43239 for the 20 characters of the serial number of this generator set.	
43238	G_Gen_SN	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: C Units: Lower Limit: Upper Limit:	Modbus uses addresses 43220–43239 for the 20 characters of the serial number of this generator set.	
43239	G_Gen_SN	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: C Units: Lower Limit: Upper Limit:	Modbus uses addresses 43220–43239 for the 20 characters of the serial number of this generator set.	
43260	G_Alt_SN	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: C Units: Lower Limit: Upper Limit:	Modbus uses addresses 43260–43279 for the 20 characters of the serial number of this generator set alternator.	

Address	Parameter	Access	Specifications	Description	Control
43261	G_Alt_SN	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: C Units: Lower Limit: Upper Limit:	Modbus uses addresses 43260–43279 for the 20 characters of the serial number of this generator set alternator.	
43262	G_Alt_SN	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: C Units: Lower Limit: Upper Limit:	Modbus uses addresses 43260–43279 for the 20 characters of the serial number of this generator set alternator.	
43263	G_Alt_SN	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: C Units: Lower Limit: Upper Limit:	Modbus uses addresses 43260–43279 for the 20 characters of the serial number of this generator set alternator.	
43264	G_Alt_SN	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: C Units: Lower Limit: Upper Limit:	Modbus uses addresses 43260–43279 for the 20 characters of the serial number of this generator set alternator.	
43265	G_Alt_SN	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: C Units: Lower Limit: Upper Limit:	Modbus uses addresses 43260–43279 for the 20 characters of the serial number of this generator set alternator.	
43266	G_Alt_SN	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: C Units: Lower Limit: Upper Limit:	Modbus uses addresses 43260–43279 for the 20 characters of the serial number of this generator set alternator.	

Address	Parameter	Access	Specifications	Description	Control
43267	G_Alt_SN	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: C Units: Lower Limit: Upper Limit:	Modbus uses addresses 43260–43279 for the 20 characters of the serial number of this generator set alternator.	
43268	G_Alt_SN	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: C Units: Lower Limit: Upper Limit:	Modbus uses addresses 43260–43279 for the 20 characters of the serial number of this generator set alternator.	
43269	G_Alt_SN	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: C Units: Lower Limit: Upper Limit:	Modbus uses addresses 43260–43279 for the 20 characters of the serial number of this generator set alternator.	
43270	G_Alt_SN	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: C Units: Lower Limit: Upper Limit:	Modbus uses addresses 43260–43279 for the 20 characters of the serial number of this generator set alternator.	
43271	G_Alt_SN	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: C Units: Lower Limit: Upper Limit:	Modbus uses addresses 43260–43279 for the 20 characters of the serial number of this generator set alternator.	
43272	G_Alt_SN	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: C Units: Lower Limit: Upper Limit:	Modbus uses addresses 43260–43279 for the 20 characters of the serial number of this generator set alternator.	

Address	Parameter	Access	Specifications	Description	Control
43273	G_Alt_SN	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: C Units: Lower Limit: Upper Limit:	Modbus uses addresses 43260–43279 for the 20 characters of the serial number of this generator set alternator.	
43274	G_Alt_SN	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: C Units: Lower Limit: Upper Limit:	Modbus uses addresses 43260–43279 for the 20 characters of the serial number of this generator set alternator.	
43275	G_Alt_SN	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: C Units: Lower Limit: Upper Limit:	Modbus uses addresses 43260–43279 for the 20 characters of the serial number of this generator set alternator.	
43276	G_Alt_SN	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: C Units: Lower Limit: Upper Limit:	Modbus uses addresses 43260–43279 for the 20 characters of the serial number of this generator set alternator.	
43277	G_Alt_SN	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: C Units: Lower Limit: Upper Limit:	Modbus uses addresses 43260–43279 for the 20 characters of the serial number of this generator set alternator.	
43278	G_Alt_SN	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: C Units: Lower Limit: Upper Limit:	Modbus uses addresses 43260–43279 for the 20 characters of the serial number of this generator set alternator.	

Address	Parameter	Access	Specifications	Description	Control
43279	G_Alt_SN	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: C Units: Lower Limit: Upper Limit:	Modbus uses addresses 43260–43279 for the 20 characters of the serial number of this generator set alternator.	
43281	G_HT_LCL_Warning	Read Only	0: Inactive 1: Active	Indicates the Coolant low level warning event	
43562	G_Gen_CB_Pos	Read Only	0: Open 1: Closed 2: Not Available	Indicates generator set breaker position	
43719	G_AltWind_Temp	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: S Units: °F Lower Limit: –32767 Upper Limit: 32762	Monitor point for the Alternator Temperature	
43740	G_AltBearing_Temp	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: S Units: °F Lower Limit: –32767 Upper Limit: 32762	Monitor point for the Drive End Bearing Temperature	
43741	G_Exhaust_Temp	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: S Units: °F Lower Limit: –32767 Upper Limit: 32762	Monitor point for the Exhaust Stack Temperature	
43793	G_Cfg_Input1_High_Fuel_Level_Warning	Read Only	0: Inactive 1: Active	Status of high fuel level warning event	
43794	G_Cfg_Input2_Low_Fuel_Level_Warning	Read Only	0: Inactive 1: Active	Status of low fuel level warning event	
43795	G_Cfg_Input13_PLC Shutdown	Read Only	0: Inactive 1: Active	Signal for G_Cfg_Input13_PLC_Shutdown	

Address	Parameter	Access	Specifications	Description	Control
46124	G_Coolant_Pre	Read Only	Multiplier: 0.1 Offset: 0 Size (bits): 8 Sign: U Units: psi Lower Limit: NA Upper Limit: NA	Monitor point for the Coolant Pressure	
46135	G_Intake_Pre	Read Only	Multiplier: 0.1 Offset: 0 Size (bits): 16 Sign: U Units: psi Lower Limit: NA Upper Limit: NA	Intake Manifold Pressure 1	
48001	StatusWord1	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Units: Lower Limit: Upper Limit:	16-bit number to represent the status of the PowerBloc IO. See Table 78 on page 1020 .	
48002	StatusWord2	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Units: Lower Limit: Upper Limit:	16-bit number to represent the status of the PowerBloc IO. See Table 79 on page 1020 .	
48003	StatusWord3	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Units: Lower Limit: Upper Limit:	16-bit number to represent the status of the PowerBloc IO. See Table 80 on page 1021 .	
48004	AlarmWord1	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Units: Lower Limit: Upper Limit:	16-bit number to represent the status of the PowerBloc alarm event. See Table 81 on page 1022 .	

Address	Parameter	Access	Specifications	Description	Control
48005	AlarmWord2	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Units: Lower Limit: Upper Limit:	16-bit number to represent the status of the PowerBloc alarm event. See Table 82 on page 1022 .	
48006	AlarmWord3	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Units: Lower Limit: Upper Limit:	16-bit number to represent the status of the PowerBloc alarm event. See Table 83 on page 1023 .	
48007	AlarmWord4	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Units: Lower Limit: Upper Limit:	16-bit number to represent the status of the PowerBloc alarm event, See Table 84 on page 1023	
48008	AlarmWord4	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Units: Lower Limit: Upper Limit:	16-bit number to represent the status of the PowerBloc alarm event. See Table 84 on page 1023 .	
48105	C_AuxAlt_Volt_A	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Units: Volt Lower Limit: Upper Limit:	Monitor point for Aux Alternator Line to neutral voltage A	
48106	C_AuxAlt_Volt_B	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Units: Volt Lower Limit: Upper Limit:	Monitor point for Aux Alternator Line to neutral voltage B	

Address	Parameter	Access	Specifications	Description	Control
48107	C_AuxAlt_Volt_C	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 16 Sign: U Units: Volt Lower Limit: Upper Limit:	Monitor point for Aux Alternator Line to neutral voltage C	
48108	C_AuxAlt_Volt_AB	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Units: Volt Lower Limit: Upper Limit:	Monitor point for Aux Alternator Line to Line voltage AB	
48109	C_AuxAlt_Volt_BC	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Units: Volt Lower Limit: Upper Limit:	Monitor point for Aux Alternator Line to Line voltage BC	
48110	C_AuxAlt_Volt_CA	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Units: Volt Lower Limit: Upper Limit:	Monitor point for Aux Alternator Line to Line voltage CA	
48111	C_AuxAlt_Freq	Read Only	Multiplier: 0.01 Offset: 0 Size (bits): 16 Sign: U Units: Hz Lower Limit: Upper Limit:	Monitor point for Aux Alternator Frequency A	
48115	C_NGR_Current	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Units: Amps Lower Limit: Upper Limit:	Monitor point for NGR Current	

Address	Parameter	Access	Specifications	Description	Control
48116	C_NGR_Temp	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Units: °C Lower Limit: Upper Limit:	Monitor point for NGR Temperature	
48127	ChargerCellVolt	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Units: volt Lower Limit: Upper Limit	Monitor point for the battery charger cell voltage	
48128	ChargerOutputVolt	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Units: volt Lower Limit: Upper Limit	Monitor point for the battery charger output voltage	
48129	ChargerFail	Read Only	0: Inactive 1: Active	Indicates Charger Failure Warning event	
48130	ChargerLowVoltAlarm	Read Only	0: Inactive 1: Active	Indicates Charger Low Voltage Warning event	
48131	C_NGR_Humidity	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Units: % Lower Limit: Upper Limit:	Monitor point for NGR Humidity	
48132	C_NGR_GND	Read Only	0: Inactive 1: Active	Indicate NGR ground fault shutdown event	
48133	Rad_S_12	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Units: seconds Lower Limit: Upper Limit:	Monitor point for Cooling Fan 1 and 2 runtime	

Address	Parameter	Access	Specifications	Description	Control
48134	Rad_M_12	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Units: minutes Lower Limit: Upper Limit:	Monitor point for Cooling Fan 1 and 2 runtime	
48135	Rad_H_12	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Units: hours Lower Limit: Upper Limit:	Monitor point for Cooling Fan 1 and 2 runtime	
48136	Rad_S_34	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Units: seconds Lower Limit: Upper Limit:	Monitor point for Cooling Fan 3 and 4 runtime	
48137	Rad_M_34	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Units: minutes Lower Limit: Upper Limit:	Monitor point for Cooling Fan 3 and 4 runtime	
48138	Rad_H_34	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Units: hours Lower Limit: Upper Limit:	Monitor point for Cooling Fan 3 and 4 runtime	
48139	Rad_S_56	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Units: seconds Lower Limit: Upper Limit:	Monitor point for Cooling Fan 5 and 6 runtime	

Address	Parameter	Access	Specifications	Description	Control
48140	Rad_M_56	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Units: minutes Lower Limit: Upper Limit:	Monitor point for Cooling Fan 5 and 6 runtime	
48141	Rad_H_56	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Units: hours Lower Limit: Upper Limit:	Monitor point for Cooling Fan 5 and 6 runtime	
48142	Vent_S	Read Only	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Units: seconds Lower Limit: Upper Limit:	Monitor point for the Ventilator Fan runtime	
48143	Vent_M	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 16 Sign: U Units: minutes Lower Limit: Upper Limit:	Monitor point for Ventilator Fan runtime	
48144	Vent_H	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 16 Sign: U Units: hours Lower Limit: Upper Limit:	Monitor point for Ventilator Fan runtime	
48145	Fuel Height	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 16 Sign: U Units: mm Lower Limit: Upper Limit:	The fuel height in the fuel tank	

Address	Parameter	Access	Specifications	Description	Control
48146	Fuel Percent	Read Only Read Only	Multiplier: 1 Offset: 0 Size (Bits): 16 Sign: U Units: % Lower Limit: Upper Limit:	The fuel percent	
48147	Fuel Liter	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 16 Sign: U Units: L Lower Limit: Upper Limit:	The volume of fuel	
48148	Fuel Total Volume	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 16 Sign: U Units: L Lower Limit: Upper Limit:	The total volume of fuel tank	
48149	Fuel Control Mode	Read Only	0: Auto 1: Manual Open 2: Manual Close		
48151	C_Container_Temperature1	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 16 Sign: S Units: °C Lower Limit: Upper Limit:		
48152	C_Container_Temperature2	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 16 Sign: S Units: °C Lower Limit: Upper Limit:		

Address	Parameter	Access	Specifications	Description	Control
48153	C_Container_Temperatur e3	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 16 Sign: S Units: °C Lower Limit: Upper Limit:		
48154	C_Container_Temperatur e4	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 16 Sign: S Units: °C Lower Limit: Upper Limit:		
48155	C_Container_Temperatur e5	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 16 Sign: S Units: °C Lower Limit: Upper Limit:		
48156	C_Container_Temperatur e6	Read Only	Multiplier: 1 Offset: 0 Size (Bits): 16 Sign: S Units: °C Lower Limit: Upper Limit:		

18.2 NFPA 110 Bitmaps

18.2.1 NFPA 110(1) Bitmap

TABLE 76. NFPA 110(1) BITMAP

Bit	Description
0	Low fuel level
1	Low coolant level
2	Over speed
3	Low oil pressure
4	Pre-low oil pressure
5	High engine temperature

6	Pre-high engine temperature
7	Low coolant temperature
8	Fail to start
9	Charger AC failure
10	Low battery voltage
11	High battery voltage
12	Not in auto
13	Genset running
14	Genset supplying load
15	Common alarm

See Register 40016 in [Section 18.1](#).

18.2.2 NFPA 110(2) Bitmap

TABLE 77. NFPA 110(2) BITMAP

Bit	Description
0	Emergency stop
1	Utility circuit breaker tripped
2	Genset circuit breaker tripped
3	Load demand
4	Fail to close
5	Fail to sync
6	Reverse KVAR
7	Reverse KW
8	Short circuit
9	Overcurrent
10	Overload
11	Under frequency
12	Low AC voltage
13	High AC voltage
14	Ground fault
15	Check genset

See Register 40017 in [Section 18.1](#).

18.3 StatusWord Bitmaps

18.3.1 StatusWord 1 Bitmap

TABLE 78. STATUSWORD 1 BITMAP

Bit	Description
0	Louver breaker position
1	Louver open relay position
2	Louver close relay position
3	Louver 1 open
4	Louver 1 close
5	Louver 2 open
6	Louver 2 close
7	Louver 3 open
8	Louver 3 close
9	Utility breaker position
10	NA
11	Ventilation fan fault
12	Cooling fan 1 and 2 contactor position
13	Cooling fan 1 breaker position
14	Cooling fan 2 breaker position
15	Cooling fan 3 and 4 contactor position

See Register 48001 in [Section 18.1](#).

18.3.2 StatusWord 2 Bitmap

TABLE 79. STATUSWORD 2 BITMAP

Bit	Description
0	Cooling fan 3 breaker position
1	Cooling fan 4 breaker position
2	Cooling fan 5 and 6 contactor position
3	Cooling fan 5 breaker position
4	Cooling fan 6 breaker position
5	Ventilation fan 7 and 8 contactor position
6	Ventilation fan 7 breaker position
7	Ventilation fan 8 breaker position

8	ATS on utility position
9	ATS on auxiliary generator position
10	Fuel valve open
11	Fuel valve close
12	Fuel valve manual open
13	Cooling fan 1 and 2 fault
14	Cooling fan 3 and 4 fault
15	Cooling fan 5 and 6 fault

See Register 48002 in [Section 18.1](#).

18.3.3 StatusWord 3 Bitmap

TABLE 80. STATUSWORD 3 BITMAP

Bit	Description
0	Louver manual open
1	Louver manual close
2	NA
3	NGR ground fault
4	Cooling fan container door open alarm
5	Fire alarm
6	PCC Key Switch
7	PCC ready to load
8	Louver open command
9	Louver close command
10	Cooling fan 1 and 2 run command
11	Cooling fan 3 and 4 run command
12	Cooling fan 5 and 6 run command
13	Ventilation fan run command
14	Fuel valve open command
15	Emergency shutdown command

See Register 48003 in [Section 18.1](#).

18.4 AlarmWord Bitmaps

18.4.1 AlarmWord 1 Bitmap

TABLE 81. ALARMWORD 1 BITMAP

Bit	Description
0	Louver breaker open warning
1	Louver open relay warning
2	Louver close relay warning
3	Louver 1 open warning
4	Louver 1 close warning
5	Louver 2 open warning
6	Louver 2 close warning
7	Louver 3 open warning
8	Louver 3 close warning
9	Utility breaker open warning
10	NA
11	Ventilation fan fault
12	Cooling fan 1 and 2 contactor warning
13	Cooling fan 1 breaker open warning
14	Cooling fan 2 breaker open warning
15	Cooling fan 3 and 4 contactor warning

See Register 48004 in [Section 18.1](#).

18.4.2 AlarmWord 2 Bitmap

TABLE 82. ALARMWORD 2 BITMAP

Bit	Description
0	Cooling fan 3 breaker open warning
1	Cooling fan 4 breaker open warning
2	Cooling fan 5 and 6 contactor warning
3	Cooling fan 5 breaker open warning
4	Cooling fan 6 breaker open warning
5	Ventilation fan 7 and 8 contactor warning
6	Ventilation fan 7 breaker open warning
7	Ventilation fan 8 breaker open warning

8	Fuel valve open warning
9	Fuel valve close warning
10	Cooling fan 1 and 2 fault warning
11	Cooling fan 3 and 4 fault warning
12	Cooling fan 5 and 6 fault warning
13	Aux alternator frequency warning
14	NGR ground fault alarm
15	Fire alarm

See Register 48005 in [Section 18.1](#).

18.4.3 AlarmWord 3 Bitmap

TABLE 83. ALARMWORD 3 BITMAP

Bit	Description
0	Aux alternator voltage warning
1	Genset container temperature high warning
2	Genset container temperature high alarm
3	ATS position warning
4	Cooling fan container door open alarm
5	PLC fault warning
6	PLC cell battery low voltage warning
7	Auxiliary Alternator Voltage warning
8	Fuel Low Level Shutdown Alarm
9	Fuel High Level Shutdown Alarm
10	Fuel Valve Fail To Open
11	Fuel Valve Fail To Close
12	Fuel Meter L Mismatch
13	Fuel Meter LL Mismatch
14	Fuel Meter H Mismatch
15	Fuel Meter HH Mismatch

See Register 48006 in [Section 18.1](#).

18.4.4 AlarmWord 4 Bitmap

TABLE 84. ALARMWORD 4 BITMAP

Bit	Description
-----	-------------

0	Fuel Fail not add warning
1	Fuel Fail to add warning
2	
3	
4	
5	
6	
7	
8	
9	
10	
11	
12	
13	
14	
15	

See Register 48008 in [Section 18.1](#).

18.4.5 AlarmWord 5 Bitmap

TABLE 85. ALARMWORD 5 BITMAP

Bit	Description
0	PCC comm fault warning
1	Container temperature sensor 1 comm fault warning
2	Container temperature sensor 2 comm fault warning
3	NGR comm fault warning
4	
5	Powermeter comm fault warning
6	
7	Battery charger comm fault warning
8	Fuel Meter Comm Fault Warning
9	VFD Comm Fault Warning
10	
11	

12	
13	
14	
15	

This page is intentionally blank.

19 Cylinder Cutoff System (CCS)/ Bank Cutoff System (BCS) Modbus Register Map

19.1 Configuration of Cylinder Cutoff System (CCS) / Bank Cutoff System (BCS) Logic

To enable the CCS/BCS logic, configure the inputs and outputs of banks in CCS/BCS as mentioned below:

Configurable Inputs:

J16-1 Sensor Selection – “Bank A Fuel Pressure Sensor”- To get the feedback of fuel rail pressure sensor of Bank A

J16-9 Sensor Selection – “Bank B Fuel Pressure Sensor”- To get the feedback of fuel rail pressure sensor of Bank B

Configurable Outputs:

J16-3 Actuator Selection - “CCS Bank A” - To activate Fuel Shut-Off (FSO) coil of Bank A

J16-4 Actuator Selection - “CCS Bank B” - To activate Fuel Shut-Off (FSO) coil of Bank B

19.2 Cylinder Cutoff System (CCS) / Bank Cutoff System (BCS) Logic List of Parameters

TABLE 86. LIST OF PARAMETERS

System Name	Default Value	Range	Description
CCS State (Mon)	Disabled		Indicates which bank is getting operated- A, B, Both or None in CCS logic
CCS Bank Switching KW Threshold (trim)	8%	5-20%	KW Threshold after which bank will switch from Low to High cylinder mode in CCS logic
CCS Load Monitor (Mon)	Low	Low, High	Indicates the Load status (low or high) on genset from single to both bank switching and vice versa based on kW and V/Hz sensing.
CCS RTL to Rated Delay (trim)	2 sec	1-5 sec	This delay has been added to neglect V/Hz action when bank switches from single to both and also when genset reaches rated conditions from RTL = active during starting for deciding the CCS load monitor state.

System Name	Default Value	Range	Description
CCS Bank Switching KW Hysteresis Threshold (trim)	2%	1-5 %	KW Hysteresis Threshold to be considered for bank switching during ramp unload for Cylinder Cutoff System
CCS previous single bank state (Mon)	Random (A or B)		Last single Bank activated during Cylinder Cutoff Control logic
CCS Previous state (Mon)	Powerup		Indicates Cylinder Cutoff System previous state
CCS Starting Cylinder Mode (trim)	Low	Low, High	Indicates whether the genset starting is required at low or High cylinder mode for Cylinder Cutoff System
CCS Bank swap time delay Timer (mon)			Time delay after which the bank switching occurs during Low load conditions
CCS Bank swap time delay (trim)	60 sec	1 to 600 sec	Time delay after which the bank switching occurs during Low load conditions
CCS BANK A Output Status (Mon)	Inactive	Inactive, Active	Bank A output status for Cylinder Cutoff System logic
CCS BANK B Output Status (Mon)	Inactive	Inactive, Active	Bank B output status for Cylinder Cutoff System logic
V by Hz Rolloff Factor (mon)	1	0-10	It is the output of V/Hz voltage roll off table
CCS High Cylinder mode starting delay Time (trim)	5 sec	2 – 10 sec	Comes in picture when the genset is been started in high cylinder mode. After the expiry of this time, system will switch from High to low cylinder mode provided that the CCS load monitor = low"
CCS High Cylinder mode starting delay Timer			Comes in picture when the genset is been started in high cylinder mode. After the expiry of this timer, system will switch from High to low cylinder mode provided that the CCS load monitor = low"
CCS Bank swapping overlap delay Time (trim)	5 sec	1- 30 sec	Time delay for Minimum overlapping of both banks activation when transitioning from high to low cylinder mode"
CCS Bank swapping overlap delay Timer			Timer for Time delay for Minimum overlapping of both banks activation when transitioning from high to low cylinder mode"
CCS Feedback Failure Detection Time Delay (trim)	5	1-15 sec	Time delay to generate fault codes- 7697, 7823 and 7824 when CCS feedback is not received as expected.

System Name	Default Value	Range	Description
CCS Bank Switching Counter (mon)			Indicates the number of times the CCS Load monitor has changed from Low mode to High mode during V/Hz action.
Gen Total Real Power Sens fail fault threshold (trim)	3	1 to 10	When CCS Bank switching counter becomes equal to Generator Total Real Power Sensing failure fault threshold, FC 7825-Generator Total Real Power Sensing Failure appears.
CCS FSO Failure Detection Time Delay	2 sec	1 to 15 sec	Time delay to generate fault code 7697 during FSO coil failure when CCS State = High Load.
Bank A Fuel Pressure (Mon)	0 psi	0 to 300 psi	Bank A pressure sensor measurement
Bank A Fuel Pressure Override Value (Vol)	0 psi	0 to 300 psi	Override value for Bank A pressure sensor
Bank A Fuel Pressure Override Enable (Vol)	Disabled	Disabled Enabled	Override enable for Bank A pressure sensor
Bank B Fuel Pressure (Mon)	0 psi	0 to 300 psi	Bank B pressure sensor measurement
Bank B Fuel Pressure Override Value (Vol)	0 psi	0 to 300 psi	Override value for Bank B pressure sensor
Bank B Fuel Pressure Override Enable (Vol)	Disabled	Disabled Enabled	Override enable for Bank B pressure sensor
Bank ON Pressure Threshold (trim)	10 psi	5 to 20 psi	Bank Pressure above which respective Bank becomes active
FC2342 Response	None	Shutdown, Warning, None	Severity setting of FC2342
Max Idle Time	15 min	1 to 30 min	Sets the fault time for the Too Long in Idle fault

19.3 Modbus Setup and Addresses

Modbus communication can be enabled on TB15 connector using PC tool. User can set the parameter "TB15 Protocol selection = Modbus" and set the required baud rate, parity and node address from display or Modbus resistors.

NOTICE

As soon as TB15 protocol selection = Modbus, the PC tool will immediately get disconnected. To connect back again back to PC tool the Modbus user has to change TB15 protocol selection = Mon from Display or user has to write '0' to respective TB15 protocol selection Modbus resistor address.

19.3.1 Modbus RTU Support Functions

The control supports the following Modbus function codes:

- Read Holding Registers (Function Code 03)
- Read Input Registers (Function Code 04)
- Write Single Holding Register (Function Code 06)
- Write Multiple Holding Registers (Function Code 16)

The control shall respond to any function code other than those listed above by sending an exception response of Illegal Function (01).

19.3.1.1 Read Holding Registers

The control provides the ability to read 1 to 125 consecutive holding registers.

The control shall respond to any read request to address not defined in the control by returning 0xFFFF data for that address.

The control will return an Illegal Address exception code 02 if any of the following conditions occurs:

- The first register in the holding register read request is not defined on the control.
- The first register in the holding register read request does not allow for the full representation of a numeric value. This would occur if the first register in the read request is not mapped to the most significant 2 bytes of a binary value parameter.
- The last register in the holding register read request does not allow for the full representation of a numeric value. This would occur if the last register in the read request is not mapped to the least significant 2 bytes of a binary value parameter.

Read requests for string type parameters where not every register associated with the string is in the request shall return only the requested portion of the string.

19.3.1.2 Read Input Registers

The control provides the ability to read 1 to 125 consecutive input registers.

The control shall respond to any read request to address not defined in the control by returning 0xFFFF data for that address.

The control will return an Illegal Address exception code 02 if any of the following conditions occur:

- The first register in the input register read request is not defined on the control.
- The first register in the input register read request does not allow for the full representation of a numeric value. This would occur if the first register in the read request is not mapped to the most significant 2 bytes of a parameter.
- The last register in the input register read request does not allow for the full representation of a numeric value. This would occur if the last register in the read request is not mapped to the least significant 2 bytes of a parameter.

The Input Registers support by each port on the control are listed in the Read Input Registers Table below.

19.3.1.3 Write Single Holding Registers

The control will return an Illegal Address exception code 02 if any of the following conditions occur:

- The register in the holding register write request is not defined on the control.

- The register in the holding register write request does not allow for the full writing of a numeric value. This would occur if the register is part of a numeric parameter that requires more than one address to represent.
- If writing to a string values, the register in the holding register write request is not the first register of that string.

Write requests for string type parameters where not every register associated with the string is in the request shall write only the requested portion of the string, null terminating the remainder of the string.

Write requests to this control may return an Illegal Data Value exception code 03. This means that the requested write failed to occur.

19.3.1.4 Write Multiple Holding Registers

The control provides the ability to write to 1 to 123 consecutive holding registers.

The control will return an Illegal Address exception code 02 if any of the following conditions occur:

- The first register in the holding register write request is not defined on the control.
- The first register in the holding register write request does not allow for the full writing of a numeric value. This would occur if the first register in the write request is not mapped to the most significant 2 bytes of a parameter.
- The last register in the holding register write request does not allow for the full writing of a numeric value. This would occur if the last register in the write request is not mapped to the least significant 2 bytes of a parameter.
- If string values are in the write request, the first register for any string is not within the requested register range.

Write requests for string type parameters where not every register associated with the string is in the request shall write only the requested portion of the string, null terminating the remainder of the string. Write requests to this control may return an Illegal Data Value exception code 03. This means that some or all of the requested writes failed to occur. It is the responsibility of the requester to read the data again to determine which parameters were not written to their requested new values and to respond as necessary.

19.3.2 Modbus RTU Serial Port Configuration Options

The following configuration options shall be available for each port the control that supports the Modbus RTU protocol. See the controller Modbus register map for individual register assignments for these parameters on any given port.

TABLE 87. CONFIGURATION OPTIONS

Parameter Name	Description	Specification
Modbus Node Address	Sets this ports node address.	Multiplier: 1 Offset: 0 Size (bits): 16 Sign: U Unit: Lower Limit: 1 Upper Limit: 247

Parameter Name	Description	Specification
Modbus Baud Rate	Sets this ports baud rate.	0: 2400 1: 4800 2: 9600 3: 19200 4: 28800 5: 38400 6: 57600 7: 115200
Modbus Parity and Stop Bit Selection	Sets this ports parity and stop bit communications settings.	0: Even Parity (1 Stop) 1: Odd Parity (1 Stop) 2: No Parity (2 Stop) 3: No Parity (1 Stop)

19.3.3 Modbus RTU Extended Status Information

The control represents abnormal states in the data by using the five most positive values of the data to convey that these abnormal states exist. The states will only be applicable to numeric parameters with the following data types:

- UINT8, INT8, UINT16, INT16, UINT32, INT32, UINT64, INT64 (signed and unsigned 8 bit thru 64 bit parameters)

Note that enumerated parameters and parameters with a floating point data type will not follow this abnormal state representation methods.

The following abnormal states are supported:

- **Unsupported (Not Available) Data:** “Not Available” data shall be represented as the highest positive value for that parameter. For example for a two byte unsigned integer the value would be 65535. For a signed two byte integer the value would be 32767.
 - Parameters which are not available due to the sensor not being installed or not enabled in the controller’s configuration will be classified as this.
- **Network Failed Data:** “Network Failure” data shall be represented as three less than the highest positive value for that parameter. For example for a two byte unsigned integer the value would be 65532. For a signed two byte integer the value would be 32764.
 - Data that comes from a network that has failed such as sensor data coming from I/O modules on a PCCnet or CAN network will be classified as this.
- **Hardware/Component Failure:** “Hardware/Component Failure” data shall be represented as four less than the highest positive value for that parameter. For example for a two byte unsigned integer the value would be 65531. For a signed two byte integer the value would be 32763.
 - An on controller hardware/component failure that provides data like voltage, current and power for example will be classified as this.
- **Out of Range High/Out of Range:** “Out of Range High/Out of Range” data shall be represented as one less than the highest positive value for that parameter. For example for a two byte unsigned integer the value would be 65534. For a signed two byte integer the value would be 32766.
 - Data that has been determined to be out of range high or out of range (when there is no distinction between out of range high and out of range low) due to an open sensor for example, will be classified as this.

- **Out of Range Low:** “Out of Range Low” data shall be represented as two less than the highest positive value for that parameter. For example for a two byte unsigned integer the value would be 65533. For a signed two byte integer the value would be 32765.
 - Data that has been determined to be out of range Low or out of range (when there is no distinction between out of range high and out of range low) due to an open sensor for example, will be classified as this.

19.3.4 Working with 8 Bit Data Types

When reading a register that contains information in an 8 bit data type, the data will be put the least significant byte of the register. If the data type is unsigned, the upper byte will be populated with zero's. If the data type is signed, the upper byte will be sign extended with the sign bit value of the data byte.

When writing a register that contains information that is expected to be in an 8 bit data type, the control will expect the data to be in the least significant byte of the register and ignore the upper byte.

19.3.5 Representation of Multi-register Parameters

For numeric parameters requiring more than one Register to represent the data, the Register Address listed in the Controllers Modbus Register Map represents the most significant 2 bytes of the data. The additional bytes of the data will always be provided in Register Address + 1, Register Address + 2, and Register Address +3 as appropriate.

For string parameters, the first two characters in the string will be mapped to the Register Address listed in the Controllers Modbus Register Map. Additional characters will be provided in the following registers. For example, for the string "String1" at address 400031, the characters will be mapped the following registers:

400031: "St" 400032: "ri" 400033: "ng" 400034: "1_"

TABLE 88. MODBUS INTERFACE PARAMETERS - GENERATOR SET CONTROLS

Descriptio n	Address	Read/Writ e	Type	Multiplier	Possible Values	Default Value	Units	Data Type
Save Trims	408039	Read/Write	Register	-	0: Is False 1: Is True	0: Is False	-	-

19.4 Cylinder Cutoff System (CCS) / Bank Cutoff System (BCS) Controller Modbus Parameters List

TABLE 89. CCS MODBUS PARAMETERS LIST

Parameter Name	Address	No of Addr esse s	Para meter Type	Enu merat ion Name	Data Type	Data Size	Acce ss Level	Uppe r Limit	Lowe r Limit	Conv ersio n Facto r	Conv ersio n Offse t	Engi neeri ng Unit
CCS Bank A Output Status	403962	1	Enum	Inacti ve Active	unit8	8	Read Only	1	0	1	0	

Parameter Name	Address	No of Addresses	Parameter Type	Enumeration Name	Data Type	Data Size	Access Level	Upper Limit	Lower Limit	Conversion Factor	Conversion Offset	Engineering Unit
CCS Bank B Output Status	403963	1	Enum	Inactive Active	unit8	8	Read Only	1	0	1	0	
CCS Load Monitor	403966	1	Enum	Low High	unit8	8	Read Only	1	0	1	0	
CCS State	403968	1	Enum	CCS states	unit8	8	Read Only	5	0	1	0	
CCS Bank Swap Time Delay Timer	403969	1	Par		unit16	16	Read Only	600	0	0.1	0	sec
CCS Load Monitor Enable Command	403971	1	Enum	Inactive Active	unit8	8	Read Only	1	0	1	0	
CCS Run Signal Status	403972	1	Enum	Inactive Active	unit8	8	Read Only	1	0	1	0	
CCS High Cylinder Mode Starting Delay	403974	1	Par		unit16	16	Read Only	10	0	0.1	0	sec
CCS Bank Swapping Overlap Delay Time	403975	1	Par		unit16	16	Read Only	30	0	0.1	0	sec

power.cummins.com

Copyright © 2024 Cummins Inc. All rights reserved.

Cummins, the "C" logo, PowerCommand, AmpSentry, and InPower are trademarks of Cummins Inc.

Other company, product, or service names may be trademarks or service marks of others.

Specifications are subject to change without notice.

