



Lm Electric - Ecole Nationale Polytechnique

/
/ Algiers
Phone +213 (0)XXXX -XX XX - X

Company / customer

Project description Station de Pompage 4kW 2x400Vac
Job number IEC_tpl002
Commission EPLAN

Manufacturer (company) Lm Electric - Ecole Nationale Polytechnique

Path EPLAN sample project
Project name SDP03
Make
Type
Place of installation
Responsible for project
Part feature

Created on 9/24/2024
Edit date 9/30/2024 by (short name) IANYL
Number of pages 19

			Date	9/24/2024	EPLAN	Lm Electric - Ecole Nationale Polytechnique	Cover			
			Ed.	IANYL						
			Appr.		Station de Pompage 4kW 2x400Vac					
Modification	Date	Name	Original		Replacement of	Replaced by			IEC_tpl002	Page 1 / 19

Symbol overview


IEC_symbol

1 S NO contact NO auxiliary contact 20010 20029 1 20029 2 20300 20027 20901 20011 20025 20024 20201	79 FT3 Electromechanical device of a thermal relay, three-pole Thermal release (bimetal relay) 20010 20029 1 20029 3 20029 5 20300 20027 20901 20011 20025 20024 20201 20029 2 20029 4 20029 6
---	--

Symbol overview

IEC_symbol

F25_001

1351 X2_1 Terminal with 2 connection points (2 x graphical line) Terminal, general, with saddle jumper, 2 connection points	20010  20030 20225 20027 20901 20011 20025 20024 20201		
1406 XT1_2 Terminal / distributed terminal with one connection point (1 x graphical line) Terminal, general, with saddle jumper, 4 connection points	20010  20030 20225 20252 20027 20901 20011 20025 20024 20201		
1410 X1_NB Terminal with one connection point without saddle jumper connections Terminal, general, 1 connection point	20010  20030 20225 20027 20901 20011 20025 20024 20201		
1413 X2_NB Terminal with 2 connection points without saddle jumper connections Terminal, general, 2 connection points	20010  20030 20225 20027 20901 20011 20025 20024 20201		
1625 SL3 NO contact, 3-fold, power contact of a contactor Triple NO contact	20010  20030 20225 20027 20901 20011 20025 20024 20201		

			Date	9/30/2024	EPLAN	Lm Electric - Ecole Nationale Polytechnique	Symbol overview : IEC_symbol 1351 - 1625			
			Ed.	IANYL						
			Appr.		Station de Pompage 4kW 2x400Vac					
Modification	Date	Name	Original		Replacement of	Replaced by			IEC_tpI002	Page 3.a Page 4 / 19


1410 X1_NB Terminal with one connection point without saddle jumper connections Terminal, general, 1 connection point	20010 20027 20901 20011 20025 20024 20201	♀ 20030 20225

SPECIAL


F25_001


8 BP Interruption point	 20010 24350 24300		
30 BCP Busbar connection point Busbar connection point	 20039 20036		
64 TLRU T-node left, right, down (LRD)			
66 TOUR T-node up, down, right (UDR)			
67 TOUL T-node up, down, left (UDL)			
70 CO Angle			
72 TLRO T-node left, right, up (LRU)			
411 DCPPO Device connection point, output (with plug) Device connection point	 20039 20036		


			Date	9/30/2024	EPLAN	Lm Electric - Ecole Nationale Polytechnique	Symbol overview : SPECIAL 8 - 411			
			Ed.	IANYL						
			Appr.							
					Station de Pompage 4kW 2x400Vac					
Modification	Date	Name	Original		Replacement of	Replaced by			IEC_tpl002	Page 3.c Page 6 / 19

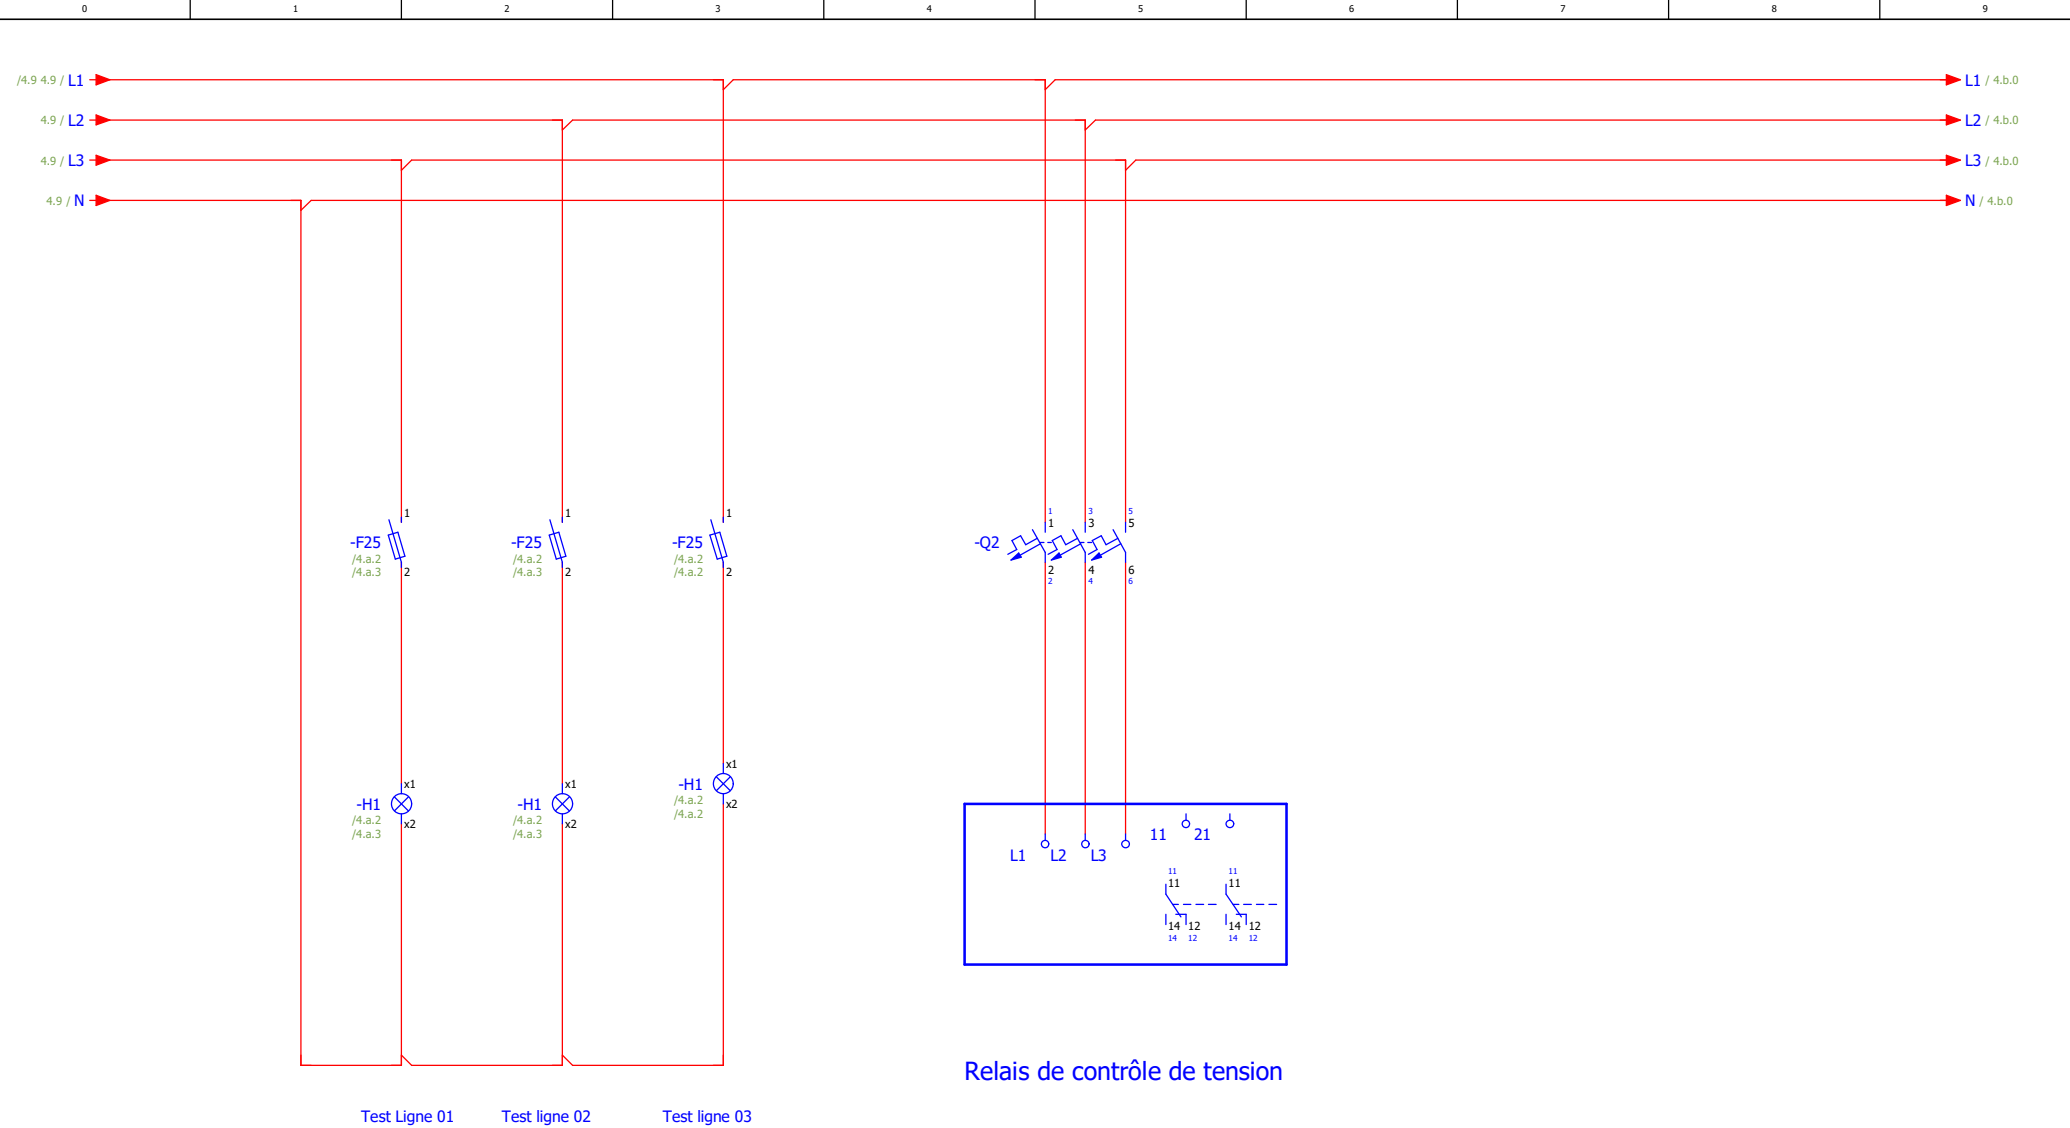


Relais de contrôle de tension

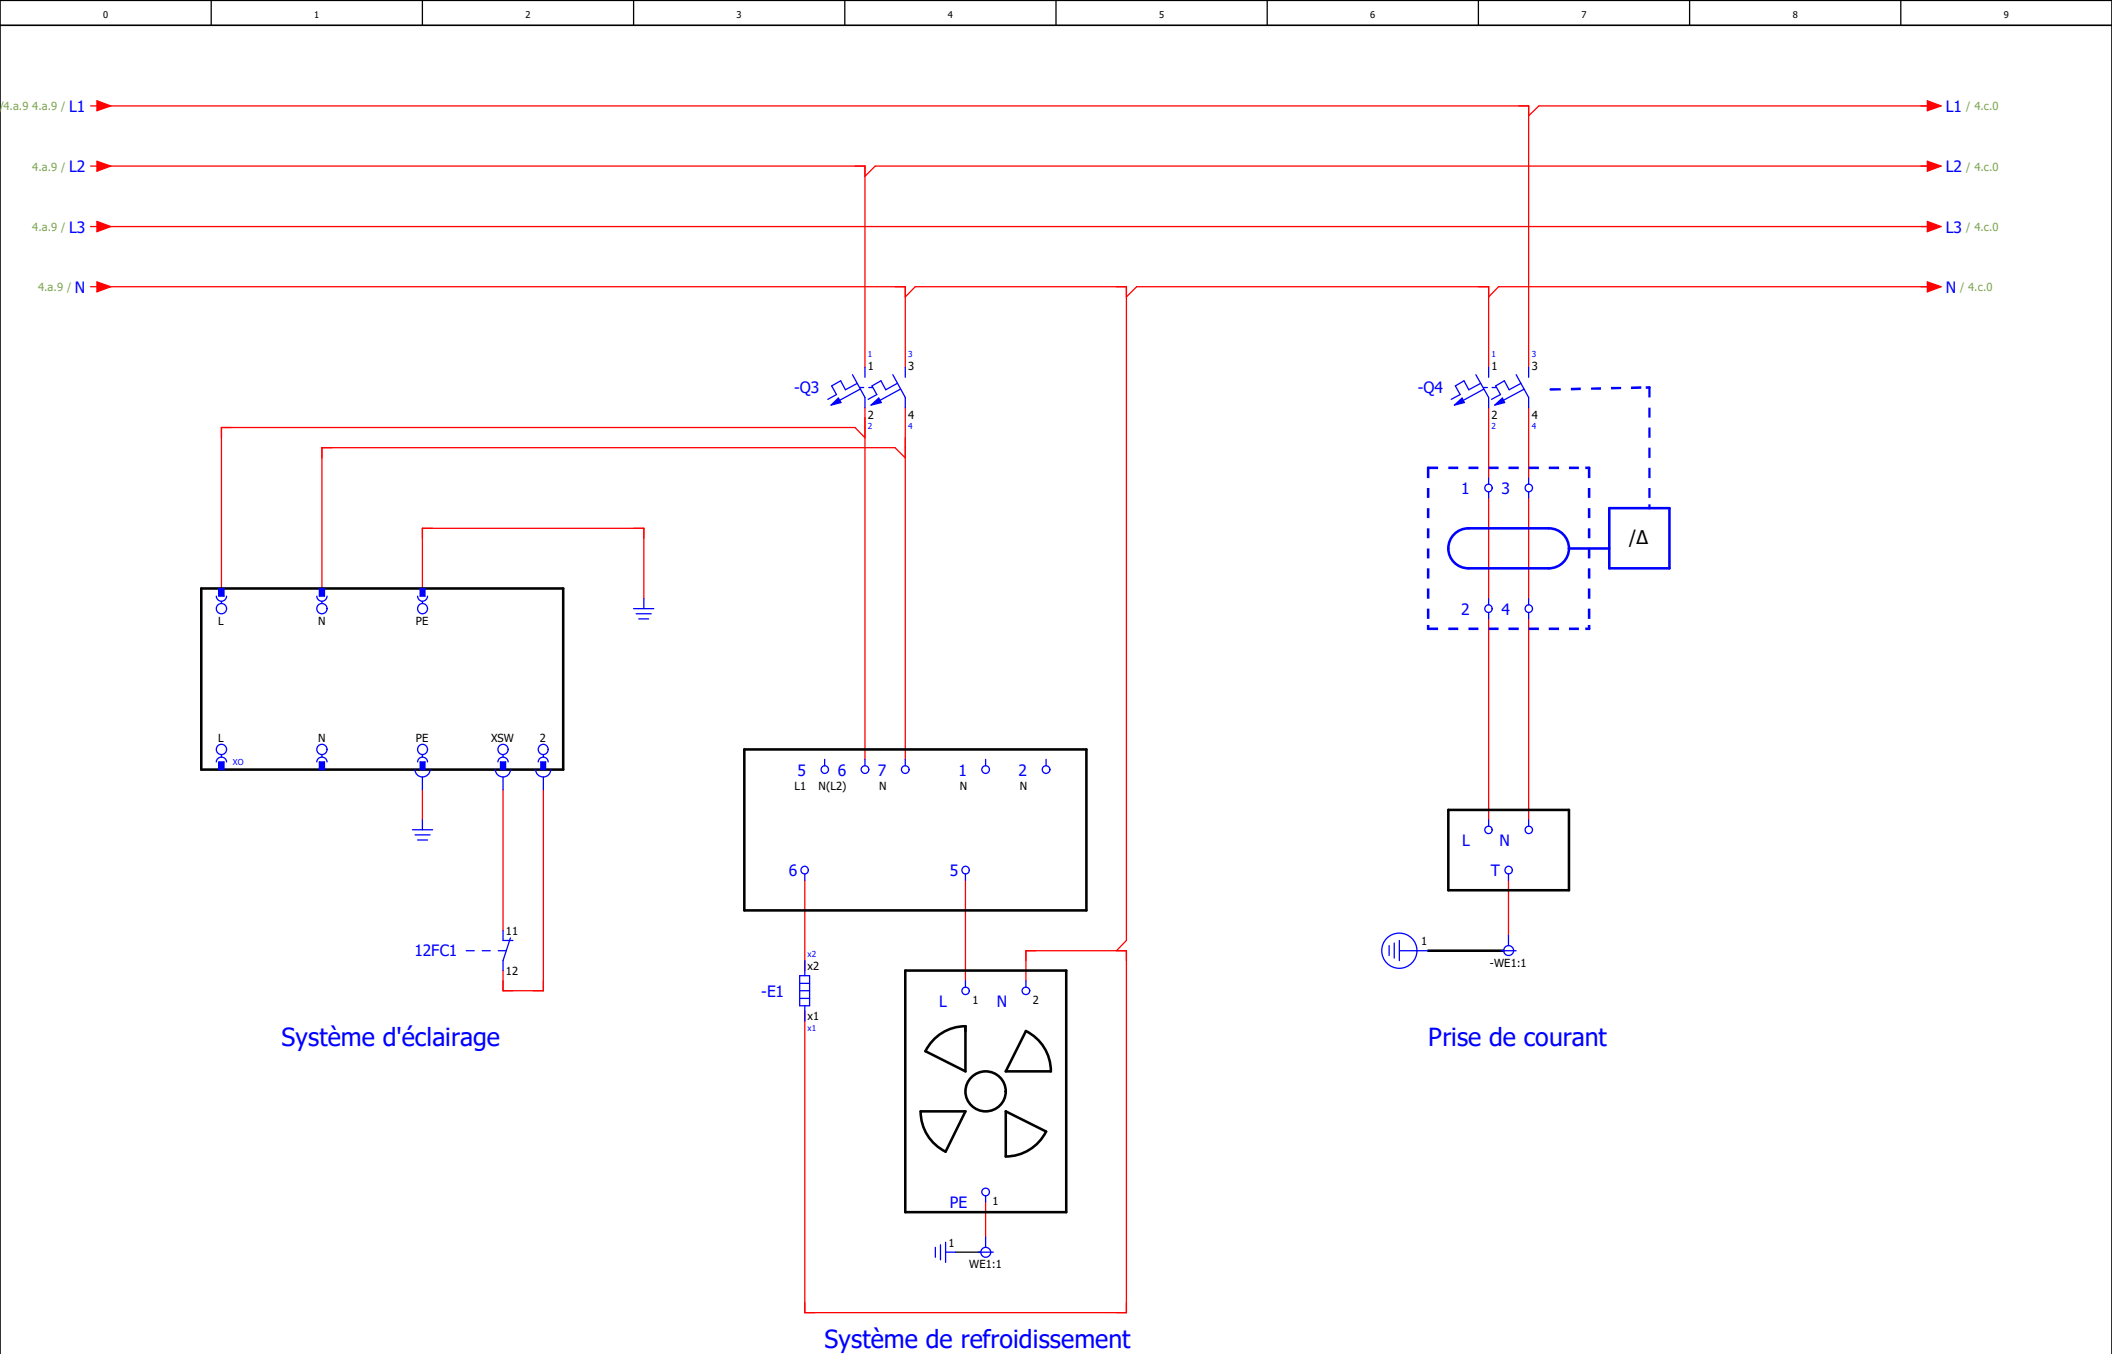

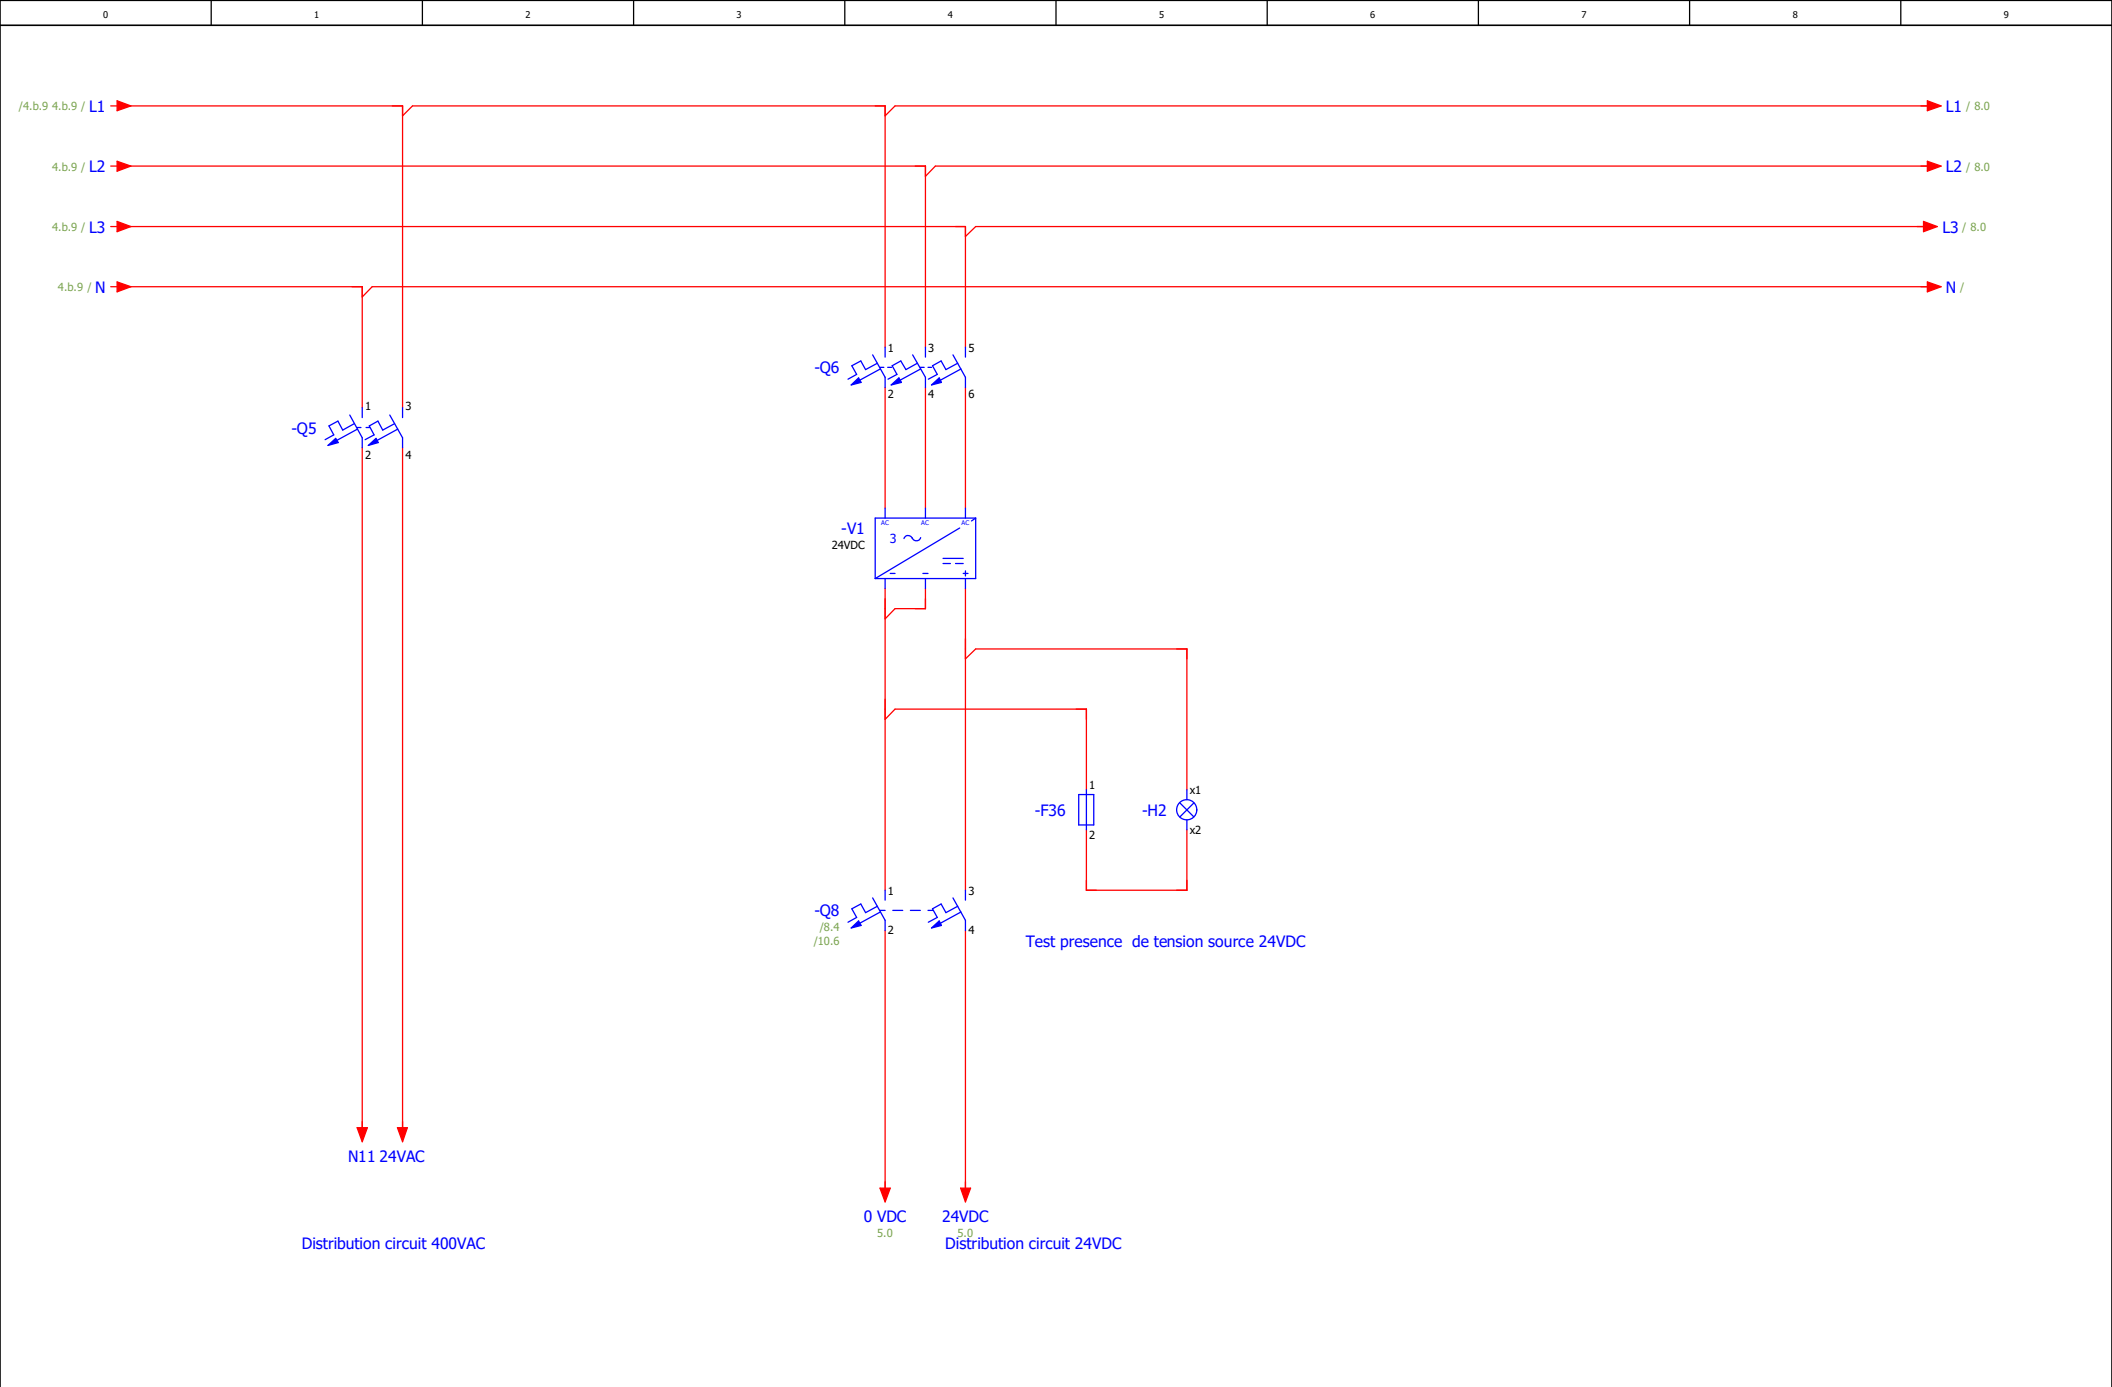

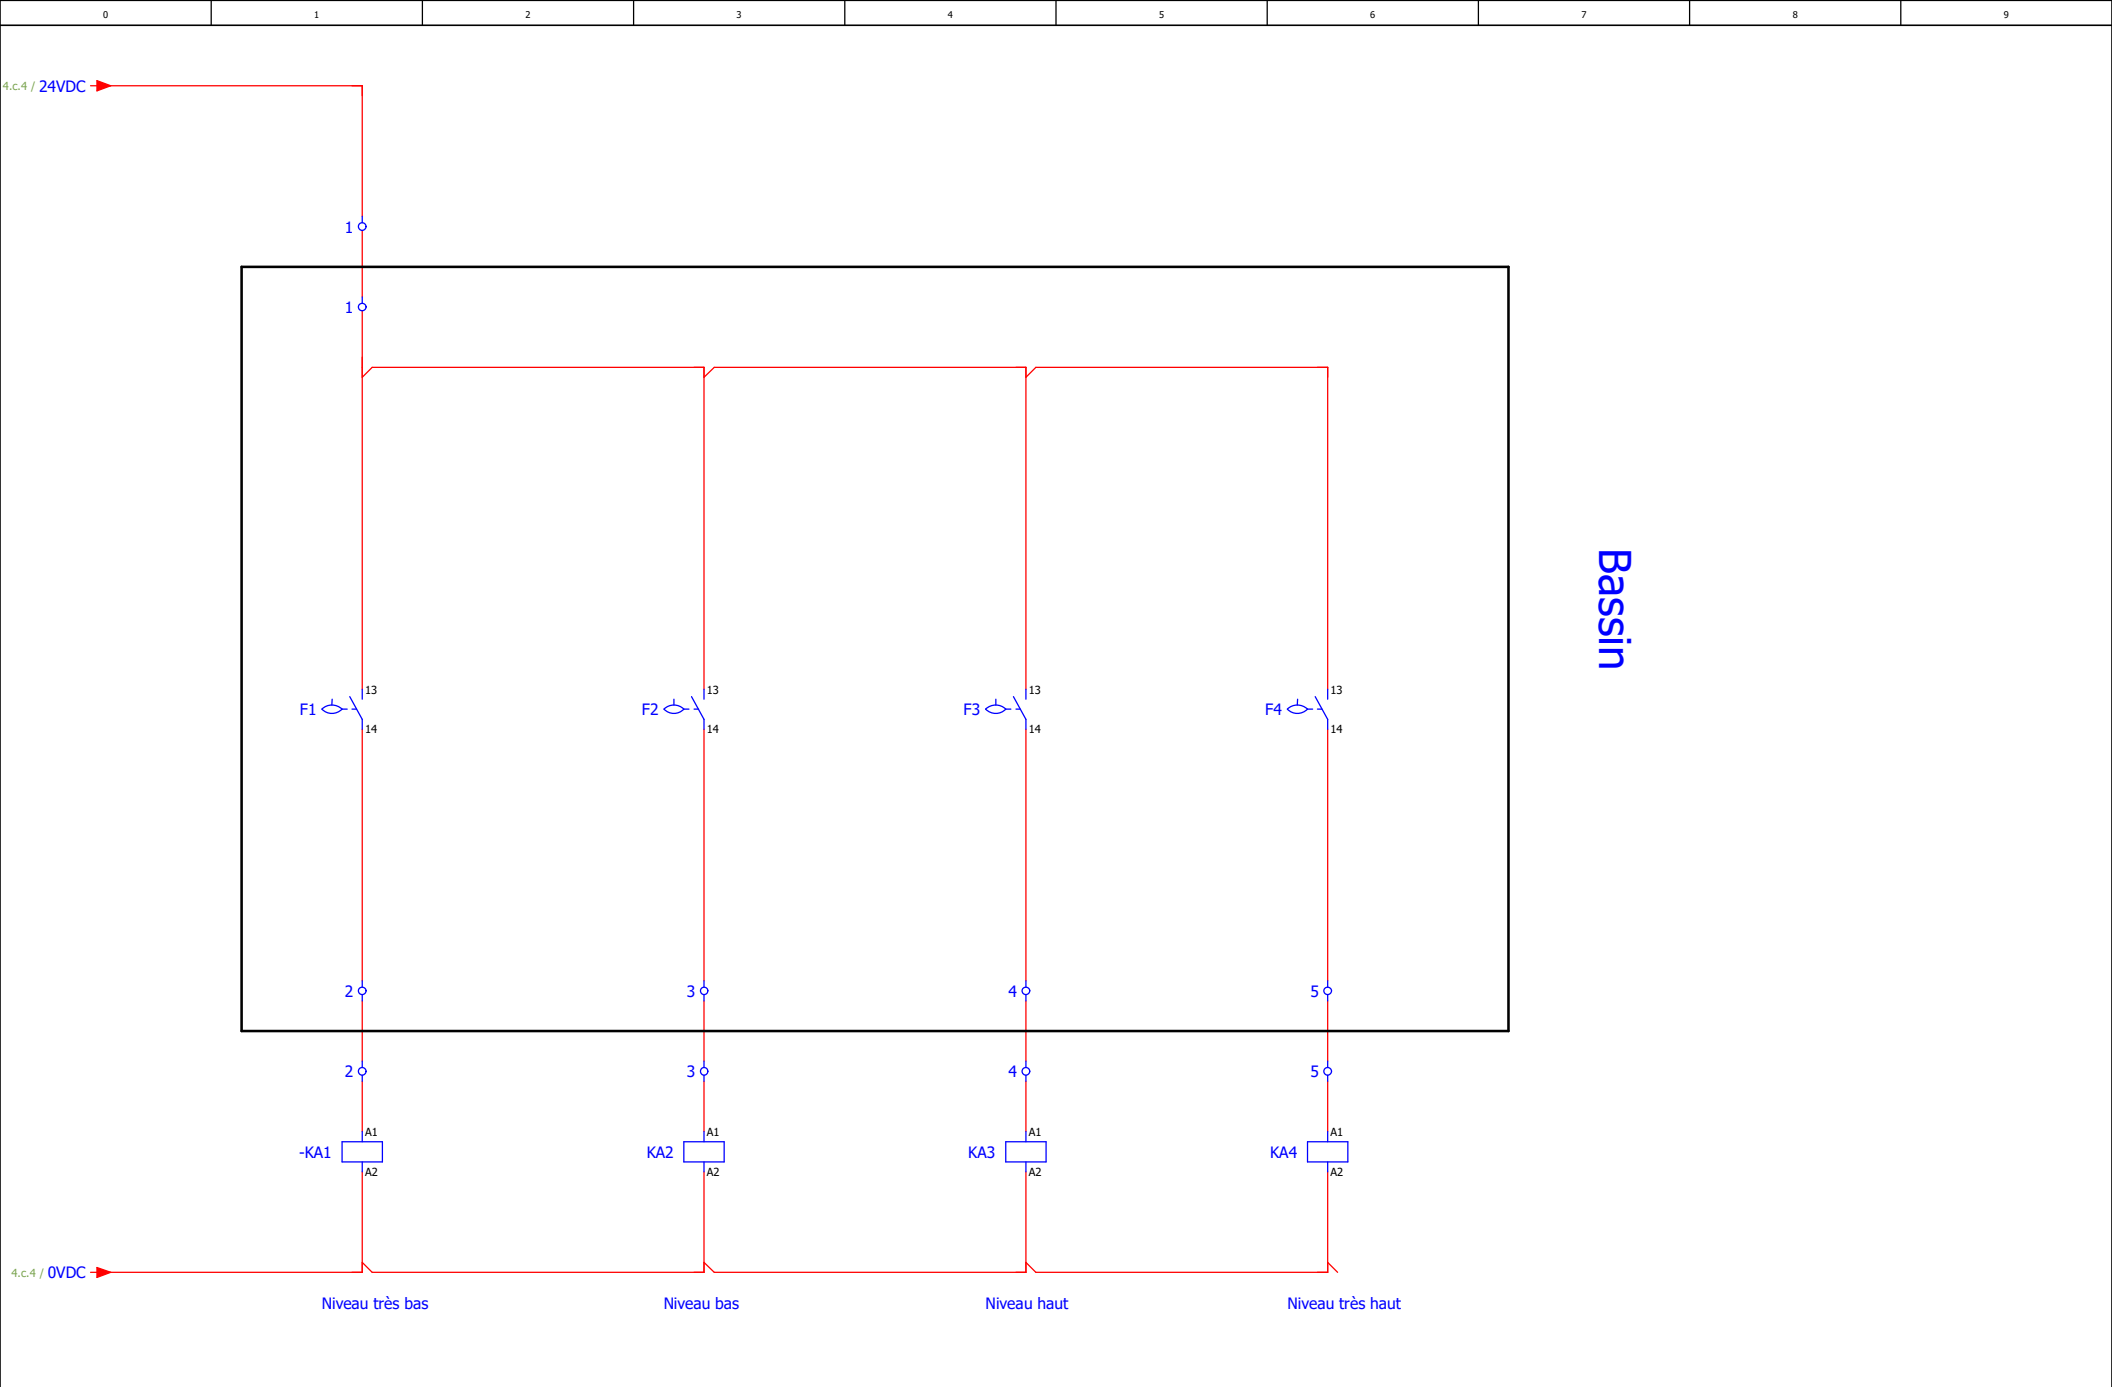


4.c										6										
			Date	9/30/2024	EPLAN				Lm Electric - Ecole Nationale Polytechnique				Niveaux du flotteur							
			Ed.	IANYL																
			Appr.																	
Station de Pompage 4kW 2x400Vac																				
Modification	Date	Name	Original		Replacement of				Replaced by											
										IEC_tpl002				Page 5						
														Page 11 / 19						

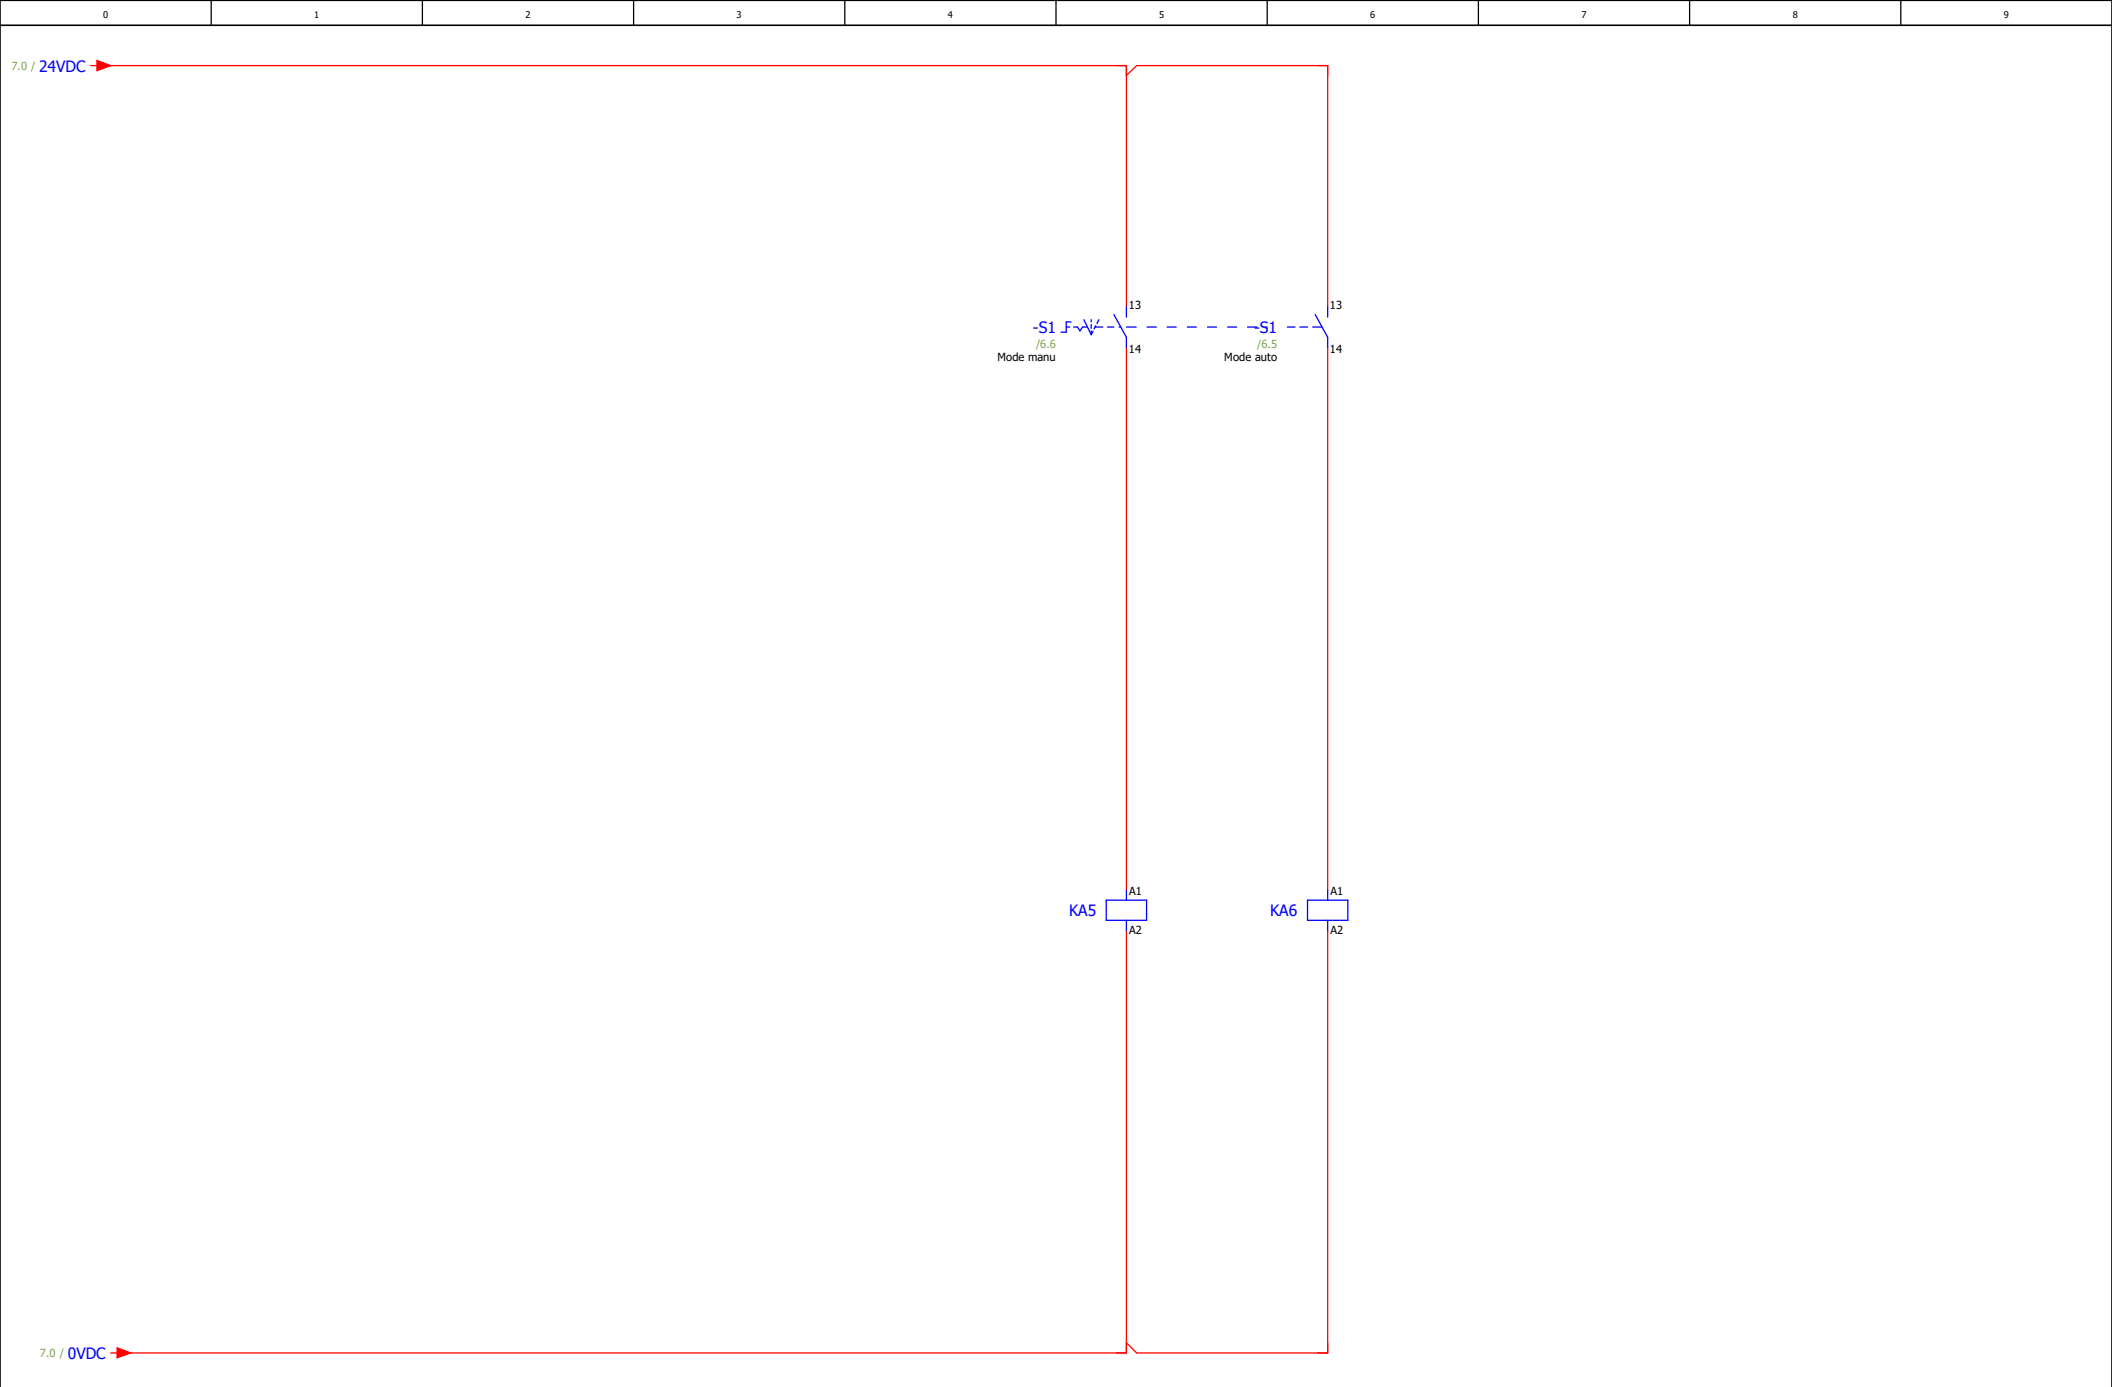


5														7													
			Date	9/30/2024	EPLAN Station de Pompage 4kW 2x400Vac				Lm Electric - Ecole Nationale Polytechnique				Commutateur mode manuel Comutateur mode automatique														
			Ed.	IANYL																							
			Appr.																								
Modification	Date	Name	Original		Replacement of		Replaced by										IEC_tpl002				Page 6						
																						Page 12 / 19					

			Date	9/30/2024	EPLAN	Lm Electric - Ecole Nationale Polytechnique	Synthèse défaut			
			Ed.	IANYL						
			Appr.					Station de Pompage 4kW 2x400Vac		
Modification	Date	Name	Original		Replacement of	Replaced by		IEC_tp1002		Page 7
										Page 13 / 19

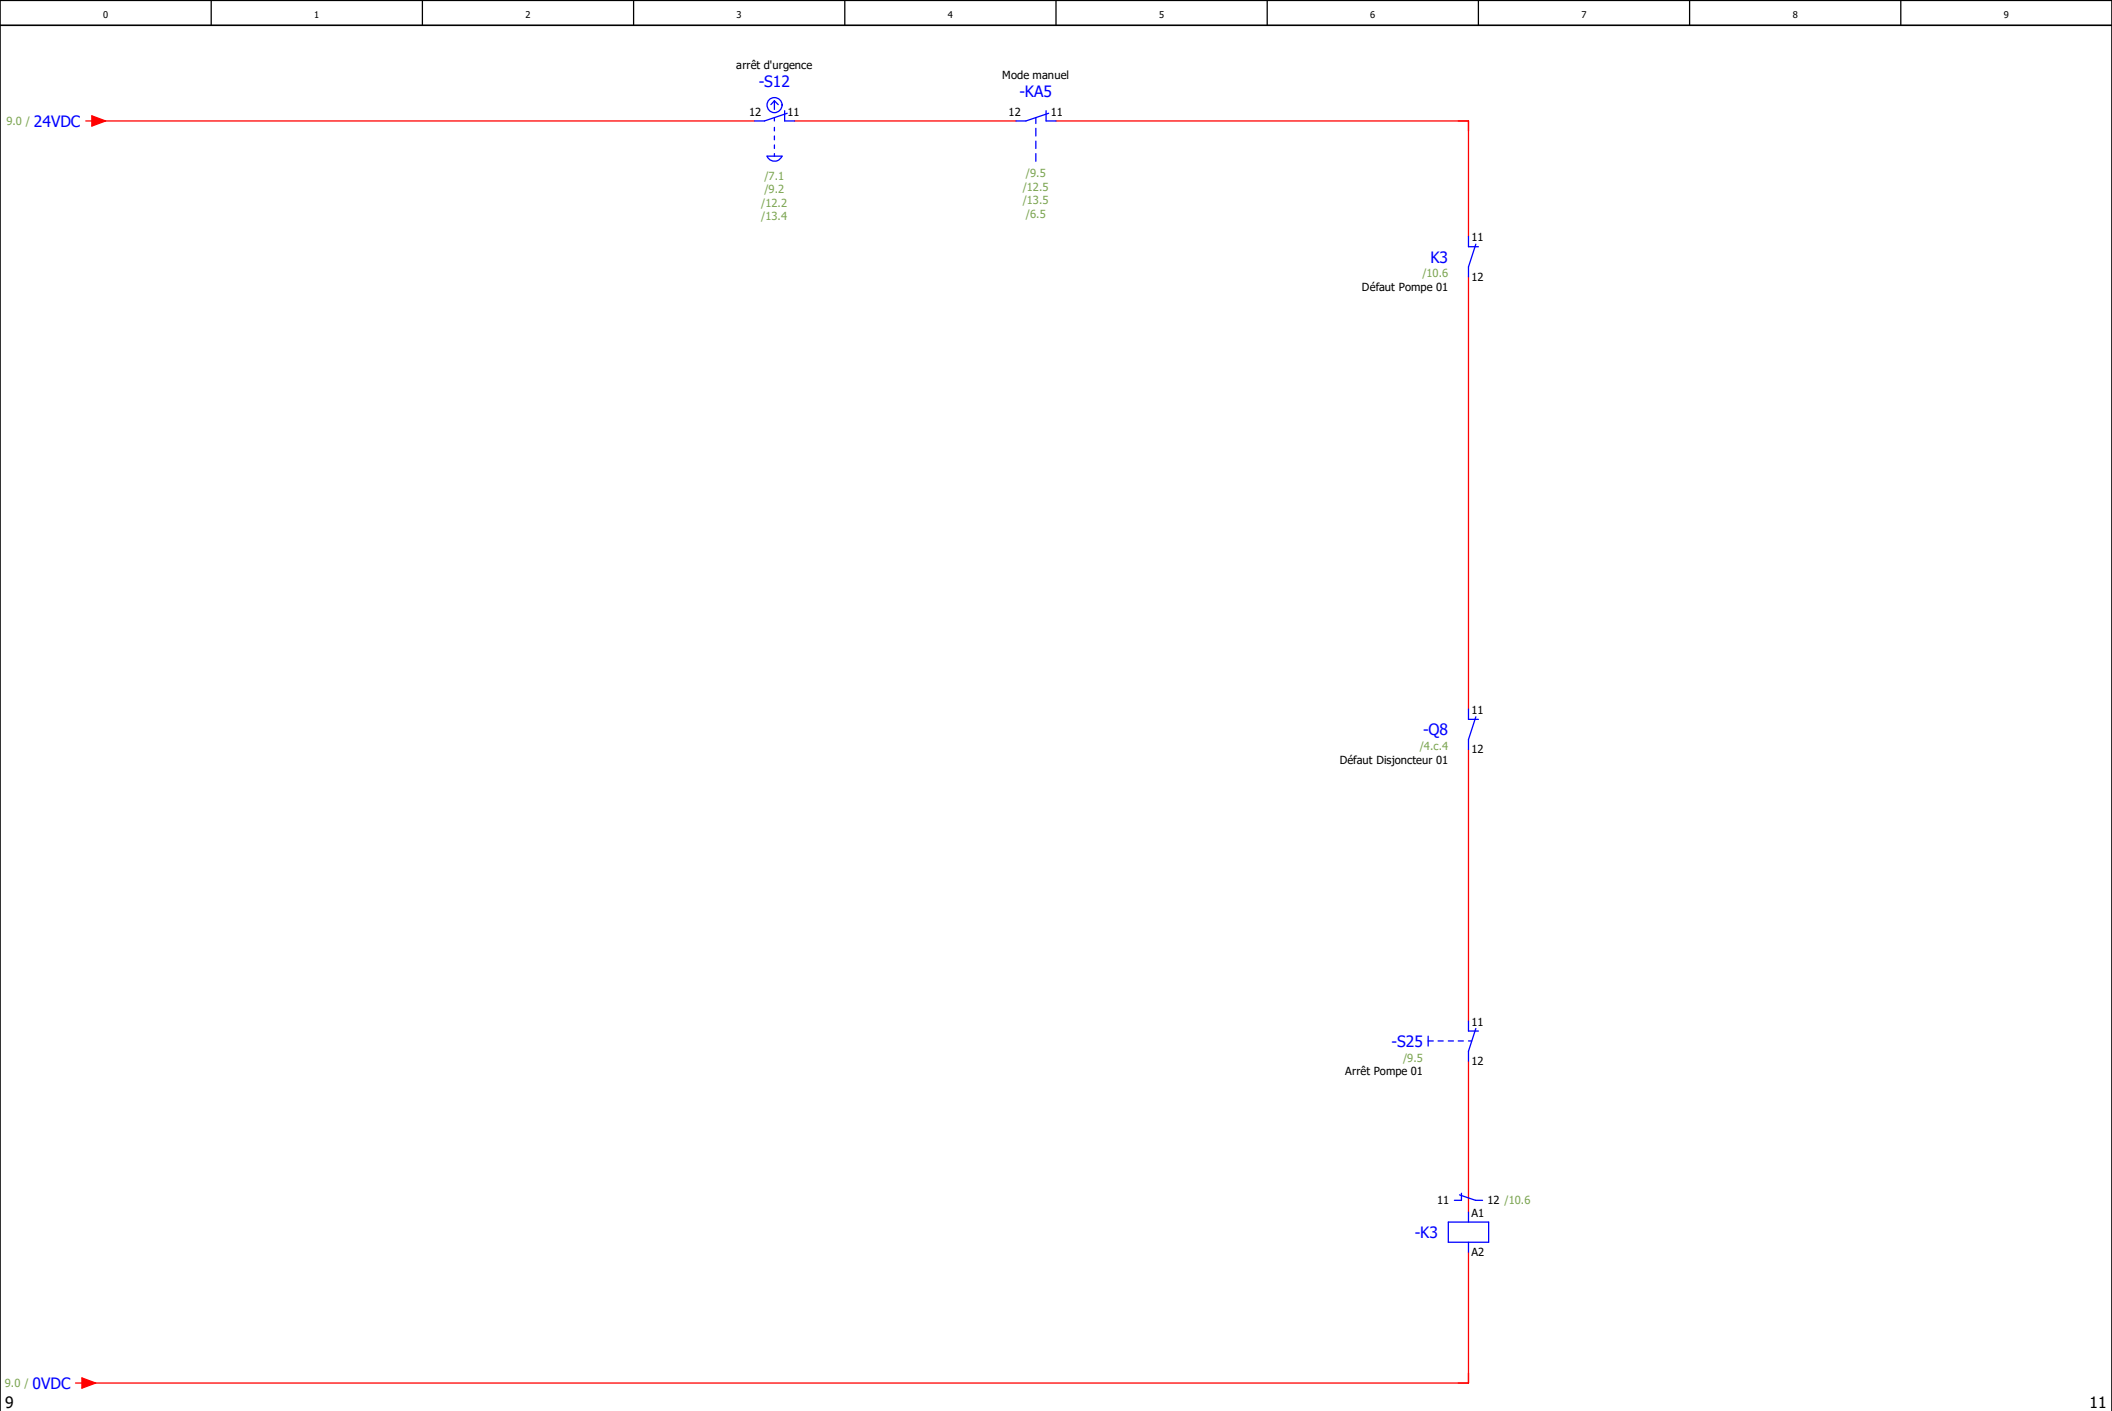

9				11	
			Date	9/30/2024	EPLAN
			Ed.	IANYL	
			Appr.		Station de Pompage 4kW 2x400Vac
Modification	Date	Name	Original	Replacement of	Replaced by
				Lm Electric - Ecole Nationale Polytechnique	Circuit commande (manuel) default pompe 01
				IEC_tpl002	Page 10
					Page 16 / 19

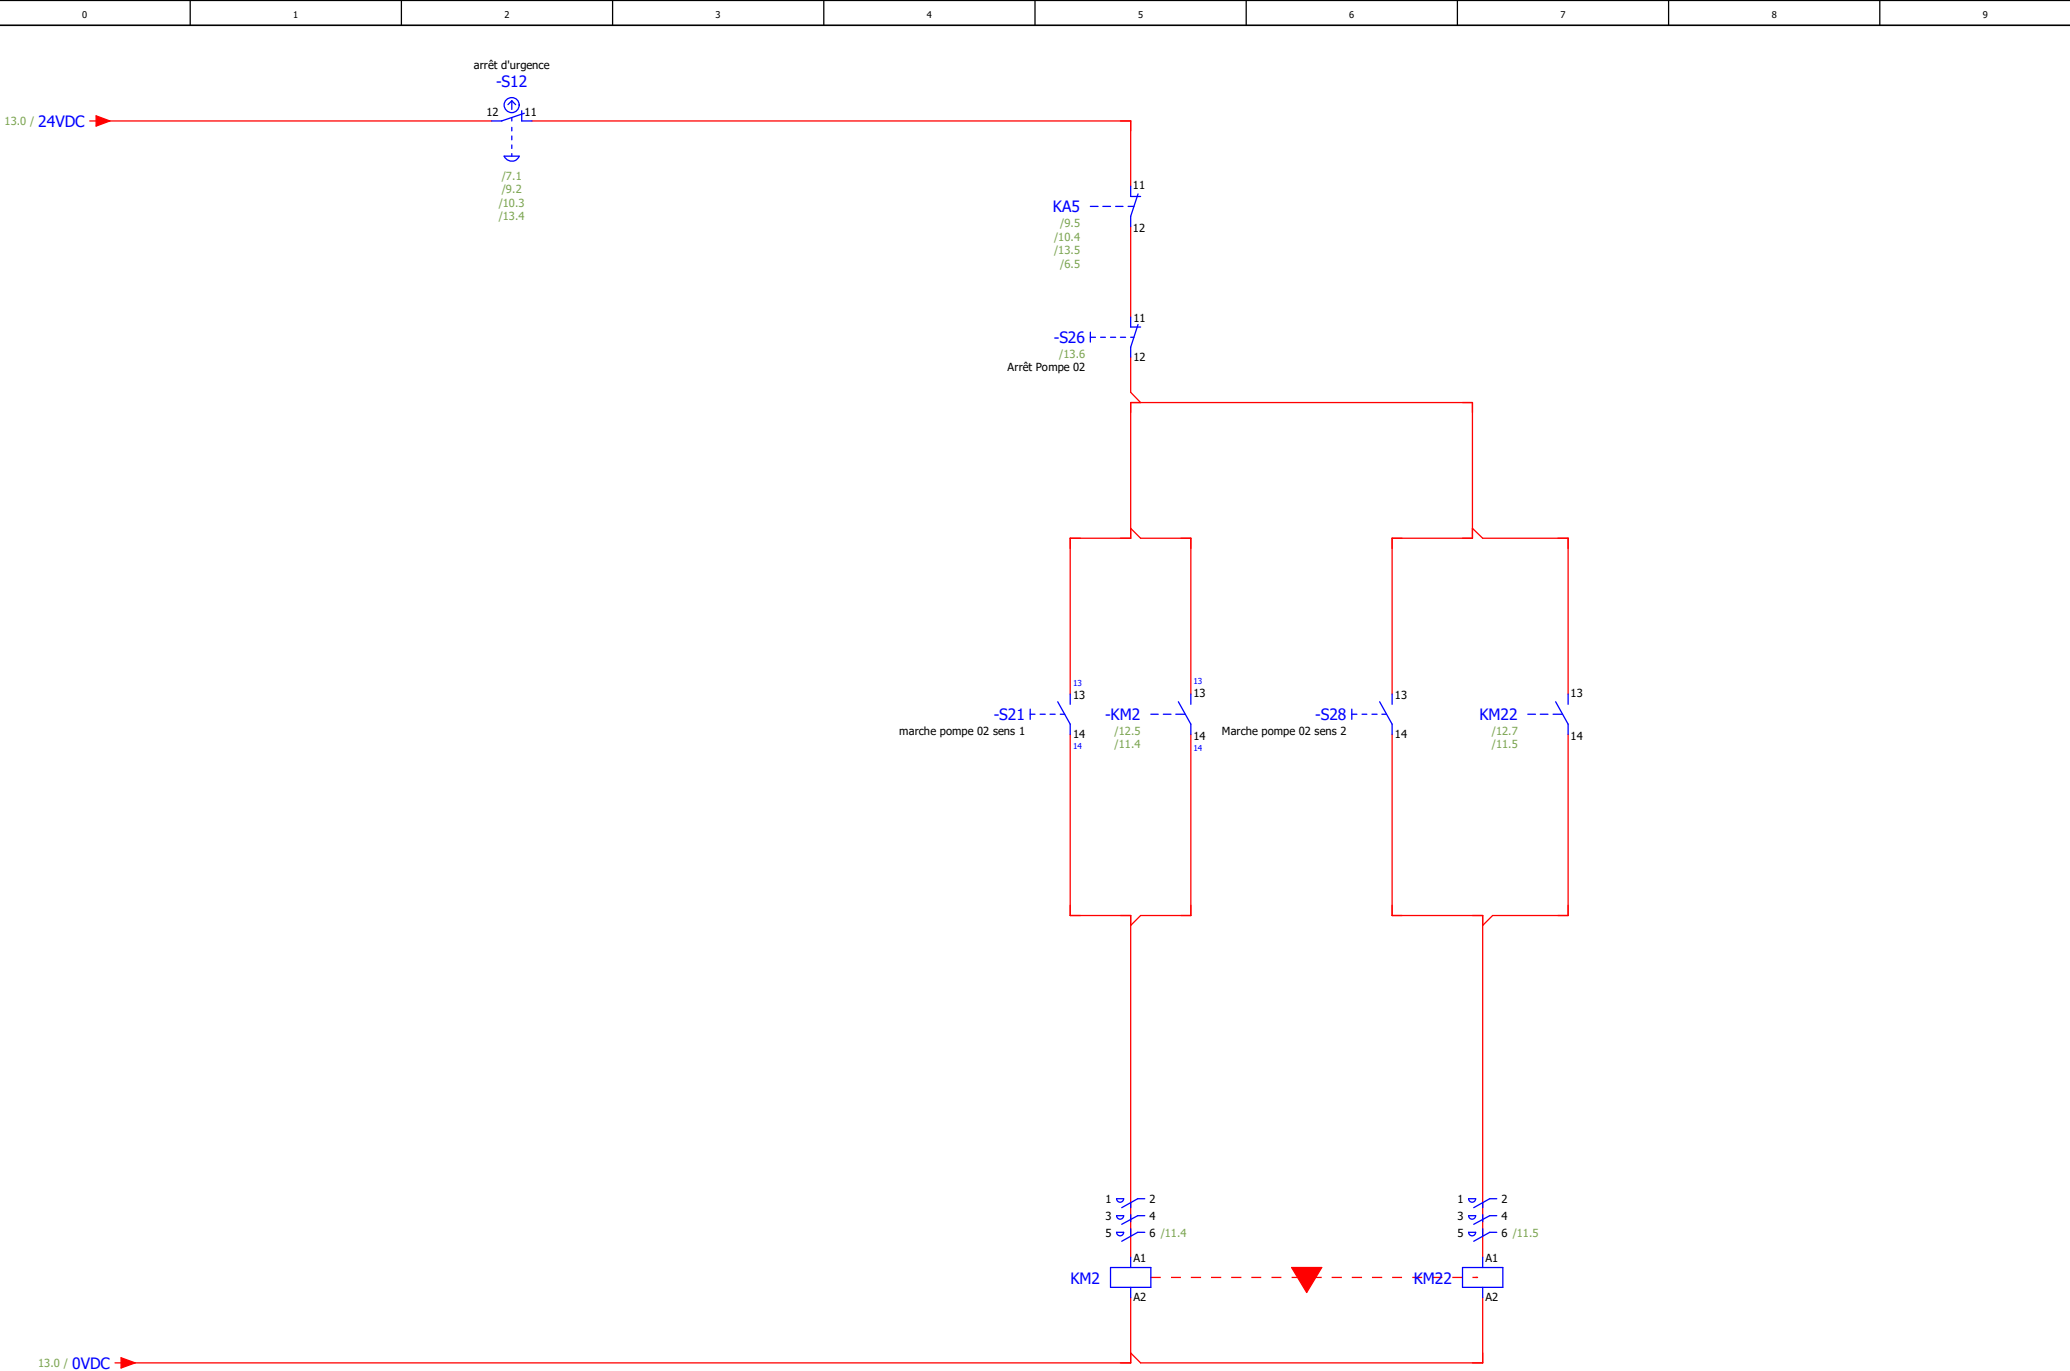

11		13									
			Date	9/30/2024	EPLAN		Lm Electric - Ecole Nationale Polytechnique		Circuit commande Pompe 02		
			Ed.	IANYL	Station de Pompage 4kW 2x400Vac						
			Appr.		Replacement of		Replaced by				
Modification	Date	Name	Original								

