



Lm Electric - Ecole Nationale Polytechnique

/
/ Algiers
Phone +213 (0)XXXX -XX XX - X

Company / customer

Project description Station de Pompage 4kW 2x400Vac
Job number IEC_tpl002
Commission EPLAN

Manufacturer (company) Lm Electric - Ecole Nationale Polytechnique

Path EPLAN sample project
Project name SDP03
Make
Type
Place of installation
Responsible for project
Part feature

Created on 9/24/2024
Edit date 9/30/2024 by (short name) IANYL
Number of pages 19

			Date	9/24/2024	EPLAN	Lm Electric - Ecole Nationale Polytechnique	Cover			
			Ed.	IANYL						
			Appr.		Station de Pompage 4kW 2x400Vac					
Modification	Date	Name	Original		Replacement of	Replaced by			IEC_tpl002	Page 1 / 19

Symbol overview

IEC_symbol

F25_001

1 S NO contact NO auxiliary contact 20010 20029 20029 20029	79 FT3 Electromechanical device of a thermal relay, three-pole Thermal release (bimetal relay) 20010 20029 20029 20029	233 XBD Socket of a plug connection Female pin, 2 connection points 20010 20029 20029 20029
2 O NC contact NC auxiliary contact 20010 20029 20029 20029	116 RE Heating element Heating, 2 connection points 20010 20029 20029 20029	288 FS Fuse switch, single-pole Fused disconnect, single 20010 20029 20029 20029
20 K Electromechanical operating device, general / relay coil, general Coil for power contactor 20010 20029 20029 20029	121 FA2 Circuit breaker, two-pole Double circuit breaker 20010 20029 20029 20029	298 ERDE2 Protective ground / protective conductor connection PE device connection point 20010 20029 20029 20029
30 X Terminal Terminal, general, with saddle jumper, 2 connection points 20010 20029 20029 20029	124 QL3 Power circuit breaker / motor overload switch with switch mechanism and without line Motor overload switch three-pole 20010 20029 20029 20029	300 ERDE Ground, general PE device connection point 20010 20029 20029 20029
35 SSD Pressure switch, NO contact Pushbutton, NO contact 20010 20029 20029 20029	130 BSSW Float switch, NO contact Switch, NO contact 20010 20029 20029 20029	307 M3_1 Three-phase asynchronous motor, one rotation speed Three-phase motor 20010 20029 20029 20029
41 SSDR Switch, NO contact, operation by pushing Switch, NO contact 20010 20029 20029 20029	159 SSA Pushbutton, NO contact, general Pushbutton, NO contact 20010 20029 20029 20029	1023 FA3 Circuit breaker, three-pole Triple circuit breaker 20010 20029 20029 20029
46 H Lamp / indicator light, general Lamp, single 20010 20029 20029 20029	160 SOA Pushbutton, NC contact, general Pushbutton, NC contact 20010 20029 20029 20029	1027 GBOX33 Bridge rectifier, three-phase, secondary side 3 connection points Rectifier, variable 20010 20029 20029 20029
50 F1 Fuse, single-pole, general Safety fuse 20010 20029 20029 20029	170 SONOT1 Emergency stop switch / Emergency stop pushbutton, NC contact Pushbutton, NC contact 20010 20029 20029 20029	1046 OMW NC contact with action line NC auxiliary contact 20010 20029 20029 20029

Symbol overview

IEC_symbol

F25_001

1406 XT1_2 Terminal / distributed terminal with one connection point (1 x graphical line) Terminal, general, with saddle jumper, 4 connection points	20010 20252 20027 20901 20011 20025 20024 20201		
1410 X1_NB Terminal with one connection point without saddle jumper connections Terminal, general, 1 connection point	20010 20027 20901 20011 20025 20024 20201		
1413 X2_NB Terminal with 2 connection points without saddle jumper connections Terminal, general, 2 connection points	20010 20027 20901 20011 20025 20024 20201		
1625 SL3 NO contact, 3-fold, power contact of a contactor Triple NO contact	20010 20300 20027 20901 20011 20025 20024 20201		

1410 X1_NB Terminal with one connection point without saddle jumper connections Terminal, general, 1 connection point	20010 20027 20901 20011 20025 20024 20201	♀ 20030 20225

SPECIAL


F25_001

3.b													4	
			Date	9/30/2024	EPLAN Lm Electric - Ecole Nationale Polytechnique		Symbol overview : SPECIAL 8 - 411							
			Ed.	IANYL										
			Appr.						Station de Pompage 4kW 2x400Vac					
Modification	Date	Name	Original		Replacement of	Replaced by			IEC_tpl002			Page	3.c	
												Page	6 / 19	

DANGER !




Également sous tension lorsque
l'interrupteur principal est ouvert

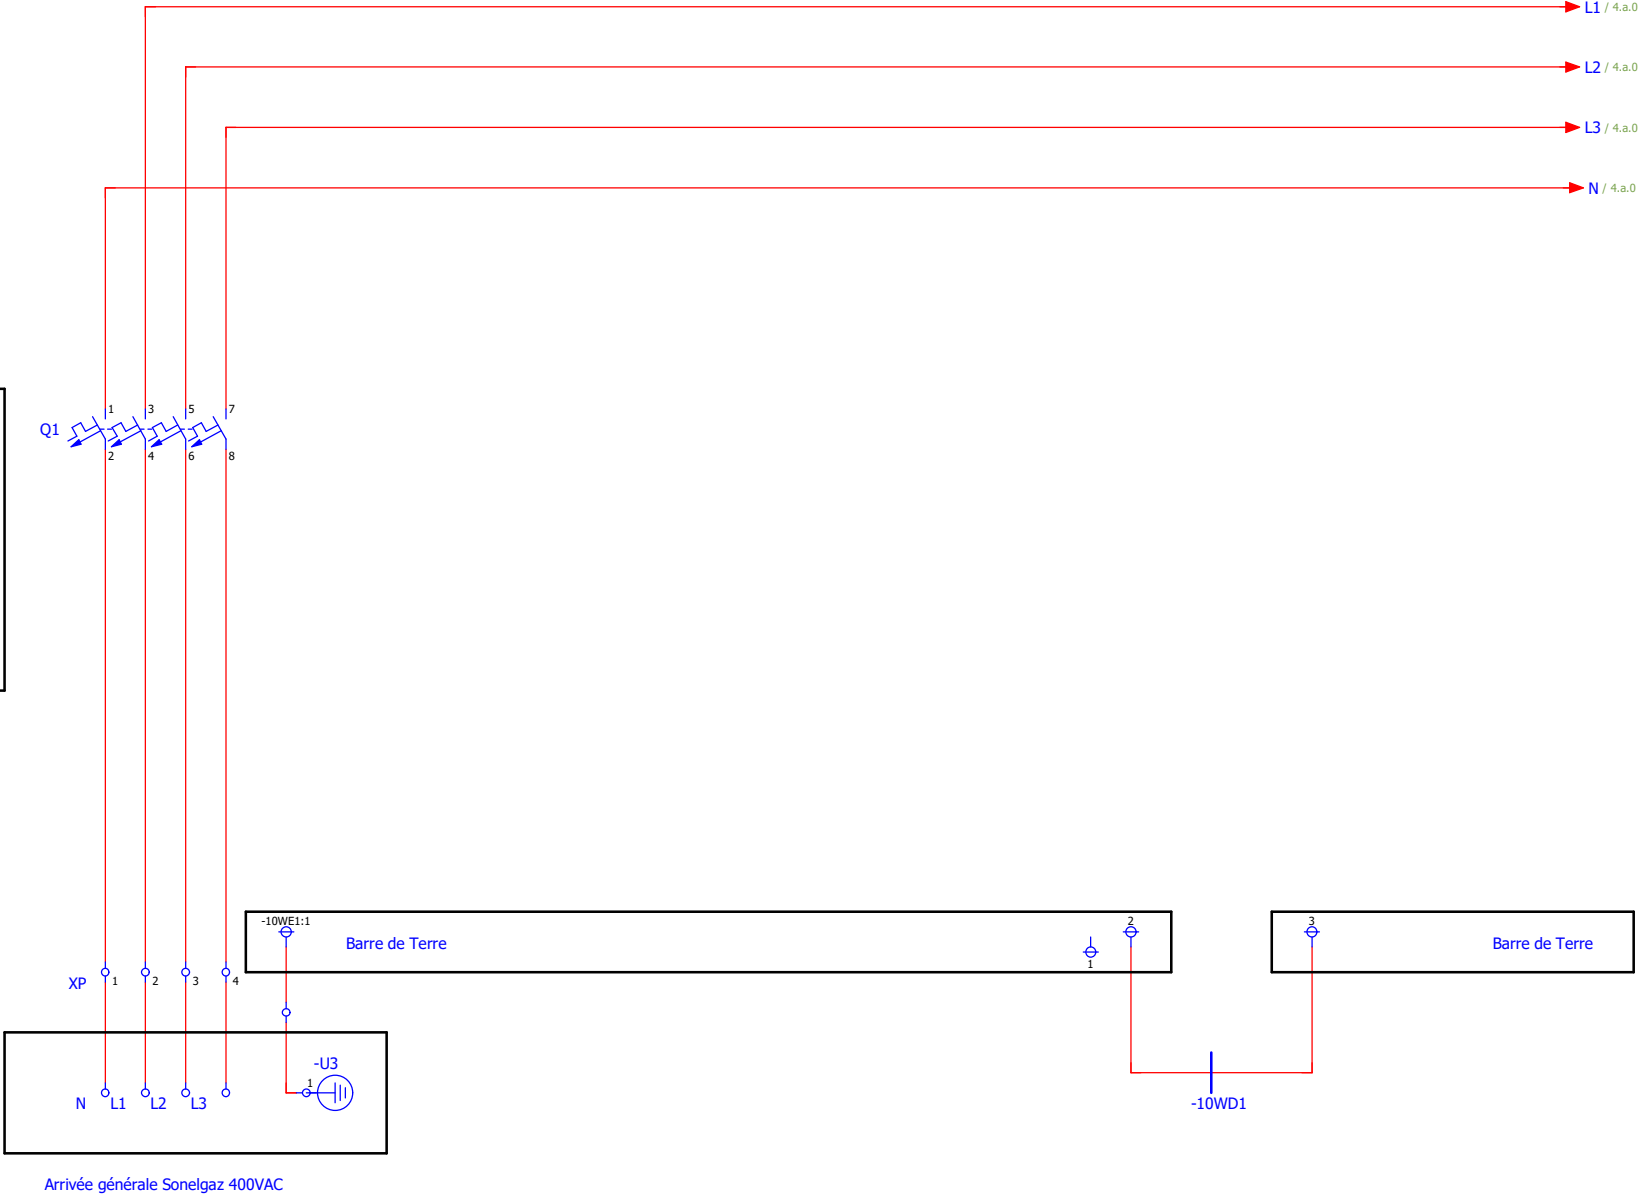


3.c

			Date	9/29/2024	EPLAN		Lm Electric - Ecole Nationale Polytechnique	Arrivée générale					
			Ed.	IANYL									
			Appr.		Station de Pompage 4kW 2x400Vac								
Modification	Date	Name	Original		Replacement of	Replaced by					IEC_tpl002	Page	4
												Page	7 / 19

4.a

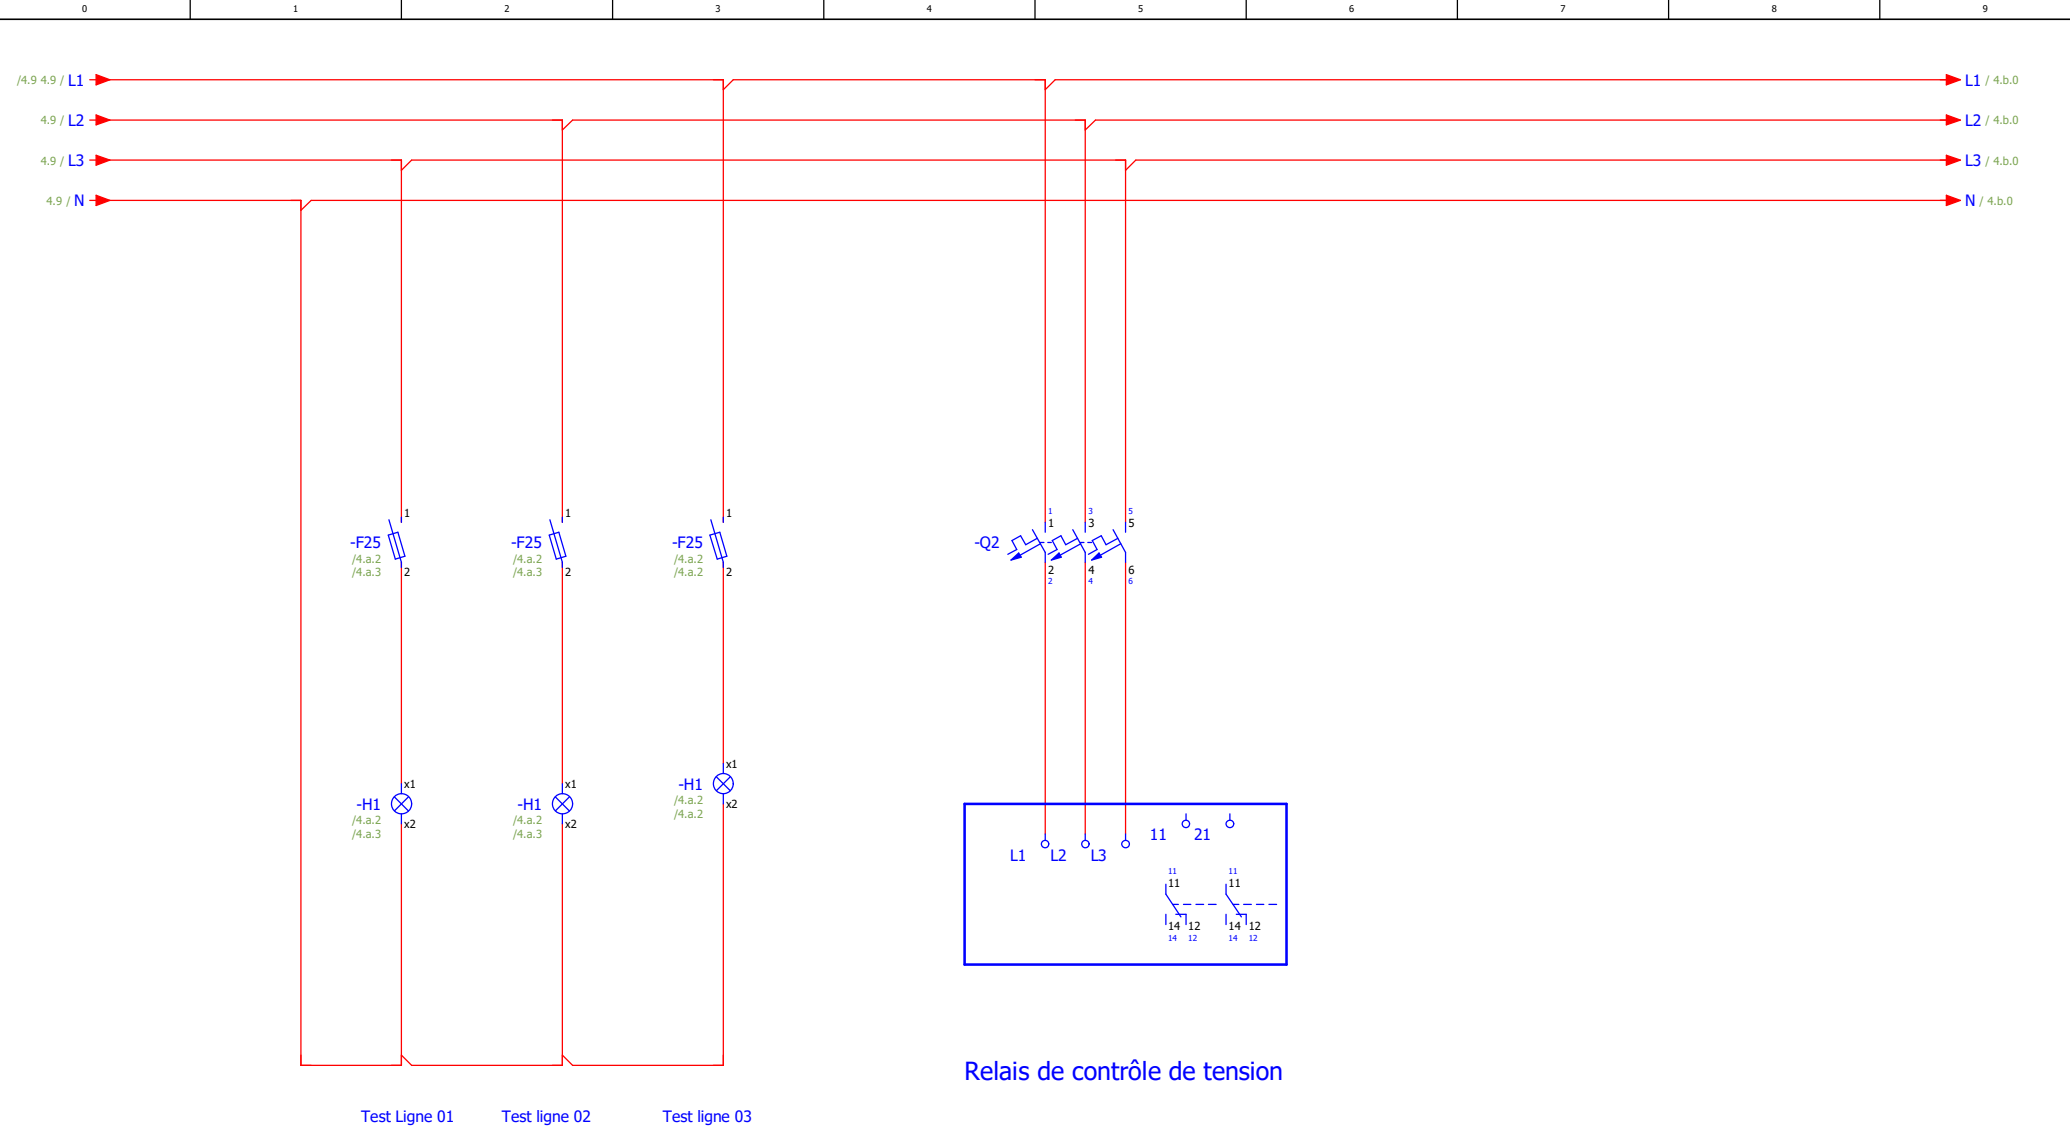


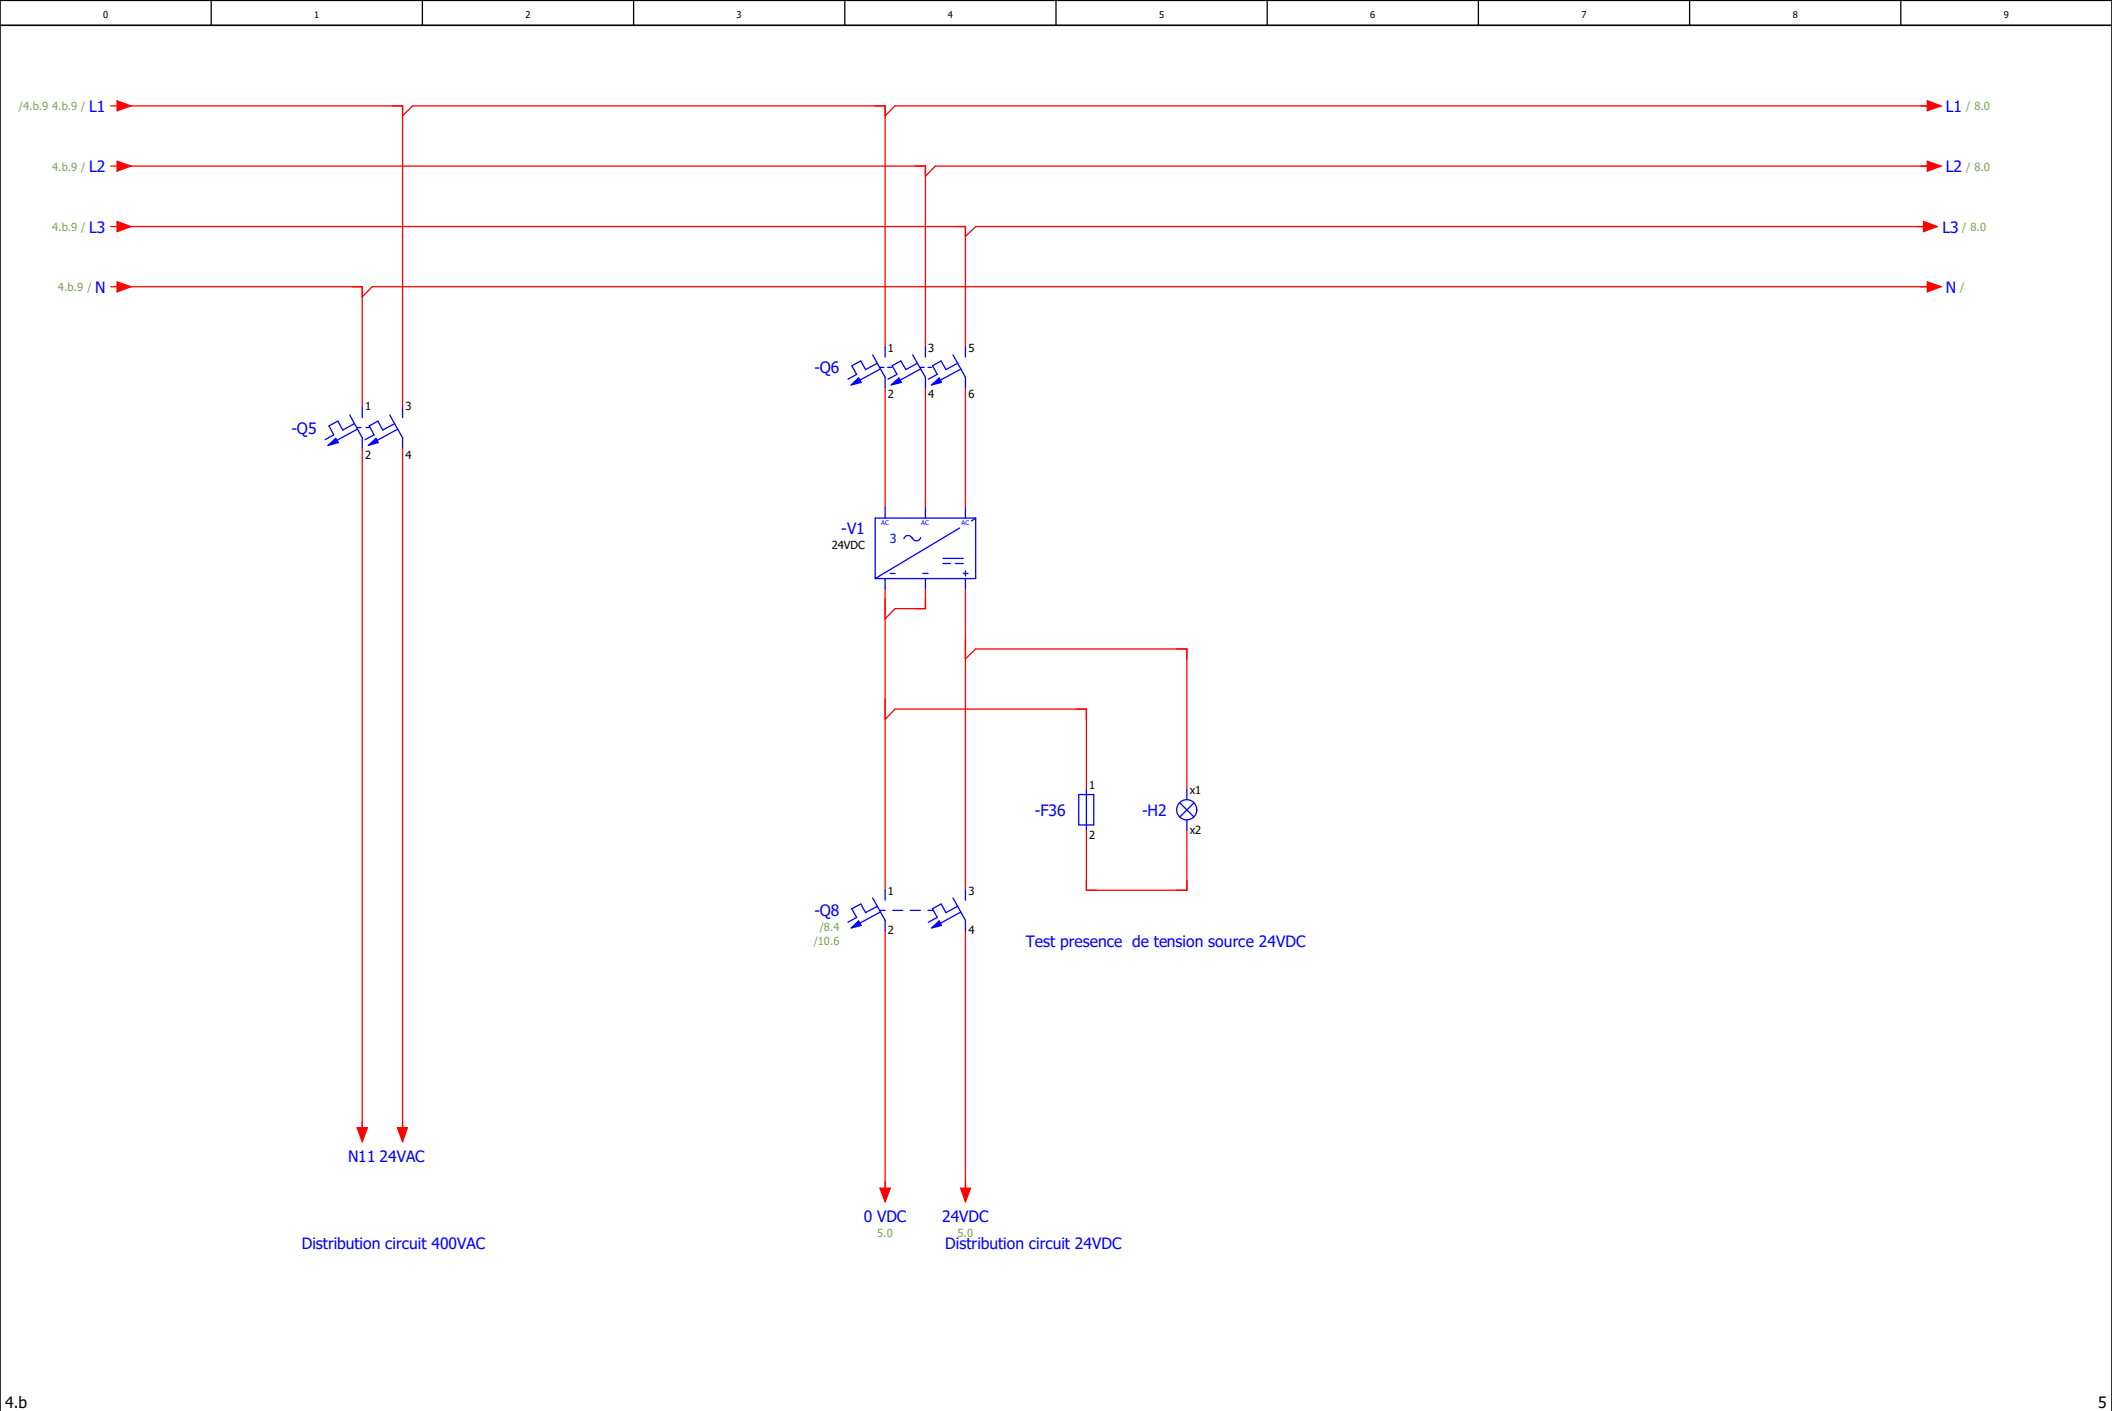


4.b

5

			Date	9/30/2024	EPLAN	Lm Electric - Ecole Nationale Polytechnique	Distribution électrique			
			Ed.	IANYL						
			Appr.							
Modification	Date	Name	Original					Replacement of	Replaced by	IEC_tpl002
								Page 10 / 19		

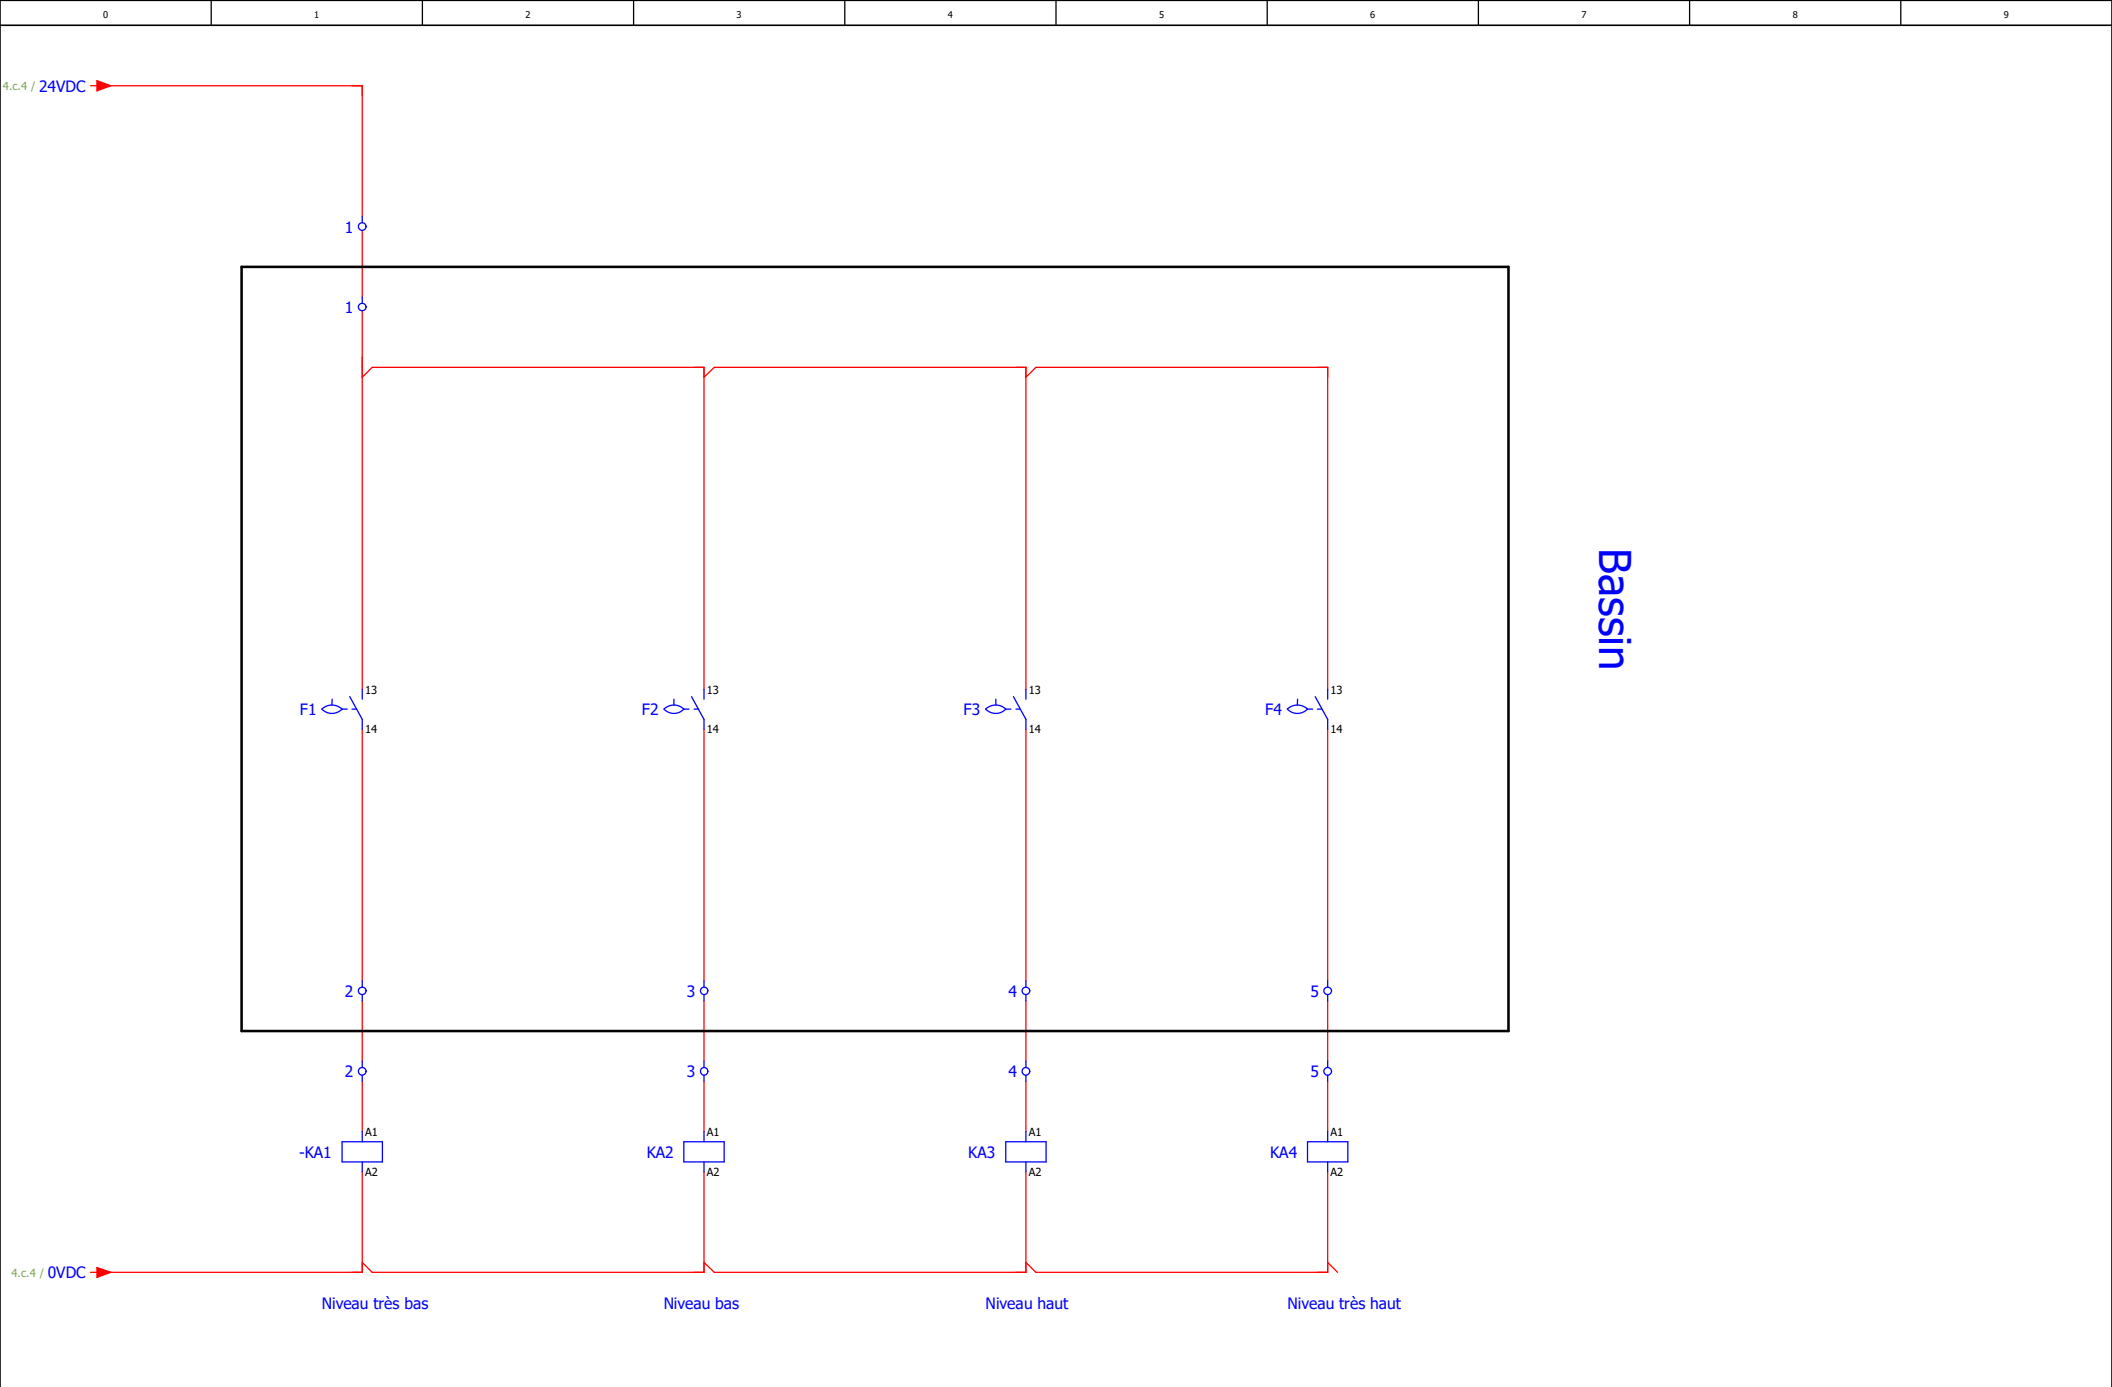


4.c				6	
			Date	9/30/2024	EPLAN
			Ed.	IANYL	Lm Electric - Ecole Nationale Polytechnique
			Appr.		Station de Pompage 4kW 2x400Vac
Modification	Date	Name	Original	Replacement of	Replaced by
				Niveaux du flotteur	
				IEC_tpl002	
				Page	5
				Page	11 / 19

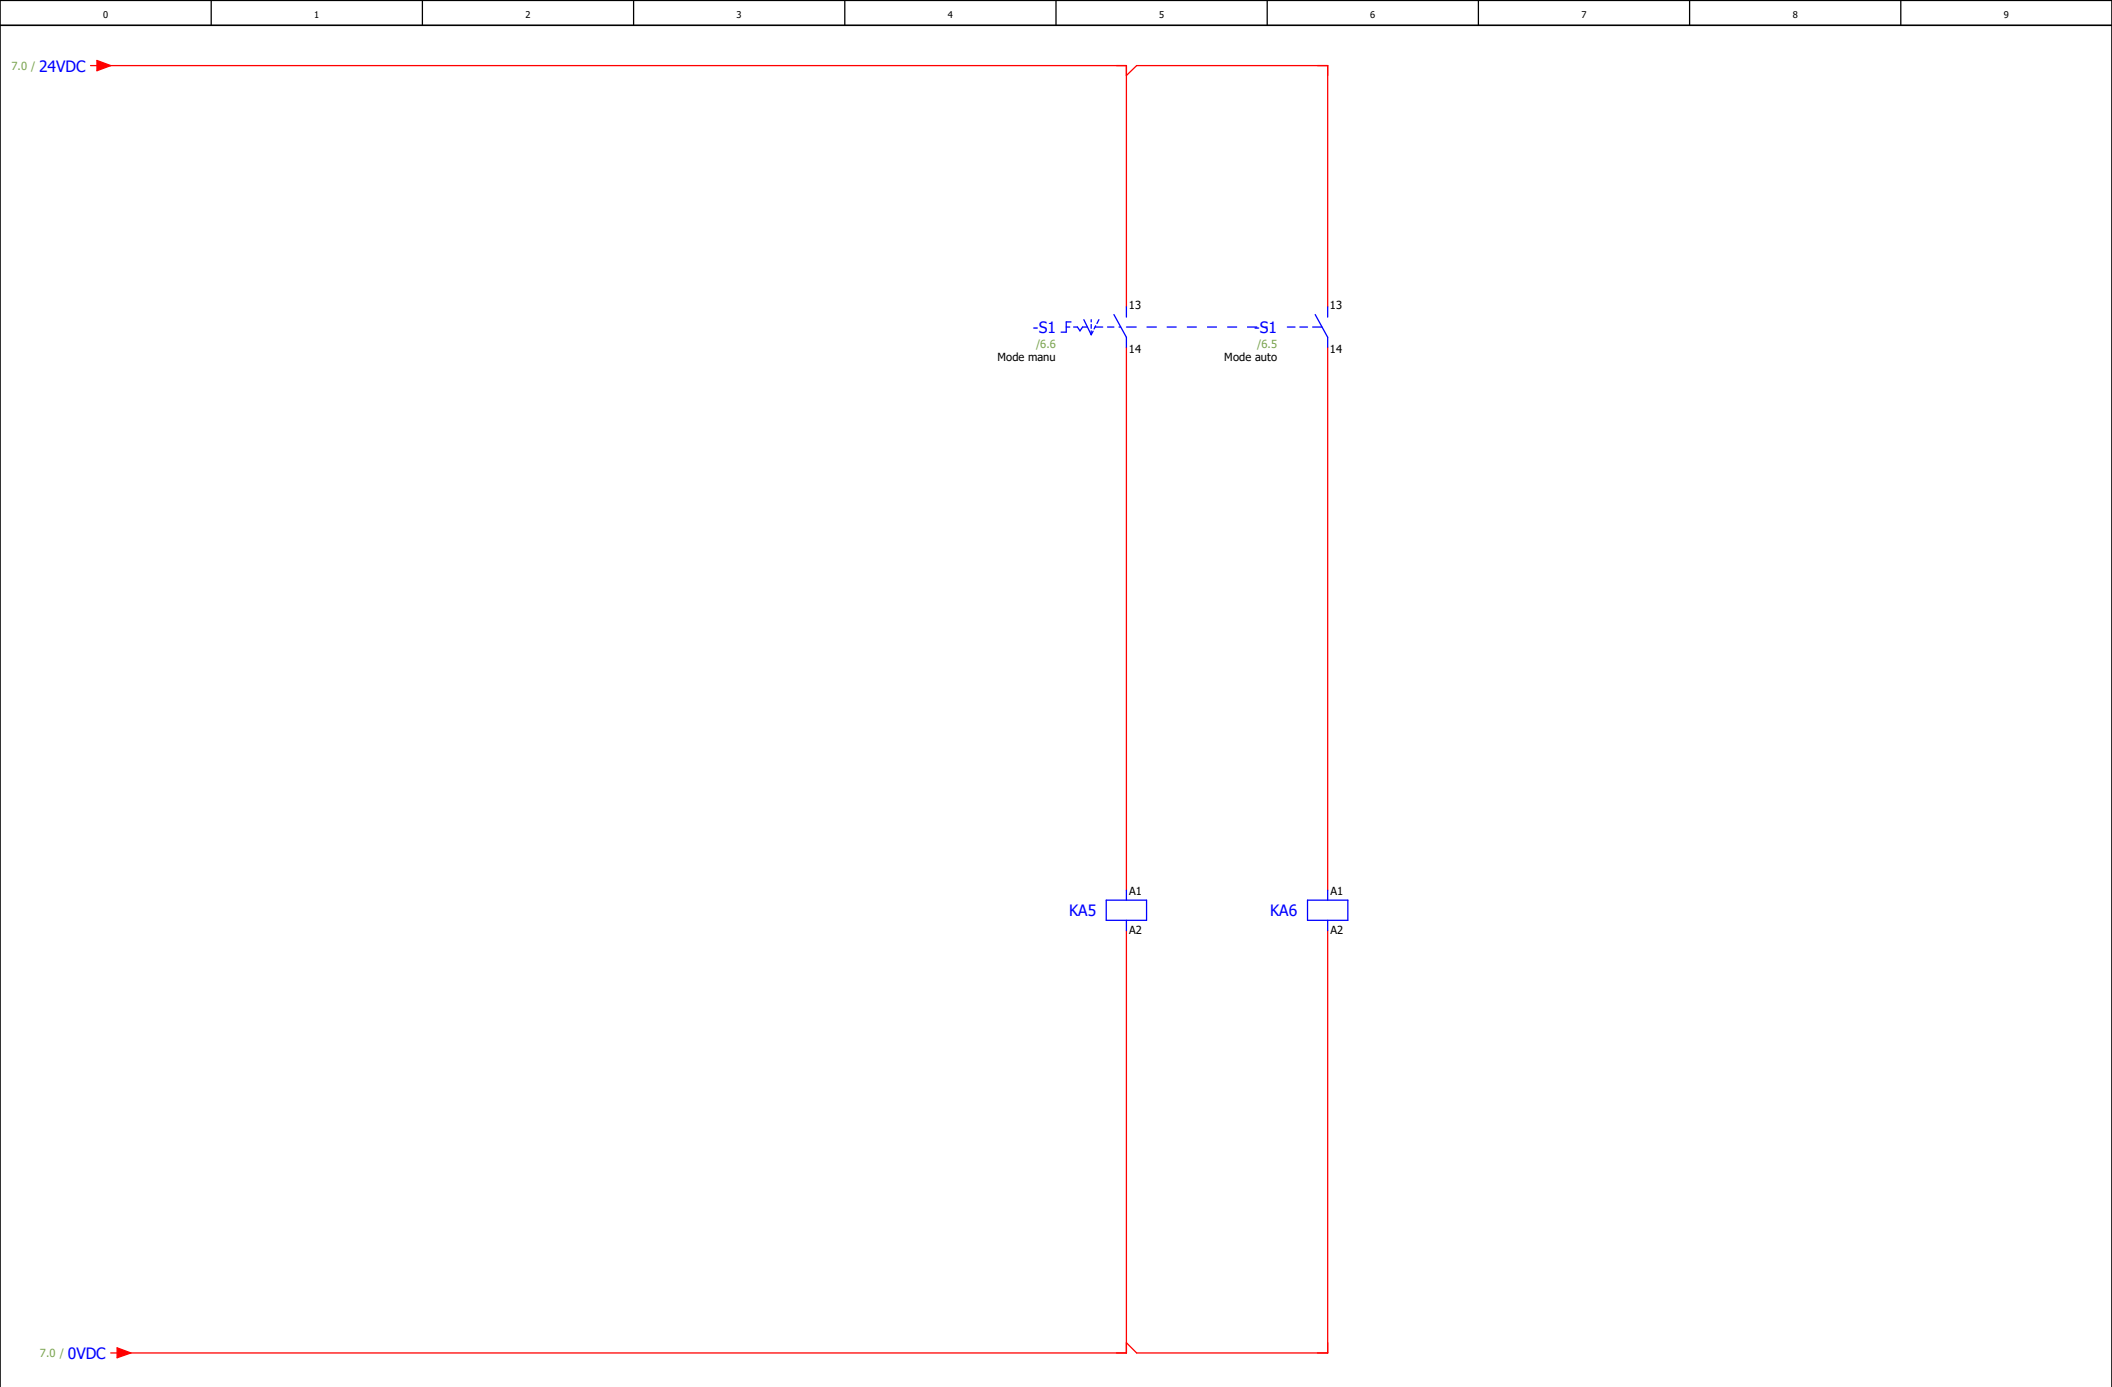


5				7																
			Date	9/30/2024	EPLAN				Lm Electric - Ecole Nationale Polytechnique				Commutateur mode manuel							
			Ed.	IANYL	Station de Pompage 4kW 2x400Vac				Polytechnique				Commutateur mode automatique							
Modification	Date	Name	Original		Replacement of				Replaced by								IEC_tpl002			
																	Page 6			
																	Page 12 / 19			


[illegible]

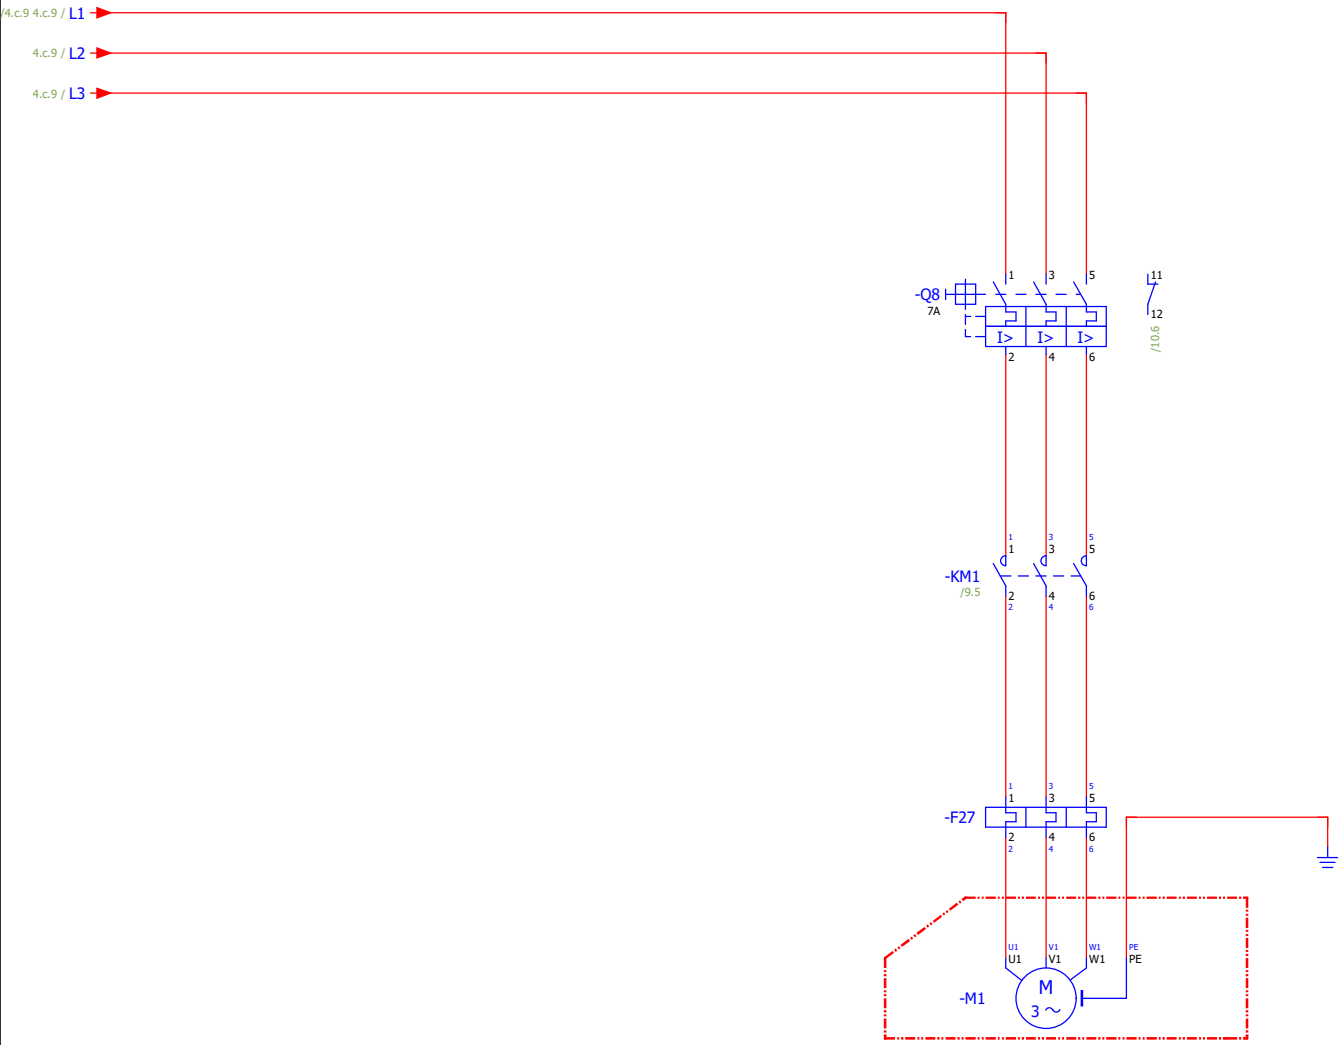


Pompe 01

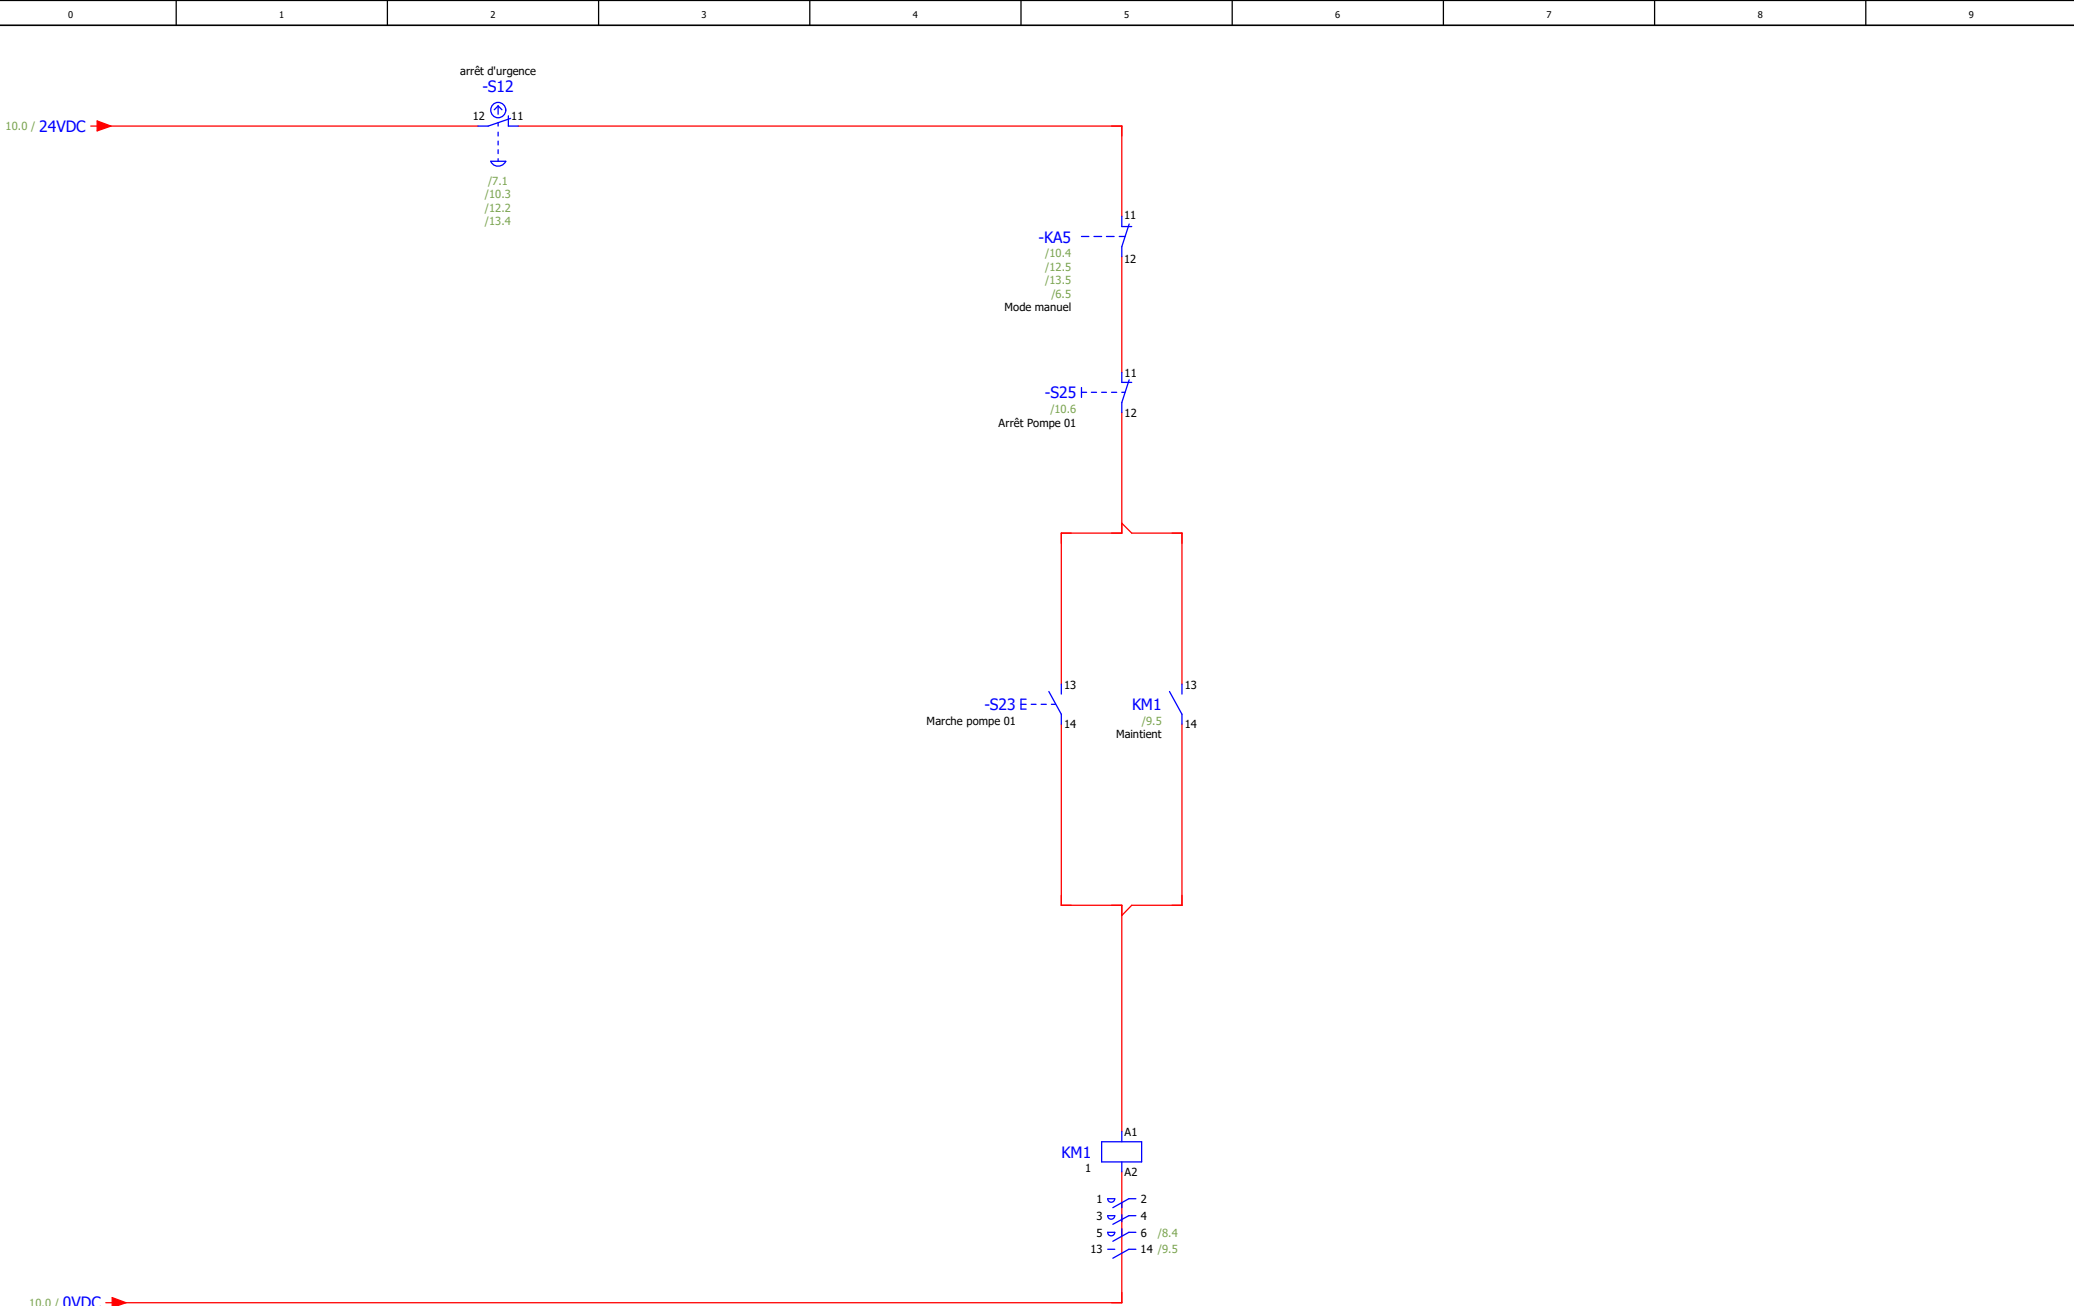


8										10									
			Date	9/30/2024	EPLAN		Lm Electric - Ecole Nationale Polytechnique	Circuit commande Pompe 01											
			Ed.	IANYL															
			Appr.		Station de Pompage 4kW 2x400Vac														
Modification	Date	Name	Original		Replacement of	Replaced by				IEC_tpl002				Page	9				
														Page	15 / 19				



0	1	2	3	4	5	6	7	8	9
---	---	---	---	---	---	---	---	---	---

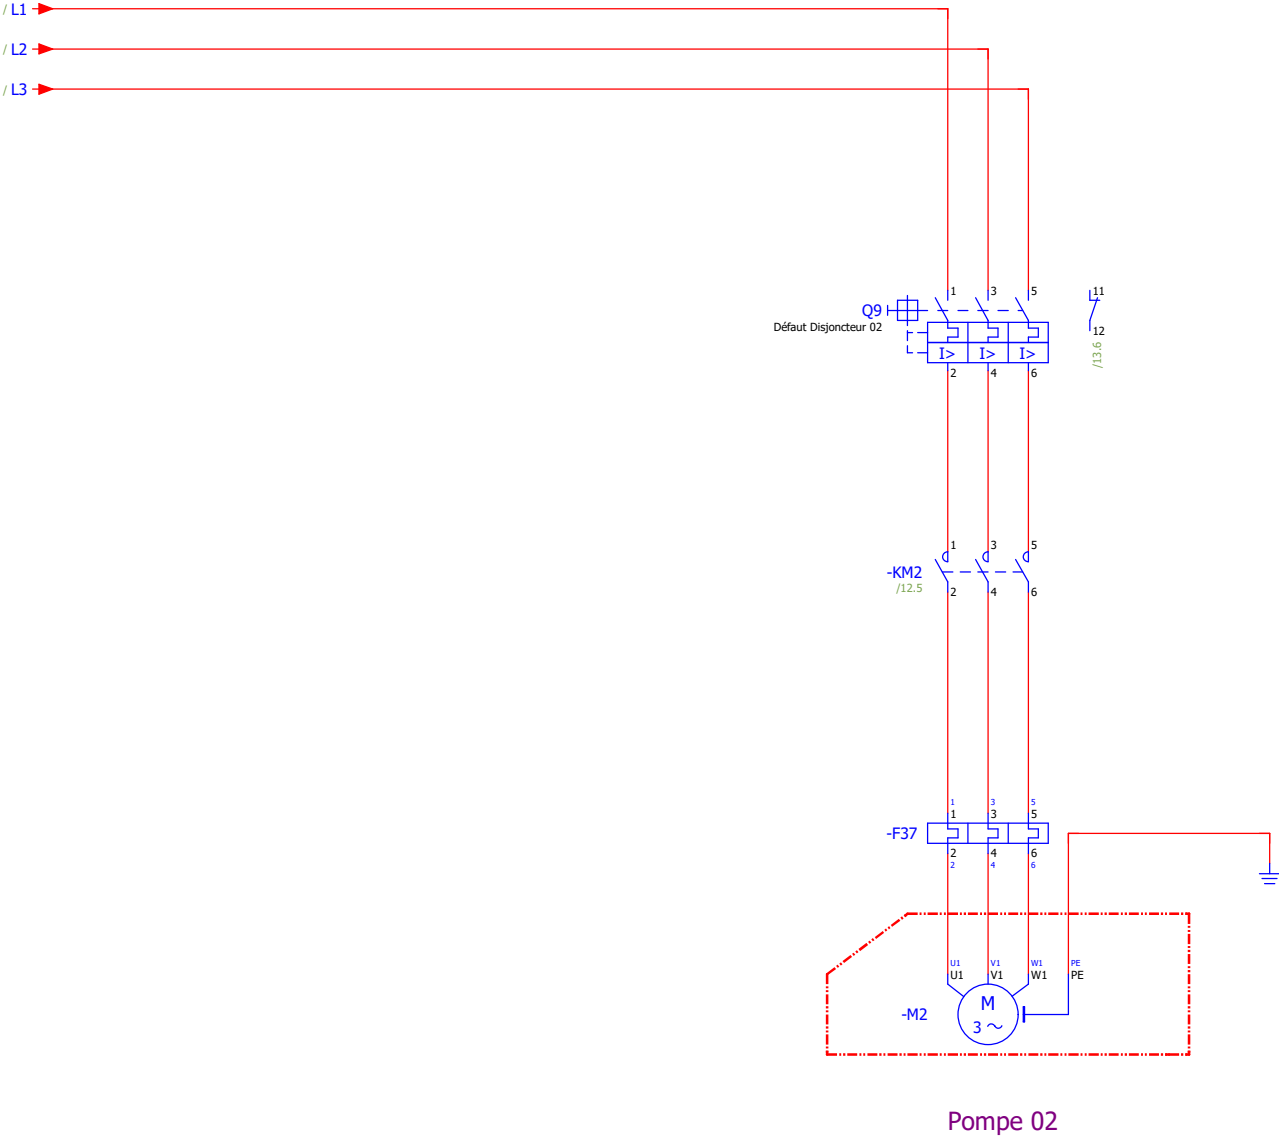

10										12									
			Date	9/30/2024	EPLAN Lm Electric - Ecole Nationale Polytechnique Station de Pompage 4kW 2x400Vac			Circuit de puissance Pompe 02											
			Ed.	IANYL															
			Appr.																
Modification	Date	Name	Original								Replacement of		Replaced by				IEC_tpl002		Page 11
														Page 17 / 19					

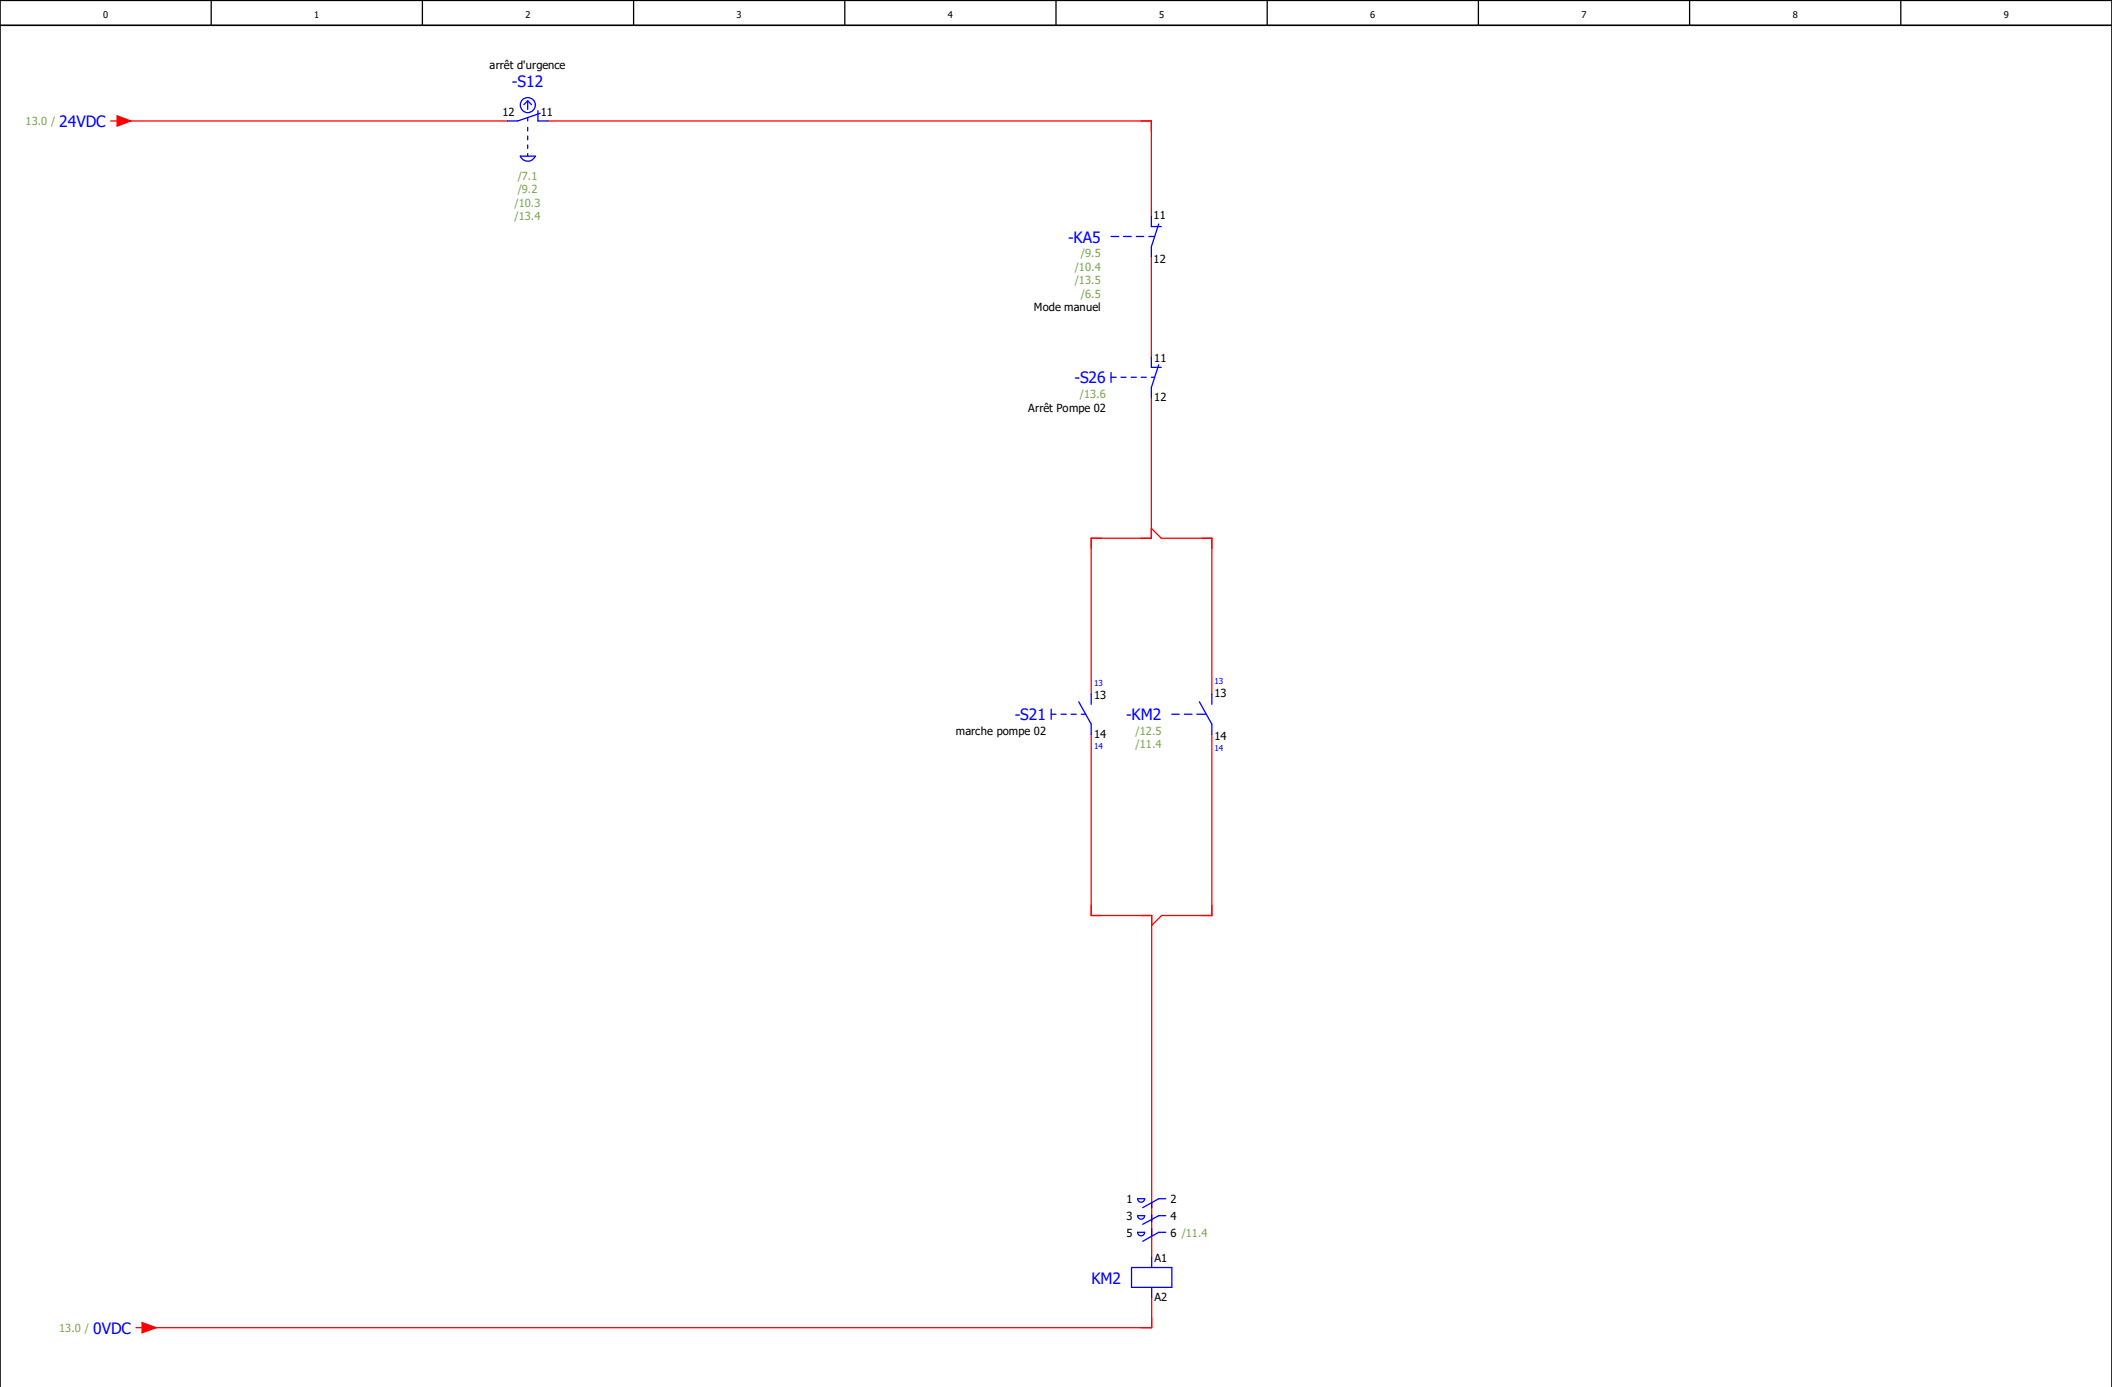

11		13																	
			Date	9/30/2024	EPLAN			Lm Electric - Ecole Nationale Polytechnique			Circuit commande Pompe 02								
			Ed.	IANYL															
			Appr.		Station de Pompage 4kW 2x400Vac														
Modification	Date	Name	Original		Replacement of		Replaced by							IEC_tpl002			Page	12	
																	Page	18 / 19	

