



Ablation C: expert mixing schedule

Free-running test accuracy

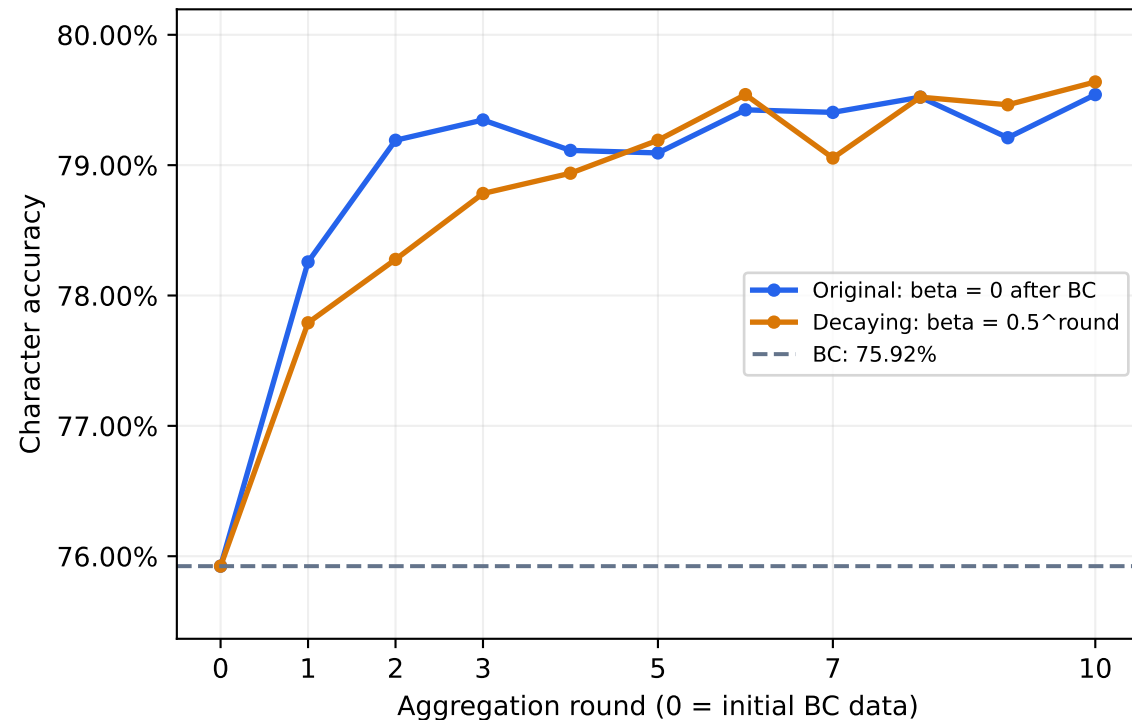

Expert-action probability during training

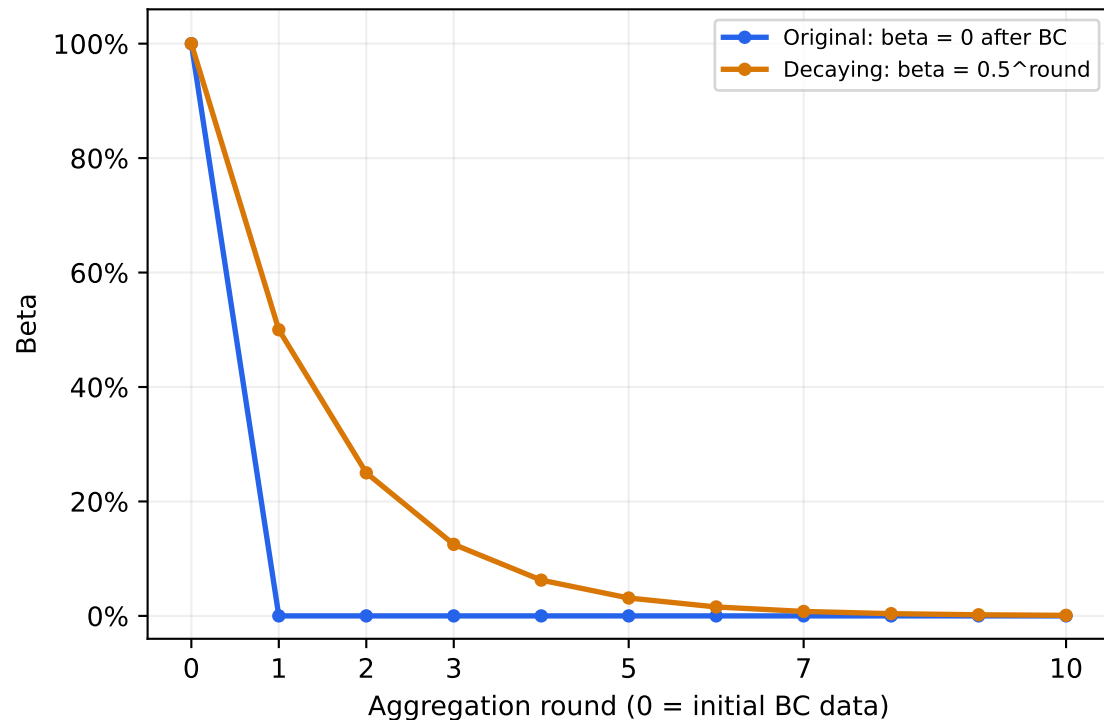

Fold 9 | seed 0 | SGD alpha=0.00001 | all data retained | unrestricted queries
Single-seed comparison; no beta=1 experiment available.