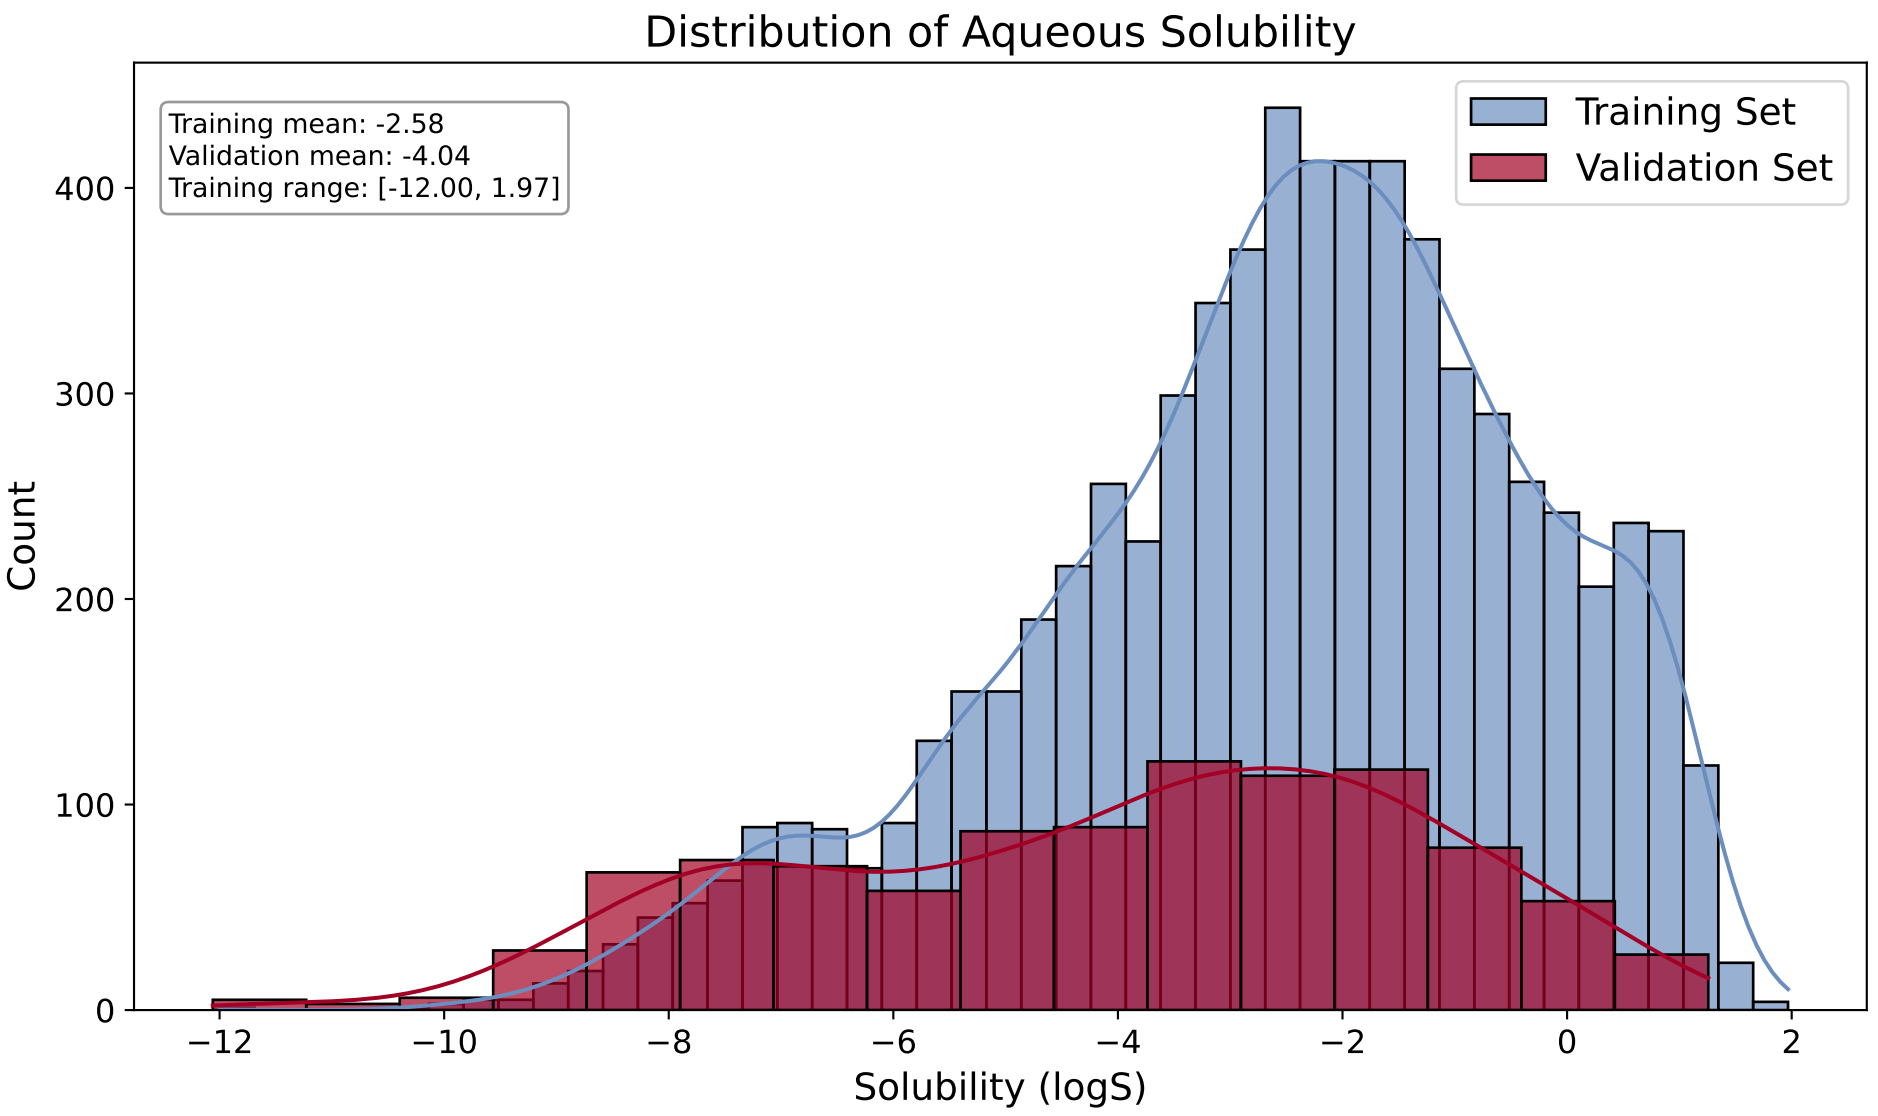
Distribution of Aqueous Solubility
Training mean: -2.58
Validation mean: -4.04
Training range: [-12.00, 1.97]
Training Set
Validation Set
Count
0
100
200
300
400
−12
−10
−8
−6
−4
−2
0
2
Solubility (logS)