

" TO WHOM IT MAY CONCERN"



It is to certify that the water sample of treated water submitted by St. ANTHONY'S HIGH SCHOOL , Poumai Colony , Heingang Road , Chingmeirong , Imphal East , Manipur affiliated to CBSE (Aff/No : 1230040, School code : 35307) is tested as per the parameters of Imphal East District Lab, Imphal East PHED, Manipur, and found to be within the permissible limit and safe for drinking.

Enclosed:- Testing Report.

This certificate is valid for 6 (Six) month only.

This certificate is valid from 18/09/2026 to 17/03/2027

(Salima Begum)

Executive Engineer

Imphal East, PHED Division

PHED, Manipur
Executive Engineer
Imphal East PHE Divn.
PHED, Manipur

Imphal

Date:-18/09/2026

IMPHAL EAST DISTRICT LABORATORY
PUBLIC HEALTH ENGINEERING DEPARTMENT
GOVERNMENT OF MANIPUR
imphaleast5@gmail.com

FF-13

IEDL/PHED,
Manipur

Page No. 1/1

Name & Address of Company & Customer:	TEST REPORT	 Certificate TC-14534
Name of Company : St. ANTHONY'S HIGH SCHOOL	Report No. IEDL/PHED 810/09	
POUMAI COLONY HEINGANG ROAD CHINGMEIRONG, IMPHAL EAST MANIPUR	Date of Tested : 18-09-2026	
	Sample ID: 810/ 09	
	Date of Collection of Sample: 14-09-.2026	
	Date of report: -18-09-.2026	

1	Description of Sample (As declared by customer)	Water
2	Sample Mark (if any, given by the customer)	NA
3	Date of Sampling by the Customer	14-09-2026
4	Source & Place of Sampling	TAP WATER
5	Type of Water	TREATED WATER
6	Sampling Plan & Procedures used	NA
7	Quantity of Water	2 liter in Plastic Jerrican bottle

We hereby certify that the following sample submitted to the laboratory has been analyzed with the following results

Analysis Results (As per IS10500:2012)
Chemical & Bacteriological Testing

Sl. no	Characteristic	Acceptable Limit	Permissible Limit	Method of Test	Results			
					1	2		
1	Chloride (as Cl) in mg/l	250	1000	APHA 24 th Edition 4500-Cl ⁻ B	38.00			
2	Total Dissolved Solids in mg/l	500	2000	APHA 24 th Edition 2540 C	268.00			
3	Total Alkalinity in mg/l as CaCO ₃	200	600	APHA 24 th Edition 2320 B	54.00			
4	Calcium (as Ca) in mg/l	75	200	APHA 24 th Edition 3500 - Ca B	25.60			
5	Magnesium (as Mg) in mg/l	30	100	APHA 24 th Edition 3500 Mg B	6.32			
6	pH value at 25°C	6.5-8.5	No Relaxation	APHA 24 th Edition 4500-H ⁺ B	7.40			
7	Turbidity in N.T. U	1	5	APHA 24 th Edition 2130 B	0.68			
8	Total Hardness in mg/l as CaCO ₃	200	600	APHA 24 th Edition 2340 C	90.00			
9	*Bacteriological	0	0	H ₂ S Strip Method	NIL			
10	*Iron (as Fe) in mg/l	1.0	No Relaxation	APHA 24th Edition 3500-Fe B	0.28			
11	*Fluoride in mg/l as F	1.0	1.5	APHA 24th Edition 4500-F D	0.18			
12	* Sulphate (as SO₄) in mg/l	200	400	APHA 24th Edition 4500-SO₄²⁻ E	11.00			
13	*Electrical Conductivity in µmho/l	-	-	APHA 24th Edition 2510 B	142.00			

The results relate only to the item(s) tested.


This Test Report shall not be reproduced except in full, without the permission of IED Laboratory, PHED, Manipur. The reserved part of sample(s) shall be retained for 30 days from the date of Completion of Test.

* Mark parameters are not in the scope of NABL

* Sample is safe for Drinking for the above parameters.

Prepared by: - Ok Nanao Singh

Designation: - Jr. chemist

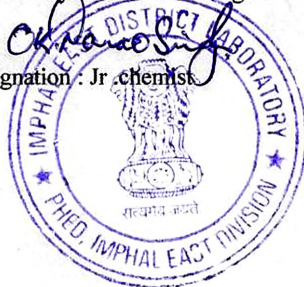

Authorized signatory:

Name: - Salima Begum

Designation: - Executive Engineer
(As Quality Manager)

Imphal East District Lab. PHED, Manipur

Executive Engineer
Imphal East PHE Divn.
-PHED, Manipur