
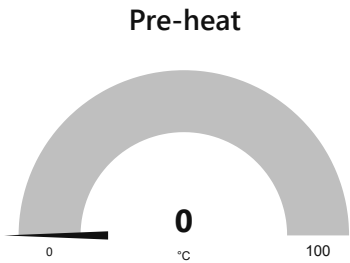
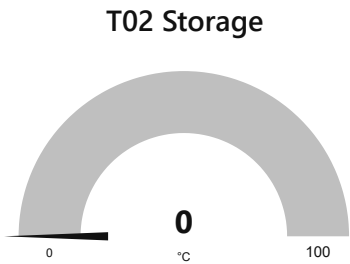


Temperatures

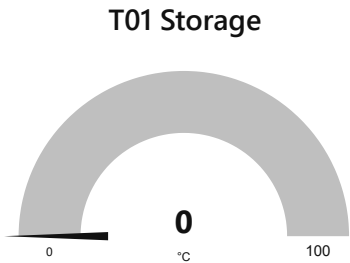

Pasteurizer In

Plant Status

Active Alarm

E-Stop

Alarm Status

Plant

Plant State

Trends

Pasteurizer Temperature

Pumps & Valves

Reception Pump

T01 Pump

T02 Pump

T01 Agitator

T02 Agitator

Transfer Pump

Booster Pump

Filling Pump

Inlet Valve

Divert Valve

Tank T01 Level

Tank T02 Level

Balance Tank

Tank T03 Level

Controls

Tank Selector T01/T02

Plant Start

Plant Stop

Alarm Reset

START CIP


Batch Log

EXPORT CSV


Timestamp	Past In (°C)	Past Out (°C)	Result
-----------	--------------	---------------	--------

No batch records yet — waiting for first pasteurization cycle

Pasteurizer Out

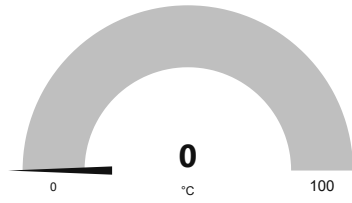

Cooler Out

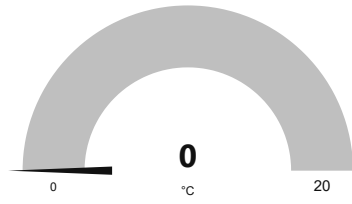

T03 Storage

