


NSP12-NSP13 Interface (Transient)

7RDY captures polymerase-helicase junction residues (3 crystal structures used as consensus)

Criterion: Interface completeness

Available PDB Structures

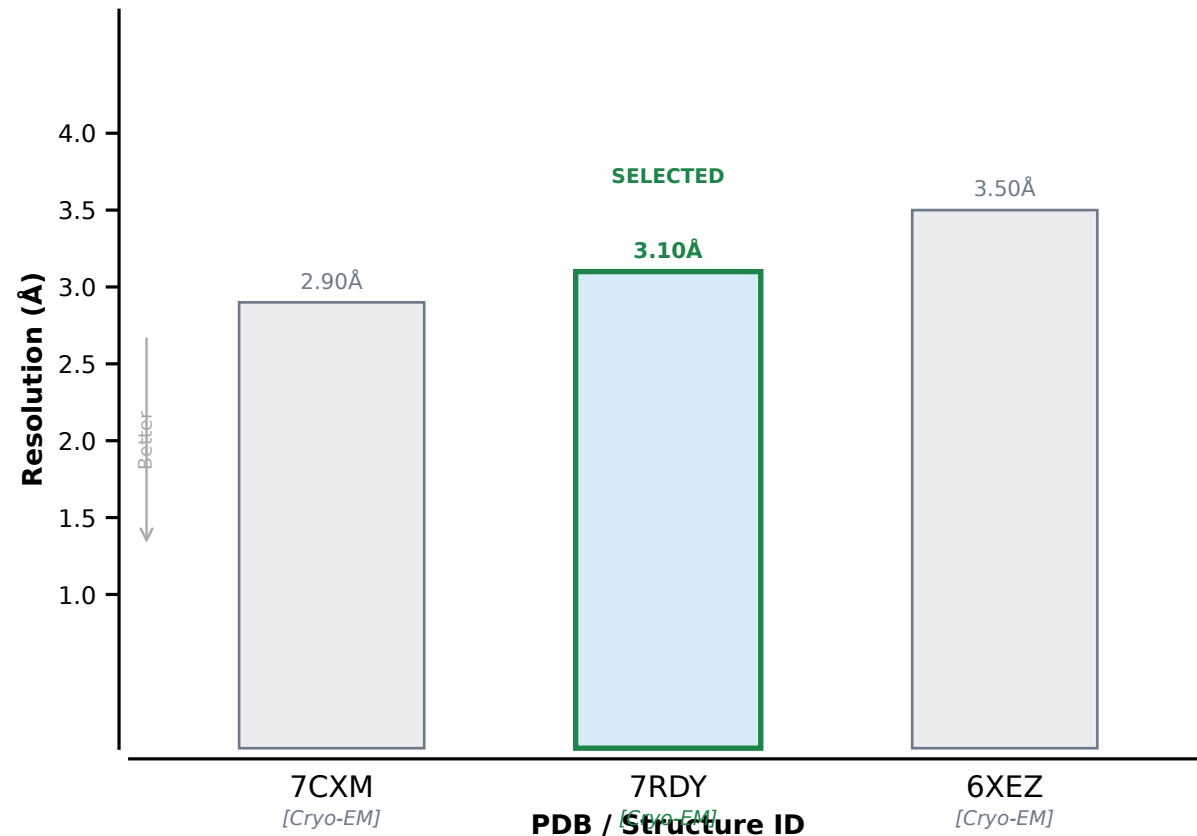

AlphaFold3 Quality Assessment

iPTM: 0.20 (gate > 0.60) **FAIL** ✗

pTM: 0.63 (gate > 0.50) **PASS** ✓

F1 vs crystal: **FAIL**

AF3 gate: **FAIL**

AF3 FAILED: iPTM=0.20
inter-chain PAE=24.95 Å
(vs NSP12-NSP8=1.22 Å)
Transient/context-dependent interface
Crystal-only evidence used

✗ **AF3 FAILED** — Crystal structures used