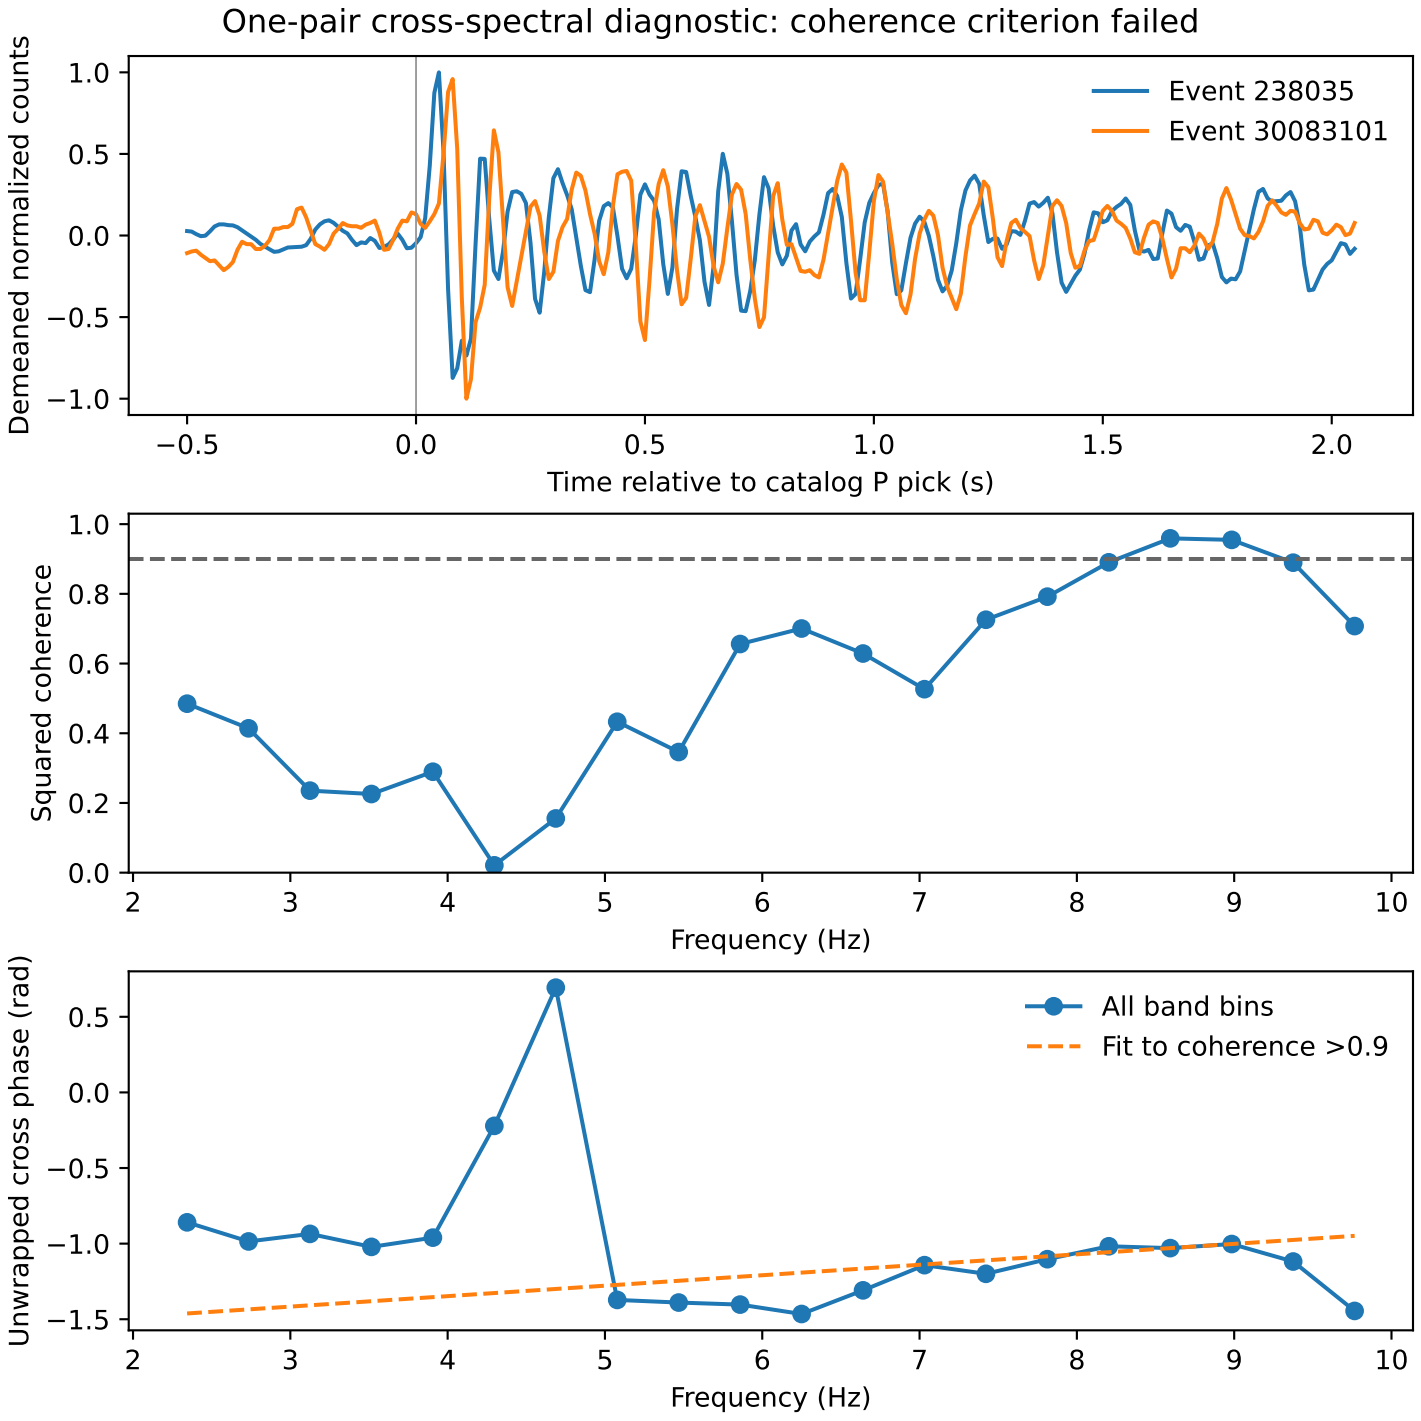
One-pair cross-spectral diagnostic: coherence criterion failed
Demeaned normalized counts
Event 238035
Event 30083101
Time relative to catalog P pick (s)
Squared coherence
Frequency (Hz)
Unwrapped cross phase (rad)
All band bins
Fit to coherence >0.9
Frequency (Hz)