


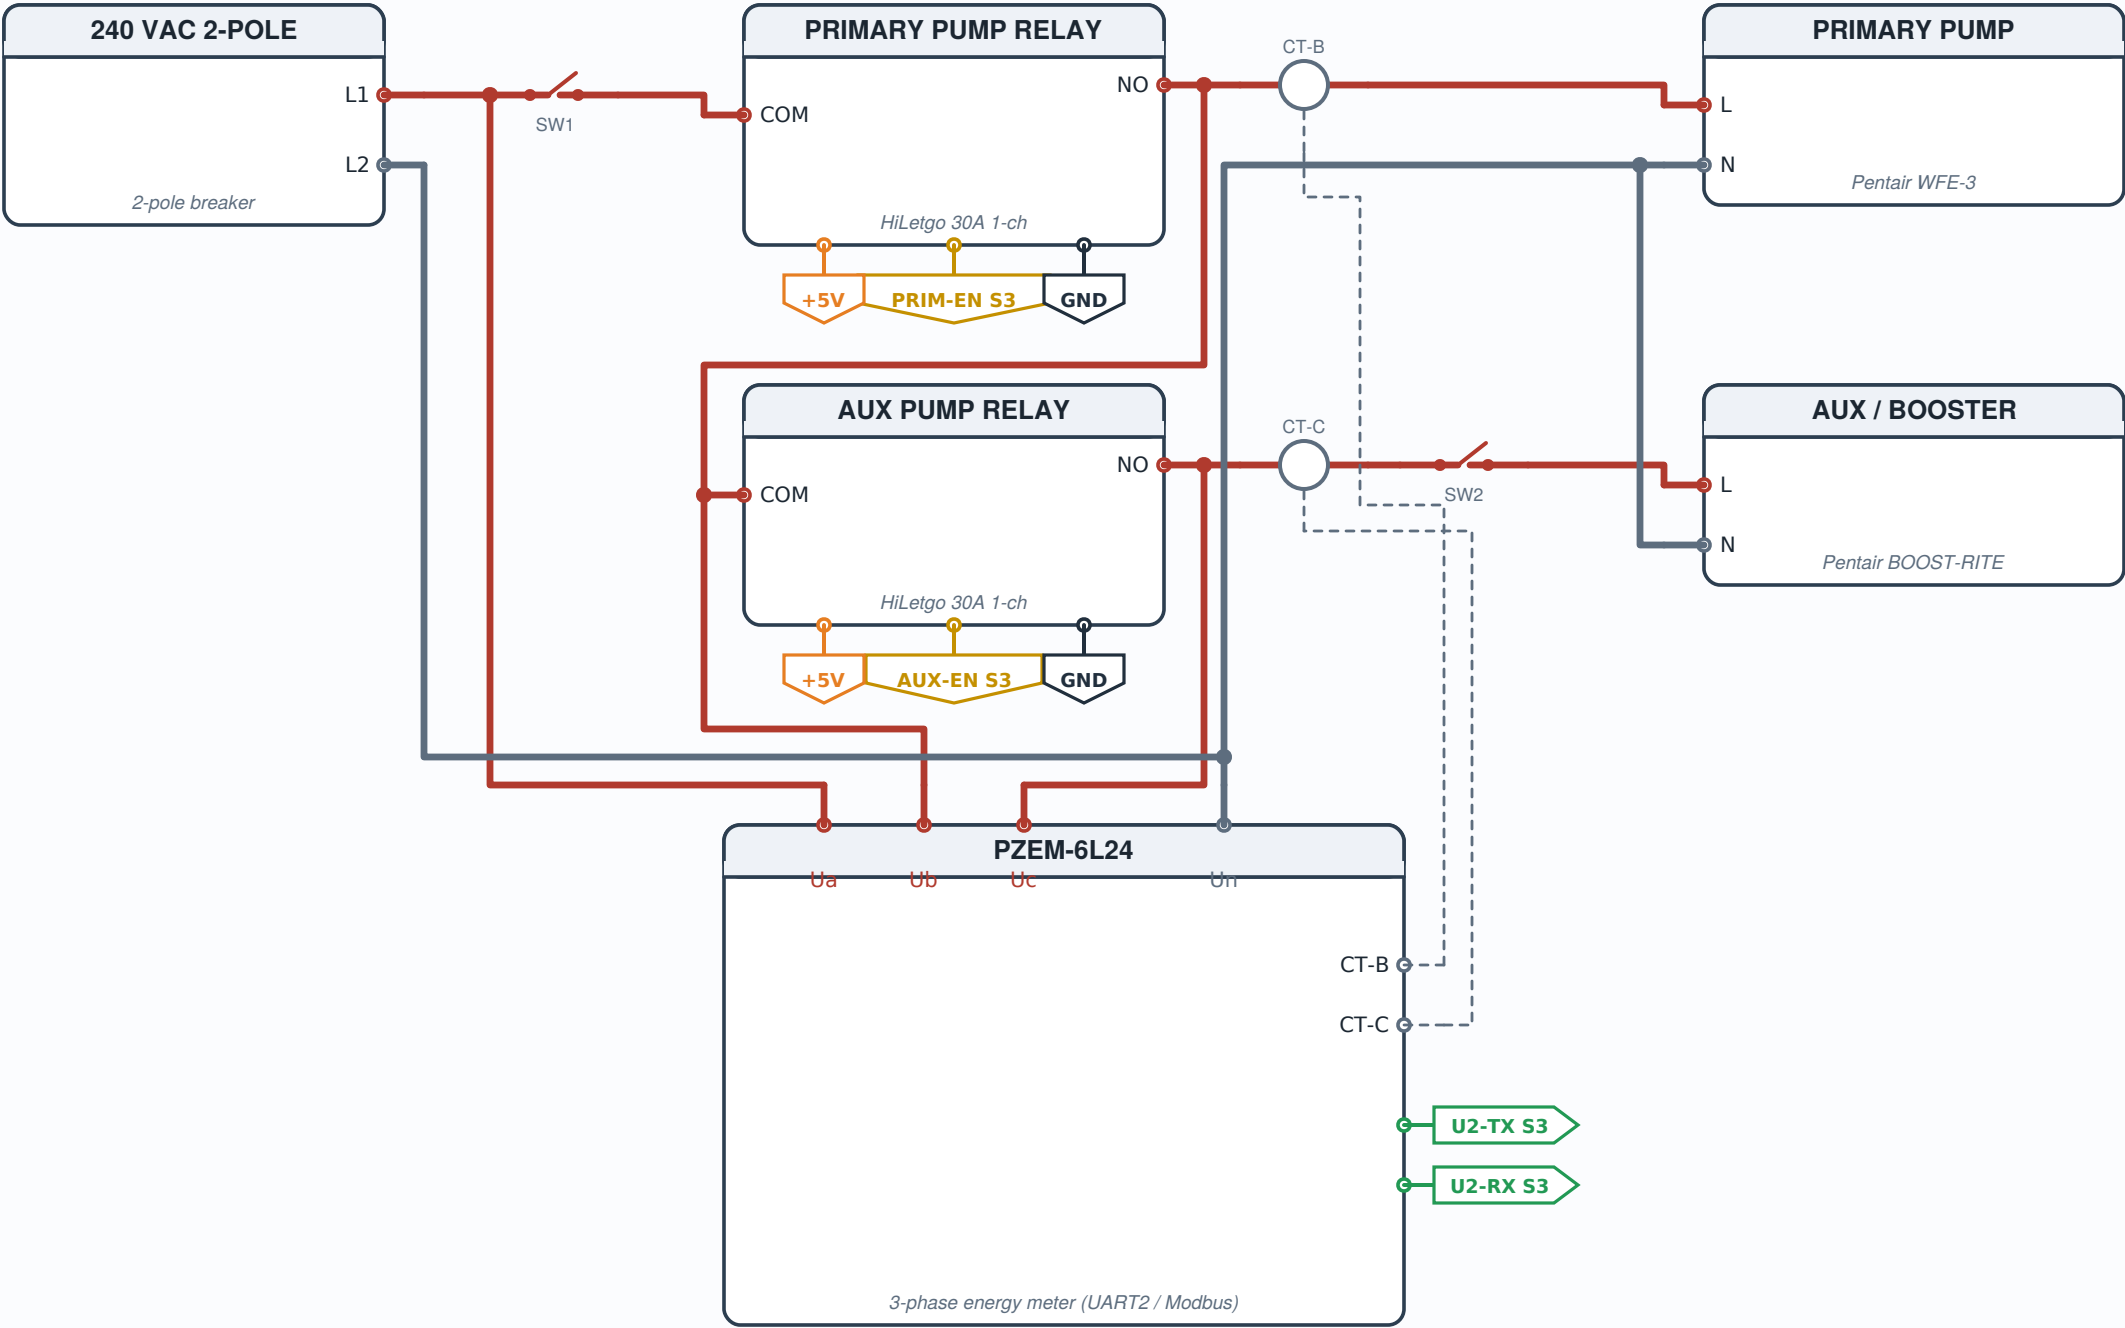

POOL CONTROLLER — 240 VAC POWER & METERING


Split-phase pump power, disconnects, and PZEM energy metering

SHEET

1 of 3

POWER NOTES

240 V single feed, both pumps  
Relay coils: +5V / GND labels  
CT = voltage-only (split-core)

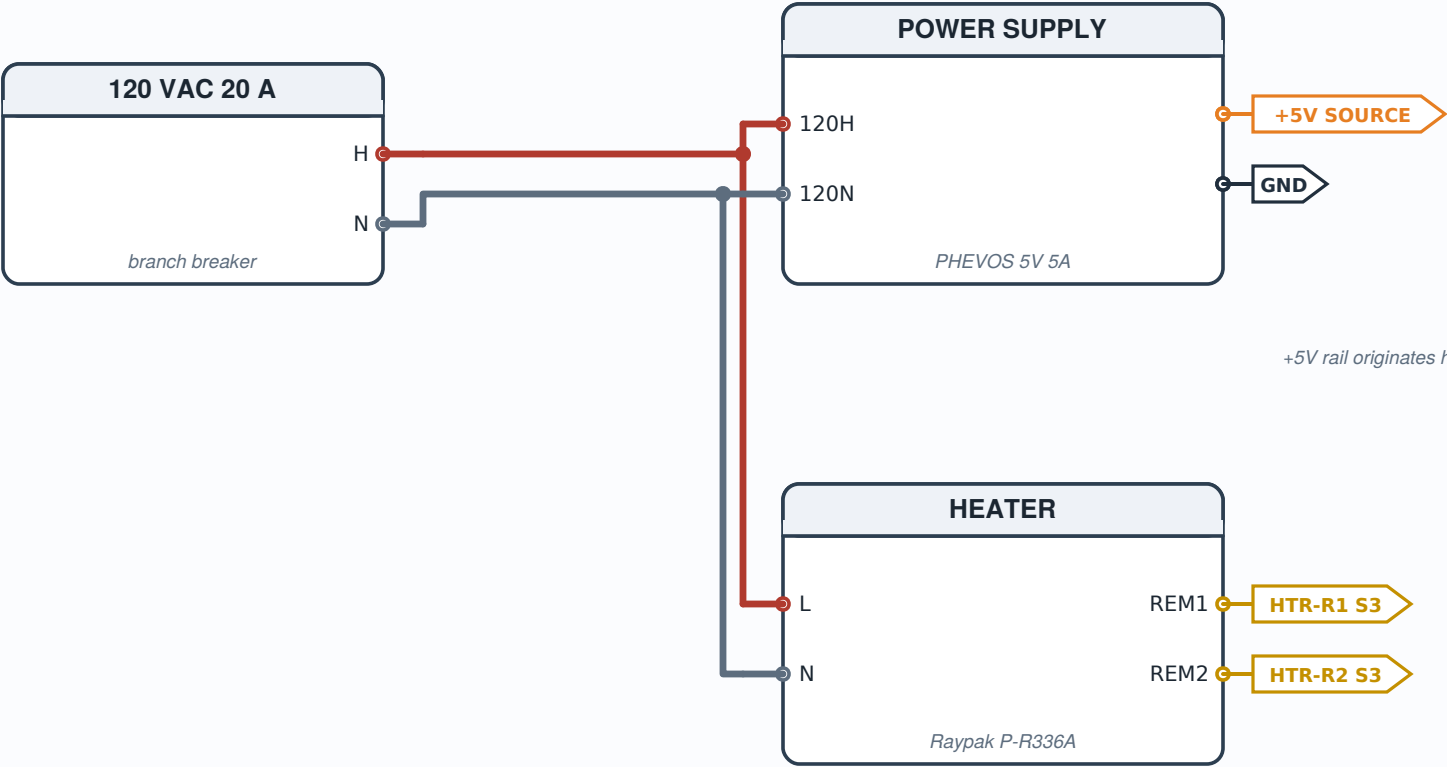

+5V rail originates here; distributed to Sheet 3 loads as labels.

Heater remote is a dry contact switched by the heater relay on Sheet 3.

POOL CONTROLLER — 120 VAC SUPPLY

Branch breaker feeding the 5 V PSU and the pool heater

