


South Africa: Local Area Supply Volatility – Demand-Weighted CV Radiance

VJ146A2 2023, annual-IQR excess-lit days removed

Settlement coverage $\geq 50\%$; LocalArea-day observed demand $\geq 40\%$; Overlay: Local Area Boundaries

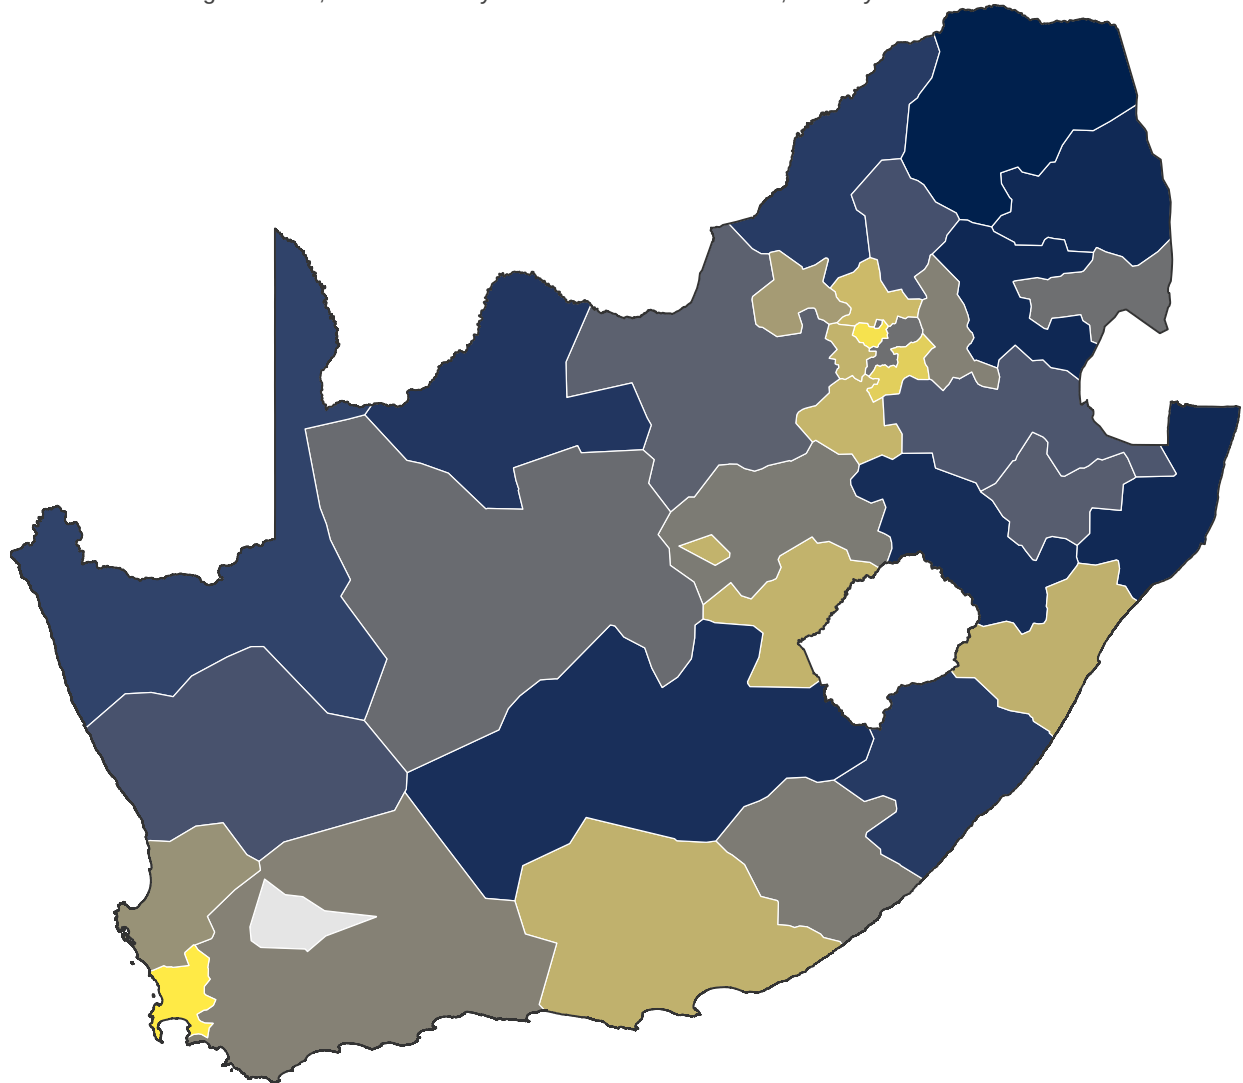

CV of daily lit share (demand-weighted)



0.05 0.10 0.15 0.20 0.25 0.30

Yellow indicates lower temporal volatility in the night-light signal. Demand weights use the settlement GPKG demand field.