


South Africa: Local Area Reliability Inequality – Demand-Weighted SD Uptime

VJ146A2 2023, annual-IQR excess-lit days removed

Settlement coverage $\geq 50\%$; LocalArea-day observed demand $\geq 40\%$; Overlay: Local Area Boundaries

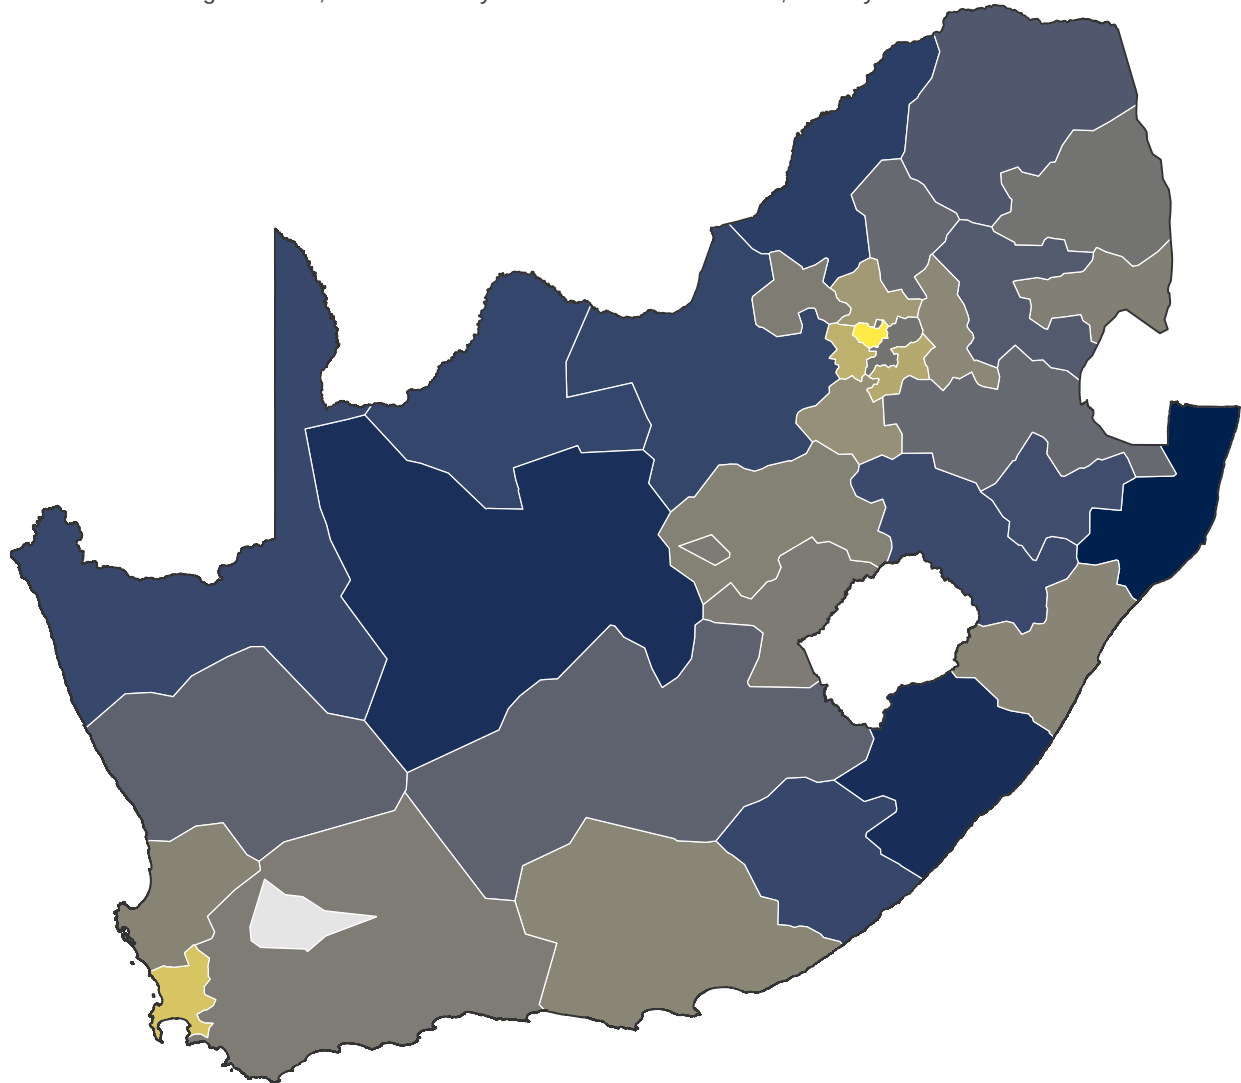

SD of uptime (demand-weighted)



2% 4% 6% 8% 10% 12%

Yellow indicates lower cross-settlement inequality in uptime. Demand weights use the settlement GPKG demand field.