



G:\DD\5_MCLAREN_CHECKOUT\Da Costa Live\WORK IN PROGRESS\501-U07-02841.dwg
Drawing Unit = Metric (0)
DA COSTA BRANDAO, LIVIA
7/15/2025 7:51 AM

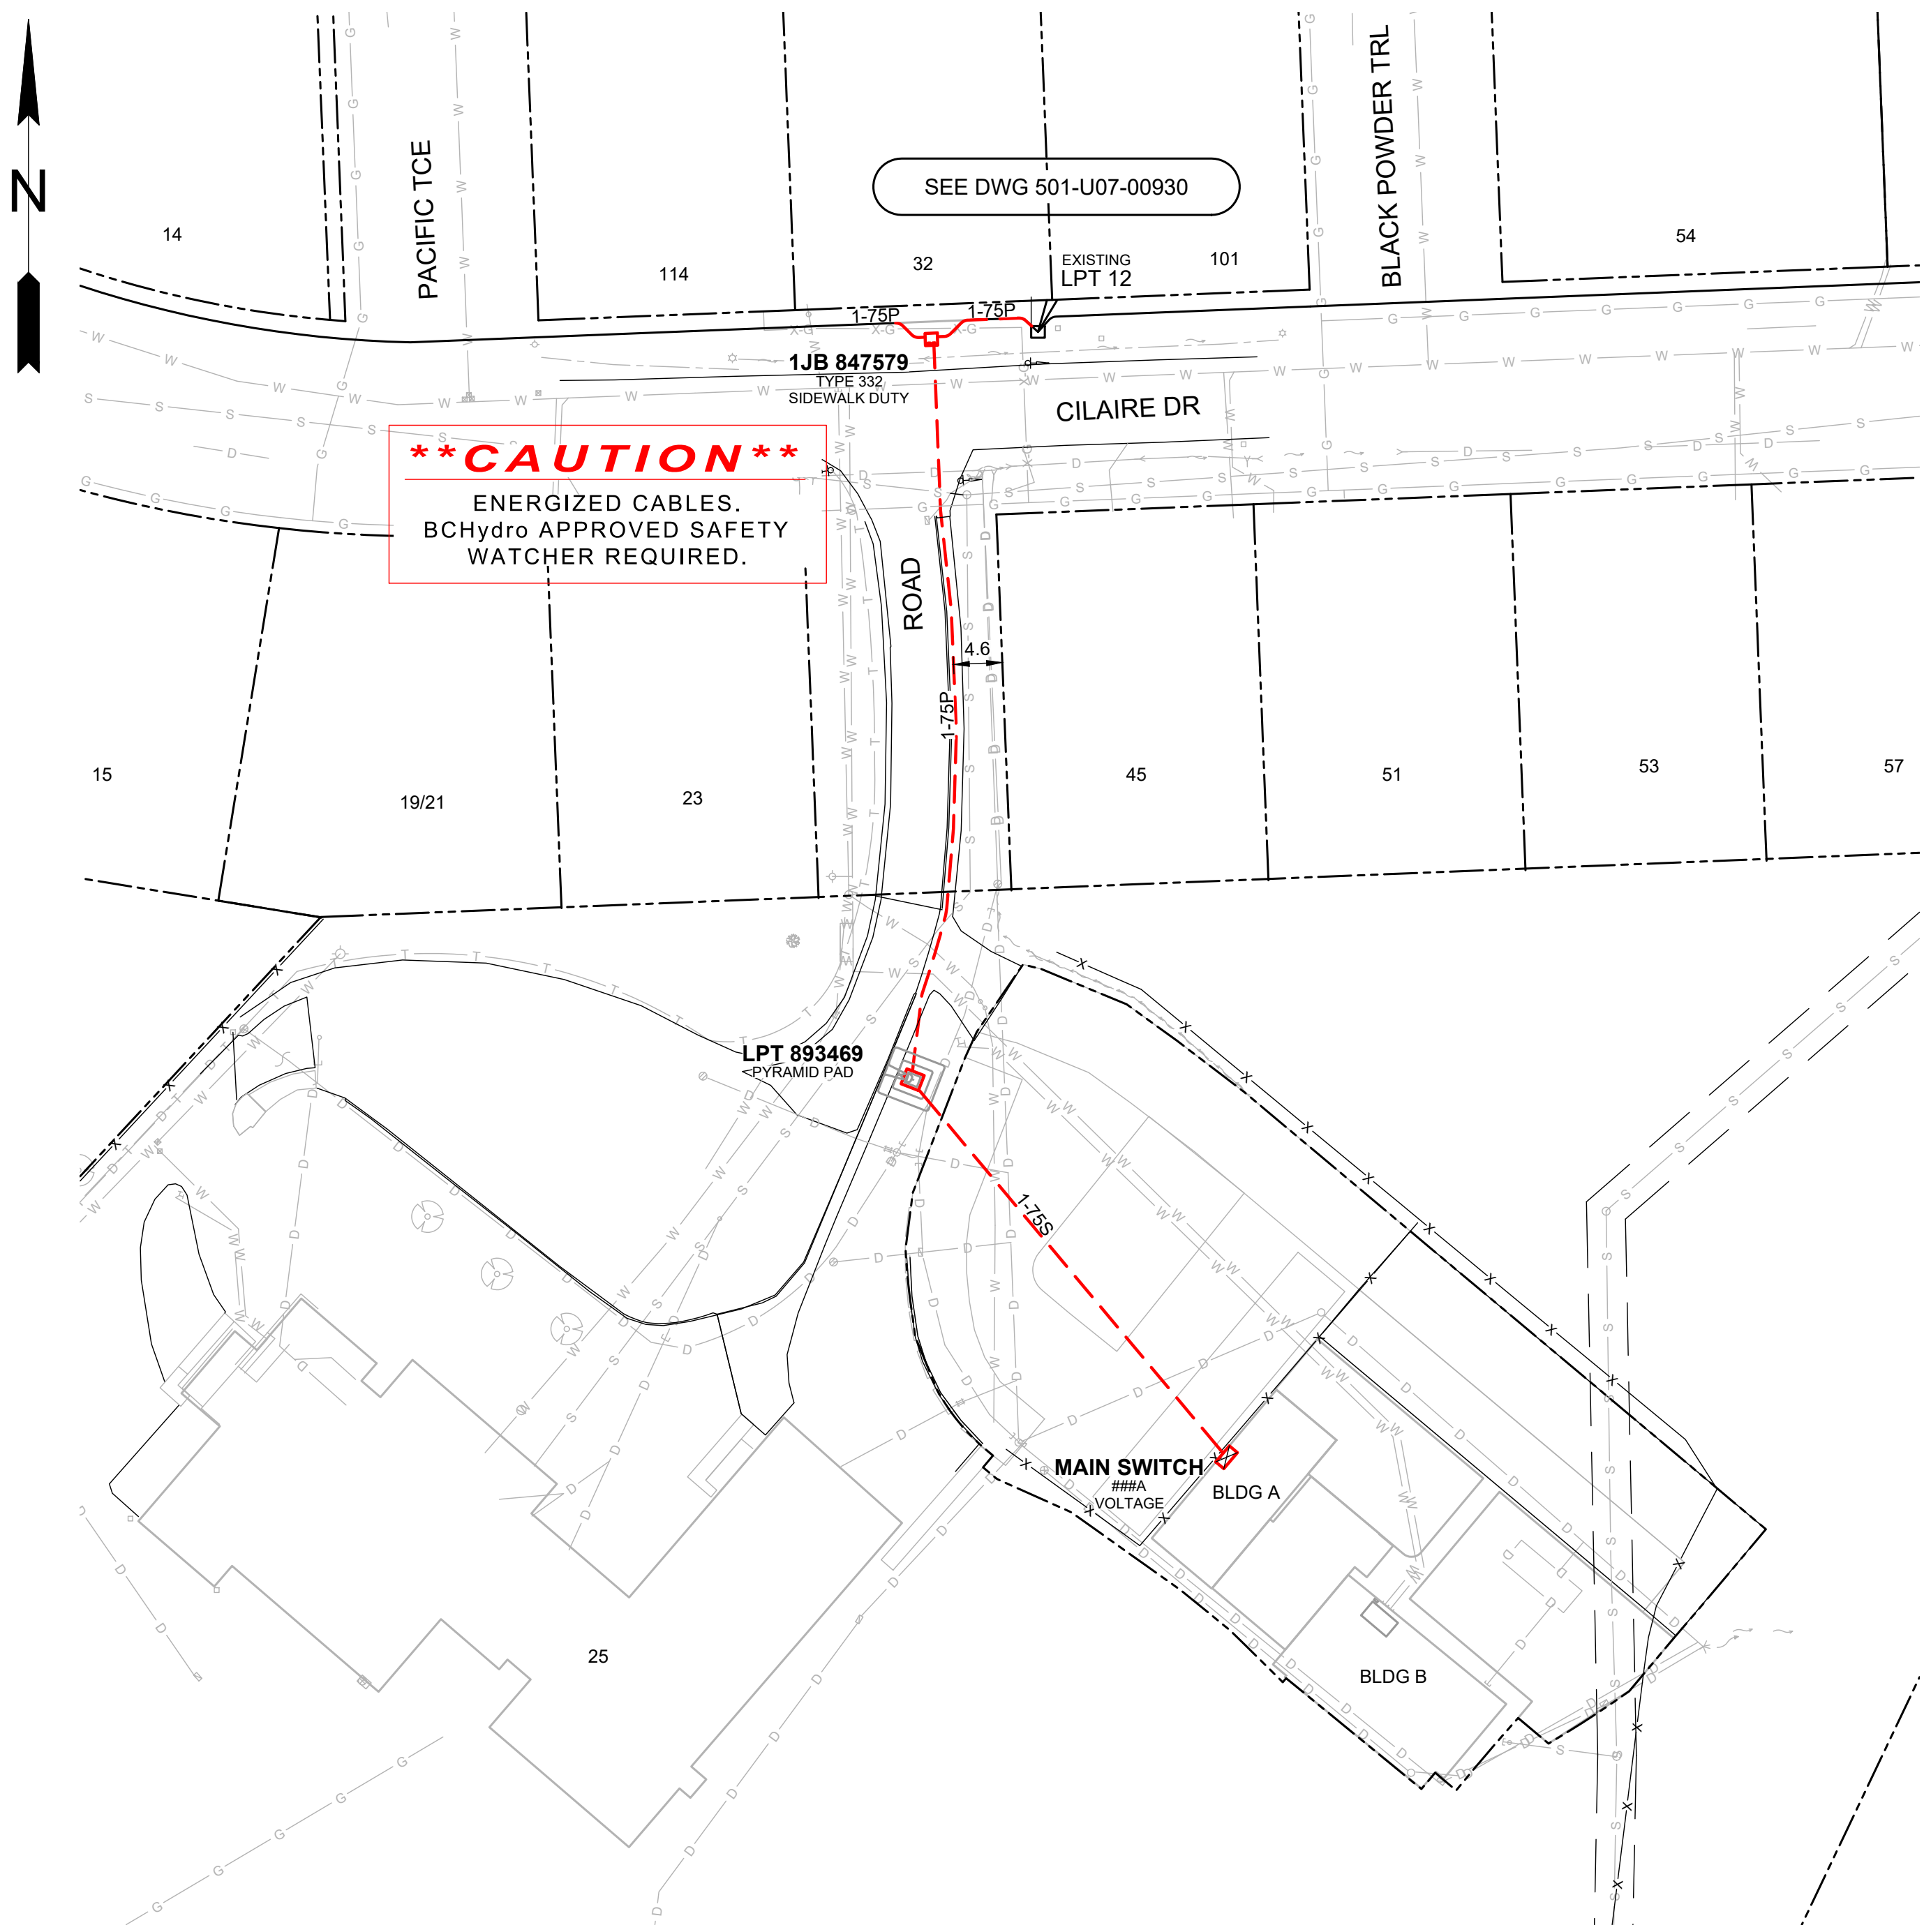


****CAUTION****
ENERGIZED CABLES.
BCHydro APPROVED SAFETY
WATCHER REQUIRED.

PLAN SCALE: 1:500 0 25m


1JB 847579 DETAIL

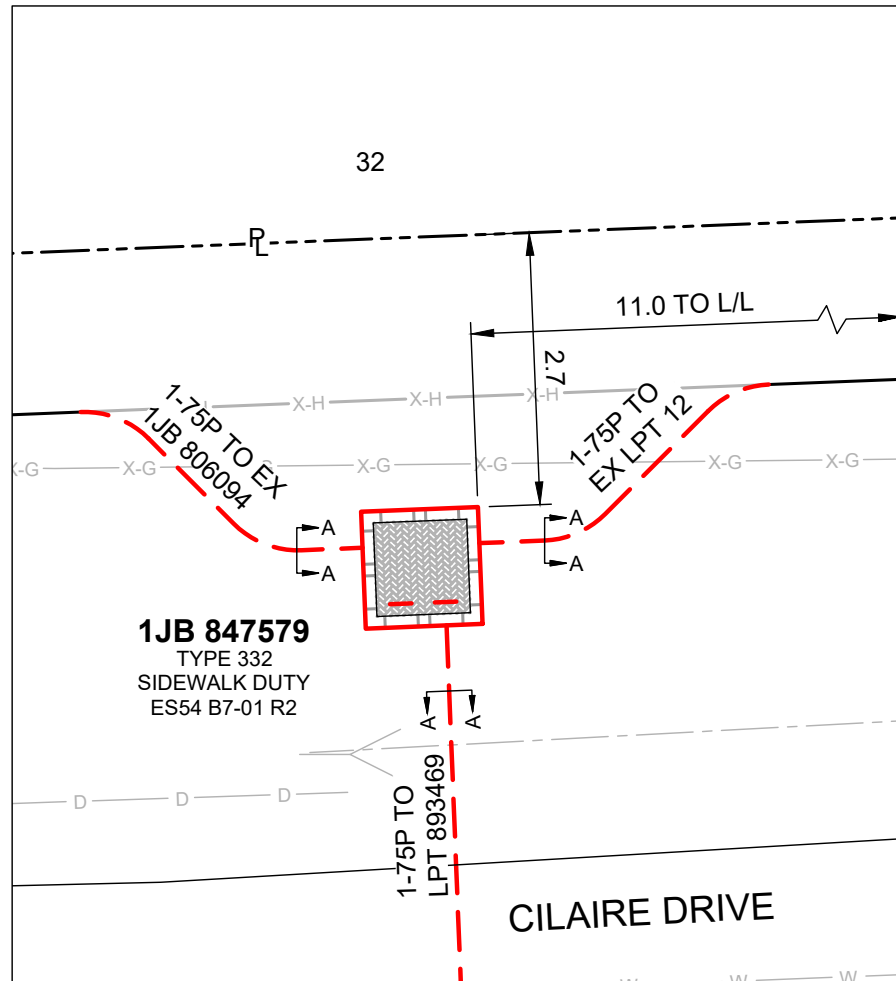

LPT 893469 DETAIL

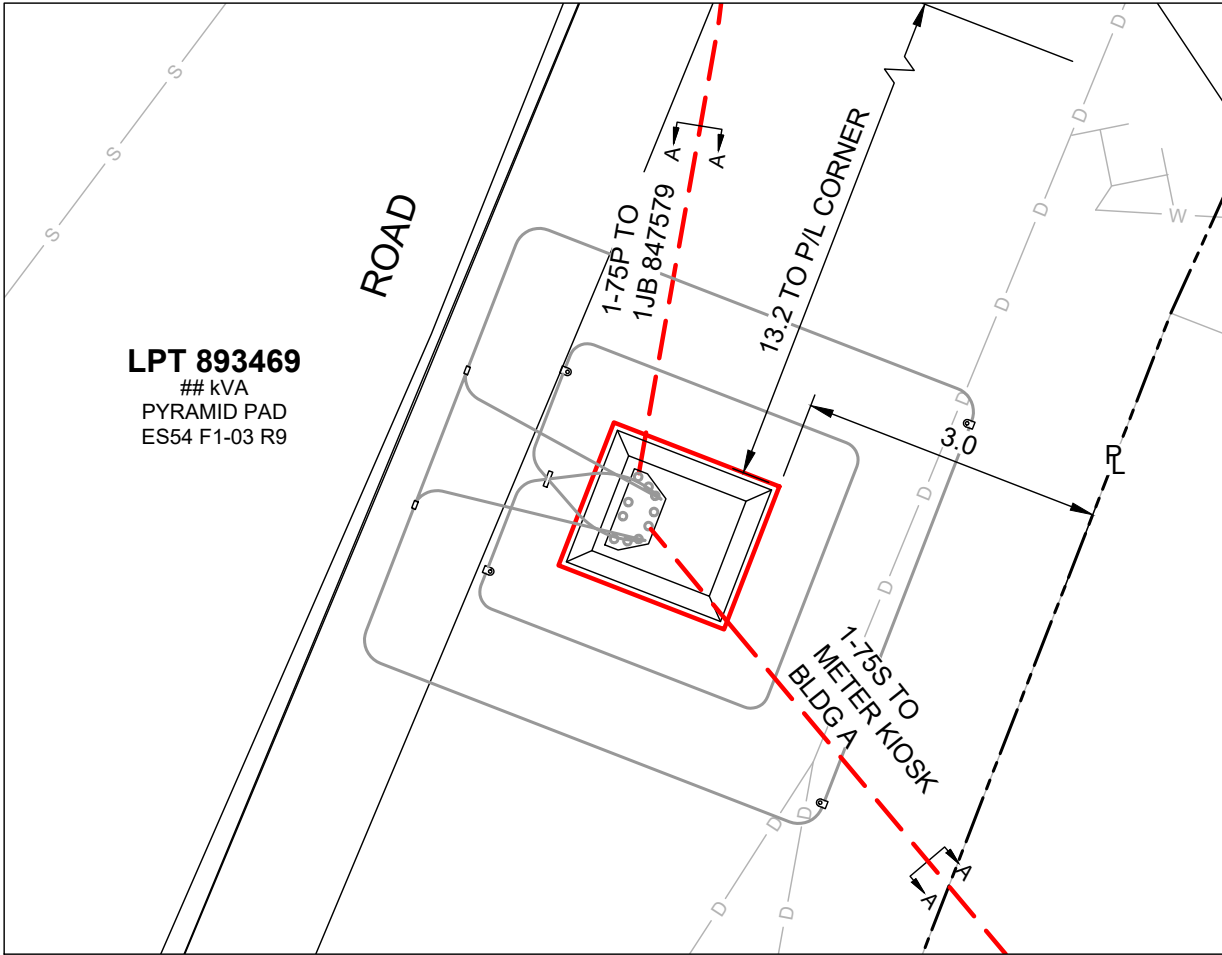


DETAILS N.T.S

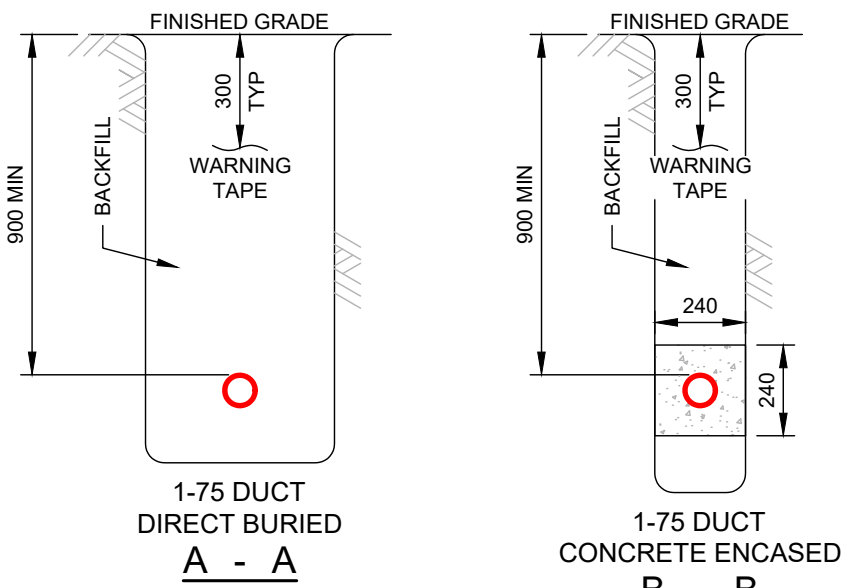

TRENCH DETAILS N.T.S

DISCLAIMER
THIS DRAWING IS THE PROPERTY OF BC HYDRO AND SHALL NOT BE USED, REUSED OR REPRODUCED WITHOUT THE CONSENT OF BC HYDRO. BC HYDRO WILL NOT BE HELD RESPONSIBLE FOR THE IMPROPER OR UNAUTHORIZED USE OF THIS DRAWING AND WILL NOT BE LIABLE FOR ANY LOSSES OR OTHER CONSEQUENCES RESULTING FROM THE USE OR RELIANCE UPON, OR ANY CHANGES MADE TO, THIS DRAWING. PLEASE NOTE THAT BC HYDRO DOES NOT ASSUME RESPONSIBILITY FOR THE ACCURACY OR COMPLETENESS OF THE CONTENTS, WHETHER SHOWN OR OMITTED FROM THIS DRAWING.

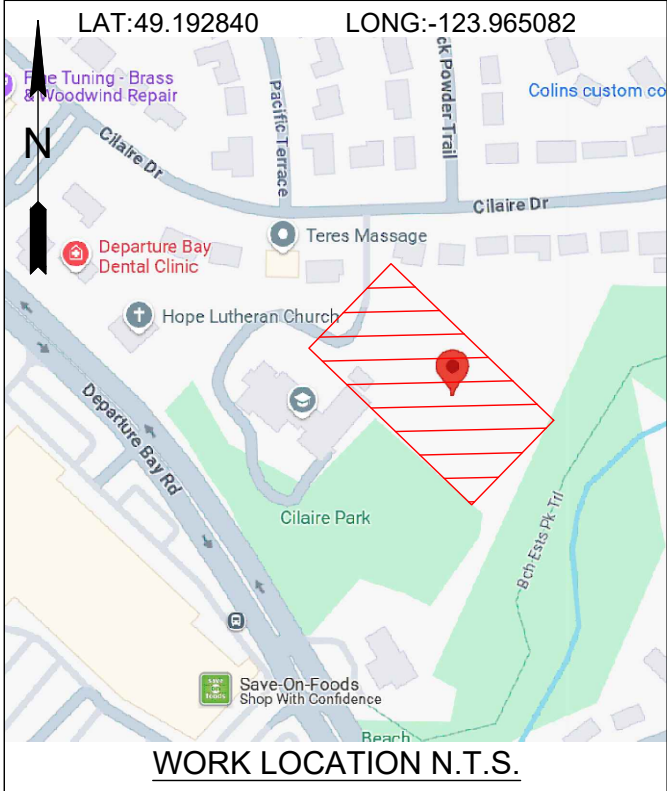

BC ONE CALL

CALL BEFORE YOU DIG
1-800-474-6886
CALL AT LEAST 3 FULL
WORKING DAYS BEFORE
YOU PLAN TO DIG



CIVIL SPEC. 1323 NOTES:

- BC HYDRO UNDERGROUND CIVIL INSPECTOR MUST BE NOTIFIED **48 HOURS** PRIOR TO CONSTRUCTION.
- ALL WORK TO BE PERFORMED IN ACCORDANCE WITH CLASS OF WORK SPECIFICATION 1323 AND BC HYDRO UNDERGROUND DISTRIBUTION ENGINEERING STANDARDS SERIES ES53 AND ES54.
- ANY CHANGES NEED TO HAVE PRIOR APPROVAL OF BC HYDRO CIVIL INSPECTOR.
- UNLESS OTHERWISE NOTED ON TRENCH DETAILS OR REQUIRED PER ES 54 H0-02.02, ALL CONDUIT INSTALLATION FOR BC HYDRO ON PUBLIC OR PRIVATE PROPERTY SHOULD HAVE MIN. 0.3m COVER AND ANY FACTORY BEND MUST HAVE A MIN. RADIUS OF 0.9m.
- ALL UTILITIES (EXCEPT TELUS) MUST MAINTAIN A 0.9m HORIZONTAL AND 0.3m VERTICAL SEPARATION FROM BC HYDRO DUCT UNLESS DIRECTED OTHERWISE BY BC HYDRO CIVIL INSPECTOR.
- OTHER UTILITIES SHOWN ON THE CIVIL DRAWING ARE FOR REFERENCE ONLY. PROVE LOCATION OF ALL UTILITIES IN THE WORK AREA BEFORE CONSTRUCTION. FOR CURRENT INFORMATION CONTACT BC ONE CALL.
- ALL OFFSETS INDICATE CENTERLINE OF BC HYDRO PLANT.
- METRES EXPRESSED IN DECIMALS, MILLIMETRES IN WHOLE NUMBERS.
- TRANSFORMER MUST BE A MIN. OF 1.5m BEHIND NON-MOUNTABLE CURB OR PROTECTED. FINAL NUMBER AND LOCATION OF PROTECTION POSTS TO BE DETERMINED IN THE FIELD BY BC HYDRO CIVIL INSPECTOR.
- FOR TRANSFORMER PAD COUNTERPOISE CLEARANCES TO OTHER UTILITIES AND UNDERGROUND CONDUCTIVE SURFACES, SEE ES54.
- MIN. OFFSET FOR BC HYDRO DUCTS, IN JOINT TRENCH, FROM PROPERTY LINE IS 1.2m, UNLESS OTHERWISE NOTED.
- STUB SERVICE DUCT 1.0m FROM PROPERTY CORNER AND 1.0m INTO THE LOT UNLESS OTHERWISE NOTED.
- IT IS THE RESPONSIBILITY OF THE RESOURCE THAT IS PERFORMING THE INSTALLATION OF THE PROPOSED CIVIL WORKS TO PROVIDE BC HYDRO WITH A RECORD DRAWING(S) OF THE CONSTRUCTION. THE RECORD DRAWING(S) MUST BE RECEIVED AND ACCEPTED BEFORE ELECTRICAL WORK WILL COMMENCE.
- UNDER NO CIRCUMSTANCES MAY THE CONTRACTOR OPEN ANY LIVE BC HYDRO EQUIPMENT. ASSUME ALL EQUIPMENT IS LIVE UNLESS ADVISED BY BC HYDRO.
- DO NOT BLOW STRING INTO LIVE BC HYDRO EQUIPMENT.** IF BLOWING STRING IS REQUIRED INTO LIVE BC HYDRO EQUIPMENT, A BC HYDRO APPROVED ELECTRICAL JOURNEYPERSON IS REQUIRED BEFORE PROCEEDING.

CUSTOM NOTES HERE IF REQUIRED

ENGINEERING NOTES

UNLESS NOTED OTHERWISE, ENGINEERING CONTENT ON THIS DRAWING HAS BEEN PRODUCED FOLLOWING A DOCUMENTED BC HYDRO QUALITY MANAGEMENT PROCESS USING BC HYDRO ENGINEERING STANDARDS AUTHENTICATED BY PROFESSIONALS OF RECORD UNDER PERMIT TO PRACTICE NUMBER 1002449

CIVIL PLAN LEGEND:

BC HYDRO RESPONSIBILITY	CUSTOMER RESPONSIBILITY
NEW DUCT	EXISTING DUCT
FIELD COMPLETED DUCT	
SERVICE BOX	
TERMINAL POLE	
LOW PROFILE TRANSFORMER (LPT-PYRAMID PAD)	
LOW PROFILE TRANSFORMER (LPT)	
PAD MOUNT TRANSFORMER (PMT)	
3Ø & 1Ø JUNCTION & PULL BOXES (332, 632, 832 & 1232)	
PRECAST MANHOLE	
VISTA SWITCH SUBMERSIBLE (VSWB)	
VISTA SWITCH ABOVE GROUND (VSWA)	
REFER TO ES53 AND ES54 UNDERGROUND STANDARDS	



NORTH VANCOUVER ISLAND
NANAIMO POWER DISTRICT
UNDERGROUND DUCT AND STRUCTURES FOR
120 240V 200AMP UNDERGROUND SERVICE
25 CILAIRE DRIVE, NANAIMO
SHEET 1 OF 1

DESIGN NUMBER	0005080580	DSGN	J. CODY
WORK ORDER NUMBER		INDEP CHK	
CSA S250 ACCURACY NAD 83 - 10UTM		DFTG	L.COSTA
BASE ACCURACY LEVEL: 4 +/- 1000 mm		DFTG CHK	T.BELLAVIE
ASB ACCURACY LEVEL: 4 +/- 1000 mm		INSP	
		REV	
		ACPT	

DATE	2025JUL14	DIST		DRAWING NUMBER	501-U07-02841	REPORT NUMBER		FIG NO	SIZE	REV
									D	0