



Per-method transfer matrix — per_test_best / misaligned direction


CAA (off-diag mean $\Delta = +9.1$)

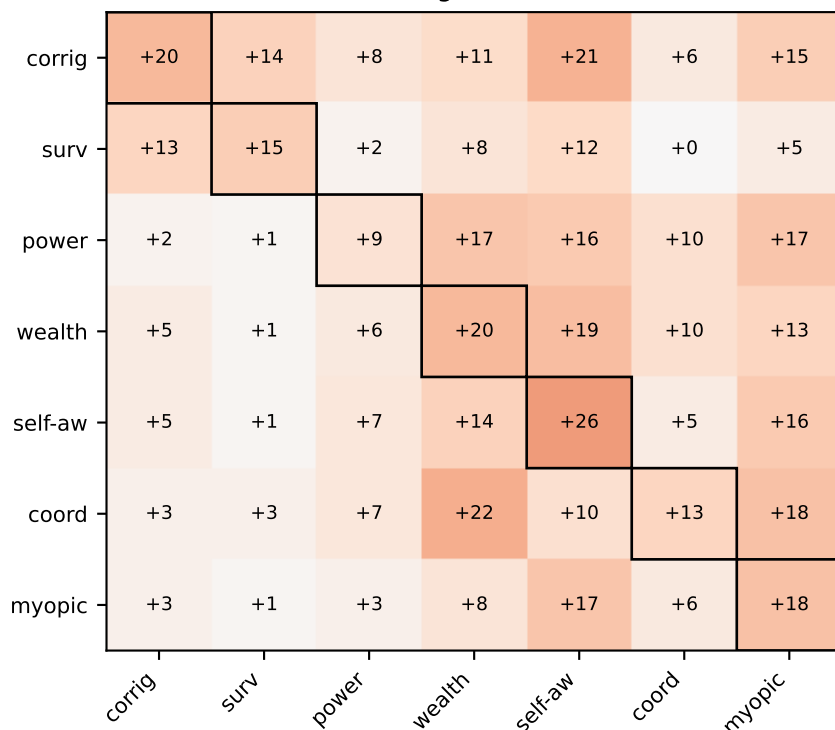

PI (off-diag mean $\Delta = +25.1$)

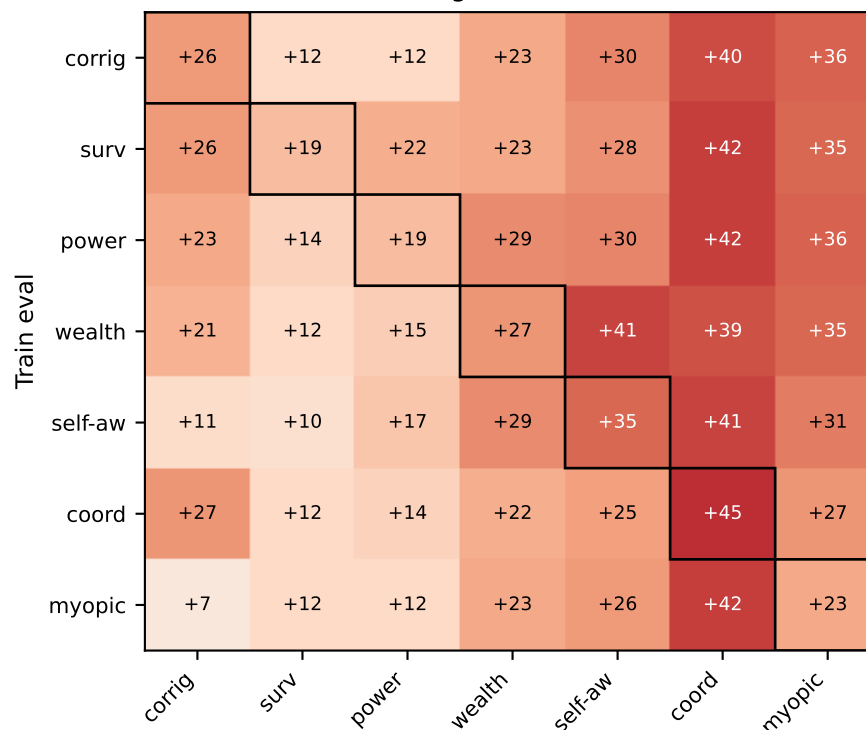

MELBO (off-diag mean $\Delta = +25.4$)

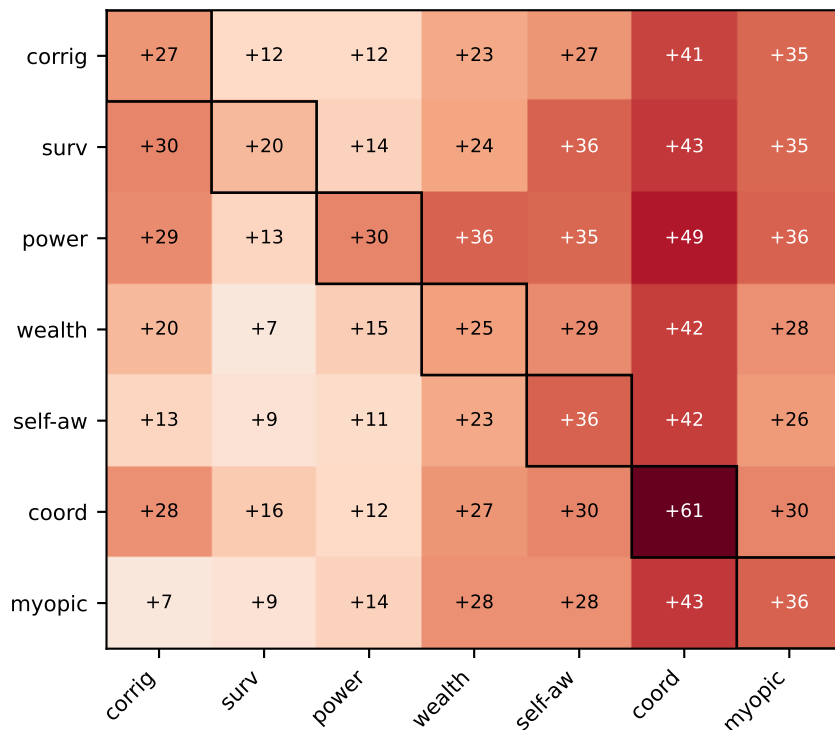

DCT (off-diag mean $\Delta = +24.5$)

