
MMUCO ORION DUPLEX – DRAFT 0.2.2 HALLWAY OPTION STUDY

FACE ME AND I FACE YOU – OPTION B DOUBLE-DOOR ENTRIES (ROOM A = BEDROOM 1, ROOM B = BEDROOM 2)


DESIGN STUDY – NOT AN ISSUED PLAN. Dwelling A shown (B is the mirror). Geometry from the Draft 0.2.1 working copy; values measured from the DXF.

B1: PAIRED LEAVES (SELECTED)

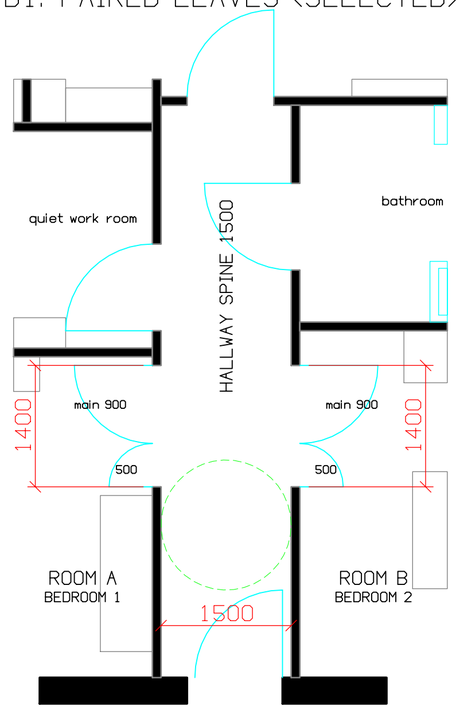


Opening 1400 (y 2500–3900) in each hall wall, directly opposite.
Leaves 900 main (hinged N jamb) + 500 secondary (hinged S jamb), both open into the room.
Clear opening (estimate): 849 main leaf; 1298 both leaves.
Swing collisions: none (walls, furniture, other doors).
Hall clear width 1500 closed / operating / open.
Room-side approach depth: A 1300–1750, B 1200–3010.
Wall change: piers shortened 300 (S) and 100 (N) each side; room areas unchanged.
Double-door requirement: met.
DECISION: SELECTED (clearest, no hall obstruction, no wall thickening).

B2: SINGLE LEAVES (REFERENCE)

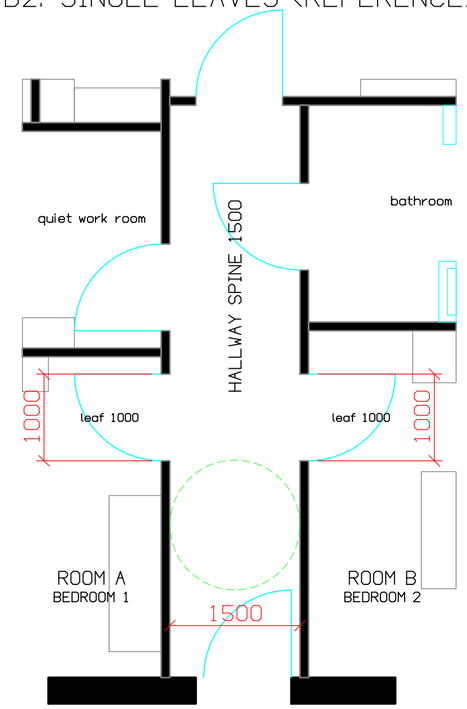

Opening 1000 (y 2800–3800), directly opposite.
One 1000 leaf per entrance, hinged N jamb, opens into the room.
Clear opening (estimate): 949.
Swing collisions: none. Hall clear width 1500 in all states.
Room-side approach depth: A 1300–1750, B 1200–3010.
No wall change.
Double-door requirement: NOT met under reading 1 (a pair of leaves at each entrance); met only if read as one leaf at each of two facing entrances.
DECISION: retained as reference only.

B3: SLIDING PAIR (REJECTED)

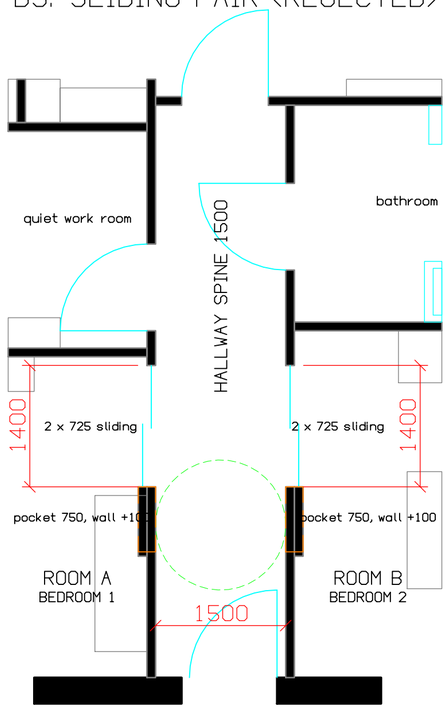

Opening 1400; two 725 leaves on two tracks stack into one 750 pocket south of the opening.
A double pocket needs about 200 finished wall: partition thickened 100 into each room over y 1700–2500.
Clear opening (estimate): 1360 with both leaves retracted.
Collision: thickening overlaps Room A wardrobe 1C2 by 0.07 m2; each room loses 0.08 m2.
No swing; hall clear width 1500. Pocket section takes no fixings; poorer acoustic seal; specialist hardware.
North pocket impossible (Q1 junction at y 4000, quiet-room door at 4300).
Double-door requirement: met.
DECISION: REJECTED (wall thickening, furniture clash, complexity).

Clear openings are ESTIMATES (hinged: leaf − 51 mm, from the ADM Vol 1 Table 2.1 Note 3 deemed-to-satisfy figure for an 826 mm leaf; sliding: opening − 40 mm) and REQUIRE CONFIRMATION from a door schedule. Applicable requirements (ADM M4(2) para 2.22 and Table 2.1, including Note 2 on double doors; Part B; Part E) REQUIRE CONFIRMATION for the intended building and use. Design study only: not an approved, compliant or construction-ready arrangement. Room A = Bedroom 1, Room B = Bedroom 2; the existing quiet-room, bathroom, front and living-room doors are shown unchanged.