

AUDIT TECHNICAL REPORT

REPORT-274

FORM PENGUKURAN (AUDIT)

A. GENERAL DATA

Room / Tenant	GODIVA	Design Air Temp	N/A (°C)
Unit Tag Number	DKN001694	Design Cooling Cap.	59000 (Btuh)
Machine Brand	MCQUAY (MCC 60)	Design Air Flow	0 (Cfm)
Machine Type	FCU/AHU	-	-

B. AIR SIDE MEASUREMENTS

Leaving Coil Temp.	19.1 (°C) DB	17.8 (°C) WB	88.7 % RH
Entering Coil Temp.	24.8 (°C) DB	21.1 (°C) WB	72.6 % RH

Cross-Section Area (m2)			Air Velocity (m/s) - 15 Points Matrix								
Supply	Return	Fresh Air	Supply			Return			Fresh Air		
600x330	1350x350	N/A	1. 6.09	2. 7.25	3. 5.51	1. 0	2. 0	3. 0	1. 0	2. 0	3. 0
			4. 5.26	5. 5.9	6. 6.32	4. 0	5. 0	6. 0	4. 0	5. 0	6. 0
			7. 5.71	8. 5.66	9. 5.8	7. 0	8. 0	9. 0	7. 0	8. 0	9. 0
			10. 5.66	11. 6.11	12. 5.82	10. 0	11. 0	12. 0	10. 0	11. 0	12. 0
			13. 5.72	14. 5.92	15. 6.08	13. 0	14. 0	15. 0	13. 0	14. 0	15. 0
			Avg: 5.92 m/s			Avg: 0.00 m/s			Avg: 0.00 m/s		
TOTAL CALCULATED AIR FLOW (Cfm)			2484			2418			-		

C. WATER SIDE

CHWS Temp	9.5 °C	CHWS Press	0 Bar
CHWR Temp	15.5 °C	CHWR Press	0 Bar
Flow Rate	0 m3/h	Pipe Size	N/A mm

D. ELECTRICAL

Current (A)	R: 2.42	S: 2.44	T: 2.32
Voltage (V)	RS: 392	ST: 395	RT: 391
Elect. Info	P: 0 kW	V L-N	22 V

PREPARED BY AUDITOR,

Name: Muhammad Yahya Ulumudin
Date: 9/4/2026

WITNESSED BY CUSTOMER,

Waiting for Signature

Name: -
Date:

AUDIT TECHNICAL REPORT

REPORT-274

Audit Documentation Photos

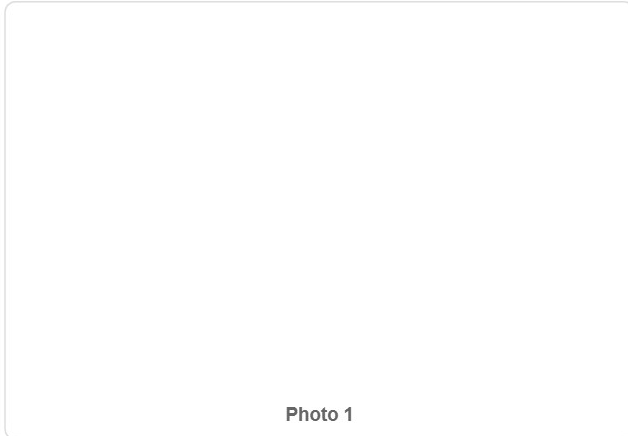


Photo 1