

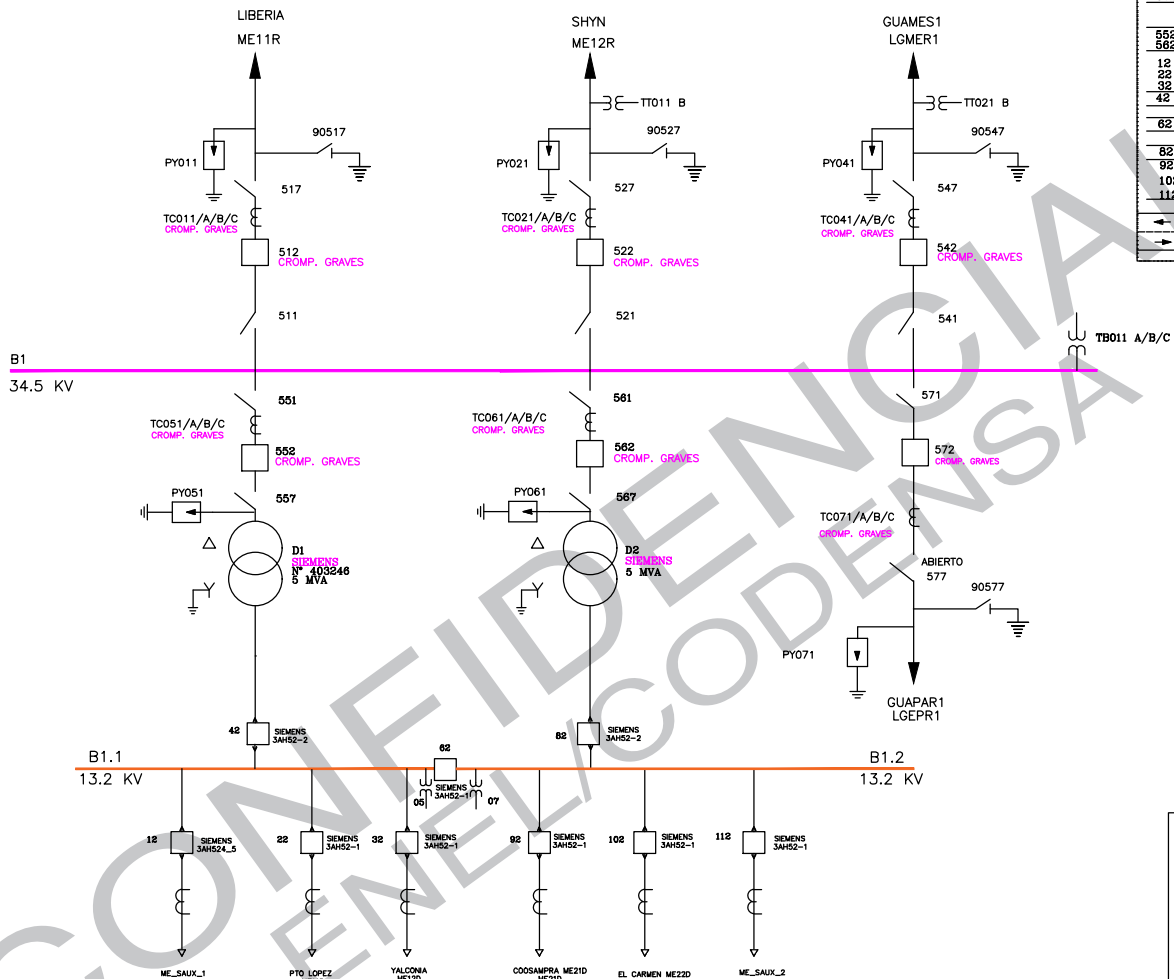


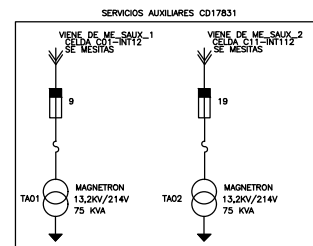

512	ME11R	LIBERIA	→
522	ME12R	SHYN	→
542	LGMER1	GUAMES1	→
572	LGEPR1	GUAPARI	→
MEDIDA B1			
552	D1	SIEMENS 5MVA	
562	D2	SIEMENS 5MVA	
12	ME11D	ME_SAU_X_1	C01
22	ME11D	PTO LOPEZ	C02
32	ME12D	YALCONIA	C03
42	D1	SIEMENS 5MVA	C04
MEDIDA B1.1			
62	ACOPLE	B1.1-B1.2 13.2KV	C05
MEDIDA B1.2			
82	D2	SIEMENS 5MVA	C06
92	ME21D	COOSAMPRA	C07
102	ME22D	EL CARMEN	C08
112	ME22D	ME_SAU_X_2	C09
C10			
C11			

← POTENCIA DE ENTRADA
→ POTENCIA DE SALIDA



Unidad Organizativa
Administración Informática
Técnica Col.

REVISION No.

11

FECHA:

OCTUBRE/2020

ARCHIVO:

MESITAS.DWG

\\COL.COD09FS01\FileServer\CONTROL UNIFILARES

DIAGRAMA UNIFILAR

SUBSTACION MESITAS

C.M/PAL EL COLEGIO CERCA A PISCINA YALCONIA

CODIGO:

ME

87

HOJA: 1

DE: 1